

# SIEMENS

VBS for Creating Procedures  
and Actions

1

ANSI-C for Creating  
Functions and Actions

2

VBA for Automated  
Configuration

3

## SIMATIC HMI

WinCC V7.4

WinCC: Scripting (VBS, ANSI-C,  
VBA)

System Manual

Print of the Online Help

02/2016

A5E37536061-AA

## Legal information

### Warning notice system

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

<b>! DANGER</b>
indicates that death or severe personal injury <b>will</b> result if proper precautions are not taken.

<b>! WARNING</b>
indicates that death or severe personal injury <b>may</b> result if proper precautions are not taken.

<b>! CAUTION</b>
indicates that minor personal injury can result if proper precautions are not taken.

<b>NOTICE</b>
indicates that property damage can result if proper precautions are not taken.

If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

### Qualified Personnel

The product/system described in this documentation may be operated only by **personnel qualified** for the specific task in accordance with the relevant documentation, in particular its warning notices and safety instructions. Qualified personnel are those who, based on their training and experience, are capable of identifying risks and avoiding potential hazards when working with these products/systems.

### Proper use of Siemens products

Note the following:

<b>! WARNING</b>
Siemens products may only be used for the applications described in the catalog and in the relevant technical documentation. If products and components from other manufacturers are used, these must be recommended or approved by Siemens. Proper transport, storage, installation, assembly, commissioning, operation and maintenance are required to ensure that the products operate safely and without any problems. The permissible ambient conditions must be complied with. The information in the relevant documentation must be observed.

### Trademarks

All names identified by ® are registered trademarks of Siemens AG. The remaining trademarks in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

### Disclaimer of Liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

# Table of contents

<b>1</b>	<b>VBS for Creating Procedures and Actions.....</b>	<b>11</b>
1.1	VBS for creating procedures and actions.....	11
1.2	Using Visual Basic Script in WinCC.....	12
1.3	Modules and Procedures.....	15
1.4	Actions.....	18
1.5	Multiple Use of Procedures and Actions.....	20
1.6	Use of CrossReference.....	22
1.7	Using Global Tags in VBS.....	24
1.8	VBScript Editors.....	26
1.8.1	VBScript Editors.....	26
1.8.2	Global Script Editor.....	27
1.8.3	Working in an Editing Window.....	30
1.8.4	Working with the Toolbars.....	33
1.8.5	Deleting Actions or Procedures.....	35
1.9	Creating and Editing Procedures.....	36
1.9.1	Creating and Editing Procedures.....	36
1.9.2	Creating a New Procedure.....	39
1.9.3	How to Write Procedure Codes.....	41
1.9.4	Using Standard and Project Procedures.....	44
1.9.5	How to add module-related information.....	45
1.9.6	Protecting a Module with a Password.....	47
1.9.7	Saving a Procedure.....	48
1.9.8	Renaming a Procedure or Module.....	50
1.10	Creating and Editing Actions.....	52
1.10.1	Creating and Editing Actions.....	52
1.10.2	Creating a New Action.....	56
1.10.3	How to Edit Actions.....	57
1.10.4	How to add action-related information.....	60
1.10.5	Protecting an Action with a Password.....	62
1.10.6	Saving Actions.....	63
1.10.7	Triggers.....	64
1.10.7.1	Triggers.....	64
1.10.7.2	Animation trigger.....	68
1.10.7.3	How to add a trigger of the type "Timer".....	70
1.10.7.4	How to add a trigger of the type "Tag".....	72
1.10.7.5	How to change a trigger.....	74
1.10.7.6	How to delete a trigger.....	75
1.10.8	How to Rename an Action.....	76
1.11	How to activate global actions in Runtime.....	78
1.12	Diagnostics.....	80

1.12.1	Diagnostics.....	80
1.12.2	GSC Diagnostics.....	81
1.12.2.1	GSC Diagnostics.....	81
1.12.2.2	Inserting the GSC Diagnostics Window into a Picture.....	82
1.12.2.3	GSC Diagnostics Attributes.....	82
1.12.2.4	GSC Diagnostics Toolbar.....	83
1.12.3	GSC Runtime.....	84
1.12.3.1	GSC Runtime.....	84
1.12.3.2	How to insert the GSC Runtime Window into a Picture.....	85
1.12.3.3	GSC Runtime Attributes.....	86
1.12.4	Testing with the Debugger.....	87
1.12.4.1	Testing with the Debugger.....	87
1.12.4.2	How to Activate the Debugger.....	89
1.12.4.3	Principles of Debugging.....	90
1.12.4.4	Structure of VBScript Files.....	92
1.12.4.5	Action and Procedure Names in the Debugger.....	94
1.12.4.6	Selecting a Script for Editing.....	96
1.12.4.7	Processing Scripts Step-by-Step.....	97
1.12.4.8	Setting Breakpoints.....	98
1.12.4.9	Deleting Breakpoints.....	99
1.12.4.10	How to Set Bookmarks in Scripts.....	100
1.12.4.11	How to Determine and Modify Tag and Property Values.....	101
1.12.4.12	Executing Script Commands.....	102
1.13	Printing VBScripts.....	104
1.14	VBS Reference.....	105
1.14.1	VBS Reference.....	105
1.14.2	Objects and Lists.....	107
1.14.2.1	Objects and Lists.....	107
1.14.2.2	Alarm object.....	110
1.14.2.3	Alarms object (list).....	110
1.14.2.4	AlarmLogs Object.....	112
1.14.2.5	Dataltem Object.....	113
1.14.2.6	DataLogs Object.....	114
1.14.2.7	DataSet Object (List).....	116
1.14.2.8	HMIRuntime Object.....	118
1.14.2.9	Item Object.....	119
1.14.2.10	Layer Object.....	120
1.14.2.11	Layers Object (Listing).....	121
1.14.2.12	Logging Object.....	122
1.14.2.13	ProcessValue Object.....	123
1.14.2.14	ProcessValues Object (List).....	124
1.14.2.15	Project Object.....	124
1.14.2.16	ScreenItem Object.....	125
1.14.2.17	ScreenItems Object (List).....	129
1.14.2.18	Screen Object.....	131
1.14.2.19	Screens Object (List).....	134
1.14.2.20	SmartTags Object.....	136
1.14.2.21	Tag Object.....	137
1.14.2.22	Tags Object (List).....	140
1.14.2.23	TagSet Object (List).....	141
1.14.3	Object types of the ScreenItem object.....	143

1.14.3.1	Object types of the ScreenItem object.....	143
1.14.3.2	Standard objects.....	144
1.14.3.3	Smart objects.....	169
1.14.3.4	Windows objects.....	201
1.14.3.5	Tube objects.....	215
1.14.3.6	Controls.....	218
1.14.3.7	Customized Object.....	298
1.14.3.8	Group.....	300
1.14.4	Properties.....	301
1.14.4.1	Properties.....	301
1.14.4.2	A.....	302
1.14.4.3	B.....	321
1.14.4.4	C.....	362
1.14.4.5	D.....	397
1.14.4.6	E.....	407
1.14.4.7	F.....	416
1.14.4.8	G.....	438
1.14.4.9	H.....	442
1.14.4.10	I.....	451
1.14.4.11	L.....	457
1.14.4.12	M.....	488
1.14.4.13	N.....	509
1.14.4.14	O.....	512
1.14.4.15	P.....	528
1.14.4.16	Q.....	546
1.14.4.17	R.....	547
1.14.4.18	S.....	557
1.14.4.19	T.....	595
1.14.4.20	U.....	671
1.14.4.21	V.....	680
1.14.4.22	W.....	697
1.14.4.23	X - Z.....	702
1.14.5	Methods.....	710
1.14.5.1	Methods.....	710
1.14.5.2	Methods A to E.....	712
1.14.5.3	Get methods.....	720
1.14.5.4	Methods H to M.....	769
1.14.5.5	Methods N to R.....	779
1.14.5.6	Methods S to T.....	797
1.14.5.7	Methods U to Z.....	812
1.14.6	Appendix.....	820
1.14.6.1	Error Messages from Database Area.....	820
1.15	Examples of VBScript.....	823
1.15.1	Examples of VBScript.....	823
1.15.2	Examples in WinCC.....	823
1.15.2.1	Examples in WinCC.....	823
1.15.2.2	Example: Accessing objects in Graphics Designer.....	824
1.15.2.3	Example: Defining the color of objects.....	825
1.15.2.4	Example: How to Configure Language Changes.....	825
1.15.2.5	Example: Deactivating Runtime.....	826
1.15.2.6	Example: Configuring change picture globally.....	826
1.15.2.7	Example: Configuring Change Picture Via Property.....	827

1.15.2.8	Example: Configuring diagnostics output via Trace.....	827
1.15.2.9	Example: Writing tag values.....	828
1.15.2.10	Example: How to Read Tag Values.....	830
1.15.2.11	Example: Writing Object Properties.....	833
1.15.2.12	Example: How to Start an Action on the Server (Logging Object).....	836
1.15.2.13	Example: You connect or disconnect a database backup with VBS.....	838
1.15.2.14	Dynamization of Controls.....	841
1.15.3	General Examples.....	855
1.15.3.1	General examples for VBScript.....	855
1.15.3.2	Example: Configuring a Database Connection with VBS.....	856
1.15.3.3	Example: Using the MS Automation interface.....	858
1.15.3.4	Example: Starting an external application.....	859
1.16	Basic Principles of VBScript.....	861
1.16.1	Basic Principles of VBScript.....	861
1.16.2	VBScript Basics.....	861
<b>2</b>	<b>ANSI-C for Creating Functions and Actions.....</b>	<b>863</b>
2.1	Creating Functions and Actions with ANSI-C.....	863
2.2	Creating Functions and Actions.....	864
2.3	Characteristics of Project Functions.....	867
2.4	Characteristics of Standard Functions.....	868
2.5	Characteristics of Internal Functions.....	870
2.6	Characteristics of Local Actions.....	871
2.7	Characteristics of Global Actions.....	872
2.8	How to Add Global Script Runtime to a Project's Startup List.....	873
2.9	Use of Global C-Tags.....	874
2.10	Use of DLLs in Functions and Actions.....	876
2.11	The Global Script Editor.....	878
2.11.1	The Global Script Editor.....	878
2.11.2	Working in the Edit Window.....	880
2.11.2.1	Working in the Edit Window.....	880
2.11.2.2	Editing Functions with the Keyboard.....	881
2.11.2.3	Editing Functions with the Mouse.....	882
2.11.3	Working with the Toolbars.....	882
2.11.4	How to Set Different Views.....	885
2.11.5	How to Set the Font Style.....	885
2.11.6	How to Use "Save As...".....	886
2.11.7	How to Delete Actions or Project and Standard Functions.....	887
2.11.8	How to Generate a New Header.....	887
2.11.9	How to Compile All Functions.....	888
2.11.10	How to Search in Files.....	889
2.11.11	Printing Functions and Actions.....	890
2.11.11.1	Printing Functions and Actions.....	890
2.11.11.2	How to Set the Print Parameters.....	890
2.11.11.3	How to Open Page View.....	891
2.11.11.4	How to Print the Project Documentation.....	891

2.12	Creating and Editing Functions.....	892
2.12.1	Creating and Editing Functions.....	892
2.12.2	How to Create a New Function.....	895
2.12.3	How to Write Function Code.....	896
2.12.4	How to Use Internal Functions.....	897
2.12.5	How to Use Standard and Project Functions.....	897
2.12.6	Inserting Additional Function-Related Information.....	898
2.12.7	How to Protect a Function Against Unauthorized Access.....	900
2.12.8	How to Compile and Save a Function.....	901
2.12.9	How to Rename a Function.....	902
2.12.10	How to Use Functions from Other Sources.....	903
2.13	Creating and Editing Actions.....	905
2.13.1	How To Create and Edit Actions.....	905
2.13.2	WinCC Coding Rule.....	908
2.13.3	How to Create a New Action.....	909
2.13.4	How to Edit Actions.....	910
2.13.5	How to add action-related information.....	910
2.13.6	How to Protect an Action Against Unauthorized Access.....	912
2.13.7	How to Compile and Save an Action.....	913
2.13.8	Triggers.....	914
2.13.8.1	Triggers.....	914
2.13.8.2	How to Add a New Trigger of the "Timer" Type.....	917
2.13.8.3	How to Add a New Trigger of the "Tag" Type.....	918
2.13.8.4	How to change a trigger.....	920
2.13.8.5	How to delete a trigger.....	921
2.13.9	How to Assign Authorizations.....	922
2.13.10	How to Export an Action.....	922
2.13.11	How to Import an Action.....	923
2.13.12	How to Rename an Action.....	924
2.13.13	How to Use Actions From Other Sources.....	925
2.14	Runtime Behavior of Actions.....	927
2.14.1	Runtime Behavior of Actions.....	927
2.14.2	GSC Runtime.....	928
2.14.2.1	GSC Runtime.....	928
2.14.2.2	How to Place GSC Runtime in a Process Picture.....	931
2.14.2.3	Attributes of GSC Runtime.....	932
2.14.2.4	How to Edit Actions.....	932
2.14.3	GSC Diagnose.....	933
2.14.3.1	GSC Diagnose.....	933
2.14.3.2	How to Place GSC Diagnose in a Process Picture?.....	934
2.14.3.3	Attributes of GSC Diagnose.....	935
2.14.3.4	The Toolbar of GSC Diagnose.....	935
2.15	ANSI-C function descriptions.....	937
2.15.1	IpszPictureName.....	937
2.15.2	Standard functions.....	937
2.15.2.1	Standard functions - short description.....	937
2.15.2.2	Alarm.....	938
2.15.2.3	Graphics.....	942
2.15.2.4	Obsolete functions.....	947
2.15.2.5	Report.....	999

2.15.2.6	WinCC.....	1002
2.15.2.7	Windows.....	1009
2.15.3	Internal functions.....	1010
2.15.3.1	Internal functions - short description.....	1010
2.15.3.2	allocate.....	1010
2.15.3.3	c_bib.....	1011
2.15.3.4	graphics.....	1095
2.15.3.5	tag.....	1408
2.15.3.6	WinCC.....	1510
2.15.4	Examples.....	1517
2.15.4.1	Examles - A to G.....	1517
2.15.4.2	Examples - GetAlarmHigh to GetPropChar.....	1518
2.15.4.3	Examples - GetRangeMax to GetWidth.....	1534
2.15.4.4	Examples - H to S.....	1557
2.15.4.5	Examples - SetAlarmHigh to SetPropChar.....	1559
2.15.4.6	Examples - SetRangeMax to SetWidth.....	1569
2.15.4.7	Examples of WinCC controls.....	1579
2.15.4.8	Examples - Obsolete functions.....	1582
2.15.5	Lists.....	1590
2.15.5.1	Bar direction.....	1590
2.15.5.2	Bar Scaling.....	1590
2.15.5.3	Flash frequencies.....	1590
2.15.5.4	I/O field, output format.....	1591
2.15.5.5	I/O field, data type of the field content.....	1592
2.15.5.6	I/O field, field type.....	1592
2.15.5.7	Element alignment in check boxes and radio boxes.....	1592
2.15.5.8	Color chart.....	1592
2.15.5.9	Format descriptors.....	1593
2.15.5.10	Fill pattern.....	1594
2.15.5.11	Line styles.....	1595
2.15.5.12	Line end style.....	1595
2.15.5.13	List types.....	1596
2.15.5.14	Language ID.....	1596
2.15.5.15	Text alignment.....	1597
2.15.5.16	Tag statuses.....	1598
2.15.6	Structure definitions.....	1599
2.15.6.1	Structure definition CCAPErrExecute.....	1599
2.15.6.2	Structure definition CCAPTime.....	1600
2.15.6.3	Structure definition CMN_ERROR.....	1601
2.15.6.4	Structure definition DM_TYPEREF.....	1602
2.15.6.5	Structure definition DM_VAR_UPDATE_STRUCT.....	1603
2.15.6.6	Structure definition DM_VAR_UPDATE_STRUCTEX.....	1604
2.15.6.7	Structure definition DM_VARKEY.....	1605
2.15.6.8	Structure definition LINKINFO.....	1605
2.15.6.9	Structure definition MSG_FILTER_STRUCT.....	1607
2.15.6.10	Structure definition MSG_RTDATA_STRUCT.....	1610
<b>3</b>	<b>VBA for Automated Configuration.....</b>	<b>1613</b>
3.1	Automated configuration.....	1613
3.2	Introduction: Using VBA in WinCC.....	1614
3.2.1	Introduction: Using VBA in WinCC.....	1614
3.2.2	Differentiation: Using VBA.....	1614



3.2.3	Organizing VBA Code in a WinCC Project.....	1615
3.2.4	How to export and import VBA code.....	1618
3.2.5	Executing VBA Macros in Graphics Designer.....	1619
3.3	VBA in the Graphics Designer.....	1621
3.3.1	VBA in the Graphics Designer.....	1621
3.3.2	Adapting the Graphics Designer with VBA.....	1623
3.3.2.1	Adapting the Graphics Designer with VBA.....	1623
3.3.2.2	Language-Dependent Configuration with VBA.....	1624
3.3.2.3	Creating Customized Menus and Toolbars.....	1626
3.3.2.4	Accessing the component library with VBA.....	1646
3.3.3	Editing Pictures with VBA.....	1654
3.3.3.1	Editing Pictures with VBA.....	1654
3.3.3.2	How to Create Picture-specific Menus and Toolbars.....	1655
3.3.3.3	Editing Layers with VBA.....	1657
3.3.3.4	Editing a Copy of a Picture with VBA.....	1658
3.3.4	Editing Objects with VBA.....	1660
3.3.4.1	Editing Objects with VBA.....	1660
3.3.4.2	Default objects, Smart objects, Windows objects and Tube objects.....	1662
3.3.4.3	Group Objects.....	1674
3.3.4.4	Customized Objects.....	1682
3.3.5	Creating Dynamics with VBA.....	1686
3.3.5.1	Creating Dynamics with VBA.....	1686
3.3.5.2	Configuring Dynamics in the Properties of Pictures and Objects.....	1687
3.3.5.3	Configuring Event-Driven Actions with VBA.....	1699
3.3.5.4	Editing Triggers.....	1707
3.3.6	Event Handling.....	1709
3.3.7	Accessing External Applications with VBA.....	1713
3.3.7.1	Accessing External Applications with VBA.....	1713
3.3.7.2	Example: Accessing MS Excel with VBA.....	1714
3.4	VBA in the WinCC Configuration Studio.....	1725
3.4.1	VBA in the WinCC Configuration Studio.....	1725
3.4.2	Example: VBA in the WinCC Configuration Studio.....	1726
3.5	AddIns.....	1734
3.5.1	AddIns.....	1734
3.5.2	Linking Add Ins.....	1734
3.5.3	How to Configure an AddIn in the Graphics Designer.....	1737
3.5.4	Example: Creating Add Ins.....	1738
3.5.4.1	Example: Creating Add Ins.....	1738
3.5.4.2	Example: Creating an Add In with Visual Basic 6.0.....	1739
3.6	VBA Reference.....	1745
3.6.1	The object model of the Graphics Designer.....	1745
3.6.1.1	VBA Reference.....	1745
3.6.1.2	VBA Reference: ActionDynamic.....	1747
3.6.1.3	VBA Reference: HMIOjects.....	1749
3.6.1.4	VBA Reference: Languages.....	1751
3.6.1.5	Events.....	1752
3.6.1.6	Methods.....	1785
3.6.1.7	Objects and Lists.....	1894
3.6.1.8	Properties.....	2106
3.6.2	VBA in Other WinCC Editors.....	2560

3.6.2.1	VBA in Other WinCC Editors.....	2560
3.6.2.2	VBA in Tag Management.....	2562
3.6.2.3	VBA im Tag Logging.....	2573
3.6.2.4	VBA in the Text Library.....	2608
3.6.2.5	VBA in Alarm Logging.....	2622
<b>Index.....</b>		<b>2637</b>

# VBS for Creating Procedures and Actions

## 1.1 VBS for creating procedures and actions

### Contents

WinCC provides the possibility of dynamizing the Runtime environment using the Visual Basic Script. It is possible to use VBS to program global actions and procedures as well as dynamizing graphic objects and triggering actions in Runtime.

This chapter will show you

- How to work with VBScript editors
- How to create and edit procedures
- How to create and edit actions
- How to activate VBScripts in Runtime
- How to execute diagnostics on scripts in Runtime
- The object model of graphic Runtime system
- Detailed examples on using VBScript

## 1.2 Using Visual Basic Script in WinCC

### Introduction

In addition to the C script, WinCC also provides the VBScript program language as a programming interface in order to make the WinCC Runtime environment dynamic.

### Target Group of the Documentation

This documentation is aimed at project engineers with experience of Visual Basic or WinCC Scriptings (C) used to date.

### Application Options

VBScript (VBS) provides access to tags and objects of the graphical Runtime system at Runtime and can execute picture-independent functions:

- **Tags:** Tag values can be read and written in order, for example, to specify tag values for the PLC by clicking the mouse when positioned on a button.
- **Objects:** Object properties can be made dynamic using actions and actions can be triggered by events influencing objects.
- **Picture-independent Actions:** Picture-independent actions can be triggered cyclically or according to tag values, e.g. for the daily transfer of values into an Excel table.

VBS can be used at the following points in WinCC:

- **In the Global Script Editor:** This is used to configure picture-independent actions and procedures. The procedures can be used in picture-dependent and picture-independent actions. Several procedures are compiled in a topic-related module.
- **In Graphics Designer:** Picture-dependent actions can be configured with which the properties of graphic objects can be made dynamic or caused to respond to events in Runtime.
- **In user-defined menus and toolbars:** Here you configure procedures called in Runtime using the menu and toolbars.

---

#### Note

##### Updating Changed Configuration in Runtime

A changed VB script that is connected with "Menus and toolbars" is only updated after Runtime is restarted.

If you change the properties of "Menus and toolbars" in Runtime, the changes are only applied in the following cases:

- After a picture change, if the configuration change does not affect the basic picture.
  - When you load another configuration file and reload the modified configuration file.
-

## Registered Tags in Menus and Toolbars

The registered tags in the scripts of "Menus and toolbars" remain registered when you unselect the picture. If you read indirectly from a process mapping the tags are registered and unregistered again when you unselect the picture. However, registered tags in the scripts of "Menus and toolbars" remain registered when you unselect the picture.

## Application Scenarios

VBS can be used in Runtime, for example:

- to configure setpoint value specification for tags for the operation of a graphic object in order to define a value for the PLC by clicking a mouse, for example.
- to configure switching the Runtime language for the operation of a graphic object.
- to configure the change of color, e.g. cyclically (flashing) or to display statuses (motor on).

Apart from the specific WinCC applications, the general functionality of VBS can also be used to customize the Windows environment, e.g.:

- to transfer data to another application (e.g. Excel).
- to start external applications from WinCC.
- to create files and folders.

The automation objects in your environment are available with which to customize the Windows environment.

---

### Note

All the objects supplied with the Windows Script Host (WSH) from Microsoft can be integrated in the environment using the standard VBS method `CreateObject`. However, there is no direct access to the WSH object itself using VBS from WinCC.

There is no guarantee nor WinCC support for the VBS functionality with regard to its adaptation to the Windows environment.

---

## Limits to Other Programming Languages in WinCC

### VBS and C

VBScript can be used in WinCC parallel to C-Script, but do not mix the script types:

- VBScripts and C-scripts can be configured within a picture and project.
- C-scripts cannot be invoked in VBScripts and vice versa.
- VBS provides internal interfaces to tags and picture objects while the C environment enables access to other WinCC subsystems (e.g. the report system).

### VBS and VBA

VBA is used in WinCC Configuration during the configuration in order to adapt Graphics Designer to your individual requirements and to simplify and automate configuration. VBA programs only run in the WinCC configuration environment.

As opposed to VBA, VB scripts only run in WinCC Runtime and, from there, enable access to graphic objects and tags. Objects and pictures can be neither created nor modified on a permanent basis in VBS, as opposed to VBA.

The main language-related differences between VBA and VBS are e.g.:


- VBS was developed for use in Internet, VBA for the automation of software applications.
- The data type of VBS tags is always VARIANT. VBA, on the other hand, differentiates the individual data types such as INT, DOUBLE, STRING, etc.
- Certain language constructs from VBA have been removed from or added to VBS.
- Errors are handled differently in VBS compared to VBA.

A complete list of the differences between VBA and VBS is provided in the Appendix in "Basic Principles of VBScript".

### Procedures, Modules and Actions

VBS in WinCC allows the use of procedures, modules and actions to make the Runtime environment dynamic:


- **Procedures:** Codes are stored in procedures which are then used at several points in the configuration. Retrieve the code or another procedure in an action by invoking the procedure name. Procedures can be created in WinCC with or without return values. Procedures do not have their own trigger, they are always retrieved by an action.
- **Modules:** It is advantageous to compile related procedures to units in modules. Create modules for procedures, for example, which must be used in a specific picture or belong to a specific topic, such as auxiliary mathematical functions or database access functions.
- **Actions:** Actions are always activated by a trigger, namely a triggering event. Actions are configured in graphic object properties, in events which occur on a graphic object or globally in a project. Codes used several times can be called, in the form of procedures, in actions.

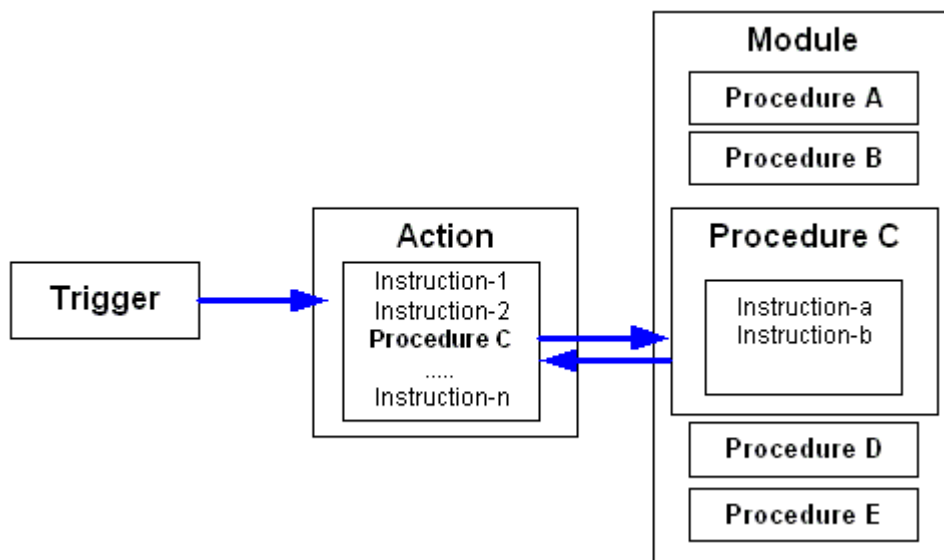

## 1.3 Modules and Procedures

### Introduction

Procedures are used to make code, created only once, available at several points in a project. Instead of entering the code several times, simply call in the corresponding procedure. The code is clearer and easier to maintain.

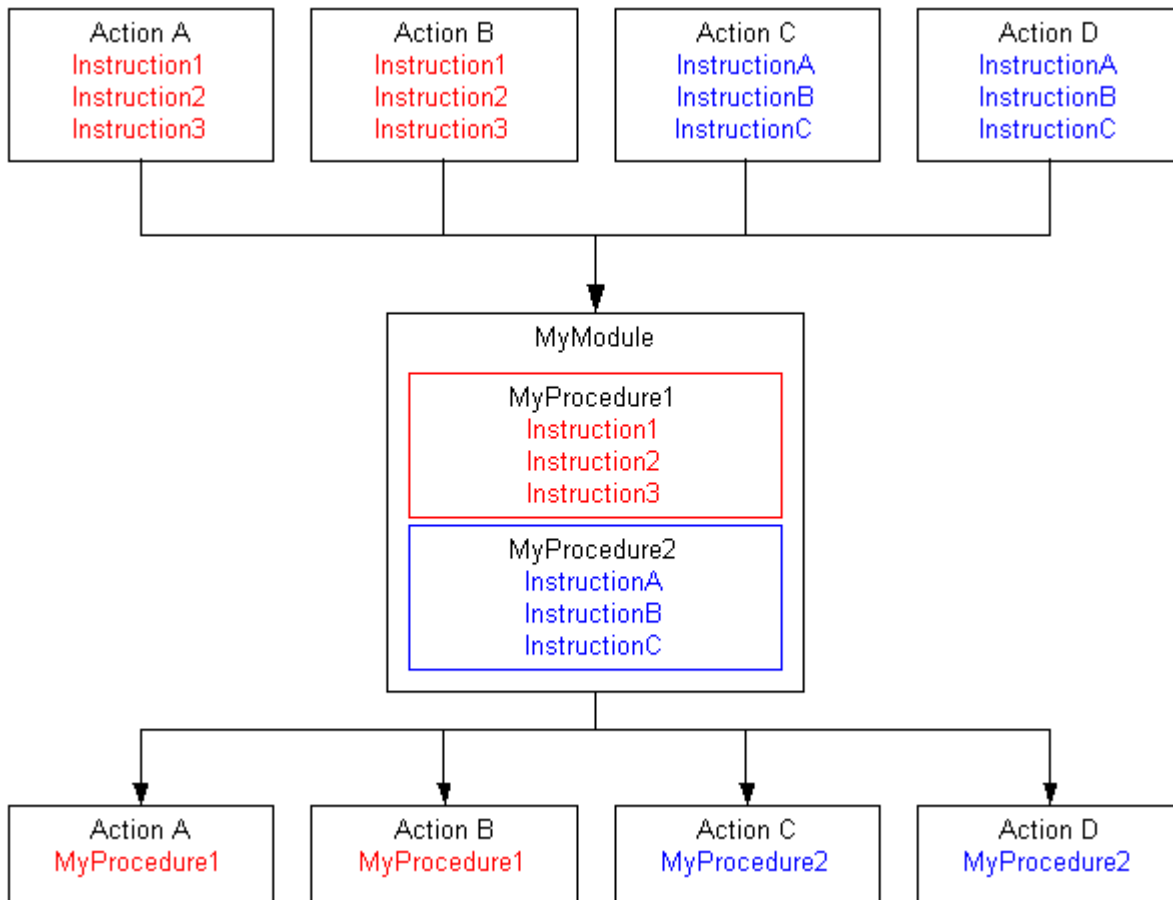


Related procedures should be stored in modules. When a certain procedure is retrieved via an action in Runtime, the module that contains that procedure is loaded. Observe the following when structuring the modules and procedures:

- The more modules that must be loaded when a picture is called in, the worse the performance in Runtime.
- The larger a module, the more procedures are contained and, thus, the longer the loading time for the module.

Organize the modules sensibly, e.g. a module with procedures for a specific system part/picture.

Another type of structuring of procedures in modules is the functional structuring, e.g. a module containing mathematical functions. Use this structure, for example, for modules which should be used globally for projects. The following example illustrates a module containing mathematical functions derived from the standard functions:

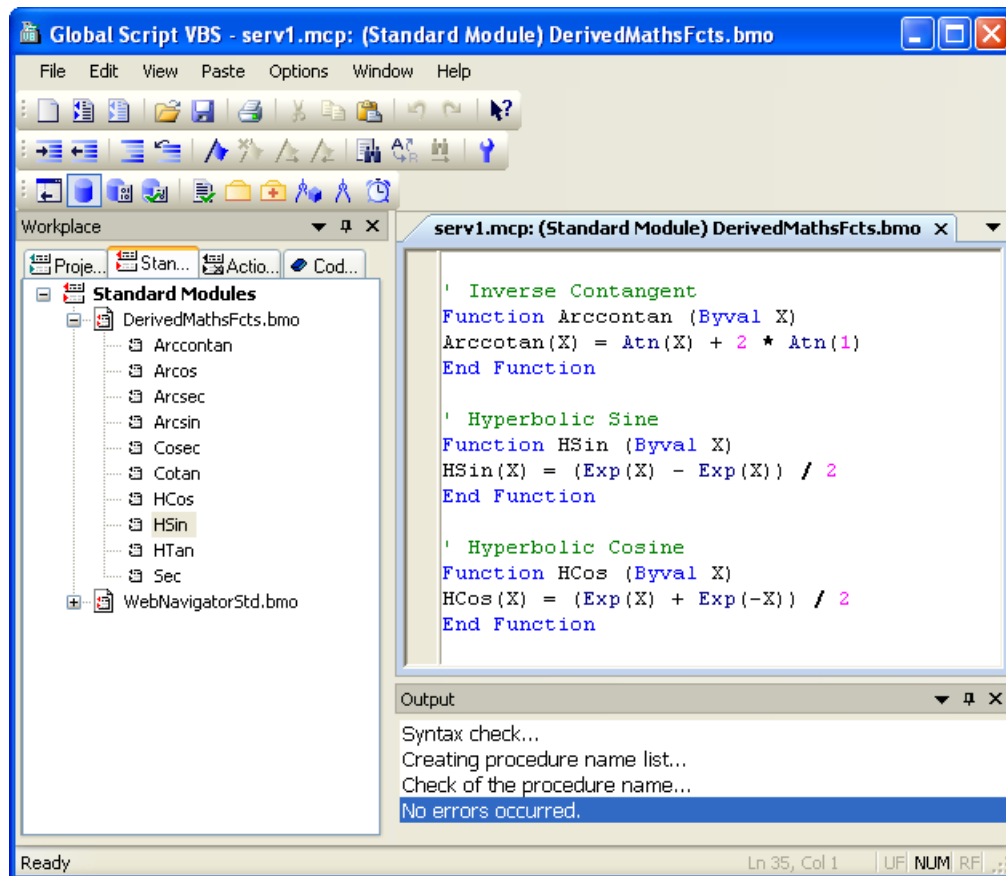

## Procedure Features

The procedures in WinCC have the following properties:

- They are created and modified by the user.
- They can be protected against modification and viewing by means of a password.
- They do not have a trigger.
- They are stored in a module.

WinCC does not provide predefined procedures, but does provide code templates and Intellisense, for example, to simplify programming. Procedures differ according to module assignment in:

- Standard procedures apply globally to projects located on the computer on which they were created.
- Project procedures can only be used within the project in which they were created.



## Module Features

A module is a file in which one or procedures is stored. The modules in WinCC have the following properties:

- They can be protected against modification and viewing by means of a password.
- They have the file extension \*.bmo.

Modules differ according to the validity of their procedures in:

- **Standard Modules:** Contain procedures which are globally available to the project. Standard modules are stored in the WinCC file system under: <WinCC-Installationsverzeichnis>\ApLib\ScriptLibStd\- **Project Modules:** Contain project-specific procedures. Project modules are stored in the WinCC file system under: <Projektverzeichnis>\ScriptLib\

---

### Note

If WinCC must be reinstalled and the standard procedures and modules need to be used again, save the module files prior to the reinstallation in a different directory and copy them in the relevant WinCC directory after the reinstallation has been completed. Otherwise, the standard modules in the WinCC installation directory are deleted during the installation routine.

---

## Using Procedures and Modules

Procedures are used in:

- Actions (in Graphics Designer and Global Script)
- Other procedures (in Global Script)
- User-defined menus and toolbars

Procedures are structured in modules.

## See also

Creating and Editing Procedures (Page 36)

VBScript Editors (Page 26)

Basic Principles of VBScript (Page 861)

Actions (Page 18)

Using Visual Basic Script in WinCC (Page 12)

## 1.4 Actions

### Introduction

An action is always started by a trigger. An action, for example, is triggered in Runtime when an object is operated by a mouse click, a certain time has occurred or a tag has been modified.

### Action Features

Actions are defined once in Global Script and then available independent of the picture. Global Script actions are only valid in the project in which they were defined. Actions linked to a graphic object are only valid in the picture in which they were defined.

---

#### Note

VBS does not currently allow the creation of computer-specific actions.

The following applies for clients in a multi-user system: All global actions configured on a server are also executed on a client when a project is opened.

The following applies to clients in a distributed system: If actions should be used on a client computer, copy all the action files in the corresponding project directory on the client.

---

Actions have the following properties:

- Actions are created and modified by the user.
- Actions in Global Script can be protected against modification and viewing by means of a password.
- Actions have at least one trigger.
- Actions in Global Script have the file extension \*.bac.
- Global Script actions are stored in the WinCC file system under: <Projektverzeichnis>\ScriptAct\Aktionsname.bac

### Action Trigger

Triggers are required to execute actions in Runtime. A trigger is linked to an action thus forming the triggering event which calls the action. Actions without triggers will not be carried out.

The following trigger types are available in WinCC:

- Timer: Acyclic or cyclic trigger, e.g. for calling a picture or every hour.
- Tags: Change of value
- Event: Modification of object properties (e.g. change of color) or event on an object (e.g. mouse click).

## Processing of Actions in Runtime

### In Graphics Designer

Two actions of the same type can be executed simultaneously in Runtime. In order, for example, that cyclic actions are not hindered by an action executed by a mouse click, event triggered actions and cyclic/tag triggered actions in Graphics Designer are executed independently of each other.

---

#### Note

Please note that synchronization between both action types in WinCC may only be executed by the DataSet object or by internal WinCC tags. As a result of the separate processing, no common data area exists between event triggered and cyclic/tag triggered actions.

---

If processing cyclic actions in pictures, for example, is prevented by a high system load or another action, the action is started once at the next opportunity. Cycles which are not executed are not retained in a queue but rejected.

After a change of picture, scripts still running are automatically stopped 1 minute after the change of picture.

Scripts which are still running when Runtime is terminated are stopped after 5 seconds.

### In Global Script

Picture-independent actions from Global Script are executed in Runtime in succession after being triggered. If an action is triggered while another action is in progress, the second action is retained in a queue until it can be executed.

---

#### Note

Please note that synchronization between actions in Global Script and in Graphics Designer may only be executed by the DataSet object or by internal WinCC tags. There is no common data area between the actions in Graphics Designer and in Global Script.

---

## Using the Actions

Actions can be used as follows:

- In Global Script The global actions defined here run picture-independent in Runtime.
- In Graphics Designer: The actions defined here only run in the configured picture. An action is configured in Graphics Designer on an object property or an event on a graphic object.

## See also

Creating and Editing Actions (Page 52)

Basic Principles of VBScript (Page 861)

Modules and Procedures (Page 15)

Using Visual Basic Script in WinCC (Page 12)

## 1.5 Multiple Use of Procedures and Actions

### Introduction

An action configured with VBS in WinCC is always valid for the project in which it was defined.

Procedures have the following areas of application:

- Standard procedures apply globally to projects located on the computer on which they were created.
- Project procedures can only be used in the project in which they were created. If a project is copied, the project procedures (modules) are copied together with the project.

### Multiple Use of Procedures and Actions

If actions or procedures/modules are to be used in other projects or on other computers, it is possible either to:

- use the "Save As" function to store the action or module in a different project directory or, for example, on a disk.
- to copy the action or module file in Windows Explorer and paste it in the corresponding project or standard directory on the target computer.

The properties and trigger configured are retained during copying. Copied modules are directly available in Runtime. Copied actions are executed in Runtime after they have been opened and stored once.

---

#### Note

Tags used in an action or procedure must also be available on the target computer. If the tag is not available, the action or procedure is not executed.

Procedures which are called in an action must be available on the target computer. If the procedure is not available, a Runtime error occurs during Runtime.

---

### Storing Procedures

If procedures need to be copied in other project directories in order to be able to use them in other projects or different computers, observe the storage path of the procedures in the WinCC file system:

- Standard procedures: <WinCC-Installationsverzeichnis>\ApLib\ScriptLibStd\Modulname.bmo
- Project procedures: <Projektverzeichnis>\ScriptLib\Modulname.bmo

---

#### Note

Since procedures are always stored in modules, always copy the module (\*.bmo) in which the procedure is contained.

---

The copied procedures/modules are visible after updating the Global Script navigation window (context menu command "Update") or restarting the editor.

## Storing Actions

If actions need to be copied in other project directories in order to be able to use them in other projects or different computers, observe the storage path of the actions in the WinCC file system:

<Projektverzeichnis>\ScriptAct\Aktionsname.bac

Each action is stored in a separate file. When an action is copied, all the triggers related to it are also copied.

---

### Note

Only actions created in Global Script are stored in the WinCC file system. Actions which are programmed in Graphics Designer are always stored with the current picture and cannot be transferred individually. If a Graphics Designer picture is copied into another project directory, the actions stored with the picture are also copied.

---

The copied actions are visible after updating the Global Script navigation window (context menu command "Update") or restarting the editor.

## See also

Modules and Procedures (Page 15)

Renaming a Procedure or Module (Page 50)

Saving a Procedure (Page 48)

Protecting a Module with a Password (Page 47)

How to add module-related information (Page 45)

Using Standard and Project Procedures (Page 44)

How to Write Procedure Codes (Page 41)

Creating a New Procedure (Page 39)

Creating and Editing Procedures (Page 36)

## 1.6 Use of CrossReference

### CrossReference and Tag Trigger

The CrossReference from WinCC can be used to quickly find all the application points of tags, even in VBS actions. Tag triggers in actions in Graphics Designer can be "linked" using CrossReference, i.e. replaced by other tags at all or selected points.

---

#### Note

Tags can also be directly linked in Graphics Designer by marking the graphic object and selecting the "Linking ..." command from the shortcut menu.

---

Further information on CrossReference is available in the WinCC documentation.

### Actions and CrossReference

All the actions used in a picture can be displayed by means of the picture properties. To do this mark the picture in WinCC Explorer and select the "Properties" shortcut menu command. After double clicking on an entry, detailed information on the type of dynamics appears.

It is also possible to display all the tags and pictures used in actions by means of the WinCC CrossReference. CrossReference can also be used for the to link tag connections of Graphics Designer actions easily.

### Tags and CrossReference

All tags addressed with the following standard formulation are automatically compiled by the CrossReference of WinCC and then listed in the picture properties.

```
' VBS1  
HMIRuntime.Tags("Tagname")
```

If tags are addressed with different formulations in the code, this can be notified by the following section of the CrossReference:

```
' WINCC:TAGNAME_SECTION_START  
Const TagNameInAction = "TagName"  
' WINCC:TAGNAME_SECTION_END
```

The section can be inserted in VBS actions as often as required.

---

#### Note

It is not possible to guarantee the compilation of combined tag names from the CrossReference.

---

## Pictures and CrossReference

All pictures addressed with the following standard formulation are automatically compiled by the CrossReference of WinCC and then listed in the picture properties.

```
'VBS2  
HMIRuntime.BaseScreenName = "Screenname"
```

If pictures are addressed with different formulations in the code, this can be notified by the following section of the CrossReference:

```
' WINCC:SCREENNAME_SECTION_START  
Const ScreenNameInAction = "ScreenName"  
' WINCC:SCREENNAME_SECTION_END
```

The section can be inserted in VBS actions as often as required.

---

### Note

Always enter picture names without the extension "PDL" for reasons of compatibility with future versions.

---

## See also

- VBS Reference (Page 105)
- VBScript Editors (Page 26)
- Basic Principles of VBScript (Page 861)
- Actions (Page 18)
- Modules and Procedures (Page 15)
- Using Visual Basic Script in WinCC (Page 12)

## 1.7 Using Global Tags in VBS

### Introduction

Global tags can be defined in the Global Script Editor which can then be used in all actions and procedures.

### Using Global Tags in Graphics Designer and Global Script

Observe the following conditions when using global tags in Graphics Designer and Global Script:

- In order to use a global tag in an action in Graphics Designer, call in the procedure in which the tag is defined so that the associated module is loaded in Runtime.
- In order to use a global tag in an action in Global Script, at least one procedure must be activated from the module in at least one global action in which the tag is defined so that the module is loaded in Global Script Runtime. This does not need to be the procedure in which the tag was defined.

This process is necessary because actions from Global Script and Graphics Designer are processed independently of each other in Runtime. There is no common data area between the two Runtime systems.

If you need to synchronize actions from Global Script and Graphics Designer, use the DataSet object or internal WinCC tags.

### Using Global Tags in Graphics Designer

When using global tags in Graphics Designer, observe the following conditions:

- In order to use a global tag in cyclic or tag triggered action in Graphics Designer, call in the procedure in which the tag is defined. This also applies when the tag has already been called in an event triggered action.
- In order to use a global tag in an event triggered action in Graphics Designer, call in the procedure in which the tag is defined. This also applies when the tag has already been called in a cyclic or tag triggered action.

This process is necessary because the cyclic/tag triggered actions and the event triggered actions in Graphics Designer in Runtime are processed independently of each other in Runtime. There is no common data area between the two types of action.

If you need to synchronize cyclic or tag-triggered actions and event-triggered actions, use the DataSet object or internal WinCC tags.

In the case of Graphics Designer, it is also possible to define global tags in a separate declaration section. Because event-triggered and cyclic/tag-triggered actions are processed separately in Runtime, the global tags can only be jointly addressed within the event-triggered or cyclic/tag-triggered actions.



**See also**

- Basic Principles of VBScript (Page 861)
- Structure of VBScript Files (Page 92)
- Creating and Editing Actions (Page 52)
- Creating and Editing Procedures (Page 36)
- VBScript Editors (Page 26)
- Use of CrossReference (Page 22)
- Actions (Page 18)
- Modules and Procedures (Page 15)


## 1.8 VBScript Editors

### 1.8.1 VBScript Editors


#### Introduction

VBScripts can be programmed at two points in WinCC:

- In Global Script Global Script is the central editor for VBS programming. Call it in via WinCC Explorer.

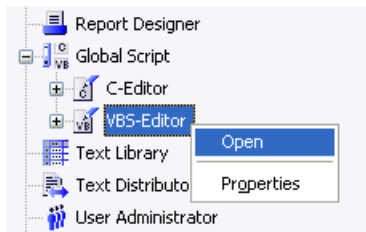

- In Graphics Designer: Graphics Designer can be used to program actions related to object properties or events related to graphic objects. The action editor in Graphics Designer is called in via the context menu in the Properties dialog of a graphic object.

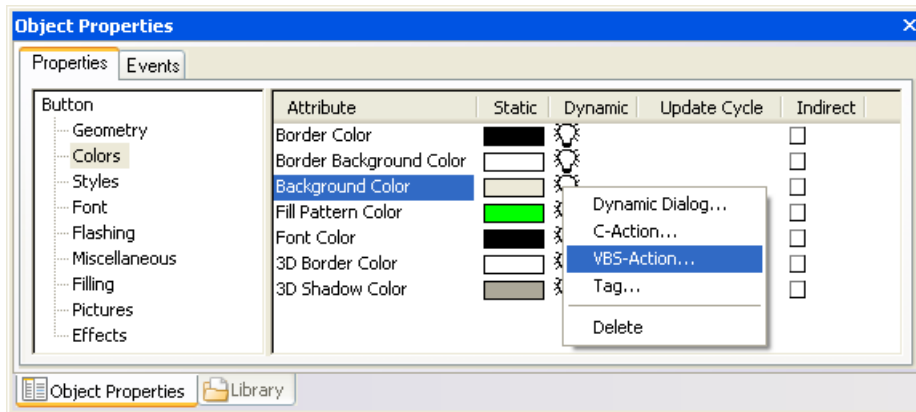

## Restrictions, Global Script - Graphics Designer

Graphics Designer can be used to program actions and picture-specific procedures but not global procedures valid for the entire project. However, global procedures which were programmed in Global Script can be called in.

---

### Note

This documentation is used primarily to describe Global Script and, if necessary, makes reference to deviations in the functionality compared to Graphics Designer. A detailed description of the Graphics Designer action editor is provided in the WinCC help topic "Dynamization".

---

## Further Information

Further information on "Dynamization" is available in the WinCC documentation.

## See also

Global Script Editor (Page 27)

## 1.8.2 Global Script Editor

### Introduction

Global procedures and actions are created and edited in the Global Script editor.

Global Script provides a similar range of functions to that of the C script editor in WinCC.

---


### Note

A detailed description of the action editor for the creation of picture-based actions and procedures in Graphics Designer is provided under the WinCC help topic "Dynamics".

---

## Starting Global Script

Global Script is started using the shortcut menu "Open" command in the WinCC Explorer project window.

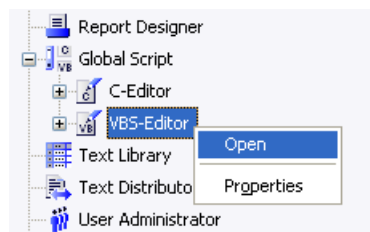


Global Script is also automatically started when a module or action is opened by means of a double click in WinCC Explorer.

## Design of Global Script

Global Script editor is designed in accordance with the Windows standards.

The action editor in the Graphics Designer provides a similar range of functions to that of Global Script. A description of the Graphics Designer action editor is provided in the WinCC help topic "Dynamization".

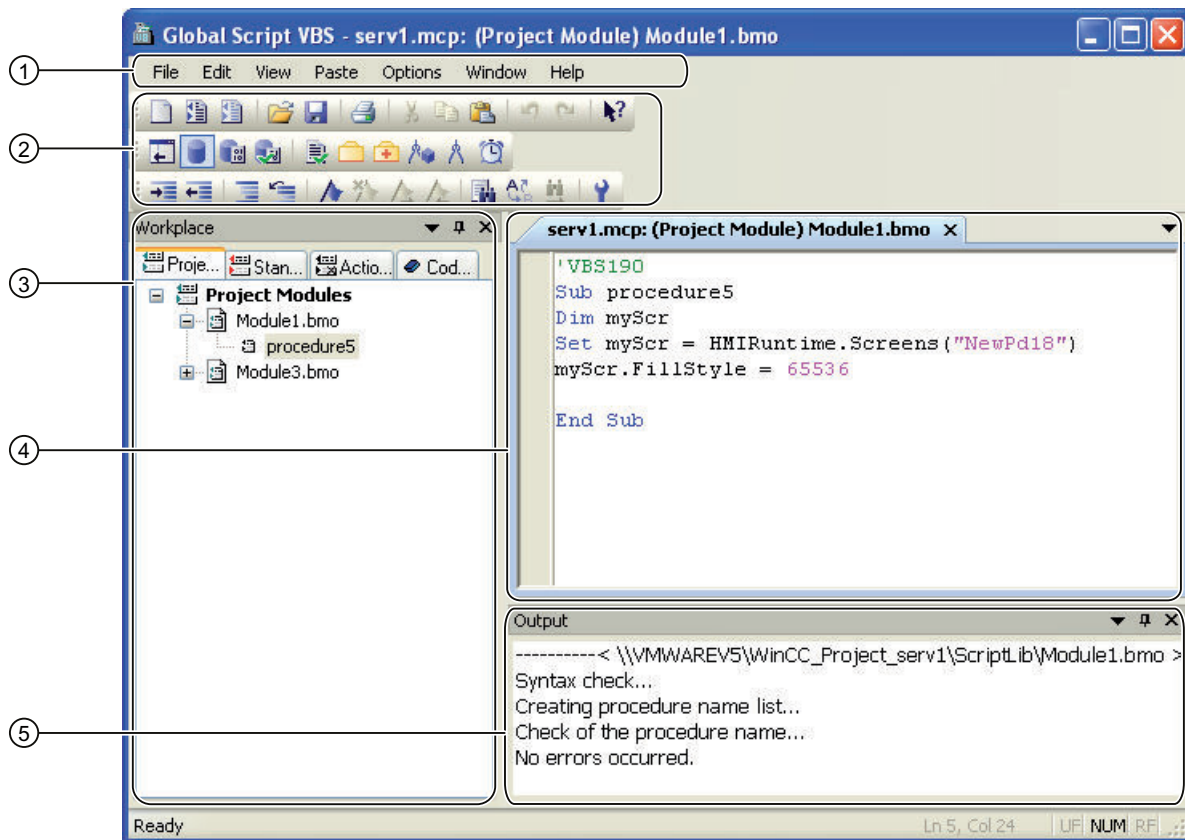

### Menu bar (1) and toolbars (2)

All the commands required to create procedures and actions are provided in the menu bar and toolbars.

The toolbars can be displayed and hidden using the "View" > "Toolbars" command and can be moved to any position within the editor.

### Navigation window (3)

In the navigation window you manage your procedures, modules and actions. In addition you can find here code templates which you can insert by drag&drop into your action or procedure.

A procedure can be called in another procedure or action by dragging them from the navigation window and dropping them at the relevant point in the code.

The display in the navigation window is always updated during the saving of the edited document. If you change a file, this will be displayed by a \* behind the file name.

The procedures contained in a module are displayed in the navigation window underneath the module file. The Actions tab control also displays the trigger and procedures configured for an action, if necessary those directly defined in an action module.

The navigation window can still be used to:

- Create subdirectories for structuring the scripts.
- Move, copy, paste, delete and rename modules and directories directly.

The display in the navigation window can be individually configured with the "View" > "Workplace" menu commands. It is possible to select whether all file types, only script files or only syntactically correct files should be displayed. The navigation window can be shown or hidden with the "View" > "Workplace" > "Display" menu commands.

#### **Editing window (4)**

You write and edit your actions in the editing window. Each procedure or action will be opened in its own editing window. Several editing windows can be open at the same time.

The user is supported by in the editing window by Highlight Syntax and Intellisense. All general editor functions (e.g. Undo/Redo, Find/Replace, Copy, Paste, Cut, Font Settings, Printer Settings) remain available.

#### **Output window (5)**

Error messages are displayed in the output window following the syntax check. Double click on the corresponding error line to access the related point in the code.

#### **Status bar (6)**

The status bar contains information on the currently selected functionality or hints on programming.

---

#### **Note**

If information on individual editor commands or icons is required, select the "?" menu icon. > "What's This?". Then click the mouse button on the corresponding icon/command. This provides fast, direct help on all the operating elements in the editors. Press "ESC" to exit "What's This?" help mode.

---

## **Window docking**

Window docking is a useful tool for the flexible arrangement of windows. It lets you reposition windows to obtain separate windows, or group windows in tab groups. For example, you can arrange your actions horizontally, vertically, or as tab group. You can automatically hide windows and show them again when needed.

## See also

Deleting Actions or Procedures (Page 35)

Working with the Toolbars (Page 33)


Working in an Editing Window (Page 30)

## 1.8.3 Working in an Editing Window

### Introduction

Procedures and actions are edited in the editing window.

### Declaration Areas in Actions (Graphics Designer only)

If you create actions in the Action Editor of Graphics Designer, you can display the declaration area of the action in the editing window using the button .

The declaration area can also be used to make general settings to be used globally for the current picture, e.g.:

- Tag Definitions
- Procedures which you only want to use in this picture

---

#### Note

Do not create any directly executable codes in the declaration area!

Please note that when creating a tag, it must not contain a value (Value = VT\_EMPTY). Initialize the tags after declaration with the corresponding value.

---

When making definitions in the declaration area, pay attention to the structure of the Script files, as described under "Structure of VBScript files".

### "Option explicit" in Actions

When creating a new action, the "Option explicit" instruction is automatically set and cannot be deleted in the declaration area (Graphics Designer) or entered in the first line of an action (Global Script). The instruction is necessary as it prevents errors caused by the incorrect notation of tags without declaration. The instruction requires that tags are always defined in your code with the "Dim" instruction.

---

#### Note

Do not use the "Option explicit" instruction in the code because it may cause Runtime errors.

---

### User Support in the Editing Window

The following functions are available to support working in the editing window.

### Color coding and indentation in the editing window

Certain parts of the code have the following default colors:

Color	Description	Example
blue	Key words Functions	Sub, End Sub, Next
green	Comments	' is a comment
red	Strings (character strings and digits)	"Object1"
dark blue	Preprocessor statements	--
bold black	Constants	<b>vbTrue, vbFalse</b>
black	Other codes	--

The color coding in the editing window can be customized by means of the editor settings. Select the "Tools" > "Options" menu commands and the "Script Editor Options" dialog to define the settings.

In order to organize the codes clearly, they can be structured by indentations. The "Script Editor Options" dialog can also be used to define the tabulator distance and Automatic Indent while writing.

### Intellisense and Highlight Syntax

During text entry, context-sensitive lists appear containing the properties, methods, and objects possible at the current code position. If you insert an element from the list, the required syntax is also indicated automatically.

---

#### Note

Full intellisense for all objects can only be utilized in the Graphics Designer if the list is accessed using the object name and the result is assigned to a tag. Otherwise, only a list of standard properties is offered.

Example of full intellisense:

```
Dim Tag
Set Variable = ScreenItems ("Kreis1")
Tag.
```

If picture window limits are exceeded during addressing, it is once again only the standard properties which are offered since the picture of the picture window is not loaded.

---

Highlight Syntax can be activated and deactivated in the "Script Editor Options" dialog. The dialog can be called in using the "Tools" > "Options" menu commands.

### General VBS Functions

Use the "Function List" command of the shortcut menu in the editing window to display a list of general VBS functions.

### Lists of Objects, Properties and Methods

Using the shortcut menu in the editing window, you can view a list of the possible objects by calling the "Object List" command in Graphics Designer. Global Script only provides the

"HMIRuntime" object in this list because there is no direct access to the objects of Graphics Designer.

Use the "Properties/Methods" command of the shortcut menu to call in a list of possible properties and methods.

The same lists can be called in with the key combination <CTRL + SPACEBAR> according to the context of the script.





### Code Templates

In the "Code templates" tab in the Navigation window of the Editor, you will find a selection of frequently used instructions, e.g., for loops and conditional instructions. The templates can be inserted in the procedure code with "drag-and-drop".

If you want to insert a code template into your code, you have to replace the "\_XYZ\_" placeholder in the templates with the respective data.





### Selection Dialogs

If WinCC tags or objects are used in the code, the following selection dialogs are available for use:

-  Opens a tag selection dialog and returns the selected tag name as the return value.
-  Opens a tag selection dialog and returns the tag name with an associated reference.
-  Opens a picture/object browser in which you can select a picture/object whose name is then used for the return value.
-  Opens a picture selection dialog for pictures and returns the picture name with the server prefix, if necessary.

### Bookmarks

Bookmarks can be set in the code to find certain parts in the code more easily:

-  Sets a bookmark in the line where the cursor is currently located.
-  Deletes all bookmarks in the active editing window.
-  Jumps ahead to the next bookmark in the code.
-  Jumps back to the last bookmark in the code.

### See also

Structure of VBScript Files (Page 92)

Global Script Editor (Page 27)















## 1.8.4 Working with the Toolbars

### Purpose




In their default position, the toolbars are located below the menu bar, at the top of the VBS editor. The buttons arranged on the toolbars enable quick, easy access to the functions provided in Global Script and the action editor in Graphics Designer.










Global Script/Graphics Designer provide the following toolbars:

### "Standard" toolbar











Button	Function	Key combination
	Creates a new project module (Global Script only)	<ALT+F1>
	Creates a new standard module (Global Script only)	<ALT+F2>
	Creates a new global action (Global Script only)	<ALT+F3>
	Opens an existing action or existing module (Global Script only)	<CTRL+O>
	Saves the content of the active editing window. This function is only available if an editing window is open. After saving the display in the navigation window is refreshed. (Global Script only)	<CTRL+S>
	Prints the contents of the active editing window as project documentation. This function is only available if an editing window is open.	<CTRL+P>
	Cuts the selected text and copies it to the clipboard. This function is only available if text has been selected.	<CTRL+X>
	Copies the selected text to the clipboard. This function is only available if text has been selected.	<CTRL+C>
	Pastes the contents of the clipboard at the location of the cursor. This function is only available if the clipboard is not empty.	<CTRL+V>
	Undoes the last of a maximum of 30 editor actions. This function is only available if an editor action has been executed.	<CTRL+Z>
	Redoes the last editor action that was undone. This function is only available if an editor action has been undone.	<CTRL+Y>
	Activates the direct help	F1

### "Editor" Toolbar Content

Button	Function	Key combination
	Indents the line, in which the cursor is located, one position to the right.	--
	Indents the line, in which the cursor is located, one position to the left.	--
	Marks the lines selected by the mouse as comments. If no lines have been selected by the mouse, the line in which the cursor is located is marked as a comment.	--



Button	Function	Key combination
	Removes the comment marking from the lines selected by the mouse. If no lines have been selected by the mouse, the comment marking in the line in which the cursor is located is removed.	--
	Sets a bookmarks in the current line. Actuating again removed the bookmark from the current line.	<CTRL+F9>
	Removes all bookmarks from the current code in the editing window.	<CTRL+SHIFT+F9>
	Moves the cursor one bookmark further.	<F9>
	Moves the cursor one bookmark back.	<SHIFT+F9>
	Opens the "Find" dialog for text search in the code.	<CTRL+F>
	Opens the "Replace" dialog for search and replace in the code.	<CTRL+H>
	Repeats the search process.	<F3>
	Opens the "Script editor options" dialog.	--

### Content of the "Edit" Toolbar

Button	Function	Key combination
	Selects the file in the navigation window to which the current editing window belongs (Global Script only).	--
	Displays all the files in the navigation window (Global Script only).	--
	Only displays the Script files in the navigation window (Global Script only).	--
	Only displays the syntactically correct files in the navigation window (Global Script only).	--
	Executes a Syntax Check in the code of the current editing window.	<F7>
	Opens a tag selection dialog returns the selected tag name as the return value.	<CTRL+U>
	Opens a tag selection dialog and returns the tag name with an associated reference.	<CTRL+W>
	Opens a picture/object browser in which a picture/object can be selected whose name is then used for the return value.	<CTRL+Q>
	Opens a picture selection dialog for pictures and returns the picture name, with the server prefix if necessary.	<CTRL+B>
	Opens the "Info/Trigger" dialog.	<CTRL+T>

### Additional Buttons in Graphics Designer

In addition to the buttons provided by Global Script, the action editor in Graphics Designer also has the following buttons:

-  Displaying the declaration area (<CTRL+E>)
-  Hiding the declaration area (<CTRL+A>)

**See also**

Global Script Editor (Page 27)

**1.8.5 Deleting Actions or Procedures****Introduction**

If an action, procedure or a module is deleted in a script editor, the code and corresponding file are deleted in the project directory.

Be careful only to delete procedures which are no longer used in other procedures or actions. If an action attempts to call in a procedure which no longer exists, the action is stopped in Runtime at the fault point. A non-existing reference in the code is not detected by the syntax check.

---

**Note**

Procedures can only be deleted within a module by deleting the code, not in the editor's navigation window.

---

**Procedure**

1. Open Global Script.
2. Select the action or module to be deleted in the navigation window.
3. Select the "Delete" command from the context menu.
4. To delete a procedure: Open the relevant module and delete the corresponding code in the editing window.

**See also**

Actions (Page 18)

Modules and Procedures (Page 15)

Global Script Editor (Page 27)

## 1.9 Creating and Editing Procedures

### 1.9.1 Creating and Editing Procedures

#### Introduction

Projects and standard procedures can be programmed in WinCC using VBS:

- Project procedures can only be retrieved in the current project. Since procedures are stored in the project directory, they are automatically copied when a project is copied.
- Standard procedures can be called in by all computers linked to a project. When a project is copied onto another computer, the standard procedures must be copied into the corresponding directory on the target computer manually.

The copied procedures are directly available for use in Runtime. They become visible in the editor when the view is updated.

Apart from the procedures programmed by yourself, general VBS functions can also be used (e.g. Abs, Array,... Year). These general VBS functions can be invoked in the code using the "Function List" command from the context menu.

In addition, WinCC provides the most popular instructions as code templates (e.g. If...Then, When...While). The code templates can be moved from the navigation window's Code Templates tab control directly into your code via drag&drop.

If you insert a code template into your code, it is important to note that, for example, conditions in the templates are identified by "\_XYZ\_". You must replace these placeholders with the appropriate information.

#### Using Procedures

Procedures are used for the central creation and maintenance of codes which are to be implemented at several points in the configuration. Codes are written and saved in a procedure and the procedure is called in with the current parameters in actions or other procedures instead of repeatedly entering the same code.


Create procedures for repeated functionalities, e.g.

- Calculations with different starting values (procedure with return value)
- Checking tag values (procedure with return value)
- Executing tasks (procedure with return value)

This is linked to the following advantages:

- The code is only programmed once.
- Modifications are only made at one point, namely in the procedure, not in each action.
- The action code is shorter and, thus, remains clearer.

Related procedures should be stored in modules in WinCC.

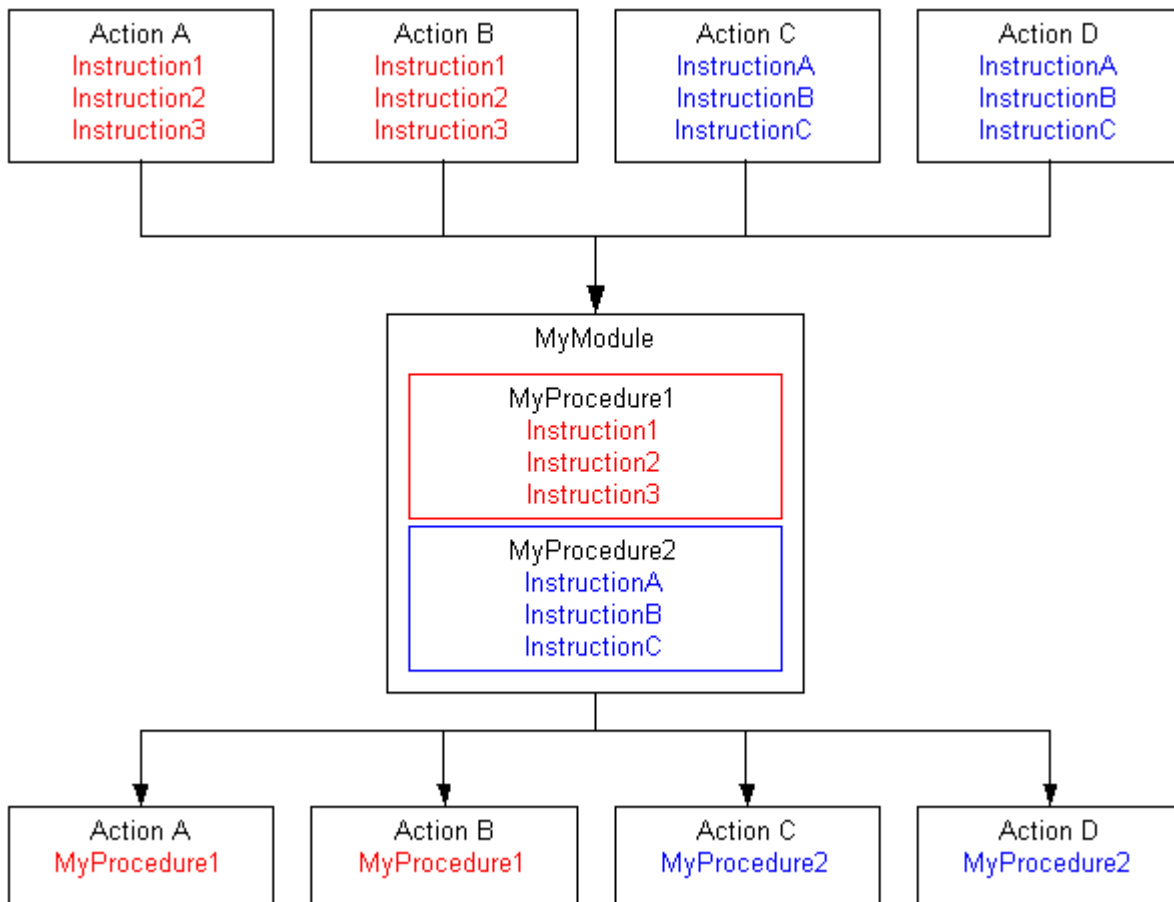

Procedures are loaded in Runtime when the calling action is executed.

If a procedure (module) used in a picture is modified, the modification is applied the next time the picture is loaded. This means that a picture currently displayed only works with the modified procedure after the picture has been reloaded.

After having a changed project module and saved the file in the VBS Editor, you must also open and save the corresponding process picture in Graphics Designer. Your changes are not

activated in Runtime unless you completed this action. By saving the the picture, you activate the information in the picture file by means of the necessary project modules.

---

**Note**

Procedures can be used in actions in Global Script and Graphics Designer.

In order to use a global tag defined in Global Script in an action in Graphics Designer, observe the following:

In order that access can be made to the tag, it is necessary to call in the procedure in which the tag is defined.

In order to use a global tag in picture-independent actions in Global Script, observe the following:

In order that access can be made to the tag, at least one procedure in the module containing the tag must be called in at least one global action.

---

### Procedure - Action Restrictions

Global procedures valid for the entire project can only be created in Global Script. Graphics Designer can only be used to create picture-specific procedures and call in global procedures in actions. Picture-specific procedures in Graphics Designer are defined in the declaration area of an action.

A procedure is not executed without an action.


### File Name and Procedure Name

The procedure name is entered in the first line of the procedure code. The procedure is displayed in the navigation window and called in actions under this name. Procedures do not have a file name of their own but are stored in a module.

Module names are assigned in the editor's navigation window. Use the "Save As" command to save a module under another name in the project directory.

Since procedures in Global Script are valid for the entire project, procedure names must always be unique. Module names can be used more than once within a project, e.g. in different subdirectories or stored separately in the standard and project directories.

### Displaying Procedures and Modules


 If you save a module that contains at least one syntactically incorrect procedure, this will be displayed in the navigation window with this adjacent symbol.

---

**Note**

If a module contains a syntactically incorrect procedure, the module can no longer be loaded. Procedures can no longer be called from the module.

---

 If you save a module that contains only syntactically incorrect procedures, this will be displayed in the navigation window with this adjacent symbol.

## Procedures and Modules

Procedures are classified as standard or project procedures according to their assignment to standard or project modules. Standard and project modules are located on the corresponding tab controls in the Global Script navigation window.

Use the modules in order to compile procedures to practical function groups. Observe the following when structuring the modules and procedures:

- The more modules that must be loaded when a picture is called in, the worse the performance in Runtime.
- The larger a module, the more procedures are contained and, thus, the longer the loading time for the module.

Organize the modules sensibly, e.g. a module with procedures for a specific system part/picture.

### See also

Multiple Use of Procedures and Actions (Page 20)

Renaming a Procedure or Module (Page 50)

Saving a Procedure (Page 48)

Protecting a Module with a Password (Page 47)

How to add module-related information (Page 45)

Using Standard and Project Procedures (Page 44)

How to Write Procedure Codes (Page 41)

Creating a New Procedure (Page 39)

Examples of VBScript (Page 823)

Modules and Procedures (Page 15)

## 1.9.2 Creating a New Procedure

### Introduction

Standard projects and procedures can be programmed with Global Script in WinCC.

The type of procedure is defined by the assignment to a project or standard module. The procedure to create standard or project procedures is identical.

On creating a new procedure, WinCC automatically assigns a standard name "procedure#", in which case # represents a continuous number. If the procedure is edited in the editing window,

assign the procedure a corresponding name via which the procedure can be called in an action later. The name appears in the navigation window when the procedure is saved.


**Note**

Procedure names must be unique within a project. If a procedure with the same name already exists, the module is identified as syntactically incorrect. Module names can be used twice when the modules are stored in different directories.

Global procedures (valid for the for entire project) can only be programmed Global Script. Procedures can be called via actions in Graphics Designer and picture-related procedures created in the declaration area of an action. Using a global action in Global Script, it is possible to create procedures directly in the code which are then only applicable for this action.

An action must be programmed in order to call in a procedure.

**Procedure**

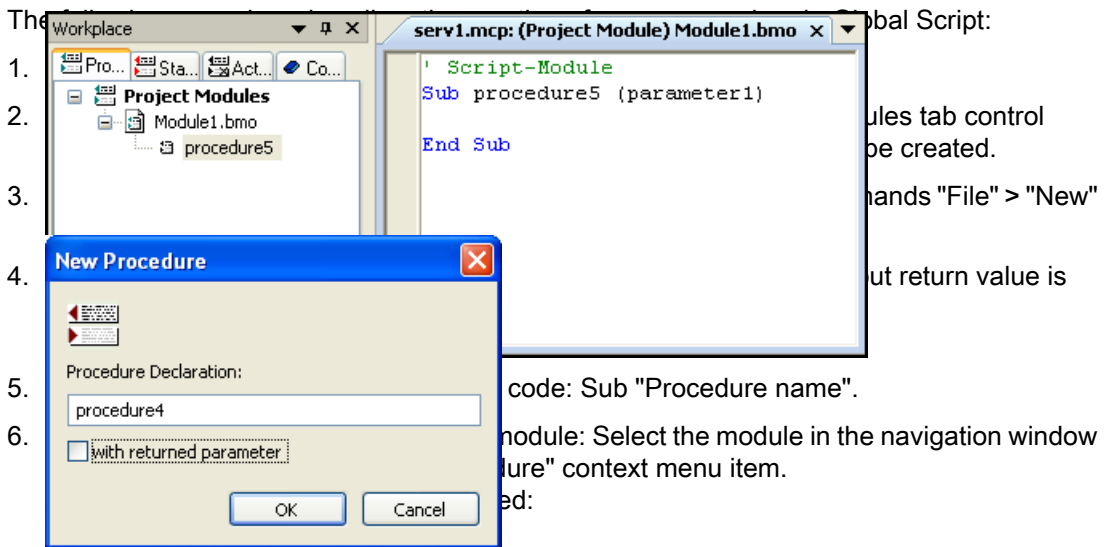

7. Enter a procedure name and select whether the procedure should have a return value parameter. The definition of a tag for the return value is then entered in the code (Dim RetVal).
8. Confirm your settings with OK.

**Note**

A new procedure can also be entered directly in a module. In the case of procedures without return value, always begin with the instruction "Sub " and <Procedure Name> and conclude with "End Sub". In the case of procedures with return value, always begin with the instruction "Function " and <Procedure Name> and conclude with "End Function". The new procedure is displayed in the navigation window when the module is saved.



## See also

Creating and Editing Procedures (Page 36)  
Multiple Use of Procedures and Actions (Page 20)  
Renaming a Procedure or Module (Page 50)  
Saving a Procedure (Page 48)  
Protecting a Module with a Password (Page 47)  
How to add module-related information (Page 45)  
Using Standard and Project Procedures (Page 44)  
How to Write Procedure Codes (Page 41)  
Modules and Procedures (Page 15)

## 1.9.3 How to Write Procedure Codes

### Introduction

Procedure codes are written in the Global Script editor window. The code of each procedure can call in other procedures via their procedure names.

Procedures can be created with or without return values. Use the return value to receive information about successful execution of the procedure, for example.

If you modify a procedure in a picture, the modification will not take effect until the next time you load the picture.

### Functions in Global Script

Global Script provides the following functions to support the creation of procedure codes:

### Intellisense and Highlight Syntax

During text entry, context-sensitive lists appear containing the properties, methods, and objects possible at the current code position. If you insert an element from the list, the required syntax is also entered automatically.

---

#### Note

Full intellisense for all objects can only be utilized in the Graphics Designer if the list is accessed using the object name and the result is assigned to a tag. Otherwise, you are only offered a list of standard properties.

Example of a full intellisense:

```
Dim Variable
Set Variable = ScreenItems ("Circle1")

Variable.<Intellisense selection>
```

If picture window limits are exceeded during addressing, it is once again only the standard properties which are offered since the picture of the picture window is not loaded.

---

### General VBS Functions

Use the "Function List" command of the shortcut menu in the editing window to display a list of general VBS functions.

### Lists of Objects, Properties and Methods

Using the shortcut menu in the editing window, you can view a list of the possible objects by calling the "Object List" command in Graphics Designer. Global Script provides only the "HMIRuntime" object in this list because there is no direct access to the objects of Graphics Designer.

Use the "Properties/Methods" command of the shortcut menu to call a list of possible properties and methods.

The same lists can be called in with the key combination <CTRL + SPACEBAR> according to the context of the script.



### Code Templates



In the "Code templates" tab in the Navigation window of the Editor, you will find a selection of frequently used instructions, e.g. for loops and conditional instructions. The templates can be inserted in the procedure code with "drag-and-drop".

If you want to insert a code template into your code, you have to replace the "\_XYZ\_" placeholder in the templates with the respective data.

### Selection Dialogs

If WinCC tags or WinCC objects are used in the code, the following selection dialogs are available for use:

-  Opens a tag selection dialog and returns the selected tag name as the return value.
-  Opens a tag selection dialog and returns the tag name with an associated reference.

-  Opens a picture/object browser in which a picture/object can be selected whose name is then used for the return value.
-  Opens a picture selection dialog for pictures and returns the picture name, with the server prefix if necessary.

### Syntax Check

Global Script supports you with a syntax check which you can perform after the code has been created. Syntax errors in the code are displayed in the output window of the editor. You can move to the erroneous point in the code by double-clicking the error in the output window.

---

### Note

The syntax check can only detect syntax errors in the code. Programming errors, such as missing references, only become visible in Runtime. You should therefore also always check your scripts in the Runtime environment.

---

## Changing a Procedure

If a procedure is modified during Runtime, the modification becomes active at the following times:

- Procedures called from actions or other procedures in pictures become active following a picture change.
- Procedures in Global Script become active directly after being called again.

## Procedure

1. Open Global Script.
2. Open the module containing the procedure to be edited.
3. After double clicking on the procedure in the navigation window, the cursor skips to the beginning of the required procedure.
4. Edit the procedure. If you create a procedure with a return parameter, e.g. to program recurring evaluations or reviews, indicate the return value with "procedurename =RetVal" at the end of the procedure.

## See also

[How to Write Procedure Codes \(Page 41\)](#)

[Multiple Use of Procedures and Actions \(Page 20\)](#)

[Renaming a Procedure or Module \(Page 50\)](#)

[Saving a Procedure \(Page 48\)](#)

[Protecting a Module with a Password \(Page 47\)](#)

[How to add module-related information \(Page 45\)](#)

[Creating a New Procedure \(Page 39\)](#)

Modules and Procedures (Page 15)

Creating and Editing Procedures (Page 36)

## 1.9.4 Using Standard and Project Procedures

### Introduction

Use the drag&drop function in the navigation window or the context menu to insert a procedure in the current code.

Project procedures can only be used within the current project, standard procedures are available for all projects on the computer.

Procedures, once created, can be used in other projects or on other computers. To do this, copy the module containing the procedures in the appropriate project or standard directory.

### Using Procedures in Graphics Designer and Global Script

Procedures defined in Global Script can be called in actions in Global Script and Graphics Designer. On executing the action in Runtime, the entire module which contains the procedure is loaded.

Please observe the following in order to use a global tag defined in a procedure in Global Script:

When using Graphics Designer, always call the procedure in which the tag is defined so that the tag can be used. If the procedure is not called in, the corresponding module is not loaded and access cannot be made to the tag.

In the case of picture-independent actions in Global Script, at least one procedure in the module containing the tag must be called in at least one global action.

---

#### Note

In the general declaration part of screens, no check is made whether a procedure or function name has already been assigned. Therefore, a name could occur several times and it is not defined which function will be executed. This is standard behavior of the MS Scripting Engine.

---

### Procedure

1. Open the procedure or action in which the procedure should be inserted.
2. Use the drag&drop function to move the procedure to be inserted from the navigation window to the correct position in the code.  
or
3. Place the cursor at the position in the code where you would like to insert the procedure.
4. Mark the procedure in the navigation window with the mouse.
5. Choose pop-up menu command "Transfer Procedure Retrieval".

## See also

Creating and Editing Procedures (Page 36)  
Multiple Use of Procedures and Actions (Page 20)  
Renaming a Procedure or Module (Page 50)  
Saving a Procedure (Page 48)  
Protecting a Module with a Password (Page 47)  
How to add module-related information (Page 45)  
How to Write Procedure Codes (Page 41)  
Creating a New Procedure (Page 39)  
Modules and Procedures (Page 15)

## 1.9.5 How to add module-related information

### Introduction

Related information can be added to each module in order to quickly recognize the functionality of the module or the procedures contained in it when edited at a later date. If several operators are involved in configuring a project, you should provide module-related information for your colleagues.


When a new module is created, the creation date is entered in the module-related information automatically and is unchangeable. The Module is also assigned the version number 1.0. The version numbers can be individually assigned when editing a module. When a module is changed and saved, the current date of change is entered automatically and is unchangeable.


The following information can be added:

- "Created by"
- "Changed by"
- "Comments" e.g. module functionality/procedures contained

It is still possible to define a password for the module. Further information on assigning passwords is provided in "Protecting Modules with a Password".

## Procedure

1. Open Global Script.
2. Select the module in which information is to be added in the navigation window.
3.  Click the "Info/Trigger" toolbar button, or select the "Info" menu command. The "Properties..." dialog appears.

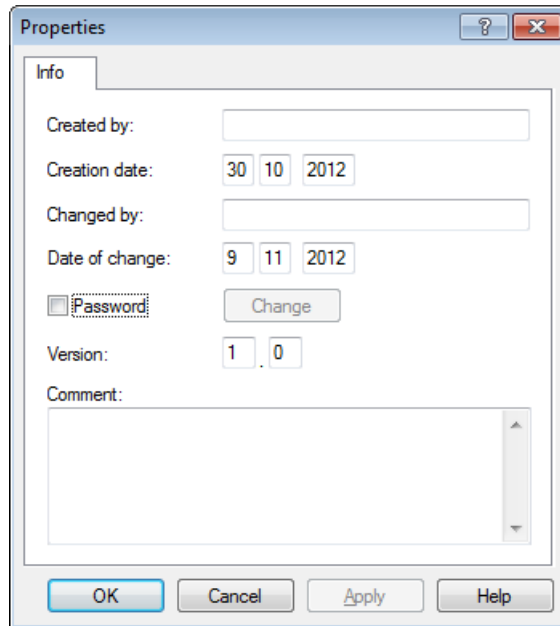

Enter the required information.

---

### Note

The "Info/Trigger" dialog can also be called if an open procedure is selected in the navigation window. The information stored in this dialog is always valid for the entire module and all the procedures contained in it.

---

## See also

- Multiple Use of Procedures and Actions (Page 20)
- Renaming a Procedure or Module (Page 50)
- Saving a Procedure (Page 48)
- How to add module-related information (Page 45)
- Using Standard and Project Procedures (Page 44)
- How to Write Procedure Codes (Page 41)
- Creating a New Procedure (Page 39)

Modules and Procedures (Page 15)

Creating and Editing Procedures (Page 36)

## 1.9.6 Protecting a Module with a Password

### Introduction

A module can be assigned a password to protect it from unauthorized access. The password is a part of the module-related information.


---

#### Note

If a module is protected by a password, all the procedures contained in it are also protected by the password.

---

### Procedure

1. Open Global Script.
2. Select the module to be assigned a password in the navigation window.
3.  Click the button "Info/Trigger" in the toolbar or choose the pop-up menu command "Info". The "Properties..." dialog appears.
4. Activate the check box "Password". The dialog "Enter Password" is displayed.
5. Enter a password and confirm it.
6. Confirm your settings with OK.

#### Result

If an attempt is made to open the module or a procedure contained in it, a prompt appears requesting the password.

#### Deactivate Password Protection

To clear the password protection, disable the "Password" check box.

#### Change Password

To change the password, open in the Properties dialog and click the "Change" button. Then enter the new password.

---

#### Note

If you forget the module password, the module cannot be edited.

---

---

**Note**

The "Info/Trigger" dialog can also be called if an open procedure is selected in the navigation window. The information stored in this dialog is always valid for the entire module and all the procedures contained in it.

---

**See also**

Multiple Use of Procedures and Actions (Page 20)

Renaming a Procedure or Module (Page 50)

Saving a Procedure (Page 48)

How to add module-related information (Page 45)

Using Standard and Project Procedures (Page 44)

How to Write Procedure Codes (Page 41)

Creating a New Procedure (Page 39)

Modules and Procedures (Page 15)

Creating and Editing Procedures (Page 36)

## 1.9.7 Saving a Procedure

### Introduction

Individual procedures are never stored but the module in which the procedure has been programmed.

Before saving a module, check the code is syntactically correct. When saving a module, the procedures contained are automatically checked and, in the case of syntax errors, a prompt appears as to whether the module should be saved with the errors or not. In this way, for example, modules and procedures can be saved which are not fully programmed. Syntactically incorrect procedures do not run in Runtime.

---

**Note**

If a module contains a syntactically incorrect procedure, the module can no longer be loaded. Procedures can no longer be called from the module.

---



**Note**

The syntax check can only detect syntax errors in the code. Programming errors, such as missing references, only become visible in Runtime. Therefore, always check the scripts in the Runtime environment and use a debugger, if necessary, to detect and eliminate errors.

Only syntactically correct modules are called in Runtime.

A list of all the possible syntax errors is available in the Appendix under " Basic Principles of VBScript".

---



If a procedure is subjected to a syntax check prior to saving, any errors are displayed in the lower part of the editor window. Double click on an error line to access the error position in the code directly.





Use the "Save As" command to store the module under another name. Note that the new module is only displayed in the navigation window after updating the view.

**Requirement**

The procedure/module to be saved must be open in the editor window.

**Procedure**

1. Click  in the toolbar.
2. If syntax errors appear in the output window, double click on the error line and correct the error in the code. Repeat steps 1 and 2 until the code is correct.
3. Save the module by clicking  in the toolbar.

**Note****Pictures with modified procedures must be opened and saved once again in Graphics Designer**

In addition to saving in the VBS editor, the corresponding picture must be opened and saved once again in Graphics Designer when the project module is changed. The change is then applied in Runtime. Only once the picture has been saved is the information applied to the picture file via the required project modules.

---

**See also**

Diagnostics (Page 80)

Multiple Use of Procedures and Actions (Page 20)

- Saving a Procedure (Page 48)
- Protecting a Module with a Password (Page 47)
- How to add module-related information (Page 45)
- Using Standard and Project Procedures (Page 44)
- How to Write Procedure Codes (Page 41)
- Creating a New Procedure (Page 39)
- Modules and Procedures (Page 15)
- Creating and Editing Procedures (Page 36)

## 1.9.8 Renaming a Procedure or Module

### Introduction

Procedures and modules are renamed in the following cases:

- When a standard name (procedure# or Modul#), which was automatically assigned when the new module/new procedure was created, is changed to a self-explanatory name.
- When a module or procedure is copied in order, for example, to create a new module with similar content from an existing one.  
Please note that procedure names must be unique within a project. Procedure names which exist twice are issued as errors during the syntax check.  
Contrary to procedure names, the same name can be applied to modules when the modules are stored in different directories.

---

#### Note

The module name is always identical to the file name in the WinCC file system. If a module name is changed, e.g. in Windows Explorer, the new module name is taken over from Global Script in the navigation window.

---

### Procedure

#### Renaming Procedures

1. Open the procedure to be renamed.
2. Enter the new name in the header of the procedure.
3. Save the procedure so that the name is transferred to the navigation window. Procedure names are always unique and may not be used more than once.

### Renaming Modules

1. Close the module to be renamed.
2. Select the module in the navigation window and choose the "Rename" option from the context menu.
3. Enter the new name in the navigation window. Module names are always unique at directory level and may not be used more than once.

### See also

[Multiple Use of Procedures and Actions \(Page 20\)](#)

[Saving a Procedure \(Page 48\)](#)

[Protecting a Module with a Password \(Page 47\)](#)

[How to add module-related information \(Page 45\)](#)

[Using Standard and Project Procedures \(Page 44\)](#)

[How to Write Procedure Codes \(Page 41\)](#)

[Creating a New Procedure \(Page 39\)](#)

[Modules and Procedures \(Page 15\)](#)

[Creating and Editing Procedures \(Page 36\)](#)

## 1.10 Creating and Editing Actions

### 1.10.1 Creating and Editing Actions

#### Introduction

When using VBS in WinCC, there is no differentiation between local (valid for entire project) and global (valid on all computers) actions, as opposed to C. A configured action is always valid globally.

A copied action is available for use in Runtime following a restart or opening and saving the action. The become visible in the editor when the view is updated.

VBS actions can be used in to make graphic objects and object properties dynamic in Runtime or to execute picture-independent actions.

---

#### Note

Please note that the object name length of objects made dynamic in Graphics Designer is limited to approx. 200 characters, and each special character used in an object name is converted to five characters in the script files. The special characters are represented by a four-place hexadecimal code behind the preceding X. If the name of an object made dynamic is too long, a corresponding error message appears. Further information is available in this help under "Structure of VBScript Files".

---

#### Note

If you make an object property dynamic with a VBS action via the return value of a script, the value of the object property is written only if it has changed in relation to the last script run. It is not considered if the value had been changed from another location.

Therefore it is illegal to change properties which have been made dynamic by VBS action via the return value from another location (e.g., other C scripts or VBS scripts).

if you do not observe this, wrong values can be the results.

---

#### Using the Actions

Actions can be used as follows:

##### On graphic objects in Graphics Designer

Making properties dynamic (action with return value), e.g.:

```
Function BackColor_Trigger(ByVal Item)
'VBS143
    BackColor_Trigger = RGB(125,0,0)
End Function
```

Triggered by an event on an object (action without return value), e.g.:

```
Sub OnClick(ByVal Item)
'VBS144
    Item.BackColor = RGB(255,0,0)
End Sub
```

### Picture-independent in Global Script

As a cyclic action, e.g. incrementing a tag:

```
Option Explicit
Function action
'VBS145
    Dim objTag1
    Dim lngValue
    Set objTag1 = HMIRuntime.Tags("Tag1")
    lngValue = objTag1.Read
    objTag1.Write lngValue + 1
    action = CLng(objTag1.value)
End Function
```

## Executing Actions

An action can be assigned several triggers. The action is always executed when one of the triggering events occurs. Observe the following:

- Actions in Global Script cannot be executed simultaneously. The action triggered last is held in a queue until the action currently being performed is completed.
- When using Graphics Designer, cyclically and tag-driven actions cannot be triggered simultaneously. If the execution of a tag-driven action hinders the execution of a cyclic action, the cyclic action is executed when the tag-driven action has finished. The cyclic action is held in a queue during the non-execution phase. When the current action is completed, the cyclic action is executed with the normal cycle.
- In Graphics Designer, event-driven actions cannot be executed simultaneously.

The action types mentioned do not prevent each other being executed: The execution of actions in Global Script has no influence on actions in Graphics Designer. In the same way, in Graphics Designer, the execution of cyclically or tag-driven actions has no effect on the execution of event-driven actions.

---

### Note

Actions in pictures which are still running one minute after the picture has been deselected are terminated by the system. This is recorded in a logfile entry.

---

## Locating Actions

All the actions used in a picture can be displayed by means of the picture properties. To do this mark the picture in WinCC Explorer and select the "Properties" context menu command. After double clicking on an entry, detailed information on the type of dynamics appears.

It is also possible to display all the tags and pictures used in actions by means of the WinCC CrossReference. CrossReference can also be used for the to link tag connections of Graphics Designer actions easily.

---

### Note


Use the standard formulations

HMIRuntime.BaseScreenName = "Screenname" and HMIRuntime.Tags("Tagname") when addressing pictures and tags in your code in order to ensure that the pictures and tags are registered by the CrossReference.

---

## Procedure - Action Restrictions

Actions can be used to program instructions and call procedures. Codes are programmed within in procedures for use at several points in a configuration. Contrary to procedures, actions always have a trigger.

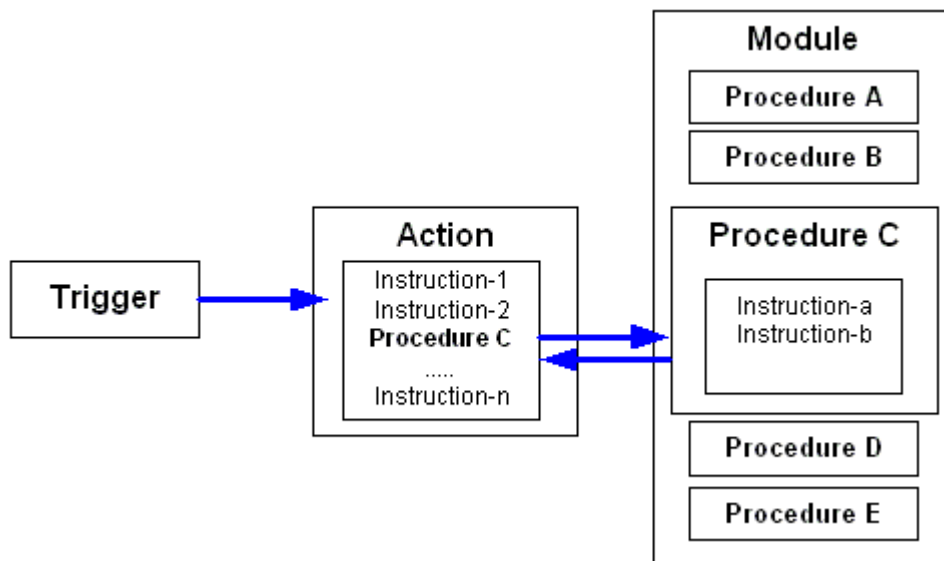

## Creating and Editing Actions

Actions can be configured in Global Script and Graphics Designer. Use Global Script to configure global actions which can be executed independently of the picture currently open. Graphics Designer is used to configure actions related to graphic objects which should be executed when the picture is opened in Runtime or when the configured trigger occurs.

The script editors in WinCC provide the option of checking that scripts have a correct syntax without executing them. Errors in the script are displayed in the output window under the editor window. Double click on the corresponding error line to access the related point in the code.

---

**Note**


The syntax check can only check objects known to the system at the moment of execution. Therefore, the tags and objects addressed in the scripts must be created in WinCC.


Only syntactically correct actions are executed in Runtime.


The automation objects "PDLRuntime" and "WinCC Runtime Project" cannot be used in VBS actions.

---

## Display of Actions

 If you save a syntactically incorrect action, it will be displayed in the navigation window with this adjacent symbol.

 If you save a syntactically correct action without trigger, it will be displayed in the Global Script navigation window with this adjacent symbol.

 If you save a syntactically correct action with trigger, it will be displayed in the Global Script navigation window with this adjacent symbol.

---

**Note**

Actions can only be saved in the Graphics Designer if they have the correct syntax. If an action with errors should still be retained and exited, however, enter the comments.

---

## System behavior if actions are changed, deleted and saved at Runtime

If a local action is stored at runtime, then all local and global actions of the computer are reset on the computer to which the local action belongs.

If a global action is stored during runtime, then all local and global actions for the entire project – and thus on all computers – are reset.

Such a reset might reinitialize for examples tags and times that are used as triggers for actions, triggering the action at that stage.

Static tags used in the reset actions are reinitialized.

## See also

Structure of VBScript Files (Page 92)

Action and Procedure Names in the Debugger (Page 94)

How to Rename an Action (Page 76)

Saving Actions (Page 63)

Protecting an Action with a Password (Page 62)

How to add action-related information (Page 60)

How to Edit Actions (Page 57)

Creating a New Action (Page 56)

Triggers (Page 64)

Actions (Page 18)

## 1.10.2 Creating a New Action

### Introduction

When a new action is created, the editor automatically suggests a file name (Action#.bac), which can be changed.

Actions can be configured in Global Script and Graphics Designer.

- Global Script is used to configure actions which can be executed, picture-independently, in Runtime. Open Global Script via WinCC Explorer.
- Graphics Designer is used to configure a new action, related to the properties of a graphic object, by clicking on the right mouse button in the "Dynamic" column of the Properties tab control and selecting VBS Action. An action, related to an event, is created in the same way using the Events tab control.  
In both cases, the Action Editor of the Graphics Designer opens.


---

#### Note

The precise procedure for linking actions with graphic objects is described under the WinCC help topic "Dynamics".

---

### Procedure

1. Open Global Script.
2. Activating the Actions Tab Control in the Navigation Window.
3. Click  in the toolbar or choose the menu command "File" > "New" > "Action".  
A new action is opened in the editor window. The action appears in the navigation window after it has been saved.

---

#### Note

When creating a new action, the "Option explicit" instruction is automatically entered in the declaration area and cannot be deleted. The instruction is necessary as it prevents errors caused by the incorrect notation of tags without declaration.

The instruction requires that tags are always defined in your code with the "Dim" instruction.  
Do not use the "Option explicit" instruction in the code because it may cause Runtime errors.

---



**See also**

How to Rename an Action (Page 76)  
Saving Actions (Page 63)  
Protecting an Action with a Password (Page 62)  
How to add action-related information (Page 60)  
How to Edit Actions (Page 57)  
Triggers (Page 64)  
Creating and Editing Actions (Page 52)  
Actions (Page 18)

**1.10.3 How to Edit Actions****Introduction**

An action is edited in the same way as a procedure in the editor window of the editor or in the Graphics Designer action editor.

In order that an action can be executed in Runtime, it requires a trigger. Actions which are triggered by an event in Graphics Designer do not require the assignment of a trigger.

If an action is modified during Runtime, the change is applied when the picture is reloaded (in the case of actions in Graphics Designer) or the next time the action is called (in the case of actions in Global Script).

---


**Note**

A change in the code in Runtime cannot be applied when another action is being carried out at the same time.

---

A procedure call can be inserted in the action by dragging the procedure from the editor navigation window with "drag-and-drop" and dropping it in the corresponding position of the code in the editor window. C scripts cannot be called in VBS actions.

**Declaration Area in Actions**

If you create actions in Graphics Designer, you can display the declaration area of the action using the button . When creating a new action, the "Option explicit" instruction is automatically entered in the declaration area and cannot be deleted. The instruction is necessary as it prevents errors caused by the incorrect notation of tags without declaration.

The instruction requires that tags are always defined in your code with the "Dim" instruction.

Do not use the instruction "Option explicit" in your code as this can cause Runtime errors.

In the declaration area, you can also make general settings which you want to use globally for the current picture, e.g.:

- Tag Definitions
- Procedures which you only want to use in this picture

In the declaration area of the actions, you may define global tags independent of each other in the areas "Event" and "Properties" of an object. There is no link between global tags of identical names in both areas.

---

### Note

Always make sure that the procedures in the declaration area have correct syntax, i.e. with "Sub" - "End Sub". Do not create directly executable codes in the declaration area as this can cause Runtime errors.

If global tags are used in the declaration area of actions Graphics Designer, note that the event-driven and cyclic/tag-driven actions are processed separately in Runtime. There is no synchronization of global tags between the two Runtime systems in Runtime. If synchronization of tags is required, configure these using the DataSet object or internal WinCC tags.

---

When making definitions in the declaration area, pay attention to the structure of the Script files, as described under "Structure of VBScript files".

## Functions for Editing Actions

The script editors provide the following functions to assist you in creating action code:

### Intellisense and Highlight Syntax

During text entry, context-sensitive lists appear containing the properties, methods, and objects possible at the current code position. If you insert an element from the list, the required syntax is also indicated automatically.

---

### Note

Full intellisense for all objects can only be utilized in the Graphics Designer if the list is accessed using the object name and the result is assigned to a tag. Otherwise, only a list of standard properties is offered.

Example of full intellisense:

```
Dim Variable  
Set Variable = ScreenItems ("Circle1")  
Variable.<Intellisense>
```

If picture window limits are exceeded during addressing, it is once again only the standard properties which are offered since the picture of the picture window is not loaded.

---

### General VBS Functions

Use the "Function List" command of the shortcut menu in the editing window to display a list of general VBS functions.

### Lists of Objects, Properties and Methods

Using the shortcut menu in the editing window, you can view a list of the possible objects by calling the "Object List" command in Graphics Designer. Global Script only provides the "HMIRuntime" object in this list because there is no direct access to the objects of Graphics Designer.

Use the "Properties/Methods" command of the shortcut menu to call in a list of possible properties and methods.

The same lists can be called in with the key combination <CTRL + SPACEBAR> according to the context of the script.





### Code Templates

In the "Code templates" tab in the Navigation window of the Editor, you will find a selection of frequently used instructions, e.g., for loops and conditional instructions. The templates can be inserted in the procedure code with "drag-and-drop".

If you want to insert a code template into your code, you have to replace the "\_XYZ\_" placeholder in the templates with the respective data.

### Selection Dialogs

If WinCC tags or WinCC objects are used in the code, the following selection dialogs are available for use:

-  Opens a tag selection dialog and returns the selected tag name as the return value.
-  Opens a tag selection dialog and returns the tag name with an associated reference.
-  Opens a picture/object browser in which a picture/object can be selected whose name is then used for the return value.
-  Opens a picture selection dialog for pictures and returns the picture name with the server prefix, if necessary.

### Syntax Check

Global Script supports you by providing a syntax check which you can perform after the code has been created. Syntax errors in the code are displayed in the output window of the editor. You can move to the erroneous point in the code directly by double-clicking the error in the output window.

---

### Note

The syntax check can only detect syntax errors in the code. Programming errors, such as missing references, only become visible in Runtime. Therefore, always check the scripts in the Runtime environment and use a debugger, if necessary, to detect and eliminate errors. The way to test scripts with a debugger is described in this documentation under the topics "Diagnostics" > "Testing with the Debugger".

---

## Procedure

1. Open Global Script.
2. Double click on the action on the Action tab control in the navigation window.
3. Edit the action.

## See also

Using Global Tags in VBS (Page 24)  
Testing with the Debugger (Page 87)  
Structure of VBScript Files (Page 92)  
How to Rename an Action (Page 76)  
Saving Actions (Page 63)  
Protecting an Action with a Password (Page 62)  
How to Edit Actions (Page 57)  
Creating a New Action (Page 56)  
Triggers (Page 64)  
Creating and Editing Actions (Page 52)  
Actions (Page 18)

### 1.10.4 How to add action-related information

#### Introduction

Related information can be added to every action in Global Script in order that the function of an action can be recognized at a later date when editing. If several operators are involved in configuring a project, you should provide action-related information for your colleagues.

When a new action is created, the creation date is entered in the action-related information automatically and is unchangeable. The action is also assigned version number 1.0. The version numbers can be individually assigned when editing an action. When an action is changed and saved, the current date of change is entered automatically and is unchangeable.

The following information can be added:

- "Created by"
- "Changed by"
- "Comments:" e.g. functionality of the action

It is also possible to define a password for the action. Further information on assigning passwords is provided in "Protecting Actions with a Password".


---


**Note**

Additional information can only be made available actions in Global Script, not for actions in Graphics Designer.

---

**Procedure**

1. Open Global Script.
2. Open the action for which information should be added.
3.  Click the "Info/Trigger" toolbar button, or select the "Info" menu command. The "Properties..." dialog appears.

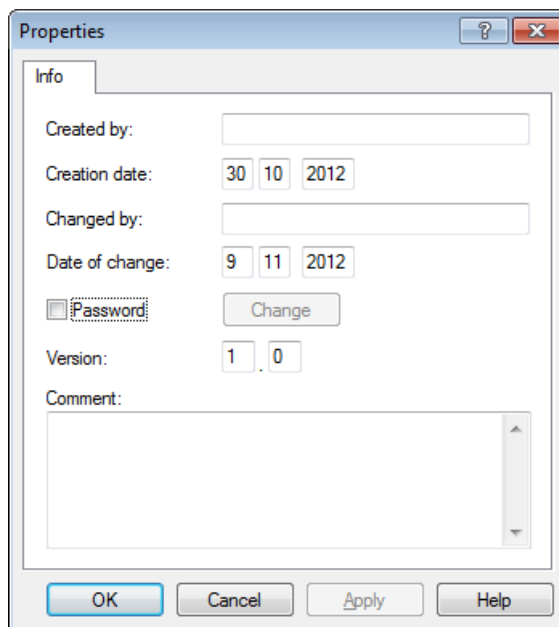

The image shows a "Properties" dialog box with an "Info" tab. It contains the following fields and controls:

- Created by: [Text box]
- Creation date: [30] [10] [2012]
- Changed by: [Text box]
- Date of change: [9] [11] [2012]
- Password: [Change button]
- Version: [1] [0]
- Comment: [Text area]

At the bottom are buttons for OK, Cancel, Apply, and Help.

4. Enter your information.

**See also**

- How to Rename an Action (Page 76)
- Saving Actions (Page 63)
- Protecting an Action with a Password (Page 62)
- How to Edit Actions (Page 57)
- Creating a New Action (Page 56)
- Triggers (Page 64)

Creating and Editing Actions (Page 52)

Actions (Page 18)

## 1.10.5 Protecting an Action with a Password

### Introduction

An action in Global Script can be protected against unauthorized access by assigning a password to it. The password is a part of the action-related information.


---

#### Note

Only actions in Global Script can be assigned a password, not actions in Graphics Designer.

---

### Procedure

1. Open Global Script.
2.  Open the action to be protected by a password.
3. Click the button "Info/Trigger" in the toolbar or choose the pop-up menu command "Info". The "Properties..." dialog appears.
4. Select the "Password" check box.
5. Click the "Change" button. The "Enter Password" window opens.
6. Enter a password and confirm it.
7. Confirm your settings with OK.

#### Result

If an attempt is made to open the action, the system requests the password is entered.

#### Deactivate Password Protection

To clear the password protection, disable the "Password" check box.

#### Change Password

To change the password, open in the Properties dialog and click the "Change" button. Then enter the new password.

---

#### Note

If you forget the action password, the action cannot be edited.

---

**See also**

How to Rename an Action (Page 76)  
Saving Actions (Page 63)  
How to add action-related information (Page 60)  
How to Edit Actions (Page 57)  
Creating a New Action (Page 56)  
Triggers (Page 64)  
Creating and Editing Actions (Page 52)  
Actions (Page 18)

**1.10.6 Saving Actions****Introduction**

Before an action can be run in Runtime, it must be saved. Save an action as any other Windows file using the "File" > "Save" commands or the corresponding icon.

---

**Note**

Actions in Graphics Designer are automatically applied on closing the action editor with the picture. Functions can only be saved in the Graphics Designer if they have the correct syntax. If an action with errors should still be retained and exited, however, enter the comments.

A list of all the possible syntax errors is available in the Appendix under " Basic Principles of VBScript".

---

In order to save an action under a different name, e.g. to use an action as a basis for another action, use the "Save As" command.

Note that, when using "Save As", only the file name is changed and not the action name.

**Prior to Saving**

Before saving an action, check the code is syntactically correct. The syntax errors in the code are displayed in the output window of Global Script. Double click on an error line to access the error position in the code directly.


---

**Note**



The syntax check can only detect syntax errors in the code. Programming errors, such as missing references, only become visible in Runtime. Therefore, always check the scripts in the Runtime environment and use a debugger, if necessary, to detect and eliminate errors.

---

If actions are saved without running a syntax check beforehand, the editor comments that a syntactically incorrect action will be saved which cannot subsequently be run in Runtime.

 Syntactically incorrect actions are displayed with the adjacent icon in the navigation window.

## Procedure

1. Click  in the toolbar.
2. If errors are displayed in the lower part of the editor window, double click on the error line and correct the error in the code. Repeat steps 1 and 2 until the code is correct.
3. Save the action by clicking  in the toolbar.

## See also

Actions (Page 18)

How to Rename an Action (Page 76)

Protecting an Action with a Password (Page 62)

How to add action-related information (Page 60)

How to Edit Actions (Page 57)

Creating a New Action (Page 56)

Triggers (Page 64)

Creating and Editing Actions (Page 52)


## 1.10.7 Triggers

### 1.10.7.1 Triggers

#### Definition and use

Triggers are used to execute actions at Runtime. To do this, a trigger is linked to an action, forming the triggering event for calling the action. Actions without triggers will not be carried out.

The triggers defined for an action are displayed in the Global Script navigation window .

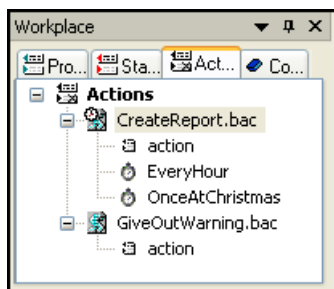



## Trigger types

The following trigger types are available:

### Acyclic triggers

They consist of the specification of date and time. The action specified by such a trigger is performed once at the date and time specified.

### Cyclic triggers

They consist of the specification of a time interval and start time. The following types of cyclic triggers are available:

- **Default cycle.** The start of the first time interval coincides with the start of Runtime. The length of the interval is determined by the cycle.
- **Hourly.** The start of the interval is specified as minute and second. The length of the interval is an hour.
- **Daily.** The start of the interval is specified by the time (hour, minute and second) festgelegt. The length of the interval is a day.
- **Weekly.** The start of the interval is specified by the day of the week (Monday, Tuesday, etc.) and the time. The length of the interval is a week.
- **Monthly.** The start of the interval is specified by the day and time. The length of the interval is a month.
- **Annual.** The start of the interval is specified by the day, month and time. The length of the interval is a year.

Time-controlled triggers are used for actions Global Script and for actions to make graphic objects dynamic.

### Tag triggers

They consist of one or more specified tags. The action associated with such a trigger is performed each time a change in the value of one of these tags is detected.

How the tag values are queried may be customized for each tag. Select from the following modes:

- **Cyclic query of the tag value:** Specify a standard cycle. The tag value is queried at the defined intervals (e.g. every 2 seconds). The action is triggered when the system detects a change of the tag value.  
Depending on the size of the cycle, it is possible that the tag value is changed but it is not detected by the system.  
If, for example, a cycle of 5 minutes has been set, the tag value may change several times within the 5 minute period but only the value set when the next query is made is detected. The value changes between the two queries are not registered.
- **Changes in the tag value:** Each change in the tag value is detected by the system. The action is executed each time the tag value changes.

Tag triggers are used for actions Global Script and for actions to make graphic objects dynamic.

### Event-driven

When an action is configured related to an event on a graphic object, the action is triggered when a specific event has occurred, e.g. following a mouse click or the change of the background color due to another action.

### Animation cycle

As of WinCC V7.0, the "animation cycle" trigger art is available for the dynamization of objects with VBS. The animation cycle allows you to switch actions on and off in Runtime and to change the time, in which the trigger is executed.

You can find additional information in the "AUTOHOTSPOT" section.

## Effects of triggers on actions

If the action is associated with only one trigger, then the action is performed as soon as the triggering event occurs.

However, an action may be associated with multiple triggers, such as a cyclic trigger and a tag trigger. Here the action is performed whenever one of the two triggering events occurs. If two events occur simultaneously, then the action is executed twice sequentially. If two tag triggers fire at the same time, the action will be performed only once.

### Processing actions in Graphics Designer

The following rules apply to processing actions in Graphics Designer:

- No event-driven actions can be executed as long as another event-driven action is running.
- No cyclic/tag triggered actions can be executed as long as another cyclic/tag triggered action is running.
- The two action types do not affect each other: An event-driven action can also be executed when a cyclic action is already in progress.
- If the execution of actions is blocked by other actions (e.g. a cyclic action by a tag-triggered action), each action which is blocked is executed once at the next possible moment. Cyclic actions then run in their normal intervals after the one-off execution.

### Processing actions in Global Script

Picture-based actions from Global Script are executed in Runtime in succession after being triggered. When an action is triggered while another action is in progress, the second action is kept in a queue until it can be executed.

Actions in Global Script and Graphics Designer do not affect each other.

---

### Note


If the action should not be executed at each event, it is possible to define a condition in the action, the result of which controls whether the action is executed or not.

---

## Notes on configuring triggers

Depending on the system, it cannot be guaranteed that an action with a cyclic trigger will be carried out at exactly the specified time. If this is a requirement, then the task (such as a check) should be implemented on the automation device.

The tag triggers should have priority over cyclic triggers: With cyclic actions, the action is always executed, e.g. every 20 seconds. The tag trigger only executes the action if a change in the value of the tag has been detected in the case of cyclic queries. This reduces the load on the system and increases performance.

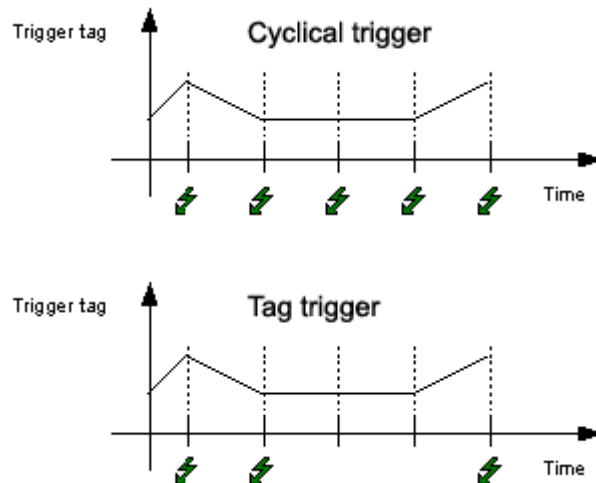

If a tag trigger is used, configure the "Upon Change" cycle to start as seldom as possible. This query cycle causes the tag to trigger the action following every change. This causes high system loads.

## Linking tag triggers

The CrossReference from WinCC can be used to quickly find all the application points of tags, even in VBS actions. Tag triggers in actions in Graphics Designer can be "linked" using CrossReference, i.e. replaced by other tags at all or selected points.

---

### Note

Tags can also be directly linked in Graphics Designer by marking the graphic object and selecting the "Linking ..." command from the context menu.

Use the standard formulations

```
HMIRuntime.BaseScreenName = "Screenname" and
HMIRuntime.Tags ("Tagname")
```

when addressing pictures and tags in your code in order to ensure that the pictures and tags are registered by the CrossReference.

---

Further information on CrossReference is available in the WinCC documentation.

**See also**

- Actions (Page 18)
- How to delete a trigger (Page 75)
- How to change a trigger (Page 74)
- How to add a trigger of the type "Tag" (Page 72)
- How to add a trigger of the type "Timer" (Page 70)
- Creating and Editing Actions (Page 52)

**1.10.7.2 Animation trigger**

**Introduction**

As of WinCC V7.0, the "animation cycle" trigger art is available for the dynamization of objects with VBS. The animation cycle allows you to switch actions on and off in Runtime and to change the time in which the trigger is executed.

**Animation cycles**

Name	Cycle	Name	Cycle
CycleTime125ms	125 ms	CycleUser1	User cycle 1
CycleTime250ms	250 ms	CycleUser2	User cycle 2
CycleTime500ms	500 ms	CycleUser3	User cycle 3
CycleTime1s	1 s	CycleUser4	User cycle 4
CycleTime2s	2 s	CycleUser5	User cycle 5
CycleTime5s	5 s	CyclePicture	Picture cycle
CycleTime10s	10 s	CycleWindow	Window Cycle
CycleTime1min	1 min		
CycleTime5min	5 min		
CycleTime10min	10 min		
CycleTime1h	1 h		

You use the trigger by writing an action and using the "animation cycle" trigger type. This action can be activated or deactivated in Runtime with the "ActivateDynamic" and "DeactivateDynamic" methods. The methods are described in the VBS reference of the WinCC Information System. The correct syntax of the methods deviates from the description in the VBS reference and is shown in the following two examples.

**Example**

With an action at the determined property "Position X" (left), the rectangle is shifted 5 pixels to the right. Select the "animation cycle" event in the action as the trigger.

Enter the following as action in the "Left" property:

```
item.Left = item.Left + 5
```

You can switch the action on and off at the property "Position X" with the following methods.

The trigger is switched on in Runtime with the "ActivateDynamic" method:

```
Dim obj  
Set obj = ScreenItems.Item("Rectangle1")  
obj.ActivateDynamic "Left", "CycleTimes"
```

The trigger is switched off in Runtime with the "DeactivateDynamic" method:

```
Dim obj  
Set obj = ScreenItems.Item("Rectangle1")  
obj.DeactivateDynamic "Left"
```

---

**Note**

The WinCC tags remain requested even when the trigger is switched off.

---

**See also**

[ActivateDynamic method \(Page 713\)](#)

### 1.10.7.3 How to add a trigger of the type "Timer"

#### Introduction

"Timer" type triggers execute an action at a certain time. "Timer" type triggers can be cyclic or acyclic triggers.

- Acyclic triggers Trigger an action once at the configured time.
- Cyclic triggers Trigger an action at regular intervals. The time interval and start time for the time must be triggered. If a standard cycle is selected as the cyclic trigger, the start time is always the start of Runtime. User-specific cycles can also be selected as standard cycles.

---


#### Note

Cyclic triggers guarantee a high updating rate of the system but require high system loads. Choose cyclic triggers only for those actions, where the update is very important. With high system loads, some actions may not be executable.


---

"Timer" type triggers are used to make the properties in Graphics Designer dynamic and execute global actions.

#### Procedure

1. Open the action.
2.  Click the button "Info/Trigger" in the toolbar or choose the pop-up menu command "Info". The "Properties..." dialog appears.
3. Select the "Triggers" tab.
4. Select the "Timer" trigger and then select the trigger type to be created: cyclic or acyclic.
5. Click on the "Add" button. The "Add Trigger" dialog appears.

6. If the "acyclic" trigger type has been selected: Enter a relevant trigger name and define the time at which the action should be executed.

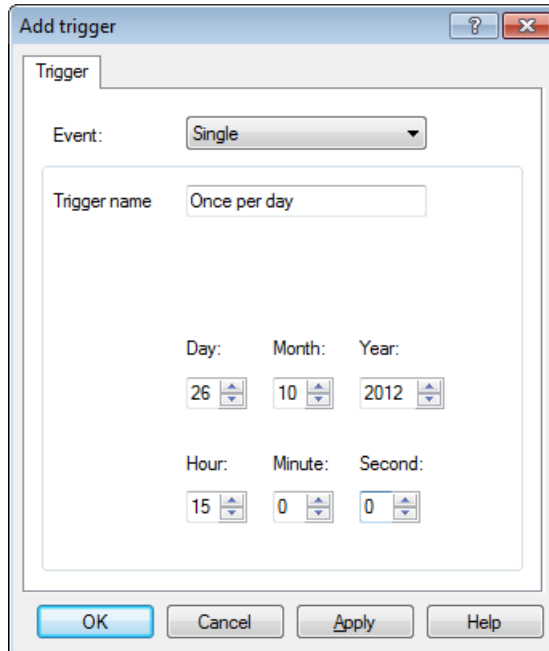

The screenshot shows a dialog box titled "Add trigger" with a "Trigger" tab. It contains the following fields and controls:

- Event:** A dropdown menu currently showing "Single".
- Trigger name:** A text input field containing "Once per day".
- Day:** A spinner box set to 26.
- Month:** A spinner box set to 10.
- Year:** A spinner box set to 2012.
- Hour:** A spinner box set to 15.
- Minute:** A spinner box set to 0.
- Second:** A spinner box set to 0.
- Buttons:** "OK", "Cancel", "Apply", and "Help" are located at the bottom of the dialog.

7. If the "cyclic" trigger type has been selected: Enter a relevant trigger name and define the start time at which the action should be executed for the first time. Enter a cycle at which the action should be repeated.  
Click OK to confirm your entries.

---

### Note

An action can be assigned several triggers. The action is always executed when one of the triggering events occurs.

---

### See also

How to delete a trigger (Page 75)

How to add a trigger of the type "Tag" (Page 72)

Triggers (Page 64)

Creating and Editing Actions (Page 52)

Actions (Page 18)

### 1.10.7.4 How to add a trigger of the type "Tag"

#### Introduction


"Tag" type triggers execute an action following the change of a tag value. Any internal or external tag stored in WinCC can be used as a trigger tag.

Actions with tag triggers can be executed at the following times:

- On change of tag: The action is executed each time the tag value changes. Since this setting causes a very high system utilization, the updating rate should be set as low as possible.
- Query the tag status according to standard cycle (including user cycles): Define a cycle in whose intervals the tag value should be queried. The action is only executed when the tag value has changed when queried. When the query status is a large value, it is possible that the tag value changes but it is not detected by the system. In this case the action will not be performed.


If an action is linked with several tags, the action is executed when one of the tag values changes.

#### Procedure


1. Open the action.
2.  Click the button "Info/Trigger" in the toolbar or choose the pop-up menu command "Info". The "Properties..." dialog appears.
3. Select the "Triggers" tab.
4. Select "Trigger" as the tag.
5. Click on the "Add" button. The "Add Trigger" dialog appears.



6. Enter the name of the tag to be used as the trigger or click the button beside the "Tag Name" field in order to select a tag from the tag selection dialog.

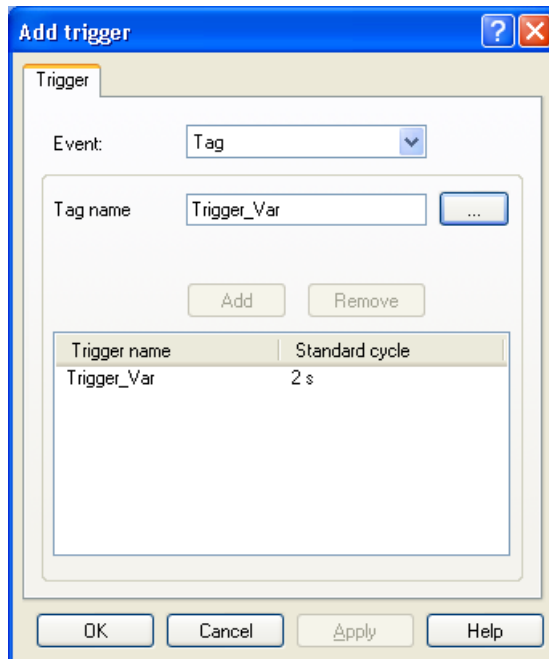

7. Double click on the "Standard cycle" field to open the selection dialog for the tag update cycle:

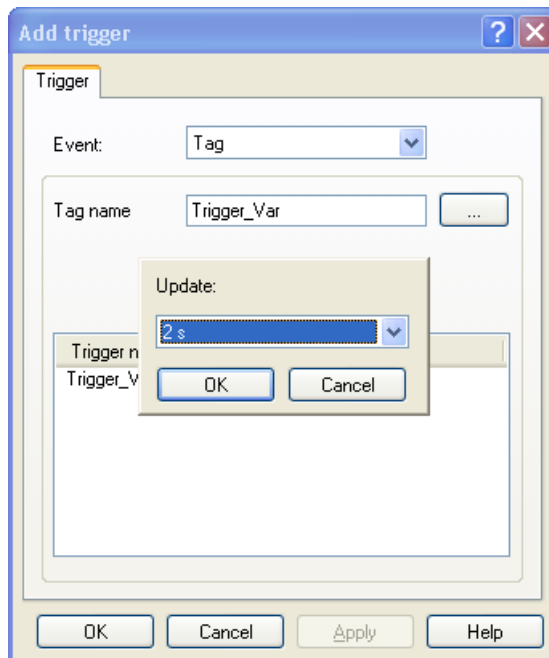

Select a cycle and click on OK to confirm the selection.

## See also


- How to delete a trigger (Page 75)
- How to add a trigger of the type "Tag" (Page 72)
- How to add a trigger of the type "Timer" (Page 70)
- Triggers (Page 64)
- Creating and Editing Actions (Page 52)
- Actions (Page 18)


### 1.10.7.5 How to change a trigger

#### Introduction

A defined trigger can be modified at any time, even during Runtime.

#### Procedure

1. Open the action whose triggers should be modified.
2.  Click the button "Info/Trigger" in the toolbar or choose the pop-up menu command "Info/Trigger". The "Properties..." dialog appears. Alternatively, call in the dialog without executing the action by double clicking on the trigger in the navigation window.
3. Select the "Triggers" tab.
4. Select the trigger to be modified and click the "Change" button.

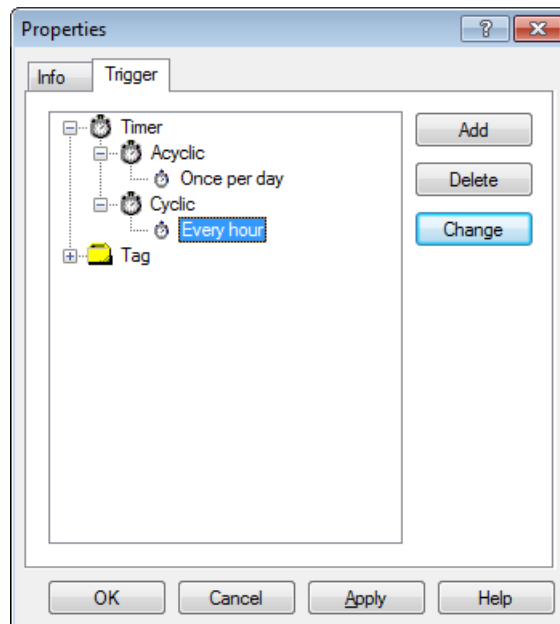

5. Modify the trigger can confirm the entries with OK.

## See also

Triggers (Page 64)

How to delete a trigger (Page 75)

How to add a trigger of the type "Tag" (Page 72)

How to add a trigger of the type "Timer" (Page 70)

Creating and Editing Actions (Page 52)

Actions (Page 18)

### 1.10.7.6 How to delete a trigger

#### Introduction

Defined triggers can be deleted at any time. Triggers can also be deleted during Runtime.

If a trigger is deleted in Runtime, it only takes effect after the action is saved.


---

#### Note


Actions without trigger are not executed in Runtime. None of the actions which used the deleted trigger are executed any longer.

---

#### Procedure

1. Open the Global Script Editor or the Graphics Designer action editor.
2. Open the action.
3.  Click the "Info/Trigger" toolbar button or select the "Info/Trigger" menu command. The "Properties..." dialog appears.
4. Select the "Triggers" tab.

5. Select the trigger to be deleted and click the "Delete" button.

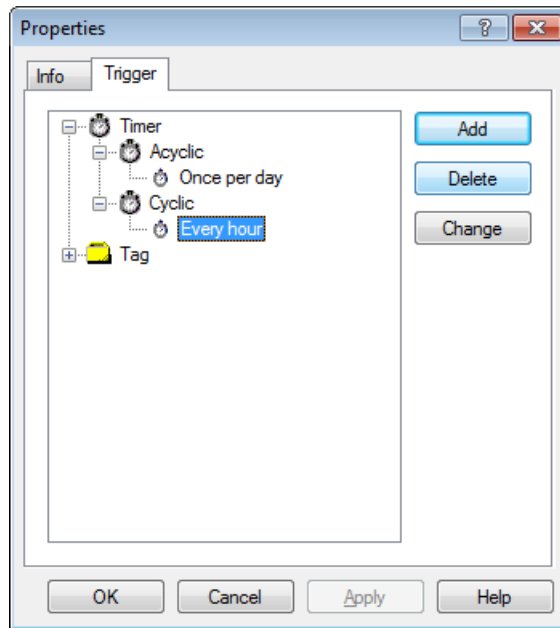

6. The trigger is deleted immediately.

---

**Note**

Triggers can also be deleted directly in the Global Script navigation window using the "Delete" command in the context menu.

---

**See also**

- Actions (Page 18)
- How to change a trigger (Page 74)
- How to add a trigger of the type "Tag" (Page 72)
- How to add a trigger of the type "Timer" (Page 70)
- Triggers (Page 64)
- Creating and Editing Actions (Page 52)

### 1.10.8 How to Rename an Action

#### Introduction

Actions can be renamed in Global Script. When an action is renamed, the action name and file name are changed.

The action to be renamed must not be open in the editor window.

## Procedure

1. Open Global Script.
2. Select the name of the action to be renamed in the editor's navigation window.
3. Select the "Rename" command from the context menu.
4. Enter a new name for the action with the extension \*.bac.

## See also

[Protecting an Action with a Password \(Page 62\)](#)

[Saving Actions \(Page 63\)](#)

[How to add action-related information \(Page 60\)](#)

[How to Edit Actions \(Page 57\)](#)

[Creating a New Action \(Page 56\)](#)

[Triggers \(Page 64\)](#)

[Creating and Editing Actions \(Page 52\)](#)

[Actions \(Page 18\)](#)

## 1.11 How to activate global actions in Runtime


### Introduction

Scripts defined in Global Script are always executed when the configured trigger occurs. Scripts in the graphical Runtime system are executed when the picture is called in and the configured event or trigger occurs.

In order that the picture-independent, Global Script global actions can be executed, the Global Script Editor must be registered in the startup list of the Runtime computer.

### Procedure

1. Select the "Properties" command in the computer's context menu WinCC Explorer. The "Computer properties" dialog will open.
2. Click on the "Startup" tab
3. Selection option "Global Script Runtime".

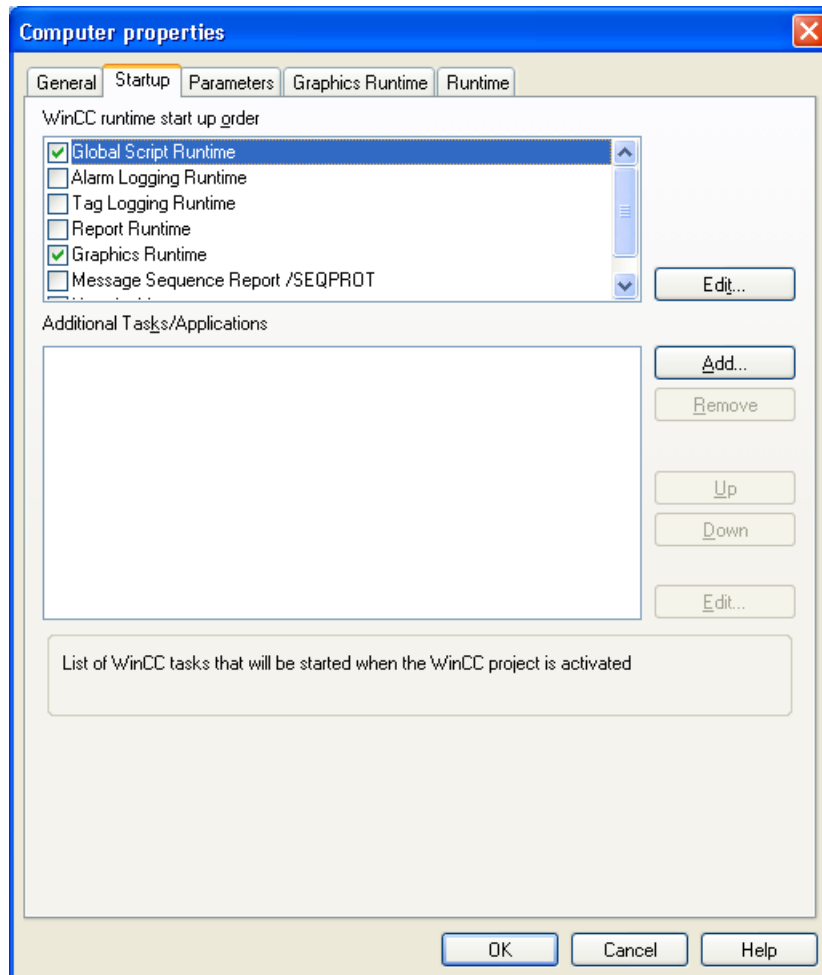

4. Click OK to confirm your entries.

**See also**

- Creating and Editing Actions (Page 52)
- Creating and Editing Procedures (Page 36)
- VBScript Editors (Page 26)
- Using Visual Basic Script in WinCC (Page 12)

## 1.12 Diagnostics

### 1.12.1 Diagnostics

#### Introduction

If the scripts are executed and tested in Runtime, the Diagnostics window can be used to display an analysis quickly.

#### Diagnostics Tools

WinCC provides a range of tools with which to analyze the behavior of actions in Runtime:

- The GSC Runtime and GSC Diagnostics application windows
- Use of a debugger

#### GSC Runtime and GSC Diagnostics

The GSC Runtime and GSC Diagnostics application window are used by inserting them in a process screen. This can be a process screen developed for diagnostics purposes which is called in Runtime.

The application windows are used for different strategies:

While Runtime is active, GSC Runtime provides information on the dynamic behavior of all (Global Script) actions, enables the individual startup as well as log on and off of each individual action and offers the access point to the Global Script Editor.

GSC Diagnostics issues the Trace methods contained in the actions in the chronological sequence they are called. This also applies to Trace instructions in procedures which are called in actions. The targeted implementation of Trace instructions, e.g. for the output of tag values, enables the progress of actions and the procedures called in them to be traced. The Trace instructions are entered in the form "HMIRuntime.Trace(<Ausgabe>)".

The GSC Diagnostics displays trace output from C and VBS.

---

#### Note

#### Runtime errors in VBS are not displayed

Some script errors are neither output via trace nor displayed via the error dialog.

---

#### Debugger

You can use the "Microsoft Visual Studio 2008" debugger to test your VB scripts in Runtime.

The debugger is included in the WinCC Setup. If another Visual Studio version is already installed, Microsoft Visual Studio 2010 for example, use the debugger of this version.



**See also**

Testing with the Debugger (Page 87)

GSC Runtime (Page 84)

GSC Diagnostics (Page 81)

**1.12.2 GSC Diagnostics****1.12.2.1 GSC Diagnostics****Introduction**

GSC Diagnostics displays the chronological sequence of calls of the trace methods contained in the actions in the Diagnostics window. This also applies to Trace instructions in procedures which are called in actions. The targeted implementation of Trace instructions, e.g. for the output of tag values, enables the progress of actions and the procedures called in them to be traced.

**Application**

In order to use GSC Diagnostics, insert a GSC Diagnostics type application window in a process screen. The GSC Diagnostics attributes can be used to control the appearance of the GSC Diagnostics window.

In the case of a picture change, the content of the GSC Diagnostics window is deleted.

---

**Note**

Messages are also displayed in the "GSC Diagnostics" window when the debugger is activated.

---

**See also**

GSC Diagnostics Toolbar (Page 83)

GSC Diagnostics Attributes (Page 82)

Inserting the GSC Diagnostics Window into a Picture (Page 82)

### 1.12.2.2 Inserting the GSC Diagnostics Window into a Picture

#### Introduction

In order to use GSC Diagnostics, insert a GSC Diagnostics process screen. The process screen can be an existing picture or a picture which serves customized diagnostics purposes. GSC Diagnostics cannot be inserted directly in the process screen as an application but is inserted as an application in an application window. In this case, the application window is a component part of the process screen.

#### Requirements

Graphics Designer has been started and the process screen is open.

#### Procedure

1. Use the "Smart Objects" object palette to insert the "Application Window" in the picture.
2. Select the "Global Script" option from the "Window Contents" dialog and confirm the selection with "OK".
3. Select the "GSC Diagnostics" option from the "Templates" dialog.
4. Confirm the selection with OK in order to insert the Diagnostics window.

#### See also

GSC Diagnostics Toolbar (Page 83)

GSC Diagnostics Attributes (Page 82)

GSC Diagnostics (Page 81)

### 1.12.2.3 GSC Diagnostics Attributes

#### Overview

GSC Diagnostics has attributes which affect the appearance of the GSC Diagnostics window in Runtime. These relate to the geometric attributes, particularly to the following:

- **Display:** This attribute defines whether the window should be visible or hidden. The attribute can be made dynamic with the name Visible.
- **Sizeable:** This attribute defines whether the size of the window should be changeable in Runtime.
- **Movable:** This attribute defines whether the window should be moveable or not during Runtime.
- **Border:** This attribute defines whether the window is provided with a border. If the window has a border, its height and width can be modified in Runtime.
- **Title:** This defines whether the window has a title bar.

- Can be maximized: This attribute defines whether the title bar should contain the button to maximize the window.
- Can be closed: This attribute defines whether the title bar should contain the button to close the window.
- Foreground: This attribute defines whether the window should always be in the foreground.

## See also

GSC Diagnostics Toolbar (Page 83)


Inserting the GSC Diagnostics Window into a Picture (Page 82)

GSC Diagnostics (Page 81)

### 1.12.2.4 GSC Diagnostics Toolbar

#### Overview

The GSC Diagnostics toolbar enables the output in the diagnostics window to be controlled and to save, print and open window content:

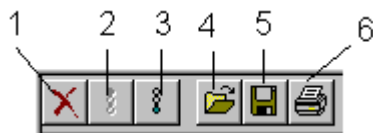

- 1: Delete the content of the diagnostics window
- 2: Stop the window being updated
- 3: Activate the window being updated
- 4: Opens a text file in the window
- 5: Saves the window contents in a text file
- 6: Print the window contents

## See also

GSC Diagnostics Attributes (Page 82)

Inserting the GSC Diagnostics Window into a Picture (Page 82)

GSC Diagnostics (Page 81)

## 1.12.3 GSC Runtime



### 1.12.3.1 GSC Runtime

#### Introduction

GSC Runtime is a window which displays the dynamic behavior of all Global Script actions in Runtime. In addition, GSC Runtime can also be used during Runtime to influence the execution of each individual action and provide access to the Global Script editor.

#### Actions

C actions and VBS actions are differentiated in the GSC Runtime window:

-  Symbolizes a C action
-  Symbolizes a VBS action

The following information is issued:

- Action name: The name of the action
- ID: Action ID. They are used internally by the system. GSC Runtime supplies the corresponding action name together with the Action ID. The link between ID and action name is only valid until Runtime is stopped or, during Runtime, until an action is saved.
- Status: Provides information on the current status of the action. Refer to the table below for the possible statuses.
- Activation Interval: The time in the form Hour:Minute:Second, which should elapse between the action being called.
- Return Value: The return value of the action
- Started On: Date and time the current action was started
- Next Start: Date and time the action will be started again
- Error message: Contains the error text in the case of an error

#### Actions Status

Possible action status:

- Action was activated.
- Action was deactivated
- Action was stopped.
- Action in progress
- Error logging on the action!
- Error executing the action!

## Pop-Up Menu

The following functions are available for every action in the pop-up menu:

- Log off: The relevant action will not be executed again when the current execution has finished.
- Log on: The relevant action will be executed again when the next trigger event occurs
- Start: The relevant action will be executed once.
- Edit: The relevant action will be opened in the Global Script editor for editing. Runtime will remain active. If the edited action is compiled (when necessary) and saved the changes will be applied by the Runtime system immediately.  
The option of opening the pop-up menu for every action can be controlled by assigning an authorization.  
In order to use GSC Runtime, insert a GSC Runtime type application window in a process screen. The GSC Runtime attributes can be used to control the appearance of the GSC Runtime window.

---

### Note

Updating the GSC Runtime window increases the system load. The system load is dependent on how many actions are visible in the window. The system load can be lowered by reducing the height of the window so that fewer lines are visible.

---

## See also

How to insert the GSC Runtime Window into a Picture (Page 85)

GSC Runtime Attributes (Page 86)

### 1.12.3.2 How to insert the GSC Runtime Window into a Picture

#### Introduction

In order to use GSC Runtime, insert a GSC Runtime process screen. The process screen can be an existing picture or a picture which serves customized diagnostics purposes. GSC Runtime cannot be inserted directly in the process screen but is inserted as an application in an application window. In this case, the application window is a component part of the process screen.

#### Requirements

Graphics Designer has been started and the process screen is open.

## Procedure

1. Use the "Smart Objects" object palette to insert the "Application Window" in the picture.
2. Select the "Global Script" option from the "Window Contents" dialog and confirm the selection with "OK".
3. Select the "GSC Runtime" option from the "Templates" dialog.
4. Confirm the selection with OK in order to insert the Diagnostics window.

## See also

GSC Runtime (Page 84)

GSC Runtime Attributes (Page 86)

### 1.12.3.3 GSC Runtime Attributes

## Overview

GSC Runtime has attributes which affect the appearance of the GSC Runtime window in Runtime. These relate to the geometric attributes, particularly to the following:

- Display: This attribute defines whether the window should be visible or hidden. The attribute can be made dynamic with the name Visible.
- Sizeable: This attribute defines whether the size of the window should be changeable in Runtime.
- Movable: This attribute defines whether the window should be moveable or not during Runtime.
- Border: This attribute defines whether the window is provided with a border. If the window has a border, its height and width can be modified in Runtime.
- Title: This defines whether the window has a title bar.
- Can be maximized: This attribute defines whether the title bar should contain the button to maximize the window.
- Can be closed: This attribute defines whether the title bar should contain the button to close the window.
- Foreground: This attribute defines whether the window should always be in the foreground.

## See also

GSC Runtime (Page 84)

How to insert the GSC Runtime Window into a Picture (Page 85)

## 1.12.4 Testing with the Debugger

### 1.12.4.1 Testing with the Debugger

#### Overview

You can use the "Microsoft Visual Studio 2008" debugger to test your VB scripts in Runtime.

The debugger is included in the WinCC Setup. If another Visual Studio version is already installed, Microsoft Visual Studio 2010 for example, use the debugger of this version.

#### Installing the debugger for WinCC


To use the debugger in WinCC, you must start Setup and specify instance "Visual Studio 2008" as the default.

During the installation of WinCC, the "VS 2008 Shell Redist" folder is created on a drive of the PC, for example, as "D:\VS 2008 Shell Redist".

#### Procedure

1. Start the setup with the following file:
  - VS 2008 Shell Redist\Integrated Mode\Vsides.enu.exe
2. Follow the instructions and accept the default settings.  
The following program is installed:
  - Microsoft Visual Studio 2008 Shell (Integrated Mode) - ENU
3. When you start the debugger the first time, the "Visual Studio Just-In-Time Debugger" dialog opens.  
Select the entry "New instance of Visual Studio 2008".  
To specify "Visual Studio 2008" as the default debugger, select the "Set the currently selected debugger as the default." setting.

Microsoft Visual Studio 2008 Debugger

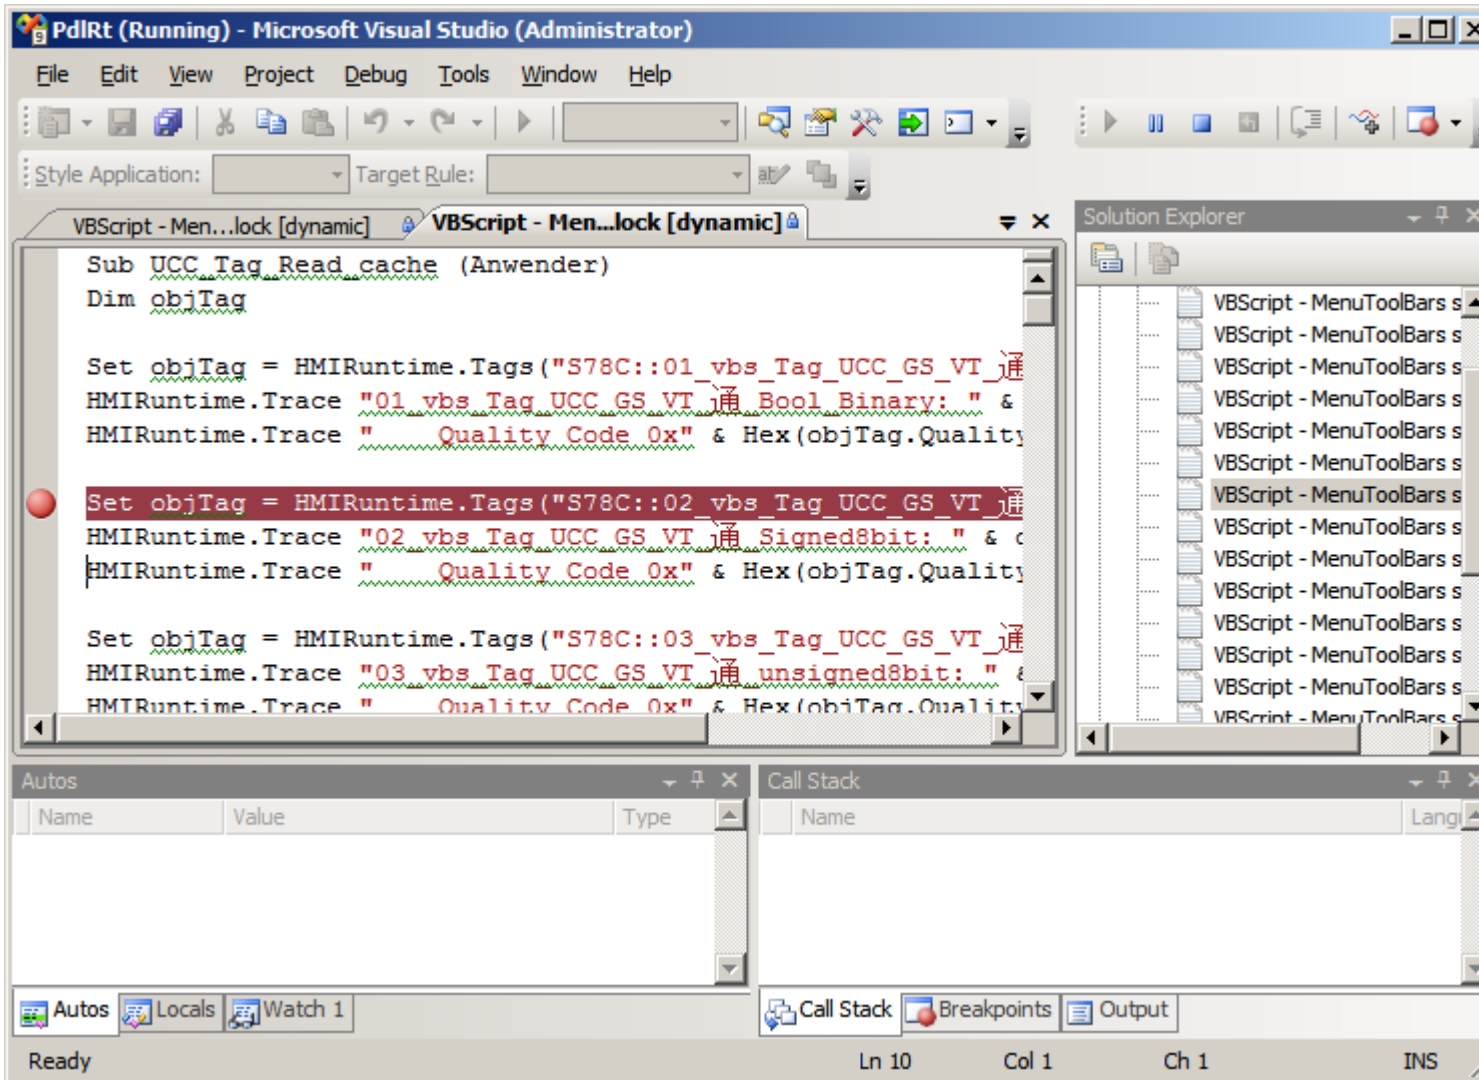

See also

- Principles of Debugging (Page 90)
- Executing Script Commands (Page 102)
- How to Determine and Modify Tag and Property Values (Page 101)
- How to Set Bookmarks in Scripts (Page 100)
- Deleting Breakpoints (Page 99)
- Setting Breakpoints (Page 98)
- Processing Scripts Step-by-Step (Page 97)
- Selecting a Script for Editing (Page 96)



Action and Procedure Names in the Debugger (Page 94)

Structure of VBScript Files (Page 92)

How to Activate the Debugger (Page 89)

Diagnostics (Page 80)

## 1.12.4.2 How to Activate the Debugger

### Principle


There are several ways of activating the debugger:

- Automatic activation of the debugger when an error occurs in Runtime.
- Opening an error box in Runtime via which the debugger can be activated.
- Starting the debugger from the Start menu and opening a running Runtime scripts.

### Procedure

The following procedure describes the first two points, activating the debugger in WinCC.

1. In the computer's pop-up menu in WinCC Explorer, select the command "Properties". The "Computer Properties" dialog appears.
2. Select the "Runtime" tab control.
3. Activate the required debug options. The debug behavior for actions in Global Script and Graphics Designer can be set independently of each other:

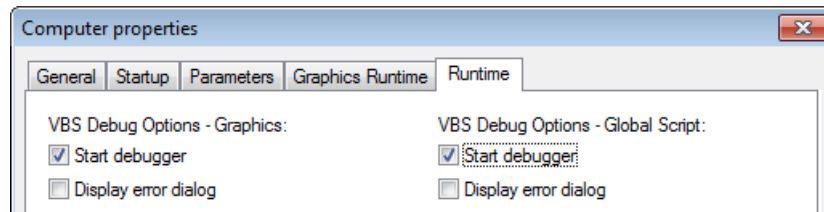

4. Select "Start debugger" when the debugger should be started directly following an error in the Runtime.
5. Select "Display Error Dialog", if you do not want to start the Debugger directly but wish to display an error dialog with information about the error. The debugger can be started from the error box by means of a button.
6. Click OK to confirm your entries.

### Starting the Debugger and Opening a Running Script

The debugger can also be started up later and linked to the system currently running. Define a connection in the debugger to the respective processes, "pdlrt.exe" for the Graphical Runtime System and "gsCRT.exe" for the Global Runtime System. The way to open a running script in the debugger is described under the topic "Select Script".

## Exiting the Debuggers

It is possible to stop the debugger without exiting the WinCC Runtime.

### See also

How to Set Bookmarks in Scripts (Page 100)

Executing Script Commands (Page 102)

How to Determine and Modify Tag and Property Values (Page 101)

Deleting Breakpoints (Page 99)

Setting Breakpoints (Page 98)

Processing Scripts Step-by-Step (Page 97)

Selecting a Script for Editing (Page 96)

Action and Procedure Names in the Debugger (Page 94)

Structure of VBScript Files (Page 92)

Principles of Debugging (Page 90)

Testing with the Debugger (Page 87)

Diagnostics (Page 80)

### 1.12.4.3 Principles of Debugging

#### Introduction

You can use the "Microsoft Visual Studio 2008" debugger to test your VB scripts in Runtime.

The debugger is included in the WinCC Setup. If another Visual Studio version is already installed, Microsoft Visual Studio 2010 for example, use the debugger of this version.

The debugger can be used to:

- View the script source code to be debugged
- Step-by-step processing of the scripts to be checked
- Display and modify tag and property values
- View and monitor the script progress

---

#### Note

Please note that the code displayed in the debugger is write-protected. The code cannot be changed directly in the debugger but only test the necessary changes.

---

#### Error types

A distinction is made between the following types of error by the debug:

### Syntax errors

Syntax errors occur, for example, when a key word is written incorrectly or a parenthesis is not closed. When a syntax check from WinCC is used, syntax errors can be excluded before testing the scripts in Runtime. In principle, only syntactically correct scripts can be saved in Graphics Designer. The WinCC syntax check also checks:

- Whether the procedure names are unique in Global Script
- Whether an action module in Global Script contains only one procedure
- Whether the action part in Graphics Designer contains only one procedure

As a result of the syntax check in WinCC, the script is parsed without being executed. The script is parsed again directly before executing in Runtime. All the script parts are parsed, even those which are executed after a certain action has been executed at a later time.

If the script contains syntax errors, the script is not executed in Runtime.

### Runtime error

A Runtime error occurs when an attempt is made to execute an invalid/erroneous action, e.g. because a tag has not been defined. In order to intercept Runtime errors, use the "On Error Resume Next" command in the VBScript. The command causes the subsequent command to be executed following a Runtime error. The error code can subsequently be checked using the Err object. In order to deactivate the processing of Runtime errors in the script, use the "On Error Goto 0" command.

### Logical errors

The debugger is particularly helpful in clearing up logical errors. A logical error occurs when an unexpected result is received because, for example, a condition was incorrectly checked. To clear logical errors, go through the scripts step-by-step in order to detect the part which does not function properly.

## Basic Procedure

When an error has occurred and the debugger is open, the script appears in a window, write-protected. It is possible to navigate through the script document, set breakpoints, execute the script again in Runtime and to process the script step-by-step.

The most important steps for successful debugging of the scripts are described under "Processing Scripts Step-by-Step".

The source codes of the scripts cannot be edited directly in the scripts. When an error has been detected, the error can be corrected in the original script in WinCC, e.g. load the picture again and update it in the debugger.

---

### Note

Tips and tricks for debugging, frequently occurring error codes and other information is available in the Microsoft Script Debugger online help.

---

## Change Picture During Debug

If a picture change is executed during debugging, the script document of the "old" picture remains open but is no longer valid. If necessary, invalid errors are displayed because the objects called following the picture change are no longer available.

### See also

Testing with the Debugger (Page 87)

Executing Script Commands (Page 102)

How to Determine and Modify Tag and Property Values (Page 101)

How to Set Bookmarks in Scripts (Page 100)

Deleting Breakpoints (Page 99)

Setting Breakpoints (Page 98)

Processing Scripts Step-by-Step (Page 97)

Selecting a Script for Editing (Page 96)

Action and Procedure Names in the Debugger (Page 94)

Structure of VBScript Files (Page 92)

How to Activate the Debugger (Page 89)

Diagnostics (Page 80)

### 1.12.4.4 Structure of VBScript Files

#### Principle

In order not to hinder the simultaneous processing of cyclic and event-driven scripts in the graphical Runtime system, the event-driven actions and cyclic/tag-driven actions are strictly separated during processing. In this way, a cyclic action, for example, cannot hinder the execution of an action initiated by clicking a button.

To ensure this, the event-driven actions and the cyclic/tag-driven actions are stored in separate script files when saving a picture. If a global picture section has been defined in actions in Graphics Designer, this is copied into both scripts. In the same way, modules which are used in an action are also copied in both script files.

If a tag from a module should be used, the corresponding module must be called in. Otherwise, the module is not copied in the script file and an error is generated.

---

#### Note

Since the two script files are handled separately, they have no common data area. Therefore, there is no synchronization of global tags between the two script files. If synchronization is required, implement this using the DataSet object or internal WinCC tags.

---

## Structure of the Script Files


When scripts are debugged with a debugger, the script files always open the different Runtime systems.

In the case of the graphical Runtime system, this means that you receive two script files per picture:


- <Bildname>.pdl\_events: Contains the event-driven actions.
- <Bildname>.pdl\_triggers: Contains the cyclic and tag-controlled actions.

The following section describes how the script files are structured:

### Graphical Runtime system

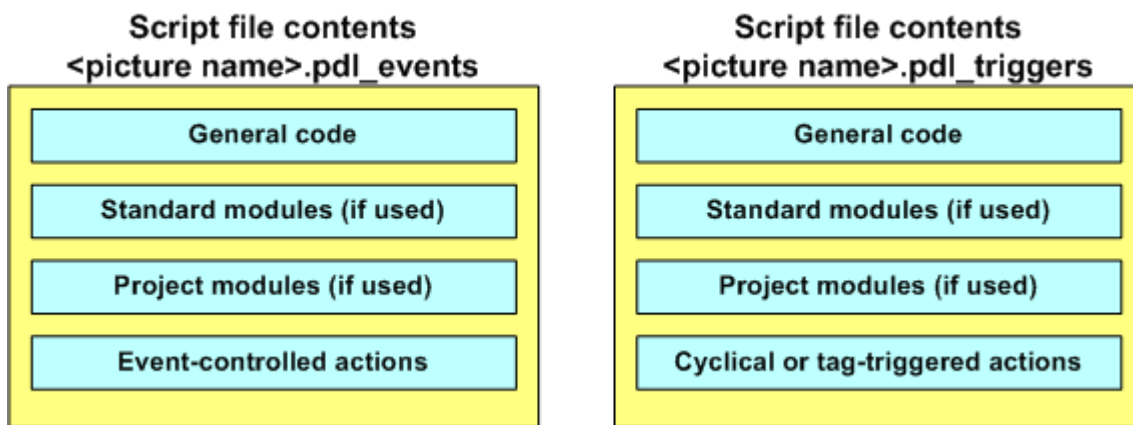

### Global Script Runtime

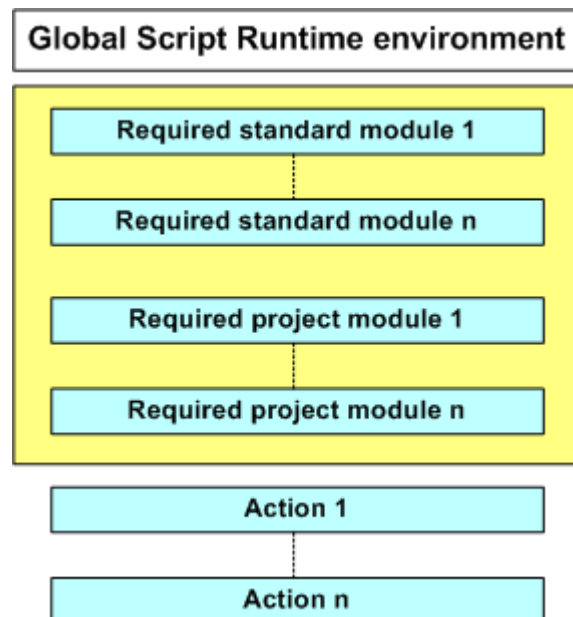

**Note**

Please note that the actions and procedures of the graphic Runtime system are not displayed with the action name in the script file under which it was saved in WinCC. The name conventions for actions and procedures in the script files sate described in "Action and Procedure Names in the Debugger".

**See also**

- How to Activate the Debugger (Page 89)
- Executing Script Commands (Page 102)
- How to Determine and Modify Tag and Property Values (Page 101)
- How to Set Bookmarks in Scripts (Page 100)
- Deleting Breakpoints (Page 99)
- Setting Breakpoints (Page 98)
- Processing Scripts Step-by-Step (Page 97)
- Selecting a Script for Editing (Page 96)
- Action and Procedure Names in the Debugger (Page 94)
- Principles of Debugging (Page 90)
- Testing with the Debugger (Page 87)
- Diagnostics (Page 80)

**1.12.4.5 Action and Procedure Names in the Debugger**

**Action and Procedure Names in the Debugger**

The names of procedures and actions in debugger script files differ from the names under which they were saved by the scripts in WinCC.

The action and procedure names in the script files are compiled according to the following rules:

Action type	Name of the script file
Cyclic or tag-driven actions on a property	ObjectName_PropertyName_Trigger
Mouse events	ObjektName_OnClick
	ObjektName_OnLButtonDown
	ObjektName_OnLButtonUp
	ObjektName_OnRButtonDown
	ObjektName_OnRButtonUp

Action type	Name of the script file
Keyboard events	ObjektName_OnKeyDown
	ObjektName_OnKeyUp
Object events	ObjektName_OnObjectChanged
	ObjektName_OnSetFocus
Events on properties	ObjektName_PropertyName_OnPropertyChanged
	ObjektName_PropertyName_OnPropertyState-Changed
Picture events	Document_OnOpen
	Document_OnClosed

### Permitted length of action names

The names of the actions in the script files are limited to 255 characters. Each special character used in an object name is converted to five characters. The special characters are represented by a four-place hexadecimal code behind the preceding X. If, for example, an action is configured on a button with the name "PushHere" per mouse click, the script in the script file appears as "PushHere\_OnClick".

If the object name compiled is too long, an error message is issued during the syntax check in WinCC. As a result of this restriction, graphic object names cannot be selected with any length during configuration.

---

#### Note

If you wish to determine the name of an object in Runtime, press <CTRL+ALT+SHIFT> and position the mouse over the corresponding object. The picture name and object name then appears in a tooltip.

---

### See also

[Executing Script Commands \(Page 102\)](#)  
[How to Determine and Modify Tag and Property Values \(Page 101\)](#)  
[How to Set Bookmarks in Scripts \(Page 100\)](#)  
[Deleting Breakpoints \(Page 99\)](#)  
[Setting Breakpoints \(Page 98\)](#)  
[Processing Scripts Step-by-Step \(Page 97\)](#)  
[Selecting a Script for Editing \(Page 96\)](#)  
[Structure of VBScript Files \(Page 92\)](#)  
[Principles of Debugging \(Page 90\)](#)  
[How to Activate the Debugger \(Page 89\)](#)

Testing with the Debugger (Page 87)

Diagnostics (Page 80)

### 1.12.4.6 Selecting a Script for Editing

#### Introduction

If the Microsoft Script Debugger is called in Windows instead of automatic activation using WinCC, scripts which are currently running can be called in for editing in Runtime.

#### Requirement

Runtime is activated, the picture to be debugged is active.

#### Procedure

1. Start Microsoft Visual Studio 2008.
2. Create a new script file:
  - File > New > File... > Select script template "Windows Script Host".
3. Start debugging with "Debug > Attach to Process".  
Select, for example, gscrt.exe or pdlrt.exe.

#### See also

Executing Script Commands (Page 102)

How to Determine and Modify Tag and Property Values (Page 101)

How to Set Bookmarks in Scripts (Page 100)

Deleting Breakpoints (Page 99)

Setting Breakpoints (Page 98)

Processing Scripts Step-by-Step (Page 97)

Action and Procedure Names in the Debugger (Page 94)

Structure of VBScript Files (Page 92)

Principles of Debugging (Page 90)

How to Activate the Debugger (Page 89)

Testing with the Debugger (Page 87)

Diagnostics (Page 80)



## 1.12.4.7 Processing Scripts Step-by-Step

### Introduction

The Microsoft Script Debugger can be used to process the scripts step-by-step in order, for example, to locate logical errors systematically. The effect of each individual script line can be tested in Runtime.

### The Procedure in Principle

1. Activate the document to be debugged in Runtime.
2. Start the debugger manually from the Start menu and open the required script file or activate the debugger in WinCC. When activated in WinCC, the debugger automatically opens when an attempt is made to execute an erroneous script.
3. Set a breakpoint in the script file. Breakpoints are normally set in front of code lines in which errors are suspected.
4. Switch to WinCC Runtime and trigger an action which causes the script to run. The Debugger stops at the first breakpoint and marks the current line.
5. In order to go through the script document step-by-step, select one of the following menu commands:  
"Debug" > "Step Into": Skip to the next code line. If the script calls a procedure in this line, it skips to the procedure using the "Step Into" command. The procedure called can then be processed step-by-step.  
  
"Debug" > "Step Over": Skips the procedure called. The procedure is called but the debugger does not stop at the individual lines of the procedure. Instead, it moves to the next line of the current script after the procedure has been executed.
6. To interrupt the step-by-step processing of a procedure, select the "Debug" > "Step Out" menu commands. The debugger then skips to the next action.
7. Proceed step-by-step to the end of the document or select the "Debug" > "Run" menu items to start the script again in Runtime.

### See also

- Principles of Debugging (Page 90)
- Executing Script Commands (Page 102)
- How to Determine and Modify Tag and Property Values (Page 101)
- How to Set Bookmarks in Scripts (Page 100)
- Deleting Breakpoints (Page 99)
- Setting Breakpoints (Page 98)
- Selecting a Script for Editing (Page 96)
- Action and Procedure Names in the Debugger (Page 94)
- Structure of VBScript Files (Page 92)

How to Activate the Debugger (Page 89)

Testing with the Debugger (Page 87)

Diagnostics (Page 80)

### 1.12.4.8 Setting Breakpoints

#### Introduction

Breakpoints can be set in a script to stop at specific points when processing it and to start the debugger. Set a breakpoint in front of a line, for example, which you suspect contains a script error.

It is possible to:

- Set breakpoints at specific lines to locate logical errors in the script step-by-step.
- Set a breakpoint and call the debugger before the next line in the script is processed. This procedure is used, for example, for events such as "Change picture".

When a script file is updated in the debugger, all the breakpoints are lost.


If a breakpoint is set in one of the script files "<Bildname>.pdl\_trigger" or "<Bildname>.pdl\_event", all the trigger-driven or all event-driven procedures are stopped, respectively, in Runtime.

#### Requirements

Runtime is activated, the picture to be debugged is active.

#### Procedure

##### Setting a breakpoint

1. Start the debugger and select the script. If automatic activation of the debuggers in WinCC has been selected, the debugger is called in as soon as an erroneous script is executed.
2. Position the cursor on the action in which a breakpoint should be set.
3. Open the "Debug" menu and select the "Toggle Breakpoint" item or the icon  from the toolbar.  
The next executable line will be marked by a red dot.
4. Switch to WinCC Runtime and execute the action you wish to debug.  
The Debugger stops at the first breakpoint it finds in the script. The current line is displayed on a yellow background. The script can then be processed step-by-step.

#### See also

Deleting Breakpoints (Page 99)

Executing Script Commands (Page 102)

How to Determine and Modify Tag and Property Values (Page 101)



How to Set Bookmarks in Scripts (Page 100)  
Setting Breakpoints (Page 98)  
Selecting a Script for Editing (Page 96)  
Action and Procedure Names in the Debugger (Page 94)  
Structure of VBScript Files (Page 92)  
Principles of Debugging (Page 90)  
How to Activate the Debugger (Page 89)  
Testing with the Debugger (Page 87)  
Diagnostics (Page 80)

### 1.12.4.9 Deleting Breakpoints

#### Introduction

When an error has been cleared properly, the breakpoints in a script can be cleared individually or all together.

#### Procedure

1. Position the cursor in the line whose breakpoint is to be deleted.
2. Open the "Debug" menu and select the "Toggle Breakpoint" item or the icon  from the toolbar.  
The next line will be displayed without a mark.
3. To delete all the breakpoints in a script, open the "Debug" menu and select the "Clear all Breakpoints" entry or the icon  from the toolbar.

#### See also

Executing Script Commands (Page 102)  
How to Determine and Modify Tag and Property Values (Page 101)  
How to Set Bookmarks in Scripts (Page 100)  
Setting Breakpoints (Page 98)  
Selecting a Script for Editing (Page 96)  
Action and Procedure Names in the Debugger (Page 94)  
Structure of VBScript Files (Page 92)  
Principles of Debugging (Page 90)  
How to Activate the Debugger (Page 89)  
Testing with the Debugger (Page 87)  
Diagnostics (Page 80)

### 1.12.4.10 How to Set Bookmarks in Scripts

#### Introduction

During the debug routine, bookmarks can be set on code lines so that they can be found easier again one line later.

#### Setting or deleting bookmarks

Position the mouse pointer in the row where you wish to set a bookmark, and click <CTRL+F9> to set a bookmark or <CTRL+SHIFT+F9> to delete one.

#### Skipping to the next bookmark

Press <F9> to go to the next bookmark in the script.

#### Skipping to the previous bookmark

Press <SHIFT+F9> to go to the previous bookmark in the script.

#### See also

[Executing Script Commands \(Page 102\)](#)

[How to Determine and Modify Tag and Property Values \(Page 101\)](#)

[Deleting Breakpoints \(Page 99\)](#)

[Setting Breakpoints \(Page 98\)](#)

[Selecting a Script for Editing \(Page 96\)](#)

[Action and Procedure Names in the Debugger \(Page 94\)](#)

[Structure of VBScript Files \(Page 92\)](#)

[Principles of Debugging \(Page 90\)](#)

[How to Activate the Debugger \(Page 89\)](#)

[Testing with the Debugger \(Page 87\)](#)

[Diagnostics \(Page 80\)](#)

## 1.12.4.11 How to Determine and Modify Tag and Property Values

### Introduction

While a script is running in Runtime, the "Command Window" of the debugger can be used, for example, to compile and modify values of tags or properties in the script currently running. It is possible, for example, to reset a process value for a script to zero without having to stop the process.

---

#### Note

If you wish to determine the name of a WinCC object in Runtime, click <CTRL+ALT+SHIFT> and position the mouse over the corresponding object. The picture name and object name then appears in a tooltip.

---

### Requirements

The script runs in Runtime and the debugger is opened.

### Procedure

1. Set at least one breakpoint in the current script.
2. Switch to WinCC Runtime and trigger an action which causes the script to be executed. The Debugger stops at the first breakpoint.
3. Open the "View" menu and activate the "Command Window" entry. The "Command Window" opens.
4. In order to determine the value of a tag or property, enter a "?" followed by a Space and the name of the tag or property whose value is to be determined, e.g. "?myTag". Press <RETURN> to execute the command.
5. In order to modify the value of a tag/property, assign a value in the VBS syntax.

### See also

Principles of Debugging (Page 90)  
Executing Script Commands (Page 102)  
How to Set Bookmarks in Scripts (Page 100)  
Deleting Breakpoints (Page 99)  
Setting Breakpoints (Page 98)  
Selecting a Script for Editing (Page 96)  
Action and Procedure Names in the Debugger (Page 94)  
Structure of VBScript Files (Page 92)  
How to Activate the Debugger (Page 89)

Testing with the Debugger (Page 87)

Diagnostics (Page 80)

### 1.12.4.12 Executing Script Commands

#### Introduction

While a script is running in Runtime, the "Command Window" of the debugger can be used to execute script commands directly and thus manipulate the running of the current script. The script commands can be executed directly for test purposes without creating the command in a script and activating it. It is possible, for example:

- To retrieve methods
- To retrieve procedures
- To manipulate object properties

"Command Window" can basically be used to execute all commands which can also be executed from a VBScript.

#### Requirements

The script runs in Runtime and the debugger is opened.

#### Procedure

1. Set at least one breakpoint in the current script.
2. Switch to WinCC Runtime and trigger an action which causes the script to be executed. The Debugger stops at the first breakpoint.
3. Open the "View" menu and activate the "Command Window" entry. The "Command Window" opens.
4. Enter the required command and press "ENTER".

---

#### Note

If a faulty command is entered in the Command window, no error message is issued in Runtime. The message "<Script Error>" appears in the Command window instead.

---

#### See also

How to Determine and Modify Tag and Property Values (Page 101)

How to Set Bookmarks in Scripts (Page 100)

Deleting Breakpoints (Page 99)

Setting Breakpoints (Page 98)

Selecting a Script for Editing (Page 96)

Action and Procedure Names in the Debugger (Page 94)

Structure of VBScript Files (Page 92)

Principles of Debugging (Page 90)

How to Activate the Debugger (Page 89)

Testing with the Debugger (Page 87)

Diagnostics (Page 80)

## 1.13 Printing VBScripts

### Principle

The actions and procedures configured in both Global Script and in Graphics Designer can be documented in WinCC.

The documentation options are distinguished between:

- **Print Feedback Doc:** In Graphics Designer, all the configured actions are printed with the feedback of the current picture. The Feed Back contains the C-actions and VBS actions, located beside each other, differentiated by the source text (C or VBScript).
- **Print current script:** The Feed Back in Global Script always contains the currently open procedure or action.

WinCC provided predefined print layouts for the layout of the Feed Back. Customized print layouts can also be developed and linked to the Print Job tab control with "Project Documentation - Setup".

### Procedure

1. Open Global Script or Graphics Designer according to the scripts to be documented.
2. Configure the print job, if necessary, using the "Project Documentation - Setup" command.
3. Use the "View Project Documentation" command to preview the data to be printed.
4. Select the menu commands "File" > "Print Project Documentation" to print the data.

### See also

[Creating and Editing Actions \(Page 52\)](#)

[Creating and Editing Procedures \(Page 36\)](#)

[VBScript Editors \(Page 26\)](#)

[Using Visual Basic Script in WinCC \(Page 12\)](#)




## 1.14 VBS Reference

### 1.14.1 VBS Reference

#### VBS object model in WinCC

The WinCC object model of the graphic Runtime system enables access to graphic objects and tags in Runtime.

When you click on an object name, you are shown a detailed description.

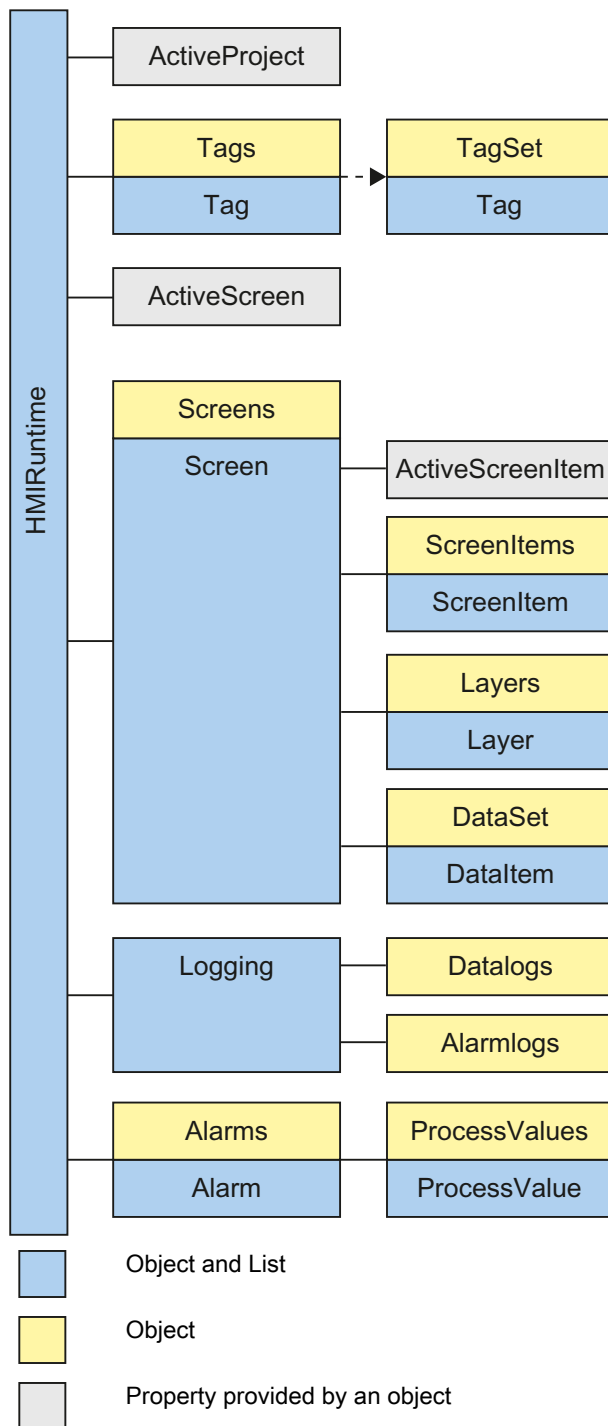

### The VBS object model in a faceplate type

The VBS object model is not valid for WinCC in a Faceplate type. It is replaced by a completely new model.

The VBS object model of the Faceplate type provides you with access to the graphic objects and Faceplate tags of the Faceplate type in Runtime.

## Objects

Objects and lists are provided for access to all the objects in the graphic Runtime systems: Graphic objects, pictures, layers and tags.

## Properties

The properties of the individual objects can be used to modify specific graphic objects and tags in Runtime , e.g. activating an operating element per mouse click or triggering a color change by modifying a tag value.

## Methods

Methods, which are applied to individual objects, can be used to read tag values for further processing or display diagnostics messages in Runtime.

## See also

Object types of the ScreenItem object (Page 143)

Methods (Page 710)

Properties (Page 301)

Objects and Lists (Page 107)

## 1.14.2 Objects and Lists

### 1.14.2.1 Objects and Lists


#### Overview

The objects and lists provided in WinCC object models enables access to graphic objects and tags in Runtime.

#### Navigation in Object Models

Access is made to objects in the VBS object model in hierarchical sequence. If, for example, a picture element is accessed within a picture, access is made to the picture element in the picture via its parent object (the surrounding picture).

**Example:**

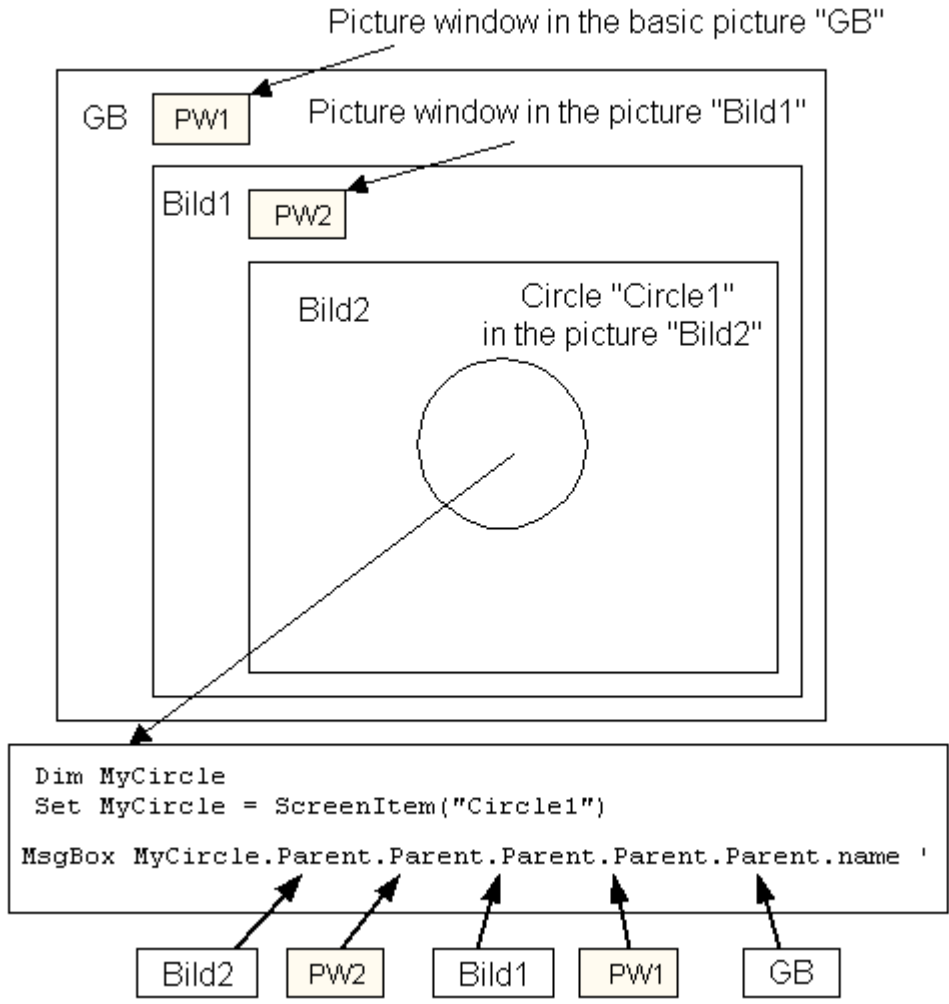

Only the basic picture name is issued in this example.

**Access to Graphic Objects**

In WinCC, access is made to pictures, layers and graphic objects in Runtime using the superordinate "HMIRuntime" object. Access to objects and layers is always made via the picture (screen) in which they are contained.

**Access to Tags**

In WinCC, tags are accessed directly in Runtime using the superordinate "HMIRuntime" object. Tag values can be read out or set anew.

## Lists

Lists of WinCC object models behave in the same way as standard collections of VBS. Exception: The "Tags" list has no Enum function.

## Available Objects

- Alarm
- Alarms
- AlarmLogs
- Dataltem
- DataLogs
- DataSet
- HMIRuntime
- Item
- Layer
- Layers
- Logging
- ProcessValues
- ProcessValue
- Project
- ScreenItem
- ScreenItems
- Screen
- Screens
- Tag
- Tags
- TagSet

## See also

[ScreenItems Object \(List\) \(Page 129\)](#)

[TagSet Object \(List\) \(Page 141\)](#)

[Tags Object \(List\) \(Page 140\)](#)

[Tag Object \(Page 137\)](#)

[Screens Object \(List\) \(Page 134\)](#)

[Screen Object \(Page 131\)](#)

[ScreenItem Object \(Page 125\)](#)

Layers Object (Listing) (Page 121)


Layer Object (Page 120)

Item Object (Page 119)

HMIRuntime Object (Page 118)

### 1.14.2.2 Alarm object

#### Description

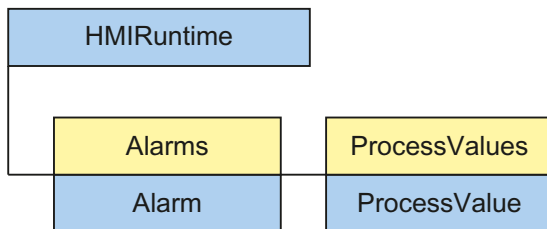

The alarm object is used to access the Alarms object list.

---

#### Note

The properties of the alarm object are not automatically updated when the values of the properties change.


---

#### See also

Alarms object (list) (Page 110)

### 1.14.2.3 Alarms object (list)

#### Description

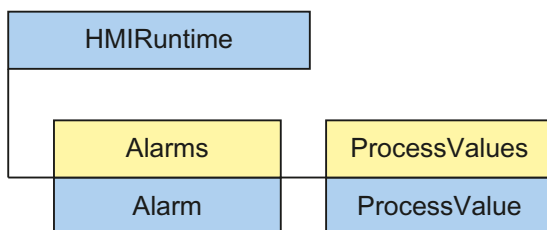

Use the alarm object to trigger existing messages.

## Usage

Using the "Alarms" list you can:

- Access a message in the list (Item method)
- Create a new alarm object (Create method)
- Read the alarm ID of the message (AlarmID attribute)
- Set the status of a message (State property)
- Set the time stamp of the message (Timestamp property)
- Generate an instance of the alarm object (Instance property)
- Read the name of the computer on which the message came (ComputerName property)
- Read the name of the user who triggered the message (UserName property)
- Set the names of the process value blocks (ProcessValues property)
- Set the comment of the message (Comment property)
- Set the server prefix of the message (Context property)

## Example

In the following example, the message with the alarm number "1" configured in the Alarm Logging Editor will be triggered:

```
'VBS360
Dim MyAlarm
Set MyAlarm = HMIRuntime.Alarms(1)
MyAlarm.State = 5 'hmiAlarmStateCome + hmiAlarmStateComment
MyAlarm.Comment = "MyComment"
MyAlarm.UserName = "Hans-Peter"
MyAlarm.ProcessValues(1) = "Process Value 1"
MyAlarm.ProcessValues(4) = "Process Value 4"
MyAlarm.Create "MyApplication"
```


## See also

[TimeStamp Property \(Page 622\)](#)  
[ComputerName property \(Page 391\)](#)  
[Context property \(Page 391\)](#)  
[State property \(Page 587\)](#)  
[AlarmID property \(Page 308\)](#)  
[Instance property \(Page 454\)](#)  
[Comment property \(Page 390\)](#)  
[UserName property \(Page 676\)](#)

- ProcessValue property (Page 545)
- Alarm object (Page 110)
- ProcessValues Object (List) (Page 124)
- Create method (Page 716)
- Item Method (Page 770)

### 1.14.2.4 AlarmLogs Object

#### Description

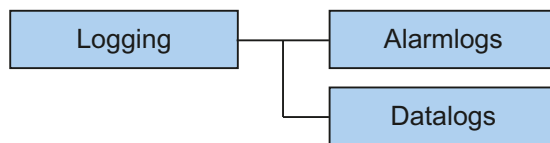

Using the object, swapped archive segments of Alarm Logging may be reconnected to Runtime, or previously swapped archive segments of Alarm Logging may be deleted again. Therein

- Archive segments to be swapped are copied to the common archiving directory of the WinCC project, or
- previously swapped archive segments are deleted in the common archiving directory.

Using parameters you may control from where archive segments are to be swapped. You may also specify the time period over which archive segments are to be swapped or deleted. Archive segments are copied to the common archiving directory of the project.

If an error occurred during the operation with archiving segments, the method used returns an error message. Additional information may be found under the subject heading "Error Messages from Database Area".

#### Usage

Previously swapped archive segments of Alarm Logging may be connected with Runtime ("Restore" method).

Previously swapped archive segments of Alarm Logging may be deleted from the Runtime project ("Remove" method).

#### Example:

In the following example, archive segments from Alarm Logging are swapped and the return value is output as Trace.

```
'VBS187  
HMIRuntime.Trace "Ret: " & HMIRuntime.Logging.AlarmLogs.Restore("D:  
\Folder","2004-09-14","2004-09-20",-1) & vbNewLine
```



**See also**


Error Messages from Database Area (Page 820)

Restore Method (Page 794)

Remove Method (Page 789)

DataLogs Object (Page 114)

Logging Object (Page 122)

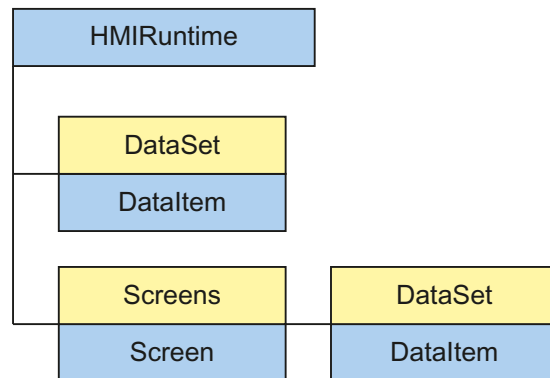**1.14.2.5 Dataltem Object****Description**

The Dataltem object is used to access the contents of the DataSet list. Values or object references are stored in the list as Dataltem.

Access uses the name under which the value was added to the list. Single access using an index is not recommended since the index changes during adding or deleting of values. The index may be used to output the complete contents of the list. The output is in alphabetical order.

**Note**

For object references it must be ascertained that objects are multiread-enabled.

**Example:**

The example shows how the value of 'Motor1' is output as Trace.

```
'VBS163
HMIRuntime.Trace "motor1: " & HMIRuntime.DataSet("motor1").Value & vbNewLine
```

The following example enumerates all Dataltem objects of the DataSet list. Name and value are output as Trace.

```
'VBS164  
Dim data  
For Each data In HMIRuntime.DataSet  
HMIRuntime.Trace data.Name & ": " & data.Value & vbNewLine  
Next
```

---

**Note**

For objects, value may possibly not be output directly


---

**See also**

- Screen Object (Page 131)
- HMIRuntime Object (Page 118)
- DataSet Object (List) (Page 116)
- Value Property (Page 680)
- Name Property (Page 509)

**1.14.2.6 DataLogs Object**

**Description**

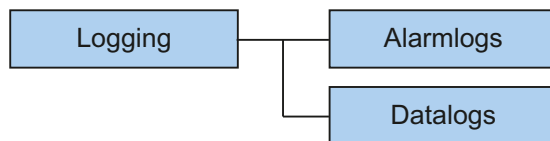

Using the object, swapped archive segments of Tag Logging may be reconnected to Runtime, or previously swapped archive segments of Tag Logging may be deleted again. Therein

- Archive segments to be swapped are copied to the common archiving directory of the WinCC project, or
- previously swapped archive segments are deleted in the common archiving directory.

Using parameters you may control from where archive segments are to be swapped. You may also specify the time period over which archive segments are to be swapped or deleted. In addition, you may set the archive type ("Tag Logging Fast", "Tag Logging Slow", "Tag Logging

Fast and Tag Logging Slow"). Archive segments are copied to the common archiving directory of the project.

If an error occurred during the operation with archiving segments, the method used returns an error message. Additional information may be found under the subject heading "Error Messages from Database Area".

## Usage

Previously swapped archive segments of Tag Logging may be connected with Runtime ("Restore" method).

Previously swapped archive segments of Tag Logging may be deleted from the Runtime project ("Remove" method).

## Example:

In the following example, fast archive segments from Tag Logging are swapped and the return value is output as Trace.

```
'VBS188
HMIRuntime.Trace "Ret: " & HMIRuntime.Logging.DataLogs.Restore("D:
\Folder", "2004-09-14", "2004-09-20", -1, 1) & vbNewLine
```

## See also

[Error Messages from Database Area \(Page 820\)](#)

[Restore Method \(Page 794\)](#)


[Remove Method \(Page 789\)](#)

[AlarmLogs Object \(Page 112\)](#)

[Logging Object \(Page 122\)](#)

### 1.14.2.7 DataSet Object (List)

#### Description

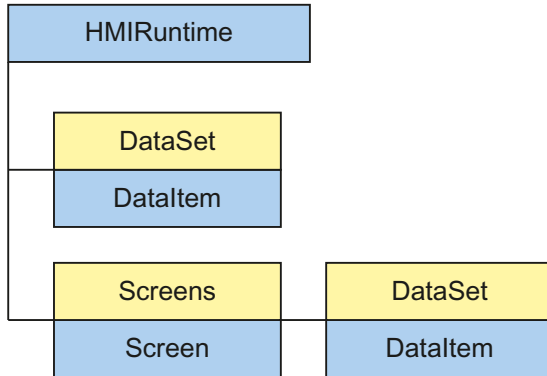

Using the DataSet object, data may be exchanged across several actions.

A DataSet object is global and defined by the Screen object. Any VBS action may access the data.

The DataSet object at the Screen object must be addressed according to picture hierarchy and shall persist as long as the picture is displayed. The global object persists over the entire Runtime time period.

Access uses the Dataltem object.

---

#### Note

Objects of type Screen, Screens, ScreenItem, ScreenItems, Tag and TagSet cannot be included in the DataSet list.

The DataSet object does not support any classes.

---

#### Usage

Using the "DataSet" list, you may:

- Output or process (enumerate) all objects in the list.
- Output the number of elements contained ("Count" property).
- To process a specific object in the list ("Item" method).
- Add an object to the list ("Add" method).
- Remove a specific object from the list ("Remove" method).
- Remove all objects from the list ("RemoveAll" method).

Access to list elements uses:

```
HMIRuntime.DataSet("Itemname")
```

For a picture-specific list, access uses:

```
HMIRuntime.Screens("Screenname").DataSet("Itemname")
```

In a picture, you may access the DataSet object of the picture by using:

```
DataSet("Itemname")
```

If upon access the stated name does not exist in the list, VT\_Empty is returned and an Exception is triggered.

### Example:

The example shows how to add a value to the list, how to read it and remove it. It make sense to perform this in several different actions.


```
'VBS162
HMIRuntime.DataSet.Add "motor1", 23
HMIRuntime.Trace "motor1: " & HMIRuntime.DataSet("motor1").Value & vbNewLine
HMIRuntime.DataSet.Remove("motor1")
```

### See also

- [DataItem Object \(Page 113\)](#)
- [RemoveAll Method \(Page 792\)](#)
- [Remove Method \(Page 789\)](#)
- [Item Method \(Page 770\)](#)
- [Count Property \(Page 393\)](#)
- [Add Method \(Page 713\)](#)

### 1.14.2.8 HMIRuntime Object

#### Description

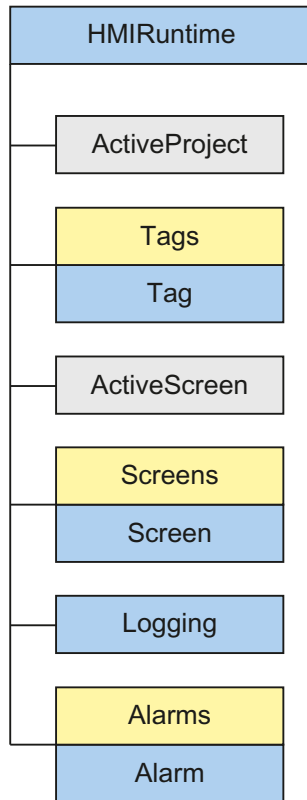

The HMIRuntime object represents the graphic Runtime environment.

#### Usage

The "HMIRuntime" object can be used for the following, for example:

- Read or set the current Runtime language ("Language" property).
- Read or set the name of the current base picture ("BaseScreenName" property).
- Read the path of the active Runtime project ("ActiveProject" property).
- Access tags ("Tags" property).
- Access tags of a list ("DataSet" property).
- Exit Runtime ("Stop" method).
- Display messages in a diagnostics window ("Trace" method).

**Example:**

The following command terminates WinCC Runtime:

```
'VBS3  
HMIRuntime.Stop
```

**See also**

- Screens Object (List) (Page 134)
- TagSet Object (List) (Page 141)
- Tags Object (List) (Page 140)
- Logging Object (Page 122)
- DataSet Object (List) (Page 116)
- Visible Property (Page 696)
- Trace Method (Page 811)
- Tags Property (Page 597)
- Stop Method (Page 810)
- AlignmentLeft Property (Page 309)
- Logging Property (Page 484)
- Language Property (Page 458)
- DataSet Property (Page 398)
- CurrentContext Property (Page 394)
- BaseScreenName Property (Page 342)
- ActiveProject Property (Page 303)
- ActiveScreen Property (Page 304)
- MenuToolBarConfig Property (Page 495)
- Alarms object (list) (Page 110)

**1.14.2.9 Item Object****Description**

The "Item" object provides a reference to the current object.

## Usage

The "Item" object is used, for example, to address the properties of the object currently selected in Graphics Designer.

## Example:

In the following example, a rectangle has been created. When the object has been selected, all the properties of the current object can be set a background color red:


```
'VBS195  
Item.BackColor = RGB(255,0,0)
```

## See also

Objects and Lists (Page 107)

### 1.14.2.10 Layer Object

#### Description



The layer object returns the result of access to the layers list.

#### Parent Object

Picture, in which the picture layer is.

#### Usage

Depending on certain events, the Layer object can be used to obtain access to the properties of a complete layer in order, for example, to hide or unhide a layer with operating elements according to the operator authorization.



The "Layer" object can be used to:

- To activate or deactivate the visualization of a layer ("Visible" property).
- To read out the name of a layer ("Name" property).

---

**Note**

The layer property specifies the layer in which the object is located. The layer "0" is output as "Layer0".

When accessed, the layers are counted up from 1 in VBS. Therefore, the layer "1" must be addressed with "layers(2)".

---

**Example:**

In the following example, Layer 1 is set invisible:

```
'VBS4  
Layers(2).Visible = vbFalse
```


**See also**

Layer Object (Page 120)

Visible Property (Page 696)

Parent Property (Page 529)

Name Property (Page 509)

**1.14.2.11 Layers Object (Listing)****Description**

The Layers list enables access to all 32 layers of the graphical Runtime system.

**Parent Object**

Picture, in which the picture layer is.

## Usage

The "Layers" list can be used to:

- Process all layers in the list ("\_NewEnum" property).
- Count all layers contained in the list ("Count" property).
- Process a layer from the list ("Item" method).

The properties represent default properties and methods of a list and are not described in detail in the WinCC documentation.

## See also

Parent Property (Page 529)


Item Method (Page 770)

Count Property (Page 393)

Layer Object (Page 120)

### 1.14.2.12 Logging Object

#### Description

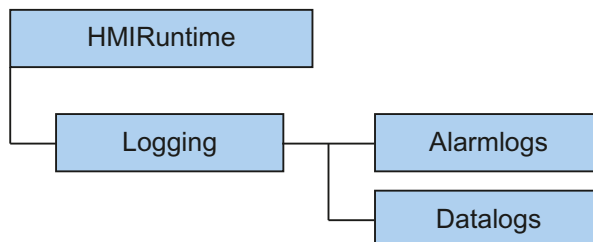

Using the object, swapped archive segments may be reconnected to Runtime, or previously swapped archive segments may be deleted again. Therein

- Archive segments to be swapped are copied to the common archiving directory of the WinCC project, or
- previously swapped archive segments are deleted in the common archiving directory.

Using parameters you may control from where archive segments are to be swapped. You may also specify the time period over which archive segments are to be swapped or deleted. Archive segments are copied to the common archiving directory of the project.

If an error occurred during the operation with archiving segments, the method used returns an error message. Additional information may be found under the subject heading "Error Messages from Database Area".

## Usage

Previously swapped archive segments of Alarm Logging and Tag Logging may be connected with Runtime ("Restore" method).

Previously swapped archive segments of Alarm Logging and Tag Logging may be deleted from the Runtime project ("Remove" method).

### Example:

In the following example, archive segments from Alarm Logging and Tag Logging are swapped and the return value is output as Trace.

```
'VBS189
HMIRuntime.Trace "Ret: " & HMIRuntime.Logging.Restore("D:
\Folder", "2004-09-14", "2004-09-20", -1) & vbNewLine
```

### See also

[Error Messages from Database Area \(Page 820\)](#)  
[DataLogs Object \(Page 114\)](#)  
[AlarmLogs Object \(Page 112\)](#)  
[Restore Method \(Page 794\)](#)  
[Remove Method \(Page 789\)](#)  
[DataLogs Property \(Page 398\)](#)  
[AlarmLogs Property \(Page 308\)](#)

## 1.14.2.13 ProcessValue Object

### Description

Alarms	ProcessValues
Alarm	ProcessValue

The ProcessValue object is used to access the ProcessValues object list.

### Note

Only the 10 predefined ProcessValues are supported.

### See also

[ProcessValues Object \(List\) \(Page 124\)](#)

### 1.14.2.14 ProcessValues Object (List)

#### Description



#### Usage

Using the "ProcessValues" list, you can:

- Edit a ProcessValue from the list ("Item" method)
- Display or edit all the objects in the list (\_NewEnum attribute)
- Count all ProcessValues contained in the list (Count property)
- Read or set the values of the ProcessValue object (Value property)

The properties represent default properties and methods of a list and are not described in detail in the WinCC documentation.

#### See also

Alarms object (list) (Page 110)

ProcessValue Object (Page 123)


Count Property (Page 393)

Value Property (Page 680)

Item Method (Page 770)

### 1.14.2.15 Project Object

#### Description

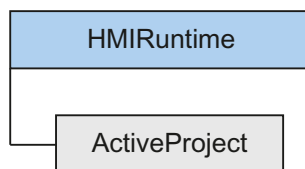

Using the object, information may be requested from the current Runtime project.

The project object is returned as the result of ActiveProject.

## Usage

Using the "Project" object, you may:

- Read the path of the current Runtime project ("Path" property).
- Read the name of the current Runtime project, without path or file extension ("Name" property).

## Example:

The following example returns name and path of the current Runtime project as Trace:

```
'VBS159
HMIRuntime.Trace "Name: " & HMIRuntime.ActiveProject.Name & vbNewLine
HMIRuntime.Trace "Path: " & HMIRuntime.ActiveProject.Path & vbNewLine
```

## See also


ActiveProject Property (Page 303)

Name Property (Page 509)

Path Property (Page 531)

### 1.14.2.16 ScreenItem Object

#### Description



The ScreenItem object returns the result of access to the ScreenItem list.

#### Parent Object

Picture containing the picture element.

#### Usage

The ScreenItem object can be used to access the properties of graphic objects within a picture according to certain events.

The "ScreenItem" object can be used for the following, for example:

- To activate or deactivate the visualization of an object ("Visible" property).
- To release or block the operation of an object ("Enabled" property).
- Change the width and height of an object ("Height" and "Width" properties).
- Change the position of an object ("Top" and "Left" properties).
- Read and define a layer in which a graphic object is located ("Layer" property).
- Read or define the name of a graphic object ("ObjectName" property).
- Define a reference to the superordinate picture ("Parent" property).

Using the "Activate" method, the focus is set on the respective ScreenItem object. If the focus cannot be set because the object is non-operable, for example, an error is generated. Using error processing (On Error Resume Next), the error may be evaluated.

### Possible features of ScreenItem

The "ScreenItem" object can contain the following object types:


Standard objects	Smart objects	Windows objects	Tube objects	Controls	Others
Ellipse	3D bar	Button	Double T-piece	Siemens HMI Symbol Library	Customized Object
Ellipse arc	Application window	Check box	Polygon tube	WinCC AlarmControl	Group
Ellipse segment	Bar	Radio box	Tube bend	WinCC digital/analog clock control	
Circle	Picture window	Round button	T-piece	WinCC Function-TrendControl	
Circular arc	Control	Slider		WinCC gauge control	
Pie segment	I/O field			WinCC Online-TrendControl	
Line	Faceplate Instance			WinCC OnlineTableControl	
Polygon	Graphic object			WinCC push button control	
Polyline	Combo box			WinCC RulerControl	
Rectangle	List box			WinCC slider control	
Rounded rectangle	Multiple row text			WinCC UserArchiveControl	
Connector	OLE object				
	Group display				
	Text list				
	Status display				

Detailed descriptions of the individual object types is provided under "ScreenItem Object Types". The ScreenItem object's "Type" property can be used to address the object types via the VBS Type ID.

## Object properties


The "ScreenItem" object has different properties according to the features. The following section describes the properties which all ScreenItem object types have:

```
Sub OnClick(ByVal Item)
Dim obj
Set obj = ScreenItems("Circle1").
End Sub
```

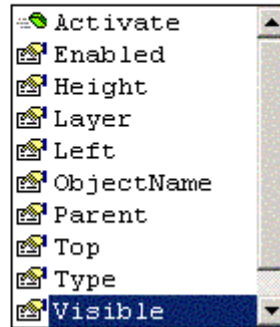

When a specific object type is addressed, certain further properties are added to the standard properties:

```
Sub OnClick(ByVal Item)
Dim obj
Set obj = ScreenItems("Circle1")
obj.|
End
```

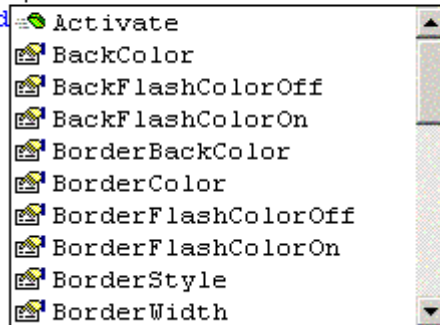

The additional properties are indicated in the descriptions of the individual object types.

## Example

In the following example, the radius of a circle is set to 2 in Runtime per mouse click:

```
Sub OnClick(ByVal Item)
'VBS5
Dim objCircle
Set objCircle= ScreenItems("Circle1")
objCircle.Radius = 2
End Sub
```


## See also

- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [Parent Property \(Page 529\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Property \(Page 460\)](#)
- [Height Property \(Page 443\)](#)
- [Enabled Property \(Page 408\)](#)
- [Activate Method \(Page 712\)](#)
- [Example: How to Read Tag Values \(Page 830\)](#)
- [Example: Writing tag values \(Page 828\)](#)
- [Properties \(Page 301\)](#)
- [Objects and Lists \(Page 107\)](#)
- [Object types of the ScreenItem object \(Page 143\)](#)
- [Object types of the ScreenItem object \(Page 143\)](#)



### 1.14.2.17 ScreenItems Object (List)

#### Description



The "ScreenItems" list can be used to reference an object in the picture.

#### Parent Object

Picture containing the picture element.

#### Usage

The "ScreenItems" list can be used to:

- To display or edit all objects in the list (i.e. all objects within a picture) ("`_NewEnum`" property).
- To count the objects in a picture ("`Count`" property).
- To process a specific object in the list ("`Item`" method).

The properties are standard properties and methods of a collection and are not described in detail in the WinCC documentation.

#### Special features of the ScreenItem object

If an external control (ActiveX control or OLE object) is embedded in WinCC, it is possible that the properties of the embedded controls have the same name with the general properties of the ScreenItem object. In such cases, the ScreenItem properties have priority.

The properties of the embedded controls can also be addressed via the "object" property:

The "object" property is only provided by ActiveX controls and OLE objects.

## 1.14 VBS Reference

### Example:

```
'Control1 is an embedded ActiveX-Control with property "type"
'VBS196
Dim Control
Set Control=ScreenItems("Control1")
Control.object.type

'Control1 is a WinCC-Control
'VBS197
Dim Control
Set Control=ScreenItems("Control1")
Control.type
```

### Example

In the following example, the name of the objects in the current picture are displayed in a message box:


```
Sub OnClick(ByVal Item)
'VBS6
Dim lngAnswer
Dim lngIndex
lngIndex = 1
For lngIndex = 1 To ScreenItems.Count
    lngAnswer = MsgBox(ScreenItems(lngIndex).Objectname, vbOKCancel)
    If vbCancel = lngAnswer Then Exit For
Next
End Sub
```

### See also

- Count Property (Page 393)
- Example: How to Read Tag Values (Page 830)
- Example: Writing tag values (Page 828)
- ScreenItem Object (Page 125)
- Parent Property (Page 529)
- Item Method (Page 770)
- Object types of the ScreenItem object (Page 143)

### 1.14.2.18 Screen Object

#### Description

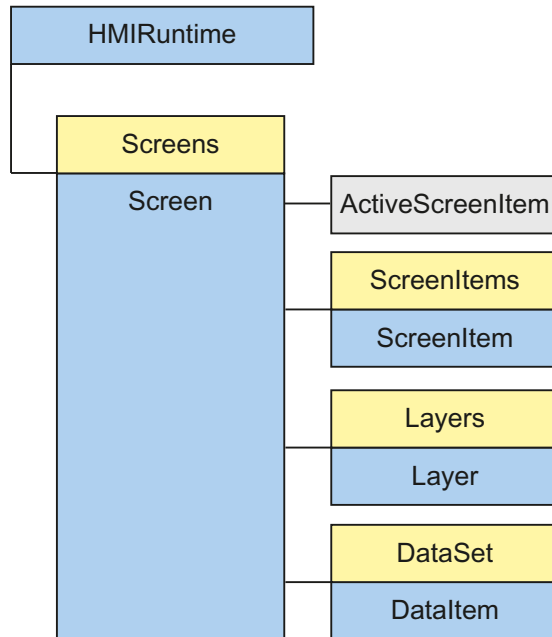

The Screen object returns the result of access to the Screen list. All the properties and methods of this object can also be edited directly in Runtime. The "Screen" object represents a WinCC picture in Runtime and contains all the properties of the picture document and picture view.

The "Screen" object also contains the following:

- A list of all the graphic objects contained in the addressed picture which can be addressed by the "ScreenItems" object.
- A list of all the layers contained in the addressed picture which can be addressed by the "Layers" object.

#### Parent Object

A picture window in which the Screen object is embedded.

When the Screen object is the basic picture, the Parent object is not defined and set to zero.

#### Usage

The "Screen" object can be used for the following, for example:

- To release or block the operation of a screen ("Enabled" property).
- Change the width and height of a screen ("Height" and "Width" properties).

- Zoom a picture ("Zoom" property).
- Modify the fill pattern, background color and fill pattern color ("Fillstyle", "Backcolor" and "Fillcolor" properties).

---

**Note**

If a Change Picture is executed, all the open references are invalid for pictures no longer open. It is then no longer possible to work with these references.

---

**Example:**

In the following example, the width of the first picture in Runtime is increased by 20 pixels:

```
'VBS7
Dim objScreen
Set objScreen = HMIRuntime.Screens(1)
MsgBox "Screen width before changing: " & objScreen.Width
objScreen.Width = objScreen.Width + 20
MsgBox "Screen width after changing: " & objScreen.Width
```

**Notes on Cross References**

All the pictures which are addressed with the standard formulation

```
HMIRuntime.BaseScreenName = "Screenname"
```

are automatically compiled by the CrossReference of WinCC and then listed in the picture properties.

If pictures are addressed with different formulations in the code, this can be notified by the following section of the CrossReference:

```
' ' WINCC:SCREENNAME_SECTION_START
Const ScreenNameInAction = "ScreenName"
' WINCC:SCREENNAME_SECTION_END
The section can be inserted in VBS actions as often as required.
```

---

**Note**

Always enter picture names without the extension "PDL" for reasons of compatibility with future versions.

---

**See also**


ScreenItems Property (Page 561)

Refresh Method (Page 788)

Activate Method (Page 712)  
Zoom Property (Page 709)  
Width Property (Page 698)  
Parent Property (Page 529)  
ObjectSizeDeclutteringMin Property (Page 515)  
ObjectSizeDeclutteringMax Property (Page 514)  
ObjectSizeDeclutteringEnable Property (Page 513)  
ObjectName Property (Page 512)  
Layers Property (Page 476)  
DataSet Property (Page 398)  
LayerDeclutteringEnable Property (Page 475)  
Height Property (Page 443)  
FillStyle Property (Page 419)  
FillColor Property (Page 418)  
ExtendedZoomingEnable Property (Page 416)  
Enabled Property (Page 408)  
BackColor Property (Page 322)  
ActiveScreenItem Property (Page 304)  
AccessPath Property (Page 302)

### 1.14.2.19 Screens Object (List)

#### Description

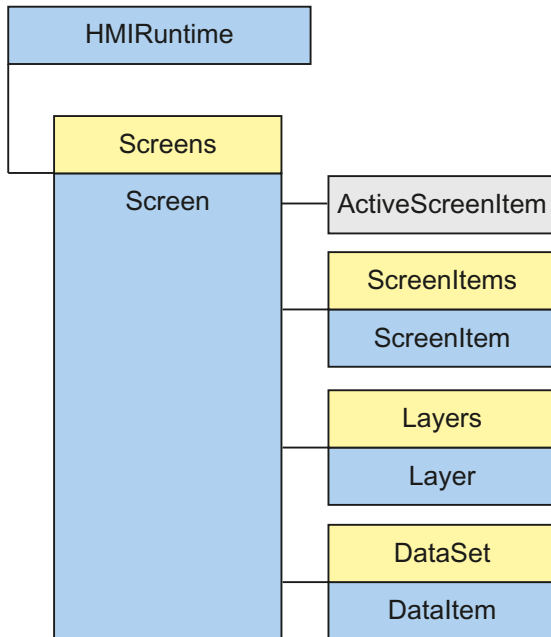

By using the picture window technique, several windows can be opened simultaneously in WinCC Runtime but only one basic picture exists. The "Screens" list enables access to all open pictures in Runtime using the picture names. The Screens list contains all invisible pictures.

#### Usage

When configuring a multi-user project, it is essential to specify the server prefix to access a picture which is not on the local computer.

The "Screens" list can be used to:

- Display or edit all the pictures within the list ("\_NewEnum" property).
- To count the pictures in a project ("Count" property).
- To process a specific picture in the list ("Item" method).
- Initiate new drawing of all visible pictures ("Refresh" method).

The properties are standard properties and methods of a collection and are not described in detail in the WinCC documentation.

The access code, required in the VBS environment in the `HMIRuntime.Screens(<Zugriffsschlüssel>)` instruction, must fulfill the syntax requirements:

```
[<Grundbildname>.]<Bildfenstername>[:<Bildname>] ...
.<Bildfenstername>[:<Bildname>]
```

This means:

- The access code expresses the picture hierarchy.
- The picture names in the code can be omitted at any point.
- The "AccessPath" property of the "Screen" object corresponds to the full access code.
- Always enter picture names without the extension "PDL" for reasons of compatibility with future versions.
- The basic picture can be addressed by the access code " ".

In addition, it has been defined that the basic picture can be addressed with Index 1.

## Examples

The pictures are addressed by the hierarchy information in the list. There are two options here, with or without use of the picture name. In the following examples, a basic picture "BaseScreenName" is configured with a picture window "ScreenWindow". The picture window contains the picture "ScreenName".

### Addressing with the picture name

```
'VBS8
Set objScreen = HMIRuntime.Screens("BaseScreenName.ScreenWindow:ScreenName")
```

### Addressing without the picture name

```
'VBS9
Set objScreen = HMIRuntime.Screens("ScreenWindow")
```

### Referencing the basic picture in various ways

```
'VBS10
Set objScreen = HMIRuntime.Screens(1)

'VBS11
Set objScreen = HMIRuntime.Screens("")

'VBS12
Set objScreen = HMIRuntime.Screens("BaseScreenName")
```

## See also

[ScreenItem Object \(Page 125\)](#)

[Refresh Method \(Page 788\)](#)

Item Method (Page 770)

Count Property (Page 393)

### 1.14.2.20 SmartTags Object

#### Description

The "HMIRuntime" component was deactivated in the faceplate type. The new "SmartTags" component was added for the faceplate type. With the SmartTags object you can dynamize the faceplate type. You can only access the faceplate variables and the properties of the faceplate type. You cannot access the normal WinCC tag management system. The normal WinCC tag management system is not available in the faceplate type.

#### Usage

Using the "SmartTags" object, you can:

- Access the faceplate tags in a faceplate type.  
Syntax: SmartTags("<tagname>")
- Access the properties of a faceplate type.  
Syntax: SmartTags("Properties\<propertyname>")

#### Example 1

Insert a rectangle and a button in a faceplate type. Define a faceplate variable var1. Connect the "Width" property of the rectangle to faceplate variable var1. Dynamize the "OnClick" event of the button as follows with VBS.

```
'VBS306
Dim w
w = SmartTags("var1")
w = w + 10
SmartTags("var1") = w
```

When you activate Runtime, the faceplate variable is incremented by 10 every time you click the button. This increases the rectangle width by 10.

#### Direct reading and writing with object reference

In the following example, the SmartTags object is used to create an object reference "w" to "var1".

Referencing offers the advantage of being able to access the "var1" tag.

```
'VBS307
Dim w
Set w = SmartTags("var1")
w.value = w.value + 10
```



**Example 2:**


Insert a rectangle and a button in a faceplate type. Define the instance-specific property "wide". Link the "Width" property of the rectangle to the instance-specific property "wide". Dynamize the "OnClick" event of the button as follows with VBS:

```
'VBS308
Dim w
w = SmartTags("Properties\wide")
SmartTags("Properties\wide") = w + 50
```

When you activate Runtime, the instance-specific property "wide" is increased by 50 every time you click the button. This increases the rectangle width by 50.

**See also**

SmartTag property (Page 580)

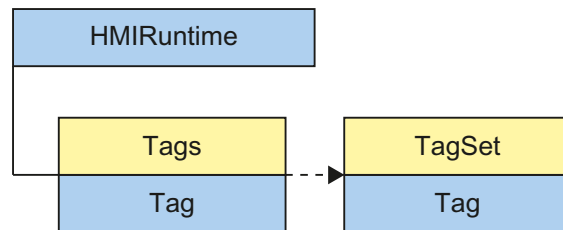**1.14.2.21 Tag Object****Description**

A tag object is returned via the "Tags" list. A tag object can be used to address all the properties and methods of a tag.

When creating a tag object, all the properties are installed with the following values:

- Value = VT\_EMPTY
- Name = Tag name
- QualityCode = BAD NON-SPECIFIC
- TimeStamp = 0
- LastError = 0
- ErrorDescription = " "

**Note**

A summary of possible Quality Codes may be found in WinCC Information System under key word "Communication" > "Diagnostics" or "Communication" > "Quality Codes".

## Usage

The "Tag" object can be used to:

- Read out information on the tag ("Name", "QualityCode", "TimeStamp", "LastError" and "ErrorDescription" properties)
- Set a value for a tag ("Write" method, "Value" property)
- Read a value for a tag ("Read" method, "Value" property)

Read the value of a "Tag1" tag:

```
'VBS13
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Read()
MsgBox objTag.Value
```

## Declaration of tags in WinCC

Always define internal tags in VB script using the "Dim" instruction in order to prevent writing tags wrongly.

When creating a new action, the "Option explicit" instruction is automatically entered in the declaration area and cannot be deleted.

Do not use the "Option explicit" instruction in the code because it may cause Runtime errors.

Example: Declaration of a VBScript "lngVar" tag:

```
'VBS14
Dim lngVar
lngVar = 5
MsgBox lngVar
```

---

### Note

Tag names must not contain any special characters.

Please note that when creating a tag, it must not contain a value (Value = VT\_EMPTY). Initialize the tags after declaration with the corresponding value.

---

## Notes on Cross References

All the pictures which are addressed with the standard formulation

```
HMIRuntime.Tags("Tagname")
```

are automatically compiled by the CrossReference of WinCC and then listed in the picture properties.

If tags are addressed with different formulations in the code, this can be notified by the following section of the CrossReference:

```
' ' WINCC:TAGNAME_SECTION_START  
Const TagNameInAction = "TagName"  
' WINCC:TAGNAME_SECTION_END
```

The section can be inserted in VBS actions as often as required.

---

**Note**

It is not possible to guarantee the compilation of combined tag names from the CrossReference.


---

**See also**

Name Property (Page 509)  
Example: How to Read Tag Values (Page 830)  
Example: Writing tag values (Page 828)  
Write Method (Page 813)  
Read Method (Page 783)  
Value Property (Page 680)  
TimeStamp Property (Page 622)  
QualityCode Property (Page 546)  
LastError Property (Page 459)  
ErrorDescription Property (Page 411)

### 1.14.2.22 Tags Object (List)

#### Description

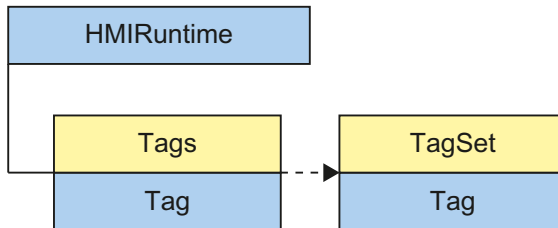

The "Tags" list enables access to tags in WinCC Runtime. The result of access to the "Tags" list is returned by an object of the type "Tag". The Tag object can be used to access all the tag properties and methods.

#### Note

"Tags" is a list with a restricted functional scope. The tags in the list cannot be accessed via the index but only by using the tag names. The standard methods `get_Count` and `get_NewEnum` cannot be used in the Tags list.

#### Usage

Tags in the list are accessed via:

```
HMIRuntime.Tags("Tagname")
```

The Tags list is used to declare tags (tag objects) for read and write access. To ensure that read and write access is carried out without errors, the corresponding tags must be available in WinCC tag management.

In VBS you can address tags directly via the name and set and read values. If you want to access additional tag properties, request the quality code, for example, you will always have to address tags via the tag listing. The tag object returned enables access to all tag properties and methods. You have to form an instance for the object, to write a binary tag with `HMIRuntime.Tags("Variable").Value=TRUE`, for example.

The "CreateTagSet" method can be used to generate a "TagSet" object that enables simultaneous access to several tags.

#### Example:

There are two options when creating tags:

- With specification of the server prefix: For tags in multi-user systems which are not stored locally.
- Direct use of the tag name: For tags stored locally on the computer.

### Specification of the server prefix

```
'VBS15
Dim objTag
Set objTag = HMIRuntime.Tags("Serverprefix::Tagname")
If the server prefix is entered directly, the "ServerPrefix" property is assigned the
corresponding value.
```

### Specification of the tag name

```
'VBS16
Dim objTag
Set objTag = HMIRuntime.Tags("Tagname")
If just the tag name is used, the "ServerPrefix" and "TagPrefix" properties are assigned
the values from the current context (current picture window).
```

### See also

Example: How to Read Tag Values (Page 830)

Example: Writing tag values (Page 828)

Item Method (Page 770)

CreateTagSet Method (Page 717)

Tag Object (Page 137)

### 1.14.2.23 TagSet Object (List)

#### Description

The object "TagSet" enables simultaneous access to several tags in one call. This features better performance and lower communication load than single access to various tags.

#### Usage

Using the TagSet object, you may:

- Add tags to the list ("Add" method)
- Access tag objects contained in the list, and their properties ("Item" method)
- Write all tags of the list ("Write" method)
- Read all tags of the list ("Read" method)
- Remove single tags from the list ("Remove" method)
- Remove all tags from the list ("RemoveAll" method)

## 1.14 VBS Reference

Tags in the list are accessed via:

```
'VBS169
Dim myTags
myTags = HMIRuntime.Tags.CreateTagSet
myTags ("Tagname")
```

In order to have error-free read/write access to tags (tag objects) of the list, the respective tags must exist in WinCC tag management.

If an error occurred during read/write access, the method used will return an error message using the "LastError" and "ErrorDescription" properties.

Synchronous writing and reading of the tags is possible. The optional "Writemode" parameter can be used to write process tags directly to the AS with "1", for example, "group.Write 1". Use the optional "Readmode" parameter to read process tags with "1" directly from the AS or channel, for example, "group.Read 1".

### Example:

The following example shows how to generate a TagSet object, how to add tags, and how to write values.

```
'VBS168
Build a Reference to the TagSet Object
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
'Add Tags to the Collection
group.Add "Motor1"
group.Add "Motor2"
'Set the Values of the Tags
group("Motor1").Value = 3
group("Motor2").Value = 9
'Write the Values to the DataManager
group.Write
```

### See also

- LastError Property (Page 459)
- Example: How to Read Tag Values (Page 830)
- Example: Writing tag values (Page 828)
- Write Method (Page 813)
- RemoveAll Method (Page 792)
- Remove Method (Page 789)
- Read Method (Page 783)
- Item Method (Page 770)

ErrorDescription Property (Page 411)

Count Property (Page 393)

Add Method (Page 713)

Tags Object (List) (Page 140)

Tag Object (Page 137)

### 1.14.3 Object types of the ScreenItem object

#### 1.14.3.1 Object types of the ScreenItem object

##### Introduction

The following section lists all the available types of the "ScreenItem" object.

The features of the "ScreenItem" object represent all the graphic objects available in WinCC Graphics Designer.

The object types are divided into the following groups according to their arrangement in Graphics Designer:

- Standard objects
- Smart objects
- Windows objects
- Tube objects
- Controls

There are also the object types

- Customized Object
- Group

##### See also

ScreenItems Object (List) (Page 129)

ScreenItem Object (Page 125)

Group (Page 300)


Customized Object (Page 298)

Controls (Page 218)

### 1.14.3.2 Standard objects

#### Ellipse

#### Description



Object Type of ScreenItem Object. Represents the graphic object "Ellipse"

#### Type Identifier in VBS

HMIEllipse

#### Usage

In the following example, the object with the name "Ellipse1" is moved 10 pixels to the right:

```
'VBS17  
Dim objEllipse  
Set objEllipse = ScreenItems("Ellipse1")  
objEllipse.Left = objEllipse.Left + 10
```

#### See also


- [FillStyle Property \(Page 419\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)



ToolTipText Property (Page 641)  
RadiusWidth Property (Page 548)  
RadiusHeight Property (Page 547)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Layer Object (Page 120)  
Height Property (Page 443)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)  
Layer Property (Page 460)

## Ellipse arc

### Description



Object Type of ScreenItem Object. Represents the graphic object "Ellipse Arc"

### Type Identifier in VBS

HMIEllipticalArc

### Usage

In the following example, the object with the name "EllipseArc1" is moved 10 pixels to the right:

```
'VBS18  
Dim objEllipseArc  
Set objEllipseArc = ScreenItems("EllipseArc1")  
objEllipseArc.Left = objEllipseArc.Left + 10
```


### See also

- [RadiusHeight Property \(Page 547\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [StartAngle Property \(Page 587\)](#)

RadiusWidth Property (Page 548)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Layer Object (Page 120)  
Height Property (Page 443)  
FlashRateBorderColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
EndAngle Property (Page 409)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
Layer Property (Page 460)

## Ellipse segment

### Description



Object Type of ScreenItem Object. Represents the graphic object "Ellipse Segment"

### Type Identifier in VBS

HMIEllipseSegment

## Usage

In the following example, the object with the name "EllipseSegment1" is moved 10 pixels to the right:

```
'VBS19
Dim objEllipseSeg
Set objEllipseSeg = ScreenItems("EllipseSegment1")
objEllipseSeg.Left = objEllipseSeg.Left + 10
```


## See also

- [Layer Object \(Page 120\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [StartAngle Property \(Page 587\)](#)
- [RadiusWidth Property \(Page 548\)](#)
- [RadiusHeight Property \(Page 547\)](#)
- [PasswordLevel Property \(Page 530\)](#)
- [Parent Property \(Page 529\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Left Property \(Page 476\)](#)
- [Height Property \(Page 443\)](#)
- [FlashRateBorderColor Property \(Page 427\)](#)
- [FlashRateBackColor Property \(Page 427\)](#)
- [FlashBorderColor Property \(Page 424\)](#)
- [FlashBackColor Property \(Page 423\)](#)
- [FillStyle Property \(Page 419\)](#)
- [FillingIndex Property \(Page 419\)](#)
- [Filling Property \(Page 419\)](#)

FillColor Property (Page 418)  
EndAngle Property (Page 409)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)  
Layer Property (Page 460)

## Circle

### Description



Object Type of ScreenItem Object. Represents the graphic object "Circle".

### Type Identifier in VBS

HMICircle

### Usage

In the following example, the object with the name "Circle1" is moved 10 pixels to the right:

```
'VBS20  
Dim objCircle  
Set objCircle= ScreenItems("Circle1")  
objCircle.Left = objCircle.Left + 10
```

## See also

Properties (Page 301)  
BorderStyle Property (Page 355)  
Activate Method (Page 712)  
ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
Width Property (Page 698)  
Visible Property (Page 696)  
Type Property (Page 666)  
Top Property (Page 643)  
ToolTipText Property (Page 641)  
Radius Property (Page 547)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Layer Object (Page 120)  
Height Property (Page 443)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)


BackFlashColorOff Property (Page 324)

BackColor Property (Page 322)

Layer Property (Page 460)

## Circular arc

### Description



Object Type of ScreenItem Object. Represents the graphic object "Circular Arc"

### Type Identifier in VBS

HMICircularArc

### Usage

In the following example, the object with the name "CircularArc1" is moved 10 pixels to the right:

```
'VBS21
Dim objCircularArc
Set objCircularArc = ScreenItems("CircularArc1")
objCircularArc.Left = objCircularArc.Left + 10
```

### See also

StartAngle Property (Page 587)

Activate Method (Page 712)

Properties (Page 301)

ScreenItems Object (List) (Page 129)

ScreenItem Object (Page 125)


Width Property (Page 698)

Visible Property (Page 696)

- Type Property (Page 666)
- Top Property (Page 643)
- ToolTipText Property (Page 641)
- Radius Property (Page 547)
- PasswordLevel Property (Page 530)
- Parent Property (Page 529)
- ObjectName Property (Page 512)
- Left Property (Page 476)
- Layer Object (Page 120)
- Height Property (Page 443)
- FlashRateBorderColor Property (Page 427)
- FlashBorderColor Property (Page 424)
- EndAngle Property (Page 409)
- Enabled Property (Page 408)
- BorderWidth Property (Page 355)
- BorderStyle Property (Page 355)
- BorderFlashColorOn Property (Page 355)
- BorderFlashColorOff Property (Page 354)
- BorderColor Property (Page 353)
- BorderBackColor Property (Page 353)
- Layer Property (Page 460)

## Pie segment

### Description



Object Type of ScreenItem Object. Represents the graphic object "Pie Segment"



## Type Identifier in VBS

HMICircleSegment

## Usage

In the following example, the object with the name "PieSegment1" is moved 10 pixels to the right:

```
'VBS22
Dim objCircleSeg
Set objCircleSeg = ScreenItems("PieSegment1")
objCircleSeg.Left = objCircleSeg.Left + 10
```


## See also

- Type Property (Page 666)
- BorderColor Property (Page 353)
- Activate Method (Page 712)
- Properties (Page 301)
- ScreenItems Object (List) (Page 129)
- ScreenItem Object (Page 125)
- Width Property (Page 698)
- Visible Property (Page 696)
- Top Property (Page 643)
- ToolTipText Property (Page 641)
- StartAngle Property (Page 587)
- Radius Property (Page 547)
- PasswordLevel Property (Page 530)
- Parent Property (Page 529)
- ObjectName Property (Page 512)
- Left Property (Page 476)
- Layer Object (Page 120)
- Height Property (Page 443)
- FlashRateBorderColor Property (Page 427)
- FlashRateBackColor Property (Page 427)
- FlashBorderColor Property (Page 424)
- FlashBackColor Property (Page 423)

- FillStyle Property (Page 419)
- FillingIndex Property (Page 419)
- Filling Property (Page 419)
- FillColor Property (Page 418)
- EndAngle Property (Page 409)
- Enabled Property (Page 408)
- BorderWidth Property (Page 355)
- BorderStyle Property (Page 355)
- BorderFlashColorOn Property (Page 355)
- BorderFlashColorOff Property (Page 354)
- BorderBackColor Property (Page 353)
- BackFlashColorOn Property (Page 324)
- BackFlashColorOff Property (Page 324)
- BackColor Property (Page 322)
- Layer Property (Page 460)

## Line

### Description



Object Type of ScreenItem Object. Represents the graphic object "Line"

### Type Identifier in VBS

HMLLine

## Usage

In the following example, the object with the name "Line1" is moved 10 pixels to the right:

```
'VBS23
Dim objLine
Set objLine = ScreenItems("Line1")
objLine.Left = objLine.Left + 10
```

## See also

- [PasswordLevel Property \(Page 530\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [RotationAngle Property \(Page 552\)](#)
- [ReferenceRotationTop Property \(Page 549\)](#)
- [ReferenceRotationLeft Property \(Page 549\)](#)
- [Parent Property \(Page 529\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [Height Property \(Page 443\)](#)
- [FlashRateBorderColor Property \(Page 427\)](#)
- [FlashBorderColor Property \(Page 424\)](#)
- [Enabled Property \(Page 408\)](#)
- [BorderWidth Property \(Page 355\)](#)
- [BorderStyle Property \(Page 355\)](#)
- [BorderFlashColorOn Property \(Page 355\)](#)
- [BorderFlashColorOff Property \(Page 354\)](#)
- [BorderEndStyle Property \(Page 354\)](#)


BorderColor Property (Page 353)

BorderBackColor Property (Page 353)

Layer Property (Page 460)

## Polygon

### Description



Object Type of ScreenItem Object. Represents the graphic object "Polygon"

### Type Identifier in VBS

HMIPolygon

### Usage

In the following example, the object with the name "Polygon1" is moved 10 pixels to the right:

```
'VBS24  
Dim objPolygon  
Set objPolygon = ScreenItems("Polygon1")  
objPolygon.Left = objPolygon.Left + 10
```

### See also

ReferenceRotationTop Property (Page 549)

BackFlashColorOn Property (Page 324)

Activate Method (Page 712)

Properties (Page 301)

ScreenItems Object (List) (Page 129)


ScreenItem Object (Page 125)

Width Property (Page 698)

Visible Property (Page 696)  
Type Property (Page 666)  
Top Property (Page 643)  
ToolTipText Property (Page 641)  
RotationAngle Property (Page 552)  
ReferenceRotationLeft Property (Page 549)  
PointCount Property (Page 541)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Layer Object (Page 120)  
Index Property (Page 452)  
Height Property (Page 443)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)  
ActualPointTop Property (Page 306)  
ActualPointLeft Property (Page 305)  
Layer Property (Page 460)

## Polyline

### Description



Object Type of ScreenItem Object. Represents the graphic object "Polyline"

### Type Identifier in VBS

HMIPolyLine

### Usage

In the following example, the object with the name "Polyline1" is moved 10 pixels to the right:

```
'VBS25  
Dim objPolyline  
Set objPolyline = ScreenItems("Polyline1")  
objPolyline.Left = objPolyline.Left + 10
```


### See also

- Layer Object (Page 120)
- Activate Method (Page 712)
- Properties (Page 301)
- ScreenItems Object (List) (Page 129)
- ScreenItem Object (Page 125)
- Width Property (Page 698)
- Visible Property (Page 696)
- Type Property (Page 666)
- Top Property (Page 643)
- ToolTipText Property (Page 641)
- RotationAngle Property (Page 552)

ReferenceRotationTop Property (Page 549)  
ReferenceRotationLeft Property (Page 549)  
PointCount Property (Page 541)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Index Property (Page 452)  
Height Property (Page 443)  
FlashRateBorderColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderEndStyle Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
ActualPointTop Property (Page 306)  
ActualPointLeft Property (Page 305)  
Layer Property (Page 460)

## Rectangle

### Description



Object Type of ScreenItem Object. Represents the graphic object "Rectangle"

## Type Identifier in VBS

HMIRectangle

## Usage

In the following example, the object with the name "Rectangle1" is moved 10 pixels to the right:

```
'VBS26
Dim objRectangle
Set objRectangle = ScreenItems("Rectangle1")
objRectangle.Left = objRectangle.Left + 10
```

## Notes on Error Handling

The rectangle and rounded rectangle are mapped to an "HMIRectangle" type in the object model. Since the two objects have different properties, the availability of the property (dynamic type compilation in Runtime) should be queried via an exception measure. The exception measure is activated for the corresponding procedure by the following instruction:

```
On Error Resume Next
```

The instruction causes the VBScript engine to initiate the follow-on command in the case of a Runtime error.

The error code can subsequently be checked using the Err object. In order to deactivate the handling of Runtime errors in scripts, use the following command:

```
On Error Goto 0
```

Handling errors always relates to the procedure layer. If a script in a procedure causes an error, VBScript checks whether an error handling measure is implemented in this layer. If not, control is transferred one layer up (to the calling procedure). If there is no error handling measure here either, the control is transferred yet another layer up. This continues until either the top module level is reached or the code for Runtime error handling is located. If the activation of the Runtime error handling fails, the control is transferred to the top level on the internal VBScript Runtime error handling. This opens an error dialog and stops the script.

The "On Error Resume Next" command can be installed on all layers (i.e. also in procedures). When the error handling measure is use, it can basically be determined whether the user is actually using the required implementation type.

In addition, it can be ensured that there is no termination of execution due to a faulty access to the object.



## Examples of error handling

```
Sub OnClick(ByVal Item)
'VBS27
Dim objScreenItem
'
'Activation of errorhandling:
On Error Resume Next
For Each objScreenItem In ScreenItems
If "HMIRectangle" = objScreenItem.Type Then
'
'=== Property "RoundCornerHeight" only available for RoundedRectangle
objScreenItem.RoundCornerHeight = objScreenItem.RoundCornerHeight * 2
If 0 <> Err.Number Then
HMIRuntime.Trace objScreenItem.Name & ": no RoundedRectangle" & vbCrLf
'
'Delete error message
Err.Clear
End If
End If
Next
On Error Goto 0 'Deactivation of errorhandling
End Sub
```


## See also

- [Properties \(Page 301\)](#)
- [BorderFlashColorOn Property \(Page 355\)](#)
- [Activate Method \(Page 712\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [PasswordLevel Property \(Page 530\)](#)
- [Parent Property \(Page 529\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [Height Property \(Page 443\)](#)
- [FlashRateBorderColor Property \(Page 427\)](#)

- FlashRateBackColor Property (Page 427)
- FlashBorderColor Property (Page 424)
- FlashBackColor Property (Page 423)
- FillStyle Property (Page 419)
- FillingIndex Property (Page 419)
- Filling Property (Page 419)
- FillColor Property (Page 418)
- Enabled Property (Page 408)
- BorderWidth Property (Page 355)
- BorderStyle Property (Page 355)
- BorderFlashColorOff Property (Page 354)
- BorderColor Property (Page 353)
- BorderBackColor Property (Page 353)
- BackFlashColorOn Property (Page 324)
- BackFlashColorOff Property (Page 324)
- BackColor Property (Page 322)
- Layer Property (Page 460)

## Rounded rectangle

### Description



Object Type of ScreenItem Object. Represents the graphic object "Rounded Rectangle".

### Type Identifier in VBS

HMIRoundRectangle

## Usage

In the following example, the object with the name "RoundedRectangle1" is moved 10 pixels to the right:

```
'VBS28
Dim objRoundedRectangle
Set objRoundedRectangle = ScreenItems("RoundedRectangle1")
objRoundedRectangle.Left = objRoundedRectangle.Left + 10
```

## Notes on Error Handling

The rectangle and rounded rectangle are mapped to an "HMIRectangle" type in the object model. Since the two objects have different properties, the availability of the property (dynamic type compilation in Runtime) should be queried via an exception measure. The exception measure is activated for the corresponding procedure by the following instruction:

```
On Error Resume Next
```

The instruction causes the VBScript engine to initiate the follow-on command in the case of a Runtime error.

The error code can subsequently be checked using the Err object. In order to deactivate the handling of Runtime errors in scripts, use the following command:

```
On Error Goto 0
```

Handling errors always relates to the procedure layer. If a script in a procedure causes an error, VBScript checks whether an error handling measure is implemented in this layer. If not, control is transferred one layer up (to the calling procedure). If there is no error handling measure here either, the control is transferred yet another layer up. This continues until either the top module level is reached or the code for Runtime error handling is located. If the activation of the Runtime error handling fails, the control is transferred to the top level on the internal VBScript Runtime error handling. This opens an error dialog and stops the script.

The "On Error Resume Next" command can be installed on all layers (i.e. also in procedures). When the error handling measure is use, it can basically be determined whether the user is actually using the required implementation type.

In addition, it can be ensured that there is no termination of execution due to a faulty access to the object.

## Examples of error handling

```
Sub OnClick(ByVal Item)
'VBS29
Dim objScreenItem
On Error Resume Next      'Activation of errorhandling
For Each objScreenItem In ScreenItems
If "HMIRectangle" = objScreenItem.Type Then
'
'=== Property "RoundCornerHeight" available only for RoundedRectangle
objScreenItem.RoundCornerHeight = objScreenItem.RoundCornerHeight * 2
If 0 <> Err.Number Then
HMIRuntime.Trace objScreenItem.ObjectName & ": no RoundedRectangle" & vbCrLf
Err.Clear      'Delete errormessage
End If
End If
Next
On Error Goto 0      'Deactivation of errorhandling
End Sub
```


## See also

- [FlashBackColor Property \(Page 423\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [RoundCornerWidth Property \(Page 553\)](#)
- [RoundCornerHeight Property \(Page 553\)](#)
- [PasswordLevel Property \(Page 530\)](#)
- [Parent Property \(Page 529\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [Height Property \(Page 443\)](#)
- [FlashRateBorderColor Property \(Page 427\)](#)

FlashRateBackColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)  
Layer Property (Page 460)

## Static text

## Description



Object Type of ScreenItem Object. Represents the graphic object "Static Text"

## Type Identifier in VBS

HMITextField

## Usage

In the following example, the object with the name "StaticText1" is moved 10 pixels to the right:

```
'VBS30
Dim objStaticText
Set objStaticText = ScreenItems("StaticText1")
objStaticText.Left = objStaticText.Left + 10
```


## See also

- [ObjectName Property \(Page 512\)](#)
- [BorderFlashColorOn Property \(Page 355\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [Text list \(Page 196\)](#)
- [PasswordLevel Property \(Page 530\)](#)
- [Parent Property \(Page 529\)](#)
- [Orientation Property \(Page 526\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [Height Property \(Page 443\)](#)
- [ForeFlashColorOn Property \(Page 436\)](#)
- [ForeFlashColorOff Property \(Page 435\)](#)
- [ForeColor Property \(Page 435\)](#)
- [FontUnderline Property \(Page 434\)](#)
- [FontSize Property \(Page 433\)](#)
- [FontName Property \(Page 433\)](#)
- [FontItalic Property \(Page 432\)](#)
- [FontBold Property \(Page 432\)](#)

FlashRateForeColor Property (Page 428)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashForeColor Property (Page 424)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)  
AlignmentTop Property (Page 310)  
AlignmentLeft Property (Page 309)  
AdaptBorder Property (Page 306)  
Layer Property (Page 460)

## Connector

### Description



Object Type of ScreenItem Object. Represents the graphic object "Connector"

## Type Identifier in VBS

HMIConnector

## Usage

In the following example, the object with the name "Connector1" is moved 10 pixels to the right:

```
'VBS31
Dim objConnector
Set objConnector = ScreenItems("Connector1")
objConnector.Left = objConnector.Left + 10
```

## See also


- [ScreenItems Object \(List\) \(Page 129\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [TopConnectedObjectName Property \(Page 644\)](#)
- [TopConnectedConnectionPointIndex Property \(Page 644\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [Parent Property \(Page 529\)](#)
- [Orientation Property \(Page 526\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Property \(Page 460\)](#)
- [Height Property \(Page 443\)](#)
- [Enabled Property \(Page 408\)](#)
- [BottomConnectedObjectName Property \(Page 356\)](#)
- [BottomConnectedConnectionPointIndex Property \(Page 356\)](#)



### 1.14.3.3 Smart objects

#### 3D Bar

#### Description



Object Type of ScreenItem Object. Represents the graphic object "3D Bar"

#### Type Identifier in VBS

HMIBar

#### Usage

In the following example, the object with the name "3DBar1" is moved 10 pixels to the right:

```
'VBS32
Dim objBar
Set objBar = ScreenItems("3DBar1")
objBar.Left = objBar.Left + 10
```

#### Notes on Error Handling

Bars and 3D bars are imaged in the object model on a "HMIBar" type. Since the two objects have different properties, the availability of the property (dynamic type compilation in Runtime) should be queried via an exception measure. The exception measure is activated for the corresponding procedure by the following instruction:

```
On Error Resume Next
```

The instruction causes the VBScript engine to initiate the follow-on command in the case of a Runtime error.

The error code can subsequently be checked using the Err object. In order to deactivate the handling of Runtime errors in scripts, use the following command:

```
On Error Goto 0
```

Handling errors always relates to the procedure layer. If a script in a procedure causes an error, VBScript checks whether an error handling measure is implemented in this layer. If not, control is transferred one layer up (to the calling procedure). If there is no error handling measure here either, the control is transferred yet another layer up. This continues until either the top module level is reached or the code for Runtime error handling is located. If the activation of the Runtime error handling fails, the control is transferred to the top level on the internal VBScript Runtime error handling. This opens an error dialog and stops the script.

The "On Error Resume Next" command can be installed on all layers (i.e. also in procedures). When the error handling measure is use, it can basically be determined whether the user is actually using the required implementation type.

In addition, it can be ensured that there is no termination of execution due to a faulty access to the object.

## Examples of error handling

```
'VBS148
Sub OnClick(ByVal Item)
Dim objScreenItem
'
'Activation of errorhandling:
On Error Resume Next
For Each objScreenItem In ScreenItems
If "HMIBar" = objScreenItem.Type Then
'
'=== Property "Layer00Value" only available for 3D bar
objScreenItem.Layer00Value = objScreenItem.Layer00Value * 2
If 0 <> Err.Number Then
HMIRuntime.Trace objScreenItem.Name & ": no 3D bar" & vbCrLf
'
'Delete error message
Err.Clear
End If
End If
Next
On Error Goto 0 'Deactivation of errorhandling
End Sub
```

## See also

[Type Property \(Page 666\)](#)


[Layer08Color Property \(Page 467\)](#)

BorderStyle Property (Page 355)  
Activate Method (Page 712)  
Properties (Page 301)  
ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
ZeroPointValue Property (Page 709)  
Width Property (Page 698)  
Visible Property (Page 696)  
Top Property (Page 643)  
ToolTipText Property (Page 641)  
Process Property (Page 544)  
PredefinedAngles Property (Page 543)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Min Property (Page 506)  
Max Property (Page 488)  
LightEffect Property (Page 477)  
Left Property (Page 476)  
Layer10Value Property (Page 475)  
Layer09Value Property (Page 475)  
Layer08Value Property (Page 475)  
Layer07Value Property (Page 474)  
Layer06Value Property (Page 474)  
Layer05Value Property (Page 474)  
Layer04Value Property (Page 473)  
Layer03Value Property (Page 473)  
Layer02Value Property (Page 473)  
Layer01Value Property (Page 473)  
Layer00Value Property (Page 472)  
Layer10Color Property (Page 468)  
Layer09Color Property (Page 468)  
Layer07Color Property (Page 467)  
Layer06Color Property (Page 467)  
Layer05Color Property (Page 466)

Layer04Color Property (Page 466)  
Layer03Color Property (Page 466)  
Layer02Color Property (Page 465)  
Layer01Color Property (Page 465)  
Layer00Color Property (Page 465)  
Layer10Checked Property (Page 464)  
Layer09Checked Property (Page 464)  
Layer08Checked Property (Page 464)  
Layer07Checked Property (Page 463)  
Layer06Checked Property (Page 463)  
Layer05Checked Property (Page 463)  
Layer04Checked Property (Page 462)  
Layer03Checked Property (Page 462)  
Layer02Checked Property (Page 462)  
Layer01Checked Property (Page 461)  
Layer00Checked Property (Page 461)  
Layer Object (Page 120)  
Height Property (Page 443)  
Enabled Property (Page 408)  
Direction Property (Page 405)  
BorderWidth Property (Page 355)  
BorderColor Property (Page 353)  
BaseY Property (Page 342)  
BaseX Property (Page 343)  
BarWidth Property (Page 340)  
BarHeight Property (Page 329)  
BarDepth Property (Page 328)  
Background Property (Page 324)  
BackColor Property (Page 322)  
Axe Property (Page 320)  
AngleBeta Property (Page 312)  
AngleAlpha Property (Page 312)

## Application Window

### Description



Object Type of ScreenItem Object. Represents the graphic object "Application Window"

### Type Identifier in VBS

HMIApplicationWindow

### Usage

In the following example, the object with the name "ApplicationWindow1" is moved 10 pixels to the right:

```
'VBS33
Dim objAppWindow
Set objAppWindow = ScreenItems("ApplicationWindow1")
objAppWindow.Left = objAppWindow.Left + 10
```


### See also

- Properties (Page 301)
- Activate Method (Page 712)
- ScreenItems Object (List) (Page 129)
- ScreenItem Object (Page 125)
- WindowBorder Property (Page 699)
- Width Property (Page 698)
- Visible Property (Page 696)
- Type Property (Page 666)
- Top Property (Page 643)
- Template Property (Page 598)
- Parent Property (Page 529)

- OnTop Property (Page 517)
- ObjectName Property (Page 512)
- Moveable Property (Page 507)
- MaximizeButton Property (Page 488)
- Left Property (Page 476)
- Layer Object (Page 120)
- Height Property (Page 443)
- Enabled Property (Page 408)
- CloseButton Property (Page 371)
- Caption Property (Page 362)
- Application Property (Page 313)

## Bar

### Description



Object Type of ScreenItem Object. Represents the graphic object "Bar"

### Type Identifier in VBS

HMIBar

### Usage

In the following example, the object with the name "Bar1" is moved 10 pixels to the right:

```
'VBS34
Dim objBar
Set objBar = ScreenItems("Bar1")
objBar.Left = objBar.Left + 10
```

## Notes on Error Handling

Bars and 3D bars are imaged in the object model on a "HMIBar" type. Since the two objects have different properties, the availability of the property (dynamic type compilation in Runtime) should be queried via an exception measure. The exception measure is activated for the corresponding procedure by the following instruction:

```
On Error Resume Next
```

The instruction causes the VBScript engine to initiate the follow-on command in the case of a Runtime error.

The error code can subsequently be checked using the Err object. In order to deactivate the handling of Runtime errors in scripts, use the following command:

```
On Error Goto 0
```

Handling errors always relates to the procedure layer. If a script in a procedure causes an error, VBScript checks whether an error handling measure is implemented in this layer. If not, control is transferred one layer up (to the calling procedure). If there is no error handling measure here either, the control is transferred yet another layer up. This continues until either the top module level is reached or the code for Runtime error handling is located. If the activation of the Runtime error handling fails, the control is transferred to the top level on the internal VBScript Runtime error handling. This opens an error dialog and stops the script.

The "On Error Resume Next" command can be installed on all layers (i.e. also in procedures). When the error handling measure is use, it can basically be determined whether the user is actually using the required implementation type.

In addition, it can be ensured that there is no termination of execution due to a faulty access to the object.

## Examples of error handling

```
'VBS147
Sub OnClick(ByVal Item)
Dim objScreenItem
'
'Activation of errorhandling:
On Error Resume Next
For Each objScreenItem In ScreenItems
If "HMIBar" = objScreenItem.Type Then
'
'=== Property "LimitHigh4" only available for bar
objScreenItem.LimitHigh4 = objScreenItem.LimitHigh4 * 2
If 0 <> Err.Number Then
HMIRuntime.Trace objScreenItem.Name & ": no bar" & vbCrLf
'
'Delete error message
Err.Clear
End If
End If
Next
On Error Goto 0 'Deactivation of errorhandling
End Sub
```

## See also

- [ToolTipText Property \(Page 641\)](#)
- [Layer Object \(Page 120\)](#)
- [ColorChangeType Property \(Page 375\)](#)
- [Average Property \(Page 320\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [ZeroPointValue Property \(Page 709\)](#)
- [ZeroPoint Property \(Page 709\)](#)
- [Width Property \(Page 698\)](#)
- [WarningLow Property \(Page 698\)](#)
- [WarningHigh Property \(Page 697\)](#)
- [Visible Property \(Page 696\)](#)
- [TypeWarningLow Property \(Page 671\)](#)
- [TypeWarningHigh Property \(Page 670\)](#)
- [TypeToleranceLow Property \(Page 670\)](#)




TypeToleranceHigh Property (Page 670)  
TypeLimitLow5 Property (Page 670)  
TypeLimitLow4 Property (Page 669)  
TypeLimitHigh5 Property (Page 669)  
TypeLimitHigh4 Property (Page 669)  
TypeAlarmLow Property (Page 668)  
TypeAlarmHigh Property (Page 668)  
Type Property (Page 666)  
LTrendColor property (before WinCC V7) (Page 647)  
Trend Property (Page 645)  
Top Property (Page 643)  
ToleranceLow Property (Page 628)  
ToleranceHigh Property (Page 628)  
ScalingType Property (Page 558)  
Scaling Property (Page 558)  
ScaleTicks Property (Page 558)  
ScaleColor Property (Page 558)  
RightComma Property (Page 551)  
Process Property (Page 544)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Min Property (Page 506)  
Max Property (Page 488)  
Marker Property (Page 488)  
LongStrokesTextEach Property (Page 485)  
LongStrokesSize Property (Page 485)  
LongStrokesOnly Property (Page 485)  
LongStrokesBold Property (Page 484)  
LimitLow5 Property (Page 479)  
LimitLow4 Property (Page 478)  
LimitHigh5 Property (Page 478)  
LimitHigh4 Property (Page 478)  
LeftComma Property (Page 477)  
Left Property (Page 476)

HysteresisRange Property (Page 451)  
Hysteresis Property (Page 451)  
Height Property (Page 443)  
FontSize Property (Page 433)  
FontName Property (Page 433)  
FontBold Property (Page 432)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle2 Property (Page 421)  
FillStyle Property (Page 419)  
FillColor Property (Page 418)  
Exponent Property (Page 412)  
Enabled Property (Page 408)  
Direction Property (Page 405)  
ColorWarningLow Property (Page 378)  
ColorWarningHigh Property (Page 378)  
ColorToleranceLow Property (Page 377)  
ColorToleranceHigh Property (Page 377)  
ColorLimitLow5 Property (Page 377)  
ColorLimitLow4 Property (Page 376)  
ColorLimitHigh5 Property (Page 376)  
ColorLimitHigh4 Property (Page 376)  
ColorAlarmLow Property (Page 375)  
ColorAlarmHigh Property (Page 374)  
CheckWarningLow Property (Page 370)  
CheckWarningHigh Property (Page 369)  
CheckToleranceLow Property (Page 369)  
CheckToleranceHigh Property (Page 369)  
CheckLimitLow5 Property (Page 368)  
CheckLimitLow4 Property (Page 368)  
CheckLimitHigh5 Property (Page 368)  
CheckLimitHigh4 Property (Page 367)  
CheckAlarmLow Property (Page 367)

CheckAlarmHigh Property (Page 367)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
BackColor3 Property (Page 323)  
BackColor2 Property (Page 323)  
BackColor Property (Page 322)  
AxisSection Property (Page 321)  
Alignment Property (Page 309)  
AlarmLow Property (Page 309)  
AlarmHigh Property (Page 308)

## Picture Window

### Description



Object Type of ScreenItem Object. Represents the graphic object "Picture Window"

### Type Identifier in VBS

HMIScreenWindow

## Usage

In the following example, the object with the name "ScreenWindow1" is moved 10 pixels to the right:

```
'VBS35
Dim objScrWindow
Set objScrWindow = ScreenItems("ScreenWindow1")
objScrWindow.Left = objScrWindow.Left + 10
```


## See also

- [ServerPrefix Property \(Page 571\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Zoom Property \(Page 709\)](#)
- [WindowBorder Property \(Page 699\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [UpdateCycle Property \(Page 673\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [TagPrefix Property \(Page 596\)](#)
- [ScrollPositionY Property \(Page 562\)](#)
- [ScrollPositionX Property \(Page 562\)](#)
- [ScrollBars Property \(Page 561\)](#)
- [ScreenName Property \(Page 560\)](#)
- [Screens Property \(Page 560\)](#)
- [Parent Property \(Page 529\)](#)
- [OnTop Property \(Page 517\)](#)
- [OffsetTop Property \(Page 516\)](#)
- [OffsetLeft Property \(Page 515\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Moveable Property \(Page 507\)](#)
- [MaximizeButton Property \(Page 488\)](#)

Left Property (Page 476)  
Layer Object (Page 120)  
Height Property (Page 443)  
Enabled Property (Page 408)  
CloseButton Property (Page 371)  
CaptionText Property (Page 364)  
Caption Property (Page 362)  
AdaptSize Property (Page 307)  
AdaptPicture Property (Page 307)  
MenuToolBarConfig Property (Page 495)

## Control

### Description



Object Type of ScreenItem Object. Represents the graphic object "Control"

The Control object type always assumes the properties of the Control type selected. In the case of controls provided by WinCC, the properties are indicated under the description of the corresponding Control.

In the case of controls from external suppliers, the control properties are supplied and thus not a part of this description. However, the control properties can be queried using the "Item" property.

### Type Identifier in VBS

Special WinCC type descriptions or version-independent ProgID

## Usage

In the following example, the object with the name "Control1" is moved 10 pixels to the right:

```
'VBS36
Dim objControl
Set objControl = ScreenItems("Control1")
objControl.Left = objControl.Left + 10
```

## Special feature

The controls provided by WinCC return a special ID as the type. It can be found under the topic "Type Identification in VBS" in the individual descriptions of the WinCC Controls.

## Use of Controls from External Suppliers

In the case of non-WinCC controls, the version-independent ProgID is returned as the type.

It is possible to determine the version-dependent ProgID or "User friendly Name" from the ProgID: In the following example, "Control1" is a control embedded in the picture which already returns the version-independent ProgID as a result of the Type property.

---

### Note

Since not every Control has a version-dependent ProgID, an error handling measure should be integrated to query the version-dependent ProgID or UserFriendlyName. If no error handling is used, the code is terminated immediately without any result when no ProgID is found.

---

Determine the version-dependent ProgID as follows:

```
'VBS37
Dim objControl
Dim strCurrentVersion
Set objControl = ScreenItems("Control1")
strCurrentVersion = CreateObject("WScript.Shell").RegRead("HKCR\" & objControl.Type &
"\CurVer\")
MsgBox strCurrentVersion
```

---

### Note

In order that example above works, a multimedia control should be inserted in the picture.

---

Determine the UserFriendlyName as follows:

```
'VBS38
Dim objControl
Dim strFriendlyName
Set objControl = ScreenItems("Control1")
strFriendlyName = CreateObject("WScript.Shell").RegRead("HKCR\" & objControl.Type & "\\")
MsgBox strFriendlyName
```

---

**Note**

In order that example above works, a multimedia control should be inserted in the picture.

---

If a non-WinCC control is used, it is possible that the properties provided by the control have the same names as the general ScreenItem properties. In such cases, the ScreenItem properties have priority. The "hidden" properties of an external control supplier can be accessed using the additional "object" property. Address the properties of an external control supplier as follows:

```
Control.object.type
```

The properties of the ScreenItem object are used in the case of identical names, if you use the following form:

```
Control.type
```

### WinCC controls available


- WinCC Alarm Control
- WinCC Digital/Analog Clock
- WinCC FunctionTrendControl
- WinCC Gauge Control
- WinCC Media Control
- WinCC OnlineTableControl
- WinCC OnlineTrendControl
- WinCC Push Button Control
- WinCC Slider Control
- WinCC UserArchiveControl
- HMI Symbol Library

**See also**

- Object Property (Page 512)
- Activate Method (Page 712)
- Properties (Page 301)
- ScreenItems Object (List) (Page 129)
- ScreenItem Object (Page 125)
- Width Property (Page 698)
- Visible Property (Page 696)
- Type Property (Page 666)
- Top Property (Page 643)
- Parent Property (Page 529)
- ObjectName Property (Page 512)
- Left Property (Page 476)
- Layer Property (Page 460)
- Height Property (Page 443)
- Enabled Property (Page 408)

**I/O Field**

**Description**



Object Type of ScreenItem Object. Represents the graphic object "I/O Field"

**Type Identifier in VBS**

HMIIOField



## Usage

In the following example, the object with the name "IOField1" is moved 10 pixels to the right:

```
'VBS39
Dim objIOField
Set objIOField = ScreenItems("IOField1")
objIOField.Left = objIOField.Left + 10
```


## See also

- [OperationMessage Property \(Page 517\)](#)
- [EditAtOnce Property \(Page 407\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [PasswordLevel Property \(Page 530\)](#)
- [Parent Property \(Page 529\)](#)
- [OutputValue Property \(Page 528\)](#)
- [OutputFormat Property \(Page 527\)](#)
- [Orientation Property \(Page 526\)](#)
- [OperationReport Property \(Page 525\)](#)
- [ObjectName Property \(Page 512\)](#)
- [LimitMin Property \(Page 479\)](#)
- [LimitMax Property \(Page 479\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [HiddenInput Property \(Page 444\)](#)
- [Height Property \(Page 443\)](#)
- [ForeFlashColorOn Property \(Page 436\)](#)
- [ForeFlashColorOff Property \(Page 435\)](#)

ForeColor Property (Page 435)  
FontUnderline Property (Page 434)  
FontSize Property (Page 433)  
FontName Property (Page 433)  
FontItalic Property (Page 432)  
FontBold Property (Page 432)  
FlashRateForeColor Property (Page 428)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashForeColor Property (Page 424)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
DataFormat Property (Page 397)  
CursorControl Property (Page 395)  
ClearOnNew Property (Page 370)  
ClearOnError Property (Page 370)  
BoxType Property (Page 357)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)  
AssumeOnFull Property (Page 315)  
AssumeOnExit Property (Page 315)  
AlignmentTop Property (Page 310)  
AlignmentLeft Property (Page 309)  
AdaptBorder Property (Page 306)

## Faceplate Instance

### Description



Object Type of ScreenItem Object. Represents the "faceplate instance" graphic object.

### Type identifier in VBS

HMIFaceplateObject


### Usage

In the following example, the object with the name "FaceplateInstance1" is moved 10 pixels to the right:

```
'VBS309
Dim objFaceplateObject
Set objFaceplateObject = ScreenItems("FaceplateInstance1")
objFaceplateObject.Left = objFaceplateObject.Left + 10
```

## Graphic Object

### Description



Object Type of ScreenItem Object. Represents the graphic object "Graphic Object"

## Type Identifier in VBS

HMIGraphicView

## Usage

In the following example, the object with the name "GraphicObject1" is moved 10 pixels to the right:

```
'VBS40
Dim objGraphicView
Set objGraphicView= ScreenItems("GraphicObject1")
objGraphicView.Left = objGraphicView.Left + 10
```


## See also

- [Parent Property \(Page 529\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [PicUseTransColor Property \(Page 540\)](#)
- [PictureName Property \(Page 538\)](#)
- [PicTransColor Property \(Page 536\)](#)
- [PicReferenced Property \(Page 535\)](#)
- [PasswordLevel Property \(Page 530\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [Height Property \(Page 443\)](#)
- [FlashRateBorderColor Property \(Page 427\)](#)
- [FlashRateBackColor Property \(Page 427\)](#)
- [FlashBorderColor Property \(Page 424\)](#)

FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)

## Combobox

### Description



Object Type of ScreenItem Object. Represents the "Combobox" graphic object.

### Type Identifier in VBS

HMIComboBox


## Usage

In the following example, the object with the name "ComboBox1" is moved 10 pixels to the right:

```
'VBS21  
Dim objComboBox  
Set objComboBox = ScreenItems("ComboBox1")  
objComboBox.Left = objComboBox.Left + 10
```

## List Box

### Description



Object Type of ScreenItem Object. Represents the "List Box" graphic object.

### Type Identifier in VBS

HMIListBox


## Usage

In the following example, the object with the name "ListBox1" is moved 10 pixels to the right:

```
'VBS21  
Dim objListBox  
Set objListBox = ScreenItems("ListBox1")  
objListBox.Left = objListBox.Left + 10
```

## Multiple row text

### Description



Object Type of ScreenItem Object. Represents the "Multiline Text" graphic object.

### Type Identifier in VBS

HMIMultiLineEdit


### Usage

In the following example, the object with the name "MultiLineEdit1" is moved 10 pixels to the right:

```
'VBS21
Dim objMultiLineEdit
Set objMultiLineEdit = ScreenItems("MultiLineEdit1")
objMultiLineEdit.Left = objMultiLineEdit.Left + 10
```

## OLE object

### Description



Object Type of ScreenItem Object. Represents the graphic object "OLE Element". The return value is a STRING type.

## Type Identifier in VBS

Version-independent ProgID

### Usage

In the following example, the object with the name "OLEElement1" is moved 10 pixels to the right:

```
'VBS41
Dim objOLEElement
Set objOLEElement = ScreenItems("OLEElement1")
objOLEElement.Left = objOLEElement.Left + 10
```

### Special feature

In the case of OLE Elements, the version-independent ProgID is returned as the type.

It is possible to determine the version-dependent ProgID or "User friendly Name" from the ProgID: In the following example, "OLEObject1" is a control embedded in the picture which already returns the version-independent ProgID as a result of the Type property.

---

#### Note

Since not every Control has a version-dependent ProgID, an error handling measure should be integrated to query the version-dependent ProgID or UserFriendlyName. If no error handling is used, the code is terminated immediately without any result when no ProgID is found.

---

Determine the version-dependent ProgID as follows:

```
'VBS42
Dim objControl
Dim strCurrentVersion
Set objControl = ScreenItems("OLEElement1")
strCurrentVersion = CreateObject("WScript.Shell").RegRead("HKCR\" & objControl.Type &
"\CurVer\")
MsgBox strCurrentVersion
```

---

#### Note

In order that the example above works, a Word document should be embedded in the picture as an OLE Element.

---



Determine the User Friendly Name as follows:

```
'VBS43
Dim objControl
Dim strFriendlyName
Set objControl = ScreenItems("OLEElement1")
strFriendlyName = CreateObject("WScript.Shell").RegRead("HKCR\" & objControl.Type & "\")
MsgBox strFriendlyName
```

---

**Note**

In order that the example above works, a Word document should be embedded in the picture as an OLE Element.

---

## Using OLE Elements

If an OLE Element is used, it is possible that the properties provided by the OLE Element have the same names as the general ScreenItem properties. In such cases, the ScreenItem properties have priority. The "hidden" properties of an OLE Element can be accessed using the additional "Object" property. Address the properties of an OLE Element as follows:

```
OLEObjekt.object.type
```

Only use the form

```
OLEObjekt.type
```

In the case of identical names, the properties of the ScreenItem object are used.


## See also

- Height Property (Page 443)
- Activate Method (Page 712)
- Properties (Page 301)
- ScreenItems Object (List) (Page 129)
- ScreenItem Object (Page 125)
- Width Property (Page 698)
- Visible Property (Page 696)
- Type Property (Page 666)

- Top Property (Page 643)
- ToolTipText Property (Page 641)
- Parent Property (Page 529)
- Object Property (Page 512)
- ObjectName Property (Page 512)
- Left Property (Page 476)
- Layer Property (Page 460)
- Enabled Property (Page 408)

## Group Display

### Description



Object Type of ScreenItem Object. Represents the graphic object "Group Display"

### Type Identifier in VBS

HMIGroupDisplay

### Usage

In the following example, the object with the name "GroupDisplay1" is moved 10 pixels to the right:

```
'VBS44  
Dim objGroupDisplay  
Set objGroupDisplay = ScreenItems("GroupDisplay1")  
objGroupDisplay.Left = objGroupDisplay.Left + 10
```

### See also


- Activate Method (Page 712)
- MCKQBackColorOn Property (Page 492)

FontBold Property (Page 432)  
Properties (Page 301)  
ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
Width Property (Page 698)  
Visible Property (Page 696)  
UserValue4 Property (Page 678)  
UserValue3 Property (Page 677)  
UserValue2-Eigenschaft (Page 677)  
UserValue1 Property (Page 677)  
Type Property (Page 666)  
Top Property (Page 643)  
ToolTipText Property (Page 641)  
SignificantMask Property (Page 579)  
SameSize Property (Page 557)  
Relevant Property (Page 550)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
MessageClass Property (Page 503)  
MCText Property (Page 494)  
MCKQTextFlash Property (Page 494)  
MCKQTextColorOn Property (Page 493)  
MCKQTextColorOff Property (Page 493)  
MCKQBackFlash Property (Page 493)  
MCKQBackColorOff Property (Page 492)  
MCKOTextFlash Property (Page 492)  
MCKOTextColorOn Property (Page 492)  
MCKOTextColorOff Property (Page 491)  
MCKOBackFlash Property (Page 491)  
MCKOBackColorOn Property (Page 491)  
MCKOBackColorOff Property (Page 490)  
MCGUTextFlash Property (Page 490)  
MCGUTextColorOn Property (Page 490)  
MCGUTextColorOff Property (Page 490)

- MCGUBackFlash Property (Page 489)
- MCGUBackColorOn Property (Page 489)
- MCGUBackColorOff-Eigenschaft (Page 489)
- LockTextColor Property (Page 484)
- LockText Property (Page 484)
- LockStatus Property (Page 483)
- LockBackColor Property (Page 483)
- Left Property (Page 476)
- Layer Object (Page 120)
- Height Property (Page 443)
- FontUnderline Property (Page 434)
- FontSize Property (Page 433)
- FontName Property (Page 433)
- FontItalic Property (Page 432)
- FlashRate Property (Page 426)
- Enabled Property (Page 408)
- CollectValue Property (Page 373)
- Button4Width Property (Page 362)
- Button3Width Property (Page 362)
- Button2Width Property (Page 361)
- Button1Width Property (Page 361)
- BackColor Property (Page 322)
- AlignmentTop Property (Page 310)
- AlignmentLeft Property (Page 309)

**Text list**

**Description**



Object Type of ScreenItem Object. Represents the graphic object "Text List"

## Type Identifier in VBS

HMSymbolicIOField

## Usage

In the following example, the object with the name "TextList1" is moved 10 pixels to the right:

```
'VBS45
Dim objSymIO
Set objSymIO = ScreenItems("TextList1")
objSymIO.Left = objSymIO.Left + 10
```

## See also


- Type Property (Page 666)
- FontUnderline Property (Page 434)
- BackFlashColorOff Property (Page 324)
- Activate Method (Page 712)
- Properties (Page 301)
- ScreenItems Object (List) (Page 129)
- ScreenItem Object (Page 125)
- Width Property (Page 698)
- Visible Property (Page 696)
- UnselTextColor Property (Page 673)
- UnselBGColor Property (Page 672)
- Top Property (Page 643)
- ToolTipText Property (Page 641)
- SelTextColor Property (Page 569)
- SelBGColor Property (Page 563)
- PasswordLevel Property (Page 530)
- Parent Property (Page 529)
- OutputValue Property (Page 528)
- Orientation Property (Page 526)
- OperationReport Property (Page 525)
- OperationMessage Property (Page 517)

ObjectName Property (Page 512)  
NumberLines Property (Page 511)  
ListType Property (Page 481)  
Left Property (Page 476)  
Layer Object (Page 120)  
LanguageSwitch Property (Page 458)  
ItemBorderWidth Property (Page 456)  
ItemBorderStyle Property (Page 455)  
ItemBorderColor Property (Page 455)  
ItemBorderBackColor Property (Page 455)  
Height Property (Page 443)  
ForeFlashColorOn Property (Page 436)  
ForeFlashColorOff Property (Page 435)  
ForeColor Property (Page 435)  
FontSize Property (Page 433)  
FontName Property (Page 433)  
FontItalic Property (Page 432)  
FontBold Property (Page 432)  
FlashRateForeColor Property (Page 428)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashForeColor Property (Page 424)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
EditAtOnce Property (Page 407)  
CursorControl Property (Page 395)  
BoxType Property (Page 357)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)

BorderBackColor Property (Page 353)  
 BitNumber Property (Page 346)  
 BackFlashColorOn Property (Page 324)  
 BackColor Property (Page 322)  
 AssumeOnExit Property (Page 315)  
 Assignments Property (Page 315)  
 AlignmentTop Property (Page 310)  
 AlignmentLeft Property (Page 309)  
 AdaptBorder Property (Page 306)

## Status display

### Description



Object Type of ScreenItem Object. Represents the graphic object "Status Display"

### Type Identifier in VBS

HMIGraphicIOField

### Usage

In the following example, the object with the name "StatusDisplay1" is moved 10 pixels to the right:

```

'VBS46
Dim objGraphicIO
Set objGraphicIO= ScreenItems("StatusDisplay1")
objGraphicIO.Left = objGraphicIO.Left + 10

```

## See also

Layer Object (Page 120)  
Activate Method (Page 712)  
Properties (Page 301)  
ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
Width Property (Page 698)  
Visible Property (Page 696)  
Type Property (Page 666)  
Top Property (Page 643)  
ToolTipText Property (Page 641)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Index Property (Page 452)  
Height Property (Page 443)  
FlashRateFlashPic Property (Page 428)  
FlashRateBorderColor Property (Page 427)  
FlashPicUseTransColor Property (Page 426)  
FlashPicture Property (Page 425)  
FlashPicTransColor Property (Page 425)  
FlashPicReferenced Property (Page 425)  
FlashFlashPicture Property (Page 424)  
FlashBorderColor Property (Page 424)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BasePicUseTransColor Property (Page 341)  
BasePicture Property (Page 341)




BasePicTransparentColor Property (Page 341)

BasePicReferenced Property (Page 340)

### 1.14.3.4 Windows objects

#### Button

#### Description



Object Type of ScreenItem Object. Represents the graphic object "Button"

#### Type Identifier in VBS

HMIButton

#### Usage

In the following example, the object with the name "Button1" is moved 10 pixels to the right:

```
'VBS47
Dim cmdButton
Set cmdButton = ScreenItems("Button1")
cmdButton.Left = cmdButton.Left + 10
```

#### Notes on Error Handling

Buttons and pushbuttons are mapped in the object model to an "HMIButton" type. Since the objects have different properties, the availability of the property (dynamic type compilation in Runtime) should be queried via an exception measure. The exception measure is activated for the corresponding procedure by the following instruction:

```
On Error Resume Next
```

The instruction causes the VBScript engine to initiate the follow-on command in the case of a Runtime error.

The error code can subsequently be checked using the Err object. In order to deactivate the handling of Runtime errors in scripts, use the following command:

```
On Error Goto 0
```

Handling errors always relates to the procedure layer. If a script in a procedure causes an error, VBScript checks whether an error handling measure is implemented in this layer. If not, control is transferred one layer up (to the calling procedure). If there is no error handling measure here either, the control is transferred yet another layer up. This continues until either the top module level is reached or the code for Runtime error handling is located. If the activation of the Runtime error handling fails, the control is transferred to the top level on the internal VBScript Runtime error handling. This opens an error dialog and stops the script.

The "On Error Resume Next" command can be installed on all layers (i.e. also in procedures). When the error handling measure is use, it can basically be determined whether the user is actually using the required implementation type.

In addition, it can be ensured that there is no termination of execution due to a faulty access to the object.

## Examples of error handling

```
Sub OnClick(ByVal Item)
  'VBS48
  Dim objScreenItem
  On Error Resume Next      'Activation of errorhandling
  For Each objScreenItem In ScreenItems
    If objScreenItem.Type = "HMIButton" Then
      '
      '=== Property "Text" available only for Standard-Button
      objScreenItem.Text = "Windows"
      If 0 <> Err.Number Then
        HMIRuntime.Trace objScreenItem.ObjectName & ": no Windows-Button" & vbCrLf
        Err.Clear      'Delete error message
      End If
    End If
  Next
  On Error Goto 0      'Deactivation of errorhandling
End Sub
```

## See also


- Top Property (Page 643)
- FlashBorderColor Property (Page 424)
- Activate Method (Page 712)

Properties (Page 301)  
ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
WindowsStyle Property (Page 700)  
Width Property (Page 698)  
Visible Property (Page 696)  
Type Property (Page 666)  
ToolTipText Property (Page 641)  
Text list (Page 196)  
PictureUp Property (Page 539)  
PictureDown Property (Page 537)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
Orientation Property (Page 526)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Layer Object (Page 120)  
Hotkey Property (Page 450)  
Height Property (Page 443)  
ForeFlashColorOn Property (Page 436)  
ForeFlashColorOff Property (Page 435)  
ForeColor Property (Page 435)  
FontUnderline Property (Page 434)  
FontSize Property (Page 433)  
FontName Property (Page 433)  
FontItalic Property (Page 432)  
FontBold Property (Page 432)  
FlashRateForeColor Property (Page 428)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashForeColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)

- FillColor Property (Page 418)
- Enabled Property (Page 408)
- BorderWidth Property (Page 355)
- BorderStyle Property (Page 355)
- BorderFlashColorOn Property (Page 355)
- BorderFlashColorOff Property (Page 354)
- BorderColorTop Property (Page 354)
- BorderColor Property (Page 353)
- BorderColorBottom Property (Page 354)
- BorderBackColor Property (Page 353)
- BackFlashColorOn Property (Page 324)
- BackFlashColorOff Property (Page 324)
- BackColor Property (Page 322)
- AlignmentTop Property (Page 310)
- AlignmentLeft Property (Page 309)
- AdaptBorder Property (Page 306)

## Check box

### Description



Object Type of ScreenItem Object. Represents the graphic object "Check Box"

### Type Identifier in VBS

HMICheckBox

## Usage

In the following example, the object with the name "CheckBox1" is moved 10 pixels to the right:

```
'VBS49
Dim chkCheckBox
Set chkCheckBox = ScreenItems("CheckBox1")
chkCheckBox.Left = chkCheckBox.Left + 10
```


## See also

- [FontSize Property \(Page 433\)](#)
- [BackColor Property \(Page 322\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [Text list \(Page 196\)](#)
- [Process Property \(Page 544\)](#)
- [PasswordLevel Property \(Page 530\)](#)
- [Parent Property \(Page 529\)](#)
- [Orientation Property \(Page 526\)](#)
- [OperationMessage Property \(Page 517\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [Index Property \(Page 452\)](#)
- [Height Property \(Page 443\)](#)
- [ForeFlashColorOn Property \(Page 436\)](#)
- [ForeFlashColorOff Property \(Page 435\)](#)
- [ForeColor Property \(Page 435\)](#)
- [FontUnderline Property \(Page 434\)](#)

FontName Property (Page 433)  
FontItalic Property (Page 432)  
FontBold Property (Page 432)  
FlashRateForeColor Property (Page 428)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashForeColor Property (Page 424)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BoxCount Property (Page 357)  
BoxAlignment Property (Page 356)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
AlignmentTop Property (Page 310)  
AlignmentLeft Property (Page 309)  
AdaptBorder Property (Page 306)

## Radio box

### Description



Object Type of ScreenItem Object. Represents the graphic object "Radio Box"

### Type Identifier in VBS

HMIOptionGroup

### Usage

In the following example, the object with the name "RadioBox1" is moved 10 pixels to the right:

```
'VBS50
Dim objOptionGroup
Set objOptionGroup = ScreenItems("RadioBox1")
objOptionGroup.Left = objOptionGroup.Left + 10
```

### See also

- [ForeColor Property \(Page 435\)](#)
- [BackFlashColorOn Property \(Page 324\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)


Text list (Page 196)  
Process Property (Page 544)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
Orientation Property (Page 526)  
OperationMessage Property (Page 517)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Layer Object (Page 120)  
Index Property (Page 452)  
Height Property (Page 443)  
ForeFlashColorOn Property (Page 436)  
ForeFlashColorOff Property (Page 435)  
FontUnderline Property (Page 434)  
FontSize Property (Page 433)  
FontName Property (Page 433)  
FontItalic Property (Page 432)  
FontBold Property (Page 432)  
FlashRateForeColor Property (Page 428)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashForeColor Property (Page 424)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BoxCount Property (Page 357)  
BoxAlignment Property (Page 356)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)



BorderColor Property (Page 353)  
BorderBackColor Property (Page 353)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)  
AlignmentTop Property (Page 310)  
AlignmentLeft Property (Page 309)  
AdaptBorder Property (Page 306)

## Round Button

### Description



Object Type of ScreenItem Object. Represents the graphic object "Round Button"

### Type Identifier in VBS

HMISwitch

### Usage

In the following example, the object with the name "RoundButton1" is moved 10 pixels to the right:

```
'VBS51
Dim objSwitch
Set objSwitch= ScreenItems("RoundButton1")
objSwitch.Left = objSwitch.Left + 10
```

1.14 VBS Reference

```
Sub OnClick(ByVal Item)
'VBS52
Dim objScreenItem
On Error Resume Next      'Activation of errorhandling
For Each objScreenItem In ScreenItems
  If objScreenItem.Type = "HMIButton" Then
    '
    '=== Property "Text" available only for Standard-Button
    objScreenItem.Text = "Windows"
    If 0 <> Err.Number Then
      HMIRuntime.Trace objScreenItem.ObjectName & ": no Windows-Button" & vbCrLf
      Err.Clear      'Delete error message
    End If
  '
  '=== Property "Radius" available only for RoundButton
  objScreenItem.Radius = 10
  If 0 <> Err.Number Then
    HMIRuntime.Trace ScreenItem.ObjectName & ": no RoundButton" & vbCrLf
    Err.Clear
  End If
End If
Next
On Error Goto 0      'Deactivation of errorhandling
End Sub
```


**See also**

- [PicDownUseTransparentColor Property \(Page 535\)](#)
- [BorderColorTop Property \(Page 354\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [Toggle Property \(Page 627\)](#)
- [Radius Property \(Page 547\)](#)
- [Pressed Property \(Page 543\)](#)
- [PicUpUseTransparentColor Property \(Page 540\)](#)

PicUpTransparent Property (Page 540)  
PicUpReferenced Property (Page 539)  
PictureUp Property (Page 539)  
PictureDown Property (Page 537)  
PictureDeactivated Property (Page 537)  
PicDownTransparent Property (Page 535)  
PicDownReferenced Property (Page 535)  
PicDeactUseTransColor Property (Page 534)  
PicDeactTransparent Property (Page 534)  
PicDeactReferenced-Eigenschaft (Page 534)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Left Property (Page 476)  
Layer Object (Page 120)  
Height Property (Page 443)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
Enabled Property (Page 408)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)  
BorderFlashColorOn Property (Page 355)  
BorderFlashColorOff Property (Page 354)  
BorderColor Property (Page 353)  
BorderColorBottom Property (Page 354)  
BorderBackColor Property (Page 353)  
BackFlashColorOn Property (Page 324)  
BackFlashColorOff Property (Page 324)  
BackColor Property (Page 322)

## Slider

### Description



Object Type of ScreenItem Object. Represents the graphic object "Slider"

### Type Identifier in VBS

HMISlider

### Usage

In the following example, the object with the name "Slider1" is moved 10 pixels to the right:

```
'VBS53
Dim sldSlider
Set sldSlider = ScreenItems("Slider1")
sldSlider.Left = sldSlider.Left + 10
```

### Notes on Error Handling

Sliders and WinCC slider controls are mapped in the object model to an "HMISlider" type. Since the objects have different properties, the availability of the property (dynamic type compilation in Runtime) should be queried via an exception measure. The exception measure is activated for the corresponding procedure by the following instruction:

```
On Error Resume Next
```

The instruction causes the VBScript engine to initiate the follow-on command in the case of a Runtime error.

The error code can subsequently be checked using the Err object. In order to deactivate the handling of Runtime errors in scripts, use the following command:

```
On Error Goto 0
```

Handling errors always relates to the procedure layer. If a script in a procedure causes an error, VBScript checks whether an error handling measure is implemented in this layer. If not, control is transferred one layer up (to the calling procedure). If there is no error handling measure here either, the control is transferred yet another layer up. This continues until either the top module level is reached or the code for Runtime error handling is located. If the activation of the Runtime error handling fails, the control is transferred to the top level on the internal VBScript Runtime error handling. This opens an error dialog and stops the script.

The "On Error Resume Next" command can be installed on all layers (i.e. also in procedures). When the error handling measure is use, it can basically be determined whether the user is actually using the required implementation type.

In addition, it can be ensured that there is no termination of execution due to a faulty access to the object.

## Examples of error handling

```
Sub OnClick(Byval Item)
'VBS194
Dim ScreenItem
' activating error handling:
On Error Resume Next
For Each ScreenItem In ScreenItems
If ScreenItem.Type = "HMISlider" Then
'=== Property "BevelColorUp" only exists for a WinCC Slider Control
ScreenItem.BevelColorUp = 1
If (Err.Number <> 0) Then
HMIRuntime.Trace(ScreenItem.ObjectName + ": no Windows-Slider" + vbCrLf)
' delete error message
Err.Clear
End If
'=== Property "BorderStyle" only exists for a Windows-Slider
ScreenItem.BorderStyle = 1
If (Err.Number <> 0) Then
HMIRuntime.Trace(ScreenItem.ObjectName + ": no WinCC Slider Control" + vbCrLf)
Err.Clear
End If
End If
Next
On Error GoTo 0 ' deactivating error handling
End Sub
```

## See also

- Height Property (Page 443)
- BackColorBottom Property (Page 323)
- Activate Method (Page 712)
- Properties (Page 301)

ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
WindowsStyle Property (Page 700)  
Width Property (Page 698)  
Visible Property (Page 696)  
Type Property (Page 666)  
Top Property (Page 643)  
ToolTipText Property (Page 641)  
SmallChange Property (Page 580)  
Process Property (Page 544)  
PasswordLevel Property (Page 530)  
Parent Property (Page 529)  
OperationReport Property (Page 525)  
OperationMessage Property (Page 517)  
ObjectName Property (Page 512)  
Min Property (Page 506)  
Max Property (Page 488)  
Left Property (Page 476)  
Layer Object (Page 120)  
FlashRateBorderColor Property (Page 427)  
FlashRateBackColor Property (Page 427)  
FlashBorderColor Property (Page 424)  
FlashBackColor Property (Page 423)  
FillStyle Property (Page 419)  
FillingIndex Property (Page 419)  
Filling Property (Page 419)  
FillColor Property (Page 418)  
ExtendedOperation Property (Page 415)  
Enabled Property (Page 408)  
Direction Property (Page 405)  
ColorTop Property (Page 377)  
ColorBottom Property (Page 375)  
ButtonColor Property (Page 357)  
BorderWidth Property (Page 355)  
BorderStyle Property (Page 355)

BorderFlashColorOn Property (Page 355)

BorderFlashColorOff Property (Page 354)

BorderColor Property (Page 353)

BorderBackColor Property (Page 353)

BackFlashColorOn Property (Page 324)

BackFlashColorOff Property (Page 324)


BackColorTop Property (Page 323)

BackColor Property (Page 322)

### 1.14.3.5 Tube objects

#### Polygon Tube

#### Description



Object Type of ScreenItem Object. Represents the "Polygon Tube" graphic object.

#### Type Identifier in VBS

HMITubePolyline

#### Usage


In the following example, the object with the name "TubePolyline1" is moved 10 pixels to the right:

```

'VBS24
Dim objTubePolyline
Set objTubePolyline = ScreenItems("TubePolyline1")
objTubePolyline.Left = objTubePolyline.Left + 10
  
```

## T-piece

### Description



Object Type of ScreenItem Object. Represents the "T-piece" graphic object.

### Type Identifier in VBS

HMITubeTeeObject


### Usage

In the following example, the object with the name "TubeTeeObject1" is moved 10 pixels to the right:

```
'VBS21  
Dim objTubeTeeObject  
Set objTubeTeeObject = ScreenItems("TubeTeeObject1")  
objTubeTeeObject.Left = objTubeTeeObject.Left + 10
```

## Double T-piece

### Description



Object Type of ScreenItem Object. Represents the "Double T-piece" graphic object.



## Type Identifier in VBS

HMITubeDoubleTeeObject


## Usage

In the following example, the object with the name "TubeDoubleTeeObject1" is moved 10 pixels to the right:

```
'VBS21
Dim objTubeDoubleTeeObject
Set objTubeDoubleTeeObject = ScreenItems("TubeDoubleTeeObject1")
objTubeDoubleTeeObject.Left = objTubeDoubleTeeObject.Left + 10
```

## Tube Bend

### Description



Object Type of ScreenItem Object. Represents the "Tube Arc" graphic object.

## Type Identifier in VBS

HMITubeArcObject

## Usage

In the following example, the object with the name "TubeArcObject1" is moved 10 pixels to the right:

```
'VBS24
Dim objTubeArcObject
Set objTubeArcObject = ScreenItems("TubeArcObject1")
objTubeArcObject.Left = objTubeArcObject.Left + 10
```

### 1.14.3.6 Controls

#### Controls

##### Special features with controls

In the case of non-WinCC controls, the version-independent ProgID is returned as the type.

It is possible to determine the version-dependent ProgID or "User friendly Name" from the ProgID: In the following example, "Control1" is a control embedded in the picture which already returns the version-independent ProgID as a result of the Type property.

---

**Note**

Since not every Control has a version-dependent ProgID, an error handling measure should be integrated to query the version-dependent ProgID or UserFriendlyName. If no error handling is used, the code is terminated immediately without any result when no ProgID is found.

---

Determine the version-dependent ProgID as follows:

```
'VBS153
Dim objControl
Dim strCurrentVersion
Set objControl = ScreenItems("Control1")
strCurrentVersion = CreateObject("WScript.Shell").RegRead("HKCR\" & objControl.Type &
"\CurVer\")
MsgBox strCurrentVersion
```

---

**Note**

In order that example above works, a multimedia control should be inserted in the picture.

---

Determine the User Friendly Name as follows:

```
'VBS154
Dim objControl
Dim strFriendlyName
Set objControl = ScreenItems("Control1")
strFriendlyName = CreateObject("WScript.Shell").RegRead("HKCR\" & objControl.Type & "\")
MsgBox strFriendlyName
```

---

**Note**

In order that example above works, a multimedia control should be inserted in the picture.

---

## Restrictions of VBS for Dynamization by Controls

If Controls are to be dynamized with, the following conditions must be fulfilled:

### Methods

The "ByRef" declaration may only be implemented as a "Variant" (ByRef xxx as Variant)

The "ByVal" declaration may only be implemented with tag types (ByVal xxx as Long)

### Properties

The "ByRef" declaration may only be implemented as a "Variant" (ByRef xxx as Variant)

The "ByVal" declaration may only be implemented with tag types (ByVal xxx as Long)

### Events

The "ByRef" declaration is not permitted.

The "ByVal" declaration may only be implemented as a "Variant" (ByVal xxx as Variant)

### Arrays

If arrays are used, they must be declared with (ByRef xxx As Variant).

In order that arrays can be transferred in variants, variant tag must also be inserted as an intermediate tag according to the following scheme:

```
'VBS151
Dim arrayPoints(200)
Dim vArrayCoercion      'Variant for array Coercion
' Make the VBS Array compatible with the OLE Automation
vArrayCoercion = (arrayPoints)
objTrendControl.DataXY = vArrayCoercion      ' this array will occur in the control
```

## Use of Controls from External Suppliers

If a non-WinCC control is used, it is possible that the properties provided by the control have the same names as the general ScreenItem properties. In such cases, the ScreenItem properties have priority. The "hidden" properties of an external control supplier can be accessed using the additional "object" property. Address the properties of an external control supplier as follows:

```
Control.object.type
```

If you use the following form, the properties of the ScreenItem object are used in the case of identical names:

```
Control.type
```

### Double parameter

When using a Control which is not an internal WinCC control, it is possible that the event prototypes contain a parameter with the name "Item". In this case, the name of the parameter is renamed according to "ObjectItem" in the VBS prototype submitted. If this name already exists, the name is differentiated by numbers being appended.

### WinCC controls available

- HMI Symbol Library
- WinCC AlarmControl
- WinCC Alarm Control (before WinCC V7)
- WinCC Digital/Analog Clock
- WinCC FunctionTrendControl
- WinCC Function Trend Control (before WinCC V7)
- WinCC Gauge Control
- WinCC Media Control
- WinCC OnlineTableControl
- WinCC Online Table Control (before WinCC V7)
- WinCC OnlineTrendControl
- WinCC Online Trend Control (before WinCC V7)
- WinCC Push Button Control
- WinCC RulerControl
- WinCC Slider Control
- WinCC UserArchiveControl

### See also

HMI Symbol Library (Page 239)

WinCC Slider Control (Page 277)

WinCC Push Button Control (Page 269)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Gauge Control (Page 254)

WinCC Function Trend Control (before WinCC V7) (Page 288)

WinCC Digital/Analog Clock (Page 246)

WinCC Alarm Control (before WinCC V7) (Page 286)

WinCC UserArchiveControl (Page 280)

WinCC RulerControl (Page 272)

WinCC OnlineTrendControl (Page 262)  
 WinCC OnlineTableControl (Page 257)  
 WinCC FunctionTrendControl (Page 248)  
 WinCC AlarmControl (Page 241)

## List of controls

### Column object (list)

#### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Column" listing object to configure the properties of the columns in the WinCC UserArchiveControl.

#### Use in the controls

- WinCC UserArchiveControl (Page 280)

#### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "colobj.ColumnName", the listing name "Column" is dropped: "colobj.Name".

ColumnAlias (Page 379)	ColumnFlagUnique (Page 381)	ColumnPosition (Page 384)	ColumnSort (Page 387)
ColumnAlign (Page 379)	ColumnHideText (Page 381)	ColumnPrecisions (Page 384)	ColumnSortIndex (Page 387)
ColumnAutoPrecisions (Page 379)	ColumnHideTitleText (Page 382)	ColumnReadAccess (Page 384)	ColumnStartValue (Page 387)
ColumnCaption (Page 380)	ColumnIndex (Page 382)	ColumnReadOnly (Page 384)	ColumnStringLength (Page 387)
ColumnCount (Page 380)	ColumnLeadingZeros (Page 383)	ColumnRepos (Page 385)	ColumnTimeFormat (Page 388)
ColumnDateFormat (Page 380)	ColumnLength (Page 383)	ColumnShowDate (Page 386)	ColumnType (Page 389)
ColumnDMVarName (Page 380)	ColumnMaxValue (Page 383)	ColumnShowIcon (Page 386)	ColumnVisible (Page 389)
ColumnExponentialFormat (Page 381)	ColumnMinValue (Page 383)	ColumnShowTitleIcon (Page 386)	ColumnWriteAccess (Page 389)
ColumnFlagNotNull (Page 381)	ColumnName (Page 383)		

**See also**

- GetColumn method (Page 720)
- GetColumnCollection method (Page 721)

**HitlistColumn object (list)**

**Description**

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "HitlistColumn" listing object to configure the message blocks used in the hitlist of WinCC AlarmControl.

**Use in the controls**

- WinCC AlarmControl (Page 241)

**Available properties of the object**

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "hitlistobj.HitlistColumnName", the listing name "HitlistColumn" is dropped: "hitlistobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

HitlistColumnAdd (Page 445)	HitlistColumnRepos (Page 446)	HitListMaxSourceItems (Page 448)
HitlistColumnAutoAdjust (Page 445)	HitlistColumnSort (Page 447)	HitListMaxSourceItemsWarn (Page 448)
HitlistColumnCount (Page 445)	HitlistColumnSortIndex (Page 447)	HitListRelTime (Page 448)
HitlistColumnIndex (Page 446)	HitlistColumnVisible (Page 447)	HitListRelTimeFactor (Page 449)
HitlistColumnName (Page 446)	HitListDefaultSort (Page 447)	HitListRelTimeFactorType (Page 449)
HitlistColumnRemove (Page 446)		

**See also**

- GetHitlistColumn method (Page 722)
- GetHitlistColumnCollection method (Page 723)

## MessageBlock object (list)

### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "MessageBlock" listing object to configure the message blocks in WinCC AlarmControl.

### Use in the controls

- WinCC AlarmControl (Page 241)

### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "messageobj.MessageBlockName", the listing name "MessageBlock" is dropped: "messageobj.Name".

MessageBlockAlign (Page 495)	MessageBlockFlashOn (Page 497)	MessageBlockLength (Page 500)	MessageBlockShowIcon (Page 501)
MessageBlockAutoPrecisions (Page 495)	MessageBlockHideText (Page 498)	MessageBlockName (Page 500)	MessageBlockShowTitleIcon (Page 501)
MessageBlockCaption (Page 496)	MessageBlockHideTitleText (Page 498)	MessageBlockPrecisions (Page 500)	MessageBlockTextId (Page 501)
MessageBlockCount (Page 496)	MessageBlockID (Page 498)	MessageBlockSelected (Page 500)	MessageBlockTimeFormat (Page 502)
MessageBlockDateFormat	MessageBlockIndex (Page 499)	MessageBlockShowDate (Page 501)	MessageBlockType (Page 502)
MessageBlockExponential-Format (Page 497)	MessageBlockLeadingZeros (Page 499)		

### See also

GetMessageBlock method (Page 724)

GetMessageBlockCollection method (Page 725)

## MessageColumn object (list)

### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "MessageColumn" listing object to configure the message blocks used in the message lists of WinCC AlarmControl.

**Use in the controls**

- WinCC AlarmControl (Page 241)

**Available properties of the object**

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "messagecol.MessageColumnName", the listing name "MessageColumn" is dropped: "messagecol.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

MessageColumnAdd (Page 503)	MessageColumnName (Page 504)	MessageColumnSort (Page 505)
MessageColumnAutoAdjust (Page 503)	MessageColumnRemove (Page 504)	MessageColumnSortIndex (Page 505)
MessageColumnCount (Page 504)	MessageColumnRepos (Page 505)	MessageColumnVisible (Page 505)
MessageColumnIndex (Page 504)		

**See also**

GetMessageColumn method (Page 727)

GetMessageColumnCollection method (Page 728)

**OperatorMessage object (list)**

**Description**

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "OperatorMessage" listing object to configure the operator messages displayed in WinCC AlarmControl.

**Use in the controls**

- WinCC AlarmControl (Page 241)



## Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "opmessobj.OperatorMessageName", the listing name "OperatorMessage" is dropped: "opmessobj.Name".

OperatorMessageID (Page 518)	OperatorMessageSource5 (Page 520)	OperatorMessageSourceType3 (Page 523)
OperatorMessageIndex (Page 518)	OperatorMessageSource6 (Page 521)	OperatorMessageSourceType4 (Page 523)
OperatorMessageName (Page 518)	OperatorMessageSource7 (Page 521)	OperatorMessageSourceType5 (Page 523)
OperatorMessageNumber (Page 519)	OperatorMessageSource8 (Page 521)	OperatorMessageSourceType6 (Page 524)
OperatorMessageSelected (Page 519)	OperatorMessageSource9 (Page 522)	OperatorMessageSourceType7 (Page 524)
OperatorMessageSource1 (Page 519)	OperatorMessageSource10 (Page 522)	OperatorMessageSourceType8 (Page 524)
OperatorMessageSource2 (Page 519)	OperatorMessageSourceType1 (Page 522)	OperatorMessageSourceType9 (Page 525)
OperatorMessageSource3 (Page 520)	OperatorMessageSourceType2 (Page 522)	OperatorMessageSourceType10 (Page 525)
OperatorMessageSource4 (Page 520)		

## See also

[GetOperatorMessage method \(Page 729\)](#)

[GetOperatorMessageCollection method \(Page 730\)](#)

## Row object (list)

### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Row" listing object to access the rows of the table-based controls. The Row object refers to the runtime data in the tables.

## Use in the controls

WinCC AlarmControl (Page 241)	WinCC OnlineTableControl (Page 257)
WinCC RulerControl (Page 272)	WinCC UserArchiveControl (Page 280)

**Available methods of the object**

SelectAll (Page 797)	SelectRow (Page 798)
UnselectAll (Page 812)	UnselectRow (Page 813)

**Available properties of the object**

- Count (Page 394)

**Example**

```
'VBS371
Dim mycontrol
Set mycontrol = ScreenItems.Item("Control1")
Dim rowobj
Set rowobj = mycontrol.GetRowCollection

'Reading the property Count of the collection
HMIRuntime.Trace "RowCount: " & rowobj.Count & vbNewline

'Reading the properties CellText, CellCount an RowNumber for the items of the collection
For lIndex = 1 To rowobj.Count
'In this example the CellText of the third column is returned
HMIRuntime.Trace "RowCellText: " & lIndex & ": " & rowobj.item(lIndex).CellText(3) &
vbNewline
HMIRuntime.Trace "RowCellCount: " & lIndex & ": " & rowobj.item(lIndex).CellCount &
vbNewline
HMIRuntime.Trace "RowNumber: " & rowobj.item(lIndex).RowNumber & vbNewline
Next
```

**See also**

- GetRow method (Page 731)
- GetRowCollection method (Page 732)
- GetSelectedRow method (Page 738)
- GetSelectedRows method (Page 739)
- CellCount property (Page 364)
- CellText property (Page 366)
- RowNumber property (Page 553)

**RulerBlock object (list)****Description**

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Block" listing object to configure the blocks of WinCC RulerControl.

### Use in the controls

- WinCC RulerControl (Page 272)

### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "rulerblockobj.BlockName", the listing name "Block" is dropped: "rulerblockobj.Name".

BlockAlign (Page 347)	BlockHideText (Page 349)	BlockPrecisions (Page 351)
BlockAutoPrecisions (Page 348)	BlockHideTitleText (Page 349)	BlockShowDate (Page 351)
BlockCaption (Page 348)	BlockID	BlockShowIcon (Page 351)
BlockCount (Page 348)	BlockIndex (Page 350)	BlockShowTitleIcon (Page 352)
BlockDateFormat (Page 348)	BlockLength (Page 351)	BlockTimeFormat (Page 352)
BlockExponentialFormat (Page 349)	BlockName (Page 351)	BlockUseSourceFormat (Page 352)

### See also

- GetRulerBlock method (Page 733)
- GetRulerBlockCollection method (Page 734)

### RulerColumn object (list)

#### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Column" listing object to configure the columns of the ruler window in WinCC RulerControl.

### Use in the controls

- WinCC RulerControl (Page 272)

### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "rulercolobj.ColumnName", the listing name "Column" is dropped: "rulercolobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

ColumnAdd (Page 379)	ColumnName (Page 383)	ColumnSort (Page 387)
ColumnCount (Page 380)	ColumnRemove (Page 384)	ColumnSortIndex (Page 387)
ColumnIndex (Page 382)	ColumnRepos (Page 385)	ColumnVisible (Page 389)

**See also**

- GetRulerColumn method (Page 735)
- GetRulerColumnCollection method (Page 736)

**StatisticAreaColumn object (list)**

**Description**

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Column" listing object to configure the columns of the statistic area window in WinCC RulerControl.

**Use in the controls**

- WinCC RulerControl (Page 272)

**Available properties of the object**

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "statareacolobj.ColumnName", the listing name "Column" is dropped: "statareacolobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

ColumnAdd (Page 379)	ColumnName (Page 383)	ColumnSort (Page 387)
ColumnCount (Page 380)	ColumnRemove (Page 384)	ColumnSortIndex (Page 387)
ColumnIndex (Page 382)	ColumnRepos (Page 385)	ColumnVisible (Page 389)

**See also**

- GetStatisticAreaColumn method (Page 741)
- GetStatisticAreaColumnCollection method (Page 742)

## StatisticResultColumn object (list)

### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Column" listing object to configure the columns of the statistic window in WinCC RulerControl.

### Use in the controls

- WinCC RulerControl (Page 272)

### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "statrescolobj.ColumnName", the listing name "Column" is dropped: "statrescolobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

ColumnAdd (Page 379)	ColumnName (Page 383)	ColumnSort (Page 387)
ColumnCount (Page 380)	ColumnRemove (Page 384)	ColumnSortIndex (Page 387)
ColumnIndex (Page 382)	ColumnRepos (Page 385)	ColumnVisible (Page 389)

### See also

GetStatisticResultColumn method (Page 743)

GetStatisticResultColumnCollection method (Page 744)

## StatusbarElement object (list)

### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "StatusbarElement" listing object to configure the properties of the statusbar of the controls.

**Use in the controls**

WinCC AlarmControl (Page 241)	WinCC FunctionTrendControl (Page 248)	WinCC OnlineTableControl (Page 257)
WinCC OnlineTrendControl (Page 262)	WinCC RulerControl (Page 272)	WinCC UserArchiveControl (Page 280)

**Available properties of the object**

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "statusbarobj.StatusbarElementName", the listing name "StatusbarElement" is dropped: "statusbarobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

StatusbarElementAdd (Page 589)	StatusbarElementIndex (Page 590)	StatusbarElementText (Page 591)
StatusbarElementAutoSize (Page 589)	StatusbarElementName (Page 590)	StatusbarElementTooltipText (Page 591)
StatusbarElementCount (Page 589)	StatusbarElementRemove (Page 590)	StatusbarElementUserDefined (Page 592)
StatusbarElementIconId (Page 589)	StatusbarElementRename (Page 590)	StatusbarElementVisible (Page 591)
StatusbarElementId (Page 589)	StatusbarElementRepos (Page 591)	StatusbarElementWidth (Page 592)

**See also**

GetStatusbarElement method (Page 745)

GetStatusbarElementCollection method (Page 746)

**TimeAxis object (list)****Description**

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "TimeAxis" listing object to configure the properties of the time axis in columns in the WinCC OnlineTrendControl.

**Use in the controls**

- WinCC OnlineTrendControl (Page 262)

## Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "timeaxisobj.TimeAxisName", the listing name "TimeAxis" is dropped: "timeaxisobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

TimeAxisActualize	TimeAxisIndex (Page 605)	TimeAxisRepos (Page 607)
TimeAxisAdd (Page 603)	TimeAxisInTrendColor	TimeAxisShowDate (Page 608)
TimeAxisAlign (Page 603)	TimeAxisLabel (Page 606)	TimeAxisTimeFormat (Page 608)
TimeAxisBeginTime (Page 603)	TimeAxisMeasurePoints (Page 606)	TimeAxisTimeRangeBase (Page 608)
TimeAxisColor (Page 604)	TimeAxisName (Page 606)	TimeAxisTimeRangeFactor (Page 609)
TimeAxisCount (Page 604)	TimeAxisRangeType (Page 607)	TimeAxisTrendWindow (Page 609)
TimeAxisDateFormat (Page 604)	TimeAxisRemove (Page 607)	TimeAxisVisible (Page 609)
TimeAxisEndTime (Page 604)	TimeAxisRename (Page 607)	

## See also

GetTimeAxis method (Page 747)

GetTimeAxisCollection method (Page 748)

## TimeColumn object (list)

### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "TimeColumn" listing object to configure the properties of the time column in WinCC OnlineTrendControl.

### Use in the controls

- WinCC OnlineTableControl (Page 257)

## Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "timecolobj.TimeColumnName", the listing name "TimeColumn" is dropped: "timecolobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

TimeColumnActualize (Page 610)	TimeColumnHideText (Page 613)	TimeColumnShowDate (Page 616)
TimeColumnAdd (Page 610)	TimeColumnHideTitleText (Page 614)	TimeColumnShowIcon (Page 616)
TimeColumnAlign (Page 611)	TimeColumnIndex (Page 614)	TimeColumnShowTitleIcon (Page 616)
TimeColumnBackColor (Page 611)	TimeColumnLength (Page 614)	TimeColumnSort (Page 617)
TimeColumnBeginTime (Page 612)	TimeColumnMeasurePoints (Page 614)	TimeColumnSortIndex (Page 617)
TimeColumnCaption (Page 612)	TimeColumnName (Page 615)	TimeColumnTimeFormat (Page 617)
TimeColumnCount (Page 612)	TimeColumnRangeType (Page 615)	TimeColumnTimeRangeBase (Page 618)
TimeColumnDateFormat (Page 612)	TimeColumnRemove (Page 615)	TimeColumnTimeRangeFactor (Page 618)
TimeColumnEndTime (Page 613)	TimeColumnRename (Page 615)	TimeColumnUseValueColumnColors (Page 618)
TimeColumnForeColor (Page 613)	TimeColumnRepos (Page 616)	TimeColumnVisible (Page 618)

**See also**

- GetTimeColumn method (Page 750)
- GetTimeColumnCollection method (Page 751)

**ToolbarButton object (list)**

**Description**

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).  
Use the "ToolbarButton" listing object to configure the properties of the toolbar of the controls.

**Use in the controls**

WinCC AlarmControl (Page 241)	WinCC FunctionTrendControl (Page 248)	WinCC OnlineTableControl (Page 257)
WinCC OnlineTrendControl (Page 262)	WinCC RulerControl (Page 272)	WinCC UserArchiveControl (Page 280)

**Available properties of the object**

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "toolbarobj.ToolbarButtonName", the listing name "ToolbarButton" is dropped: "toolbarobj.Name".



Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

ToolBarButtonActive (Page 630)	ToolBarButtonId (Page 635)	ToolBarButtonRename (Page 637)
ToolBarButtonAdd (Page 630)	ToolBarButtonIndex (Page 636)	ToolBarButtonRepos (Page 637)
ToolBarButtonBeginGroup (Page 630)	ToolBarButtonLocked (Page 636)	ToolBarButtonTooltipText (Page 638)
ToolBarButtonCount (Page 635)	ToolBarButtonName (Page 636)	ToolBarButtonUserDefined (Page 638)
ToolBarButtonEnabled (Page 635)	ToolBarButtonPasswordLevel (Page 636)	ToolBarButtonVisible (Page 638)
ToolBarButtonHotKey (Page 635)	ToolBarButtonRemove (Page 636)	

### See also

GetToolBarButton method (Page 752)

GetToolBarButtonCollection method (Page 753)

### Trend object (list)

#### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Trend" listing object to configure the properties of the trends. The "InsertData" and "RemoveData" methods are used to fill the trend with data or to delete the trend. The "GetRulerData" method is used to access the data at a particular point of the trend.

#### Use in the controls

WinCC FunctionTrendControl (Page 248)	WinCC OnlineTrendControl (Page 262)
---------------------------------------	-------------------------------------

#### Available methods of the object

GetRulerData (Page 737)	InsertData (Page 769)	RemoveData (Page 794)
-------------------------	-----------------------	-----------------------

#### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "trendobj.Trendname", the listing name "Trend" is dropped: "trendobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

**Properties in WinCC FunctionTrendControl and WinCC OnlineTrendControl**

TrendAdd (Page 645)	TrendLineWidth (Page 650)	TrendRemove (Page 654)
TrendColor (Page 647)	TrendLowerLimit (Page 650)	TrendRename (Page 654)
TrendCount (Page 647)	TrendLowerLimitColor (Page 650)	TrendRepos (Page 654)
TrendExtendedColorSet	TrendLowerLimitColoring (Page 651)	TrendTrendWindow (Page 657)
TrendFill (Page 648)	TrendName (Page 651)	TrendUncertainColor (Page 657)
TrendFillColor (Page 648)	TrendPointColor (Page 651)	TrendUncertainColoring (Page 658)
TrendIndex (Page 649)	TrendPointStyle	TrendUpperLimit (Page 658)
TrendLabel (Page 649)	TrendPointWidth (Page 652)	TrendUpperLimitColor (Page 658)
TrendLineStyle (Page 649)	TrendProvider (Page 652)	TrendUpperLimitColoring (Page 658)
TrendLineType (Page 650)	TrendProviderCLSID (Page 653)	TrendVisible (Page 660)

**Properties in WinCC OnlineTrendControl**

TrendAutoRangeBeginTagName (Page 645)	TrendAutoRangeSource (Page 646)	TrendValueAlignment
TrendAutoRangeBeginValue (Page 646)	TrendSelectTagName (Page 654)	TrendValueAxis (Page 659)
TrendAutoRangeEndTagName (Page 646)	TrendTagName (Page 656)	TrendValueUnit
TrendAutoRangeEndValue (Page 646)	TrendTimeAxis (Page 656)	

**Properties in the WinCC FunctionTrendControl**

TrendActualize (Page 645)	TrendSelectTagNameX (Page 655)	TrendTimeRangeBase (Page 656)
TrendBeginTime (Page 647)	TrendSelectTagNameY (Page 655)	TrendTimeRangeFactor (Page 657)
TrendEndTime (Page 648)	TrendTagNameX (Page 656)	TrendXAxis (Page 666)
TrendMeasurePoints (Page 651)	TrendTagNameY (Page 656)	TrendYAxis (Page 666)
TrendRangeType		

**See also**

- GetTrend method (Page 754)
- GetTrendCollection method (Page 755)

**TrendWindow object (list)**

**Description**

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "TrendWindow" listing object to configure the properties of the trend window.

**Use in the controls**

WinCC FunctionTrendControl (Page 248)	WinCC OnlineTrendControl (Page 262)
---------------------------------------	-------------------------------------

**Available properties of the object**

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "trendwndobj.TrendWindowName", the listing name "TrendWindow" is dropped: "trendwndobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

**Properties in WinCC FunctionTrendControl and WinCC OnlineTrendControl**

TrendWindowAdd (Page 660)	TrendWindowGridInTrendColor (Page 662)	TrendWindowRulerColor (Page 663)
TrendWindowCoarseGrid (Page 660)	TrendWindowHorizontalGrid (Page 662)	TrendWindowRulerLayer
TrendWindowCoarseGridColor (Page 660)	TrendWindowIndex (Page 662)	TrendWindowRulerStyle (Page 664)
TrendWindowCount (Page 661)	TrendWindowName (Page 662)	TrendWindowRulerWidth (Page 664)
TrendWindowFineGrid (Page 661)	TrendWindowRemove (Page 663)	TrendWindowSpacePortion (Page 664)
TrendWindowFineGridColor (Page 661)	TrendWindowRename (Page 663)	TrendWindowVerticalGrid (Page 665)
TrendWindowForegroundTrendGrid (Page 661)	TrendWindowRepos (Page 663)	TrendWindowVisible (Page 666)

**Properties in WinCC OnlineTrendControl**

TrendWindowStatisticRulerColor (Page 665)	TrendWindowStatisticRulerStyle (Page 665)	TrendWindowStatisticRulerWidth (Page 665)
---	---	---

**See also**

GetTrendWindow method (Page 757)

GetTrendWindowCollection method (Page 758)

**ValueAxis object (list)****Description**

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "ValueAxis" listing object to configure the properties of the value axis in WinCC OnlineTrendControl.

### Use in the controls

- WinCC OnlineTrendControl (Page 262)

### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "valueaxisobj.ValueAxisName", the listing name "ValueAxis" is dropped: "valueaxisobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

ValueAxisAdd (Page 681)	ValueAxisEndValue (Page 683)	ValueAxisRemove (Page 686)
ValueAxisAlign (Page 681)	ValueAxisExponentialFormat (Page 684)	ValueAxisRename (Page 686)
ValueAxisAutoPrecisions (Page 682)	ValueAxisIndex (Page 684)	ValueAxisRepos (Page 686)
ValueAxisAutoRange (Page 682)	ValueAxisInTrendColor	ValueAxisScalingType (Page 687)
ValueAxisBeginValue (Page 683)	ValueAxisLabel (Page 685)	ValueAxisTrendWindow (Page 687)
ValueAxisColor (Page 683)	ValueAxisName (Page 685)	ValueAxisVisible (Page 687)
ValueAxisCount (Page 683)	ValueAxisPrecisions (Page 686)	

### See also

- GetValueAxis method (Page 759)
- GetValueAxisCollection method (Page 760)

### ValueColumn object (list)

#### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "ValueColumn" listing object to configure the properties of the value column in WinCC OnlineTrendControl.

### Use in the controls

- WinCC OnlineTableControl (Page 257)

### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "valcolobj.ValueColumnName", the listing name "ValueColumn" is dropped: "valcolobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

ValueColumnAdd (Page 687)	ValueColumnHideTitleText (Page 690)	ValueColumnRepos (Page 692)
ValueColumnAlign (Page 688)	ValueColumnIndex (Page 690)	ValueColumnSelectTagName (Page 693)
ValueColumnAutoPrecisions (Page 688)	ValueColumnLength (Page 691)	ValueColumnShowIcon (Page 693)
ValueColumnBackColor (Page 689)	ValueColumnName (Page 691)	ValueColumnShowTitleIcon (Page 693)
ValueColumnCaption (Page 689)	ValueColumnPrecisions (Page 691)	ValueColumnSort (Page 693)
ValueColumnCount (Page 689)	ValueColumnProvider (Page 691)	ValueColumnSortIndex (Page 694)
ValueColumnExponentialFormat (Page 689)	ValueColumnProviderCLSID (Page 692)	ValueColumnTagName (Page 694)
ValueColumnForeColor (Page 690)	ValueColumnRemove (Page 692)	ValueColumnTimeColumn (Page 694)
ValueColumnHideText (Page 690)	ValueColumnRename (Page 692)	ValueColumnVisible (Page 695)

## See also

GetValueColumn method (Page 761)

GetValueColumnCollection method (Page 762)

## XAxis object (list)

### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Xaxis" listing object to configure the properties of the X axis in WinCC FunctionTrendControl.

### Use in the controls

- WinCC FunctionTrendControl (Page 248)

### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "xaxisobj.XAxisName", the listing name "XAxis" is dropped: "xaxisobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

XAxisAdd (Page 702)	XAxisEndValue (Page 704)	XAxisRemove (Page 706)
XAxisAlign	XAxisExponentialFormat (Page 704)	XAxisRename (Page 708)
XAxisAutoPrecisions (Page 703)	XAxisIndex (Page 708)	XAxisRepos (Page 706)
XAxisAutoRange (Page 703)	XAxisInTrendColor	XAxisScalingType (Page 706)
XAxisBeginValue (Page 703)	XAxisLabel (Page 705)	XAxisTrendWindow (Page 707)
XAxisColor (Page 704)	XAxisName (Page 705)	XAxisVisible (Page 707)
XAxisCount (Page 707)	XAxisPrecisions (Page 706)	

### See also

GetXAxis method (Page 764)

GetXAxisCollection method (Page 765)

### YAxis object (list)

#### Description

The listing of controls is a data container that can save a number of objects of the same type (users can change the number).

Use the "Yaxis" listing object to configure the properties of the Y axis in WinCC FunctionTrendControl.

#### Use in the controls

- WinCC FunctionTrendControl (Page 248)

#### Available properties of the object

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "yaxisobj.YAxisName", the listing name "YAxis" is dropped: "yaxisobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".


YAxisAdd (Page 702)	YAxisEndValue (Page 704)	YAxisRemove (Page 706)
YAxisAlign (Page 702)	YAxisExponentialFormat (Page 704)	YAxisRename (Page 709)
YAxisAutoPrecisions (Page 703)	YAxisIndex (Page 708)	YAxisRepos (Page 706)
YAxisAutoRange (Page 703)	YAxisInTrendColor (Page 705)	YAxisScalingType (Page 706)
YAxisBeginValue (Page 703)	YAxisLabel (Page 705)	YAxisTrendWindow (Page 707)

YAxisColor (Page 704)	YAxisName (Page 705)	YAxisVisible (Page 707)
YAxisCount (Page 708)	YAxisPrecisions (Page 706)	

**See also**

GetYAxis method (Page 766)

GetYAxisCollection method (Page 767)

**HMI Symbol Library****Description**

Object Type of ScreenItem Object. Represents the graphic object "HMI Symbol Library"

**Type Identifier in VBS**

HMISymbolLibrary

**Usage**

In the following example, the object with the name "Control1" is moved 20 pixels to the right:

```

'VBS64
Dim objControl
Set objControl = ScreenItems("Control1")
objControl.Left = objControl.Left +20
  
```

**Properties**

This object type has the following properties:


## See also

Left Property (Page 476)  
Activate Method (Page 712)  
Properties (Page 301)  
ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
Controls (Page 218)  
Width Property (Page 698)  
Visible Property (Page 696)  
Type Property (Page 666)  
Top Property (Page 643)  
Stretch Property (Page 594)  
Picture Property (Page 536)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Object Property (Page 512)  
Layer Object (Page 120)  
Height Property (Page 443)  
ForeColor Property (Page 435)  
Flip Property (Page 429)  
Enabled Property (Page 408)  
Cursor Property (Page 395)  
BlinkColor Property (Page 346)  
BackStyle Property (Page 325)  
BackColor Property (Page 322)



## WinCC AlarmControl

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC AlarmControl" as of WinCC V7.0.

### Type Identifier in VBS

HMIAlarmControl

### Available list objects

HitlistColumn (Page 222)	Row (Page 225)
MessageBlock (Page 223)	StatusbarElement (Page 229)
MessageColumn (Page 223)	ToolbarButton (Page 232)
OperatorColumn (Page 224)	

### Methods Available in VBS

Activate	ActivateDynamic	AttachDB
----------	-----------------	----------

CopyRows		
----------	--	--

DeactivateDynamic	DetachDB	
-------------------	----------	--

Export		
--------	--	--

GetHitlistColumn	GetOperatorMessage	GetStatusbarElement
GetHitlistColumnCollection	GetOperatorMessageCollection	GetStatusbarElementCollection
GetMessageBlock	GetRow (Page 731)	GetToolbarButton

1.14 VBS Reference

GetMessageBlockCollection	GetRowCollection (Page 732)	GetToolBarButtonCollection
GetMessageColumn	GetSelectedRow (Page 738)	
GetMessageColumnCollection	GetSelectedRows (Page 739)	

HideAlarm	LockAlarm	
-----------	-----------	--

LoopInAlarm		
-------------	--	--

MoveToFirstLine	MoveToLastPage	MoveToPreviousLine
MoveToFirstPage	MoveToNextLine	MoveToPreviousPage
MoveToLastLine	MoveToNextPage	

Print		
-------	--	--

QuitHorn	QuitSelected	QuitVisible
----------	--------------	-------------

ShowComment	ShowInfoText	ShowSelectionDialog
ShowDisplayOptionsDialog	ShowLockDialog	ShowShortTermArchiveList
ShowEmergencyQuitDialog	ShowLockList	ShowSortDialog
ShowHelp	ShowLongTermArchiveList	ShowTimebaseDialog
ShowHideList	ShowMessageList	
ShowHitList	ShowPropertyDialog	

UnhideAlarm	UnlockAlarm	
-------------	-------------	--

**Properties Available in VBS**

If you access the properties with a listing object, you do not have to enter the name of the listing. For example, when using "messagecol.MessageColumnName", the listing name "MessageColumn" is dropped: "messagecol.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

Activate	AutoCompleteColumns	AutoSelectionColors
AllServer	AutoCompleteRows	AutoSelectionRectColor
ApplyProjectSettings	AutoScroll	

BackColor	BorderColor	BorderWidth
-----------	-------------	-------------

Caption	CellSpaceRight	ColumnTitleAlign
CellCut	CellSpaceTop	ColumnTitles
CellSpaceBottom	Closeable	
CellSpaceLeft	ColumnResize	

DefaultMsgFilterSQL	DefaultSort2	DisplayOptions
DefaultSort	DefaultSort2Column	DoubleClickAction

ExportDirectoryChangeable	ExportFilenameChangeable	ExportSelection
ExportDirectoryname	ExportFormatGuid	ExportShowDialog
ExportFileExtension	ExportFormatName	ExportXML
ExportFilename	ExportParameters	

Font		
------	--	--

GridLineColor	GridLineWidth	
---------------	---------------	--

HitlistColumnAdd	HitlistColumnRepos	HitListMaxSourceItemsWarn
HitlistColumnAutoAdjust (Page 445)	HitlistColumnSort	HitListRelTime
HitlistColumnCount	HitlistColumnSortIndex	HitListRelTimeFactor
HitlistColumnIndex	HitlistColumnVisible	HitListRelTimeFactorType
HitlistColumnName	HitListDefaultSort	HorizontalGridLines
HitlistColumnRemove	HitListMaxSourceItems	

IconSpace		
-----------	--	--

LineColor (Page 480)	LineWidth (Page 481)	LongTermArchiveConsistency
----------------------	----------------------	----------------------------

MessageBlockAlign	MessageBlockLength	MessageColumnIndex
MessageBlockAutoPrecisions	MessageBlockPrecisions	MessageColumnName
MessageBlockCaption	MessageBlockSelected	MessageColumnRemove

1.14 VBS Reference

MessageBlockCount	MessageBlockShowDate	MessageColumnRepos
MessageBlockDateFormat	MessageBlockShowIcon	MessageColumnSort
MessageBlockExponentialFormat	MessageBlockShowTitleIcon	MessageColumnSortIndex
MessageBlockFlashOn	MessageBlockTextId	MessageColumnVisible
MessageBlockHideText	MessageBlockType	MessageListType
MessageBlockHideTitleText	MessageColumnAdd	Moveable
MessageBlockIndex	MessageColumnAutoAdjust (Page 503)	MsgFilterSQL
MessageBlockLeadingZeros	MessageColumnCount	

OperatorMessageID	OperatorMessageSource5	OperatorMessageSourceType4
OperatorMessageIndex	OperatorMessageSource6	OperatorMessageSourceType5
OperatorMessageName	OperatorMessageSource7	OperatorMessageSourceType6
OperatorMessageNumber	OperatorMessageSource8	OperatorMessageSourceType7
OperatorMessageSelected	OperatorMessageSource9	OperatorMessageSourceType8
OperatorMessageSource1	OperatorMessageSource10	OperatorMessageSourceType9
OperatorMessageSource2	OperatorMessageSourceType1	OperatorMessageSourceType10
OperatorMessageSource3	OperatorMessageSourceType2	
OperatorMessageSource4	OperatorMessageSourceType3	

PageMode	PageModeMessageNumber	PrintJobName
----------	-----------------------	--------------

RowCellCount (Page 364)	RowScrollbar	RTPersistencePasswordLevel
RowCellText (Page 366)	RowTitleAlign	RTPersistenceType
RowCount (Page 394)	RowTitles	
RowNumber (Page 553)	RTPersistence	

SelectedCellColor	SelectionRect	ShowSortIndex
SelectedCellForeColor	SelectionRectColor	ShowTitle
SelectedRowColor	SelectionRectWidth	Sizeable
SelectedRowForeColor	SelectionType	SkinName
SelectedTitleColor	ServerNames	SortSequence
SelectedTitleForeColor	ShowSortButton	
SelectionColoring	ShowSortIcon	

StatusbarBackColor	StatusbarElementName	StatusbarElementVisible
StatusbarElementAdd	StatusbarElementRemove	StatusbarElementWidth
StatusbarElementAutoSize	StatusbarElementRename	StatusbarFontColor

StatusbarElementCount	StatusbarElementRepos	StatusbarShowTooltips
StatusbarElementIconId	StatusbarElementText	StatusbarText
StatusbarElementId	StatusbarElementTooltipText	StatusbarUseBackColor
StatusbarElementIndex	StatusbarElementUserDefined	StatusbarVisible

TableColor	TitleColor	TitleLightShadowColor
TableColor2	TitleCut	TitleSort
TableForeColor	TitleDarkShadowColor	TitleStyle
TableForeColor2	TitleForeColor	
TimeBase	TitleGridLineColor	

ToolbarAlignment	ToolbarButtonHotKey	ToolbarButtonRepos
ToolbarBackColor	ToolbarButtonId	ToolbarButtonTooltipText
ToolbarButtonActive	ToolbarButtonIndex	ToolbarButtonUserDefined
ToolbarButtonAdd	ToolbarButtonLocked	ToolbarButtonVisible
ToolbarButtonBeginGroup	ToolbarButtonName	ToolbarShowTooltips
ToolbarButtonClick	ToolbarButtonPasswordLevel	ToolbarUseBackColor
ToolbarButtonCount	ToolbarButtonRemove	ToolbarUseHotKeys
ToolbarButtonEnabled	ToolbarButtonRename	ToolbarVisible

UseMessageColor	UseSelectedTitleColor	UseTableColor2
-----------------	-----------------------	----------------

VerticalGridLines		
-------------------	--	--

## Example

A selection of messages is defined in an existing WinCC AlarmControl. The column properties are configured in the script.

### Requirement

- A "WinCC AlarmControl" with the name "Control1" has already been inserted in a process picture in Graphics Designer. The picture "C\_015\_Native\_Alarms\_Sel.pdl" from the demo project was used for this example.
- A button is inserted in the Graphics Designer. You have configured the event "mouse click" with a VBS action and the following script for the button.
- You have already configured messages in your project. Or you are using the demo project from which we have taken the messages used for the example.
- Messages have already been triggered in Runtime. The buttons "incoming" and "outgoing" were clicked in the demo project.

```
'VBS366
Sub OnClick(ByVal Item)
Dim objControl
Dim objMessColumn
Dim objMessBlock

Set objControl = ScreenItems("Control1")
objControl.ApplyProjectSettings = False
Set objMessBlock = objControl.GetMessageBlock("Date")
objMessBlock.DateFormat = "dd.MM.yy"
Set objMessColumn = objControl.GetMessageColumn("Time")
objMessColumn.Visible = False
objControl.MsgFilterSQL = "MSGNR >= 5 AND Priority = 0"
End Sub
```

---

**Note**

More examples for use of properties and methods are available in the descriptions of the Get methods of the controls and under "Examples for VBScript/Examples in WinCC/Dynamizing controls".


---

**See also**

Controls (Page 218)

**WinCC Digital/Analog Clock**

**Description**



Object Type of ScreenItem Object. Represents the graphic object "WinCC Digital/Analog Clock"

**Type Identifier in VBS**

HMIClock

## Usage

In the following example, the object with the name "Control1" is moved 11 pixels to the right:

```
'VBS55  
Dim objControl  
Set objControl = ScreenItems("Control1")  
objControl.Left = objControl.Left + 11
```


## See also

- [Parent Property \(Page 529\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Controls \(Page 218\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [Ticks Property \(Page 601\)](#)
- [TicksColor Property \(Page 601\)](#)
- [SquareExtent Property \(Page 587\)](#)
- [SecondNeedleWidth Property \(Page 563\)](#)
- [SecondNeedleHeight Property \(Page 563\)](#)
- [Picture Property \(Page 536\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Object Property \(Page 512\)](#)
- [MinuteNeedleWidth Property \(Page 507\)](#)
- [MinuteNeedleHeight Property \(Page 507\)](#)
- [LocaleID Property \(Page 482\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [HourNeedleWidth Property \(Page 450\)](#)
- [HourNeedleHeight Property \(Page 450\)](#)
- [Height Property \(Page 443\)](#)

- Handtype Property (Page 443)
- HandFillColor Property (Page 442)
- ForeColor Property (Page 435)
- Font property (before WinCC V7) (Page 431)
- FocusRect Property (Page 430)
- Enabled Property (Page 408)
- BackStyle Property (Page 325)
- BackColor Property (Page 322)
- Analog Property (Page 311)

## WinCC FunctionTrendControl

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC FunctionTrendControl" as of WinCC V7.0.

### Type Identifier in VBS

HMIFunctionTrendControl

### Available list objects

StatusbarElement (Page 229)	Trend (Page 233)	XAxis (Page 237)
ToolbarButton (Page 232)	TrendWindow (Page 234)	YAxis (Page 238)

### Methods Available in VBS

Activate	ActivateDynamic	AttachDB
DeactivateDynamic	DetachDB	



Export		
--------	--	--

GetStatusBarElement	GetTrend	GetXAxis
GetStatusBarElementCollection	GetTrendCollection	GetXAxisCollection
GetToolBarButton	GetTrendWindow	GetYAxis
GetToolBarButtonCollection	GetTrendWindowCollection	GetYAxisCollection

MoveAxis		
----------	--	--

NextTrend		
-----------	--	--

OneToOneView		
--------------	--	--

PreviousTrend	Print	
---------------	-------	--

ShowHelp	ShowTagSelection	ShowTrendSelection
ShowPropertyDialog	ShowTimeSelection	StartStopUpdate

ZoomArea	ZoomInOutX	ZoomMove
ZoomInOut	ZoomInOutY	

### Properties Available in VBS

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "xaxisobj.XAxisName", the listing name "XAxis" is dropped: "xaxisobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

BackColor	BorderColor	BorderWidth
-----------	-------------	-------------

Caption	Closeable	ConnectTrendWindows
---------	-----------	---------------------

1.14 VBS Reference

ExportDirectoryChangeable	ExportFilenameChangeable	ExportShowDialog
ExportDirectoryname	ExportFormatGuid	ExportParameters
ExportFileExtension	ExportFormatName	ExportXML
ExportFilename	ExportSelection	

Font		
------	--	--

GraphDirection		
----------------	--	--

LineColor	LineWidth	LoadDataImmediately
-----------	-----------	---------------------

Moveable		
----------	--	--

Online		
--------	--	--

PrintJobName		
--------------	--	--

RTPersistence	RTPersistencePasswordLevel	RTPersistenceType
---------------	----------------------------	-------------------

ShowRuler	ShowTitle	SkinName
ShowRulerInAxis	Sizeable	
ShowScrollbars	ShowTrendIcon	

StatusbarBackColor	StatusbarElementName	StatusbarElementVisible
StatusbarElementAdd	StatusbarElementRemove	StatusbarElementWidth
StatusbarElementAutoSize	StatusbarElementRename	StatusbarFontColor
StatusbarElementCount	StatusbarElementRepos	StatusbarShowTooltips
StatusbarElementIconId	StatusbarElementText	StatusbarText
StatusbarElementId	StatusbarElementTooltipText	StatusbarUseBackColor
StatusbarElementIndex	StatusbarElementUserDefined	StatusbarVisible

TimeBase	ToolbarButtonHotKey	ToolbarButtonTooltipText
ToolbarAlignment	ToolbarButtonId	ToolbarButtonUserDefined
ToolbarBackColor	ToolbarButtonIndex	ToolbarButtonVisible
ToolbarButtonActive	ToolbarButtonLocked	ToolbarShowTooltips
ToolbarButtonAdd	ToolbarButtonName	ToolbarUseBackColor
ToolbarButtonBeginGroup	ToolbarButtonPasswordLevel	ToolbarUseHotKeys
ToolbarButtonClick	ToolbarButtonRemove	ToolbarVisible
ToolbarButtonCount	ToolbarButtonRename	
ToolbarButtonEnabled	ToolbarButtonRepos	

TrendActualize	TrendLowerLimit	TrendSelectTagNameX
TrendAdd	TrendLowerLimitColor	TrendSelectTagNameY
TrendBeginTime	TrendLowerLimitColoring	TrendTagNameX
TrendColor	TrendMeasurePoints	TrendTagNameY
TrendCount	TrendName	TrendTimeRangeBase
TrendEndTime	TrendPointColor	TrendTimeRangeFactor
TrendExtendedColorSet	TrendPointStyle	TrendTrendWindow
TrendFill	TrendPointWidth	TrendUncertainColor
TrendFillColor	TrendProvider	TrendUncertainColoring
TrendIndex	TrendProviderCLSID	TrendUpperLimit
TrendLabel	TrendRangeType	TrendUpperLimitColor
TrendLineStyle	TrendRemove	TrendUpperLimitColoring
TrendLineType	TrendRename	TrendVisible
TrendLineWidth	TrendRepos	

TrendWindowAdd	TrendWindowHorizontalGrid	TrendWindowRulerStyle
TrendWindowCoarseGrid	TrendWindowIndex	TrendWindowRulerWidth
TrendWindowCount	TrendWindowName	TrendWindowSpacePortion
TrendWindowCoarseGridColor	TrendWindowRemove	TrendWindowVerticalGrid
TrendWindowFineGrid	TrendWindowRename	TrendWindowVisible
TrendWindowFineGridColor	TrendWindowRepos	TrendXAxis
TrendWindowForegroundTrendGrid	TrendWindowRulerColor	TrendYAxis
TrendWindowGridInTrendColor	TrendWindowRulerLayer	

UseTrendNameAsLabel		
---------------------	--	--

XAxisAdd	XAxisEndValue	XAxisRemove
XAxisAlign	XAxisExponentialFormat	XAxisRename / YAxisRename

XAxisAutoPrecisions	XAxisIndex / YAxisIndex	XAxisRepos
XAxisAutoRange	XAxisInTrendColor	XAxisScalingType
XAxisBeginValue	XAxisLabel	XAxisTrendWindow
XAxisColor	XAxisName	XAxisVisible
XAxisCount / YAxisCount	XAxisPrecisions	

## Examples

A trend is displayed in a WinCC FunctionTrendControl that is linked with a user archive. Different properties are configured for the trend in the script. The "StartID" of the user archive and the number of measurement points is changed regarding data connection.

### Requirement

- A "WinCC FunctionTrendControl" with the name "Control1" is inserted in a process picture in Graphics Designer.
- A button is inserted in the Graphics Designer. You have configured the event "mouse click" with a VBS action and the following script for the button.
- You have already configured a user archive in your project. Or you are using the demo project from which we have taken the user archive for the example.

```
'VBS363
Sub OnClick(ByVal Item)
Dim objFXControl
Dim objTrendWindow
Dim objTrend
Dim objXAxis
Dim objYAxis
Dim startID
Dim FXServerDataX(3)
Dim FXServerDataY(3)
' create reference to FXControl
Set objFXControl = ScreenItems("Controll")
' create reference to new window, x and y axis
Set objTrendWindow = objFXControl.GetTrendWindowCollection.AddItem("myWindow")
Set objXAxis = objFXControl.GetXAxisCollection.AddItem("myXAxis")
Set objYAxis = objFXControl.GetYAxisCollection.AddItem("myYAxis")
' assign x and y axis to the window
objXAxis.TrendWindow = objTrendWindow.Name
objYAxis.TrendWindow = objTrendWindow.Name
' add new trend
Set objTrend = objFXControl.GetTrendCollection.AddItem("myTrend1")
' configure trend data connection (UserArchive)
objTrend.Provider = 3
startID = CLng(4)
FXServerDataX(0) = "Setpoint"
FXServerDataX(1) = "ParabelX"
FXServerDataX(3) = startID
FXServerDataY(0) = "Setpoint"
FXServerDataY(1) = "ParabelY"
FXServerDataY(3) = startID
objTrend.MeasurePoints = 50
objTrend.SetTagName "Setpoint\ParabelX", "Setpoint\ParabelY", FXServerDataX, FXServerDataY
' assign trend properties
objTrend.Color = RGB(255,0,0)
objTrend.PointStyle = 1
objTrend.TrendWindow = objTrendWindow.Name
objTrend.XAxis = objXAxis.Name
objTrend.YAxis = objYAxis.Name
End Sub
```

---

**Note**

More examples for use of properties and methods are available in the descriptions of the Get methods of the controls and under "Examples for VBScript/Examples in WinCC/Dynamizing controls".

---

**See also**


[Controls \(Page 218\)](#)

[ServerDataX \(Page 569\)](#)

[ServerDataY \(Page 570\)](#)

## WinCC Gauge Control

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC Gauge Control"

### Type Identifier in VBS

HMI Gauge

### Usage

In the following example, the object with the name "Control1" is moved 14 pixels to the right:

```
'VBS58  
Dim objControl  
Set objControl = ScreenItems("Control1")  
objControl.Left = objControl.Left +14
```

### See also


- [WarningColor Property \(Page 697\)](#)
- [Object Property \(Page 512\)](#)
- [BackColor Property \(Page 322\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Object types of the ScreenItem object \(Page 143\)](#)
- [Width Property \(Page 698\)](#)
- [Warning Property \(Page 697\)](#)
- [Visible Property \(Page 696\)](#)

ValueMin Property (Page 695)  
ValueMax Property (Page 695)  
ValueColumnAlignment Property (Page 688)  
UnitText Property (Page 672)  
UnitOffset Property (Page 672)  
UnitFont Property (Page 671)  
UnitColor Property (Page 671)  
Type Property (Page 666)  
Top Property (Page 643)  
TicWidth Property (Page 601)  
TicTextOffset Property (Page 600)  
TicTextColor Property (Page 600)  
TicOffset Property (Page 600)  
TicFont Property (Page 599)  
TicColor Property (Page 599)  
ShowWarning Property (Page 579)  
ShowPeak Property (Page 574)  
ShowNormal Property (Page 573)  
ShowDecimalPoint Property (Page 573)  
ShowDanger Property (Page 573)  
Rectangular Property (Page 549)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
NormalColor Property (Page 510)  
NeedleColor Property (Page 510)  
LocaleID Property (Page 482)  
Left Property (Page 476)  
Layer Object (Page 120)  
Height Property (Page 443)  
FrameScale Property (Page 437)  
FramePicture Property (Page 437)  
FrameColor Property (Page 436)  
Enabled Property (Page 408)  
Delta Property (Page 402)  
DangerColor Property (Page 397)

- CenterScale Property (Page 366)
- CenterColor Property (Page 366)
- CaptionOffset Property (Page 364)
- CaptionFont Property (Page 363)
- Caption Property (Page 362)
- CaptionColor Property (Page 363)
- BorderWidth Property (Page 355)
- BevelWidth Property (Page 346)
- BevelOuter Property (Page 345)
- BevelInner Property (Page 345)
- BackStyle Property (Page 325)
- BackgroundPicture Property (Page 324)
- AngleMin Property (Page 313)
- AngleMax Property (Page 312)

## WinCC Media Control

### Description



Object Type of ScreenItem Object. Represents the "WinCC Media Control" graphic object as of WinCC V7.0.

Object Type of ScreenItem Object. Represents the "WinCC Media Control" graphic object as of WinCC V7.0.

### Type Identifier in VBS

HMIMediaControl




## Usage

In the following example, the object with the name "Control1" is moved 16 pixels to the right:

```
'VBS60
Dim objControl
Set objControl = ScreenItems("Control1")
objControl.Left = objControl.Left + 16
```

## WinCC OnlineTableControl

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC OnlineTableControl" as of WinCC V7.0.

### Type Identifier in VBS

HMIOnlineTableControl

### Available list objects

Row (Page 225)	ToolbarButton (Page 232)
StatusbarElement (Page 229)	ValueColumn (Page 236)
TimeColumn (Page 231)	

### Methods Available in VBS

Activate	ActivateDynamic	AttachDB
CalculateStatistic	CopyRows	

DeactivateDynamic	DetachDB	
-------------------	----------	--

Edit	Export	
------	--------	--

GetRow (Page 731)	GetStatusBarElement	GetToolBarButton
GetRowCollection (Page 732)	GetStatusBarElementCollection	GetToolBarButtonCollection
GetSelectedRow (Page 738)	GetTimeColumn	GetValueColumn
GetSelectedRows (Page 739)	GetTimeColumnCollection	GetValueColumnCollection

MoveToFirst	MoveToNext	MoveToPrevious
MoveToLast		

NextColumn		
------------	--	--

PreviousColumn	Print	
----------------	-------	--

SelectedStatisticArea	ShowPropertyDialog	ShowTimeSelection
ShowColumnSelection	ShowTagSelection	StartStopUpdate
ShowHelp		

### Properties Available in VBS

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "timecolobj.TimeColumnName", the listing name "TimeColumn" is dropped: "timecolobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

AutoCompleteColumns	AutoSelectionColors	AutoSelectionRectColor
AutoCompleteRows		

BackColor	BorderColor	BorderWidth
-----------	-------------	-------------

Caption	CellSpaceRight	ColumnScrollbar
CellCut	CellSpaceTop	ColumnTitleAlign
CellSpaceBottom	Closeable	ColumnTitles
CellSpaceLeft	ColumnResize	

EnableEdit	ExportFilename	ExportParameters
ExportDirectoryChangeable	ExportFilenameChangeable	ExportSelection
ExportDirectoryname	ExportFormatGuid	ExportShowDialog
ExportFileExtension	ExportFormatName	ExportXML

Font		
------	--	--

GridLineColor	GridLineWidth	
---------------	---------------	--

HorizontalGridLines		
---------------------	--	--

IconSpace		
-----------	--	--

LineColor	LineWidth	LoadDataImmediately
-----------	-----------	---------------------

Moveable		
----------	--	--

Online		
--------	--	--

PrintJobName		
--------------	--	--

RowCellCount (Page 364)	RowScrollbar	RTPersistence
RowCellText (Page 366)	RowTitleAlign	RTPersistencePasswordLevel
RowCount (Page 394)	RowTitles	RTPersistenceType
RowNumber (Page 553)		

1.14 VBS Reference

SelectedCellColor	SelectionColoring	ShowSortIcon
SelectedCellForeColor	SelectionRect	ShowSortIndex
SelectedRowColor	SelectionRectColor	ShowTitle
SelectedRowForeColor	SelectionRectWidth	Sizeable
SelectedTitleColor	SelectionType	SkinName
SelectedTitleForeColor	ShowSortButton	SortSequence

StatusbarBackColor	StatusbarElementName	StatusbarElementVisible
StatusbarElementAdd	StatusbarElementRemove	StatusbarElementWidth
StatusbarElementAutoSize	StatusbarElementRename	StatusbarFontColor
StatusbarElementCount	StatusbarElementRepos	StatusbarShowTooltips
StatusbarElementIconId	StatusbarElementText	StatusbarText
StatusbarElementId	StatusbarElementTooltipText	StatusbarUseBackColor
StatusbarElementIndex	StatusbarElementUserDefined	StatusbarVisible

TableColor	TableForeColor	TimeBase
TableColor2	TableForeColor2	

TimeColumnActualize	TimeColumnHideText	TimeColumnShowDate
TimeColumnAdd	TimeColumnHideTitleText	TimeColumnShowIcon
TimeColumnAlign	TimeColumnIndex	TimeColumnShowTitleIcon
TimeColumnBackColor	TimeColumnLength	TimeColumnSort
TimeColumnBeginTime	TimeColumnMeasurePoints	TimeColumnSortIndex
TimeColumnCaption	TimeColumnName	TimeColumnTimeFormat
TimeColumnCount	TimeColumnRangeType	TimeColumnTimeRangeBase
TimeColumnDateFormat	TimeColumnRemove	TimeColumnTimeRangeFactor
TimeColumnEndTime	TimeColumnRename	TimeColumnUseValueColumnColors
TimeColumnForeColor	TimeColumnRepos	TimeColumnVisible

TimeStepBase	TitleDarkShadowColor	TitleLightShadowColor
TimeStepFactor	TitleForeColor	TitleSort
TitleColor	TitleGridLineColor	TitleStyle
TitleCut		

ToolbarAlignment	ToolbarButtonHotKey	ToolbarButtonRepos
ToolbarBackColor	ToolbarButtonId	ToolbarButtonTooltipText
ToolbarButtonActive	ToolbarButtonIndex	ToolbarButtonUserDefined

ToolBarButtonAdd	ToolBarButtonLocked	ToolBarButtonVisible
ToolBarButtonBeginGroup	ToolBarButtonName	ToolBarShowTooltips
ToolBarButtonClick	ToolBarButtonPasswordLevel	ToolBarUseBackColor
ToolBarButtonCount	ToolBarButtonRemove	ToolBarUseHotKeys
ToolBarButtonEnabled	ToolBarButtonRename	ToolBarVisible

UseColumnBackColor	UseSelectedTitleColor	UseTableColor2
UseColumnForeColor		

ValueColumnAdd	ValueColumnIndex	ValueColumnShowIcon
ValueColumnAlign	ValueColumnLength	ValueColumnShowTitleIcon
ValueColumnAutoPrecisions	ValueColumnName	ValueColumnSort
ValueColumnBackColor	ValueColumnPrecisions	ValueColumnSortIndex
ValueColumnCaption	ValueColumnProvider	ValueColumnState
ValueColumnCount	ValueColumnProviderCLSID	ValueColumnTagName
ValueColumnExponentialFormat	ValueColumnRemove	ValueColumnTimeColumn
ValueColumnForeColor	ValueColumnRename	ValueColumnVisible
ValueColumnHideText	ValueColumnRepos	VerticalGridLines
ValueColumnHideTitleText	ValueColumnSelectTagName	

## Example

An additional column is added in an existing WinCC OnlineTableControl that is linked with an archive tag. Different properties are configured for the control and the column in the script.

### Requirement

- A "WinCC OnlineTableControl" with the name "Control1" has already been inserted in a process picture in Graphics Designer. The control consists of a time column and three value columns. The picture "B\_025\_V7\_Arch\_TableControl.PDL" from the demo project was used for this example.
- A button is inserted in the Graphics Designer. You have configured the event "mouse click" with a VBS action and the following script for the button.
- You have already configured archives and archive tags in your project. Or you are using the demo project from which we have taken the archive for the example.

1.14 VBS Reference

```
`VBS362
Sub OnClick(ByVal Item)
Dim objControl
Dim objTimeColumn
Dim objValueCollection
Set objControl = ScreenItems("Controll1")
' Control wide specification
objControl.ColumnResize = False
objControl.TimeBase = 1
objControl.TimeColumnTimeFormat = "HH:mm:ss tt"
objControl.TimeColumnLength = 20
' properties for Time column
Set objTimeColumn = objControl.GetTimeColumn("Time column 1")
objTimeColumn.DateFormat = "dd/MM/yy"
' properties for a new 4th value column with connection to archive tag "Trend_4"
Set objValueCollection = objControl.GetValueColumnCollection.AddItem("Trend 4")
objValueCollection.Caption = "Trend 4"
objValueCollection.Length = 10
objValueCollection.Align = 1
objValueCollection.Provider = 1
objValueCollection.TagName = "G_Archive\Trend_4"
objValueCollection.TimeColumn = "Time column 1"
End Sub
```

---

**Note**

More examples for use of properties and methods are available in the descriptions of the Get methods of the controls and under "Examples for VBScript/Examples in WinCC/Dynamizing controls".


---

**See also**

Controls (Page 218)

**WinCC OnlineTrendControl**

**Description**



Object Type of ScreenItem Object. Represents the graphic object "WinCC OnlineTrendControl" as of WinCC V7.0.

## Type Identifier in VBS

HMIOnlineTrendControl

## Available list objects

StatusbarElement (Page 229)	ToolbarButton (Page 232)	TrendWindow (Page 234)
TimeAxis (Page 230)	Trend (Page 233)	ValueAxis (Page 235)

## Methods Available in VBS

Activate	ActivateDynamic-Methode	AttachDB-Methode
----------	-------------------------	------------------

CalculateStatistic		
--------------------	--	--

DeactivateDynamic	DetachDB	
-------------------	----------	--

Export		
--------	--	--

GetStatusbarElement	GetToolbarButton (Page 752)	GetTrendWindow
GetStatusbarElementCollection	GetToolbarButtonCollection (Page 753)	GetTrendWindowCollection
GetTimeAxis	GetTrend	GetValueAxis
GetTimeAxisCollection	GetTrendCollection	GetValueAxisCollection

MoveAxis	MoveToLast	MoveToPrevious
MoveToFirst	MoveToNext	

NextTrend		
-----------	--	--

OneToOneView		
--------------	--	--

PreviousTrend	Print	
---------------	-------	--

ShowHelp	ShowTagSelection	StartStopUpdate
ShowPercentageAxis	ShowTimeSelection	
ShowPropertyDialog	ShowTrendSelection	

ZoomArea	ZoomInOutTime	ZoomMove
ZoomInOut	ZoomInOutValues	

### Properties Available in VBS

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "trendobj.Trendname", the listing name "Trend" is dropped: "trendobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

BackColor	BorderColor	BorderWidth
-----------	-------------	-------------

Caption	Closeable	ConnectTrendWindows
---------	-----------	---------------------

ExportDirectoryChangeable	ExportFilenameChangeable	ExportSelection
ExportDirectoryname	ExportFormatGuid	ExportShowDialog
ExportFileExtension	ExportFormatName	ExportXML
ExportFilename	ExportParameters	

Font		
------	--	--

GraphDirection		
----------------	--	--

LineColor	LineWidth	LoadDataImmediately
-----------	-----------	---------------------

Moveable		
----------	--	--

Online		
--------	--	--



PercentageAxis	PercentageAxisColor	PrintJobName
PercentageAxisAlign		

RTPersistence	RTPersistencePasswordLevel	RTPersistenceType
---------------	----------------------------	-------------------

ShowRuler	ShowStatisticRuler	Sizeable
ShowRulerInAxis	ShowTitle	SkinName
ShowScrollbars	ShowTrendIcon	

StatusbarBackColor	StatusbarElementName	StatusbarElementVisible
StatusbarElementAdd	StatusbarElementRemove	StatusbarElementWidth
StatusbarElementAutoSize	StatusbarElementRename	StatusbarFontColor
StatusbarElementCount	StatusbarElementRepos	StatusbarShowTooltips
StatusbarElementIconId	StatusbarElementText	StatusbarText
StatusbarElementId	StatusbarElementTooltipText	StatusbarUseBackColor
StatusbarElementIndex	StatusbarElementUserDefined	StatusbarVisible

TimeAxisActualize	TimeAxisIndex	TimeAxisRepos
TimeAxisAdd	TimeAxisInTrendColor	TimeAxisShowDate
TimeAxisAlign	TimeAxisLabel	TimeAxisTimeFormat
TimeAxisBeginTime	TimeAxisMeasurePoints	TimeAxisTimeRangeBase
TimeAxisColor	TimeAxisName	TimeAxisTimeRangeFactor
TimeAxisCount	TimeAxisRangeType	TimeAxisTrendWindow
TimeAxisDateFormat	TimeAxisRemove	TimeAxisVisible
TimeAxisEndTime	TimeAxisRename	TimeBase

ToolBarAlignment	ToolBarButtonHotKey	ToolBarButtonRepos
ToolBarBackColor	ToolBarButtonId	ToolBarButtonTooltipText
ToolBarButtonActive	ToolBarButtonIndex	ToolBarButtonUserDefined
ToolBarButtonAdd	ToolBarButtonLocked	ToolBarButtonVisible
ToolBarButtonBeginGroup	ToolBarButtonName	ToolBarShowTooltips
ToolBarButtonClick	ToolBarButtonPasswordLevel	ToolBarUseBackColor
ToolBarButtonCount	ToolBarButtonRemove	ToolBarUseHotKeys
ToolBarButtonEnabled	ToolBarButtonRename	ToolBarVisible

1.14 VBS Reference

TrendAdd	TrendLineType	TrendSelectTagName
TrendAutoRangeBeginTagName	TrendLineWidth	TrendTagName
TrendAutoRangeBeginValue	TrendLowerLimit	TrendTimeAxis
TrendAutoRangeEndTagName	TrendLowerLimitColor	TrendTrendWindow
TrendAutoRangeEndValue	TrendLowerLimitColoring	TrendUncertainColor
TrendAutoRangeSource	TrendName	TrendUncertainColoring
TrendColor	TrendPointColor	TrendUpperLimit
TrendCount	TrendPointStyle	TrendUpperLimitColor
TrendExtendedColorSet	TrendPointWidth	TrendUpperLimitColoring
TrendFill	TrendProvider	TrendValueAlignment
TrendFillColor	TrendProviderCLSID	TrendValueAxis
TrendIndex	TrendRemove	TrendValueUnit
TrendLabel	TrendRename	TrendVisible
TrendLineStyle	TrendRepos	

TrendWindowAdd	TrendWindowHorizontalGrid	TrendWindowRulerStyle
TrendWindowCoarseGrid	TrendWindowIndex	TrendWindowRulerWidth
TrendWindowCoarseGridColor	TrendWindowName	TrendWindowSpacePortion
TrendWindowCount	TrendWindowRemove	TrendWindowStatisticRulerColor
TrendWindowFineGrid	TrendWindowRename	TrendWindowStatisticRulerStyle
TrendWindowFineGridColor	TrendWindowRepos	TrendWindowStatisticRulerWidth
TrendWindowForegroundTrendGrid	TrendWindowRulerColor	TrendWindowVerticalGrid
TrendWindowGridInTrendColor	TrendWindowRulerLayer	TrendWindowVisible

UseTrendNameAsLabel		
---------------------	--	--

ValueAxisAdd	ValueAxisEndValue	ValueAxisRemove
ValueAxisAlign	ValueAxisExponentialFormat	ValueAxisRename
ValueAxisAutoPrecisions	ValueAxisIndex	ValueAxisRepos
ValueAxisAutoRange	ValueAxisInTrendColor	ValueAxisScalingType
ValueAxisBeginValue	ValueAxisLabel	ValueAxisTrendWindow
ValueAxisColor	ValueAxisName	ValueAxisVisible
ValueAxisCount	ValueAxisPrecisions	

**Example**

Three trends are displayed in a WinCC OnlineTrendControl that are linked with archive tags. Different properties are configured for the trends in the script.

**Requirement**

- A "WinCC OnlineTrendControl" with the name "Control1" is inserted in a process picture in Graphics Designer.
- A button is inserted in the Graphics Designer. You have configured the event "mouse click" with a VBS action and the following script for the button.
- You have already configured archives and archive tags in your project. Or you are using the demo project from which we have taken the archives for the example.

```
'VBS361
Sub OnClick(ByVal Item)
Dim objTrendControl
Dim objTrendWindow
Dim objTimeAxis
Dim objValueAxis
Dim objTrend
'create reference to TrendControl
Set objTrendControl = ScreenItems("Control1")
'create reference to new window, time and value axis
Set objTrendWindow = objTrendControl.GetTrendWindowCollection.AddItem("myWindow")
Set objTimeAxis = objTrendControl.GetTimeAxisCollection.AddItem("myTimeAxis")
Set objValueAxis = objTrendControl.GetValueAxisCollection.AddItem("myValueAxis")
'assign time and value axis to the window
objTimeAxis.TrendWindow = objTrendWindow.Name
objValueAxis.TrendWindow = objTrendWindow.Name
' assign properties to trendwindow
objTrendWindow.HorizontalGrid = False
' add new trend and assign properties
Set objTrend = objTrendControl.GetTrendCollection.AddItem("myTrend1")
objTrend.Provider = 1
objTrend.TagName = "G_Archive\Trend_1"
objTrend.TrendWindow = objTrendWindow.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValueAxis.Name
objTrend.Color = RGB(255,0,0)
objTrend.PointStyle = 0
'add new trend and assign properties
Set objTrend = objTrendControl.GetTrendCollection.AddItem("myTrend2")
objTrend.Provider = 1
objTrend.TagName = "G_Archive\Trend_2"
objTrend.TrendWindow = objTrendWindow.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValueAxis.Name
objTrend.Color = RGB(0,255,0)
objTrend.LineWidth = 3
'add new trend and assign properties
Set objTrend = objTrendControl.GetTrendCollection.AddItem("myTrend3")
objTrend.Provider = 1
objTrend.TagName = "G_Archive\Trend_3"
objTrend.TrendWindow = objTrendWindow.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValueAxis.Name
objTrend.Color = RGB(0,0,255)
objTrend.LineType = 2
End Sub
```

---


**Note**

More examples for use of properties and methods are available in the descriptions of the Get methods of the controls and under "Examples for VBScript/Examples in WinCC/Dynamizing controls".

---

**See also**

Controls (Page 218)

**WinCC Push Button Control****Description**

Object Type of ScreenItem Object. Represents the graphic object "WinCC Push Button Control"

**Type Identifier in VBS**

HMIButton

**Usage**

In the following example, the object with the name "Control1" is moved 17 pixels to the right:

```
'VBS61
Dim objControl
Set objControl = ScreenItems("Control1")
objControl.Left = objControl.Left +17
```

---

**Note**

The events KeyDown, KeyUp and KeyPress cannot be addressed by VBS. If it is required to make controls dynamic with the help of VBS, no parameter must be declared with ByRef.

---

## Notes on Error Handling

Buttons and pushbuttons are mapped in the object model to an "HMIButton" type. Since the objects have different properties, the availability of the property (dynamic type compilation in Runtime) should be queried via an exception measure. The exception measure is activated for the corresponding procedure by the following instruction:

```
On Error Resume Next
```

The instruction causes the VBScript engine to initiate the follow-on command in the case of a Runtime error.

The error code can subsequently be checked using the Err object. In order to deactivate the handling of Runtime errors in scripts, use the following command:

```
On Error Goto 0
```

Handling errors always relates to the procedure layer. If a script in a procedure causes an error, VBScript checks whether an error handling measure is implemented in this layer. If not, control is transferred one layer up (to the calling procedure). If there is no error handling measure here either, the control is transferred yet another layer up. This continues until either the top module level is reached or the code for Runtime error handling is located. If the activation of the Runtime error handling fails, the control is transferred to the top level on the internal VBScript Runtime error handling. This opens an error dialog and stops the script.

The "On Error Resume Next" command can be installed on all layers (i.e. also in procedures). When the error handling measure is use, it can basically be determined whether the user is actually using the required implementation type.

In addition, it can be ensured that there is no termination of execution due to a faulty access to the object.

## Examples of error handling

```
'VBS62
Dim objScreenItem
On Error Resume Next      'Activation of errorhandling
For Each objScreenItem In ScreenItems
If objScreenItem.Type = "HMIButton" Then
'
'=== Property "Text" available only for Standard-Button
objScreenItem.Text = "Windows"
If 0 <> Err.Number Then
HMIRuntime.Trace objScreenItem.ObjectName & ": no Windows-Button" & vbCrLf
Err.Clear      'Delete error message
End If
'
'=== Property "Caption" available only for PushButton
objScreenItem.Caption = "Push"
If 0 <> Err.Number Then
HMIRuntime.Trace objScreenItem.ObjectName & ": no Control" & vbCrLf
Err.Clear
End If
End If
Next
On Error Goto 0      'Deactivation of errorhandling
```


## See also

- [Properties \(Page 301\)](#)
- [FontName Property \(Page 433\)](#)
- [Activate Method \(Page 712\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Controls \(Page 218\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Transparent Property \(Page 644\)](#)
- [Top Property \(Page 643\)](#)
- [PictureUnselected Property \(Page 539\)](#)
- [PictureSelected Property \(Page 538\)](#)
- [Parent Property \(Page 529\)](#)
- [Outline Property \(Page 527\)](#)
- [ObjectName Property \(Page 512\)](#)

- Object Property (Page 512)
- Left Property (Page 476)
- Layer Object (Page 120)
- Height Property (Page 443)
- FrameWidth Property (Page 438)
- FrameColorUp Property (Page 437)
- FrameColorDown Property (Page 436)
- ForeColor Property (Page 435)
- FontUnderline Property (Page 434)
- FontStrikeThru Property (Page 434)
- FontSize Property (Page 433)
- FontItalic Property (Page 432)
- Font property (before WinCC V7) (Page 431)
- FontBold Property (Page 432)
- FocusRect Property (Page 430)
- Enabled Property (Page 408)
- Caption Property (Page 362)
- BackColor Property (Page 322)
- AutoSize Property (Page 319)

## WinCC RulerControl

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC RulerControl" as of WinCC V7.0.

### Type Identifier in VBS

HMIRulerControl



**Available list objects**

Row (Page 225)	StatisticResultColumn (Page 229)
RulerBlock (Page 226)	StatusbarElement (Page 229)
RulerColumn (Page 227)	ToolbarButton (Page 232)
StatisticAreaColumn (Page 228)	

**Methods Available in VBS**

Activate	ActivateDynamic	
----------	-----------------	--

DeactivateDynamic		
-------------------	--	--

Export		
--------	--	--

GetRow (Page 731)	GetSelectedRow (Page 738)	GetStatusBarElement
GetRowCollection (Page 732)	GetSelectedRows (Page 739)	GetStatusBarElementCollection
GetRulerBlock	GetStatisticAreaColumn	GetToolbarButton
GetRulerBlockCollection	GetStatisticAreaColumnCollection	GetToolbarButtonCollection
GetRulerColumn	GetStatisticResultColumn	
GetRulerColumnCollection	GetStatisticResultColumnCollection	

ShowHelp	ShowPropertyDialog	
----------	--------------------	--

**Properties Available in VBS**

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "rulercolobj.ColumnName", the listing name "Column" is dropped: "rulercolobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

AutoCompleteColumns	AutoPositon	AutoSelectionRectColor
AutoCompleteRows	AutoSelectionColors	AutoShow

BackColor	BlockHideText	BlockShowDate
BlockAlign	BlockHideTitleText	BlockShowIcon
BlockAutoPrecisions	BlockID	BlockShowTitleIcon
BlockCaption	BlockIndex	BlockTimeFormat

1.14 VBS Reference

BlockCount	BlockLength	BlockUseSourceFormat
BlockDateFormat	BlockName	BorderColor
BlockExponentialFormat	BlockPrecisions	BorderWidth

Caption	ColumnAdd	ColumnScrollbar
CellCut	ColumnCount	ColumnSort
CellSpaceBottom	ColumnIndex	ColumnSortIndex
CellSpaceLeft	ColumnName	ColumnTitleAlign
CellSpaceRight	ColumnRemove	ColumnTitles
CellSpaceTop	ColumnRepos	ColumnVisible
Closeable	ColumnResize	

ExportDirectoryChangeable	ExportFilenameChangeable	ExportSelection
ExportDirectoryname	ExportFormatGuid	ExportShowDialog
ExportFileExtension	ExportFormatName	ExportXML
ExportFilename	ExportParameters	

Font		
------	--	--

GridLineColor	GridLineWidth	
---------------	---------------	--

HorizontalGridLines		
---------------------	--	--

IconSpace		
-----------	--	--

LineColor	LineWidth	
-----------	-----------	--

Moveable		
----------	--	--

PrintJobName		
--------------	--	--

RowCellCount (Page 364)	RowScrollbar	RTPersistencePasswordLevel
RowCellText (Page 366)	RowTitleAlign	RTPersistenceType

RowCount (Page 394)	RowTitles	RulerType
RowNumber (Page 553)	RTPersistence	

SelectedCellColor	SelectionRect	ShowSortIndex
SelectedCellForeColor	SelectionRectColor	ShowTitle
SelectedRowColor	SelectionRectWidth	Sizeable
SelectedRowForeColor	SelectionType	SkinName
SelectedTitleColor	ShareSpaceWithSourceControl	SortSequence
SelectedTitleForeColor	ShowSortButton	SourceControl
SelectionColoring	ShowSortIcon	SourceControlType

StatusbarBackColor	StatusbarElementName	StatusbarElementVisible
StatusbarElementAdd	StatusbarElementRemove	StatusbarElementWidth
StatusbarElementAutoSize	StatusbarElementRename	StatusbarFontColor
StatusbarElementCount	StatusbarElementRepos	StatusbarShowTooltips
StatusbarElementIconId	StatusbarElementText	StatusbarText
StatusbarElementId	StatusbarElementTooltipText	StatusbarUseBackColor
StatusbarElementIndex	StatusbarElementUserDefined	StatusbarVisible

TableColor	TitleColor	TitleGridLineColor
TableColor2	TitleCut	TitleLightShadowColor
TableForeColor	TitleDarkShadowColor	TitleSort
TableForeColor2	TitleForeColor	TitleStyle

ToolbarAlignment	ToolbarButtonHotKey	ToolbarButtonRepos
ToolbarBackColor	ToolbarButtonId	ToolbarButtonTooltipText
ToolbarButtonActive	ToolbarButtonIndex	ToolbarButtonUserDefined
ToolbarButtonAdd	ToolbarButtonLocked	ToolbarButtonVisible
ToolbarButtonBeginGroup	ToolbarButtonName	ToolbarShowTooltips
ToolbarButtonClick	ToolbarButtonPasswordLevel	ToolbarUseBackColor
ToolbarButtonCount	ToolbarButtonRemove	ToolbarUseHotKeys
ToolbarButtonEnabled	ToolbarButtonRename	ToolbarVisible

UseSelectedTitleColor	UseSourceForeColors	UseTableColor2
UseSourceBackColors		

VerticalGridLines		
-------------------	--	--

## Example

A WinCC Ruler Control is inserted in a picture with an existing WinCC OnlineTableControl. The RulerControl contains a statistics window that displays the "Minimum", "Maximum" and "Average" columns. The static values are then displayed for the selected rows of the OnlineTableControl.

### Requirement

- A "WinCC OnlineTableControl" with the name "Control1" has already been inserted in a process picture in Graphics Designer. The control is linked with archive tags or process tags. The picture "B\_025\_V7\_Arch\_TableControl.PDL" from the demo project was used for this example.
- You have added an additional "WinCC RulerControl" with the name "Control2" in the picture.
- A button is inserted in the Graphics Designer. You have configured the event "mouse click" with a VBS action and the following script for the button.
- You have selected some rows in OnlineTableControl.

```
'VBS364
Sub OnClick(ByVal Item)
Dim objRulerControl
Dim objTableControl
Dim objstatColumn
Dim rows

Set objRulerControl = ScreenItems("Control2")
' Use Statistic-window
objRulerControl.RulerType = 2
objRulerControl.SourceControl = "Control1"
' In Statistic-window only columns "Name", "MinValue", MaxValue" and "Average" are shown
Set objstatColumn = objRulerControl.GetStatisticResultColumnCollection
objstatColumn.RemoveItem(4)
objstatColumn.RemoveItem(5)
objstatColumn.RemoveItem(6)
' Get the selected rows of tablecontrol and calculate statistic
Set objTrendControl = ScreenItems("Control1")
Set rows = objTableControl.SelectAll
objTableControl.CalculateStatistic
End Sub
```

---

### Note

More examples for use of properties and methods are available in the descriptions of the Get methods of the controls and under "Examples for VBScript/Examples in WinCC/Dynamizing controls".


---

## See also

Controls (Page 218)

## WinCC Slider Control

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC Slider Control"

### Type Identifier in VBS

HMIISlider

### Usage

In the following example, the object with the name "Control1" is moved 19 pixels to the right:

```
'VBS63
Dim objControl
Set objControl = ScreenItems("Control1")
objControl.Left = objControl.Left + 19
```

### Notes on Error Handling

Sliders and WinCC slider controls are mapped in the object model to an "HMIISlider" type. Since the objects have different properties, the availability of the property (dynamic type compilation in Runtime) should be queried via an exception measure. The exception measure is activated for the corresponding procedure by the following instruction:

```
On Error Resume Next
```

The instruction causes the VBScript engine to initiate the follow-on command in the case of a Runtime error.

The error code can subsequently be checked using the Err object. In order to deactivate the handling of Runtime errors in scripts, use the following command:

```
On Error Goto 0
```

Handling errors always relates to the procedure layer. If a script in a procedure causes an error, VBScript checks whether an error handling measure is implemented in this layer. If not, control is transferred one layer up (to the calling procedure). If there is no error handling measure here either, the control is transferred yet another layer up. This continues until either the top module level is reached or the code for Runtime error handling is located. If the activation of the Runtime error handling fails, the control is transferred to the top level on the internal VBScript Runtime error handling. This opens an error dialog and stops the script.

The "On Error Resume Next" command can be installed on all layers (i.e. also in procedures). When the error handling measure is use, it can basically be determined whether the user is actually using the required implementation type.

In addition, it can be ensured that there is no termination of execution due to a faulty access to the object.

## Examples of error handling

```
Sub OnClick(Byval Item)
'VBS193
Dim ScreenItem
' activating error handling:
On Error Resume Next
For Each ScreenItem In ScreenItems
If ScreenItem.Type = "HMISlider" Then
'=== Property "BevelColorUp" only exists for a WinCC Slider Control
ScreenItem.BevelColorUp = 1
If (Err.Number <> 0) Then
HMIRuntime.Trace(ScreenItem.ObjectName + ": no Windows-Slider" + vbCrlf)
' delete error message
Err.Clear
End If
'=== Property "BorderStyle" only exists for a Windows-Slider
ScreenItem.BorderStyle = 1
If (Err.Number <> 0) Then
HMIRuntime.Trace(ScreenItem.ObjectName + ": no WinCC Slider Control" + vbCrlf)
Err.Clear
End If
End If
Next
On Error GoTo 0 ' deactivating error handling
End Sub
```

## See also

[PictureThumb Property \(Page 538\)](#)

[BarFillColor Property \(Page 329\)](#)

[Activate Method \(Page 712\)](#)


[Properties \(Page 301\)](#)

ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
Controls (Page 218)  
WithLabels Property (Page 701)  
WithAxes Property (Page 701)  
Width Property (Page 698)  
Visible Property (Page 696)  
Type Property (Page 666)  
Top Property (Page 643)  
TickStyle Property (Page 602)  
ThumbBackColor Property (Page 599)  
ShowThumb Property (Page 577)  
ShowPosition Property (Page 574)  
ShowBar Property (Page 572)  
RangeMin Property (Page 548)  
RangeMax Property (Page 548)  
Position Property (Page 541)  
PictureBack Property (Page 536)  
Parent Property (Page 529)  
OuterBevelWidth Property (Page 527)  
OuterBevelStyle Property (Page 526)  
ObjectName Property (Page 512)  
Object Property (Page 512)  
LocaleID Property (Page 482)  
Left Property (Page 476)  
Layer Object (Page 120)  
LabelColor Property (Page 457)  
InnerBevelWidth Property (Page 453)  
InnerBevelStyle Property (Page 453)  
InnerBevelOffset Property (Page 453)  
Height Property (Page 443)  
ForeColor Property (Page 435)  
FontPosition Property (Page 433)  
Font property (before WinCC V7) (Page 431)  
FocusWidth Property (Page 430)

- FocusColor Property (Page 430)
- Enabled Property (Page 408)
- ContinousChange Property (Page 393)
- Caption Property (Page 362)
- BevelColorUp Property (Page 345)
- BevelColorDown Property (Page 344)
- BarBackColor Property (Page 326)
- BackStyle Property (Page 325)
- BackColor Property (Page 322)

## WinCC UserArchiveControl

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC UserArchiveControl" as of WinCC V7.0.

### Type Identifier in VBS

HMIUserArchiveControl

### Available list objects

Column (Page 221)	StatusbarElement (Page 229)
Row (Page 225)	ToolbarButton (Page 232)

### Methods Available in VBS

Activate	ActivateDynamic	
----------	-----------------	--

CopyRows	CutRows	
----------	---------	--



DeactivateDynamic		
-------------------	--	--

Export		
--------	--	--

GetColumn	GetSelectedRow (Page 738)	GetToolBarButton
GetColumnCollection	GetSelectedRows (Page 739)	GetToolBarButtonCollection
GetRow (Page 731)	GetStatusBarElement	
GetRowCollection (Page 732)	GetStatusBarElementCollection	

MoveToFirst	MoveToNext	MoveToPrevious
MoveToLast		

PasteRows	Print	
-----------	-------	--

ReadTags		
----------	--	--

ServerExport	ShowPropertyDialog	ShowSelectTimeBase
ServerImport	ShowSelectArchive	ShowSort
ShowHelp	ShowSelection	

WriteTags		
-----------	--	--

## Properties Available in VBS

If you access the properties with the listing object, you do not have to enter the name of the listing. For example, when using "colobj.ColumnName", the listing name "Column" is dropped: "colobj.Name".

Note that properties are available for WinCC controls that can have the effect of methods. These properties are characterized by the respective names, e.g. "Add", "Remove" or "Rename".

ArchiveName	AutoCompleteColumns	AutoSelectionColors
ArchiveType	AutoCompleteRows	AutoSelectionRectColor

BackColor	BorderColor	BorderWidth
-----------	-------------	-------------

1.14 VBS Reference

Caption	CellSpaceLeft	CellSpaceTop
CellCut	CellSpaceRight	Closeable
CellSpaceBottom		

ColumnAlias	ColumnLeadingZeros	ColumnShowIcon
ColumnAlign	ColumnLength	ColumnShowTitleIcon
ColumnAutoPrecisions	ColumnMaxValue	ColumnSort
ColumnCaption	ColumnMinValue	ColumnSortIndex
ColumnCount	ColumnName	ColumnStartValue
ColumnDateFormat	ColumnPosition (Page 384)	ColumnStringLength
ColumnDMVarName	ColumnPrecisions	ColumnTimeFormat
ColumnExponentialFormat	ColumnReadAccess	ColumnTitleAlign
ColumnFlagNotNull	ColumnReadOnly	ColumnTitles
ColumnFlagUnique	ColumnRepos	ColumnType
ColumnHideText	ColumnResize	ColumnVisible
ColumnHideTitleText	ColumnScrollbar	ColumnWriteAccess
ColumnIndex	ColumnShowDate	

EnableDelete	ExportFileExtension	ExportParameters
EnableEdit	ExportFilename	ExportSelection
EnableInsert	ExportFilenameChangeable	ExportShowDialog
ExportDirectoryChangeable	ExportFormatGuid	ExportXML
ExportDirectoryname	ExportFormatName	

FilterSQL	Font	
-----------	------	--

GridLineColor	GridLineWidth	
---------------	---------------	--

HorizontalGridLines		
---------------------	--	--

IconSpace		
-----------	--	--

LineColor	LineWidth	
-----------	-----------	--

Moveable		
----------	--	--

PrintJobName		
--------------	--	--

RowCellCount (Page 364)	RowScrollbar	RTPersistence
RowCellText (Page 366)	RowTitleAlign	RTPersistencePasswordLevel
RowCount (Page 394)	RowTitles	RTPersistenceType
RowNumber (Page 553)		

SelectArchiveName	SelectionColoring	ShowSortIcon
SelectedCellColor	SelectionRect	ShowSortIndex
SelectedCellForeColor	SelectionRectColor	ShowTitle
SelectedRowColor	SelectionRectWidth	Sizeable
SelectedRowForeColor	SelectionType	SkinName
SelectedTitleColor	ShowSortButton	SortSequence
SelectedTitleForeColor		

StatusbarBackColor	StatusbarElementName	StatusbarElementVisible
StatusbarElementAdd	StatusbarElementRemove	StatusbarElementWidth
StatusbarElementAutoSize	StatusbarElementRename	StatusbarFontColor
StatusbarElementCount	StatusbarElementRepos	StatusbarShowTooltips
StatusbarElementIconId	StatusbarElementText	StatusbarText
StatusbarElementId	StatusbarElementTooltipText	StatusbarUseBackColor
StatusbarElementIndex	StatusbarElementUserDefined	StatusbarVisible

TableColor	TitleColor	TitleGridLineColor
TableColor2	TitleCut	TitleLightShadowColor
TableForeColor	TitleDarkShadowColor	TitleSort
TableForeColor2	TitleForeColor	TitleStyle
TimeBase		

ToolBarAlignment	ToolBarButtonHotKey	ToolBarButtonRepos
ToolBarBackColor	ToolBarButtonId	ToolBarButtonTooltipText
ToolBarButtonActive	ToolBarButtonIndex	ToolBarButtonUserDefined
ToolBarButtonAdd	ToolBarButtonLocked	ToolBarButtonVisible
ToolBarButtonBeginGroup	ToolBarButtonName	ToolBarShowTooltips

ToolBarButtonClick	ToolBarButtonPasswordLevel	ToolBarUseBackColor
ToolBarButtonCount	ToolBarButtonRemove	ToolBarUseHotKeys
ToolBarButtonEnabled	ToolBarButtonRename	ToolBarVisible

UseSelectedTitleColor	UseTableColor2	
-----------------------	----------------	--

VerticalGridLines		
-------------------	--	--

### Example

A user archive is displayed in a WinCC UserArchiveControl.

The following actions are initiated via script:

- Selecting data
- Exporting data
- Printing a table

#### Requirement

- A "WinCC UserArchiveControl" with the name "Control1" is inserted in a process picture in Graphics Designer.
- A button is inserted in the Graphics Designer. You have configured the event "mouse click" with a VBS action and the following script for the button.
- You have already configured a user archive in your project. Or you are using the demo project from which you can use a user archive.

```
VBS365
Sub OnClick(ByVal Item)
Dim objUAControl
Dim objColumn
Dim coll
Dim field
' create reference to UserArchivControl
Set objUAControl = ScreenItems("Control1")
' Select user archive and general column properties
objUAControl.SelectArchiveName = True
objUAControl.ColumnResize = False
objUAControl.ColumnTitleAlign = 1
' properties for ID column
Set objColumn = objUAControl.GetColumn("ID")
objColumn.Length = 2
objColumn.Align = 0
' Select data
objUAControl.FilterSQL = "ID >=3"
'export the content as a CSV-file in the "ua" directory of the project folder
objUAControl.ServerExport
' print the control
objUAControl.PrintJobName = "UserArchiveControl - Table"
objUAControl.Print
End Sub
```

---

**Note**

More examples for use of properties and methods are available in the descriptions of the Get methods of the controls and under "Examples for VBScript/Examples in WinCC/Dynamizing controls".

---


**See also**

Controls (Page 218)

## Controls before WinCC V7

### WinCC Alarm Control (before WinCC V7)

#### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC Alarm Control"

#### Type Identifier in VBS

HMIMessageView

#### Usage

In the following example, the object with the name "Control1" is moved 10 pixels to the right:

```
'VBS54  
Dim objControl  
Set objControl = ScreenItems("Control1")  
objControl.Left = objControl.Left + 10
```

#### See also


- [ProjectPath Property \(Page 545\)](#)
- [BackColor Property \(Page 322\)](#)
- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Controls \(Page 218\)](#)
- [WindowType Property \(Page 701\)](#)
- [Width Property \(Page 698\)](#)

Visible Property (Page 696)  
Type Property (Page 666)  
Top Property (Page 643)  
ToolBarButtons Property (Page 638)  
Titleline Property (Page 626)  
TitleCut property (before WinCC V7) (Page 625)  
StatusBarPanels Property (Page 592)  
ServerNames property (before WinCC V7) (Page 571)  
SelectionType property (before WinCC V7) (Page 568)  
SelectionRectWidth property (before WinCC V7) (Page 567)  
SelectionRectColor property (before WinCC V7) (Page 567)  
SelectionMode Property (Page 566)  
PersistentRTPermission Property (Page 533)  
PersistentRTCSPermission Property (Page 533)  
Parent Property (Page 529)  
ObjectName Property (Page 512)  
Object Property (Page 512)  
MsgFilterSQL property (before WinCC V7) (Page 508)  
MsgCtrlFlags Property (Page 508)  
LineTitle Property (Page 481)  
LineHeight Property (Page 480)  
LineFont Property (Page 480)  
Left Property (Page 476)  
Layer Object (Page 120)  
Height Property (Page 443)  
HeaderSort Property (Page 443)  
GridLineVert Property (Page 442)  
GridLineHorz Property (Page 440)  
Font property (before WinCC V7) (Page 431)  
Enabled Property (Page 408)  
ColWidth Property (Page 389)  
ColTitle Property (Page 378)  
ColMove Property (Page 374)  
CellCut property (before WinCC V7) (Page 364)  
Caption Property (Page 362)

- ButtonCommand Property (Page 358)
- AutoScroll property (before WinCC V7) (Page 317)
- AllServer property (before WinCC V7) (Page 311)
- Activate property (before WinCC V7) (Page 302)
- LocaleSpecificSettings Property (Page 483)
- SortOrder Property (Page 580)
- TableFocusOnButtonCommand Property (Page 595)
- CursorMode Property (Page 396)
- CursorModePrefetch Property (Page 396)
- LongTimeArchiveConsistency property (before WinCC V7) (Page 486)

## WinCC Function Trend Control (before WinCC V7)

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC Function Trend Control"

### Type Identifier in VBS

HMIFunctionTrendView

### Usage

In the following example, the object with the name "Control1" is moved 13 pixels to the right:

```
'VBS57
Dim objControl
Set objControl = ScreenItems("Control1")
objControl.Left = objControl.Left +13
```



**See also**

Top Property (Page 643)  
ScalingTypeY Property (Page 560)  
Layer Object (Page 120)  
DesiredCurveSourceUAArchive Property (Page 403)  
Activate Method (Page 712)  
Properties (Page 301)  
ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
Controls (Page 218)  
Width Property (Page 698)  
Visible Property (Page 696)  
UpperLimitValue Property (Page 674)  
UpperLimit Property (Page 673)  
UpperLimitColor Property (Page 674)  
Type Property (Page 666)  
ToolbarHotKeys Property (Page 640)  
ToolbarButtons Property (Page 638)  
ToolbarAlignment property (before WinCC V7) (Page 629)  
Titleline Property (Page 626)  
TimeZone Property (Page 624)  
TimeAxisX Property (Page 609)  
TagProviderClsid Property (Page 597)  
SourceUAColumnY Property (Page 586)  
SourceUAColumnX Property (Page 586)  
SourceUAArchiveStartID Property (Page 585)  
SourceUAArchive Property (Page 585)  
SourceTimeRange Property (Page 585)  
SourceTagProviderDataY Property (Page 584)  
SourceTagProviderDataX Property (Page 584)  
SourceTagNameY Property (Page 584)  
SourceTagNameX Property (Page 583)  
SourceNumberOfValues Property (Page 583)  
SourceNumberOfUAValues Property (Page 582)  
SourceEndTime Property (Page 582)


SourceBeginTime Property (Page 581)  
ShowValuesExponentialY Property (Page 578)  
ShowValuesExponentialX Property (Page 578)  
ShowRulerImmediately Property (Page 575)  
ScalingTypeX Property (Page 559)  
RulerPrecisionY Property (Page 556)  
RulerPrecisionX Property (Page 556)  
Replacement Property (Page 550)  
ReplacementColor Property (Page 551)  
RelayCurves Property (Page 550)  
ProviderType Property (Page 545)  
PrecisionY Property (Page 542)  
PrecisionX Property (Page 542)  
PersistentRTPermission Property (Page 533)  
PersistentRT Property (Page 532)  
PersistentRTCSPermission Property (Page 533)  
PersistentRTCS Property (Page 532)  
Parent Property (Page 529)  
Online property (before WinCC V7) (Page 516)  
ObjectName Property (Page 512)  
Object Property (Page 512)  
NumItems Property (Page 511)  
Name Property (Page 509)  
LowerLimitValue Property (Page 487)  
LowerLimit Property (Page 486)  
LowerLimitColor Property (Page 487)  
LoadDataImmediately property (before WinCC V7) (Page 482)  
Left Property (Page 476)  
LabelY Property (Page 458)  
LabelX Property (Page 457)  
ItemVisible Property (Page 456)  
InsertData Property (Page 454)  
Index Property (Page 452)  
Height Property (Page 443)  
GridlinesY Property (Page 441)

GridlinesX Property (Page 441)  
GridlinesValueY Property (Page 441)  
GridlinesValueX Property (Page 440)  
GraphDirection property (before WinCC V7) (Page 439)  
FreezeProviderConnections Property (Page 438)  
Font property (before WinCC V7) (Page 431)  
FineGridY Property (Page 423)  
FineGridX Property (Page 423)  
FineGridValueY Property (Page 423)  
FineGridValueX Property (Page 422)  
EndY Property (Page 411)  
EndX Property (Page 411)  
Enabled Property (Page 408)  
DesiredCurveVisible Property (Page 405)  
DesiredCurveSourceUAColumnY Property (Page 404)  
DesiredCurveSourceUAColumnX Property (Page 404)  
DesiredCurveSourceUAArchiveStartID Property (Page 404)  
DesiredCurveSourceNumberOfUAValues Property (Page 403)  
DesiredCurveCurveForm Property (Page 403)  
DesiredCurveColor Property (Page 402)  
DeleteData Property (Page 402)  
DataY Property (Page 400)  
DataXY Property (Page 399)  
DataX Property (Page 399)  
DataIndex Property (Page 398)  
CurveForm Property (Page 396)  
CommonY Property (Page 391)  
CommonX Property (Page 391)  
Color Property (Page 374)  
CoarseGridY Property (Page 372)  
CoarseGridX Property (Page 372)  
CoarseGridValueY Property (Page 373)  
CoarseGridValueX Property (Page 373)  
Closeable property (before WinCC V7) (Page 370)  
Caption Property (Page 362)

- BeginY Property (Page 344)
- BeginX Property (Page 344)
- BackColor Property (Page 322)
- AutorangeY Property (Page 317)
- AutorangeX Property (Page 317)
- AllowPersistence Property (Page 310)
- LocaleSpecificSettings Property (Page 483)
- PrintBackgroundColor Property (Page 543)
- PrintJob Property (Page 544)
- RulerFont Property (Page 556)

## WinCC Online Table Control (before WinCC V7)

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC Online Table Control"

### Type Identifier in VBS

HMITableView

### Usage

In the following example, the object with the name "Control1" is moved 15 pixels to the right:

```
'VBS59  
Dim objControl  
Set objControl = ScreenItems("Control1")  
objControl.Left = objControl.Left +15
```


**See also**

TimeOverlap Property (Page 620)  
ItemVisible Property (Page 456)  
PrintBackgroundColor Property (Page 543)  
Activate Method (Page 712)  
Properties (Page 301)  
ScreenItems Object (List) (Page 129)  
ScreenItem Object (Page 125)  
Controls (Page 218)  
Width Property (Page 698)  
Visible Property (Page 696)  
Variable Property (Page 695)  
ValueColumnAlignment Property (Page 688)  
UpperLimitValue Property (Page 674)  
UpperLimit Property (Page 673)  
UpperLimitColor Property (Page 674)  
Type Property (Page 666)  
Top Property (Page 643)  
ToolbarHotKeys Property (Page 640)  
Toolbar Property (Page 628)  
ToolbarButtons Property (Page 638)  
ToolbarAlignment property (before WinCC V7) (Page 629)  
Titleline Property (Page 626)  
TimeZone Property (Page 624)  
TimeRangeFactor Property (Page 622)  
TimeRange Property (Page 621)  
TimeRangeBase Property (Page 621)  
TimeOverlapColor Property (Page 620)  
TimeJump Property (Page 619)  
TimeJumpColor Property (Page 620)  
TimeFormat Property (Page 619)  
TimeColumnAlignment Property (Page 611)  
Statusbar Property (Page 588)  
PrintJob Property (Page 544)  
Precisions Property (Page 542)

PersistentRTPermission Property (Page 533)  
PersistentRT Property (Page 532)  
PersistentRTCSPermission Property (Page 533)  
PersistentRTCS Property (Page 532)  
Parent Property (Page 529)  
Online property (before WinCC V7) (Page 516)  
ObjectName Property (Page 512)  
Object Property (Page 512)  
NumItems Property (Page 511)  
LowerLimitValue Property (Page 487)  
LowerLimit Property (Page 486)  
LowerLimitColor Property (Page 487)  
LoadDataImmediately property (before WinCC V7) (Page 482)  
Left Property (Page 476)  
Layer Object (Page 120)  
Index Property (Page 452)  
Height Property (Page 443)  
Font property (before WinCC V7) (Page 431)  
EndTime Property (Page 410)  
Enabled Property (Page 408)  
Edit Property (Page 407)  
Editable Property (Page 407)  
CommonTime Property (Page 390)  
Command Property (Page 390)  
Color Property (Page 374)  
Closeable property (before WinCC V7) (Page 370)  
Caption Property (Page 362)  
BeginTime Property (Page 343)  
BackColor Property (Page 322)  
Archive Property (Page 314)  
AllowPersistence Property (Page 310)  
Actualize Property (Page 305)  
Activate property (before WinCC V7) (Page 302)  
LocaleSpecificSettings Property (Page 483)

## WinCC Online Trend Control (before WinCC V7)

### Description



Object Type of ScreenItem Object. Represents the graphic object "WinCC Online Trend Control"

### Type Identifier in VBS

HMITrendView

### Usage

In the following example, the object with the name "Control1" is moved 16 pixels to the right:

```
'VBS60
Dim objControl
Set objControl = ScreenItems("Control1")
objControl.Left = objControl.Left + 16
```

### See also

- Properties (Page 301)
- TimeAxis Property (Page 602)
- LowerLimitColor Property (Page 487)
- Caption Property (Page 362)
- Activate Method (Page 712)
- ScreenItems Object (List) (Page 129)
- ScreenItem Object (Page 125)
- Controls (Page 218)
- Width Property (Page 698)
- Visible Property (Page 696)
- UpperLimitValue Property (Page 674)

UpperLimit Property (Page 673)  
UpperLimitColor Property (Page 674)  
Type Property (Page 666)  
Top Property (Page 643)  
ToolbarHotKeys Property (Page 640)  
Toolbar Property (Page 628)  
ToolbarButtons Property (Page 638)  
ToolbarAlignment property (before WinCC V7) (Page 629)  
Titleline Property (Page 626)  
TimeZone Property (Page 624)  
TimeRangeFactor Property (Page 622)  
TimeRange Property (Page 621)  
TimeRangeBase Property (Page 621)  
TimeOverlap Property (Page 620)  
TimeOverlapColor Property (Page 620)  
TimeJump Property (Page 619)  
TimeJumpColor Property (Page 620)  
TimeAxisFormat Property (Page 605)  
TagName Property (Page 596)  
Statusbar Property (Page 588)  
ShowRulerImmediately Property (Page 575)  
ServerData Property (Page 569)  
RulerPrecisions Property (Page 556)  
Replacement Property (Page 550)  
ReplacementColor Property (Page 551)  
RelayCurves Property (Page 550)  
ProviderClsid Property (Page 545)  
PrintJob Property (Page 544)  
Precisions Property (Page 542)  
PersistentRTPermission Property (Page 533)  
PersistentRT Property (Page 532)  
PersistentRTCSPermission Property (Page 533)  
PersistentRTCS Property (Page 532)  
Parent Property (Page 529)  
Online property (before WinCC V7) (Page 516)




ObjectName Property (Page 512)  
Object Property (Page 512)  
NumItems Property (Page 511)  
MeasurePoints Property (Page 494)  
LowerLimitValue Property (Page 487)  
LowerLimit Property (Page 486)  
LoadDataImmediately property (before WinCC V7) (Page 482)  
Left Property (Page 476)  
Layer Object (Page 120)  
Label Property (Page 457)  
ItemVisible Property (Page 456)  
Index Property (Page 452)  
Height Property (Page 443)  
GridLineValue Property (Page 442)  
GridLines Property (Page 440)  
GraphDirection property (before WinCC V7) (Page 439)  
Font property (before WinCC V7) (Page 431)  
FineGridValue Property (Page 422)  
FineGrid Property (Page 422)  
EndValue Property (Page 410)  
EndTime Property (Page 410)  
Enabled Property (Page 408)  
CurveForm Property (Page 396)  
CommonY Property (Page 391)  
CommonX Property (Page 391)  
Command Property (Page 390)  
Color Property (Page 374)  
CoarseGridValue Property (Page 372)  
CoarseGrid Property (Page 371)  
Closeable property (before WinCC V7) (Page 370)  
BeginValue Property (Page 343)  
BeginTime Property (Page 343)  
BackColor Property (Page 322)  
Autorange Property (Page 317)  
AllowPersistence Property (Page 310)

- Actualize Property (Page 305)
- Activate property (before WinCC V7) (Page 302)
- AdjustRuler Property (Page 307)
- LineWidth property (before WinCC V7) (Page 481)
- ScalingType Property (Page 558)
- UseRangeSubstitutes Property (Page 676)
- XAxisColor property (before WinCC V7) (Page 702)
- HideTagNames Property (Page 445)
- LocaleSpecificSettings Property (Page 483)
- PrintBackgroundColor Property (Page 543)
- ItemProviderClsid Property (Page 456)
- OneY Property (Page 516)
- AllowXAxisColor - Property (Page 311)
- AnchorRuler Property (Page 312)
- SavedTrend Property (Page 557)
- SelectedTrend Property (Page 565)
- ShowSpanNames Property (Page 577)
- DefaultPrecision Property (Page 400)
- DefaultRulerPrecision Property (Page 400)
- LowerLimitTagName Property (Page 487)
- UpperLimitTagName Property (Page 674)
- UseOnlineTags Property (Page 676)

### 1.14.3.7 Customized Object

#### Description



Object Type of ScreenItem Object. Represents the graphic object "Customized Object".

## Type Identifier in VBS

HMIScreenModule

## Usage

You access customized properties in a customized object via the attribute name in VBS. Intellisense is only applicable to the customized object as a whole.

You will locate the attribute name under Properties of the properties placed outside (right-click Property) and can be modified there.

In the following example, the object with the name "CustomizedObject1" is moved 10 pixels to the right:


```
'VBS65
Dim objCustomObject
Set objCustomObject = ScreenItems("CustomizedObject1")
objCustomObject.Left = objCustomObject.Left + 10
```

## See also

- [Activate Method \(Page 712\)](#)
- [Properties \(Page 301\)](#)
- [ScreenItems Object \(List\) \(Page 129\)](#)
- [ScreenItem Object \(Page 125\)](#)
- [Object types of the ScreenItem object \(Page 143\)](#)
- [Width Property \(Page 698\)](#)
- [Visible Property \(Page 696\)](#)
- [Type Property \(Page 666\)](#)
- [Top Property \(Page 643\)](#)
- [ToolTipText Property \(Page 641\)](#)
- [Parent Property \(Page 529\)](#)
- [ObjectName Property \(Page 512\)](#)
- [Left Property \(Page 476\)](#)
- [Layer Object \(Page 120\)](#)
- [Height Property \(Page 443\)](#)
- [Enabled Property \(Page 408\)](#)

### 1.14.3.8 Group

#### Description



Object Type of ScreenItem Object. Represents the graphic object "Group"

#### Type Identifier in VBS

HMIGroup

#### Usage

In the following example, the object with the name "Group1" is moved 10 pixels to the right:

```
'VBS66  
Dim objGroup  
Set objGroup = ScreenItems("Group1")  
objGroup.Left = objGroup.Left + 10
```

#### See also

- Properties (Page 301)
- Activate Method (Page 712)
- ScreenItems Object (List) (Page 129)
- ScreenItem Object (Page 125)
- Object types of the ScreenItem object (Page 143)
- Width Property (Page 698)
- Visible Property (Page 696)
- Type Property (Page 666)
- Top Property (Page 643)
- ToolTipText Property (Page 641)
- Parent Property (Page 529)

ObjectName Property (Page 512)

Left Property (Page 476)

Layer Object (Page 120)

Height Property (Page 443)

Enabled Property (Page 408)

## 1.14.4 Properties

### 1.14.4.1 Properties

#### Overview

The properties of the individual objects can be used to modify specific graphic objects and tags in Runtime , e.g. activating an operating element per mouse click or triggering a color change by modifying a tag value.

Properties on graphic objects can be addressed via the following syntax:

```
'VBS191
Dim obj
Set obj = ScreenItems("object1")
obj.property = Value
```

In the following example, the object with the name "Control1" is moved 10 pixels to the right:

```
'VBS192
Dim obj
Set obj = ScreenItems("control1")
obj.Left = obj.Left + 10
```

#### 1.14.4.2 A

### Aa - Ad

## AccessPath Property

### Description

Displays the storage path (with hierarchy information) of a screen object (picture). The property corresponds to the full access code on the Screens Collections.

STRING (read only)

### Example:

In the following example, the path of the picture "ScreenWindow1" is issued:

```
'VBS67
Dim objScreen
Set objScreen = HMIRuntime.Screens("ScreenWindow1")
MsgBox objScreen.AccessPath
```

### See also

[ScreenItem Object \(Page 125\)](#)

[Screens Object \(List\) \(Page 134\)](#)

## Activate property (before WinCC V7)

### Description

The data to be displayed is only requested from the archive server when this attribute is set. In order to reduce the picture opening times, this attribute should not be set and the value only dynamically changed when necessary.

Write/Read access

To differentiate between the "Activate" property form the "Activate" method, the property is accessed via "Object".

**Example:**

```
Dim ctrl
Set ctrl = ScreenItems("Control")
ctrl.Object.activate = true
```

**See also**

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

**Activate property****Activate**

The data to be displayed in the message window are only requested from the message server if you set this attribute. Instead of setting this attribute, it is advisable to change the value dynamically in order to reduce picture activation times.

To differentiate the "Activate" property from the "Activate" method, the property is addressed via "Object".

**Example**

```
Dim ctrlSet
ctrl = ScreenItems("Control")
ctrl.Object.activate = true
```

The attribute can be assigned dynamic properties by means of the name **Activate** . The data type is BOOLEAN.

**ActiveProject Property****Description**

Returns an object of type "Project".

**See also**

Path Property (Page 531)

Name Property (Page 509)

Ellipse segment (Page 147)

HMIRuntime Object (Page 118)

## ActiveScreen Property

### Description

Supplies a reference to the picture which contains the object with the current focus.

### Usage

"ActiveScreen" is used in Runtime to address the properties of the picture which contains the currently focussed object.

### Example:

The following example assigns the name of the current picture to the tag "strScrName" and outputs it in a message:

```
'VBS68  
Dim strScrName  
strScrName = HMIRuntime.ActiveScreen.Objectname  
MsgBox strScrName
```

### See also

[Screen Object \(Page 131\)](#)

[HMIRuntime Object \(Page 118\)](#)

## ActiveScreenItem Property

### Description

Supplies a reference to the object currently in focus.

### Usage

"ActiveScreenItem" is used in Runtime in order to address the properties of the object currently in focus.



**Example:**

The following example displays the name of the object in the "ScreenWindow1" picture which has the focus:

```
'VBS69
Dim objScreen
Set objScreen = HMIRuntime.Screens("ScreenWindow1")
MsgBox objScreen.ActiveScreenItem.ObjectName
```

**See also**

[ScreenItem Object \(Page 125\)](#)

[HMIRuntime Object \(Page 118\)](#)

**Actualize Property****Description**

The "Index" property references a column pair or a trend. "Actualize" defines whether a static or dynamic representation should be used for this column pair/trend.

- 0: Static display
- -1: Dynamic display

**See also**

[WinCC Online Table Control \(before WinCC V7\) \(Page 292\)](#)

[WinCC Online Trend Control \(before WinCC V7\) \(Page 295\)](#)

[ScreenItem Object \(Page 125\)](#)

**ActualPointLeft Property****Description**

Defines or returns the x-coordinate of the current corner point in relation to the original picture (top left). Each corner point is identified by an index which is derived from the number ("PointCount") of corner point available.

A change of the value can affect the properties "Width" (object width) and "Left" (x-coordinate of the object position).

## See also

Polyline (Page 158)  
Polygon (Page 156)  
ScreenItem Object (Page 125)

## ActualPointTop Property

### Description

Defines or returns the y-coordinate of the current corner point in relation to the original picture (top left). Each corner point is identified by an index which is derived from the number ("PointCount") of corner point available.

A change of the value can affect the properties "Height" (object height) and "Top" (y-coordinate of the position).

## See also

Polyline (Page 158)  
Polygon (Page 156)  
ScreenItem Object (Page 125)

## AdaptBorder Property

### Description

TRUE, when the border should be dynamically adjusted to the size of the text. BOOLEAN write-read access.

For text list and I/O field: Read only access.

## See also

Button (Page 201)  
Static text (Page 165)  
Text list (Page 196)  
Radio box (Page 207)  
Check box (Page 204)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## AdaptPicture Property

### Description

Defines whether the picture displayed in a picture window should be adapted to the size of the picture window in Runtime or not. Read only access.

TRUE, when the picture adapts to the picture window size.

FALSE, when the picture does not adapt to the picture window size.

### See also

Picture Window (Page 179)

ScreenItem Object (Page 125)

## AdaptSize Property

### Description

Defines whether the picture window should adapt to the size of the picture displayed in it during Runtime or not. Read only access.

TRUE, when the picture window adapts to the picture size.

FALSE, when the picture window does not adapt to the picture size.

### See also

Picture Window (Page 179)

ScreenItem Object (Page 125)

## AdjustRuler Property

### Description

Specifies if the ruler window should be adjusted to the trend window upon each appearance.

TRUE, if you move the ruler window and make it appear and disappear again, it will be displayed in its original position and its original size.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## Al - Ap

### AlarmID property

#### Description

Returns the AlarmID of the Alarm object. The AlarmID is unique, and is assigned by the system.

AlarmID (readonly)

#### See also

Alarms object (list) (Page 110)

### AlarmHigh Property

#### Description

Defines the top limit value at which an alarm should be triggered or returned. The type of the evaluation (in percent or absolute) is defined in the "TypeAlarmHigh" property. The "CheckAlarmHigh" property determines whether the monitoring for this limit value is activated.

#### See also

Bar (Page 174)

ScreenItem Object (Page 125)

### AlarmLogs Property

#### Description

Returns an object of type "AlarmLogs".

AlarmLogs (read-only)

#### See also

HMIRuntime Object (Page 118)

## AlarmLow Property

### Description

Defines the bottom limit value at which an alarm should be triggered or returned. The type of the evaluation (in percent or absolute) is defined in the "TypeAlarmLow" property. The "CheckAlarmLow" property determines whether the monitoring for this limit value is activated.

### See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## Alignment Property

### Description

Defines or returns the representation of the scale (left/right or top/bottom) according to the position of the bar graph object. The "Scaling" property must be set to TRUE for the scale to be displayed.

### See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## AlignmentLeft Property

### Description

Defines or returns the horizontal alignment of the text. Value range from 0 to 2.

0 = left  
1 = centered  
2 = right

### See also

Group Display (Page 194)  
Static text (Page 165)  
Text list (Page 196)  
Radio box (Page 207)  
Check box (Page 204)

Button (Page 201)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## AlignmentTop Property

### Description

Defines or returns the vertical alignment of the text. Value range from 0 to 2.

0 = top

1 = centered

2 = bottom

### See also

Group Display (Page 194)  
Static text (Page 165)  
Text list (Page 196)  
Radio box (Page 207)  
Check box (Page 204)  
Button (Page 201)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## AllowPersistence Property

### Description

TRUE, when settings regarding persistence are possible. BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)  
WinCC Online Table Control (before WinCC V7) (Page 292)  
WinCC Function Trend Control (before WinCC V7) (Page 288)  
ScreenItem Object (Page 125)

## AllowXAxisColor - Property

### Description

TRUE if the defined color of the common X-axis is displayed in runtime. BOOLEAN write-read access.

## AllServer property (before WinCC V7)

### Description

Defines that the data to be displayed in the message window is required by all servers participating in a distributed system on which Alarm Logging is activated. Write/Read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## AllServer property

### All servers - AllServer

Selects all servers whose packages were loaded and on which "Alarm Logging Runtime" is activated in the startup list.

Value	Explanation
TRUE	All servers are activated.
FALSE	Activates only the servers entered in "Server selection".

The attribute can be assigned dynamic properties by means of the name **AllServer**. The data type is BOOLEAN.

## Analog Property

### Description

TRUE, when the clock is to be displayed as an analog clock. BOOLEAN write-read access.

### See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## AnchorRuler Property

### Description

TRUE if the ruler window is firmly linked to the curve window. BOOLEAN write-read access.

## AngleAlpha Property

### Description

Defines or returns depth angle a for the 3D-effect of the "3DBarGraph" object. Value range in degrees from 0 to 90.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## AngleBeta Property

### Description

Defines or returns depth angle b for the 3D-effect of the "3DBarGraph" object. Value range in degrees from 0 to 90.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## AngleMax Property

### Description

Defines or returns the angle on the scale at which the scale graduation ends. LONG write-read access.

The start and end of the scale graduation are described by the attributes "AngleMin" and "AngleMax" in angular degrees. AngleMin < AngleMax applies.

Angle 0 degrees is at the right side of the horizontal diameter of the graduated scale disk. Positive angle values are counted in a counterclockwise direction.



**See also**

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

**AngleMin Property****Description**

Defines or returns the angle on the scale at which the scale graduation begins. LONG write-read access.

**See also**

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

**Application Property****Description**

Returns the Graphics Designer application when the application property is used without an object identifier. If the application property is used with object identifier, it returns an application object which displays the application with which the defined object was created. Read only access.

**See also**

Application Window (Page 173)

ScreenItem Object (Page 125)

**ApplyProjectSettings property****Apply project settings - ApplyProjectSettings**

Activates the project settings derived from "Alarm Logging".

Value	Explanation
TRUE	The "Apply project settings" check box is selected. The message blocks configured in "Alarm Logging" and their properties are activated in AlarmControl. The message blocks are displayed with these properties in the message window.
FALSE	The "Apply project settings" check box is deactivated. You can add or remove message blocks, or edit their properties.

The attribute can be assigned dynamic properties by means of the name **ApplyProjectSettings**. The data type is BOOLEAN.

## Ar - Ax

### Archive Property

#### Description

The "Index" property references a pair of columns. "Archive" defines process archive values linked to the column pair. The name of the process value archive is specified in the following form: Server name::Archive name

#### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

### ArchiveName property

#### Name - ArchiveName

Specifies the user archive or view to be displayed. Open the "Package Browser" dialog for configuring an archive or a view by clicking the button.

The attribute can be assigned dynamic properties by means of the name **ArchiveName**. The data type is STRING.

### ArchiveType property

#### Type - ArchiveType

Specifies whether the selected user archive is an archive or a view. The field cannot be edited.

The attribute can be assigned dynamic properties by means of the name **ArchiveType**. The data type is LONG.

### AspectRatio property

#### AspectRatio

Specifies if the aspect ratio is kept in movies.

The attribute can be assigned dynamic properties by means of the name **AspectRatio**. The data type is BOOLEAN.

## Assignments Property

### Description

A list which contains the assignments between the output values and the actual output texts to be output.  
The assignments depend on the set list type. The list type is defined with the ListType property.  
Read only access.

### See also

Text list (Page 196)  
ScreenItem Object (Page 125)

## AssumeOnExit Property

### Description

TRUE, if the entered text is assumed upon exiting the entry field (e.g., with the key or mouse click). BOOLEAN write-read access.

### See also

I/O Field (Page 184)  
Text list (Page 196)  
ScreenItem Object (Page 125)

## AssumeOnFull Property

### Description

TRUE, when the content of the input field is full (specified number of characters have been entered) and should be exited automatically and the input accepted. BOOLEAN write-read access.

### See also

I/O Field (Page 184)  
ScreenItem Object (Page 125)

## AutoCompleteColumns property

### Show empty columns - AutoCompleteColumns

Adds empty columns if the Control width is greater than the width of columns configured.

Value	Explanation
TRUE	Enables the display of empty columns.
FALSE	Disables the display of empty columns.

The attribute can be assigned dynamic properties by means of the name **AutoCompleteColumns**. The data type is BOOLEAN.

## AutoCompleteRows property

### Show empty rows - AutoCompleteRows

Enables the insertion of empty rows if the Control length is greater than the number of rows configured.

Value	Explanation
TRUE	Enables the display of empty rows.
FALSE	Disables the display of empty rows.

The attribute can be assigned dynamic properties by means of the name **AutoCompleteRows**. The data type is BOOLEAN.

## AutoPosition property

### Automatic positioning - AutoPosition

Defines whether to position the RulerControl exactly below the source control.

The following settings are available:

Value	Explanation
TRUE	The RulerControl is positioned exactly below the source control.
FALSE	The RulerControl is displayed in accordance with your configuration of the control position.

The attribute can be assigned dynamic properties by means of the name **AutoPosition**. The data type is BOOLEAN.

## Autorange Property

### Description

TRUE, when the value range of the Y-axis is determined automatically or defined by using the "BeginValue" and "EndValue" attributes. BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## AutorangeX Property

### Description

TRUE, when the value range of the X-axis is determined automatically. FALSE, when it is determined by means of the "BeginX" and "EndX" attributes. BOOLEAN write-read access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## AutorangeY Property

### Description

TRUE, when the value range of the Y-axis is determined automatically. FALSE, when it is determined by means of the "BeginY" and "EndY" attributes. BOOLEAN write-read access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## AutoScroll property (before WinCC V7)

### Description

Defines the behavior of the message window when a new message is received. BOOLEAN write-read access.

TRUE : A newly received message is appended to the list displayed in the message window and is automatically selected. The visible range of the message window is moved, if necessary.

FALSE : A newly received message is not selected. The visible range of the message window is not changed.

The targeted selection of messages is only possible when "AutoScroll" is not active.

The "AutoScroll" property is deactivated when the attribute "MsgCtrlFlag" = "-1" is set. This means that the most recent message is displayed at the top of the list in the message window.

**See also**

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

**AutoScroll Property**

**Auto scrolling - AutoScroll**

Defines the behavior of the message window after a new message events.

You can only select message lines if "Auto scrolling" is disabled.

Value	Explanation
TRUE	If "AutoScroll" is activated, a new activated message is appended to the list displayed in the message window and selected automatically. The visible area of the message window is shifted as required.
FALSE	New message events are not selected if "Autoscroll" is disabled. The visible area of the message window is not changed.

The attribute can be assigned dynamic properties by means of the name **AutoScroll**. The data type is BOOLEAN.

**AutoSelectionColors property**

**Automatic selection coloring - AutoSelectionColor**

Enables the display of default system colors as selection color for cells and rows.

Value	Explanation
TRUE	The system colors are in use.
FALSE	The custom colors are used.

The attribute can be assigned dynamic properties by means of the name **AutoSelectionColors**. The data type is BOOLEAN.

## AutoSelectionRectColor property

### Automatic color assignment - AutoSelectionRectColor

Defines a system color for the selection border.

Value	Explanation
TRUE	The system color is in use.
FALSE	The custom color is used.

The attribute can be assigned dynamic properties by means of the name **AutoSelectionRectColors**. The data type is BOOLEAN.

## AutoShow property

### Show/hide automatically - AutoShow

Enables/disables automatic activation of the RulerControl on the display if you selected the button functions for the ruler, statistics range and for statistics in the source control.

The RulerControl is hidden again if you are no longer using the ruler, statistics range and statistics functions.

Value	Explanation
TRUE	The RulerControl is displayed automatically.
FALSE	The RulerControl is not displayed automatically.

The attribute can be assigned dynamic properties by means of the name **AutoShow**. The data type is BOOLEAN.

## AutoSize Property

### Description

Defines or returns the size adaptation of the object. The following values can be set:

- 0: No size adaptation.
- 1: The picture ("PictureSelected", "PictureUnselected" properties) is adapted to the button.
- 2: The button is adapted to the picture ("PictureSelected", "PictureUnselected" properties).

### See also

WinCC Push Button Control (Page 269)

ScreenItem Object (Page 125)

## Autostart property

### Autostart

Specifies if movies are started automatically.

The attribute can be assigned dynamic properties by means of the name **Autostart**. The data type is BOOLEAN.

## Average Property

### Average

TRUE, if the mean value is calculated based on the last 10 values. A value change is conditional for calculation of a new mean value. The mean value is reset when you change a picture. If only one value is available when you change the picture, the following mean value is calculated:  $(5+0+0+0+0+0+0+0+0+0)/10=0,5$ .

BOOLEAN write-read access.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## Axe Property

### Description

Defines or returns the position of the 3D bar in the coordinate system. Value range from 0 to 2.

0: The 3D-bar is displayed on the X-axis.

1: The 3D-bar is displayed on the Y-axis.

2: The 3D-bar is displayed on the Z-axis.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)



## AxisSection Property

### Description

Defines or returns the distance between two long axis sections. The information on the distance is given in scale units and is dependent on the minimum and maximum values configured.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## 1.14.4.3 B

### Ba

## BackBorderWidth Property

### Description

Defines or returns the width of the 3D border in pixels. The value for the width is dependent on the size of the object.

### See also

ScreenItem Object (Page 125)

Button (Page 201)

Round Button (Page 209)

Slider (Page 212)

Group Display (Page 194)

## BackColor property

### Background - BackColor

Specifies the background color of the control. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **BackColor**. The data type is LONG.

## BackColor property

### Background Color (BackColor)

Specifies the icon background color in the "Color selection" dialog. The background color is displayed in "opaque" style.

The attribute can be assigned dynamic properties by means of the name **BackColor**. The data type is LONG.

## BackColor Property

### Function

Defines or returns the background color for the object.

For objects with a fill pattern, the background color is not displayed if "transparent" is defined as the fill style.

### Special features of the WinCC slider control

The background color only takes effect when the object is at least partially filled.

### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Enter the appropriate decimal value for each of the three RGB values.

Example:

```
RGB(200, 150, 100)
```

### Example:

The following example defines the background of the "ScreenWindow1" picture to red:

```
'VBS70
Dim objScreen
Set objScreen = HMIRuntime.Screens("ScreenWindow1")
objScreen.BackColor = RGB(255, 0, 0)
```

### See also

[FillStyle Property \(Page 419\)](#)

[FillColor Property \(Page 418\)](#)

[ScreenItem Object \(Page 125\)](#)

## BackColor2 Property

### Description

Defines or returns the bar color for the display of the current value. LONG write-read access.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## BackColor3 Property

### Description

Defines or returns the color of the bar background. LONG write-read access.

### See also

ScreenItem Object (Page 125)

Bar (Page 174)

## BackColorBottom Property

### Description

Defines or returns the color for the bottom/right part of the slider. LONG write-read access.

### See also

Slider (Page 212)

ScreenItem Object (Page 125)

## BackColorTop Property

### Description

Defines or returns the color for the top/left part of the slider. LONG write-read access.

### See also

Slider (Page 212)

ScreenItem Object (Page 125)

## BackFlashColorOff Property

### Description

Defines or returns the color of the object background for the flash status "Off". LONG write-read access.

### See also

ScreenItem Object (Page 125)

## BackFlashColorOn Property

### Description

Defines or returns the color of the object background for the flash status "On". LONG write-read access.

### See also

ScreenItem Object (Page 125)

## Background Property

### Description

TRUE, when the background of the 3D-bar graph object should be visible. BOOLEAN write-read access.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## BackgroundPicture Property

### Description

Returns the picture name of the background picture for the graduated scale disk. Read only access

**See also**

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

**BackPictureAlignment property****Description**

Defines or returns the mode of representation of the background image in the process picture.  
LONG write-read access.

**BackPictureName property****Description**

Defines the path and file name of the background image in the process picture or returns it.  
LONG write-read access.

**BackStyle Property****Description****WinCC Digital/Analog Clock**

Defines the type of background of the analog clock:

- 0: The rectangular background of the clock is filled by the specified background color.
- 1: The round numbered face of the clock is filled by the specified background color. This enables a round analog clock to be displayed.
- 2: Numbered face and rectangular background are transparent.

**WinCC Gauge Control**

Defines the type of background of the gauge:

- 0: The rectangular or square background of the gauge has a border color is filled with the specified color. The circular graduated scale disk is filled by the specified background color.
- 1: The rectangular or square background of the gauge is transparent. The circular graduated scale disk is filled by the specified background color. This enables a circular gauge to be displayed.
- 2: The rectangular or square background and graduated scale disk are transparent.

### WinCC Slider Control

Defines whether the object background should be transparent.

- 0: The object background is not transparent
- 1: The object background is transparent

### HMI Symbol Library

Defines the icon background transparency. Write/Read access.

- 0: The background is transparent and, thus, invisible.
- 1: The background is visible, the color of the background is defined by the "Background Color" attribute.

### See also

HMI Symbol Library (Page 239)

WinCC Slider Control (Page 277)

WinCC Gauge Control (Page 254)

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

### Bar

### BarAdd property

### New - BarAdd

Creates a new diagram.

The attribute can be assigned dynamic properties using the name **BarAdd**. The data type is STRING.

### BarBackColor Property

### Description

Defines the background color in the area of the slider. The area stretches from "RangeMin" to "RangeMax".

### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

**BarBarGradientColor property****Fill pattern color - BarBarGradientColor**

The "Fill Pattern Color" attribute defines the color of the pattern that is displayed on a filled area.

The attribute can be assigned dynamic properties using the name **BarBarGradientColor**. The data type is LONG.

**BarBarGradientPattern property****Fill pattern - BarBarGradientPattern**

The "Fill Pattern" attribute specifies the pattern for the display of bars.

So that the fill pattern becomes visible, the color of the fill pattern must differ from the background color.

49 fill patterns are available for selection:

- Fill pattern 1 "Solid" fills the object with the set background color.
- Fill pattern 2 "Transparent" means neither a background nor a fill pattern is displayed.

The attribute can be assigned dynamic properties using the name **BarBarGradientPattern**. The data type is LONG.

**BarBarWindow property****Diagram window - BarBarWindow**

Specifies the diagram window in which the selected diagram will be displayed. You specify the available diagram windows on the "Diagram window" tab.

The attribute can be assigned dynamic properties using the name **BarWindow**. The data type is STRING.

**BarChartType property****Diagram type - BarChartType**

Specifies how the diagram will be displayed.

The following settings are available:

Value	Description	Explanation
0	Bar diagram	A diagram with bars will be displayed.
1	Bars with value	In addition to the bars, the values will be displayed in the diagram. The display of values conforms to the configuration of the "Alignment" property and the write direction of the bars.

The attribute can be assigned dynamic properties using the name **BarChartType**. The data type is LONG.

### BarColor property

#### Border color - BarColor

Indicates the border color of the bar. Use the button to open the "Color selection" dialog to select the color.

The attribute can be assigned dynamic properties using the name **BarColor**. The data type is LONG.

### BarCount property

#### BarCount

Specifies the number of configured diagrams.

The attribute can be assigned dynamic properties using the name **BarCount**. The data type is LONG.

### BarDepth Property

#### Description

Defines or returns the depth of the bar in pixels.

#### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

### BarFillColor property

#### Bar color - BarFillColor

Indicates the fill color of the bars. For the "Bars with value" diagram type, the text background color is specified.

Use the button to open the "Color selection" dialog to select the color.

The attribute can be assigned dynamic properties using the name **BarFillColor**. The data type is LONG.



## BarFillColor Property

### Description

Defines the fill color in the area of the slider. The area stretches from "RangeMin" to the position of the slider.

### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## BarHeight Property

### Description

Defines or returns the height of the bar in pixels.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## BarIndex property

### BarIndex

References a configured diagram. Using this attribute, you can assign the values of other attributes to a specific diagram. The index must always be set before you change the properties of a diagram in Runtime.

Valid values for "BarIndex" are between 0 and "BarCount" minus 1. The "BarCount" attribute specifies the number of configured diagrams.

The "BarIndex" attribute can be assigned dynamic properties using the attribute **BarRepos**. The data type is LONG.

## BarLabel property

### Label - BarLabel

Specifies the label of the selected diagram. The label is displayed in Runtime when the "UseBarNameAsLabel" attribute has the value "FALSE".

The attribute can be assigned dynamic properties using the name **BarLabel**. The data type is STRING.

## BarLineStyle property

### Border style - BarLineStyle

Specifies which border type is used to represent the border of the bar.

The following settings are available:

Value	Description	Explanation
0	Solid	The border is displayed as a solid border.
1	Dashed	The border is displayed as a dashed border.
2	Dotted	The border is displayed as a dotted line.
3	Dash dot	The border is displayed as a dash-dot line.
4	Dash-dot-dot	The border is displayed as a dash-dot-dot line.

The attribute can be assigned dynamic properties using the name **BarLineStyle**. The data type is LONG.

## BarLineWidth property

### Border width - BarLineWidth

Specifies the border width of the bar.

The attribute can be assigned dynamic properties using the name **BarLineWidth**. The data type is LONG.

## BarLowerLimit property

### BarLowerLimit

Specifies the low limit of a tag. If the tag value is less than "BarLowerLimit", the values are designated with the color set in "BarLowerLimitColor". This setting is enabled when the "BarLowerLimitColoring" attribute has the value "TRUE".

The attribute can be assigned dynamic properties using the name **BarLowerLimit**. The data type is DOUBLE.

## BarLowerLimitColor property

### BarLowerLimitColor

Specifies the color for designating tag values below the value at "BarLowerLimit". The setting is enabled when the "BarLowerLimitColoring" attribute has the value "TRUE".

The attribute can be assigned dynamic properties using the name **BarLowerLimitColor**. The data type is LONG.

**BarLowerLimitColoring** property**BarLowerLimitColoring**

Specifies whether the "BarLowerLimitColor" attribute is used for designating tag values that are lower than the value at "BarLowerLimit".

Value	Explanation
TRUE	The "BarLowerLimitColor" attribute is enabled.
FALSE	The "BarLowerLimitColor" attribute is disabled.

The attribute can be assigned dynamic properties using the name **BarLowerLimitColoring**. The data type is BOOLEAN.

**BarName** property**Object name - BarName**

Specifies the name of the selected diagram.

The "BarName" attribute can be assigned dynamic properties using the attribute **BarRename**.

**BarProvider** property**Data source - BarProvider**

Specifies the data source of the selected diagram.

The following settings are available:

Value	Description	Explanation
0	None	No data source configured to create a connection in Runtime by means of a script.
1	Archive tags	Data source with archive tags of a process value archive.

The attribute can be assigned dynamic properties using the name **BarProvider**.

**BarProviderCLSID** property**BarProviderCLSID**

Displays the data source of the selected diagram.

Value	Explanation
	No data source configured to create a connection in Runtime by means of a script.
{416A09D2-8B5A-11D2-8B81-006097A45D48}	Data source with archive tags of a process value archive.

The attribute can be assigned dynamic properties using the name **BarProviderCLSID**. The data type is STRING.

### BarRemove property

#### Remove - BarRemove

Removes the selected diagram from the list.

The attribute can be assigned dynamic properties using the name **BarRemove**. The data type is STRING.

### BarRename property

#### BarRename

Renames the diagram that is referenced using the "BarIndex" attribute.

The attribute can be assigned dynamic properties using the name **BarRename**. You can use "BarRename" to also assign dynamic properties to the "BarName" attribute. The data type is STRING.

### BarRepos property

#### Up/down - BarRepos

Changes the order of the selected diagrams in the diagram window. "Up" and "Down" move the selected diagrams up and down in the list. As a result, the diagram is displayed further in the foreground or background in runtime.

The attribute can be assigned dynamic properties using the name **BarRepos**. The data type is LONG.

### BarSelectTagName property

#### BarSelectTagName

Opens a dialog for selecting the tag name for the data source of the diagram. Programmers can set this attribute to allow users to select a tag name using a button, for example.

The attribute can be assigned dynamic properties using the name **BarSelectTagName**. The data type is BOOLEAN.

## BarTagName property

### Tag name - BarTagName

Displays the tag name of the connected tag. With the button you open a dialog for selecting an archive tag.

The attribute can be assigned dynamic properties using the name **BarTagName**. The data type is STRING.

## BarTimeAxis property

### Time axis - BarTimeAxis

Specifies which time axis will be used for the selected diagram. You specify the available time axes on the "Time axes" tab.

The attribute can be assigned dynamic properties using the name **BarTimeAxis**. The data type is STRING.

## BarUncertainColor property

### BarUncertainColor

Values have an uncertain status if the initial value is unknown when Runtime starts or if a substitute value is used. You can use the "BarUncertainColor" attribute to specify the color used for identifying these values. The "BarUncertainColoring" attribute determines whether or not this setting is evaluated.

The attribute can be assigned dynamic properties using the name **BarUncertainColor**. The data type is LONG.

## BarUncertainColoring property

### BarUncertainColoring

Values have an uncertain status if the initial value is unknown when Runtime starts or if a substitute value is used. You can use the "BarUncertainColoring" attribute to enable identification of such values based on the color set in "BarUncertainColor".

Value	Explanation
TRUE	The setting for the "BarUncertainColor" attribute is enabled.
FALSE	The setting for the " BarUncertainColor " attribute is disabled.

The attribute can be assigned dynamic properties using the name **BarUncertainColoring**. The data type is BOOLEAN.

## BarUpperLimitColoring property

### BarUpperLimitColoring

Specifies whether the "BarUpperLimitColor" attribute is used for designating tag values that are higher than the value at "BarUpperLimit".

Value	Explanation
TRUE	The setting for the "BarUpperLimitColor" attribute is enabled.
FALSE	The setting for the "BarUpperLimitColor" attribute is disabled.

The attribute can be assigned dynamic properties using the name **BarUpperLimitColoring**. The data type is BOOLEAN.

## BarUpperLimitColor property

### BarUpperLimitColor

Specifies the color for designating tag values above the value at "BarUpperLimit". The setting is enabled when the "BarUpperLimitColoring" attribute has the value "TRUE" hat.

The attribute can be assigned dynamic properties using the name **BarUpperLimitColor**. The data type is LONG.

## BarUpperLimit property

### BarUpperLimit

Specifies the high limit of a tag. If the tag value is higher than "BarUpperLimit", the values are designated with the color set in "BarUpperLimitColor". This setting is enabled when the "BarUpperLimitColoring" attribute has the value "TRUE".

The attribute can be assigned dynamic properties using the name **BarUpperLimit**. The data type is DOUBLE.

## BarValueAlignment property

### Alignment - BarValueAlignment

Specifies the alignment of the displayed values for the "Bars with value" diagram type.

The following settings are available depending on the write direction of the bars:

- The write direction of bars is "From the right" or "From the left"

Value	Description	Explanation
0	Bottom	The values are displayed at the bottom of the diagram window.
1	Centered	The values are displayed at the center of the diagram window.
2	Top	The values are displayed at the top of the diagram window.

- The write direction of bars is "From the top" or "From the bottom"

Value	Description	Explanation
0	Left	The values are displayed at the left of the diagram window.
1	Centered	The values are displayed at the center of the diagram window.
2	Right	The values are displayed at the right of the diagram window.

The attribute can be assigned dynamic properties using the name **BarValueAlignment**. The data type is LONG.

### BarValueAxis property

#### Value axis - BarValueAxis

Specifies which value axis will be used for the selected diagram. You specify the available value axes on the "Value axes" tab.

The attribute can be assigned dynamic properties using the name **BarValueAxis**. The data type is STRING.

### BarValueUnit property

#### Unit - BarValueUnit

Specifies a unit of the values that will be appended to the value to be displayed for the "Bars with value" diagram type. e.g. "%" or "°C"

The attribute can be assigned dynamic properties using the name **BarValueUnit**. The data type is STRING.

### BarVisible property

#### Diagram - BarVisible

The list shows the diagrams you have created.

Select the diagrams in the list that you want to display in the diagram windows.

Click on a diagram in the list to adapt the properties and to assign axes and diagram windows to the diagram.

The attribute can be assigned dynamic properties using the name **BarVisible**. The data type is BOOLEAN.

## BarWindowAdd property

### New - BarWindowAdd

Creates a new diagram window.

The attribute can be assigned dynamic properties using the name **BarWindowAdd**. The data type is STRING.

## BarWindowCoarseGrid property

### Main scaling - BarWindowCoarseGrid

Enables the display of grid lines for the main scale.

Value	Explanation
TRUE	Enables the display of grid lines for the main scale.
FALSE	Disables the display of grid lines for the main scale.

The attribute can be assigned dynamic properties using the name **BarWindowCoarseGrid**. The data type is BOOLEAN.

## BarWindowCoarseGridColor property

### Color main scale - BarWindowCoarseGridColor

Specifies the color of the grid lines for the main scale. Use the button to open the "Color selection" dialog to select the color.

The attribute can be assigned dynamic properties using the name **BarWindowCoarseGridColor**. The data type is LONG.

## BarWindowCount property

### BarWindowCount

Specifies the number of configured diagrams.

The attribute can be assigned dynamic properties using the name **BarWindowCount**. The data type is LONG.



**BarWindowFineGrid property****Secondary scaling - BarWindowFineGrid**

Specifies whether the grid lines are displayed for the secondary scale.

Value	Explanation
TRUE	Enables the display of grid lines for the secondary scale.
FALSE	Disables the display of grid lines for the secondary scale.

The attribute can be assigned dynamic properties using the name **BarWindowFineGrid**. The data type is BOOLEAN.

**BarWindowFineGridColor property****Color secondary scale - BarWindowFineGridColor**

Specifies the color of the grid lines for the secondary scale. Use the button to open the "Color selection" dialog to select the color.

The attribute can be assigned dynamic properties using the name **BarWindowFineGridColor**. The data type is LONG.

**BarWindowForegroundBarGrid property****For foreground diagram only - BarWindowForegroundBarGrid**

Specifies whether the grid lines for the foreground diagram only will be displayed in the selected diagram window.

Value	Explanation
TRUE	The grid lines for the foreground diagram are displayed in the diagram window.
FALSE	The grid lines for all diagrams are displayed in the diagram window.

The attribute can be assigned dynamic properties using the name **BarWindowForegroundBarGrid**. The data type is BOOLEAN.

**BarWindowGapWidth property****Gap width - BarWindowGapWidth**

Specifies the gap between two bars of a bar diagram in % of the bar width.

The attribute can be assigned dynamic properties using the name **BarWindowGapWidth**. The data type is LONG.

**BarWindowGridInBarColor** property**In diagram color - BarWindowGridInBarColor**

Specifies whether the grid lines for the main scaling will be displayed in the color of the bars.

Value	Explanation
TRUE	The grid lines are displayed in the color of the bars.
FALSE	The grid lines are displayed with the color set in the "Color" field.

The attribute can be assigned dynamic properties using the name **BarWindowGridInBarColor**. The data type is BOOLEAN.

**BarWindowHorizontalGrid** property**For value axes - BarWindowHorizontalGrid**

Enables the display of horizontal grid lines for value axes.

Value	Explanation
TRUE	Display of horizontal grids for value axes is enabled.
FALSE	Display of horizontal grid lines for value axes is disabled.

The attribute can be assigned dynamic properties using the name **BarWindowHorizontalGrid**.

**BarWindowIndex** property**BarWindowIndex**

References a configured diagram. Using this attribute, you can assign the values of other attributes to a specific diagram.

Valid values for "BarWindowIndex" are between 0 and "BarWindowCount" minus 1. The "BarWindowCount" attribute specifies the number of configured diagrams.

The "BarWindowIndex" attribute can be assigned dynamic properties using the attribute **BarWindowRepos**. The data type is LONG.

**BarWindowName** property**Object name - BarWindowName**

Specifies the name of the selected diagram window.

The "BarWindowName" attribute can be assigned dynamic properties using the attribute **BarWindowRename**. The data type is STRING.

## BarWindowRemove property

### Remove - BarWindowRemove

Removes the selected diagram window from the list.

The attribute can be assigned dynamic properties using the name **BarWindowRemove**. The data type is STRING.

## BarWindowRename property

### BarWindowRename

Renames the diagram window, which is referenced using the "BarWindowIndex" attribute.

The attribute can be assigned dynamic properties using the name **BarWindowRename**. You can use "BarWindowRename" to also assign dynamic properties to the "BarWindowName" attribute. The data type is STRING.

## BarWindowRepos property

### Up/down - BarWindowRepos

Changes the order of the diagram windows. "Up" and "Down" move the selected diagram windows up and down in the list.

The order in the list determines the position in the Control. The first diagram window is displayed at the bottommost position, the last diagram window is displayed at the topmost position.

The attribute can be assigned dynamic properties using the name **BarWindowRepos**. The data type is LONG.

## BarWindowSeriesOverlap property

### Overlap - BarWindowBarOverlap

Specifies the overlap of various bars of a time instant in % of the bar width.

The attribute can be assigned dynamic properties using the name **BarWindowBarOverlap**. The data type is LONG.

## BarWindowSpacePortion property

### Proportional area - BarWindowSpacePortion

Specifies the portion of the selected diagram window for the display in the control.

The attribute can be assigned dynamic properties using the name **BarWindowSpacePortion**. The data type is LONG.

### BarWindowVerticalGrid property

#### For time axes- BarWindowVerticalGrid

Enables the display of vertical grid lines for time axes.

Value	Explanation
TRUE	Display of vertical grid lines for time axes is enabled.
FALSE	Display of vertical grid lines for time axes is disabled.

The attribute can be assigned dynamic properties using the name **BarWindowVerticalGrid**.

### BarWindowVisible property

#### Diagram window - BarWindowVisible

The list shows the diagram windows you have created.

Select the diagram windows in the list that you want to display in the control.

Click on an entry in the list to adapt the properties of the bar display and the grid lines.

The attribute can be assigned dynamic properties using the name **BarWindowVisible**. The data type is BOOLEAN.

### BarWidth Property

#### Description

Defines or returns the width of the bar in pixels.

#### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

### BasePicReferenced Property

#### Description

TRUE, when the picture assigned in the object status display should be saved. Otherwise, only the associated object reference is saved. Read only access.

**See also**

Status display (Page 199)  
ScreenItem Object (Page 125)

**BasePicTransColor Property****Description**

Defines or returns which color of the assigned bitmap object (.bmp, .dib) should be set to "transparent". LONG Write/Read Access.  
The color is only set to "Transparent" if the value of the "BasePicUseTransColor" property is "True".

**See also**

Status display (Page 199)  
ScreenItem Object (Page 125)

**BasePicture Property****Description**

Returns the basic picture for the object status display. Read-only access.  
The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.  
In this context, the "BasePicReferenced" property defines whether the basic picture should be saved together with the object status display or referenced.

**See also**

Status display (Page 199)  
ScreenItem Object (Page 125)

**BasePicUseTransColor Property****Description**

TRUE, when the configured color ("BasePicTransColor" property) of the bitmap objects should be set to "transparent". BOOLEAN write-read access.

**See also**

Status display (Page 199)  
ScreenItem Object (Page 125)

## BaseScreenName Property

### Function

Defines or returns the current basic picture.

STRING (write-read access)

A picture change is executed using the

```
HMIRuntime.BaseScreenName = (<Serverpräfix>::)<Neues Grundbild>
```

command.

When reading out the "BaseScreenName" property, only the picture name without server prefix is returned.

---

#### Note

Always enter picture names without the extension "PDL" for reasons of compatibility with future versions.

---

### Example:

The following example executes a picture change to "bild1.pdl":

```
HMIRuntime.BaseScreenName = "bild1"
```

### See also

[ScreenItem Object \(Page 125\)](#)

[HMIRuntime Object \(Page 118\)](#)

## BaseY Property

### Description

Defines or returns the vertical distance of the bottom bar edge to the top edge of the object field.

### See also

[3D Bar \(Page 169\)](#)

[ScreenItem Object \(Page 125\)](#)

## BaseX Property

### Description

Defines or returns the horizontal distance of the right bar edge to the left edge of the object field in pixels.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## Be - Bl

## BeginTime Property

### Description

#### WinCC Online Trend Control

The "Index" property references a pair of columns. "BeginTime" defines the start time for displaying this column pair. Write/Read access.

#### WinCC Online Trend Control

The "Index" property references a trend. "BeginTime" defines the start time for displaying this trend. Whether the information is evaluated is dependent on the "TimeRange" and "CommonX" properties.

Use the "yyyy-mm-dd hh:mm:ss" format when creating a dynamic time range.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## BeginValue Property

### Description

The "Index" property references a trend. "BeginValue" defines the lower limit of the value range to be displayed for the trend. Whether the information is evaluated is dependent on the "Autorange" and "CommonY" properties.

## See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## BeginX Property

### Description

Defines or returns the lower limit of the X-axis of a trend referenced with the "Index" property. Whether the information is evaluated is dependent on the "AutorangeX" and "CommonX" properties.

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## BeginY Property

### Description

Defines or returns the lower limit of the Y-axis of a trend referenced with the "Index" property. Whether the information is evaluated is dependent on the "AutorangeY" and "CommonY" properties.

## See also

ScreenItem Object (Page 125)

WinCC Function Trend Control (before WinCC V7) (Page 288)

## BevelColorDown Property

### Description

Defines the color of the following border sections in the case of 3D representation of the borders:

- with depressed bevel ("BevelStyle" = 1): top and left bevel section
- with raised bevel ("BevelStyle" = 2): bottom and right bevel section

## See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)



## BevelColorUp Property

### Description

Defines the color of the following border sections in the case of 3D representation of the borders:

- with depressed bevel ("BevelStyle" = 1): bottom and right bevel section
- with raised bevel ("BevelStyle" = 2): top and left bevel section

### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## BevelInner Property

### Description

Defines or returns the appearance of the inner part of the object bevel. Write/Read access.

- 0: inner part not available
- 1: "depressed" appearance
- 2: "raised" appearance
- 3: uniform gray border
- 4 or higher: uniformly colored border, border color = background color

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## BevelOuter Property

### Description

Defines or returns the appearance of the outer part of the object bevel. Write/Read access.

- 0: inner part not available
- 1: "depressed" appearance
- 2: "raised" appearance
- 3: uniform gray border
- 4 or higher: uniformly colored border, border color = background color

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

### BevelWidth Property

#### Description

Defines or returns the border width for the inner part of the border (inner bevel) and for the outer border part (outer bevel) in pixels. Write/Read access.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

### BitNumber Property

#### Description

Defines or returns the bit whose status must change in order to trigger a change of value. The tag used must be of the type BYTE, WORD or DWORD.

### See also

Text list (Page 196)

ScreenItem Object (Page 125)

### BlinkColor Property

#### Description

Defines the color of the icon in the flash picture. LONG write-read access.

### See also

HMI Symbol Library (Page 239)

ScreenItem Object (Page 125)

**BlinkMode property****Flash mode (BlinkMode)**

Specifies the flash mode of the icon in runtime.

The following settings are available:

Value	Description	Comments
0	No flashing	The icon does not flash.
1	Hidden	The icon flashes in the background color.
2	Shadow	The icon flashes with shading in the foreground color.
3	Solid	The icon flashes in the foreground color.

The attribute can be assigned dynamic properties by means of the name **BlinkMode**. The data type is LONG.

**BlinkSpeed property****Flash rate (BlinkSpeed)**

Specifies the length of the icon flash interval in Runtime.

The following settings are available:

Value	Description	Comments
250	Fast	Flash interval of 250 ms.
500	Medium	Flash interval of 500 ms.
1000	Slow	Flash interval of 1000 ms.

The attribute can be assigned dynamic properties by means of the name **BlinkSpeed**. You can also use other values. The data type is LONG.

**BlockAlign property****Block alignment - BlockAlign**

Defines the mode of aligning the caption of blocks in column headers.

The following settings are available:

Value	Description	Explanation
0	left	The block caption is left justified.
1	centered	The block caption is aligned to center.
2	right	The block caption is right justified.

The attribute can be assigned dynamic properties by means of the name **BlockAlign**. The data type is LONG.

## BlockAutoPrecisions property

### Decimal places automatic - BlockAutoPrecisions

Enables automatic setting of the decimal precision.

Value	Explanation
TRUE	The decimal precision is defined automatically. The value in the "Decimal places" field is disabled.
FALSE	The value in the "Decimal places" field is enabled.

The attribute can be assigned dynamic properties by means of the name **BlockAutoPrecisions**. The data type is BOOLEAN.

## BlockCaption property

### Caption - BlockCaption

Defines the caption of the column header in the control for the selected message block.

The caption is active in all Runtime languages.

The attribute can be assigned dynamic properties by means of the name **BlockCaption**. The data type is STRING.

## BlockCount property

### BlockCount

Specifies the number of blocks to be made available as columns for the control.

The attribute can be assigned dynamic properties by means of the name **BlockCount**. The data type is LONG.

## BlockDateFormat property

### Date format - BlockDateFormat

Defines the date format for visualization.

The following date formats are available:

Value	Explanation
Automatic	The date format is set automatically.
dd.MM.yy	Day.Month.Year, e.g. 24.12.07.
dd.MM.yyyy	Day.Month.Year, e.g. 24.12.2007.
dd/MM/yy	Day/Month/Year, e.g. 24/12/07.
dd/MM/yyyy	Day/Month/Year, e.g. 24/12/2007.

The attribute can be assigned dynamic properties by means of the name **BlockDateFormat**. The data type is STRING.

### BlockExponentialFormat property

#### Exponential notation - BlockExponentialFormat

Specifies exponential notation for the display of values of a selected block.

Value	Explanation
TRUE	The values are displayed with exponential notation.
FALSE	The values are displayed with decimal notation.

The attribute can be assigned dynamic properties by means of the name **BlockExponentialFormat**. The data type is BOOLEAN.

### BlockHideText property

#### Content as text - BlockHideText

Enables the textual display of the content of a selected block.

Value	Explanation
TRUE	The content is not displayed in text format. The option is disabled.
FALSE	The content is displayed in text format. The option is enabled.

The attribute can be assigned dynamic properties by means of the name **BlockHideText**. The data type is BOOLEAN.

### BlockHideTitleText property

#### Title as text - BlockHideTitleText

Enables the display of the header of a selected block in text format.

Value	Explanation
TRUE	The header is not displayed in text format. The option is disabled.
FALSE	The header is displayed in text format. The option is enabled.

The attribute can be assigned dynamic properties by means of the name **BlockHideTitleText**. The data type is BOOLEAN.

## BlockId property

### BlockId

Default assignment of the ID number and of the block in WinCC RulerControl:

Value	Description
0	No block
1	Name
2	Index
3	Designation
4	Display
5	Tag name Y
6	Tag name X
7	Y value
8	X value/time stamp
9	Y value (LL)
10	Time stamp (LL)
11	Y value (UL)
12	Time stamp (UL)
13	Minimum
14	Minimum - Time stamp
15	Maximum
16	Maximum - Time stamp
17	Average
18	Standard deviation
19	Integral
20	Weighted mean value
21	Duration
22	Number of values

The attribute can be assigned dynamic properties by means of the name **BlockID**. The data type is LONG.

## BlockIndex property

### BlockIndex

References a block. Using this attribute you can assign the values of other attributes to a specific block.

Values between 0 and "BlockCount" minus 1 are valid for "BlockIndex". Attribute "BlockCount" defines the number of available blocks.

The attribute can be assigned dynamic properties by means of the name **BlockIndex**. The data type is LONG.

**BlockLength property****Length in characters - BlockLength**

Specifies the column width for a selected block.

The attribute can be assigned dynamic properties by means of the name **BlockLength**. The data type is LONG.

**BlockName property****Object name - BlockName**

Displays the name of the block selected. You cannot edit this name.

The attribute can be assigned dynamic properties by means of the name **BlockName**. The data type is STRING.

**BlockPrecisions property****Decimal places - BlockPrecisions**

Specifies the number of decimal places of the values in the selected column. You can only enter the value if the "Automatic" option is disabled.

The attribute can be assigned dynamic properties by means of the name **BlockPrecisions**. The data type is SHORT.

**BlockShowDate property****Display date - BlockShowDate**

Specifies if the "Time" block is displayed with time and date in a field.

Value	Explanation
TRUE	The date and time are displayed. The date format is defined in the "Date format" field.
FALSE	The time is displayed.

The attribute can be assigned dynamic properties by means of the name **BlockShowDate**. The data type is BOOLEAN.

**BlockShowIcon property**

Content as icon - **BlockShowIcon**

Enables the display of the content of a selected block as icon. This function is only available in WinCC Alarm Control.

Value	Explanation
TRUE	The content is visualized as icon.
FALSE	The content is not visualized as icon.

The attribute can be assigned dynamic properties by means of the name **BlockShowIcon**. The data type is BOOLEAN.

### BlockShowTitleIcon property

#### Title as icon - BlockShowTitleIcon

Enables the display of the header of a selected block as icon. This function is only available in WinCC Alarm Control.

Value	Explanation
TRUE	The header is displayed as icon.
FALSE	The header is not displayed as icon.

The attribute can be assigned dynamic properties by means of the name **BlockShowTitleIcon**. The data type is BOOLEAN.

### BlockTimeFormat property

#### Time format - BlockTimeFormat

Defines the time format to be used for visualization.

The following time formats are available:

Value	Explanation
Automatic	The time format is set automatically.
HH:mm:ss.ms	Hours:Minutes:Seconds, e.g. 15:35:44.240.
hh:mm:ss tt	Hours:Minutes:Seconds AM/PM, e.g. 03:35:44 PM.
hh:mm:ss.ms tt	Hours:Minutes:Seconds.Milliseconds AM/PM, e.g. 03:35:44.240 PM.

The attribute can be assigned dynamic properties by means of the name **BlockTimeFormat**. The data type is STRING.

### BlockUseSourceFormat property

#### Use source format - BlockUseSourceFormat



Specifies that the format is inherited from the interconnected control. Here the size of the control, the zoom factor and the value range are taken into consideration to display the optimal number of decimal places.

Value	Explanation
TRUE	The formats are derived from the interconnected control.
FALSE	The formats configured in Ruler Control are used, for example, the display of a precisely specified number of decimal places.

The attribute can be assigned dynamic properties by means of the name **BlockUseSouceFormat**. The data type is BOOLEAN.

## Bo - Bu

### BorderBackColor Property

#### Description

Defines or returns the background color of the line for the object. LONG write-read access. The background color is only visible with the property setting "BorderWidth" > 0.

#### See also

ScreenItem Object (Page 125)

### BorderColor Property

#### Description

Defines or returns the line color for the object. LONG write-read access.

#### See also

ScreenItem Object (Page 125)

### BorderColor property

#### Border color - BorderColor

Specifies the border color. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **BorderColor**. The data type is LONG.

## BorderColorBottom Property

### Description

Defines or returns the border color for the bottom/right part of the object. LONG write-read access.

### See also

ScreenItem Object (Page 125)

Button (Page 201)

Round Button (Page 209)

## BorderColorTop Property

### Description

Defines or returns the border color for the top/left part of the object. LONG write-read access.

### See also

Button (Page 201)

Round Button (Page 209)

ScreenItem Object (Page 125)

## BorderEndStyle Property

### Description

Defines or returns the line end style of the object. LONG write-read access.

### See also

Polyline (Page 158)

Line (Page 154)

ScreenItem Object (Page 125)

## BorderFlashColorOff Property

### Description

Defines or returns the color of the object lines for the flashing status "Off". LONG write-read access.

**See also**

ScreenItem Object (Page 125)

**BorderFlashColorOn Property****Description**

Defines or returns the color of the object lines for the flashing status "On". LONG write-read access.

**See also**

ScreenItem Object (Page 125)

**BorderStyle Property****Description**

Defines or returns the line style for the object. Value range from 0 to 4.

0 = solid line

1 = dashed line

2 = dotted line

3 = dash-dotted line

4 = dash-dot-dot line

**See also**

ScreenItem Object (Page 125)

**BorderWidth Property****Description**

Defines or returns the line weight (in pixels) for the object.

**WinCC Gauge Control:**

Defines or returns the width of the middle border part in pixels.

The object border is composed of three parts. The middle part of the object border is described by the "BorderWidth" property.

The color of the middle border part is in the background color.

## See also

ScreenItem Object (Page 125)

## BorderWidth property

### Border width - BorderWidth

Specifies the line weight of the border in pixels.

The attribute can be assigned dynamic properties by means of the name **BorderWidth**. The data type is LONG.

## BottomConnectedConnectionPointIndex Property

### Description

Specifies or sets the index number of the bottom connecting point.

LONG write-read access.

## See also

Connector (Page 167)

ScreenItem Object (Page 125)

## BottomConnectedObjectName Property

### Description

Specifies or sets the object name of the object which is docked on at the bottom connecting point.

LONG write-read access.

## See also

Connector (Page 167)

ScreenItem Object (Page 125)

## BoxAlignment Property

### Description

TRUE, when the fields are arranged aligned to the right. BOOLEAN write-read access.

## See also

Radio box (Page 207)  
Check box (Page 204)  
ScreenItem Object (Page 125)

## BoxCount Property

### Description

Defines or returns the number of fields. Value range from 0 to 31.

## See also

Radio box (Page 207)  
Check box (Page 204)  
ScreenItem Object (Page 125)

## BoxType Property

### Description

Defines or returns the field type. Value range from 0 to 2:

- 0: Edition
- 1: Input
- 2: I/O field

## See also

Text list (Page 196)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## ButtonColor Property

### Description

Defines or returns the color of the slider. LONG write-read access.

## See also

Slider (Page 212)

ScreenItem Object (Page 125)

## ButtonCommand Property

### Description

Upon changing a value of "ButtonCommand", a message is issued to the WinCC Alarm Control in order to adapt the display in the message window.

Value (hex); value (dec); Retrieved Function:

- 0x00000001; 1; Message list
- 0x00000002; 2; Short-term archive list
- 0x00000004; 4; Long-term archive list
- 0x00200000; 2097152; Lock list
- 0x00000008; 8; Acknowledge central signaling device
- 0x00000010; 16; Single Acknowledgment
- 0x00000020; 32; Group Acknowledge
- 0x00000040; 64; Autoscroll
- 0x00000080; 128; Selection Dialog
- 0x00000100; 256; Lock Dialog
- 0x00000200; 512; Print Message Log
- 0x00000800; 2048; Emergency Acknowledgment
- 0x00001000; 4096; First Message
- 0x00002000; 8192; Last Message
- 0x00004000; 16384; Next Message
- 0x00008000; 32768; Previous Message
- 0x00010000; 65536; Infotext Dialog
- 0x00020000; 131072; Comments Dialog
- 0x00040000; 262144; Loop in Alarm
- 0x00100000; 1048576; Print current view
- 0x00400000; 4194304; Lock/unlock message
- 0x00800000; 8388608; Sorting Dialog
- 0x01000000; 16777216; Time base dialog
- 0x02000000; 33554432; Hit list
- 0x04000000; 67108864; List of messages to be hidden

- 0x08000000; 134217728; Show/hide message
- 0x10000000; 268435456; Display option dialog

## See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## Button1MessageClasses property

### Message Types for Button 1 (Button1MessageClasses)

Define one or more message events for displaying the first button in the group display. This is done by entering the numbers of the bits in the collect value. The display of the message events is configured in the "Message Types" property group.

If you want to assign several message events, separate the numbers with a comma. The sequence of the assignment defines the priority. If there are more than one selected event for one button, the event that has been entered first is displayed.

One event can be displayed simultaneously in more than one button.

The "Message Types for Button 1" attribute can be assigned dynamic properties with the name "Button1MessageClasses".

## Button2MessageClasses property

### Message Types for Button 2 (Button2MessageClasses)

For displaying both buttons, define one or more message events in the group display. This is done by entering the number of the bit in the collect value. The display of the message events is configured in the "Message Types" property group.

If you want to assign several message events, separate the numbers with a comma. The sequence of the assignment defines the priority. If there are more than one selected event for one button, the event that has been entered first is displayed.

The same event can be visualized simultaneously in several buttons.

The "Message Types for Button 2" attribute can be assigned dynamic properties with the name "Button2MessageClasses".

## Button3MessageClasses property

### Message Types for Button 3 (Button3MessageClasses)

For displaying the third button, define one or more message events in the group display. This is done by entering the number of the bit in the collect value. The display of the message events is configured in the "Message Types" property group.

If you want to assign several message events, separate the numbers with a comma. The sequence of the assignment defines the priority. If there are more than one selected event for one button, the event that has been entered first is displayed.

The same event can be visualized simultaneously in several buttons.

The "Message Types for Button 3" attribute can be assigned dynamic properties with the name "Button3MessageClasses".

### **Button4MessageClasses property**

#### **Message Types for Button 4 (Button4MessageClasses)**

For displaying the fourth button, define one or more message events in the group display. This is done by entering the number of the bit in the collect value. The display of the message events is configured in the "Message Types" property group.

If you want to assign several message events, separate the numbers with a comma. The sequence of the assignment defines the priority. If there are more than one selected event for one button, the event that has been entered first is displayed.

The same event can be visualized simultaneously in several buttons.

The "Message Types for Button 4" attribute can be assigned dynamic properties with the name "Button4MessageClasses".

### **Button5MessageClasses property**

#### **Message Types for Button 5 (Button5MessageClasses)**

For displaying the fifth button, define one or more message events in the group display. This is done by entering the number of the bit in the collect value. The display of the message events is configured in the "Message Types" property group.

If you want to assign several message events, separate the numbers with a comma. The sequence of the assignment defines the priority. If there are more than one selected event for one button, the event that has been entered first is displayed.

The same event can be visualized simultaneously in several buttons.

The "Message Types for Button 5" attribute can be assigned dynamic properties with the name "Button5MessageClasses".

### **Button6MessageClasses property**

#### **Message Types for Button 6 (Button6MessageClasses)**

For displaying the sixth button, define one or more message events in the group display. This is done by entering the number of the bit in the collect value. The display of the message events is configured in the "Message Types" property group.

If you want to assign several message events, delimit the numbers with a comma. The order of assignment defines the priority. If there are more than one selected event for one button, the event that has been entered first is displayed.

The same event can be visualized simultaneously in several buttons.

The "Message Types for Button 6" attribute can be assigned dynamic properties with the name "Button6MessageClasses".



## Button7MessageClasses property

### Message Types for Button 7 (Button7MessageClasses)

For displaying the seventh button, define one or more message events in the group display. This is done by entering the number of the bit in the collect value. The display of the message events is configured in the "Message Types" property group.

If you want to assign several message events, delimit the numbers with a comma. The order of assignment defines the priority. If there are more than one selected event for one button, the event that has been entered first is displayed.

The same event can be visualized simultaneously in several buttons.

The "Message Types for Button 7" attribute can be assigned dynamic properties with the name "Button7MessageClasses".

## Button8MessageClasses property

### Message Types for Button 8 (Button8MessageClasses)

For displaying the eighth button, define one or more message events in the group display. This is done by entering the number of the bit in the collect value. The display of the message events is configured in the "Message Types" property group.

If you want to assign several message events, delimit the numbers with a comma. The order of assignment defines the priority. If there are more than one selected event for one button, the event that has been entered first is displayed.

The same event can be visualized simultaneously in several buttons.

The "Message Types for Button 8" attribute can be assigned dynamic properties with the name "Button8MessageClasses".

## Button1Width Property

### Description

Defines or returns the width of the Button 1 in pixels.  
When the SameSize property is set to TRUE, all the buttons are specified the same width.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## Button2Width Property

### Description

Defines or returns the width of the Button 2 in pixels.  
When the SameSize property is set to TRUE, all the buttons are specified the same width.

## See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## Button3Width Property

### Description

Defines or returns the width of the Button 3 in pixels.  
When the SameSize property is set to TRUE, all the buttons are specified the same width.

## See also

ScreenItem Object (Page 125)  
Group Display (Page 194)

## Button4Width Property

### Description

Defines or returns the width of the Button 4 in pixels.  
When the SameSize property is set to TRUE, all the buttons are specified the same width.

## See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## 1.14.4.4 C

## Ca - Cl

## Caption Property

### Description

#### **Application and picture windows**

TRUE, when the application or picture window has a title bar in Runtime. Read only access.

The Caption property must be set to TRUE when the application or picture window should have Maximize and Close buttons.

### Controls before WinCC V7

Defines or returns the text to be displayed on the label on the button or in the title bar (Online Trend Control and Online Table Control). Write/Read access.

#### See also

Controls (Page 218)

Picture Window (Page 179)

Application Window (Page 173)

ScreenItem Object (Page 125)

#### Caption property

##### Text - Caption

Defines the text of the window caption.

The attribute can be assigned dynamic properties by means of the name **Caption**. The data type is STRING.

#### CaptionColor Property

##### Description

Defines or returns the color of the element labeling. LONG write-read access.

#### See also

ScreenItem Object (Page 125)

WinCC Gauge Control (Page 254)

#### CaptionFont Property

##### Description

Returns the values for font, font style and font size as well as the "Underline" and "Strikethrough" effects for the element labeling. Read only access.

#### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## CaptionOffset Property

### Description

Defines or returns the distance of the element labeling in relation to the top edge of the object. The element labeling can only be positioned along the vertical diameter of the graduated scale disk. The value of the attribute is related to the height of the object and is measured from the top edge of the object to the base of the text. Write/Read access.

The value range is 0 to 1:

0: The base of the text is at the top limit of the object. The text is no longer visible because it is outside the object.

1: The base of the text is at the bottom limit of the object.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## CaptionText Property

### Description

Defines or returns the window title which is displayed in Runtime. The Caption property must be set to TRUE.

### See also

Picture Window (Page 179)

ScreenItem Object (Page 125)

## CellCount property

### CellCount

Specifies the number of cells of the Row object of a Table Control. The number of cells corresponds to the number of columns.

## CellCut property (before WinCC V7)

### Description

TRUE, when the content of the cells in a message line should be cut if the column width is too small. BOOLEAN write-read access.

**See also**

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

**CellCut property****Shorten contents - CellCut**

Shortens cell contents if the cell width is insufficient.

Value	Explanation
TRUE	Enables shortening of cell contents.
FALSE	Disables shortening of cell contents.

The attribute can be assigned dynamic properties by means of the name **CellCut**. The data type is BOOLEAN.

**CellSpaceBottom property****CellSpaceBottom**

Defines the bottom margin of the table cells.

The attribute can be assigned dynamic properties by means of the name **CellSpaceBottom**. The data type is LONG.

**CellSpaceLeft property****CellSpaceLeft**

Defines the left indent of the table cells.

The attribute can be assigned dynamic properties by means of the name **CellSpaceLeft**. The data type is LONG.

**CellSpaceRight property****CellSpaceRight**

Defines the right indent of the table cells.

The attribute can be assigned dynamic properties by means of the name **CellSpaceRight**. The data type is LONG.

## CellSpaceTop property

### CellSpaceTop

Defines the top margin of the table cells.

The attribute can be assigned dynamic properties by means of the name **CellSpaceTop**. The data type is LONG.

## CellText property

### CellText

Returns the contents of a cell as a string. The cell is determined from the column number of the row object, e.g. `CellText(3)` for the third column. Numbering runs from "1" to "CellCount".

## CenterColor Property

### Description

Defines or returns the color of the circular center of the scale (cover of the pointer axis). LONG write-read access.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## CenterScale Property

### Description

Defines or returns the diameter of the circular center of the scale (cover of the pointer axis) in relation to the smaller value of the geometric width and height attributes. Write/Read access.

The value range is 0.03 to 1:

1: The diameter corresponds to the smaller value of the "Width" or "Height" geometric values.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## CheckAlarmHigh Property

### Description

TRUE, when the "AlarmHigh" limit value is to be monitored. BOOLEAN write/read access. The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "AlarmHigh", "ColorAlarmHigh" and "TypeAlarmHigh" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## CheckAlarmLow Property

### Description

TRUE, when the "AlarmLow" limit value is to be monitored. BOOLEAN write/read access. The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "AlarmLow", "ColorAlarmLow" and "TypeAlarmLow" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## CheckLimitHigh4 Property

### Description

TRUE, when the "Reserve 4" upper limit value should be monitored. BOOLEAN write/read access. The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "LimitHigh4", "ColorLimitHigh4" and "TypeLimitHigh4" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## CheckLimitHigh5 Property

### Description

TRUE, when the "Reserve 5" upper limit value should be monitored. BOOLEAN write/read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "LimitHigh5", "ColorLimitHigh5" and "TypeLimitHigh5" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## CheckLimitLow4 Property

### Description

TRUE, when the "Reserve 4" lower limit value should be monitored. BOOLEAN write/read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "LimitLow4", "ColorLimitLow4" and "TypeLimitLow4" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## CheckLimitLow5 Property

### Description

TRUE, when the "Reserve 5" lower limit value should be monitored. BOOLEAN write/read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "LimitLow5", "ColorLimitLow5" and "TypeLimitLow5" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)



## CheckToleranceHigh Property

### Description

TRUE, when the "ToleranceHigh" limit value is to be monitored. BOOLEAN write/read access. The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "ToleranceHigh", "ColorToleranceHigh" and "TypeToleranceHigh" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## CheckToleranceLow Property

### Description

TRUE, when the "ToleranceLow" limit value is to be monitored. BOOLEAN write/read access. The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "ToleranceLow", "ColorToleranceLow" and "TypeToleranceLow" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## CheckWarningHigh Property

### Description

TRUE, when the "WarningHigh" limit value is to be monitored. BOOLEAN write/read access. The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "WarningHigh", "ColorWarningHigh" and "TypeWarningHigh" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## CheckWarningLow Property

### Description

TRUE, when the "WarningLow" limit value is to be monitored. BOOLEAN write/read access. The limit value, the display on reaching the limit value and the type of evaluation are defined by means of the "WarningLow", "ColorWarningLow" and "TypeWarningLow" properties.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ClearOnError Property

### Description

TRUE, when the field entry is automatically deleted in the case of invalid input. BOOLEAN write-read access.

### See also

I/O Field (Page 184)

ScreenItem Object (Page 125)

## ClearOnNew Property

### Description

TRUE, when the field entry is deleted as soon as the I/O field has the focus. BOOLEAN write-read access.

### See also

I/O Field (Page 184)

ScreenItem Object (Page 125)

## Closeable property (before WinCC V7)

### Description

TRUE, when the window can be closed in Runtime. BOOLEAN write-read access.

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)  
 WinCC Online Trend Control (before WinCC V7) (Page 295)  
 WinCC Online Table Control (before WinCC V7) (Page 292)  
 ScreenItem Object (Page 125)

**Closeable property****Closeable**

Defines whether the control can be closed in Runtime.

Value	Explanation
TRUE	The control can be closed in Runtime.
FALSE	The control cannot be closed in Runtime.

The attribute can be assigned dynamic properties by means of the name **Closeable**. The data type is BOOLEAN.

**CloseButton Property****Description**

TRUE, when the window is provided with a "Close" button. Read only access.

**See also**

Picture Window (Page 179)  
 Application Window (Page 173)  
 ScreenItem Object (Page 125)

**Co****CoarseGrid Property****Description**

TRUE when the value axis is scaled by long tick marks. The distance between two long tick marks can be changed using the "CoarseGridValue" property. BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

### CoarseGridX Property

#### Description

TRUE, when the X-axis graduation is scaled by long tick marks. The distance between two long tick marks can be changed using the "CoarseGridValueX" property. BOOLEAN write-read access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

### CoarseGridY Property

#### Description

TRUE, when the Y-axis graduation is scaled by long tick marks. The distance between two long tick marks can be changed using the "CoarseGridValueY" property. BOOLEAN write-read access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

### CoarseGridValue Property

#### Description

Defines the distance between two long tick marks in the scale. Whether the information is evaluated is dependent on the value of the "CoarseGrid" property.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## CoarseGridValueX Property

### Description

Defines or returns the distance between two long tick marks on the graduation scale of the X-axis. Whether the information is evaluated is dependent on the value of the "CoarseGridX" property.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## CoarseGridValueY Property

### Description

Defines or returns the distance between two long tick marks on the graduation scale of the Y-axis. Whether the information is evaluated is dependent on the value of the "CoarseGridY" property.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## CollectValue Property

### Description

Contains the respective status of the active message class in Runtime as the start value. LONG write/read access.

The value can be determined from the group display of hierarchically subordinate pictures by making it dynamic using a tag.

### See also

Group Display (Page 194)

ScreenItem Object (Page 125)

## ColMove Property

### Description

TRUE, when the arrangement of columns can be changed. BOOLEAN write-read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## Color Property

### Description

The "Index" property references a column pair or a trend. "Color" defines the color of the font in the column or the trend. LONG write-read access. The color is defined as an RGB value.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## ColorAlarmHigh Property

### Description

Defines or returns the bar color for the "AlarmHigh" limit value. LONG write/read access. The "CheckAlarmHigh" property must have been set to TRUE if the bar color should change on reaching the limit value.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorAlarmLow Property

### Description

Defines or returns the bar color for the "AlarmLow" limit value. LONG write/read access. The "CheckAlarmLow" property must have been set to TRUE if the bar color should change on reaching the limit value.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorBottom Property

### Description

Defines or returns the color for the bottom/right stop of the slider object. LONG write-read access.

### See also

Slider (Page 212)

ScreenItem Object (Page 125)

## ColorChangeType Property

### Description

TRUE, if the change of color should occur segment by segment in the case of a color change (e.g. on reaching a limit value). If set to FALSE, it defines the change of color for the entire bar. BOOLEAN write-read access.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorLimitHigh4 Property

### Description

Defines or returns the color for the "Reserve 4" upper limit value. LONG write/read access. The "CheckLimitHigh4" property must have been set to TRUE if the bar color should change on reaching the limit value.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorLimitHigh5 Property

### Description

Defines or returns the color for the "Reserve 5" upper limit value. LONG write/read access. The "CheckLimitHigh5" property must have been set to TRUE if the bar color should change on reaching the limit value.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorLimitLow4 Property

### Description

Defines or returns the color for the "Reserve 4" lower limit value. LONG write/read access. The "CheckLimitLow4" property must have been set to TRUE if the bar color should change on reaching the limit value.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)



## ColorLimitLow5 Property

### Description

Defines or returns the color for the "Reserve 5" lower limit value. LONG write/read access. The "CheckLimitLow5" property must have been set to TRUE if the bar color should change on reaching the limit value.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorToleranceHigh Property

### Description

Defines or returns the color for the "ToleranceHigh" upper limit value. LONG write/read access. The "CheckToleranceHigh" property must have been set to TRUE if the bar color should change on reaching the limit value.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorToleranceLow Property

### Description

Defines or returns the color for the "ToleranceLow" lower limit value. LONG write/read access. The "CheckToleranceLow" property must have been set to TRUE if the bar color should change on reaching the limit value.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorTop Property

### Description

Defines or returns the color for the top/left stop of the slider object. LONG write-read access.

## See also

Slider (Page 212)

ScreenItem Object (Page 125)

## ColorWarningHigh Property

### Description

Defines or returns the color for the "WarningHigh" upper limit value. LONG write/read access. The "CheckWarningHigh" property must have been set to TRUE if the bar color should change on reaching the limit value.

## See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColorWarningLow Property

### Description

Defines or returns the color for the "WarningLow" lower limit value. LONG write/read access. The "CheckWarningLow" property must have been set to TRUE if the bar color should change on reaching the limit value.

## See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ColTitle Property

### Description

TRUE, when the columns in the message window should have a title bar. BOOLEAN write-read access.

## See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## ColumnAdd property

### Apply - ColumnAdd

Copies the selected column from the list of existing columns to the list of selected columns.

The attribute can be assigned dynamic properties by means of the name **ColumnAdd**. The data type is STRING.

## ColumnAlias property

### ColumnAlias

Defines the alias specified in the user archive for the column name.

The attribute can be assigned dynamic properties by means of the name **ColumnAlias**. The data type is STRING.

## ColumnAlign property

### Alignment - ColumnAlign

Specifies the mode of alignment of a selected column.

The following settings are available:

Value	Description	Explanation
0	left	The selected column is aligned left.
1	centered	The selected column is aligned to center.
2	right	The selected column is aligned right.

The attribute can be assigned dynamic properties by means of the name **ColumnAlign**. The data type is LONG.

## ColumnAutoPrecisions property

### Decimal places automatic - ColumnAutoPrecisions

Enables automatic setting of the decimal precision.

Value	Explanation
TRUE	The decimal precision is defined automatically. The value in the "Decimal places" field is disabled.
FALSE	The value in the "Decimal places" field is enabled.

The attribute can be assigned dynamic properties by means of the name **ColumnAutoPrecisions**. The data type is BOOLEAN.

## ColumnCaption property

### Caption - ColumnCaption

Sets the caption for a selected column.

The attribute can be assigned dynamic properties by means of the name **ColumnCaption**. The data type is STRING.

## ColumnCount property

### ColumnCount

Defines the number of columns configured.

The attribute can be assigned dynamic properties by means of the name **ColumnCount**. The data type is LONG.

## ColumnDateFormat property

### Date format - ColumnDateFormat

Defines the date format for visualization.

The following date formats are available:

Value	Explanation
Automatic	The date format is set automatically.
dd.MM.yy	Day.Month.Year, e.g. 24.12.07.
dd.MM.yyyy	Day.Month.Year, e.g. 24.12.2007.
dd/MM/yy	Day/Month/Year, e.g. 24/12/07.
dd/MM/yyyy	Day/Month/Year, e.g. 24/12/2007.

The attribute can be assigned dynamic properties by means of the name **ColumnDateFormat**. The data type is STRING.

## ColumnDMVarName property

### ColumnDMVarName

Defines the name of the tag you assigned to the column in the user archive.

The attribute can be assigned dynamic properties by means of the name **ColumnDMVarName**. The data type is STRING.

**ColumnExponentialFormat property****Exponential notation - ColumnExponentialFormat**

Sets exponential notation for the display of values of a selected column.

Value	Explanation
TRUE	The values are displayed with exponential notation.
FALSE	The values are displayed with decimal notation.

The attribute can be assigned dynamic properties by means of the name **ColumnExponentialFormat**. The data type is BOOLEAN.

**ColumnFlagNotNull property****ColumnFlagNotNull**

Specifies whether the user archive field assigned to the column must have a value.

Value	Explanation
Yes	The column must have a value.
No	The column can have a value.

The attribute cannot be dynamized.

**ColumnFlagUnique property****ColumnFlagUnique**

Specifies whether the user archive field assigned to the column must have a unique value. Values in this column must not be redundant.

Value	Explanation
TRUE	The column must have a unique value.
FALSE	The column must not have a unique value.

The attribute cannot be dynamized.

**ColumnHideText property****Content as text - ColumnHideText**

Defines textual display of the contents of a selected column.

Value	Explanation
TRUE	The content is not displayed in text format. The option is disabled.
FALSE	The content is displayed in text format. The option is enabled.

The attribute can be assigned dynamic properties by means of the name **ColumnHideText**. The data type is BOOLEAN.

## ColumnHideTitleText property

### Text header - ColumnHideTitleText

Sets textual display of the header of a selected column.

Value	Explanation
TRUE	The header is not displayed in text format. The option is disabled.
FALSE	The header is displayed in text format. The option is enabled.

The attribute can be assigned dynamic properties by means of the name **ColumnHideTitleText**. The data type is BOOLEAN.

## ColumnId property

### ColumnId

Default assignment of the ID number and column in the WinCC control:

The attribute can be assigned dynamic properties by means of the name **ColumnId**. The data type is LONG.

## ColumnIndex property

### ColumnIndex

References a control column. Using this attribute you can assign the values of other properties to a specific column.

Values between 0 and "ColumnCount" minus 1 are valid for "ColumnIndex"; the attribute "ColumnCount" defines the number of available columns.

The "ColumnIndex" attribute can be assigned dynamic properties by means of attribute **ColumnIndex**. The data type is LONG.

## ColumnInspectorView property

### ColumnInspectorView

Specifies whether the diagnostic data in the detail view are displayed in columns instead of rows.

The attribute can be assigned dynamic properties using the name **ColumnInspectorView**. The data type is BOOLEAN.

## ColumnLeadingZeros property

### With leading zeros - ColumnLeadingZeros

Enables the display of values with leading zeros for the column selected. Use "Number of digits" or "ColumnLeadingZeros" to specify the number of leading zeros. The maximum number is "11". No leading zeros are displayed with the value "0". The "With leading zeros" option is deactivated.

The attribute can be assigned dynamic properties by means of the name **ColumnLeadingZeros**. The data type is LONG.

## ColumnLength property

### Length in Characters - ColumnLength

Specifies the width of a selected column.

The attribute can be assigned dynamic properties by means of the name **ColumnLength**. The data type is LONG.

## ColumnMaxValue property

### ColumnMaxValue

Defines the maximum column value specified in the user archive.

The attribute can be assigned dynamic properties by means of the name **ColumnMaxValue**. The data type is STRING.

## ColumnMinValue property

### ColumnMinValue

Defines the minimum column value specified in the user archive.

The attribute can be assigned dynamic properties by means of the name **ColumnMinValue**. The data type is STRING.

## ColumnName property

### ColumnName

Defines the name of the column which is referenced by means of "ColumnIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **ColumnName**. The data type is STRING.

## ColumnPosition property

### ColumnPosition

Displays the field position defined in the user archive.

The attribute can be assigned dynamic properties by means of the name **ColumnPosition**. The data type is LONG.

## ColumnPrecisions property

### Decimal places - ColumnPrecisions

Specifies the number of decimal places of the values in the selected column. You can only enter the value if the "Automatic" option is disabled.

The attribute can be assigned dynamic properties by means of the name **ColumnPrecisions**. The data type is SHORT.

## ColumnReadAccess property

### ColumnReadAccess

Defines authorizations for read access to the column as specified in the user archive. The number corresponds with the number assigned to the authorization in the "User Administrator" editor.

The attribute cannot be dynamized.

## ColumnReadOnly property

### Write protected - ColumnReadOnly

Sets the write protection of a selected column.

Value	Explanation
TRUE	This column is write protected.
FALSE	This column is not write protected. You can edit the column values in Runtime by activating the "Change" option in the General" tab.

The attribute can be assigned dynamic properties by means of the name **ColumnReadOnly**. The data type is BOOLEAN.

## ColumnRemove property

### Remove - ColumnRemove

Cuts selected columns from the list of selected columns and pastes these to the list of available columns.



The attribute can be assigned dynamic properties by means of the name **ColumnRemove**. The data type is STRING.

## ColumnRepos property

### Up/Down - ColumnRepos

Changes the order of columns. "Up" and "Down" move the column selected up or down in the list. This moves the column towards the front or towards the back.

The attribute can be assigned dynamic properties by means of the name **ColumnRepos**. The data type is LONG.

## ColumnResize property

### Width can be resized - ColumnResize

Enables changes to the width of columns.

Value	Explanation
TRUE	You can change the width of the columns.
FALSE	You cannot change the width of the columns.

The attribute can be assigned dynamic properties by means of the name **ColumnResize**. The data type is BOOLEAN.

## ColumnScrollbar properties

### Column scroll bars - ColumnScrollbar

Enables the display of column scroll bars.

The following settings are available:

Value	Description	Explanation
0	no	Column scroll bars are not displayed.
1	as required	Column scroll bars are displayed if vertical space requirements of the control are greater than the actually available display area.
2	always	Column scroll bars are always displayed.

The attribute can be assigned dynamic properties by means of the name **ColumnScrollbar**. The data type is LONG.

**ColumnShowDate property****Display date - ColumnShowDate**

Specifies if the "Time" block is displayed with time and date in a field.

Value	Explanation
TRUE	The date and time are displayed. The date format is defined in the "Date format" field.
FALSE	The time is displayed.

The attribute can be assigned dynamic properties by means of the name **ColumnShowDate**. The data type is BOOLEAN.

**ColumnShowIcon property****Content as icon - ColumnShowIcon**

Enables the display the contents of a selected column by means of icon. This function is only available in WinCC Alarm Control.

Value	Explanation
TRUE	The content is visualized as icon.
FALSE	The content is not visualized as icon.

The attribute can be assigned dynamic properties by means of the name **ColumnShowIcon**. The data type is BOOLEAN.

**ColumnShowTitleIcon property****Header as icon - ColumnShowTitleIcon**

Specifies the display of the header of a selected column by means of icon. This function is only available in WinCC Alarm Control.

Value	Explanation
TRUE	The header is displayed as icon.
FALSE	The header is not displayed as icon.

The attribute can be assigned dynamic properties by means of the name **ColumnShowTitleIcon**. The data type is BOOLEAN.

**ColumnsMoveable property****ColumnsMoveable**

Specifies whether the user can move the columns of the control in runtime.

The attribute can be assigned dynamic properties using the name **ColumnsMoveable**. The data type is BOOLEAN.

## ColumnSort property

### ColumnSort

Defines the sorting order of the user archive column referenced in the "ColumnIndex" attribute.

The following settings are available:

Value	Description	Explanation
0	No	No sorting
1	Ascending	Ascending order, starting at the lowest value.
2	Descending	Descending order, starting at the highest value.

The attribute can be assigned dynamic properties by means of the name **ColumnSort**. The data type is LONG.

## ColumnSortIndex property

### ColumnSortIndex

Defines the sorting order of the column referenced in "ColumnIndex". The sorting criterion is removed from "ColumnSort" if you set a "0" value..

The attribute can be assigned dynamic properties by means of the name **ColumnSortIndex**. The data type is LONG.

## ColumnStartValue property

### ColumnStartValue

Defines the column start value specified in the user archive.

The attribute can be assigned dynamic properties by means of the name **ColumnStartValue**. The data type is STRING.

## ColumnStringLength property

### ColumnStringLength

Displays the string length of the column as defined in the user archive.

The attribute can be assigned dynamic properties by means of the name **ColumnStringLength**. The data type is LONG.

**ColumnTimeFormat property****Time format - ColumnTimeFormat**

Defines the time format to be used for visualization.

The following time formats are available:

Value	Explanation
Automatic	The time format is set automatically.
HH:mm:ss.ms	Hours:Minutes:Seconds, e.g. 15:35:44.240.
hh:mm:ss tt	Hours:Minutes:Seconds AM/PM, e.g. 03:35:44 PM.
hh:mm:ss.ms tt	Hours:Minutes:Seconds.Milliseconds AM/PM, e.g. 03:35:44.240 PM.

The attribute can be assigned dynamic properties by means of the name **ColumnTimeFormat**. The data type is STRING.

**ColumnTitleAlign property****Column title alignment - ColumnTitleAlign**

Specifies the type of column title alignment.

The following settings are available:

Value	Description	Explanation
0	left	The column titles are left justified.
1	centered	The column titles are centered.
2	right	The column titles are right justified.
3	Same as table content	The column titles are justified to fit the corresponding column content.

The attribute can be assigned dynamic properties by means of the name **ColumnTitleAlign**. The data type is LONG.

**ColumnTitles property****Show column title - ColumnTitles**

Enables the display of the column header.

Value	Explanation
TRUE	The column header is displayed.
FALSE	The column header is not displayed.

The attribute can be assigned dynamic properties by means of the name **ColumnTitles**. The data type is BOOLEAN.

**ColumnType property****Type - ColumnType**

Displays the data type set in the user archive for a selected column.

The attribute can be assigned dynamic properties by means of the name **ColumnType**. The data type is LONG.

**ColumnType property****ColumnType**

Indicates the associated view of the selected column in the SysDiagControl.

The attribute can be assigned dynamic properties using the name **ColumnType**. The data type is LONG.

**ColumnVisible property****ColumnVisible**

Enables the display of a column referenced by means of "ColumnIndex" attribute.

Value	Explanation
TRUE	The column is displayed.
FALSE	The column is not displayed.

The attribute can be assigned dynamic properties by means of the name **ColumnVisible**. The data type is BOOLEAN.

**ColumnWriteAccess property****ColumnWriteAccess**

Defines authorizations for write access to the column as specified in the user archive. The number corresponds with the number assigned to the authorization in the "User Administrator" editor.

The attribute cannot be dynamized.

**ColWidth Property****Description**

TRUE, when it should be possible to change the widths of the columns in the message window. The width of the columns can only be changed, however, when the "AutoScroll" property is not active. BOOLEAN write-read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

### Command Property

#### Description

TRUE, when updating of the values displayed in the control should be forced.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

### Comment property

#### Description

Reads or sets the Alarm object comment.

### See also

Alarms object (list) (Page 110)

### CommonTime Property

#### Description

TRUE, when a common time column is to be used in the table window. BOOLEAN write-read access.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

## CommonX Property

### Description

TRUE, when the trends in the trend window should be displayed with a common X-axis.  
BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)  
WinCC Function Trend Control (before WinCC V7) (Page 288)  
ScreenItem Object (Page 125)

## CommonY Property

### Description

TRUE, when the trends in the trend window should be displayed with a common Y-axis.  
BOOLEAN write-read access.

### See also

ScreenItem Object (Page 125)  
WinCC Online Trend Control (before WinCC V7) (Page 295)  
WinCC Function Trend Control (before WinCC V7) (Page 288)

## ComputerName property

### Description

Returns the name of the computer on which the alarm object was triggered.  
ComputerName (readonly)

### See also

Alarms object (list) (Page 110)

## Context property

### Description

Reads or sets the alarm object server prefix.

**See also**

Alarms object (list) (Page 110)

**ConnectBarWindows property****Connected diagram window - ConnectBarWindows**

Specifies whether the configured diagram windows are connected. You must have configured several diagram windows for this.

The connected diagram windows have the following properties:

- They can have a common X axis.
- They have a scroll bar.
- The zoom functions for a diagram window affect the connected diagram windows.

Value	Description
TRUE	All configured diagram windows are connected.
FALSE	The diagram windows are displayed separately.

The attribute can be assigned dynamic properties using the name **ConnectBarWindows**. The data type is BOOLEAN.

**ConnectTrendWindows property****Connect trend windows - ConnectTrendWindows**

Enables the connection of trend windows configured. You must have configured several trend windows.

The connected trend windows have the following properties:

- They can have a common X axis.
- They have a scroll bar.
- They have a ruler.
- The zoom functions for a trend window affect the connected trend windows.

Value	Description
TRUE	All trend windows configured are connected.
FALSE	The trend windows are displayed separately.

The attribute can be assigned dynamic properties by means of the name **ConnectTrendWindows**. The data type is BOOLEAN.



## ContinuousChange Property

### Description

Defines the type of transfer of the value defined by the slider ("Position" property) in Runtime:

- FALSE : The value of the "Position" property is transferred when the mouse button is released.
- TRUE : The value of the "Position" property is transferred immediately following a change of the slider position.

### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## Count Property

### Description

Supplies the number of elements in a list.

INTEGER (read-only access).

### Example:

The example shows how the number of objects in a DataSet list is output.

```
'VBS165
HMIRuntime.Trace "Count: " & HMIRuntime.DataSet.Count & vbNewLine
```

The following example adds two tags to the TagSet list and outputs the count properties as Trace.

```
'VBS177
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
group.Add "Motor1"
group.Add "Motor2"
HMIRuntime.Trace "Count: " & group.Count & vbNewLine
```

## See also

CreateTagSet Method (Page 717)  
TagSet Object (List) (Page 141)  
ScreenItems Object (List) (Page 129)  
Screens Object (List) (Page 134)  
Layers Object (Listing) (Page 121)  
DataSet Object (List) (Page 116)  
ProcessValues Object (List) (Page 124)

## Count property

### Count

Specifies the number of rows of the row listing object of a table control.

### Cu

## CurrentContext Property

### Description

In the case of a picture window, the server from which the picture comes and contains the script is read out.

The "CurrentContext" property can return different results: If, for example, a picture window displaying a server picture is set in a local basic picture, distinction is made between two cases:

- The "CurrentContext" property is used in an action of the picture window picture: The result is the return of the symbolic computer name of the server (Package property) extended by two colons, e.g. "WinCCProject\_MyComputer::" .
- The "CurrentContext" property is used in an action of the basic picture: The result is returned in the form of an empty character string.

## See also

HMIRuntime Object (Page 118)

## Cursor Property

### Description

Controls the appearance of the cursor in Runtime when positioned over an icon.

- 0: The cursor appears as an arrow and does not change when positioned over the icon.
- 1: The cursor appears as a 3D arrow accompanied by a green lightening symbol. In Runtime, this indicates that the object concerned can be operated.

### See also

ScreenItem Object (Page 125)

HMI Symbol Library (Page 239)

## Cursor property

### Mouse pointer (Cursor)

Specifies whether or not to display the mouse pointer on the icon at runtime.

Value	Explanation
TRUE	The mouse pointer is shown at runtime if positioned on the icon.
FALSE	The mouse pointer is hidden at runtime if positioned on the icon.

The attribute can be assigned dynamic properties by means of the name **Cursor**. The data type is BOOLEAN.

## CursorControl Property

### Description

TRUE, when Alpha Cursor mode is activated, the cursor skips to the next field in the TAB sequence after exiting the field. BOOLEAN write-read access.

To do this, the "CursorMode" property must be set to TRUE.

### See also

Text list (Page 196)

I/O Field (Page 184)

ScreenItem Object (Page 125)

## CurveForm Property

### Description

#### WinCC Function Trend Control

Defines how the measuring points of a trend referenced by the "Index" property should be connected. Write/Read access.

#### WinCC Online Trend Control

The "Index" property references a trend. "CurveForm" defines how the measuring points should be connected.

- 0x00000012 Representation of the measuring points.
- 0x00000014 Measuring points are connected linearly.
- 0x00000011 Measuring points are connected via a step curve.
- 0x00000021 The area under the linearly connected trend is filled.
- 0x00000022: The area under the step curve is filled.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## CursorMode Property

### Description

When the "CursorMode" is set to "yes", you can show all messages from the short-term archive page by page in the long-term archive list. Use the "CursorModePrefetch" property to determine the number of messages shown per page.

The "Autoscroll" option must be unchecked in order to be able to switch between pages. Write/Read access.

## CursorModePrefetch Property

### Description

Sets the number of message that you want to display page by page in the long-term archive list out of all messages in the short-term archive.

The "CursorMode" object property must be set to "yes".

Write/Read access.

#### 1.14.4.5 D

Da

### DangerColor Property

#### Description

Defines or returns the color of the danger zone on the scale. LONG write-read access.

#### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

### Danger Property

#### Description

Defines or returns the beginning of the "danger zone". The zone stretches from the "danger" value to the end of the scale. Write/Read access.

#### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

### DataFormat Property

#### Description

Returns the data type of the I/O field object. Read only access.

Value range from 0 to 3.

0: Binary

1: Decimal

2: String

3: Hexadecimal

### See also

I/O Field (Page 184)

ScreenItem Object (Page 125)

### DataIndex Property

#### Description

Returns the current index of the data of the current trend.

---

#### Note

The property is only supported for the controls prior to WinCC V7.

---

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

### DataLogs Property

#### Description

Returns an object of type "DataLogs".

DataLogs (read-only)

### See also

DataLogs Object (Page 114)

HMIRuntime Object (Page 118)

### DataSet Property

#### Description

Returns an object of type "DataSet".

DataSet (read-only)

**See also**

DataSet Object (List) (Page 116)

HMIRuntime Object (Page 118)

**DataX Property****Description**

Inserts a single data record and must be set before calling "InsertData".

---

**Note**

The property is only supported for the controls prior to WinCC V7.

---

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

**DataXY Property****Description**

Inserts several data records as an array with pairs of values and must be set before calling "InsertData".

The data in the array is assumed when "DataX" is of the VT\_EMPTY type. Otherwise, the "InsertData" attribute used the single value pair resulting from "DataX" and "DataY".

---

**Note**

The property is only supported for the controls prior to WinCC V7.

---

**See also**

Example: Calling Methods of an ActiveX Control (Page 841)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## DataY Property

### Description

Inserts a single data record and must be set before calling "InsertData".

---

#### Note

The property is only supported for the controls prior to WinCC V7.

---

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

### De - Do

## DefaultMsgFilterSQL property

### DefaultMsgFilterSQL

Defines an SQL statement for a fixed selection of messages.

The SQL statements of "DefaultMsgFilterSQL" and "MsgFilterSQL" are linked logically by "AND" operation if you define additional custom selections by means of "MsgFilterSQL" attribute.

The attribute can be assigned dynamic properties by means of the name **DefaultMsgFilterSQL**. The data type is STRING.

## DefaultPrecision Property

### Description

This attribute defines the number of default decimal places, with which the scale value is specified. Write/Read access.

## DefaultRulerPrecision Property

### Description

This attribute defines the number of decimal places as standard value with which a measured value should be displayed when it is determined using the "Display value at this position" function. Write/Read access.



## DefaultSort property

### Default sorting order - DefaultSort

Defines the default sorting order in table columns.

The following settings are available:

Value	Description	Explanation
0	Ascending	The list is updated starting with the bottom line.
1	Descending	The list is updated starting with the top line.

The attribute can be assigned dynamic properties by means of the name **DefaultSort**. The data type is LONG.

## DefaultSort2 property

### DefaultSort2

Use this function to define the sorting method in table columns if not using the default "Date/time/number" sorting order. Instead, you defined a message block in the "DefaultSort2Column" object property to sort the columns based on the "message block/date/time/number" order.

The following settings are available:

Value	Description	Explanation
0	Ascending	The list is updated starting with the bottom line.
1	Descending	The list is updated starting with the top line.

The attribute can be assigned dynamic properties by means of the name **DefaultSort2**. The data type is LONG.

## DefaultSort2Column property

### DefaultSort2Column

Use this function to define the sorting method in table columns if not using the default "Date/time/number" sorting order.

Define a message block by its object name.

The table columns are now sorted based on the "message block/date/time/number" order.

The attribute can be assigned dynamic properties by means of the name **DefaultSort2Column**. The data type is STRING.

## DeleteData Property

### Description

Deletes data in the data buffer of the current trend.

TRUE : All trend data is deleted.

FALSE : The value pair at the "DataIndex" position are deleted.

---

### Note

The property is only supported for the controls prior to WinCC V7.

---

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## Delta Property

### Description

Defines or returns the value difference between two main scale graduation marks. Write/Read access.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## DesiredCurveColor Property

### Description

Defines the color of a setpoint trend which belongs to a trend referenced by the "Index" property. The color is defined as an RGB value. Whether the information is evaluated is dependent on the value of the "DesiredCurveVisible" property.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## DesiredCurveCurveForm Property

### Description

Defines the form of representation of a setpoint trend which belongs to a trend referenced by the "Index" property. Whether the information is evaluated is dependent on the value of the "DesiredCurveVisible" property.

0x00000011 Measuring points are connected by a solid line via a step curve

0x00000012 Representation of the measuring points

0x00000014 Measuring points are connected linearly with a solid line

0x00000021 The area under the linearly connected trend is filled.

0x00000022: The area under the stepped curve is filled.

0x00000031: Measuring points are connected by a dashed line via a step curve

0x00000032: Measuring points are connected linearly with a dashed line

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## DesiredCurveSourceNumberOfUAValues Property

### Description

Defines the number of value pairs of a setpoint trend which belongs to a trend referenced by the "Index" property. Whether the information is evaluated is dependent on the value of the "DesiredCurveVisible" property.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## DesiredCurveSourceUAArchive Property

### Description

Defines the name of the user archive from which the value of a setpoint trend, which belongs to a trend referenced by "Index", is read. Whether the information is evaluated is dependent on the value of the "DesiredCurveVisible" property.

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## DesiredCurveSourceUAArchiveStartID Property

### Description

Defines the starting point for the value of a setpoint trend, which belongs to a trend referenced by "Index", from which the values should be read from the archive. Whether the information is evaluated is dependent on the value of the "DesiredCurveVisible" property.

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## DesiredCurveSourceUAColumnX Property

### Description

Defines the column in the user archive from which the X-values of a setpoint trend, which belongs to a trend referenced by "Index", should be read. Whether the information is evaluated is dependent on the value of the "DesiredCurveVisible" property.

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## DesiredCurveSourceUAColumnY Property

### Description

Defines the column in the user archive from which the Y-values of a setpoint trend, which belongs to a trend referenced by "Index", should be read. Whether the information is evaluated is dependent on the value of the "DesiredCurveVisible" property.

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## DesiredCurveVisible Property

### Description

TRUE, a setpoint trend which belongs to a trend referenced by "Index" should be displayed. BOOLEAN write-read access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## Direction Property

### Description

Defines or returns the bar direction or the position of the slider object. BOOLEAN write-read access. Value range from 0 to 3.

0 = top

1 = bottom

2 = left

3 = right

### See also

Slider (Page 212)

Bar (Page 174)

3D Bar (Page 169)

ScreenItem Object (Page 125)

## DisplayName property

### Display name (DisplayName)

Specifies the user-defined name of the process picture. The attribute is of type "Multilingual String". You can specify names for all languages installed in WinCC.

The logon name is displayed in the following cases:

WinCC Explorer	"Details" view in the data window	"Display name" column
	"Large Icons" view in the data window	Process picture preview
WinCC Runtime	"Favorites" system dialog	Process picture preview

The "Display name" attribute can be dynamized with the "DisplayName" name.

## DisplayOptions property

### Show messages - DisplayOptions

Select the messages to be displayed.

The following selection options are available:

Value	Designation
0	All messages
1	Only displayed messages
2	Only hidden messages

The attribute can be assigned dynamic properties by means of the name **DisplayOptions**. The data type is LONG.

### DisplayOptions property (before WinCC V7)

#### Description

Specifies if a button is assigned to a graphic, text, or both.

- 0 Picture or text: If a picture exists, the button is assigned with the picture, otherwise it is assigned with text.
- 1 Graphic and text
- 2 Text only
- 3 Graphic only

## DoubleClickAction property

### Action on double-click - DoubleClickAction

Specifies the action to be executed in Runtime by double-clicking on a message line.

The following settings are available:

Value	Description	Explanation
0	none	No action.
1	Loop-in-alarm	Calls the "Loop-in-alarm" function.
2	Open comments dialog	Calls the "Comments dialog" button function.
3	Open Infotext dialog	Calls the "Infotext dialog" button function.
4	Column-dependent	The action is determined by the column in which you double-clicked.

The attribute can be assigned dynamic properties by means of the name **DoubleClickAction**. The data type is LONG.

#### 1.14.4.6 E

### Edit Property

#### Description

Activates Editing mode for a cell as long as the "Editable" property has been set to TRUE for the corresponding column.

#### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

### Editable Property

#### Description

The "Index" property references a pair of columns. "Editable" defines whether the column pair should be editable. BOOLEAN write-read access.

#### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

### EditAtOnce Property

#### Description

TRUE, if accessing the field with the <TAB> key permits input immediately and without further action. BOOLEAN write-read access.

#### See also

Text list (Page 196)

I/O Field (Page 184)

ScreenItem Object (Page 125)

## Enabled Property

### Function

Enables or disables possible operation of an object or issues the corresponding value. TRUE : Enable operation, FALSE: Operation is disabled.

BOOLEAN write-read access.

### Example:

The following example disables all objects in the picture "NewPDL1":

```
'VBS71
Dim objScreen
Dim objScrItem
Dim lngIndex
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
strName = objScreen.ScreenItems.Item(lngIndex).ObjectName      'Read names of objects
Set objScrItem = objScreen.ScreenItems(strName)
objScrItem.Enabled=False      'Lock object
Next
```

### See also

Screen Object (Page 131)

ScreenItem Object (Page 125)

## EnableDelete property

### Delete - EnableDelete

Enables deletion of data from the user archive in Runtime.

Value	Explanation
TRUE	You can delete data from the user archive in Runtime.
FALSE	You cannot delete data from the user archive in Runtime.

The attribute can be assigned dynamic properties by means of the name **EnableDelete**. The data type is BOOLEAN.



## EnableEdit property

### Modify - EnableEdit

Enables editing of the data displayed during runtime.

Value	Explanation
TRUE	Enables editing of data during runtime.
FALSE	Disables editing of data during runtime.

The attribute can be assigned dynamic properties by means of the name **EnableEdit**. The data type is BOOLEAN.

## EnableInsert property

### Add - EnableInsert

Enables insertion of data in the user archive in Runtime.

Value	Explanation
TRUE	You can add data to the user archive in Runtime.
FALSE	You cannot add data to the user archive in Runtime.

The attribute can be assigned dynamic properties by means of the name **EnableInsert**. The data type is BOOLEAN.

## EnablePopupMenu property

### EnablePopupMenu

Specifies if the pop-up menu is enabled in the control.

The attribute can be assigned dynamic properties by means of the name **EnablePopupMenu**. The data type is BOOLEAN.

## EndAngle Property

### Description

Defines or returns the end of the object. The information is in counterclockwise direction in degrees, beginning at the 12:00 clock position.

### See also

Pie segment (Page 152)

Circular arc (Page 151)

Ellipse segment (Page 147)

Ellipse arc (Page 146)

ScreenItem Object (Page 125)

## EndTime Property

### Description

#### Online Table Control

The "Index" attribute references a pair of columns. "EndTime" defines the end time for displaying this column pair. Whether the information is evaluated is dependent on the "TimeRange" and "CommonTime" properties. Write/Read access.

#### Online Trend Control

The "Index" attribute references a trend. "EndTime" defines the end time for displaying this trend. Whether the information is evaluated is dependent on the "Autorange", "TimeRange" and "CommonX" properties.

Use the "yyyy-mm-dd hh:mm:ss" format when creating a dynamic time range.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

## EndValue Property

### Description

The "Index" property references a trend. "EndValue" defines the upper limit of the value range to be displayed for the trend. Whether the information is evaluated is dependent on the "Autorange" and "CommonY" properties.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## EndX Property

### Description

Defines the upper limit of the X-axis of a trend referenced with "Index". Whether the information is evaluated is dependent on the "AutorangeX" and "CommonX" properties.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## EndY Property

### Description

Defines the upper limit of the Y-axis of a trend referenced with "Index". Whether the information is evaluated is dependent on the "AutorangeY" and "CommonY" properties.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## ErrorDescription Property

### Function

Error description of the "LastError" property. The error description is provided in English only.  
STRING (read only)

The following error messages are defined:

Output	Description
" "	OK
"Operation Failed"	Execution error
"Variable not found"	Tag error
"Server down"	Server not available.
"An error occurred for one or several tags"	Multi Tag Error (Error in one or several tags)

In order that ErrorDescription returns a value, a read process must be executed beforehand.

If an error occurs during read or write of several tags using the TagSet object, the error is set to "Multi Tag Error". In order to determine at which tag the error occurred and what type of error it was, the ErrorDescription property of each tag must be analyzed.

### Example:

The following example displays the error description for "Tag1":

```
'VBS72
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objtag.Read
MsgBox objTag.ErrorDescription
```

The following example adds two tags to the TagSet list and outputs the ErrorDescription property as Trace.

```
'VBS179
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
group.Add "Motor1"
group.Add "Motor2"
HMIRuntime.Trace "ErrorDescription: " & group.ErrorDescription & vbNewLine
```

The ErrorDescription property of a tag contained in the list may be accessed as follows:

```
HMIRuntime.Trace "ErrorDescription: " & group("Motor1").ErrorDescription & vbNewLine
```

### See also

- LastError Property (Page 459)
- QualityCode Property (Page 546)
- TagSet Object (List) (Page 141)
- Tag Object (Page 137)

### Exponent Property

#### Description

TRUE, when the display of numbers should be with exponents (e.g."1.00e+000"). BOOLEAN write-read access.

### See also

- Bar (Page 174)
- ScreenItem Object (Page 125)

**ExportDirectoryChangeable property****Directory can be changed - ExportDirectoryChangeable**

Enables changing of the directory for data export in Runtime.

Value	Explanation
TRUE	The data export directory can be changed in Runtime.
FALSE	The data export directory cannot be changed in Runtime.

The attribute can be assigned dynamic properties by means of the name **ExportDirectoryChangeable**. The data type is BOOLEAN.

**ExportDirectoryname property****Directory - ExportDirectoryname**

Defines the directory to which the exported Runtime data is written.

You can select or create the directory using the selection button.

The attribute can be assigned dynamic properties by means of the name **ExportDirectoryname**. The data type is STRING.

**ExportFileExtension property****ExportFileExtension**

Defines the extension of the export file.

Only the file name extension "csv" is currently supported.

The attribute can be assigned dynamic properties by means of the name **ExportFileExtension**. The data type is STRING.

**ExportFilename property****File name - ExportFilename**

Defines the name of the file which is to receive the exported Runtime data.

The attribute can be assigned dynamic properties by means of the name **ExportFilename**. The data type is STRING.

## ExportFilenameChangeable property

### File can be renamed - ExportFilenameChangeable

Enables renaming of the export file in Runtime.

Value	Explanation
TRUE	The export file can be renamed in Runtime.
FALSE	The export file cannot be renamed in Runtime.

The attribute can be assigned dynamic properties by means of the name **ExportFilenameChangeable**. The data type is BOOLEAN.

## ExportFormatGuid property

### ExportFormatGuid

Default assignment of the ID number and export provider.

The attribute can be assigned dynamic properties by means of the name **ExportFormatGuid**. The data type is STRING.

## ExportFormatName property

### Format - ExportFormatName

Defines the export file format.

Only the "csv" file format is currently available for the export.

The attribute can be assigned dynamic properties by means of the name **ExportFormatName**. The data type is STRING.

## ExportParameters property

### ExportParameters

Specifies the parameters of the selected format by means of the properties dialog.

The attribute can be assigned dynamic properties by means of the name **ExportParameters**. The data type is VARIANT.

## ExportSelection property

### Scope of data export - ExportSelection

Specifies the control's Runtime data to be exported.

The following settings are available:

Value	Description	Explanation
0	all	All Runtime data of the control is exported.
1	Selection	Selected Runtime data of the control is exported.

The attribute can be assigned dynamic properties by means of the name **ExportSelection**. The data type is LONG.

### ExportShowDialog property

#### Show dialog - ExportShowDialog

Enables the display of the export dialog during runtime.

Value	Explanation
TRUE	The dialog is displayed during runtime.
FALSE	The dialog is not displayed during runtime.

The attribute can be assigned dynamic properties by means of the name **ExportShowDialog**. The data type is BOOLEAN.

### ExportXML property

#### ExportXML

Only used internally.

The attribute can be assigned dynamic properties by means of the name **ExportXML**.

### ExtendedOperation Property

#### Description

TRUE, when the slider regulator is set at the respective end value (minimum/maximum value). This is done by clicking the mouse in an area outside the current regulator setting. BOOLEAN write-read access.

#### See also

Slider (Page 212)

ScreenItem Object (Page 125)

## ExtendedZoomingEnable Property

### Description

Activates/deactivates the ExtendedZooming properties of a picture.

Using ExtendedZooming, the view of a process picture in Runtime may be enlarged or reduced by using the mouse wheel.

BOOLEAN write-read access.

### Example:

Activates ExtendedZooming for picture NewPDL1.

```
'VBS155  
Dim objScreen  
Set objScreen = HMIRuntime.Screens("NewPDL1")  
objScreen.ExtendedZoomingEnable = 1
```

### See also

Screen Object (Page 131)

## 1.14.4.7 F

### Fe - FI

## FeatureFullscreen property

### FeatureFullscreen

Specifies if the "Full screen" function is available in the control.

The attribute can be assigned dynamic properties by means of the name **FeatureFullscreen**. The data type is BOOLEAN.

## FeaturePause property

### FeaturePause

Specifies if the "Pause" function is available in the control.

The attribute can be assigned dynamic properties by means of the name **FeaturePause**. The data type is BOOLEAN.



## FeaturePlay property

### FeaturePlay

Specifies if the "Play" function is available in the control.

The attribute can be assigned dynamic properties by means of the name **FeaturePlay**. The data type is BOOLEAN.

## FeatureStepBackward property

### FeatureStepBackward

Specifies if the "Step backward" function is available in the control.

The attribute can be assigned dynamic properties by means of the name **FeatureStepBackward**. The data type is BOOLEAN.

## FeatureStepForward property

### FeatureStepForward

Specifies if the "Step forward" function is available in the control.

The attribute can be assigned dynamic properties by means of the name **FeatureStepForward**. The data type is BOOLEAN.

## FeatureStop property

### FeatureStop

Specifies if the "Stop" function is available in the control.

The attribute can be assigned dynamic properties by means of the name **FeatureStop**. The data type is BOOLEAN.

## FeatureVolume property

### FeatureVolume

Specifies if the "Volume" function is available in the control.

The attribute can be assigned dynamic properties by means of the name **FeatureVolume**. The data type is BOOLEAN.

## FileName property

### FileName

Specifies the file whose content you want to display or play.

The attribute can be assigned dynamic properties by means of the name **FileName**. The data type is STRING.

## FillColor Property

### Description

Defines or returns the fill pattern color for the object.

LONG (write-read access)

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Enter the appropriate decimal value for each of the three RGB values.

Example:

RGB(200, 150, 100)

### Example:

The following example defines the fill color for "ScreenWindow1" to blue:

```
'VBS73
Dim objScreen
Set objScreen = HMIRuntime.Screens("ScreenWindow1")
objScreen.FillStyle = 131075
objScreen.FillColor = RGB(0, 0, 255)
```

### See also

[FillStyle Property \(Page 419\)](#)

[BackColor Property \(Page 322\)](#)

[ScreenItem Object \(Page 125\)](#)

## Filling Property

### Description

TRUE, when the object can be filled by closed border lines (e.g. representing the fill level of a tank). BOOLEAN write-read access.

The fill level of the object is set by means of the "FillingIndex" property.

### See also

ScreenItem Object (Page 125)

## FillingDirection properties

### Filling direction (FillingDirection)

The "Filling direction" attribute specifies the filling direction for an object enclosed in a frame line.

Bottom to top	The object is filled from bottom to top.
Top to bottom	The object is filled from top to bottom.
Left to right	The object is filled from left to right.
Right to left	The object is filled from right to left.

The attribute can be assigned dynamic properties by means of the name FillingDirection. The data type is LONG.

## FillingIndex Property

### Description

Defines the %age value (related to the height of the object) to which the object with closed border line is to be filled.

The fill level is represented by the current background color. The unfilled background is transparent.

### See also

















































ScreenItem Object (Page 125)

## FillStyle Property

### Description

Defines or returns the fill pattern for the object.

LONG (write-read access)

Fill pattern	Value	Fill pattern	Value	Fill pattern	Value
< Transparent >	65536				
< Massiv >	0				
	1048576		196611		196627
	1048577		196612		196628
	1048578		196613		196629
	1048579		196614		196630
	1048832		196615		196631
	1048833		196616		196632
	1048834		196617		196633
	1048835		196618		196634
	131072		196619		196635
	131073		196620		196636
	131074		196621		196637
	131075		196622		196638
	131076		196623		196639
	196608		196624		196640
	196609		196625		196641
	196610		196626		196642

## Example

The following example sets the fill pattern for "ScreenWindow1" to transparent:

```
'VBS190
Dim obj
Set obj = ScreenItems("Rectangle1")
obj.FillStyle = 65536
```

## See also

FillColor Property (Page 418)  
BackColor Property (Page 322)  
Screen Object (Page 131)

## FillStyle2 Property

### Description

Defines or returns the fill style of the bar.

## See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## FillStyleAlignment property

### Description

Defines the alignment of the fill pattern for the process picture.

Normal	The fill pattern refers to the process picture. In runtime, no scaling is performed when opening the picture.
Stretched (window)	The fill pattern refers to the window in the Graphics Designer. In runtime, scaling is performed when opening the picture.

## FilterSQL property

### FilterSQL

Defines an SQL statement for a selection of data in the user archive.

The attribute can be assigned dynamic properties by means of the name **FilterSQL**. The data type is STRING.

## FineGrid Property

### Description

TRUE, when the value axis is scaled by short tick marks. The distance between two short tick marks can be changed using the "FineGridValue" property. BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## FineGridValue Property

### Description

Defines the distance between two short tick marks in the scale. Whether the information is evaluated is dependent on the value of the "FineGrid" property.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## FineGridValueX Property

### Description

Defines the distance between two short tick marks on the X-axes scaling. Whether the information is evaluated is dependent on the value of the "FineGridX" property.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## FineGridValueY Property

### Description

Defines the distance between two short tick marks on the Y-axis scaling. Whether the information is evaluated is dependent on the value of the "FineGridX" property.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## FineGridX Property

### Description

TRUE, when the X-axis graduation is scaled by short tick marks. The distance between two short tick marks can be changed using the "FineGridValueX" property.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## FineGridY Property

### Description

TRUE, when the Y-axis graduation is scaled by short tick marks. The distance between two short tick marks can be changed using the "FineGridValueY" property.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## FlashBackColor Property

### Description

TRUE, when flashing of the background is activated. BOOLEAN write-read access

**See also**

ScreenItem Object (Page 125)

**FlashBorderColor Property**

**Description**

TRUE, when flashing of the object lines is activated. BOOLEAN write-read access.

**See also**

ScreenItem Object (Page 125)

**FlashFlashPicture Property**

**Description**

TRUE, when flashing of the flash picture is activated. BOOLEAN write-read access.

**See also**

Status display (Page 199)

ScreenItem Object (Page 125)

**FlashForeColor Property**

**Description**

TRUE, when flashing of the text is activated. BOOLEAN write-read access.

**See also**

I/O Field (Page 184)

Static text (Page 165)

Text list (Page 196)

Radio box (Page 207)

Check box (Page 204)

Button (Page 201)

ScreenItem Object (Page 125)



## FlashPicReferenced Property

### Description

TRUE, when the assigned flash picture should be saved. Otherwise, only the associated object reference is saved. Read only access.

### See also

Status display (Page 199)

ScreenItem Object (Page 125)

## FlashPicTransColor Property

### Description

Defines which color of the bitmap object (.bmp, .dib) assigned to the flash picture should be set to "transparent". LONG Write/Read Access.  
The color is only set to "Transparent" if the value of the "FlashPicUseTransColor" property is "True".

### See also

ScreenItem Object (Page 125)

Status display (Page 199)

## FlashPicture Property

### Description

Returns the flash picture. Read-only access.  
The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.  
In this context, the "FlashPicReferenced" property defines whether the flash picture should be saved together with the object status display or referenced.

### See also

Status display (Page 199)

ScreenItem Object (Page 125)

## FlashPicUseTransColor Property

### Description

TRUE, when the configured color ("FlashPicTransColor" property) of the bitmap objects assigned to the flash picture should be set to "transparent". BOOLEAN write-read access.

### See also

Status display (Page 199)

ScreenItem Object (Page 125)

## FlashRate Property

### Description

Defines or returns the flashing frequency for the object. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

---

### Note

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

---

### See also

Group Display (Page 194)

ScreenItem Object (Page 125)

## FlashRateBackColor Property

### Description

Defines or returns the flash frequency for the object background. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

#### Note

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

### See also

ScreenItem Object (Page 125)

## FlashRateBorderColor Property

### Description

Defines or returns the flash frequency for the lines of the object. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

#### Note

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

### See also

ScreenItem Object (Page 125)

## FlashRateFlashPic Property

### Description

Defines or returns the flash frequency for the status display. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

#### Note

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

---

### See also

Status display (Page 199)

ScreenItem Object (Page 125)

## FlashRateForeColor Property

### Description

Defines or returns the flash frequency for the object label. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.5 Hz)	0
Medium (approx. 2 Hz)	1
Fast (approx. 8 Hz)	2

#### Note

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

---

**See also**

Static text (Page 165)  
 Text list (Page 196)  
 Radio box (Page 207)  
 Check box (Page 204)  
 Button (Page 201)  
 I/O Field (Page 184)  
 ScreenItem Object (Page 125)

**Flip property****Flip (Flip)**

Specifies flipping of the icon at runtime.

The following settings are available:

Value	Description	Comments
0	None	The icon is not flipped.
1	Horizontal	The object is flipped along the horizontal center axis.
2	Vertical	The object is flipped along the vertical center axis.
3	Both	The object is flipped along the horizontal and vertical center axes.

The attribute can be assigned dynamic properties by means of the name **Flip**. The data type is LONG.

**Flip Property****Description**

Mirrors the icon on the vertical and/or horizontal middle axis of the icon.

- Zero - 0: The icon is not mirrored.
- Horizontal - 1: The icon is mirrored on the vertical center axis.
- Vertical - 2: The icon is mirrored on the horizontal, center axis.
- Both - 3: The icon is mirrored both on the horizontal and vertical center axes.

**See also**

HMI Symbol Library (Page 239)  
 ScreenItem Object (Page 125)

## Fo - Fr

### FocusColor Property

#### Description

If the focus is positioned on the control in Runtime, the labeling and position text are identified by a border. FocusColor defines the color of the border.

#### See also

WinCC Slider Control (Page 277)  
ScreenItem Object (Page 125)

### FocusRect Property

#### Description

TRUE, when the button should be provided with a selection border, in Runtime, as soon as it receives the focus. BOOLEAN write-read access.

#### See also

WinCC Push Button Control (Page 269)  
WinCC Digital/Analog Clock (Page 246)  
ScreenItem Object (Page 125)

### FocusWidth Property

#### Description

If the focus is positioned on the control in Runtime, the labeling and position text are identified by a border. FocusWidth defines the width of the border, value range of 1-10 pixels. LONG write-read access.

#### See also

WinCC Slider Control (Page 277)  
ScreenItem Object (Page 125)

## Font Property

### Name - Font

Sets the font.

The attribute cannot be dynamized.

### Font property (before WinCC V7)

#### Description

Defines or returns the font. Write/Read access.

The font object has the following sub-properties

- Size (Font Size)
- Bold (yes/no)
- Name (font name)
- Italic (yes/no)
- Underline (underline yes/no)
- StrikeThrough (yes/no)

If two font properties are directly assigned, only the default property "Name" is assumed.

#### Example:

```
'VBS74
Dim objControl1
Dim objControl2
Set objControl1 = ScreenItems("Control1")
Set objControl2 = ScreenItems("Control2")
objControl2.Font = objControl1.Font ' take over only the type of font
```

#### See also

[WinCC Slider Control \(Page 277\)](#)

[WinCC Push Button Control \(Page 269\)](#)

[WinCC Online Trend Control \(before WinCC V7\) \(Page 295\)](#)

[WinCC Online Table Control \(before WinCC V7\) \(Page 292\)](#)

[WinCC Function Trend Control \(before WinCC V7\) \(Page 288\)](#)

[WinCC Digital/Analog Clock \(Page 246\)](#)

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## FontBold Property

### Description

TRUE, when the text in the object should be assigned the "bold" attribute. BOOLEAN write-read access.

### See also

WinCC Push Button Control (Page 269)

Group Display (Page 194)

Text list (Page 196)

Radio box (Page 207)

Check box (Page 204)

Button (Page 201)

I/O Field (Page 184)

Bar (Page 174)

ScreenItem Object (Page 125)

## FontItalic Property

### Description

TRUE, when the text in the object should be assigned the "italic" attribute. BOOLEAN write-read access.

### See also

WinCC Push Button Control (Page 269)

Group Display (Page 194)

Static text (Page 165)

Text list (Page 196)

Radio box (Page 207)

Check box (Page 204)

Button (Page 201)

I/O Field (Page 184)

ScreenItem Object (Page 125)



## FontName Property

### Description

Defines or returns the font name of the text in the object.  
All the fonts installed in Windows are available for selection.

### See also

WinCC Push Button Control (Page 269)  
Group Display (Page 194)  
Static text (Page 165)  
Text list (Page 196)  
Radio box (Page 207)  
Check box (Page 204)  
Button (Page 201)  
I/O Field (Page 184)  
Bar (Page 174)  
ScreenItem Object (Page 125)

## FontPosition Property

### Description

Returns the font name for the display of the slider position in the bottom part of the object. All the fonts installed in Windows are available for selection. Read only access.

### See also

WinCC Slider Control (Page 277)  
ScreenItem Object (Page 125)

## FontSize Property

### Description

Defines or returns the font size of the text in the object in points.

### See also

WinCC Push Button Control (Page 269)  
Group Display (Page 194)

Static text (Page 165)  
Text list (Page 196)  
Radio box (Page 207)  
Check box (Page 204)  
Button (Page 201)  
I/O Field (Page 184)  
Bar (Page 174)  
ScreenItem Object (Page 125)

## FontStrikeThru Property

### Description

TRUE, when the text in the object should be assigned the "strikethrough" attribute. BOOLEAN write-read access.

### See also

WinCC Push Button Control (Page 269)  
ScreenItem Object (Page 125)

## FontUnderline Property

### Description

TRUE, when the text in the object should be assigned the "underline" attribute. BOOLEAN write-read access.

### See also

WinCC Push Button Control (Page 269)  
Group Display (Page 194)  
Static text (Page 165)  
Text list (Page 196)  
Radio box (Page 207)  
Check box (Page 204)  
Button (Page 201)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## ForeColor Property

### Description

Defines or returns the color of the font for the text in the object. LONG write-read access.

### See also

WinCC Slider Control (Page 277)  
WinCC Push Button Control (Page 269)  
WinCC Digital/Analog Clock (Page 246)  
HMI Symbol Library (Page 239)  
Static text (Page 165)  
Text list (Page 196)  
Radio box (Page 207)  
Check box (Page 204)  
Button (Page 201)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## ForeColor property

### Foreground color (ForeColor)

Specifies the foreground color of the icon in the "Color selection" dialog. The icon is displayed in the foreground color if the "Shadow" and "Solid" foreground mode is set.

The attribute can be assigned dynamic properties by means of the name **ForeColor**. The data type is LONG.

## ForeFlashColorOff Property

### Description

Defines or returns the color of the text for flash status "Off". LONG write-read access.

### See also

Text list (Page 196)  
Static text (Page 165)  
Radio box (Page 207)  
Check box (Page 204)

- Button (Page 201)
- I/O Field (Page 184)
- ScreenItem Object (Page 125)

## ForeFlashColorOn Property

### Description

Defines or returns the color of the text for flash status "On". LONG write-read access.

### See also

- Static text (Page 165)
- Text list (Page 196)
- Radio box (Page 207)
- Check box (Page 204)
- Button (Page 201)
- I/O Field (Page 184)
- ScreenItem Object (Page 125)

## FrameColor Property

### Description

Defines or returns the color of the rectangular or square area located on the graduated scale disk. LONG write-read access.

### See also

- WinCC Gauge Control (Page 254)
- ScreenItem Object (Page 125)

## FrameColorDown Property

### Description

Defines or returns the color for the right, bottom part of the 3D frame of the button (button pressed). LONG write-read access.

## See also

WinCC Push Button Control (Page 269)

ScreenItem Object (Page 125)

## FrameColorUp Property

### Description

Defines or returns the color for the left, top part of the 3D frame of the button (button not pressed). LONG write-read access.

## See also

WinCC Push Button Control (Page 269)

ScreenItem Object (Page 125)

## FramePicture Property

### Description

Returns the picture name of the background picture for the graduated scale disk. Read only access.

## See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## FrameScale Property

### Description

Defines or returns the diameter of the graduated scale disk in relation to smallest value of the width and height geometric attributes. Write/Read access.

The value range is (scale distance - scale width) to 1.

## See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## FrameWidth Property

### Description

Defines or returns the border width of the button in pixels. Write/Read access.

### See also

WinCC Push Button Control (Page 269)

ScreenItem Object (Page 125)

## FreezeProviderConnections Property

### Description

Enables modification of the data connection properties ("ProviderType", "Source"...), without the change being effective immediately. On changing "SourceTagNameX", for example, impermissible combinations can be created with "SourceTagNameY".

Therefore, "FreezeProviderConnections" must be set to TRUE before modifying a data connection attribute. After modifying all the data connections, "FreezeProviderConnections" is set to FALSE and the changes take effect.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## 1.14.4.8 G

## GlobalColorScheme property

### Description

Defines whether the colors defined for the current design in the global color scheme will be used for this object.

TRUE if the object is displayed with the colors from the global color scheme defined for this object type.

FALSE if the object is displayed with the colors as per the settings in the object.

BOOLEAN write-read access.

## GlobalShadow property

### Description

Defines whether the object will be displayed with the shadowing defined in the active design.  
 TRUE if the object is displayed with the global shadow defined for this object type.  
 FALSE if no shadow is displayed.  
 BOOLEAN write-read access.

## GraphDirection property (before WinCC V7)

### Description

Defines which edge of the trend window should display the current values. Write/Read access.  
 0: Positive values run to the right and upwards.  
 -1: Positive values run to the left and upwards.  
 -2: Positive values run to the right and upwards.  
 -3: Positive values run to the right and downwards.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)  
 WinCC Function Trend Control (before WinCC V7) (Page 288)  
 ScreenItem Object (Page 125)

## GraphDirection Property

### Write direction - GraphDirection

Defines the direction of the update of axis values.

Value	Description	Explanation
0	From the right	The updated values are displayed starting at the right in the control.
1	From the left	The updated values are displayed starting at the left in the control.
2	From the top	The updated values are displayed starting at the top in the control.
3	From the bottom	The updated values are displayed starting at the bottom in the control.

True type fonts must be used within the trend window if "From the top" or "From the bottom" is selected for write direction. Only this setting ensures legibility of the labeling of the vertical axis.

The attribute can be assigned dynamic properties by means of the name **GraphDirection**. The data type is LONG.

## GridLineColor property

### Color of the row divider / content - GridLineColor

Defines the color of row/column dividers in table contents. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **GridLineColor**. The data type is LONG.

## GridLineHorz Property

### Description

TRUE, when the message window columns are separated by horizontal dividing lines.  
BOOLEAN write-read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## GridLines Property

### Description

TRUE, when the trend window is displayed with grid lines parallel to the X-axis. The distance between two grid lines can be changed using the "GridLineValue" property. BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## GridlinesValueX Property

### Description

Defines or returns the distance between two grid lines on the X-axis. Whether the information is evaluated is dependent on the value of the "GridLinesX" property.



## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## GridlinesValueY Property

### Description

Defines or returns the distance between two grid lines on the Y-axis. Whether the information is evaluated is dependent on the value of the "GridLinesY" property.

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## GridlinesX Property

### Description

TRUE, when the trend window is displayed with grid lines parallel to the X-axis. The distance between two grid lines can be changed using the "GridLineValueX" property.

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## GridlinesY Property

### Description

TRUE, when the trend window is displayed with grid lines parallel to the Y-axis. The distance between two grid lines can be changed using the "GridLineValueX" property.

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## GridLineValue Property

### Description

Defines the distance between two grid lines. Whether the information is evaluated is dependent on the value of the "GridLines" property.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## GridLineVert Property

### Description

TRUE, when the message window columns are separated by vertical dividing lines. BOOLEAN write-read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## GridLineWidth property

### Width of dividers - GridLineWidth

Defines the line weight of the row/column dividers in pixels.

The attribute can be assigned dynamic properties by means of the name **GridLineWidth**. The data type is LONG.

## 1.14.4.9 H

### Ha - Hi

## HandFillColor Property

### Description

Defines or returns the fill color of all the hands in the analog clock. In order that the hands are displayed with the fill color defined, the "Handtype" property must be set to "0" (covering). LONG write-read access.

## See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## Handtype Property

### Description

Defines the representation of the hands:

- 0: The hands are filled in the hand color defined and the edges in the foreground color.
- 1: The hands fill color is transparent and the edges displayed in the foreground color.

## See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## HeaderSort Property

### Description

Specifies if sorting of messages by message block column header is possible.

## See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## Height Property

### Description

Defines or returns the height of the object in pixels.

LONG (write-read access)

**Example:**

The following example halves the height of all objects in the "NewPDL1" picture whose names begin with "Circle":

```
'VBS75
Dim objScreen
Dim objCircle
Dim lngIndex
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
  '
  'Searching all circles
  strName = objScreen.ScreenItems.Item(lngIndex).ObjectName
  If "Circle" = Left(strName, 6) Then
    '
    'to halve the height of the circles
    Set objCircle = objScreen.ScreenItems(strName)
    objCircle.Height = objCircle.Height / 2
  End If
Next
```

**See also**

- Width Property (Page 698)
- Object types of the ScreenItem object (Page 143)
- ScreenItem Object (Page 125)

**HiddenInput Property**

**Description**

TRUE, when the input value should not be displayed when being entered. Each character entered is substituted by a \*. BOOLEAN write-read access.

**See also**

- I/O Field (Page 184)
- ScreenItem Object (Page 125)

## HideTagNames Property

### Description

TRUE if the archive and tag name in the trend should be hidden via the right mouse button, in the status line and in the table to display the coordinates. BOOLEAN write-read access.

## HitlistColumnAdd property

### HitlistColumnAdd

Transfers the selected message block from the list of available message blocks to the list of selected message blocks.

The attribute can be assigned dynamic properties by means of the name **HitlistColumnAdd** . The data type is STRING.

## HitlistColumnAutoAdjust property

### HitlistColumnAutoAdjust

Automatically optimizes the width of the columns in the hit list in Runtime. If the configured column is not sufficient for the displayed text, the column width is increased.

If the user changes the width of columns in Runtime, the width is only optimized again when the picture is opened again.

The attribute can be assigned dynamic properties using the name **HitlistColumnAutoAdjust**. The data type is BOOLEAN.

## See also

WinCC AlarmControl (Page 241)

HitlistColumn object (list) (Page 222)

## HitlistColumnCount property

### HitlistColumnCount

Specifies the number of message blocks displayed in the hitlist in Runtime.

The attribute can be assigned dynamic properties by means of the name **HitlistColumnCount** . The data type is LONG.

## HitlistColumnIndex property

### HitlistColumnIndex

References a message block selected for the hitlist. Using this attribute you can assign the values of other attributes to a specific message block of the hitlist.

Values between 0 and "HitlistColumnCount" minus 1 are valid for "HitlistColumnIndex". Attribute "HitlistColumnCount" defines the number of message blocks selected for the hitlist.

The "HitlistColumnIndex" attribute can be assigned dynamic properties by means of attribute **HitlistColumnRepos**. The data type is LONG.

## HitlistColumnName property

### HitlistColumnName

Displays the name of the message block of the hitlist which is referenced with attribute "HitlistColumnIndex". You cannot edit this name.

The attribute can be assigned dynamic properties by means of the name **HitlistColumnName**. The data type is STRING.

## HitlistColumnRemove property

### HitlistColumnRemove

Cuts the marked message block from the list of selected message blocks and pastes it to the list of available message blocks.

The attribute can be assigned dynamic properties by means of the name **HitlistColumnRemove**. The data type is STRING.

## HitlistColumnRepos

### Up/Down - MessageColumnRepos/HitlistColumnRepos

Resorts the message blocks. The "Up" and "Down" commands move the selected message block accordingly in the list. This moves the message block in Runtime Control towards the front or towards the back.

The attribute for the hitlist can be assigned dynamic properties by means of the name **HitlistColumnRepos**.

The attribute for the message list can be assigned dynamic properties by means of the name **MessageColumnRepos**.

The data type is LONG.

## HitlistColumnSort property

### HitlistColumnSort

Defines the sorting order of the message block referenced in "HitlistColumnIndex" for the hitlist.

The following settings are available:

Value	Description	Explanation
0	none	No sorting
1	Ascending	Ascending order, starting at the lowest value.
2	Descending	Descending order, starting at the highest value.

The attribute can be assigned dynamic properties by means of the name **HitlistColumnSort**. The data type is LONG.

## HitlistColumnSortIndex property

### HitlistColumnSortIndex

Defines the sorting order of the message block referenced in "HitlistColumnIndex" in the hitlist. The sorting criterion is removed from "HitlistColumnSort" if you set a "0" value..

The attribute can be assigned dynamic properties by means of the name **HitlistColumnSortIndex**. The data type is LONG.

## HitlistColumnVisible

### Selected message blocks - MessageColumnVisible/HitlistColumnVisible

Selected message blocks of message list or hitlist that are displayed in Runtime. Defines whether the message block referenced in "MessageColumnIndex" or "HitlistColumnIndex" is displayed.

The attribute for the message list can be assigned dynamic properties by means of the name **MessageColumnVisible**.

The attribute for the hitlist can be assigned dynamic properties by means of the name **HitlistColumnVisible**.

The data type is BOOLEAN.

## HitlistDefaultSort property

### HitlistDefaultSort

Defines the default sorting order in the table columns of the hitlist.

The following settings are available:

Value	Description	Explanation
0	Ascending	The list is sorted in ascending order based on frequency.
1	Descending	The list is sorted in descending order based on frequency.

The attribute can be assigned dynamic properties by means of the name **HitlistDefaultSort**. The data type is LONG.

### HitListMaxSourceItems property

#### Maximum number of data records - HitListMaxSourceItems

Defines the maximum number of data records for statistics.

The attribute can be assigned dynamic properties by means of the name **HitListMaxSourceItems**. The data type is LONG.

### HitListMaxSourceItemsWarn property

#### Warning when maximum is reached - HitListMaxSourceItemsWarn

Enables the output of a warning notice after the valid number of data records was reached.

Value	Explanation
TRUE	A warning is output after the valid maximum number of data records was reached.
FALSE	A warning is not output after the valid maximum number of data records was reached.

The attribute can be assigned dynamic properties by means of the name **HitListMaxSourceItemsWarn**. The data type is BOOLEAN.

### HitListRelTime property

#### Time range for statistics - HitListRelTime

Sets a time range for the statistics.

Value	Explanation
TRUE	The time range set for statistics is used if this range was not defined in the selection.
FALSE	The time range is not used.

The attribute can be assigned dynamic properties by means of the name **HitListRelTime**. The data type is BOOLEAN.



**HitListRelTimeFactor property****Time range - HitListRelTimeFactor**

Defines the factor for calculating the time range. Only integer factors are valid.

The attribute can be assigned dynamic properties by means of the name **HitListRelTimeFactor**. The data type is LONG.

**HitListRelTimeFactorType property****Time range - HitListRelTimeFactorType**

Defines the time unit for calculating the time range.

The following time units are available:

Value	Description
0	Minute
1	Hour
2	Day
3	Week
4	Month

The attribute can be assigned dynamic properties by means of the name **HitListMaxRelTimeFactorType**. The data type is LONG.

**Ho - Hy****HorizontalGridLines property****Horizontal - HorizontalGridLines**

Defines whether horizontal separating lines will be displayed.

Value	Explanation
TRUE	Enables the display of horizontal dividers.
FALSE	Disables the display of horizontal dividers.

The attribute can be assigned dynamic properties by means of the name **HorizontalGridLines**. The data type is BOOLEAN.

## Hotkey Property

### Description

Returns the function key related to the mouse operation in respect of a button object.  
Read only access.

### See also

Button (Page 201)  
ScreenItem Object (Page 125)

## HourNeedleHeight Property

### Description

Defines or returns the length of the hour hand for the analog clock. The specification of the length is entered as a percentage value in relation to half the length of the short side of the rectangular background. Write/Read access.

Example:

The shorter side of the rectangular background is 100 pixels long.  
The hour hand length is 50.  
This results in a length of the hour hand of  $(100 \text{ pixels} / 2) * 0.5 = 25 \text{ pixels}$ .

### See also

WinCC Digital/Analog Clock (Page 246)  
ScreenItem Object (Page 125)

## HourNeedleWidth Property

### Description

Defines or returns the width of the hour hand for the analog clock. The width is specified as a percentage value related to double the length of the hour hand. Write/Read access.

Example:

The length of the hour hand is 25 pixels.  
The hour hand width is 10.  
This results in a width of the hour hand of  $25 \text{ pixels} * 2 * 0.1 = 5 \text{ pixels}$ .

### See also

WinCC Digital/Analog Clock (Page 246)  
ScreenItem Object (Page 125)

## Hysteresis Property

### Description

TRUE, when the display should appear with hysteresis. BOOLEAN write-read access.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## HysteresisRange Property

### Description

Defines the hysteresis in % of the displayed value or returns it.  
The Hysteresis property must be set to TRUE for the hysteresis to be calculated.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## 1.14.4.10 I

## IconSpace property

### IconSpace

Defines the spacing between the icons and text in the table cells. The value is active if and icon and text are displayed.

The attribute can be assigned dynamic properties by means of the name **IconSpace**. The data type is LONG.

## IndependentWindow property

### Description

Defines whether the display of the picture window in Runtime depends on the process picture in which the picture window was configured.

TRUE if the size and position of the picture window are independent of the process picture and only defined by the "Window mode" attribute.

FALSE if the size and position of the picture window change with the shift or scaling of the process picture.

## Index Property

### Description

#### **Check box, radio box**

Defines or returns the number (0 to 31) of the field whose text is to be defined.

#### **Combo box, list box**

Defines or returns the number (0 to 31) of the line whose text is to be defined.

#### **Polygon, polyline, tube polygon**

Defines or returns the number of the corner point whose position coordinates are to be modified or displayed.

#### **WinCC online trend control, WinCC online table control, WinCC function trend control**

The "Index" property is evaluated by other properties in order to be able to assign the settings to a specific trend or column pair. The valid values for the index move within the range from 0 to (NumItems - 1). The "NumItems" properties contains the number of the trends/column pairs to be displayed. The index must always be set before you change the properties of a trend / column in runtime.

#### **Status display**

Defines the status (0 to 255) or returns it. A basic picture and flash picture can be defined for each status value.

### See also

Status display (Page 199)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Function Trend Control (before WinCC V7) (Page 288)

Polyline (Page 158)

Polygon (Page 156)

Radio box (Page 207)

Check box (Page 204)

ScreenItem Object (Page 125)

## InnerBevelOffset Property

### Description

Defines the distance between the inner and outer bevels.

### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## InnerBevelStyle Property

### Description

Defines the 3D effect for the inner bevel of the object.

- 0: No border.
- 1: The border is displayed depressed.
- 2: The border is displayed raised.
- 3: The border is displayed in one color without a 3D effect. The border color is defined by the "BevelColorDown" property.

### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## InnerBevelWidth Property

### Description

Defines the width of the inner bevel in pixels.

### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## InputValue property

### Description

Defines the value to be entered by the user in the I/O field. The value is not displayed in the I/O field when the property is set.

If you want the value to be displayed in the I/O field after confirmation with the <Return> key, configure a direct connection between the properties "input value" and "output value". The direct connection is only practical when no tag is connected to the output value, but the user can nevertheless query the specified value, for example, through a script.

LONG write-read access.

### See also

Example: Calling Methods of an ActiveX Control (Page 841)

## InsertData Property

### Description

Inserts data for the current trend.

TRUE : "DataIndex" is ignored and the data is appended to that in the data buffer.

FALSE : The data is inserted at the "DataIndex" position in the data buffer.

The trend window is redrawn following each operation involving "Insert Data".

---

### Note

The property is only supported for the controls prior to WinCC V7.

---

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## Instance property

### Description

Returns an instance of the alarm object.

### See also

Alarms object (list) (Page 110)

## ItemBorderBackColor Property

### Description

Defines or returns the background color for dividing lines in the selection list of the text list object. LONG write-read access. The background color is only visible with the property setting ItemBorderStyle > 0.

### See also

Text list (Page 196)  
ScreenItem Object (Page 125)

## ItemBorderColor Property

### Description

Defines or returns the color for deviding lines in the selection list of the text list object. LONG write-read access.

### See also

Text list (Page 196)  
ScreenItem Object (Page 125)

## ItemBorderStyle Property

### Description

Defines or returns the color for the dividing line style in the selection list of the text list object. Value range from 0 to 4.

0 = solid line  
1 = dashed line  
2 = dotted line  
3 = dash-dotted line  
4 = dash-dot-dot line

### See also

Text list (Page 196)  
ScreenItem Object (Page 125)

## ItemBorderWidth Property

### Description

Defines or returns the dividing line weight in pixels in the selection list of the text list object.

### See also

Text list (Page 196)

ScreenItem Object (Page 125)

## ItemProviderCIsid Property

### Description

"ItemProviderCIsid" shows, if the trend referenced using Index in Trend Control is connected with an archive tag or an online tag.

Notice: If you assign a value to the "ProviderCIsid" property, you will overwrite the trend-specific property "ItemProviderCIsid".

- {416A09D2-8B5A-11D2-8B81-006097A45D48}: The trend is connected to an archive tag.
- {A3F69593-8AB0-11D2-A440-00A0C9DBB64E}: The trend is connected to an online tag.

If the trends are being supplied with archive and online tags, the property "ProviderCIsid" returns the value "{00000000-0000-0000-0000-000000000000}".

## ItemVisible Property

### Description

TRUE, when a trend or a column pair reference by the "Index" property is visible. BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)



1.14.4.11 L

**Lab - Las**

**Label Property**

**Description**

The "Index" property references a trend. Label is used to define the name of the time axis or value axis in accordance with the value of the "TimeAxis" property.

**See also**

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

**LabelColor Property**

**Description**

Defines the color of the scale label.

**See also**

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

**LabelX Property**

**Description**

Defines or returns the label on the X-axis for a trend referenced by "Index" according to the value of "TimeAxisX". Write/Read access.

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## LabelY Property

### Description

Defines or returns the label on the Y-axis for a trend referenced by "Index" according to the value of "TimeAxisY". Write/Read access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## LanguageSwitch Property

### Description

Returns the value which defines where the language dependent assigned texts are stored. Read only access.

TRUE, when the texts in the Text Library are managed. Translation to other language occurs in the Text Library.

FALSE, when the texts are managed directly in the object. Translation to other language can be carried out using Text Distributor.

### See also

Text list (Page 196)

ScreenItem Object (Page 125)

## Language Property

### Description

Defines the current Runtime language or reads it.

You specify the Runtime language in VBS by using a country code, e.g., 1031 for German - Default, 1033 for English - USA etc. A summary of all country codes may be found in the Basics of VBScript under the subject header "Regional Scheme ID (LCID) Diagram".

INTEGER (write-read access)

**Example:**

The following example sets the data language to German:

```
'VBS76
HMIRuntime.Language = 1031
```

**See also**

HMIRuntime Object (Page 118)

**LastError Property****Description**

Returns an error code regarding the success of the last operation, e.g. information on a tag write or read process. The "QualityCode" property can provide information on the quality of the returned value. A description of the error can be called in using the "ErrorDescription" property.

LONG (read only)

The following error codes are defined:

Code in hexadecimal notation	Description
0x00000000	OK
0x80040001	Execution error
0x80040002	Tag error
0x80040003	Server not available.
0x80040004	Multi Tag Error (Error in one or several tags)

In order that LastError returns a value, a read must be executed beforehand.

If an error occurs during read or write of several tags using the TagSet object, the error is set to "Multi Tag Error". In order to determine at which tag the error occurred and what type of error it was, the LastError property of each tag must be analyzed.

**Example:**

The following example displays the error code for "Tag1":

```
'VBS77
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Read
MsgBox objTag.LastError
```

## 1.14 VBS Reference

The following example adds two tags to the TagSet list and outputs the LastError property as Trace.

```
'VBS178
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
group.Add "Motor1"
group.Add "Motor2"
HMIRuntime.Trace "LastError: " & group.LastError & vbNewLine
```

The LastError property of a tag contained in the list may be accessed as follows:

```
HMIRuntime.Trace "LastError: " & group("Motor1").LastError & vbNewLine
```

### See also

- TagSet Object (List) (Page 141)
- QualityCode Property (Page 546)
- ErrorDescription Property (Page 411)
- Tag Object (Page 137)

### Layer

#### Layer Property

#### Description

Returns the layer of the picture in which the object is located. There is a total of 32 layers available, whereby Layer "0" is the bottom layer and Layer "31" the top layer.

The configured objects are initially in the background of a layer.

LONG (read only)

---

#### Note

The layer property specifies the layer in which the object is located. The layer "0" is output as "Layer0".

When accessed, the layers are counted up from 1 in VBS. Therefore, the layer "1" must be addressed with "layers(2)".

---

**Example:**

The following example displays the name and layer of all the objects in the picture "NewPDL1":

```
'VBS78
Dim objScreen
Dim objScrItem
Dim lngAnswer
Dim lngIndex
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
strName = objScreen.ScreenItems.Item(lngIndex).ObjectName
Set objScrItem = objScreen.ScreenItems(strName)
lngAnswer = MsgBox(strName & " is in layer " & objScrItem.Layer,vbOKCancel)
If vbCancel = lngAnswer Then Exit For
Next
```

**See also**

ScreenItem Object (Page 125)

**Layer00Checked Property****Description**

TRUE, when limit 0 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer00Value and Layer00Color properties.

**See also**

3D Bar (Page 169)

ScreenItem Object (Page 125)

**Layer01Checked Property****Description**

TRUE, when limit 1 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer01Value and Layer01Color properties.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

### Layer02Checked Property

#### Description

TRUE, when limit 2 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer02Value and Layer02Color properties.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

### Layer03Checked Property

#### Description

TRUE, when limit 3 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer03Value and Layer03Color properties.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

### Layer04Checked Property

#### Description

TRUE, when limit 4 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer04Value and Layer04Color properties.

### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## Layer05Checked Property

### Description

TRUE, when limit 5 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer05Value and Layer05Color properties.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer06Checked Property

### Description

TRUE, when limit 6 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer06Value and Layer06Color properties.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer07Checked Property

### Description

TRUE, when limit 7 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer07Value and Layer07Color properties.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer08Checked Property

### Description

TRUE, when limit 8 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer08Value and Layer08Color properties.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer09Checked Property

### Description

TRUE, when limit 9 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer09Value and Layer09Color properties.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer10Checked Property

### Description

TRUE, when limit 10 should be monitored. BOOLEAN write/read access.  
Limit value and representation are defined with the Layer10Value and Layer10Color properties.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)



## Layer00Color Property

### Description

Defines or returns the color for limit 0. LONG write/read access.  
When monitoring of the limit value is activated (Layer00Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer01Color Property

### Description

Defines or returns the color for limit 1. LONG write/read access.  
When monitoring of the limit value is activated (Layer01Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer02Color Property

### Description

Defines or returns the color for limit 2. LONG write/read access.  
When monitoring of the limit value is activated (Layer02Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer03Color Property

### Description

Defines or returns the color for limit 3. LONG write/read access.  
When monitoring of the limit value is activated (Layer03Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer04Color Property

### Description

Defines or returns the color for limit 4. LONG write/read access.  
When monitoring of the limit value is activated (Layer04Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer05Color Property

### Description

Defines or returns the color for limit 5. LONG write/read access.  
When monitoring of the limit value is activated (Layer05Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer06Color Property

### Description

Defines or returns the color for limit 6. LONG write/read access.  
When monitoring of the limit value is activated (Layer06Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer07Color Property

### Description

Defines or returns the color for limit 7. LONG write/read access.  
When monitoring of the limit value is activated (Layer07Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer08Color Property

### Description

Defines or returns the color for limit 8. LONG write/read access.  
When monitoring of the limit value is activated (Layer08Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer09Color Property

### Description

Defines or returns the color for limit 9. LONG write/read access.  
When monitoring of the limit value is activated (Layer09Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer10Color Property

### Description

Defines or returns the color for limit 10. LONG write/read access.  
When monitoring of the limit value is activated (Layer10Checked property), the bar turns to the color defined by this attribute on reaching the limit value.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer00FillColor property

### Bar fill color 0 (Layer00FillColor)

The "Layer00FillColor" attribute defines the color with which the bar is filled in relation to "Limit 0".

The "Layer00FillColor" attribute can be made dynamic with the name "Layer00FillColor".

## Layer01FillColor property

### Layer01FillColor

The "Layer01FillColor" attribute defines the color with which the bar is filled in relation to "Limit 1".

The "Layer01FillColor" attribute can be made dynamic with the name "Layer01FillColor".

## Layer02FillColor property

### Layer02FillColor

The "Layer02FillColor" attribute defines the color with which the bar is filled in relation to "Limit 2".

The "Layer02FillColor" attribute can be made dynamic with the name "Layer02FillColor".

#### **Layer03FillColor property**

##### **Layer03FillColor**

The "Layer03FillColor" attribute defines the color with which the bar is filled in relation to "Limit 3".

The "Layer03FillColor" attribute can be made dynamic with the name "Layer03FillColor".

#### **Layer04FillColor property**

##### **Layer04FillColor**

The "Layer04FillColor" attribute defines the color with which the bar is filled in relation to "Limit 4".

The "Layer04FillColor" attribute can be made dynamic with the name "Layer04FillColor".

#### **Layer05FillColor property**

##### **Layer05FillColor**

The "Layer05FillColor" attribute defines the color with which the bar is filled in relation to "Limit 5".

The "Layer05FillColor" attribute can be made dynamic with the name "Layer05FillColor".

#### **Layer06FillColor property**

##### **Layer06FillColor**

The "Layer06FillColor" attribute defines the color with which the bar is filled in relation to "Limit 6".

The "Layer06FillColor" attribute can be made dynamic with the name "Layer06FillColor".

#### **Layer07FillColor property**

##### **Layer07FillColor**

The "Layer07FillColor" attribute defines the color with which the bar is filled in relation to "Limit 7".

The "Layer07FillColor" attribute can be made dynamic with the name "Layer07FillColor".

#### **Layer08FillColor property**

##### **Layer08FillColor**

The "Layer08FillColor" attribute defines the color with which the bar is filled in relation to "Limit 8".

The "Layer08FillColor" attribute can be made dynamic with the name "Layer08FillColor".

### **Layer09FillColor property**

#### **Layer09FillColor**

The "Layer09FillColor" attribute defines the color with which the bar is filled in relation to "Limit 9".

The "Layer09FillColor" attribute can be made dynamic with the name "Layer09FillColor".

### **Layer10FillColor property**

#### **Layer10FillColor**

The "Layer10FillColor" attribute defines the color with which the bar is filled in relation to "Limit 10".

The "Layer10FillColor" attribute can be made dynamic with the name "Layer10FillColor".

### **Layer00FillStyle property**

#### **Layer00FillStyle**

The "Layer00FillStyle" attribute defines the style of the bar in relation to "Limit 0". For the fill pattern to become visible, "bar fill color 0" must differ from "bar color 0".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer00FillStyle" attribute can be made dynamic with the name "Layer00FillStyle".

### **Layer01FillStyle property**

#### **Layer01FillStyle**

The "Layer01FillStyle" attribute defines the style of the bar in relation to "Limit 1". For the fill pattern to become visible, "bar fill color 1" must differ from "bar color 1".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer01FillStyle" attribute can be made dynamic with the name "Layer01FillStyle".

### **Layer02FillStyle property**

#### **Layer02FillStyle**

The "Layer02FillStyle" attribute defines the style of the bar in relation to "Limit 2". For the fill pattern to become visible, "bar fill color 2" must differ from "bar color 2".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer02FillStyle" attribute can be made dynamic with the name "Layer02FillStyle".

### Layer03FillStyle property

#### Layer03FillStyle

The "Layer03FillStyle" attribute defines the style of the bar in relation to "Limit 3". For the fill pattern to become visible, "bar fill color 3" must differ from "bar color 3".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer03FillStyle" attribute can be made dynamic with the name "Layer03FillStyle".

### Layer04FillStyle property

#### Layer04FillStyle

The "Layer04FillStyle" attribute defines the style of the bar in relation to "Limit 4". For the fill pattern to become visible, "bar fill color 4" must differ from "bar color 4".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer04FillStyle" attribute can be made dynamic with the name "Layer04FillStyle".

### Layer05FillStyle property

#### Layer05FillStyle

The "Layer05FillStyle" attribute defines the style of the bar in relation to "Limit 5". For the fill pattern to become visible, "bar fill color 5" must differ from "bar color 5".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer05FillStyle" attribute can be made dynamic with the name "Layer05FillStyle".

### Layer06FillStyle property

#### Layer06FillStyle

The "Layer06FillStyle" attribute defines the style of the bar in relation to "Limit 6". For the fill pattern to become visible, "bar fill color 6" must differ from "bar color 6".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer06FillStyle" attribute can be made dynamic with the name "Layer06FillStyle".

### Layer07FillStyle property

#### Layer07FillStyle

The "Layer07FillStyle" attribute defines the style of the bar in relation to "Limit 7". For the fill pattern to become visible, "bar fill color 7" must differ from "bar color 7".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer07FillStyle" attribute can be made dynamic with the name "Layer07FillStyle".

### Layer08FillStyle property

#### Layer08FillStyle

The "Layer08FillStyle" attribute defines the style of the bar in relation to "Limit 8". For the fill pattern to become visible, "bar fill color 8" must differ from "bar color 8".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer08FillStyle" attribute can be made dynamic with the name "Layer08FillStyle".

### Layer09FillStyle property

#### Layer09FillStyle

The "Layer09FillStyle" attribute defines the style of the bar in relation to "Limit 9". For the fill pattern to become visible, "bar fill color 9" must differ from "bar color 9".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer09FillStyle" attribute can be made dynamic with the name "Layer09FillStyle".

### Layer10FillStyle property

#### Layer10FillStyle

The "Layer10FillStyle" attribute defines the style of the bar in relation to "Limit 10". For the fill pattern to become visible, "bar fill color 10" must differ from "bar color 10".

There is a choice of 50 fill styles. The 0 "Solid" fill style fills the object with the set background color. The 1 "Transparent" fill style means neither a background nor a fill pattern is displayed.

The "Layer10FillStyle" attribute can be made dynamic with the name "Layer10FillStyle".

### Layer00Value Property

#### Description

Determines the value for "Limit 0" or returns it.

Monitoring only takes effect when the Layer00Checked property value is set to TRUE.

#### See also

3D Bar (Page 169)

ScreenItem Object (Page 125)



## Layer01Value Property

### Description

Determines the value for "Limit 1" or returns it.  
Monitoring only takes effect when the Layer01Checked property value is set to TRUE.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer02Value Property

### Description

Determines the value for "Limit 2" or returns it.  
Monitoring only takes effect when the Layer02Checked property value is set to TRUE.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer03Value Property

### Description

Determines the value for "Limit 3" or returns it.  
Monitoring only takes effect when the Layer03Checked property value is set to TRUE.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer04Value Property

### Description

Determines the value for "Limit 4" or returns it.  
Monitoring only takes effect when the Layer04Checked property value is set to TRUE.

## See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## Layer05Value Property

### Description

Determines the value for "Limit 5" or returns it.  
Monitoring only takes effect when the Layer05Checked property value is set to TRUE.

## See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## Layer06Value Property

### Description

Determines the value for "Limit 6" or returns it.  
Monitoring only takes effect when the Layer06Checked property value is set to TRUE.

## See also

3D Bar (Page 169)

ScreenItem Object (Page 125)

## Layer07Value Property

### Description

Determines the value for "Limit 7" or returns it.  
Monitoring only takes effect when the Layer07Checked property value is set to TRUE.

## See also

ScreenItem Object (Page 125)

3D Bar (Page 169)

## Layer08Value Property

### Description

Determines the value for "Limit 8" or returns it.  
Monitoring only takes effect when the Layer08Checked property value is set to TRUE.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer09Value Property

### Description

Determines the value for "Limit 9" or returns it.  
Monitoring only takes effect when the Layer09Checked property value is set to TRUE.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## Layer10Value Property

### Description

Determines the value for "Limit 10" or returns it.  
Monitoring only takes effect when the Layer10Checked property value is set to TRUE.

### See also

3D Bar (Page 169)  
ScreenItem Object (Page 125)

## LayerDeclutteringEnable Property

### Description

Returns the LayerDecluttering properties of a picture.  
LayerDecluttering enables fading in and out of layers depending on the set minimum and maximum zoom.

BOOLEAN Read-only access.

**Example:**

The example outputs the LayerDecluttering Property NewPDL1 as a trace.

```
'VBS156
Dim objScreen
Set objScreen = HMIRuntime.Screens("NewPDL1")
HMIRuntime.Trace "Enable: " & objScreen.LayerDeclutteringEnable & vbNewLine
```

**See also**

Screen Object (Page 131)

**Layers Property**

**Description**

Returns an object of type "Layers".

Layers (read-only)

**See also**

Layers Object (Listing) (Page 121)

HMIRuntime Object (Page 118)

**Le - Li**

**Left Property**

**Description**

Defines or returns the X-coordinate of an object (measured from the top left edge of the picture) in pixels. The X-coordinate relates to the top left corner of the rectangle enclosing the object.

LONG (write-read access)

**Example:**

The following example shifts all objects in the picture "NewPDL1" 5 pixels to the left:

```
'VBS79
Dim objScreen
Dim objScrItem
Dim lngIndex
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
strName = objScreen.ScreenItems.Item(lngIndex).ObjectName
Set objScrItem = objScreen.ScreenItems(strName)
objScrItem.Left = objScrItem.Left - 5
Next
```

**See also**

[Top Property \(Page 643\)](#)

[ScreenItem Object \(Page 125\)](#)

**LeftComma Property****Description**

Defines or returns the number of digits to the left of the decimal point (0 to 20).

**See also**

[Bar \(Page 174\)](#)

[ScreenItem Object \(Page 125\)](#)

**LightEffect Property****Description**

TRUE, when the light effect should be activated. BOOLEAN write-read access.

**See also**

[3D Bar \(Page 169\)](#)

[ScreenItem Object \(Page 125\)](#)

## LimitHigh4 Property

### Description

Determines the upper limit value for "Reserve 4" or returns it.

The CheckLimitHigh4 property must be set to TRUE in order that the "Reserve 4" limit value can be monitored.

The type of the evaluation (in percent or absolute) is defined in the TypeLimitHigh4 property.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## LimitHigh5 Property

### Description

Determines the upper limit value for "Reserve 5" or returns it.

The CheckLimitHigh5 property must be set to TRUE in order that the "Reserve 5" limit value can be monitored.

The type of the evaluation (in percent or absolute) is defined in the TypeLimitHigh5 property.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## LimitLow4 Property

### Description

Determines the lower limit value for "Reserve 4" or returns it.

The CheckLimitLow4 property must be set to TRUE in order that the "Reserve 4" limit value can be monitored.

The type of the evaluation (in percent or absolute) is defined in the TypeLimitLow4 property.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## LimitLow5 Property

### Description

Determines the lower limit value for "Reserve 5" or returns it.  
The CheckLimitLow5 property must be set to TRUE in order that the "Reserve 5" limit value can be monitored.  
The type of the evaluation (in percent or absolute) is defined in the TypeLimitLow5 property.

### See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## LimitMax Property

### Description

Determines the upper limit value as an absolute value depending on the data format or returns it.  
If the displayed value exceeds the upper limit value, it is displayed by a sequence of \*\*\* (not displayable).

### See also

I/O Field (Page 184)  
ScreenItem Object (Page 125)

## LimitMin Property

### Description

Determines the lower limit value as an absolute value depending on the data format or returns it.  
If the displayed value exceeds the upper limit value, it is displayed by a sequence of \*\*\* (not displayable).

### See also

I/O Field (Page 184)  
ScreenItem Object (Page 125)

## LineColor property

### Color of window dividers - LineColor

Specifies the color of the window dividers. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **LineColor**. The data type is LONG.

## LineFont Property

### Description

TRUE, when the font size should be automatically adapted to the line height. BOOLEAN write-read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## LineHeight Property

### Description

TRUE, when the line height can be modified. BOOLEAN write-read access.

The "LineHeight" property is only deactivated if both properties "LineHeight" and "LineFont" are set to "FALSE".

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## LineJoinStyle property

### Description

Defines the way that corners are displayed in a tube polygon.

Angle The tubes are joined at corner points without rounding

Round The tubes are rounded at the outside corner points.



## LineTitle Property

### Description

TRUE, when the message window a column with consecutive number contains queued messages. BOOLEAN write-read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## LineWidth property (before WinCC V7)

### Description

Specifies the line width of the trend referenced by "Index". Value range from 0 to 10.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## LineWidth property

### Line weight of window dividers - LineWidth

Defines the line weight of the window dividers in pixels.

The attribute can be assigned dynamic properties by means of the name **LineWidth**. The data type is LONG.

## ListType Property

### Description

Returns the data type displayed in the case of a text list object. Read only access.

Value range from 0 to 2.

0 = decimal

1 = binary

2 = bit

**See also**

- Text list (Page 196)
- ScreenItem Object (Page 125)

**Lo**

**LoadDataImmediately property**

**Load archive data - LoadDataImmediately**

Defines whether the tag values for the time range to be displayed are loaded from the archives when the picture is called.

Value	Explanation
TRUE	Loads archived values on picture calls.
FALSE	Loads only current values on picture calls.

The attribute can be assigned dynamic properties by means of the name **LoadDataImmediately**. The data type is BOOLEAN.

**LoadDataImmediately property (before WinCC V7)**

**Description**

TRUE, when the tag values for the time range to be displayed are loaded from the archives on opening a picture. BOOLEAN write-read access.

**See also**

- WinCC Online Table Control (before WinCC V7) (Page 292)
- WinCC Online Trend Control (before WinCC V7) (Page 295)
- WinCC Function Trend Control (before WinCC V7) (Page 288)
- ScreenItem Object (Page 125)

**LocaleID Property**

**Description**

Defines the language to be displayed in the control, e.g. 1031 for German. Write/Read access. The list of language codes is available in the WinCC documentation (Index > Language Code).

## See also

WinCC Slider Control (Page 277)  
WinCC Gauge Control (Page 254)  
WinCC Digital/Analog Clock (Page 246)  
ScreenItem Object (Page 125)

## LocaleSpecificSettings Property

### Description

TRUE if a font can be assigned and formatted for each Runtime language. BOOLEAN write-read access.

## LockBackColor Property

### Description

Defines or returns the background color of the button for a locked measuring point. LONG write/read access.  
The LockStatus property must be set to TRUE for the background color to be displayed.

## See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## LockStatus Property

### Description

TRUE, when a locked measuring point should be displayed. BOOLEAN write-read access.

## See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## LockText Property

### Description

Defines the label of a button for a locked measuring point.  
The LockStatus property must be set to TRUE for the label to be displayed.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## LockTextColor Property

### Description

Defines or returns the color of the button label for a locked measuring point. LONG write/read access.  
The LockStatus property must be set to TRUE for the background color to be displayed.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## Logging Property

### Description

Returns an object of type "Logging".  
Logging (read-only)

### See also

HMIRuntime Object (Page 118)  
Logging Object (Page 122)

## LongStrokesBold Property

### Description

TRUE, when the long sections of a scale should be displayed in bold face. BOOLEAN write-read access.

**See also**

Bar (Page 174)  
ScreenItem Object (Page 125)

**LongStrokesOnly Property**

**Description**

TRUE, when only the long sections of a scale should be displayed . BOOLEAN write-read access.

**See also**

Bar (Page 174)  
ScreenItem Object (Page 125)

**LongStrokesSize Property**

**Description**

Defines or returns the length of the axis section in pixels.

**See also**

Bar (Page 174)  
ScreenItem Object (Page 125)

**LongStrokesTextEach Property**

**Description**

Returns the value which defines which sections of the scale displayed should be labeled (1 = every section, 2 = every second section, etc.). Read only access

**See also**

Bar (Page 174)  
ScreenItem Object (Page 125)

## LongTimeArchiveConsistency Property

### LongTimeArchiveConsistency

If "LongTimeArchiveConsistency" is set to "No", 1000 messages are displayed in the long-term archive list on the single-user system, server or client for each server, or for each redundant server pair.

If the "LongTimeArchiveConsistency" is set to "yes", the most recent 1000 messages are displayed on the client of all servers or redundant server pair in the long-term archive list.

The attribute can be assigned dynamic properties by means of the name **LongTimeArchiveConsistency**. The data type is BOOLEAN.

### LongTimeArchiveConsistency property (before WinCC V7)

#### Description

If "LongTimeArchiveConsistency" is set to "No", 1000 messages are displayed in the long-term archive list in the single-user system, server or client for each server or for each redundant server pair.

If the "LongTimeArchiveConsistency" is set to "yes", the most recent 1000 messages are displayed on the client of all servers or redundant server pair in the long-term archive list.

Write/Read access.

## LowerLimit Property

#### Description

##### WinCC Online Trend Control/WinCC Function Trend Control

TRUE, when the "LowerLimitColor" specification is to be used in order to identify the tag values (from a trend referenced via "Index") which lie below the value defined in "LowerLimitValue".  
BOOLEAN write-read access.

##### WinCC Online Trend Control

The value of this attribute cannot be changed. Read only access.

#### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## LowerLimitColor Property

### Description

#### **WinCC Online Trend Control/WinCC Function Trend Control**

Defines the color to be used in order to identify the tag values (from trend referenced via "Index") which lie below the value defined in "LowerLimitValue". Whether the information is evaluated is dependent on the value of the "LowerLimit" property. The color is defined as an RGB value. LONG write-read access.

#### **Online Table Control**

The value of this attribute cannot be changed. Read only access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## LowerLimitTagName Property

### Description

This defines the lower limit of the trend range, which is automatically taken from the variable properties configured in PCS 7. Write/Read access.

## LowerLimitValue Property

### Description

#### **WinCC Online Trend Control/WinCC Function Trend Control**

Tag values (from a trend referenced via "Index") which lie below the value defined by "LowerLimitValue" are identified by the color specified in "LowerLimitColor". Whether the information is evaluated is dependent on the value of the "LowerLimit" attribute.

#### **Online Table Control**

The value of this attribute cannot be changed. Read only access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

#### 1.14.4.12 M

### Ma - Mc

#### Marker Property

##### Description

TRUE, when the limit values should be displayed as scale values. BOOLEAN write-read access.

##### See also

Bar (Page 174)

ScreenItem Object (Page 125)

#### Max Property

##### Description

Defines or returns the absolute value in the case of a full value display. This value is displayed if the scale display is active.

##### See also

Bar (Page 174)

Slider (Page 212)

3D Bar (Page 169)

ScreenItem Object (Page 125)

#### MaximizeButton Property

##### Description

TRUE, when the object can be maximized in Runtime. Read only access.



## See also

Picture Window (Page 179)  
Application Window (Page 173)  
ScreenItem Object (Page 125)

## MCGUBackColorOff-Eigenschaft

### Description

Defines or returns the background color for flash status "Off" in the case of the "Departed Unacknowledged" status. LONG write-read access.

## See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCGUBackColorOn Property

### Description

Defines or returns the background color for flash status "On" in the case of the "Departed Unacknowledged" status. LONG write-read access.

## See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCGUBackFlash Property

### Description

TRUE, when the background should flash when a message departs unacknowledged. BOOLEAN write-read access.

## See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCGUTextColorOff Property

### Description

Defines or returns the color of the text for flash status "Off" in the case of the "Departed Unacknowledged" status. LONG write-read access.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCGUTextColorOn Property

### Description

Defines or returns the background color of the text for flash status "Off" in the case of the "Departed Unacknowledged" status. LONG write-read access.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCGUTextFlash Property

### Description

TRUE, when the font should flash when a message departs unacknowledged. BOOLEAN write-read access.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCKOBackColorOff Property

### Description

Defines or returns the background color for flash status "Off" in the case of the "Arrived" status. LONG write-read access.

**See also**

Group Display (Page 194)  
ScreenItem Object (Page 125)

**MCKOBackColorOn Property**

**Description**

Defines or returns the background color for flash status "On" in the case of the "Arrived" status. LONG write-read access.

**See also**

Group Display (Page 194)  
ScreenItem Object (Page 125)

**MCKOBackFlash Property**

**Description**

TRUE, when the background should flash when a message arrives. BOOLEAN write-read access.

**See also**

Group Display (Page 194)  
ScreenItem Object (Page 125)

**MCKOTextColorOff Property**

**Description**

Defines or returns the color of the text for flash status "Off" in the case of the "Arrived" status. LONG write-read access.

**See also**

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCKOTextColorOn Property

### Description

Defines or returns the background color of the text for flash status "On" in the case of the "Arrived" status. LONG write-read access.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCKOTextFlash Property

### Description

TRUE, when the font should flash when a message arrives. BOOLEAN write-read access.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCKQBackColorOff Property

### Description

Defines or returns the background color for flash status "Off" in the case of the "Departed Acknowledged" status. LONG write-read access.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCKQBackColorOn Property

### Description

Defines or returns the background color for flash status "On" in the case of the "Departed Acknowledged" status. LONG write-read access.

**See also**

Group Display (Page 194)  
ScreenItem Object (Page 125)

**MCKQBackFlash Property**

**Description**

TRUE, when the background should flash when a message departs acknowledged. BOOLEAN write-read access.

**See also**

Group Display (Page 194)  
ScreenItem Object (Page 125)

**MCKQTextColorOff Property**

**Description**

Defines or returns the color of the text for flash status "Off" in the case of the "Departed Acknowledged" status. LONG write-read access.

**See also**

Group Display (Page 194)  
ScreenItem Object (Page 125)

**MCKQTextColorOn Property**

**Description**

Defines or returns the background color of the text for flash status "On" in the case of the "Departed Acknowledged" status. LONG write-read access.

**See also**

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCKQTextFlash Property

### Description

TRUE, when the font should flash when a message departs acknowledged. BOOLEAN write-read access.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## MCText Property

### Description

Defines or returns the label for the respective message class.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## Me

## MeasurePoints Property

### Description

The "Index" property references a trend. "MeasurePoints" defines the number of measuring points to be displayed. The information is only evaluated when the "TimeAxis" property is set to the value "-1".

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)  
ScreenItem Object (Page 125)

## MenuToolBarConfig Property

### Description

Loads the given configuration file with configured menu and toolbars or returns the name of the configuration file. STRING (write-read access)

### See also

Picture Window (Page 179)

HMIRuntime Object (Page 118)

## MessageBlockAlign property

### Alignment - MessageBlockAlign

Aligns the contents of a selected message block in the table.

To change the alignment, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

The following settings are available:

Value	Description	Explanation
0	Left	Aligns the contents of a selected message block to the left.
1	Centered	Aligns the contents of a selected message block to the center.
2	Right	Aligns the contents of a selected message block to the right.

The attribute can be assigned dynamic properties by means of the name **MessageBlockAlign**. The data type is LONG.

## MessageBlockAutoPrecisions property

### Automatic decimal places - MessageBlockAutoPrecisions

Enables automatic setting of the number of decimal places.

Value	Explanation
TRUE	The number of decimal places is set automatically. The value in the "Decimal places" field is disabled.
FALSE	The value in the "Decimal places" field is enabled.

The attribute can be assigned dynamic properties by means of the name **MessageBlockAutoPrecisions**. The data type is BOOLEAN.

## MessageBlockCaption property

### Label - MessageBlockCaption

Defines the label of the column title in the message window for the selected message block. The label specified is active in all Runtime languages.

To change the label, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

The attribute can be assigned dynamic properties by means of the name **MessageBlockCaption**. The data type is STRING.

## MessageBlockCount property

### MessageBlockCount

Defines the number of message blocks which are available for the message list and the hitlist.

The attribute can be assigned dynamic properties by means of the name **MessageBlockCount**. The data type is LONG.

## MessageBlockDateFormat property

### Date format - MessageBlockDateFormat

Defines the date format for displaying messages.

To change the date format, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

The following date formats are available:

Value	Explanation
Automatic	The date format is set automatically.
dd.MM.yy	Day.Month.Year, e.g. 24.12.07.
dd.MM.yyyy	Day.Month.Year, e.g. 24.12.2007.
dd/MM/yy	Day/Month/Year, e.g. 24/12/07.
dd/MM/yyyy	Day/Month/Year, e.g. 24/12/2007.

The attribute can be assigned dynamic properties by means of the name **MessageBlockDateFormat**. The data type is STRING.



## MessageBlockExponentialFormat property

### Exponential notation - MessageBlockExponentialFormat

Specifies the exponential notation for visualization of the values of a selected message block.

Value	Explanation
TRUE	The values are displayed with exponential notation.
FALSE	The values are displayed with decimal notation.

The attribute can be assigned dynamic properties by means of the name **MessageBlockExponentialFormat**. The data type is BOOLEAN.

## MessageBlockFlashMode property

### Flash mode - MessageBlockFlashMode

Specifies how the content of the selected message block flashes in Runtime when a message appears. The "Flashing on" option must be selected.

To change the setting, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

Value	Description	Explanation
0	Standard	The text color switches between the standard color and the flash color when flashing
1	Switch background color/text color	The color of the background and the text color switch during flashing. You configure the message colors for the type of message in the alarm logging editor.
2	Switch message color/table color	The message colors and the configured table colors switch during flashing. You configure the message colors for the type of message in the alarm logging editor. Set the table colors in the "Layout" tab in the AlarmControl.

The attribute can be assigned dynamic properties by means of the name **MessageBlockFlashMode**. The data type is LONG.

## MessageBlockFlashOn property

### Flashing on - MessageBlockFlashOn

Enables flashing of the selected message block in Runtime after a message was activated.

To change the setting, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

Value	Explanation
TRUE	Flashing message block content.
FALSE	No flashing message block content.

The attribute can be assigned dynamic properties by means of the name **MessageBlockFlashOn**. The data type is BOOLEAN.

### MessageBlockHideText property

#### Content as text - MessageBlockHideText

Enables the textual display of the content of a selected message block.

Value	Explanation
TRUE	The content is not displayed in text format. The option is disabled.
FALSE	The content is displayed in text format. The option is enabled.

The attribute can be assigned dynamic properties by means of the name **MessageBlockHideText**. The data type is BOOLEAN.

### MessageBlockHideTitleText property

#### Title as text - MessageBlockHideTitleText

Enables the display of the header of a selected message block in text format.

Value	Explanation
TRUE	The header is not displayed in text format. The option is disabled.
FALSE	The header is displayed in text format. The option is enabled.

The attribute can be assigned dynamic properties by means of the name **MessageBlockHideTitleText**. The data type is BOOLEAN.

### MessageBlockId property

#### MessageBlockId

Default assignment of the ID number and message block in WinCC AlarmControl.

The attribute can be assigned dynamic properties by means of the name **MessageBlockID**. The data type is LONG.

## MessageBlockInvertUseMessageColor property

### MessageBlockInvertUseMessageColor

Specifies for the message block whether or not the message colors are displayed, contrary to the central setting for the AlarmControl . For example, the "UseMessageColor" property is set to "FALSE" for the AlarmControl. You have set the "MessageBlockInvertUseMessageColor" property to "TRUE" for a message block. This causes the message colors to be displayed for this message block in Runtime.

Value	Explanation
TRUE	Contrary to the central setting in "UseMessageColor", the message colors are displayed or not displayed for the message block.
FALSE	Just like the central setting in "UseMessageColor", the message colors are displayed or not displayed for the message block.

The attribute can be assigned dynamic properties by means of the name **MessageBlockInvertUseMessageColor**. The data type is BOOLEAN.

## MessageBlockIndex property

### MessageBlockIndex

References an existing message block. Using this attribute, you can assign a specific message block values for other attributes.

Values between 0 and "MessageBlockCount" minus 1 are valid for "MessageBlockIndex". Attribute "MessageBlockCount" defines the number of available message blocks.

The attribute can be assigned dynamic properties by means of the name **MessageBlockIndex**. The data type is LONG.

## MessageBlockLeadingZeros property

### Number of digits - MessageBlockLeadingZeros

Defines the number of leading zeros for the message block content. The maximum number is "11". A "0" value deactivates the "With leading zeros" option.

To change the setting, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

The attribute can be assigned dynamic properties by means of the name **MessageBlockLeadingZeros**. The data type is LONG.

## MessageBlockLength property

### Length in characters - MessageBlockLength

Defines the length of the message block selected based on the number of characters.

To change the length, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

The attribute can be assigned dynamic properties by means of the name **MessageBlockLength**. The data type is LONG.

## MessageBlockName property

### Object name - MessageBlockName

Displays the object name of the message block selected. You cannot edit this name.

The data type is STRING.

## MessageBlockPrecisions property

### Decimal places - MessageBlockPrecisions

Specifies the decimal precision of the values of a selected message block. You can only enter the value if the "Automatic" option is disabled.

The attribute can be assigned dynamic properties by means of the name **MessageBlockPrecisions**. The data type is SHORT.

## MessageBlockSelected property

### Available message blocks - MessageBlockSelected

The available message blocks are blocks that can be used in Runtime for the message list or hitlist.

Select the "Message blocks" tab to activate existing message blocks as required in the Control. Select the "Hitlist" and "Message list" tabs to configure the hitlist and message list based on the available blocks.

To change the setting, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

The attribute can be assigned dynamic properties by means of the name **MessageBlockSelected**. The data type is BOOLEAN.

**MessageBlockShowDate property****Show date - MessageBlockShowDate**

Enables the display of a date in the "Time" message block in addition to the time.

Value	Explanation
TRUE	Date and time are displayed.
FALSE	The time is displayed.

The attribute can be assigned dynamic properties by means of the name **MessageBlockShowDate**. The data type is BOOLEAN.

**MessageBlockShowIcon property****Content as icon - MessageBlockShowIcon**

Enables the display of the content of a selected message block as icon.

Value	Explanation
TRUE	The content is visualized as icon.
FALSE	The content is not visualized as icon.

The attribute can be assigned dynamic properties by means of the name **MessageBlockShowIcon**. The data type is BOOLEAN.

**MessageBlockShowTitleIcon property****Title as icon - MessageBlockShowTitleIcon**

Enables the display of the title of a selected message block as icon.

Value	Explanation
TRUE	The header is displayed as icon.
FALSE	The header is not displayed as icon.

The attribute can be assigned dynamic properties by means of the name **MessageBlockShowTitleIcon**. The data type is BOOLEAN.

**MessageBlockTextId property****Text ID - MessageBlockTextId**

Specifies the caption of the selected message block using a Text ID which was derived from the text library. The caption is adapted automatically if a user changes the Runtime language.

To change the setting, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

The attribute can be assigned dynamic properties by means of the name **MessageBlockTextId**. The data type is LONG.

### MessageBlockTimeFormat property

#### MessageBlockTimeFormat

Defines which time format or duration format is used for displaying the messages.

To change the setting, the option "Apply project settings" must be deactivated or "ApplyProjectSettings" must be set to "FALSE".

The following time formats are available:

Value	Explanation
Automatic	The time format is set automatically.
HH:mm:ss	Hours:Minutes:Seconds, e.g. 15:35:44
HH:mm:ss.ms	Hours:Minutes:Seconds.Milliseconds, e.g. 15:35:44.240.
hh:mm:ss tt	Hours:Minutes:Seconds AM/PM, e.g. 03:35:44 PM.
hh:mm:ss.ms tt	Hours:Minutes:Seconds.Milliseconds AM/PM, e.g. 03:35:44.240 PM.

The following time duration formats are available:

Value	Explanation
Automatic	The time duration format is determined automatically.
d H:mm:ss	Day Hours:Minutes:Seconds, e.g. 1 2:03:55.
H:mm:ss.	Hours:Minutes:Seconds, e.g. 26:03:55.
m:ss	Minutes:Seconds, Example: 1563:55.
s	Seconds, e.g. 93835.

The attribute can be made dynamic by means of the name **MessageBlockTimeFormat**. The data type is STRING.

### MessageBlockType property

#### MessageBlockType

Displays the association of the message block.

The following settings are available:

Value	Description	Explanation
0	System block	The message block belongs to the system block category.
1	Text block	The message block belongs to the user text block category.
2	Process value block	The message block belongs to the process value block category.
3	Hitlist block	The message block belongs to the message blocks of the hitlist.

The attribute can be assigned dynamic properties by means of the name **MessageBlockType** . The data type is LONG.

## MessageClass Property

### Description

Defines the respective message type (Alarm High, Alarm Low, Warning High, Warning Low, ...) for which the "Display Text", "Arrived-", "Arrived Acknowledged -" and "Departed Unacknowledged -" settings have been configured.

### See also

Group Display (Page 194)

ScreenItem Object (Page 125)

## MessageColumnAdd property

### MessageColumnAdd

Adds the selected message block from the list of existing message blocks to the list of selected message blocks.

The attribute can be assigned dynamic properties by means of the name **MessageColumnAdd** . The data type is STRING.

## MessageColumnAutoAdjust property

### MessageColumnAutoAdjust

Automatically optimizes the width of the columns in the WinCC AlarmControl in Runtime. If the configured column is not sufficient for the displayed text, the column width is increased.

If the user changes the width of columns in Runtime, the width is only optimized again when the picture is opened again.

The attribute can be assigned dynamic properties using the name **MessageColumnAutoAdjust** . The data type is BOOLEAN.

### See also

MessageColumn object (list) (Page 223)

WinCC AlarmControl (Page 241)

## MessageColumnCount property

### MessageColumnCount

Specifies the number of message blocks to be displayed in the message list in Runtime.

The attribute can be assigned dynamic properties by means of the name **MessageColumnCount** . The data type is LONG.

## MessageColumnIndex property

### MessageColumnIndex

References a message block selected for the message list. Using this attribute you can assign the values of other attributes to a specific message block of the message list.

Values between 0 and "MessageColumnCount" minus 1 are valid for "MessageColumnIndex". Attribute "MessageColumnCount" defines the number of message blocks selected for the message list.

The "MessageColumnIndex" attribute can be assigned dynamic properties by means of attribute **MessageColumnRepos**. The data type is LONG.

## MessageColumnName property

### MessageColumnName

Displays the name of the message block of the message list which is referenced with attribute "MessageColumnIndex". You cannot edit this name.

The attribute can be assigned dynamic properties with the name **MessageColumnName**. The data type is STRING.

## MessageColumnRemove property

### MessageColumnRemove

Cuts the marked message block from the list of selected message blocks and pastes it to the list of available message blocks.

The attribute can be assigned dynamic properties by means of the name **MessageColumnRemove** . The data type is STRING.



## MessageColumnRepos property

### Up/Down - MessageColumnRepos/HitlistColumnRepos

Resorts the message blocks. The "Up" and "Down" commands move the selected message block accordingly in the list. This moves the message block in Runtime Control towards the front or towards the back.

The attribute for the hitlist can be assigned dynamic properties by means of the name **HitlistColumnRepos** .

The attribute for the message list can be assigned dynamic properties by means of the name **MessageColumnRepos**.

The data type is LONG.

## MessageColumnSort property

### MessageColumnSort

Defines the sorting order of the message block referenced in "MessageColumnIndex" .

The following settings are available:

Value	Description	Explanation
0	no	No sorting
1	Ascending	Ascending order, starting at the lowest value.
2	Descending	Descending order, starting at the highest value.

The attribute can be assigned dynamic properties by means of the name **MessageColumnSort** . The data type is LONG.

## MessageColumnSortIndex property

### MessageColumnSortIndex

Defines the sorting order of the message block referenced in "MessageColumnIndex". The sorting criterion is removed from "MessageColumnSort" if you set a "0" value.

The attribute can be assigned dynamic properties by means of the name **MessageColumnSortIndex**. The data type is LONG.

## MessageColumnVisible property

### Selected message blocks - MessageColumnVisible/HitlistColumnVisible

Selected message blocks of message list or hitlist that are displayed in Runtime. Defines whether the message block referenced in "MessageColumnIndex" or "HitlistColumnIndex" is displayed.

The attribute for the message list can be assigned dynamic properties by means of the name **MessageColumnVisible**.

The attribute for the hitlist can be assigned dynamic properties by means of the name **HitlistColumnVisible**.

The data type is BOOLEAN.

## MessageListType property

### Active list on picture call - MessageListType

Selection field for defining the active list for picture calls.

Value	Description	Explanation
0	Message list	The currently active messages are displayed after a picture was called.
1	Short-term archive list	A short-term archive list displays the logged messages after the picture was called. The display is updated immediately on activation of new messages.
2	Long-term archive list	A long-term archive list displays the logged messages after a picture was called.
3	Lock list	Only the currently locked messages are displayed after a picture was called.
4	Hitlist	The configured statistics data is displayed after a picture was called.
5	List of messages to be hidden	The messages to be hidden are displayed at the call of a picture.

The attribute can be assigned dynamic properties by means of the name **MessageListType**. The data type is LONG.

## Mi - Ms

### Min Property

#### Description

Defines or returns the absolute value in the case of the smallest value display. This value is displayed if the scale display is active.

#### See also

Slider (Page 212)

Bar (Page 174)

3D Bar (Page 169)

ScreenItem Object (Page 125)

## MinuteNeedleHeight Property

### Description

Defines or returns the length of the minute hand for the analog clock. The specification of the length is entered as a percentage value in relation to half the length of the short side of the rectangular background. Write/Read access.

Example:

The shorter side of the rectangular background is 100 pixels long.

The minute hand length is 80.

This results in a length of the minute hand of  $(100 \text{ pixels} / 2) * 0.8 = 40 \text{ pixels}$ .

### See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## MinuteNeedleWidth Property

### Description

Defines or returns the width of the minute hand for the analog clock. The width is specified as a percentage value related to double the length of the minute hand.

Example:

The length of the minute hand is 40 pixels.

The minute hand width is 8.

This results in a width of the minute hand of  $40 \text{ pixels} * 2 * 0.08 = 6 \text{ pixels}$ .

### See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## Moveable Property

### Description

TRUE, when the object can be moved in Runtime. Read only access.

### See also

Picture Window (Page 179)

Application Window (Page 173)

ScreenItem Object (Page 125)

## Moveable Property

### Movable

Defines whether the control can be moved in Runtime.

Value	Explanation
TRUE	The control can be moved in Runtime.
FALSE	The control cannot be moved in Runtime.

The attribute can be assigned dynamic properties by means of the name **Moveable**. The data type is BOOLEAN.

## MsgCtrlFlags Property

### Description

Defines the sorting sequence in Alarm Control. Write/Read access.

- 0: The entries are sorted by the value in the time column and in ascending order, i.e. the oldest messages are displayed at the top of the message window.
- 1: The entries are sorted by the value in the time column in descending order, i.e. the oldest messages are displayed at the bottom of the message window. In the case of this value, the "AutoScroll" property is automatically deactivated, otherwise the current message could be moved out of the display area of the message window.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## MsgFilterSQL property (before WinCC V7)

### Description

Defines an SQL Statement to the selected messages displayed in the message window. Write/Read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## MsgFilterSQL property

### MsgFilterSQL

Defines one or several SQL statements for the custom selection of messages. Multiple user-defined selections are logically linked by "OR" operation. The SQL statements of "DefaultMsgFilterSQL" and "MsgFilterSQL" are linked logically by "AND" operation if you define a default selection by means of "DefaultMsgFilterSQL".

The attribute can be assigned dynamic properties by means of the name **MsgFilterSQL**. The data type is STRING.

#### 1.14.4.13 N

## Name Property

### Description of layer and tag object

Returns the object name. STRING (read only)

- In the case of tags, the name of the tag without server and tag prefix
- In the case of layers, the layer name

#### Tags

The tag "Name" property is used to address the tag via the tag list. The name of a tag can contain a server prefix. In WinCC, tag names are structured according to the following scheme:

<Serverprefix>::<Variablenprefix><Name der Variable>

If the tag name alone is specified, the server prefix and tag prefix are removed from the context of the picture.

If the tag is specified with a server prefix in the tag name, the tags and server prefix of the context are ignored and the server prefix included is used.

## WinCC Function Trend Control Description

The "Index" property references a trend. "Name" defines the name of the trend.

## Description Project Object

Returns the name of the current Runtime project. STRING (read only)

#### Example:

The following example returns the name of the current Runtime project as Trace:

```
'VBS160
HMIRuntime.Trace "Name: " & HMIRuntime.ActiveProject.Name & vbNewLine
```

## Description of Dataltem Object

Returns the name of the Dataltem object.

### See also

ActiveProject Property (Page 303)

WinCC Function Trend Control (before WinCC V7) (Page 288)

Tag Object (Page 137)

Ellipse segment (Page 147)

Layer Object (Page 120)

Dataltem Object (Page 113)

## NeedleColor Property

### Description

Defines or returns the color of the pointer. LONG write-read access.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## NormalColor Property

### Description

Defines the color of the normal area of the scale. LONG write-read access.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## NumberLines Property

### Description

#### Text list

Defines the number of lines the text list object should contain or returns the value. If the amount of configured text is larger than this value, the selection list receives a vertical scroll bar.

#### Combo box and list box

Defines the number of lines the combo box and list field object should contain or returns the value. You can set a maximum of 32 000 lines.

At the same time, the value of the "Number of rows" attribute specifies the high limit for the "Index" attribute in the "Font" property group. Changing the value can have the following effects:

- Increasing the number: New lines are added at the bottom. The standard labeling of the new field can be changed using the "Text" attribute in the "Font" property group.
- Reducing the number: All lines are removed for which the value of the "Index" attribute is higher than the new number.

### See also

Text list (Page 196)

ScreenItem Object (Page 125)

## NumItems Property

### Description

Returns the number of trends or column pairs (visible and invisible) in the window which have been configured. Write/Read access.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

#### 1.14.4.14 O

Ob - On

### Object Property

#### Description

If a non-WinCC control is used, it is possible that the properties provided by the control have the same names as the general ScreenItem properties. In such cases, the ScreenItem properties have priority. The "hidden" properties of an external control supplier can be accessed using the additional "object" property.

#### Example:

Address the properties of an external control supplier as follows:

Control.object.type

If the following form alone is used

Control.type

the properties of the ScreenItem object are used in the case of identical names.

#### See also

Controls (Page 218)

ScreenItem Object (Page 125)

### ObjectName Property

#### Description

Returns the object name.

- In the case of graphic objects, the object name
- In the case of pictures, the picture name

STRING (read only)



**Example:**

The following example issues the names of all the objects contained in the picture "NewPDL1":

```
'VBS80
Dim objScreen
Dim lngIndex
Dim lngAnswer
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
strName = objScreen.ScreenItems.Item(lngIndex).ObjectName
lngAnswer = MsgBox("Name of object " & lngIndex & ": " & strName, vbOKCancel)
If vbCancel = lngAnswer Then Exit For
Next
```

**Pictures**

Establish the picture name directly from the "ObjectName" property:

```
'VBS81
MsgBox "Screenname: " & HMIRuntime.ActiveScreen.ObjectName
```

**See also**

[Screen Object \(Page 131\)](#)

[ScreenItem Object \(Page 125\)](#)

**ObjectSizeDeclutteringEnable Property****Description**

Returns the ObjectSizeDecluttering properties of a picture.

Upon activated ObjectSizeDecluttering, only objects within a set size range are displayed.

You specify the upper and lower limits for the display range in Graphics Designer under "Tools> Settings > Show/Hide".

BOOLEAN Read-only access.

**Example:**

The example outputs the Decluttering Properties of the picture NewPDL1 as a trace.

```
'VBS157
Dim objScreen
Set objScreen = HMIRuntime.Screens("NewPDL1")
HMIRuntime.Trace "Min: " & objScreen.ObjectSizeDeclutteringMin & vbNewLine
HMIRuntime.Trace "Max: " & objScreen.ObjectSizeDeclutteringMax & vbNewLine
HMIRuntime.Trace "Enable: " & objScreen.LayerDeclutteringEnable & vbNewLine
```

**See also**

Screen Object (Page 131)

**ObjectSizeDeclutteringMax Property**

**Description**

Using the ObjectSizeDeclutteringMax property, the upper size range of a picture may be read.

Objects which are larger than the stated pixel size are no longer displayed when ObjectSizeDecluttering is activated.

LONG read-only access.

**Example:**

The example outputs the Decluttering Properties of the picture NewPDL1 as a trace.

```
'VBS157
Dim objScreen
Set objScreen = HMIRuntime.Screens("NewPDL1")
HMIRuntime.Trace "Min: " & objScreen.ObjectSizeDeclutteringMin & vbNewLine
HMIRuntime.Trace "Max: " & objScreen.ObjectSizeDeclutteringMax & vbNewLine
HMIRuntime.Trace "Enable: " & objScreen.LayerDeclutteringEnable & vbNewLine
```

**See also**

Screen Object (Page 131)

## ObjectSizeDeclutteringMin Property

### Description

Using the ObjectSizeDeclutteringMin property, the lower size range of a picture may be read.

Objects which are smaller than the stated pixel size are no longer displayed when ObjectSizeDecluttering is activated.

LONG read-only access.

### Example:

The example outputs the Decluttering Properties of the picture NewPDL1 as a trace.

```
'VBS157
Dim objScreen
Set objScreen = HMIRuntime.Screens("NewPDL1")
HMIRuntime.Trace "Min: " & objScreen.ObjectSizeDeclutteringMin & vbNewLine
HMIRuntime.Trace "Max: " & objScreen.ObjectSizeDeclutteringMax & vbNewLine
HMIRuntime.Trace "Enable: " & objScreen.LayerDeclutteringEnable & vbNewLine
```

### See also

Screen Object (Page 131)

## OffsetLeft Property

### Description

Defines or returns the distance of the picture from the left edge of the picture window.

The picture is displayed as a cutout of the picture window. The picture scroll bars are located at the left and upper edge of the picture. If you wish to display the picture in the picture window by using the horizontal and vertical positioning of the picture scroll bars, use the properties "ScrollPositionX" and "ScrollPositionY" for such positioning.

### See also

ScrollPositionY Property (Page 562)

ScrollPositionX Property (Page 562)

Picture Window (Page 179)

ScreenItem Object (Page 125)

## OffsetTop Property

### Description

Defines or returns the distance of the picture from the top edge of the picture window.

The picture is displayed as a cutout of the picture window. The picture scroll bars are located at the left and upper edge of the picture. If you wish to display the picture in the picture window by using the horizontal and vertical positioning of the picture scroll bars, use the properties "ScrollPositionX" and "ScrollPositionY" for such positioning.

### See also

ScrollPositionY Property (Page 562)

ScrollPositionX Property (Page 562)

Picture Window (Page 179)

ScreenItem Object (Page 125)

## OneY Property

### Description

TRUE if only the Y-axis of the trend is displayed in the foreground instead of all Y-axes of the displayed trends. BOOLEAN write-read access.

## Online property (before WinCC V7)

### Description

Serves to start or stop updating.

- 0: The updated display is stopped. The values are buffered and updated when the button is clicked again.
- -1: The updated display is resumed.

### See also

ScreenItem Object (Page 125)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

## Online property

### Starting refresh - Online

Enables a refresh of displayed values when calling a picture in Runtime.

Value	Description
TRUE	Enables the refresh of values on picture calls.
FALSE	Disables the refresh of values on picture calls.

The attribute can be assigned dynamic properties by means of the name **Online**. The data type is BOOLEAN.

## OnTop Property

### Description

TRUE, when the object should remain in the foreground in Runtime. Read only access.

### See also

Picture Window (Page 179)

Application Window (Page 173)

ScreenItem Object (Page 125)

## Op

### OperationMessage Property

#### Description

TRUE, if a message should be output upon successful operation. BOOLEAN Schreib-Lese-Zugriff.

The operation is sent to the message system, and is archived. Using the message system, a message may be output in a message line, for example.

#### Special features of I/O field, text list and slider

The reason for the operation may only be entered if the "OperationReport" property has been set to TRUE.

### See also

Slider (Page 212)

Text list (Page 196)

- Radio box (Page 207)
- Check box (Page 204)
- I/O Field (Page 184)
- ScreenItem Object (Page 125)

## OperatorMessageID property

### OperatorMessageID

Default assignment of the ID number and trigger event in WinCC OnlineTableControl:

Value	Description	Explanation
5	EditValue	Trigger event "Change archive value"
6	InsertValue	Trigger event "Generate archive value"

The attribute can be assigned dynamic properties by means of the name **OperatorMessageID**. The data type is LONG.

## OperatorMessageIndex property

### OperatorMessageIndex

References the event of an archive value change for an operator message. Using this attribute you can assign the values of other attributes to a specific operator message.

The following values are available:

Value	Explanation
0	Trigger event "Change archive value"
1	Trigger event "Generate archive value"

The attribute can be assigned dynamic properties by means of the name **OperatorMessageIndex**. The data type is LONG.

## OperatorMessageName property

### Object name - OperatorMessageName

Displays the name that is referenced with the attribute "OperatorMessageIndex" for message events for operator messages. You cannot edit this name.

The following names are available for message events:

Value	Explanation
Lock	Message event "Lock"
Unlock	Message event "Enable"

Value	Explanation
Hide	Message event "Hide"
Unhide	Message event "Unhide"
Quit	Message event "Ackn."

The attribute can be assigned dynamic properties by means of the name **OperatorMessageName**. The data type is STRING.

### OperatorMessageNumber property

#### Message number - OperatorMessageNumber

Define a message number for the selected operator message event if you do not want to use the operator message of WinCC.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageNumber**. The data type is LONG.

### OperatorMessageSelected property

#### Operator messages for - OperatorMessageSelected

Activate the message events which trigger operator messages in the list.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSelected**. The data type is BOOLEAN.

### OperatorMessageSource1 property

#### Source - OperatorMessageSource1

Define the message block of an operated message to be added to "Process value block 1" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 1" of the operator message. Select "1" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource1**. The data type is STRING.

### OperatorMessageSource2 property

#### Source - OperatorMessageSource2

Define the message block of an operated message to be added to "Process value block 2" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 2" of the operator message. Select "2" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource2**. The data type is STRING.

### OperatorMessageSource3 property

#### Source - OperatorMessageSource3

Define the message block of an operated message to be added to "Process value block 3" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 3" of the operator message. Select "3" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource3**. The data type is STRING.

### OperatorMessageSource4 property

#### Source - OperatorMessageSource4

Define the message block of an operated message to be added to "Process value block 4" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 4" of the operator message. Select "4" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource4**. The data type is STRING.

### OperatorMessageSource5 property

#### Source - OperatorMessageSource5

Define the message block of an operated message to be added to "Process value block 5" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 5" of the operator message. Select "5" at process value as the message lock of the operated message "User text block 1".



The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource5**. The data type is STRING.

### OperatorMessageSource6 property

#### Source - OperatorMessageSource6

Define the message block of an operated message to be added to "Process value block 6" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 6" of the operator message. Select "6" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource6**. The data type is STRING.

### OperatorMessageSource7 property

#### Source - OperatorMessageSource7

Define the message block of an operated message to be added to "Process value block 7" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 7" of the operator message. Select "7" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource7**. The data type is STRING.

### OperatorMessageSource8 property

#### Source - OperatorMessageSource8

Define the message block of an operated message to be added to "Process value block 8" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 8" of the operator message. Select "8" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource8**. The data type is STRING.

## OperatorMessageSource9 property

### Source - OperatorMessageSource9

Define the message block of an operated message to be added to "Process value block 9" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 9" of the operator message. Select "9" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource9**. The data type is STRING.

## OperatorMessageSource10 property

### Source - OperatorMessageSource10

Define the message block of an operated message to be added to "Process value block 10" of the operator message configured in Source.

An operator message is to be generated to indicate that a message was locked. The contents of "User text block 1" of the locked message, e.g. "Motor faulty", is to be displayed in "Process value block 10" of the operator message. Select "10" at process value as the message lock of the operated message "User text block 1".

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSource10**. The data type is STRING.

## OperatorMessageSourceType1 property

### Transfer as - OperatorMessageSourceType1

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType1**. The data type is LONG.

## OperatorMessageSourceType2 property

### Transfer as - OperatorMessageSourceType2

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType2**. The data type is LONG.

### OperatorMessageSourceType3 property

#### Transfer as - OperatorMessageSourceType3

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType3**. The data type is LONG.

### OperatorMessageSourceType4 property

#### Transfer as - OperatorMessageSourceType4

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType4**. The data type is LONG.

### OperatorMessageSourceType5 property

#### Transfer as - OperatorMessageSourceType5

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType5**. The data type is LONG.

### OperatorMessageSourceType6 property

#### Transfer as - OperatorMessageSourceType6

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType6**. The data type is LONG.

### OperatorMessageSourceType7 property

#### Transfer as - OperatorMessageSourceType7

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType7**. The data type is LONG.

### OperatorMessageSourceType8 property

#### Transfer as - OperatorMessageSourceType8

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType8**. The data type is LONG.

### OperatorMessageSourceType9 property

#### Transfer as - OperatorMessageSourceType9

Defines the format for transferring the source.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source as text.
1	Value	Transfer the source as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType9**. The data type is LONG.

### OperatorMessageSourceType10 property

#### Transfer as - OperatorMessageSourceType10

Specifies the format of the source content for the transfer.

The following formats are available:

Value	Description	Explanation
0	Text	Transfer the source content in text format.
1	Value	Transfer the source content as value.

The attribute can be assigned dynamic properties by means of the name **OperatorMessageSourceType10**. The data type is LONG.

### OperationReport Property

#### Description

TRUE, if the reason for an operation should be recorded. BOOLEAN write/read access. When the object is used or operated in Runtime, a dialog opens in which the operator can input the reason for the operation in the form of text. The operation is sent to the message system, and is archived.

## See also

Slider (Page 212)  
Text list (Page 196)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## Or - Ou

## Orientation Property

### Description

TRUE, when the text in the object should be displayed horizontally. BOOLEAN write-read access.

## Description of the "Connector" object type

Modifies the orientation of the connector. BOOLEAN write-read access.

## See also

Connector (Page 167)  
Static text (Page 165)  
Text list (Page 196)  
Radio box (Page 207)  
Check box (Page 204)  
Button (Page 201)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## OuterBevelStyle Property

### Description

Defines the 3D effect for the outer bevel of the object.

- 0: No border.
- 1: The border is displayed depressed.
- 2: The border is displayed raised.
- 3: The border is displayed in one color without a 3D effect. The border color is defined by the "BevelColorUp" property.

**See also**

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

**OuterBevelWidth Property**

**Description**

Defines the width of the outer bevel in pixels.

**See also**

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

**Outline Property**

**Description**

TRUE, when the button should be given a black border in addition to the 3D border. BOOLEAN write-read access.

**See also**

WinCC Push Button Control (Page 269)

ScreenItem Object (Page 125)

**OutputFormat Property**

**Description**

Returns the value for the representation of the output value and sets it. The representation depends on the data format.

**See also**

I/O Field (Page 184)

ScreenItem Object (Page 125)

## OutputValue Property

### Description

Determines the default setting for the value to be displayed or returns it. This value is used in Runtime when the associated tag cannot be connected or updated when a picture is started.

### See also

Text list (Page 196)  
I/O Field (Page 184)  
ScreenItem Object (Page 125)

## 1.14.4.15 P

### Pa - Pe

## PageMode property

### Enable paging - PageMode

Enables paging is in the long-term archive list. Allows you to display all messages of the short-term archive in the long-term archive list. Use the "Messages per page" or "PageModeMessageNumber" property to determine the number of messages displayed per page.

The page up/down buttons of the toolbar can be used if paging is enabled.

Value	Explanation
TRUE	Paging is enabled for the long-term archive list.
FALSE	Paging is disabled for the long-term archive list.

The attribute can be assigned dynamic properties by means of the name **PageMode**. The data type is BOOLEAN.

## PageModeMessageNumber property

### Messages per page - PageModeMessageNumber

Defines the number of messages shown per page when paging the long-term archive list.

The attribute can be assigned dynamic properties by means of the name **PageModeMessageNumber**. The data type is LONG.



## Parent Property


### Description

Returns a reference to the superordinate object.

Objects within the VBS object model are accessed by hierarchy. You may descend in the picture hierarchy using Screen and Screenitems. You may ascend in the picture hierarchy by using the Parent property.

### Usage

The Parent property can be used as often as required within an object hierarchy. The following section provides a systematic description of how to access all the elements in a hierarchy:

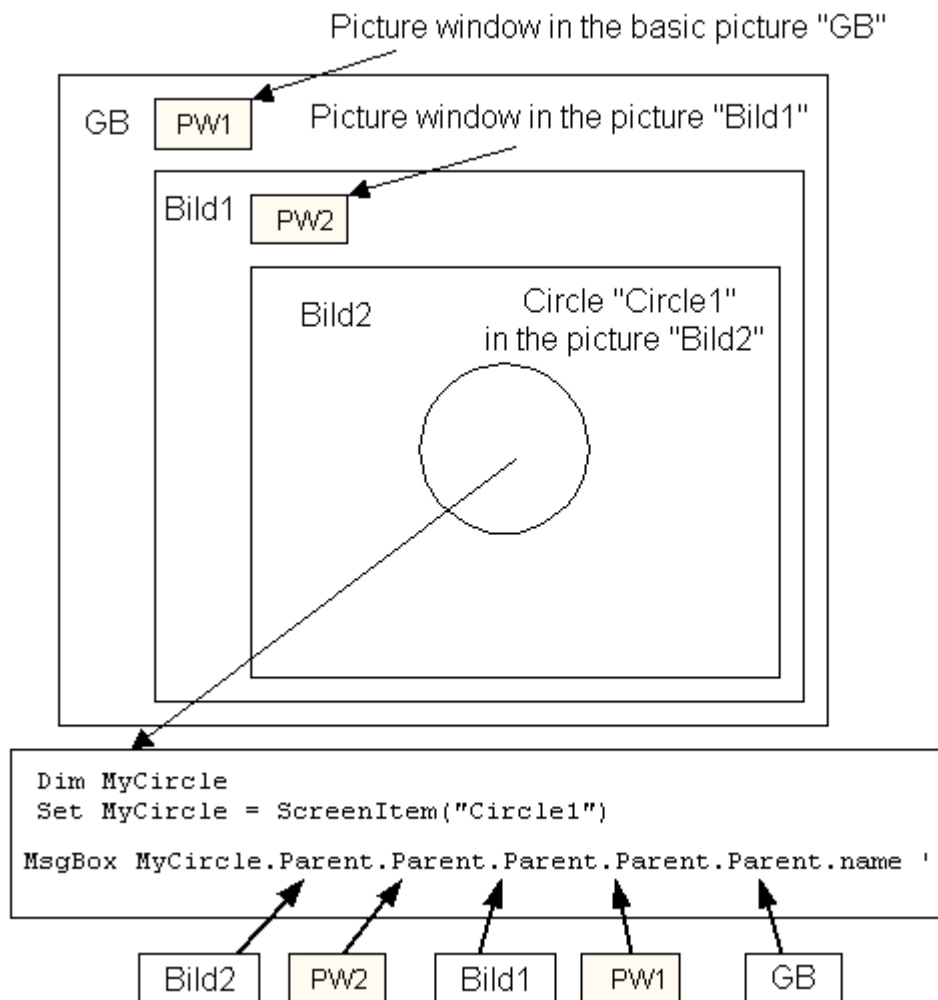

#### The Command

```
MsgBox MyCircle.Parent.Objectname
```

returns the name of "Picture2" located one layer higher in the object hierarchy than the original ScreenItem object "Circle1".

For example, if you wish to use "Parent" three times, ascend in the object hierarchy by three layers:

```
MsgBox MyCircle.Parent.Parent.Parent.Objectname
```

returns the name of Picture1.

Reasoning:

- Original reference is to ScreenItem "Circle1"
- "Circle1" is within "Picture2" (Layer 1)
- "Picture2" is within Picture Window2 "BF2" (Layer 2)
- "BF2" is within "Picture 1"(Layer 3)

## Example

In the following examples, the object name of the parent object is displayed:

```
'VBS120
Dim objCircle
Set objCircle = HMIRuntime.Screens("ScreenWindow1").ScreenItems("Circle1")
MsgBox objCircle.Parent.ObjectName
```

```
'VBS82
Dim objScrItem
Set objScrItem = HMIRuntime.Screens(1).ScreenItems(1)
MsgBox "Name of BaseScreen: " & objScrItem.Parent.ObjectName
```

## See also

[Picture Window \(Page 179\)](#)

[Screen Object \(Page 131\)](#)

[Objects and Lists \(Page 107\)](#)

## PasswordLevel Property

### Description

Defines the authorization for operation (e.g. no input or no triggering actions) of the object.

**See also**

ScreenItem Object (Page 125)

**Path Property****Description**

Returns the path of the current project (without file name). For a WinCC client without its own path, the path is returned in UNC format, otherwise the local path is returned.

STRING (read access only)

**Example:**

The following example returns the project path as Trace:

```
'VBS161
HMIRuntime.Trace "Path: " & HMIRuntime.ActiveProject.Path & vbNewLine
```

**See also**

Project Object (Page 124)

**PercentageAxis property****PercentageAxis**

Specifies whether an axis with percentage scaling will be displayed in addition to the value axes in the trend window or diagram window.

Value	Explanation
TRUE	The display of an axis with percentage scaling is enabled.
FALSE	The display of an axis with percentage scaling is disabled.

The attribute can be assigned dynamic properties by means of the name **PercentageAxis**. The data type is BOOLEAN.

**PercentageAxisAlign property****PercentageAxisAlign**

Specifies the alignment of the axis with percentage scaling in the trend window or diagram window.

The following settings are available:

Value	Description	Explanation
0	left	The axis with percentage scaling is aligned left.
1	right	The axis with percentage scaling is aligned right.

The attribute can be assigned dynamic properties by means of the name **PercentageAxisAlign**. The data type is LONG.

### PercentageAxisColor property

#### PercentageAxisColor

Specifies the color of an axis with percentage scaling. The button opens the "Color selection" dialog to select the color.

The attribute can be assigned dynamic properties by means of the name **PercentageAxisColor**. The data type is LONG.

### PersistentRT Property

#### Description

TRUE, when modified window settings should be retained following a change of picture. Whether the information is evaluated is dependent on the value of the "AllowPersistence" property.

#### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

### PersistentRTCS Property

#### Description

TRUE, when modified settings should be retained following a change of picture and applied in the configuration system. Whether the information is evaluated is dependent on the value of the "AllowPersistence" property. BOOLEAN write-read access.

**See also**

WinCC Online Trend Control (before WinCC V7) (Page 295)  
WinCC Online Table Control (before WinCC V7) (Page 292)  
WinCC Function Trend Control (before WinCC V7) (Page 288)  
ScreenItem Object (Page 125)

**PersistentRTCSPermission Property****Description**

Defines the operator permission which is necessary in order to modify settings related to persistence. The value to be entered must correspond to the number of the requested authorization level in the user administrator. Whether or not the information is to be analyzed depends on the value of the "AllowPersistence" property (does not apply to WinCC Alarm Control).

**See also**

WinCC Alarm Control (before WinCC V7) (Page 286)  
WinCC Online Trend Control (before WinCC V7) (Page 295)  
WinCC Online Table Control (before WinCC V7) (Page 292)  
WinCC Function Trend Control (before WinCC V7) (Page 288)  
ScreenItem Object (Page 125)

**PersistentRTPermission Property****Description**

Defines the operator permission which is necessary in order to modify settings related to the persistency in Runtime. The value to be entered must correspond to the number of the requested authorization level in the user administrator. Whether or not the information is to be analyzed depends on the value of the "AllowPersistence" property (does not apply to WinCC Alarm Control).

**See also**

WinCC Alarm Control (before WinCC V7) (Page 286)  
WinCC Online Trend Control (before WinCC V7) (Page 295)  
WinCC Online Table Control (before WinCC V7) (Page 292)  
WinCC Function Trend Control (before WinCC V7) (Page 288)  
ScreenItem Object (Page 125)

Pi

### **PicDeactReferenced-Eigenschaft**

#### **Description**

TRUE, when the picture assigned for the "Disable" status should be saved in the RoundButton object. Otherwise, only the associated object reference is saved. Read only access.

#### **See also**

Round Button (Page 209)

ScreenItem Object (Page 125)

### **PicDeactTransparent Property**

#### **Description**

Defines or returns which color of the bitmap object (.bmp, .dib) assigned to the "Disabled" status should be set to "transparent". LONG Write/Read Access.  
The color is only set to "Transparent" if the value of the "PicDeactUseTransColor" property is "True".

#### **See also**

Round Button (Page 209)

ScreenItem Object (Page 125)

### **PicDeactUseTransColor Property**

#### **Description**

TRUE, when the transparent color defined by the "PicDeactTransparent" property for the "Disable" status should be used. BOOLEAN write-read access.

#### **See also**

Round Button (Page 209)

ScreenItem Object (Page 125)

## PicDownReferenced Property

### Description

TRUE, when the picture assigned for the "On" status is to be saved. Otherwise, only the associated object reference is saved. Read only access.

### See also

Round Button (Page 209)  
ScreenItem Object (Page 125)

## PicDownTransparent Property

### Description

Defines or returns which color of the bitmap object (.bmp, .dib) assigned to the "On" status should be set to "transparent". LONG Write/Read Access.  
The color is only set to "Transparent" if the value of the "PicDownUseTransColor" property is "True".

### See also

Round Button (Page 209)  
ScreenItem Object (Page 125)

## PicDownUseTransColor Property

### Description

TRUE, when the transparent color defined by the "PicDownTransparent" property for the "On" status should be used. BOOLEAN write-read access.

### See also

Round Button (Page 209)  
ScreenItem Object (Page 125)

## PicReferenced Property

### Description

TRUE, when the assigned picture is references the object and is not saved in it. Read only access.

## See also

Graphic Object (Page 187)

ScreenItem Object (Page 125)

## PictAlignment property

### Description

Defines or returns the picture alignment of the picture on the button or round button.

LONG write-read access.

## PicTransparentColor Property

### Description

Defines or returns which color of the assigned bitmap object (.bmp, .dib) should be set to "transparent". LONG Write/Read Access.

The color is only set to "Transparent" if the value of the "PicUseTransparentColor" property is "True".

## See also

Graphic Object (Page 187)

ScreenItem Object (Page 125)

## Picture Property

### Description

Returns the picture name of the background picture for the rectangular background for both the analog and digital clocks. Read only access

## See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## PictureBack Property

### Description

Returns the picture name of the picture for the object background. Read only access.



**See also**

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

**PictureDeactivated Property****Description**

Defines the picture to be displayed in the "Disable" status or returns the picture name. The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

**See also**

Round Button (Page 209)

ScreenItem Object (Page 125)

**PictureDirectory property****Directory for pictures (PictureDirectory)**

Specifies the name of the subdirectory that is created in the "GraCS" directory of the WinCC project. If pictures are stored in the subdirectory, they are available for the extended status display. If no subdirectory is specified or the subdirectory does not contain any pictures, the pictures in the "GraCS" directory are taken into consideration.

The "Directory for pictures" attribute can be dynamized with the name "PictureDirectory".

**PictureDown Property****Description**

Defines the picture to be displayed in the "On" status or returns the picture name. The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

**See also**

Button (Page 201)

Round Button (Page 209)

ScreenItem Object (Page 125)

## PictureName Property

### Description

Defines the picture to be displayed in the graphic object in Runtime or returns the picture name. The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

### See also

Graphic Object (Page 187)  
 ScreenItem Object (Page 125)

## PictureSelected Property

### Description

Returns the picture name of the picture displayed in the "On" status. "AutoSize" controls the adaptation of the size of picture and buttons. Read only access.

### See also

WinCC Push Button Control (Page 269)  
 ScreenItem Object (Page 125)

## PictureSizeMode property

### PictureSizeMode

Specifies the size adjustment between picture and control.

Value	Designation	Explanation
0	Fit size to content	The control is adapted to the picture size.
1	Fit content to size	The picture is adapted or scaled to the control.

The attribute can be assigned dynamic properties by means of the name **PictureSizeMode**. The data type is LONG.

## PictureThumb Property

### Description

Returns the picture name of the background picture for the slider. Read only access.

## See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## PictureUnselected Property

### Description

Returns the picture name of the picture displayed in the "Off" status. "AutoSize" controls the adaptation of the size of picture and buttons. Read only access.

## See also

WinCC Push Button Control (Page 269)

ScreenItem Object (Page 125)

## PictureUp Property

### Description

Defines the picture to be displayed in the "Off" status or returns the picture name. The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

## See also

Round Button (Page 209)

Button (Page 201)

ScreenItem Object (Page 125)

## PicUpReferenced Property

### Description

TRUE, when the picture assigned for the "Off" status should be saved in the object. Otherwise, only the associated object reference is saved. Read only access.

## See also

Round Button (Page 209)

ScreenItem Object (Page 125)

## PicUpTransparent Property

### Description

Defines or returns which color of the bitmap object (.bmp, .dib) assigned to the "Off" status should be set to "transparent". LONG Write/Read Access.  
The color is only set to "Transparent" if the value of the "PicUpUseTransColor" property is "True".

### See also

Round Button (Page 209)

ScreenItem Object (Page 125)

## PicUpUseTransColor Property

### Description

TRUE, when the transparent color defined by the "PicUpTransparent" property for "Off" status should be used. BOOLEAN write-read access.

### See also

Round Button (Page 209)

ScreenItem Object (Page 125)

## PicUseTransColor Property

### Description

TRUE, when the transparent color defined by the "PicDeactTransparent" property for the "Disable" status should be used. BOOLEAN write-read access.

### See also

Graphic Object (Page 187)

ScreenItem Object (Page 125)

## PI - Pr

### PlayEndless property

#### PlayEndless

Specifies if movies are played endlessly in the control.

The attribute can be assigned dynamic properties by means of the name **PlayEndless**. The data type is BOOLEAN.

### PointCount Property

#### Description

Defines or returns the number of corner points. Each corner point has position coordinates and is identified via an index.

#### See also

Polyline (Page 158)

Polygon (Page 156)

ScreenItem Object (Page 125)

### Position Property

#### Description

Defines the presetting for the position of the slider.

This value is used as the start value in Runtime.

To operate the process value linked to this attribute, it is necessary that the process value is also linked to the "Position" event. You will find the event "Position" in the "Event" tab, in the topic tree under SliderCtrl\Property Topics\Control Properties\Value.

#### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## Precisions Property

### Description

#### WinCC Online Trend Control

The "Index" property references a pair of columns. "Precision" defines the number of decimal places which should be shown in this value column. A maximum of 16 decimal places can be displayed.

#### WinCC Online Trend Control

Defines the number of decimal places with which the scale value is specified.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## PrecisionX Property

### Description

Defines or returns the number of decimal places with which the scale value for the X-axis should be specified. Write/Read access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## PrecisionY Property

### Description

Defines or returns the number of decimal places with which the scale value for the Y-axis should be specified. Write/Read access.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## PredefinedAngles Property

### Description

Defines or returns the depth of the display of the 3DBarGraph object. Value range from 0 to 3.

0 = cavalier

1 = isometric

2 = axionometric

3 = freely defined

### See also

ScreenItem Object (Page 125)

3D Bar (Page 169)

## PreferredTarget property

### Preferred picture target (PreferredTarget)

The "Preferred picture target" attribute specifies where the picture change is carried out by the Favorites browser.

Yes	The picture change is carried out in this picture screen. In the case of nested picture screens the picture change is carried out at the innermost picture screen with the "Yes" setting.
No	The picture change is carried out in the main screen.

The "Preferred picture target" attribute can be made dynamic with the name "PreferredTarget".

## Pressed Property

### Description

TRUE, when the Button or RoundButton object is pressed. BOOLEAN write-read access.

### See also

Round Button (Page 209)

ScreenItem Object (Page 125)

## PrintBackgroundColor Property

### Description

TRUE, if the defined background color is also printed while printing the controls. BOOLEAN write-read access.

## PrintJob Property

### Description

Defines or reads out which print layout should be used for the printed output.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## PrintJobName property

### Current print job view - PrintJobName

Defines the print job triggered by the print function of the "Print" toolbar button. The recommended print job is set for the control by default.

Open the "Select Print Job" dialog using the selection button.

The attribute can be assigned dynamic properties by means of the name **PrintJobName**. The data type is STRING.

## Process Property

### Description

Defines or returns presetting for the value to be displayed.

This value is used in Runtime when the associated tag cannot be connected or updated when a picture is started.

### See also

Slider (Page 212)

Radio box (Page 207)

Check box (Page 204)

Bar (Page 174)

3D Bar (Page 169)

ScreenItem Object (Page 125)



## ProcessValue property

### Description

Returns an object of type "ProcessValue".

### See also

Alarms object (list) (Page 110)

## ProjectPath Property

### Description

Contains the path and name of the associated project.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## ProviderClsid Property

### Description

The "Index" property references a trend. "ProviderClsid" defines whether an archive tag or an internal or external tag should be displayed in this trend.

- {416A09D2-8B5A-11D2-8B81-006097A45D48}: The trend is connected to an archive tag.
- {A3F69593-8AB0-11D2-A440-00A0C9DBB64E}: The trend is connected to an internal or external tag.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## ProviderType Property

### Description

Defines the type of values to be displayed in a trend referenced by "Index". In the case of modification of "ProviderType", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "ProviderType", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

## 1.14 VBS Reference

0: Values are supplied via the API interface.

-1: Display of online or archive tags

-2: Displaying values from a user archive

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

### 1.14.4.16 Q

## QualityCode Property

### Description

Defines a standard for the quality of a tag value after being read. The quality code is provided as a 16-bit value for automatic evaluation. After a tag has been written, the value is invalid.

SHORT (read only)

---

#### Note

A summary of possible Quality Codes is provided in the WinCC Information System under the heading "Communication" > "Diagnostics" or "Communication" > "Quality Codes".

---

### Example:

The following example indicates the quality of the read value when no errors have occurred during the reading process:

```
'VBS83
Dim objTag
Dim lngLastErr
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Read
lngLastErr = objTag.LastError
If 0 = lngLastErr Then
MsgBox objTag.QualityCode
End If
```

**See also**

LastError Property (Page 459)  
ErrorDescription Property (Page 411)  
Tag Object (Page 137)

**1.14.4.17 R**

**Ra - Ri**

**Radius Property**

**Description**

Defines or returns the radius in pixels.

**See also**

Pie segment (Page 152)  
Circular arc (Page 151)  
Circle (Page 149)  
Round Button (Page 209)  
ScreenItem Object (Page 125)

**RadiusHeight Property**

**Description**

Defines or returns the vertical radius in pixels (0 to 5000).

**See also**

Ellipse segment (Page 147)  
Ellipse arc (Page 146)  
Ellipse (Page 144)  
ScreenItem Object (Page 125)

## RadiusWidth Property

### Description

Defines or returns the horizontal radius in pixels (0 to 5000).

### See also

Ellipse segment (Page 147)  
Ellipse arc (Page 146)  
Ellipse (Page 144)  
ScreenItem Object (Page 125)

## RangeMax Property

### Description

Defines the maximum absolute value for the value display.  
If the "WithLabels" property has the value -1 (yes), this value is displayed on the scale.

### See also

WinCC Slider Control (Page 277)  
ScreenItem Object (Page 125)

## RangeMin Property

### Description

Defines the minimum absolute value for the value display.  
If the "WithLabels" property has the value -1 (yes), this value is displayed on the scale.

### See also

WinCC Slider Control (Page 277)  
ScreenItem Object (Page 125)

## Rectangular Property

### Description

Defines or returns the side ratio of the rectangular background of the gauge. BOOLEAN write-read access.

FALSE : The size of the gauge can be adjusted to any side ratio by dragging the marking points with the mouse.

TRUE : The size of the gauge can only be adjusted by dragging the marking points with the mouse. The side ratio of the background always remains 1:1.

### See also

ScreenItem Object (Page 125)

WinCC Gauge Control (Page 254)

## ReferenceRotationLeft Property

### Description

Defines or returns the X-coordinate of the reference point about which the object should be rotated in Runtime.

The value of the x coordinate is relative to the object width. Enter the value in percent starting from the left edge of the rectangle enclosing the object.

### See also

Line (Page 154)

Polyline (Page 158)

Polygon (Page 156)

ScreenItem Object (Page 125)

## ReferenceRotationTop Property

### Description

Defines or returns the Y-coordinate of the reference point about which the object should be rotated in Runtime.

The value of the Y-coordinate is relative to the object height. Enter the value in percent starting from the top edge of the rectangle enclosing the object.

## See also

ScreenItem Object (Page 125)

Line (Page 154)

Polyline (Page 158)

Polygon (Page 156)

## RelayCurves Property

### Description

TRUE, when the trends should be displayed staggered. BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## Relevant Property

### Description

TRUE, when the object will be taken into account when forming the group display. BOOLEAN write-read access.

### See also

Group Display (Page 194)

ScreenItem Object (Page 125)

## Replacement Property

### Description

The "Index" property references a trend. Values, whose start value is unknown on activating Runtime or for which a substitute value is used, have an unstable status. "Replacement" defines whether such values should be identified by the color defined in "ReplacementColor". BOOLEAN write-read access.

**See also**

WinCC Online Trend Control (before WinCC V7) (Page 295)  
 WinCC Function Trend Control (before WinCC V7) (Page 288)  
 ScreenItem Object (Page 125)

**ReplacementColor Property****Description**

The "Index" property references a trend. Values, whose start value is unknown on activating Runtime or for which a substitute value is used, have an unstable status. "ReplacementColor" defines the color used to identify this value. The color is defined as an RGB value. Whether the information is evaluated is dependent on the value of the "Replacement" property.

**See also**

WinCC Online Trend Control (before WinCC V7) (Page 295)  
 WinCC Function Trend Control (before WinCC V7) (Page 288)  
 ScreenItem Object (Page 125)

**RestrictedCursorMovement property****Limited cursor movement (RestrictedCursorMovement)**

The "Limited cursor movement" attribute specifies whether the cursor is fixed on the left-hand side in the I/O field. This corresponds to the default setting when opening the I/O field. As a result, negative values are always displayed correctly. You enter the values with decimal places regardless of the cursor position. You no longer have any possibility to change the position during the entry. The decimal place shown in the I/O field is hidden during the entry of a decimal place.

Yes	The cursor movement is restricted in the I/O field. The cursor is fixed on the left-hand side.
No	The cursor movement is not restricted in the I/O field.

The "Limited cursor movement" attribute can be made dynamic with the "RestrictedCursorMovement" name.

**RightComma Property****Description**

Defines or returns the number of decimal places (0 to 20).

**See also**

- Bar (Page 174)
- ScreenItem Object (Page 125)

**Ro - Ru**

**Rotation property**

**Rotation (Rotation)**

Specifies anticlockwise rotation around the icon center.

The following settings are available:

Value	Comments
0	The icon is not rotated.
90	The icon is rotated by 90 degrees.
180	The icon is rotated by 180 degrees.
270	The icon is rotated by 270 degrees.

The attribute can be assigned dynamic properties by means of the name **Rotation**. The data type is LONG.

**RotationAngle Property**

**Description**

**Standard objects**

Defines or returns the rotation angle in degrees.

In Runtime, the object (starting from the configured starting position) is displayed rotated clockwise around the reference point by the specified value. The changed orientation of the object is only visible in Runtime.

The coordinates of the reference point are defined with the "Rotation Reference X" and "Rotation Reference Y" attributes.

**T-piece**

Defines or returns the orientation of a T-piece in degrees.

The attribute can assume one of four values. If you enter another value, it is automatically converted to modulus 360 and rounded up or down to the closest permissible value.

The orientation is produced by rotating the T-piece clockwise around the center point by the specified number of degrees.

- 0 The standard position of the T-piece is the shape of the letter "T"
- 90 The "leg" of the "T" points towards the left



- 180 The "leg" of the "T" points upwards
- 270 The "leg" of the "T" points to the right

### See also

- Line (Page 154)
- Polyline (Page 158)
- Polygon (Page 156)
- ScreenItem Object (Page 125)

## RoundCornerHeight Property

### Description

Defines or returns the corner radius.  
Enter the value as a percentage of half the height of the object.

### See also

- Rounded rectangle (Page 162)
- ScreenItem Object (Page 125)

## RoundCornerWidth Property

### Description

Defines or returns the corner radius.  
Enter the value as a percentage of half the width of the object.

### See also

- ScreenItem Object (Page 125)

## RowNumber property

### RowNumber

Specifies the row number of the Row object of a Table Control.

## RowScrollbar property

### Row scroll bars - RowScrollbar

Enables the display of row scroll bars.

The following settings are available:

Value	Description	Explanation
0	No	No row scroll bars.
1	as required	Row scroll bars are displayed if horizontal space requirements of the control are greater than the actually available display area.
2	always	Row scroll bars are always displayed.

The attribute can be assigned dynamic properties by means of the name **RowScrollbar**. The data type is LONG.

## RowTitleAlign property

### Row label alignment - RowTitleAlign

Specifies the type of row label alignment.

The following settings are available:

Value	Description	Explanation
0	left	The row headers are aligned left.
1	centered	The row headers are aligned to center.
2	right	The row headers are aligned right.

The attribute can be assigned dynamic properties by means of the name **RowTitleAlign**. The data type is LONG.

## RowTitles property

### Show row labels - RowTitles

Enables the display of row labels.

Value	Explanation
TRUE	The row labels are displayed.
FALSE	The row labels are not displayed.

The attribute can be assigned dynamic properties by means of the name **RowTitles**. The data type is BOOLEAN.

## RTPersistence property

### Online configuration at the next picture change - RTPersistence

Enables retention of the online configurations of the control after a picture change.

The following settings are available:

Value	Description	Explanation
0	Discard	The current online configurations are discarded at the next picture change.
1	Retain	The current online configurations are retained at the next picture change.
2	Reset	All online configurations made are lost. The picture is set to the contents found in the configuration system.

The attribute can be assigned dynamic properties by means of the name **RTPersistence**. The data type is LONG.

## RTPersistencePasswordLevel property

### Operator authorization for online configuration - RTPersistencePasswordLevel

Displays the authorization for online configuration. You can edit the authorization using the selection button. Authorizations are configured in the "User Administrator" editor.

The attribute can be assigned dynamic properties by means of the name **RTPersistencePasswordLevel**. The data type is LONG.

## RTPersistenceType property

### Online configuration - RTPersistenceType

Defines how to retain online configurations of WinCC.

The following settings are available:

Value	Description	Explanation
0	Do not retain	Online configurations are not retained. These are lost at the next picture change.
1	Retain during runtime	Online configurations are retained during runtime. These are lost on exiting.
2	Retain permanently	Online configurations are retained permanently. These are also available after restart.

The attribute cannot be dynamized.

## RulerFont Property

### Description

This attribute defines the font of the table of the tag values, which is displayed by the key function "Display value at this position" / "Ruler". Write/Read access.

## RulerPrecisions Property

### Description

Defines the number of decimal places to which a measured value should be displayed when it is determined using the "Display value at this position" function.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## RulerPrecisionX Property

### Description

Defines the number of decimal places used by the "Display value at this position" to display the X-coordinate of a measured value. Whether the information is evaluated is dependent on the value of the "TimeAxisX" attribute.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## RulerPrecisionY Property

### Description

Defines the number of decimal places used by the "Display value at this position" to display the Y-coordinate of a measured value.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## RulerType property

### Window - RulerType

Specifies window to be displayed during runtime. Depending on the window type, only certain blocks can be used as columns of the WinCC RulerControl.

The following window types can be selected:

Value	Description	Explanation
0	"Ruler" window	The ruler window shows the coordinate values of the trends on a ruler or values of a selected row in the table.
1	"Statistics area" window	The statistics area window shows the values of the low and high limit of trends between two rulers, or displays the selected range in the table.
2	"Statistics" window	The statistics window shows the statistic evaluation of trends between two rulers, or it displays the selected values in the table.

The attribute can be assigned dynamic properties by means of the name **RulerType**. The data type is LONG.

#### 1.14.4.18 S

### Sa - Sc

### SameSize Property

#### Description

TRUE, when all four buttons of a Group Display object have the same size. BOOLEAN write-read access.

#### See also

Group Display (Page 194)

ScreenItem Object (Page 125)

### SavedTrend Property

#### Description

Displays the name of the last saved trend that was exported in WinCC Online Trend Control using the Save Report button. Read only access.

## ScaleColor Property

### Description

Defines or returns the color of the scale. LONG write-read access.  
The "Scaling" property must be set to TRUE for the color to be displayed.

### See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## ScaleTicks Property

### Description

Defines the number of segments into which the bar will be subdivided by large tick marks of the scale:  
0-100: Object can be divided into a maximum of 100 segments  
= 0: The optimum number of segments is set automatically.

### See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## Scaling Property

### Description

TRUE, when a scale should also be used to represent a value. BOOLEAN write-read access.

### See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## ScalingType Property

### Description of Bar Scaling

Defines or returns the type of bar scaling. Value range from 0 to 6.  
0 = linear

- 1 = logarithmic
- 2 = negative logarithmic
- 3 = automatic (linear)
- 4 = tangent
- 5 = square
- 6 = cubic

The "Scaling" property must be set to TRUE for the color to be displayed.

### Description of Online Trend Control

Specifies or returns the type of scaling for a trend referenced by "Index". Value range from 0 to 2.

- 0 = linear
- 1 = logarithmic
- 2 = negative logarithmic

### See also

- WinCC Online Trend Control (before WinCC V7) (Page 295)
- Bar (Page 174)
- ScreenItem Object (Page 125)

### ScalingTypeX Property

#### Description

Defines the type of scaling of the X-axis of a trend referenced with "Index". Whether the information is evaluated is dependent on the value of the "TimeAxisX" attribute.

- 0: Linear
- 1: Logarithmically. This setting prevents the display of negative values.
- 2: Logarithmically negated. This setting prevents the display of positive values.

### See also

- WinCC Function Trend Control (before WinCC V7) (Page 288)
- ScreenItem Object (Page 125)

## ScalingTypeY Property

### Description

Defines the type of scaling of the Y-axis of a trend referenced with "Index".

0: Linear

-1: Logarithmically. This setting prevents the display of negative values.

-2: Logarithmically negated. This setting prevents the display of positive values.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## ScreenName Property

### Description

Defines the picture to be displayed in the picture window in Runtime or returns the picture name.

---

#### Note

Always enter picture names without the extension "PDL" for reasons of compatibility with future versions.

---

### See also

Picture Window (Page 179)

ScreenItem Object (Page 125)

## Screens Property

### Description

Returns an object of type "Screens".

Screens (read only)



**Example:**

The following example accesses the picture "NewPDL1":

```
'VBS84
Dim objScreen
Set objScreen = HMIRuntime.Screens("NewPDL1")
```

**See also**

[Screens Object \(List\) \(Page 134\)](#)

[Screen Object \(Page 131\)](#)

[HMIRuntime Object \(Page 118\)](#)

**ScreenItems Property****Description**

Returns an object of type "ScreenItems".

ScreenItems (read only)

**Example:**

The following example issues the number of all the objects contained in the picture "NewPDL1":

```
'VBS85
Dim objScreen
Set objScreen = HMIRuntime.Screens("NewPDL1")
Msgbox objScreen.ScreenItems.Count
```

**See also**

[ScreenItems Object \(List\) \(Page 129\)](#)

[HMIRuntime Object \(Page 118\)](#)

**ScrollBars Property****Description**

TRUE, when the object is equipped with a scroll bar in Runtime. Read only access.

## See also

Picture Window (Page 179)

ScreenItem Object (Page 125)

## ScrollPositionX Property

### Description

Specifies the horizontal positioning of the scroll bar in a picture window with slider, or returns its value.

The picture is displayed in the picture window by positioning the horizontal and vertical scroll bars. If you wish to display the picture as a cutout where the scroll bars are located at the left and upper edge of the picture, use the properties "OffsetLeft" and "OffsetTop" as the origin of this cutout.

## See also

ScreenItem Object (Page 125)

OffsetTop Property (Page 516)

OffsetLeft Property (Page 515)

Picture Window (Page 179)

## ScrollPositionY Property

### Description

Specifies the vertical positioning of the scroll bar in a picture window with slider, or returns its value.

The picture is displayed in the picture window by positioning the horizontal and vertical scroll bars. If you wish to display the picture as a cutout where the scroll bars are located at the left and upper edge of the picture, use the properties "OffsetLeft" and "OffsetTop" as the origin of this cutout.

## See also

OffsetTop Property (Page 516)

OffsetLeft Property (Page 515)

Picture Window (Page 179)

ScreenItem Object (Page 125)

Se

## SecondNeedleHeight Property

### Description

Defines or returns the length of the second hand for the analog clock. The specification of the length is entered as a percentage value in relation to half the length of the short side of the rectangular background. Write/Read access.

Example:

The shorter side of the rectangular background is 100 pixels long.

The second hand length is 80.

This results in a length of the second hand of  $(100 \text{ pixels} / 2) * 0.8 = 40 \text{ pixels}$ .

### See also

ScreenItem Object (Page 125)

WinCC Digital/Analog Clock (Page 246)

## SecondNeedleWidth Property

### Description

Defines or returns the width of the second hand for the analog clock. The width is specified as a percentage value related to double the length of the second hand. Write/Read access.

Example:

The length of the second hand is 40 pixels.

The second hand width is 2.

This results in a width of the second hand of  $40 \text{ pixels} * 2 * 0.02 = 2 \text{ pixels}$ .

### See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## SelBGColor Property

### Description

Defines or returns the background color of the selected entry in a text list object. LONG write-read access.

## See also

Text list (Page 196)

ScreenItem Object (Page 125)

## SelectArchiveName property

### SelectArchiveName

Opens the dialog for selecting the user archive.

Programmers can set this attribute to allow users to select a user archive by means of a button, for example.

The attribute can be assigned dynamic properties by means of the name **SelectArchiveName**. The data type is BOOLEAN.

## SelectedCellColor property

### Background color of selected cell - SelectedCellColor

Specifies the background color of a selected cell. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **SelectedCellColor**. The data type is LONG.

## SelectedCellForeColor property

### Font color of the selected cell - SelectedCellForeColor

Specifies the font color of the selected cell. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **SelectedCellForeColor**. The data type is LONG.

## SelectedRowColor property

### Background color of the selected row - SelectedRowColor

Specifies the background color of the selected line. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **SelectedRowColor**. The data type is LONG.

## SelectedRowForeColor property

### Font color of the selected row - SelectedRowForeColor

Specifies the font color of the selected row. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **SelectedRowForeColor**. The data type is LONG.

## SelectedTitleColor property

### Background selection color - SelectedTitleColor

Specifies the background color of a selected table header. The button opens the "Color selection" dialog.

The setting is only active in Runtime if the "Selection color" or "UseSelectedTitleColor" option is activated.

The attribute can be assigned dynamic properties by means of the name **SelectedTitleColor**. The data type is LONG.

## SelectedTitleForeColor property

### Font selection color - SelectedTitleForeColor

Specifies the font color of the table header selected. The button opens the "Color selection" dialog.

The setting is only active in Runtime if the "Selection color" or "UseSelectedTitleColor" option is activated.

The attribute can be assigned dynamic properties by means of the name **SelectedTitleForeColor**. The data type is LONG.

## SelectedTrend Property

### Description

This property brings a trend to the foreground via its name. Write/Read access.

## SelectionColoring property

### Selection colors for - SelectionColoring

Enables the use of selection colors for cells or rows.

The following settings are available:

Value	Description	Explanation
0	None	No selection colors for cells and rows.
1	Cell	Selection color for cell.
2	Row	Selection color for row.
3	Cell and row	Selection colors for cell and row.

The attribute can be assigned dynamic properties by means of the name **SelectionColoring**. The data type is LONG.

## SelectionMode Property

### Description

Defines whether and how a message line can be selected.

- 0 - NoSelection: Prevents the selection of a message. Acknowledgement affects the oldest pending message.
- 1 - Cell: Enables the selection of fields in the message line. Acknowledgement affects the selected message.
- 2 - Line: Enables the selection of a message line. Acknowledgement affects the selected message.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## SelectionRect property

### Selection border- SelectionRect

Enables the use of a selection border for selected cells or rows.

The following settings are available:

Value	Description	Explanation
0	None	No selection border is drawn for selected cells or rows.
1	Cell	A selection border is drawn for the selected cell.
2	Row	A selection border is drawn for the selected row.

The attribute can be assigned dynamic properties by means of the name **SelectionRect**. The data type is LONG.

## SelectionRectColor property (before WinCC V7)

### Description

Specifies the color of the rectangle in the message window if SelectionType equals "1".

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## SelectionRectColor property

### Color of the selection border - SelectionRectColor

Specifies the color of the selection border. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **SelectionRectColor**.  
The data type is LONG.

## SelectionRectWidth property (before WinCC V7)

### Description

Specifies the line weight of the rectangle in the message window if SelectionType equals "1".

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## SelectionRectWidth property

### Line weight of the selection border - SelectionRectWidth

Defines the line weight of the selection border in pixels.

The attribute can be assigned dynamic properties by means of the name **SelectionRectWidth**.  
The data type is LONG.

## SelectionMode property (before WinCC V7)

### Description

Specifies if the selected message in the message window should be optically emphasized by color change or rectangle.

- 0 - Color Change: selected message is optically emphasized by color change
- 1 - Rectangle: selected message is optically emphasized by a rectangle

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## SelectionMode property

### Selectable rows - SelectionType

Defines the number of lines you can select. The following settings are available:

Value	Description	Explanation
0	None	No row selection.
1	Single selection	One row can be selected.
2	Multiple selection	Multiple rows can be selected.

The attribute can be assigned dynamic properties by means of the name **SelectionMode**. The data type is LONG.

## SelIndex property

### Description

Defines and returns the index of which the associated text is highlighted in the combobox or list box.

The maximum value is the number of lines (NumberLines) of the object.

## SelText property

### Description

Shows the text defined with the "Selected field" (SelIndex) attribute which is highlighted in the combobox or list box.



## SelTextColor Property

### Description

Defines or returns the color of the text of the selected entry in the text list object. LONG write-read access.

### See also

Text list (Page 196)

ScreenItem Object (Page 125)

## ServerData Property

### Description

The attribute can only be modified using the "Properties of WinCC Online Trend Control" dialog. Read only access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## ServerDataX

### ServerDataX

Accesses the configured data connection for the X axis with WinCC FunctionTrendControl.

The attribute can be assigned dynamic properties by means of the name **ServerDataX**. The data type is LONG.

### Example: Editing the start ID

You may use the **ServerDataX** attribute to edit the start ID of the X axis.

Prerequisite is that you have an existing trend and trend view, configured X and Y axes, as well as a data connection to the user archive.

In the following example you employ the GetTrend method to set a reference to the object in step one, and then to the trend used in step two. Determine the data connection settings in the third step. Set the start ID to 4 in step 4. The number (3) represents the listing type "user archive" for data transfer. Change the modified data connection settings in step five:

```

Sub OnCklick(ByVal Item)
1. Step:
  Dim fx_ctrl
  Set fx_ctrl = ScreenItems.Item("Control1")
2. Step:
  Dim fx_trend
  Set fx_trend = fx_ctrl.Gettrend("myTrend1")
3. Step:
  Dim vServerDataX, vServerDataY
  vServerDataX = fx_trend.ServerDataX
  vServerDataY = fx_trend.ServerDataY
4. Step:
  Dim startId
  startId = CLng(4)
  vServerDataX(3) = startId
  vServerDataY(3) = startId
5. Step:
  fx_trend.ServerDataX = ServerDataX
  fx_trend.ServerDataY = ServerDataY
End Sub

```

## ServerDataY

## ServerDataY

Accesses the configured data connection for the Y axis with WinCC FunctionTrendControl.

The attribute can be assigned dynamic properties by means of the name **ServerDataY**. The data type is LONG.

### Example: Editing the start ID

You may use the **ServerDataY** attribute to edit the start ID of the Y axis.

Prerequisite is that you have an existing trend and trend view, configured X and Y axes, as well as a data connection to the user archive.

In the following example you employ the GetTrend method to set a reference to the object and then to the trend used. Determine the data connection settings in the third step. Set the start ID to 4 in step 4. The number (3) represents the listing type "user archive" for data transfer. Change the modified data connection settings in step five:

```

Sub OnCklick(ByVal Item)
1. Step:
  Dim fx_ctrl
  Set fx_ctrl = ScreenItems.Item("Control1")
2. Step:
  Dim fx_trend
  Set fx_trend = fx_ctrl.Gettrend("myTrend1")

```

```
3. Step:
Dim vServerDataX, vServerDataY
vServerDataX = fx_trend.ServerDataX
vServerDataY = fx_trend.ServerDataY

4. Step:
Dim startId
startId = CLng(4) * vServerDataX(3)
startId = startId + vServerDataY(3)

5. Step:
fx_trend.ServerDataX = ServerDataX
fx_trend.ServerDataY = ServerDataY

End Sub
```

## ServerNames property

### Server selection - ServerNames

Defines from which servers within a distributed system the message window obtains the display data.

The attribute can be assigned dynamic properties by means of the name **ServerNames**. The data type is STRING.

## ServerNames property (before WinCC V7)

### Description

Defines the server in a distributed system to which the data in the message window should relate. Servers are specified as follows: NameServer1;NameServer2;NameServer3. Write/Read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## ServerPrefix Property

### Description

Defines the server containing the picture to be displayed in the picture window in Runtime or returns the server name.

Enter the server name followed by two colons: "<Servername>:". No check is made as to whether the server actually exists.

## See also

Picture Window (Page 179)

ScreenItem Object (Page 125)

## Sh - Sk

### ShareSpaceWithSourceControl property

#### ShareSpaceWithSourceControl

Defines whether the size of the source control in the picture window is adapted so that the WinCC RulerControl is also displayed in a small picture window.

Value	Explanation
TRUE	The source control in the picture window is adapted.
FALSE	The source control in the picture window is not adapted.

The attribute can be assigned dynamic properties by means of the name **ShareSpaceWithSourceControl**. The data type is BOOLEAN.

### ShowBar Property

#### Description

TRUE, when the bar should be displayed. BOOLEAN write-read access.

#### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

### ShowBarIcon property

#### ShowBarIcon

Enables the display of an icon below the value axes. The symbol indicates the diagram currently displayed in the foreground.

The attribute can be assigned dynamic properties using the name **ShowBarIcon**. The data type is BOOLEAN.

## ShowDanger Property

### Description

Controls the display of the "danger zone" on the instrument scale. BOOLEAN write-read access.

TRUE : The area is identified by the color defined in "DangerColor".

FALSE : The color identification of the area is switched off.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## ShowDecimalPoint Property

### Description

TRUE, when the labeling of the scale section should be with decimal numbers (decimal point and one decimal place).

FALSE, when the labeling of the scale section should be with whole numbers.

BOOLEAN write-read access.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## ShowMilliseconds property

### ShowMilliseconds

Specifies whether milliseconds are displayed in the diagnostic buffer view.

The attribute can be assigned dynamic properties using the name **ShowMilliseconds**. The data type is BOOLEAN.

## ShowNormal Property

### Description

Controls the display of the "normal zone" on the instrument scale. BOOLEAN write-read access.

TRUE : The area is identified by the color defined for normal color.

FALSE : The color identification of the area is switched off.

**See also**

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

**ShowPeak Property**

**Description**

Defines the display of a slave pointer to display the maximum value. BOOLEAN write-read access.

TRUE : The slave pointer is displayed.

FALSE : The slave pointer is hidden.

**See also**

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

**ShowPosition Property**

**Description**

TRUE, when the slider position is to be displayed. BOOLEAN write-read access.

**See also**

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

**ShowRuler property**

**Show ruler - ShowRuler**

Enables the display of a ruler for scanning the coordinate points on picture calls.

Value	Explanation
TRUE	Enables the display of a ruler for scanning the coordinate points.
FALSE	Disables the display of a ruler for scanning the coordinate points.

The attribute can be assigned dynamic properties by means of the name **ShowRuler**. The data type is BOOLEAN.

## ShowRulerImmediately Property

### Description

TRUE, when the ruler for determining the coordinate values should be displayed when opening a picture. BOOLEAN write-read access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## ShowRulerInAxis property

### ShowRulerInAxis

Enables the display of rulers in the time axis.

Value	Explanation
TRUE	Enables the display of rulers in the time axes.
FALSE	Disables the display of rulers in the time axes.

The attribute can be assigned dynamic properties by means of the name **ShowRulerInAxis**. The data type is BOOLEAN.

## ShowScrollbars property

### Scroll bars - ShowScrollbars

Enables the display of scroll bars.

The following settings are available:

Value	Description	Explanation
0	No	The display of scroll bars is disabled.
1	as required	Scroll bars are displayed if space requirements of the control are greater than the actual display area.
2	always	The scroll bars are always displayed.

The attribute can be assigned dynamic properties by means of the name **ShowScrollbars**. The data type is LONG.

## ShowSlider property

### ShowSlider

Specifies if a time slider is displayed in the control.

The attribute can be assigned dynamic properties by means of the name **ShowSlider**. The data type is BOOLEAN.

## ShowSortButton property

### Use sorting button - ShowSortButton

Enables the display of a sorting button above the vertical scroll bar. Click this sorting button to sort the selected column based on the configured sorting criteria. The sorting button is not displayed if the table does not contain a vertical scroll bar.

Value	Explanation
TRUE	Enables sorting of a selected column by means of sorting button.
FALSE	The sorting button is not displayed.

The attribute can be assigned dynamic properties by means of the name **ShowSortButton** . The data type is BOOLEAN.

## ShowSortIcon property

### Show sorting icon - ShowSortIcon

Enables the display of the sorting icon.

Value	Explanation
TRUE	Enables the display of the sorting icon.
FALSE	Disables the display of the sorting icon.

The attribute can be assigned dynamic properties by means of the name **ShowSortIcon**. The data type is BOOLEAN.

## ShowSortIndex property

### Show sorting index - ShowSortIndex

Enables the display of a sorting icon.

Value	Explanation
TRUE	Enables the display of a sorting index.
FALSE	Disables the display of a sorting index.



The attribute can be assigned dynamic properties by means of the name **ShowSortIndex**. The data type is BOOLEAN.

## ShowSpanNames Property

### Description

TRUE, if a section name is also to be displayed in the Value column of Trend Control apart from the measured value and the status display "i" and "u". BOOLEAN write-read access.

## ShowStatisticRuler property

### ShowStatisticRuler

Enables the display of rulers in the statistics field on picture calls.

Value	Explanation
TRUE	Enables the display of rulers in the statistics field.
FALSE	Disables the display of rulers in the statistics field.

The attribute can be assigned dynamic properties by means of the name **ShowStatisticRuler**. The data type is BOOLEAN.

## ShowThumb Property

### Description

TRUE, when the slider is to be displayed. BOOLEAN write-read access.

### See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## ShowTitle property

### Window title - ShowTitle

Defines representation the Control window header.

Value	Designation	Explanation
0	No	No window title.
1	Normal	The window title consists of a WinCC icon and text. The text is entered in the "Text" field.
2	Narrow	The window title consists only of text. The text is entered in the "Text" field.

The attribute can be assigned dynamic properties by means of the name **ShowTitle**. The data type is LONG.

### ShowToolbar property

#### ShowToolbar

Specifies if a toolbar is displayed in the control.

The attribute can be assigned dynamic properties by means of the name **ShowToolbar**. The data type is BOOLEAN.

### ShowTrendIcon property

#### ShowTrendIcon

Enables the display of an icon below the value axes. The icon indicates the trend currently displayed in the foreground.

The attribute can be assigned dynamic properties by means of the name **ShowTrendIcon**. The data type is BOOLEAN.

### ShowValuesExponentialX Property

#### Description

TRUE, when the X-coordinate of a measured value determined via the "Display value at this position" function is displayed in exponential notation by a trend referenced via "Index". Whether the information is evaluated is dependent on the value of the "TimeAxisX" property. BOOLEAN write-read access.

#### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

### ShowValuesExponentialY Property

#### Description

TRUE, when the Y-coordinate of a measured value determined via the "Display value at this position" function is displayed in exponential notation by a trend referenced via "Index". BOOLEAN write-read access.

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

**ShowWarning Property****Description**

Controls the display of the "warning zone" on the instrument scale. BOOLEAN write-read access.

TRUE : The area is identified by the color defined by the warning color attribute.

FALSE : The color identification of the area is switched off.

**See also**

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

**SignificantMask Property****Description**

Is required in Runtime to display the active message class with the highest priority. The value of the SignificantMask property represents an internal system output value does not require any specific configuration by the user. Updating is initiated in Runtime by clicking on the object.

**See also**

Group Display (Page 194)

ScreenItem Object (Page 125)

**Sizeable property****Sizeable**

Enables resizing of the control during runtime.

Value	Explanation
TRUE	The control can be resized during runtime.
FALSE	The control cannot be resized during runtime.

The attribute can be assigned dynamic properties by means of the name **Sizeable**. The data type is BOOLEAN.

## SkinName property

### Style - SkinName

The control style can be defined in this selection field.

The following settings are available:

Value	Designation	Explanation
	Project setting	The style corresponds to the project settings in WinCC Explorer.
0	Simple	"Classic" WinCC style
1	Standard	New WinCC V7 style
	Basic Process Control	The style is reserved for internal use with Basic Process Control.

The attribute can be assigned dynamic properties by means of the name **SkinName**. The data type is STRING.

### Sm - Sq

## SmallChange Property

### Description

Defines how many steps the controller can be moved with one mouse click or returns the value.

### See also

Slider (Page 212)

ScreenItem Object (Page 125)

## SmartTag property

### Description

Returns an object of type "SmartTag".

### See also

SmartTags Object (Page 136)

## SortOrder Property

### Description

Defines the sort sequence of the message blocks in the message window.

## SortSequence property

### Sorting order by mouse click - SortSequence

Specifies how to change the sorting order by mouse click.

The following sorting orders are available:

Value	Description	Explanation
0	Up/down/none	You can toggle between ascending, descending and no sorting by means of mouse click.
1	Up/down	You can toggle between ascending and descending sorting order by means of mouse click.

The attribute can be assigned dynamic properties by means of the name **SortSequence**. The data type is LONG.

## SourceBeginTime Property

### Description

In the case of online tags and archive tags ("ProviderType" = -1), it defines the starting time of the time range of a trend referenced via "Index" and to be displayed in the trend window. In the case of modification of "SourceBeginTime", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceBeginTime", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceControl property

### Source - SourceControl

Defines the control to be interconnected with WinCC RulerControl.

The attribute can be assigned dynamic properties by means of the name **SourceControl**. The data type is STRING.

## SourceControlType property

### Type - SourceControlType

Defines the type of control that is interconnected with the WinCC RulerControl in the "Source" field.

Value	Designation	Explanation
0	None	The RulerControl is not connected to any source.
1	OnlineTrend Control	The RulerControl is connected with an OnlineTrendControl.
2	OnlineTable Control	The RulerControl is connected with an OnlineTableControl.
3	FunctionTrend Control	The RulerControl is connected with a FunctionTrendControl.

The attribute can be assigned dynamic properties by means of the name **SourceControlType**. The data type is LONG.

## SourceEndTime Property

### Description

In the case of online tags and archive tags ("ProviderType" = -1), it defines the stopping time of the time range of a trend referenced via "Index" and to be displayed in the trend window. In the case of modification of "SourceEndTime", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceEndTime", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceNumberOfUAValues Property

### Description

For values from the user archives ("ProviderType" = -2) it defines the number of values which should be loaded from the user archive for a trend referenced via "Index". In the case of modification of "SourceNumberOfUAValues", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceNumberOfUAValues", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

**SourceNumberOfValues Property****Description**

The "Index" property references a trend. In the case of online tags and archive tags ("ProviderType" = -1), "SourceNumberOfValues" defines the number of values which should be displayed in the trend window. Whether the information is evaluated is dependent on the value of the "SourceTimeRange" property.

In the case of modification of "SourceNumberOfValues", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceNumberOfValues", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

**SourceTagNameX Property****Description**

The "Index" property references a trend. In the case of online tags and archive tags ("ProviderType" = -1) "SourceTagNameX" defines the tag which should be displayed along the X-axis. In the case of modification of "SourceTagNameX", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceTagNameX", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceTagNameY Property

### Description

The "Index" property references a trend. In the case of online tags and archive tags ("ProviderType" = -1) "SourceTagNameY" defines the tag which should be displayed along the X-axis. In the case of modification of "SourceTagNameY", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceTagNameY", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceTagProviderDataX Property

### Description

The attribute can only be modified using the "Properties of WinCC Function Trend Control" dialog.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceTagProviderDataY Property

### Description

The attribute can only be modified using the "Properties of WinCC Function Trend Control" dialog.

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)



## SourceTimeRange Property

### Description

The "Index" property references a trend. In the case of online tags and archive tags ("ProviderType" = -1) "SourceTimeRange" defines how the time range to be displayed in the trend window is defined. In the case of modification of "SourceTimeRange", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceTimeRange", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

0: The time range to be displayed is defined by the starting time (SourceBeginTime) and the number of value pairs (SourceNumberOfValues).

-1: The time range to be displayed is defined by the starting time (SourceBeginTime) and stopping time (SourceEndTime).

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceUAArchive Property

### Description

The "Index" property references a trend. In the case of values from the user archives ("ProviderType" = -2), "SourceUAArchive" defines the user archive from which the values should be loaded. In the case of modification of "SourceUAArchive", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceUAArchive" the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

### See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceUAArchiveStartID Property

### Description

The "Index" property references a trend. In the case of values from the user archives ("ProviderType" = -2), "SourceUAArchiveStartID" defines the data record from which the values should be loaded from the user archive. In the case of modification of "SourceUAArchiveStartID", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceUAArchiveStartID", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceUAColumnX Property

### Description

The "Index" property references a trend. In the case of values from the user archives ("ProviderType" = -2), "SourceUAColumnX" defines the column in the user archive from which the values for the X-axis should be loaded. In the case of modification of "SourceUAColumnX", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceUAColumnX", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SourceUAColumnY Property

### Description

The "Index" property references a trend. In the case of values from the user archives ("ProviderType" = -2), "SourceUAColumnY" defines the column in the user archive from which the values for the Y-axis should be loaded. In the case of modification of "SourceUAColumnY", impermissible combinations with other attributes for data connection could be created. Therefore, before modifying "SourceUAColumnY", the immediate acceptance of the changes must be prevented using "FreezeProviderConnections".

## See also

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## SplittedViewRatio property

### SplittedViewRatio

With a split display, this specifies the portion of the "Diagnostic overview" area is shown compared to the "Detail view" area.

The attribute can be assigned dynamic properties using the name **SplittedViewRatio**. The data type is DOUBLE.

## SquareExtent Property

### Description

TRUE, when the size of the clock should be adjustable to any side ratio by dragging the marking points with the mouse. BOOLEAN write-read access.

### See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## St - Sy

## StartAngle Property

### Description

Defines or returns the start of the object. The information is in counterclockwise direction in degrees, beginning at the 12:00 clock position.

### See also

Pie segment (Page 152)

Circular arc (Page 151)

Ellipse segment (Page 147)

Ellipse arc (Page 146)

ScreenItem Object (Page 125)

## State property

### Description

Returns the status of a message.

The following table shows the possible states of a message:

State	Alarm Log Status
1	Came In
2	Went Out
5	Came in and comment
6	Gone and comment

**See also**

Alarms object (list) (Page 110)

**Statusbar Property**

**Description**

TRUE, when the status line is to be displayed. BOOLEAN write-read access.

**See also**

- WinCC Online Table Control (before WinCC V7) (Page 292)
- WinCC Online Trend Control (before WinCC V7) (Page 295)
- WinCC Function Trend Control (before WinCC V7) (Page 288)
- WinCC Alarm Control (before WinCC V7) (Page 286)
- ScreenItem Object (Page 125)

**StatusbarAlignment property**

**Alignment - StatusbarAlignment**

Specifies the alignment of the status bar in the control.

The following settings are available:

Value	Description	Explanation
0	Top	The status bar is aligned to the top edge.
1	Below	The status bar is aligned to the bottom edge.
2	Left	The status bar is aligned to the left edge.
3	Right	The status bar is aligned to the right edge.

The attribute can be assigned dynamic properties using the name **StatusbarAlignment**. The data type is LONG.

**StatusbarBackColor property**

**Background color - StatusbarBackColor**

Defines the background color of the status bar. The button opens the "Color selection" dialog to select the color.

For the setting to become active, the "Display" or "StatusbarUseBackColor" option must be activated.

The attribute can be assigned dynamic properties by means of the name **StatusbarBackColor**. The data type is LONG.

**StatusbarElementAdd** property**New - StatusbarElementAdd**

Defines a new, user-defined status bar element. The name set by WinCC can be edited in the "Object name" field.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementAdd**. The data type is STRING.

**StatusbarElementAutoSize** property**Automatic - StatusbarElementAutoSize**

Enables autosizing of the width of a status bar element selected.

Value	Explanation
TRUE	The width of the selected element is set automatically.
FALSE	The width of the selected element is not set automatically.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementAutoSize**. The data type is BOOLEAN.

**StatusbarElementCount** property**StatusbarElementCount**

Defines the number of configurable status bar elements.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementCount**. The data type is LONG.

**StatusbarElementIconId** property**StatusbarElementIconId**

Default assignment of the ID number and icon of a status bar element.

The attribute for custom status bar elements can be made assigned dynamic properties by means of the name **StatusbarElementIconId**. The data type is LONG.

**StatusbarElementID** property**Object ID - StatusbarElementID**

Unique ID of the status bar element selected. WinCC assigns this read only ID number.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementID**. The data type is LONG.

### StatusbarElementIndex property

#### StatusbarElementIndex

References a status bar element. Using this attribute you can assign the values of other attributes to a specific status bar element.

Values between 0 and "StatusbarElementCount" minus 1 are valid for "StatusbarElementIndex". Attribute "StatusbarElementCount" defines the number of configurable status bar elements.

The "StatusbarElementIndex" attribute can be assigned dynamic properties by means of attribute **StatusbarElementIndex**. The data type is LONG.

### StatusbarElementName property

#### Object name - StatusbarElementName

Displays the object name of the status bar element selected. You can rename the objects of custom status bar elements.

The "StatusbarElementName" attribute can be assigned dynamic properties by means of attribute **StatusbarElementRename**. The data type is STRING.

### StatusbarElementRemove property

#### Remove - StatusbarElementRemove

Removes the selected status bar element. You can only remove user-defined status bar element from the list.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementRemove**. The data type is STRING.

### StatusbarElementRename property

#### StatusbarElementRename

Renames a custom status bar element which is referenced by means of "StatusbarElementIndex" attribute.

The attribute for custom elements can be assigned dynamic properties by means of the name **StatusbarElementRename**. "StatusbarElementRename" also sets a dynamic attribute "StatusbarElementName". The data type is STRING.

**StatusbarElementRepos property****Up/Down - StatusbarElementRepos**

Changes the sorting order of button functions. "Up" and "Down" moves the selected status bar element up or down in the list. This moves the status bar element of the Control towards the front or towards the back in Runtime.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementRepos** . The data type is LONG.

**StatusbarElementText property****StatusbarElementText**

Defines the text to be displayed for the status bar element. You can edit the "StatusbarElementText" attribute for custom elements.

The attribute for custom elements can be assigned dynamic properties by means of the name **StatusbarElementText**. The data type is STRING.

**StatusbarElementTooltipText property****StatusbarElementTooltipText**

Defines the tooltip text for the custom status bar element.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementTooltipText**. The data type is STRING.

**StatusbarElementVisible property****Status bar elements - StatusbarElementVisible**

Activate the elements in the list of status bar elements for their display in Runtime.

Click a list entry to adapt the properties, or to change its position in the status bar of the Control by means of the "Up" and "Down" buttons.

Value	Explanation
TRUE	The status bar element is displayed.
FALSE	The status bar element is not displayed.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementVisible**. The data type is BOOLEAN.

## StatusbarElementUserDefined property

### StatusbarElementUserDefined

Indicates whether the project engineer has added the status bar element as a new custom element.

Value	Explanation
TRUE	The status bar element is user-defined.
FALSE	The status bar element is defined by the system.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementUserDefined**. The data type is BOOLEAN.

## StatusbarElementWidth property

### Width in pixels - StatusbarElementWidth

Shows the width of the status bar element selected in pixels. You can define the width if the "Automatic" option is not activated.

The attribute can be assigned dynamic properties by means of the name **StatusbarElementWidth**. The data type is LONG.

## StatusbarFontColor property

### Font color - StatusbarFontColor

Defines the color of the text in the status bar.

The attribute can be assigned dynamic properties by means of the name **StatusbarFontColor**. The data type is LONG.

## StatusbarPanels Property

### Description

Defines the elements to be displayed in the status bar. Write/Read access.

### See also

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)



**StatusbarShowTooltips property****Tooltips - StatusbarShowTooltips**

Enables the display of tooltips for the status bar elements in Runtime.

Value	Explanation
TRUE	Enables the display of tooltips.
FALSE	Disables the display of tooltips.

The attribute can be assigned dynamic properties by means of the name **StatusbarShowTooltips**. The data type is BOOLEAN.

Attribute "StatusBarElementTooltipText" defines the tooltip text.

**StatusbarText property****StatusbarText**

Default text in the status bar.

The attribute can be assigned dynamic properties by means of the name **StatusbarText**. The data type is STRING.

**StatusbarUseBackColor property****Display background color - StatusbarUseBackColor**

Sets a background color for the status bar.

Value	Explanation
TRUE	Enables the display of the background color of the status bar.
FALSE	Disables the display of a background color for the status bar.

The attribute can be assigned dynamic properties by means of the name **StatusbarUseBackColor**. The data type is BOOLEAN.

**StatusbarVisible property****Show status bar - StatusbarVisible**

Enables the display of the status bar of a control.

Value	Explanation
TRUE	Enables the display of a status bar.
FALSE	Disables the display of a status bar.

The attribute can be assigned dynamic properties by means of the name **StatusbarVisible** .  
The data type is BOOLEAN.

### StepSeconds property

#### StepSeconds

Specifies the interval for step forward or step backward in movies.

The attribute can be assigned dynamic properties by means of the name **StepSeconds**. The data type is LONG.

### Stretch Property

#### Description

Defines whether the side ratio is retained or adjustable on changing the icon size. BOOLEAN write-read access.

- FALSE : The side ratio is retained on changing the icon size.
- TRUE : The side ratio of the icon can be adjusted parallel to changing the icon size.

#### See also

HMI Symbol Library (Page 239)

ScreenItem Object (Page 125)

### SymbolAppearance property

#### Foreground mode (SymbolAppearance)

Specifies the appearance of the icon.

The following settings are available:

Value	Description	Comments
0	Original	The appearance of the icon corresponds to the multi-color representation in the selection of the "Icons" tab.
1	Shadow	"Black" lines are maintained as contour lines. Elements of the symbols in other colors are displayed as brightness grades of the current foreground color.
2	Solid	"Black" lines are maintained as contour lines. All icon elements of other colors are assigned the color value of the current foreground color.
3	Outline	Lines of the color "Black" are maintained as contour lines. All the elements of the symbol in other colors are assigned the color value of the current background color.

The attribute can be assigned dynamic properties by means of the name **SymbolAppearance**. The data type is LONG.

#### 1.14.4.19 T

### Ta -Tic

#### TableColor property

##### Row background color 1 - TableColor

Defines the background color of the rows. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **TableColor**. The data type is LONG.

#### TableColor2 property

##### Row background color 2 - TableColor2

Specifies the background color of "Row color 2". The button opens the "Color selection" dialog.

The setting is only active in Runtime if the "Row color 2" or "UseTableColor2" option is activated. The background colors of "Row color 2" and "Row color 1" are used alternately in this case.

The attribute can be assigned dynamic properties by means of the name **TableColor2**. The data type is LONG.

#### TableFocusOnButtonCommand Property

##### Description

Defines whether the focus is set to the table of the control when a button in a script is clicked.

#### TableForeColor property

##### Row font color 1 - TableForeColor

Specifies the font color of the rows. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **TableForeColor**. The data type is LONG.

#### TableForeColor2 property

##### Row font color 2 - TableForeColor2

Specifies the font color of "Row color 2". The button opens the "Color selection" dialog.

The setting is only active in Runtime if the "Row color 2" or "UseTableColor2" option is activated. The font colors of "Row color 2" and "Row color 1" are used alternately in this case.

The attribute can be assigned dynamic properties by means of the name **TableForeColor2**.  
The data type is LONG.

## TagName Property

### Description

The "Index" property references a trend. "TagName" defines the tag linked to this trend. It is specified in the form "Archivname\Variablenname" to display tags in a process value archive or "TasgName" to display an internal or external tag which is not stored in an archive.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## TagPrefix Property

### Description

Defines or returns the tag prefix which is prefixed to all tags contained in the picture window object. In this way, a picture that is embedded in a picture window retains access to its own tags while another accesses other tags.

Modification of the TagPrefix takes effect when a picture is reloaded. When a picture is changed, this occurs automatically; otherwise, the picture name must be reassigned.

The tag prefix can be freely defined, but must match the name of the structure tags.

---

#### Note

##### **Do not specify an additional tag prefix in the child picture window**

If a picture window is configured in a referenced picture of a picture window, the tag prefix of the parent picture window is applied to the child picture window of the tag prefix. You should not specify an additional tag prefix in the child picture window, because WinCC does not support bundled structure tags. The interpretation "Tag\_prefix1.Tag\_prefix2.Tag\_name" cannot be used for dynamization.

---

#### Note

The TagPrefix property is not available for the controls.

---

**See also**

Picture Window (Page 179)

ScreenItem Object (Page 125)

**Tags Property****Description**

Returns an object of type "Tags".

Tags (read only)

**Example:**

The following example accesses the tag "Tag1":

```
'VBS86
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
```

**See also**

Tags Object (List) (Page 140)

HMIRuntime Object (Page 118)

**TagProviderClsid Property****Description**

The "Index" property references a trend. "TagProviderClsid" defines whether this trend should display an online tag or archived value. The data is only evaluated for online tags and archive tags ("ProviderType" = -1).

{A3F69593-8AB0-11D2-A440-00A0C9DBB64E}: Online tag.

{416A09D2-8B5A-11D2-8B81-006097A45D48}: Values are read from a process value archive or a user archive.

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## Template Property

### Description

Returns the template for displaying the window content of the "Application Window" object. Read only access.

The following templates are possible depending on the property value:

#### **Window Contents = Global Script**

"GSC diagnostics"

The application window is supplied by applications of the Global Script. The results of the diagnosis system are displayed.

"GSC Runtime"

The application window is supplied by applications of the Global Script. The analysis results regarding characteristics in Runtime are displayed.

#### **Window Contents = Print Jobs**

"All Jobs":

The application window is supplied by the logging system. The available reports are displayed as a list.

"All Jobs - Context Menu":

The application window is supplied by the logging system. The available reports are displayed as a list. The shortcut menu enables the selection of print options, display of a print preview as well as a printout of the log.

"Job Detail View":

The application window is supplied by the logging system. The available reports are displayed in a selection menu. Detailed information is displayed for the selected report.

"Selected Jobs - Context Menu":

The application window is supplied by the logging system. The available reports are displayed as a list. This list only contains reports which you have activated the option "Mark for print job list" in the "Print Job Properties" dialog. The shortcut menu enables the selection of print options, display of a print preview as well as a printout of the log.

### See also

ScreenItem Object (Page 125)

Application Window (Page 173)

## Text Property

### Description

Defines or returns the labeling for an object.

## See also

Radio box (Page 207)  
Check box (Page 204)  
Button (Page 201)  
Static text (Page 165)  
ScreenItem Object (Page 125)

## ThumbBackColor Property

### Description

Defines the color of the slider.

### See also

WinCC Slider Control (Page 277)  
ScreenItem Object (Page 125)

## TicColor Property

### Description

Defines the color of the scale tick marks. LONG write-read access.

### See also

WinCC Gauge Control (Page 254)  
ScreenItem Object (Page 125)

## TicFont Property

### Description

Controls the display of the scale division labeling. Read only access.

The following properties can be set:

- Font
- Font Style
- Font Size
- "Strikethrough" effect
- "Underline" effect

## See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## TicOffset Property

### Description

Defines the diameter of the imaginary circle on which the scale graduation is set. The value is related to the smaller value of the geometric properties Width and Height.

The ends of the main tick marks of the scale graduation point outwards onto this circle.

Value range from 0 to 1.

0: The scale division is in the middle of the graduated scale disk.

1: The diameter of the imaginary circle for the scale tick marks is the smaller value of the geometric properties Width and Height.

## See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## TicTextColor Property

### Description

Defines the color of the labeling of the scale tick marks.

## See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## TicTextOffset Property

### Description

Defines the diameter of the imaginary circle on which the labeling of the scale tick marks is set. The value is related to the smaller value of the geometric properties Width and Height.

Value range from 0 to 1.

0: The label is in the middle of the graduated scale disk.



1: The diameter of the imaginary circle for the label is the smaller value of the geometric properties Width and Height. As a result, part of the label can lie outside the object limits and is, thus, invisible.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## TicWidth Property

### Description

Defines the length of the long tick marks for the scaling. The value is related to the half the smaller value of the geometric properties Width and Height.

The length of the tick marks for fine scaling is  $0.5 * \text{scale width}$ .

Value range from 0 to end of scale.

0: No scale graduation is available. The division of the scale into ranges is not visible.

Scaling distance: The scaling division ranges from the middle point of the graduated scale disk to the value defined by the scaling distance.

### See also

ScreenItem Object (Page 125)

WinCC Gauge Control (Page 254)

## Ticks Property

### Description

TRUE, when the numbered face is displayed. BOOLEAN write-read access.

### See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## TicksColor Property

### Description

Defines or returns the color of the hour markings on the face of the analog clock. LONG write-read access.

## See also

WinCC Digital/Analog Clock (Page 246)

ScreenItem Object (Page 125)

## TickStyle Property

### Description

This attribute defines the appearance of the scale. Value Range: 0 to 3.

As a result of the automatic scaling, it is possible that, occasionally, two scale tick marks lie directly beside each other (apparently wide tick mark). This effect can be corrected by minimally lengthening or shortening the slider object.

It is also possible to completely suppress display of the scaling ("WithAxes").

## See also

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

## TimeAxis - TimeBase

## TimeAxis Property

### Description

Defines whether a common time axis should be used for all trends in the trend window.

## See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## TimeAxisActualize property

## Refresh - TimeAxisActualize

Enables refreshing of the time axis selected.

Value	Explanation
TRUE	Enables updates of the trend window which is assigned to the time axis.
FALSE	Disables updates of the trend window which is assigned to the time axis. This setting can be useful when comparing a logged trend with a current trend.

The attribute can be assigned dynamic properties by means of the name **TimeAxisActualize**. The data type is BOOLEAN.

## TimeAxisAdd property

### New - TimeAxisAdd

Creates a new time axis.

The attribute can be assigned dynamic properties by means of the name **TimeAxisAdd**. The data type is STRING.

## TimeAxisAlign property

### Alignment - TimeAxisAlign

Specifies the mode of alignment of a selected time axis.

The following settings are available:

Value	Description	Explanation
0	Bottom	The selected time axis is displayed below the trend or diagram.
1	Top	The selected time axis is displayed above the trend or diagram.

The attribute can be assigned dynamic properties by means of the name **TimeAxisAlign**. The data type is LONG.

## TimeAxisBarWindow property

### Diagram window - TimeAxisBarWindow

Specifies the diagram window in which the selected time axis will be used. You can specify the available diagram window in the "Diagram window" tab or using "BarWindowAdd".

The attribute can be assigned dynamic properties using the name **TimeAxisBarWindow**. The data type is STRING.

## TimeAxisBeginTime property

### Start time - TimeAxisBeginTime

Defines the start of the time range for a selected time axis.

The attribute can be assigned dynamic properties by means of the name **TimeAxisBeginTime**. The data type is Date.

Use the "yyyy-mm-dd hh:mm:ss" format when setting a dynamic time range.

## TimeAxisColor property

### Time axis color - TimeAxisColor

Specifies the color of the time axis. The button opens the "Color selection" dialog to select the color.

The setting is only active if the "Use trend color" or "Use diagram color" option is disabled or if "ValueAxisInTrendColor" is "FALSE".

The attribute can be assigned dynamic properties by means of the name **TimeAxisColor**. The data type is LONG.

## TimeAxisCount property

### TimeAxisCount

Defines the number of time axes configured.

The attribute can be assigned dynamic properties by means of the name **TimeAxisCount**. The data type is LONG.

## TimeAxisDateFormat property

### Date format - TimeAxisDateFormat

Defines the date format for visualizing a selected time axis.

The following date formats are available:

Value	Explanation
Automatic	The date format is set automatically.
dd.MM.yy	Day.Month.Year, e.g. 24.12.07.
dd.MM.yyyy	Day.Month.Year, e.g. 24.12.2007.
dd/MM/yy	Day/Month/Year, e.g. 24/12/07.
dd/MM/yyyy	Day/Month/Year, e.g. 24/12/2007.

The attribute can be assigned dynamic properties by means of the name **TimeAxisDateFormat**. The data type is STRING.

## TimeAxisEndTime property

### End time - TimeAxisEndTime

Defines the end of the time range of a selected time axis.

The attribute can be assigned dynamic properties by means of the name **TimeAxisEndTime**. The data type is Date.

Use the "yyyy-mm-dd hh:mm:ss" format when setting a dynamic time range.

## TimeAxisFormat Property

### Description

Defines the format of the information along the time axis.

- 0: The information is provided in hh:mm
- -1: The information is provided in hh:mm:ss
- -2: The information is provided in hh:mm:ss.ms
- -3: The information is provided in hh:mm (full hours)
- -4: The information is provided in hh:mm:ss (full minutes)
- -5: The information is provided in hh:mm:ss.ms (full seconds)

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

## TimeAxisInBarColor property

### In diagram color - TimeAxisInBarColor

Specifies whether the selected time axis will be displayed in the diagram color. If there is more than one diagram in the diagram window, the color of the first diagram will be used. You specify the order of the diagrams on the "Diagrams" tab.

Value	Explanation
TRUE	The selected time axis is displayed in the diagram color. The setting in the "Color" or "TimeAxisColor" field is disabled.
FALSE	The selected time axis is displayed in the color set in the "Color" or "TimeAxisColor" field.

The attribute can be assigned dynamic properties using the name **TimeAxisInBarColor**. The data type is BOOLEAN.

## TimeAxisIndex property

### TimeAxisIndex

References a configured time axis. Using this attribute you can assign the values of other attributes to a specific time axis.

Values between 0 and "TimeAxisCount" minus 1 are valid for "TimeAxisIndex". Attribute "TimeAxisCount" defines the number of trends configured.

The "TimeAxisIndex" attribute can be assigned dynamic properties by means of attribute **TimeAxisRepos**. The data type is LONG.

**TimeAxisInTrendColor property****Use trend color - TrendAxisInTrendColor**

Sets a trend color for displaying the time axis selected. The color of the first trend is activated if several trends are displayed in the trend window. Define the order of trends on the "Trends" tab.

Value	Explanation
TRUE	The trend color is used to display the time axis selected. The setting in the "Color" or "TimeAxisColor" field is disabled.
FALSE	The time axis selected is displayed in the color set in the "Color" or "TimeAxisColor" field.

The attribute can be assigned dynamic properties by means of the name **TimeAxisInTrendColor**. The data type is BOOLEAN.

**TimeAxisLabel property****Label - TimeAxisLabel**

Defines the label text for a time axis.

The attribute can be assigned dynamic properties by means of the name **TimeAxisLabel**. The data type is STRING.

**TimeAxisMeasurePoints property****Number of measurement points - TimeAxisMeasurePoints**

Defines the number of measurement points to be displayed at the time axis selected.

The attribute can be assigned dynamic properties by means of the name **TimeAxisMeasurePoints**. The data type is LONG.

**TimeAxisName property****Object name - TimeAxisName**

Specifies the name of a selected time axis.

The "TimeAxisName" attribute can be assigned dynamic properties by means of attribute **TimeAxisRename**. The data type is STRING.

## TimeAxisRangeType property

### Time range setting - TimeAxisRangeType

Specifies the time range for the time axis selected.

Value	Description	Explanation
0	Time range	Defines the start time and the time range for the time axis.
1	Start to end time	Defines the start and end time for the time axis.
2	Number of measurement points	Defines the start time and the number of measurement points for the time axis.

The attribute can be assigned dynamic properties by means of the name **TimeAxisRangeType**. The data type is LONG.

## TimeAxisRemove property

### Remove - TimeAxisRemove

Removes the selected time axis from the list.

The attribute can be assigned dynamic properties by means of the name **TimeAxisRemove**. The data type is STRING.

## TimeAxisRename property

### TimeAxisRename

Renames a time axis which is referenced by means of "TimeAxisIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **TimeAxisRename**. "TimeAxisRename" also sets a dynamic attribute "TimeAxisName". The data type is STRING.

## TimeAxisRepos property

### Up/Down - TimeAxisRepos

Changes the order of the time axes. "Up" and "Down" move the selected time axis up or down in the list.

The list order determines the time axis position in the trend window or diagram window in runtime. If the orientation is the same and the time axis is further above, the time axis is shown at a more remote position of the curve or diagram.

The attribute can be assigned dynamic properties by means of the name **TimeAxisRepos**. The data type is LONG.

**TimeAxisShowDate** property**Show date - TimeAxisShowDate**

Enables the display of the date and time at the time axis selected.

Value	Explanation
TRUE	Date and time are displayed. The date format is defined in the "Date format" field.
FALSE	The date is not displayed. Only the time is displayed.

The attribute can be assigned dynamic properties by means of the name **TimeAxisShowDate**. The data type is BOOLEAN.

**TimeAxisTimeFormat** property**Time format - TimeAxisTimeFormat**

Defines the time format for visualizing a selected time axis.

The following time formats are available:

Value	Explanation
Automatic	The time format is set automatically.
hh:mm:ss.ms	Hours:Minutes:Seconds, e.g. 15:35:44.240.
hh:mm:ss tt	Hours:Minutes:Seconds AM/PM, e.g. 03:35:44 PM.
hh:mm:ss.ms tt	Hours:Minutes:Seconds.Milliseconds AM/PM, e.g. 03:35:44.240 PM.

The attribute can be assigned dynamic properties by means of the name **TimeAxisTimeFormat**. The data type is STRING.

**TimeAxisTimeRangeBase** property**Time range - TimeAxisTimeRangeBase**

Defines the time unit for calculating the time range.

The following time units are available:

Value	Description
500	500 ms
1000	1 second
60000	1 minute
3600000	1 hour
86400000	1 day

The attribute can be assigned dynamic properties by means of the name **TimeAxisTimeRangeBase**. The data type is LONG.



**TimeAxisTimeRangeFactor property****Time range - TimeAxisTimeRangeFactor**

Defines the factor for calculating the time range. Only integer factors are valid.

The attribute can be assigned dynamic properties by means of the name **TimeAxisTimeRangeFactor**. The data type is SHORT.

**TimeAxisTrendWindow property****Trend window - TimeAxisTrendWindow**

Specifies the trend window for displaying the time axis selected. Define the available trend windows in the "Trend window" or "TrendWindowAdd" tab.

The attribute can be assigned dynamic properties by means of the name **TimeAxisTrendWindow**. The data type is STRING.

**TimeAxisVisible property****Time axis - TimeAxisVisible**

The list shows all time axes you created. Click a time axis entry in the list to adapt the properties and to assign a trend window or diagram window to the time axis.

Select the time axes in the list that you want to display in the trend windows or diagram windows.

Defines whether the selected time axis is displayed.

Value	Explanation
TRUE	The time axis is displayed.
FALSE	The time axis is not displayed.

The attribute can be assigned dynamic properties by means of the name **TimeAxisVisible**. The data type is BOOLEAN.

**TimeAxisX Property****Description**

TRUE, when a common axis should be used for all trends in the trend window. BOOLEAN write-read access.

**See also**

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

**TimeBase property**

**Time base - TimeBase**

This selection field is used to define the time base for the time stamp in the control.

Value	Designation
0	Local time zone
1	Coordinated Universal Time (UTC)
2	Project setting

The attribute can be assigned dynamic properties by means of the name **TimeBase**. The data type is LONG.

**TimeColumn**

**TimeColumnActualize property**

**TimeColumnActualize**

Enables the update of values in the selected column.

Value	Explanation
TRUE	The time column is updated.
FALSE	The time column is not updated. This setting can be useful when comparing tables.

The attribute can be assigned dynamic properties by means of the name **TimeColumnActualize**. The data type is BOOLEAN.

**TimeColumnAdd property**

**New - TimeColumnAdd**

Creates a new time column.

The attribute can be assigned dynamic properties by means of the name **TimeColumnAdd**. The data type is STRING.

## TimeColumnAlign property

### Alignment - TimeColumnAlign

Defines the mode of alignment of the time column selected.

The following settings are available:

Value	Description	Explanation
0	left	The time column selected is displayed on the left.
1	Centered	The time column selected is aligned to center.
2	right	The time column selected is displayed on the right.

The attribute can be assigned dynamic properties by means of the name **TimeColumnAlign**. The data type is LONG.

## TimeColumnAlignment Property

### Description

The "Index" property references a pair of columns. "TimeColumnAlignment" defines the alignment of the time column for this column pair.

- 0: Time values are entered aligned left.
- 1: Time values are entered centered.
- 2: Time values are entered aligned right.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

## TimeColumnBackColor property

### Background color - TimeColumnBackColor

Specifies the background color of the time column selected. Use the button to open the "Color selection" dialog.

The setting is useful if:

- The "Use value column colors" option is not activated or "TimeColumnUseValueColumnColors" is "FALSE".
- The "Background color" option is activated or "UseColumnBackColor" is "TRUE" in the "Use column color" field of the "General" tab".

The attribute can be assigned dynamic properties by means of the name **TimeColumnBackColor**. The data type is LONG.

## TimeColumnBeginTime property

### Start time - TimeColumnBeginTime

Defines the start of the time range for a selected time column.

The attribute can be assigned dynamic properties by means of the name **TimeColumnBeginTime**. The data type is Date.

Use the "yyyy-mm-dd hh:mm:ss" format when setting a dynamic time range.

## TimeColumnCaption property

### Caption - TimeColumnCaption

Defines the caption of the time column.

The attribute can be assigned dynamic properties by means of the name **TimeColumnCaption**. The data type is STRING.

## TimeColumnCount property

### TimeColumnCount

Defines the number of time columns configured.

The attribute can be assigned dynamic properties by means of the name **TimeColumnCount**. The data type is LONG.

## TimeColumnDateFormat property

### Date format - TimeColumnDateFormat

Defines the date format for visualizing a selected time column.

The following date formats are available:

Value	Explanation
Automatic	The date format is set automatically.
dd.MM.yy	Day.Month.Year, e.g. 24.12.07.
dd.MM.yyyy	Day.Month.Year, e.g. 24.12.2007.
dd/MM/yy	Day/Month/Year, e.g. 24/12/07.
dd/MM/yyyy	Day/Month/Year, e.g. 24/12/2007.

The attribute can be assigned dynamic properties by means of the name **TimeColumnDateFormat**. The data type is STRING.

**TimeColumnEndTime property****End time - TimeColumnEndTime**

Defines the end of the time range of a selected time column.

The attribute can be assigned dynamic properties by means of the name **TimeColumnEndTime**. The data type is Date.

Use the "yyyy-mm-dd hh:mm:ss" format when setting a dynamic time range.

**TimeColumnForeColor property****Font color - TimeColumnForeColor**

Specifies the font color of the time column selected. Use the button to open the "Color selection" dialog.

The setting is useful if:

- The "Use value column colors" option is not activated or "TimeColumnUseValueColumnColors" is "FALSE".
- The "Font color" option is activated or "UseColumnForeColor" is "TRUE" in the "Use column color" field of the "General" tab.

The attribute can be assigned dynamic properties by means of the name **TimeColumnForeColor**. The data type is LONG.

**TimeColumnHideText property****TimeColumnHideText**

Sets text format for displaying the content of a time column.

Value	Explanation
TRUE	The content is not displayed in text format.
FALSE	The content is displayed in text format.

The attribute can be assigned dynamic properties by means of the name **TimeColumnHideText**. The data type is BOOLEAN.

### TimeColumnHideTitleText property

#### TimeColumnHideTitleText

Sets text format for displaying the time column header.

Value	Explanation
TRUE	The header is not displayed in text format.
FALSE	The header is displayed in text format.

The attribute can be assigned dynamic properties by means of the name **TimeColumnHideTitleText**. The data type is BOOLEAN.

### TimeColumnIndex property

#### TimeColumnIndex

References a configured time column. Using this attribute you can assign the values of other attributes to a specific time column.

Values between 0 and "TimeColumnCount" minus 1 are valid for "TimeColumnIndex". Attribute "TimeColumnCount" defines the number of time columns configured.

The "TimeColumnIndex" attribute can be assigned dynamic properties by means of attribute **TimeColumnRepos**. The data type is LONG.

### TimeColumnLength property

#### Length in characters - TimeColumnLength

Specifies the width of a selected time column.

The attribute can be assigned dynamic properties by means of the name **TimeColumnLength**. The data type is LONG.

### TimeColumnMeasurePoints property

#### Number of measurement points - TimeColumnMeasurePoints

Defines the number of measurement points to be displayed in the time column selected.

The attribute can be assigned dynamic properties by means of the name **TimeColumnMeasurePoints**. The data type is LONG.

**TimeColumnName property****Object name - TimeColumnName**

Specifies the name of a selected time column.

The "TimeColumnName" attribute can be assigned dynamic properties by means of attribute **TimeColumnRename**. The data type is STRING.

**TimeColumnRangeType property****Time range setting - TimeColumnRangeType**

Defines the time range setting for the time column selected.

Value	Description	Explanation
0	Time range	Defines the start time and time range of the time column.
1	Start to end time	Defines the start and end time for the time column.
2	Number of measurement points	Defines the start time and the number of measurement points for the time column.

The attribute can be assigned dynamic properties by means of the name **TimeColumnRangeType**. The data type is LONG.

**TimeColumnRemove property****Remove - TimeColumnRemove**

Removes the selected time column from the list.

The attribute can be assigned dynamic properties by means of the name **TimeColumnRemove**. The data type is STRING.

**TimeColumnRename property****TimeColumnRename**

Renames a time column which is referenced by means of "TimeColumnIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **TimeColumnRename**. "TimeColumnRename" also sets a dynamic attribute "TimeColumnName". The data type is STRING.

**TimeColumnRepos property****Up/Down - TimeColumnRepos**

Repositions the order of time columns and of corresponding value columns. "Up" and "Down" move the time column selected up or down in the list. This moves the time column and corresponding value columns in the table towards the front or towards the back.

The attribute can be assigned dynamic properties by means of the name **TimeColumnRepos**. The data type is LONG.

**TimeColumnShowDate property****Show date - TimeColumnShowDate**

Enables the display of the date and time in the time column selected.

Value	Explanation
TRUE	Date and time are displayed. The date format is defined in the "Date format" field or by using "TimeColumnDateFormat".
FALSE	The date is not displayed. Only the time is displayed.

The attribute can be assigned dynamic properties by means of the name **TimeColumnShowDate**. The data type is BOOLEAN.

**TimeColumnShowIcon property****TimeColumnShowIcon**

Enables the display of time column contents as icon. This function is only available in WinCC Alarm Control.

Value	Explanation
TRUE	The content is visualized as icon.
FALSE	The content is not visualized as icon.

The attribute can be assigned dynamic properties by means of the name **TimeColumnShowIcon**. The data type is BOOLEAN.

**TimeColumnShowTitleIcon property****TimeColumnShowTitleIcon**

Enables display of the time column header as icon. This function is only available in WinCC Alarm Control.

Value	Explanation
TRUE	The header is displayed as icon.
FALSE	The header is not displayed as icon.



The attribute can be assigned dynamic properties by means of the name **TimeColumnShowTitleIcon**. The data type is BOOLEAN.

### TimeColumnSort property

#### TimeColumnSort

Defines the sorting order of the time column referenced in "TimeColumnIndex" .

The following settings are available:

Value	Description	Explanation
0	No	No sorting
1	Ascending	Ascending order, starting at the lowest value.
2	Descending	Descending order, starting at the highest value.

The attribute can be assigned dynamic properties by means of the name **TimeColumnSort** . The data type is LONG.

### TimeColumnSortIndex property

#### TimeColumnSortIndex

Defines the sorting order of the time column referenced in "TimeColumnIndex". The sorting criterion is removed from "TimeColumnSort" if you set a "0" value..

The attribute can be assigned dynamic properties by means of the name **TimeColumnSortIndex**. The data type is LONG.

### TimeColumnTimeFormat property

#### Time format - TimeColumnTimeFormat

Defines the time format for visualizing a selected time column.

The following time formats are available:

Value	Explanation
Automatic	The time format is set automatically.
HH:mm:ss.ms	Hours:Minutes:Seconds, e.g. 15:35:44.240.
hh:mm:ss tt	Hours:Minutes:Seconds AM/PM, e.g. 03:35:44 PM.
hh:mm:ss.ms tt	Hours:Minutes:Seconds.Milliseconds AM/PM, e.g. 03:35:44.240 PM.

The attribute can be assigned dynamic properties by means of the name **TimeColumnTimeFormat**. The data type is STRING.

## TimeColumnTimeRangeBase property

### Time range - TimeColumnTimeRangeBase

Defines the time unit for calculating the time range.

The following time units are available:

Value	Description
500	500 ms
1000	1 second
60000	1 minute
3600000	1 hour
86400000	1 day

The attribute can be assigned dynamic properties by means of the name **TimeColumnTimeRangeBase**. The data type is LONG.

## TimeColumnTimeRangeFactor property

### Time range - TimeColumnTimeRangeFactor

Defines the factor for calculating the time range. Only integer factors are valid.

The attribute can be assigned dynamic properties by means of the name **TimeColumnTimeRangeFactor**. The data type is SHORT.

## TimeColumnUseValueColumnColors property

### Use value column colors - TimeColumnUseValueColumnColors

Defines whether the selected time column will be displayed in the value column colors.

Value	Explanation
TRUE	The colors of the value column are used to display a selected time column. The settings in the "Font color" and "Background color" fields are disabled.
FALSE	The colors defined in the "Font color" and "Background color" fields are used to display the selected time column.

The attribute can be assigned dynamic properties by means of the name **TimeColumnUseValueColumnColors**. The data type is BOOLEAN.

## TimeColumnVisible property

### Time columns - TimeColumnVisible

The list shows the time columns you created. Click a time column entry in the list to adapt the properties and to define the time range of the time column.

Select the time columns to be displayed in the table from the list.

Defines whether the selected time column is displayed.

The attribute can be assigned dynamic properties by means of the name **TimeColumnVisible**.  
The data type is BOOLEAN.

## TimeFormat - Tolerance

### TimeFormat Property

#### Description

Defines the format of the time specification.

- 0: The information is provided in hh:mm
- -1: The information is provided in hh:mm:ss
- -2: The information is provided in hh:mm:ss.ms
- -3: The information is provided in hh:mm (full hours)
- -4: The information is provided in hh:mm:ss (full minutes)
- -5: The information is provided in hh:mm:ss.ms (full seconds)

#### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

### TimeJump Property

#### Description

##### WinCC Online Trend Control

The "Index" property references a trend. "TimeJump" defines whether the time jumps in the archive should be identified by the color defined in "TimeJumpColor".

##### WinCC Online Trend Control

The value of this attribute cannot be changed. Read only access.

#### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

## TimeJumpColor Property

### Description

#### WinCC Online Trend Control

The "Index" property references a trend. "TimeJumpColor" defines the color identifying the time jumps in the archive. Whether the information is evaluated is dependent on the value of the "TimeJump" property. The color is defined as an RGB value. LONG write-read access.

#### WinCC Online Trend Control

The value of this property cannot be changed. Read only access.

### See also

ScreenItem Object (Page 125)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

## TimeOverlap Property

### Description

#### WinCC Online Trend Control

The "Index" property references a trend. "TimeOverlap" defines whether the time overlaps in the archive should be identified by the color defined in "TimeOverlapColor".

#### WinCC Online Trend Control

The value of this property cannot be changed. Read only access.

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

## TimeOverlapColor Property

### Description

#### WinCC Online Trend Control

The "Index" property references a trend. "TimeOverlapColor" defines the color identifying the time overlaps in the archive. Whether the information is evaluated depends on the value of the "TimeOverlap" attribute. The color is defined as an RGB value.

### WinCC Online Trend Control

The value of this property cannot be changed. Read only access.

#### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

ScreenItem Object (Page 125)

### TimeRange Property

#### Description

The "Index" property references a column pair or a trend. "TimeRange" defines how the time range to be displayed should be defined.

- 0: The time range to be displayed is defined by a start time ("BeginTime") and end time ("EndTime").
- -1: The time range to be displayed is defined by a start time ("BeginTime") and a time range ("TimeRangeBase" and "TimeRangeFactor").

#### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

### TimeRangeBase Property

#### Description

The "Index" property references a column pair or a trend. The time range to be displayed for this column pair/trend results from multiplying the values "TimeRangeBase" and "TimeRangeFactor", whereby the value "TimeRangeBase" is interpreted in milliseconds.

The "TimeRangeBase" and "TimeRangeFactor" properties are only evaluated when the "TimeRange" property is set, i.e. has the value "-1".

#### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

## TimeRangeFactor Property

### Description

The "Index" property references a column pair or a trend. The time range to be displayed for this column pair/trend results from multiplying the values "TimeRangeBase" and "TimeRangeFactor", whereby the value "TimeRangeBase" is interpreted in milliseconds.

The "TimeRangeBase" and "TimeRangeFactor" properties are only evaluated when the "TimeRange" property is set, i.e. has the value "-1".

### See also

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

## TimeStamp Property

### Description

Reads the time stamp of the last read access of a tag. The time stamp is returned in local time.  
DATE (read only)

The VBS standard function "FormatDateTime(Date[, NamedFormat])" enables the time stamp property to be output in plain text. The output is dependent on the current language setting. The language setting can be set using the VBS standard function SetLocale().

By implementing the second parameter of the FormatDate() function and further VBS standard functions such as Year, WeekDay, Day, Hour, Minute, Second enable the information, required by the user, to be split. Use the WeekdayName function to receive the name of the weekday for WeekDay.

**Example:**

```
'VBS87
Dim objTag
Dim lngCount
lngCount = 0
Set objTag = HMIRuntime.Tags("Tag11")
objTag.Read
SetLocale("en-gb")
MsgBox FormatDateTime(objTag.TimeStamp) 'Output: e.g. 06/08/2002 9:07:50
MsgBox Year(objTag.TimeStamp) 'Output: e.g. 2002
MsgBox Month(objTag.TimeStamp) 'Output: e.g. 8
MsgBox Weekday(objTag.TimeStamp) 'Output: e.g. 3
MsgBox WeekdayName(Weekday(objTag.TimeStamp)) 'Output: e.g. Tuesday
MsgBox Day(objTag.TimeStamp) 'Output: e.g. 6
MsgBox Hour(objTag.TimeStamp) 'Output: e.g. 9
MsgBox Minute(objTag.TimeStamp) 'Output: e.g. 7
MsgBox Second(objTag.TimeStamp) 'Output: e.g. 50
For lngCount = 0 To 4
MsgBox FormatDateTime(objTag.TimeStamp, lngCount)
Next
'lngCount = 0: Output: e.g. 06/08/2002 9:07:50
'lngCount = 1: Output: e.g. 06 August 2002
'lngCount = 2: Output: e.g. 06/08/2002
'lngCount = 3: Output: e.g. 9:07:50
'lngCount = 4: Output: e.g. 9:07
```

**Example:**

The following example issues the time stamp of the tag "Tag1":

```
'VBS88
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Read
MsgBox objTag.TimeStamp
```

**See also**

[Tag Object \(Page 137\)](#)  
[Alarms object \(list\) \(Page 110\)](#)

## TimeStepBase property

### Precision - TimeStepBase

Defines the precision of the time stamp displayed in a table.

Calculate the precision by multiplying the factor with the time unit. Enter factor "3" and time unit "1s" to display all values which were generated within 3 seconds in the same row, for example.

Value	Description	Explanation
0	Exact	Only values with precisely the same time stamp are displayed in a table row.
100	100 ms	All values generated within 100 milliseconds are grouped in a table row.
250	250 ms	All values generated within 250 milliseconds are grouped in a table row.
500	500 ms	All values generated within 500 milliseconds are grouped in a table row.
1000	1 s	All values generated within 1 second are grouped in a table row.

The attribute can be assigned dynamic properties by means of the name **TimeStepBase**. The data type is LONG.

## TimeStepFactor property

### Precision - TimeStepFactor

Defines the precision of the time stamp displayed in a table.

Calculate the precision by multiplying the factor with the time unit. Enter factor "3" and time unit "1s" to display all values which were generated within 3 seconds in the same row.

The factor entered is disabled if "Exact" is selected for the time unit or "0" is selected for "TimeStepBase".

The attribute can be assigned dynamic properties by means of the name **TimeStepFactor**. The data type is LONG.

## TimeZone Property

### Description

Defines the time zone used as a basis for displaying time values. Four settings are possible:

- Local time zone
- Server's time zone
- UTC (Universal Time Coordinated)
- Apply project settings (=> Use WinCC Explorer and access the computer's properties page to define the time mode specifically for the computer. The following are available for selection: WinCC V50 (Compatibility mode => Display as was standard in the individual display sections to V5 ), local time and UTC.



**See also**

WinCC Online Trend Control (before WinCC V7) (Page 295)  
 WinCC Online Table Control (before WinCC V7) (Page 292)  
 WinCC Function Trend Control (before WinCC V7) (Page 288)  
 ScreenItem Object (Page 125)

**TitleColor property****Table header background - TitleColor**

Specifies the background color of the table headers. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **TitleColor**. The data type is LONG.

**TitleCut property****Shorten contents - TitleCut**

Truncates the content of column headers if the column is insufficient.

Value	Explanation
TRUE	The column headers are truncated.
FALSE	The column headers are not truncated.

The attribute can be assigned dynamic properties by means of the name **TitleCut**. The data type is BOOLEAN.

**TitleCut property (before WinCC V7)****Description**

Defines whether the content of the fields of a title bar should be shortened if the column width is too small. Write/Read access.

**See also**

WinCC Alarm Control (before WinCC V7) (Page 286)  
 ScreenItem Object (Page 125)

### **TitleDarkShadowColor property**

#### **Dark shading color - TitleDarkShadowColor**

Specifies the color of the dark side of shading. The button opens the "Color selection" dialog.

The setting is only active if the "Shading Color" option or "TitleStyle" is activated.

The attribute can be assigned dynamic properties by means of the name **TitleDarkShadowColor**. The data type is LONG.

### **TitleForeColor property**

#### **Table header font color - TitleForeColor**

Specifies the color of the table header. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **TitleForeColor**. The data type is LONG.

### **TitleGridLineColor property**

#### **Color of the divider / header - TitleGridLineColor**

Defines the color of row/column dividers in the table header. The button opens the "Color selection" dialog.

The attribute can be assigned dynamic properties by means of the name **TitleGridLineColor**. The data type is LONG.

### **TitleLightShadowColor property**

#### **Bright shading color - TitleLightShadowColor**

Specifies the color of the bright side of shading. The button opens the "Color selection" dialog.

The setting is only active if the "Shading Color" option or "TitleStyle" is activated.

The attribute can be assigned dynamic properties by means of the name **TitleLightShadowColor**. The data type is LONG.

### **Titleline Property**

#### **Description**

TRUE, when the control has a title bar and it can be moved in Runtime. BOOLEAN write-read access.

**See also**

WinCC Online Table Control (before WinCC V7) (Page 292)  
 WinCC Online Trend Control (before WinCC V7) (Page 295)  
 WinCC Function Trend Control (before WinCC V7) (Page 288)  
 WinCC Alarm Control (before WinCC V7) (Page 286)  
 ScreenItem Object (Page 125)

**TitleSort property****Sort by column title- TitleSort**

Defines how to trigger sorting by column title. You can only sort by column title if the "Auto-scrolling" option is deactivated.

Value	Description	Explanation
0	No	Sorting by column title is not possible.
1	With click	Sorting is triggered by clicking in the column header.
2	With double-click	Sorting is triggered by double-clicking in the column title.

The attribute can be assigned dynamic properties by means of the name **TitleSort**. The data type is LONG.

**TitleStyle property****Shading color - TitleStyle**

Specifies whether to set a shading color for the table header.

Value	Description	Explanation
0	Flat	Disables the use of shading colors. Flat header style.
1	Button	Enables the use of shading colors. 3D representation of the header.

The attribute can be assigned dynamic properties by means of the name **TitleStyle**. The data type is LONG.

**Toggle Property****Description**

TRUE, when the button or round button should lock after being operated in Runtime.  
 BOOLEAN write-read access.

## See also

Round Button (Page 209)

ScreenItem Object (Page 125)

## ToleranceHigh Property

### Description

Defines or returns the limit value for "Tolerance high".

The type of the evaluation (in percent or absolute) is defined in the "TypeToleranceHigh" property.

The monitoring of the limit value is only valid if the "CheckToleranceHigh" property is set to "TRUE".

## See also

Bar (Page 174)

ScreenItem Object (Page 125)

## ToleranceLow Property

### Description

Defines or returns the limit value for "Tolerance low".

The type of the evaluation (in percent or absolute) is defined in the "TypeToleranceLow" property.

The monitoring of the limit value is only valid if the "CheckToleranceLow" property is set to "TRUE".

## See also

Bar (Page 174)

ScreenItem Object (Page 125)

## Toolbar

### Toolbar Property

### Description

TRUE, when a toolbar is to be displayed. BOOLEAN write-read access.

**See also**

WinCC Online Table Control (before WinCC V7) (Page 292)  
 WinCC Online Trend Control (before WinCC V7) (Page 295)  
 WinCC Function Trend Control (before WinCC V7) (Page 288)  
 WinCC Alarm Control (before WinCC V7) (Page 286)  
 ScreenItem Object (Page 125)

**ToolbarAlignment property (before WinCC V7)****Description**

Defines or returns the position of the toolbar. Write/Read access.

**See also**

WinCC Online Table Control (before WinCC V7) (Page 292)  
 WinCC Online Trend Control (before WinCC V7) (Page 295)  
 WinCC Function Trend Control (before WinCC V7) (Page 288)  
 ScreenItem Object (Page 125)

**ToolbarAlignment Property****Alignment - ToolbarAlignment**

Defines the orientation of the Control toolbar.

The following settings are available:

Value	Description	Explanation
0	Top	The toolbar is aligned to the top edge.
1	Bottom	The toolbar is aligned to the bottom edge.
2	Left	The toolbar is aligned to the left edge.
3	Right	The toolbar is aligned to the right edge.

The attribute can be assigned dynamic properties by means of the name **ToolbarAlignment**.  
 The data type is LONG.

**ToolbarBackColor property****Background color - ToolbarBackColor**

Specifies the background color of the toolbar. Open the "Color selection" dialog by clicking the button.

The background color you configured is only displayed if the "Display" option is activated or "ToolbarUseBackColor" is "TRUE".

The attribute can be assigned dynamic properties by means of the name **ToolbarBackColor**. The data type is LONG.

### ToolbarButtonActive property

#### Active - ToolbarButtonActive

Activates a button function in Runtime. Clicking the button in Runtime triggers the corresponding function.

Value	Explanation
TRUE	The button function is enabled.
FALSE	The button function is disabled. You can assign custom functions to the button by means of scripting.

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonActive**. The data type is BOOLEAN.

### ToolbarButtonAdd property

#### New - ToolbarButtonAdd

Creates a new, user-defined button function. The name set by WinCC can be edited in the "Object name" field.

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonAdd**. The data type is STRING.

### ToolbarButtonBeginGroup property

#### Separator - ToolbarButtonBeginGroup

Inserts a leading separator (vertical line) for the selected button function on the toolbar. These separators can be used to group the icons of the button functions.

Value	Explanation
TRUE	A separator prefix is inserted for the button function selected.
FALSE	A separator prefix is not inserted for the button function selected.

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonBeginGroup**. The data type is BOOLEAN.

**ToolBarButtonClick AlarmControl property****ToolBarButtonClick**

Triggers the function linked to the toolbar button. Programmers can use the "ID" to call the corresponding button function.

ID	Button function	ID	Button function
1	"Help"	21	"Next message"
2	"Configuration dialog"	22	"Last message"
3	"Message list".	23	"Info text dialog"
4	"Short-term archive list".	24	"Comments dialog"
5	"Long-term archive list"	25	"Loop In Alarm"
6	"Lock List".	26	"Lock message"
7	"Hit List"	27	"Enable message"
8	"List of messages to be hidden"	28	"Hide messages"
9	"Ackn. Central Signaling Devices"	29	"Unhide messages"
10	"Single acknowledgment"	30	"Sort dialog"
11	"Group acknowledgement"	31	"Time base dialog"
18	"Emergency acknowledgement"	32	"Copy rows"
13	"Selection dialog"	33	"Connect backup"
14	"Display options dialog"	34	"Disconnect backup"
15	"Lock dialog"	36	"First page"
17	"Print"	37	"Previous page"
35	"Export data"	38	"Next page"
12	"Autoscroll"	39	"Last page"
19	"First message"	1001	"User-defined 1"
20	"Previous message"		

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonClick**. The data type is LONG.

**ToolBarButtonClick FunctionTrendControl property****ToolBarButtonClick**

Triggers the function linked to the toolbar button. Programmers can use the "ID" to call the corresponding button function.

ID	Button function	ID	Button function
1	"Help"	13	"Select time range"
2	"Configuration dialog"	14	"Previous trend"
4	"Zoom area"	15	"Next trend"
5	"Zoom +/-"	16	"Stop"
6	"Zoom X axis +/-"	16	"Start"

7	"Zoom Y axis +/-"	17	"Print"
8	"Shift trend range"	20	"Export data"
9	"Shift axes range"	3	"Ruler"
10	"Original view"	18	"Connect backup"
11	"Select data connection"	19	"Disconnect backup"
12	"Select trends"	1001	"User-defined 1"

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonClick**. The data type is LONG.

### ToolbarButtonClick OnlineTableControl property

#### ToolbarButtonClick

Triggers the function linked to the toolbar button. Programmers can use the "ID" to call the corresponding button function.

ID	Button function	ID	Button function
1	"Help"	13	"Next column"
2	"Configuration dialog"	14	"Stop"
3	"First data record"	14	"Start"
4	"Previous data record"	15	"Print"
5	"Next data record"	20	"Export data"
6	"Last data record"	16	"Define statistics area"
7	"Edit"	17	"Calculate statistics"
8	"Copy rows"	18	"Connect backup"
9	"Select data connection"	19	"Disconnect backup"
10	"Select columns"	21	"Create archive value"
11	"Select time range"	1001	"User-defined 1"
12	"Previous column"		

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonClick**. The data type is LONG.

### ToolbarButtonClick OnlineTrendControl property

#### ToolbarButtonClick

Triggers the function linked to the toolbar button. Programmers can use the "ID" to call the corresponding button function.

ID	Button function	ID	Button function
1	"Help"	17	"Select time range"
2	"Configuration dialog"	18	"Previous trend"
3	"First data record"	19	"Next trend"
4	"Previous data record"	20	"Stop"



5	"Next data record"	20	"Start"
6	"Last data record"	21	"Print"
8	"Zoom area"	26	"Export data"
9	"Zoom +/-"	7	"Ruler"
10	"Zoom time axis +/-"	22	"Define statistics area"
11	"Zoom value axis +/-"	23	"Calculate statistics"
12	"Shift trend range"	24	"Connect backup"
13	"Shift axes range"	25	"Disconnect backup"
14	"Original view"	27	"Relative axis"
15	"Select data connection"	1001	"User-defined 1"
16	"Select trends"		

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonClick**. The data type is LONG.

### ToolBarButtonClick RulerControl property

#### ToolBarButtonClick

Triggers the function linked to the toolbar button. Programmers can use the "ID" to call the corresponding button function.

ID	Button function
1	"Help"
2	"Configuration dialog"
3	"Ruler window"
4	"Statistics range"
5	"Statistics"
6	"Print"
7	"Export data"
1001	"User-defined 1"

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonClick**. The data type is LONG.

### ToolBarButtonClick SysdiagControl property

#### ToolBarButtonClick

Triggers the function linked to the toolbar button. Programmers can use the "ID" to call the corresponding button function.

ID	Button function
1	"Configuration dialog"
2	"Overview"
3	"Back"

4	"Open"
5	"Diagnostics buffer"
6	"Update diagnostic buffer"
7	"Sort dialog"
8	"Print"
9	"Export data"

The attribute can be assigned dynamic properties using the name **ToolBarButtonClick**. The data type is LONG.

### ToolBarButtonClick UserAdminControl property

#### ToolBarButtonClick

Triggers the function linked to the toolbar button. Programmers can use the "ID" to call the corresponding button function.

ID	Button function	ID	Button function
1	"Help"	9	"Log on"
2	"Configuration dialog"	10	"Log off"
3	"Group list"	11	"Change password"
4	"User list"	12	"Import user administration"
5	"Edit"	13	"Export user administration"
6	"Add"	14	"Sort dialog"
7	"Authorization levels"	15	"Print"
8	"Delete"	16	"Export data"

The attribute can be assigned dynamic properties using the name **ToolBarButtonClick**. The data type is LONG.

### ToolBarButtonClick UserArchiveControl property

#### ToolBarButtonClick

Triggers the function linked to the toolbar button. Programmers can use the "ID" to call the corresponding button function.

ID	Button function	ID	Button function
1	"Help"	12	"Read tags"
2	"Configuration dialog"	13	"Write tags"
3	"Select data connection"	14	"Import archive"
4	"First row"	15	"Export archive"
5	"Previous row"	16	"Sort dialog"
6	"Next row"	17	"Selection dialog"
7	"Last row"	18	"Print"
8	"Delete rows"	20	"Export data"

9	"Cut rows"	19	"Time base dialog"
10	"Copy rows"	1001	"User-defined 1"
11	"Insert rows"		

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonClick**. The data type is LONG.

### ToolBarButtonCount property

#### ToolBarButtonCount

Defines the number of configurable button functions.

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonCount**. The data type is LONG.

### ToolBarButtonEnabled property

#### ToolBarButtonEnabled

Enables operation of custom toolbar buttons.

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonEnabled**. The data type is BOOLEAN.

### ToolBarButtonHotKey property

#### Hotkey - ToolBarButtonHotKey

Shows the hotkey for a button function selected.

You create or edit a hotkey by clicking in the "Hotkey" field and pressing the button or key shortcut required.

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonHotKey**. The data type is LONG.

### ToolBarButtonID property

#### Object ID - ToolBarButtonID

Unique ID number for the selected button function. WinCC assigns this read only ID number.

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonID**. The data type is LONG.

## ToolBarButtonIndex property

### ToolBarButtonIndex

References a button function. Using this attribute you can assign the values of other attributes to a specific button function.

Values between 0 and "ToolBarButtonIndex" minus 1 are valid for "ToolBarButtonCount". Attribute "ToolBarButtonCount" defines the number of configurable button functions.

The "ToolBarButtonIndex" attribute can be assigned dynamic properties by means of attribute **ToolBarButtonRepos**. The data type is LONG.

## ToolBarButtonLocked property

### ToolBarButtonLocked

Enables/disables the display of the pressed state of a user-defined toolbar button.

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonLocked**. The data type is BOOLEAN.

## ToolBarButtonName property

### Object name - ToolBarButtonName

Shows the name for the selected button function. You rename user-defined button functions.

The "ToolBarButtonName" attribute can be assigned dynamic properties by means of attribute **ToolBarButtonRename**. The data type is STRING.

## ToolBarButtonPasswordLevel property

### Operator authorization - ToolBarButtonPasswordLevel

Shows the authorization for a button function selected. You can edit the authorization using the selection button.

Authorizations are configured in the "User Administrator" editor.

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonPasswordLevel**. The data type is LONG.

## ToolBarButtonRemove property

### Remove - ToolBarButtonRemove

Removes the selected button function from the list. Only user-defined button functions can be removed.

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonRemove**. The data type is STRING.

## ToolBarButtonRename property

### ToolBarButtonRename

Renames a custom toolbar element which is referenced by means of "ToolBarButtonIndex" attribute.

The attribute for custom elements can be assigned dynamic properties by means of the name **ToolBarButtonRename**. "ToolBarButtonRename" also sets a dynamic attribute "ToolBarButtonName". The data type is STRING.

## ToolBarButtonRepos property

### Up/Down - ToolBarButtonRepos

Changes the sorting order of button functions. "Up" and "Down" move the button function selected up or down in the list. This moves the button function in the toolbar of a Control towards the front or towards the back.

The attribute can be assigned dynamic properties by means of the name **ToolBarButtonRepos**. The data type is LONG.

## ToolBarButtonSize property

### Button size in pixels - ToolBarButtonSize

Defines the size of the buttons in the toolbar.

With the maximum value of 280 pixels, the button size can be ten times larger than the original size of 28 pixels.

The following behavior results for the button size depending on the configured value:

Value of the button size	Behavior
Value < 0	Invalid value. The most recent valid value is used.
$0 \leq \text{value} \leq \text{original size of button}$	The original size of the button is used. "ToolBarButtonSize" is set to the default (= 0).
$\text{Original size of the button} < \text{value} \leq \text{maximum value}$	The configured value is used.
Maximum value < value	Invalid value. The most recent valid value is used.

With a large button size, please note that in some cases not all buttons may be displayed in the control. To show all activated buttons in Runtime, you must therefore extend the control or activate fewer buttons as required.

You can create a dedicated button to zoom in or out of the toolbar in Runtime. For instructions, refer to the example "How to configure a user-defined toolbar button with a self-created selection dialog" in the documentation "VBS for Creating Procedures and Actions".

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonSize** .  
The data type is LONG.

### ToolbarButtonTooltipText property

#### ToolbarButtonTooltipText

Specifies the tooltip text for the button.

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonTooltipText**. The data type is STRING.

### ToolbarButtonUserDefined property

#### ToolbarButtonUserDefined

Indicates whether the project engineer has added a new user-defined toolbar button.

Value	Explanation
TRUE	The toolbar button is assigned a user-defined function.
FALSE	The toolbar button is defined by the system.

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonUserDefined**. The data type is BOOLEAN.

### ToolbarButtonVisible property

#### Button functions - ToolbarButtonVisible

Select the button functions to be displayed in the toolbar from the list.

Click a list entry to adapt the properties, or to change the position in the status bar of the Control by means of the "Up" and "Down" buttons.

The attribute can be assigned dynamic properties by means of the name **ToolbarButtonVisible** . The data type is BOOLEAN.

### ToolbarButtons Property

#### Description

Defines or returns the buttons contained in the toolbar by setting or resetting the corresponding bits. Each button is assigned a bit. There are no limitations as to the bit combinations.

Bit - Value (hex) ; Value (dec) ; Button:

- 0 - 0x00000001; 1; Message List
- 1 - 0x00000002; 2; Short-term archive list

- 2 - 0x00000004; 4; Long-term archive list
- 3 - 0x00000008; 8; Acknowledgment of central signaling device
- 4 - 0x00000010; 16; Single Acknowledgment
- 5 - 0x00000020; 32; Group acknowledgment
- 6 - 0x00000040; 64; Autoscroll
- 7 - 0x00000080; 128; Selection Dialog
- 8 - 0x00000100; 256; Lock Dialog
- 9 - 0x00000200; 512; Print message log
- 11 - 0x00000800; 2048; Emergency acknowledgment
- 12 - 0x00001000; 4096; First message
- 13 - 0x00002000; 8192; Last message
- 14 - 0x00004000; 16384; Next message
- 15 - 0x00008000; 32768; Previous message
- 16 - 0x00010000; 65536; Infotext Dialog
- 17 - 0x00020000; 131072; Comment Dialog
- 18 - 0x00040000; 262144; Loop in Alarm
- 20 - 0x00100000; 1048576; Print current view
- 21 - 0x00200000; 2097152; Lock list
- 22 - 0x00400000; 4194304; Lock/release message
- 23 - 0x00800000; 8388608; Sorting Dialog
- 24 - 0x01000000; 16777216; Time basis dialog
- 25 - 0x02000000; 33554432; Hit list

In order to display more buttons, their values must be logically linked with OR. Write/Read access.

## See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

WinCC Alarm Control (before WinCC V7) (Page 286)

ScreenItem Object (Page 125)

## ToolbarHotKeys Property

### Description

Defines or returns hotkeys of the buttons in the toolbar. Write/Read access.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## ToolbarShowTooltips property

### Tooltips - ToolbarShowTooltips

Enables the display of tooltips for the button functions in Runtime.

Value	Explanation
TRUE	Enables the display of tooltips.
FALSE	Disables the display of tooltips.

The attribute can be assigned dynamic properties by means of the name **ToolbarShowTooltips**. The data type is BOOLEAN.

Attribute "ToolbarButtonTooltipText" defines the tooltip text.

## ToolbarUseBackColor property

### Show background color - ToolbarUseBackColor

Enables the display of the background color for a toolbar.

Value	Explanation
TRUE	Enables the display of the background color of a toolbar.
FALSE	Disables the display of the background color of a toolbar.

The attribute can be assigned dynamic properties by means of the name **ToolbarUseBackColor**. The data type is BOOLEAN.



## ToolbarUseHotKeys property

### Hotkeys - ToolbarUseHotKeys

Activates the hotkeys for button functions in Runtime. Insert the hotkeys for button functions in the "Hotkey" field.

Value	Explanation
TRUE	The hotkeys are activated.
FALSE	The hotkeys are deactivated.

The attribute can be assigned dynamic properties by means of the name **ToolbarUseHotKeys**. The data type is BOOLEAN.

## ToolbarVisible property

### Show toolbar - ToolbarVisible

Enables the display of the Control toolbar.

Value	Explanation
TRUE	Enables the display of the toolbar.
FALSE	Disables the display of the toolbar.

The attribute can be assigned dynamic properties by means of the name **ToolbarVisible** . The data type is BOOLEAN.

## ToolTip - TrendLower

### ToolTipText Property

#### Description

Defines or returns the text to be displayed as a tooltip when the mouse is positioned over the object.

STRING (write-read access)

**Example:**

The following example assigns a tool tip text to every object in the picture "NewPDL1": The picture "NewPDL1" comprises only objects containing the ToolTipText property:

```
'VBS89
Dim objScreen
Dim objScrItem
Dim lngIndex
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
strName = objScreen.ScreenItems(lngIndex).ObjectName
Set objScrItem = objScreen.ScreenItems(strName)
'
'Assign tooltip texts to the objects
objScrItem.ToolTipText = "Name of object is " & strName
Next
```

**See also**

- Radio box (Page 207)
- Status display (Page 199)
- Connector (Page 167)
- Text list (Page 196)
- Static text (Page 165)
- Slider (Page 212)
- Group Display (Page 194)
- Rounded rectangle (Page 162)
- Round Button (Page 209)
- Rectangle (Page 159)
- Polyline (Page 158)
- Polygon (Page 156)
- OLE object (Page 191)
- Line (Page 154)
- Pie segment (Page 152)
- Circular arc (Page 151)
- Circle (Page 149)
- Group (Page 300)
- Graphic Object (Page 187)

Ellipse segment (Page 147)  
Ellipse arc (Page 146)  
Ellipse (Page 144)  
I/O Field (Page 184)  
Check box (Page 204)  
Button (Page 201)  
Bar (Page 174)  
Customized Object (Page 298)  
3D Bar (Page 169)

## Top Property

## Function

Defines or returns the Y-coordinate of an object (measured from the top left edge of the picture) in pixels. The Y-coordinate relates to the top left corner of the rectangle enclosing the object.

LONG (write-read access)

## Example:

The following example shifts all objects in the picture "NewPDL1" 5 pixels upwards:

```
'VBS90
Dim objScreen
Dim objScrItem
Dim lngIndex
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
strName = objScreen.ScreenItems(lngIndex).ObjectName
Set objScrItem = objScreen.ScreenItems(strName)
objScrItem.Top = objScrItem.Top - 5
Next
```

## See also

Left Property (Page 476)  
ScreenItem Object (Page 125)

## TopConnectedConnectionPointIndex Property

### Description

Specifies or sets the index number of the top connecting point.  
LONG write-read access.

### See also

Connector (Page 167)  
ScreenItem Object (Page 125)

## TopConnectedObjectName Property

### Description

Specifies or sets the object name of the object which is docked on at the bottom connecting point.  
LONG write-read access.

### See also

Connector (Page 167)  
ScreenItem Object (Page 125)

## Transparency property

### Description

Defines and returns the percentage transparency of the object.  
0 = no transparency; 100 = complete transparency (invisible)  
The text and fields of the graphic objects are only transparent at "100."  
In runtime, a completely transparent object (invisible) is also functional.

## Transparent Property

### Description

TRUE, when the button appears completely filled in the color specified in "BackColor".  
BOOLEAN write-read access.

**See also**

WinCC Push Button Control (Page 269)

ScreenItem Object (Page 125)

**Trend Property****Description**

TRUE, when the tendency (rising or falling) of the measuring value being monitored should be displayed by a small arrow. BOOLEAN write-read access.

**See also**

Bar (Page 174)

ScreenItem Object (Page 125)

**TrendActualize property****Update -TrendActualize**

Enables the update of a selected trend.

Value	Explanation
TRUE	Enables updates of the trend selected.
FALSE	Disables updates of the trend selected. This setting can be useful when comparing a logged trend with a current trend.

The attribute can be assigned dynamic properties by means of the name **TrendActualize**. The data type is BOOLEAN.

**TrendAdd property****New - TrendAdd**

Creates a new trend.

The attribute can be assigned dynamic properties by means of the name **TrendAdd**. The data type is STRING.

**TrendAutoRangeBeginTagName property****TrendAutoRangeBeginTagName**

This attribute sets the low limit tag for the range of values if the range of values is calculated automatically by means of online tags.

The attribute can be assigned dynamic properties by means of the name **TrendAutoRangeBeginTagName**. The data type is STRING.

### TrendAutoRangeBeginValue property

#### TrendAutoRangeBeginValue

This attribute sets the low limit tag for the range of values if the range of values is calculated based on the configuration of high and low limits.

The attribute can be assigned dynamic properties by means of the name **TrendAutoRangeBeginValue**. The data type is DOUBLE.

### TrendAutoRangeEndTagName property

#### TrendAutoRangeEndTagName

This attribute sets the high limit tag for the range of values if the range of values is calculated automatically by means of online tags.

The attribute can be assigned dynamic properties by means of the name **TrendAutoRangeEndTagName**. The data type is STRING.

### TrendAutoRangeEndValue property

#### TrendAutoRangeEndValue

This attribute sets the high limit tag for the range of values if the range of values is calculated based on the configuration of high and low limits.

The attribute can be assigned dynamic properties by means of the name **TrendAutoRangeEndValue**. The data type is DOUBLE.

### TrendAutoRangeSource property

#### TrendAutoRangeSource

Defines the mode for automatic calculation of the range of values of trend data.

Value	Description	Explanation
0	Display data	The range of values is calculated automatically based on the data displayed.
1	Value range	The range of values is defined based on its configured low and high limit. The low and high limits are emulated in the "TrendAutoRangeBeginValue" and "TrendAutoRangeEndValue" attributes.
2	Online tags	The low and high limits of the range of values are derived from the values of connected online tags. The low and high limits are emulated in the "TrendAutoRangeBeginTagName" and "TrendAutoRangeEndTagName" attributes.

The attribute can be assigned dynamic properties by means of the name **TrendAutoRangeSource**. The data type is LONG.

### TrendBeginTime property

#### Start time - TrendBeginTime

Defines the start time of the time range for data transfer to the selected trend.

The attribute can be assigned dynamic properties by means of the name **TrendBeginTime**. The data type is Date.

### TrendColor property

#### Trend color - TrendColor

Specifies the trend color. Open the "Color selection" dialog by clicking the button.

The attribute can be assigned dynamic properties by means of the name **TrendColor**. The data type is LONG.

### LTrendColor property (before WinCC V7)

#### Description

Determines the color of the trend display or returns it.

The trend display indicates the tendency (rising or falling) of the measuring value being monitored by a small arrow. In order to activate the trend display, the Trend property must be set to "True". LONG write-read access.

#### See also

Bar (Page 174)

ScreenItem Object (Page 125)

### TrendCount property

#### TrendCount

Defines the number of configured trends.

The attribute can be assigned dynamic properties by means of the name **TrendCount**. The data type is LONG.

## TrendEndTime property

### End time - TrendEndTime

Defines the end of the time range for data connections of a selected trend.

The attribute can be assigned dynamic properties by means of the name **TrendEndTime**. The data type is Date.

## TrendExtendedColorSet property

### Extended - TrendExtendedColorSet

Enables configuration of the point and fill colors and the display of colors in Runtime.

Value	Explanation
TRUE	The "Point color" and "Fill color" field settings can be configured and are active in Runtime.
FALSE	The "Point color" and "Fill color" field settings cannot be configured and are inactive in Runtime.

The attribute can be assigned dynamic properties by means of the name **TrendExtendedColorSet**. The data type is BOOLEAN.

## TrendFill property

### Filled - TrendFill

Specifies if the area beneath the trend is to be filled.

Value	Explanation
TRUE	The area beneath the trend is shown filled. You can define the trend color as fill color if the "Advanced" option is deactivated. The text background is displayed in the trend color for the trend type "Values". The background color of the control is used as text color.
FALSE	The trend is not visualized with fill color.

The attribute can be assigned dynamic properties by means of the name **TrendFill**. The data type is BOOLEAN.

## TrendFillColor property

### Fill color - TrendFillColor

Specifies the fill color of the trend. The text fill color is specified for the trend type "Values".

The fill color is used if the "Filled" option is activated or "TrendFill" is "TRUE". Open the "Color selection" dialog by clicking the button.



The configuration is only possible if the "Advanced" option is activated or "TrendExtendedColorSet" is "TRUE".

The attribute can be assigned dynamic properties by means of the name **TrendFillColor**. The data type is LONG.

## TrendIndex property

### TrendIndex

References a configured trend. Using this attribute you can assign the values of other attributes to a specific trend. The index must always be set before you change the properties of a trend in runtime.

Values between 0 and "TrendIndex" minus 1 are valid for "TrendCount". Attribute "TrendCount" defines the number of trends configured.

The "TrendIndex" attribute can be assigned dynamic properties by means of attribute **TrendRepos**. The data type is LONG.

## TrendLabel property

### Label - TrendLabel

Defines the label of the trend selected. The label is displayed in Runtime if the value at attribute "UseTrendNameAsLabel" is "FALSE".

The attribute can be assigned dynamic properties by means of the name **TrendLabel**. The data type is STRING.

## TrendLineStyle property

### Line style - TrendLineStyle

Defines the line style for trend visualization.

The following settings are available:

Value	Description	Explanation
0	Solid	The trend is visualized as solid line.
1	Dashed	The trend is visualized as dashed line.
2	Dotted	The trend is visualized as dotted line.
3	Dash dot	The trend is visualized as dot-dash line.
4	Dash Dot Dot	The trend is visualized as dash-dot-dot line.

The attribute can be assigned dynamic properties by means of the name **TrendLineStyle**. The data type is LONG.

## TrendLineType property

### Trend type - TrendLineType

Defines how to visualize a trend.

The following settings are available:

Value	Description	Explanation
0	None	Only the dots are displayed.
1	Connect dots linearly	Visualizes a trend with linear interconnection of points.
2	Stepped	Visualizes a stepped trend and its interconnected points.
3	Values	Can only be configured with OnlineTrendControl. A value is displayed at each time stamp or at the main grid line of the time axis instead of trend points.

The attribute can be assigned dynamic properties by means of the name **TrendLineType**. The data type is LONG.

## TrendLineWidth property

### Line weight - TrendLineWidth

Defines the line weight of the line displayed.

The attribute can be assigned dynamic properties by means of the name **TrendLineWidth**. The data type is LONG.

## TrendLowerLimit property

### TrendLowerLimit

Specifies the low limit of a tag. The values are identified based on the color set in "TrendLowerLimitColor" if the tag value is less than "TrendLowerLimit". This setting is only active if the value at attribute "TrendLowerLimitColoring" is "TRUE".

The attribute can be assigned dynamic properties by means of the name **TrendLowerLimit**. The data type is DOUBLE.

## TrendLowerLimitColor property

### TrendLowerLimitColor

Specifies the color of tag values which are less than the value at "TrendLowerLimit". This setting is only active if the value at attribute "TrendLowerLimitColoring" is "TRUE".

The attribute can be assigned dynamic properties by means of the name **TrendLowerLimitColor**. The data type is LONG.

## TrendLowerLimitColoring property

### TrendLowerLimitColoring

Enables the "TrendLowerLimitColor" attribute for identifying tag values which are less than the value at "TrendLowerLimitValue".

Value	Explanation
TRUE	Attribute "TrendLowerLimitColor" is active.
FALSE	Attribute "TrendLowerLimitColor" is inactive.

The attribute can be assigned dynamic properties by means of the name **TrendLowerLimitColoring**. The data type is BOOLEAN.

## TrendMeasure - TrendVisible

### TrendMeasurePoints property

#### Number of measurement points - TrendMeasurePoints

Defines the number of measurement points for visualization of selected trends.

Defines the number of value pairs provided to the trend from a user archive.

The attribute can be assigned dynamic properties by means of the name **TrendMeasurePoints**. The data type is LONG.

### TrendName property

#### Object name - TrendName

Displays the name of the selected trend. The name is defined on the "Trends" tab.

The "TrendName" attribute can be assigned dynamic properties by means of attribute **TrendRename**. The data type is STRING.

### TrendPointColor property

#### Point color - TrendPointColor

Defines the color of trend points. Open the "Color selection" dialog by clicking the button.

The configuration is only possible if the "Advanced" option is activated or "TrendExtendedColorSet" is "TRUE".

The attribute can be assigned dynamic properties by means of the name **TrendPointColor**. The data type is LONG.

## TrendPointSize property

### Dot type - TrendPointSize

Defines the dot style for trend visualization.

The following settings are available:

Value	Description	Explanation
0	None	The points are not displayed.
1	Dots	The trend points are visualized with a size of one pixel. The setting in the "Dot width" field is deactivated.
2	Squares	The dots are displayed as square. The setting in the "Dot width" field is active.
3	Circles	The dots are displayed as circles. The setting in the "Dot width" field is active.

The attribute can be assigned dynamic properties by means of the name **TrendPointSize**. The data type is LONG.

## TrendPointWidth property

### Dot width - TrendPointWidth

Sets the dot width in pixels. You can only define the dot width for the "square" and "circular" type.

The attribute can be assigned dynamic properties by means of the name **TrendPointWidth**. The data type is LONG.

## TrendProvider property

### Data source - TrendProvider

Specifies the data source for a selected trend.

The following settings are available:

Value	Description	Explanation
0	None	No data source configured for implementation in Runtime by means of script.
1	Archive tags	Data source with archive tags of a process value archive.
2	Online tags	Data source with online tags derived from tag management.
3	User archive	Data source with columns of a user archive.

The attribute can be assigned dynamic properties by means of the name **TrendProvider**. The data type is LONG.

**TrendProviderCLSID\_FunctionTrend property****TrendProviderCLSID\_FunctionTrend**

Indicates the data source of the trend selected.

Value	Explanation
	No data source configured for implementation in Runtime by means of script.
{416A09D2-8B5A-11D2-8B81-006097A45D48}	Data source with archive tags of a process value archive.
{A3F69593-8AB0-11D2-A440-00A0C9DBB64E}	Data source with online tags derived from tag management.
{2DC9B1C8-4FC1-41B1-B354-3E469A13FBFD}	Data source with columns of a user archive.

The attribute can be assigned dynamic properties by means of the name **TrendProviderCLSID**. The data type is STRING.

**TrendProviderCLSID\_OnlineTrend property****TrendProviderCLSID\_OnlineTrend**

Indicates the data source of the trend selected.

Value	Explanation
	No data source configured for implementation in Runtime by means of script.
{416A09D2-8B5A-11D2-8B81-006097A45D48}	Data source with archive tags of a process value archive.
{A3F69593-8AB0-11D2-A440-00A0C9DBB64E}	Data source with online tags derived from tag management.

The attribute can be assigned dynamic properties by means of the name **TrendProviderCLSID**. The data type is STRING.

**TrendRangeType property****Time range setting - TrendRangeType**

Defines the time range for providing data to the selected trend.

You can only define the number of measuring points if you select user archives as the data source.

The following configuration options are available:

Value	Description	Explanation
0	Time range	Defines the start time and the time range for the data connection.
1	Start to end time	Defines the start and end time for the data connection.
2	Number of measurement points	Defines the start time and the number of measurement points for the data connection.

The attribute can be assigned dynamic properties by means of the name **TrendRangeType**. The data type is LONG.

### TrendRemove property

#### Remove - TrendRemove

Removes selected trends from the list.

The attribute can be assigned dynamic properties by means of the name **TrendRemove**. The data type is STRING.

### TrendRename property

#### TrendRename

Renames a trend which is referenced by means of "TrendIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **TrendRename**. "TrendRename" also sets a dynamic attribute "TrendName". The data type is STRING.

### TrendRepos property

#### Up/Down - TrendRepos

Repositions the trend in the trend window. "Up" and "Down" move the selected trend up or down in the list. This moves the trend towards the foreground or background for visualization in Runtime.

The attribute can be assigned dynamic properties by means of the name **TrendRepos**. The data type is LONG.

### TrendSelectTagName property

#### TrendSelectTagName

Opens a dialog for selecting the tag name for the source of Y axis data in WinCC OnlineTrendControl. Programmers can set this attribute to allow users to select a tag name by means of a button, for example.

The attribute can be assigned dynamic properties by means of the name **TrendSelectTagName**. The data type is BOOLEAN.

### TrendSelectTagNameX property

#### TrendSelectTagNameX

Opens a dialog for selecting the tag name for the source of X axis data in WinCC FunctionTrendControl. Programmers can set this attribute to allow users to select a tag name by means of a button, for example.

The attribute can be assigned dynamic properties by means of the name **TrendSelectTagNameX**. The data type is BOOLEAN.

### TrendSelectTagNameY property

#### TrendSelectTagNameY

Opens a dialog for selecting the tag name for the source of Y axis data in WinCC FunctionTrendControl. Programmers can set this attribute to allow users to select a tag name by means of a button, for example.

The attribute can be assigned dynamic properties by means of the name **TrendSelectTagNameY**. The data type is BOOLEAN.

### TrendShowAlarms property

#### Displaying alarms - TrendShowAlarms

If you have connected online tags and activate the "Show alarms" option, you can have the assigned message displayed as a symbol and tooltip for the trend values with limit violation. Limit monitoring must be configured in the alarm logging for the online tag for this.

The red symbol indicates a high or low limit violation. The tooltip contains the message text and information text of the message. If you have configured "Loop in Alarm" with the "OpenPicture" function for the message, you can jump to the assigned picture by double-clicking this symbol.

The attribute can be assigned dynamic properties by means of the name **TrendShowAlarms**. The data type is BOOLEAN.

### TrendState property

#### TrendState

Shows the status of the data link of the selected curve in Runtime.

The attribute can be made dynamic with the name **TrendState**. The data type is LONG.

## TrendTagName property

### Tag name - TrendTagName

Displays the name of connected tags. Use the Open button to open a dialog for selecting an online or archive tag.

The attribute can be assigned dynamic properties by means of the name **TrendTagName**. The data type is STRING.

## TrendTagNameX property

### Tag Name X / Column X - TrendTagNameX

Shows the name of interconnected tags or of the column for the X axis. Using the selection button, select a tag or a column for the data source you configured.

The attribute can be assigned dynamic properties by means of the name **TrendTagNameX**. The data type is STRING.

## TrendTagNameY property

### Tag Name Y / Column Y - TrendTagNameY

Shows the name of interconnected tags or of the column for the Y axis. Using the selection button, select a tag or a column for the data source you configured.

The attribute can be assigned dynamic properties by means of the name **TrendTagNameY**. The data type is STRING.

## TrendTimeAxis property

### Time axis - TrendTimeAxis

Defines the time axis to be used for the trend selected. Define the available time axes in the "Time axes" tab.

The attribute can be assigned dynamic properties by means of the name **TrendTimeAxis**. The data type is STRING.

## TrendTimeRangeBase property

### Time Range - TrendTimeRangeBase

Defines the time unit for calculating the time range.



The following time units are available:

Value	Description
500	500 ms
1000	1 second
60000	1 minute
3600000	1 hour
86400000	1 day

The attribute can be assigned dynamic properties by means of the name **TrendTimeRangeBase**. The data type is LONG.

### TrendTimeRangeFactor property

#### Time range - TrendTimeRangeFactor

Defines the factor for calculating the time range. Only integer factors are valid.

The attribute can be assigned dynamic properties by means of the name **TrendTimeRangeFactor**. The data type is SHORT.

### TrendTrendWindow property

#### Trend window - TrendTrendWindow

Defines the trend window for visualizing the trend selected. Define the available trend windows in the "Trend window" tab.

The attribute can be assigned dynamic properties by means of the name **TrendTrendWindow**. The data type is STRING.

### TrendUncertainColor property

#### TrendUncertainColor

Value are in uncertain state if the initial value is unknown after runtime has been activated, or if a substitute value is used. Set attribute "TrendUncertainColor" to define the color identifier of these values. The "TrendUncertainColoring" attribute determines whether or not this setting is evaluated.

The attribute can be assigned dynamic properties by means of the name **TrendUncertainColor**. The data type is LONG.

## TrendUncertainColoring property

### TrendUncertainColoring

Value are in uncertain state if the initial value is unknown after runtime has been activated, or if a substitute value is used. The "TrendUncertainColoring" attribute is used to enable identification of such values based on the color set in "TrendUncertainColor".

Value	Explanation
TRUE	The settings of the "TrendUncertainColor" attribute are active.
FALSE	The settings of the "TrendUncertainColor" attribute are inactive.

The attribute can be assigned dynamic properties by means of the name **TrendUncertainColoring**. The data type is BOOLEAN.

## TrendUpperLimit property

### TrendUpperLimit

Specifies the high limit of a tag. The values are identified based on the color set in "TrendUpperLimitColor" if the tag value exceeds the "TrendUpperLimit". This setting is only active if the value at attribute "TrendUpperLimitColoring" is "TRUE".

The attribute can be assigned dynamic properties by means of the name **TrendUpperLimit**. The data type is DOUBLE.

## TrendUpperLimitColor property

### TrendUpperLimitColor

Specifies the color of tag values which are less than the value at "TrendLowerLimit". This setting is only active if the value at attribute "TrendUpperLimitColoring" is "TRUE".

The attribute can be assigned dynamic properties by means of the name **TrendUpperLimitColor**. The data type is LONG.

## TrendUpperLimitColoring property

### TrendUpperLimitColoring

Enables the "TrendUpperLimitColor" attribute for identifying tag values which are less than the value at "TrendUpperLimit".

Value	Explanation
TRUE	The setting of the "TrendUpperLimitColor" attribute is active.
FALSE	The setting of the "TrendUpperLimitColor" attribute is inactive.

The attribute can be assigned dynamic properties by means of the name **TrendUpperLimitColoring**. The data type is BOOLEAN.

## TrendValueAlignment property

### Alignment - TrendValueAlignment

Specifies the alignment of the displayed values for the trend type "Values".

The following settings are available depending on the writing direction of the trend:

- The writing direction of the trend is "from right" or "from left"

Value	Description	Explanation
0	Bottom	The values are displayed at the bottom in the trend window.
1	Centered	The values are displayed centered in the trend window.
2	Top	The values are displayed at the top in the trend window.

- The writing direction of the trend is "from top" or "from bottom"

Value	Description	Explanation
0	Left	The values are displayed on the left in the trend window.
1	Centered	The values are displayed centered in the trend window.
2	Right	The values are displayed on the right in the trend window.

The attribute can be assigned dynamic properties by means of the name **TrendValueAlignment**. The data type is LONG.

## TrendValueAxis property

### Value axis - TrendValueAxis

Defines the value axis to be used for the trend selected. Define the available value axes in the "Value axes" tab.

The attribute can be assigned dynamic properties by means of the name **TrendValueAxis**. The data type is STRING.

## TrendValueUnit property

### Unit - TrendValueUnit

Specifies a unit for the trend type "Values" that is appended to the displayed value, e.g., "%" or "°C".

The attribute can be assigned dynamic properties by means of the name **TrendValueUnit**. The data type is STRING.

## TrendVisible property

### Trends - TrendVisible

The list shows all trends you created.

Select the trends to be displayed in the trend window from the list.

Click a trend entry in the list to adapt the properties and to assign axes and trend windows to the trend.

The attribute can be assigned dynamic properties by means of the name **TrendVisible**. The data type is BOOLEAN.

## TrendWindow - TrendYAxis

### TrendWindowAdd property

#### New - TrendWindowAdd

Creates a new trend window.

The attribute can be assigned dynamic properties by means of the name **TrendWindowAdd**. The data type is STRING.

## TrendWindowCoarseGrid property

### Main grid lines - TrendWindowCoarseGrid

Enables the display of grid lines for the main scale.

Value	Explanation
TRUE	Enables the display of grid lines for the main scale.
FALSE	Disables the display of grid lines for the main scale.

The attribute can be assigned dynamic properties by means of the name **TrendWindowCoarseGrid**. The data type is BOOLEAN.

## TrendWindowCoarseGridColor property

### Color of main scale - TrendWindowCoarseGridColor

Specifies the grid color of the main scale. Open the "Color selection" dialog by clicking the button.

The attribute can be assigned dynamic properties by means of the name **TrendWindowCoarseGridColor**. The data type is LONG.

**TrendWindowCount property****TrendWindowCount**

Defines the number of configured trend views.

The attribute can be assigned dynamic properties by means of the name **TrendWindowCount**. The data type is LONG.

**TrendWindowFineGrid property****Secondary grid lines - TrendWindowFineGrid**

Enables the display of grid lines for the secondary scale.

Value	Explanation
TRUE	Enables the display of grid lines for the secondary scale.
FALSE	Disables the display of grid lines for the secondary scale.

The attribute can be assigned dynamic properties by means of the name **TrendWindowFineGrid**. The data type is BOOLEAN.

**TrendWindowFineGridColor property****Color of secondary scale - TrendWindowFineGridColor**

Specifies the grid color of the main scale. Open the "Color selection" dialog by clicking the button.

The attribute can be assigned dynamic properties by means of the name **TrendWindowFineGridColor**. The data type is LONG.

**TrendWindowForegroundTrendGrid property****Only for foreground trend - TrendWindowForegroundTrendGrid**

Enables the display of grid lines only for the foreground trend in the trend window.

Value	Explanation
TRUE	Enables the display of grid lines for the foreground trend in the trend window.
FALSE	Enables the display of grid lines for all trends in the trend window.

The attribute can be assigned dynamic properties by means of the name **TrendWindowForegroundTrendGrid**. The data type is BOOLEAN.

**TrendWindowGridInTrendColor** property**Use trend color - TrendWindowGridInTrendColor**

Sets the trend color for the visualization of the grid lines for the main scale.

Value	Explanation
TRUE	The grid is displayed in the trend color.
FALSE	The grid is displayed with the color set in the "Color" field.

The attribute can be assigned dynamic properties by means of the name **TrendWindowGridInTrendColor**. The data type is BOOLEAN.

**TrendWindowHorizontalGrid** property**For X axis - TrendWindowVerticalGrid**

Enables the display of horizontal grid lines.

Value	Explanation
TRUE	The display of horizontal grid lines is enabled.
FALSE	The display of horizontal grid lines is disabled.

The attribute can be assigned dynamic properties by means of the name **TrendWindowHorizontalGrid**. The data type is BOOLEAN.

**TrendWindowIndex** property**TrendWindowIndex**

References a configured trend view. Using this attribute you can assign the values of other attributes to a specific trend view.

Values between 0 and "TrendWindowIndex" minus 1 are valid for "TrendWindowCount". Attribute "TrendWindowCount" defines the number of trend views configured.

The "TrendWindowIndex" attribute can be assigned dynamic properties by means of attribute **TrendWindowRepos**. The data type is LONG.

**TrendWindowName** property**Object name - TrendWindowName**

Defines the name of the trend window selected.

The "TrendWindowName" attribute can be assigned dynamic properties by means of attribute **TrendWindowRename**. The data type is STRING.

## TrendWindowRemove property

### Remove - TrendWindowRemove

Removes the selected trend window from the list.

The attribute can be assigned dynamic properties by means of the name **TrendWindowRemove**. The data type is STRING.

## TrendWindowRename property

### TrendWindowRename

Renames a trend view which is referenced by means of "TrendWindowIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **TrendWindowRename**. "TrendWindowRename" also sets a dynamic attribute "TrendWindowName". The data type is STRING.

## TrendWindowRepos property

### Up/Down - TrendWindowRepos

Changes the sorting order of the trend windows. "Up" and "Down" move the selected trend up or down in the list.

The sorting order in the list defines the position in the Control. The first trend window is displayed at the last position, while the last is displayed at the top position.

The attribute can be assigned dynamic properties by means of the name **TrendWindowRepos**. The data type is LONG.

## TrendWindowRulerColor property

### Ruler color - TrendWindowRulerColor

Specifies the ruler color. Open the "Color selection" dialog by clicking the button.

The color can be configured and displayed if "1 - graphic" is set for display of the ruler or "TrendWindowRulerStyle".

The attribute can be assigned dynamic properties by means of the name **TrendWindowRulerColor**. The data type is LONG.

## TrendWindowRulerLayer property

### Ruler layer - TrendWindowRulerLayer

Defines the representation layer of a ruler in the trend window.

The following settings are available:

Value	Description	Explanation
0	Under grid	The ruler is visualized on a layer under the grid.
1	Between grid and trend	The ruler is positioned on top of the trend and under the grid.
2	On top of trend	The ruler is positioned on top of the trend.

The attribute can be assigned dynamic properties by means of the name **TrendWindowRulerLayer**. The data type is LONG.

## TrendWindowRulerStyle property

### Ruler - TrendWindowRulerStyle

Defines the appearance of the ruler.

The following settings are available:

Value	Description	Explanation
0	Simple	The ruler is displayed as basic black line.
1	Graphic	The ruler is displayed based on the "color" and "weight" configured.

The attribute can be assigned dynamic properties by means of the name **TrendWindowRulerStyle**. The data type is LONG.

## TrendWindowRulerWidth property

### Ruler width - TrendWindowRulerWidth

Defines the width of the ruler in pixels.

The width can be configured and displayed if "1 - graphic" is set for display of the ruler or "TrendWindowRulerStyle".

The attribute can be assigned dynamic properties by means of the name **TrendWindowRulerWidth**. The data type is LONG.

## TrendWindowSpacePortion property

### Proportional area - TrendWindowSpacePortion

Specifies the proportion of the trend widow to be used for the selected curve.

The attribute can be assigned dynamic properties by means of the name **TrendWindowSpacePortion**. The data type is LONG.



**TrendWindowStatisticRulerColor property****Color of ruler for statistics area - TrendWindowStatisticRulerColor**

Specifies the color of the ruler for the statistics area. The button opens the "Color selection" dialog to select the color.

The color can be configured and displayed if "1 - graphic" is set for display of the ruler for the statistics area or "TrendWindowStatisticRulerStyle".

The attribute can be assigned dynamic properties by means of the name **TrendWindowStatisticRulerColor**. The data type is LONG.

**TrendWindowStatisticRulerStyle property****Ruler for statistics area - TrendWindowStatisticRulerStyle**

Enables the display of a ruler for defining the statistics area.

The following settings are available:

Value	Description	Explanation
0	Simple	The ruler is displayed as basic black line.
1	Graphic	The ruler is displayed based on the "color" and "weight" configured.

The attribute can be assigned dynamic properties by means of the name **TrendWindowStatisticRulerStyle**. The data type is LONG.

**TrendWindowStatisticRulerWidth property****Width of ruler for statistics area - TrendWindowStatisticRulerWidth**

Defines the width of the ruler for the statistics area in pixels.

The width of the ruler can be configured and displayed if "1 - graphic" is set for display of the ruler for the statistics area or "TrendWindowStatisticRulerStyle".

The attribute can be assigned dynamic properties by means of the name **TrendWindowStatisticRulerWidth**. The data type is LONG.

**TrendWindowVerticalGrid property****for Y axis - TrendWindowVerticalGrid**

Enables the display of vertical grid lines.

Value	Explanation
TRUE	The display of vertical grid lines is enabled.
FALSE	The display of vertical grid lines is disabled.

The attribute can be assigned dynamic properties by means of the name **TrendWindowVerticalGrid**. The data type is BOOLEAN.

### TrendWindowVisible property

#### Trend window - TimeAxisTrendWindow

The list shows all trend windows you created.

Select the trend windows to be displayed in the control from the list.

Click a list entry to adapt the ruler and grid line properties.

The attribute can be assigned dynamic properties by means of the name **TrendWindowVisible**. The data type is BOOLEAN.

### TrendXAxis property

#### X axis - TrendXAxis

Defines the X axis to be used for the trend selected. Define the available X axes in the "X Axes" tab.

The attribute can be assigned dynamic properties by means of the name **TrendXAxis**. The data type is STRING.

### TrendYAxis property

#### Y axis - TrendYAxis

Defines the Y axis to be used for the trend selected. Define the available Y axes in the "Y Axes" tab.

The attribute can be assigned dynamic properties by means of the name **TrendYAxis**. The data type is STRING.

### Type

#### Type Property

#### Description

Reads out the object type, e.g. "Rectangle", "Circle" or "Line".

The object type is returned as a string. Read only

A special ID is returned as the type for all the graphic elements provided by WinCC. It can be found under the topic "Type Identification in VBS" in the individual descriptions of the WinCC Object Types.

## Special feature

In the case of non-WinCC controls and OLE objects, the version-independent ProgID is returned as the type.

It is possible to determine the version-dependent ProgID or "User friendly Name" from the ProgID: In the following example, "Control1" is a control embedded in the picture which already returns the version-independent ProgID as a result of the Type property.

---

### Note

Since not every Control has a version-dependent ProgID, an error handling measure should be integrated to query the version-dependent ProgID or UserFriendlyName. If no error handling is used, the code is terminated immediately without any result when no ProgID is found.

---

Determine the version-dependent ProgID as follows:

```
'VBS91
Dim objControl
Dim strCurrentVersion
Set objControl = ScreenItems("Control1")
strCurrentVersion = CreateObject("WScript.Shell").RegRead("HKCR\" & objControl.Type &
"\CurVer\")
MsgBox strCurrentVersion
```

---

### Note

In order that example above works, a multimedia control should be inserted in the picture.

---

Determine the User Friendly Name as follows:

```
'VBS92
Dim objControl
Dim strFriendlyName
Set objControl = ScreenItems("Control1")
strFriendlyName = CreateObject("WScript.Shell").RegRead("HKCR\" & objControl.Type & "\")
MsgBox strFriendlyName
```

---

### Note

In order that example above works, a multimedia control should be inserted in the picture.

---

### Example:

The following example displays the type for all objects in the picture "NewPDL1":

```
'VBS93
Dim objScreen
Dim objScrItem
Dim lngIndex
Dim lngAnswer
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
strName = objScreen.ScreenItems(lngIndex).ObjectName
Set objScrItem = objScreen.ScreenItems(strName)
lngAnswer = MsgBox(objScrItem.Type, vbOKCancel)
If vbCancel = lngAnswer Then Exit For
Next
```

### See also

[ScreenItem Object \(Page 125\)](#)

[Object types of the ScreenItem object \(Page 143\)](#)

## TypeAlarmHigh Property

### Description

TRUE, when the upper limit value, at which an alarm is triggered, should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

### See also

[ScreenItem Object \(Page 125\)](#)

[Bar \(Page 174\)](#)

## TypeAlarmLow Property

### Description

TRUE, when the lower limit value, at which an alarm is triggered, should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

## See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## TypeLimitHigh4 Property

### Description

TRUE, when the "Reserve 4" upper limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

## See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## TypeLimitHigh5 Property

### Description

TRUE, when the "Reserve 5" upper limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

## See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## TypeLimitLow4 Property

### Description

TRUE, when the "Reserve 4" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

## See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## TypeLimitLow5 Property

### Description

TRUE, when the "Reserve 5" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## TypeToleranceHigh Property

### Description

TRUE, when the "Tolerance high" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## TypeToleranceLow Property

### Description

TRUE, when the "Tolerance low" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

### See also

Bar (Page 174)

ScreenItem Object (Page 125)

## TypeWarningHigh Property

### Description

TRUE, when the "Warning high" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

## See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## TypeWarningLow Property

### Description

TRUE, when the "Warning low" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

## See also

Bar (Page 174)  
ScreenItem Object (Page 125)

## 1.14.4.20 U

## Un - Up

## UnitColor Property

### Description

Defines the text color for the names of the unit of measurement. LONG write-read access.

## See also

WinCC Gauge Control (Page 254)  
ScreenItem Object (Page 125)

## UnitFont Property

### Description

Controls the display of the labeling for the unit of measurement. Read only access.

The following properties can be set:

- Font
- Font Style
- Font Size

- "Strikethrough" effect
- "Underline" effect

### See also

- WinCC Gauge Control (Page 254)
- ScreenItem Object (Page 125)

## UnitOffset Property

### Description

This attribute defines the distance of the text for the unit of measurement in relation to the top edge of the object. The text can only be positioned along the vertical diameter of the graduated scale disk. The value of the property is related to the height of the object and is measured from the top edge of the object to the base of the text.

The value range is 0 to 1.

0: The base of the text is at the top limit of the object. The text is no longer visible because it is outside the object.

1: The base of the text is at the bottom limit of the object.

### See also

- WinCC Gauge Control (Page 254)
- ScreenItem Object (Page 125)

## UnitText Property

### Description

Defines the text for the unit of measurement. Write/Read access.

### See also

- WinCC Gauge Control (Page 254)
- ScreenItem Object (Page 125)

## UnselBGColor Property

### Description

Defines or returns the background color of entries in the text list object which are not selected. LONG write-read access.



**See also**

Text list (Page 196)  
ScreenItem Object (Page 125)

**UnselTextColor Property****Description**

Defines or returns the color of the text for entries in the text list object which are not selected.  
LONG write-read access.

**See also**

Text list (Page 196)  
ScreenItem Object (Page 125)

**UpdateCycle Property****Description**

Returns the type and frequency of updating the picture window in Runtime. Read only access.

**See also**

Picture Window (Page 179)  
ScreenItem Object (Page 125)

**UpperLimit Property****Description**

TRUE, when the "UpperLimitColor" specification is to be used in order to identify the tag values (from a trend referenced via "Index") which lie above the value defined in "UpperLimitValue".  
BOOLEAN write-read access.

**See also**

WinCC Online Trend Control (before WinCC V7) (Page 295)  
WinCC Online Table Control (before WinCC V7) (Page 292)  
WinCC Function Trend Control (before WinCC V7) (Page 288)  
ScreenItem Object (Page 125)

## UpperLimitColor Property

### Description

Defines the color to be used in order to identify the tag values (from a trend referenced via "Index") which lie above the value defined in "UpperLimitValue". Whether the information is evaluated is dependent on the value of the "UpperLimit" property. The color is defined as an RGB value. LONG write-read access.

### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

ScreenItem Object (Page 125)

## UpperLimitTagName Property

### Description

This defines the upper limit of the trend range, which is automatically taken from the variable properties configured in PCS 7. Write/Read access.

## UpperLimitValue Property

### Description

Tag values (from a trend referenced via "Index") which lie above the value defined by "UpperLimitValue" are identified by the color specified in "UpperLimitColor". Whether the information is evaluated is dependent on the value of the "UpperLimit" property.

### See also

ScreenItem Object (Page 125)

WinCC Online Table Control (before WinCC V7) (Page 292)

WinCC Online Trend Control (before WinCC V7) (Page 295)

WinCC Function Trend Control (before WinCC V7) (Page 288)

**Us****UseColumnBackColor property****Use column color / background - UseColumnBackColor**

Specifies the settings to be activated for the background colors of columns.

Value	Explanation
TRUE	The background color settings are active in the "Time columns" or "TimeColumnBackColor" tabs and in the "Value columns" or "ValueColumnBackColor" tabs.
FALSE	The background color settings are active in the "Display" tab.

The attribute can be assigned dynamic properties by means of the name **UseColumnBackColors**. The data type is BOOLEAN.

**UseColumnForeColor property****Use column color / font - UseColumnForeColor**

Defines the active font color settings for the columns.

Value	Explanation
TRUE	The font color color settings are active in the "Time columns" or "TimeColumnForeColor" tabs and in the "Value columns" or "ValueColumnForeColor" tabs.
FALSE	The font color settings are active in the "Display" tab.

The attribute can be assigned dynamic properties by means of the name **UseColumnForeColors**. The data type is BOOLEAN.

**UseMessageColor property****Show message colors - UseMessageColor**

Sets the outputs of messages with colors as agreed by handshake.

Value	Explanation
TRUE	The message colors are displayed.
FALSE	The message colors are not displayed. Instead, the color settings defined for the table content are activated on the "Display" tab.

The attribute can be assigned dynamic properties by means of the name **UseMessageColor**. The data type is BOOLEAN.

## UseOnlineTags Property

### Description

This defines whether or not the variable properties configured in PCS 7 are applied as trend parameters. Write/Read access.

## UseRangeSubstitutes Property

### Description

TRUE, if a separate scaling of the value axis is displayed for the trends in Trend Control. BOOLEAN write-read access.

## UserData-Property

### Description

Contains the value that is to be transferred to the VB script while running a customized menu item or icon. STRING (write-read access)

### Example:

Use the "User data" field in the "Menus and Toolbars" editor to apply a parameter to the procedure

The following example shows the "ActivateScreen" procedure that executes the picture change. Enter the picture name in the "User Data" field:

```
Sub ActivateScreen (ByVal Item)
Dim objScreen
Dim strScreenName
' "UserData" contains the screen name specified
' in editor menus and toolbars.
strScreenName = Item.Userdata
HMIRuntime.BaseScreenName = strScreenName
End Sub
```

## UserName property

### Description

Returns the name of the user who triggered the alarm object.

## See also

Alarms object (list) (Page 110)

## UserValue1 Property

### Description

Defines or returns a value.

The value can be evaluated by a script, for example. This value is neither evaluated nor displayed in Runtime.

## See also

ScreenItem Object (Page 125)

Group Display (Page 194)

## UserValue2-Eigenschaft

### Description

Defines or returns a value.

The value can be evaluated by a script, for example. This value is neither evaluated nor displayed in Runtime.

## See also

Group Display (Page 194)

ScreenItem Object (Page 125)

## UserValue3 Property

### Description

Defines or returns a value.

The value can be evaluated by a script, for example. This value is neither evaluated nor displayed in Runtime.

## See also

Group Display (Page 194)

ScreenItem Object (Page 125)

## UserValue4 Property

### Description

Defines or returns a value.  
The value can be evaluated by a script, for example. This value is neither evaluated nor displayed in Runtime.

### See also

Group Display (Page 194)  
ScreenItem Object (Page 125)

## UseSelectedTitleColor property

### Selection color - UseSelectedTitleColor

Specifies whether to use a selection color for the headers of selected table cells.

Value	Explanation
TRUE	A selection color is used. The "Background" or "SelectedTitleColor" and "Font" or "SelectedTitleForeColor" settings are active in Runtime.
FALSE	Selection color is not used. The "Background" and "Font" settings are disabled in Runtime.

The attribute can be assigned dynamic properties by means of the name **UseSelectedTitleColor**. The data type is BOOLEAN.

## UseSourceBackColors property

### Apply background colors - UseSourceBackColors

Sets the background color derived from the control defined in the "Source" field.

Value	Explanation
TRUE	The background color from the interconnected control is used.
FALSE	The background color from the interconnected control is not used. The settings on the "Layout" tab are used.

The attribute can be assigned dynamic properties by means of the name **UseSourceBackColors**. The data type is BOOLEAN.

**UseSourceForeColors property****Apply font colors - UseSourceForeColors**

Sets the font colors derived from the control defined in the "Source" field.

Value	Explanation
TRUE	The font color of the interconnected control is activated.
FALSE	The font color from the connected control is not used. The settings on the "Layout" tab are used.

The attribute can be assigned dynamic properties by means of the name **UseSourceForeColors**. The data type is BOOLEAN.

**UseTableColor2 property****Row Color 2 - UseTableColor2**

Specifies whether to use a second row color for the representation of the table.

Value	Explanation
TRUE	"Row color 2" and "Row color 1" are used alternately.
FALSE	The "Row color 1" settings are used for all rows.

The attribute can be assigned dynamic properties by means of the name **UseTableColor2**. The data type is BOOLEAN.

**UseTrendNameAsLabel property****UseTrendNameAsLabel**

Sets the "TrendName" or "TrendLabel" attribute for labeling the trend in Runtime.

Value	Explanation
TRUE	Sets the "TrendName" attribute for labeling the trend in Runtime.
FALSE	Sets the "TrendLabel" attribute for labeling the trend in Runtime.

The attribute can be assigned dynamic properties by means of the name **UseTrendNameAsLabel**. The data type is BOOLEAN.

#### 1.14.4.21 V

### Val - ValueAxis

### Value Property

#### Description of Tag Object

Displays the value of the tags at the last read access or the value written or to be written. Value represents the value of a tag. After calling in the "Read" method, the tag value read is returned. Before writing, the new tag value required can be assigned to the property. After calling in the "Write" method, the property contains the value last written.

VARIANT (write-read access)

#### Example:

The following example writes a new value in the "Tag1" tag:

```
'VBS94
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Value = 50
objTag.Write
```

#### Description of WinCC Gauge Control

Defines the value to which the pointer points. Value Range: "ValueMin" to "ValueMax".

#### Description of DataItem Object

Returns a value copy or object reference. Furthermore, an already added value can be changed via the value property.



**Example:**

The example shows how to add a value to the list, and how to output it as a trace. After that, the value is changed, output again and then removed. It make sense to perform this in several different actions.

```
'VBS198
HMIRuntime.DataSet.Add "motor1", 23
HMIRuntime.Trace "motor1: " & HMIRuntime.DataSet("motor1").Value & vbNewLine
HMIRuntime.DataSet("motor1").Value = 55
HMIRuntime.Trace "motor1: " & HMIRuntime.DataSet("motor1").Value & vbNewLine
HMIRuntime.DataSet.Remove("motor1")
```

---

**Note**

For object references it must be ascertained that objects are multiread-enabled.

---

**See also**

- WinCC Gauge Control (Page 254)
- Write Method (Page 813)
- Read Method (Page 783)
- Tag Object (Page 137)
- Datatem Object (Page 113)
- ProcessValues Object (List) (Page 124)

**ValueAxisAdd property****New - ValueAxisAdd**

Creates a new value axis.

The attribute can be assigned dynamic properties by means of the name **ValueAxisAdd**. The data type is STRING.

**ValueAxisAlign property****Alignment - ValueAxisAlign**

Specifies the mode of alignment of a selected value axis.

The following settings are available:

Value	Description	Explanation
0	left	The selected value axis is displayed on left side of the trend or diagram.
1	right	The selected value axis is displayed on right side of the trend or diagram.

The attribute can be assigned dynamic properties by means of the name **ValueAxisAlign**. The data type is LONG.

### ValueAxisAutoPrecisions property

#### Decimal places automatic - ValueAxisAutoPrecisions

Enables automatic setting of the decimal precision.

Value	Explanation
TRUE	The decimal precision is defined automatically. The value in the "Decimal places" or "ValueAxisPrecisions" field is disabled.
FALSE	The value in the "Decimal places" or "ValueAxisPrecisions" field is active.

The attribute can be assigned dynamic properties by means of the name **ValueAxisAutoPrecisions**. The data type is BOOLEAN.

### ValueAxisAutoRange property

#### Value range automatic - ValueAxisAutoRange

Enables automatic calculation of the range of values.

Value	Explanation
TRUE	The range of values is calculated automatically.
FALSE	The range of values is calculated based on the values configured in the "from" and "to" or "ValueAxisBeginValue" and "ValueAxisEndValue" fields.

The attribute can be assigned dynamic properties by means of the name **ValueAxisAutoRange**. The data type is BOOLEAN.

### ValueAxisBarWindow property

#### Diagram window - ValueAxisBarWindow

Specifies the diagram window in which the selected value axis will be used. You can specify the available diagram window in the "Diagram window" tab or using "BarWindowAdd".

The attribute can be assigned dynamic properties using the name **ValueAxisBarWindow**. The data type is STRING.

### ValueAxisBeginValue property

#### Value range from - ValueAxisBeginValue

Specifies the start value of the value axis selected. You can configure the value if the "Automatic" option is disabled or "ValueAxisAutoRange" is "FALSE".

The attribute can be assigned dynamic properties by means of the name **ValueAxisBeginValue**. The data type is DOUBLE.

### ValueAxisColor property

#### Value axis color - ValueAxisColor

Specifies the color of the time axis. The button opens the "Color selection" dialog to select the color.

The setting is only active if the "Use trend color" or "Use diagram color" option is disabled or if "ValueAxisInTrendColor" is "FALSE".

The attribute can be assigned dynamic properties by means of the name **ValueAxisColor**. The data type is LONG.

### ValueAxisCount property

#### ValueAxisCount

Defines the number of value axes configured.

The attribute can be assigned dynamic properties by means of the name **ValueAxisCount**. The data type is LONG.

### ValueAxisEndValue property

#### Value range to - ValueAxisEndValue

Specifies the end value of the value axis selected. You can configure the value if the "Automatic" option is disabled or "ValueAxisAutoRange" is "FALSE".

The attribute can be assigned dynamic properties by means of the name **ValueAxisEndValue**. The data type is DOUBLE.

**ValueAxisExponentialFormat** property**Exponential notation - ValueAxisExponentialFormat**

Sets exponential notation for the display of values of a value axis selected.

Value	Explanation
TRUE	The values are displayed with exponential notation.
FALSE	The values are displayed with decimal notation.

The attribute can be assigned dynamic properties by means of the name **ValueAxisExponentialFormat**. The data type is BOOLEAN.

**ValueAxisInBarColor** property**In diagram color - ValueAxisInBarColor**

Specifies whether the selected value axis will be displayed in the diagram color. If there is more than one diagram in the diagram window, the color of the first diagram will be used. You specify the order of the diagrams on the "Diagrams" tab.

Value	Explanation
TRUE	The selected value axis is displayed in the diagram color. The setting in the "Color" or "ValueAxisColor" field is disabled.
FALSE	The value axis selected is displayed in the color set in the "Color" or "ValueAxisColor" field.

The attribute can be assigned dynamic properties using the name **ValueAxisInBarColor**. The data type is BOOLEAN.

**ValueAxisIndex** property**ValueAxisIndex**

References a value axis. Using this attribute you can assign the values of other attributes to a specific value axis.

Values between 0 and "ValueAxisCount" minus 1 are valid for "ValueAxisIndex". Attribute "ValueAxisCount" defines the number of value axes configured.

The "ValueAxisIndex" attribute can be assigned dynamic properties by means of attribute **ValueAxisRepos**. The data type is LONG.

**ValueAxisInTrendColor property****Use trend color - ValueAxisInTrendColor**

Sets the trend color for displaying the value axis selected. The color of the first trend is activated if several trends are displayed in the trend window. Define the order of trends on the "Trends" tab.

Value	Explanation
TRUE	The selected value axis is displayed in the trend color. The setting in the "Color" or "ValueAxisColor" field is disabled.
FALSE	The value axis selected is displayed in the color set in the "Color" or "ValueAxisColor" field.

The attribute can be assigned dynamic properties by means of the name **ValueAxisInTrendColor**. The data type is BOOLEAN.

**ValueAxisInTrendColor property****Use trend color - ValueAxisInTrendColor**

Sets the trend color for displaying the value axis selected. The color of the first trend is activated if several trends are displayed in the trend window. Define the order of trends on the "Trends" tab.

Value	Explanation
TRUE	The selected value axis is displayed in the trend color. The setting in the "Color" or "ValueAxisColor" field is disabled.
FALSE	The value axis selected is displayed in the color set in the "Color" or "ValueAxisColor" field.

The attribute can be assigned dynamic properties by means of the name **ValueAxisInTrendColor**. The data type is BOOLEAN.

**ValueAxisLabel property****Label - ValueAxisLabel**

Specifies the label of a value axis selected.

The attribute can be assigned dynamic properties by means of the name **ValueAxisLabel**. The data type is STRING.

**ValueAxisName property****Object name - ValueAxisName**

Specifies the name of a value axis selected.

The "ValueAxisName" attribute can be assigned dynamic properties by means of attribute **ValueAxisRename**. The data type is STRING.

### ValueAxisPrecisions property

#### Decimal places - ValueAxisPrecisions

Specifies the decimal precision for displaying the value axis selected. The value can be configured and is active in Runtime, if the "Automatic" option is disabled or "ValueAxisAutoPrecisions" is "FALSE".

The attribute can be assigned dynamic properties by means of the name **ValueAxisPrecisions**. The data type is SHORT.

### ValueAxisRemove property

#### Remove - ValueAxisRemove

Removes the selected value axis from the list.

The attribute can be assigned dynamic properties by means of the name **ValueAxisRemove**. The data type is STRING.

### ValueAxisRename property

#### ValueAxisRename

Renames a value axis which is referenced by means of "ValueAxisIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **ValueAxisRename**. "ValueAxisRename" also sets a dynamic attribute "ValueAxisName". The data type is STRING.

### ValueAxisRepos property

#### Up/Down - ValueAxisRepos

Changes the order of value axes. "Up" and "Down" move the value axis selected up or down in the list.

The list order determines the value axis position in the trend window or diagram window in runtime. If the orientation is the same and the value axis of the list is further above, the value axis is shown at a more remote position of the curve or diagram.

The attribute can be assigned dynamic properties by means of the name **ValueAxisRepos** . The data type is LONG.

**ValueAxisScalingType property****Scaling - ValueAxisScalingType**

Specifies the scaling mode for a selected value axis.

The following settings are available:

Value	Description	Explanation
0	Linear	Enables linear scaling of a value axis selected.
1	Logarithmic	Enables logarithmic scaling of a value axis selected.
2	Logarithmically negated	Enables scaling of a selected value value axis with logarithmic negation.

The attribute can be assigned dynamic properties by means of the name **ValueAxisScalingType**. The data type is LONG.

**ValueAxisTrendWindow property****Trend window - ValueAxisTrendWindow**

Specifies the trend window for displaying the value axis selected. Define the available trend windows in the "Trend window" tab.

The attribute can be assigned dynamic properties by means of the name **ValueAxisTrendWindow**. The data type is STRING.

**ValueAxisVisible property****Value axes - ValueAxisVisible**

The list shows all value axes you created. Click a value axis entry in the list to adapt the properties and to assign a trend window or diagram window to the value axis.

Select the value axes in the list that you want to display in the trend windows or diagram windows.

The attribute can be assigned dynamic properties by means of the name **ValueAxisVisible**. The data type is BOOLEAN.

**ValueColumn - Vi****ValueColumnAdd property****New - ValueColumnAdd**

Creates a new value column.

The attribute can be assigned dynamic properties by means of the name **ValueColumnAdd**.  
The data type is STRING.

### ValueColumnAlign property

#### Alignment - ValueColumnAlign

Defines the mode of alignment of a selected value column.

The following settings are available:

Value	Description	Explanation
0	left	The selected value column is displayed on the left.
1	Centered	The selected value column is aligned to center.
2	right	The selected value column is displayed on the right.

The attribute can be assigned dynamic properties by means of the name **ValueColumnAlign**.  
The data type is LONG.

### ValueColumnAlignment Property

#### Description

The "Index" property references a pair of columns. "ValueColumnAlignment" defines the alignment of the tag value for this column pair.

- 0: Tag values are entered aligned left.
- 1: Tag values are entered centered.
- 2: Tag values are entered aligned right.

#### See also

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

### ValueColumnAutoPrecisions property

#### Automatic - ValueColumnAutoPrecisions

Enables automatic setting of the decimal precision.

Value	Explanation
TRUE	The decimal precision is defined automatically. The value in the "Decimal places" or "ValueColumnPrecisions" field is disabled.
FALSE	The value in the "Decimal places" or "ValueColumnPrecisions" field is active.



The attribute can be assigned dynamic properties by means of the name **ValueColumnAutoPrecisions**. The data type is BOOLEAN.

### ValueColumnBackColor property

#### Background color - ValueColumnBackColor

Specifies the background color of the value column selected. Use the button to open the "Color selection" dialog.

The setting is only active if the "Background color" option is set or "UseColumnBackColor" is "TRUE" in the "Use column color" field of the "General" tab.

The attribute can be assigned dynamic properties by means of the name **ValueColumnBackColor**. The data type is LONG.

### ValueColumnCaption property

#### Description - ValueColumnCaption

Defines the label of the value column selected.

The attribute can be assigned dynamic properties by means of the name **ValueColumnCaption**. The data type is STRING.

### ValueColumnCount property

#### ValueColumnCount

Defines the number of value columns configured.

The attribute can be assigned dynamic properties by means of the name **ValueColumnCount**. The data type is LONG.

### ValueColumnExponentialFormat property

#### Exponential notation - ValueColumnExponentialFormat

Sets exponential notation for the display of values of a value column selected.

Value	Explanation
TRUE	Display with exponential notation.
FALSE	Display with decimal notation.

The attribute can be assigned dynamic properties by means of the name **ValueColumnExponentialFormat**. The data type is BOOLEAN.

## ValueColumnForeColor property

### Font color - ValueColumnForeColor

Specifies the font color of the value column selected. Use the button to open the "Color selection" dialog.

The setting is only active if the "Font color" option is set or "UseColumnForeColor" is "TRUE" in the "Use column color" field of the "General" tab.

The attribute can be assigned dynamic properties by means of the name **ValueColumnForeColor**. The data type is LONG.

## ValueColumnHideText property

### ValueColumnHideText

Sets text format for displaying the content of a value column.

Value	Explanation
TRUE	The content is not displayed in text format.
FALSE	The content is displayed in text format.

The attribute can be assigned dynamic properties by means of the name **ValueColumnHideText**. The data type is BOOLEAN.

## ValueColumnHideTitleText property

### ValueColumnHideTitleText

Sets text format for displaying the value column header.

Value	Explanation
TRUE	The header is not displayed in text format.
FALSE	The header is displayed in text format.

The attribute can be assigned dynamic properties by means of the name **ValueColumnHideTitleText**. The data type is BOOLEAN.

## ValueColumnIndex property

### ValueColumnIndex

References a configured value column. Using this attribute you can assign the values of other attributes to a specific value column.

Values between 0 and "ValueColumnCount" minus 1 are valid for "ValueColumnIndex". Attribute "ValueColumnCount" defines the number of value columns configured.

The "ValueColumnIndex" attribute can be assigned dynamic properties by means of attribute **ValueColumnRepos**. The data type is LONG.

### ValueColumnLength property

#### Length in characters - ValueColumnLength

Specifies the width of a selected value column.

The attribute can be assigned dynamic properties by means of the name **ValueColumnLength**. The data type is LONG.

### ValueColumnName property

#### Object name - ValueColumnName

Specifies the name of a selected value column.

The "ValueColumnName" attribute can be assigned dynamic properties by means of attribute **ValueColumnRename**. The data type is STRING.

### ValueColumnPrecisions property

#### Decimal places - ValueColumnPrecisions

Specifies the decimal precision for displaying the data of a value column selected. The value can be entered if the "Automatic" option is disabled or "ValueColumnAutoPrecisions" is "FALSE".

The attribute can be assigned dynamic properties by means of the name **ValueColumnPrecisions**. The data type is SHORT.

### ValueColumnProvider property

#### Data source - ValueColumnProvider

Specifies the data source for a selected value column.

The following settings are available:

Value	Description	Explanation
1	Archive tags	Data source with archive tags of a process value archive.
2	Online tags	Data source with online tags derived from tag management.

The attribute can be assigned dynamic properties by means of the name **ValueColumnProvider**. The data type is LONG.

**ValueCollectionProviderCLSID property****ValueCollectionProviderCLSID**

Indicates the data source of the value column selected.

Value	Explanation
{416A09D2-8B5A-11D2-8B81-006097A45D48}	Data source with archive tags of a process value archive.
{A3F69593-8AB0-11D2-A440-00A0C9DBB64E}	Data source with online tags derived from tag management.

The attribute can be assigned dynamic properties by means of the name **ValueCollectionProviderCLSID**. The data type is STRING.

**ValueCollectionRemove property****Remove - ValueColumnRemove**

Removes the selected value column from the list.

The attribute can be assigned dynamic properties by means of the name **ValueCollectionRemove**. The data type is STRING.

**ValueCollectionRename property****ValueCollectionRename**

Renames a value column which is referenced by means of "ValueCollectionIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **ValueCollectionRename**. "ValueCollectionRename" also sets a dynamic attribute "ValueCollectionName". The data type is STRING.

**ValueCollectionRepos property****Up/Down - ValueColumnRepos**

Changes the sorting order of the value columns. "Up" and "Down" move the value column selected up or down in the list.

The sorting order in the list determines the order of value columns after the time column if several value columns are assigned to the same time column. Higher positions of the value column in the list moves it to closer proximity towards the time column.

You change the order of time columns and their assigned value columns in the "Time columns" tab.

The attribute can be assigned dynamic properties by means of the name **ValueCollectionRepos**. The data type is LONG.

**ValueColumnSelectTagName property****ValueColumnSelectTagName**

Opens a dialog for selecting the tag name for the data source of the value column in WinCC OnlineTableControl. Programmers can set this attribute to allow users to select a tag name by means of a button, for example.

The attribute can be assigned dynamic properties by means of the name **ValueColumnSelectTagName**. The data type is BOOLEAN.

**ValueColumnShowIcon property****ValueColumnShowIcon**

Enables the display of value column contents as icon.

Value	Explanation
TRUE	The content is visualized as icon.
FALSE	The content is not visualized as icon.

The attribute can be assigned dynamic properties by means of the name **ValueColumnShowIcon**. The data type is BOOLEAN.

**ValueColumnShowTitleIcon property****ValueColumnShowTitleIcon**

Enables display of the value column header as icon.

Value	Explanation
TRUE	The header is displayed as icon.
FALSE	The header is not displayed as icon.

The attribute can be assigned dynamic properties by means of the name **ValueColumnShowTitleIcon**. The data type is BOOLEAN.

**ValueColumnSort property****ValueColumnSort**

Defines the sorting order of the value column referenced in "ValueColumnIndex" .

The following settings are available:

Value	Description	Explanation
0	No	No sorting
1	Ascending	Ascending order, starting at the lowest value.
2	Descending	Descending order, starting at the highest value.

The attribute can be assigned dynamic properties by means of the name **ValueColumnSort**. The data type is LONG.

### ValueColumnSortIndex property

#### ValueColumnSortIndex

Defines the sorting order of the value column referenced in "ValueColumnIndex". The sorting criterion is removed from "ValueColumnSort" if you set a "0" value..

The attribute can be assigned dynamic properties by means of the name **ValueColumnSortIndex**. The data type is LONG.

### ValueColumnState property

#### ValueColumnState

Displays the data connection status of a selected value column in Runtime.

The attribute can be assigned dynamic properties by means of the name **ValueColumnState**. The data type is LONG.

### ValueColumnTagName property

#### Tag name - ValueColumnTagName

Displays the name of connected tags. You can change the tag connection using the selection button.

The attribute can be assigned dynamic properties by means of the name **ValueColumnTagName**. The data type is STRING.

### ValueColumnTimeColumn property

#### Time column - ValueColumnTimeColumn

Specifies the time column for displaying the value column selected. Define the available time columns in the "Time columns" tab.

The attribute can be assigned dynamic properties by means of the name **ValueColumnTimeColumn**. The data type is STRING.

## ValueColumnVisible property

### Value columns - ValueColumnVisible

The list shows all value columns you created. Click a value column entry in the list to adapt the properties, to assign the value column, and to define the data connection.

Select the value columns to be displayed in the table from the list. Value columns are displayed if interconnected with a time column.

The attribute can be assigned dynamic properties by means of the name **ValueColumnVisible** . The data type is BOOLEAN.

## ValueMax Property

### Description

Defines the value at the end of the scale. Write/Read access.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## ValueMin Property

### Description

Defines the value at the start of the scale. Write/Read access.

### See also

WinCC Gauge Control (Page 254)

ScreenItem Object (Page 125)

## Variable Property

### Description

The "Index" property references a pair of columns. "Tag" defines the name of the tag which should be connected to this column pair.

**See also**

WinCC Online Table Control (before WinCC V7) (Page 292)

ScreenItem Object (Page 125)

**VerticalGridLines property****Vertical - VerticalGridLines**

Enables the display of vertical dividers.

Value	Explanation
TRUE	Enables the displays of vertical dividers.
FALSE	Disables the display of vertical dividers.

The attribute can be assigned dynamic properties by means of the name **VerticalGridLines**. The data type is BOOLEAN.

**Visible Property****Description**

witches an object visible or invisible or issues a corresponding value:

- TRUE : Object is visible
- FALSE : Object is invisible

VARIANT\_BOOL (write-read access)

**Example:**

The following example sets all the objects in the picture "NewPDL1" to invisible:

```
'VBS95
Dim objScreen
Dim objScrItem
Dim lngIndex
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
strName = objScreen.ScreenItems(lngIndex).ObjectName
Set objScrItem = objScreen.ScreenItems(strName)
objScrItem.Visible = False
Next
```



**See also**

ScreenItem Object (Page 125)  
Layer Object (Page 120)  
HMIRuntime Object (Page 118)

**1.14.4.22 W****Warning Property****Description**

Defines the start of the "Warning zone" as a scale value. Write/Read access.

**See also**

WinCC Gauge Control (Page 254)  
ScreenItem Object (Page 125)

**WarningColor Property****Description**

Defines the color of the "Warning zone" o the scale. LONG write-read access.

**See also**

WinCC Gauge Control (Page 254)  
ScreenItem Object (Page 125)

**WarningHigh Property****Description**

Defines or returns the upper limit value for "Warning High".  
In order that the limit value is monitored, the "CheckWarningHigh" property must be set to TRUE.  
The display on reaching the limit value and the type of evaluation are defined by means of the "ColorWarningHigh" and "TypeWarningHigh" properties.

## See also

Bar (Page 174)

ScreenItem Object (Page 125)

## WarningLow Property

### Description

Defines or returns the lower limit value for "Warning Low".

In order that the limit value is monitored, the "CheckWarningLow" property must be set to TRUE.

The display on reaching the limit value and the type of evaluation are defined by means of the "ColorWarningLow" and "TypeWarningLow" properties.

## See also

Bar (Page 174)

ScreenItem Object (Page 125)

## Width Property

### Description

Sets or outputs the width of an object in pixels.

LONG

**Example:**

The following example doubles the width of all objects in the pictures "NewPDL1" whose name begins with "Button":

```
'VBS96
Dim objScreen
Dim cmdButton
Dim lngIndex
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
'
'Get all "Buttons"
strName = objScreen.ScreenItems(lngIndex).ObjectName
If "Button" = Left(strName, 6) Then
Set cmdButton = objScreen.ScreenItems(strName)
cmdButton.Width = cmdButton.Width * 2
End If
Next
```

**See also**

[Height Property \(Page 443\)](#)

[ScreenItem Object \(Page 125\)](#)

**WinCCStyle property****Description**

Defines the style in which the object is displayed.

User Defined	Shows the object according to the respective settings.
Global	Shows the object in a globally defined design.
Windows Style	Shows the object in Windows style.

**WindowBorder Property****Description**

TRUE, when the window is displayed with borders in Runtime. Read only access.

## See also

Picture Window (Page 179)

Application Window (Page 173)

ScreenItem Object (Page 125)

## WindowPositionMode property

### Description

Defines the position and scaling of the picture window on the screen. It is only effective if the "Independent window" attribute is set to TRUE.

Standard	The picture window is positioned in its original size in the configured position on the screen.
Center	The picture window is positioned in its original size, centered on the screen.
Maximize	The picture window is scaled to the size of the screen.

## WindowsStyle property

### Description

Defines whether the object is displayed in the Windows style of WinCC version 6.2. It can only be selected if "WinCC Classic" is chosen as the current design.

TRUE if the object is displayed in the Windows style of WinCC version 6.2.

FALSE if the object is not displayed in the Windows style of WinCC version 6.2.

## WindowsStyle Property

### Description

TRUE, when the object complies with the general Windows style (e.g. gray buttons without borders). BOOLEAN write-read access. Note:

- When this property is set to "True", the properties which do not comply with the Windows style are ignored (e.g. "BorderWidth").
- On the other hand, the definition of a "BorderWidth" or a background color other than gray causes "WindowsStyle" to receive the value "False".
- Exceptions here are the flash attributes: The definition of flash attributes does not automatically lead to the deactivation of the "WindowsStyle" attribute.

**See also**

Slider (Page 212)  
Button (Page 201)  
ScreenItem Object (Page 125)

**WindowType Property****Description**

Defines the use of the message window.

- 0 - Message list: shows the currently pending messages.
- 1 - Short-term archive list: shows the archived messages.
- 2 - Long-term archive list: shows the archived messages.
- 3 - Lock list: shows the currently locked messages.
- 4 - Hit list: To display the statistical information of messages.

**See also**

WinCC Alarm Control (before WinCC V7) (Page 286)  
ScreenItem Object (Page 125)

**WithAxes Property****Description**

TRUE, when the scale should be displayed. BOOLEAN write-read access.

**See also**

WinCC Slider Control (Page 277)  
ScreenItem Object (Page 125)

**WithLabels Property****Description**

TRUE, when the scale labels should be displayed. BOOLEAN write-read access.

**See also**

WinCC Slider Control (Page 277)

ScreenItem Object (Page 125)

**1.14.4.23 X - Z****XAxisColor property (before WinCC V7)****Description**

Use this attribute to define the color for the common X-axis. The color is defined as an RGB value. LONG write-read access.

**X/YAxisAdd property****New - X/YAxisAdd**

Creates a new X or Y axis.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisAdd**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisAdd**.

The data type is STRING.

**X/YAxisAlign property****Alignment - X/YAxisAlign**

Defines the alignment mode for a selected axis.

The following settings are available for the X axis:

Value	Description	Explanation
0	Bottom	The X axis selected is displayed below the trend.
1	Top	The X axis selected is displayed above the trend.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisAlign**.

The data type is LONG.

The following settings are available for the Y axis:

Value	Description	Explanation
0	left	The X axis selected is displayed on left side of the trend.
1	right	The X axis selected is displayed on right side of the trend.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisAlign**.

The data type is LONG.

## X/YAxisAutoPrecisions property

### Decimal places automatic - X/YAxisAutoPrecisions

Enables automatic setting of the decimal precision.

Value	Explanation
TRUE	The number of decimal places is set automatically. The value in the "Decimal places" or "X/YAxisPrecisions" field is disabled.
FALSE	The value in the "Decimal places" or "X/YAxisPrecisions" field is active.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisAutoPrecisions**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisAutoPrecisions**.

The data type is BOOLEAN.

## X/YAxisAutoRange property

### Value range automatic - X/YAxisAutoRange

Enables automatic calculation of the value range of the axis selected.

Value	Explanation
TRUE	The range of values is calculated automatically.
FALSE	The range of values is calculated based on the values configured in the "from" and "to" or "X/YAxisBeginValue" and "X/YAxisEndValue" fields.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisAutoRange**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisAutoRange**.

The data type is BOOLEAN.

## X/YAxisBeginValue property

### Value range from - X/YAxisBeginValue

Specifies the lower range of values of the axis selected. You can configure the value if the "Automatic" option is disabled or "X/YAxisAutoRange" is "FALSE".

The X axis attribute can be assigned dynamic properties by means of the name **XAxisBeginValue**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisBeginValue**.

The data type is DOUBLE.

## X/YAxisColor property

### Color XY axis - X/YAxisColor

Specifies the color of the axis selected. The button opens the "Color selection" dialog to select the color.

The setting is only active if the "Use trend color" field is disabled or "X/YAxisInTrendColor" is "FALSE".

The X axis attribute can be assigned dynamic properties by means of the name **XAxisColor**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisColor**.

The data type is LONG.

## X/YAxisEndValue property

### Value range to - X/YAxisEndValue

Specifies the upper range of values of the axis selected. You can configure the value if the "Automatic" option is disabled or "X/YAxisAutoRange" is "FALSE".

The X axis attribute can be assigned dynamic properties by means of the name **XAxisEndValue**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisEndValue**.

The data type is DOUBLE.

## X/YAxisExponentialFormat property

### Exponential notation - X/YAxisExponentialFormat

Enables the exponential notation for visualization of a selected axis.

Value	Explanation
TRUE	The values are displayed with exponential notation.
FALSE	The values are displayed with decimal notation.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisExponentialFormat**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisExponentialFormat**.

The data type is BOOLEAN.



## X/YAxisInTrendColor property

### Use trend color - X/YAxisInTrendColor

Enables the display of an axis selected in the trend color. The color of the first trend is activated if several trends are displayed in the trend window. Define the order of trends on the "Trends" tab.

Value	Explanation
TRUE	The axis selected is displayed in the trend color. The setting in the "Color" or "X/YAxisColor" field is disabled.
FALSE	The axis selected is displayed in the color set in the "Color" or "X/YAxisColor" field.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisInTrendColor**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisInTrendColor**.

The data type is BOOLEAN.

## X/YAxisLabel property

### Label - X/YAxisLabel

Defines the label text for a selected axis.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisLabel**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisLabel**.

The data type is STRING.

## X/YAxisName property

### Object name - X/YAxisName

Specifies the name of a selected axis.

Attribute "XAxisName" can be assigned dynamic properties for the X axis by means of **XAxisRename** attribute.

Attribute "YAxisName" can be assigned dynamic properties for the Y axis by means of **YAxisRename** attribute.

The data type is STRING.

## **X/YAxisPrecisions property**

### **Decimal places - X/YAxisPrecisions**

Specifies the decimal precision for displaying the axis selected. The value can be configured and is active in Runtime, if the "Automatic" option is disabled or "X/YAxisAutoPrecisions" is "FALSE".

The X axis attribute can be assigned dynamic properties by means of the name **XAxisPrecisions**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisPrecisions**.

The data type is SHORT.

## **X/YAxisRemove property**

### **Remove - X/YAxisRemove**

Removes the selected axis from the list.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisRemove** .

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisRemove** .

The data type is STRING.

## **X/YAxisRepos property**

### **Up/Down - X/YAxisRepos**

Changes the sorting order of the axes. "Up" and "Down" move the axis selected up or down in the list.

The list order determines the axis position in the trend window. The axis output position is moved away from the trend if the axis is moved further up in the list and the orientation is the same.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisRepos** .

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisRepos** .

The data type is LONG.

## **X/YAxisScalingType property**

### **Scaling - X/YAxisScalingType**

Defines the scaling mode for a selected axis.

The following settings are available:

Value	Description
0	Linear
1	Logarithmic
2	Logarithmically negated

The X axis attribute can be assigned dynamic properties by means of the name **XAxisScalingType**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisScalingType**.

The data type is LONG.

### **X/YAxisTrendWindow property**

#### **Trend window - X/YAxisTrendWindow**

Specifies the trend window for a selected axis. Define the available trend windows in the "Trend window" tab.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisTrendWindow**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisTrendWindow**.

The data type is STRING.

### **X/YAxisVisible property**

#### **X/Y axes - X/YAxisVisible**

The list shows all axes you created. Click an axis entry in the list to adapt the properties and to assign the axis to a trend window.

Activate the axes to be displayed in the trend windows in the list.

The X axis attribute can be assigned dynamic properties by means of the name **XAxisVisible**.

The Y axis attribute can be assigned dynamic properties by means of the name **YAxisVisible**.

The data type is BOOLEAN.

### **XAxisCount property**

#### **XAxisCount**

Defines the number of X axes configured.

The attribute can be assigned dynamic properties by means of the name **XAxisCount**. The data type is LONG.

### **XAxisIndex property**

#### **XAxisIndex**

References a configured X axis. Using this attribute you can assign the values of other attributes to a specific X axis.

Values between 0 and "XAxisCount" minus 1 are valid for "Index"; the attribute "XAxisCount" defines the number of configured X axes.

The "XAxisIndex" attribute can be assigned dynamic properties by means of attribute **XAxisRepos**. The data type is LONG.

### **XAxisRename property**

#### **XAxisRename**

Renames the X axis which is referenced by means of "XAxisIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **XAxisRename**. "XAxisRename" also sets a dynamic attribute "XAxisName". The data type is STRING.

### **YAxisCount property**

#### **YAxisCount**

Defines the number of Y axes configured.

The attribute can be assigned dynamic properties by means of the name **YAxisCount**. The data type is LONG.

### **YAxisIndex property**

#### **YAxisIndex**

References a configured Y axis. Using this attribute you can assign the values of other attributes to a specific Y axis.

Values between 0 and "YAxisCount" minus 1 are valid for "Index". Attribute "YAxisCount" defines the number of configured Y axes.

The "YAxisIndex" attribute can be assigned dynamic properties by means of attribute **YAxisRepos**. The data type is LONG.

## YAxisRename property

### YAxisRename

Renames the Y axis which is referenced by means of "YAxisIndex" attribute.

The attribute can be assigned dynamic properties by means of the name **YAxisRename**. "YAxisRename" also sets a dynamic attribute "YAxisName". The data type is STRING.

## ZeroPoint Property

### Description

Defines or returns the position of the zero point of the bar graph. Specify the value as a %age of the total bar height. The zero point can also be outside of the range represented. The "ScalingType" property must be set to "2" and "Scaling" to TRUE.

### See also

ScreenItem Object (Page 125)

Bar (Page 174)

## ZeroPointValue Property

### Description

Defines the value of the zero point of the scale indicator.

Defines or returns the absolute value for the zero point.

### See also

Bar (Page 174)

3D Bar (Page 169)

ScreenItem Object (Page 125)

## Zoom Property

### Description

Sets the zoom factor within a picture or picture window or reads it out.

If the indicated zoom factor is smaller than the minimum value, the zoom factor is automatically set to the minimum value. If the indicated zoom factor is larger than the minimum value, the zoom factor is automatically set to the maximum value.

The minimum value of the zoom factor is at 2%, the maximum value at 800%.

With the Screen Object the zoom factor is indicated as a numeric value and with a picture window object, it is indicated in percent.

**Example:**

The following example doubles the zoom factor of the current picture:

```
'VBS97
HMIRuntime.ActiveScreen.Zoom = HMIRuntime.ActiveScreen.Zoom * 2
```

**See also**

Picture Window (Page 179)

Screen Object (Page 131)

**1.14.5 Methods**

**1.14.5.1 Methods**

**Overview**

Methods, which are applied to individual objects, can be used to read out tag values for further processing or displaying diagnostics messages in Runtime.

**Available Methods in VBS**

Activate	GetStatusBarElement	MoveToNext	ShowInfoText
ActivateDynamic	GetStatusBarElementCollection	MoveToNextLine	ShowLockDialog
Add	GetTimeAxis	MoveToNextPage	ShowLockList
AttachDB	GetTimeAxisCollection	MoveToPrevious	ShowLongTermArchiveList
CalculateStatistic	GetTimeColumn	MoveToPreviousLine	ShowMessageList
CopyRows	GetTimeColumnCollection	MoveToPreviousPage	ShowPercentageAxis
CreateTagSet	GetToolBarButton	NextColumn	ShowPropertyDialog
CutRows	GetToolBarButtonCollection	NextTrend	ShowSelectArchive
DeactivateDynamic	GetTrend	OneToOneView	ShowSelection
DeleteRows	GetTrendCollection	PasteRows	ShowSelectionDialog
DetachDB	GetTrendWindow	PreviousColumn	ShowSelectTimeBase

Edit	GetTrendWindowCollection	PreviousTrend	ShowShortTermArchiveList
Export	GetValueAxis	Print	ShowSort
GetColumn	GetValueAxisCollection	QuitHorn	ShowSortDialog
GetColumnCollection	GetValueColumn	QuitSelected	ShowTagSelection
GetHitlistColumn	GetValueColumnCollection	QuitVisible	ShowTimebaseDialog
GetHitlistColumnCollection	GetXAxis	Read	ShowTimeSelection
GetMessageBlock	GetXAxisCollection	ReadTags	ShowTrendSelection
GetMessageBlockCollection	GetYAxis	Refresh	StartStopUpdate
GetMessageColumn	GetYAxisCollection	Remove	Stop
GetMessageColumnCollection	HideAlarm	RemoveAll	Trace
GetOperatorMessage	Item Method	Restore	UnhideAlarm
GetOperatorMessageCollection	LockAlarm	SelectedStatisticArea	UnlockAlarm
GetRulerBlock	LoopInAlarm	ServerExport	Write
GetRulerBlockCollection	MoveAxis	ServerImport	WriteTags
GetRulerColumn	MoveRuler (Page 772)	ShowColumnSelection	ZoomArea
GetRulerColumnCollection	MoveToFirst	ShowComment	ZoomInOut
GetRulerData	MoveToFirstLine	ShowDisplayOptionsDialog	ZoomInOutTime
GetStatisticAreaColumn	MoveToFirstPage	ShowEmergencyQuitDialog	ZoomInOutValues
GetStatisticAreaColumnCollection	MoveToLast	ShowHelp	ZoomInOutX
GetStatisticResultColumn	MoveToLastLine	ShowHideList	ZoomInOutY
GetStatisticResultColumnCollection	MoveToLastPage	ShowHitList	ZoomMove

## 1.14.5.2 Methods A to E

### Activate Method

#### Function

Activates the specified picture and picture element, respectively.

---

#### Note

Focus assignments should not be configured during a ButtonDown event. Since the focus is specifically requested during the ButtonDown event, invalid states may occur.

---

#### Syntax

Expression.Activate

#### Expression

Necessary. An expression which returns an object of type "Screen" or "ScreenItem".

#### Parameters

--

#### Examples

The following example shows the use for type "Screen":

```
'VBS98
Dim objScreen
MsgBox HMIRuntime.ActiveScreen.ObjectName      'Output of active screen
Set objScreen = HMIRuntime.Screens("ScreenWindow1")
objScreen.Activate      'Activate "ScreenWindow1"
MsgBox HMIRuntime.ActiveScreen.ObjectName      'New output of active screen
```

The following example shows the use for type "ScreenItem":

```
'VBS158
MsgBox HMIRuntime.ActiveScreen.ActiveScreenItem.ObjectName 'Output of active screen item
HMIRuntime.ActiveScreen.ScreenItems("IOField1").Activate
MsgBox HMIRuntime.ActiveScreen.ActiveScreenItem.ObjectName 'New output of active screen
item
```



**See also**

ScreenItem Object (Page 125)

Screen Object (Page 131)

**ActivateDynamic method****Function**

Dynamically activates a trigger for the defined property and with the defined cycle during runtime. Every time the trigger is activated a different activation cycle can be used.

Examples of this method are available in chapter "VBS for creating procedures and action > Creating and editing actions > Trigger > Animation trigger".

**Syntax**

```
Expression.ActivateDynamic (ByVal bstrPropertyName As String, ByVal
bstrCycleName As String)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

Parameters	Description
bstrPropertyName	Name of property to which trigger relates.
bstrCycleName	Name of activation cycle, e.g. "CycleTime1s".

**See also**

Animation trigger (Page 68)

**Add Method****Description of TagSet Object**

Adds a tag to the list. A tag may be added to the tag object by using name or reference.

**syntax**

```
Expression.Add [Tag]
```

**Expression**

Necessary. An expression which returns an object of type "TagSet".

**Parameters**

VARIANT

Parameters	Description
Tag	Name of a WinCC tag or reference to a tag object to be added to the list.

**Example:**

In the following example, a TagSet object is generated and a tag is added.

```
'VBS170
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
group.Add "Motor1"
```

Tag objects may also be added as follows.

```
'VBS171
Dim Tag
Set Tag = HMIRuntime.Tags("Motor2")
Dim group2
Set group2 = HMIRuntime.Tags.CreateTagSet
group2.Add Tag
```

**Description of DataSet Object**

Adds a value or object reference to the list.

**Note**

The Data Set Object does not support classes. Objects of type Screen, Screens, ScreenItem, ScreenItems, Tag and TagSet cannot be included in the DataSet list.

For object references it must be ascertained that objects are multiread-enabled.

**syntax**

```
Expression.Add [vtName], [vtUserData]
```

**Expression**

Necessary. An expression which returns an object of type "DataSet".

**Parameters**

VARIANT

Parameters	Description
vtName	Name by which value or tag are to be added to list.
vtUserData	Value to be added to list.

**Example:**

In this example, a value is included in the DataSet list.

```
'VBS172
HMIRuntime.DataSet.Add "Motor1",23
```

**See also**

TagSet Object (List) (Page 141)

DataSet Object (List) (Page 116)

**AttachDB method****Function**

Executes the "Connect backup" key function of the control.

**Syntax**

```
Ausdruck.AttachDB()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## CalculateStatistic method

### Function

Executes the "Calculate statistics" key function of the OnlineTrendControl and OnlineTableControl.

### Syntax

```
Ausdruck.CalculateStatistic()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## CopyRows method

### Function

Executes the "Copy lines" key function of the control.

### Syntax

```
Ausdruck.CopyRows()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Create method

### Function

Creates a new Alarm object.

### Syntax

```
Expression.Create (VARIANT vtApplication)
```

**Expression**

Necessary. An expression which returns an object of type "Alarm".

**Parameters**

VARIANT

Parameters	Description
vtApplication	Name of alarm object (optional)

**See also**

Alarms object (list) (Page 110)

**CreateTagSet Method****Function**

Creates a new TagSet object. This object may be used for optimized multi-tag access.

**syntax**

```
Expression.CreateTagSet()
```

**Expression**

Necessary. An expression which returns an object of type "TagSet".

**Parameters**

VARIANT

**Example:**

The following example shows how to create a TagSet object.

```
'VBS168  
'Build a Reference to the TagSet Object  
Dim group  
Set group = HMIRuntime.Tags.CreateTagSet
```

## See also

TagSet Object (List) (Page 141)

Tags Object (List) (Page 140)

## CutRows method

### Function

Executes the "Cut lines" key function of the UserArchiveControl.

### Syntax

```
Ausdruck.CutRows ( )
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## DeactivateDynamic method

### Function

Deactivates the trigger used with the "ActivateDynamic" method for the defined property during runtime.

### Syntax

```
Ausdruck.DeactivateDynamic (ByVal bstrPropertyName As String)
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

String

Parameters	Description
bstrPropertyName	Name of property to which trigger relates.

## DeleteRows method

### Function

Executes the "Delete Rows" key function of the UserArchiveControl.

### Syntax

```
Ausdruck.DeleteRows()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## DetachDB method

### Function

Executes the "Disconnect backup" key function of the control.

### Syntax

```
Ausdruck.DetachDB()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Edit method

### Function

Executes the "Edit" key function of the OnlineTableControl.

### Syntax

```
Ausdruck.Edit()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**Export Method**

**Function**

Executes the "Export archive" or "Export data" key function of the control.

**Syntax**

```
Ausdruck.Export ()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

**1.14.5.3 Get methods**

**GetColumn method**

**Function**

Returns the name or index designated column object of the WinCC UserArchiveControl as type "ICCAxUAColumn".

**Syntax**

```
Ausdruck.GetColumn (ByVal vIndex As Variant)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.



## Parameters

VARIANT

Parameters	Description
vIndex	Index or name of column of UserArchiveControl.

## Example

```
'VBS312
Dim ctrl
Dim objColumn
Set ctrl = ScreenItems("UAControl")
Set objColumn = ctrl.GetColumn("Field1")
objColumn.Length = 30
Set objColumn = ctrl.GetColumn(3)
objColumn.Align = 2
```

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "Column" listing, for example, you write "objColumn.Align" instead of "objColumn.ColumnAlign".

## See also

Column object (list) (Page 221)

## GetColumnCollection method

### Function

Returns the list of all column objects of the WinCC UserArchiveControl as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetColumnCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS313
Dim ctrl
Dim coll
Dim field
Set ctrl = ScreenItems("UAControl")
Set coll = ctrl.GetColumnCollection
HMIRuntime.Trace "Number of fields:" & coll.Count & vbCrLf
For Each field In coll
  HMIRuntime.Trace field.Name & vbCrLf
  HMIRuntime.Trace field.Type & vbCrLf
  HMIRuntime.Trace field.Length & vbCrLf
  HMIRuntime.Trace field.Caption & vbCrLf
Next
```

## See also

[Column object \(list\) \(Page 221\)](#)

## GetHitlistColumn method

### Function

Returns the name or index designated column object of the hitlist of the WinCC AlarmControl as type "ICCAxMessageColumn".

### Syntax

```
Expression.GetHitlistColumn(ByVal vIndex As Variant)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

Parameters	Description
vIndex	Index or name of hitlist column

**Example**

```
'VBS314
Dim ctrl
Dim objHitlistColumn
Set ctrl = ScreenItems("AlarmControl")
Set objHitlistColumn = ctrl.GetHitlistColumn("Date")
objHitlistColumn.Sort = 2
Set objHitlistColumn = ctrl.GetHitlistColumn("AverageComeGo")
objHitlistColumn.Visible = FALSE
```

**Note**

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "HitlistColumn" listing, for example, you write "objHitlistColumn.Visible" instead of "objHitlistColumn.HitlistColumnVisible".

**See also**

HitlistColumn object (list) (Page 222)

**GetHitlistColumnCollection method****Function**

Returns the list of all column objects of the WinCC AlarmControl hitlist as type "ICCAxCollection".

**Syntax**

```
Expression.GetHitlistColumnCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

### Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

### Example

```
'VBS315
Dim ctrl
Dim coll
Dim hitlistcol
Set ctrl = ScreenItems("AlarmControl")
Set coll = ctrl.GetHitlistColumnCollection
HMIRuntime.Trace "Number of hitlist columns:" & coll.Count & vbCrLf
For Each hitlistcol In coll
  HMIRuntime.Trace hitlistcol.Index & vbCrLf
  HMIRuntime.Trace hitlistcol.Name & vbCrLf
  HMIRuntime.Trace hitlistcol.Sort & vbCrLf
  HMIRuntime.Trace hitlistcol.SortIndex & vbCrLf
Next
```

### See also

[HitlistColumn object \(list\) \(Page 222\)](#)

### GetMessageBlock method

### Function

Returns the name or index designated message block object of the WinCC AlarmControl as type "ICCAxMessageBlock".

## Syntax

```
Expression.GetMessageBlock(ByVal vIndex As Variant)
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

VARIANT

Parameters	Description
vIndex	Index or name of message block.

## Example

```
'VBS316
Dim ctrl
Dim objMsgBlock
Set ctrl = ScreenItems("AlarmControl")
Set objMsgBlock = ctrl.GetMessageBlock("Date")
objMsgBlock.Align = 2
Set objMsgBlock = ctrl.GetMessageBlock("Number")
objMsgBlock.LeadingZeros = 4
```

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "MessageBlock" listing, for example, you write "objMsgBlock.Align" instead of "objMsgBlock.MessageBlockAlign".

## See also

MessageBlock object (list) (Page 223)

## GetMessageBlockCollection method

## Function

Returns the list of all message block objects of the WinCC AlarmControl as type "ICCAxCollection".

## Syntax

```
Expression.GetMessageBlockCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS317
Dim ctrl
Dim coll
Dim msgblock
Set ctrl = ScreenItems("AlarmControl")
Set coll = ctrl.GetMessageBlockCollection
For Each msgblock In coll
  msgblock.Align = 1
  msgblock.Length = 12
  msgblock.Selected = TRUE
Next
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "MessageBlock" listing, for example, you write "msgblock.Align" instead of "msgblock.MessageBlockAlign".

---

## See also

MessageBlock object (list) (Page 223)

## GetMessageColumn method

### Function

Returns the name or index designated column object of the WinCC AlarmControl as type "ICCAxMessageColumn".

### Syntax

```
Expression.GetMessageColumn(ByVal vIndex As Variant)
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

VARIANT

Parameters	Description
vIndex	Index or name of column in message list.

### Example

```
'VBS318
Dim ctrl
Dim objMessColumn
Set ctrl = ScreenItems("AlarmControl")
Set objMessColumn = ctrl.GetMessageColumn("Date")
objMessColumn.Visible = FALSE
Set objMessColumn = ctrl.GetMessageColumn("Number")
objMessColumn.Sort = 1
```

---

#### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "MessageColumn" listing, for example, you write "objMessColumn.Visible" instead of "objMessColumn.MessageColumnVisible".

---

### See also

MessageColumn object (list) (Page 223)

## GetMessageColumnCollection method

### Function

Returns the list of all column objects of the WinCC AlarmControl as type "ICCAxCollection".

### Syntax

```
Expression.GetMessageColumnCollection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS319
Dim ctrl
Dim coll
Dim msgcol
Set ctrl = ScreenItems("AlarmControl")
Set coll = ctrl.GetMessageColumnCollection
HMIRuntime.Trace "Number of message columns:" & coll.Count & vbCrLf
For Each msgcol In coll
  HMIRuntime.Trace msgcol.Index & vbCrLf
  HMIRuntime.Trace msgcol.Name & vbCrLf
  HMIRuntime.Trace msgcol.Sort & vbCrLf
  HMIRuntime.Trace msgcol.SortIndex & vbCrLf
Next
```



**See also**

MessageColumn object (list) (Page 223)

**GetOperatorMessage method****Function**

Returns the name or index designated operator message object of the WinCC AlarmControl as type "ICCAxOperatorMessage".

**Syntax**

```
Expression.GetOperatorMessage(ByVal vIndex As Variant)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

Parameters	Description
vIndex	Index or name of operator message

**Example**

```
'VBS320
Dim ctrl
Dim objOpMess
Set ctrl = ScreenItems("AlarmControl")
Set objOpMess = ctrl.GetOperatorMessage(0)
objOpMess.Source1 = "Number"
objOpMess.SourceType1 = 1
```

**Note**

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "OperatorMessage" listing, for example, you write "objOpMess.Source1" instead of "objOpMess.OperatorMessageSource1".

## See also

OperatorMessage object (list) (Page 224)

## GetOperatorMessageCollection method

### Function

Returns the list of all operator message objects of the WinCC AlarmControl as type "ICCAxCollection".

### Syntax

```
Expression.GetOperatorMessageCollection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS321
Dim ctrl
Dim coll
Dim opmsg
Set ctrl = ScreenItems("AlarmControl")
Set coll = ctrl.GetOperatorMessageCollection
For Each opmsg In coll
  HMIRuntime.Trace opmsg.Index & vbCrLf
  HMIRuntime.Trace opmsg.Name & vbCrLf
  HMIRuntime.Trace opmsg.Number & vbCrLf
  HMIRuntime.Trace opmsg.Selected & vbCrLf
Next
```

**See also**

OperatorMessage object (list) (Page 224)

**GetRow method****Function**

Returns the row number designated row object of the table-based controls as type "ICCAxDataRow".

**Syntax**

```
Expression.GetRow(ByVal IRow As Long)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

Long

Parameters	Description
IRow	Number of the desired line of the control.

**Example**

```
'VBS356
Dim ctrl
Dim lIndex
Dim lCellIndex
Set ctrl = ScreenItems("UAControl")
Set coll = ctrl.GetRowCollection
'enumerate and trace out row numbers
For lIndex = 1 To coll.Count
  HMIRuntime.trace "Row: " & (ctrl.GetRow(lIndex).RowNumber) & " "
  'enumerate and trace out column titles and cell texts
  For lCellIndex = 1 To ctrl.GetRow(lIndex).CellCount
    HMIRuntime.Trace ctrl.GetRow(0).CellText(lCellIndex) & " "
    HMIRuntime.trace ctrl.GetRow(lIndex).CellText(lCellIndex) & " "
  Next
  HMIRuntime.trace vbNewLine
Next
```

---

**Note**

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "Row" listing, for example, you write "objRow.CellCount" instead of "objRow.RowCellCount".

---

**See also**

Row object (list) (Page 225)

**GetRowCollection method**

**Function**

Returns the list of all row objects of the table-based controls type "ICCAxDataRowCollection".

**Syntax**

```
Expression.GetRowCollection()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**Properties of the ICCAxDataRowCollection**

The ICCAxDataRowCollection refers to runtime data. The data is read-only. It is not possible to add and edit the data.

The following properties are available for the ICCAxDataRowCollection:

- Count - Determines the number of rows in the collection.
- Item - Access to an individual row within the collection via the row number. Numbering runs from 1 to Count. A Row object is returned.

## Example

```
'VBS357
Dim ctrl
Dim coll
Dim lIndex
Dim lCellIndex
Set ctrl = ScreenItems("AlarmControl")
Set coll = ctrl.GetRowCollection
HMIRuntime.Trace "Number of message rows:" & coll.Count & vbCrLf
'enumerate and trace out row numbers
For lIndex = 1 To coll.Count
HMIRuntime.Trace "Row: " & (ctrl.GetRow(lIndex).RowNumber) & " "
'enumerate and trace out column titles and cell texts
For lCellIndex = 1 To ctrl.GetRow(lIndex).CellCount
HMIRuntime.Trace ctrl.GetMessageColumn(lCellIndex -1).Name & " "
HMIRuntime.Trace ctrl.GetRow(lIndex).CellText(lCellIndex) & " "
Next
HMIRuntime.Trace vbNewLine
Next
```

## See also

Row object (list) (Page 225)

## GetRulerBlock method

### Function

Returns the Block object designated as name or index of the WinCC RulerControl as type "ICCAxRulerBlock".

### Syntax

```
Expression.GetRulerBlock(ByVal vIndex As Variant)
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

VARIANT

Parameters	Description
vIndex	Index or name of block in RulerControl

## Example

```
'VBS322
Dim ctrl
Dim objRulerBlock
Set ctrl = ScreenItems("RulerControl")
Set objRulerBlock = ctrl.GetRulerBlock(0)
objRulerBlock.Caption = "RulerBlock1"
Set objRulerBlock = ctrl.GetRulerBlock("Name")
objRulerBlock.Length = 10
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "RulerBlock" listing, for example, you write "objRulerBlock.Caption" instead of "objRulerBlock.BlockCaption".

---

## See also

RulerBlock object (list) (Page 226)

## GetRulerBlockCollection method

### Function

Returns the list of all Block objects of the WinCC RulerControl as type "ICCAxCollection".

### Syntax

```
Expression.GetRulerBlockCollection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS323
Dim ctrl
Dim coll
Dim rulerblock
Set ctrl = ScreenItems("RulerControl")
Set coll = ctrl.GetRulerBlockCollection
For Each rulerblock In coll
  rulerblock.Align = 1
  rulerblock.Length = 12
Next
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "RulerBlock" listing, for example, you write "rulerblock.Align" instead of "rulerblock.RulerBlockAlign".

---

## See also

RulerBlock object (list) (Page 226)

## GetRulerColumn method

### Function

Returns the Column object designated as name or index of the WinCC RulerControl as type "ICCAxRulerColumn".

### Syntax

```
Expression.GetRulerColumn(ByVal vIndex As Variant)
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

VARIANT

Parameters	Description
vIndex	Index or name of column of RulerControl.

## Example

```
'VBS324
Dim ctrl
Dim objRulercol
Set ctrl = ScreenItems("RulerControl")
Set objRulercol = ctrl.GetRulerColumn("Name")
objRulercol.Sort = 0
Set objRulercol = ctrl.GetRulerColumn("ValueY")
objRulercol.Visible = FALSE
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "RulerColumn" listing, for example, you write "objRulercol.Visible" instead of "objRulercol.ColumnVisible".

---

## See also

RulerColumn object (list) (Page 227)

## GetRulerColumnCollection method

### Function

Returns the list of all Column objects of the WinCC RulerControl as type "ICCAxCollection".

### Syntax

```
Expression.GetRulerColumnCollection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--



## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS325
Dim ctrl
Dim coll
Dim rulercol
Set ctrl = ScreenItems("RulerControl")
Set coll = ctrl.GetRulerColumnCollection
HMIRuntime.Trace "Number of ruler columns:" & coll.Count & vbCrLf
For Each rulercol In coll
  HMIRuntime.Trace rulercol.Index & vbCrLf
  HMIRuntime.Trace rulercol.Name & vbCrLf
  HMIRuntime.Trace rulercol.Sort & vbCrLf
  HMIRuntime.Trace rulercol.SortIndex & vbCrLf
Next
```

## See also

RulerColumn object (list) (Page 227)

## GetRulerData method

## Function

Returns the value of the called trend at the ruler position.

## Syntax

```
Expression.GetRulerData (ByVal RulerIndex As Long, pvValue As Variant, Optional pvTimeStamp As Variant, Optional pvFlags As Varian) Long
```

### Expression

Necessary. An expression which returns an object of the "Trend" type.

## Parameters

Parameters	Description
RulerIndex	0 =Ruler
pvValue	Value of X axis
pvTimeStamp	Time or value of the Y axis
pvFlags	Qualitycode

## Example

```
'VBS326
Dim ctrl
Dim objTrend
Dim objIOField1
Dim objIOField2
    Dim value
Dim time
Set ctrl = ScreenItems( "Controll1" )
Set objTrend = ctrl.GetTrend( "Trend 1" )
Set objIOField1 = ScreenItems( "I/O Field1" )
Set objIOField2 = ScreenItems( "I/O Field2" )
objTrend.GetRulerData 0, value, time
objIOField1.OutputValue = value
objIOField2.OutputValue = time
```

## GetSelectedRow method

### Function

Returns the selected row object of the table-based controls as type "ICCAxDataRow".

### Syntax

```
Expression.GetSelectedRow()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Example

```
'VBS358
Dim ctrl
Dim lCellIndex
Dim lCellCount
Dim headingRow
Dim selectedRow
Set ctrl = ScreenItems("TableControl")
Set headingRow = ctrl.GetRow(0)
Set selectedRow = ctrl.GetSelectedRow
lCellCount = headingRow.CellCount
'enumerate and trace out column titles and cell texts
For lCellIndex = 1 To lCellCount
  HMIRuntime.trace headingRow.CellText(lCellIndex) & ":  "
  HMIRuntime.trace selectedRow.CellText(lCellIndex)
  HMIRuntime.trace vbNewLine
Next
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "Row" listing, for example, you write "objRow.CellCount" instead of "objRow.RowCellCount".

---

## See also

Row object (list) (Page 225)

## GetSelectedRows method

### Function

Returns the selected row objects of the table-based controls as type "ICCAxDataRow" for multiple selection.

### Syntax

```
Expression.GetSelectedRows ()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## Example

```
'VBS359
Dim ctrl
Dim lCellIndex
Dim lCellCount
Dim lRowIndex
Dim lRowCount
Dim headingRow
Dim selectedRow
Dim selectedRows
Set ctrl = ScreenItems("TableControl")
Set headingRow = ctrl.GetRow(0)
Set selectedRows = ctrl.GetSelectedRows
lCellCount = headingRow.CellCount
lRowCount = selectedRows.Count
'enumerate selected rows
For lRowIndex = 1 To lRowCount
  Set selectedRow = selectedRows(lRowIndex)
  HMIRuntime.Trace "Row number: " & CStr(lRowIndex) & vbNewLine
  'enumerate and trace out column titles and cell texts
  For lCellIndex = 1 To lCellCount
    HMIRuntime.trace headingRow.CellText(lCellIndex) & ": "
    HMIRuntime.trace selectedRow.CellText(lCellIndex)
    HMIRuntime.trace vbNewLine
  Next
Next
Next
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "Row" listing, for example, you write "objRow.CellCount" instead of "objRow.RowCellCount".

---

## See also

Row object (list) (Page 225)

## GetStatisticAreaColumn method

### Function

Returns the name or index designated Column object of the WinCC RulerControl statistics area window as type "ICCAxRulerColumn".

### Syntax

```
Ausdruck.GetStatisticAreaColumn(ByVal vIndex As Variant)
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

VARIANT

Parameters	Description
vIndex	Index or name of column of statistics area window.

### Example

```
'VBS327
Dim ctrl
Dim objStatAreaCol
Set ctrl = ScreenItems("RulerControl")
Set objStatAreaCol = ctrl.GetStatisticAreaColumn("DatasourceY")
objStatAreaCol.Visible = FALSE
Set objStatAreaCol = ctrl.GetStatisticAreaColumn("ValueY(LL) ")
objStatAreaCol.Sort = 1
```

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "StatisticAreaColumn" listing, for example, you write "objStatAreaCol.Visible" instead of "objStatAreaCol.ColumnVisible".

### See also

StatisticAreaColumn object (list) (Page 228)

## GetStatisticAreaColumnCollection method

### Function

Returns the list of all column objects of the WinCC RulerControl statistics area window as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetStatisticAreaColumnCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS328
Dim ctrl
Dim coll
Dim statcol
Set ctrl = ScreenItems("RulerControl")
Set coll = ctrl.GetStatisticAreaColumnCollection
HMIRuntime.Trace "Number of statistic Area columns:" & coll.Count & vbCrLf
For Each statcol In coll
  HMIRuntime.Trace statcol.Index & vbCrLf
  HMIRuntime.Trace statcol.Name & vbCrLf
  HMIRuntime.Trace statcol.Sort & vbCrLf
  HMIRuntime.Trace statcol.SortIndex & vbCrLf
Next
```

**See also**

StatisticAreaColumn object (list) (Page 228)

**GetStatisticResultColumn method****Function**

Returns the name or index designated Column object of the WinCC RulerControl statistics window as type "ICCAxRulerColumn".

**Syntax**

```
Ausdruck.GetStatisticResultColumn(ByVal vIndex As Variant)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

Parameters	Description
vIndex	Index or name of column of statistics window.

**Example**

```
'VBS329
Dim ctrl
Dim objStatResCol
Set ctrl = ScreenItems("RulerControl")
Set objStatResCol = ctrl.GetStatisticResultColumn("MaxValue")
objStatResCol.Visible = FALSE
Set objStatResCol = ctrl.GetStatisticResultColumn("Average")
objStatResCol.Sort = 2
```

**Note**

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "StatisticResultColumn" listing, for example, you write "objStatResCol.Visible" instead of "objStatResCol.ColumnVisible".

**See also**

StatisticResultColumn object (list) (Page 229)

## GetStatisticResultColumnCollection method

### Function

Returns the list of all Column objects of the WinCC RulerControl statistics window as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetStatisticResultColumnCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS330
Dim ctrl
Dim coll
Dim statcol
Set ctrl = ScreenItems("RulerControl")
Set coll = ctrl.GetStatisticResultColumnCollection
HMIRuntime.Trace "Number of statistic result columns:" & coll.Count & vbCrLf
For Each statcol In coll
  HMIRuntime.Trace statcol.Index & vbCrLf
  HMIRuntime.Trace statcol.Name & vbCrLf
  HMIRuntime.Trace statcol.Sort & vbCrLf
  HMIRuntime.Trace statcol.SortIndex & vbCrLf
Next
```



**See also**

StatisticResultColumn object (list) (Page 229)

**GetStatusBarElement method****Function**

Returns the element of the control status bar designated as name or index as type "ICCAxStatusBarElement".

**Syntax**

```
Ausdruck.GetStatusBarElement(ByVal vIndex As Variant)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

Parameters	Description
vIndex	Index or name of status bar element.

**Example**

```
'VBS331
Dim ctrl
Dim objStatusBar
Set ctrl = ScreenItems( "Control1" )
Set objStatusBar = ctrl.GetStatusBarElement(1)
objStatusBar.Visible = FALSE
Set objStatusBar = ctrl.GetStatusBarElement(3)
objStatusBar.Width = 10
```

**Note**

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "StatusBarElement" listing, for example, you write "objStatusBar.Visible" instead of "objStatusBar.StatusbarElementVisible".

## See also

StatusbarElement object (list) (Page 229)

## GetStatusBarElementCollection method

### Function

Returns the list of all status bar elements of the control as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetStatusBarElementCollection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS332
Dim ctrl
Dim coll
Dim statelement
Set ctrl = ScreenItems.Item("Controll")
Set coll = ctrl.GetStatusBarElementCollection
HMIRuntime.Trace "Number of statusbar elements:" & coll.Count & vbCrLf
For Each statelement In coll
  HMIRuntime.Trace statelement.Name & vbCrLf
  HMIRuntime.Trace statelement.Width & vbCrLf
  HMIRuntime.Trace statelement.Text & vbCrLf
Next
```

**Note**

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "StatusBarElement" listing, for example, you write "statelement.Name" instead of "statelement.StatusbarElementName".

**See also**

StatusbarElement object (list) (Page 229)

**GetTimeAxis method****Function**

Returns the time axis object designated as name or index of the WinCC OnlineTrendControl as type "ICCAxTimeAxis".

**Syntax**

```
Ausdruck.GetTimeAxis(ByVal vIndex As Variant)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

Parameters	Description
vIndex	Index or name of time axis.

## Example

```
'VBS333
Dim ctrl
Dim objTimeAxis
Set ctrl = ScreenItems("OnlineTrendControl")
Set objTimeAxis = ctrl.GetTimeAxis(1)
objTimeAxis.Visible = FALSE
Set objTimeAxis = ctrl.GetTimeAxis("axis 2")
objTimeAxis.Label = "Time axis 2"
objTimeAxis.DateFormat = "dd.MM.yy"
objTimeAxis.TimeFormat = "HH:mm:ss.ms"
objTimeAxis.RangeType = 2
objTimeAxis.BeginTime = "06.04.2010 9:33:18"
objTimeAxis.MeasurePoints = 100
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "TimeAxis" listing, for example, you write "objTimeAx.Visible" instead of "objTimeAx.TimeAxisVisible".

---

## See also

[TimeAxis object \(list\) \(Page 230\)](#)

## GetTimeAxisCollection method

### Function

Returns the list of all time axis objects of the WinCC OnlineTrendControl as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetTimeAxisCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS334
Dim ctrl
Dim objTrendWnd
Dim objTimeAxis1
Dim objTimeAxis2
Dim objTrend
Set ctrl = ScreenItems("OnlineTrendControl")
Set objTrendWnd = ctrl.GetTrendWindowCollection.AddItem("myWindow")
Set objTimeAxis1 = ctrl.GetTimeAxisCollection.AddItem("TimeAxis2010")
Set objTimeAxis2 = ctrl.GetTimeAxisCollection.AddItem("TimeAxis2011")
objTimeAxis1.TrendWindow = objTrendWnd.Name
objTimeAxis1.Label = "2010"
objTimeAxis1.RangeType = 1
objTimeAxis1.BeginTime = "01.01.2010 0:00:00"
objTimeAxis1.EndTime = "31.12.2010 11:59:59"
objTimeAxis2.TrendWindow = objTrendWnd.Name
objTimeAxis2.Label = "2011"
objTimeAxis2.RangeType = 1
objTimeAxis2.BeginTime = "01.01.2011 0:00:00"
objTimeAxis2.EndTime = "31.12.2011 11:59:59"
Set objTrend = ctrl.GetTrendCollection.AddItem("myTrend1")
objTrend.TrendWindow = objTrendWnd.Name
objTrend.TimeAxis = objTimeAxis1.Name
Set objTrend = ctrl.GetTrendCollection.AddItem("myTrend2")
objTrend.TrendWindow = objTrendWnd.Name
objTrend.TimeAxis = objTimeAxis2.Name
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "TimeAxis" listing, for example, you write "objTimeAxis1.Label" instead of "objTimeAxis1.TimeAxisLabel".

---

## See also

TimeAxis object (list) (Page 230)

## GetTimeColumn method

### Function

Returns the time column object designated as name or index of the WinCC OnlineTableControl as type "ICCAxTimeColumn".

### Syntax

```
Ausdruck.GetTimeColumn(ByVal vIndex As Variant)
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

VARIANT

Parameters	Description
vIndex	Index or name of time column.

### Example

```
'VBS335  
Dim ctrl  
Dim objTimeCol  
Set ctrl = ScreenItems("TableControl")  
Set objTimeCol = ctrl.GetTimeColumn("Timecolumn1")  
objTimeCol.ShowDate = FALSE  
Set objTimeCol = ctrl.GetTimeColumn("Timecolumn2")  
objTimeCol.Visible = FALSE
```

---

#### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "TimeColumn" listing, for example, you write "objTimeColumn.ShowDate" instead of "objTimeColumn.TimeColumnShowDate".

---

## See also

TimeColumn object (list) (Page 231)

## GetTimeColumnCollection method

### Function

Returns the list of all time column objects of the WinCC OnlineTableControl as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetTimeColumnCollection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS336
Dim ctrl
Dim objTimeCol1
Dim objTimeCol2
Dim coll
Dim timecol
Set ctrl = ScreenItems("TableControl")
Set objTimeCol1 = ctrl.GetTimeColumnCollection.AddItem("TimeColumn2010")
Set objTimeCol2 = ctrl.GetTimeColumnCollection.AddItem("TimeColumn2011")
objTimeCol1.Caption = "2010"
objTimeCol1.RangeType = 1
objTimeCol1.BeginTime = "01.01.2010 0:00:00"
objTimeCol1.EndTime = "31.12.2010 11:59:59"
objTimeCol2.Caption = "2011"
objTimeCol2.RangeType = 0
objTimeCol2.BeginTime = "01.01.2011 0:00:00"
objTimeCol2.TimeRangeFactor = 1
objTimeCol2.TimeRangeBase = 3600000
Set coll = ctrl.GetTimeColumnCollection
For Each timecol In coll
    timecol.Align = 1
    timecol.Length = 12
    timecol.BackColor = RGB(240,240,0)
    timecol.ForeColor = RGB(130,160,255)
Next
```

## See also

[TimeColumn object \(list\) \(Page 231\)](#)

## GetToolBarButton method

### Function

Returns the name or index designated toolbar button function of the control as type "ICCAxToolBarButton".

### Syntax

```
Ausdruck.GetToolBarButton(ByVal vIndex As Variant)
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.



## Parameters

VARIANT

Parameters	Description
vIndex	Index or name of toolbar button function.

## Example

```
'VBS337
Dim ctrl
Set ctrl = ScreenItems( "Control1" )
Dim toolbu
Set toolbu = ctrl.GetToolBarButton ("ShowHelp")
HMIRuntime.Trace "Name: " & toolbu.Name & vbCrLf
HMIRuntime.Trace "Index: " & toolbu.Index & vbCrLf
HMIRuntime.Trace "Hotkey: " & toolbu.HotKey & vbCrLf
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "ToolBarButton" listing, for example, you write "toolbu.Index" instead of "toolbu.ToolBarButtonIndex".

---

## See also

ToolBarButton object (list) (Page 232)

## GetToolBarButtonCollection method

### Function

Returns the list of all toolbar button functions of the control as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetToolBarButtonCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following methods are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS338
Dim ctrl
Dim coll
Dim toolbu
Set ctrl = ScreenItems( "Controll" )
Set coll = ctrl.GetToolBarButtonCollection
HMIRuntime.Trace "Number of toolbar buttons:" & coll.Count & vbCrLf
For Each toolbu In coll
  HMIRuntime.Trace toolbu.Name & vbCrLf
  HMIRuntime.Trace "Hotkey: " & toolbu.HotKey & vbCrLf
  HMIRuntime.Trace "Authorization: " & toolbu.PasswordLevel & vbCrLf
Next
```

## See also

ToolBarButton object (list) (Page 232)

## GetTrend method

## Function

Returns the trend object designated as name or index of the WinCC OnlineTrendControl or WinCC FunctionTrendControl as type "ICCAxTrend" or "ICCAxFunctionTrend".

## Syntax

```
Ausdruck.GetTrend(ByVal vIndex As Variant)
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

VARIANT

Parameters	Description
vIndex	Index or name of curve.

## Example

```
'VBS339
Dim ctrl
Dim objTrend
Set ctrl = ScreenItems("OnlineTrendControl")
Set objTrend = ctrl.GetTrend( "Trend 1" )
objTrend.PointStyle = 1
objTrend.LineWidth = 4
Set objTrend = ctrl.GetTrend(2)
objTrend.Provider = 1
objTrend.TagName = "Archive\ArchiveTag2"
```

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "Trend" listing, for example, you write "objTrend.PointStyle" instead of "objTrend.TrendPointStyle".

## See also

Trend object (list) (Page 233)

## GetTrendCollection method

### Function

Returns the list of all trend objects of the WinCC OnlineTrendControl or WinCC FunctionTrendControl as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetTrendCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS340
Dim ctrl
Dim objTrendWnd
Dim objTimeAxis
Dim objValAxis
Dim objTrend
Set ctrl = ScreenItems("OnlineTrendControl")
Set objTrendWnd = ctrl.GetTrendWindowCollection.AddItem("myWindow")
Set objTimeAxis = ctrl.GetTimeAxisCollection.AddItem("myTimeAxis")
Set objValAxis = ctrl.GetValueAxisCollection.AddItem("myValueAxis")
objTimeAxis.TrendWindow = objTrendWnd.Name
objValAxis.TrendWindow = objTrendWnd.Name
Set objTrend = ctrl.GetTrendCollection.AddItem("myTrend1")
objTrend.Provider = 1
objTrend.TagName = "Archive\ArchiveTag1"
objTrend.TrendWindow = objTrendWnd.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValAxis.Name
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "Trend" listing, for example, you write "objTrend.TagName" instead of "objTrend.TrendTagName".

---

## See also

Trend object (list) (Page 233)

## GetTrendWindow method

### Function

Returns the trend window object designated as name or index of the WinCC OnlineTrendControl or WinCC FunctionTrendControl as type "ICCAxTrendWindow".

### Syntax

```
Ausdruck.GetTrendWindow(ByVal vIndex As Variant)
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

VARIANT

Parameters	Description
vIndex	Index or name of curve window.

### Example

```
'VBS341
Dim ctrl
Dim objTrendWnd
Set ctrl = ScreenItems("OnlineTrendControl")
Set objTrendWnd = ctrl.GetTrendWindow(1)
objTrendWnd.Visible = FALSE
Set objTrendWnd = ctrl.GetTrendWindow("trend window 2")
objTrendWnd.VerticalGrid = TRUE
objTrendWnd.FineGrid = TRUE
```

---

#### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "TrendWindow" listing, for example, you write "objTrendWnd.Visible" instead of "objTrendWnd.TrendWindowVisible".

---

### See also

TrendWindow object (list) (Page 234)

## GetTrendWindowCollection method

### Function

Returns the list of all trend window objects of the WinCC OnlineTrendControl or WinCC FunctionTrendControl as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetTrendWindowCollection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS342
Dim ctrl
Dim objTrendWnd
Dim objTimeAxis
Dim objValAxis
Set ctrl = ScreenItems("OnlineTrendControl")
Set objTrendWnd = ctrl.GetTrendWindowCollection.AddItem("myWindow")
Set objTimeAxis = ctrl.GetTimeAxisCollection.AddItem("myTimeAxis")
Set objValAxis = ctrl.GetValueAxisCollection.AddItem("myValueAxis")
objTimeAxis.TrendWindow = objTrendWnd.Name
objValAxis.TrendWindow = objTrendWnd.Name
```

## See also

TrendWindow object (list) (Page 234)

## GetValueAxis method

### Function

Returns the value axis object designated as name or index of the WinCC OnlineTrendControl as type "ICCAxValueAxis".

### Syntax

```
Ausdruck.GetValueAxis(ByVal vIndex As Variant)
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

VARIANT

Parameters	Description
vIndex	Index or name of value axis.

### Example

```
'VBS343
Dim ctrl
Dim objValAxis
Set ctrl = ScreenItems("OnlineTrendControl")
Set objValAxis = ctrl.GetValueAxis(1)
objValAxis.Visible = FALSE
Set objValAxis = ctrl.GetValueAxis("axis 2")
objValAxis.Label = "Value axis 2"
objValAxis.ScalingType = 0
objValAxis.Precisions = 2
objValAxis.AutoRange = TRUE
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "ValueAxis" listing, for example, you write "objValueAx.Visible" instead of "objValueAx.ValueAxisVisible".

---

### See also

ValueAxis object (list) (Page 235)

## GetValueAxisCollection method

### Function

Returns the list of all value axis objects of the WinCC OnlineTrendControl as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetValueAxisCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)



## Example

```
'VBS344
Dim ctrl
Dim objTrendWnd
Dim objValAxis1
Dim objValAxis2
Dim objTrend
Set ctrl = ScreenItems("OnlineTrendControl")
Set objTrendWnd = ctrl.GetTrendWindowCollection.AddItem("myWindow")
Set objValAxis1 = ctrl.GetValueAxisCollection.AddItem("myValueAxis1")
Set objValAxis2 = ctrl.GetValueAxisCollection.AddItem("myValueAxis2")
objValAxis1.TrendWindow = objTrendWnd.Name
objValAxis1.Label = "Value1"
objValAxis2.TrendWindow = objTrendWnd.Name
objValAxis2.inTrendColor = TRUE
Set objTrend = ctrl.GetTrendCollection.AddItem("myTrend1")
objTrend.TrendWindow = objTrendWnd.Name
objTrend.ValueAxis = objValAxis1.Name
Set objTrend = ctrl.GetTrendCollection.AddItem("myTrend2")
objTrend.TrendWindow = objTrendWnd.Name
objTrend.ValueAxis = objValAxis2.Name
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "ValueAxis" listing, for example, you write "objValueAxis1.Label" instead of "objValueAxis1.ValueAxisLabel".

---

## See also

ValueAxis object (list) (Page 235)

## GetValueColumn method

### Function

Returns the column object designated as name or index of the WinCC OnlineTableControl as type "ICCAxValueColumn".

### Syntax

```
Ausdruck.GetValueColumn(ByVal vIndex As Variant)
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

VARIANT

Parameters	Description
vIndex	Index or name of value column of OnlineTableControl.

## Example

```
'VBS345
Dim ctrl
Dim objValueColumn
Set ctrl = ScreenItems("TableControl")
Set objValueColumn = ctrl.GetValueColumn("ValueColumn1")
objValueColumn.Precisions = 4
Set objValueColumn = ctrl.GetValueColumn(2)
objValueColumn.ExponentialFormat = TRUE
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "ValueColumn" listing, for example, you write "objValueColumn.Precisions" instead of "objValueColumn.ValueColumnPrecisions".

---

## See also

ValueColumn object (list) (Page 236)

## GetValueColumnCollection method

### Function

Returns the list of all value column objects of the WinCC OnlineTableControl as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetValueColulmnCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS346
Dim ctrl
Dim objValCol1
Dim objValCol2
Dim coll
Dim valcol
Set ctrl = ScreenItems("TableControl")
Set objValCol1 = ctrl.GetValueColumnCollection.AddItem("ValueColumn1")
Set objValCol2 = ctrl.GetValueColumnCollection.AddItem("ValueColumn2")
objValCol1.Caption = "Value Archive"
objValCol1.Provider = 1
objValCol1.TagName = "ProcessValueArchive\arch1"
objValCol1.TimeColumn = "TimeColumn1"
objValCol2.Caption = "Value Tag"
objValCol2.Provider = 2
objValCol2.TagName = "tagxx"
objValCol2.TimeColumn = "TimeColumn2"
Set coll = ctrl.GetValueColumnCollection
For Each valcol In coll
    valcol.Align = 2
    valcol.Length = 10
    valcol.AutoPrecisions = TRUE
Next
```

## See also

[ValueColumn object \(list\) \(Page 236\)](#)

## GetXAxis method

### Function

Returns the X axis object designated as name or index of the WinCC FunctionTrendControl as type "ICCAxValueAxis".

### Syntax

```
Ausdruck.GetXAxis (ByVal vIndex As Variant)
```

### Expression

Required. An expression that returns an object of the "ScreenItem" type.

### Parameters

VARIANT

Parameters	Description
vIndex	Index or name of X axis.

### Example

```
'VBS347
Dim ctrl
Dim objXAx

Set ctrl = ScreenItems("FunctionTrendControl")
Set objXAx = ctrl.GetXAxis(0)
objXAx.ScalingType = 0

Set objXAx = ctrl.GetXAxis("X axis 1")
objXAx.Label = "X2"
objXAx.Precisions = 2
objXAx.Color = RGB(109,109,109)
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "XAxis" listing, for example, you write "objXAx.Visible" instead of "objXAx.XAxisVisible".

---

### See also

XAxis object (list) (Page 237)

## GetXAxisCollection method

### Function

Returns the list of all X axis objects of the WinCC FunctionTrendControl as type "ICCAxCollection".

### Syntax

```
Ausdruck.GetXAxisCollection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS348
Dim ctrl
Dim objXAxis1
Dim objXAxis2
Dim coll
Dim axes
Set ctrl = ScreenItems("FunctionTrendControl")
Set objXAxis1 = ctrl.GetXAxisCollection.AddItem("myXAxis1")
objXAxis1.Label = "temperature"
Set objXAxis2 = ctrl.GetXAxisCollection.AddItem("myXAxis2")
objXAxis2.Label = "pressure"
Set coll = ctrl.GetXAxisCollection
HMIRuntime.Trace "Number of XAxis:" & coll.Count & vbCrLf
For Each axes In coll
    HMIRuntime.Trace axes.Name & vbCrLf
    HMIRuntime.Trace axes.Label & vbCrLf
Next
```

---

**Note**

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "XAxis" listing, for example, you write "objXAxis1.Label" instead of "objXAxis1.XAxisLabel".

---

**See also**

XAxis object (list) (Page 237)

**GetYAxis method**

**Function**

Returns the Y axis object designated as name or index of the WinCC FunctionTrendControl as type "ICCAxValueAxis".

**Syntax**

```
Ausdruck.GetYAxis (ByVal vIndex As Variant)
```

**Expression**

Required. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

Parameters	Description
vIndex	Index or name of Y axis.

## Example

```
'VBS349
Dim ctrl
Dim objYAx

Set ctrl = ScreenItems("FunctionTrendControl")
Set objYAx = ctrl.GetYAxis(0)
objYAx.Align = 0
objYAx.Precisions = 3

Set objYAx = ctrl.GetYAxis("Y axis 1")
objYAx.Label = "Y1"
Msgbox objYAx.Label
objYAx.EndValue = 90
objYAx.BeginValue = 10
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "YAxis" listing, for example, you write "objYAx.Visible" instead of "objYAx.YAxisVisible".

---

## See also

YAxis object (list) (Page 238)

## GetYAxisCollection method

### Function

Returns the list of all Y axis objects of the WinCC FunctionTrendControl of type "ICCAxCollection".

### Syntax

```
Ausdruck.GetYAxisCollection()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Features and functions of the ICCAxCollection

The following properties are available for the ICCAxCollection:

- Count
- Item

The following functions are available for the ICCAxCollection:

- AddItem(vName) As Object
- RemoveItem(vIndex)

## Example

```
'VBS350
Dim ctrl
Dim objYAxis1
Dim objYAxis2
Dim coll
Dim axes
Set ctrl = ScreenItems("FunctionTrendControl")
Set objYAxis1 = ctrl.GetXAxisCollection.AddItem("myYAxis1")
objYAxis1.Label = "temperature"
Set objYAxis2 = ctrl.GetXAxisCollection.AddItem("myYAxis2")
objYAxis2.Label = "pressure"
Set coll = ctrl.GetYAxisCollection
HMIRuntime.Trace "Number of YAxis:" & coll.Count & vbCrLf
For Each axes In coll
  HMIRuntime.Trace axes.Name & vbCrLf
  HMIRuntime.Trace axes.Label & vbCrLf
Next
```

---

### Note

If you access the properties with the listing object, you do not have to enter the name of the listing.

For the "YAxis" listing, for example, you write "objYAxis1.Label" instead of "objYAxis1.YAxisLabel".

---

## See also

YAxis object (list) (Page 238)



#### 1.14.5.4 Methods H to M

##### HideAlarm method

###### Function

Executes the "Hide messages" key function of the AlarmControl.

###### Syntax

```
Expression.HideAlarm()
```

###### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

###### Parameters

--

##### InsertData method

###### Function

Adds data to the called trend.

###### Syntax

```
Expression.InsertData(dblAxisX As Variant, dblAxisY As Variant)
```

###### Expression

Necessary. An expression which returns an object of the "Trend" type.

###### Parameters

Parameters	Description
dblAxisX	Value of X axis
dblAxisY	Value of Y axis

## Example

```
'VBS300
Dim lngFactor
Dim dblAxisX
Dim dblAxisY
Dim objTrendControl
Dim objTrend
Set objTrendControl = ScreenItems("Control1")
Set objTrend = objTrendControl.GetTrend("Trend 1")
For lngFactor = -100 To 100
    dblAxisX = CDBl(lngFactor * 0.02)
    dblAxisY = CDBl(dblAxisX * dblAxisX + 2 * dblAxisX + 1)
    objTrend.InsertData dblAxisX, dblAxisY
Next
```

## Item Method

### Function

Retrieves an object from a collection and enables access to it via Index.

## Description of Dataltem Object

Access uses the name under which the value was added to the list. Single access using an index is not recommended since the index changes during adding or deleting of values.

### syntax

```
Expression.Item()
```

#### Expression

Necessary. An expression which returns an object of the type "Screens", "Layers" (or "Tags").

---

#### Note

In the case of "Tags", restricted functional scope! The standard methods `get_Count` and `get_NewEnum` are missing so that access via Index nor the counting of all tags is possible.

---

## Parameters

VARIANT

**Example:**

The following example issues the names of all objects contained in the picture "NewPDL1":

```
'VBS99
Dim objScreen
Dim objScrItem
Dim lngIndex
Dim lngAnswer
Dim strName
lngIndex = 1
Set objScreen = HMIRuntime.Screens("NewPDL1")
For lngIndex = 1 To objScreen.ScreenItems.Count
'
'The objects will be indicate by Item()
strName = objScreen.ScreenItems.Item(lngIndex).ObjectName
Set objScrItem = objScreen.ScreenItems(strName)
lngAnswer = MsgBox(objScrItem.ObjectName, vbOKCancel)
If vbCancel = lngAnswer Then Exit For
Next
```

**See also**

[ScreenItems Object \(List\) \(Page 129\)](#)  
[ScreenItem Object \(Page 125\)](#)  
[Tags Object \(List\) \(Page 140\)](#)  
[Alarms object \(list\) \(Page 110\)](#)  
[ProcessValues Object \(List\) \(Page 124\)](#)

**LockAlarm method****Function**

Executes the "Lock Alarm" key function of the AlarmControl.

**Syntax**

```
Expression.LockAlarm()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## LoopInAlarm method

### Function

Executes the "Loop in Alarm" key function of the AlarmControl.

### Syntax

```
Expression.LoopInAlarm()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## MoveAxis method

### Function

Executes the "Move axis" key function of the OnlineTrendControl and FunctionTrendControl.

### Syntax

```
Expression.MoveAxis()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## MoveRuler

### Function

Moves the ruler from a specified reference point by a specified distance.

### Syntax

```
Expression.MoveRuler( RulerIndex As Long, RulerMoveRef As Long,  
MoveDistance As Long, Optional vTrendWindow As Variant )
```

**Expression**

Required. An expression that returns an object of the "ScreenItem" type.

**Parameter**

Parameter	Description
RulerIndex	Specifies the ruler to move: 0 = Ruler 1 = Ruler at the start of the statistics area 2 = Ruler at the end of the statistics area
RulerMoveRef	Specifies the reference point as orientation for the third parameter "MoveDistance": 0 = Time axis start position 1 = Current ruler position 2 = Time axis end position
MoveDistance	Number of pixels by which the ruler is moved away from reference point "RulerMoveRef".
vTrendWindow	Optional parameter for handling several, independent trend windows. Specifies the trend window in which the ruler is moved. The ruler moves in all trend windows if this parameter is not specified.

**Return value**

Function that returns the new ruler position.

**Example**

Table 1-1 Move ruler left by 10 pixels

```
'VBS367
Sub OnClick(ByVal Item)
Dim ctrl
Set ctrl = ScreenItems.Item("Control1")
call ctrl.MoveRuler (0, 1, -10)
End Sub
```

In the example, the ruler is moved by -10 pixels, starting at reference point 1 (current ruler position). The ruler is now positioned 10 pixels away from the left of its original position.

## Example

Table 1-2 Move ruler right by 10 pixels

```
'VBS368
Sub OnClick(ByVal Item)
Dim ctrl
Set ctrl = ScreenItems.Item("Controll")
ctrl.MoveRuler 0, 1, 10
End Sub
```

In the example, the ruler is moved by 10 pixels, starting at reference point 1 (current ruler position). The ruler is now positioned 10 pixels away from the right of its original position.

## Example

Table 1-3 Move ruler to end on opening of the window

```
'VBS369
Sub OnOpen()
Dim ctrl
Set ctrl = ScreenItems.Item("Controll")
ctrl.MoveRuler 0, 2, 0
End Sub
```

In the example, the ruler is moved by 0 pixels, starting at reference point 2 (time axis end position). The ruler is now positioned at the time axis end position.

## Example

Table 1-4 Calculate current ruler position

```
'VBS370
Sub OnClick(ByVal Item)
Dim ctrl
Set ctrl = ScreenItems.Item("Controll")
Dim pos
pos = ctrl.MoveRuler (0, 1, 0)
HmiRuntime.Trace "RulerPosition=" & pos & vbCrLf
End Sub
```

In the example, the ruler is moved by 0 pixels, starting at reference point 1 (current ruler position). The ruler remains in its original position. The ruler position is returned as value.

## MoveToFirst method

### Function

Executes the "First line" key function of the control.

### Syntax

```
Expression.MoveToFirst()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## MoveToFirstLine method

### Function

Executes the "First message" key function of the AlarmControl.

### Syntax

```
Ausdruck.MoveToFirstLine()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## MoveToFirstPage method

### Function

Executes the "First page" key function of the AlarmControl.

### Syntax

```
Ausdruck.MoveToFirstPage()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**MoveToLast method**

**Function**

Executes the "Last data record" key function of the control.

**Syntax**

```
Ausdruck.MoveToLast ()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**MoveToLastLine method**

**Function**

Executes the "Last message" key function of the AlarmControl.

**Syntax**

```
Ausdruck.MoveToLastLine ()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--



## MoveToLastPage method

### Function

Executes the "Last page" key function of the AlarmControl.

### Syntax

```
Ausdruck.MoveToLastPage ()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## MoveToNext method

### Function

Executes the "Next data record" key function of the control.

### Syntax

```
Ausdruck.MoveToNext ()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## MoveToNextLine method

### Function

Executes the "Next message" key function of the AlarmControl.

### Syntax

```
Ausdruck.MoveToNextLine ()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**MoveToNextPage method**

**Function**

Executes the "Next page" key function of the AlarmControl.

**Syntax**

```
Ausdruck.MoveToNextPage()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**MoveToPrevious method**

**Function**

Executes the "Previous data record" key function of the control.

**Syntax**

```
Ausdruck.MoveToPrevious()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## MoveToPreviousLine method

### Function

Executes the "Previous message" key function of the AlarmControl.

### Syntax

```
Ausdruck.MoveToPreviousLine()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## MoveToPreviousPage method

### Function

Executes the "Previous page" key function of the AlarmControl.

### syntax

```
Ausdruck.MoveToPreviousPage()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## 1.14.5.5 Methods N to R

### NextColumn method

### Function

Executes the "Next column" key function of the OnlineTableControl.

## Syntax

```
Ausdruck.NextColumn()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## NextTrend method

## Function

Executes the "Next curve" key function of the OnlineTrendControl and FunctionTrendControl.

## Syntax

```
Ausdruck.NextTrend()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## OneToOneView method

## Function

Executes the "Original view" key function of the OnlineTrendControl and FunctionTrendControl.

## Syntax

```
Ausdruck.OneToOneView()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

VARIANT

## PasteRows method

### Function

Executes the "Paste Rows" key function of the UserArchiveControl.

### Syntax

```
Expression.PasteRows()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## PreviousColumn method

### Function

Executes the "Previous column" key function of the OnlineTableControl.

### Syntax

```
Ausdruck.PreviousColumn()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## PreviousTrend method

### Function

Executes the "Previous curve" key function of the OnlineTrendControl and FunctionTrendControl.

### Syntax

```
Ausdruck.PreviousTrend()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**Print method**

**Function**

Executes the "Print" key function of the control.

**Syntax**

```
Ausdruck.Print()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**QuitHorn method**

**Function**

Executes the "Acknowledge central signaling devices" key function of the AlarmControl.

**Syntax**

```
Ausdruck.QuitHorn()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## QuitSelected method

### Function

Executes the "Single acknowledgment" key function of the AlarmControl.

### Syntax

```
Ausdruck.QuitSelected()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## QuitVisible method

### Function

Executes the "Group acknowledgment" key function of the AlarmControl.

### Syntax

```
Ausdruck.QuitVisible()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Read Method

### Description of Tag Object

Reads out the status of a tag (tag object) shortly after the moment it was called. At the same time, the tag object is provided with the values read. Upon reading a tag, its value, quality code and time stamp are determined. The "LastError" property can be used to determine whether the call was successful.

The "Name", "ServerPrefix" and "TagPrefix" properties are not changed as a result.

If the value of the tag is read successfully, the properties of the tag object are assigned the following values:

Property	Assignment
Value	Tag values
Name	Tag name (unchanged)
QualityCode	Quality level
Timestamp	Current tag time stamp
LastError	0
ErrorDescription	" "

If the value of the tag is not read successfully, the properties of the tag object are assigned the following values:

Property	Allocation
Value	VT_Empty
Name	Tag name (unchanged)
QualityCode	Bad Out of Service
Timestamp	0
LastError	Read operation error codes
ErrorDescription	Error description on LastError

**Note**

A summary of possible Quality Codes may be found in WinCC Information System under key word "Communication" > "Diagnostics" or "Communication" > "Quality Codes".

**syntax**

```
Expression.Read ([Readmode])
```

**Expression**

Necessary. An expression which returns a tag object. The return value of the Read method is the value of the tag read out.

**Parameters**

The optional "Readmode" parameter enables the distinction between two types of reading:

Parameters	Description
0	The tag value is read from the process image (cache). 0 is the default value.
1	The value of a tag is read directly from AS or channel (direct).



If the "Readmode" parameter is omitted, the value is read from the process image by default. The return value of the Read method is the tag value read out as VARIANT.

## Reading From the Process Image

When reading from the process image, the tag is logged on and, from that moment, polled cyclically from the PLC. The login cycle is dependent on the configured trigger. The value is read from the tag image by WinCC. For Close Picture, the tag actions are ended again. The call is characterized by the following:

- The value is read by WinCC from the tag image.
- The call is faster in comparison to direct reading (except with the first call: The first call basically takes longer because the value from the PLC must be read out and logged on.)
- The duration of the call is not dependent on the bus load or AS.

### Behavior in actions with a tag trigger

All of the tags contained in the tag trigger are already known with Open Picture and are registered with the defined monitoring time. Since all tags are requested at once, the best possible optimization can be targeted from the channel. If a tag, contained in the trigger, is requested with Read during an action, the value already exists and is transferred directly to the call. If a tag is requested which is not contained in the trigger, the behavior is the same as with a standard trigger.

### Behavior in actions with a cyclic trigger

tags are registered with half of the cycle time with the first call. For every other call, the value is present.

### Behavior in event-driven actions

The tag is registered in the "upon change" mode with the first call. Process tags that are registered in the "upon change" mode correspond with a cyclic read job with a cycle time of 1s.

If an event (e.g. mouse click) requests a value asynchronously, the tag is transferred to the tag image. The tag is requested cyclically from the AS as of this point in time and therefore increases the basic load. To bypass this increase in the basic load, the value can also be read synchronously. The synchronous call causes a one-off increase in the communication load but the tag is not transferred to the tag image.

## Direct reading

In the case of direct reading, the current value is returned. The tag is not registered cyclically, the value is requested from the AS one time only. Direct reading has the following properties:

- The value is read explicitly from the AS.
- The call takes longer compared to reading from the process image.
- The duration of the call is dependent on the bus load and AS, amongst other things.

**Example:**

**Reading a tag directly from AS or channel**

```
'VBS100
Dim objTag
Dim vntValue
Set objTag = HMIRuntime.Tags("Tagname")
vntValue = objTag.Read(1)      'Read direct
MsgBox vntValue
```

**Reading a tag from the process image**

```
'VBS101
Dim objTag
Dim vntValue
Set objTag = HMIRuntime.Tags("Tagname")
vntValue = objTag.Read      'Read from cache
MsgBox vntValue
```

**Description of TagSet Object**

The TagSet object offers the option of reading several tags in one call.

Functionality here is mostly identical with that of a tag object. In the following, only deviations thereof are described.

**Expression**

Necessary. An expression which returns an object of type "TagSet".

**Reading From the Process Image**

The TagSet object offers the advantage of requesting several tags in one read command. The tags are registered in the process image as a group, improving performance in the process.

**Direct reading**

Since one call may process several read commands, performance is enhanced in comparison to single calls.

**Example:**

The following example shows how tags are included in the TagSet list, how tag values are imported and subsequently read.

```
'VBS174
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
group.Add "Motor1"
group.Add "Motor2"
group.Read
HMIRuntime.Trace "Motor1: " & group("Motor1").Value & vbNewLine
HMIRuntime.Trace "Motor2: " & group("Motor2").Value & vbNewLine
```

If the optional parameter "Readmode" is set to 1, the process tags are not registered but read directly from AS or channel.

```
group.Read 1
```

**See also**

[Example: How to Read Tag Values \(Page 830\)](#)

[Example: Writing tag values \(Page 828\)](#)

[LastError Property \(Page 459\)](#)

[ErrorDescription Property \(Page 411\)](#)

[TagSet Object \(List\) \(Page 141\)](#)

[Tag Object \(Page 137\)](#)

**Read Tags method****Function**

Executes the "Read tags" key function of the UserArchiveControl.

**Syntax**

```
Ausdruck.ReadTags ()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## Refresh Method

### Function

Drawing all visible pictures again.

### syntax

```
Expression.Refresh
```

#### Expression

Necessary. An expression which returns a "Screens" or "Screen" type object.

## Parameters

--

## Examples

The first example forces all visible pictures to be drawn again:

```
'VBS149  
HMIRuntime.Screens.Refresh
```

The second example forces the basic picture to be immediately redrawn:

```
'VBS150  
HMIRuntime.Screens(1).Refresh
```

## See also

[Screen Object \(Page 131\)](#)

[Screens Object \(List\) \(Page 134\)](#)

[HMIRuntime Object \(Page 118\)](#)

## Remove Method

### Description of TagSet Object

Removes a tag from the TagSet list. The tag may be removed by name or reference to a tag object.

### syntax

```
Expression.Remove [Tag]
```

#### Expression

Necessary. An expression which returns an object of type "TagSet".

### Parameters

VARIANT

Parameters	Description
Tag	Name of a WinCC tag or reference to a tag object to be removed from the list.

### Example:

The following example shows how several tags are included in the TagSet list, and how to remove a tag again.

```
'VBS175
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
group.Add "Motor1"
group.Add "Motor2"
group.Remove "Motor1"
```

### Description of DataSet Object

Deletes the element specified in parameter "Name" from a list.

### syntax

```
Expression.Remove [Name]
```

#### Expression

Necessary. An expression which returns an object of type "DataSet".

## Parameters

VARIANT

Parameters	Description
Name	Name of the object to be removed from the list.

## Example:

The example shows how to remove the object "motor1" from the list.

```
'VBS166
HMIRuntime.DataSet.Remove("motor1")
```

## Description of objects Logging, AlarmLogs, DataLogs

The method deletes a previously swapped archive segment from the Runtime project.

Archive segments deleted with the "Remove" method are removed from the common archiving directory of the project.

The call may require a somewhat longer time period, depending on archive data. This may block the processing of subsequent scripts. Blockage of actions within the picture may be avoided if you start the call in a Global Scripting action, such as starting the action through a triggering tag.

The archive separation and deletion creates a CPU load. This will affect performance.

---

### Note

Calling up the "Remove" method is presently only possible at the server. There is an example, however, which shows how the method may be started by the client from a server.

For redundancy, the following applies: Re-swapped archives are deleted with the "Remove" method only on the computer from which the method was initiated.

---

## syntax

### Objects Logging, AlarmLogs

```
Expression.Remove [TimeFrom] [TimeTo] [TimeOut] [ServerPrefix]
```

### Expression

Necessary. An expression which returns an object of type "Logging" or "AlarmLogs".

## Object DataLogs

```
Expression.Remove [TimeFrom] [TimeTo] [TimeOut] [Type] [ServerPrefix]
```

**Expression**

Necessary. An expression which returns an object of type "DataLogs".

**Parameters****TimeFrom**

Point in time, from which the archives are to be deleted.

When indicating the time format, a short form is also possible. This is described in the "Time Format" section.

**TimeTo**

Time up to which archive segments are to be deleted.

When indicating the time format, a short form is also possible. This is described in the "Time Format" section.

**Timeout**

Timeout in milliseconds.

If you enter "-1" as a value, the wait will be infinite. If you enter a value of "0", there will be no wait.

**Type:**

Type of archive.

The parameter can (optionally) be used only to delete archive segments of the tag logging. The following values can be entered:

Assigned Value	Type	Description
1	hmiDataLogFast	Tag Logging Fast data
2	hmiDataLogSlow	Tag Logging Slow data
3	hmiDataLogAll	Tag Logging Fast and Slow data

**ServerPrefix**

Reserved for future versions.

**Return value**

If an error occurred during deletion of the archive segments, the method will return an error message. Additional information may be found under the subject heading "Error Messages from Database Area".

**Time format**

Time format is defined as follows: YYYY-MM-DD hh:mm:ss, where YYYY represents the year, MM the month, DD the day, hh the hour, mm the minute and ss the second. For example, the time of 2 minutes and one second past 11 o'clock on July 26, 2004 is displayed as follows: 2004-07-26 11:02:01.

For parameters "TimeFrom" and "TimeTo" the statement of data and time is also possible in short form. Not all format fields must be filled in this case. The short form means that the

information on date and time may be lacking one or several parameters, beginning with the value for seconds. For example, the statement may be in the form of "YYYY-MM" or "YYYY-MM-DD hh". Using the statement "TimeFrom" = "2004-09" and "TimeTo" = "2004-10-04" all archive segments between September 2004 up to and including October 4th are to be swapped.

### Example:

In the following example, archive segments re-swapped after the fact for a specified time period may be removed and the return value may be output as Trace.

```
'VBS182
HMIRuntime.Trace "Ret: " & HMIRuntime.Logging.Remove("2004-08-22","2004-09-22",-1) &
vbNewLine
```

In the following example, all archive segments re-swapped after the fact may be removed and the return value may be output as Trace.

```
'VBS183
HMIRuntime.Trace "Ret: " & HMIRuntime.Logging.Remove("", "", -1) & vbNewLine
```

### See also

- Error Messages from Database Area (Page 820)
- Example: How to Start an Action on the Server (Logging Object) (Page 836)
- Logging Object (Page 122)
- DataSet Object (List) (Page 116)
- DataLogs Object (Page 114)
- AlarmLogs Object (Page 112)
- TagSet Object (List) (Page 141)

### RemoveAll Method

#### Description of TagSet Object

Deletes all tags from a TagSet list.

#### syntax

```
Expression.RemoveAll
```



**Expression**

Necessary. An expression which returns an object of type "TagSet".

**Parameters**

--

**Example:**

The following example shows how several tags are included in the TagSet list, and how to remove all tags again.

```
'VBS176
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
group.Add "Motor1"
group.Add "Motor2"
group.RemoveAll
```

**Description of DataSet Object**

Deletes all values or object references from a DataSet list.

**syntax**

```
Expression.RemoveAll
```

**Expression**

Necessary. An expression which returns an object of type "DataSet".

**Parameters**

--

**Example:**

The example shows how all objects are removed from the list.

```
'VBS167
HMIRuntime.DataSet.RemoveAll
```

## See also

DataSet Object (List) (Page 116)

TagSet Object (List) (Page 141)

Tag Object (Page 137)

## RemoveData method

### Function

Deletes the data of the called trend.

### Syntax

```
Expression.RemoveData
```

#### Expression

Necessary. An expression which returns an object of the "Trend" type.

### Example

```
'VBS310
Dim objTrendControl
Dim objTrend
Set objTrendControl = ScreenItems("Control1")
Set objTrend = objTrendControl.GetTrend("Trend 1")
objTrend.RemoveData
```

## Restore Method

### Description of objects Logging, AlarmLogs, DataLogs

The method adds swapped archive segments to the Runtime project.

Upon swapping, the archive segments are copied to the common archiving directory of the project. Therefore, the appropriate storage capacity must be available.

The call may require a somewhat longer time period, depending on archive data. This may block the processing of subsequent scripts. Blockage of actions within the picture may be avoided if you start the call in a Global Scripting action, such as starting the action through a triggering tag.

Linking / copying of the archives generates a CPU load because the SQL server experiences additional load because of turned-on signature checking in particular. Copying of archive segments will slow down hard disk access.

Upon turned-on signature checking, an error message is returned if an unsigned or modified archive is to be swapped. There is always only one error message returned, even if several errors occurred during the swap process. Additionally, a WinCC system message is generated for each archive segment. An entry is added to the Windows event log in the "Application" section. This provides the opportunity to check which archive segments are creating the error.

- With an unsigned archive, the return value "0x8004720F" is returned. The archive is stored. The following text is entered in the event display:  
"Validation of database <db\_name> failed! No signature found!"
- With an changed archive, the return value "0x80047207" is returned. The even screen, the entry is "Validation of database <db\_name> failed !".  
The archive is not stored.

---

**Note**

Calling up the "Restore" method is presently only possible at the server. There is an example, however, which shows how the method may be started by the client from a server.

For redundancy, the following applies: Upon re-swapping of archives with the "Restore" method, only archive segments are added to the Runtime project on the computer from which the method was called.

---

## Syntax

### Objects Logging, AlarmLogs

```
Expression.Restore [SourcePath] [TimeFrom] [TimeTo] [TimeOut]  
[ServerPrefix]
```

**Expression**

Required. An expression which returns an object of type "Logging" or "AlarmLogs".

## Object DataLogs

```
Expression.Restore [SourcePath] [TimeFrom] [TimeTo] [TimeOut] [Type]  
[ServerPrefix]
```

**Expression**

Required. An expression which returns an object of type "DataLogs".

## Parameter

**SourcePath**

Path to archive data.

**TimeFrom**

Point in time, from which the archives are to be stored.

When indicating the time format, a short form is also possible. This is described in the "Time Format" section.

**TimeTo**

Time up to which archive segments are to be swapped.

When indicating the time format, a short form is also possible. This is described in the "Time Format" section.

**Timeout**

Timeout in milliseconds.

If you enter "-1" as a value, the wait will be infinite. If you enter a value of "0", there will be no wait.

**Type**

Type of archive.

The parameter can (optionally) be used only to store archive segments of the tag logging. The following values can be entered:

Assigned Value	Type	Description
1	hmiDataLogFast	Tag Logging Fast data
2	hmiDataLogSlow	Tag Logging Slow data
3	hmiDataLogAll	Tag Logging Fast and Slow data

**ServerPrefix**

Reserved for future versions.

**Return value**

If an error occurred during swapping of archive segments, the method will return an error message. Additional information may be found under the subject heading "Error Messages from Database Area".

**Time format**

Time format is defined as follows: YYYY-MM-DD hh:mm:ss, where YYYY represents the year, MM the month, DD the day, hh the hour, mm the minute and ss the second. For example, the time of 2 minutes and one second past 11 o'clock on July 26, 2004 is displayed as follows: 2004-07-26 11:02:01.

For parameters "TimeFrom" and "TimeTo" the statement of data and time is also possible in short form. Not all format fields must be filled in this case. The short form means that the information on date and time may be lacking one or several parameters, beginning with the value for seconds. For example, the statement may be in the form of "YYYY-MM" or "YYYY-MM-DD hh". Using the statement "TimeFrom" = "2004-09" and "TimeTo" = "2004-10-04" all archive segments between September 2004 up to and including October 4th are to be swapped.

## Example

In the following example, all archive segments since the specified time period are re-swapped, and the return value is output as Trace.

```
'VBS184
HMIRuntime.Trace "Ret: " & HMIRuntime.Logging.Restore("D:\Folder","2004-09-14","", -1) &
vbNewLine
```

In the following example, all Tag Logging Slow archive segments since the specified time period are re-swapped, and the return value is output as Trace.

```
'VBS185
HMIRuntime.Trace "Ret: " & HMIRuntime.Logging.DataLogs.Restore("D:\Folder","2004-09-14
12:30:05","2004-09-20 18:30",-1,2) & vbNewLine
```

In the following example, all Alarm Logging archive segments up to the specified time period are re-swapped, and the return value is output as Trace.

```
'VBS186
HMIRuntime.Trace "Ret: " & HMIRuntime.Logging.AlarmLogs.Restore("", "2004-09-20", -1) &
vbNewLine
```

## See also

- Error Messages from Database Area (Page 820)
- Example: How to Start an Action on the Server (Logging Object) (Page 836)
- Logging Object (Page 122)
- DataLogs Object (Page 114)
- AlarmLogs Object (Page 112)

### 1.14.5.6 Methods S to T

#### SelectAll

#### Function

Selects all rows in the table-based control.

## Syntax

```
Expression.SelectAll()
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## See also

Row object (list) (Page 225)

## SelectRow

## Function

Selects a particular row in the table-based control.

## Syntax

```
Expression.SelectRow(ByVal IRow As Long, Optional bExtendSelection  
As Boolean)
```

### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

Parameters	Description
IRow	Number of the row to be selected.
bExtendSelection	Indicates as an option whether the current selection will be extended. Is only relevant if multiple selections are possible.

## Example

- Row 1 is currently selected. If `SelectRow( 2, True )` is called, then row 1 and row 2 will be selected.
- Row 1 is currently selected. If `SelectRow( 2, False )` or `SelectRow( 2 )` is called without an optional parameter, then only row 2 will be selected.

## See also

Row object (list) (Page 225)

## SelectedStatisticArea method

### Function

Executes the "Set statistic area" key function of the OnlineTableControl.

### Syntax

```
Ausdruck.SelectedStatisticArea()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ServerExport method

### Function

Executes the "Export archive" key function of the UserArchiveControl.

### Syntax

```
Ausdruck.ServerExport()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ServerImport method

### Function

Executes the "Import archive" key function of the UserArchiveControl.

### Syntax

```
Ausdruck.ServerImport()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowColumnSelection method**

**Function**

Executes the "Select columns" key function of the OnlineTableControl.

**Syntax**

```
Ausdruck.ShowColumnSelection()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowComment method**

**Function**

Executes the "Comments dialog" key function of the AlarmControl.

**Syntax**

```
Ausdruck.ShowComment()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--



## ShowDisplayOptionsDialog method

### Function

Executes the "Display options dialog" key function of the AlarmControl.

### Syntax

```
Ausdruck.ShowDisplayOptionsDialog()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ShowEmergencyQuitDialog method

### Function

Executes the "Emergency acknowledgment" key function of the AlarmControl.

### Syntax

```
Ausdruck.ShowEmergencyQuitDialog()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ShowHelp method

### Function

Executes the "Help" key function of the control.

### Syntax

```
Ausdruck.ShowHelp()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

**ShowHideList method**

**Function**

Executes the "List of messages to be hidden" key function of the AlarmControl.

**Syntax**

```
Ausdruck.ShowHideList ()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowHitList method**

**Function**

Executes the "Hitlist" key function of the AlarmControl.

**Syntax**

```
Ausdruck.ShowHitList ()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## ShowInfoText method

### Function

Executes the "Info text dialog" key function of the AlarmControl.

### Syntax

```
Ausdruck.ShowInfoText()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ShowInsertValueDialog method

### Function

Executes the "Create archive value" key function of the OnlineTableControl.

### Syntax

```
Expression.ShowInsertValueDialog()
```

#### Expression

Required. An expression that returns an object of the "ScreenItem" type.

## ShowLockDialog method

### Function

Executes the "Lock dialog" key function of the AlarmControl.

### Syntax

```
Ausdruck.ShowLockDialog()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## ShowLockList method

### Function

Executes the "Lock list" key function of the AlarmControl.

### Syntax

```
Ausdruck.ShowLockList()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## ShowLongTermArchiveList method

### Function

Executes the "Long-term archive list" key function of the AlarmControl.

### Syntax

```
Ausdruck.ShowLongTermArchiveList()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

## Parameters

--

## ShowMessageList method

### Function

Executes the "Message list" key function of the AlarmControl.

**Syntax**

```
Ausdruck.ShowMessageList()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowPercentageAxis method****Function**

Executes the "Relative axis" key function of the OnlineTrendControl.

**Syntax**

```
Ausdruck.ShowPercentageAxis()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowPropertyDialog method****Function**

Executes the "Configuration dialog" key function of the control.

**Syntax**

```
Ausdruck.ShowPropertyDialog()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

VARIANT

## ShowSelectArchive method

### Function

Executes the "Select data connection" key function of the UserArchiveControl.

### Syntax

```
Ausdruck.ShowSelectArchive()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ShowSelection method

### Function

Executes the "Selection dialog" key function of the UserArchiveControl.

### Syntax

```
Ausdruck.ShowSelection ()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ShowSelectTimeBase method

### Function

Executes the "Time base dialog" key function of the UserArchiveControl.

### Syntax

```
Ausdruck.ShowSelectTimeBase()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowSelectionDialog method****Function**

Executes the "Selection dialog" key function of the AlarmControl.

**Syntax**

```
Ausdruck.ShowSelectionDialog()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowShortTermArchiveList method****Function**

Executes the "Short-term archive list" key function of the AlarmControl.

**Syntax**

```
Ausdruck.ShowShortTermArchiveList()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## ShowSort method

### Function

Executes the "Sort dialog" key function of the UserArchiveControl.

### Syntax

```
Ausdruck.ShowSort ()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ShowSortDialog method

### Function

Executes the "Sort dialog" key function of the AlarmControl.

### Syntax

```
Ausdruck.ShowSortDialog ()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ShowTagSelection method

### Function

Executes the "Select data connection" key function of the control.

### Syntax

```
Ausdruck.ShowTagSelection ()
```



**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowTimebaseDialog method****Function**

Executes the "Time base dialog" key function of the AlarmControl.

**Syntax**

```
Ausdruck.ShowTimebaseDialog()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ShowTimeSelection method****Function**

Executes the "Select time range" key function of the control.

**Syntax**

```
Ausdruck.ShowTimeSelection()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## ShowTrendSelection method

### Function

Executes the "Select trends" key function of the OnlineTrendControl and FunctionTrendControl.

### Syntax

```
Ausdruck.ShowTrendSelection()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## StartStopUpdate method

### Function

Executes the "Start" or "Stop" key function of the control.

### Syntax

```
Ausdruck.StartStopUpdate()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## Stop Method

### Function

Terminates WinCC Runtime.

### syntax

```
HMIRuntime.Stop
```

## Parameters

---

## Example:

The following example terminates WinCC Runtime:

```
'VBS124  
HMIRuntime.Stop
```

## See also

HMIRuntime Object (Page 118)

## Trace Method

## Description

Displays messages in the diagnostics window.

## syntax

```
HMIRuntime.Trace
```

## Parameters

STRING

## Example:

The following example writes a text in the diagnostics window:

```
'VBS103  
HMIRuntime.Trace "Customized error message"
```

## See also

HMIRuntime Object (Page 118)

### 1.14.5.7 Methods U to Z

#### UnhideAlarm method

##### Function

Executes the "Unhide alarm" key function of the AlarmControl.

##### Syntax

```
Ausdruck.UnhideAlarm()
```

##### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

##### Parameters

--

#### UnlockAlarm method

##### Function

Executes the "Unlock alarm" key function of the AlarmControl.

##### Syntax

```
Ausdruck.UnlockAlarm()
```

##### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

##### Parameters

--

#### UnselectAll

##### Function

Deselects all rows in the table-based control.

**Syntax**

```
Expression.UnselectAll()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**See also**

Row object (list) (Page 225)

**UnselectRow****Function**

Deselects a particular row in the table-based control.

**Syntax**

```
Expression.UnselectRow(ByVal IRow As Long)
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

Long

Parameters	Description
IRow	Number of the row to be selected.

**See also**

Row object (list) (Page 225)

**Write Method****Description of Tag Object**

Writes a value synchronously or asynchronously in a tag. The "LastError" property can be used to determine whether the call was successful.

If the value of the tag is set successfully, the properties of the tag object are assigned the following values:

Property	Allocation
Value	Tag values set by the user (unchanged)
Name	Tag name (unchanged)
QualityCode	Bad Out of Service
Timestamp	0
LastError	0
ErrorDescription	" "

If the value of the tag is not set successfully, the properties of the tag object are assigned the following values:

Property	Allocation
Value	Tag values set by the user (unchanged)
Name	Tag name (unchanged)
QualityCode	Bad Out of Service
Timestamp	0
LastError	Write operation error codes
ErrorDescription	Error description on LastError

## syntax

```
Expression.Write [Value],[Writemode]
```

### Expression

Necessary. An expression which returns a tag object.

## Parameters

The value to be written can be transferred directly to the method as a parameter. If the parameter is not specified, the value in the "Value" property is used. The "Writemode" option parameter can be used to select whether the tag value should be written synchronously or asynchronously. If the "Writemode" parameter is not used, writing is performed asynchronously as its default value.

During the writing process, no information is supplied on the status of the tags.

The "Value" property contains the value which was set before or during the writing operation, therefore it may not correspond to the real current value of the tag. If the data on the tag should be updated, use the Read method.

Parameters	Description
Value (optional)	The tag value is specified. The specified value overwrites the value in the "Value" property in the tag object. The tag value is not specified. The tag receives the current value from the "Value" property of the tag object.
Writemode (optional)	0 or empty: The tag value is written asynchronously. 0 is the default value. 1: The tag value is written synchronously.

On asynchronous writing, it is written immediately into the tag image. The user does not receive any feedback if the value has been written in the programmable controller, too.

In the case of synchronous writing (direct to the PLC), the writing operation actually occurs when the PLC is ready to operate. The user receives a check-back message if the writing operation was not successful.

### Example:

#### Asynchronous writing

```
'VBS104
Dim objTag
Set objTag = HMIRuntime.Tags("Var1")
objTag.Value = 5
objTag.Write
MsgBox objTag.Value
```

or

```
'VBS105
Dim objTag
Set objTag = HMIRuntime.Tags("Var1")
objTag.Write 5
MsgBox objTag.Value
```

### Synchronous writing

```
'VBS106  
Dim objTag  
Set objTag = HMIRuntime.Tags("Var1")  
objTag.Value = 5  
objTag.Write ,1  
MsgBox objTag.Value
```

or

```
'VBS107  
Dim objTag  
Set objTag = HMIRuntime.Tags("Var1")  
objTag.Write 5, 1  
MsgBox objTag.Value
```

### Description of TagSet Object

The TagSet object offers the option of writing several tags in one call.

Functionality here is mostly identical with that of a tag object. In the following, only deviations thereof are described.

#### Expression

Necessary. An expression which returns an object of type "TagSet".

### Parameters

In order to write different values, the "Value" property of individual tag objects must be set, and write must be called thereafter without the "Value" parameter. Since the write commands are grouped into one call, it results in improved performance compared to single calls.

In a TagSet object, it is not possible to pass on a value using the "Write" method. Individual values must be set using the "Value" property of the individual tag objects.



**Example:**

The following example shows how tags are included in the TagSet list, how tag values are set and subsequently written.

```
'VBS173
Dim group
Set group = HMIRuntime.Tags.CreateTagSet
group.Add "Wert1"
group.Add "Wert2"
group("Wert1").Value = 3
group("Wert2").Value = 9
group.Write
```

If you set the optional parameter "Writemode" equal to 1, the process tags are written synchronously (directly to AS).

```
group.Write 1
```

**See also**

LastError Property (Page 459)  
ErrorDescription Property (Page 411)  
TagSet Object (List) (Page 141)  
Tag Object (Page 137)

**WriteTags method****Function**

Executes the "Write tags" key function of the UserArchiveControl.

**Syntax**

```
Expression.WriteTags()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## ZoomArea - Method

### Function

Executes the "Zoom area" key function of the OnlineTrendControl and FunctionTrendControl.

### Syntax

```
Ausdruck.ZoomArea ()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ZoomInOut - Method

### Function

Executes the "Zoom +/-" key function of the OnlineTrendControl and FunctionTrendControl.

### Syntax

```
Ausdruck.ZoomInOut ()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ZoomInOutTime method

### Function

Executes the "Zoom time axis +/-" key function of the OnlineTrendControl.

### Syntax

```
Ausdruck.ZoomInOutTime ()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ZoomInOutValues - Method****Function**

Executes the "Zoom value axis +/-" key function of the OnlineTrendControl.

**Syntax**

```
Ausdruck.ZoomInOutValues()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

**ZoomInOutX method****Function**

Executes the "Zoom X axis +/-" key function of the FunctionTrendControl.

**Syntax**

```
Ausdruck.ZoomInOutX()
```

**Expression**

Necessary. An expression that returns an object of the "ScreenItem" type.

**Parameters**

--

## ZoomInOutY - Method

### Function

Executes the "Zoom Y axis +/-" key function of the FunctionTrendControl.

### Syntax

```
Ausdruck.ZoomInOutY()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## ZoomMove method

### Function

Executes the "Move trend area" key function of the OnlineTrendControl and FunctionTrendControl.

### Syntax

```
Ausdruck.ZoomMove()
```

#### Expression

Necessary. An expression that returns an object of the "ScreenItem" type.

### Parameters

--

## 1.14.6 Appendix

### 1.14.6.1 Error Messages from Database Area

#### Introduction

Upon access to databases, a value is returned upon execution. Values in the range "0x8..." represent an error message. Values not equal to "0x8..." represent a status message.

## Status Messages

The following status messages are defined:

0x0	OK
0x1	<p>Function did not find any errors in parameter supply and did not find any internal errors. The following causes may result in this value.</p> <p>When connecting databases:</p> <ul style="list-style-type: none"> <li>- No archive could be found in the given time window.</li> <li>- Archives were found in the given time window, but they were already connected.</li> </ul> <p>When separating databases:</p> <ul style="list-style-type: none"> <li>- No connected archives could be found in the given time window. No checks are performed on whether or not archives are attached at all.</li> </ul>

## Error Messages

The following error messages are defined (n in English only):

Error code	Error Message
0x80047200	WinCC is not activated
0x80047201	Invalid archive type
0x80047202	Invalid lower boundary
0x80047203	Invalid upper boundary
0x80047204	Path 'CommonArchiving' could not be created in the project path
0x80047205	Timeout, please retry
0x80047206	WinCC was deactivated
0x80047207	Wrong signification At least one database had a invalid signature and has not been attached.
0x80047208	Database could not be attached
0x80047209	Copy to 'CommonArchiving' is not possible.
0x8004720A	Invalid syntax for database filename.
0x8004720B	No list of databases.
0x8004720C	Database already detached.
0x8004720D	Database could not be detached.
0x8004720F	Unsigned database attached. At least one database without signature has been attached.
0x80047210	Path error : - Path invalid, - no *.MDF files found in specified path or - no permission to specified path.

## See also

Remove Method (Page 789)

Write Method (Page 813)

*1.14 VBS Reference*

Read Method (Page 783)

Restore Method (Page 794)

Logging Object (Page 122)

DataLogs Object (Page 114)

AlarmLogs Object (Page 112)

## 1.15 Examples of VBScript

### 1.15.1 Examples of VBScript

#### Introduction

The following section contains application examples of VBS in WinCC. The "Examples in WinCC" section contains examples of codes with which the WinCC Runtime environment can be made dynamic. These examples have been conceived so that they can be assumed 1:1 in the configuration.

The "General Examples" section contains examples with which to influence the Microsoft environment. There is no guarantee nor support for the running capability of these examples.

#### See also

Examples in WinCC (Page 823)

### 1.15.2 Examples in WinCC

#### 1.15.2.1 Examples in WinCC

#### Introduction

This section contains examples of using VBScript in WinCC with regard to the following topics:

- Access to objects in the Graphics Designer (e.g. color or text change)
- Set color of objects above RGB colors
- Configuring language change
- Deactivate Runtime
- Start external program
- Globally configure picture change (from Global Script)
- Configuring Change Picture Via Property
- Use trace for diagnostics output
- Set value of a tag
- Read value of a tag
- Check the success of a read/write action into a tag
- Asynchronously set value of a tag

## See also

- Example: Starting an external application (Page 859)
- Example: Writing Object Properties (Page 833)
- Example: How to Read Tag Values (Page 830)
- Example: Writing tag values (Page 828)
- Example: Configuring diagnostics output via Trace (Page 827)
- Example: Configuring Change Picture Via Property (Page 827)
- Example: Configuring change picture globally (Page 826)
- Example: Deactivating Runtime (Page 826)
- Example: How to Configure Language Changes (Page 825)
- Example: Defining the color of objects (Page 825)
- Example: Accessing objects in Graphics Designer (Page 824)

### 1.15.2.2 Example: Accessing objects in Graphics Designer

#### Introduction

Access can be made to all Graphic Designer objects using VBS WinCC in order to make the graphic Runtime environment dynamic. Graphic objects can be made dynamic on operation (e.g. clicking the mouse on a button), depending on a tag or cyclically (e.g. flashing).

The following examples illustrate how to change a graphic object following a mouse click.

#### Procedure

In the following example, the radius of a circle is set to 20 in Runtime per mouse click:

```
'VBS121
Dim objCircle
Set objCircle= ScreenItems("Circle1")
objCircle.Radius = 20
```

---

#### Note

The expression used in the example only applies to Graphics Designer. In the case of analog actions in Global Script, address the objects using the HMIRuntime object.

---

## See also

- Examples in WinCC (Page 823)



### 1.15.2.3 Example: Defining the color of objects

#### Introduction

The colors of graphic objects are defined via RGB values (Red/Green/Blue). The color values for graphic objects can be set or read out.

#### Procedure

The following example defines the fill color for "ScreenWindow1" to blue:

```
'VBS122
Dim objScreen
Set objScreen = HMIRuntime.Screens("ScreenWindow1")
objScreen.FillStyle = 131075
objScreen.FillColor = RGB(0, 0, 255)
```

#### See also

Examples in WinCC (Page 823)

### 1.15.2.4 Example: How to Configure Language Changes

#### Introduction

The Runtime language of WinCC can be changed using VBS. The most typical use is buttons with the corresponding language codes which are placed on the start page of a project.

You specify the Runtime language in VBS by using a country code, e.g., 1031 for German - Default, 1033 for English - USA etc. A summary of all country codes may be found in the Basics of VBScript under the subject header "Regional Scheme ID (LCID) Diagram".

#### Procedure

Use the "Mouse click" event on a button to create a VBS action and enter the following action code to switch the Runtime language to German:

```
'VBS123
HMIRuntime.Language = 1031
```

#### See also

Examples in WinCC (Page 823)

### 1.15.2.5 Example: Deactivating Runtime

#### Introduction

It is possible to terminate WinCC Runtime with VBS, e.g. via a mouse click or in dependence on tag values or other events, such as multiple faulty input of a password when starting Runtime.

#### What to do

The following example terminates WinCC Runtime:

```
'VBS124  
HMIRuntime.Stop
```

#### See also

Examples in WinCC (Page 823)

### 1.15.2.6 Example: Configuring change picture globally

#### Introduction

VBS can be used to initiate a global picture change and thus, for example, display a picture from a server on a client in a distributed system. To do this, server's server prefix must precede the target picture.

#### What to do

Configure the following code for a picture change to a button, for example:

```
'VBS125  
HMIRuntime.BaseScreenName = "Serverprefix::New screen"
```

#### See also

Examples in WinCC (Page 823)

### 1.15.2.7 Example: Configuring Change Picture Via Property

#### Introduction

If partitioned pictures are used in the configuration, e.g. in a basic picture title and operating bar for the user interface and an embedded picture window for the actual picture display, configure a picture change using the properties of the picture window.

The property of the "ScreenName" picture window must be changed in order for the other picture to appear. The action and picture window must be configured in the same picture.

#### What to do

In the following example, the "test.pdl" picture is displayed in the "ScreenWindow" picture window when executing the action:

```
'VBS126
Dim objScrWindow
Set objScrWindow = ScreenItems("ScreenWindow")
objScrWindow.ScreenName = "test"
```

#### See also

Examples in WinCC (Page 823)

### 1.15.2.8 Example: Configuring diagnostics output via Trace

#### Introduction

If a GSC diagnostics window has been inserted in the picture, diagnostics output can be displayed in the diagnostics window in Runtime using the Trace command.

GSC Diagnostics issues the Trace methods contained in the actions in the chronological sequence they are called. This also applies to Trace instructions in procedures which are called in actions. The targeted implementation of Trace instructions, e.g. for the output of tag values, enables the progress of actions and the procedures called in them to be traced. The Trace instructions are entered in the form "HMIRuntime.Trace(<Ausgabe>)".

The GSC Diagnostics displays trace output from C and VBS.

#### What to do

The following example writes a text in the diagnostics window:

```
'VBS127
HMIRuntime.Trace "Customized error message"
```

## See also

Examples in WinCC (Page 823)

### 1.15.2.9 Example: Writing tag values

#### Introduction

Using VBS, it is possible to write a tag value to the PLC, e.g. by clicking the mouse on a button to specify setpoint values, or to set internal tag values to trigger other actions.

Various write variations are mentioned and explained below.

#### Simple writing

In the following example, a value is written to the "Tag1" tag:

```
'VBS128
HMIRuntime.Tags("Tag1").Write 6
```

This is the simplest form of writing since no object reference is generated.

#### Writing with object reference

In the following example, a local copy of the tag object is created and a value written to "Tag1":

```
'VBS129
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Write 7
```

Referencing offers the advantage of being able to work with the tag object before writing. The tag value can be read, calculations executed and written again:

```
'VBS130
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Read
objTag.Value = objTag.Value + 1
objTag.Write
```

## Synchronous writing

Normally, the value to be written is transferred to the tag management and processing of the action resumed. In some cases, however, it must be ensured that the value has actually been written before processing of the action can be resumed.

This type of writing is realized by specifying the value 1 for the additional, optional parameters:

```
'VBS131
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Write 8.1
```

or

```
'VBS132
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Value = 8
objTag.Write ,1
```

---

### Note

Please note that the call takes longer in comparison to the standard call. The duration is also dependent on the channel and AS, amongst other things.

The type of writing complies to the SetTagXXXWait() call in C scripting.

---

## Writing with status handling

In order to ensure that a value has been written successfully, it is necessary to execute an error check or determine the status of the tag, after the writing process.

This is done by checking the value of the "LastError" property after writing. When the test proves successful, i.e. the job has been placed successfully, the tag status is checked.

In the case of a write job, the current status from the process is not determined. To establish this, it is necessary to read the tag. The value specified in the Quality Code property after the read process provides an indication of the tag status and, if necessary, makes reference to a failed AS connection.

### 1.15 Examples of VBScript

In the following example, the "Tag1" tag is written. If an error occurs during writing, the error value and error description appear in the Global Script diagnostics window. Finally, the Quality Code is checked. If the Quality Code is no OK (0x80), it is displayed in the diagnostics window.

```
'VBS133
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Write 9
If 0 <> objTag.LastError Then
HMIRuntime.Trace "Error: " & objTag.LastError & vbCrLf & "ErrorDescription: " &
objTag.ErrorDescription & vbCrLf
Else
objTag.Read
If &H80 <> objTag.QualityCode Then
HMIRuntime.Trace "QualityCode: 0x" & Hex(objTag.QualityCode) & vbCrLf
End If
End If
```

---

#### Note

After writing a tag, the QualityCode property of the local tag object is set to "BAD Out of Service" because it is not known which Quality Code manages the tag in the process.

The Quality Code cannot be written from VBS.

---

#### See also

Write Method (Page 813)

Examples in WinCC (Page 823)

#### 1.15.2.10 Example: How to Read Tag Values

##### Introduction

VBS can be used to read and further process a tag value. This makes it possible, for example, to click the mouse on a button to obtain information on the system status or to execute a calculation.

Various read variations are mentioned and explained below.

## Simple reading

In the following example, the value of "Tag1" is read and displayed in the Global Script diagnostics window:

```
'VBS134
HMIRuntime.Trace "Value: " & HMIRuntime.Tags("Tag1").Read & vbCrLf
```

This is the simplest form of reading since no object reference is generated.

## Reading with object reference

In the following example, a local copy of the tag object is created, the tag value read and displayed in the Global Script diagnostics window:

```
'VBS135
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
HMIRuntime.Trace "Value: " & objTag.Read & vbCrLf
```

Referencing offers the advantage of being able to work with the tag object. The tag value can be read, calculations executed and written again:

```
'VBS136
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Read
objTag.Value = objTag.Value + 1
objTag.Write
```

Using the Read method, process tags which have been read are added to the image, from this moment on they cyclically requested from the AS. If the tag is already in the image, the value contained in it is returned.

For Close Picture, the tag actions are ended again.

---

### Note

If a tag is requested in a Global Script action, it remains registered throughout the enter Runtime of WinCC.

---

## Direct reading

Normally, the tag values are read from the tag image. In certain situations, however, it may be necessary to read the value direct from the AS, e.g. to synchronize fast processes.

### 1.15 Examples of VBScript

If the optional parameter is set to 1 for the read process, the tag is not logged in cyclically but the value is requested once from the AS.

```
'VBS137
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
HMIRuntime.Trace "Value: " & objTag.Read(1) & vbCrLf
```

---

#### Note

Please note that the call takes longer in comparison to the standard call. The duration is also dependent on the channel and AS, amongst other things.

This type of call must be avoided in the case of cyclic C actions because this is the main reason for performance problems.

This type of read process corresponds to GetTagXXXWait() call from C scripting.

---

### Reading with status handling

In order to ensure that a value is valid, a check should be made following reading. This occurs by the fact that the Quality Code is controlled.

In the following example, the "myWord" tag is read and the QualityCode then checked. When the Quality Code does not correspond to OK (0x80) the LastError, ErrorDescription and QualityCode properties are displayed in the Global Script diagnostics window.

```
'VBS138
Dim objTag
Set objTag = HMIRuntime.Tags("Tag1")
objTag.Read
If &H80 <> objTag.QualityCode Then
HMIRuntime.Trace "Error: " & objTag.LastError & vbCrLf & "ErrorDescription: " &
objTag.ErrorDescription & vbCrLf & "QualityCode: 0x" & Hex(objTag.QualityCode) & vbCrLf
Else
HMIRuntime.Trace "Value: " & objTag.Value & vbCrLf
End If
```

---

#### Note

If an error occurs during reading, QualityCode is set to BAD NON-SPECIFIC. Therefore, it is sufficient to check the QualityCode following reading.

---



**See also**

Read Method (Page 783)

Examples in WinCC (Page 823)

**1.15.2.11 Example: Writing Object Properties****Introduction**

VBS enables access to the properties of all Graphics Designer picture objects. Properties can be read out to be modified or changed during Runtime.

The following examples illustrate various forms of access.

**Simple setting of a property**

In the following example, the background color of the "Rectangle1" object contained in the picture is set to red:

```
'VBS139
ScreenItems("Rectangle1").BackColor = RGB(255,0,0)
This is the simplest form of writing since no object reference is generated.
```

---

**Note**

If the work is completed without an object reference, only the standard properties are provided in Intellisense.

The form of expression used in the example only applies to Graphics Designer. In the case of analog actions in Global Script, address the objects using the HMIRuntime object.

---

**Setting a property with object reference**

In the following example, a reference is created to the "Rectangle1" object contained in the picture and the background is set to red using the VBS standard function RGB():

```
'VBS140
Dim objRectangle
Set objRectangle = ScreenItems("Rectangle1")
objRectangle.BackColor = RGB(255,0,0)
```

Referencing is useful when several object properties must be changed. When using Intellisense, this process then lists all the object properties.

---

#### Note

The form of expression used in the example only applies to Graphics Designer. In the case of analog actions in Global Script, address the objects using the HMIRuntime object.

---

### Setting properties via the picture window

VBS in Graphics Designer offers two possibilities for picture transcending addressing:

- via the Screen object of a picture window with "ScreenItems"
- from the basic picture with "HMIRuntime.Screens"

#### Referencing via the picture window

In the following example, the color of a rectangle is changed in an subordinate picture window. The script is executed in the picture "BaseScreen", in which the picture window "ScreenWindow1" is located. The picture window displays a picture, which contains an object of the type "Rectangle" with the name "Rectangle1".

```
'VBS199
Sub OnLButtonUp(ByVal Item, ByVal Flags, ByVal x, ByVal y)
Dim objRectangle
Set objRectangle = ScreenItems("ScreenWindow1").Screen.ScreenItems("Rectangle1")
objRectangle.BackColor = RGB(255,0,0)
End Sub
```

#### Referencing from the basic picture

You can reference the picture with the object to be modified via HMIRuntime.Screens. The specification of the picture is defined relative to the basic picture via the following access code:

```
[<Grundbildname>.<Bildfenstername>[:<Bildname>]... .<Bildfenstername>[:<Bildname>]
```

In the following example, a reference is created to the "Screen2" object contained in the "Rectangle1" picture and the background color is set to red.

The picture "Screen2", in this case, is in "Screen1". "Screen1" is displayed in the basic picture "BaseScreen".

```
'VBS141
Dim objRectangle
Set objRectangle =
HMIRuntime.Screens("BaseScreen.ScreenWindow1:Screen1.ScreenWindow1:Screen2").ScreenItems("
Rectangle1")
objRectangle.BackColor = RGB(255,0,0)
```

It is not necessary to specify the picture name. It is possible to address a picture uniquely using the picture window name. Therefore, it is sufficient to specify the name of the picture window, as in the following example:

```
'VBS142
Dim objRectangle
Set objRectangle =
HMIRuntime.Screens("ScreenWindow1.ScreenWindow2").ScreenItems("Rectangle1")
objRectangle.BackColor = RGB(255,0,0)
```

This type of addressing enables objects in picture windows to be addressed in different pictures. This is a particularly interesting aspect in respect of the picture module technique.

### Make the property dynamic using the return value

Actions on properties can not only be triggered by events or cyclically but properties can also be made dynamic directly via an action.

In the following example, the background color of an object is made dynamic via a return value. The value transferred can come from the evaluation of events in the PLC, for example and used for the graphic display of an operating status:

```
'VBS146
Function BackColor_Trigger(ByVal Item)
BackColor_Trigger = RGB(125,0,0)
End Function
```

---

#### Note

If you make an object property dynamic with a VBS action via the return value of a script, the value of the object property is written only if it has changed in relation to the last script run. It is not considered if the value had been changed from another location.

Therefore it is illegal to change properties which have been made dynamic by VBS action via the return value from another location (e.g., other C scripts or VBS scripts).

if you do not observe this, wrong values can be the results.

---

### See also

VBS Reference (Page 105)

Examples in WinCC (Page 823)

### 1.15.2.12 Example: How to Start an Action on the Server (Logging Object)

#### Introduction

In multi-user projects, the Logging object presently functions on the server only. The following example shows how to start an action on the server from the client, and how to swap and delete archive segments on client accordingly.

The example shows a global action started with a control tag. The contents of the control tag determine whether the "Restore" method or the "Remove" method is called. At the end of the action, the control tag is set to "0".

A query prevents the action from being started on client computers.

Path and time period are passed on by internal tags.

The path information may also contain a network release. Archive segments to be swapped must therefore not be stored locally at the server. It must be warranted, though, that the server may directly access the path.

---

#### Note

The example shows a delete suggestion and may be adjusted as needed.

---

#### What to do

1. Create the following internal tags with project-wide updating in the WinCC Explorer:
  - StartLogging (unsigned 8 bit value)
  - SourcePath (Text tag 8 bit character set)
  - TimeFrom (Text tag 8 bit character set)
  - TimeTo (Text tag 8 bit character set)
  - RetVal (signed 32 bit value)
2. Create a global VBS action and enter the tag 'StartLogging' as tag trigger with cycle "Upon Change".
3. Copy the following script into the action

```
'VBS180
Dim StartLogging
Dim SourcePath
Dim TimeFrom
Dim TimeTo
Dim RetVal
'Exit when running on client
If (Left(HMIRuntime.ActiveProject.Path, 1) = "\") Then
Exit Function
End If
'read parameters
StartLogging = HMIRuntime.Tags("StartLogging").Read
SourcePath = HMIRuntime.Tags("SourcePath").Read(1)
TimeFrom = HMIRuntime.Tags("TimeFrom").Read(1)
TimeTo = HMIRuntime.Tags("TimeTo").Read(1)
'restore or remove depends on the parameter
If (StartLogging = 1) Then
RetVal = HMIRuntime.Logging.Restore(SourcePath, TimeFrom, TimeTo, -1)
HMIRuntime.Tags("RetVal").Write RetVal, 1
HMIRuntime.Tags("StartLogging").Write 0,1
Elseif (StartLogging = 2) Then
RetVal = HMIRuntime.Logging.Remove(TimeFrom, TimeTo, -1)
HMIRuntime.Tags("RetVal").Write RetVal, 1
HMIRuntime.Tags("StartLogging").Write 0,1
End If
```

The action may be started on a client with the following action, for example. Please note that parameters must be written prior to setting the control tag.

```
'VBS181
'set parameters
HMIRuntime.Tags("SourcePath").Write "\\client_pc\temp",1
HMIRuntime.Tags("TimeFrom").Write "2004",1
HMIRuntime.Tags("TimeTo").Write "2004",1
'start action
HMIRuntime.Tags("StartLogging").Write 1.1
```

---

**Note**

Tags are predominantly written and read in "direct" mode. This will synchronize the sequences. Since this deals with internal tags, this mode may be used without any further concerns.

---

### 1.15.2.13 Example: You connect or disconnect a database backup with VBS

#### Introduction

You can connect and read swapped-out databases with VBScript.

The example below describes access to a swapped-out WinCC process value archive via the WinCC OLE DB Provider. A backup file is connected, read and the connection terminated again.

1. Create connection for access via ADO and specify data source (1.1)
2. Define command for access: Read relative time range for the last 10 minutes (1.2)
3. Establish the connection (2.1)
4. Execute command (2.2)
5. Define data record structure and test first data record (2.3)
6. Call subsequent rows of the result set (3.1)
7. Clean up: Disconnect (4.1)

The example does not include error processing.

Further information on the OLE DB Provider is available in the documentation for the WinCC/Connectivity Pack under "Access via OLE DB Provider > Retrieve archive data".

#### Requirement

- WinCC or WinCC/Connectivity Pack is installed on the PC.

## Example

```
'VBS372
Sub OnClick(Byval Item)

Const MaxRows = 100

' 1.1 Create connection string for ADO access
Dim ProviderName
Dim CatalogName
Dim DataSourceName
Dim ConnectionString
Dim CommandString

ProviderName = "Provider=WinCCOLEDBProvider.1;"
CatalogName = "Catalog=CC_Test_15_04_14_08_23_27R;"
DataSourceName = "Data Source=.\WinCC"
ConnectionString = ProviderName + CatalogName + DataSourceName

' 1.2 Define command string for access (relative time range, last 10
minutes)
CommandString = "TAG:R,'ArcTag\Tag_1','0000-00-00
00:10:00.000','0000-00-00 00:00:00.000'"

Dim DBConnection
Dim DBCommand
Dim DBRecordset

' 2.1 Open connection
HMIRuntime.Trace "before open connection" & vbNewLine
Set DBConnection = CreateObject("ADODB.Connection")
DBConnection.ConnectionString = ConnectionString
DBConnection.CursorLocation = 3
DBConnection.open

Set DBRecordset = CreateObject("ADODB.Recordset")

' 2.2 Execute command
HMIRuntime.Trace "before execute command" & vbNewLine
Set DBCommand = CreateObject("ADODB.Command")
DBCommand.CommandType = 1
DBCommand.ActiveConnection = DBConnection
DBCommand.CommandText = CommandString
Set DBRecordset = DBCommand.Execute

Dim lngCount
Dim lngValue

' 2.3 Record structure and first record data (test)
lngCount = DBRecordset.Fields.Count
HMIRuntime.Trace "RecordSet.Field.Count=" & lngCount & vbNewLine
If (lngCount>0) Then
```

```

        DBRecordset.movefirst
        lngValue = DBRecordset.Fields(0).Value
        HMIRuntime.Trace "RecordSet.Fields(0).Value=" & lngValue & " (ValueID)"
    & vbNewLine
        lngValue = DBRecordset.Fields(1).Value
        HMIRuntime.Trace "RecordSet.Fields(1).Value=" & lngValue &
    " (TimeStamp)" & vbNewLine
        lngValue = DBRecordset.Fields(2).Value
        HMIRuntime.Trace "RecordSet.Fields(2).Value=" & lngValue & " (Value)"
    & vbNewLine
        lngValue = DBRecordset.Fields(3).Value
        HMIRuntime.Trace "RecordSet.Fields(3).Value=" & lngValue &
    " (QualityCode)" & vbNewLine
        lngValue = DBRecordset.Fields(4).Value
        HMIRuntime.Trace "RecordSet.Fields(4).Value=" & lngValue & " (Flags)"
    & vbNewLine

    Dim DBValueID
    Dim DBTimeStamp
    Dim DBValue
    Dim DBQualityCode
    Dim DBFlags

    Dim Count
    Count = 0
    HMIRuntime.Trace "before While DBReader (MaxRows=" & MaxRows & ")" &
vbNewLine

    ' 3.1 Fetch subsequent rows of the result set
    DBRecordset.movefirst
    Do While (Not DBRecordset.EOF And Count < MaxRows)
        DBValueID = DBRecordset.Fields(0).Value
        DBTimeStamp = DBRecordset.Fields(1).Value
        DBValue = DBRecordset.Fields(2).Value
        DBQualityCode = DBRecordset.Fields(3).Value
        DBFlags = DBRecordset.Fields(4).Value

        HMIRuntime.Trace "Rec[" & Count & "]=( " & DBValueID & "," &
    DBTimeStamp & "," & DBValue & "," & DBQualityCode & "," & DBFlags & " )" &
vbNewLine
        Count = Count + 1
        DBRecordset.movenext
    Loop
    HMIRuntime.Trace Count & "records read finish" & vbNewLine
Else
    HMIRuntime.Trace "Selection returned no fields" & vbNewLine
End If

' 4.1 Clean up
DBRecordset.Close
Set DBRecordset = Nothing
Set DBCommand = Nothing
DBConnection.Close
Set DBConnection = Nothing

```



```
HMIRuntime.Trace "Connection closed again" & vbNewLine

End Sub
```

### 1.15.2.14 Dynamization of Controls

#### Example: Calling Methods of an ActiveX Control

##### Introduction

The following examples illustrate how to call methods and properties of an ActiveX control which is embedded in a WinCC picture.

##### Example 1: WinCC FunctionTrendControl

This example fills "Trend 1" of the FunctionTrendControl "Control1" with values which describe a parabola.

To dynamize a trend with VBS, in the configuration dialog of the control on the "Data connection" tab under "Data supply" set "0 - None".

```
'VBS300
Dim lngFactor
Dim dblAxisX
Dim dblAxisY
Dim objTrendControl
Dim objTrend

Set objTrendControl = ScreenItems("Control1")
Set objTrend = objTrendControl.GetTrend("Trend 1")

For lngFactor = -100 To 100
dblAxisX = CDbI(lngFactor * 0.02)
dblAxisY = CDbI(dblAxisX * dblAxisX + 2 * dblAxisX + 1)
objTrend.InsertData dblAxisX, dblAxisY
Next
```

##### Example 2: WinCC FunctionTrendControl with value supply via array

In this example, "Trend 1" of the FunctionTrendControl "Control1" is supplied with values stored in arrays.

### 1.15 Examples of VBScript

To dynamize a trend with VBS, in the configuration dialog of the control on the "Data connection" tab under "Data supply" set "0 - None".

```
'VBS301
Dim lngIndex
Dim dblAxisX(100)
Dim dblAxisY(100)
Dim objTrendControl
Dim objTrend
Set objTrendControl = ScreenItems("Control1")
Set objTrend = objTrendControl.GetTrend("Trend 1")
For lngIndex = 0 To 100
dblAxisX(lngIndex) = CDbI(lngIndex * 0.8)
dblAxisY(lngIndex) = CDbI(lngIndex)
Next
objTrend.InsertData dblAxisX, dblAxisY
```

#### Example 3: WinCC FunctionTrendControl (before WinCC V7)

This example fills the FunctionTrendControl named "Control1" with values that describe a parabola.

```
'VBS111
Dim lngFactor
Dim dblAxisX
Dim dblAxisY
Dim objTrendControl
Set objTrendControl = ScreenItems("Control1")
For lngFactor = -100 To 100
dblAxisX = CDbI(lngFactor * 0.02)
dblAxisY = CDbI(dblAxisX * dblAxisX + 2 * dblAxisX + 1)
objTrendControl.DataX = dblAxisX
objTrendControl.DataY = dblAxisY
objTrendControl.InsertData = True
Next
```

**Example 4: WinCC FunctionTrendControl with value supply via array (before WinCC V7)**

In this example, a FunctionTrendControl called "Control1" is supplied with 100 value pairs. In order that the value pair can be transferred correctly, the transfer e.g. in "dblAxisXY" must not occur directly but via an intermediate tag, e.g. "varTemp".

```
'VBS152
Dim lngIndex
Dim dblXY(1)
Dim dblAxisXY(100)
Dim varTemp
Dim objTrendControl
Set objTrendControl = ScreenItems("Control1")
For lngIndex = 0 To 100
  dblXY(0) = CDBl(lngIndex * 0.8)
  dblXY(1) = CDBl(lngIndex)
  dblAxisXY(lngIndex) = dblXY
Next
varTemp = (dblAxisXY)
objTrendControl.DataXY = varTemp
objTrendControl.InsertData = True
```

**Example 5: Microsoft Web Browser**

This example controls MS Web Browser.

```
'VBS112
Dim objWebBrowser
Set objWebBrowser = ScreenItems("WebControl")
objWebBrowser.Navigate "http://www.siemens.de"
...
objWebBrowser.GoBack
...
objWebBrowser.GoForward
...
objWebBrowser.Refresh
...
objWebBrowser.GoHome
...
objWebBrowser.GoSearch
...
objWebBrowser.Stop
...
```

---

**Note**

Insert the instructions, separated by stops, in self-defined procedures. Declaration and assignments must always precede them.

---

## See also

General examples for VBScript (Page 855)

## Example: How to configure a user-defined toolbar button with a self-created selection dialog

### Introduction

In the following example you create a user-defined toolbar button of an OnlineTrendControl. On this toolbar button you configure a self-created selection dialog with which you can optionally set one of two different time ranges of the OnlineTrendControl.

### Requirement

- The Graphics Designer is open.
- An archive is created in the Tag Logging Editor.

### Inserting and configuring WinCC OnlineTrendControl

1. Create a new process picture in the Graphics Designer.
2. Save the process picture under "OnlineTrend.pdl".
3. Insert a WinCC OnlineTrendControl into the process picture.
4. Select "Configuration dialog..." from the shortcut menu of the control.  
The "Properties of WinCC OnlineTrendControl" dialog opens.
5. On the "Trend" tab under "Data connection" connect the trend to an archive tag.
6. On the "Toolbar" tab under "Button functions" create a new user-defined toolbar button with object ID "1001" for the OnlineTrendControl.
7. Click on "Accept" to save the changes.
8. Click "OK" to close the dialog box.
9. Select "Properties" from the shortcut menu of the control.  
The "Object properties" dialog box opens.
10. Enter "Control1" as the object name for the control.
11. In the Object Properties of "Control1" select the "Event" tab.
12. On the "OnToolbarButtonClicked" object event, configure the VB script "Create VBS action on "OnToolbarButtonClicked" event of user-defined toolbar button (VBS302)".
13. Close the "Object properties" dialog box.

### Creating a process picture for the selection dialog

1. Create a new process picture in the Graphics Designer.
2. Save the process picture under "Selectiondialog.pdl".

3. Click the "Properties" button on the shortcut menu of the process picture.  
The "Object properties" dialog box opens.
4. Under "Geometry", set value "200" for the "Picture width" and "Picture height" attributes.
5. Close the "Object properties" dialog box.
6. Insert two "Button" objects into the process picture.
7. Enter "Morning" or "Afternoon" as text for the button.

### Dynamizing selection dialog button

1. In the Object Properties of the "Morning" button select the "Event" tab.
2. On the "Mouse-click" event, configure the VB script "Create VBS action on "Mouse-click" event of "Morning" button (VBS303)".
3. Close the "Object properties" dialog box.
4. In the Object Properties of the "Afternoon" button select the "Event" tab.
5. On the "Mouse-click" event configure the VB script "Create VBS action on "Mouse-click" event of "Afternoon" button (VBS304)".
6. Close the "Object properties" dialog box.

### Inserting and configuring a picture window

1. Insert a "Picture window" object into the "OnlineTrend.pdf" process picture.
2. Select "Properties" from the shortcut menu of the picture window.  
The "Object properties" dialog box opens.
3. Enter "PictureWindow1" as the object name for the picture window.
4. Under "Miscellaneous" set the "Display" attribute to "no".
5. Under "Miscellaneous", select the "Selectiondialog.pdf" process picture for the "Picture name" attribute.
6. Close the "Object properties" dialog box.

### Create VBS action on "OnToolBarButtonClicked" event of user-defined toolbar button (VBS302)

```
'VBS302
'Open selection window if Toolbarbutton with ID 1001 is pressed
If lId = 1001 Then
ScreenItems("PictureWindow1").Visible = True
End If
```

### Create VBS action on "Mouse-click" event of "Morning" button (VBS303)

```
'VBS303
Dim obj
Set obj = Parent.Parent.ScreenItems("Control1")

'choose time axis, stop update, set begin time and time range
obj.TimeAxisName = "Time axis 1"
obj.TimeAxisActualize = False
obj.TimeAxisBeginTime = CStr(Date & " 4:00:00")
obj.TimeAxisTimeRangeBase = 3600000
obj.TimeAxisTimeRangeFactor = 8

'close the selection window
Parent.Visible = False
```

### Create VBS action on "Mouse-click" event of "Afternoon" button (VBS304)

```
'VBS304
Dim obj
Set obj = Parent.Parent.ScreenItems("Control1")

'choose time axis, stop update, set begin time and time range
obj.TimeAxisName = "Time axis 1"
obj.TimeAxisActualize = False
obj.TimeAxisBeginTime = CStr(Date & " 12:00:00")
obj.TimeAxisTimeRangeBase = 3600000
obj.TimeAxisTimeRangeFactor = 8

'close the selection window
Parent.Visible = False
```

## Example: How to add elements to an empty WinCC OnlineTrendControl

### Introduction

In the following example you insert the Trend Window, Value Axis, Time Axis and Trends elements into an empty WinCC OnlineTrendControl.

### Requirement

- The Graphics Designer is open.
- An archive is created in the Tag Logging Editor with three archive tags.

### Inserting and configuring WinCC OnlineTrendControl

1. Create a new process picture in the Graphics Designer.
2. Insert a WinCC OnlineTrendControl into the process picture.
3. Select "Configuration dialog..." from the shortcut menu of the control.  
The "Properties of WinCC OnlineTrendControl" dialog opens.
4. In the "Trends" area of the "Trends" tab delete the default trend window "Trend 1".
5. Click on "Accept" to save the changes.
6. Click "OK" to close the dialog box.
7. Select "Properties" from the shortcut menu of the control.  
The "Object properties" dialog box opens.
8. Enter "Control1" as the object name for the control.
9. Close the "Object properties" dialog box.

### Inserting and configuring a button

1. Insert a "Button" object into the process picture.
2. Enter "Paste elements" as text for the button.
3. Select "Properties" from the shortcut menu of the button.  
The "Object properties" dialog box opens.
4. In the Object Properties of the button select the "Event" tab.
5. On the "Mouse-click" event configure the VB script "Create VBS action on "Mouse-click" event of button (VBS305)".
6. Close the "Object properties" dialog box.

**Create VBS action on "Mouse-click" event of button (VBS305)**

```
'VBS305
Dim objTrendControl
Dim objTrendWindow
Dim objTimeAxis
Dim objValueAxis
Dim objTrend

'create reference to TrendControl
Set objTrendControl = ScreenItems("Control1")

'create reference to new window, time and value axis
Set objTrendWindow =
objTrendControl.GetTrendWindowCollection.AddItem("myWindow")
Set objTimeAxis =
objTrendControl.GetTimeAxisCollection.AddItem("myTimeAxis")
Set objValueAxis =
objTrendControl.GetValueAxisCollection.AddItem("myValueAxis")

'assign time and value axis to the window
objTimeAxis.TrendWindow = objTrendWindow.Name
objValueAxis.TrendWindow = objTrendWindow.Name

'add new trend and assign properties
Set objTrend = objTrendControl.GetTrendCollection.AddItem("myTrend1")
objTrend.Provider = 1
objTrend.TagName = "TestArchive\ArchivTag1"
objTrend.Color = RGB(255,0,0)
objTrend.TrendWindow = objTrendWindow.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValueAxis.Name

'add new trend and assign properties
Set objTrend = objTrendControl.GetTrendCollection.AddItem("myTrend2")
objTrend.Provider = 1
objTrend.TagName = "TestArchive\ArchivTag2"
objTrend.Color = RGB(0,255,0)
objTrend.TrendWindow = objTrendWindow.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValueAxis.Name

'add new trend and assign properties
Set objTrend = objTrendControl.GetTrendCollection.AddItem("myTrend3")
objTrend.Provider = 1
objTrend.TagName = "TestArchive\ArchivTag3"
objTrend.Color = RGB(0,0,255)
objTrend.TrendWindow = objTrendWindow.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValueAxis.Name
```



---

### Note

In the VB script, replace the archive used and the archive tags "Archive\ArchiveTagX" with the names of the archive and archive tags that have been created.

---

## Example: How to add a trend and a setpoint trend to an empty OnlineTrendControl.

### Introduction

In the following example, you add a trend and a setpoint trend to an empty WinCC OnlineTrendControl. The time axis and value axis are added for the trends in a trend window.

### Requirement

- A "WinCC OnlineTrendControl" with the name "Control2" is inserted in the process picture in the Graphics Designer.
- A button is inserted in the Graphics Designer. You have configured the event "mouse click", for example, for the button, with a VBS action and the following script.

**Example**

```
'VBS352
Dim objTrendControl
Dim objTrendWindow
Dim objTimeAxis
Dim objValueAxis
Dim objTrend
'tags used to generate trend data
Dim dtCurrent
Dim dblCurrent
Dim lIndex
Dim vValues(360)
Dim vTimeStamps(360)

'create reference to TrendControl
Set objTrendControl = ScreenItems("Control2")

'---- reference trend ----
'create reference to new window, time and value axis
Set objTrendWindow = objTrendControl.GetTrendWindowCollection.AddItem("myWindow")
Set objTimeAxis = objTrendControl.GetTimeAxisCollection.AddItem("myRefTimeAxis")
Set objValueAxis = objTrendControl.GetValueAxisCollection.AddItem("myRefValueAxis")

'assign time and value axis to the window
objTimeAxis.TrendWindow = objTrendWindow.Name
objTimeAxis.ShowDate = False
objValueAxis.TrendWindow = objTrendWindow.Name

'add trend and assign propertys
Set objTrend = objTrendControl.GetTrendCollection.AddItem("myRefTrend")
objTrend.Provider = 0
objTrend.Color = RGB(0,0,0)
objTrend.TrendWindow = objTrendWindow.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValueAxis.Name

'generate values for reference trend
dtCurrent = CDate("23.11.2006 00:00:00")
For lIndex = 0 To 360
    vValues(lIndex) = ( Sin(dblCurrent) * 60 ) + 60
    vTimeStamps(lIndex) = dtCurrent
    dblCurrent = dblCurrent + 0.105
    dtCurrent = dtCurrent + CDate ("00:00:01")
Next

'insert data to the reference trend
objTrend.RemoveData
objTrend.InsertData vValues, vTimeStamps

'---- data trend ----
'add time and value axis to the existing window
Set objTimeAxis = objTrendControl.GetTimeAxisCollection.AddItem("myTimeAxis")
Set objValueAxis = objTrendControl.GetValueAxisCollection.AddItem("myValueAxis")

'assign time and value axis to the window
```

```

objTimeAxis.TrendWindow = objTrendWindow.Name
objTimeAxis.ShowDate = False
objValueAxis.TrendWindow = objTrendWindow.Name


'add new trend and assign properties
Set objTrend = objTrendControl.GetTrendCollection.AddItem("myTrend")
objTrend.Provider = 0
objTrend.Color = RGB(255,200,0)
objTrend.Fill = True
objTrend.TrendWindow = objTrendWindow.Name
objTrend.TimeAxis = objTimeAxis.Name
objTrend.ValueAxis = objValueAxis.Name

'generate values for data trend
dtCurrent = CDate("23.11.2006 00:00:00")
For lIndex = 0 To 360
  vValues(lIndex) = ( Sin(dblCurrent) * 60 ) + 60
  vTimeStamps(lIndex) = dtCurrent
  dblCurrent = dblCurrent + 0.106
  dtCurrent = dtCurrent + CDate ("00:00:01")
Next

'insert values to the data trend
objTrend.RemoveData
objTrend.InsertData vValues, vTimeStamps

```

## Result

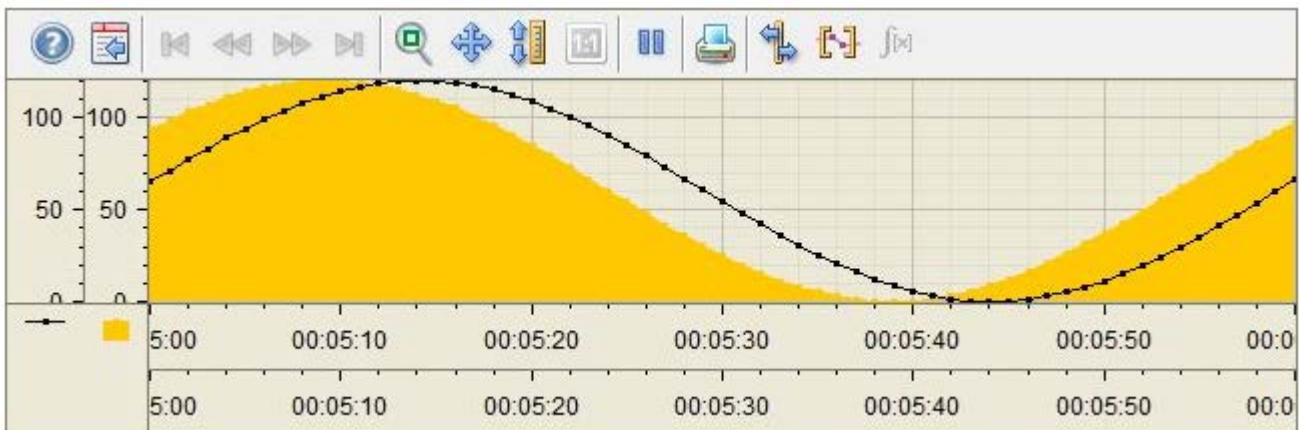

## Example: How to add elements to a WinCC OnlineTrendControl

### Introduction

In the following example, insert value columns with properties in an empty WinCC OnlineTableControl and link the columns to archive tags.

## 1.15 Examples of VBScript

### Requirement

- An archive is created in the "Tag Logging Editor" with three archive tags.
- A "WinCC OnlineTableControl" with the name "Control2" is inserted in the process picture in the Graphics Designer.
- A button is inserted in the Graphics Designer. You have configured the event "mouse click", for example, for the button, with a VBS action and the following script.

### Example

```
'VBS351
Dim objTableControl
Dim objTimeColumn
Dim objValueColumn
Dim objTrend

'create reference to TableControl and enable BackColor
Set objTableControl = ScreenItems("Control2")
objTableControl.UseColumnBackColor = True

'create reference to new TimeColumn and assign column length
Set objTimeColumn = objTableControl.GetTimeColumnCollection.AddItem("myRefTimeAxis")
objTimeColumn.Length = 20

'add new ValueColumn and assign propertys
Set objValueColumn = objTableControl.GetValueColumnCollection.AddItem("myValueTable1")
objValueColumn.Provider = 1
objValueColumn.TagName = "Process value archive\PDL_ZT_1"
objValueColumn.BackColor = RGB(255,255,255)
objValueColumn.TimeColumn = objTimeColumn.Name

'add new ValueColumn and assign propertys
Set objValueColumn = objTableControl.GetValueColumnCollection.AddItem("myValueTable2")
objValueColumn.Provider = 1
objValueColumn.TagName = "Process value archive\PDL_ZT_2"
objValueColumn.BackColor = RGB(0,255,255)
objValueColumn.TimeColumn = objTimeColumn.Name

'add new ValueColumn and assign propertys
Set objValueColumn = objTableControl.GetValueColumnCollection.AddItem("myValueTable3")
objValueColumn.Provider = 1
objValueColumn.TagName = "Process value archive\PDL_ZT_3"
objValueColumn.BackColor = RGB(255,255,0)
objValueColumn.TimeColumn = objTimeColumn.Name
```

## Result

	myRefTimeAxis	myValueTable1	myValueTable2	myValueTable3	
112	08.02.2010 14:15:03	1	1	84	
113	08.02.2010 14:15:03	22	1	84	
114	08.02.2010 14:15:04	2	1	84	
115	08.02.2010 14:15:04	1	1	84	
116	08.02.2010 14:15:05	1	1	84	
117	08.02.2010 14:15:05	3	1	84	
118	08.02.2010 14:15:06	1	1	84	
119	08.02.2010 14:15:06	1	1	84	
120	08.02.2010 14:15:07	18	1	84	

## Example: Scripts for WinCC AlarmControl

### Introduction

The following examples demonstrate the use of scripts for WinCC AlarmControl.

### Requirement

- You have already configured messages in the "Alarm Logging" editor.

### Example 1: Setting filters

A filter with message number "2" is set, or reset if the filter has already been set. The status is also output in the dialog window.

```
'VBS353
Dim objAlarmControl
'create reference to AlarmControl
Set objAlarmControl = ScreenItems("Control1")
'set / reset the filter and create a trace
If (objAlarmControl.MsgFilterSQL = "") Then
  objAlarmControl.MsgFilterSQL = "MSGNR = 2"
  HMIRuntime.Trace "MsgFilterSQL set to MSGNR = 2" & vbNewLine
Else
  objAlarmControl.MsgFilterSQL = ""
  HMIRuntime.Trace "no filter" & vbNewLine
End If
```

**Example 2: Adding a column to WinCC AlarmControl**

The column "Message text" is added or removed if the column already exists. The status is also output in the dialog window. The message block of the "Message text" column has the object name "Text1".

```
'VBS354
'add this function to the declaration section
Function IsExistingMsgColumn( objAlarmControl, strName )
'this function checks if the MessageColumn exists
on error resume next
objAlarmControl.GetMessageColumn( strName )
If err.number = 0 Then
  IsExistingMsgColumn = True
else
  err.Clear
  IsExistingMsgColumn = False
end if
End Function

'example code
Dim objAlarmControl
Dim colMsgColumn
'create reference to the alarm control
Set objAlarmControl = ScreenItems("Control1")
Set colMsgColumn = objAlarmControl.GetMessageColumnCollection
'add or remove the MsgColumn
If ( IsExistingMsgColumn(objAlarmControl, "Text1") ) Then
  HMIRuntime.Trace "Remove MsgColumn" & vbNewLine
  colMsgColumn.RemoveItem("Text1")
Else
  HMIRuntime.Trace "Add MsgColumn" & vbNewLine
  colMsgColumn.AddItem("Text1")
End If
```

**Example 3: Output content of message window in dialog window**

```
'VBS355
Dim objAlarmControl
Dim lIndex
Dim lCellIndex
'create reference to the alarm control
Set objAlarmControl = ScreenItems("Control1")
'enumerate and trace out row numbers
For lIndex = 1 To objAlarmControl.GetRowCollection.Count
  HMIRuntime.trace "Row: " & (objAlarmControl.GetRow(lIndex).RowNumber) & " "
  'enumerate and trace out column titles and cell texts
  For lCellIndex = 1 To objAlarmControl.GetRow(lIndex).CellCount
    HMIRuntime.trace objAlarmControl.GetMessageColumn(lCellIndex -1).Name & " "
    HMIRuntime.trace objAlarmControl.GetRow(lIndex).CellText(lCellIndex) & " "
  Next
  HMIRuntime.trace vbNewLine
Next
```

## 1.15.3 General Examples

### 1.15.3.1 General examples for VBScript

#### Introduction

This section contains examples of the general use of VBScript with regard to the following topics:

- Program data connection with VBS
- To retrieve methods
- Using the MS Automation Interface
- Starting External Applications

---

#### Note

All objects supplied with the Windows Script Host (WSH) from Microsoft can be integrated in their environment using the standard VBS method "CreateObject". However, there is no direct access to the WSH object itself using VBS from WinCC.

Example 1: "FileSystemObject" object for working with the file system

```
Dim fso, MyFile
Set fso = CreateObject("Scripting.FileSystemObject")
Set MyFile = fso.CreateTextFile("c:\testfile.txt", True)
MyFile.WriteLine("This is a test.")
MyFile.Close
```

Example 2: "WScript.Shell"-Object for working with the Windows environment

---

#### See also

Example: Configuring a Database Connection with VBS (Page 856)

Example: Starting an external application (Page 859)

Example: Using the MS Automation interface (Page 858)

Example: Calling Methods of an ActiveX Control (Page 841)

### 1.15.3.2 Example: Configuring a Database Connection with VBS

#### Introduction

The following examples describe the configuration of an Access database link via an ODBC driver.

- Example 1 writes a tag value from WinCC in an Access database.
- Example 2 reads a value from the database and writes it in a WinCC tag.

The examples do not contain any handling faults.

#### Procedure, Example 1

1. Create the Access database with the WINCC\_DATA table and columns (ID, TagValue) with the ID as the Auto Value.
2. Set up the ODBC data source with the name "SampleDSN", reference to the above Access database.
3. Programming.

#### Example 1

```
'VBS108
Dim objConnection
Dim strConnectionString
Dim lngValue
Dim strSQL
Dim objCommand
strConnectionString = "Provider=MSDASQL;DSN=SampleDSN;UID=;PWD=;"
lngValue = HMIRuntime.Tags("Tag1").Read
strSQL = "INSERT INTO WINCC_DATA (TagValue) VALUES (" & lngValue & ");"
Set objConnection = CreateObject("ADODB.Connection")
objConnection.ConnectionString = strConnectionString
objConnection.Open
Set objCommand = CreateObject("ADODB.Command")
With objCommand
    .ActiveConnection = objConnection
    .CommandText = strSQL
End With
objCommand.Execute
Set objCommand = Nothing
objConnection.Close
Set objConnection = Nothing
```



## Procedure, Example 2

1. Create the WinCC tag with the name dbValue.
2. Create Access database with WINCC\_DATA table and ID, TagValue columns: ID, create TagValue (ID as auto value).
3. Set up the ODBC data source with the name "SampleDSN", reference to the above Access database.
4. Programming.

## Example 2

```
'VBS108a
Dim objConnection
Dim objCommand
Dim objRecordset
Dim strConnectionString
Dim strSQL
Dim lngValue
Dim lngCount
strConnectionString = "Provider=MSDASQL;DSN=SampleDSN;UID=;PWD="
strSQL = "select TagValue from WINCC_DATA where ID = 1"
Set objConnection = CreateObject("ADODB.Connection")
objConnection.ConnectionString = strConnectionString
objConnection.Open
Set objRecordset = CreateObject("ADODB.Recordset")
Set objCommand = CreateObject("ADODB.Command")
objCommand.ActiveConnection = objConnection
objCommand.CommandText = strSQL
Set objRecordset = objCommand.Execute
lngCount = objRecordset.Fields.Count
If (lngCount>0) Then
objRecordset.movefirst
lngValue = objRecordset.Fields(0).Value
HMIRuntime.Tags("dbValue").Write lngValue
Else
HMIRuntime.Trace "Selection returned no fields" & vbNewLine
End If
Set objCommand = Nothing
objConnection.Close
Set objRecordset = Nothing
Set objConnection = Nothing
```

There are several ways in which to define the ConnectionString for the connection depending on the provider used:

## 1.15 Examples of VBScript

### Microsoft OLE DB provider for ODBC

Enables connections to any ODBC data source. The corresponding syntax is:

```
"[Provider=MSDASQL;]{DSN=name|FileDSN=filename};  
[DATABASE=database;]UID=user; PWD=password"
```

### Other Microsoft OLE DB Providers (e.g. MS Jet, MS SQL Server)

It is possible to work without DSN. The corresponding syntax is:

```
"[Provider=provider;]DRIVER=driver; SERVER=server;  
DATABASE=database; UID=user; PWD=password"
```

### See also

General examples for VBScript (Page 855)

### 1.15.3.3 Example: Using the MS Automation interface

#### Introduction

The following three examples illustrate how to use the MS Automation interface.

#### Example 1: MS Excel

In this example, an output value from an input field is written in an Excel table.

```
'VBS113  
Dim objExcelApp  
Set objExcelApp = CreateObject("Excel.Application")  
objExcelApp.Visible = True  
,  
'ExcelExample.xls is to create before executing this procedure.  
'Replace <path> with the real path of the file ExcelExample.xls.  
objExcelApp.Workbooks.Open "<path>\ExcelExample.xls"  
objExcelApp.Cells(4, 3).Value = ScreenItems("IOField1").OutputValue  
objExcelApp.ActiveWorkbook.Save  
objExcelApp.Workbooks.Close  
objExcelApp.Quit  
Set objExcelApp = Nothing
```

## Example 2: MS Access

This example opens a report from MS Access.

```
'VBS114
Dim objAccessApp
Set objAccessApp = CreateObject("Access.Application")
objAccessApp.Visible = True
'
'DbSample.mdb and RPT_WINCC_DATA have to create before executing
'this procedure.
'Replace <path> with the real path of the database DbSample.mdb.
objAccessApp.OpenCurrentDatabase "<path>\DbSample.mdb", False
objAccessApp.DoCmd.OpenReport "RPT_WINCC_DATA", 2
objAccessApp.CloseCurrentDatabase
Set objAccessApp = Nothing
```

## Example 3: MS Internet Explorer

This example opens the MS IE.

```
'VBS115
Dim objIE
Set objIE = CreateObject("InternetExplorer.Application")
objIE.Navigate "http://www.siemens.de"
Do
Loop While objIE.Busy
objIE.Resizable = True
objIE.Width = 500
objIE.Height = 500
objIE.Left = 0
objIE.Top = 0
objIE.Visible = True
```

## See also

General examples for VBScript (Page 855)

### 1.15.3.4 Example: Starting an external application

## Introduction

The following two examples illustrate how to start an external application.

**Example:**

```
'VBS117  
Dim objWshShell  
Set objWshShell = CreateObject("Wscript.Shell")  
objWshShell.Run "Notepad Example.txt", 1
```

**See also**

General examples for VBScript (Page 855)

## 1.16 Basic Principles of VBScript

### 1.16.1 Basic Principles of VBScript

#### Introduction

The most important topics of the Microsoft VBScript Reference are provided below:

- VBScript Language Directory
- VBScript Tutorial with the most important basic principles
- Scripting runtime reference

If a full version of the VBScript Reference is required, it is available under

<http://msdn2.microsoft.com/en-us/library/t0aew7h6> (<http://msdn2.microsoft.com/en-us/library/t0aew7h6>)

#### See also

Microsoft VBScript Reference (<http://msdn2.microsoft.com/en-us/library/t0aew7h6>)

### 1.16.2 VBScript Basics



# ANSI-C for Creating Functions and Actions

## 2.1 Creating Functions and Actions with ANSI-C

### Contents

In Runtime, background tasks, such as printing daily reports, monitoring tags or performing picture-specific calculations, are performed as actions.

These actions are started by triggers.

Functions can be called from actions. WinCC has a multitude of functions, which can be modified by the user. Furthermore, the user can also develop his own functions.

The Global Script editor is used to create and edit functions and actions.

This chapter will show you

- How to use the Global Script editor
- How to create and edit functions
- How to create and edit actions
- How to use the diagnostic tools to analyze runtime problems


## 2.2 Creating Functions and Actions

### Introduction

WinCC supports the use of functions and actions for dynamization of the processes in your WinCC project. These functions and actions are written in ANSI-C.


### Difference between Functions and Actions

Actions are activated by a trigger, namely a triggering event. Functions do not have a trigger and are used as components of actions as well as in Dynamic Dialogs, in Tag Logging and in Alarm Logging.

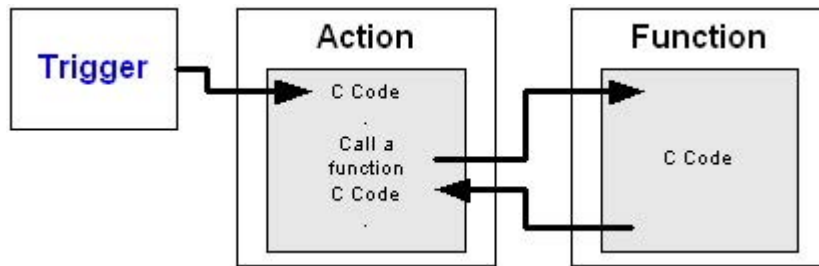

### Trigger Types


The following trigger types are available:

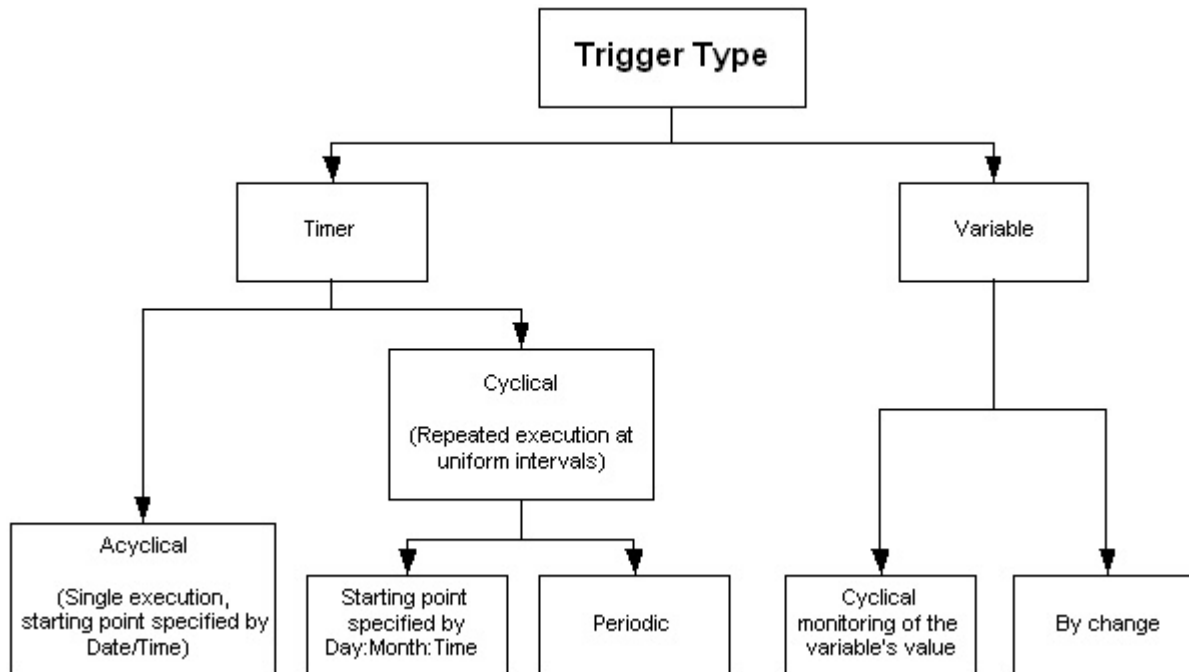



## Outline of the Functions and Actions

The diagram provides an overview of the range of functions and actions:

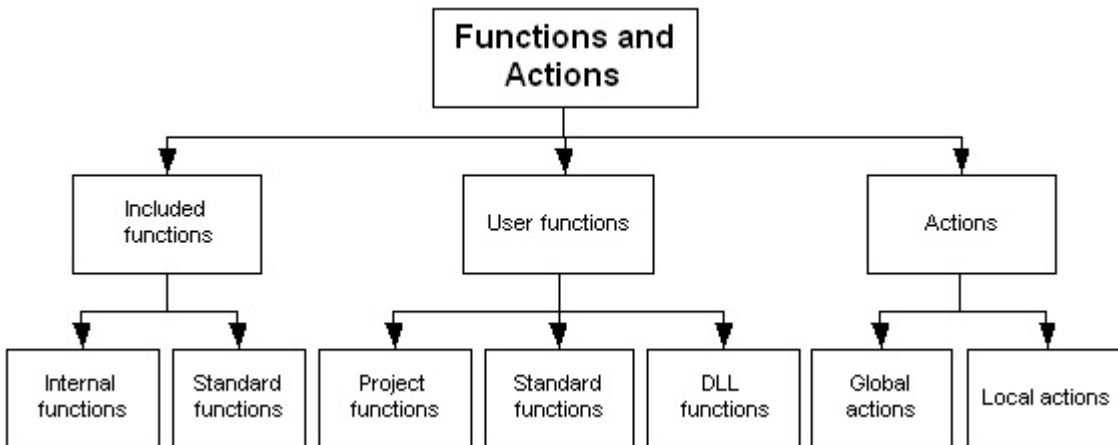

Actions are used for picture-independent background tasks, such as printing daily reports, monitoring tags or performing calculations.

Functions are pieces of code, which can be used in several locations, but are only defined in one place. WinCC includes a multitude of functions. Furthermore, you can also write your own functions and actions.

The included standard functions can be modified by the user. In the event that WinCC is reinstalled or upgraded, the standard functions that were modified are deleted or replaced by the unedited standard functions. Therefore, you should back up the modified functions prior to upgrading or reinstalling.

## Design tool

WinCC provides the "Global Script" editor for designing, creating and editing functions and actions. Global Script is started from the navigation window of WinCC Explorer.

## Unicode support

You can set the suitable code page in the toolbar of the "Global Script" editor. This means that the system language no longer has to be changed with the Microsoft setting "Start > Settings > Control Panel > Regional and Language Options".

You can select "Dynamic: Project setting" as the language setting for scripts. The C script is compiled in English. The code page of the centrally configured language is used for the strings in runtime.

You can specify the project setting in the "Project Properties" dialog in the WinCC Explorer. You can select the following from a list in the "Options" under "C scripts with "Dynamic" language setting in runtime":

- "Respective set WinCC Runtime language". The C script is executed in the WinCC Runtime language.
- Operating system language for non-Unicode programs.
- The C script is executed with the code page setting of the operating system. Select the language from the list.

### See also

Runtime Behavior of Actions (Page 927)

How To Create and Edit Actions (Page 905)

Creating and Editing Functions (Page 892)

The Global Script Editor (Page 878)

Use of DLLs in Functions and Actions (Page 876)

Use of Global C-Tags (Page 874)

How to Add Global Script Runtime to a Project's Startup List (Page 873)

How to Generate a New Header (Page 887)

Characteristics of Global Actions (Page 872)

Characteristics of Local Actions (Page 871)

Characteristics of Internal Functions (Page 870)

Characteristics of Standard Functions (Page 868)

Characteristics of Project Functions (Page 867)

## 2.3 Characteristics of Project Functions

### Characteristics of Project Functions

Project functions ...

- can be created by yourself
- can be edited by you
- can be password-protected against modification and viewing by unauthorized persons
- have no trigger
- are only known within the project
- are assigned file name extension `*.fct`

Project functions are saved in the `"library"` subdirectory of the WinCC project.



### Use of Project Functions

Project functions can be used...

- in other project functions
- in Global Script actions
- in C-Actions in the Graphics Designer and within the Dynamic Dialog
- in Alarm Logging within the Loop in Alarm functionality
- in Tag Logging when starting and releasing archives and when swapping-out cyclic archives

### See also

[How to Protect a Function Against Unauthorized Access \(Page 900\)](#)

[Creating and Editing Functions \(Page 892\)](#)


## 2.4 Characteristics of Standard Functions

### Characteristics of Standard Functions

Standard functions ...

- are provided for use in WinCC
- cannot be created by yourself
- can be edited by you
- can be password-protected against modification and viewing by unauthorized persons
- have no trigger
- are known across projects
- are assigned file name extension "\*.fct"

Standard functions are saved in the "aplib" subdirectories in the WinCC installation directory.

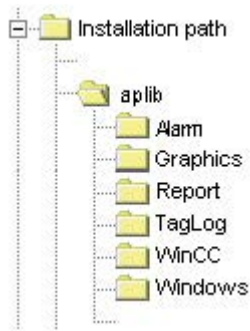

### Use of Standard Functions

Standard functions can be used...

- in project functions
- in other standard functions
- in Global Script actions
- in C-actions in the Graphics Designer and within the Dynamic Dialog
- in Alarm Logging within the Loop in Alarm functionality
- in Tag Logging when starting and releasing archives and when swapping-out cyclic archives

---

**Note**

The included standard functions can be edited by the user. In the event that WinCC is reinstalled or upgraded, the standard functions that were modified are deleted or replaced by the unedited standard functions. Therefore, you should back up the modified functions prior to upgrading or reinstalling.

---

**See also**

How to Use Standard and Project Functions (Page 897)

Creating and Editing Functions (Page 892)


## 2.5 Characteristics of Internal Functions

### Characteristics of Internal Functions

Internal functions ...

- are provided for use in WinCC
- **cannot** be created by you
- **cannot** be edited
- **cannot** be renamed
- have no trigger
- are know project-wide
- are assigned file name extension "\*.icf"

Internal functions are saved in the "\aplib" subdirectories in the WinCC installation directory.

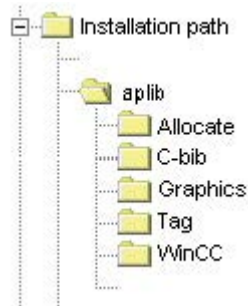

### Use of Internal Functions

Internal functions can be used...

- in project functions
- in standard functions
- in actions
- in C-actions in the Graphics Designer and within the Dynamic Dialog


## 2.6 Characteristics of Local Actions

### Characteristics of Local Actions

Local actions ...

- can be created by yourself
- can be edited by you
- can be password-protected against modification and viewing by unauthorized persons
- have at least one trigger
- are only executed on the assigned computer
- are assigned file name extension "\*.pas"

Local actions are saved in the "\\<computer\_name\Pas" subdirectory in the project directory.



### Use of Local Actions

Actions are used for picture-independent background tasks, such as printing daily reports, monitoring tags or performing calculations. An action is started by the trigger configured for it. In order for an action to be executed, Global Script Runtime must be included in the startup list.

In contrast to global actions, local actions can be assigned to a single computer. It is thus for example possible to ensure that a report is only printed on the server.

### See also

[How to Protect an Action Against Unauthorized Access \(Page 912\)](#)

[Triggers \(Page 914\)](#)

[How To Create and Edit Actions \(Page 905\)](#)

[How to Add Global Script Runtime to a Project's Startup List \(Page 873\)](#)

## 2.7 Characteristics of Global Actions

### Characteristics of Global Actions

Global actions ...

- can be created by yourself
- can be edited by you
- can be password-protected against modification and viewing by unauthorized persons
- have at least one trigger to start them
- are executed on all project computers in a client-server project
- are assigned file name extension ".pas"

Global Actions are saved in the "\Pas" subdirectory of the WinCC project.



### Use of Global Actions

Actions are used for background tasks, such as printing daily reports, monitoring tags or performing calculations. An action is started by the trigger configured for it. In order for an action to be executed, Global Script Runtime must be included in the startup list.

In contrast to local actions, global actions are executed on all project computers in a client-server project. In a single-user project there is no difference between global and local actions.

### See also

[How to Protect an Action Against Unauthorized Access \(Page 912\)](#)

[Triggers \(Page 914\)](#)

[How To Create and Edit Actions \(Page 905\)](#)

[How to Add Global Script Runtime to a Project's Startup List \(Page 873\)](#)




## 2.8 How to Add Global Script Runtime to a Project's Startup List

### Introduction

In order to run Global Script Actions in Runtime, Global Script Runtime must be added to the project's startup list. This does not affect the executability of the functions.

### Procedure

1. In the shortcut menu of computer in WinCC Explorer, select "Properties". The "Computer list properties" dialog opens.
2. Click "Properties". The "Computer Properties" dialog opens.
3. Select the "Startup" tab
4. Activate "Global Script Runtime".

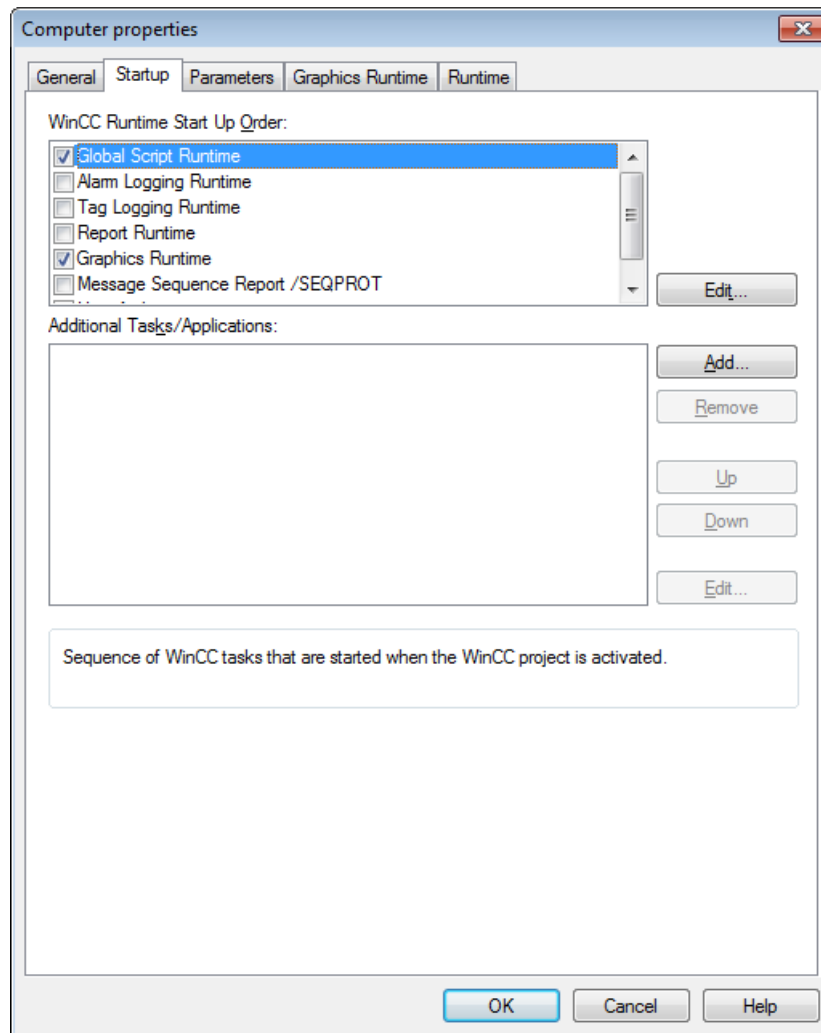

5. Click "OK" to close the dialog.

## 2.9 Use of Global C-Tags

### Definition of global C tags

A global C-tag is defined by adding the definition line in front of the function name of a function:

```
int a; //The tag a is defined as an integer
void dummy() //Function name
{
. //Function code
}
```

### Validity range

A tag defined in this manner is known to every function and action in Runtime. It is created as soon as Runtime is started, even if the function itself was not called.

---

#### Note

When you operate the WinCC Service Mode, there is no common data area for C scripting. Thus, for example, no global C variables can be exchanged between "Global Script" and the "Graphics Designer".

---

### Use of global C tags

Global C tags are used in functions or actions by declaring them as external within the function or action:

```
void dummy() //Function name
{
extern int a; //External declaration of the tag a
. //Function code
}
```

The compiler is thus informed that it need not create the tag, since it is created in another location in Runtime.

If the value of tag a changes, this change can be read by every function and action.

Each C-tag may only be defined in one location. For reasons of clarity and to avoid duplicate definitions, we recommend defining global C tags in only one location.

---

**Note**

A maximum of 64 Kbytes are available to a function and the global C-tag defined with it.

---

## 2.10 Use of DLLs in Functions and Actions

### Adjusting DLLs

WinCC allows you to use your own DLLs (Dynamic Link Libraries).

Functions in existing DLLs can be enabled for functions and actions by making the necessary additions to the respective function or action.

Add the following code in front of the function or action:

```
#pragma code("<Name>.dll")
<Type of returned value> <Function_name 1>(...);
<Type of returned value> <Function_name2>(...);
.
.
.
<Type of returned value> <Function_name n>(...);
#pragma code()
```

The functions <Function\_name 1> ... <Function\_name n> from <Name.dll> are declared and can now be called by the respective function or action.

Example:

```
#pragma code("kernel32.dll")
VOID GetLocalTime(LPSYSTEMTIME lpSystemTime);
#pragma code()

SYSTEMTIME st;

GetLocalTime(&st);
```

As an alternative to this procedure, you can also make the necessary additions in the "Apdefap.h" header file.

When using own DLLs in WinCC, you must use the release version. WinCC is delivered as a release version and thus uses the release version of the system DLLs. If you generate a custom DLL in the debug version, it is possible that both the release and the debug version of the DLL are loaded, increasing the memory requirements.

Structures of the DLL have to be set up using 1-byte alignment.

---

**Note**

The DLL must be saved in either the "\bin" directory or in a path defined in the "PATH" system tag. This tag is defined in the operating system properties.

---

## 2.11 The Global Script Editor


### 2.11.1 The Global Script Editor

#### Introduction

WinCC supports the creation and editing of functions and actions with the Global Script editor. Global Script is started from the project window of WinCC Explorer.

#### Structure of the Global Script Editor

The Global Script editor is designed in accordance with the Windows standards. It comes with toolbars, a menu bar and a status bar. It has several windows featuring drop-down menus.

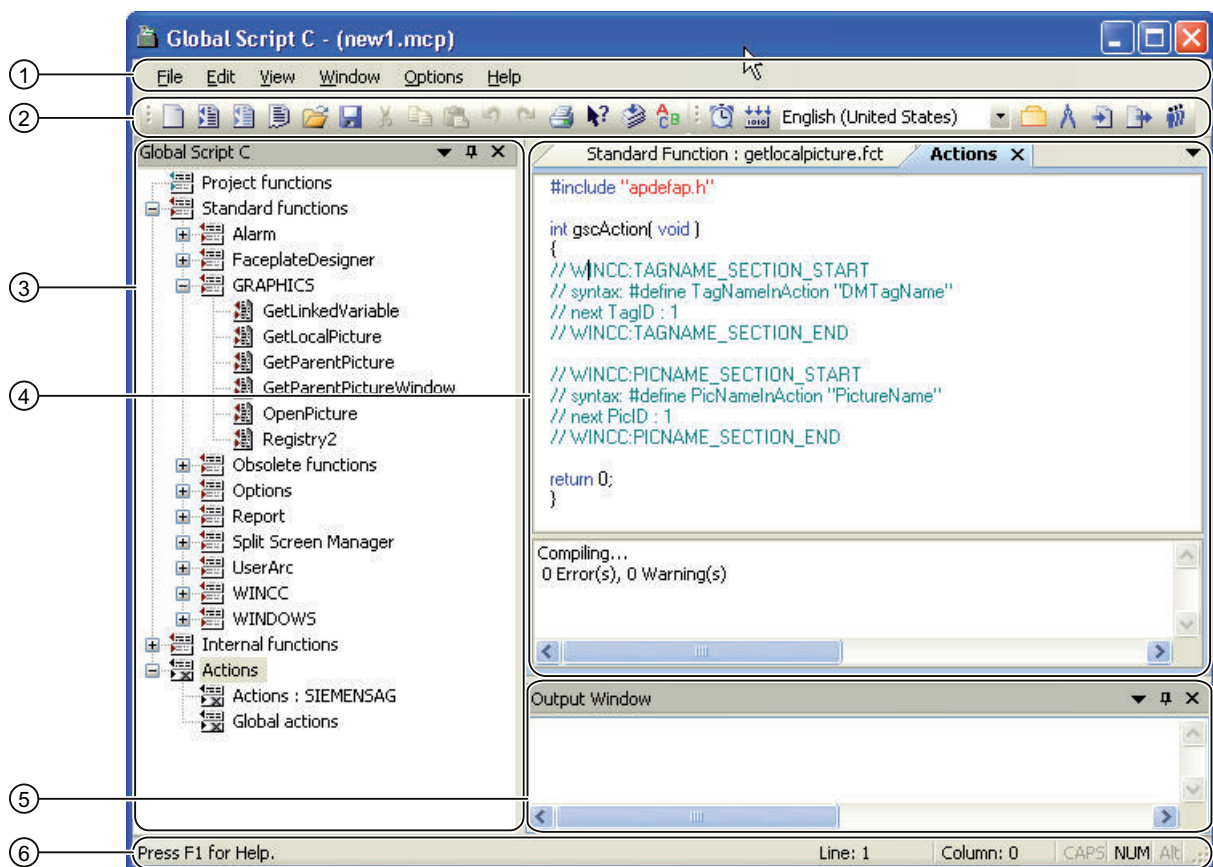

#### Menu bar (1)

The menu bar content depends on the situation. It is always visible.

#### Toolbars (2)

Global Script contains two toolbars. You may always unhide these toolbars and use the mouse

to move them to any screen position.

You may hide/unhide the toolbars using the "View" > "Toolbars" menu command and move these to any position in the editor.

### Navigation window (3)

The navigation window serves to select functions and actions for editing, or to insert an editing window at the cursor position. The functions and actions are organized in groups with hierarchic order. Functions are always displayed by their function name, while actions are displayed by their file name.

### Editing window (4)

The editing window is used to edit functions and actions. It is only visible when a function or action has been opened for editing. Each function or action is opened in a separate edit window. Several editing windows can be opened simultaneously.

### Output window (5)

The output window displays results of the "Search in files" or "Compile all functions" functions. By default, it is visible, but can be hidden.

- Search in files:  
A hit list is returned for each search term found in a single line of the output window, which consists of the line number, path and file name, as well as the line text with the specified number of the line in which the search term was found. You can directly open the corresponding file by double-clicking an entry in the output window. The cursor is placed in the line in which the search term was found.
- Compile All Functions:  
Compiler warnings and error messages are output for all functions compiled. In the next line, the path and file name of the compiled function as well as the summary message from the compiler are displayed.

### Status bar (6)

The status bar is located on the bottom edge of the Global Script window; you may hide/unhide the status bar. It contains information about the position of the cursor in the edit window and the keyboard settings. In addition, the status bar shows either a brief description for the currently selected Global Script functionality or a tip.

## Window docking



Window docking is a useful tool for the flexible arrangement of windows. It lets you reposition windows to obtain separate windows, or to group windows in tab groups. For example, you can arrange your actions horizontally, vertically, or as tab group. You may hide windows automatically and show these again as required.

For more information, refer to chapter "Creating process pictures".

## See also

Printing Functions and Actions (Page 890)

How to Search in Files (Page 889)

How to Compile All Functions (Page 888)

How to Generate a New Header (Page 887)

How to Delete Actions or Project and Standard Functions (Page 887)

How to Use "Save As..." (Page 886)

How to Set the Font Style (Page 885)

How to Set Different Views (Page 885)

Working with the Toolbars (Page 882)

Working in the Edit Window (Page 880)


## 2.11.2 Working in the Edit Window

### 2.11.2.1 Working in the Edit Window

#### Introduction

The edit window includes an array of functions, which can be executed with either the keyboard or the mouse.

In the edit window, you can edit functions and actions.

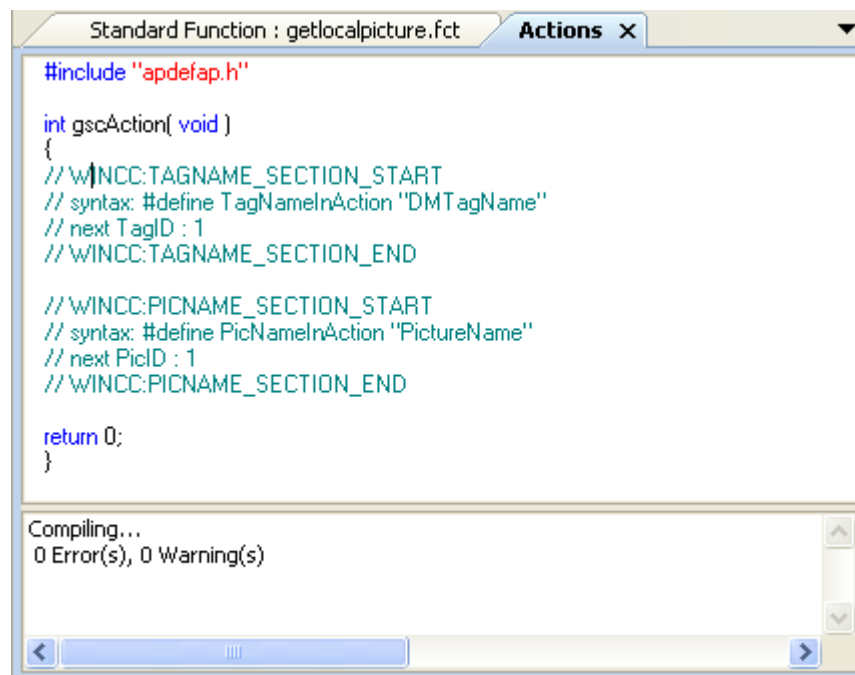

#### Contents

The window can be split. The upper part of the edit window displays the code of the function or action. In the lower part, you can see the messages that the compiler output while compiling the function or action.



## Properties

When the window is opened for the first time, the lower part of the window is minimized. When the compiler process is started, the lower part of the window is enlarged to allow for the display of the compiler messages. The division of the window can be adjusted with the mouse. Double-click an error message to jump to the corresponding line in the code.

## Color code

The C code is color-coded as follows:

Color	Description	Example
Blue	Keywords	define, double, if
Green	Comments	// is a comment
Red	Strings	"Rectangle3"
Black	Other C-codes	level=100*newvalue/255;

---

### Note

A function or action cannot have more than 32767 characters including spaces.

---

## See also

Editing Functions with the Mouse (Page 882)

Editing Functions with the Keyboard (Page 881)

### 2.11.2.2 Editing Functions with the Keyboard

You can carry out the following editing functions using the keyboard:

Editing function	Keyboard operation
Switch between write modes Insert/Overwrite	<INSERT>
Add new line	<ENTER>
Delete one character to the right	<DELETE>
Delete one character to the left	<BACKSPACE>
Delete marked text	<DELETE> or <BACKSPACE>
Jump to beginning of line	<POS1>
Jump to end of line	<END>
Jump to beginning of text	<CTRL+POS1>
Jump to end of text	<CTRL+END>
Move cursor	<Cursor keys>
Move cursor by one window content to beginning of text	<PAGE UP>
Move cursor by one window content to end of text	<PAGE DOWN>
Move cursor to first line in window	<CTRL+PAGE UP>

Editing function	Keyboard operation
Move cursor to last line in window	<CTRL+PAGE DOWN>
Jump to next tab position	<TAB>
Cut marked text and paste to clipboard	<CTRL+X>
Copy marked text to clipboard	<CTRL+C>
Paste text from clipboard	<CTRL+V>

### 2.11.2.3 Editing Functions with the Mouse

You can carry out the following editing functions using the mouse:

Editing function	Mouse command (left mouse button)
Select text	Drag mouse over text
Select a word	Double-click the word
Select a line	Triple-click the line
Extended selection	<SHIFT> + mouse-click
Set cursor	Click
Move selected text	Drag and drop
Duplicate selected text	<CTRL>+drag and drop

Other editing functions:

- By double-clicking a compiler error message, the editor jumps to the corresponding line in the code.
- Right-clicking calls up a shortcut menu.

With the following actions, the selected text is replaced by the result of the action:

- Input of character(s) through the keyboard
- Pasting of text from the clipboard
- Insertion of a function call by means of parameter assignment

### 2.11.3 Working with the Toolbars

#### Purpose
















The toolbars are located in their default position below the menu bar, at the top of the Global Script window. The toolbar buttons allow for fast and easy execution to a number of Global Script functions.

There are two toolbars available:

#### "Standard" toolbar

**"Edit" toolbar****Contents**









The standard toolbar contains buttons for the following functions:

Button	Function	Key combination
	Creates a new action.	<ALT+A> or <CTRL+N>
	Creates a new standard function.	<ALT+S> or <CTRL+N>
	Creates a new project function.	<ALT+P> or <CTRL+N>
	Creates a new header file.	<CTRL+H>
	Opens an existing action or function.	<CTRL+O>
	Saves the content of the active editing window. This function is only available if an editing window is open.	<CTRL+S>
	Cuts the selected text and copies it to the clipboard. This function is only available if text has been selected.	<CTRL+X>
	Copies the selected text to the clipboard. This function is only available if text has been selected.	<CTRL+C>
	Pastes the contents of the clipboard at the location of the cursor. This function is only available if the clipboard is not empty.	<CTRL+V>
	Undoes the last of a maximum of 30 editor actions. This function is only available if an editor action has been performed.	<CTRL+Z>
	Redoes the last editor action that was undone. This function is only available if an editor action has been undone.	<CTRL+A>
	Prints the contents of the active editing window as project documentation. This function is only available if an editing window is open.	<CTRL+P>
	Activates the direct help (What's this?).	<SHIFT+F1>
	Generates a new header.	<CTRL+G>
	Allows you to set the font.	<CTRL+F>

**Note**

The key combination <CTRL+N> is only available if at least one editing window is open. If the active editing window contains a function and <CTRL+N> is pressed, a new project function is created. If the active editing window contains an action, this key combination creates a new global action.

The editing toolbar contains buttons for the following functions:

Button	Function	Key combination
	Enables you to add information about functions and, in the case of an action, to setup a trigger. This function is only available if an editing window is open.	<CTRL+I>
	Compiles the code in the active editing window. This function is only available if an editing window is open.	<SHIFT+F8>
English (United States) 	Set the appropriate code page. Verify that the code page selection matches the source text. You cannot use more than one language in the source text.	-
	Opens the tag dialog. This function is only available if an editing window is open.	<CTRL+R>
	Opens a dialog for the selection of a picture. The name of the selected picture is inserted at the position of the cursor in the editing window. This function is only available if an editing window is open.	<CTRL+W>
	Imports an action. This function is only available if the active window contains an action.	<CTRL+M>
	Exports the action from the active editing window. This function is only available if the active window contains an action.	<CTRL+T>
	Sets the authorization for operating the action. This function is only available if the active window contains an action.	<CTRL+E>

**Properties**

Both toolbars can be shown or hidden.

They can be pinned below the menu bar.

When they are not pinned down, they can be dragged with the mouse to any position on the screen.

## See also

How to Set Different Views (Page 885)

## 2.11.4 How to Set Different Views

### Introduction

In this context, views are considered to be different combinations of elements visible in the Global Script editor, such as the output window, status bar and toolbars. These elements can be individually displayed or hidden.

By default, all elements are visible.

### Procedure

1. Opens the "View" menu in the Global Script menu bar.
2. Activate or deactivate the display of the desired elements e.g. the toolbars. If "show" is chosen, a check mark is displayed in front of the name.

---

#### Note

When Global Script restarted, the editor reverts to the default settings and all elements are again visible.

---


## 2.11.5 How to Set the Font Style

### Introduction

The font style is composed of the settings "Font", "Style" and "Size".

The style selected is active in all edit windows.

### Procedure

1. Click the  button in the standard toolbar to open the dialog for setting the font style.
2. Make the desired settings.
3. Confirm your settings by clicking "OK".

### Alternative procedure

You can also open the dialog for the font style settings in the following manner:

Select the "Options" menu in the Global Scripts menu bar and select "Font", or use the corresponding key combination.

---

#### Note

The settings are automatically saved and are not reset when WinCC is restarted.

---

## 2.11.6 How to Use "Save As..."

### Introduction

If a function or action is created, Global Script saves the corresponding file in a predefined path with a default file name, e.g. "new\_function\_1.fct" for functions and "gscs1.pas" for actions. Since these default file names are not particularly useful, use "Save As ..." to save the function or action under a different - more meaningful - file name. The file with the default file name is retained.

With "Save As ...", only the file name is changed, the function or action name remains unchanged.

Global Script expects that the function or action is saved in a project directory. If this is not the case, a message is displayed, but the file is saved nonetheless.

### Requirement

"Save As..." is only available, if at least one edit window is open. It saves the content of the active edit window.

### Procedure

1. In the Global Script menu bar, open the "File" menu.
2. Select "Save As...".
3. Enter the new file name.
4. Close the dialog by clicking the "Save" button.

### See also

How to Delete Actions or Project and Standard Functions (Page 887)

## 2.11.7 How to Delete Actions or Project and Standard Functions

### Introduction

Actions or project and standard functions can be deleted during configuration or in Runtime. Global Script deletes the entry in the navigation window as well as the associated file.

If a deleted function is called by an action, the action is terminated upon calling the function.

If a Global Script diagnostic window is open at this time, a message is displayed. The termination of the action is logged in the "WinCC\_Sys\_xx.log" diagnostic file (xx = consecutive number). This diagnostic file is located in the "Diagnostics" subdirectory of the WinCC installation directory.

### Procedure

1. In the Global Script navigation window, call up the shortcut menu for the function or action to be deleted.
2. Select "Delete".
3. Confirm the command by clicking "Yes".

### Alternative operation

Instead of using the shortcut menu, you can also delete the selected function or action by using the <DELETE> key.

---

#### Note

If a function is deleted, the entry in the respective header file is deleted as well.

---

## 2.11.8 How to Generate a New Header


### Introduction

The header must be generated again in the following cases:

- After you have copied project functions from a different project to the "library" directory in your project path.
- After you have copied standard functions from another PC to the "aplib" directory or subdirectories.

By regenerating the header, you enter the copied functions in the respective header files. You can then use the functions in your project.

### Procedure

1. Click  in the "Standard" toolbar.

### Alternative operation

Alternatively, you can start a generation process as follows:

Open the "Options" menu and select "Regenerate Header" or use the corresponding key combination.

---

#### Note

Once the regeneration is finished, the contents of the navigation window are updated.

If WinCC is in Runtime, the Runtime system is not influenced by the regeneration of the header.

---

## 2.11.9 How to Compile All Functions

### Introduction

If you have changed the header files manually, you have to recompile all functions. All project functions, standard functions and internal functions are automatically compiled with the menu command "Compile all functions".

If functions are called in other functions, error messages are possible. The reason for this is that the called functions have not yet been compiled. These functions must then be compiled individually.

### Requirement

This function is only available, if all edit windows are closed.

### Procedure

1. Open the "Options" menu.
2. Select "Compile All Functions".

### Alternative operation

You can compile all functions using the key combination <ALT+U>.



## Result

The results of the individual compilation runs are displayed in the output window, e.g. warnings and error messages of the compiler. The path and the file name of the compiled function as well as the summary message of the compiler are also displayed.

---

### Note

In a multi-user project, the "Compile All Functions" function is not available. Assigning functions is no longer possible with these projects.

The functions compiled in this way will not become active until the next time you start Runtime on a WinCC PC.

---

## 2.11.10 How to Search in Files

### Introduction

All files of the group selected in the navigation window are searched for the specified search term.

The result of the search is displayed in the output window as follows:

For each found search term, a line is displayed in the output window. This line contains the line number of the line in the code in which the search term was found, plus the path and file name as well as the line of code itself.

Standard and project functions as well as actions can be opened by double-clicking the search results. The cursor is positioned at the start of the line in which the search term was found. In the case of internal functions, the function containing the search term is shown in the navigation window and selected.

### Procedure

1. Open the shortcut menu for the group to be searched in the Global Script navigation window.
2. Select "Find in Files".
3. In the dialog, enter the search term to be found.
4. Click "Find" to start the search. The result of the search is displayed in the output window.

## 2.11.11 Printing Functions and Actions

### 2.11.11.1 Printing Functions and Actions

#### Introduction

Actions or project or standard functions can be printed using specified system layouts.

This is however only possible, if the function or action to be printed is displayed in the edit window. The content of the active edit window is printed.

The printout can be examined on the screen in page view.

The printing process can be controlled by a number of print parameters.

The following system layouts are used:

- @gsc\_pfc.rpl for project functions
- @gsc\_sfc.rpl for standard functions
- @gsc\_act.rpl for actions

#### See also

How to Print the Project Documentation (Page 891)

How to Open Page View (Page 891)

How to Set the Print Parameters (Page 890)

### 2.11.11.2 How to Set the Print Parameters

#### Introduction

You can modify the printout as follows:

- By specifying a layout that differs from the standard layout
- By selecting a page range
- By selecting a printer selection
- By printing to file

#### Requirement

At least one edit window must be open.

#### Procedure

1. In the Global Script menu bar, open the "File" menu.
2. Select "Project Documentation Setup..."

3. In the subsequent dialog, adjust the desired settings.
4. Apply the settings by clicking "OK".

---

**Note**

The settings are automatically saved and are not reset when WinCC is restarted.

---

### 2.11.11.3 How to Open Page View

#### Introduction

Before you begin printing a function or action, it is sometimes an advantage to first see a preview of the printout on the screen (in page view).

The content of the active edit window is displayed in page view.

#### Procedure

1. In the Global Script menu bar, open the "File" menu.
2. Select "Project Documentation Setup...".

### 2.11.11.4 How to Print the Project Documentation

#### Introduction

You can output the contents of the active edit window to a printer or to a file. The selected print parameter settings are applied.

#### Procedure

1. In the Global Script menu bar, open the "File" menu.
2. Select "Print Project Documentation".

## 2.12 Creating and Editing Functions

### 2.12.1 Creating and Editing Functions

#### Introduction

The system distinguishes between project, standard and internal functions. WinCC is delivered with a broad selection of standard and internal functions. Furthermore, you can create your own project and standard functions or modify standard functions. Please remember, however, that the standard functions included with WinCC are overwritten when WinCC is reinstalled so any modifications are lost.


Internal functions cannot be created or edited.

#### Using Functions

If the same calculation must be performed - with different starting values - in several actions, it would be to your advantage to program a function to perform this calculation. Subsequently you can simply call this function with the current parameters in the actions.

This approach has a number of advantages:


- The code is only programmed once.
- Modifications are only made at one point, namely in the procedure, not in each action.
- The action code is shorter and, thus clearer.

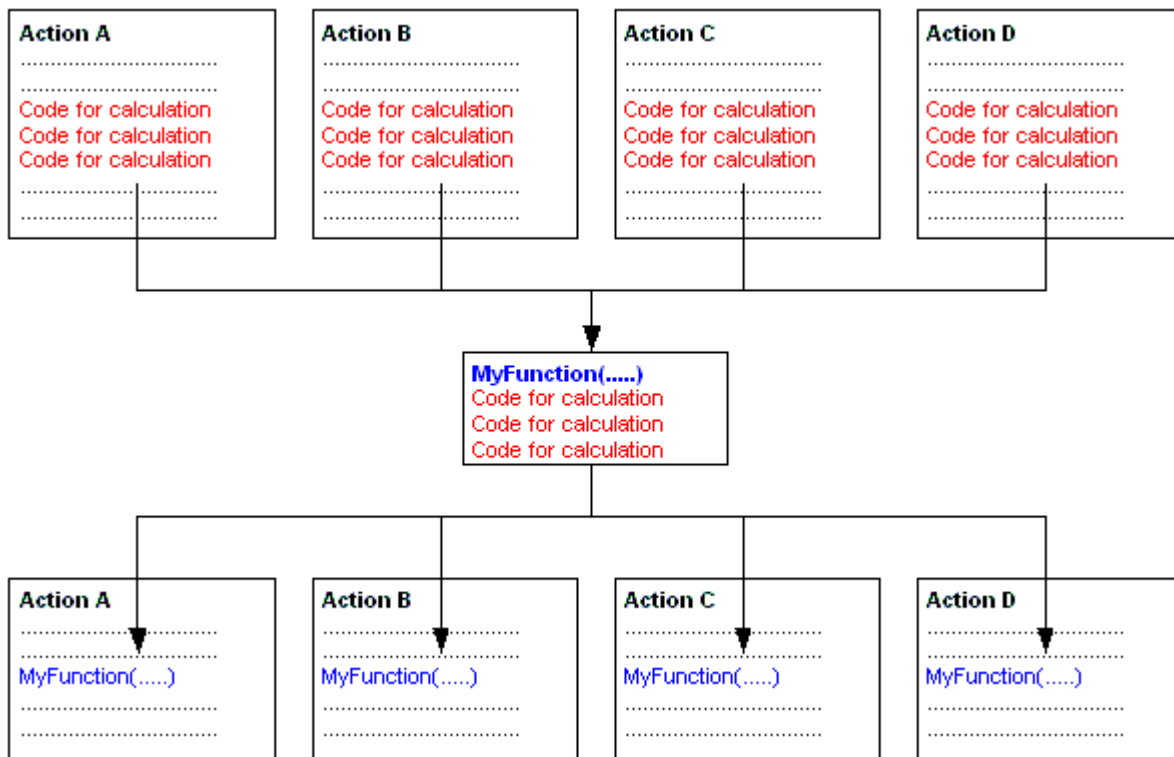

## Finding Functions

To access existing functions or create new ones, you can either use the "File" menu in the Global Script navigation window or click the corresponding button in the toolbar.

Functions are stored in the file system as follows:

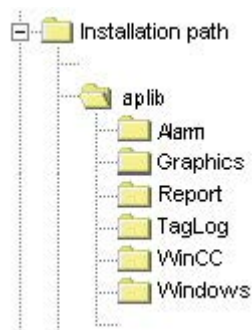


## Editing and Compiling Functions


A function is edited and compiled in its own edit window. The edit window displays messages from the compiler after a compilation run. These might be warnings or error messages. In each case, a summary of the number of warnings and error messages is output.

## What Happens When Functions Are Renamed?

In the navigation window, functions are always displayed with their function not their Windows file names. If you change the name of a function and then compile it, the name displayed in the navigation window longer match the function name. This is indicated in the navigation window with the prefix "\*" (asterisk) in front of the name. As soon as you save the function, the current function name is displayed in the navigation window.

## Note re. Saving Functions

If you save a function that has not been properly compiled, the  symbol is shown in the navigation window.

If you save a function that has not been compiled without errors, the  symbol is shown in the navigation window.

## See also

- Working in the Edit Window (Page 880)
- How to Use Functions from Other Sources (Page 903)
- How to Rename a Function (Page 902)
- How to Compile and Save a Function (Page 901)
- How to Protect a Function Against Unauthorized Access (Page 900)
- Inserting Additional Function-Related Information (Page 898)
- How to Use Standard and Project Functions (Page 897)
- How to Use Internal Functions (Page 897)
- How to Write Function Code (Page 896)
- How to Create a New Function (Page 895)
- Characteristics of Standard Functions (Page 868)
- Characteristics of Project Functions (Page 867)


## 2.12.2 How to Create a New Function

### Introduction

The procedure is identical for both project and standard functions. In the navigation window, specify the type (project or standard function) and, for standard functions, the group, e.g. "graphics". This also specifies the place where the file is to be saved.

Global Script suggests a default name, e.g. "new\_function\_3", for the new function. This is also the file name of the function. To ensure that the function name is unique, the suggested name includes a sequential number.

As a rule, the default name should be replaced with a more informative function name. When the renamed function is first saved, the file name can also be changed.

Global Script adds the following information to the function: date created, date modified and version. This information can be viewed in the "Properties" dialog. In the same dialog, you can also assign a password to protect the function against unauthorized modification or viewing. To open the dialog, click the  button.

---

### Note

The characters supported by ANSI-C are also supported for the function name:

- Letters, apart from regional special characters
  - Numbers
  - Underscore
- 

### Procedure

1. In the navigation window, open the shortcut menu for the desired group.
2. Select "New"  
If a new function has been created, the first line of code in the associated edit window contains the type of return value and the default name of the new function. In the brackets following this, you can enter transfer parameters if you wish.  
The function code is entered between the curly brackets.

### Alternative operation

Alternatively, you can also create a new function by clicking the associated button in the toolbar, via the "File" menu or by using the corresponding key combination.

### See also

Inserting Additional Function-Related Information (Page 898)

How to Use "Save As..." (Page 886)

## 2.12.3 How to Write Function Code

### Introduction

The function code is written in the edit window for the function. The programming language is ANSI-C.

The code of any project or standard function can call other functions. The called function can be a project, standard, internal or DLL function. To make certain that the called function is known to the calling function, the line `#include "apdefap.h"` is added as the first line of code in the calling function code.

In the navigation window under "Internal Functions", the C-function library is available as "c\_bib".

The first line of code contains the type of the returned value and the default name of the new function. Parameters can be passed by entering them in the following brackets.


The function code is entered between the braces.

### Procedure

1. Double-click the function in the navigation window to open it in an edit window.
2. Set the cursor where you wish to begin writing.
3. Enter the desired code.

### Alternative operation

You can also open a function as follows:

In the navigation window, open the shortcut menu for the desired action and click "Open" or "File\Open...". You can also click the  button in the standard toolbar or use the corresponding key combination.

---

#### Note

A maximum of 32 Kbytes of memory is available for local tags (tags defined within the braces of the function code).

---

### See also

[How to Use Standard and Project Functions \(Page 897\)](#)

[How to Use Internal Functions \(Page 897\)](#)

[Editing Functions with the Mouse \(Page 882\)](#)

[Editing Functions with the Keyboard \(Page 881\)](#)

[Working in the Edit Window \(Page 880\)](#)



## 2.12.4 How to Use Internal Functions

### Introduction

You can use any of the internal functions as part of your function code. The internal functions are found in the navigation window in the "Internal Functions" group.

If you have used the "Assigning Parameters" dialog to add a function, the function's comments show the type of value returned.

### Procedure

1. Place the cursor at the point at which the internal function is to be inserted.
2. In the navigation window, open the shortcut menu for the internal function to be added.
3. Select "Assigning Parameters". The "Assigning Parameters" dialog is opened. This dialog has one line for each parameter. In the "Value" column, enter the respective current parameter.
4. In the "Value" column, enter the current value for each of the required parameters. This can be accomplished by either a direct entry from the keyboard, or you can open the menu in the "Value" column (single-click and then click the displayed button). From the menu, you can open the selection dialog for tags, pictures or graphic objects.
5. Confirm your entries with "OK". The parameterized function is inserted in the edit window at the location of the cursor.

### Alternative operation

Alternatively you can also open the "Assigning Parameters" dialog for an internal function by double-clicking the function to be added.

---

#### Note

If you close the "Assigning Parameters" dialog with "OK" without entering the current parameter value, the internal function is inserted with its formal parameters. You can then set the parameters in the edit window at a later stage.

Instead of using the "Assigning Parameters" dialog, you can also use the keyboard to enter the function.

---

## 2.12.5 How to Use Standard and Project Functions

### Introduction

You can use any project or standard function as part of the function code, if you have first added the line `#include "apdefap.h"` in the header. The project functions are found in the navigation window in the "Project Functions" group. The standard functions are found in the navigation window in the "Standard Functions" group.

Project functions are entered in the "Ap\_pbib.h" header file; standard functions are entered in the "Ap\_glob.h" header file. These entries are made by the system. The " Ap\_glob.h" header file is integrated into the "Ap\_pbib.h" header file. The "Ap\_pbib.h" header file itself is linked to the "Apdefap.h" header file. Therefore all project and standard functions are declared in the "Apdefap.h" file header.

To inform the compiler of the project and standard functions added, add the line `#include "apdefap.h"` as the first line in the function code.

If you have used the "Assigning Parameters" dialog to add a function, the function comments show the type of value returned.

## Procedure

1. Place the cursor at the point at which the project or standard function is to be inserted.
2. In the navigation window, open the shortcut menu for the function to be added.
3. Select "Assigning Parameters". The "Assigning Parameters" dialog is opened. This dialog has one line for each parameter. In the "Value" column, enter the respective current parameter.
4. In the "Value" column, enter the current value for each of the required parameters. This can be accomplished by either a direct entry from the keyboard, or you can open the menu in the "Value" column (single-click and then click the displayed button). From the menu, you can open the selection dialog for tags, pictures or graphic objects.
5. Confirm the entries by clicking "OK".

---

### Note

If the function does not require a parameter, it is added to the function code immediately without opening the "Assigning Parameters" dialog.

If you close the "Assigning Parameters" dialog with "OK" without entering the current parameter value, the internal function is inserted with its formal parameters. You can then set the parameters in the edit window at a later stage.

---

## 2.12.6 Inserting Additional Function-Related Information

### Introduction


Additional information can be assigned to every function.


When a new action is created, the creation date is automatically entered in the function-related information and is unchangeable. In addition, the version number 1.0 is also assigned to the number. The version numbers can be individually assigned when editing a function. When a function is changed and saved, the current date of change is entered automatically and is unchangeable. This dialog can be used to assign a password to protect the function from unauthorized viewing and modification.

## Requirements

The function to which the information relates must be open in an edit window.

## Procedure

1. Click the  button in the editing toolbar. The "Properties" dialog is opened.
2. Select the required entries.

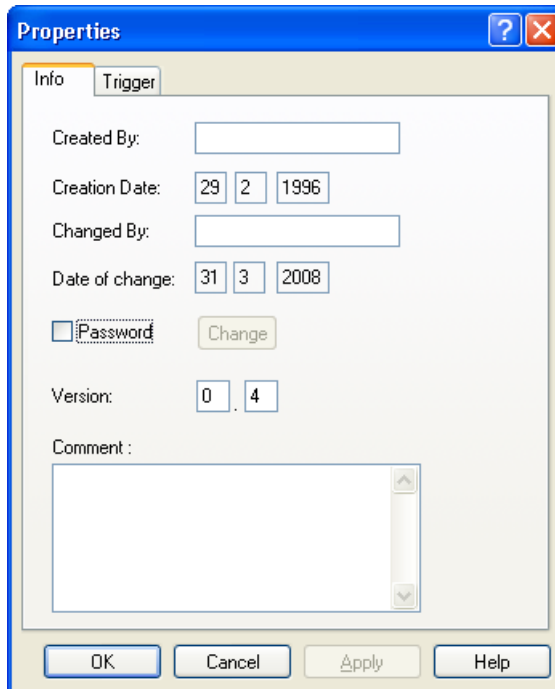

The screenshot shows a "Properties" dialog box with two tabs: "Info" and "Trigger". The "Info" tab is active. It contains the following fields and controls:

- Created By: [Empty text box]
- Creation Date: [29] [2] [1996]
- Changed By: [Empty text box]
- Date of change: [31] [3] [2008]
- Password [Change button]
- Version: [0] [.] [4]
- Comment: [Empty text area]

At the bottom of the dialog are four buttons: OK, Cancel, Apply, and Help.

3. Confirm the entries by clicking "OK".

## Alternative operation

Alternatively, the "Properties" dialog can be opened as follows:

Click the "Edit" menu and select the "Info" option or use the corresponding key combination.

## See also

How to Protect a Function Against Unauthorized Access (Page 900)

How to Set Different Views (Page 885)

Working with the Toolbars (Page 882)

## 2.12.7 How to Protect a Function Against Unauthorized Access


### Introduction


Functions can be protected with a password against unauthorized read and write access. The password is a part of the function-related information.

### Requirements

The function to be compiled must be opened in the edit window.

### Procedure

1. Click the  button in the editing toolbar. The "Properties" dialog is opened.
2. Select the "Password" check box.
3. Click the "Change" button.

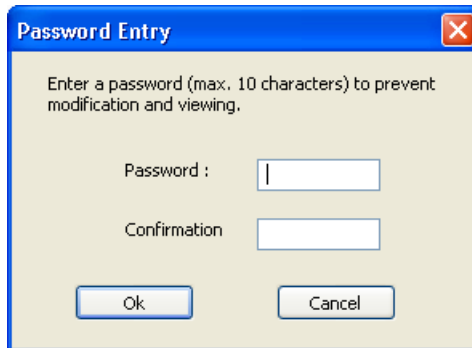

4. Enter the password in the "Password" field.
5. Enter the password again in the "Confirmation" field.
6. Confirm your entries with "OK".
7. Click "OK" to close the dialog.

### Alternative operation

Alternatively, the "Properties" dialog can be opened as follows:

Click the "Edit" menu and select the "Info" option or use the corresponding key combination.

---

#### Note

A password-protected function can only be opened in the edit window if the correct password is entered.

To deactivate the password protection, clear the "Password" check box.

---

## See also

How to Set Different Views (Page 885)

Working with the Toolbars (Page 882)

## 2.12.8 How to Compile and Save a Function

### Introduction


In order to use a function, it must first be compiled. Only the function in the active edit window is compiled.


Errors reported by the compiler are displayed in the lower portion of the window. Each message is displayed on a separate line. The line includes the line number in the source code where the error occurred, a hexadecimal encoded error code and a description of the error.

Double-click such a line to select the source code line where the error occurred.

It is recommended that you examine the first message error listed, as subsequent ones could be errors resulting from the first one. If the first error is corrected, then the others might disappear after the next compilation.

To make the changes permanent, the function must be saved.



If you save a function that has been compiled with errors, or not at all, the  icon is assigned to this function in the navigation window.

If you save a function that has been compiled without errors, the  icon is assigned to this function in the navigation window.

### Requirements

The function to be compiled must be opened in the edit window.

### Procedure

1. Use the toolbar to set the language for compilation of the C function.
2. Click  on the "Edit" toolbar.
3. Examine the compiler messages in the lower portion of the edit window.
4. If the compiler reported an error, the function code must be corrected. After this has been done, start again with step 1 in this table.
5. If the compiler generated warnings, the function source code may require correction. After the code has been corrected, start again with step 1 in this table, otherwise proceed to step 6.
6. Click  on the "Default" toolbar.

### Alternative operation

Alternatively, the compilation process can be initiated in the following ways:

Select "Compile" from the "Edit" menu, select the "Compile" option from the shortcut menu of the edit window or use the corresponding key combination.

Saving may also be performed in the following ways:

Select "Save" from the "File" menu or use the corresponding key combination.

---

### Note

The compiler does not output an error message if tag names are used several times in a C function. This is also the case if a tag name is used both as transfer parameter and as local tag definition.

For example, the following faulty script does not trigger an error message in the compiler:

```
void neue_Funktion(DWORD dwMyVar)
{
    DWORD dwMyVar = 0;
}
```

Message in the output window of the compiler:

Compiling ...

0 Error(s), 0 Warning(s)

---

### See also

Runtime Behavior of Actions (Page 927)

## 2.12.9 How to Rename a Function

### Introduction

It is recommended that you rename the function, when it is created.

The name of the function in the edit window is then changed accordingly. Since this also changes the code, the function must be recompiled. The old function name, displayed in the navigation window, is assigned prefix "\*" (asterisk).

Afterwards, the modified function must be saved at which time you can change the path and file name. The old function should then be deleted to avoid accumulating a collection of obsolete functions.



---

**Note**

Please note that only certain characters may be used in function names: characters (with the exception of national special characters), numbers and the underscore.

---

**Procedure**

1. Change the function name in the edit window.
2. Click the  button in the editing toolbar. The function is compiled.
3. Click the  button in the standard toolbar to save the function.
4. If desired, enter a different path and/or file name.
5. Confirm your entry by clicking "Save".

**Alternative operation**

Alternatively, the compilation process can be initiated in the following ways:

Select "Compile" from the "Edit" menu, select the "Compile" option from the shortcut menu of the edit window or use the corresponding keyboard shortcut.

Saving may also be performed in the following ways:

Select "Save" from the "File" menu or use the corresponding key combination.


## 2.12.10 How to Use Functions from Other Sources

**Introduction**

Project functions from other WinCC projects and standard functions from other WinCC systems can also be made useable for the current project. To do so they must be brought into the current project.

Apart from the location in the file system in which they are saved, there is no difference in the procedure for project or standard functions.

**Procedure**

1. Copy the functions. Project functions are copied in the "\library" directory for the WinCC project. Standard functions are copied in the "\aplib\..." directory in the WinCC path. The content of the navigation window is updated automatically.
2. Click  in the "Standard" toolbar. When the header is regenerated, the copied functions are registered so that you can use them in your current project.

### **Alternative operation**

Alternatively, you can start a generation process as follows:

Open the "Options" menu and select "Regenerate Header" or use the corresponding key combination.

---

### **Note**

In the event that WinCC is reinstalled or upgraded, the standard functions that were modified are deleted or replaced by the unedited standard functions.

If WinCC is in Runtime, the Runtime system is not influenced by the regeneration of the header.



## 2.13 Creating and Editing Actions

### 2.13.1 How To Create and Edit Actions

#### Introduction

The system distinguishes between global and local actions. In a client-server project, global actions are carried out on all computers in the project, whereas local ones are carried out only on the computer to which they are assigned.

A global action can, for instance, be used to perform a calculation on all computers in the project.

An example of use for a local action might be to output a log file on a server.

The process of creating and editing both action types is identical.


#### Differences between actions and functions

- Actions, in contrast to functions, can have a trigger. This means that a function, by itself, cannot be executed in Runtime.
- Actions can be exported and imported.
- Authorizations can be assigned to actions. This authorization refers to the operational options for the Global Script Runtime troubleshooting window.
- An action has no parameters.

#### Finding actions

New actions can be created, and existing actions can be accessed through the Global Script navigation window.

Actions are stored in the file system as follows:





### Editing and Compiling Actions

An action is edited and compiled in a separate edit window. The edit window displays messages from the compiler after a compilation run. These might be warnings or error messages. In each case, a summary of the number of warnings and error messages is output.

### Display of Actions



If a syntactically incorrect action is stored, it is displayed in the Global Script navigation window with the icon shown to the left.



If a syntactically correct action is stored with no trigger, it is displayed in the Global Script navigation window with the icon shown to the left.



If a syntactically correct action is stored with a trigger, it is displayed in the Global Script navigation window with the icon shown to the left.

### Please note the following when creating actions:

The CrossReference feature of WinCC allows for the creation of cross-references. When building the cross-reference list, in order that the tags and images be recognized when function calls are used as part of actions, the coding rules described further below are to be observed.

### Renaming actions

Actions are always displayed with their file names in the navigation window. Renaming an action means renaming the file containing the action code.

### System behavior if actions are changed, deleted and saved at Runtime

If a local action is stored at runtime, then all local and global actions of the computer are reset on the computer to which the local action belongs.

If a global action is stored in Runtime, then all local and global actions for the entire project – and thus on all computers – are reset.

Such a reset might reinitialize for examples tags and times that are used as triggers for actions, triggering the action at that stage.

Static tags used in the reset actions are reinitialized.

### Possible causes for an action not being performed in Runtime

Failure of an action to be executed in Runtime might have the following causes:

- The action has no trigger
- The action was not compiled
- Global Script Runtime is not enabled in the project start list

---

#### Note

Before creating an action, check whether the relevant functionality can also be implemented on the automation device.

---

### See also

[How to Protect an Action Against Unauthorized Access \(Page 912\)](#)

[How to Use Actions From Other Sources \(Page 925\)](#)

[How to Rename an Action \(Page 924\)](#)

[How to Import an Action \(Page 923\)](#)

[How to Export an Action \(Page 922\)](#)

[How to Assign Authorizations \(Page 922\)](#)

[Triggers \(Page 914\)](#)

[How to Compile and Save an Action \(Page 913\)](#)

[How to add action-related information \(Page 910\)](#)

[How to Edit Actions \(Page 910\)](#)

[How to Create a New Action \(Page 909\)](#)

[WinCC Coding Rule \(Page 908\)](#)

[How to Add Global Script Runtime to a Project's Startup List \(Page 873\)](#)

[Characteristics of Global Actions \(Page 872\)](#)

[Characteristics of Local Actions \(Page 871\)](#)

## 2.13.2 WinCC Coding Rule

### Coding Rules for the Use of CrossReference

The CrossReference feature of WinCC allows for the creation of cross-references. To ensure that the software can recognize the tags and pictures used in function calls made within actions, the coding rules given here must be observed.

The action's code begins with two sections. In the first section, you must declare all tags used; in the second section all picture names used.

Do not enter any other instructions in the sections.

Both sections are already present in the form of comments when an action is created:

```
// WINCC:TAGNAME_SECTION_START
// syntax: #define TagNameInAction "DMTagName"
// next TagID : 1
// WINCC:TAGNAME_SECTION_END

// WINCC:PICNAME_SECTION_START
// syntax: #define PicNameInAction "PictureName"
// next PicID : 1
// WINCC:PICNAME_SECTION_END
```

The sections are expanded, for example as follows:

```
// WINCC:TAGNAME_SECTION_START
// syntax: #define TagNameInAction "DMTagName"
// next TagID : 1
#define ApcTagName1 "TagName1"
// WINCC:TAGNAME_SECTION_END

// WINCC:PICNAME_SECTION_START
// syntax: #define PicNameInAction "PictureName"
// next PicID : 1
#define ApcPicName1 "PicName1"
#define ApcPicName2 "PicName2"
#define ApcPicName3 "PicName3"
// WINCC:PICNAME_SECTION_END
```

Calls to functions to read and write tags and the utilization of picture names must then be handled using the defined names:

```
GetTagDWord (ApcTagName1) ;  
OpenPicture (ApcPicName1) ;  
SetPictureName (ApcPicName2, "PictureWindow1", ApcPicName3) ;
```

## 2.13.3 How to Create a New Action

### Introduction

In a client-server project, global actions are carried out on all computers in the project, whereas local ones are carried out only on the computer to which they are assigned.

The procedure is identical for both global and local actions. By specifying, in the navigation window, the location in which the action is saved, you specify its type (global or local).

Global Script suggests a default name for the new action.

A newly created action already contains the instruction `#include "apdefap.h"`. Therefore, all functions are registered within the action. The name of the action is found in the third line. The first three lines cannot be deleted nor modified. This means that every function can be called from each action without requiring any special measures. Furthermore every action has a returned value of type "int" and it is already set to a value of 0.

A returned value of an action can be used in conjunction with GSC Runtime for diagnostic purposes.

The action code begins with a code framework in the form of comments. If this coding framework is filled out in accordance with the coding rules, the tags and picture names are recognized by CrossReference.

### Procedure

1. In the navigation window, open the shortcut menu for the desired action type.
2. Select "New".

### Alternative operation

Alternatively, you can also create a new action by clicking the associated button in the toolbar, via the "File" menu or by using the corresponding key combination.

### See also

GSC Runtime (Page 928)

WinCC Coding Rule (Page 908)

## 2.13.4 How to Edit Actions

### Introduction

An action is edited in its own edit window exactly like a function. Only the first three lines cannot be edited.

The action must have a return value. The returned value is of the type "int" and is preset to 0. A returned value of an action can be modified and used in conjunction with GSC Runtime for diagnostic purposes. The returned value's type cannot be changed.


To execute an action in Runtime, the action must have a trigger.

### Procedure

1. Double-click the action in the navigation window to open it in an edit window.
2. Edit the action code.

### Alternative operation

You can also open an action as follows:

In the navigation window, open the shortcut menu for the desired action and click "Open" or "File\Open...". You can also click the  button in the standard toolbar or use the corresponding key combination.

---

#### Note

A maximum of 32 Kbytes of memory is available for local tags (tags defined within the braces of the action code).

---

### See also

GSC Runtime (Page 928)

How to Write Function Code (Page 896)

## 2.13.5 How to add action-related information

### Introduction

Additional information can be assigned to every action.


When a new action is created, the creation date is entered in the action-related information automatically and is unchangeable. The action is also assigned version number 1.0. The version numbers can be individually assigned when editing an action. When an action is changed and saved, the current date of change is entered automatically and is unchangeable.


This dialog can be used to assign a password to protect the action against unauthorized read and write access.

## Requirements

The action to which the information relates must be open in an edit window.

## Procedure

1. Click the  button in the editing toolbar. The "Properties" dialog is opened.
2. Select the required entries.

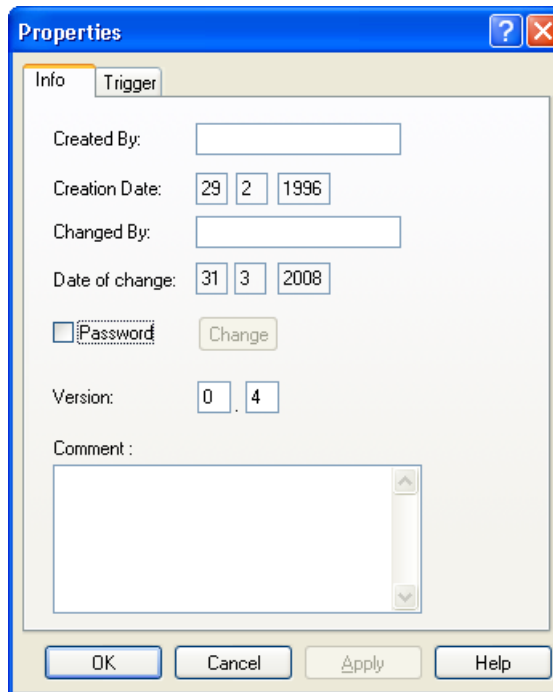

The image shows a "Properties" dialog box with two tabs: "Info" (selected) and "Trigger". The "Info" tab contains the following fields and controls:

- Created By: [Text input field]
- Creation Date: [29] [2] [1996]
- Changed By: [Text input field]
- Date of change: [31] [3] [2008]
- Password [Change button]
- Version: [0] [4]
- Comment: [Text area]

At the bottom of the dialog are four buttons: OK, Cancel, Apply, and Help.

3. Confirm your entries with "OK".

## Alternative operation

Alternatively, the "Properties" dialog can be opened as follows:

Click the "Edit" menu and select the "Info" option or use the corresponding key combination.

## See also

How to Protect an Action Against Unauthorized Access (Page 912)

How to Set Different Views (Page 885)

Working with the Toolbars (Page 882)

## 2.13.6 How to Protect an Action Against Unauthorized Access


### Introduction


Actions can be protected with a password against unauthorized read and write access. The password is a part of the action-related information.

### Requirements

The action to be compiled must be opened in the edit window.

### Procedure

1. Click the  button in the editing toolbar. The "Properties" dialog is opened.
2. Select the "Password" check box.
3. Click the "Change" button.

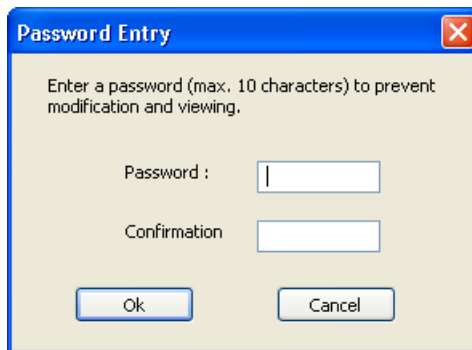

4. Enter the password in the "Password" field.
5. Enter the password again in the "Confirmation" field.
6. Confirm your entries with "OK".
7. Click "OK" to close the dialog.

### Alternative operation

Alternatively, the "Properties" dialog can be opened as follows:

Click the "Edit" menu and select the "Info" option or use the corresponding key combination.

---

#### Note

A password-protected action can only be opened in the edit window if the correct password is entered.

To deactivate the password protection, clear the "Password" check box.

---



## See also

How to Set Different Views (Page 885)

Working with the Toolbars (Page 882)

## 2.13.7 How to Compile and Save an Action

### Introduction

In order to use an action, it must first be compiled. Only the action in the active edit window is compiled.

Errors reported by the compiler are displayed in the lower portion of the window. Each message is displayed on a separate line. The line includes the line number in the source code where the error occurred, a hexadecimal encoded error code and a description of the error.



Double-click such a line to view the source code line where the error occurred.

It is recommended that you examine the first message error listed, because subsequent ones could be errors resulting from the first one. If the first error is corrected, then the others might disappear after the next compilation.

### Requirement

The action to be compiled must be opened in the edit window.

### Procedure

1. Set the language for C compilation using the toolbar.
2. Click  on the "Edit" toolbar.
3. Examine the compiler messages in the lower portion of the edit window.
4. If the compiler reported an error, the action source code must be corrected. After this has been done, start again with step 1 in this table.
5. If the compiler generated warnings, the action source code may require correction. After the code has been corrected, start again with step 1 in this table, otherwise proceed to step 6.
6. Click  on the "Default" toolbar.

### Alternative operation

Alternatively, the compilation process can be initiated in the following ways:

Select "Compile" from the "Edit" menu, select the "Compile" option from the shortcut menu of the edit window or use the corresponding keyboard shortcut.

Saving may also be performed in the following ways:

Select "Save" from the "File" menu or use the corresponding key combination.

## Display of Actions



If a syntactically incorrect action is stored, it is displayed in the Global Script navigation window with the icon shown to the left.



If a syntactically correct action is stored with no trigger, it is displayed in the Global Script navigation window with the icon shown to the left.



If a syntactically correct action is stored with a trigger, it is displayed in the Global Script navigation window with the icon shown to the left.

## See also

Runtime Behavior of Actions (Page 927)

## 2.13.8 Triggers

### 2.13.8.1 Triggers

## Defining and Using Triggers

Triggers are used to execute actions in Runtime. To do this, a trigger is linked to an action, forming the triggering event for calling the action. Actions without triggers are not executed.

## Trigger Types

The following trigger types are available:

### Acyclic Triggers

These consist of a specified date and time. The action specified by such a trigger is performed once at the date and time specified.

### Cyclic Triggers

These consist of a specified time interval and starting point. The following types of cyclic triggers are available:

- Default cycle. The start of the first time interval coincides with the start of Runtime. The length of the interval is determined by the cycle.
- Hourly. The start of the interval is specified as minutes and seconds. The length of the interval is an hour.

- Daily. The start of the interval is specified by the time (hours, minutes and seconds). The length of the interval is a day.
- Weekly. The start of the interval is specified by the day of the week (Monday, Tuesday, etc.) and the time. The length of the interval is a week.
- Monthly. The start of the interval is specified by the day and time. The length of the interval is a month.
- Annually. The start of the interval is specified by the day, month and time. The length of the interval is a year.

### Tag Triggers

These consist of the specification of one or more tags. The action associated with such a trigger is performed each time a change in the value of one of these tags is detected.

How the tag values are queried may be customized for each tag. Either cyclic polling with a specified period or a reaction as soon as the system detects a change in the tag value may be selected.

Depending on the choice of query method, it is possible that the tag changes but the system does not detect this. In this case the action is not performed.

### Effect of Triggers on an Action

If the action is associated with only one trigger, then the action is performed as soon as the triggering event occurs.

However, an action may be associated with multiple triggers, such as a cyclic trigger and a tag trigger. In this case, the action is performed whenever one of the two triggering events occurs. If two events occur simultaneously, the action is executed twice in sequence. If two tag triggers fire at the same time, the action is performed only once.

The processing of an action should be completed before another call of the action occurs, as there might otherwise be an overflow of the queue.


**Tip:** If the action is not to be carried out with each event occurrence, then a condition can be specified for the action that controls its further course dependent on the event. If the action is not to be executed any more, it can be terminated with a <value> return.

### Rules for the Selection of Triggers


Depending on the system, it cannot be guaranteed that an action with a cyclic trigger is carried out at exactly the specified time. If this is a requirement, then the task (such as a check, etc.) must be implemented on the automation device.

For processing, tag triggers have priority over cyclic triggers.

- For a cyclic trigger, the action is always performed when the trigger event occurs, e.g. every 20 seconds. (⚡ = action is performed)

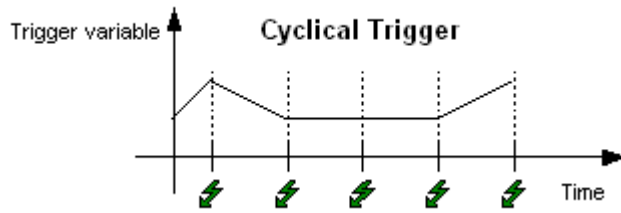

- The tag trigger only causes the action to be performed if the value of the trigger tag has changed. This is done to reduce the system load (⚡ = action is performed).

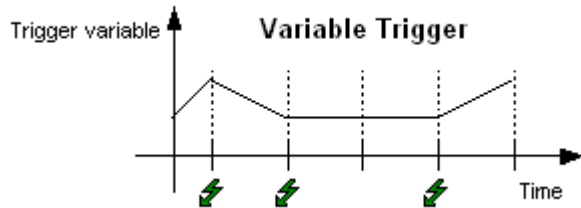

The values of tags contained in the trigger are already known when the action begins. The GetTag() call can be used to access the value directly. Processing is much faster than for trigger tags than for those not contained in the trigger whose values must be obtained via GetTag() requests.

### Display of Actions



If a syntactically incorrect action is stored, it is displayed in the Global Script navigation window with the icon shown to the left.



If a syntactically correct action is stored with no trigger, it is displayed in the Global Script navigation window with the icon shown to the left.



If a syntactically correct action is stored with a trigger, it is displayed in the Global Script navigation window with the icon shown to the left.

### See also

How to delete a trigger (Page 921)

How to change a trigger (Page 920)

How to Add a New Trigger of the "Tag" Type (Page 918)

How to Add a New Trigger of the "Timer" Type (Page 917)

## 2.13.8.2 How to Add a New Trigger of the "Timer" Type

### Introduction

Triggers are used to execute actions in Runtime. To do this, a trigger is linked to an action, forming the triggering event for calling the action. Actions without triggers are not executed.

"Timer" type triggers can be cyclic or acyclic triggers.

Acyclic triggers consist of a specified date and time. The action specified by such a trigger is performed once at the date and time specified.

Cyclic triggers consist of a specified time interval and starting point. The following types of cyclic triggers are available:


- Default cycle. The start of the first time interval coincides with the start of the Runtime system. The length of the interval is determined by the cycle.
- Hourly. The start of the interval is specified as minutes and seconds. The length of the interval is an hour.
- Daily. The start of the interval is specified by the time (hours, minutes and seconds). The length of the interval is a day.
- Weekly. The start of the interval is specified by the day of the week (Monday, Tuesday, ... a week.
- Monthly. The start of the interval is specified by the day and time. The length of the interval is a month.
- Yearly. The start of the interval is specified by the day, month and time. The length of the interval is a year.

### Requirement

The

### Procedure

1. Click the "Add" button.
2. The "Add trigger" dialog is opened.
3. The "Properties" dialog is opened.
4. Click the "Add" button.
5. Complete the required details in the dialog.
6. Confirm the entries by clicking "OK".
7. Close the "Properties" dialog by clicking "OK".

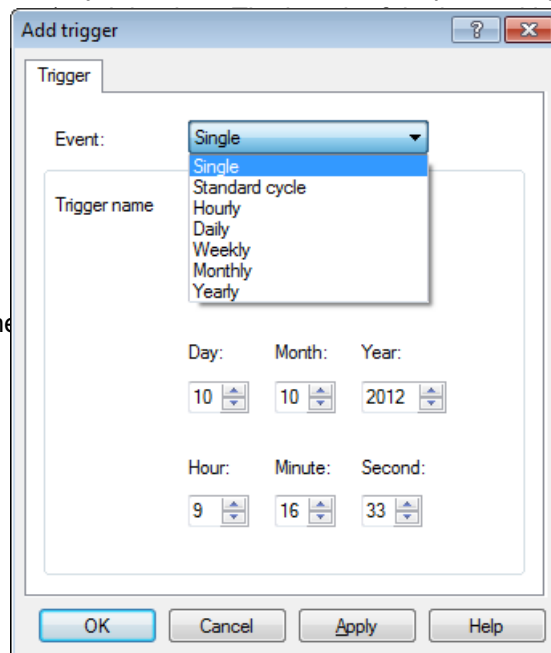

### Alternative operation

Alternatively, the "Properties" dialog can be opened as follows:

In the "Edit" menu, select "Info", select "Info / Trigger" in the shortcut menu of the edit window, or use the corresponding key combination.

### 2.13.8.3 How to Add a New Trigger of the "Tag" Type

#### Introduction

Triggers are used to execute actions in Runtime. To do this, a trigger is linked to an action, forming the triggering event for calling the action. Actions without triggers are not executed.

Tag triggers consist of one or more specified tags. The action associated with such a trigger is performed each time a change in the value of one of these tags is detected.


How the tag values are queried may be customized for each tag. Either cyclic polling with a specified period or a reaction as soon as the system detects a change in the tag value may be selected.

Depending on the choice of query method, it is possible that the tag changes while the system fails to detect this. In this case the action is not performed.


#### Requirements

The action to be linked with a trigger must be open in the active edit window.

#### Procedure

1. Click the  button in the editing toolbar. The "Properties" dialog is opened.
2. Select the "Trigger" tab.

3. Select the trigger source "Tag" and click the "Add" button. The "Add Tags" dialog is opened.

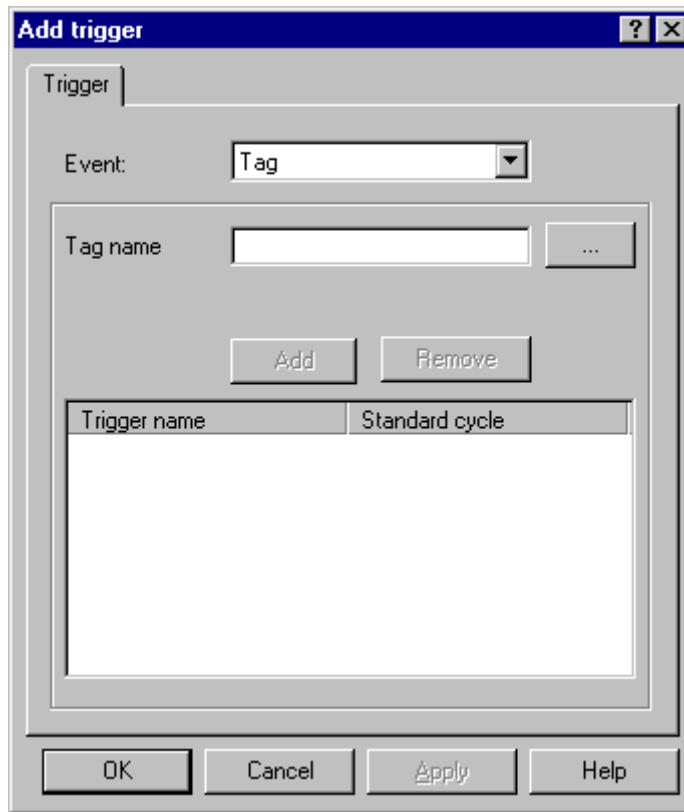

4. Click the  button to open the tag selection dialog, select a tag and confirm your selection by clicking "OK".
5. In the "Add Trigger" dialog, open the shortcut menu in the "Standard cycle" column and then select the desired monitoring cycle. Selecting "After Every Change" results continuous monitoring.
6. Repeat steps 4 and 5, if you want add more tags.
7. Confirm the entries by clicking "OK".
8. Close the "Properties" dialog by clicking "OK".

### Alternative operation

Alternatively, the "Properties" dialog can be opened as follows:

In the "Edit" menu, select "Info", select "Info / Trigger" in the shortcut menu of the edit window, or use the corresponding key combination.

In the "Add Trigger" dialog, you can also enter a tag name directly and insert the tag in the "Trigger Name" column by clicking "Add". With this approach, the system does however not check whether the tag exists.

### 2.13.8.4 How to change a trigger


#### Introduction


Triggers that have been defined can be changed at any time. They can also be changed in Runtime.

#### Requirements

The relevant action must be opened in the edit window.

#### Procedure

1. Click the  button in the editing toolbar. The "Properties" dialog is opened.
2. Select the "Trigger" tab and select the trigger you wish to change.

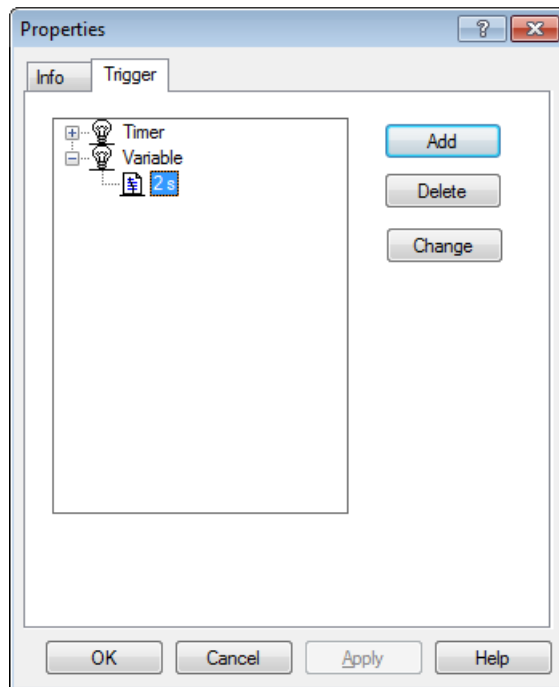

3. Click the "Change" button to open the "Change Trigger" dialog.
4. Make the desired changes.
5. Confirm the entries by clicking "OK".
6. Close the "Properties" dialog by clicking "OK".

#### Alternative operation

Alternatively, the "Properties" dialog can be opened as follows:

In the "Edit" menu, select "Info", select "Info / Trigger" in the shortcut menu of the edit window, or use the corresponding key combination.



### 2.13.8.5 How to delete a trigger

#### Introduction


Triggers that have been defined can be deleted at any time. They can also be deleted in Runtime.


If a trigger is deleted in Runtime, it only takes effect after the action is saved.

#### Requirements

The relevant action must be opened in the edit window.

#### Procedure

1. Click the  button in the editing toolbar. The "Properties" dialog is opened.
2. Select the "Trigger" tab and select the trigger you wish to delete.

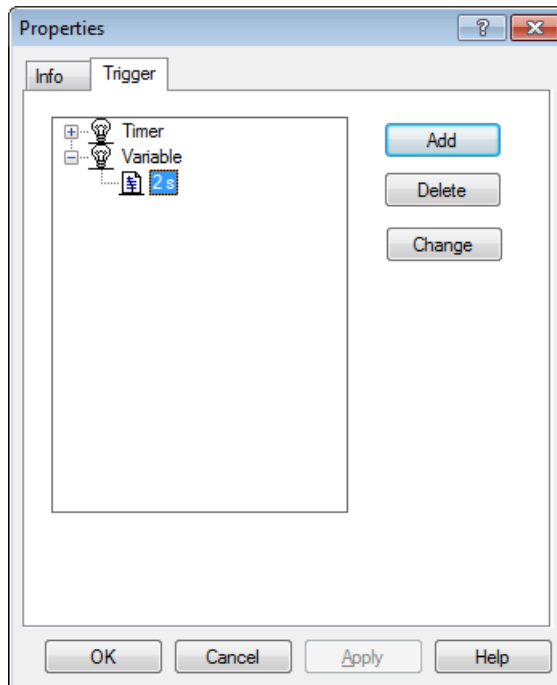

3. Delete the selected trigger by clicking "Delete".
4. Close the "Properties" dialog by clicking "OK".

#### Alternative operation

Alternatively, the "Properties" dialog can be opened as follows:

In the "Edit" menu, select "Info", select "Info / Trigger" in the shortcut menu of the edit window, or use the corresponding key combination.

### 2.13.9 How to Assign Authorizations


#### Introduction


With the Global Script - Runtime diagnostic tool, you can influence the processing of actions in Runtime. Each action can be assigned an authorization. This authorization only effects the operation in the Global Script - Runtime window.

#### Requirement

The relevant action must be opened in the editing window.

#### Procedure

1. Click  in the toolbar.  
The "Authorizations" dialog box is opened.
2. Select an authorization.

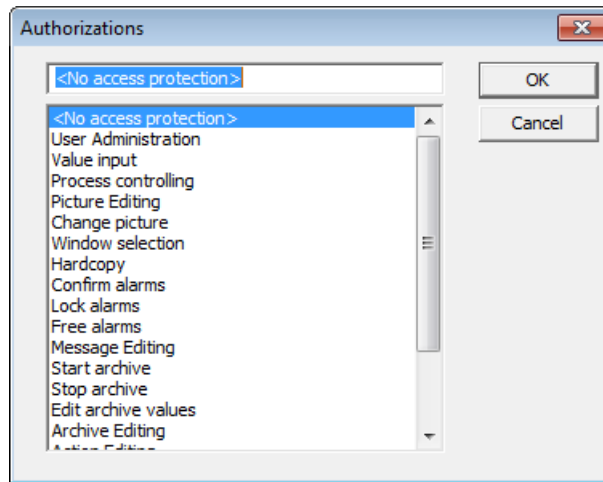

3. Confirm your selection with "OK".

#### See also

GSC Runtime (Page 928)

### 2.13.10 How to Export an Action


#### Introduction


Use export and import to move actions between projects. The triggers linked to the actions are retained in the process.

## Requirements

The action to be exported must be opened in the edit window.

## Procedure

1. Click the  button in the editing toolbar. The "Save As" dialog is opened.
2. Select the path and file name for the action that you wish to export.

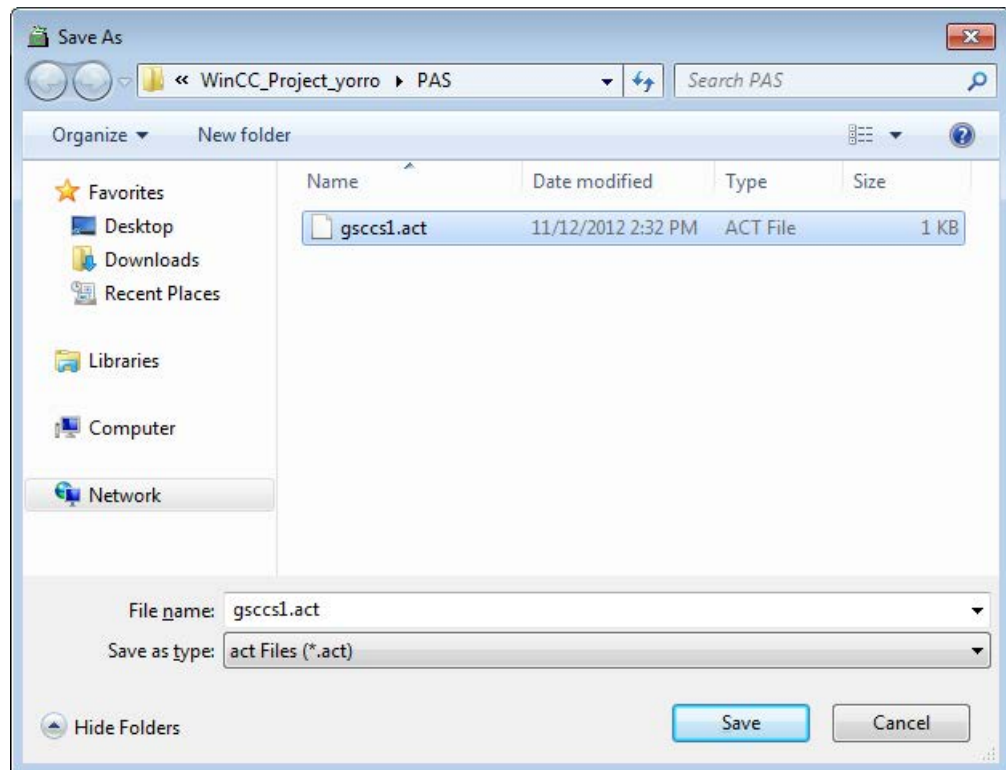

3. Close the dialog by clicking the "Save" button.

## Alternative operation

Alternatively, you can start the export as follows:

In the "Edit" menu, select "Export", select "Export" in the shortcut menu of the edit window, or use the corresponding key combination.


## 2.13.11 How to Import an Action


### Introduction

Use export and import to move actions between projects. The triggers linked to the actions are retained in the process.

The action in the active edit window is replaced by the imported action.

## Procedure

1. Click the  button in the editing toolbar. The "Open" dialog is opened.
2. Select the path and file name of the action that you wish to import.

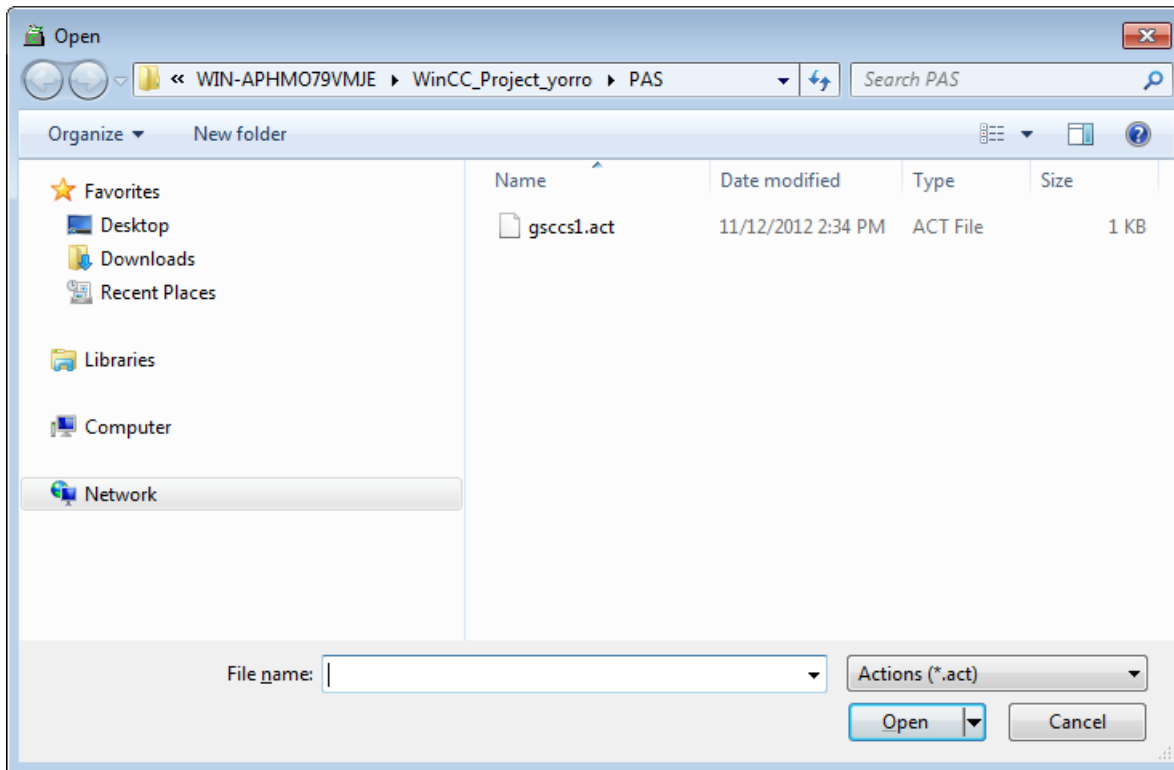

3. Close the dialog by clicking the "Open" button.

## Alternative operation

Alternatively, you can start the import as follows:

In the "Edit" menu, select "Import", select "Import" in the shortcut menu of the edit window, or use the corresponding key combination.

## 2.13.12 How to Rename an Action

### Introduction


You may rename an action at any time. The action is thereby assigned a different file name.

## Requirements

The action to be renamed may not be open in the edit window.

## Procedure

1. Open the shortcut menu of the action to be renamed.
2. Select "Rename".
3. Enter a new name with the file extension ".pas".

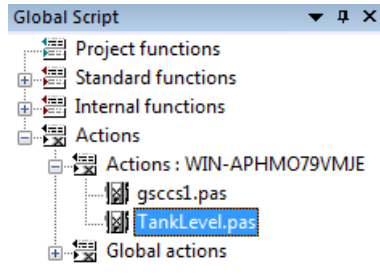

4. Confirm the new name by pressing the <ENTER> key.

## Alternative operation

Alternatively, click the action name twice to complete the renaming.

---

### Note

If you do not enter the file extension ".pas", the action name remains unchanged.

---

## 2.13.13 How to Use Actions From Other Sources

### Introduction

You have two options for using actions from other sources in your project:

- Importing exported actions
- Copy the file with the desired action into the corresponding path in your project. The path for local actions is "<Computer\_name>\Pas" in the project path. The path for global actions is "\Pas" in the project path.

To show the copied actions in the navigation window, you must refresh the display. This can be accomplished by quitting and then restarting Global Script.

If Runtime is active, imported actions are only executed, after they have been opened in Global Script Editor and then saved.

---

**Note**

Actions can include calls to project and standard functions. These can in turn have calls to project and standard functions etc. Therefore, when importing actions from other sources, you must make sure that the current project has all necessary functions.

Particular attention is called for whenever the actions were imported from a different computer. Since standard functions can be customized by the user, it is possible that the standard functions called in the action have a different functionality on the source computer than the ones with the same names on the target computer.

---

**See also**

How to Import an Action (Page 923)

How to Export an Action (Page 922)

## 2.14 Runtime Behavior of Actions

### 2.14.1 Runtime Behavior of Actions

#### Analysis of Runtime Behavior

WinCC provides a range of tools with which the Runtime behavior of actions can be analyzed. These are the application windows GSC Runtime and GSC Diagnose plus the application `apdiag.exe`.

To use the application windows GSC Runtime and GSC Diagnose, they must be added to a process picture. This may be a process picture made especially for diagnostic purposes. This picture is then called in Runtime.

The application windows are used for the following strategies:

- GSC Runtime supplies information about the dynamic behavior of all (Global Script) actions, supports the individual start and the Start and End Action for each individual action and provides an entry point into Global Script Editor, while Runtime is active.
- GSC Diagnose outputs the `printf` instructions (contained in the actions) in the order in which they are called. This also applies to the `printf` instructions in functions that are called in actions. Through a well thought out use of `printf` instructions, for example to output the values of tags, it is possible to follow the action's flow and that of the called functions. Even error conditions, which result in a call to the `OnErrorExecute` function, are displayed in the GSC Diagnose window.

---

#### Note

When using dynamic C-scripts with access to picture objects, you should note that execution of the script is not terminated automatically by closing the picture.

This scenario may to the failure of access to an object that is addressed in the script, e.g. if properties of the type "Text" are read and the values returned are modified or processed in subsequent string operations.

---

#### See also

GSC Diagnose (Page 933)

GSC Runtime (Page 928)

## 2.14.2 GSC Runtime

### 2.14.2.1 GSC Runtime

#### GSC Runtime Window

GSC Runtime is a window showing the dynamic behavior of all (Global Script) actions in Runtime. Additionally, GSC Runtime, enables you to influence the execution of each individual action and provides an entry point into Global Script Editor, while Runtime is active.

The following information is output:

- Action: Name of the action
- ID: Action ID. It is used internally to the system and for example is output by the function OnErrorExecute together with a description of the error in the event that an error occurs in the action. GSC Runtime supplies the name of the action with this ID. The connection between the ID and action name ceases to be valid when Runtime is terminated or an action is saved while Runtime is active.
- Status: Current status of the action. For possible statuses, refer to the table below.
- Activation Interval: The time in the form hours:minutes:seconds that has elapsed between two calls to the action.
- Return Value: Return value of the action.
- Started On: Date and time at which the current action was started.
- Next Start: Date and time at which the action is started again.
- Error Message: Contains the error text in the case of an error.

Action	ID	Status	Activation Interval	Return Value	Started on:	Next Start	Error message:
TankLevel.pas	@15	Action is running	0: 0: 2	10	09/27/00 17:36:16		
gsccs1_2.pas	@16	Action was ended.	0: 0: 2	0	09/27/00 17:35:50		
gsccs1_1.pas	@17	Action was started.		0	09/27/00 17:35:31	11/27/00 17:35:08	
gsccs1.pas	@18	Action is running	0: 0: 2	0	09/27/00 17:36:16		

#### Statuses of actions

Possible statuses of actions:

- Action was started.
- Action was ended.
- Action was stopped.
- Action is running.



- Error during start of action!
- Error during execution of action!

## Error messages

Possible error messages:


- No error occurred.
- The application is already connected to the script control. No additional connection setup is possible.
- There is no connection to the script control. Possibly no connection setup took place.
- An error occurred during interprocess communication. The cause of the error is unknown.
- Undefined error.
- The parameter assignment is wrong. Some necessary parameters may be missing.
- Script control is not started. Check has whether WinCC has been started.
- Time-out occurred. Check the connection or increase the monitoring time.
- Script control was terminated.
- The service channel could not be installed.
- An unknown job number was used for the EndAct job.
- The action could not be executed without error. The returned results are invalid.
- An error occurred in the server application.
- The maximum number of connections to the script control has been reached.
- The transaction is unknown. An attempt was made to terminate a transaction that was not logged on previously.
- A pre-compiled header file cannot be generated from a pre-compiled header file.
- There is no access to the action. The module is being used presently.
- The program is invalid.
- The action is invalid.
- The script control could not set up the file.
- The script interpreter does not have enough memory.
- The file format is invalid for the script control.
- The script control could not open the file.
- The program is presently locked by the script control. No further access is possible.
- The action has already been given to the script control for processing.
- In this action, a conflict has occurred with another action.
- The script control could not find the action.
- The script control could not find the function.
- The specified line information is invalid.

- The specified symbol is outside the valid range.
- The provided memory is too small for the script interpreter.
- The script interpreter does not recognize the specified type.
- The specified symbol was not found.
- Load project functions.
- A stack overflow has occurred in the script interpreter during execution. Further execution of the action is being canceled.
- Division by 0 occurred during execution of an action. The action is being canceled.
- Within the action, a reference was made during execution to a symbol that does not exist.
- Within the action, an attempt was made during execution to access an undefined memory area.
- The script interpreter ran into a breakpoint.
- The script interpreter was advanced in the debugger by one processing step.
- The action contains no interpreter code.
- The action has the wrong data format.
- The return value of the action cannot be represented as a variant.
- There is insufficient memory to execute this operation.
- An error has occurred within the transaction. For more information, see the AP\_ACT\_KEYs.
- An error occurred while executing the action. For more information, see the AP\_ACT\_KEYs.
- An error occurred while executing the action. For more information, see the AP\_ACT\_KEYs.
- There is no update capability for the existing data format. The action cannot be read.

### Shortcut Menu for Actions

The following functions are available for every action in the shortcut menu:

- End Action: The corresponding action is not executed again after the current execution is completed.
- Start Action: The corresponding action is executed again when the next trigger occurs.
- Start: The relevant action is executed once.
- Edit: The relevant action is opened in the Global Script editor for editing. Runtime remains active. If the edited action is compiled (if necessary) and saved, the changes are immediately adopted by the Runtime system.



You can determine for each action individually, whether or not the popup menu can be opened without a password.

To use GSC Runtime, you must first add an application window of the GSC Runtime type in a process picture. Using the GSC Runtime attributes, you can determine the appearance of the GSC Runtime window.

---

**Note**

Updating the GSC Runtime window increases the load on the system resources. The system load depends on how many actions are visible in the window. The system load can be lowered by reducing the height of the window so that fewer lines are visible.

---

**See also**

How to Edit Actions (Page 932)

Attributes of GSC Runtime (Page 932)

How to Place GSC Runtime in a Process Picture (Page 931)

How to Assign Authorizations (Page 922)

**2.14.2.2 How to Place GSC Runtime in a Process Picture**

**Introduction**

To use GSC Runtime, you must add GSC Runtime to a process picture. This process picture can be an existing picture or a picture that just serves diagnostic purposes. GSC Runtime cannot be added to the process picture directly, rather it must be added as an application in an application window. The application window is itself part of the process picture. The measures described must be performed in Graphics Designer.

**Requirement**

Graphics Designer has been started and the process picture is open.

**Procedure**

1. In the Object palette, select "Smart Object\Application Window".
2. In the drawing area, open the application window.
3. In the "Window Contents" dialog select "Global Script".
4. Confirm the entries by clicking "OK".
5. In the "Template" dialog, select "GSC Runtime".
6. Click "OK" to confirm your selection.

## See also

Attributes of GSC Runtime (Page 932)

### 2.14.2.3 Attributes of GSC Runtime

#### GSC Runtime Window Layout

GSC Runtime has attributes with which you can determine the appearance of the GSC Runtime window in Runtime. These include the geometry attribute and in particular the following attributes:

- **Display:** With this attribute, you can specify whether the window should be visible or hidden. The attribute can be made dynamic with the name "Visible".
- **Sizeable:** Use this attribute to specify whether the window size can be changed in Runtime.
- **Moveable:** Use this attribute to specify whether the window can be moved in Runtime.
- **Border:** Use this attribute to specify whether the window has a border. If the window has a border, its height and width can be changed in Runtime.
- **Title:** Use this attribute to specify whether the window has a title bar.
- **Can be Maximized:** Use this attribute to specify whether the window's title bar has a button to maximize the window in Runtime.
- **Can be Closed:** Use this attribute to specify whether the window's title bar has a button to close the window in Runtime.
- **Foreground:** Use this attribute to specify whether the window is always in the foreground.

The attributes are displayed and can be set in Graphics Designer.

### 2.14.2.4 How to Edit Actions

#### Introduction

Each of the actions in your project will be displayed on its own line in the GSC Runtime window. You can open an action in the GSC Runtime window and then edit it using Global Script Editor. After the edited action is saved, it is used in Runtime.

#### Procedure

1. Open the shortcut menu for the desired action.
2. Select "Edit".

## See also

How To Create and Edit Actions (Page 905)

## 2.14.3 GSC Diagnose

### 2.14.3.1 GSC Diagnose

#### Description of Functions

GSC Diagnose outputs the printf instructions (contained in the actions) in the order in which they are called in the Diagnose window. This also applies to the printf instructions in functions that are called in actions. Through a well thought out use of printf instructions, for example to output the values of tags, it is possible to follow the action's flow and that of the called functions. Even error conditions, which result in a call to the OnErrorExecute function, are displayed in the GSC Diagnose window.

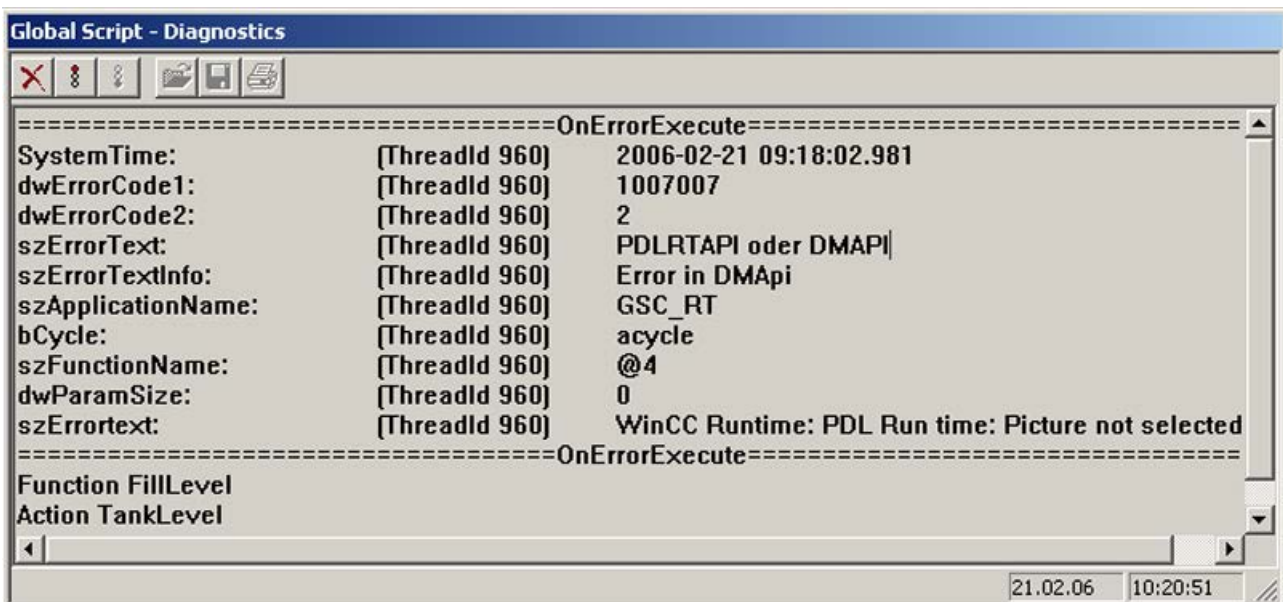


Image 2-1 Diagnose window of GSC Diagnose

To use GSC Diagnose, you must first add an application window of the GSC Diagnose type in a process picture. Using the GSC Diagnose attributes, you can determine the appearance of the GSC Diagnose window.

When the picture is changed, the contents in the GSC Diagnose window is deleted.

---

#### Note

A printf() may contain maximum 360 characters.

---

## See also

The Toolbar of GSC Diagnose (Page 935)

Attributes of GSC Runtime (Page 932)

How to Place GSC Diagnose in a Process Picture? (Page 934)

### 2.14.3.2 How to Place GSC Diagnose in a Process Picture?

#### Introduction

To use GSC Diagnose, you must add GSC Diagnose to a process picture. This process picture can be an existing picture or a picture that just serves diagnostic purposes. GSC Diagnose cannot be added as an application to the process picture directly, rather it must be added as an application in an application window. The application window is itself part of the process picture. The measures described must be performed in Graphics Designer.

#### Requirement

Graphics Designer has been started and the process picture is open.

#### Procedure

1. In the Object palette, select "Smart Object\Application Window".
2. In the drawing area, open the application window.
3. In the "Window Contents" dialog select "Global Script".
4. Confirm the entries by clicking "OK".
5. In the "Template" dialog, select "GSC Diagnose".
6. Click "OK" to confirm your selection.

## See also

Attributes of GSC Runtime (Page 932)

The Toolbar of GSC Diagnose (Page 935)

### 2.14.3.3 Attributes of GSC Diagnose

#### GSC Diagnose Attributes

GSC Diagnose has attributes with which you can determine the appearance of the GSC Diagnose window in Runtime. These include the geometry attribute and in particular the following attributes:

- **Display:** With this attribute, you can specify whether the window should be visible or hidden. The attribute can be made dynamic with the name "Visible".
- **Sizeable:** Use this attribute to specify whether the window size can be changed in Runtime.
- **Moveable:** Use this attribute to specify whether the window can be moved in Runtime.
- **Border:** Use this attribute to specify whether the window has a border. If the window has a border, its height and width can be changed in Runtime.
- **Title:** Use this attribute to specify whether the window has a title bar.
- **Can be Maximized:** Use this attribute to specify whether the window's title bar has a button to maximize the window in Runtime.
- **Can be Closed:** Use this attribute to specify whether the window's title bar has a button to close the window in Runtime.
- **Foreground:** Use this attribute to specify whether the window is always in the foreground.

The attributes are displayed and can be set in Graphics Designer.







### 2.14.3.4 The Toolbar of GSC Diagnose

#### Toolbar Functions

The toolbar of GSC Diagnose includes buttons for the control the output in the Diagnose window as well as for saving, printing and opening the contents of the window.



The toolbar contains buttons with the following functions:

Button	Function
	Deletes the contents of the window.
	Stops the updating of the window.
	Resumes the updating of the window.
	Opens a text file in the window.
	Saves the contents of the window in a text file.
	DPrints the contents of the window.





## 2.15 ANSI-C function descriptions

### 2.15.1 IpszPictureName

#### Overview

"IpszPictureName" is the name of the picture.

If you configure an action on a property or a "Mouse-click" event in WinCC, the name of the picture is provided as "IpszPictureName" in the action. The picture name has the following structure:

<BASE PICTURE NAME>.<PICTURE WINDOW NAME>:<PICTURE NAME>. ... .<Picture window name>:<Picture name>.

The "BASE PICTURE NAME" and the "PICTURE NAME" are provided without the file extension ".PDL".

This enables you to identify the object's picture path. You can also address specific picture windows, if a process picture is opened more than once for example.

---

#### Note

Do not change the text in "IpszPictureName" not even using the function "strcat".

---

### 2.15.2 Standard functions

#### 2.15.2.1 Standard functions - short description

The system provides standard functions. You can modify these functions to adapt them to your personal needs. Furthermore, you can create your own standard functions.

The basic system provides you with standard functions. They are divided into the following function groups:

- Alarm
- Graphics
- Report
- TagLog
- WinCC
- Windows

The "Obsolete functions" directory contains standard functions that were used to control the control before WinCC V7.

If the corresponding options have been installed, the following additional function groups are available:

- Options
- Split Screen Manager
- userarc (user archives)

## 2.15.2.2 Alarm

### AcknowledgeMessage

#### Function

Acknowledges the message with the number that has been sent as a parameter in the message system.

#### Syntax

```
void AcknowledgeMessage(DWORD MsgNr)
```

#### Parameters

##### MsgNo

Message to be acknowledged

---

##### Note

Make sure a configured message exists for the transferred message number.  
To use the function on a client with its own project, a standard server for alarms has to be configured on the client.

---

### GCreateMyOperationMsg

#### Function

The "GCreateMyOperationMsg" standard function makes it possible to trigger your own operator input message in the message system. The message with the "dwMsgNum" message number must have already been configured as the operator input message.

## Syntax

```
int GCreateMyOperationMsg( DWORD dwFlags, DWORD dwMsgNum, char*
IpszPictureName, char* IpszObjectName, DWORD dwMyTextID, double doValueOld, double
doValueNew, char* pszComment)
```

## Parameters

### dwFlags

The message form can be selected using the "dwFlags" parameter.

Name	Value	Description
FLAG_COMMENT_PARAMETER	0x00000001	The text is entered as a comment directly into the message in Runtime, without its own comment dialog. The pointer to the comment must not equal "NULL."
FLAG_COMMENT_DIALOG	0x00000003	A comment dialog appears. The comment entered there is transferred to the message.
FLAG_TEXTID_PARAMETER	0x00000100	The text ID of a text from the TextLibrary is provided as the accompanying process value of the message.

### dwMsgNum

WinCC message number of a self-created operator input message.

### IpszPictureName

Pointer to the picture name of the picture from which the function is called.

### IpszObjectName

Pointer to the WinCC tag name to which the old values and new values belong.

The name is forwarded as the instance name of the operator input message and entered in the accompanying process value "1".

### dwMyTextID

Text ID of a text from the TextLibrary.

When the "FLAG\_TEXTID\_PARAMETER" is set, the text ID is provided as the numeric accompanying process value "8" of the message and is displayed as a number in process value block 8. So that the language-dependent text from the TextLibrary is displayed in the message, you must enter format statement "@8%s@" in the message text block.

### doValueOld

Numeric old value of the WinCC tags with the name specified in "IpszObjectName". "doValueOld" is entered in the accompanying process value "2" of the message.

The function itself has no option of reading a tag value before the action. For this, use the provided "GetTag..." feature.

**doValueNew**

Numeric new value of the WinCC tags with the name specified in "lpszObjectName". "doValueNew" is entered in the accompanying proces value "3" of the message. The function itself has no option of reading a tag value after the action. For this, use the provided "GetTag..." feature.

**pszComment**

Comment text or empty string.

When "FLAG\_COMMENT\_PARAMETER" is set, the text is entered directly into the message in Runtime as a comment. The message does not need a separate comment dialog.

**Return value**

Value	Description
0	The function has been completed without any errors.
-101	The message editing could not be started.
-201	An error occurred when calling the "MSRTGetComment()" feature.
-301	An error occurred when calling the "MSRTCreateMsgInstanceWithComment()" feature.

---

**Note**

Make sure that only operator input messages are used for the "GCreateMyOperationMsg" function. The use of messages of different message classes is not permitted.

Please note the role of the standard server when using the function with a Client. For more information see the chapter "Client configuration".

---

**GMsgFunction**

**Function**

This function provides the message data.

It is a global function for single messages. It is called for each message for which the "Triggers an action" parameter has been set.

Evaluation of the message data is best made in a project function called from GMsgFunction.

**Syntax**

BOOL GMsgFunction(char\* pszMsgData)

## Parameters

### **pszMsgData**

Pointer to a string whose data are mapped with scanf to the MSG\_RTDATA\_STRUCT structure.

The "MSG\_RTDATA\_STRUCT" string contains the following data, which are separated from each other with "#":

1. Telegram time
2. Process values
3. Instance
4. User
5. Computer
6. Current time in format "yyyy.mm.dd, hh:mm:ss.mmm"

---

### **Note**

The value "Instance" of string "MSG\_RTDATA\_STRUCT" is only supplied if an instance message was triggered.

The values "User" and "Computer" of the string "MSG\_RTDATA\_STRUCT" are only supplied if a comment was provided during the creation of the message with the same call.

---

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

Please note that modified standard functions are overwritten by a WinCC installation so that the changes will be lost.

---

### 2.15.2.3 Graphics

#### Graphics - short description

The Graphics group contains functions for programming the graphic system.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

#### GetLinkedVariable

##### Function

Provides the name of the variable linked to a certain object property.

##### Syntax

```
char* GetLinkedVariable(char* lpszPictureName, char* lpszObjectName, char* lpszPropertyName);
```

##### Parameters

**lpszPictureName**

Pointer to the picture

**lpszObjectName**

Pointer to the object

**lpszPropertyName**

Pointer to the object property

##### Return value

Pointer to the name of the tag linked to a certain object property.

#### GetLocalPicture

##### Function

Provides a pointer to the name of the picture. The picture name is the file name without the ".PDL" extension.

**Syntax**

```
char* GetLocalPicture(char* lpszPictureName);
```

**Parameters****lpszPictureName**

Pointer to the picture

**Return value**

Pointer on the name of the picture.

---

**Note**

The passed call parameter lpszPictureName must have the structure provided by the graphics system for the picture paths:

```
<Basic picture name>.<Picture window name>:<Picture name>. ... .<Picture window name>[:<Picture name>]
```

where <Basic picture name> and <Picture name> go without the ".PDL" file extension.

---

**Example:**

In a basic picture "AAA" there is a picture window "bbb" in which a picture "CCC" is called which itself contains a picture window "ddd" in which a picture "EEE" is called.

Then the function call

```
GetLocalPicture(lpszPictureName)
```

returns the pointer to the picture name:

"EEE" if the functions is called in the picture "EEE";

"CCC" if the functions is called in the picture "CCC";

"AAA" if the functions is called in the picture "AAA".

**GetParentPicture****Function**

Provides a pointer to the name of the picture. The picture name is the file name without the ".PDL" extension.

**Syntax**

```
char* GetParentPicture(char* lpszPictureName);
```

## Parameters

### **lpszPictureName**

Pointer to the picture

## Return value

Name of the current picture if the function is called in the basic picture

Name path of the higher-level picture if the function is called in a picture window

---

### **Note**

The passed call parameter `lpszPictureName` must have the structure provided by the graphics system for the picture paths:

`<Basic picture name>.<Picture window name>:<Picture name>. ... .<Picture window name>[:<Picture name>]`

where `<Basic picture name>` and `<Picture name>` go without the ".PDL" file extension.

---

## GetParentPictureWindow

### Function

Provides a pointer to the name of the picture window.

### Syntax

```
char* GetParentPictureWindow(char* lpszPictureName);
```

### Parameters

#### **lpszPictureName**

Pointer to the picture

### Return value

Pointer to the name of the picture window if the function is called in a picture displayed in a picture window of a higher-level picture

Call parameter `lpszPictureName` unchanged if the function is called in the basic picture



**Note**

The passed call parameter `lpszPictureName` must have the structure provided by the graphics system for the picture paths:

<Basic picture name>.<Picture window name>:<Picture name>. ... .<Picture window name>[:<Picture name>]

where <Basic picture name> and <Picture name> go without the ".PDL" file extension.

---

**Example:**

In a basic picture "Picture\_1" there is a picture window "Picture\_window\_1" in which a picture "Picture\_2" is called.

In the picture "Picture\_2" there is a picture window "Picture\_window\_2" in which a picture "Picture\_3" is called.

Then the function call

```
GetParentPictureWindow(lpszPictureName)
```

returns the pointer to the picture window name:

"Picture\_2" if the function is called in the picture "Picture\_3";

"Picture\_window\_1" if the function is called in the picture "Picture\_2";

"Picture\_1" if the function is called in the picture "Picture\_1".

**OpenPicture****Function**

Changes the specified basic picture. On the client and in case of a picture name with server prefix a picture change is performed in the picture window.

If, for example, the picture window is located in a different picture window with a server prefix, a picture change is not performed in the picture window in which the function was called.

If multiple picture windows with server prefix are integrated in the picture and the "OpenPicture()" function calls the last picture, the picture change is carried out in the first picture window. For example, "screen1.window1(screen2.window2(screen3.window3(screen4.OpenPicture)))" executes a picture change in "window1".

**WinCC Alarm Control: WinCC server or WinCC client with its own project**

If you have selected a server package in the WinCC AlarmControl, the picture change takes place in the picture window of the WinCC Alarm Control when called with "Loop in Alarm".

## Syntax

```
void OpenPicture(Picture PictureName)
```

## Parameters

### Picture name

Picture name

## Registry2

## Function

This function manages a list of string pairs (String0, String1).

It knows the following types of calls controlled by the mode parameter:

- Registry2("set", "String0", "String1");

Includes the passed string pair into the list.

- Registry2("get", "String0", NULL);

Returns the first string pair partner String1 which belongs to the passed String0 and then deletes the string pair from the list.

- Registry2("reset", NULL, NULL);

Deletes all string pairs from the list.

- Registry2("display", NULL, NULL);

Shows the string pairs currently stored in the list in a Global Script diagnostics window.

## Syntax

```
char* Registry2(char* mode, char* String0, char* String1);
```

## Parameters

### mode

Defines the working principle of the function.

set	Incorporation of the string pair into the list
get	Determination of the first sting pair partner for String0 and deletion of the string pair from the list
reset	Deletion of all string pairs
display	Display of the string pairs in a Global Script diagnostics window

### String0

The parameter supply depends on the working principle of the function.

**String1**

The parameter supply depends on the working principle of the function.

**Return value**

In the mode=get mode a pointer to the first string pair partner is returned.

---

**Note**

This function is used in conjunction with the picture module technology.

If you work with the "Create faceplate as type" and "Create instance(s) in the process picture" wizards in the "Faceplates" tab of the Dynamic Wizard, using the "Registry2" function is not permitted!

---

**2.15.2.4 Obsolete functions**

**Alarm**

**AXC\_OnBtnAlarmHidingList**

**Function**

This function displays the list of hidden messages in a message window.

**Syntax**

BOOL AXC\_OnBtnAlarmHidingList(char\* lpszPictureName, char\* lpszObjectName)

**Parameters**

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnArcLong

### Function

This function displays the messages stored in a long-term archive list in a message window.

### Syntax

BOOL AXC\_OnBtnArcLong (char\* lpszPictureName, char\* lpszObjectName)

### Parameters

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnArcShort

### Function

This function displays the messages stored in a short-term archive list in a message window.

### Syntax

```
BOOL AXC_OnBtnArcShort(char* lpszPictureName, char* lpszObjectName)
```

### Parameters

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnComment

### Function

External message window operation

This function displays the comment of the previously selected messages.

### Syntax

```
BOOL AXC_OnBtnComment (char* lpszPictureName, char* lpszObjectName)
```

## Parameters

### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnEmergAckn

### Function

External message window operation

This function opens the acknowledgement dialog (emergency acknowledgement/reset).

### Syntax

```
BOOL AXC_OnBtnEmergAckn(char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

**AXC\_OnBtnHideDlg****Function**

This function opens the display options dialog for defining the messages that are to be displayed in the message window. The options are "All messages", "Shown messages" or "Hidden messages".

**Syntax**

```
BOOL AXC_OnBtnHideDlg(char* lpszPictureName, char* lpszObjectName)
```

**Parameters****lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

**Return value****TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnHideUnhideMsg

### Function

The function hides the selected message or displays again the hidden message.

### Syntax

```
BOOL AXC_OnBtnHideUnhideMsg(char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnHit

### Function

This function displays the messages stored in the hit list in a message window.

### Syntax

```
BOOL AXC_OnBtnHit (char* lpszPictureName, char* lpszObjectName)
```



## Parameters

### **IpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

### **IpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnHornAckn

### Function

External message window operation

This function acknowledges the horn signal.

### Syntax

BOOL AXC\_OnBtnHornAckn (char\* IpszPictureName, char\* IpszObjectName)

### Parameters

#### **IpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **IpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnInfo

### Function

External message window operation  
This function displays the information text.

### Syntax

BOOL AXC\_OnBtnInfo (char\* lpszPictureName, char\* lpszObjectName)

### Parameters

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnLock

### Function

External message window operation

This function opens the "Set the Lock List Parameters" dialog.

### Syntax

```
BOOL AXC_OnBtnLock (char* lpszPictureName, char* lpszObjectName)
```

### Parameters

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnLockUnlock

### Function

This function locks the selected message in the message window. This message will then no longer be archived.

This function unlocks the selected message in the lock list.

### Syntax

```
BOOL AXC_OnBtnLockUnlock (char* lpszPictureName, char* lpszObjectName)
```

## Parameters

### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnLockWin

### Function

External message window operation.

This function calls the lock list.

### Syntax

```
BOOL AXC_OnBtnLockWin (char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnLoop

### Function

External message window operation

This function triggers the "LoopInAlarm" function of the selected message.

### Syntax

BOOL AXC\_OnBtnLoop (char\* lpszPictureName, char\* lpszObjectName)

### Parameters

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnMsgFirst

### Function

External message window operation

This function switches to the beginning of the message list.

### Syntax

```
BOOL AXC_OnBtnMsgFirst (char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnMsgLast

### Function

External message window operation

This function switches to the beginning of the message list.

### Syntax

```
BOOL AXC_OnBtnMsgLast (char* lpszPictureName, char* lpszObjectName)
```

## Parameters

### **IpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

### **IpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnMsgNext

### Function

External message window operation

This function switches to the next message in the message list.

### Syntax

BOOL AXC\_OnBtnMsgNext (char\* IpszPictureName, char\* IpszObjectName)

### Parameters

#### **IpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **IpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnMsgPrev

### Function

External message window operation

This function switches to the previous message in the message list.

### Syntax

BOOL AXC\_OnBtnMsgPrev (char\* lpszPictureName, char\* lpszObjectName)

### Parameters

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---



## AXC\_OnBtnMsgWin

### Function

External message window operation

This function calls the message list.

---

#### Note

The message list contains the currently pending and unacknowledged messages.

---

### Syntax

```
BOOL AXC_OnBtnMsgWin (char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### Note

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnPrint

### Function

External message window operation

All messages fulfilling the selection criterion set in the Alarm Control are output to the printer.

### Syntax

BOOL AXC\_OnBtnPrint(char\* lpszPictureName, char\* lpszObjectName)

### Parameters

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnProtocol

### Function

External message window operation

Printing of the current view of the Alarm Control is started. All messages fulfilling the selection criterion set in the Alarm Control are output to the printer.

### Syntax

BOOL AXC\_OnBtnProtocol(char\* lpszPictureName, char\* lpszObjectName)

### Parameters

**lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

**lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

---

### Note

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnScroll

### Function

External message window operation

This function activates or deactivates the horizontal and vertical scroll functions.

### Syntax

```
BOOL AXC_OnBtnScroll(char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

---

### Note

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnSelect

### Function

External message window operation

This function opens the "Specify Selection" dialog for the displayed list.

### Syntax

```
BOOL AXC_OnBtnSelect(char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnSinglAckn

### Function

External message window operation

This function acknowledges the currently selected message.

### Syntax

```
BOOL AXC_OnBtnSinglAckn(char* lpszPictureName, char* lpszObjectName)
```

## Parameters

### **IpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

### **IpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnSortDlg

### Function

External operation of the message window

This function opens the dialog for setting a user-defined sorting of the displayed messages for the displayed list.

### Syntax

```
BOOL AXC_OnBtnSortDlg(char* IpszPictureName, char* IpszObjectName)
```

### Parameters

#### **IpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **IpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnTimeBase

### Function

External operation of the message window

This function opens the dialog for setting the time base for the times shown in the messages.

### Syntax

```
BOOL AXC_OnBtnTimeBase(char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_OnBtnVisibleAckn

### Function

External message window operation

All visible messages in the message window are acknowledged (group acknowledgement).

### Syntax

```
BOOL AXC_OnBtnVisibleAckn(char* lpszPictureName, char* lpszObjectName)
```

### Parameters

#### **lpszPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

#### **lpszObjectName**

Pointer to the object name of the WinCC Alarm Control

#### **Return value**

##### **TRUE**

The function has been completed without any errors.

##### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## AXC\_SetFilter

### Function

External message window operation

This function sets a filter for WinCC Alarm Control to show a portion of the existing messages according to the filter criterion.

### Syntax

```
BOOL AXC_SetFilter(char* lpszPictureName, char* lpszObjectName,  
LPMSG_FILTER_STRUCT lpMsgFilter, LPCMN_ERROR, lpError)
```

## Parameters

### **lpzPictureName**

Pointer to the name of the picture in which the WinCC Alarm Control is located

### **lpzObjectName**

Pointer to the WinCC Alarm Control name

### **lpMsgFilter**

Pointer to the structure containing the filter criterion

### **lpError**

Pointer to the structure of the error description

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC AlarmControl as of WinCC V7.0.

---

## Report

## ReportJob

## Function

Depending on the value of the lpMethodName parameter a print job or the preview for a print job is started.

## Syntax

```
void ReportJob(LPSTR lpJobName, LPSTR lpMethodName)
```

## Parameters

### **lpJobName**

Pointer to the name of the print job



### **IpMethodName**

PRINTJOB Print job is started

PREVIEW Preview of the print job is started

---

### **Note**

This function is replaced by the RPTJobPreview and RPTJobPrint functions and should no longer be used.

---

## **TagLog**

## **TOOLBAR\_BUTTONS**

## **TlgTableWindowPressEditRecordButton**

### **Function**

The editing of the table window is blocked or enabled (toggle function).

If editing is enabled, updating of the table window is stopped at the same time.

The updating of the table window remains to be stopped afterward, even if editing is blocked by a further function call.

### **Syntax**

```
BOOL TlgTableWindowPressEditRecordButton(char* lpszWindowName)
```

### **Parameter**

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

### **Return value**

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressFirstButton

### Function

Displays the first data records of the display area in the table window.

The number of displayed data records depends on the configured time range.

### Syntax

```
BOOL TlgTableWindowPressFirstButton(char* lpszWindowName)
```

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressHelpButton

### Function

Displays the online help for the table window.

### Syntax

BOOL TlgTableWindowPressHelpButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressInsertRecordButton

### Syntax

BOOL TlgTableWindowPressInsertRecordButton(char\* lpszWindowName)

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressLastButton

### Function

Displays the last data records of the display area in the table window.

The number of displayed data records depends on the configured time range.

**Syntax**

BOOL TlgTableWindowPressLastButton(char\* lpszWindowName)

**Parameter**

**lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

**TlgTableWindowPressNextButton**

**Function**

The data records following the current display area are displayed in the table window.  
The number of displayed data records depends on the configured time range.

**Syntax**

BOOL TlgTableWindowPressNextButton(char\* lpszWindowName)

**Parameter**

**lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressNextItemButton

### Function

The columns of the table window are moved one column to the left, the left column taking the position of the right column.

### Syntax

```
BOOL TlgTableWindowPressNextItemButton(char* lpszWindowName)
```

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressOpenArchiveVariableSelectionDlgButton

### Function

Opens the dialog for connecting table columns to archives and tags.

**Syntax**

BOOL TlgTableWindowPressOpenArchiveVariableSelectionDlgButton(char\*  
IpszWindowName)

**Parameter**

**IpszWindowName**

Pointer to the window title of the WinCC Online Table Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

**TlgTableWindowPressOpenDlgButton**

**Function**

Opens the dialog for online configuration of the table window.

**Syntax**

BOOL TlgTableWindowPressOpenDlgButton(char\* IpszWindowName)

**Parameter**

**IpszWindowName**

Pointer to the window title of the WinCC Online Table Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

**TlgTableWindowPressOpenItemSelectDlgButton****Function**

Opens the dialog for selecting the visible columns and the first column of the table window.

**Syntax**

BOOL TlgTableWindowPressOpenItemSelectDlgButton(char\* lpszWindowName)

**Parameter****lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

**Return value****TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

**TlgTableWindowPressOpenTimeSelectDlgButton****Function**

Opens the dialog for setting the time range to be displayed in the table columns.

**Syntax**

BOOL TlgTableWindowPressOpenTimeSelectDlgButton(char\* lpszWindowNumber)

**Parameter**

**lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

**TlgTableWindowPressPrevButton**

**Function**

The data records preceding the current display area are displayed in the table window.  
The number of displayed data records depends on the configured time range.

**Syntax**

BOOL TlgTableWindowPressPrevButton(char\* lpszWindowName)

**Parameter**

**lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

**Return value**

**TRUE**

The function has been completed without any errors.



**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressPrevItemButton

### Function

The columns of the table window are moved one column to the right, the right column taking the position of the left column.

### Syntax

```
BOOL TlgTableWindowPressPrevItemButton(char* lpszWindowName)
```

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressRemoveRecordButton

### Syntax

```
BOOL TlgTableWindowPressRemoveRecordButton(char* lpszWindowName)
```

---

#### Note

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTableWindowPressStartStopButton

### Function

Updating of the table window is switched on or off (toggle function).

### Syntax

```
BOOL TlgTableWindowPressStartStopButton(char* lpszWindowName)
```

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Table Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### Note

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgTrendWindowPressFirstButton

### Function

Displays the first data records of the display area in the trend window.

The number of displayed data records depends on the configured time range.

### Syntax

```
BOOL TlgTrendWindowPressFirstButton(char* lpszWindowName)
```

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## **TlgTrendWindowPressHelpButton**

### Function

Displays the online help for the trend window.

### Syntax

```
BOOL TlgTableWindowPressNextButton(char* lpszWindowName)
```

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressLastButton

### Function

Displays the last data records of the display area in the trend window.

The number of displayed data records depends on the configured time range.

### Syntax

```
BOOL TlgTrendWindowPressLastButton(char* lpszWindowName)
```

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressLinealButton

### Function

The ruler of the trend window is shown or hidden (toggle function).

The ruler can be moved by means of the "cursor left" and "cursor right" buttons.

### Syntax

BOOL TlgTableWindowPressNextButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## **TlgTrendWindowPressNextButton**

### Function

The data records following the current display area are displayed in the trend window.  
The number of displayed data records depends on the configured time range.

### Syntax

BOOL TlgTrendWindowPressNextButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressNextItemButton

### Function

Brings all trends in the trend window one layer to the front.

The trend in the foreground is moved into the background.

### Syntax

```
BOOL TlgTrendWindowPressNextItemButton(char* lpszWindowName)
```

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressOneToOneButton

### Function

Restores the standard size (1:1) in the trend window.

**Syntax**

BOOL TlgTrendWindowPressOneToOneButton(char\* lpszWindowName)

**Parameter**

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

**TlgTrendWindowPressOpenArchiveVariableSelectionDlgButton**

**Function**

Opens the dialog for connecting trends to archives and tags.

**Syntax**

BOOL TlgTrendWindowPressOpenArchiveVariableSelectionDlgButton(char\* lpszWindowName)

**Parameter**

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressOpenDlgButton

### Function

Opens the dialog for online configuration of the trend window.

### Syntax

```
BOOL TlgTrendWindowPressOpenDlgButton(char* lpszWindowName)
```

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressOpenItemSelectDlgButton

### Function

Opens the dialog for selecting the visible trends and the trend which is to be in the foreground.



**Syntax**

BOOL TlgTrendWindowPressOpenItemSelectDlgButton(char\* lpszWindowNumber)

**Parameter**

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

**TlgTrendWindowPressOpenTimeSelectDlgButton**

**Function**

Opens the dialog for setting the time range to be displayed.

**Syntax**

BOOL TlgTrendWindowPressOpenTimeSelectDlgButton(char\* lpszWindowNumber)

**Parameter**

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressPrevButton

### Function

The data records preceding the current display area are displayed in the trend window.  
The number of displayed data records depends on the configured time range.

### Syntax

```
BOOL TlgTrendWindowPressPrevButton(char* lpszWindowName)
```

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressPrevItemButton

### Function

Brings all trends in the trend window one layer to the back.  
The trend in the background is moved to the foreground.

### Syntax

BOOL TlgTrendWindowPressPrevItemButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## **TlgTrendWindowPressPrintButton**

### Function

The current view of the trends is output in accordance with the display configured for the WinCC Trend Control.

### Syntax

BOOL TlgTrendWindowPressPrintButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressReportSaveButton

### Function

The displayed trend window data is saved in a text file.

### Syntax

BOOL TlgTrendWindowPressReportSaveButton (char\* lpszWindowName)

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressStartStopButton

### Function

Updating of the trend window is switched on or off (toggle function).

### Syntax

BOOL TlgTrendWindowPressStartStopButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## **TlgTrendWindowPressStatsResultButton**

### Function

Starts the evaluation of data in the selected time area.  
The statistic values minimum, maximum, average and standard deviation are calculated.

### Syntax

BOOL TlgTrendWindowPressStatsResultButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressStatsSelectRangeButton

### Function

To select the time range for the statistics function, the rulers for start and end time are displayed.

### Syntax

BOOL TlgTrendWindowPressStatsSelectRangeButton(char\* lpszWindowName)

### Parameter

**lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressZoomInButton

### Function

The zoom in the trend window is activated. The zoom range can only be selected with the mouse.

### Syntax

BOOL TlgTrendWindowPressZoomInButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgTrendWindowPressZoomOutButton

### Function

The trend window is restored to the state in which it was before the zoom was activated. The zoom is deactivated.

The zoom range can only be selected with the mouse (also see TlgTrendWindowPressZoomInButton).

### Syntax

BOOL TlgTrendWindowPressZoomOutButton(char\* lpszWindowName)

### Parameter

#### **lpszWindowName**

Pointer to the window title of the WinCC Online Trend Control

### Return value

#### **TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

**Template**

**TlgGetNumberOfColumns**

**Function**

Provides the number of columns in the table window.

The window title of the corresponding WinCC Online Table Control is passed with the `lpszTemplate` parameter.

**Syntax**

```
int TlgGetNumberOfColumns(char* lpszTemplate)
```

**Parameter**

**`lpszTemplate`**

Pointer to the window title of the WinCC Online Table Control

**Return value**

Number of columns in a table window

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

**TlgGetNumberOfRows**

**Function**

Provides the number of lines in the table window.

The window title of the corresponding WinCC Online Table Control is passed with the `lpszTemplate` parameter.



### Syntax

```
int TlgGetNumberOfRows(char* lpszTemplate)
```

### Parameter

#### **lpszTemplate**

Pointer to the window title of the WinCC Online Table Control

### Return value

Number of lines in the table window

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgGetNumberOfTrends

### Function

Provides the number of trends in the trend window.

The window title of the corresponding WinCC Online Trend Control is passed with the lpszTemplate parameter.

### Syntax

```
int TlgGetNumberOfTrends(char* lpszTemplate)
```

### Parameter

#### **lpszTemplate**

Pointer to the window title of the WinCC Online Trend Control

### Return value

Number of trends in the trend window

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgGetRowPosition

### Function

Provides the current position of the line pointer in the table window.

The window title of the corresponding WinCC Online Table Control is passed with the `lpszTemplate` parameter.

### Syntax

```
int TlgGetRowPosition(char* lpszTemplate)
```

### Parameter

#### **lpszTemplate**

Pointer to the window title of the WinCC Online Table Control

### Return value

Current position of the line pointer in the table window

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

## TlgGetRulerArchivNameTrend

### Function

Provides the archive name of the trend with the `nTrend` number in the trend window at the ruler position.

The window title of the corresponding WinCC Online Trend Control is passed with the `lpszTemplate` parameter.

### Syntax

```
char* TlgGetRulerArchivNameTrend(char* lpszTemplate, int nTrend)
```

### Parameter

#### **lpszTemplate**

Pointer to the window title of the WinCC Online Trend Control

**nTrend**

Number of the trend

(0 &lt;= nTrend &lt;= Number of visible trends - 1)

**Return value**Archive name of the trend with the nTrend number in the trend window at the ruler position

---

**Note**The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

**TlgGetRulerTimeTrend****Function**

Provides the time of the trend with the nTrend number in the trend window at the ruler position.

The window title of the corresponding WinCC Online Trend Control is passed with the lpszTemplate parameter.

**Syntax**

SYSTEMTIME TlgGetRulerTimeTrend(char\* lpszTemplate, int nTrend)

**Parameter****lpszTemplate**

Pointer to the window title of the WinCC Online Trend Control

**nTrend**

Number of the trend

(0 &lt;= nTrend &lt;= Number of visible trends - 1)

**Return value**Time of the trend with the nTrend number in the trend window at the ruler position

---

**Note**The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## See also

TlgGetRulerTimeTrend example (Page 1587)

## TlgGetRulerValueTrend

### Function

Provides the value of the trend with the nTrend number in the trend window at the ruler position. The window title of the corresponding WinCC Online Trend Control is passed with the lpszTemplate parameter.

### Syntax

```
double TlgGetRulerValueTrend(char* lpszTemplate, int nTrend)
```

### Parameter

#### **lpszTemplate**

Pointer to the window title of the WinCC Online Trend Control

#### **nTrend**

Number of the trend

(0 <= nTrend <= Number of visible trends - 1)

### Return value

Value of the trend with the nTrend number in the trend window at the ruler position

---

#### **Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## TlgGetRulerVariableNameTrend

### Function

Provides the tag name of the trend with the nTrend number in the trend window.

The window title of the corresponding WinCC Online Trend Control is passed with the lpszTemplate parameter.

**Syntax**

```
char* TlgGetRulerVariableNameTrend(char* lpszTemplate, int nTrend)
```

**Parameter****lpszTemplate**

Pointer to the window title of the WinCC Online Trend Control

**nTrend**

Number of the trend

(0 <= nTrend <= Number of visible trends - 1)

**Return value**

The tag name of the trend with the nTrend number in the trend window.

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

**TlgGetTextAtPos****Function**

Provides the content of a cell of the table window as text for process value archives and user archives.

The cell is specified by nColumn and nLine.

The window title of the corresponding WinCC Online Table Control is passed with the lpszTemplate parameter.

**Syntax**

```
char* TlgGetTextAtPos(char* lpszTemplate, int nColumn, int nLine)
```

**Parameter****lpszTemplate**

Pointer to the window title of the WinCC Online Table Control

**nColumn**

Number of the column

**nLine**

Number of the line

**Return value**

Content of the cell of a table window as text

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

**TlgGetColumnPosition**

**Function**

Provides the current position of the column pointer in the table window as column index.

**Syntax**

```
int TlgGetColumnPosition(char* lpszTemplate)
```

**Parameter**

**lpszTemplate**

Pointer to the window title of the WinCC Online Table Control

**Return value**

Current position of the column pointer in a table window

---

**Note**

The standard function is no longer supported for the new WinCC OnlineTableControl as of WinCC V7.0.

---

**TlgTrendWindowActivateCurve**

**Function**

Activates a certain trend in WinCC Online Trend Control via the configured name of the trend. This function is executed independently of the visibility or foreground position of the trend.

## Syntax

```
BOOL TlgTrendWindowActivateCurve(char* lpszPictureName, char* lpszObjectName, char* szValue)
```

## Parameter

### **lpszPictureName**

Picture name

### **lpszObjectName**

Name of Trend Control

### **szValue**

Name of the curve

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

The standard function is no longer supported for the new WinCC OnlineTrendControl as of WinCC V7.0.

---

## 2.15.2.5 Report

### Report - short description

The Report group contains functions with which to start the print preview of a print job or the printout itself.

---

### **Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## RPTJobPreview

### Function

The preview of a print job is started.

### Syntax

```
BOOL RPTJobPreview(LPSTR lpJobName)
```

### Parameters

#### **lpJobName**

Pointer to the name of the print job

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## RPTJobPrint

### Function

A print job is started.

### Syntax

```
BOOL RPTJobPrint(LPSTR lpJobName)
```

### Parameters

#### **lpJobName**

Pointer to the name of the print job

### Return value

#### **TRUE**

The function has been completed without any errors.



**FALSE**

An error has occurred.

**RptShowError****Function**

This function provides an error description for a failed print job.

The function is already integrated into the RptJobPrint and RptJobPreview standard functions and does not have to be called separately.

The error description is displayed in a Global Script diagnostics window.

---

**Note**

As RptShowError is a standard function the output type and form can be changed if required.

Please note that modified standard functions are overwritten by a WinCC installation so that the changes will be lost.

---

**Syntax**

```
void RptShowError ( LPCSTR pszFailedFunction, CMN_ERRORA* pCmnErrorA )
```

**Parameters****pszFailedFunction**

Pointer to the name of the failed function.

If this pointer is NULL there will be no output of the function name.

**pCmnErrorA**

Pointer to the error structure of the failed function.

If this pointer is NULL there will be no output of the error structure.

STRUCTURES\_TABLES\_ERROR\_STRUCTURE

## 2.15.2.6 WinCC

### WinCC - short description

The WinCC group contains functions which affect the entire WinCC system.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### GetHWDiag

#### Function

This function realizes the direct start of diagnosis at runtime triggered by an event, which must be configured, exercised on an object.

If the event occurs, the hardware diagnostics function is started from STEP7 for the associated PLC.

The following conditions must be fulfilled in order to use the function:

- The WinCC project, with the picture from which access should occur, and the STEP7 project must be on the same computer.
- The WinCC project must be stored as a subdirectory of the STEP7 project (STEP7 Projekt \wincproj\WinCC Projekt).
- The S7 tags have been mapped to WinCC.

#### Syntax

```
BOOL GetHWDiag(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR IProperties)
```

#### Parameters

##### IpszPictureName

Name of the picture (PDL file) that contains the tag that will be used for the entry point for the hardware diagnostics

Since the name "IpszPictureName" stands for the current picture, entries are only required here in cases where it is necessary to access an object tag in a different picture.

##### IpszObjectName

Name of the object in the picture that connected with the tag that will be used for the entry point for the hardware diagnostics

Since the name "IpszObjectName" stands for the current object entries are only required here in cases where it is necessary to access a tag in a different object.

### **IpProperties**

Name of the attribute that is connected with the tag that will be used for the entry point for the hardware diagnostics

If multiple attribute are entered, they must be separated by semicolons (";").

### **Return value**

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

### **GetHWDiagLevel**

#### **Function**

Checks the logged-in user's authorization on the basis of the User Administrator function number in dwLevel.

Then, diagnostics is started directly during runtime and is triggered by an event, which has to be configured, occurring on an object.

If the event occurs, the hardware diagnostics function is started from STEP7 for the associated PLC.

The following conditions must be fulfilled in order to use the function:

- The WinCC project, with the picture from which access should occur, and the STEP7 project must be on the same computer.
- The WinCC project must be stored as a subdirectory of the STEP7 project (STEP7 Projekt \wincproj\WinCC Projekt).
- The S7 tags have been mapped to WinCC.
- In order for the user logged into WinCC to edit the hardware diagnostics dialog, the user must have a WinCC user authorization matching the number passed by the function call in the parameter "dwLevel".

#### **Syntax**

```
BOOL GetHWDiagLevel(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR IpProperties, DWORD dwLevel)
```

## Parameters

### **lpszPictureName**

Name of the picture (PDL file) that contains the tag that will be used for the entry point for the hardware diagnostics

Since the name "lpszPictureName" stands for the current picture, entries are only required here in cases where it is necessary to access an object tag in a different picture.

### **lpszObjectName**

Name of the object in the picture that connected with the tag that will be used for the entry point for the hardware diagnostics

Since the name "lpszObjectName" stands for the current object entries are only required here in cases where it is necessary to access a tag in a different object.

### **lpProperties**

Name of the attribute that is connected with the tag that will be used for the entry point for the hardware diagnostics

If multiple attribute are entered, they must be separated by semicolons (";").

### **dwLevel**

Level number for STEP7 write permissions.

This can be defined in User Administrator.

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## GetKopFupAwI

### Function

This function performs the network entry jump of WinCC into the STEP7 Editor "KFA".

When executing this function two tasks are performed:

- Determination of the required date for the network entry jump from WinCC.
- Transfer of the data to Step7 and finding the places of use of the operand in a STEP7 program by means of AUTAPI.

## Syntax

BOOL GetKopFupAwI(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR IpszProperties)

## Parameters

### IpszPictureName

Name of the picture (PDL file) that contains the tag that will be used for the network entry jump

Since the name "IpszPictureName" stands for the current picture, entries are only required here in cases where it is necessary to access an object tag in a different picture.

### IpszObjectName

Name of the object in the picture that connected with the tag that will be used for the network entry jump

Since the name "IpszObjectName" stands for the current object entries are only required here in cases where it is necessary to access a tag in a different object.

### IpszProperties

Name of the attribute that is connected with the tag that will be used for the network entry jump

If multiple attribute are entered, they must be separated by semicolons (;).

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

## GetKopFupAwILevel

## Function

Checks the active user's authorization on the basis of the User Administrator function number in dwLevel and then performs the entry jump into the STEP7 Editor "KFA".

When executing this function three tasks are performed:

- Determination of the required date for the network entry jump from WinCC.
- Authorization check for the active user within WinCC.
- Transfer of the data to STEP7 and finding the places of use of the operand in a STEP7 program by means of AUTAPI.

---

**Note**

Depending on the result of the authorization check in WinCC the user has either only reading rights in STEP7 or is authorized to change S7 data.

---

**Syntax**

```
BOOL GetKopFupAwlLevel(LPCTSTR lpszPictureName, LPCTSTR  
lpszObjectName, LPCTSTR lpProperties, DWORD dwLevel)
```

**Parameters**

**lpszPictureName**

Name of the picture (PDL file) that contains the tag that will be used for the network entry jump

Since the name "lpszPictureName" stands for the current picture, entries are only required here in cases where it is necessary to access an object tag in a different picture.

**lpszObjectName**

Name of the object in the picture that connected with the tag that will be used for the network entry jump

Since the name "lpszObjectName" stands for the current object entries are only required here in cases where it is necessary to access a tag in a different object.

**lpProperties**

Name of the attribute that is connected with the tag that will be used for the network entry jump

If multiple attribute are entered, they must be separated by semicolons (";").

**dwLevel**

Level number for STEP7 write permissions.

This can be defined in User Administrator.

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**OnDeactivateExecute**

**Function**

This function is called when terminating WinCC Runtime.

As this is a standard function, you can insert instructions which are then executed.

---

**Note**

Concerning the instructions it must be taken into account that the Runtime is terminating and therefore not all functionalities are available.

Please note that modified standard functions are overwritten by a WinCC installation so that the changes will be lost.

---

**Syntax**

```
void OnDeactivateExecute()
```

**OnErrorExecute**

**Function**

OnErrorExecute is called by the system when an error occurred upon executing an action or a function.

This allows you to determine the precise error cause.

The function is called by the system and does not require an additional call.

As this function is available as a standard function the output type and form can be changed if required.

---

**Note**

Please note that modified standard functions are overwritten by a new installation so that the changes will be lost.

---

**Syntax**

```
void OnErrorExecute(CCAPErrorExecute ErrorExecute)
```

## Parameters

### ErrorExecute

Structure informing about the error that has occurred

## Diagnostic information

These information are displayed in a Global Script diagnostics window.

SystemTime	Time (UTC) at which the error occurred
dwErrorCode1	The error codes and their meaning are to be found in the structure definition
dwErrorCode2	The error codes and their meaning are to be found in the structure definition
szErrorText	Text description of the error cause
bCycle	Cycle type
szApplicationName	Error-triggering application
szFunctionName	FunctionID
szTagName	Tag name
dwCycle	Cycle type
szErrorTextTagName	Text description of the tag status
status	Tag status
lpszPictureName	Picture in which the error occurred
lpszObjectName	Object in which the error occurred
lpszPropertyName	Object property in which the error occurred
dwParamSize	only used internally
szErrorText	Text description of the error cause returned by the error structure "pError"

## OnTime

### Function

OnTime is exclusively called by the system. The function returns the runtime of all actions or determines the actions running longer than the specified time. Time measurement can be enabled/disabled via APDIAG.

As this function is available as a standard function the output type can be influenced by changing the function code.

---

### Note

Please note that modified standard functions are overwritten by a WinCC installation so that the changes will be lost.

---



**Syntax**

```
void OnTime(CCAPTime time)
```

**Parameters****time**

Result structure

STRUCTURES\_TABLES\_CCAPTIVE

**2.15.2.7 Windows****Windows - short description**

The Windows group contains the ProgramExecute function.

This function can be used to execute any program.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

**ProgramExecute****Function**

Starts the program with the specified name.

**Syntax**

```
unsigned int ProgramExecute(char* Program_Name)
```

**Parameters****Program\_Name**

Pointer to the program name

**Return value**

If the return value is greater than 31, the function has been completed without any errors.

In case of an error, the return value contains one of the following error codes:

0	out of memory
2	Specified file could not be found.
3	Specified path could not be found.
11	Program could not be started.

## 2.15.3 Internal functions

### 2.15.3.1 Internal functions - short description

Internal functions are used to make graphic objects and archives dynamic and in project functions, standard functions and global script actions.

Internal functions are recognized throughout a project.

They can neither be newly created nor can existing internal functions be modified.

Internal functions are divided into the following groups:

#### **allocate**

Functions to reserve and release working memory space

#### **c\_bib**

Functions from the standard C-library

#### **graphics**

Functions to read and set properties of graphical objects

#### **tag**

Functions to read and write tags

#### **wincc**

Functions for changing languages, deactivating Runtime and ending WinCC

### 2.15.3.2 **allocate**

#### **SysFree**

#### **Function**

Releases the memory area previously reserved with the SysMalloc function.

**Syntax**

```
void SysFree(void* lpFree);
```

**Parameters****lpFree**

Pointer to the memory area reserved with the SysMalloc function

**SysMalloc****Function**

Reserves memory space for an action. The memory area is assigned to the action. When the action has been completed and the result transferred, the system releases the memory again.

The SysFree function can be used to release reserved memory space.

**Syntax**

```
void* SysMalloc(unsigned long int size);
```

**Parameters****size**

Size of the memory area in bytes.

**2.15.3.3 c\_bib****c\_bib - short description**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**ctype**

**isalnum**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## isalpha

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## isdigit

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## isgraph

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## islower

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## **isprint**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---



## ispunct

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## isspace

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## isupper

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## isxdigit

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## tolower

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## toupper

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## math

### acos

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**asin**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## atan

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## atan2

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**ceil**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output



You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**COS**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## cosh

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## exp

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**fabs**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**floor**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## fmod

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## frexp

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## Idexp

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**log**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## log10

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## modf

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`



stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**pow**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**sin**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## sinh

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## sqrt

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**tan**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**tanh**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## memory

## memchr

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## memcmp

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## memcpy

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**memmove**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---



## memset

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## stdio

## char\_io

## fgetc

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`

- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## fgets

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**fputc**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## **fputs**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### **Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## **getc**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## putc

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## ungetc

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## Directio

### fread

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

### fwrite

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## Error

### clearerr

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output



You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**feof**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## **ferror**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### **Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## **File**

### **fclose**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**fflush**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## **fopen**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## freopen

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## remove

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**rename**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**setbuf**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## setvbuf

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## tmpfile

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`



stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## tmpnam

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## File\_pos

### fgetpos

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**fseek**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**fsetpos**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**ftell**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## rewind

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## Output

### vfprintf

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

#### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

### vsprintf

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## stdlib

### abs

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**atof**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---



## atoi

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## atol

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**bsearch**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## **calloc**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## div

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## free

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## getenv

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**labs**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## ldiv

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## malloc

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## qsort

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output



You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**rand**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## realloc

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## srand

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## strtod

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**strtol**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## strtoul

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## string

## strcat

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**strchr**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**strcmp**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## strcpy

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## strcspn

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`



stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**strerror**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**strlen**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## strncat

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## strncmp

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**strncpy**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**strpbrk**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## strchr

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## strspn

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**strstr**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**strtok**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---



## time

### asctime

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

#### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

### clock

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

**ctime**

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**difftime**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## gmtime

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

### Note

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

## localtime

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function localtime reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions printf(), sprintf(), fprintf() can only process 360 characters in WinCC.

---

## mktime

The function group c\_bib contains C functions from the C library and is divided into:

- ctype
- math
- memory
- stdio
- stdlib
- string
- time

stdio itself is further divided into:

- char\_io
- directio
- error
- file
- file\_pos
- output

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**strftime**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**time**

The function group `c_bib` contains C functions from the C library and is divided into:

- `ctype`
- `math`
- `memory`
- `stdio`
- `stdlib`
- `string`
- `time`

`stdio` itself is further divided into:

- `char_io`
- `directio`
- `error`
- `file`
- `file_pos`
- `output`

You can find a description of this function in related technical literature.

---

**Note**

The function `localtime` reacts as follows in respect of date output:

Numbering of the months begins with 0.

The years are counted from 1900, beginning with 0.

The C-library functions `printf()`, `sprintf()`, `fprintf()` can only process 360 characters in WinCC.

---

**2.15.3.4 graphics****Graphics - short description**

The functions of the Graphics group allow to modify or query graphical properties of WinCC objects.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

---

**Note**

If the function is called for the picture object, set the parameter `IpszObjectName = ZERO`.

---

**get**

**axes**

**GetAlignment**

**Function**

When using bar objects, it indicates whether the text is to the right or left of the bar.

**Syntax**

```
BOOL GetAlignment(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

Text is to the right of the bar

**FALSE**

Text is to the left of the bar

**See also**

Beispiel GetScaling (Page 1536)



## GetAxisSection

### Function

When using bar objects, it specifies the difference between the values of two neighboring axis labels.

### Syntax

```
double GetAxisSection(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Difference between the values of two neighboring axis labels

## GetExponent

### Function

When using bar objects, it specifies whether the axis label corresponds to the decimal or exponential form.

### Syntax

```
BOOL GetExponent(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

## Return value

### **TRUE**

Axis label in exponential form

### **FALSE**

Axis label in decimal form

## See also

Beispiel GetScaling (Page 1536)

## GetLeftComma

### Function

When using bar objects, it specifies the number of integers in the axis label.

### Syntax

```
long int GetLeftComma(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### **IpszPictureName**

Picture name

#### **IpszObjectName**

Object name

### Return value

The number of integers in the axis label

## GetLongStrokesBold

### Function

When using bar objects, it specifies whether the main division lines on the scale are bold or regular.

### Syntax

```
BOOL GetLongStrokesBold(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

The main division lines on the graph scale are bold

### **FALSE**

The main division lines on the graph scale are regular

## See also

Beispiel GetScaling (Page 1536)

## GetLongStrokesOnly

## Function

When using bar objects, it specifies whether intermediate division lines are used on the scale.

## Syntax

```
BOOL GetLongStrokesOnly(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Only main division lines are used on the bar graph scale.

**FALSE**

Both main and intermediate division lines are used on the bar graph scale.

**See also**

Beispiel GetScaling (Page 1536)

**GetLongStrokesSize**

**Function**

When using bar objects, it specifies the length of the main division lines.

**Syntax**

```
long int GetLongStrokesSize(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Length of the main division lines as numeric value

**GetLongStrokesTextEach**

**Function**

When using bar objects, it specifies the interval between the main division lines being assigned a label.

**Syntax**

```
long int GetLongStrokesTextEach(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Label of the main division lines as numeric value

**Example:**

Return value = 1 -> Every main division line is assigned a label.

Return value = 2 -> Every 2nd main division line is assigned a label.

etc.

**GetRightComma**

**Function**

When using bar objects, it specifies the number of decimal places in the axis label.

**Syntax**

```
long int GetRightComma(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

The number of decimal places in the axis label

**GetScaleTicks**

**Function**

When using bar objects, it specifies the scale marks as number of scale sections. A scale section is a part of the scale bounded by two main tick marks.

### Syntax

```
long int GetScaleTicks(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Scale marks as number of scale sections

---

**Note**

The number of scale sections is given as 0, if the bar object itself calculates a suitable scale unit.

---

### GetScaling

#### Function

When using bar objects, it specifies whether the scale is activated or deactivated.

#### Syntax

```
BOOL GetScaling(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

#### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

#### Return value

**TRUE**

Display with scale

**FALSE**

Display without scale

**See also**

Beispiel GetScaling (Page 1536)

**GetScalingType**

**Function**

When using bar objects, it specifies the type of bar scaling.

**Syntax**

```
long int GetScalingType(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Type of bar scaling as numeric value

**See also**

Bar Scaling (Page 1590)

## color

### Color - short description

The various color properties of objects can be modified or queried using the functions in the Color group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetBackColor

### Function

Specifies the background color of the object as a numeric value.

### Syntax

```
long int GetBackColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

### Return value

Background color of the object as a numeric value

---

#### Note

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

### See also

[GetBackColor example \(Page 1518\)](#)

[Color chart \(Page 1592\)](#)



## GetBackColor2

### Function

When using bar objects, it specifies the color of the bar as a numeric value.

### Syntax

```
long int GetBackColor2(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the bar color

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetBackColor3

### Function

When using bar objects, it specifies the background color of the bar as a numeric value.

### Syntax

```
long int GetBackColor3(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the bar background color

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetBackColorBottom

### Function

Specifies the background color of the slider objects at the bottom right.

### Syntax

```
long int GetBackColorBottom(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

### Return value

Numeric value defining the background color of the slider objects at the bottom right

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetBackColorTop

### Function

Specifies the background color of the slider objects at the top left.

### Syntax

```
long int GetBackColorTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the background color of the slider objects at the top left

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetBorderBackColor

## Function

Specifies the background color of the lines or borders.

## Syntax

```
long int GetBorderBackColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the background color of the lines or borders

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetBorderColor

### Function

Specifies the line or border color as a numeric value.

### Syntax

```
long int GetBorderColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the color of lines or borders

### See also

[GetBackColor example \(Page 1518\)](#)

[Color chart \(Page 1592\)](#)

## GetBorderColorBottom

### Function

Specifies the 3D border color at the bottom.

### Syntax

```
long int GetBorderColorBottom(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the 3D border color at the bottom

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetBorderColorTop

### Function

Specifies the 3D border color at the top.

### Syntax

```
long int GetBorderColorTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

### Return value

Numeric value defining the 3D border color at the top

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetButtonColor

### Function

Specifies the button color of slider objects.

### Syntax

```
long int GetButtonColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

## Return value

Numeric value defining the button color of slider objects

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorBottom

### Function

When using slider objects, it specifies the color of the bottom limit.

### Syntax

```
long int GetColorBottom(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

## Return value

Numeric value defining the color of the bottom limit of slider objects

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorTop

### Function

When using slider objects, it specifies the color of the top limit.

### Syntax

```
long int GetColorTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the color of the top limit of slider objects

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetFillColor

### Function

Specifies the color of the fill pattern.

### Syntax

```
long int GetFillColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value of the fill color

---

#### Note

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

### See also

[GetBackColor example \(Page 1518\)](#)

[Color chart \(Page 1592\)](#)

### GetForeColor

#### Function

Specifies the color of the font.

#### Syntax

```
long int GetForeColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

#### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Numeric value defining the font color

### See also

[GetBackColor example \(Page 1518\)](#)

[Color chart \(Page 1592\)](#)



## GetGridColor

### Function

Specifies the grid color of Graphics Designer.

### Syntax

```
long int GetGridColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the grid color of Graphics Designer

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetItemBorderBackColor

### Function

Specifies the background color of the dividing line for the "text list" object.

### Syntax

```
long int GetItemBorderBackColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the background color of the dividing line for the "text list" object

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

### GetItemBorderColor

#### Function

Specifies the color of the dividing line for the "text list" object.

#### Syntax

```
long int GetItemBorderColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

#### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

#### Return value

Numeric value defining the dividing line color for the "text list" object

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

### GetScaleColor

#### Function

Specifies the scale color for bar objects.

#### Syntax

```
long int GetScaleColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value of the scale color for bar objects

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetSelBGColor

### Function

Specifies the background color of the selected entry for the "text list" object.

### Syntax

```
long int GetSelBGColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the background color of the selected entry

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetSelTextColor

### Function

Specifies the font color of the selected entry for the "text list" object.

### Syntax

```
long int GetSelTextColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Numeric value defining the font color of the selected entry

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetTrendColor

### Function

Specifies the trend color of bar objects.

### Syntax

```
long int GetTrendColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Numeric value defining the trend color of bar objects

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetUnselBGColor

### Function

Specifies the background color of the non-selected entries for the "text list" object.

### Syntax

```
long int GetUnselBGColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

### Return value

Numeric value defining the background color of the non-selected entries

### See also

Color chart (Page 1592)

GetBackColor example (Page 1518)

## GetUnselTextColor

### Function

Specifies the font color of the non-selected entries for the "text list" object.

### Syntax

```
long int GetUnselTextColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Numeric value defining the font color of the non-selected entries

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## fill

## Fill - short description

The functions in the Fill group control the dynamic filling of objects.

---

### **Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetFilling

## Function

Specifies whether dynamic filling with background color is activated.

## Syntax

```
BOOL GetFilling(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

Dynamic filling with background color is activated.

**FALSE**

Dynamic filling with background color is not activated.

**See also**

GetFilling example (Page 1519)

**GetFillingIndex**

**Function**

Specifies the current fill level.

**Syntax**

```
long int GetFillingIndex(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Current fill level as a numeric value (0 - 100)

**See also**

GetFillingIndex example (Page 1520)

## flash

### Flash - short description

The various flashing properties can be modified or called in using the functions in the Flash group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### GetBackFlashColorOff

#### Function

Specifies the background flash color for the deactivated status.

#### Syntax

```
long int GetBackFlashColorOff(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

#### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

#### Return value

Background flash color for the deactivated status as a numeric value

#### See also

Color chart (Page 1592)

GetFlashBackColorOn example (Page 1521)



## GetBackFlashColorOn

### Function

Specifies the background flash color for the activated status.

### Syntax

```
long int GetBackFlashColorOn(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Background flash color for the activated status as a numeric value

### See also

GetFlashBackColorOn example (Page 1521)

Color chart (Page 1592)

## GetBorderFlashColorOff

### Function

Specifies the border or line flashing color for the deactivated status.

### Syntax

```
long int GetBorderFlashColorOff(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Border or line flashing color for the deactivated status as a numeric value

### See also

GetFlashBackColorOn example (Page 1521)

Color chart (Page 1592)

## GetBorderFlashColorOn

### Function

Specifies the border or line flashing color for the activated status.

### Syntax

```
long int GetBorderFlashColorOn(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Border or line flashing color for the activated status as a numeric value

### See also

GetFlashBackColorOn example (Page 1521)

Color chart (Page 1592)

## GetFlashBackColor

### Function

Specifies whether flashing of the background is activated or not.

### Syntax

```
BOOL GetFlashBackColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Flashing background is activated.

### **FALSE**

Flashing background is not activated.

## See also

GetFlashBackColor example (Page 1521)

## GetFlashBorderColor

## Function

Specifies whether flashing of the border or line is activated or not.

## Syntax

```
BOOL GetFlashBorderColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Flashing of the border or line is activated.

**FALSE**

Flashing of the border or line is not activated.

**See also**

GetFlashBackColor example (Page 1521)

**GetFlashForeColor**

**Function**

Specifies whether flashing of the font is activated or not.

**Syntax**

```
BOOL GetFlashForeColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

Flashing of the font is activated.

**FALSE**

Flashing of the font is not activated.

**See also**

GetFlashBackColor example (Page 1521)

**GetFlashRateBackColor**

**Function**

Specifies the flash frequency of the background.

## Syntax

```
long int GetFlashRateBackColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

## Return value

Flash frequency of the background

## See also

[GetFlashBackColorOn example \(Page 1521\)](#)

[Flash frequencies \(Page 1590\)](#)

## GetFlashRateBorderColor

## Function

Specifies the flash frequency of the line or border.

## Syntax

```
long int GetFlashRateBorderColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

## Return value

Flash frequency of the line or border

## See also

GetFlashBackColorOn example (Page 1521)

Flash frequencies (Page 1590)

## GetFlashRateForeColor

### Function

Specifies the flash frequency of the font.

### Syntax

```
long int GetFlashRateForeColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Flash frequency of the font

## See also

GetFlashBackColorOn example (Page 1521)

Flash frequencies (Page 1590)

## GetForeFlashColorOff

### Function

Specifies the font flash color for the deactivated status.

### Syntax

```
long int GetForeFlashColorOff(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Font flash color for the deactivated status as a numeric value

## See also

GetFlashBackColorOn example (Page 1521)

Color chart (Page 1592)

## GetForeFlashColorOn

## Function

Specifies the font flash color for the activated status.

## Syntax

```
long int GetForeFlashColorOn(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Font flash color for the activated status as a numeric value

## See also

GetFlashBackColorOn example (Page 1521)

Color chart (Page 1592)

## focus

### Focus - short description

Using the functions in the Focus group, it is possible to set the focus or poll which object has the focus.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## Get\_Focus

### Function

Specifies the name of the object currently or last focussed.

### Syntax

```
char *Get_Focus();
```

### Return value

Name of the object currently or last focussed.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

### See also

GetFocus example (Page 1523)



## font

### Font - short description

The various properties affecting text can be modified or called in using the functions in the Font group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### GetAlignmentLeft

#### Function

Specifies the horizontal text alignment (left, centered, right).

#### Syntax

```
long int GetAlignmentLeft(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

#### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

#### Return value

Horizontal text alignment as a numeric value

#### See also

Text alignment (Page 1597)

GetFontSize example (Page 1524)

## GetAlignmentTop

### Function

Specifies the vertical text alignment (top, centered, bottom).

### Syntax

```
long int GetAlignmentTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Vertical text alignment as a numeric value

### See also

GetFontSize example (Page 1524)

Text alignment (Page 1597)

## GetFontBold

### Function

Specifies whether the font is bold or not.

### Syntax

```
BOOL GetFontBold(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

Bold font on

**FALSE**

Bold font off

### See also

GetFontBold example (Page 1523)

### GetFontItalic

### Function

Specifies whether the font is italic or not.

### Syntax

```
BOOL GetFontItalic(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Italic font on

**FALSE**

Italic font off

### See also

GetFontBold example (Page 1523)

## GetFontName

### Function

Indicates the current font name.

### Syntax

```
char* GetFontName(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

### Return value

Pointer to the name of the font currently selected.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

### See also

GetText example (Page 1555)

## GetFontSize

### Function

Specifies the font size.

### Syntax

```
long int GetFontSize(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Current font size

## See also

GetFontSize example (Page 1524)

## GetFontUnderline

## Function

Specifies whether the font is underlined or not.

## Syntax

```
BOOL GetFontUnderline(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Underlined font on

### **FALSE**

Underlined font off

## See also

GetFontBold example (Page 1523)

## GetOrientation

### Function

Specifies the text orientation (vertical/horizontal).

### Syntax

```
BOOL GetOrientation(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Vertical text orientation

**FALSE**

Horizontal text orientation

### See also

GetFontBold example (Page 1523)

## GetText

### Function

Specifies the value of the "text" property for objects like static text, check box or radio box.

### Syntax

```
char* GetText(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

Pointer to a text.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

---

**Note**

In case of check and radio boxes, the element to be determined must be defined with the "SetIndex" function before actually activating this function.

---

**See also**

GetText example (Page 1555)

**general****GetLayer****Function**

Specifies the picture layer in which the object is located.

**Syntax**

```
long int GetLayer(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters****lpszPictureName**

Picture name

**lpszObjectName**

Object name

## Return value

Picture layer in which the object is located

## geometry

### Geometry - short description

The size, position and other geometrical properties of objects can be modified or called in using the functions in the Geometry group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetActualPointLeft

### Function

Specifies the X value of the current position in a polygon or polygon line.

### Syntax

```
long int GetActualPointLeft(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

### Return value

X value for the current point of a polygon or polygon line

---

#### Note

The current point of the polygon can be set using the SetIndex function.

---



## See also

GetLeft example (Page 1526)

## GetActualPointTop

### Function

Specifies the Y value of the current position in a polygon or polygon line.

### Syntax

```
long int GetActualPointTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Y value for the current point of a polygon or polygon line

---

**Note**

The current point of the polygon can be set using the SetIndex function.

---

## See also

GetTop example (Page 1555)

## GetBoxCount

### Function

Specifies the number of fields for check boxes and radio boxes.

### Syntax

```
long int GetBoxCount(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Number of fields in a check box or radio box.

## GetDirection

## Function

Specifies the bar direction for bar objects.

## Syntax

```
long int GetDirection(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Bar direction of bar objects as numeric value

## See also

Bar direction (Page 1590)

## GetEndAngle

## Function

Specifies the end angle of circle and ellipse segments and circle and elliptical arcs.

### Syntax

```
long int GetEndAngle(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

End angle of circle and ellipse segments as well as circle and ellipse arcs

### GetGrid

### Function

Specifies whether the grid is activated in the graphics area of Graphics Designer.

### Syntax

```
BOOL GetGrid(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

Grid in Graphics Designer is activated.

**FALSE**

Grid in Graphics Designer is deactivated.

## GetGridHeight

### Function

Specifies the height of the grid in the graphics area of Graphics Designer.

### Syntax

```
long int GetGridHeight(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Height of the grid in Graphics Designer

## GetGridWidth

### Function

Specifies the width of the grid in the graphics area of Graphics Designer.

### Syntax

```
long int GetGridWidth(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Width of the grid in Graphics Designer

## GetHeight

### Function

Specifies the height of the rectangle framing an object.

### Syntax

```
long int GetHeight(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Height of the rectangle framing an object

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

### See also

GetHeight example (Page 1524)

## GetLeft

### Function

Specifies the X position of the upper left corner of the rectangle framing an object.

### Syntax

```
long int GetLeft(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Current X value of the upper left corner of the rectangle framing an object

## See also

GetLeft example (Page 1526)

## GetPointCount

## Function

Specifies the number of corners of a polygon or in a polygon line.

## Syntax

```
long int GetPointCount(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Number of corners of a polygon or in a polyline

## GetRadius

## Function

Specifies the radius of a circle, circle segment or arc.

## Syntax

```
long int GetRadius(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### IpszPictureName

Picture name

### IpszObjectName

Object name

## Return value

Radius of a circle, circle segment or arc

## See also

GetHeight example (Page 1524)

## GetRadiusHeight

## Function

Specifies the radius of an ellipse, ellipse segment or elliptical arc in a vertical direction.

## Syntax

```
long int GetRadiusHeight(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### IpszPictureName

Picture name

### IpszObjectName

Object name

## Return value

Radius of an ellipse, ellipse segment or elliptical arc in a vertical direction

## See also

GetHeight example (Page 1524)

## GetRadiusWidth

### Function

Specifies the radius of an ellipse, ellipse segment or elliptical arc in a horizontal direction.

### Syntax

```
long int GetRadiusWidth(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Radius of an ellipse, ellipse segment or elliptical arc in a horizontal direction

### See also

GetHeight example (Page 1524)

## GetReferenceRotationLeft

### Function

Specifies the X value of the rotation reference (central axis about which the object can be rotated) for lines, polygons and polylines.

### Syntax

```
long int GetReferenceRotationLeft(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name



### Return value

X value of the rotation reference for lines, polygons and polygon lines

### See also

GetLeft example (Page 1526)

## GetReferenceRotationTop

### Function

Specifies the Y value of the rotation reference (central axis about which the object can be rotated) for lines, polygons and polylines.

### Syntax

```
long int GetReferenceRotationTop(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Y value of the rotation reference for lines, polygons and polygon lines

### See also

GetTop example (Page 1555)

## GetRotationAngle

### Function

Specifies the angle of rotation about the central axis for lines, polygons and polylines.

### Syntax

```
long int GetRotationAngle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Angle of rotation about the central axis

## See also

GetHeight example (Page 1524)

## GetRoundCornerHeight

## Function

Specifies the radius of the rounded corner of a rectangle vertically.

## Syntax

```
long int GetRoundCornerHeight(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Vertical radius of the rounded corner of a rectangle

## See also

GetHeight example (Page 1524)

## GetRoundCornerWidth

### Function

Specifies the radius of the rounded corner of a rectangle horizontally.

### Syntax

```
long int GetRoundCornerWidth(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Horizontal radius of the corner of the rounded corner of a rectangle

### See also

GetWidth example (Page 1557)

## GetStartAngle

### Function

Specifies the start angle of circle and ellipse segments and circle and elliptical arcs.

### Syntax

```
long int GetStartAngle(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Start angle of circle and ellipse segments as well as circle and elliptical arcs

**See also**

GetHeight example (Page 1524)

**GetTop**

**Function**

Specifies the Y position of the upper left corner of the rectangle framing an object.

**Syntax**

```
long int GetTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Current Y value of the upper left corner of the rectangle framing an object

**See also**

GetTop example (Page 1555)

**GetWidth**

**Function**

Specifies the width of the rectangle framing an object.

**Syntax**

```
long int GetWidth(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Width of the rectangle framing an object

---

### **Note**

If the function is called in relation to the entire picture, set the parameter IpszObjectName = NULL.

---

## See also

GetWidth example (Page 1557)

## GetZeroPoint

### Function

When using bar objects, it indicates the zero point.

### Syntax

```
long int GetZeroPoint(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Zero point for bar objects

## See also

GetHeight example (Page 1524)

## i\_o

### i\_o - short description

The various properties affecting input and output values can be modified or called in using the functions in the i\_o group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetAssignments

### Function

Assignment of text to the value range of lists

### Syntax

```
char* GetAssignments(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

### Return value

The assignment of text to the value range depends on the list type.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

## See also

List types (Page 1596)

## GetAssumeOnExit

### Function

Specifies for I/O fields whether the entered value is assumed upon exiting the field.

### Syntax

```
BOOL GetAssumeOnExit(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

Value application upon exiting the field.

**FALSE**

No value application upon exiting the field.

## GetAssumeOnFull

### Function

Specifies for I/O fields whether the entered value is assumed on completion of input.

### Syntax

```
BOOL GetAssumeOnFull(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

Value application on completion of input.

**FALSE**

No value application on completion of input.

**GetBitNumber**

**Function**

Specifies the relevant bit in the output value for the "bit" list type.

**Syntax**

```
long int GetBitNumber(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Indication of the relevant bit in the output value for the "bit" list type

**See also**

GetHiddenInput example (Page 1525)

List types (Page 1596)

**GetClearOnError**

**Function**

Specifies for I/O fields whether deletion of the content in case of input errors is activated.



## Syntax

```
BOOL GetClearOnError(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Deletion of the content in case of input errors is activated

### **FALSE**

Deletion of the content in case of input errors is not activated

## GetClearOnNew

## Function

Specifies for I/O fields whether deletion of the content on new input is activated.

## Syntax

```
BOOL GetClearOnNew(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Deletion of the content on new input is activated.

**FALSE**

Deletion of the content on new input is not activated.

**GetDataFormat**

**Function**

Specifies the data type of the field content for I/O fields.

**Syntax**

```
long int GetDataFormat(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Data type of the field content as numeric value

**See also**

GetHiddenInput example (Page 1525)

I/O field, data type of the field content (Page 1592)

**GetHiddenInput**

**Function**

Specifies whether hidden input is activated for I/O fields.

**Syntax**

```
BOOL GetHiddenInput(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

### **TRUE**

Hidden input is activated

### **FALSE**

Hidden input is not activated

## See also

GetHiddenInput example (Page 1525)

## GetInputValueChar

## Function

Specifies the input value in the data type "char" for I/O fields.

## Syntax

```
char* GetInputValueChar(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Pointer to the input value in the data type "char".

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpzPictureName, "Text1");  
if(pszValue != NULL)
```

```
{  
    .....  
}
```

## GetInputValueDouble

### Function

Specifies the input value in the data type "double" for I/O fields.

### Syntax

```
double GetInputValueDouble(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Input value in the data type "double"

## GetListType

### Function

Specifies the list type for the "text list" object.

### Syntax

```
long int GetListType(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

List type for the "text list" object

### See also

GetHiddenInput example (Page 1525)

List types (Page 1596)

### GetNumberLines

#### Function

Specifies the number of visible lines for the "text list" object.

#### Syntax

```
long int GetNumberLines(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

#### Parameters

##### **IpszPictureName**

Picture name

##### **IpszObjectName**

Object name

#### Return value

Number of visible lines for the "text list" object

---

#### **Note**

If the amount of configured text is larger than the number of visible lines, the "text list" object receives a vertical scroll bar.

---

### See also

GetHiddenInput example (Page 1525)

### GetOutputFormat

#### Function

Specifies the output format for I/O fields.

## Syntax

```
char* GetOutputFormat(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

## Return value

Pointer to the output format.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

## See also

I/O field, data type of the field content (Page 1592)

I/O field, output format (Page 1591)

## GetOutputValueChar

## Function

Determines the output value in the data type "char" for I/O fields. This function should only be used if the field content of the I/O field is of the "string" data type.

## Syntax

```
char* GetOutputValueChar(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

Pointer to the output value in the data type "char".

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

**GetOutputValueDouble****Function**

Determines the output value in the data type "double" for I/O fields. This function should only be used if the field content of the I/O field is not of the "string" data type.

**Syntax**

```
double GetOutputValueDouble(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters****lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

Output value in the data type "double"

**See also**

GetOutputValueDouble example (Page 1529)

## Limits

### Limits - short description

The various properties affecting limit values can be modified or called in using the functions in the Limits group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetAlarmHigh

### Function

Specifies the upper alarm limit for bar objects.

### Syntax

```
double GetAlarmHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Upper alarm limit for bar objects

### See also

GetAlarmHigh example (Page 1518)

## GetAlarmLow

### Function

Specifies the lower alarm limit for bar objects.



## Syntax

```
double GetAlarmLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Lower alarm limit for bar objects

## See also

GetAlarmHigh example (Page 1518)

## GetCheckAlarmHigh

## Function

When using bar objects, it specifies whether the upper alarm limit is monitored.

## Syntax

```
BOOL GetCheckAlarmHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the upper alarm limit is monitored.

### **FALSE**

In case of bar objects the upper alarm limit is not monitored.

**See also**

GetMarker example (Page 1528)

**GetCheckAlarmLow**

**Function**

When using bar objects, it specifies whether the lower alarm limit is monitored.

**Syntax**

```
BOOL GetCheckAlarmLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

**TRUE**

In case of bar objects the lower alarm limit is monitored.

**FALSE**

In case of bar objects the lower alarm limit is not monitored.

**See also**

GetMarker example (Page 1528)

**GetCheckLimitHigh4**

**Function**

When using bar objects, it specifies whether the upper limit value reserve 4 is monitored.

**Syntax**

```
BOOL GetCheckLimitHigh4(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the upper limit value reserve 4 is monitored.

### **FALSE**

In case of bar objects the upper limit value reserve 4 is not monitored.

## See also

GetMarker example (Page 1528)

## GetCheckLimitHigh5

## Function

When using bar objects, it specifies whether the upper limit value reserve 5 is monitored.

## Syntax

```
BOOL GetCheckLimitHigh5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the upper limit value reserve 5 is monitored.

**FALSE**

In case of bar objects the upper limit value reserve 5 is not monitored.

**See also**

GetMarker example (Page 1528)

**GetCheckLimitLow4**

**Function**

When using bar objects, it specifies whether the lower limit value reserve 4 is monitored.

**Syntax**

```
BOOL GetCheckLimitLow4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

In case of bar objects the lower limit value reserve 4 is monitored.

**FALSE**

In case of bar objects the lower limit value reserve 4 is not monitored.

**See also**

GetMarker example (Page 1528)

**GetCheckLimitLow5**

**Function**

When using bar objects, it specifies whether the lower limit value reserve 5 is monitored.

## Syntax

```
BOOL GetCheckLimitLow5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### IpszPictureName

Picture name

### IpszObjectName

Object name

## Return value

### TRUE

In case of bar objects the lower limit value reserve 5 is monitored.

### FALSE

In case of bar objects the lower limit value reserve 5 is not monitored.

## See also

GetMarker example (Page 1528)

## GetCheckToleranceHigh

## Function

When using bar objects, it specifies whether the upper tolerance limit is monitored.

## Syntax

```
BOOL GetCheckToleranceHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### IpszPictureName

Picture name

### IpszObjectName

Object name

## Return value

### **TRUE**

In case of bar objects the upper tolerance limit is monitored.

### **FALSE**

In case of bar objects the upper tolerance limit is not monitored.

## See also

GetMarker example (Page 1528)

## GetCheckToleranceLow

## Function

When using bar objects, it specifies whether the lower tolerance limit is monitored.

## Syntax

```
BOOL GetCheckToleranceLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the lower tolerance limit is monitored.

### **FALSE**

In case of bar objects the lower tolerance limit is not monitored.

## See also

GetMarker example (Page 1528)

## GetCheckWarningHigh

### Function

When using bar objects, it specifies whether the upper warning limit is monitored.

### Syntax

```
BOOL GetCheckWarningHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

In case of bar objects the upper warning limit is monitored.

**FALSE**

In case of bar objects the upper warning limit is not monitored.

### See also

GetMarker example (Page 1528)

## GetCheckWarningLow

### Function

When using bar objects, it specifies whether the lower warning limit is monitored.

### Syntax

```
BOOL GetCheckWarningLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

In case of bar objects the lower warning limit is monitored.

**FALSE**

In case of bar objects the lower warning limit is not monitored.

**See also**

GetMarker example (Page 1528)

**GetColorAlarmHigh**

**Function**

Specifies the bar color for bar objects upon reaching the upper alarm limit.

**Syntax**

```
long int GetColorAlarmHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Numeric value defining the bar color upon reaching the upper alarm limit

**See also**

GetBackColor example (Page 1518)

Color chart (Page 1592)



## GetColorAlarmLow

### Function

Specifies the bar color for bar objects upon reaching the lower alarm limit.

### Syntax

```
long int GetColorAlarmLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the bar color upon reaching the lower alarm limit

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorLimitHigh4

### Function

Specifies the bar color for bar objects upon reaching the upper limit reserve 4.

### Syntax

```
long int GetColorLimitHigh4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the bar color upon reaching the upper limit reserve 4

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorLimitHigh5

### Function

Specifies the bar color for bar objects upon reaching the upper limit reserve 5.

### Syntax

```
long int GetColorLimitHigh5(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Numeric value defining the bar color upon reaching the upper limit reserve 5

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorLimitLow4

### Function

Specifies the bar color for bar objects upon reaching the lower limit reserve 4.

### Syntax

```
long int GetColorLimitLow4(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the bar color upon reaching the lower limit reserve 4

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorLimitLow5

## Function

Specifies the bar color for bar objects upon reaching the lower limit reserve 5.

## Syntax

```
long int GetColorLimitLow5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the bar color upon reaching the lower limit reserve 5

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorToleranceHigh

### Function

Specifies the bar color for bar objects upon reaching the upper tolerance limit.

### Syntax

```
long int GetColorToleranceHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the bar color upon reaching the upper tolerance limit

### See also

[GetBackColor example \(Page 1518\)](#)

[Color chart \(Page 1592\)](#)

## GetColorToleranceLow

### Function

Specifies the bar color for bar objects upon reaching the lower tolerance limit.

### Syntax

```
long int GetColorToleranceLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the bar color upon reaching the lower tolerance limit

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorWarningHigh

### Function

Specifies the bar color for bar objects upon reaching the upper warning limit limit.

### Syntax

```
long int GetColorWarningHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### **IpszPictureName**

Picture name

#### **IpszObjectName**

Object name

### Return value

Numeric value defining the bar color upon reaching the upper warning limit

### See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetColorWarningLow

### Function

Specifies the bar color for bar objects upon reaching the lower warning limit.

### Syntax

```
long int GetColorWarningLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Numeric value defining the bar color upon reaching the lower warning limit

## See also

GetBackColor example (Page 1518)

Color chart (Page 1592)

## GetLimitHigh4

## Function

Specifies the upper limit value for reserve 4 for bar objects.

## Syntax

```
double GetLimitHigh4(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

High limit value for reserve 4 for bar objects

## See also

GetAlarmHigh example (Page 1518)

## GetLimitHigh5

### Function

Specifies the upper limit value for reserve 5 for bar objects.

### Syntax

```
double GetLimitHigh5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

High limit value for reserve 5 for bar objects

### See also

GetAlarmHigh example (Page 1518)

## GetLimitLow4

### Function

Specifies the low limit value for reserve 4 for bar objects.

### Syntax

```
double GetLimitLow4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Low limit value for reserve 4 for bar objects

### See also

GetAlarmHigh example (Page 1518)

### GetLimitLow5

### Function

Specifies the low limit value for reserve 5 for bar objects.

### Syntax

```
double GetLimitLow5(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Low limit value for reserve 5 for bar objects

### See also

GetAlarmHigh example (Page 1518)

### GetLimitMax

### Function

Specifies the upper limit value for I/O fields.

### Syntax

```
double GetLimitMax(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```



## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

High limit value for I/O fields

## See also

GetAlarmHigh example (Page 1518)

## GetLimitMin

## Function

Specifies the low limit value for I/O fields.

## Syntax

```
double GetLimitMin(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Low limit value for I/O fields

## See also

GetAlarmHigh example (Page 1518)

## GetMarker

### Function

When using bar objects, it specifies whether the limit marker is displayed.

### Syntax

```
BOOL GetMarker(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Limit marker for bar objects is displayed.

**FALSE**

Limit marker for bar objects is not displayed.

### See also

GetMarker example (Page 1528)

## GetToleranceHigh

### Function

Specifies the upper tolerance limit for bar objects.

### Syntax

```
double GetToleranceHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Upper tolerance limit for bar objects

**See also**

GetAlarmHigh example (Page 1518)

**GetToleranceLow**

**Function**

Specifies the lower tolerance limit for bar objects.

**Syntax**

```
double GetToleranceLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Lower tolerance limit for bar objects

**See also**

GetAlarmHigh example (Page 1518)

**GetTypeAlarmHigh**

**Function**

Specifies for bar objects whether the upper alarm limit is given in percentages or absolute terms.

### Syntax

```
BOOL GetTypeAlarmHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

In case of bar objects the upper alarm limit is given in percentages.

**FALSE**

In case of bar objects the upper alarm limit is given in absolute terms.

### See also

GetMarker example (Page 1528)

### GetTypeAlarmLow

### Function

Specifies for bar objects whether the lower alarm limit is given in percentages or absolute terms.

### Syntax

```
BOOL GetTypeAlarmLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the lower alarm limit is given in percentages.

### **FALSE**

In case of bar objects the lower alarm limit is given in absolute terms.

## See also

GetMarker example (Page 1528)

## GetTypeLimitHigh4

## Function

Specifies for bar objects whether the upper limit reserve 4 is given in percentages or absolute terms.

## Syntax

```
BOOL GetTypeLimitHigh4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the upper limit reserve 4 is given in percentages.

### **FALSE**

In case of bar objects the upper limit reserve 4 is given in absolute terms.

## See also

GetMarker example (Page 1528)

## GetTypeLimitHigh5

### Function

Specifies for bar objects whether the upper limit reserve 5 is given in percentages or absolute terms.

### Syntax

```
BOOL GetTypeLimitHigh5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

In case of bar objects the upper limit reserve 5 is given in percentages.

**FALSE**

In case of bar objects the upper limit reserve 5 is given in absolute terms.

### See also

GetMarker example (Page 1528)

## GetTypeLimitLow4

### Function

Specifies for bar objects whether the lower limit reserve 4 is given in percentages or absolute terms.

### Syntax

```
BOOL GetTypeLimitLow4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the lower limit reserve 4 is given in percentages.

### **FALSE**

In case of bar objects the lower limit reserve 4 is given in absolute terms.

## See also

GetMarker example (Page 1528)

## GetTypeLimitLow5

## Function

Specifies for bar objects whether the lower limit reserve 5 is given in percentages or absolute terms.

## Syntax

```
BOOL GetTypeLimitLow5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the lower limit reserve 5 is given in percentages.

**FALSE**

In case of bar objects the lower limit reserve 5 is given in absolute terms.

**See also**

GetMarker example (Page 1528)

**GetTypeToleranceHigh**

**Function**

Specifies for bar objects whether the upper tolerance limit is given in percentages or absolute terms.

**Syntax**

```
BOOL GetTypeToleranceHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

**TRUE**

In case of bar objects the upper tolerance limit is given in percentages.

**FALSE**

In case of bar objects the upper tolerance limit is given in absolute terms.

**See also**

GetMarker example (Page 1528)

**GetTypeToleranceLow**

**Function**

Specifies for bar objects whether the lower tolerance limit is given in percentages or absolute terms.



## Syntax

```
BOOL GetTypeToleranceLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the lower tolerance limit is given in percentages.

### **FALSE**

In case of bar objects the lower tolerance limit is given in absolute terms.

## See also

GetMarker example (Page 1528)

## GetTypeWarningHigh

## Function

Specifies for bar objects whether the upper warning limit is given in percentages or absolute terms.

## Syntax

```
BOOL GetTypeWarningHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the upper warning limit is given in percentages.

### **FALSE**

In case of bar objects the upper warning limit is given in absolute terms.

## See also

GetMarker example (Page 1528)

## GetTypeWarningLow

## Function

Specifies for bar objects whether the lower warning limit is given in percentages or absolute terms.

## Syntax

```
BOOL GetTypeWarningLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

## Return value

### **TRUE**

In case of bar objects the lower warning limit is given in percentages.

### **FALSE**

In case of bar objects the lower warning limit is given in absolute terms.

## See also

GetMarker example (Page 1528)

## GetWarningHigh

### Function

Specifies the upper warning limit for bar objects.

### Syntax

```
double GetWarningHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Upper warning limit for bar objects

### See also

GetAlarmHigh example (Page 1518)

## GetWarningLow

### Function

Specifies the lower warning limit for bar objects.

### Syntax

```
double GetWarningLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Lower warning limit for bar objects

### See also

GetAlarmHigh example (Page 1518)

### link

### Link - short description

A tag link property can be created or called in using the functions in the Link group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### GetLink

### Function

Specifies the current tag connection of object properties.

### Syntax

```
BOOL GetLink(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, LPCTSTR  
lpszPropertyName, LPLINKINFO *pLink);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **lpszPropertyName**

Object property

#### **pLink**

Pointer to a structure of the type: LINKINFO

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

## See also

Structure definition LINKINFO (Page 1605)

GetLink example (Page 1526)

## miscs

### Miscs - short description

The properties of objects can be modified or called in using the functions in the Miscs group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetAdaptBorder

### Function

Specifies for static texts, I/O fields, check boxes and radio boxes whether the border of the field is to be dynamically adapted to the text size.

### Syntax

```
BOOL GetAdaptBorder(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

### Return value

**TRUE**

Border is adapted

**FALSE**

Border is not adapted

### See also

GetVisible example (Page 1556)

### GetAdaptPicture

### Function

Specifies for picture windows whether the picture is to be adapted to the window size.

### Syntax

```
BOOL GetAdaptPicture(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Picture is adapted

**FALSE**

Picture is not adapted

### See also

GetVisible example (Page 1556)

## GetAdaptSize

### Function

Specifies for picture windows whether the window is to be adapted.

### Syntax

```
BOOL GetAdaptSize(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

Window is adapted

**FALSE**

Window is not adapted

### See also

GetVisible example (Page 1556)

## GetAverage

### Function

When using bar objects, it specifies whether value averaging is activated.

### Syntax

```
BOOL GetAverage(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

**TRUE**

Averaging is activated for bar objects

**FALSE**

Averaging is not activated for bar objects

**See also**

GetVisible example (Page 1556)

**GetBoxType**

**Function**

Specifies the field type (input field, output field, input/output field) for I/O fields.

**Syntax**

```
long int GetBoxType(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

Field type of an I/O field

**See also**

I/O field, field type (Page 1592)



## GetCaption

### Function

Specifies whether a picture or application window has a title.

### Syntax

```
BOOL GetCaption(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

Picture/application window has a title

**FALSE**

Picture/application window has no title

### See also

GetVisible example (Page 1556)

## GetCloseButton

### Function

When using a picture window, it specifies whether the window can be closed.

### Syntax

```
BOOL GetCloseButton(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**lpzObjectName**

Object name

**Return value**

**TRUE**

Picture window can be closed

**FALSE**

Picture window cannot be closed

**See also**

GetVisible example (Page 1556)

**GetColorChangeType**

**Function**

When using bar objects, it specifies whether the color change upon reaching a limit value only affects a bar segment or the entire bar.

**Syntax**

```
BOOL GetColorChangeType(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

**Parameters**

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**Return value**

**TRUE**

Color change applies to the bar segment

**FALSE**

Color change applies to the entire bar

## See also

GetVisible example (Page 1556)

## GetCursorControl

### Function

Specifies whether cursor control is activated for I/O fields.

### Syntax

```
BOOL GetCursorControl(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

### Return value

#### TRUE

Cursor control for I/O fields is enabled.

#### FALSE

Cursor control for I/O fields is disabled.

## See also

GetVisible example (Page 1556)

## GetCursorMode

### Function

Specifies whether the cursor mode for the picture is alpha cursor or tab order cursor.

### Syntax

```
BOOL GetCursorMode(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

### **TRUE**

Cursor mode for the picture is "Alpha-cursor"

### **FALSE**

Cursor mode for the picture is "tab order cursor"

## See also

GetVisible example (Page 1556)

## GetEditAtOnce

## Function

Specifies whether the "Immediate input" property is activated for I/O fields.

## Syntax

```
BOOL GetEditAtOnce(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

### **TRUE**

"Immediate input" property is activated

**FALSE**

"Immediate input" property is deactivated

**See also**

GetVisible example (Page 1556)

**GetExtendedOperation**

**Function**

Specifies whether the "Extended operation" property is activated for slider objects.

**Syntax**

```
BOOL GetExtendedOperation(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

**TRUE**

"Extended operation" property is activated

**FALSE**

"Extended operation" property is deactivated

**See also**

GetVisible example (Page 1556)

**GetHotkey**

**Function**

Specifies the key combination for check boxes.

### Syntax

```
long int GetHotkey(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Key code for key combinations for check boxes

### GetHysteresis

### Function

When using bar objects, it specifies whether the display appears with or without hysteresis.

### Syntax

```
BOOL GetHysteresis(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Display with hysteresis for bar objects

**FALSE**

Display without hysteresis for bar objects

### See also

GetVisible example (Page 1556)

## GetHysteresisRange

### Function

Specifies the hysteresis value in the display for bar objects.

### Syntax

```
double GetHysteresisRange(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Hysteresis in the display for bar objects

## GetLanguageSwitch

### Function

Specifies for the "Text list" object whether the assignment texts are to be stored in the text library or in the object itself.

### Syntax

```
BOOL GetLanguageSwitch(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

## Return value

### **TRUE**

Assignment texts are stored in the text library

### **FALSE**

Assignment texts are stored in the text list object

## See also

GetVisible example (Page 1556)

## GetLastChange

## Function

Specifies the date when the picture was last changed.

## Syntax

```
char* GetLastChange(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

## Return value

Date of the last change of the picture.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

## See also

GetPictureName example (Page 1531)



## GetMax

### Function

Specifies the maximum value for bar and slider objects.

### Syntax

```
double GetMax(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Maximum value for bar and slider objects.

## GetMaximizeButton

### Function

Specifies for picture or application windows whether the window can be maximized.

### Syntax

```
BOOL GetMaximizeButton(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

Picture or application window can be maximized

**FALSE**

Picture or application window cannot be maximized

**See also**

GetVisible example (Page 1556)

**GetMin**

**Function**

Specifies the minimum value for bar and slider objects.

**Syntax**

```
double GetMin(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

Minimum value for bar and slider objects

**GetMoveable**

**Function**

Specifies for picture or application windows whether the window can be moved.

**Syntax**

```
BOOL GetMoveable(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters**

**lpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

Picture or application window is movable

**FALSE**

Picture or application window is not movable

**See also**

GetVisible example (Page 1556)

**GetOffsetLeft**

**Function**

Specifies the horizontal picture distance from the left window border for picture windows.

**Syntax**

```
long int GetOffsetLeft(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Horizontal picture distance from the left window border for picture windows

**GetOffsetTop**

**Function**

Specifies the vertical picture distance from the upper window border for picture windows.

### Syntax

```
long int GetOffsetTop(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Vertical picture distance from the upper window border for picture windows

### GetOnTop

### Function

Specifies for picture or application windows whether the window is always in the foreground.

### Syntax

```
BOOL GetOnTop(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Picture or application window is always in the foreground

**FALSE**

Picture or application window can be overlapped by other windows.

### See also

GetVisible example (Page 1556)

## GetOperation

### Function

Specifies whether the object can be operated.

### Syntax

```
BOOL GetOperation(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

Object is operable

**FALSE**

Object is not operable

---

**Note**

If the function is called in relation to the entire picture, set the parameter IpszObjectName = NULL.

---

### See also

GetVisible example (Page 1556)

## GetOperationMessage

### Function

Specifies for I/O fields, check boxes, radio boxes or sliders whether a message is output following operation.

### Syntax

```
BOOL GetOperationMessage(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Upon operation a message is issued

### **FALSE**

Upon operation no message is issued

## See also

GetVisible example (Page 1556)

## GetOperationReport

## Function

Specifies for all objects except application and picture windows and OLE control whether the reason for the operation is logged.

## Syntax

```
BOOL GetOperationReport(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Reason for the operation is logged.

**FALSE**

Reason for the operation is not logged.

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

**See also**

GetVisible example (Page 1556)

**GetPasswordLevel**

**Function**

Specifies the authorization level for the operation of the object for all objects except application and picture windows and OLE control.

**Syntax**

```
long int GetPasswordLevel(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

Authorization level for the operation of the object

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

## GetPictureName

### Function

Returns the name of the picture currently displayed in the picture window.

### Syntax

```
char* GetPictureName(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Name of the picture window

### Return value

Pointer to the name of the currently displayed picture

---

**Note**

If both parameters are NULL, a pointer appears indicating the name of the basic screen.

---

### See also

GetPictureName example (Page 1531)

## GetProcess

### Function

Specifies the default setting value for the process value to be displayed for bar and slider objects.

Specifies the selected fields for check boxes and radio boxes.

### Syntax

```
double GetProcess(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```



## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

- For bar and slider objects: Default setting value for the process value to be displayed
- For check and radio boxes: In a 32-bit word each field is represented by a bit (field 1 corresponds to the bit value 0). Selected fields are marked by a set bit. Non-existing are assigned 0.

## GetScrollBars

## Function

Specifies for picture windows whether the window has a scroll bar.

## Syntax

```
BOOL GetScrollBars(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Picture window has a scroll bar

### **FALSE**

Picture window has no scroll bar

## See also

GetVisible example (Page 1556)

## GetServerName

### Function

Specifies the default setting for the process value to be displayed for OLE control and OLE object.

### Syntax

```
char* GetServerName(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

### Return value

Name of the object (OLE control and OLE object) under which it is registered in WINDOWS.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

### See also

GetPictureName example (Page 1531)

## GetSizeable

### Function

Specifies for application or picture windows whether the window size can be changed.

### Syntax

```
BOOL GetSizeable(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Application or picture window is sizeable

### **FALSE**

Application or picture window is not sizeable

## See also

GetVisible example (Page 1556)

## GetSmallChange

## Function

Specifies the number of steps for slider objects by which the slider is shifted by a mouse click.

## Syntax

```
long int GetSmallChange(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Number of steps by which the slider is shifted by a mouse click

## GetTagPrefix

### Function

Returns the tag prefix of a picture window.

### Syntax

```
char* GetTagPrefix(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

### Return value

Tag prefix of the picture window.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

### See also

GetTagPrefix example (Page 1549)

## GetTrend

### Function

When using bar objects, it specifies whether the trend display is activated.

### Syntax

```
BOOL GetTrend(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Trend display is activated for a bar object

### **FALSE**

Trend display is not activated for a bar object

## See also

GetVisible example (Page 1556)

## GetUpdateCycle

### Function

Specifies the update cycle for the entire picture.

### Syntax

```
long int GetUpdateCycle(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the update cycle

## See also

Structure definition LINKINFO (Page 1605)

## GetVisible

### Function

Specifies whether the object is displayed.

### Syntax

```
BOOL GetVisible(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Object is displayed

**FALSE**

Object is not displayed

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

### See also

GetVisible example (Page 1556)

## GetWindowBorder

### Function

Specifies for application or picture windows whether the object is displayed with a border.

### Syntax

```
BOOL GetWindowBorder(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Application or picture window is displayed with a border.

### **FALSE**

Application or picture window is displayed without a border.

## See also

GetVisible example (Page 1556)

## GetZeroPointValue

## Function

Specifies the absolute value of the zero point for bar objects.

## Syntax

```
double GetZeroPointValue(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Absolute value of the zero point for the bar display

## GetZoom

### Function

Specifies the scaling factor for picture windos.

### Syntax

```
long int GetZoom(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Scaling factor of a picture window

## ole\_control

### OLE\_control - short description

The functions in the ole\_Control group can only be used with OCX slider objects.

Various OCX slider object properties and settings can be modified or called in using these functions.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetPosition

### Function

Specifies the position of the slider for OCX slider objects.



## Syntax

```
long int GetPosition(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Slider position of the OCX slider object as numeric value

## See also

GetPosition example (Page 1532)

## GetRangeMax

## Function

Specifies the adjustment range "Max" for OCX slider objects.

## Syntax

```
long int GetRangeMax(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Adjustment range "Max" of the OCX slider object as numeric value

## See also

GetRangeMax example (Page 1534)

## GetRangeMin

### Function

Specifies the adjustment range "Min" for OCX slider objects.

### Syntax

```
long int GetRangeMin(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Adjustment range "Min" of the OCX slider object as numeric value

### See also

GetRangeMin example (Page 1535)

### pictures

#### Pictures - short description

Various properties of pictures of graphic objects and round buttons can be modified or called in using the functions in the Pictures group.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetPicDeactReferenced

### Function

Specifies whether the picture for the "deactivated" status is referenced for round buttons.

## Syntax

```
BOOL GetPicDeactReferenced(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

The picture assigned to the "deactivated" status was not stored in the object.

### **FALSE**

The picture assigned to the "deactivated" status was stored in the object.

## GetPicDeactTransparent

## Function

Specifies the transparent color for the "deactivated" status of round buttons.

## Syntax

```
long int GetPicDeactTransparent(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the transparent color for the "deactivated" status

---

### Note

This function only applies to Bitmap graphics (\*.bmp).

---

## See also

Color chart (Page 1592)

GetBackColor example (Page 1518)

## GetPicDeactUseTransColor

### Function

Specifies whether the transparent color for the "deactivated" status is used for round buttons.

### Syntax

```
BOOL GetPicDeactUseTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Transparent color for "deactivated" status is used

**FALSE**

Transparent color for "deactivated" status is not used

## GetPicDownReferenced

### Function

Specifies whether the picture for the "On/pressed" status is referenced for round buttons.

## Syntax

```
BOOL GetPicDownReferenced(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

The picture assigned to the "On/pressed" status was not stored in the object.

### **FALSE**

The picture assigned to the "On/pressed" status was stored in the object.

## GetPicDownTransparent

## Function

Specifies the transparent color for the "On/pressed" status of round buttons.

## Syntax

```
long int GetPicDownTransparent(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the transparent color for the "On/pressed" status

---

### Note

This function only applies to Bitmap graphics (\*.bmp).

---

## See also

Color chart (Page 1592)

GetPictureDown example (Page 1530)

## GetPicDownUseTransColor

### Function

Specifies whether the transparent color for the "On/pressed" status is used for round buttons.

### Syntax

```
BOOL GetPicDownUseTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

**TRUE**

Transparent color for "On/pressed" status is used

**FALSE**

Transparent color for "On/pressed" status is not used

## GetPicReferenced

### Function

When using graphic objects, it specifies whether the picture is referenced.

## Syntax

```
BOOL GetPicReferenced(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

The assigned picture was not stored in the object.

### **FALSE**

The assigned picture was stored in the object.

## GetPicTransColor

## Function

Specifies the transparent color for a background picture for graphic objects.

## Syntax

```
long int GetPicTransColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

Numeric value defining the background picture of a graphic object

---

### Note

This function only applies to Bitmap graphics (\*.bmp).

---

## See also

Color chart (Page 1592)

GetBackColor example (Page 1518)

## GetPictureDeactivated

### Function

Specifies the picture name for the "deactivated" status of round buttons.

### Syntax

```
char* GetPictureDeactivated(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

### Return value

Picture name for "deactivated" status.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

---

### Note

Bitmap files (\*.bmp, \*.dib) as well as metafiles (\*.emf, \*.wmf) can be integrated.

---



## GetPictureDown

### Function

Specifies the picture name for the "On/pressed" status of round buttons.

### Syntax

```
char* GetPictureDown(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Picture name for the "On/pressed" status.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

---

**Note**

Bitmap files (\*.bmp, \*.dib) as well as metafiles (\*.emf, \*.wmf) can be integrated.

---

### See also

GetPictureDown example (Page 1530)

## GetPictureUp

### Function

Specifies the picture name for the "Off/not pressed" status of round buttons.

### Syntax

```
char* GetPictureUp(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Picture name for the "Off/not pressed" status.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

---

**Note**

Bitmap files (\*.bmp, \*.dib) as well as metafiles (\*.emf, \*.wmf) can be integrated.

---

### See also

GetPictureUp example (Page 1532)

### GetPicUpReferenced

#### Function

Specifies whether the picture for the "Off/not pressed" status is referenced for round buttons.

#### Syntax

```
BOOL GetPicUpReferenced(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

#### Parameters

**lpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

The picture assigned to the "Off/not pressed" status was not stored in the object.

**FALSE**

The picture assigned to the "Off/not pressed" status was stored in the object.

**GetPicUpTransparent**

**Function**

Specifies the transparent color for the "Off/not pressed" status of round buttons.

**Syntax**

```
long int GetPicUpTransparent(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

Numeric value defining the transparent color for the "Off/not pressed" status

---

**Note**

This function only applies to Bitmap graphics (\*.bmp).

---

**See also**

Color chart (Page 1592)

GetBackColor example (Page 1518)

## GetPicUpUseTransColor

### Function

Specifies whether the transparent color for the "Off/not pressed" status is used for round buttons.

### Syntax

```
BOOL GetPicUpUseTransColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

**TRUE**

Transparent color for "Off/not pressed" status is used

**FALSE**

Transparent color for "Off/not pressed" status is not used

## GetPicUseTransColor

### Function

When using graphic objects, it specifies whether the transparent color is used for a background picture.

### Syntax

```
BOOL GetPicUseTransColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**Return value**

**TRUE**

Transparent color is used for a background picture.

**FALSE**

Transparent color is not used for a background picture.

**property**

**Property - short description**

The properties of objects for which there are no direct functions can be modified or called in using the functions in the Property group.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

**GetPropBOOL**

**Function**

Specifies the current status of a property of the data type "BOOL".

**Syntax**

BOOL GetPropBOOL(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR IpszPropertyName)

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**lpszPropertyName**

Name of the object property

**Return value**

Value of the attribute in the data type "BOOL"

**See also**

GetPropBOOL example (Page 1533)

**GetPropChar**

**Function**

Specifies the current status of a property of the data type "char".

**Syntax**

```
char* GetPropChar(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, LPCTSTR  
lpszPropertyName)
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lpszPropertyName**

Name of the object property

**Return value**

Pointer to a character string containing the value of the object property.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

## See also

GetPropChar example (Page 1534)

## GetPropDouble

### Function

Specifies the current status of a property of the data type "double".

### Syntax

```
double GetPropDouble(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR  
IpszPropertyName)
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IpszPropertyName**

Name of the object property

### Return value

Value of the attribute in the data type "double"

## GetPropWord

### Function

Specifies the current status of a property of the data type "long".

### Syntax

```
long GetPropWord(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR  
IpszPropertyName)
```

### Parameters

**IpszPictureName**

Picture name

**lpzObjectName**

Object name

**lpzPropertyName**

Name of the object property

**Return value**

Value of the attribute in the type "long"

**state**

**State - short description**

The properties of status displays can be modified or called in using the functions in the State group.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

**GetBasePicReferenced**

**Function**

Specifies whether the basic picture is referenced for the status display.

**Syntax**

BOOL GetBasePicReferenced(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);

**Parameters**

**lpzPictureName**

Picture name

**lpzObjectName**

Object name



## Return value

### TRUE

The basic picture was not stored in the object.

### FALSE

The basic picture was stored in the object.

## GetBasePicTransColor

### Function

Specifies the transparent color of the basic picture for the status display.

### Syntax

```
long int GetBasePicTransColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

### Return value

Transparent color of the basic picture as numeric value

---

#### Note

This function only applies to Bitmap graphics (\*.bmp).

---

### See also

Color chart (Page 1592)

GetBackColor example (Page 1518)

## GetBasePicture

### Function

Specifies the basic picture name for the status display.

### Syntax

```
char* GetBasePicture(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Basic picture name for the status display.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if (pszValue != NULL)  
{  
    .....  
}
```

### GetBasePicUseTransparentColor

### Function

When using the status display, it specifies whether the transparent color is used for the basic picture.

### Syntax

```
BOOL GetBasePicUseTransparentColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

## Return value

### TRUE

Transparent color is used for the basic picture.

### FALSE

Transparent color is not used for the basic picture.

## GetFlashFlashPicture

### Function

Specifies whether the flash picture of the status display is animated dynamically or statically.

### Syntax

```
BOOL GetFlashFlashPicture(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

## Return value

### TRUE

The flash picture is animated dynamically.

### FALSE

The flash picture is animated statically.

## GetFlashPicReferenced

### Function

Specifies whether the flash picture is referenced for the status display.

### Syntax

```
BOOL GetFlashPicReferenced(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

## Return value

**TRUE**

The flash picture was not stored in the object.

**FALSE**

The flash picture was stored in the object.

## GetFlashPicTransColor

### Function

Specifies the transparent color of the flash picture for the status display.

### Syntax

```
long int GetFlashPicTransColor(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

## Return value

Transparent color of the flash picture as numeric value

---

**Note**

This function only applies to Bitmap graphics (\*.bmp).

---

**See also**

Color chart (Page 1592)

GetBackColor example (Page 1518)

**GetFlashPicture****Function**

Specifies the flash picture name for the status display.

**Syntax**

```
char* GetFlashPicture(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

**Parameters****lpszPictureName**

Picture name

**lpszObjectName**

Object name

**Return value**

Flash picture name (file name of the graphic).

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

**GetFlashPicUseTransColor****Function**

When using the status display, it specifies whether the transparent color is used for the flash picture.

**Syntax**

```
BOOL GetFlashPicUseTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

### **TRUE**

Transparent color is used for the flash picture.

### **FALSE**

Transparent color is not used for the flash picture.

## GetFlashRateFlashPic

## Function

Specifies the flash frequency of the flash picture for the status display.

## Syntax

```
long int GetFlashRateFlashPic(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Flash frequency of a flash picture as numeric value

---

### **Note**

Since the flashing is performed by means of software engineering, the precise frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time etc.).

---

## See also

Flash frequencies (Page 1590)

GetFlashRateFlashPic example (Page 1522)

## GetIndex

### Function

Specifies the index of the current position in a polygon or polygon line.

Specifies the index of the current field for check boxes and radio boxes.

### Syntax

```
long int GetIndex(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

### Return value

Index of the current point or field

### style

### Style - short description

Various properties affecting the appearance of objects can be modified or called in using the functions in the Style group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## GetBackBorderWidth

### Function

Specifies the frame width of 3D frames and slider objects.

### Syntax

```
long int GetBackBorderWidth(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Numeric value for the frame width of 3D frames and slider objects

### See also

GetBorderStyle example (Page 1519)

## GetBorderEndStyle

### Function

Specifies the type of line end.

### Syntax

```
long int GetBorderEndStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name



### Return value

Type of line end as numeric value

### See also

GetBorderStyle example (Page 1519)

Line end style (Page 1595)

### GetBorderStyle

#### Function

Specifies the line or border style.

#### Syntax

```
long int GetBorderStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

#### Parameters

##### **lpszPictureName**

Picture name

##### **lpszObjectName**

Object name

### Return value

Numeric value defining the line or border style

### See also

GetBorderStyle example (Page 1519)

Line styles (Page 1595)

### GetBorderWidth

#### Function

Specifies the line or border line width.

#### Syntax

```
long int GetBorderWidth(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Line or border line width as numeric value

## See also

GetBorderStyle example (Page 1519)

## GetBoxAlignment

### Function

Specifies the arrangement of controls (left or right justified) in check boxes or radio boxes.

### Syntax

```
long int GetBoxAlignment(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Numeric value defining the arrangement of controls in check boxes or radio boxes

## See also

GetBorderStyle example (Page 1519)

Text alignment (Page 1597)

## GetFillStyle

### Function

Specifies the type of fill pattern.

### Syntax

```
long int GetFillStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

### Return value

Type of fill pattern as numeric value

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

### See also

Fill pattern (Page 1594)

GetFillStyle example (Page 1520)

## GetFillStyle2

### Function

Specifies the bar fill pattern for a bar graph.

### Syntax

```
long int GetFillStyle2(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Bar fill pattern as numeric value

## See also

Fill pattern (Page 1594)

GetFillStyle example (Page 1520)

## GetItemBorderStyle

### Function

Specifies the dividing line style for the "text list" object.

### Syntax

```
long int GetItemBorderStyle(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

## Return value

Dividing line style for the "text list" object

## See also

GetBorderStyle example (Page 1519)

Line styles (Page 1595)

## GetItemBorderWidth

### Function

Specifies the dividing line width for the "text list" object.

### Syntax

```
long int GetItemBorderWidth(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

### Return value

Numeric value defining the dividing line width for the "text list" object

### See also

GetBorderStyle example (Page 1519)

## GetPressed

### Function

Specifies for buttons or round buttons whether the switch setting is "pressed" or "not pressed".

### Syntax

```
BOOL GetPressed(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

## Return value

### TRUE

Switch setting is "pressed"

### FALSE

Switch setting is "not pressed"

## GetToggle

### Function

Specifies for buttons or round buttons whether the switch is latchable or not.

### Syntax

```
BOOL GetToggle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

## Return value

### TRUE

Switch is latchable

### FALSE

Switch is not latchable

## GetWindowsStyle

### Function

Specifies whether buttons are to be displayed in Windows style.

### Syntax

```
BOOL GetWindowsStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

## Return value

### **TRUE**

Button is displayed in the usual Windows fashion.

### **FALSE**

The appearance of the button is defined by the user.

## set

## axes

## Axes - short description

The functions in the Axes group can only be used with bar graph objects.

This function can be used to modify or query various bar graph object properties.

---

### **Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetAlignment

### Function

When using bar objects, it indicates whether the text is to the right or left of the bar.

### Syntax

```
BOOL SetAlignment(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bAlignment);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

### **bAlignment**

Text alignment

TRUE Text is to the right of the bar

FALSE Text is to the left of the bar

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetScaling example (Page 1569)

## SetAxisSection

### Function

When using bar objects, it specifies the axis section, i.e. the difference between the values of two neighboring axis labels.

### Syntax

```
BOOL SetAxisSection(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, double  
dAxisSection);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name



**dAxisSection**

Axis section

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetScaling example (Page 1569)

**SetExponent**

**Function**

Sets the axis label display for bar objects (exponential/decimal).

**Syntax**

```
BOOL SetExponent(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bExponent);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bExponent**

Axis labeling

TRUE Axis label in exponential form

FALSE Axis label in decimal form

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetScaling example (Page 1569)

**SetLeftComma**

**Function**

When using bar objects, it specifies the number of integers in the axis label.

**Syntax**

```
BOOL SetLeftComma(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lLeftComma);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lLeftComma**

Number of integers

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetScaling example (Page 1569)

## SetLongStrokesBold

### Function

When using bar objects, it specifies whether the main division lines are bold or regular.

### Syntax

```
BOOL SetLongStrokesBold(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bLongStrokesBold);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **bLongStrokesBold**

Main division lines on the bar graph scale

TRUE bold

FALSE normal

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

### See also

SetScaling example (Page 1569)

## SetLongStrokesOnly

### Function

When using bar objects, it specifies whether intermediate or only main division lines are used on the scale.

## Syntax

```
BOOL SetLongStrokesOnly(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bLongStrokesOnly);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **bLongStrokesOnly**

Only main division lines yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetScaling example (Page 1569)

## SetLongStrokesSize

## Function

When using bar objects, it specifies the length of the main division lines on the bar graph scale.

## Syntax

```
BOOL SetLongStrokesSize(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lLongStrokesSize);
```

## Parameters

### **lpszPictureName**

Picture name

**IpszObjectName**

Object name

**ILongStrokesSize**

Length of the main division marks in pixels

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetScaling example (Page 1569)

**SetRightComma**

**Function**

When using bar objects, it specifies the number of decimal places in the axis label.

**Syntax**

```
BOOL SetRightComma(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IRightComma);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IRightComma**

Number of decimal places

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetScaling example (Page 1569)

**SetScaleTicks**

**Function**

When using bar objects, it specifies the scale marks as number of scale sections. A scale section is a part of the scale bounded by two main tick marks.

**Syntax**

```
BOOL SetScaleTicks(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int IScaleTicks);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IScaleTicks**

Number of scale sections

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the number of scale sections is given as 0, the bar object itself calculates a suitable scale unit.

---

## See also

SetScaling example (Page 1569)

## SetScaling

### Function

Switches the bar graph scale of bar objects on or off.

### Syntax

```
BOOL SetScaling(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL bScaling);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bScaling**

Scale on/off.

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetScaling example (Page 1569)

## SetScalingType

### Function

When using bar objects, it specifies the type of bar scaling.

## Syntax

```
BOOL SetScalingType(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IScalingType);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **IScalingType**

Type of bar scaling as numeric value

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Bar Scaling (Page 1590)

SetScaling example (Page 1569)

## color

### **Color - short description**

The various color properties of objects can be modified or queried using the functions in the Color group.

---

### **Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---



## SetBackColor

### Function

Sets the background color of the object.

### Syntax

```
BOOL SetBackColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IBackColor);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IBackColor**

Background color of the object as a numeric value

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetBackColor2

### Function

Sets the bar color for bar objects.

### Syntax

```
BOOL SetBackColor2(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lBackColor2);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lBackColor2**

Numeric value defining the bar color

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetBackColor3

### Function

Sets the bar background color for bar objects.

### Syntax

```
BOOL SetBackColor3(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lBackColor3);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IBackColor3**

Numeric value defining the bar background color

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetBackColorBottom

## Function

Sets the background color of the slider objects at the bottom right.

## Syntax

```
BOOL SetBackColorBottom(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long  
int IBackColorBottom);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IBackColorBottom**

Numeric value defining the background color of slider objects

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetBackColorTop

### Function

Sets the background color of the slider objects at the top left.

### Syntax

```
BOOL SetBackColorTop(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IBackColorTop);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **IBackColorTop**

Numeric value defining the background color of slider objects

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetBorderBackColor

### Function

Sets the background color of the lines or borders.

### Syntax

```
BOOL SetBorderBackColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int  
IBorderBackColor);
```

### Parameters

#### **IpszPictureName**

Picture name

#### **IpszObjectName**

Object name

#### **IBorderBackColor**

Background color of the lines or borders

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetBorderColor

### Function

Sets the color of the lines or borders.

### Syntax

```
BOOL SetBorderColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lBorderColor);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lBorderColor**

Numeric value defining the color of lines or borders

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetBorderColorBottom

### Function

Sets the 3D border color at the bottom.

### Syntax

```
BOOL SetBorderColorBottom(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int lBorderColorBottom);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IBorderColorBottom**

Numeric value defining the 3-D border color at the bottom

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetBorderColorTop

## Function

Sets the 3D border color at the top.

## Syntax

```
BOOL SetBorderColorTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IBorderColorTop);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IBorderColorTop**

Numeric value defining the 3-D border color at the top

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetButtonColor

### Function

Sets the button color of slider objects.

### Syntax

```
BOOL SetButtonColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IButtonColor);
```

### Parameters

#### **IpszPictureName**

Picture name

#### **IpszObjectName**

Object name

#### **IButtonColor**

Numeric value defining the button color of slider objects

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.



## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorBottom

### Function

When using slider objects, it sets the color of the bottom limit.

### Syntax

```
BOOL SetColorBottom(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IColorBottom);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

#### IColorBottom

Numeric value defining the color of the bottom limit of slider objects

### Return value

#### TRUE

The function has been completed without any errors.

#### FALSE

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorTop

### Function

When using slider objects, it sets the color of the top limit.

### Syntax

```
BOOL SetColorTop(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int IColorTop);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IColorTop**

Numeric value defining the color of the top limit of slider objects

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetFillColor

### Function

Sets the color of the fill pattern.

### Syntax

```
BOOL SetFillColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int IFillColor);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IFillColor**

Numeric value of the fill color

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

If the function is called in relation to the entire picture, set the parameter IpszObjectName = NULL.

---

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetForeColor

## Function

Sets the font color.

## Syntax

```
BOOL SetForeColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IForeColor);
```

## Parameters

### **IpszPictureName**

Picture name

**lpzObjectName**

Object name

**IForeColor**

Numeric value defining the font color

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

Color chart (Page 1592)

SetBackColor example (Page 1559)

**SetItemBorderBackColor**

**Function**

Sets the background color of the separating line for the "text list" object.

**Syntax**

```
BOOL SetItemBorderBackColor(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName,  
long int lItemBorderBackColor);
```

**Parameters**

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**lItemBorderBackColor**

Background color of the dividing line as a numeric value

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetItemBorderColor

### Function

Sets the color of the dividing line for the "text list" object.

### Syntax

```
BOOL SetItemBorderColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
ItemBorderColor);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **ItemBorderColor**

Numeric value defining the dividing line color

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetScaleColor

### Function

Sets the scale color for bar objects.

### Syntax

```
BOOL SetScaleColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IScaleColor);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **IScaleColor**

Numeric value of the scale color for bar objects

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetSelBGColor

### Function

Sets the background color of the selected entry for the "text list" object.

### Syntax

```
BOOL SetSelBGColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lSelBGColor);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lSelBGColor**

Numeric value defining the background color in the selected entry

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetSelTextColor

### Function

Sets the font color of a selected entry for the "text list" object.

### Syntax

```
BOOL SetSelTextColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lSelTextColor);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**ISelTextColor**

Numeric value defining the font color in the selected entry

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetTrendColor

### Function

Sets the trend color for bar objects.

### Syntax

```
BOOL SetTrendColor(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, long int ITrendColor);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**ITrendColor**

Numeric value defining the trend color



## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetUnselBGColor

### Function

Sets the background color of non-selected entries for the "text list" object.

### Syntax

```
BOOL SetUnselBGColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IUnselBGColor);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **IUnselBGColor**

Numeric value defining the background color for non-selected entries

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetUnselTextColor

### Function

Sets the font color of non-selected entries for the "text list" object.

### Syntax

```
BOOL SetUnselTextColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IUnselTextColor);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **IUnselTextColor**

Numeric value defining the font color for non-selected entries

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## fill

### Fill - short description

The functions in the Fill group control the dynamic filling of objects.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### SetFilling

#### Function

Activates or deactivates dynamic filling with background color.

#### Syntax

```
BOOL SetFilling(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bFilling);
```

#### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bFilling**

Dynamic filling with background color on/off

#### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

#### See also

SetFilling example (Page 1561)

## SetFillingIndex

### Function

Sets the fill level.

### Syntax

```
BOOL SetFillingIndex(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IFillingIndex);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IFillingIndex**

Fill level as a numeric value (0 - 100)

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetFillingIndex example (Page 1561)

## flash

### Flash - short description

The various flashing properties can be modified or called in using the functions in the Flash group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### SetBackFlashColorOff

#### Function

Sets the background flash color for the deactivated status.

#### Syntax

```
BOOL SetBackFlashColorOff(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int lBackFlashColorOff);
```

#### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lBackFlashColorOff**

Background flash color for the deactivated status as a numeric value

#### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetFlashBackColorOn example (Page 1562)

## SetBackFlashColorOn

### Function

Sets the background flash color for the activated status.

### Syntax

```
BOOL SetBackFlashColorOn(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int lBackColorOn);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **lBackColorOn**

Background flash color for the activated status as a numeric value

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetFlashBackColorOn example (Page 1562)

## SetBorderFlashColorOff

### Function

Sets the border or line flashing color for the deactivated status.

### Syntax

```
BOOL SetBorderFlashColorOff(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
long int IBorderFlashColorOff);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

#### IBorderFlashColorOff

Border or line flashing color for the deactivated status as a numeric value

### Return value

#### TRUE

The function has been completed without any errors.

#### FALSE

An error has occurred.

### See also

SetFlashBackColorOn example (Page 1562)

Color chart (Page 1592)

## SetBorderFlashColorOn

### Function

Sets the border or line flashing color for the activated status.

### Syntax

```
BOOL SetBorderFlashColorOn(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
long int IBorderFlashColorOn);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**lBorderFlashColorOn**

Border or line flashing color for the activated status as a numeric value

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetFlashBackColorOn example (Page 1562)

## SetFlashBackColor

### Function

Activates or deactivates background flashing.

### Syntax

```
BOOL SetFlashBackColor(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, BOOL  
bFlashBackColor);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**bFlashBackColor**

Flashing background on/off



## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetFlashBackColor example (Page 1562)

## SetFlashBorderColor

### Function

Activates or deactivates flashing of the border or line.

### Syntax

```
BOOL SetFlashBorderColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bFlashBorderColor);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **bFlashBorderColor**

Flashing of the border or line on/off

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetFlashBackColor example (Page 1562)

## SetFlashForeColor

### Function

Activates or deactivates font flashing.

### Syntax

```
BOOL SetFlashForeColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bFlashForeColor);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bFlashForeColor**

Flashing of the font on/off

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetFlashBackColor example (Page 1562)

## SetFlashRateBackColor

### Function

Sets the flash frequency of the background.

### Syntax

```
BOOL SetFlashRateBackColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
long int IFlashRateBackColor);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IFlashRateBackColor**

Flash frequency of the background

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

Flash frequencies (Page 1590)

SetFlashBackColor example (Page 1562)

## SetFlashRateBorderColor

### Function

Sets the flash frequency of the line or border.

### Syntax

```
BOOL SetFlashRateBorderColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
long int IFlashRateBorderColor);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IFlashRateBorderColor**

Flash frequency of the line or border

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Flash frequencies (Page 1590)

SetFlashBackColor example (Page 1562)

## SetFlashRateForeColor

## Function

Sets the flash frequency of the font.

## Syntax

```
BOOL SetFlashRateForeColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
long int IFlashRateForeColor);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **IFlashRateForeColor**

Flash frequency of the font

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Flash frequencies (Page 1590)

SetFlashBackColor example (Page 1562)

## SetForeFlashColorOff

### Function

Sets the font flash color for the deactivated status.

### Syntax

```
BOOL SetForeFlashColorOff(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int IForeFlashColorOff);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **IForeFlashColorOff**

Font flash color for the deactivated status as a numeric value

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetFlashBackColorOn example (Page 1562)

## SetForeFlashColorOn

### Function

Sets the font flash color for the activated status.

### Syntax

```
BOOL SetForeFlashColorOn(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long  
int IForeFlashColorOn);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IForeFlashColorOn**

Font flash color for the activated status as a numeric value

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Color chart (Page 1592)

SetFlashBackColorOn example (Page 1562)

## focus

### Focus - short description

Using the functions in the Focus group, it is possible to set the focus or poll which object has the focus.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## Set\_Focus

### Function

Sets the focus on the specified object.

### Syntax

```
BOOL Set_Focus(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

### Return value

#### TRUE

The function has been completed without any errors.

#### FALSE

An error has occurred.

### See also

SetFocus example (Page 1563)

## font

### Font - short description

The various properties affecting text can be modified or called in using the functions in the Font group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetAlignmentLeft

### Function

Sets the horizontal text alignment (left, centered, right).

### Syntax

```
BOOL SetAlignmentLeft(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IAAlignmentLeft);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IAAlignmentLeft**

Horizontal text alignment as a numeric value

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.



## See also

Text alignment (Page 1597)

SetFontSize example (Page 1564)

## SetAlignmentTop

### Function

Sets the vertical text alignment (top, centered, bottom).

### Syntax

```
BOOL SetAlignmentTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IAlignmentTop);
```

### Parameters

#### IpszPictureName

Picture name

#### IpszObjectName

Object name

#### IAlignmentTop

Vertical text alignment as a numeric value

### Return value

#### TRUE

The function has been completed without any errors.

#### FALSE

An error has occurred.

## See also

Text alignment (Page 1597)

SetFontSize example (Page 1564)

## SetFontBold

### Function

Switches the bold font on or off.

### Syntax

```
BOOL SetFontBold(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bFontBold);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bFontBold**

Bold font on/off

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetFontBold example (Page 1563)

## SetFontItalic

### Function

Switches the italic font on or off.

### Syntax

```
BOOL SetFontItalic(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bFontItalic);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bFontItalic**

Italic font on/off

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetFontBold example (Page 1563)

## SetFontName

### Function

Sets a font.

### Syntax

```
BOOL SetFontName(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, char* szFontName);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**szFontName**

Pointer to name of font

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetText example (Page 1578)

### SetFontSize

### Function

Sets the font size.

### Syntax

```
BOOL SetFontSize(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IFontSize);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IFontSize**

Font Size

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetFontSize example (Page 1564)

## SetFontUnderline

### Function

Switches the underlined font on or off.

### Syntax

```
BOOL SetFontUnderline(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bFontUnderline);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bFontUnderline**

Underlined font on/off

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetFontBold example (Page 1563)

## SetOrientation

### Function

Defines the text orientation (vertical/horizontal).

### Syntax

```
BOOL SetOrientation(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bOrientation);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

### **bOrientation**

Text orientation

TRUE vertical

FALSE Horizontal

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetFontBold example (Page 1563)

## SetText

## Function

Sets the value of the "text" property for objects like static text, check box or radio box.

## Syntax

```
BOOL SetText(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, char* szText);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

**szText**

Pointer to a text

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

In case of check and radio boxes the element to be changed must be defined with the SetIndex function before actually activating this function.

---

**See also**

SetText example (Page 1578)

**geometry**

**Geometry - short description**

The size, position and other geometrical properties of objects can be modified or called in using the functions in the Geometry group.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

**SetActualPointLeft**

**Function**

Sets the X value for the current point of a polygon or polygon line.

**Syntax**

```
BOOL SetActualPointLeft(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int lActualPointLeft);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**IActualPointLeft**

X value for the current point of a polygon or polygon line

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The current point of the polygon can be set using the SetIndex function.

---

## See also

SetLeft example (Page 1565)

## SetActualPointTop

### Function

Sets the Y value for the current point of a polygon or polygon line.

### Syntax

```
BOOL SetActualPointTop(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, long int IActualPointTop);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name



**IActualPointTop**

Y value for the current point of a polygon or polygon line

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

The current point of the polygon can be set using the SetIndex function.

---

**See also**

SetTop example (Page 1578)

**SetBoxCount**

**Function**

Sets the number of fields in a check box or radio box.

**Syntax**

```
BOOL SetBoxCount(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IBoxCount);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IBoxCount**

Number of fields in a check box or radio box.

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## SetDirection

## Function

Sets the bar direction for bar objects.

## Syntax

```
BOOL SetDirection(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IDirection);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **IDirection**

Numeric value defining the bar direction

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Bar direction (Page 1590)

SetTop example (Page 1578)

## SetEndAngle

### Function

Sets the end angle of circle and ellipse segments and circle and elliptical arcs.

### Syntax

```
BOOL SetEndAngle(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IEndAngle);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IEndAngle**

End angle of circle and ellipse segments as well as circle and ellipse arcs

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetTop example (Page 1578)

## SetHeight

### Function

Sets the height of the rectangle framing an object.

### Syntax

```
BOOL SetHeight(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IHeight);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**lHeight**

Height of the framing rectangle

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the function is called in relation to the entire picture, set the parameter lpzObjectName = NULL.

---

## See also

SetHeight example (Page 1564)

## SetLeft

## Function

Sets the X value of the upper left corner of the rectangle framing an object

## Syntax

```
BOOL SetLeft(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, long int lLeft);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**lLeft**

X value of the upper left corner of the framing rectangle

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetLeft example (Page 1565)

**SetPointCount**

**Function**

Sets the number of corners of a polygon or in a polygon line.

**Syntax**

```
BOOL SetPointCount(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IPointCount);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IPointCount**

Number of corner points

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetLeft example (Page 1565)

**SetRadius**

**Function**

Sets the radius of a circle, circle segment or arc.

**Syntax**

```
BOOL SetRadius(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int IRadius);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IRadius**

Radius

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetHeight example (Page 1564)

**SetRadiusHeight**

**Function**

Sets the radius of an ellipse, ellipse segment or elliptical arc in vertical direction.

## Syntax

```
BOOL SetRadiusHeight(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IRadiusHeight);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IRadiusHeight**

Radius in vertical direction

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetHeight example (Page 1564)

## SetRadiusWidth

## Function

Sets the radius of an ellipse, ellipse segment or elliptical arc in horizontal direction.

## Syntax

```
BOOL SetRadiusWidth(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IRadiusWidth);
```

## Parameters

### **IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IRadiusWidth**

Radius in horizontal direction

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetWidth example (Page 1579)

**SetReferenceRotationLeft**

**Function**

Sets the X value of the rotation reference (central axis about which the object can be rotated) for lines, polygons and polylines.

**Syntax**

```
BOOL SetReferenceRotationLeft(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
long int IReferenceRotationLeft);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IReferenceRotationLeft**

X value of the rotation reference



## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetLeft example (Page 1565)

## SetReferenceRotationTop

### Function

Sets the Y value of the rotation reference (central axis about which the object can be rotated) for lines, polygons and polylines.

### Syntax

```
BOOL SetReferenceRotationTop(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
long int IReferenceRotationTop);
```

### Parameters

#### **IpszPictureName**

Picture name

#### **IpszObjectName**

Object name

#### **IReferenceRotationTop**

Y value of the rotation reference

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetTop example (Page 1578)

## SetRotationAngle

### Function

Sets the angle of rotation about the central axis for lines, polygons and polylines.

### Syntax

```
BOOL SetRotationAngle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IRotationAngle);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IRotationAngle**

Angle of rotation

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetLeft example (Page 1565)

## SetRoundCornerHeight

### Function

Specifies the radius of the rounded corner of a rectangle vertically.

## Syntax

```
BOOL SetRoundCornerHeight(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int IRoundCornerHeight);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **IRoundCornerHeight**

Vertical radius

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetHeight example (Page 1564)

## SetRoundCornerWidth

## Function

Specifies the radius of the rounded corner of a rectangle horizontally.

## Syntax

```
BOOL SetRoundCornerWidth(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int IRoundCornerWidth);
```

## Parameters

### **lpszPictureName**

Picture name

**IpszObjectName**

Object name

**IRoundCornerWidth**

Horizontal radius

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetWidth example (Page 1579)

**SetStartAngle**

**Function**

Sets the start angle of circle and ellipse segments and circle and elliptical arcs.

**Syntax**

```
BOOL SetStartAngle(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IStartAngle);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IStartAngle**

Starting angle

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetHeight example (Page 1564)

**SetTop**

**Function**

Sets the Y value of the upper left corner of the rectangle framing an object.

**Syntax**

```
BOOL SetTop(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int ITop);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**ITop**

Y value of the upper left corner of the framing rectangle

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetTop example (Page 1578)

## SetWidth

### Function

Sets the width of the rectangle framing an object.

### Syntax

```
BOOL SetWidth(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int IWidth);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IWidth**

Width of the framing rectangle

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

### See also

SetWidth example (Page 1579)

## SetZeroPoint

### Function

Sets the zero point for bar objects.

## Syntax

```
BOOL SetZeroPoint(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int  
IZeroPoint);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IZeroPoint**

Zero point

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetTop example (Page 1578)

## i\_o

### **i\_o - short description**

The various properties affecting input and output values can be modified or called in using the functions in the i\_o group.

---

### **Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetAssumeOnExit

### Function

Specifies for I/O fields whether the entered value is assumed upon exiting the field.

### Syntax

```
BOOL SetAssumeOnExit(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bAssumeOnExit);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bAssumeOnExit**

Value application upon exiting the field yes/no

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetHiddenInput example (Page 1564)

## SetAssumeOnFull

### Function

Specifies for I/O fields whether the entered value is assumed on completion of input.

### Syntax

```
BOOL SetAssumeOnFull(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bAssumeOnFull);
```



## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **bAssumeOnFull**

Value application on completion of input yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetHiddenInput example (Page 1564)

## SetBitNumber

## Function

Sets the relevant bit in the output value for the "bit" list type.

## Syntax

```
BOOL SetBitNumber(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IBitNumber);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IBitNumber**

Relevant bit in the output value for the "bit" list type

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

List types (Page 1596)

## SetClearOnError

## Function

Specifies for I/O fields whether deletion of the content in case of input errors is activated.

## Syntax

```
BOOL SetClearOnError(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bClearOnError);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **bClearOnError**

Deletion of the entry in case of input errors yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetHiddenInput example (Page 1564)

## SetClearOnNew

### Function

Specifies the deletion of the content in case of new inputs for I/O fields.

### Syntax

```
BOOL SetClearOnNew(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bClearOnNew);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bClearOnNew**

Deletion of content in case of new input yes/no

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetHiddenInput example (Page 1564)

## SetHiddenInput

### Function

Controls the hidden input for I/O fields.

### Syntax

```
BOOL SetHiddenInput(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bHiddenInput);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**bHiddenInput**

Hidden input yes/no

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetHiddenInput example (Page 1564)

## SetNumberLines

### Function

Sets the number of visible lines lines for the "text list" object.

### Syntax

```
BOOL SetNumberLines(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, long int  
INumberLines);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**INumberLines**

Number of visible lines

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

---

### Note

If the amount of configured text is larger than the number of visible lines, the "text list" object receives a vertical scroll bar.

---

## SetOutputValueChar

### Function

Sets a pointer to the output value for I/O fields

### Syntax

```
BOOL SetOutputValueChar(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, char* szOutputValueChar);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **szOutputValueChar**

Pointer to the output value

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

## SetOutputValueDouble

### Function

Sets the output value for I/O fields.

### Syntax

```
BOOL SetOutputValueDouble(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
double dOutputValueDouble);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**dOutputValueDouble**

Output value

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetOutputValueDouble example (Page 1566)

## Limits

### Limits - short description

The various properties affecting limit values can be modified or called in using the functions in the Limits group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetAlarmHigh

### Function

Sets the upper alarm limit for bar objects.

### Syntax

```
BOOL SetAlarmHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double dAlarmHigh);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**dAlarmHigh**

Upper alarm limit

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetAlarmLow

### Function

Sets the lower alarm limit for bar objects.

### Syntax

```
BOOL SetAlarmLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double  
dAlarmLow);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**dAlarmLow**

Lower alarm limit

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetCheckAlarmHigh

### Function

Controls the monitoring of the upper alarm limit for bar objects.



## Syntax

```
BOOL SetCheckAlarmHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bCheckAlarmHigh);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **bCheckAlarmHigh**

Monitoring yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetCheckAlarmLow

## Function

Controls the monitoring of the lower alarm limit for bar objects.

## Syntax

```
BOOL SetCheckAlarmLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bCheckAlarmLow);
```

## Parameters

### **IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bCheckAlarmLow**

Monitoring yes/no

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetMarker example (Page 1566)

**SetCheckLimitHigh4**

**Function**

Controls the monitoring of the upper limit value reserve 4 for bar objects.

**Syntax**

```
BOOL SetCheckLimitHigh4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bCheckLimitHigh4);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bCheckLimitHigh4**

Monitoring yes/no

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetMarker example (Page 1566)

**SetCheckLimitHigh5**

**Function**

Controls the monitoring of the upper limit value reserve 5 for bar objects.

**Syntax**

```
BOOL SetCheckLimitHigh5(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bCheckLimitHigh5);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bCheckLimitHigh5**

Monitoring yes/no

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetMarker example (Page 1566)

## SetCheckLimitLow4

### Function

Controls the monitoring of the lower limit value reserve 4 for bar objects.

### Syntax

```
BOOL SetCheckLimitLow4(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bCheckLimitLow4);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bCheckLimitLow4**

Monitoring yes/no.

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetMarker example (Page 1566)

## SetCheckLimitLow5

### Function

Controls the monitoring of the lower limit value reserve 5 for bar objects.

### Syntax

```
BOOL SetCheckLimitLow5(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bCheckLimitLow5);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bCheckLimitLow5**

Monitoring yes/no

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetCheckToleranceHigh

### Function

Controls the monitoring of the upper tolerance limit for bar objects.

### Syntax

```
BOOL SetCheckToleranceHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
BOOL bCheckToleranceHigh);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bCheckToleranceHigh**

Monitoring yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetCheckToleranceLow

## Function

Controls the monitoring of the lower tolerance limit for bar objects.

## Syntax

```
BOOL SetCheckToleranceLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
BOOL bCheckToleranceLow);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **bCheckToleranceLow**

Monitoring yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetCheckWarningHigh

### Function

Controls the monitoring of the upper warning limit for bar objects.

### Syntax

```
BOOL SetCheckWarningHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
BOOL bCheckWarningHigh);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bCheckWarningHigh**

Monitoring yes/no

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetMarker example (Page 1566)

## SetCheckWarningLow

### Function

Controls the monitoring of the lower warning limit for bar objects.

### Syntax

```
BOOL SetCheckWarningLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
BOOL bCheckWarningLow);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bCheckWarningLow**

Monitoring yes/no

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetColorAlarmHigh

### Function

Sets the bar color for bar objects upon reaching the upper alarm limit.

### Syntax

```
BOOL SetColorAlarmHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IColorAlarmHigh);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IColorAlarmHigh**

Numeric value defining the bar color



## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorAlarmLow

### Function

Sets the bar color for bar objects upon reaching the lower alarm limit.

### Syntax

```
BOOL SetColorAlarmLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IColorAlarmLow);
```

### Parameters

#### **IpszPictureName**

Picture name

#### **IpszObjectName**

Object name

#### **IColorAlarmLow**

Numeric value defining the bar color

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorLimitHigh4

### Function

Sets the bar color for bar objects upon reaching the upper limit reserve 4.

### Syntax

```
BOOL SetColorLimitHigh4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IColorLimitHigh4);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IColorLimitHigh4**

Numeric value defining the bar color

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorLimitHigh5

### Function

Sets the bar color for bar objects upon reaching the upper limit reserve 5.

### Syntax

```
BOOL SetColorLimitHigh5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IColorLimitHigh5);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IColorLimitHigh5**

Numeric value defining the bar color

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorLimitLow4

### Function

Sets the bar color for bar objects upon reaching the lower limit reserve 4.

### Syntax

```
BOOL SetColorLimitLow4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IColorLimitLow4);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IColorLimitLow4**

Numeric value defining the bar color

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorLimitLow5

## Function

Sets the bar color for bar objects upon reaching the lower limit reserve 5.

## Syntax

```
BOOL SetColorLimitLow5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IColorLimitLow5);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IColorLimitLow5**

Numeric value defining the bar color

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorToleranceHigh

### Function

Sets the bar color for bar objects upon reaching the upper tolerance limit.

### Syntax

```
BOOL SetColorToleranceHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int IColorToleranceHigh);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **IColorToleranceHigh**

Numeric value defining the bar color

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorToleranceLow

### Function

Sets the bar color for bar objects upon reaching the lower tolerance limit.

### Syntax

```
BOOL SetColorToleranceLow(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long  
int IColorToleranceLow);
```

### Parameters

#### **IpszPictureName**

Picture name

#### **IpszObjectName**

Object name

#### **IColorToleranceLow**

Numeric value defining the bar color

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorWarningHigh

### Function

Sets the bar color for bar objects upon reaching the upper warning limit.

### Syntax

```
BOOL SetColorWarningHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int IColorWarningHigh);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IColorWarningHigh**

Numeric value defining the bar color

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetColorWarningLow

### Function

Sets the bar color for bar objects upon reaching the lower warning limit.

### Syntax

```
BOOL SetColorWarningLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int IColorWarningLow);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**IColorWarningLow**

Numeric value defining the bar color

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetLimitHigh4

### Function

Sets the high limit value for reserve 4 for bar objects.

### Syntax

```
BOOL SetLimitHigh4(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, double dLimitHigh4);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**dLimitHigh4**

High limit value for reserve 4



## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetLimitHigh5

## Function

Sets the high limit value for reserve 5 for bar objects.

## Syntax

```
BOOL SetLimitHigh5(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double dLimitHigh5);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **dLimitHigh5**

High limit value for reserve 5

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetLimitLow4

### Function

Sets the low limit value for reserve 4 for bar objects.

### Syntax

```
BOOL SetLimitLow4(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, double  
dLimitLow4);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**dLimitLow4**

Low limit value for reserve 4

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetAlarmHigh example (Page 1559)

## SetLimitLow5

### Function

Sets the low limit value for reserve 5 for bar objects.

### Syntax

```
BOOL SetLimitLow5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, double  
dLimitLow5);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**dLimitLow5**

Low limit value for reserve 5

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetLimitMax

## Function

Sets the high limit value for I/O fields.

## Syntax

```
BOOL SetLimitMax(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, double  
dLimitMax);
```

## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**dLimitMax**

High limit value

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetLimitMin

## Function

Sets the low limit value for I/O fields.

## Syntax

```
BOOL SetLimitMin(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double dLimitMin);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **dLimitMin**

Lower limit

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetMarker

### Function

Controls the limit marker display for bar objects.

### Syntax

```
BOOL SetMarker(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL bMarker);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bMarker**

Limit marker on/off

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetMarker example (Page 1566)

## SetToleranceHigh

### Function

Sets the upper tolerance limit for bar objects.

### Syntax

```
BOOL SetToleranceHigh(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, double dToleranceHigh);
```

## Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**dToleranceHigh**

Upper tolerance limit

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetToleranceLow

### Function

Sets the lower tolerance limit for bar objects.

### Syntax

```
BOOL SetToleranceLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double dToleranceLow);
```

## Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**dToleranceLow**

Lower tolerance limit

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetAlarmHigh example (Page 1559)

## SetTypeAlarmHigh

### Function

Specifies for bar objects whether the upper alarm limit is given in percentages or absolute terms.

### Syntax

```
BOOL SetTypeAlarmHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bTypeAlarmHigh);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **bTypeAlarmHigh**

Upper alarm limit

TRUE Specification in percent

FALSE Absolute specification

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetTypeAlarmLow

### Function

Specifies for bar objects whether the lower alarm limit is given in percentages or absolute terms.

### Syntax

```
BOOL SetTypeAlarmLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bTypeAlarmLow);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **bTypeAlarmLow**

Lower alarm limit

TRUE Specification in percent

FALSE Absolute specification

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)



## SetTypeLimitHigh4

### Function

Specifies for bar objects whether the upper limit for reserve 4 is given in percentages or absolute terms.

### Syntax

```
BOOL SetTypeLimitHigh4(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bTypeLimitHigh4);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **bTypeLimitHigh4**

High limit

TRUE Specification in percent

FALSE Absolute specification

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

### See also

SetMarker example (Page 1566)

## SetTypeLimitHigh5

### Function

Specifies for bar objects whether the upper limit for reserve 5 is given in percentages or absolute terms.

### Syntax

```
BOOL SetTypeLimitHigh5(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bTypeLimitHigh5);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bTypeLimitHigh5**

High limit

TRUE Specification in percent

FALSE Absolute specification

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetMarker example (Page 1566)

### SetTypeLimitLow4

### Function

Specifies for bar objects whether the lower limit for reserve 4 is given in percentages or absolute terms.

### Syntax

```
BOOL SetTypeLimitLow4(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bTypeLimitLow4);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **bTypeLimitLow4**

Low limit

TRUE Specification in percent

FALSE Absolute specification

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetTypeLimitLow5

## Function

Specifies for bar objects whether the lower limit for reserve 5 is given in percentages or absolute terms.

## Syntax

```
BOOL SetTypeLimitLow5(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bTypeLimitLow5);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

**bTypeLimitLow5**

Low limit

TRUE Specification in percent  
FALSE Absolute specification

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetMarker example (Page 1566)

**SetTypeToleranceHigh**

**Function**

Specifies for bar objects whether the high tolerance limit is given in percentages or absolute terms.

**Syntax**

BOOL SetTypeToleranceHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bTypeToleranceHigh);

**Parameter**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bTypeToleranceHigh**

High tolerance limit

TRUE Specification in percent  
FALSE Absolute specification

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetTypeToleranceLow

### Function

Specifies for bar objects whether the lower tolerance limit is given in percentages or absolute terms.

### Syntax

```
BOOL SetTypeToleranceLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
BOOL bTypeToleranceLow);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **bTypeToleranceLow**

Lower tolerance limit

TRUE Specification in percent

FALSE Absolute specification

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetTypeWarningHigh

### Function

Specifies for bar objects whether the upper warning limit is given in percentages or absolute terms.

### Syntax

```
BOOL SetTypeWarningHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bTypeWarningHigh);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **bTypeWarningHigh**

Upper warning limit

TRUE Specification in percent

FALSE Absolute specification

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

SetMarker example (Page 1566)

## SetTypeWarningLow

### Function

Specifies for bar objects whether the lower warning limit is given in percentages or absolute terms.

### Syntax

```
BOOL SetTypeWarningLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bTypeWarningLow);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bTypeWarningLow**

Lower warning limit

TRUE Specification in percent

FALSE Absolute specification

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetMarker example (Page 1566)

## SetWarningHigh

### Function

Sets the upper warning limit for bar objects.

### Syntax

```
BOOL SetWarningHigh(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double  
dWarningHigh);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**dWarningHigh**

Upper warning limit

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetMarker example (Page 1566)

### SetWarningLow

### Function

Sets the lower warning limit for bar objects.

### Syntax

```
BOOL SetWarningLow(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double  
dWarningLow);
```

### Parameters

**lpszPictureName**

Picture name



**IpszObjectName**

Object name

**dWarningLow**

Lower warning limit

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetMarker example (Page 1566)

**link**

**Link - short description**

A tag link property can be created or called in using the functions in the Link group.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

**SetLink**

**Function**

Creating a tag connection of object properties

**Syntax**

```
BOOL SetLink(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR  
IpszPropertyName, LPLINKINFO *pLink);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

### **lpzPropertyName**

Name of the object property

### **pLink**

Pointer to a structure of the type: LINKINFO

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Structure definition LINKINFO (Page 1605)

SetLink example (Page 1565)

## miscs

### **Miscs - short description**

The properties of objects can be modified or called in using the functions in the Miscs group.

---

#### **Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetAverage

### **Function**

Controls the averaging of bar objects.

## Syntax

```
BOOL SetAverage(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bAverage);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **bAverage**

Averaging yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetVisible example (Page 1578)

## SetBoxType

## Function

Specifies the field type (input field, output field, input/output field) for an I/O object.

## Syntax

```
BOOL SetBoxType(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int  
IBoxType);
```

## Parameters

### **IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IBoxType**

Field type

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

I/O field, field type (Page 1592)

**SetColorChangeType**

**Function**

When using bar objects, it defines whether the color change upon reaching a limit value only affects a bar segment or the entire bar.

**Syntax**

```
BOOL SetColorChangeType(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
BOOL bColorChangeType);
```

**Parameter**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bColorChangeType**

Type of color change

TRUE Color change applies to a segment

FALSE Color change applies to the entire bar

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetVisible example (Page 1578)

## SetCursorControl

## Function

Sets the cursor control for I/O fields.

## Syntax

```
BOOL SetCursorControl(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bCursorControl);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **bCursorControl**

Cursor control on/off

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetVisible example (Page 1578)

## SetCursorMode

### Function

Sets the cursor control for pictures.

### Syntax

```
BOOL SetCursorMode(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bCursorMode);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **bCursorMode**

Cursor Mode

TRUE Tab order cursor

FALSE Alpha-Cursor

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Example - SetCursorMode (Page 1561)

## SetEditAtOnce

### Function

Specifies whether the "Immediate input" property is activated for I/O fields.

### Syntax

```
BOOL SetEditAtOnce(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bEditAtOnce);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bEditAtOnce**

Immediate input yes/no

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetVisible example (Page 1578)

## SetExtendedOperation

### Function

Controls the "Extended operation" property of slider objects.

### Syntax

```
BOOL SetExtendedOperation(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
BOOL bExtendedOperation);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**bExtendedOperation**

Extended operation yes/no

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetVisible example (Page 1578)

## SetHysteresis

### Function

When using bar objects, it specifies whether the display appears with or without hysteresis.

### Syntax

```
BOOL SetHysteresis(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, BOOL  
bHysteresis);
```

## Parameters

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**bHysteresis**

Display with/without hysteresis



## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetVisible example (Page 1578)

## SetHysteresisRange

### Function

Sets the hysteresis value in the display for bar objects.

### Syntax

```
BOOL SetHysteresisRange(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double dHysteresisRange);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **dHysteresisRange**

Hysteresis value

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## SetMax

### Function

Sets the maximum value for bar and slider objects.

### Syntax

```
BOOL SetMax(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double dMax);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**dMax**

Maximum value

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetMin

### Function

Sets the minimum value for bar and slider objects.

### Syntax

```
BOOL SetMin(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double dMin);
```

### Parameters

**lpszPictureName**

Picture name

**IpszObjectName**

Object name

**dMin**

Minimum value

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**SetOffsetLeft**

**Function**

Sets the horizontal picture distance from the left window border for picture windows.

**Syntax**

```
BOOL SetOffsetLeft(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IOffsetLeft);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IOffsetLeft**

Picture distance

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetOffsetTop

### Function

Sets the vertical picture distance from the upper window border for picture windows.

### Syntax

```
BOOL SetOffsetTop(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int IOffsetTop);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IOffsetTop**

Picture distance

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetOperation

### Function

Controls the operability of the objects.

### Syntax

```
BOOL SetOperation(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bOperation);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **bOperation**

Object operable, yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

If the function is called for the picture object, set the parameter IpszObjectName = NULL.

---

## See also

SetVisible example (Page 1578)

## SetOperationMessage

### Function

Controls the output of a message when operating the objects "I/O field", "Check box", "Radio box" and "Slider".

### Syntax

```
BOOL SetOperationMessage(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
BOOL bOperationMessage);
```

## Parameters

### **IpszPictureName**

Picture name

**lpzObjectName**

Object name

**bOperationMessage**

Message output for yes/no operation

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetVisible example (Page 1578)

**SetOperationReport**

**Function**

Controls the logging of the operating reason for all objects except application and picture windows and OLE control.

**Syntax**

```
BOOL SetOperationReport(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, BOOL  
bOperationReport);
```

**Parameters**

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**bOperationReport**

Logging operating reason yes/no

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

---

### Note

If the function is called for the picture object, set the parameter `lpszObjectName = NULL`.

---

## See also

SetVisible example (Page 1578)

## SetPasswordLevel

### Function

Defines the authorization level for operating objects for all objects except application and picture windows and OLE control.

### Syntax

```
BOOL SetPasswordLevel(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IPasswordLevel);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **IPasswordLevel**

Authorization level

## Return value

### TRUE

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

## SetPictureName

### Function

Sets the name of the picture, which should be shown in a picture window or in a graphic object.

### Syntax

```
BOOL SetPictureName(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, char* szPictureName);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Name of the picture window or graphic object

**szPictureName**

Pointer to the picture name

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

SetPictureName example (Page 1567)



## SetProcess

### Function

Specifies the default setting of the value to be displayed for bar and slider objects.  
Sets the selected fields for check boxes and radio boxes.

### Syntax

```
BOOL SetProcess(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, double  
dProcess);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**dProcess**

- In case of bar and slider objects, this value is used in Runtime when the associated tag cannot be connected or updated when a picture is started.
- For check boxes and radio boxes the selected fields are specified. In the 32-bit word each field is represented by a bit (field 1 corresponds to the bit value 0). Selected fields are marked by a set bit. Non-existing are assigned 0.

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetSmallChange

### Function

Sets the number of steps for slider objects by which the slider is shifted by a mouse click.

### Syntax

```
BOOL SetSmallChange(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int  
ISmallChange);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

### **ISmallChange**

Number of setting steps

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## SetTagPrefix

## Function

This function sets the tag prefix of a picture window:

In a picture window the "temperature" tag is requested on an object. If a "Motor1." tag prefix is assigned to the picture window, the tag "Motor1.Temperature" is requested.

The setting of the tag prefix only becomes effective when newly supplying the picture name.

This means you must either set the prefix before picture selection or newly supply the picture name if the picture is not changed.

## Syntax

```
BOOL SetTagPrefix(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, char* szTagPrefix);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

**szTagPrefix**

Tag prefix to be set

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the tag prefix is set for a picture window, the tag prefix is added to all tags contained in the picture to be displayed. This also applies if the request takes place in a function. If a tag needs to be read without the tag prefix, you must add "@NOTP::" to the tag name.

Using a tag prefix greatly simplifies the picture module technology.

---

**See also**

SetTagPrefix example (Page 1574)

**SetTrend**

**Function**

Controls the trend display for bar objects.

**Syntax**

```
BOOL SetTrend(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bTrend);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bTrend**

Trend display yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetVisible example (Page 1578)

## SetVisible

## Function

Controls the display of an object.

## Syntax

```
BOOL SetVisible(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bVisible);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **bVisible**

Object display yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

---

### **Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = NULL`.

---

## See also

SetVisible example (Page 1578)

## SetZeroPointValue

### Function

Sets the absolute value of the zero point for bar objects.

### Syntax

```
BOOL SetZeroPointValue(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, double dZeroPointValue);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**dZeroPointValue**

Absolute value of the zero point

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetZoom

### Function

Sets the scaling factor for a picture window.

### Syntax

```
BOOL SetZoom(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int lZoom);
```

## Parameters

### **lpzPictureName**

Picture name

### **lpzObjectName**

Object name

### **IZoom**

Scaling factor

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## ole\_control

### **OLE\_control - short description**

The functions in the ole\_Control group can only be used with OCX slider objects.

Various OCX slider object properties and settings can be modified or called in using these functions.

---

### **Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetPosition

### **Function**

Sets the slider position of the OCX slider object.

### **Syntax**

```
BOOL SetPosition(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, long int  
IPosition);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IPosition**

Slider position of the OCX slider object

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetPosition example (Page 1568)

## SetRangeMax

## Function

Defines the adjustment range "Max" of the OCX slider object.

## Syntax

```
BOOL SetRangeMax(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IRangeMax);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IRangeMax**

Adjustment range "Max" of the OCX slider object

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetRangeMax example (Page 1569)

## SetRangeMin

## Function

Defines the adjustment range "Min" of the OCX slider object.

## Syntax

```
BOOL SetRangeMin(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int IRangeMin);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **IRangeMin**

Adjustment range "Min" of the OCX slider object

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetRangeMin example (Page 1569)



## pictures

### Pictures - short description

Various properties of pictures of graphic objects and round buttons can be modified or called in using the functions in the Pictures group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### SetPicDeactTransparent

#### Function

Sets the transparent color for the "deactivated" status of a round button.

#### Syntax

```
BOOL SetPicDeactTransparent(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
long int IPicDeactTransparent);
```

#### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IPicDeactTransparent**

Transparent color for "deactivated" status

#### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

This function only applies to Bitmap graphics (\*.bmp).

---

**See also**

Color chart (Page 1592)

SetBackColor example (Page 1559)

**SetPicDeactUseTransColor**

**Function**

Controls the transparent color for the "deactivated" status of a round button.

**Syntax**

```
BOOL SetPicDeactUseTransColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
BOOL bPicDeactUseTransColor);
```

**Parameter**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bPicDeactUseTransColor**

Transparent color yes/no

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetPicDownTransparent

### Function

Sets the transparent color for the "On/pressed" status of a round button.

### Syntax

```
BOOL SetPicDownTransparent(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
long int IPicDownTransparent);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IPicDownTransparent**

Transparent color for "On/pressed" status

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

This function only applies to Bitmap graphics (\*.bmp).

---

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetPicDownUseTransColor

### Function

Controls the transparent color for the "On/pressed" status of a round button.

### Syntax

```
BOOL SetPicDownUseTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
BOOL bPicDownUseTransColor);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bPicDownUseTransColor**

Transparent color yes/no

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### SetPicTransColor

### Function

Sets the transparent color of the background picture of a graphic object.

### Syntax

```
BOOL SetPicTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lPicTransColor);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lPicTransColor**

Transparent color of the background picture

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

---

### Note

This function only applies to Bitmap graphics (\*.bmp).

---

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetPictureDeactivated

### Function

Specifies the picture name for the "deactivated" status of a round button.

### Syntax

```
BOOL SetPictureDeactivated(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, char* szPictureDeactivated);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **szPictureDeactivated**

Picture name for "deactivated" status

## Return value

### TRUE

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

Bitmap files (\*.bmp, \*.dib) as well as metafiles (\*.emf, \*.wmf) can be integrated.

---

**See also**

SetPictureDown example (Page 1567)

**SetPictureDown**

**Function**

Specifies the picture name for the "On/pressed" status of a round button.

**Syntax**

```
BOOL SetPictureDown(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, char* szPictureDown);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**szPictureDown**

Picture name for "On/pressed" status

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

Bitmap files (\*.bmp, \*.dib) as well as metafiles (\*.emf, \*.wmf) can be integrated.

---

## See also

SetPictureDown example (Page 1567)

## SetPictureUp

### Function

Specifies the picture name for the "Off/not pressed" status of a round button.

### Syntax

```
BOOL SetPictureUp(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, char* szPictureUp);
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**szPictureUp**

Picture name for "Off/not pressed" status

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

Bitmap files (\*.bmp, \*.dib) as well as metafiles (\*.emf, \*.wmf) can be integrated.

---

## See also

SetPictureUp example (Page 1567)

## SetPicUpTransparent

### Function

Sets the transparent color for the "Off/not pressed" status of a round button.

### Syntax

```
BOOL SetPicUpTransparent(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int lPicUpTransparent);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lPicUpTransparent**

Transparent color for "Off/not pressed" status

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

This function only applies to Bitmap graphics (\*.bmp).

---

### See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetPicUpUseTransColor

### Function

Controls the transparent color for the "Off/not pressed" status of a round button.



## Syntax

```
BOOL SetPicUpUseTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
BOOL bPicUpUseTransColor);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **bPicUpUseTransColor**

Transparent color yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## SetPicUseTransColor

## Function

Controls the transparent color of the background picture of a graphic object.

## Syntax

```
BOOL SetPicUseTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName,  
BOOL bPicUseTransColor);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **bPicUseTransColor**

Transparent color yes/no

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## property

### Property - short description

The properties of objects for which there are no direct functions can be modified or called in using the functions in the Property group.

---

### **Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetPropBOOL

### Function

Sets a property with the value "bValue".

### Syntax

```
BOOL SetPropBOOL(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, LPCTSTR  
lpszPropertyName, BOOL bValue)
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **lpszPropertyName**

Name of the object property

#### **bValue**

Value in BOOL data format

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

---

### Note

If the function is called for the picture object, set the parameter `lpszObjectName = NULL`.

---

## See also

SetPropBOOL example (Page 1568)

## SetPropChar

## Function

Sets a property with the value the pointer "szValue" points to.

## Syntax

```
BOOL SetPropChar(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, LPCTSTR  
lpszPropertyName, char* szValue)
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **lpszPropertyName**

Name of the object property

### **szValue**

Pointer to the value

## Return value

### TRUE

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the function is called for the picture object, set the parameter `IpszObjectName = NULL`.

---

**See also**

`GetPropChar` example (Page 1534)

**SetPropDouble**

**Function**

Sets a property with the value "dValue".

**Syntax**

```
BOOL SetPropDouble(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR  
IpszPropertyName, double dValue)
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IpszPropertyName**

Name of the object property

**dValue**

Value in "double" data format

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the function is called for the picture object, set the parameter `IpszObjectName = NULL`.

---

## SetPropWord

### Function

Sets a property with the value "IValue".

### Syntax

```
BOOL SetPropWord(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, LPCTSTR  
IpszPropertyName, long IValue)
```

### Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IpszPropertyName**

Name of the object property

**IValue**

Value in "long" data format

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the function is called for the picture object, set the parameter `IpszObjectName = NULL`.

---

## state

### State - short description

The properties of status displays can be modified or called in using the functions in the State group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetBasePicTransColor

### Function

Sets the transparent color of the basic picture for the status display.

### Syntax

```
BOOL SetBasePicTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int IBasePicTransColor);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IBasePicTransColor**

Transparent color of the basic picture

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

This function only applies to Bitmap graphics (\*.bmp).

---

**See also**

Color chart (Page 1592)

SetBackColor example (Page 1559)

**SetBasePicUseTransparentColor**

**Function**

Controls the transparent color of the basic picture for the status display.

**Syntax**

```
BOOL SetBasePicUseTransparentColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
BOOL bBasePicUseTransparentColor);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**bBasePicUseTransparentColor**

Transparent color yes/no

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetFlashFlashPicture

### Function

Specifies whether the flash picture of the status display is animated dynamically or statically.

### Syntax

```
BOOL SetFlashFlashPicture(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bFlashFlashPicture);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bFlashFlashPicture**

Type of flash picture

TRUE dynamically animated flash picture

FALSE statically animated flash picture

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetFlashPicTransColor

### Function

Sets the transparent color of the flash picture for a status display.

### Syntax

```
BOOL SetFlashPicTransColor(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int IFlashPicTransColor);
```



## Parameters

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IFlashPicTransColor**

Transparent color of the flash picture

## Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

This function only applies to Bitmap graphics (\*.bmp).

---

## See also

Color chart (Page 1592)

SetBackColor example (Page 1559)

## SetFlashPicUseTransColor

### Function

Controls the transparent color of the flash picture for a status display.

### Syntax

```
BOOL SetFlashPicUseTransColor(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName,  
BOOL bFlashPicUseTransColor);
```

## Parameters

**IpszPictureName**

Picture name

**lpzObjectName**

Object name

**bFlashPicUseTransparentColor**

Transparent color yes/no

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**SetFlashRateFlashPic**

**Function**

Sets the flash frequency of the flash picture for a status display.

**Syntax**

BOOL SetFlashRateFlashPic(LPCTSTR lpzPictureName, LPCTSTR lpzObjectName, long int IFlashRateFlashPic);

**Parameters**

**lpzPictureName**

Picture name

**lpzObjectName**

Object name

**IFlashRateFlashPic**

Flash frequency of the flash picture

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

Since the flashing is performed by means of software engineering, the precise frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time etc.).

---

**See also**

Flash frequencies (Page 1590)

SetFlashRateFlashPic example (Page 1563)

**SetIndex**

**Function**

Sets the index of a polygon or polyline thus defining the current object point.

**Syntax**

```
BOOL SetIndex(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IIndex);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IIndex**

Index value

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## style

### Style - short description

Various properties affecting the appearance of objects can be modified or called in using the functions in the Style group.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## SetBackBorderWidth

### Function

Sets the frame width of 3D frames and slider objects.

### Syntax

```
BOOL SetBackBorderWidth(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long  
int IBackBorderWidth);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IBackBorderWidth**

Frame width in pixels

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

SetBorderStyle example (Page 1560)

## SetBorderEndStyle

### Function

Sets the type of line end.

### Syntax

```
BOOL SetBorderEndStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IBorderEndStyle);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IBorderEndStyle**

Type of line end as numeric value

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## See also

Line end style (Page 1595)

SetBorderEndStyle example (Page 1559)

## SetBorderStyle

### Function

Sets the line or border style.

## Syntax

```
BOOL SetBorderStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lBorderStyle);
```

## Parameters

### **lpszPictureName**

Picture name

### **lpszObjectName**

Object name

### **lBorderStyle**

Numeric value defining the line or border style

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Line styles (Page 1595)

SetBorderStyle example (Page 1560)

## SetBorderWidth

## Function

Sets the line or border line width.

## Syntax

```
BOOL SetBorderWidth(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
lBorderWidth);
```

## Parameters

### **lpszPictureName**

Picture name

**IpszObjectName**

Object name

**IBorderWidth**

Line width or border line width

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

SetBorderStyle example (Page 1560)

**SetBoxAlignment**

**Function**

Defines the arrangement of controls (left or right justified) in check boxes or radio boxes.

**Syntax**

```
BOOL SetBoxAlignment(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, long int IBoxAlignment);
```

**Parameters**

**IpszPictureName**

Picture name

**IpszObjectName**

Object name

**IBoxAlignment**

Arrangement of controls

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

Element alignment in check boxes and radio boxes (Page 1592)

SetBorderStyle example (Page 1560)

**SetFillStyle**

**Function**

Sets the type of fill pattern.

**Syntax**

```
BOOL SetFillStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IFillStyle);
```

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**IFillStyle**

Type of fill pattern as numeric value

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

---

**Note**

If the function is called in relation to the entire picture, set the parameter `lpszObjectName = ZERO`.

---



## See also

Fill pattern (Page 1594)

SetFillStyle example (Page 1562)

## SetFillStyle2

### Function

Sets the bar fill pattern for a bar graph.

### Syntax

```
BOOL SetFillStyle2(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int  
IFillStyle2);
```

### Parameters

#### **lpszPictureName**

Picture name

#### **lpszObjectName**

Object name

#### **IFillStyle2**

Bar fill pattern as numeric value

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Fill pattern (Page 1594)

SetFillStyle example (Page 1562)

## SetItemBorderStyle

### Function

Sets the dividing line style for the "text list" object.

### Syntax

```
BOOL SetItemBorderStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int lItemBorderStyle);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**lItemBorderStyle**

Numeric value defining the dividing line style

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Line styles (Page 1595)

SetBorderStyle example (Page 1560)

## SetItemBorderWidth

### Function

Sets the dividing line width for the "text list" object.

### Syntax

```
BOOL SetItemBorderWidth(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, long int lItemBorderWidth);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

### **IItemBorderWidth**

Numeric value defining the dividing line width

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

SetBorderStyle example (Page 1560)

## SetPressed

## Function

Specifies for buttons or round buttons whether the switch setting is "pressed" or "not pressed".

## Syntax

```
BOOL SetPressed(LPCTSTR IpszPictureName, LPCTSTR IpszObjectName, BOOL  
bPressed);
```

## Parameters

### **IpszPictureName**

Picture name

### **IpszObjectName**

Object name

**bPressed**

Switch setting of the button

TRUE Switch setting "pressed"  
FALSE Switch setting "not pressed"

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**SetToggle**

**Function**

Specifies for buttons or round buttons whether the switch is latchable or not.

**Syntax**

BOOL SetToggle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL bToggle);

**Parameters**

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bToggle**

Switch latchable/not latchable

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## SetWindowsStyle

### Function

Specifies whether buttons are to be displayed in Windows style.

### Syntax

```
BOOL SetWindowsStyle(LPCTSTR lpszPictureName, LPCTSTR lpszObjectName, BOOL  
bWindowStyle);
```

### Parameters

**lpszPictureName**

Picture name

**lpszObjectName**

Object name

**bWindowStyle**

"Windows style" on/off

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

## OpenHomePicture

### Function

Opens the entered start picture.

### Syntax

```
BOOL OpenHomePicture();
```

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**OpenNextPicture**

**Function**

WinCC saves the names of the pictures opened by the user during runtime as well as the sequence in which these pictures were opened.

The maximum number of picture names saved this way can be set in the WinCC Explorer in the computer properties on the "Graphics Runtime" tab under "picture buffer size".

The OpenNextPicture function now opens the picture which was opened before the last call of OpenPrevPicture.

**Syntax**

```
BOOL OpenNextPicture();
```

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**OpenPrevPicture**

**Function**

WinCC saves the names of the pictures opened by the user during runtime as well as the sequence in which these pictures were opened.

The maximum number of picture names saved this way can be set in the WinCC Explorer in the computer properties on the "Graphics Runtime" tab under "picture buffer size".

The OpenPrevPicture function now opens the picture which was opened before the currently open picture.

**Syntax**

```
BOOL OpenPrevPicture();
```

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## OpenStoredPicture

### Function

Opens the picture saved with the StorePicture function.

### Syntax

```
BOOL OpenStoredPicture();
```

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## StorePicture

### Function

Saves the current picture which can then be opened with the OpenStoredPicture function.

### Syntax

```
BOOL StorePicture();
```

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

### 2.15.3.5 tag

#### tag - short description

Tags can be set or called in using the functions from the tag group.

#### GetTag or GetTagWait?

Process tags that are called with GetTag are put in an image. Since updating and reading the image is done in two separate procedures, the GetTag call is not directly influenced by the coupling. It can therefore be executed quicker and more independently than a GetTagWait retrieval.

With GetTagWait, process tags that have been requested are not accepted in the image. A GetTagWait retrieval reads the value explicitly from the AS. This always includes the send and return path through the coupling and the response time of the AS. During this runtime, the processing of the C actions is blocked and the time required for the retrieval cannot be estimated. If multiple tags are read, the time is added.

A GetTagWait call is required if

- fast write/read procedures are to be synchronized
- a value is read explicitly from the AS
- or a registration is to be avoided in the image deliberately.

The GetTagWait call is to be avoided in cyclic C-Actions, this is the main reason for performance problems.

#### SetTag or SetTagWait?

The SetTag retrieval distributes a write job without waiting for confirmation from the AS.

The SetTagWait retrieval distributes a write job and waits for confirmation from the AS. This always includes the send and return path through the coupling and the response time of the AS. During this runtime, the processing of the C actions is blocked and the time required for the retrieval cannot be estimated. If multiple tags are written, the time is added.

A SetTagWait call is set to guarantee that the value has been written before the C-Action is processed any further. The SetTagWait call in cyclic C actions is to be avoided.

---

#### Note

The difference between GetTag and GetTagWait also exists for internal tags. The difference is not quite so serious here however, since no coupling comes into play. To synchronize fast write/read procedures, the respective wait function is to be used with internal tags as well.

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---



get

## Functionality of the GetTag functions


### GetTagXXX

By calling the function the tag is logged on and, from that moment, polled cyclically from the AS. The cycle for the registration depends on the trigger (see following description). For GetTagXXX calls, the value that is available in WinCC is sent. For Close Picture, the tag actions are ended again.

The call is marked by the following:

- The value is read from the tag image by WinCC.
- The call is faster in comparison to GetTagXXXWait (except for the first call which generally takes longer because the value from the PLC must be read out and logged on).
- The duration of the call does not depend on the bus-load or on the AS.
- The function does not deliver any information on the status of the tags

### Asynchronous

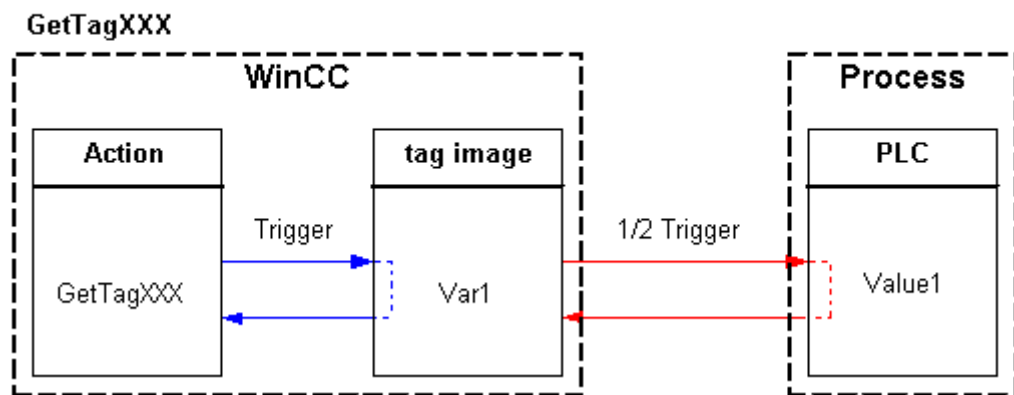

#### Note

If a tag is requested in a Global Script action, it remains registered throughout the enter Runtime of WinCC.

In Callback functions, the respective GetTagXXXWait function must be used.

#### Behavior in actions with tag trigger (recommended):


All of the tags contained in the tag trigger are already known with Open Picture and are registered with the defined monitoring time.

Since all tags are requested at once, the best possible optimization can be targeted from the channel. If a tag is requested with GetTagXXX() within a C-Action, which is contained in the trigger, the value already exists and is sent directly to the call (high-performance).

#### Registering tags in actions with tag trigger

2.15 ANSI-C function descriptions

As the tags are already known when the picture is selected, they can be transmitted in a job to the Data Manager and so be registered collectively to the channel.

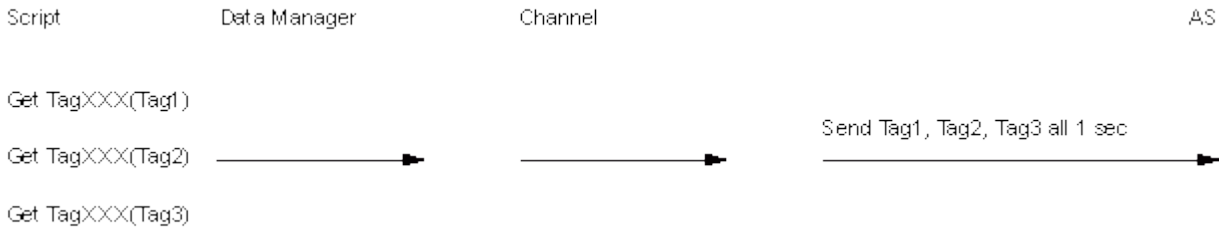

**Note**

If a tag is requested, which is not in the trigger, then the behavior is the same as with the default trigger.


**Behavior in actions with default trigger:**

tags are registered with half of the cycle time with the first call. For every other call, the value is present.

**Registering tags in actions with default trigger and event trigger**

Only when the individual actions are executed is it identified which tags are needed in the picture. As a result, the tags are registered to the channel in a large number of single jobs. When a picture with cyclic actions is selected, the continual reorganization may place a heavy strain on communications.

Example: The channel supports custom cycle creation. Usually cycles are created by the channel directly from the AS. The resources for these cycles are limited by the AS. As a result, the channel stops the current jobs for this cycle and reconfigures the cycle on the AS.

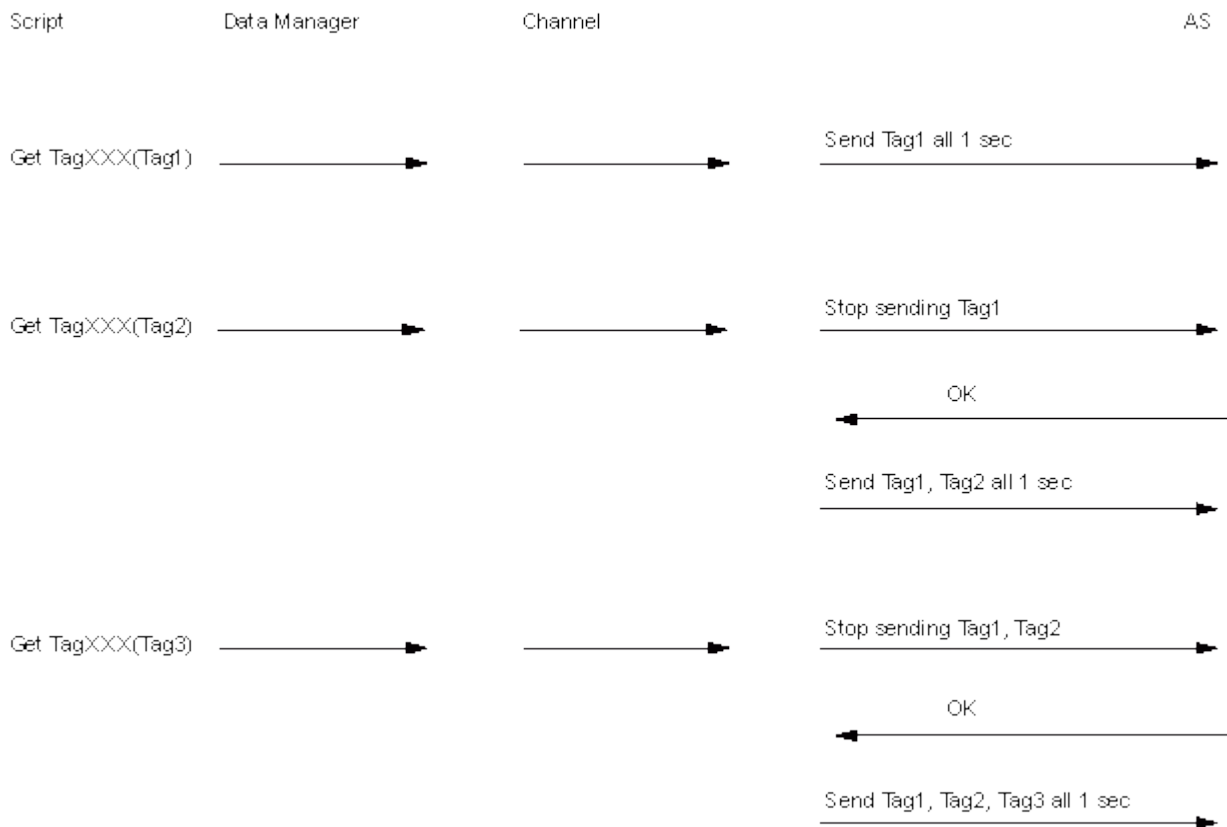**Behavior in event triggered actions:**

The tag is registered in the "upon change" mode with the first call. Process tags that are registered in the "upon change" mode correspond with a cyclic read job with a cycle time of 1s.

**Note**

If a value is requested by GetTagXXX() by a mouse click for example, the tag is accepted in the tag image. The tag is requested cyclically from the AS as of this point in time and therefore increases the basic load.

To avoid this increase in basic loading, the value can be requested by GetTagXXXWait(). The call GetTagXXXWait() causes a higher communication load one time but the tag is not added to the tag image.

**GetTagXXXWait**


The function returns the current value. The tag is not registered cyclically, the value is requested from the AS one time only.

The call is marked by the following:

- The value is read explicitly from the AS.
- The call, compared with GetTagXXX, takes longer.

- The duration of the call does not depend on the bus-load or on the AS.
- The function does not deliver any information on the status of the tags.

### Synchronous

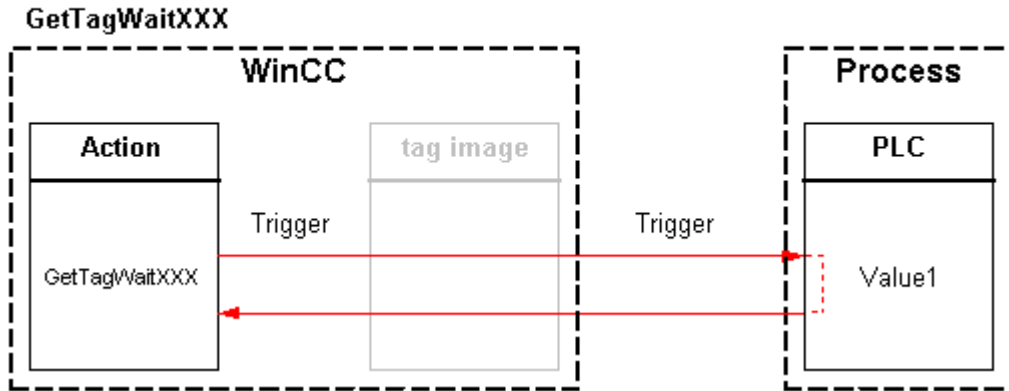

### GetTagXXXState

The function GetTagXXXState has the same features as GetTagXXX, it also sends the function information on the status of the tags. Since the status is always delivered internally, there is no performance difference to GetTagXXX.

### GetTagXXXStateWait

The function GetTagXXXStateWait has the same features as GetTagXXXWait, additionally it sends the function information on the status of the tags. Since the status is always delivered internally, there is no performance difference to GetTagXXXWait.

The difference between functions GetTagXXXStateWait and GetTagXXXState corresponds with the difference between GetTagXXXWait and GetTagXXX. Since the value is explicitly read from the AS for process tags, the value and the status can be more current than for GetTagXXXState.

### GetTagXXXStateQC

The function GetTagXXXStateQC has the same features as GetTagXXXState. The function also delivers information on the quality code of the tag.

### GetTagXXXStateQCWait

The function GetTagXXXStateQCWait has the same features as GetTagXXXStateWait. The function also delivers information on the quality code of the tag.

### GetTagMultiWait

The function GetTagMultiWait has the same features as GetTagXXXWait. However, it allows the request for more tags in a job. Therefore, the read requests in the direction of the AS can be optimized in most cases so that only one request will be given to the AS.

## GetTagMultiStateWait

The function GetTagMultiStateWait has the same features as GetTagMultiWait, additionally it sends the function information on the statuses of the tags.

## GetTagMultiStateQCWait

The function GetTagMultiStateQCWait has the same features as GetTagMultiStateWait. The function also delivers information on the quality codes of the tags.

**state**

**wait**

## getTagBitStateWait

### Function

Determines the value of a tag of data type "Binary tag". The value is read explicitly from the AS. The status of the tag is also returned.

### Syntax

```
BOOL GetTagBitStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "BOOL"

### See also

Tag statuses (Page 1598)

GetTagBitStateWait example (Page 1541)

Functionality of the GetTag functions (Page 1409)

## GetTagByteStateWait

### Function

Determines the value of a tag of data type "unsigned 8 bit". The value is read explicitly from the AS. The status of the tag is also returned.

### Syntax

```
BYTE GetTagByteStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "BYTE"

### See also

Tag statuses (Page 1598)

GetTagWordStateWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagCharStateWait

### Function

Determines the value of a tag of data type "8-bit text tag" or "16-bit text tag". The value is read explicitly from the AS. The status of the tag is also returned.

### Syntax

```
char* GetTagCharStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

**Tag\_Name**

name of the tag

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Pointer to the value of the tag in data type "char".

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

## See also

Functionality of the GetTag functions (Page 1409)

Tag statuses (Page 1598)

Beispiel GetTagCharStateWait (Page 1544)

## GetTagDoubleStateWait

### Function

Determines the value of a tag of data type "64-bit floating point value". The value is read explicitly from the AS. The status of the tag is also returned.

### Syntax

```
double GetTagDoubleStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

**Tag\_Name**

name of the tag

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Value of the tag in the data type "double"

## See also

Tag statuses (Page 1598)

GetTagFloatStateWait example (Page 1546)

Functionality of the GetTag functions (Page 1409)

## GetTagDWordStateWait

### Function

Determines the value of a tag of data type "unsigned 32 bit". The value is read explicitly from the AS. The status of the tag is also returned.

### Syntax

```
DWORD GetTagDWordStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "DWORD"

### See also

Tag statuses (Page 1598)

GetTagWordStateWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)



## GetTagFloatStateWait

### Function

Determines the value of a tag of data type "32-bit floating point value". The value is read explicitly from the AS. The status of the tag is also returned.

### Syntax

```
float GetTagFloatStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

**Tag\_Name**

name of the tag

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "float"

### See also

Tag statuses (Page 1598)

GetTagFloatStateWait example (Page 1546)

Functionality of the GetTag functions (Page 1409)

## GetTagMultiStateWait

### Function

The values and states of several tags are established and stored in the corresponding addresses in the specified format. The values are read explicitly from the AS.

The function must transfer a DWORD array whose members contain the individual tag states after the function is invoked. The size of the array must be selected so that sufficient memory space is available for these statuses.

### Syntax

```
BOOL GetTagMultiStateWait(DWORD* pdwState, const char* pFormat)
```

## Parameters

### **pdwState**

Field in which the tag statuses are stored.

### **pFormat**

Format description for all requested tags and for each tag name and address of the value

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Format descriptors (Page 1593)

Tag statuses (Page 1598)

GetTagMultiStateWait example (Page 1548)

Functionality of the GetTag functions (Page 1409)

## GetTagRawStateWait

### Function

Determines the value of a tag of data type "Raw data type". The value is read explicitly from the AS. The status of the tag is also returned.

### Syntax

```
BOOL GetTagRawStateWait(Tag Tag_Name, BYTE pValue, DWORD size, PDWORD  
lp_dwstate);
```

### Parameters

#### **Tag\_Name**

name of the tag

#### **pValue**

The pointer to a byte field which contains the value of the raw data tag

**size**

Size of the byte field in bytes

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

GetTagRawStateWait example (Page 1551)

Functionality of the GetTag functions (Page 1409)

**GetTagSByteStateWait**

**Function**

Determines the value of a tag of data type "signed 8 bit". The value is read explicitly from the AS. The status of the tag is also returned.

**Syntax**

```
signed char GetTagSByteStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

**Parameters**

**Tag\_Name**

name of the tag

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value**

The value of the tag in the data type "signed char"

## See also

Tag statuses (Page 1598)

GetTagSByteStateWait example (Page 1553)

Functionality of the GetTag functions (Page 1409)

## GetTagSDWordStateWait

### Function

Determines the value of a tag of data type "signed 32 bit". The value is read explicitly from the AS. The status of the tag is also returned.

### Syntax

```
long GetTagSDWordStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "long"

## See also

Tag statuses (Page 1598)

GetTagSByteStateWait example (Page 1553)

Functionality of the GetTag functions (Page 1409)

## GetTagSWordStateWait

### Function

Determines the value of a tag of data type "signed 16 bit". The value is read explicitly from the AS. The status of the tag is also returned.

## Syntax

```
short GetTagSWordStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Value of the tag in the data type "short"

## See also

Functionality of the GetTag functions (Page 1409)

Tag statuses (Page 1598)

GetTagSByteStateWait example (Page 1553)

## GetTagWordStateWait

## Function

Determines the value of a tag of data type "unsigned 16 bit". The value is read explicitly from the AS. The status of the tag is also returned.

## Syntax

```
WORD GetTagWordStateWait(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Value of the tag in the data type "WORD"

## See also

Tag statuses (Page 1598)

GetTagWordStateWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagBitState

### Function

Determines the value of a tag of data type "Binary tag". The status of the tag is also returned.

### Syntax

```
BOOL GetTagBitState(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "BOOL"

## See also

Tag statuses (Page 1598)

GetTagBitStateWait example (Page 1541)

Functionality of the GetTag functions (Page 1409)

## GetTagByteState

### Function

Determines the value of a tag of data type "unsigned 8 bit". The status of the tag is also returned.

## Syntax

```
BYTE GetTagByteState(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Value of the tag in the data type "BYTE"

## See also

Tag statuses (Page 1598)

GetTagWordStateWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagCharState

## Function

Determines the value of a tag of data type "8-bit text tag" or "16-bit text tag". The status of the tag is also returned.

## Syntax

```
char* GetTagCharState(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Pointer to the value of the tag in data type "char".

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

## See also

Tag statuses (Page 1598)

Beispiel GetTagCharStateWait (Page 1544)

Functionality of the GetTag functions (Page 1409)

## GetTagDoubleState

### Function

Determines the value of a tag of data type "64-bit floating point value". The status of the tag is also returned.

### Syntax

```
double GetTagDoubleState(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "double"



## See also

Tag statuses (Page 1598)

GetTagFloatStateWait example (Page 1546)

Functionality of the GetTag functions (Page 1409)

## GetTagDWordState

### Function

Determines the value of a tag of data type "unsigned 32 bit". The status of the tag is also returned.

### Syntax

```
DWORD GetTagDWordState(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "DWORD"

## See also

Tag statuses (Page 1598)

GetTagWordStateWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagFloatState

### Function

Determines the value of a tag of data type "32-bit floating point value". The status of the tag is also returned.

## Syntax

```
float GetTagFloatState(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Value of the tag in the data type "float"

## See also

GetTagFloatStateWait example (Page 1546)

Tag statuses (Page 1598)

Functionality of the GetTag functions (Page 1409)

## GetTagRawState

## Function

Determines the value of a tag of data type "Raw data type". The status of the tag is also returned.

## Syntax

```
BOOL GetTagRawState(Tag Tag_Name, BYTE* pValue, DWORD size, PDWORD  
lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### pValue

The pointer to a byte field which contains the value of the raw data tag

### size

Size of the byte field in bytes

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

GetTagRawStateWait example (Page 1551)

Functionality of the GetTag functions (Page 1409)

**GetTagSByteState**

**Function**

Determines the value of a tag of data type "signed 8 bit". The status of the tag is also returned.

**Syntax**

```
signed char GetTagSByteState(Tag Tag_Name, PDWORD lp_dwstate);
```

**Parameters**

**Tag\_Name**

name of the tag

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value**

The value of the tag in the data type "signed char"

## See also

Tag statuses (Page 1598)

GetTagSByteStateWait example (Page 1553)

Functionality of the GetTag functions (Page 1409)

## GetTagSDWordState

### Function

Determines the value of a tag of data type "signed 32 bit". The status of the tag is also returned.

### Syntax

```
long GetTagSDWordState(Tag Tag_Name, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

Value of the tag in the data type "long"

## See also

Tag statuses (Page 1598)

GetTagSByteStateWait example (Page 1553)

Functionality of the GetTag functions (Page 1409)

## GetTagSWordState

### Function

Determines the value of a tag of data type "signed 16 bit". The status of the tag is also returned.

### Syntax

```
short GetTagSWordState(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

### **Tag\_Name**

name of the tag

### **lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Value of the tag in the data type "short"

## See also

Tag statuses (Page 1598)

GetTagSByteStateWait example (Page 1553)

Functionality of the GetTag functions (Page 1409)

## GetTagWordState

### Function

Determines the value of a tag of data type "unsigned 16 bit". The status of the tag is also returned.

### Syntax

```
WORD GetTagWordState(Tag Tag_Name, PDWORD lp_dwstate);
```

## Parameters

### **Tag\_Name**

name of the tag

### **lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

Value of the tag in the data type "WORD"

## See also

Tag statuses (Page 1598)

GetTagWordStateWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## stateqc

## wait

## GetTagBitStateQCWait

### Function

Determines the value of a tag of data type "Binary tag". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

### Syntax

```
BOOL GetTagBitStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tags in the data type "BOOL".

## See also

Tag statuses (Page 1598)

GetTagWordStateQCWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagByteStateQCWait

### Function

Determines the value of a tag of data type "unsigned 8 bit". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

### Syntax

```
BYTE GetTagByteStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tag in the data type "BYTE".

### See also

Tag statuses (Page 1598)

GetTagWordStateQCWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagCharStateQCWait

### Function

Determines the value of a tag of data type "8-bit text tag" or "16-bit text tag". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

### Syntax

```
char* GetTagCharStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

## Parameters

### Tag\_Name

Name of the tag.

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

## Return value

Pointer to the value of the tag in data type "char".

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

## See also

Tag statuses (Page 1598)

GetTagCharStateQCWait example (Page 1543)

Functionality of the GetTag functions (Page 1409)

## GetTagDoubleStateQCWait

### Function

Determines the value of a tag of data type "64-bit floating point value". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

### Syntax

```
double GetTagDoubleStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

## Parameters

### Tag\_Name

Name of the tag.



**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

**Return value**

Value of the tag in the data type "double".

**See also**

Tag statuses (Page 1598)

GetTagFloatStateQCWait example (Page 1545)

Functionality of the GetTag functions (Page 1409)

**GetTagDWordStateQCWait**

**Function**

Determines the value of a tag of data type "unsigned 32 bit". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

**Syntax**

```
DWORD GetTagDWordStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD pdwQualityCode);
```

**Parameters**

**Tag\_Name**

Name of the tag.

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

**Return value**

Value of the tag in the data type "DWORD".

## See also

Tag statuses (Page 1598)

GetTagWordStateQCWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagFloatStateQCWait

### Function

Determines the value of a tag of data type "32-bit floating point value". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

### Syntax

```
float GetTagFloatStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tag in the data type "float".

## See also

Tag statuses (Page 1598)

GetTagFloatStateQCWait example (Page 1545)

Functionality of the GetTag functions (Page 1409)

## GetTagMultiStateQCWait

### Function

The values, states and quality codes are determined for several tags and are stored in the respective addresses in the specified format. The values are read explicitly from the AS.

The function must be provided with two DWORD arrays, the member of which contains the states and quality codes of the individual tags after the function has been called. The size of the arrays must be selected so that sufficient memory space is available for these statuses.

### Syntax

```
BOOL GetTagMultiStateQCWait(DWORD* pdwState, DWORD* pdwQualityCode, const char* pFormat)
```

### Parameters

**pdwState**

Field in which the status of the individual tags is stored after the function has been completed.

**pdwQualityCode**

Field in which the quality codes of the individual tags is stored after the function has been completed.

**pFormat**

Format description for all requested tags and for each tag name and address of the value.

### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

### See also

Format descriptors (Page 1593)

Tag statuses (Page 1598)

GetTagMultiStateQCWait example (Page 1547)

Functionality of the GetTag functions (Page 1409)

## GetTagRawStateQCWait

### Function

Determines the value of a tag of data type "Raw data type". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

### Syntax

```
BOOL GetTagRawStateQCWait(Tag Tag_Name, BYTE pValue, DWORD size, PDWORD  
lp_dwstate, PDWORD pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### pValue

Pointer to a byte field containing the value of the raw data tag.

#### size

Size of the byte field in bytes.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

#### TRUE

The function has been completed without any errors.

#### FALSE

An error has occurred.

### See also

Tag statuses (Page 1598)

GetTagRawStateQCWait example (Page 1550)

Functionality of the GetTag functions (Page 1409)

## GetTagSByteStateQCWait

### Function

Determines the value of a tag of data type "signed 8 bit". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

### Syntax

```
signed char GetTagSByteStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tag in the data type "signed char".

### See also

Tag statuses (Page 1598)

GetTagSByteStateQCWait example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagSDWordStateQCWait

### Function

Determines the value of a tag of data type "signed 32 bit". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

## Syntax

```
long GetTagSDWordStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

## Parameters

### Tag\_Name

Name of the tag.

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

## Return value

Value of the tags in the data type "long".

## See also

Tag statuses (Page 1598)

GetTagSByteStateQCWait example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagSWordStateQCWait

## Function

Determines the value of a tag of data type "signed 16 bit". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

## Syntax

```
short GetTagSWordStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

## Parameters

### Tag\_Name

Name of the tag.

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

**Return value**

Value of the tag in the data type "short".

**See also**

Tag statuses (Page 1598)

GetTagSByteStateQCWait example (Page 1552)

Functionality of the GetTag functions (Page 1409)

**GetTagValueStateQCWait****Function**

Enables the transfer of a value in the form of a variant. Establishes the pointer to the result structure containing the value. The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

**Syntax**

```
BOOL GetTagValueStateQCWait(LPDM_VARKEY lpdmVarKey,  
LPDM_VAR_UPDATE_STRUCTEX lpdmresult, LPCMN_ERROR lpdmError);
```

**Parameters****lpdmVarKey**

Pointer to a structure of the data type "DM\_VARKEY"

**lpdmresult**

Pointer to the value from data type "DM\_VAR\_UPDATE\_STRUCTEX"

**lpdmError**

Pointer to the structure which contains the error description

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Structure definition CMN\_ERROR (Page 1601)

Structure definition DM\_VAR\_UPDATE\_STRUCTEX (Page 1604)

Structure definition DM\_VARKEY (Page 1605)

Functionality of the GetTag functions (Page 1409)

## GetTagWordStateQCWait

### Function

Determines the value of a tag of data type "unsigned 16 bit". The value is read explicitly from the AS. In addition, the status and the quality code of the tags are returned.

### Syntax

```
WORD GetTagWordStateQCWait(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### **Tag\_Name**

Name of the tag.

#### **lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### **pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tag in the data type "WORD".



## See also

Tag statuses (Page 1598)

GetTagWordStateQCWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagBitStateQC

### Function

Determines the value of a tag of data type "Binary tag". In addition, the status and the quality code of the tags are returned.

### Syntax

```
BOOL GetTagBitStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tags in the data type "BOOL".

## See also

Tag statuses (Page 1598)

GetTagBitStateQC example (Page 1540)

Functionality of the GetTag functions (Page 1409)

## GetTagByteStateQC

### Function

Determines the value of a tag of data type "unsigned 8 bit". In addition, the status and the quality code of the tags are returned.

### Syntax

```
BYTE GetTagByteStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tag in the data type "BYTE".

### See also

Tag statuses (Page 1598)

GetTagWordStateQCWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## GetTagCharStateQC

### Function

Determines the value of a tag of data type "8-bit text tag" or "16-bit text tag". In addition, the status and the quality code of the tags are returned.

**Syntax**

```
char* GetTagCharStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

**Parameters****Tag\_Name**

Name of the tag.

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

**Return value**

Pointer to the value of the tag in data type "char".

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

**See also**

Tag statuses (Page 1598)

GetTagCharStateQCWait example (Page 1543)

Functionality of the GetTag functions (Page 1409)

**GetTagDoubleStateQC****Function**

Determines the value of a tag of data type "64-bit floating point value". In addition, the status and the quality code of the tags are returned.

**Syntax**

```
double GetTagDoubleStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

## Parameters

### **Tag\_Name**

Name of the tag.

### **lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### **pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

## Return value

Value of the tag in the data type "double".

## See also

GetTagFloatStateQCWait example (Page 1545)

Tag statuses (Page 1598)

Functionality of the GetTag functions (Page 1409)

## GetTagDWordStateQC

### Function

Determines the value of a tag of data type "unsigned 32 bit". In addition, the status and the quality code of the tags are returned.

### Syntax

```
DWORD GetTagDWordStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

## Parameters

### **Tag\_Name**

Name of the tag.

### **lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

**Return value**

Value of the tag in the data type "DWORD".

**See also**

Tag statuses (Page 1598)

GetTagWordStateQCWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

**GetTagFloatStateQC**

**Function**

Determines the value of a tag of data type "32-bit floating point value". In addition, the status and the quality code of the tags are returned.

**Syntax**

```
float GetTagFloatStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

**Parameters**

**Tag\_Name**

Name of the tag.

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

**Return value**

Value of the tag in the data type "float".

## See also

GetTagFloatStateQCWait example (Page 1545)

Tag statuses (Page 1598)

Functionality of the GetTag functions (Page 1409)

## GetTagRawStateQC

### Function

Determines the value of a tag of data type "Raw data type". In addition, the status and the quality code of the tags are returned.

### Syntax

```
BOOL GetTagRawStateQC(Tag Tag_Name, BYTE* pValue, DWORD size, PDWORD  
lp_dwstate, PDWORD pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### pValue

Pointer to a byte field containing the value of the raw data tag.

#### size

Size of the byte field in bytes.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

#### TRUE

The function has been completed without any errors.

#### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

GetTagRawStateQCWait example (Page 1550)

Functionality of the GetTag functions (Page 1409)

## GetTagSByteStateQC

### Function

Determines the value of a tag of data type "signed 8 bit". In addition, the status and the quality code of the tags are returned.

### Syntax

```
signed char GetTagSByteStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tag in the data type "signed char".

## See also

Tag statuses (Page 1598)

GetTagSByteStateQCWait example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagSDWordStateQC

### Function

Determines the value of a tag of data type "signed 32 bit". In addition, the status and the quality code of the tags are returned.

### Syntax

```
long GetTagSDWordStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

### Parameters

#### Tag\_Name

Name of the tag.

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

#### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

### Return value

Value of the tags in the data type "long".

### See also

Tag statuses (Page 1598)

GetTagSByteStateQCWait example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagSWordStateQC

### Function

Determines the value of a tag of data type "signed 16 bit". In addition, the status and the quality code of the tags are returned.



## Syntax

```
short GetTagSWordStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

## Parameters

### Tag\_Name

Name of the tag.

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### pdwQualityCode

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

## Return value

Value of the tag in the data type "short".

## See also

Tag statuses (Page 1598)

GetTagSByteStateQCWait example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagValueStateQC

## Function

Enables the transfer of a value in the form of a variant. Establishes the pointer to the result structure containing the value. In addition, the status and the quality code of the tags are returned.

## Syntax

```
BOOL GetTagValueStateQC(LPDM_VARKEY lpdmVarKey,  
LPDM_VAR_UPDATE_STRUCTEX lpdmresult, LPCMN_ERROR lpdmError);
```

## Parameters

### lpdmVarKey

Pointer to a structure of the data type "DM\_VARKEY"

**lpdmresult**

Pointer to the value from data type "DM\_VAR\_UPDATE\_STRUCTEX"

**lpdmError**

Pointer to the structure which contains the error description

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

Structure definition CMN\_ERROR (Page 1601)

Structure definition DM\_VAR\_UPDATE\_STRUCTEX (Page 1604)

Structure definition DM\_VARKEY (Page 1605)

Functionality of the GetTag functions (Page 1409)

**GetTagWordStateQC**

**Function**

Determines the value of a tag of data type "unsigned 16 bit". In addition, the status and the quality code of the tags are returned.

**Syntax**

```
WORD GetTagWordStateQC(Tag Tag_Name, PDWORD lp_dwstate, PDWORD  
pdwQualityCode);
```

**Parameters**

**Tag\_Name**

Name of the tag.

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**pdwQualityCode**

Pointer to a DWORD in which the quality code of the tag is stored after the function is complete.

## Return value

Value of the tag in the data type "WORD".

## See also

Tag statuses (Page 1598)

GetTagWordStateQCWait example (Page 1554)

Functionality of the GetTag functions (Page 1409)

## wait

## GetTagBitWait

## Function

Determines the value of a tag of data type "Binary tag". The value is read explicitly from the AS.

## Syntax

```
BOOL GetTagBitWait(Tag Tag_Name);
```

## Parameters

### Tag\_Name

name of the tag

## Return value

Value of the tag in the data type "BOOL"

## See also

GetTagBit example (Page 1539)

Functionality of the GetTag functions (Page 1409)

## GetTagByteWait

### Function

Determines the value of a tag of data type "unsigned 8 bit". The value is read explicitly from the AS.

### Syntax

```
BYTE GetTagByteWait(Tag Tag_Name);
```

### Parameters

**Tag\_Name**  
name of the tag

### Return value

Value of the tag in the data type "BYTE"

### See also

GetTagWord example (Page 1553)  
Functionality of the GetTag functions (Page 1409)

## GetTagCharWait

### Function

Determines the value of a tag of data type "8-bit text tag" or "16-bit text tag". The value is read explicitly from the AS.

### Syntax

```
char* GetTagCharWait(Tag Tag_Name);
```

### Parameters

**Tag\_Name**  
name of the tag

### Return value

Pointer to a character string containing the value of the tag.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

## See also

GetTagChar example (Page 1542)

Functionality of the GetTag functions (Page 1409)

## GetTagDoubleWait

### Function

Determines the value of a tag of data type "64-bit floating point value". The value is read explicitly from the AS.

### Syntax

```
double GetTagDoubleWait(Tag Tag_Name);
```

### Parameters

#### Tag\_Name

name of the tag

### Return value

Value of the tag in the data type "double"

## See also

GetTagFloat example (Page 1544)

Functionality of the GetTag functions (Page 1409)

## GetTagDWordWait

### Function

Determines the value of a tag of data type "unsigned 32 bit". The value is read explicitly from the AS.

**Syntax**

DWORD GetTagDWordWait(Tag Tag\_Name);

**Parameters**

**Tag\_Name**  
name of the tag

**Return value**

Value of the tag in the data type "DWORD"

**See also**

Functionality of the GetTag functions (Page 1409)  
GetTagWord example (Page 1553)

**GetTagFloatWait**

**Function**

Determines the value of a tag of data type "32-bit floating point value". The value is read explicitly from the AS.

**Syntax**

float GetTagFloatWait(Tag Tag\_Name);

**Parameters**

**Tag\_Name**  
name of the tag

**Return value**

Value of the tag in the data type "float"

**See also**

GetTagFloat example (Page 1544)  
Functionality of the GetTag functions (Page 1409)

## GetTagMultiWait

### Function

The values of several tags are established and stored in the corresponding addresses in the specified format. The value is read explicitly from the AS. The memory for the tag value is created by the function with SysMalloc.

### Syntax

```
BOOL GetTagMultiWait(const char* pFormat,...)
```

### Parameters

#### **pFormat**

Format description for all requested tags and for each tag name and address of the value

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

### See also

Format descriptors (Page 1593)

GetTagMultiWait example (Page 1549)

Functionality of the GetTag functions (Page 1409)

## GetTagRawWait

### Function

Determines the value of a tag of data type "Raw data type". The value is read explicitly from the AS.

### Syntax

```
BOOL GetTagRawWait(Tag Tag_Name , BYTE pValue, DWORD size);
```

## Parameters

### **Tag\_Name**

name of the tag

### **pValue**

The pointer to a byte field which contains the value of the raw data tag

### **size**

Size of the byte field in bytes

## Return value

### **TRUE**

The function has been completed without any errors.

### **FALSE**

An error has occurred.

## See also

Functionality of the GetTag functions (Page 1409)

GetTagRaw example (Page 1550)

## GetTagSByteWait

### Function

Determines the value of a tag of data type "signed 8 bit". The value is read explicitly from the AS.

### Syntax

```
signed char GetTagSByteWait(Tag Tag_Name);
```

### Parameters

#### **Tag\_Name**

name of the tag

### Return value

The value of the tag in the data type "signed char"



## See also

GetTagSByte example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagSDWordWait

### Function

Determines the value of a tag of data type "signed 32 bit". The value is read explicitly from the AS.

### Syntax

```
long GetTagSDWordWait(Tag Tag_Name);
```

### Parameters

#### Tag\_Name

name of the tag

### Return value

Value of the tag in the data type "long"

## See also

GetTagSByte example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagSWordWait

### Function

Determines the value of a tag of data type "signed 16 bit". The value is read explicitly from the AS.

### Syntax

```
short GetTagSWordWait(Tag Tag_Name);
```

## Parameters

### Tag\_Name

name of the tag

## Return value

Value of the tag in the data type "short"

## See also

GetTagSByte example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagValueWait

### Function

Enables the transfer of a value in the form of a variant. Establishes the pointer to the result structure containing the value. The value is read explicitly from the AS.

### Syntax

```
BOOL GetTagValueWait(LPDM_VARKEY lpdmVarKey, LPDM_VAR_UPDATE_STRUCT  
lpdmresult, LPCMN_ERROR lpdmError);
```

## Parameters

### lpdmVarKey

Pointer to a structure of the data type "DM\_VARKEY"

### lpdmresult

Pointer to the value from data type "DM\_VAR\_UPDATE\_STRUCT"

### lpdmError

Pointer to the structure which contains the error description

## Return value

### TRUE

The function has been completed without any errors.

### FALSE

An error has occurred.

## See also

Structure definition CMN\_ERROR (Page 1601)

Structure definition DM\_VAR\_UPDATE\_STRUCT (Page 1603)

Structure definition DM\_VARKEY (Page 1605)

Functionality of the GetTag functions (Page 1409)

## GetTagWordWait

### Function

Determines the value of a tag of data type "unsigned 16 bit". The value is read explicitly from the AS.

### Syntax

```
WORD GetTagWordWait(Tag Tag_Name);
```

### Parameters

#### **Tag\_Name**

name of the tag

### Return value

Value of the tag in the data type "WORD"

## See also

GetTagWord example (Page 1553)

Functionality of the GetTag functions (Page 1409)

## GetTagBit

### Function

Determines the value of a tag of data type "Binary tag".

### Syntax

```
BOOL GetTagBit(Tag Tag_Name);
```

## Parameters

**Tag\_Name**  
name of the tag

## Return value

Value of the tag in the data type "BOOL"

## See also

GetTagBit example (Page 1539)  
Functionality of the GetTag functions (Page 1409)

## GetTagByte

### Function

Determines the value of a tag of data type "unsigned 8 bit".

### Syntax

```
BYTE GetTagByte(Tag Tag_Name);
```

## Parameters

**Tag\_Name**  
name of the tag

## Return value

Value of the tag in the data type "BYTE"

## See also

GetTagWord example (Page 1553)  
Functionality of the GetTag functions (Page 1409)

## GetTagChar

### Function

Determines the value of a tag of data type "8-bit text tag" or "16-bit text tag".

**Syntax**

```
char* GetTagChar(Tag Tag_Name);
```

**Parameters****Tag\_Name**

name of the tag

**Return value**

Pointer to a character string containing the value of the tag.

The return value must be checked for validity to prevent a null pointer exception, e.g. with the function "GetText()":

```
pszValue = GetText(lpszPictureName, "Text1");  
if(pszValue != NULL)  
{  
    .....  
}
```

**See also**

GetTagChar example (Page 1542)

Functionality of the GetTag functions (Page 1409)

**GetTagDateTime****Function**

Determines the value of a tag of data type "Date/Time".

**Syntax**

```
SYSTEMTIME GetTagDateTime(Tag Tag_Name);
```

**Parameter****Tag\_Name**

Name of the tag

**Return value**

Value of the tag in the data type "Date/Time".

## GetTagDouble

### Function

Determines the value of a tag of data type "64-bit floating point value".

### Syntax

```
double GetTagDouble(Tag Tag_Name);
```

### Parameters

**Tag\_Name**  
name of the tag

### Return value

Value of the tag in the data type "double"

### See also

GetTagFloat example (Page 1544)  
Functionality of the GetTag functions (Page 1409)

## GetTagDWord

### Function

Determines the value of a tag of data type "unsigned 32 bit".

### Syntax

```
DWORD GetTagDWord(Tag Tag_Name);
```

### Parameters

**Tag\_Name**  
name of the tag

### Return value

Value of the tag in the data type "DWORD"

## See also

GetTagWord example (Page 1553)

Functionality of the GetTag functions (Page 1409)

## GetTagFloat

### Function

Determines the value of a tag of data type "32-bit floating point value".

### Syntax

```
float GetTagFloat(Tag Tag_Name);
```

### Parameters

#### Tag\_Name

name of the tag

### Return value

Value of the tag in the data type "float".

## See also

GetTagFloat example (Page 1544)

Functionality of the GetTag functions (Page 1409)

## GetTagRaw

### Function

Determines the value of a tag of data type "Raw data type".

### Syntax

```
BOOL GetTagRaw(Tag Tag_Name, BYTE* pValue, DWORD size);
```

### Parameters

#### Tag\_Name

name of the tag

**pValue**

The pointer to a byte field which contains the value of the raw data tag

**size**

Size of the byte field in bytes

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

GetTagRaw example (Page 1550)

Functionality of the GetTag functions (Page 1409)

**GetTagSByte**

**Function**

Determines the value of a tag of data type "signed 8 bit".

**Syntax**

```
signed char GetTagSByte(Tag Tag_Name);
```

**Parameters**

**Tag\_Name**

name of the tag

**Return value**

The value of the tag in the data type "signed char"

**See also**

GetTagSByte example (Page 1552)

Functionality of the GetTag functions (Page 1409)



## GetTagSDWord

### Function

Determines the value of a tag of data type "signed 32 bit".

### Syntax

```
long GetTagSDWord(Tag Tag_Name);
```

### Parameters

#### Tag\_Name

name of the tag

### Return value

Value of the tag in the data type "long"

### See also

GetTagSByte example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagSWord

### Function

Determines the value of a tag of data type "signed 16 bit".

### Syntax

```
short GetTagSWord(Tag Tag_Name);
```

### Parameters

#### Tag\_Name

name of the tag

### Return value

Value of the tag in the data type "short"

## See also

GetTagSByte example (Page 1552)

Functionality of the GetTag functions (Page 1409)

## GetTagValue

### Function

Enables the transfer of a value in the form of a variant. Establishes the pointer to the result structure containing the value.

### Syntax

```
BOOL GetTagValue(LPDM_VARKEY lpdmVarKey, LPDM_VAR_UPDATE_STRUCT  
lpdmresult, LPCMN_ERROR lpdmError);
```

### Parameters

#### **lpdmVarKey**

Pointer to a structure of the data type "DM\_VARKEY"

#### **lpdmresult**

Pointer to the value from data type "DM\_VAR\_UPDATE\_STRUCT"

#### **lpdmError**

Pointer to the structure which contains the error description

### Return value

#### **TRUE**

The function has been completed without any errors.

#### **FALSE**

An error has occurred.

## See also

Structure definition CMN\_ERROR (Page 1601)

Structure definition DM\_VAR\_UPDATE\_STRUCT (Page 1603)

Structure definition DM\_VARKEY (Page 1605)

Functionality of the GetTag functions (Page 1409)

## GetTagWord

### Function

Determines the value of a tag of data type "unsigned 16 bit".

### Syntax

```
WORD GetTagWord(Tag Tag_Name);
```

### Parameters

#### **Tag\_Name**

name of the tag

### Return value

Value of the tag in the data type "WORD"

### See also

GetTagWord example (Page 1553)

Functionality of the GetTag functions (Page 1409)

### set

## Principle of the SetTag functions

### SetTagXXX

The SetTagXXX function assigns the job a value to write and returns immediately to the caller. In this case, the system does not wait until value is actually written.

The call is marked by the following:

- The call is fast.
- The caller does not know when the value is actually written.
- The function provides no information on the state of the write job.

### SetTagXXXWait

The function SetTagXXXWait assigns the job of writing a value and will first return to the caller when the value has actually been written.

The call is marked by the following:

- The call takes longer in comparison to SetTagXXX. The duration is also dependent on the channel and AS, amongst other things.
- The value is written after the call.
- The function provides no information on the state of the write job.

### **SetTagXXXState**

The function SetTagXXXState has the same features as SetTagXXX; plus the function returns information regarding the status of the write request.

Since the status is always provided internally, there is no performance difference compared to SetTagXXX.

### **SetTagXXXStateWait**

The function SetTagXXXStateWait has the same features as SetTagXXXWait; plus the function returns information regarding the status of the write request.

Since the status is always provided internally, there is no performance difference compared to SetTagXXXWait.

The difference between the functions SetTagXXXStateWait and SetTagXXXState corresponds to the difference between SetTagXXXWait and SetTagXXX.

Note, that certain statuses can only be generated when the write process has been completed.

### **SetTagMultiWait**

The SetTagMultiWait function has the same features as SetTagXXXWait. It also offers the option of granting several write jobs in a single job.

**state**

**wait**

### **SetTagBitStateWait**

#### **Function**

Sets the value of a tag of data type "Binary tag". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

**Syntax**

```
BOOL SetTagBitStateWait(Tag Tag_Name, short value, PDWORD lp_dwstate);
```

**Parameters****Tag\_Name**

name of the tag

**value**

Value of the tag in the data type "short"

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value****TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

Beispiel SetTagBitStateWait (Page 1570)

**SetTagByteStateWait****Function**

Sets the value of a tag of the data type "unsigned 8 Bit". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

**Syntax**

```
BOOL SetTagByteStateWait(Tag Tag_Name, BYTE value, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### value

Value of the tag in the data type "BYTE"

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

Beispiel SetTagWordStateWait (Page 1577)

## SetTagCharStateWait

## Function

Sets the value of a tag of the data type "8-bit text tag" or "16-bit text tag". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

## Syntax

```
BOOL SetTagCharStateWait(Tag Tag_Name, LPSTR value, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

**value**

Value of the tag in the data type "LPSTR"

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value****TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

SetTagCharStateWait example (Page 1571)

**SetTagDoubleStateWait****Function**

Defines the value of a tag of the data type "64-bit floating point value". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

**Syntax**

```
BOOL SetTagDoubleStateWait(Tag Tag_Name, double value, PDWORD lp_dwstate);
```

**Parameters****Tag\_Name**

name of the tag

**value**

Value of the tag in the data type "double"

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value**

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

SetTagFloatStateWait example (Page 1572)

**SetTagDWordStateWait**

**Function**

Sets the value of a tag of the data type "unsigned 32 Bit". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

**Syntax**

```
BOOL SetTagDWordStateWait(Tag Tag_Name, DWORD value, PDWORD lp_dwstate);
```

**Parameters**

**Tag\_Name**

name of the tag

**value**

Value of the tag in the data type "DWORD"

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.



## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

Beispiel SetTagWordStateWait (Page 1577)

## SetTagFloatStateWait

### Function

Defines the value of a tag of the data type "32-bit floating point value". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

### Syntax

```
BOOL SetTagFloatStateWait(Tag Tag_Name, float value, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "float"

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

SetTagFloatStateWait example (Page 1572)

**SetTagMultiStateWait**

**Function**

Sets the values of several tags. The function is ended after the AS has acknowledged acceptance of the value.

The function must transfer a DWORD array whose members contain the individual tag states after the function is invoked. The size of the array must be selected so that sufficient memory space is available for these statuses.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

**Syntax**

BOOL SetTagMultiStateWait(DWORD\* pdwState, const char\* pFormat,...)

**Parameters**

**pdwState**

Field in which the tag statuses are stored.

**pFormat**

Format description for all requested tags and for each tag name and value.

FormatdescriberEXAMPLES\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

**Return value**

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

**FALSE**

An error has occurred.

## See also

Tag statuses (Page 1598)

SetTagMultiStateWait example (Page 1573)

## SetTagRawStateWait

### Function

Sets the value of a tag of the data type "Raw data type". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

### Syntax

```
BOOL SetTagRawStateWait(Tag Tag_Name, BYTE pValue, DWORD size, PDWORD  
lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### pValue

The pointer to a byte field which contains the value of the raw data tag

#### size

Size of the byte field in bytes

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

#### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

SetTagRawStateWait example (Page 1575)

## SetTagSByteStateWait

### Function

Sets the value of a tag of the data type "signed 8 bit". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

### Syntax

```
BOOL SetTagSByteStateWait(Tag Tag_Name, signed char value, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

The value of the tag in the data type "signed char"

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

#### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

Beispiel SetTagSByteStateWait (Page 1576)

## SetTagSDWordStateWait

### Function

Sets the value of a tag of the data type "signed 32 bit". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

### Syntax

```
BOOL SetTagSDWordStateWait(Tag Tag_Name, long value, PDWORD lp_dwstate);
```

### Parameters

**Tag\_Name**

name of the tag

**value**

Value of the tag in the data type "long"

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

**FALSE**

An error has occurred.

### See also

Tag statuses (Page 1598)

Beispiel SetTagSByteStateWait (Page 1576)

## SetTagSWordStateWait

### Function

Sets the value of a tag of the data type "signed 16 bit". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

### Syntax

```
BOOL SetTagSWordStateWait(Tag Tag_Name, short value, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "short"

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

#### FALSE

An error has occurred.

### See also

Tag statuses (Page 1598)

Beispiel SetTagSByteStateWait (Page 1576)

## SetTagWordStateWait

### Function

Sets the value of a tag of the data type "unsigned 16 Bit". The function is ended after the AS has acknowledged acceptance of the value. The status of the tag is also returned.

Principle of the SetTag

functionsEXAMPLE\_INTERNAL\_FUNCTIONS\_TAG\_STATEWAIT\_23\_130

### Syntax

```
BOOL SetTagWordStateWait(Tag Tag_Name, WORD value, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "WORD"

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. To do this, the tag status must be evaluated.

#### FALSE

An error has occurred.

### See also

Tag statuses (Page 1598)

Beispiel SetTagWordStateWait (Page 1577)

## SetTagBitState

### Function

Sets the value of a tag of data type "Binary tag". The status of the tag is also returned.

### Syntax

```
BOOL SetTagBitState(Tag Tag_Name, short int value, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "short int"

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

#### FALSE

An error has occurred.

### See also

Tag statuses (Page 1598)

Beispiel SetTagBitStateWait (Page 1570)

Principle of the SetTag functions (Page 1467)

## SetTagByteState

### Function

Sets the value of a tag of the data type "unsigned 8 Bit". The status of the tag is also returned.



## Syntax

```
BOOL SetTagByteState(Tag Tag_Name, BYTE value, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### value

Value of the tag in the data type "BYTE"

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

Beispiel SetTagWordStateWait (Page 1577)

Principle of the SetTag functions (Page 1467)

## SetTagCharState

## Function

Sets the value of a tag of the data type " 8-bit text tag" or "16-bit text tag". The status of the tag is also returned.

## Syntax

```
BOOL SetTagCharState(Tag Tag_Name, LPSTR value, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### value

Value of the tag in the data type "LPSTR"

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

SetTagCharStateWait example (Page 1571)

Principle of the SetTag functions (Page 1467)

## SetTagDoubleState

### Function

Defines the value of a tag of the data type "64-bit floating point value". The status of the tag is also returned.

### Syntax

```
BOOL SetTagDoubleState(Tag Tag_Name, double value, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

**value**

Value of the tag in the data type "double"

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value**

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

SetTagFloatStateWait example (Page 1572)

Principle of the SetTag functions (Page 1467)

**SetTagDWordState**

**Function**

Sets the value of a tag of the data type "unsigned 32 Bit". The status of the tag is also returned.

**Syntax**

BOOL SetTagDWordState(Tag Tag\_Name, DWORD value, PDWORD lp\_dwstate);

**Parameters**

**Tag\_Name**

name of the tag

**value**

Value of the tag in the data type "DWORD"

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

Beispiel SetTagWordStateWait (Page 1577)

Principle of the SetTag functions (Page 1467)

## SetTagFloatState

### Function

Defines the value of a tag of the data type "32-bit floating point value". The status of the tag is also returned.

### Syntax

```
BOOL SetTagFloatState(Tag Tag_Name, float value, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "float"

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

SetTagFloatStateWait example (Page 1572)

Principle of the SetTag functions (Page 1467)

**SetTagRawState****Function**

Sets the value of a tag of the data type "Raw data type". The status of the tag is also returned.

**Syntax**

```
BOOL SetTagRawState(Tag Tag_Name, BYTE* pValue, DWORD size, PDWORD  
lp_dwstate);
```

**Parameters****Tag\_Name**

name of the tag

**pValue**

The pointer to a byte field which contains the value of the raw data tag

**size**

Size of the byte field in bytes

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value****TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

**FALSE**

An error has occurred.

**See also**

Tag statuses (Page 1598)

GetTagRaw example (Page 1550)

Principle of the SetTag functions (Page 1467)

**SetTagSByteState**

**Function**

Sets the value of a tag of the data type "signed 8 bit". The status of the tag is also returned.

**Syntax**

```
BOOL SetTagSByteState(Tag Tag_Name, signed char value, PDWORD lp_dwstate);
```

**Parameters**

**Tag\_Name**

name of the tag

**value**

The value of the tag in the data type "signed char"

**lp\_dwstate**

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

**Return value**

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

**FALSE**

An error has occurred.

## See also

Tag statuses (Page 1598)  
Beispiel SetTagSByteStateWait (Page 1576)  
Principle of the SetTag functions (Page 1467)

## SetTagSDWordState

### Function

Sets the value of a tag of the data type "signed 32 bit". The status of the tag is also returned.

### Syntax

```
BOOL SetTagSDWordState(Tag Tag_Name, long value, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "long"

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

#### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)  
Beispiel SetTagSByteStateWait (Page 1576)  
Principle of the SetTag functions (Page 1467)

## SetTagSWordState

### Function

Sets the value of a tag of the data type "signed 16 bit". The status of the tag is also returned.

### Syntax

```
BOOL SetTagSWordState(Tag Tag_Name, short value, PDWORD lp_dwstate);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "short"

#### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

#### FALSE

An error has occurred.

### See also

Tag statuses (Page 1598)

Beispiel SetTagSByteStateWait (Page 1576)

Principle of the SetTag functions (Page 1467)

## SetTagWordState

### Function

Sets the value of a tag of the data type "unsigned 16 Bit". The status of the tag is also returned.



## Syntax

```
BOOL SetTagWordState(Tag Tag_Name, WORD value, PDWORD lp_dwstate);
```

## Parameters

### Tag\_Name

name of the tag

### value

Value of the tag in the data type "short"

### lp\_dwstate

Pointer to a DWORD in which the status of the tag is stored after the function has been completed.

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors. For this purpose, the tag status must be evaluated.

### FALSE

An error has occurred.

## See also

Tag statuses (Page 1598)

Beispiel SetTagWordStateWait (Page 1577)

Principle of the SetTag functions (Page 1467)

## wait

## SetTagBitWait

## Function

Sets the value of a tag of data type "Binary tag". The function is ended after the AS has acknowledged acceptance of the value.

## Syntax

```
BOOL SetTagBitWait(Tag Tag_Name, short value);
```

## Parameter

### Tag\_Name

Name of the tag

### Value

Value of the tag in the data type "short"

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

SetTagBit example (Page 1570)

Principle of the SetTag functions (Page 1467)

## SetTagByteWait

### Function

Sets the value of a tag of the data type "unsigned 8 Bit". The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagByteWait(Tag Tag_Name, BYTE value);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "BYTE"

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

SetTagWord example (Page 1577)

Principle of the SetTag functions (Page 1467)

## SetTagCharWait

### Function

Sets the value of a tag of the data type "8-bit text tag" or "16-bit text tag". The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagCharWait(Tag Tag_Name, LPSTR value);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "LPSTR"

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

Principle of the SetTag functions (Page 1467)

SetTagChar example (Page 1570)

## SetTagDoubleWait

### Function

Defines the value of a tag of the data type "64-bit floating point value". The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagDoubleWait(Tag Tag_Name, double value);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "double"

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

#### FALSE

An error has occurred.

## See also

SetTagFloat example (Page 1571)

Principle of the SetTag functions (Page 1467)

## SetTagDWordWait

### Function

Sets the value of a tag of the data type "unsigned 32 Bit". The function is ended after the AS has acknowledged acceptance of the value.

## Syntax

```
BOOL SetTagDWordWait(Tag Tag_Name, DWORD value);
```

## Parameters

### Tag\_Name

name of the tag

### value

Value of the tag in the data type "DWORD"

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

SetTagWord example (Page 1577)

Principle of the SetTag functions (Page 1467)

## SetTagFloatWait

## Function

Defines the value of a tag of the data type "32-bit floating point value". The function is ended after the AS has acknowledged acceptance of the value.

## Syntax

```
BOOL SetTagFloatWait(Tag Tag_Name, float value);
```

## Parameters

### Tag\_Name

name of the tag

### value

Value of the tag in the data type "float"

## Return value

### **TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### **FALSE**

An error has occurred.

## See also

SetTagFloat example (Page 1571)

Principle of the SetTag functions (Page 1467)

## SetTagMultiWait

### Function

The values of several tags are set in the specified format. The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagMultiWait(const char* pFormat,...)
```

### Parameters

#### **pFormat**

Format description for all requested tags and for each tag name and value.

## Return value

### **TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### **FALSE**

An error has occurred.

## See also

Format descriptors (Page 1593)  
SetTagMultiWait example (Page 1574)  
Principle of the SetTag functions (Page 1467)

## SetTagRawWait

### Function

Sets the value of a tag of the data type "Raw data type". The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagRawWait(Tag Tag_Name, BYTE pValue, DWORD size);
```

### Parameters

#### Tag\_Name

name of the tag

#### pValue

The pointer to a byte field which contains the value of the raw data tag

#### size

Size of the byte field in bytes

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

#### FALSE

An error has occurred.

## See also

SetTagRaw example (Page 1574)  
Principle of the SetTag functions (Page 1467)

## SetTagSByteWait

### Function

Sets the value of a tag of the data type "signed 8 bit". The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagSByteWait(Tag Tag_Name, signed char value);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

The value of the tag in the data type "signed char"

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

#### FALSE

An error has occurred.

### See also

SetTagSByte example (Page 1576)

Principle of the SetTag functions (Page 1467)

## SetTagSDWordWait

### Function

Sets the value of a tag of the data type "signed 32 bit". The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagSDWordWait(Tag Tag_Name, long value);
```



## Parameters

### **Tag\_Name**

name of the tag

### **value**

Value of the tag in the data type "long"

## Return value

### **TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### **FALSE**

An error has occurred.

## See also

Principle of the SetTag functions (Page 1467)

SetTagSByte example (Page 1576)

## SetTagSWordWait

## Function

Sets the value of a tag of the data type "signed 16 bit". The function is ended after the AS has acknowledged acceptance of the value.

## Syntax

```
BOOL SetTagSWordWait(Tag Tag_Name, short value);
```

## Parameters

### **Tag\_Name**

name of the tag

### **value**

Value of the tag in the data type "short"

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

SetTagSByte example (Page 1576)

Principle of the SetTag functions (Page 1467)

## SetTagValueWait

### Function

Enables the transfer of a value in the form of a variant and sets the pointer to the value of the data type "Variant". The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagValueWait(LPDM_VARKEY lpdmVarKey, LPVARIANT lpdmValue, PDWORD dwState, LPCMN_ERROR lpdmError);
```

### Parameters

#### lpdmVarKey

Pointer to a structure of the data type "DM\_VARKEY"

#### lpdmValue

Pointer to the value of data type "Variant". A description of the data type VARIANT can be found in the associated documentation.

#### dwState

Tag status which is returned after the function has been run.

#### lpdmError

Pointer to the structure which contains the error description

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

Structure definition CMN\_ERROR (Page 1601)

Tag statuses (Page 1598)

Structure definition DM\_VAR\_UPDATE\_STRUCT (Page 1603)

Structure definition DM\_VARKEY (Page 1605)

Principle of the SetTag functions (Page 1467)

## SetTagWordWait

### Function

Sets the value of a tag of the data type "unsigned 16 Bit". The function is ended after the AS has acknowledged acceptance of the value.

### Syntax

```
BOOL SetTagWordWait(Tag Tag_Name, WORD value);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "WORD"

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

**FALSE**

An error has occurred.

**See also**

SetTagWord example (Page 1577)

Principle of the SetTag functions (Page 1467)

**SetTagBit**

**Function**

Sets the value of a tag of data type "Binary tag".

**Syntax**

```
BOOL SetTagBit(Tag Tag_Name, short int value);
```

**Parameters**

**Tag\_Name**

name of the tag

**value**

Value of the tag in the data type "short int"

**Return value**

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

**FALSE**

An error has occurred.

**See also**

Principle of the SetTag functions (Page 1467)

SetTagBit example (Page 1570)

## SetTagByte

### Function

Sets the value of a tag of the data type "unsigned 8 Bit".

### Syntax

```
BOOL SetTagByte(Tag Tag_Name, BYTE value);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "BYTE"

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

#### FALSE

An error has occurred.

### See also

SetTagWord example (Page 1577)

Principle of the SetTag functions (Page 1467)

## SetTagChar

### Function

Sets the value of a tag of the data type " 8-bit text tag" or "16-bit text tag".

### Parameter

#### Tag\_Name

Name of the tag

**Value**

Value of the tag in the data type "LPSTR"

**Return value**

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

**FALSE**

An error has occurred.

**See also**

SetTagChar example (Page 1570)

Principle of the SetTag functions (Page 1467)

**SetTagDateTime**

**Function**

Sets the value of a tag of data type "Date/Time".

**Syntax**

```
BOOL SetTagDateTime(Tag Tag_Name, SYSTEMTIME value);
```

**Parameter**

**Tag\_Name**

Name of the tag

**value**

Value of the tag in the data type "Date/Time".

**Return value**

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

**FALSE**

An error has occurred.

## SetTagDouble

### Function

Defines the value of a tag of the data type "64-bit floating point value".

### Syntax

```
BOOL SetTagDouble(Tag Tag_Name, double value);
```

### Parameters

#### **Tag\_Name**

name of the tag

#### **value**

Value of the tag in the data type "double"

### Return value

#### **TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

#### **FALSE**

An error has occurred.

### See also

SetTagFloat example (Page 1571)

Principle of the SetTag functions (Page 1467)

## SetTagDWord

### Function

Sets the value of a tag of the data type "unsigned 32 Bit".

### Syntax

```
BOOL SetTagDWord(Tag Tag_Name, DWORD value);
```

## Parameters

### **Tag\_Name**

name of the tag

### **value**

Value of the tag in the data type "DWORD"

## Return value

### **TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### **FALSE**

An error has occurred.

## See also

SetTagWord example (Page 1577)

Principle of the SetTag functions (Page 1467)

## SetTagFloat

## Function

Defines the value of a tag of the data type "32-bit floating point value".

## Syntax

```
BOOL SetTagFloat(Tag Tag_Name, float value);
```

## Parameters

### **Tag\_Name**

name of the tag

### **value**

Value of the tag in the data type "float"



## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

SetTagFloat example (Page 1571)

Principle of the SetTag functions (Page 1467)

## SetTagRaw

### Function

Sets the value of a tag of the data type "Raw data type".

### Syntax

```
BOOL SetTagRaw(Tag Tag_Name, BYTE* pValue, DWORD size);
```

### Parameters

#### Tag\_Name

name of the tag

#### pValue

The pointer to a byte field which contains the value of the raw data tag

#### size

Size of the byte field in bytes

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

SetTagRaw example (Page 1574)

Principle of the SetTag functions (Page 1467)

## SetTagSByte

### Function

Sets the value of a tag of the data type "signed 8 bit".

### Syntax

```
BOOL SetTagSByte(Tag Tag_Name, signed char value);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

The value of the tag in the data type "signed char"

### Return value

#### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

#### FALSE

An error has occurred.

## See also

SetTagSByte example (Page 1576)

Principle of the SetTag functions (Page 1467)

## SetTagSDWord

### Function

Sets the value of a tag of the data type "signed 32 bit".

## Syntax

```
BOOL SetTagSDWord(Tag Tag_Name, long value);
```

## Parameters

### Tag\_Name

name of the tag

### value

Value of the tag in the data type "long"

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

SetTagSByte example (Page 1576)

Principle of the SetTag functions (Page 1467)

## SetTagSWord

## Function

Sets the value of a tag of the data type "signed 16 bit".

## Syntax

```
BOOL SetTagSWord(Tag Tag_Name, short value);
```

## Parameters

### Tag\_Name

name of the tag

### value

Value of the tag in the data type "short"

**size**

Size of the byte field in bytes

**Return value**

**TRUE**

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

**FALSE**

An error has occurred.

**See also**

SetTagSByte example (Page 1576)

Principle of the SetTag functions (Page 1467)

**SetTagValue**

**Function**

Enables the transfer of a value in the form of a variant and sets the pointer to the value of the data type "Variant".

**Syntax**

```
BOOL SetTagValue(LPDM_VARKEY lpdmVarKey, LPVARIANT lpdmValue, PDWORD  
dwState, LPCMN_ERROR lpdmError);
```

**Parameters**

**lpdmVarKey**

Pointer to a structure of the data type "DM\_VARKEY"

**lpdmValue**

Pointer to the value of data type "Variant". A description of the data type VARIANT can be found in the associated documentation.

**dwState**

Tag status which is returned after the function has been run.

**lpdmError**

Pointer to the structure which contains the error description

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

Principle of the SetTag functions (Page 1467)

Structure definition CMN\_ERROR (Page 1601)

Tag statuses (Page 1598)

Structure definition DM\_VAR\_UPDATE\_STRUCT (Page 1603)

Structure definition DM\_VARKEY (Page 1605)

## SetTagWord

### Function

Sets the value of a tag of the data type "unsigned 16 Bit".

### Syntax

```
BOOL SetTagWord(Tag Tag_Name, WORD value);
```

### Parameters

#### Tag\_Name

name of the tag

#### value

Value of the tag in the data type "WORD"

## Return value

### TRUE

The function itself has been completed without any errors.

However, no test is made as to whether the tag could be written without errors.

### FALSE

An error has occurred.

## See also

SetTagWord example (Page 1577)

Principle of the SetTag functions (Page 1467)

### 2.15.3.6 WinCC

#### WinCC - short description

The functions of the WinCC group allow to define various setting in Runtime.

The functions of the System subgroup can be used to influence WinCC Runtime.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

## system

### DeactivateRTProject

#### Function

Deactivates the activated project.

---

#### Note

If Runtime is exited on a server or client this applies only to the respective computer.

An activated project for which the WinCC Explorer has not been started must be closed with the internal function "ExitWinCC".

If the activated project was exited with the internal function "DeactivateRTProject" the WinCC project remains open in the background. To close this project, the WinCC Explorer must be opened and then be closed by means of the menu commands "File" > "Exit".

---

#### Syntax

```
BOOL DeactivateRTProject();
```

#### Return value

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

DeactivateRTProject example (Page 1517)

**ExitWinCC**

**Function**

Deactivates Runtime and exits WinCC on the computer executing the function.

---

**Note**

If Runtime is exited on a server or client this applies only to the respective computer.

An activated project for which the WinCC Explorer has not been started must be closed with the internal function "ExitWinCC".

If the activated project was exited with the internal function "DeactivateRTProject" the WinCC project remains open in the background. To close this project, the WinCC Explorer must be opened and then be closed by means of the menu commands "File" > "Exit".

---

**Syntax**

```
BOOL ExitWinCC ();
```

**Return value**

**TRUE**

The function has been completed without any errors.

**FALSE**

An error has occurred.

**See also**

ExitWinCC example (Page 1517)

## GetLanguage

### Function

Determines the current Runtime language.

### Syntax

```
DWORD GetLanguage();
```

### Return value

The current Runtime language with the associated language identifier is returned.

---

#### Note

You can find a comprehensive "Language code" table in the "Basic Principles of VBScript" documentation under the index entry "Language code".

---

### See also

GetLanguage example (Page 1525)

## InquireLanguage

### Function

Determines all languages configured in the text library for the runtime.

Use dwCount to specify where the number of determined language IDs is to be stored.

### Syntax

```
DWORD* InquireLanguage(DWORD* dwCount);
```

### Parameters

#### dwCount

Pointer to the number of determined language IDs



## Return value

The configured languages with the associated language identifiers are returned.

---

### Note

You can find a comprehensive "Language code" table in the "Basic Principles of VBScript" documentation under the index entry "Language code".

---

## See also

InquireLanguage example (Page 1557)

## SetLanguage

### Function

Changes the language setting in Runtime.

### Syntax

```
BOOL SetLanguage(DWORD dwLocaleID);
```

### Parameters

#### dwLocaleID

Language ID of the language to be set

### Return value

#### TRUE

The function has been completed without any errors.

#### FALSE

An error has occurred.

## See also

Language ID (Page 1596)

SetLanguage example (Page 1565)

## FillDiagnoseInTags

### Function

Activates or deactivates the storage of diagnostic information in tags.

As filling the tags is an additional load for the system, it should only be activated temporarily for diagnostic information.

### Syntax

```
void FillDiagnoseInTags(BOOL bfill);
```

### Parameters

#### **bFill**

Storage of diagnostic information in tags on/off

TRUE    Activate supply of diagnostic tags  
FALSE   Deactivate supply of diagnostic tags

### Diagnostic tags of GlobalScript

@SCRIPT\_COUNT\_TAGS

This tag contains the current number of tags requested via Script.

@SCRIPT\_COUNT\_REQUEST\_IN\_QUEUES

This tag contains the current number of jobs.

@SCRIPT\_COUNT\_ACTIONS\_IN\_QUEUES

This tag contains the current number of actions.

## GetServerTagPrefix

### Function

To be able to access tags of the respective server from a WinCC client in a distributed system, the tag names must be supplemented with the server prefix.

If the tags are accessed by means of the functions GetTagxx or SetTagxx, the required addition is made by the script control.

If WinCC API functions are used for accessing, the tag names have to be supplemented by the user. The GetServer TagPrefix function provides the required prefixes.

One pointer each of the "char" type to ServerPrefix, TagPrefix and WindowPrefix is returned.

The user must neither change the memory (also no strcat) nor release it.

## Syntax

```
void GetServerTagPrefix(char** ppszServerPrefix, char** ppszTagPrefix, char**  
ppszWindowPrefix);
```

## Parameters

### **ppszServerPrefix**

Pointer to a pointer referring to the server prefix

### **ppszTagPrefix**

Pointer to a pointer referring to the tag prefix

### **ppszWindowPrefix**

Pointer to a pointer referring to the window prefix

## See also

GetServerTagPrefix example (Page 1538)

## TraceText

## Function

The value defined in <Parameter> is recorded in APDiag if the specified diagnostic level has been reached.

## Syntax

```
void TraceText(DWORD dwTraceLevel, char* pszFormat, <Parameter>);
```

## Parameters

### **dwTraceLevel**

Diagnostic level

### **pszFormat**

Output format (according to printf function)

**<Parameter>**

Value to be reported

---

**Note**

The parameterization dialog for this function provides the selection of tags, graphic objects and pictures.

---

**TraceTime**

**Function**

The value defined in <Parameter> is recorded in APDiag if the specified diagnostic level has been reached.

In addition, the time since the AP start of diagnosis is output in milliseconds to enable performance measurements.

**Syntax**

```
void TraceTime(DWORD dwTraceLevel, char* pszFormat, <Parameter>);
```

**Parameters**

**dwTraceLevel**

Diagnostic level

**pszFormat**

Output format (according to printf function)

**<Parameter>**

Value to be reported

---

**Note**

The parameterization dialog for this function provides the selection of tags, graphic objects and pictures.

---

## 2.15.4 Examples

### 2.15.4.1 Examples - A to G

#### AcknowledgeMessage example

```
{  
//Acknowledge the AlarmLogging message which is selected  
AcknowledgeMessage(GetTagWord("U08i_MsgNr"));  
}
```

Specify the message number to be acknowledged. It is read from a tag.

#### DeactivateRTProject example

```
{  
//deactivate the runtime  
DeactivateRTProject ();  
}
```

This function deactivates WinCC Runtime.

#### ExitWinCC example

```
{  
//exit wincc  
ExitWinCC ();  
}
```

This function exits WinCC.

### 2.15.4.2 Examples - GetAlarmHigh to GetPropChar

#### GetAlarmHigh example

```
{
double dAlarmHigh;
//Get the Alarm High Limit
dAlarmHigh = GetAlarmHigh(lpszPictureName, "Bar1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the function GetAlarmHigh:

"lpszPictureName" is the name of the picture in which the object was configured.

"Bar1" is the name of the object.

1. Read out the upper alarm limit and temporarily store it in dAlarmHigh.
2. Executing user-defined code for processing return values.

#### GetBackColor example

```
{
long int bk_color;

//Get the background color
bk_color = GetBackColor(lpszPictureName, "StatischerText1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the function GetBackColor:

"lpszPictureName" is the name of the picture in which the object was configured.

"StaticText1" is the name of the object.

1. Read out the current background color and temporarily store it in bk\_color.
2. Executing user-defined code for processing return values.

## GetBorderStyle example

```
{
long int lstyle;

//Get the current border style
lstyle = GetBorderStyle(lpszPictureName,"Rectangle1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the function GetBorderStyle:

"lpszPictureName" is the name of the picture in which the object was configured.

"Rectangle1" is the name of the object.

1. Read out the current line style of the object and temporarily store it in lstyle.
2. Executing user-defined code for processing return values.

## GetFilling example

```
{
BOOL bfilling;

//Get the actual state of dynamic filling
bfilling = GetFilling(lpszPictureName,"Rectangle1");

if(bfilling)
{
// User defined code if the
// dynamic filling is activated
...
}
Else
{
// User defined code if the
// dynamic filling is deactivated
...
}
}
```

Parameters of the function GetFilling:

"lpszPictureName" is the name of the picture in which the object was configured.

## 2.15 ANSI-C function descriptions

"Rectangle1" is the name of the object.

1. Read out whether dynamic filling is activated or not and temporary store in bfilling.
2. Executing user-defined code, depending on the return value of the function.

### GetFillingIndex example

```
{
long int filling_index;

//Get the actual filling index of the object
filling_index = GetFillingIndex(lpszPictureName, "Rectangle1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the function GetFillingIndex:

"lpszPictureName" is the name of the picture in which the object was configured.

"Rectangle1" is the name of the object.

1. Read out the current fill level of the object and temporarily store it in filling\_index.
2. Executing user-defined code for processing return values.

### GetFillStyle example

```
{
long int lstyle;

//Get the current fill style
lstyle = GetFillStyle(lpszPictureName, "Rectangle1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the function GetFillStyle:

"lpszPictureName" is the name of the picture in which the object was configured.

"Rectangle1" is the name of the object.



1. Read out the current fill pattern of the object and temporarily store it in lstyle.
2. Executing user-defined code for processing return values.

### GetFlashBackColor example

```
{
BOOL bflash_col;

//Get if the flashing is on or off
bflash_col = GetFlashBackColor(lpszPictureName,"Group1");

if(bflash_col)
{
    // User defined code if the
    // flashing is activated
    ...
}
Else
{
    // User defined code if the
    // flashing is deactivated
    ...
}
}
```

Parameters of the function GetFlashBackColor:

"lpszPictureName" is the name of the picture in which the object was configured.

"Group1" is the name of the object.

1. Read out whether flashing of the background color is activated or not and temporary store in bflash\_col.
2. Executing user-defined code, depending on the return value of the function.

### GetFlashBackColorOn example

```
{
long int flashcol_on;

//Get the BackFlashColor
flashcol_on = GetBackFlashColorOn(lpszPictureName,"Group1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetBackFlashColorOn function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Group1" is the name of the object.

1. Read out the background flash color for the "On" status of the object and temporarily store it in flashcol\_on.
2. Executing user-defined code for processing return values.

### GetFlashRateFlashPic example

```
{
long lFlashRate;

//Get the flashrate
lFlashRate = GetFlashRateFlashPic(lpszPictureName, "StatusDisplay1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetFlashRateFlashPic function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Status display1" is the name of the object.

1. Read out the flash frequency of the object and temporarily store it in lFlashRate.
2. Executing user-defined code for processing return values.

## GetFocus example

```
{
char* pszValue = NULL;
char szValue[_MAX_PATH+1];

//Get the Object which has the focus
pszValue = Get_Focus();

//Copy the string
if(pszValue != NULL)
{
    strncpy(szValue,pszValue,_MAX_PATH);
}
//User defined code where the
//user can do something with the return value
...
}
```

1. Read out on which object the focus is and temporarily store in pszValue.
2. If a valid value has been returned, store the return value of the function in the local string szValue. A maximum of \_MAX\_PATH characters is stored.
3. Executing user-defined code for processing return values.

## GetFontBold example

```
{
BOOL bbold;

//Get if the text is bold
bbold = GetFontBold(lpszPictureName,"StaticText1");

if(bbold)
{
    // User defined code if the
    // font is bold
    ...
}
Else
{
    // User defined code if the
    // font is not bold
    ...
}
}
```

### Parameters of the GetBackColor function

## 2.15 ANSI-C function descriptions

"lpszPictureName" is the name of the picture in which the object was configured.

"StaticText1" is the name of the object.

1. Read out whether the text is in bold or not and temporarily store in `bbold`.
2. Executing user-defined code, depending on the return value of the function.

### GetFontSize example

```
{
long int fontsize;

//Get the actual Font size
fontsize = GetFontSize(lpszPictureName,"StaticText1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the `GetFontSize` function:

"lpszPictureName" is the name of the picture in which the object was configured.

"StaticText1" is the name of the object.

1. Read out the current font size and temporarily store it in `fontsize`.
2. Executing user-defined code for processing return values.

### GetHeight example

```
{
long lHeight;

//Get the height of the object
lHeight = GetHeight(lpszPictureName,"WinCCLogo");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the `GetHeight` function:

"lpszPictureName" is the name of the picture in which the object was configured.

"WinCCLogo" is the name of the object.

1. Read out the current height of the object and temporarily store it in lHeight.
2. Executing user-defined code for processing return values.

### GetHiddenInput example

```
{
BOOL bHiddenInput;

//Get the state of hidden input
bHiddenInput = GetHiddenInput(lpszPictureName,"IOField1");

if(bHiddenInput)
{
    // User defined code if the
    // hidden input is activated
    ...
}
Else
{
    // User defined code if the
    // hidden input is activated
    ...
}
}
```

Parameters of the GetHiddenInput function:

"lpszPictureName" is the name of the picture in which the object was configured.

"IOField1" is the name of the object.

1. Read out whether the text is in bold or not and temporarily store in bHiddenInput.
2. Executing user-defined code, depending on the return value of the function.

### GetLanguage example

```
{
DWORD rt_language;

//Get the current language
rt_language = GetLanguage ();

//User defined code where the
//user can do something with the return value
...
}
```

1. Read out the current Runtime language and temporarily store it in `rt_language`.
2. Executing user-defined code for processing return values.

### GetLeft example

```
{
long lPos;

//Get the x-position of the object
lPos = GetLeft(lpszPictureName, "WinCCLogo");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the `GetLeft` function:

"`lpszPictureName`" is the name of the picture in which the object was configured.

"`WinCCLogo`" is the name of the object.

1. Read out the current X position of the object and temporarily store it in `lPos`.
2. Executing user-defined code for processing return values.

### GetLink example

```
{
LINKINFO linkinfo;

//Get the linked Tag
GetLink(lpszPictureName, "Bar1", "Process", &linkinfo);

// linkinfo.szLinkName is the tag name
// linkinfo.dwCycle is the update cycle
// linkinfo.LinkType is the type of the connection

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the `GetLink` function:

"`lpszPictureName`" is the name of the picture in which the object was configured.

"Bar1" is the name of the object.

"Process" is the property connected to a tag.

"&linkinfo" is the address of the linkinfo structure.

1. Fills the passed linkinfo structure with the tag connection information.
2. Executing user-defined code, depending on the return value of the function.

### GetLinkedVariable example

```
{
char* pszVarName = NULL;
char szVarName[_MAX_PATH+1];

//Get the TagName
pszVarName = GetLinkedVariable("gs_stand_graph_00","StaticText6","Visible");

//Copy the string
if (strcmp (pszVarName,"") != 0)
{
    strncpy(szVarName,pszVarName,_MAX_PATH);
}
else printf("Attribute 'visible' is not made dynamic\r\n");
}
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetLinkedVariable function:

"gs\_stand\_graph\_00" is the name of the picture in which the object was configured.

"StaticText6" is the name of the object.

"Visible" is the property connected to a tag.

1. Temporarily store the return value of the GetLinkedVariable function in pszVarName.
2. If a valid value has been returned, store the return value in szVarName. A maximum of \_MAX\_PATH characters is stored.
3. Executing user-defined code for processing return values.

### GetLocalPicture example

```
{
char* pszPicName = NULL;
char szPicName[_MAX_PATH+1];

//Get the Local Picture
pszPicName = GetLocalPicture(lpszPictureName);

//Copy the string
if (pszPicName != NULL)
{
    strncpy(szPicName,pszPicName,_MAX_PATH);
}
//User defined code where the
//user can do something with the return value
...
}
```

1. Temporarily store the return value of the GetLocalPicture function in pszPicName.
2. If a valid value has been returned, store the return value in szPicName. A maximum of \_MAX\_PATH characters is stored.
3. Executing user-defined code for processing return values.

### GetMarker example

```
{
BOOL bmarker;

//Get the state of the Marker
bmarker = GetMarker(lpszPictureName,"Bar1");

if(bmarker)
{
    // User defined code if the
    // marker is activated
    ...
}
Else
{
    // User defined code if the
    // marker is deactivated
    ...
}
}
```

Parameters of the GetMarker function:

"lpszPictureName" is the name of the picture in which the object was configured.



"Bar1" is the name of the object.

1. Read out whether the marker is displayed or not and temporarily store in bmarker.
2. Executing user-defined code, depending on the return value of the function.

### GetOutputValueDouble example

```
{
double doutput;

//Get the output value of IO Field 1
doutput = GetOutputValueDouble(lpszPictureName,"IOField1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetOutputValueDouble function:

"lpszPictureName" is the name of the picture in which the object was configured.

"IOField1" is the name of the object.

1. Read out the output value and temporarily store it in doutput.
2. Executing user-defined code for processing return values.

### GetParentPicture example

```
{
char* pszPicName = NULL;
char szPicName[_MAX_PATH+1];

//Get the parent picture
pszPicName = GetParentPicture(lpszPictureName);

//Copy the string
if (pszPicName != NULL)
{
    strncpy(szPicName,pszPicName,_MAX_PATH);
}
//User defined code where the
//user can do something with the return value
...
}
```

## 2.15 ANSI-C function descriptions

1. Temporarily store the return value of the GetParentPicture function in pszPicName.
2. If a valid value has been returned, store the return value in szPicName. A maximum of \_MAX\_PATH characters is stored.
3. Executing user-defined code for processing return values.

### GetPictureDown example

```
{
char* pszPicName = NULL;
char szPicName[_MAX_PATH+1];

//Get the current picture name
pszPicName = GetPictureDown(lpszPictureName, "Roundbutton1");

if (pszPicName != NULL)
{
//Copy the string
strncpy(szPicName, pszPicName, _MAX_PATH);
}

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetPictureDown function:

"lpszPictureName" is the name of the picture in which the object was configured.

"RoundButton1" is the name of the object.

1. Read out the picture name of the picture displayed in round button 1 and temporarily store it in pszPicName.
2. If a valid value has been returned, store the return value of the function in the local string szPicName. A maximum of \_MAX\_PATH characters is stored.
3. Executing user-defined code for processing return values.

## GetPictureName example

```
{
char* pszPictureName = NULL;
char szPictureName[_MAX_PATH + 1];

//Get the current PictureName
pszPictureName = GetPictureName(lpszPictureName, "GraphicObject1");

if(pszPictureName != NULL)
{
//copy the string
strncpy(szPictureName, pszPictureName, _MAX_PATH);
}
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetPictureName function:

"lpszPictureName" is the name of the picture in which the object was configured.

"GraphicObject1" is the name of the object.

1. Read out the picture name of the picture displayed in graphic object 1 and temporarily store it in pszPictureName.
2. If a valid value has been returned, store the return value of the function in the local string szPictureName. A maximum of \_MAX\_PATH characters is stored.
3. Executing user-defined code for processing return values.

### GetPictureUp example

```
{
char* pszPicName = NULL;
char szPicName[_MAX_PATH+1];

//Get the current picture name
pszPicName = GetPictureUp(lpszPictureName, "Roundbutton1");

if (pszPicName != NULL)
{
//Copy the string
strncpy(szPicName, pszPicName, _MAX_PATH);
}

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetPictureUp function:

"lpszPictureName" is the name of the picture in which the object was configured.

"RoundButton1" is the name of the object.

1. Read out the picture name of the picture displayed in round button 1 and temporarily store it in pszPicName.
2. If a valid value has been returned, store the return value of the function in the local string szPicName. A maximum of \_MAX\_PATH characters is stored.
3. Executing user-defined code for processing return values.

### GetPosition example

```
{
long int lpos;

//Get the actual position of the Slider
lpos = GetPosition(lpszPictureName, "Control1");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetPosition function:

"IpszPictureName" is the name of the picture in which the object was configured.

"Control1" is the name of the object.

1. Read out the current slider position and temporarily store it in Ipos.
2. Executing user-defined code for processing return values.

### GetPropBOOL example

```
{
BOOL bProp;

//Get the property Visible
bProp = GetPropBOOL("gs_graph_eafield","IOField1","Visible");

if(bProp)
{
    // User defined code if the
    // object is visible
    ...
}
else
{
    // User defined code if the
    // object is not visible
    ...
}
}
```

Parameters of the GetVisible function:

"IpszPictureName" is the name of the picture in which the object was configured.

"IOField1" is the name of the object.

"Visible" is the object property.

1. Read out whether the object is visible or not and temporarily store in bProp.
2. Executing user-defined code, depending on the return value of the function.

### GetPropChar example

```
{
char* pszProp = NULL;
char szProp[14];

//Get the property Tooltiptext
pszProp = GetPropChar("lpszPictureName","EAFeld1","Tooltiptext");

if(pszProp != NULL)
{
//Copy the string
strncpy(szProp,pszProp,13);
}
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetPropChar function:

"lpszPictureName" is the name of the picture in which the object was configured.

"IOField1" is the name of the object.

"Tooltiptext" is the object property.

1. Read out the tooltip text of the object and temporarily store it in pszProp.
2. If a valid value has been returned, store the return value of the function in the local string szProp. A maximum of 13 characters is stored.
3. Executing user-defined code for processing return values.

#### 2.15.4.3 Examples - GetRangeMax to GetWidth

### GetRangeMax example

```
{
long int lrange;

//Get the upper scale Limit
lrange = GetRangeMax(lpszPictureName,"Controll");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetRangeMax function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Control1" is the name of the object.

1. Read out the current upper limit of the object and temporarily store it in lrange.
2. Executing user-defined code for processing return values.

### GetRangeMin example

```
{  
long int lrange;  
  
//Get the lower scale Limit  
lrange = GetRangeMin(lpszPictureName,"Control1");  
  
//User defined code where the  
//user can do something with the return value  
...  
}
```

Parameters of the GetRangeMin function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Control1" is the name of the object.

1. Read out the current lower limit of the object and temporarily store it in lrange.
2. Executing user-defined code for processing return values.

## Beispiel GetScaling

```
{
BOOL bscaling;

//Get the Scaling state
bscaling = GetScaling(lpszPictureName,"Bar1");

if (bscaling)
{
    // User defined code if the
    // bar object has an additional scale
    ...
}
Else
{
    // User defined code if the
    // bar object has no additional scale
    ...
}
}
```

Parameters of the GetScaling function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Bar1" is the name of the object.

1. Read out whether the scale of the bar is displayed or not and temporarily store in bscaling.
2. Executing user-defined code, depending on the return value of the function.



## GetServerTagPrefix example

```
{
char* pszServerPrefix;
char* pszTagPrefix;
char* pszWindowPrefix;
int nServerPrefixLen = 0;
int nTagPrefixLen = 0;
int nTagLen = 0;
char myTagName[MAX_DM_VAR_NAME+1];

//Initialize the return value
memset(myTagName,0,MAX_DM_VAR_NAME + 1);

//Get the serverprefix the tagprefix and the windowprefix
GetServerTagPrefix(&pszServerPrefix, &pszTagPrefix, &pszWindowPrefix);

//If a serverprefix exists
if (pszServerPrefix)
{
//Get the length of the string
nServerPrefixLen = strlen(pszServerPrefix);
}
Else
{
printf("No server prefix was returned.");
return;
}

//If a tagprefix exists
if (pszTagPrefix)
{
//Get the length of the string
nTagPrefixLen = strlen(pszTagPrefix);
}

//Get the length of the tag
nTagLen = strlen("TagName");

//Check if the lenght of the
//ServerPrefix+TagPrefix+VarName + the double points < MAX_DM_VAR_NAME)
if (nServerPrefixLen + nTagPrefixLen + nTagLen+2 < MAX_DM_VAR_NAME)
{
sprintf(myTagName,"%s::%s%s",pszServerPrefix,pszTagPrefix,"TagName");
//User defined code where the
//user can do something with the return value
...
}
Else
{
printf("The resulting string is too long.");
return;
}
}
```

1. Initialize the myTagName tag.
2. Read out the server prefix, the tag prefix and the window prefix.
3. If no server prefix has been returned, a text ist output and the function is terminated.
4. If a server prefix has been returned, determine its length and temporarily store it in nServerPrefixLen.
5. If a tag prefix has been returned, determine its length and temporarily store it in TagPrefixLen.
6. Determine the length of the tag name and temporarily store it in nVarLen.
7. If the length permitted for tag names is exceeded a text is output and the function is terminated.
8. If the length permitted for tag names is not exceeded, the tag name required for a client environment is compiled.
9. Executing user-defined code for processing return values.

### GetServerTagPrefix example

```
{
char* pszServerPrefix;
char* pszTagPrefix;
char* pszWindowPrefix;

//Get the serverprefix and the tagprefix
GetServerTagPrefix(&pszServerPrefix, &pszTagPrefix, &pszWindowPrefix);
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetServerTagPrefix function:

- "pszServerPrefix" is the tag which is written into the server prefix.
- "pszTagPrefix" is the tag which is written into the tag prefix.
- "pszWindowrPrefix" is the tag which is written into the window prefix.

1. Read out the server prefix, the tag prefix and the window prefix.
2. The pszServerPrefix tag contains the returned server prefix.
3. The pszTagPrefix tag contains the returned tag prefix.
4. The pszWindowPrefix tag contains the returned window prefix.
5. Executing user-defined code for processing return values.

## GetTagBit example

```
{
BOOL bstate;

//Get the current state of the tag
bstate = GetTagBit("gs_tag_bit");

if(bstate)
{
    // User defined code if the
    // value of the tag is true
    ...
}
else
{
    // User defined code if the
    // value of the tag is false
    ...
}
}
```

### Parameters of the GetTagBit function

"gs\_tag\_bit" is the name of the tag.

1. Read out the value of the tag and temporarily store it in bstate.
2. Executing user-defined code, depending on the return value of the function.

### GetTagBitStateQC example

```
{
DWORD dwState;
DWORD dwQC;
BOOL bValue;

dwState = 0xFFFFFFFF;

//Get the tag value
//dwstate is the tag state
bValue = GetTagBitStateQCWait("gs_tag_bit", &dwState, &dwQC);

//Create a string which includes the tag value
if (bValue)
{
    // User defined code if the
    // value of the tag is true
    ...
}
else
{
    // User defined code if the
    // value of the tag is false
    ...
}
}
```

Parameters of the GetTagBitStateQC function:

"gs\_tag\_bit" is the name of the tag.

"&dwState" is the address of the tags in which the tag status is to be stored.

"&dwQC" is the address of the tag in which the quality code is to be stored.

1. Read out the value of the tag and temporarily store it in bValue. The function puts the tag status in dwState and the quality code in dwQC.
2. Executing user-defined code, depending on the return value of the function.

## GetTagBitStateWait example

```
{
DWORD dwstate;
BOOL bValue;

dwstate = 0xFFFFFFFF;

//Get the tag value
//dwstate is the tag state
bValue = GetTagBitStateWait("gs_tag_bit",&dwstate);

//Create a string which includes the tag value
if (bValue)
{
    // User defined code if the
    // value of the tag is true
    ...
}
else
{
    // User defined code if the
    // value of the tag is false
    ...
}
}
```

Parameters of the GetTagBitStateWait function:

"gs\_tag\_bit" is the name of the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Read out the value of the tag and temporarily store it in bstate. The function puts the tag status in dwstate.
2. Executing user-defined code, depending on the return value of the function.

## GetTagChar example

```
{
char* pszValue = NULL;
char szValue[13];

//Get the current value of the tag
pszValue = GetTagChar("gs_tag_char");

if(pszValue != NULL)
{
//Copy the string
strncpy(szValue,pszValue,12);
}
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagChar function:

"gs\_tag\_char" is the name of the tag.

1. Reading the value of the tag and temporarily storing in pszValue.
2. If a valid value has been returned, store the return value of the function in the local string szValue. A maximum of 12 characters is stored.
3. Executing user-defined code for processing return values.

## GetTagCharStateQCWait example

```
{
DWORD dwState;
DWORD dwQC;
char* pszRetVal = NULL;
char szRetVal[13];

dwState = 0xFFFFFFFF;

//Get the tag value
pszRetVal = GetTagCharStateQCWait("gs_tag_char",&dwState, &dwQC);

if (pszRetVal != NULL)
{
//Copy the string
strncpy(szRetVal,pszRetVal,12);
}
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagCharStateQCWait function:

"gs\_tag\_char" is the name of the tag.

"&dwState" is the address of the tags in which the tag status is to be stored.

"&dwQC" is the address of the tag in which the quality code is to be stored.

1. Read out the value of the tag and temporarily store it in pszRetVal. The function puts the tag status in dwState and the quality code in dwQC.
2. If a valid value has been returned, store the return value of the function in the local string szRetVal. A maximum of 12 characters is stored.
3. Executing user-defined code for processing return values.

### Beispiel GetTagCharStateWait

```
{
DWORD dwstate;
char szValue[11];
char* pszRetValue = NULL;
char szRetValue[13];

dwstate = 0xFFFFFFFF;
//Get the tag value
//dwstate is the tag state
pszRetValue = GetTagCharStateWait("gs_tag_char",&dwstate);

if (pszRetValue != NULL)
{
//Copy the string
strncpy(szRetValue,pszRetValue,12);
}
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagCharStateWait function:

"gs\_tag\_char" is the name of the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Read out the value of the tag and temporarily store it in pszRetValue. The function puts the tag status in dwstate.
2. If a valid value has been returned, store the return value of the function in the local string szRetValue. A maximum of 12 characters is stored.
3. Executing user-defined code for processing return values.

### GetTagFloat example

```
{
float fValue;

//Get the current value of the tag
fValue = GetTagFloat("gs_tag_float");

//User defined code where the
//user can do something with the return value
...
}
```



Parameters of the GetTagFloat function:

"gs\_tag\_float" is the name of the tag.

1. Read out the value of the tag and temporarily store it in fValue.
2. Executing user-defined code for processing return values.

### GetTagFloatStateQCWait example

```
{
DWORD dwState;
DWORD dwQC;
float fValue;

dwState = 0xFFFFFFFF;

//Get the tag value
fValue = GetTagFloatStateQCWait("gs_tag_float",&dwState, &dwQC);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagFloatStateQCWait function:

"gs\_tag\_float" is the name of the tag.

"&dwState" is the address of the tags in which the tag status is to be stored.

"&dwQC" is the address of the tag in which the quality code is to be stored.

1. Read out the value of the tag and temporarily store it in fValue. The function puts the tag status in dwState and the quality code in dwQC.
2. Executing user-defined code for processing return values.

### GetTagFloatStateWait example

```
{  
DWORD dwstate;  
float fValue;  
  
dwstate = 0xFFFFFFFF;  
//Get the tag value  
//dwstate is the tag state  
fValue = GetTagFloatStateWait("gs_tag_float",&dwstate);  
  
//User defined code where the  
//user can do something with the return value  
...  
}
```

Parameters of the GetTagFloatStateWait function:

"gs\_tag\_float" is the name of the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Read out the value of the tag and temporarily store it in fValue. The function puts the tag status in dwstate.
2. Executing user-defined code for processing return values.

## GetTagMultiStateQCWait example

```
{
#define DATA_SIZE 5
DWORD dwState[DATA_SIZE];
DWORD dwQC[DATA_SIZE];

//define all Datas
BOOL lValue1;
long lValue2 ;
char* szValue3;
double dblValue4 ;
WORD lValue5 ;

//Set the tags
GetTagMultiStateQCWait(dwState,dwQC,"%d%d%s%f%d",
    "gs_tag_bit",&lValue1,
    "gs_tag_SByte",&lValue2,
    "gs_tag_char",&szValue3,
    "gs_tag_float",&dblValue4,
    "gs_tag_word",&lValue5);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagMultiStateWait function:

"dwState" is the DWord-Array, in which the tag statuses are stored.

"dwQC" is the DWord-Array, in which the quality codes are stored.

"%d%d%s%f%d" are the type descriptions of the tags to be read.

"gs\_tag\_bit" is the tag to be read.

"&lValue1" is the address of the tags in which the value of the tags gs\_tag\_bit should be stored.

"gs\_tag\_SByte" is the tag to be read.

"&lValue2" is the address of the tags in which the value of the tags gs\_tag\_SByte should be stored.

The other parameters are to be handled in the same way as those described previously.

1. Creating a DWord-Array with the required size (Number of tags).
2. Reading and storing the values of the tags. The value of the tags gs\_tag\_bit is stored temporarily in lValue1. The value of the tags gs\_tag\_SByte is stored temporarily in lValue2, etc.
3. Executing user-defined code for processing return values.

**GetTagMultiStateWait example**

```
{
#define DATA_SIZE 5
DWORD dwData[DATA_SIZE];

//define all Datas
BOOL lValue1;
long lValue2 ;
char* szValue3;
double dblValue4 ;
WORD lValue5 ;

//Set the tags
GetTagMultiStateWait(dwData, "%d%d%s%f%d",
    "gs_tag_bit", &lValue1,
    "gs_tag_SByte", &lValue2,
    "gs_tag_char", &szValue3,
    "gs_tag_float", &dblValue4,
    "gs_tag_word", &lValue5);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagMultiStateWait function:

"dwData" is the DWord-Array, in which the tag statuses are stored.

"%d%d%s%f%d" are the type descriptions of the tags to be read.

"gs\_tag\_bit" is the tag to be read.

"&lValue1" is the address of the tags in which the value of the tags gs\_tag\_bit should be stored.

"gs\_tag\_SByte" is the tag to be read.

"&lValue2" is the address of the tags in which the value of the tags gs\_tag\_SByte should be stored.

The other parameters are to be handled in the same way as those described previously.

1. Creating a DWord-Array with the required size (Number of tags).
2. Reading and storing the values of the tags. The value of the tags gs\_tag\_bit is stored temporarily in lValue1. The value of the tags gs\_tag\_SByte is stored temporarily in lValue2, etc.
3. Executing user-defined code for processing return values.

## GetTagMultiWait example

```
DWORD dwVar1Value;
char* szVar2Value;
//Memory for the tag value is
//created by teh function with SysMalloc
double dbVar3Value;

BOOL ok;

ok=GetTagMultiWait("%d%s%f", "Ernie_word", &dwVar1Value,
    "Ernie_char", &szVar2Value,
    "Ernie_double", &dbVar3Value);

printf("Word %d, String %s, Double %f\r\n",
    dwVar1Value, szVar2Value, dbVar3Value);
```

## GetTagPrefix example

```
{
char* pszTagPrefix = NULL;
char szTagPrefix[7];

//Get the current tag prefix
pszTagPrefix = GetTagPrefix(lpszPictureName,"PicWindow1");

if(pszTagPrefix != NULL)
{
//Copy the string
strncpy(szTagPrefix,pszTagPrefix,6);
}
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagPrefix function:

"lpszPictureName" is the name of the picture in which the object was configured.

"PictureWindow1" is the name of the object.

1. Read out the current tag prefix of picture window 1 and temporarily store it in pszTagPrefix.
2. If a valid value has been returned, store the return value of the function in the local string szTagPrefix. A maximum of 6 characters is stored.
3. Executing user-defined code for processing return values.

### GetTagRaw example

```
{
#define DATA_SIZE 3

BYTE byData[DATA_SIZE];

//Get the current values of the tag
GetTagRaw("gs_tag_raw",byData,DATA_SIZE);

//Use the values received in the array byData
...
}
```

Parameters of the GetTagRaw function:

"gs\_tag\_raw" is the name of the tag.

"byData" is the byte array in which the values of the raw data tags will be stored.

"DATA\_SIZE" is the number of values that will be read.

1. Reading the values of the tags and temporarily storing in byData.
2. Executing user-defined code for processing return values.

### GetTagRawStateQCWait example

```
{
#define DATA_SIZE 3
DWORD dwState;
DWORD dwQC;
BYTE byData[DATA_SIZE];

dwState = 0xFFFFFFFF;

//Get the values of the tag
GetTagRawStateQCWait("gs_tag_raw",byData,DATA_SIZE,&dwState,&dwQC);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagRawStateQCWait function:

"gs\_tag\_raw" is the name of the tag.

"byData" is the byte array in which the values of the raw data tags will be stored.

"DATA\_SIZE" is the number of values that will be read.

"&dwState" is the address of the tags in which the tag status is to be stored.

"&dwQC" is the address of the tag in which the quality code is to be stored.

1. Reading the values of the tags and temporarily storing in byData.
2. Executing user-defined code for processing return values.

### GetTagRawStateWait example

```
{
#define DATA_SIZE 3
DWORD dwstate;
BYTE byData[DATA_SIZE];
char szValue[11];

//Load dwState with default values
dwstate = 0xFFFFFFFF;

//Get the values of the tag
//dwstate is the tag state
GetTagRawStateWait("gs_tag_raw",byData,DATA_SIZE,&dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagRawStateWait function:

"gs\_tag\_raw" is the name of the tag.

"byData" is the byte array in which the values of the raw data tags will be stored.

"DATA\_SIZE" is the number of values that will be read.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Reading the values of the tags and temporarily storing in byData.
2. Executing user-defined code for processing return values.

### GetTagSByte example

```
{
long lValue;

//Get the current value of the tag
lValue = GetTagSByte("gs_tag_SByte");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagSByte function:

"gs\_tag\_SByte" is the name of the tag.

1. Read the value of the tag and temporarily store it in lValue.
2. Executing user-defined code for processing return values.

### GetTagSByteStateQCWait example

```
{
DWORD dwState;
DWORD dwQC;
long lValue;

dwState = 0xFFFFFFFF;

//Get the tag value
lValue = GetTagSByteStateQCWait("gs_tag_SByte",&dwState, &dwQC);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagSByteStateQCWait function:

"gs\_tag\_SByte" is the name of the tag.

"&dwState" is the address of the tags in which the tag status is to be stored.

"&dwQC" is the address of the tag in which the quality code is to be stored.

1. Read the value of the tag and temporarily store it in lValue. The function puts the tag status in dwState and the quality code in dwQC.
2. Executing user-defined code for processing return values.



## GetTagSByteStateWait example

```
{
DWORD dwstate;
long lValue;

dwstate = 0xFFFFFFFF;
//Get the tag value
//dwstate is the tag state
lValue = GetTagSByteStateWait("gs_tag_SByte",&dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagSByteStateWait function:

"gs\_tag\_SByte" is the name of the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Read the value of the tag and temporarily store it in lValue. The function puts the tag status in dwstate.
2. Executing user-defined code for processing return values.

## GetTagWord example

```
{
WORD wValue;

//Get the current value of the tag
wValue = GetTagWord("gs_tag_word");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagWord function:

"gs\_tag\_word" is the name of the tag.

1. Read out the value of the tag and temporarily store it in wValue.
2. Executing user-defined code for processing return values.

### GetTagWordStateQCWait example

```
{
DWORD dwState;
DWORD dwQC;
WORD wValue;

dwState = 0xFFFFFFFF;

//Get the tag value
wValue = GetTagWordStateQCWait("gs_tag_word",&dwState, &dwQC);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTagWordStateQCWait function:

"gs\_tag\_word" is the name of the tag.

"&dwState" is the address of the tags in which the tag status is to be stored.

"&dwQC" is the address of the tag in which the quality code is to be stored.

1. Read out the value of the tag and temporarily store it in wValue. The function puts the tag status in dwState and the quality code in dwQC.
2. Executing user-defined code for processing return values.

### GetTagWordStateWait example

```
{
DWORD dwstate;
WORD wValue;

dwstate = 0xFFFFFFFF;
//Get the tag value
//dwstate is the tag state
wValue = GetTagWordStateWait("gs_tag_word",&dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of then GetTagWordStateWait function:

"gs\_tag\_word" is the name of the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Read out the value of the tag and temporarily store it in wValue. The function puts the tag status in dwstate.
2. Executing user-defined code for processing return values.

### GetText example

```
{
char* pszValue = NULL;
char szValue[13];

//Get the Text which is actually set
pszValue = GetText(lpszPictureName, "StaticText1");

if(pszValue != NULL)
{
//Copy the string
strncpy(szValue, pszValue, 12);
}
//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetText function:

"lpszPictureName" is the name of the picture in which the object was configured.

"StaticText1" is the name of the object.

1. Read out the text in the object StaticText1 and temporarily store it in pszValue.
2. If a valid value has been returned, store the return value of the function in the local string szValue. A maximum of 12 characters is stored.
3. Executing user-defined code for processing return values.

### GetTop example

```
{
long lPos;

//Get the y-Position of the Object
lPos = GetTop(lpszPictureName, "WinCCLogo");

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the GetTop function:

"IpszPictureName" is the name of the picture in which the object was configured.

"WinCCLogo" is the name of the object.

1. Read out the current Y position of the object and temporarily store it in IPos.
2. Executing user-defined code for processing return values.

### GetVisible example

```
{
BOOL bVisible;

//Get the visibility
bVisible = GetVisible(IpszPictureName,"GraphicObject1");

if(bVisible)
{
    // User defined code if the
    // object is visible
    ...
}
else
{
    // User defined code if the
    // object is not visible
    ...
}
}
```

Parameters of the GetVisible function:

"IpszPictureName" is the name of the picture in which the object was configured.

"GraphicObject1" is the name of the object.

1. Read out whether the object is visible or not and temporarily store in bVisible.
2. Executing user-defined code, depending on the return value of the function.

## GetWidth example

```

{
long lWidth;

//Get the width of the object
lWidth = GetWidth(lpszPictureName, "WinCCLogo");

//User defined code where the
//user can do something with the return value
...
}

```

Parameters of the GetWidth function:

"lpszPictureName" is the name of the picture in which the object was configured.

"WinCCLogo" is the name of the object.

1. Read out the current width of the object and temporarily store it in lWidth.
2. Executing user-defined code for processing return values.

### 2.15.4.4 Examples - H to S

## InquireLanguage example

```

{
DWORD count;
DWORD* language;
int i;

//Count the installed languages
language = InquireLanguage(&count);

printf("##### INQUIRE LANGUAGE #####");
//Print out the count of languages
printf ( "\r\nCount Languages=%d\r\n", count );

//print out which languages are installed
for (i=1;i<=count; i++)
{
printf ("\r\n%d.language=%x", i,*language++);
}
}

```

1. Determine the languages configured for the runtime. In language the language IDs are temporarily stored. In count the number of languages is temporarily stored.

2. The number of determined languages is output.
3. All determined language IDs are displayed.

### **ProgramExecute example**

```
{  
//start the program calc.exe  
ProgramExecute("C:\\Winnt\\system32\\calc.exe");  
}
```

As parameter the file is to be specified with its path.

### **RPTJobPreview example**

```
{  
//Start the print preview of the specified print job  
RPTJobPreview("Documentation Text Library");  
}
```

Parameters of the "RPTJobPreview" function:

"Documentation Text Library" is the name of the print job.

### **RPTJobPrint example**

```
{  
//Print the specified print job out  
RPTJobPrint("@Text library (compact)");  
}
```

Parameters of the RPTJobPrint function:

@Text library (compact) is the name of the print job.

### **SysMalloc example**

```
char* main(...);  
{  
char* returnwert;  
char text[17];  
returnwert=SysMalloc(17);  
strcpy(returnwert,&text[0]);  
return returnwert;  
}
```

### 2.15.4.5 Examples - SetAlarmHigh to SetPropChar

#### SetAlarmHigh example

```
{  
//Set the upper limit for the warning  
SetAlarmHigh(lpszPictureName, "Bar1", 3.0);  
}
```

Parameters of the SetAlarmHigh function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Bar1" is the name of the object.

"3.0" is the value to which the upper alarm limit will be set.

#### SetBackColor example

```
{  
//Set the back color blue  
SetBackColor(lpszPictureName, "StaticText1", CO_BLUE);  
}
```

Parameters of the SetBackColor function:

"lpszPictureName" is the name of the picture in which the object was configured.

"StaticText1" is the name of the object.

"CO\_BLUE" is the constant for the color "Blue".

---

**Note**

Instead of using the constant for the color value you may also specify the color by means of a hexadecimal value.

---

#### SetBorderEndStyle example

```
{  
SetBorderEndStyle(lpszPictureName, "Line", (2|393216));  
}
```

## 2.15 ANSI-C function descriptions

Sets the left line end as filled arrow and the right one as filled circle. The left line end is stored in the two lower bytes, the right line end in the two upper bytes. The parameters are transferred by means of numeric values.

### Example of setting the line ends with symbolic names

```
{  
SetBorderEndStyle(lpszPictureName,"Line", (LE_FULL_ARROW|(LE_FULL_CIRCLE <<16)));  
}
```

Sets the left line end as filled arrow and the right one as filled circle. The left line end is stored in the two lower bytes, the right line end in the two upper bytes. To address the right line end the symbolic designation "LE\_FULL\_CIRCLE" is moved by 2 bytes or 16 bit into the two upper bytes.

### SetBorderStyle example

```
{  
//Change the Border style  
SetBorderStyle(lpszPictureName,"Rectangle1",3);  
}
```

Parameters of the SetBorderStyle function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Rectangle1" is the name of the object.

"3" is the line style which is set for the object.

### SetColorAlarmHigh example

```
{  
//Set the Color for the alarm high limit to red  
SetColorAlarmHigh(lpszPictureName,"Bar1",CO_RED);  
}
```

Parameters of the SetColorAlarmHigh function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Bar1" is the name of the object.



"CO\_RED" is the constant for the color red.

---

**Note**

Instead of using the constant for the color value you may also specify the color by means of a hexadecimal value.

---

### Example - SetCursorMode

```
{
//Set the Cursor Mode to Alpha cursor
SetCursorMode(lpszPictureName, "GraphikObjekt1", FALSE);
}
```

Parameters of the SetCursorMode function:

"lpszPictureName" is the name of the picture in which the object was configured.

"GraphicObject1" is the name of the object.

"FALSE" signifies: Cursor mode "Alpha-Cursor" is set.

### SetFilling example

```
{
//Set the dynamic filling true
SetFilling(lpszPictureName, "Rectangle1", TRUE);
}
```

Parameters of the SetFilling function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Rectangle1" is the name of the object.

"TRUE" means: Activating dynamic filling.

### SetFillingIndex example

```
{
//Set the Filling of Rectangle1 to 10
SetFillingIndex(lpszPictureName, "Rectangle1", 10);
}
```

Parameters of the SetFillingIndex function:

## 2.15 ANSI-C function descriptions

"IpszPictureName" is the name of the picture in which the object was configured.

"Rectangle1" is the name of the object.

"10" is the fill level which is assigned to the object.

### SetFillStyle example

```
{  
//Change the fill style  
SetFillStyle(IpszPictureName,"Rectangle1",196617);  
}
```

Parameters of the SetFillStyle function:

"IpszPictureName" is the name of the picture in which the object was configured.

"Rectangle1" is the name of the object.

"196617" is the fill pattern (brick wall) which is set for the object.

### SetFlashBackColor example

```
{  
//Set the flashing to True  
SetFlashBackColor(IpszPictureName,"Group1",TRUE);  
}
```

Parameters of the SetFlashBackColor function

"IpszPictureName" is the name of the picture in which the object was configured.

"Group1" is the name of the object.

"TRUE" means: Activating flashing of the background color.

### SetFlashBackColorOn example

```
{  
//Set the Flash color for the state on to red  
SetBackFlashColorOn(IpszPictureName,"Group1",CO_RED);  
}
```

Parameters of the SetBackFlashColorOn function:

"IpszPictureName" is the name of the picture in which the object was configured.

"Group1" is the name of the object.

"CO\_Red" is the constant for the color "Red".

---

**Note**

Instead of using the constant for the color value you may also specify the color by means of a hexadecimal value.

---

### SetFlashRateFlashPic example

```
{
//Set the flash rate to 0
SetFlashRateFlashPic(lpszPictureName,"Statusdisplay1",0);
}
```

Parameters of the SetFlashRateFlashPic function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Status display1" is the name of the object.

"0" is the flash frequency of the object.

### SetFocus example

```
{
//Set the Focus on the Object Button 1
Set_Focus(lpszPictureName,"Button1");
}
```

Parameters of the Set\_Focus function

"lpszPictureName" is the name of the picture in which the object was configured.

"Button1" is the name of the object on which the focus is set.

### SetFontBold example

```
{
//Set the displayed Text bold
SetFontBold(lpszPictureName,"StatischerText1",TRUE);
}
```

Parameters of the SetFontBold function:

"lpszPictureName" is the name of the picture in which the object was configured.

## 2.15 ANSI-C function descriptions

"StaticText1" is the name of the object.

"TRUE" means: The text is written in bold face.

### SetFontSize example

```
{  
//Set Font Size to 12  
SetFontSize(lpszPictureName,"StaticText1",12);  
}
```

Parameters of the SetFontSize function:

"lpszPictureName" is the name of the picture in which the object was configured.

"StaticText1" is the name of the object.

"12" is the font size to which the text is set.

### SetHeight example

```
{  
//Set the height of the object to 100  
SetHeight(lpszPictureName,"WinCCLogo",100);  
}
```

Parameters of the SetHeight function:

"lpszPictureName" is the name of the picture in which the object was configured.

"WinCCLogo" is the name of the object.

"100" is the height to which the object is set.

### SetHiddenInput example

```
{  
//Set the hidden input true  
SetHiddenInput(lpszPictureName,"IOField1",TRUE);  
}
```

Parameters of the SetHiddenInput function:

"lpszPictureName" is the name of the picture in which the object was configured.

"IOField1" is the name of the object.

"TRUE" means: Activating the hidden input.

### SetLanguage example

```
{
//German
SetLanguage(0x0407);
}
```

The Runtime language is set to German.

### SetLeft example

```
{
//Set the x-position to 0
SetLeft(lpszPictureName, "WinCCLogo", 0);
}
```

Parameters of the SetLeft function:

"lpszPictureName" is the name of the picture in which the object was configured.

"WinCCLogo" is the name of the object.

"0" is the X position to which the object is set.

### SetLink example

```
{
LINKINFO linkinfo;

//Set the link type
linkinfo.LinkType = 1;

//Set the update cycle
linkinfo.dwCycle = 0;

//set the Structmember
strcpy(linkinfo.szLinkName, "U08i_link_00");

//Set the connection to the tag
SetLink(lpszPictureName, "Bar1", "Process", &linkinfo);
}
```

## 2.15 ANSI-C function descriptions

Parameters of the SetLink function:

"IpszPictureName" is the name of the picture in which the object was configured.

"Bar1" is the name of the object.

"Process" is the property connected to a tag.

"&linkinfo" is the address of the linkinfo structure.

1. Set the connection type for the process property to direct connection.
2. Set the update cycle to "Upon change".
3. Set the tag name to U08i\_link\_00.

### SetMarker example

```
{  
//Set the marker visible  
SetMarker(lpszPictureName, "Bar1", TRUE);  
}
```

Parameters of the SetMarker function:

"IpszPictureName" is the name of the picture in which the object was configured.

"Bar1" is the name of the object.

"TRUE" means: The marker is displayed.

### SetOutputValueDouble example

```
{  
//Set the output value of the IO field to 55.5  
SetOutputValueDouble(lpszPictureName, "IOField1", 55.5);  
}
```

Parameters of the SetOutputValueDouble function:

"IpszPictureName" is the name of the picture in which the object was configured.

"IOField1" is the name of the object.

"55.5" is the value which is output.

### SetPictureDown example

```
{  
//Set the picture name to activated.bmp  
SetPictureDown(lpszPictureName, "Roundbutton1", "activated.bmp");  
}
```

Parameters of the SetPictureDown function:

"lpszPictureName" is the name of the picture in which the object was configured.

"RoundButton1" is the name of the object.

"activated.bmp" is the picture name of the picture to be displayed in round button 1.

### SetPictureName example

```
{  
//Set the picture name cool_man.bmp  
SetPictureName(lpszPictureName, "GraphicObject1", "cool_man.bmp");  
}
```

Parameters of the SetPictureName function:

"lpszPictureName" is the name of the picture in which the object was configured.

"GraphicObject1" is the name of the object.

"cool\_man.bmp" is the picture name of the picture to be displayed in graphic object 1.

### SetPictureUp example

```
{  
//Set the picture name to deactivated.bmp  
SetPictureUp(lpszPictureName, "Roundbutton1", "deactivated.bmp");  
}
```

Parameters of the SetPictureUp function:

"lpszPictureName" is the name of the picture in which the object was configured.

"RoundButton1" is the name of the object.

"deactivated.bmp" is the picture name of the picture to be displayed in round button 1.

### SetPosition example

```
{  
//Set the Slider Position to 30  
SetPosition(lpszPictureName,"Control1",30);  
}
```

Parameters of the SetPosition function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Control1" is the name of the object.

"30" is the position to which the slider is to be set.

### SetPropBOOL example

```
{  
//Set the visibility TRUE  
SetPropBOOL("lpszPictureName","EAFeld1","Visible",TRUE);  
}
```

Parameters of the SetVisible function:

"lpszPictureName" is the name of the picture in which the object was configured.

"IOField1" is the name of the object.

"TRUE" means: The object is intended to be visible.

### SetPropChar example

```
{  
//Set the property Tooltiptext  
SetPropChar("gs_graph_eafield","IOField1","ToolTipText","Tooltiptext1 ");  
}
```

Parameters of the SetPropChar function:

"lpszPictureName" is the name of the picture in which the object was configured.

"IOField1" is the name of the object.

"Tooltiptext" is the object property.

"Tooltiptext 1" is the value to which the property is to be set.



## 2.15.4.6 Examples - SetRangeMax to SetWidth

### SetRangeMax example

```
{  
//Set the Upper Scale Limit  
SetRangeMax(lpszPictureName, "Control1", 80);  
}
```

Parameters of the SetRangeMax function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Control1" is the name of the object.

"80" is the upper limit to be assigned to the object.

### SetRangeMin example

```
{  
//Set the lower Scale Limit  
SetRangeMin(lpszPictureName, "Control1", 0);  
}
```

Parameters of the SetRangeMin function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Control1" is the name of the object.

"0" is the lower limit to be assigned to the object.

### SetScaling example

```
{  
//Set the Scaling Visible  
SetScaling(lpszPictureName, "Bar1", TRUE);  
}
```

Parameters of the SetScaling function:

"lpszPictureName" is the name of the picture in which the object was configured.

"Bar1" is the name of the object.

"TRUE" means: Making the scaling visible.

### SetTagBit example

```
{
//Set the tag to true
SetTagBit("gs_tag_bit",TRUE);
}
```

Parameters of the SetTagBit function:

"gs\_tag\_bit" is the name of the tag.

"TRUE" is the value to be written to the tag.

### Beispiel SetTagBitStateWait

```
{
DWORD dwstate;

//Load dwState with default values
dwstate = 0xFFFFFFFF;

//Set the value of the tag to TRUE
//dwstate is the tag state
SetTagBitStateWait("gs_tag_bit",TRUE,&dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the SetTagBitStateWait function:

"gs\_tag\_bit" is the name of the tag.

"TRUE" is the value to be written to the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Setting the tags to the specified value.
2. Executing user-defined code for processing return values.

### SetTagChar example

```
{
//Set the tag to Example text
SetTagChar("gs_tag_char","Example Text");
}
```

Parameters of the SetTagChar function:

"gs\_tag\_char" is the name of the tag.

"Example text" is the value to be written to the tag.

### SetTagCharStateWait example

```
{
DWORD dwstate;

//Load dwState with default values
dwstate = 0xFFFFFFFF;

//Set the tag to Example Text
//dwstate is the tag state
SetTagCharStateWait("gs_tag_char","Example Text",&dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the SetTagCharStateWait function:

"gs\_tag\_char" is the name of the tag.

"Example text" is the value to be written to the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Setting the tags to the specified value.
2. Executing user-defined code for processing return values.

### SetTagFloat example

```
{
//Set the tag to 55.4711
SetTagFloat("gs_tag_float",55.4711);
}
```

Parameters of the SetTagFloat function:

"gs\_tag\_float" is the name of the tag.

"55.4711" is the value to be written to the tag.

### SetTagFloatStateWait example

```
{
DWORD dwstate;
char szValue[9];

//Load dwState with default values
dwstate = 0xFFFFFFFF;

//Set the tag to 55.4711
//dwstate is the tag state
SetTagFloatStateWait("gs_tag_float", 55.4711, &dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the SetTagFloatStateWait function:

"gs\_tag\_float" is the name of the tag.

"55.4711" is the value to be written to the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Setting the tags to the specified value.
2. Executing user-defined code for processing return values.

## SetTagMultiStateWait example

```
{
#define DATA_SIZE 5
DWORD dwData[DATA_SIZE];

//define all tags
BOOL lValue1;
long lValue2 ;
char szValue3[_MAX_PATH];
float lValue4;
char lValue5;

// Fill the tags with the values
// you want to set into the WinCC tags
...

//Set the WinCC tags
SetTagMultiStateWait(dwData, "%d%d%s%f%d", "gs_tag_bit", lValue1,
    "gs_tag_SByte", lValue2,
    "gs_tag_char", szValue3,
    "gs_tag_float", lValue4,
    "gs_tag_word", lValue5);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the SetTagMultiStateWait function:

"dwData" is the DWord-Array, in which the tag statuses are stored.

"%d%d%s%f%d" are the type descriptions of the tags to be written.

"gs\_tag\_bit" is the WinCC tag to be written.

"lValue1" is the tag to whose value the WinCC tag gs\_tag\_bit is to be set.

"gs\_tag\_SByte" is the WinCC tag to be written.

"&lValue2" is the tag to whose value the WinCC tag gs\_tag\_SByte is to be set.

The other parameters are to be handled in the same way as those described previously.

1. Creating a DWord-Array with the required size (Number of tags).
2. Creating tags whose values are to be written to the WinCC tags.
3. Writing the values of the previously created and filled tags to the WinCC tags.
4. Executing user-defined code for processing return values.

### SetTagMultiWait example

```
BOOL ok;

ok=SetTagMultiWait("%d%s%f", "Ernie_word", 16,
  "Ernie_char", "Hello World",
  "Ernie_double", 55.4711);
```

### SetTagPrefix example

```
{
//Set the TagPrefix to Struct1.
SetTagPrefix(lpszPictureName,"PicWindow1","Struct1.");

//Set the picture name again to update the tag prefix
SetPictureName(lpszPictureName,"PicWindow1","gs_graph_eafield");
}
```

Parameters of the SetTagPrefix function:

"lpszPictureName" is the name of the picture in which the object was configured.

"PictureWindow1" is the name of the object.

"Struct1." is the tag prefix to be set at picture window 1.

1. Set the tag prefix of the object "PictureWindow1" to "Struct1."
2. Reset the name of the picture shown in the picture window to make the tag prefix setting effective.

### SetTagRaw example

```
{
#define DATA_SIZE 3

BYTE byData[DATA_SIZE];

// Fill the Byte array with the values
// you want to set into the raw data tag
...

//Set the tag to the default values
SetTagRaw("gs_tag_raw",byData,DATA_SIZE);
}
```

Parameters of the SetTagRaw function:

"gs\_tag\_raw" is the name of the tag.

"byData" is the byte array whose values are written to the raw data tags.

"DATA\_SIZE" is the number of values that will be written.

1. Creating a BYTE-Array with the required size (size of the raw data tag).
2. Filling the BYTE-Array with the values to be written.
3. Writing the values of the BYTE-Array to the raw data tag.

### SetTagRawStateWait example

```
{
#define DATA_SIZE 3

BYTE byData[DATA_SIZE];
DWORD dwstate;
char szValue[9];

//Load dwState with default values
dwstate = 0xFFFFFFFF;

// Fill the Byte array with the values
// you want to set into the raw data tag
...

//Set the tag to the default values
//dwstate is the tag state
SetTagRawStateWait("gs_tag_raw",byData,DATA_SIZE,&dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the SetTagRawStateWait function:

"gs\_tag\_raw" is the name of the tag.

"byData" is the byte array whose values are written to the raw data tags.

"DATA\_SIZE" is the number of values that will be written.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Creating a BYTE-Array with the required size (size of the raw data tag).
2. Filling the BYTE-Array with the values to be written.
3. Writing the values of the BYTE-Array to the raw data tag.

4. Executing user-defined code for processing return values.

### SetTagSByte example

```
{
//Set the tag to 50
SetTagSByte("gs_tag_SByte",50);
}
```

Parameters of the SetTagSByte function:

"gs\_tag\_SByte" is the name of the tag.

"50" is the value to be written to the tag.

### Beispiel SetTagSByteStateWait

```
{
DWORD dwstate;
char szValue[9];

//Load dwState with default values
dwstate = 0xFFFFFFFF;

//Set the tag to 50
//dwstate is the tag state
SetTagSByteStateWait("gs_tag_SByte",50,&dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the SetTagSByteStateWait:

"gs\_tag\_SByte" is the name of the tag.

"50" is the value to be written to the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Setting the tags to the specified value.
2. Executing user-defined code for processing return values.



## SetTagWord example

```
{
//Set the tag to 50
SetTagWord("gs_tag_word",50);
}
```

Parameters of the SetTagWord function:

"gs\_tag\_word" is the name of the tag.

"50" is the value to be written to the tag.

## Beispiel SetTagWordStateWait

```
{
DWORD dwstate;
char szValue[9];

//Load dwState with default values
dwstate = 0xFFFFFFFF;

//Set the tag to 50
//dwstate is the tag state
SetTagWordStateWait("gs_tag_word",50,&dwstate);

//User defined code where the
//user can do something with the return value
...
}
```

Parameters of the SetTagWordStateWait function:

"gs\_tag\_word" is the name of the tag.

"50" is the value to be written to the tag.

"&dwstate" is the address of the tags in which the tag status is to be stored.

1. Setting the tags to the specified value.
2. Executing user-defined code for processing return values.

### SetText example

```
{  
//Set the text Example Text on the StaticText field  
SetText(lpszPictureName, "StaticText1", "Example Text");  
}
```

Parameters of the SetText function:

"lpszPictureName" is the name of the picture in which the object was configured.

"StaticText1" is the name of the object.

"ExampleText" is the text which is to be output.

### SetTop example

```
{  
//Set the y-position to 0  
SetTop(lpszPictureName, "WinCCLogo", 140);  
}
```

Parameters of the SetTop function:

"lpszPictureName" is the name of the picture in which the object was configured.

"WinCCLogo" is the name of the object.

"140" is the Y position to which the object is set.

### SetVisible example

```
{  
//Set the Object visible  
SetVisible(lpszPictureName, "GraphicObject1", TRUE);  
}
```

Parameters of the SetVisible function:

"lpszPictureName" is the name of the picture in which the object was configured.

"GraphicObject1" is the name of the object.

"TRUE" means: The object is intended to be visible.

## SetWidth example

```
{  
//Set the width of the object to 400  
SetWidth(lpszPictureName, "WinCCLogo", 400);  
}
```

### Parameters of the SetWidth function

"lpszPictureName" is the name of the picture in which the object was configured.

"WinCCLogo" is the name of the object.

"400" is the width to which the object is set.

## 2.15.4.7 Examples of WinCC controls

### How to add elements to a WinCC OnlineTrendControl

#### Introduction

In the following example, insert value columns with properties in an empty WinCC OnlineTableControl and link the columns to archive tags.

#### Prerequisite

- An archive is created in the "Tag Logging Editor" with three archive tags.
- A "WinCC OnlineTableControl" with the name "Control2" is inserted in the process picture in the Graphics Designer.
- A button is inserted in the Graphics Designer. You have configured, for example, the event "mouse click" with a C action and the following script for the button.

**Example**

```
//enable BackColor
SetPropBOOL(lpszPictureName, "Control2", "UseColumnBackColor", TRUE);

//add new TimeColumn and assign column length
SetPropChar(lpszPictureName, "Control2", "TimeColumnAdd", "myRefTimeColumn");
SetPropWord(lpszPictureName, "Control2", "TimeColumnLength", 20);

//add new ValueColumn and assign properties
SetPropChar(lpszPictureName, "Control2", "ValueColumnAdd", "myValueTable1");
SetPropWord(lpszPictureName, "Control2", "ValueColumnProvider", 1);
SetPropChar(lpszPictureName, "Control2", "ValueColumnTagName", "Process value archive\
\PDL_ZT_1");
SetPropWord(lpszPictureName, "Control2", "ValueColumnBackColor", RGB(255,255,255));
SetPropChar(lpszPictureName, "Control2", "ValueColumnTimeColumn", "myRefTimeColumn");

//add new ValueColumn and assign properties
SetPropChar(lpszPictureName, "Control2", "ValueColumnAdd", "myValueTable2");
SetPropWord(lpszPictureName, "Control2", "ValueColumnProvider", 1);
SetPropChar(lpszPictureName, "Control2", "ValueColumnTagName", "Process value archive\
\PDL_ZT_2");
SetPropWord(lpszPictureName, "Control2", "ValueColumnBackColor", RGB(0,255,255));
SetPropChar(lpszPictureName, "Control2", "ValueColumnTimeColumn", "myRefTimeColumn");

//add new ValueColumn and assign properties
SetPropChar(lpszPictureName, "Control2", "ValueColumnAdd", "myValueTable3");
SetPropWord(lpszPictureName, "Control2", "ValueColumnProvider", 1);
SetPropChar(lpszPictureName, "Control2", "ValueColumnTagName", "Process value archive\
\PDL_ZT_3");
SetPropWord(lpszPictureName, "Control2", "ValueColumnBackColor", RGB(255,255,0));
SetPropChar(lpszPictureName, "Control2", "ValueColumnTimeColumn", "myRefTimeColumn");
```

**Result**

	myRefTimeAxis	myValueTable1	myValueTable2	myValueTable3	
112	08.02.2010 14:15:03	1	1	84	
113	08.02.2010 14:15:03	22	1	84	
114	08.02.2010 14:15:04	2	1	84	
115	08.02.2010 14:15:04	1	1	84	
116	08.02.2010 14:15:05	1	1	84	
117	08.02.2010 14:15:05	3	1	84	
118	08.02.2010 14:15:06	1	1	84	
119	08.02.2010 14:15:06	1	1	84	
120	08.02.2010 14:15:07	18	1	84	

## How to add elements to a WinCC OnlineTrendControl

### Introduction

In the following example you insert the Trend Window, Value Axis, Time Axis and Trends elements into an empty WinCC OnlineTrendControl.

### Prerequisite

- An archive is created in the "Tag Logging Editor" with three archive tags.
- A "WinCC OnlineTrendControl" with the name "Control2" is inserted in the process picture in the Graphics Designer.
- A button is inserted in the Graphics Designer. You have configured, for example, the event "mouse click" with a C action and the following script for the button.

**Example**

```

//create reference to new window, time and value axis
SetPropChar(lpszPictureName, "Control2", "TrendWindowAdd", "myWindow");
SetPropChar(lpszPictureName, "Control2", "TimeAxisAdd", "myTimeAxis");
SetPropChar(lpszPictureName, "Control2", "ValueAxisAdd", "myValueAxis");

//assign time and value axis to the window
SetPropChar(lpszPictureName, "Control2", "TimeAxisTrendWindow", "myWindow");
SetPropChar(lpszPictureName, "Control2", "ValueAxisTrendWindow", "myWindow");

//add new trend and assign properties
SetPropChar(lpszPictureName, "Control2", "TrendAdd", "myTrend1");
SetPropWord(lpszPictureName, "Control2", "TrendProvider", 1);
SetPropChar(lpszPictureName, "Control2", "TrendTagName", "Process value archive\
\PDL_ZT_1");
SetPropWord(lpszPictureName, "Control2", "TrendColor", RGB(255,0,0));
SetPropChar(lpszPictureName, "Control2", "TrendTrendWindow", "myWindow");
SetPropChar(lpszPictureName, "Control2", "TrendTimeAxis", "myTimeAxis");
SetPropChar(lpszPictureName, "Control2", "TrendValueAxis", "myValueAxis");

//add new trend and assign properties
SetPropChar(lpszPictureName, "Control2", "TrendAdd", "myTrend2");
SetPropWord(lpszPictureName, "Control2", "TrendProvider", 1);
SetPropChar(lpszPictureName, "Control2", "TrendTagName", "Process value archive\
\PDL_ZT_2");
SetPropWord(lpszPictureName, "Control2", "TrendColor", RGB(0,255,0));
SetPropChar(lpszPictureName, "Control2", "TrendTrendWindow", "myWindow");
SetPropChar(lpszPictureName, "Control2", "TrendTimeAxis", "myTimeAxis");
SetPropChar(lpszPictureName, "Control2", "TrendValueAxis", "myValueAxis");

//add new trend and assign properties
SetPropChar(lpszPictureName, "Control2", "TrendAdd", "myTrend3");
SetPropWord(lpszPictureName, "Control2", "TrendProvider", 1);
SetPropChar(lpszPictureName, "Control2", "TrendTagName", "Process value archive\
\PDL_ZT_3");
SetPropWord(lpszPictureName, "Control2", "TrendColor", RGB(0,0,255));
SetPropChar(lpszPictureName, "Control2", "TrendTrendWindow", "myWindow");
SetPropChar(lpszPictureName, "Control2", "TrendTimeAxis", "myTimeAxis");
SetPropChar(lpszPictureName, "Control2", "TrendValueAxis", "myValueAxis");

```

**2.15.4.8 Examples - Obsolete functions****AXC\_OnBtnMsgFirst example**

```

{
// jump to the first message in the WinCC Alarm Control
AXC_OnBtnMsgFirst("gs_alarm_00","Control1");
}

```

Parameters of the AXC\_OnBtnMsgFirst function:

"gs\_alarm\_00" is the name of the picture in which WinCC Alarm Control was configured.

Control1 is the object name of the WinCC Alarm Control.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### Beispiel AXC\_OnBtnMsgLast

```
{  
// jump to the last message in the WinCC Alarm Control  
AXC_OnBtnMsgLast("gs_alarm_00","Control1");  
}
```

Parameters of the AXC\_OnBtnMsgLast function:

"gs\_alarm\_00" is the name of the picture in which WinCC Alarm Control was configured.

Control1 is the object name of the WinCC Alarm Control.

### AXC\_OnBtnScroll example

```
{  
// activate/deactivate the scroll function  
AXC_OnBtnScroll("gs_alarm_00","Control1");  
}
```

Parameters of the AXC\_OnBtnScroll function:

"gs\_alarm\_00" is the name of the picture in which WinCC Alarm Control was configured.

Control1 is the object name of the WinCC Alarm Control.

### AXC\_OnBtnSinglAckn example

```
{  
// acknowledge the active message  
AXC_OnBtnSinglAckn("gs_alarm_00","Control1");  
}
```

Parameters of the AXC\_OnBtnSinglAckn function:

"gs\_alarm\_00" is the name of the picture in which WinCC Alarm Control was configured.

Control1 is the object name of the WinCC Alarm Control.

### AXC\_SetFilter example

```
{  
BOOL ret;  
MSG_FILTER_STRUCT Filter;  
CMN_ERROR Error;  
  
//Reset the filter struct  
memset( &Filter, 0, sizeof( MSG_FILTER_STRUCT ) );  
  
//Set the filter name  
strcpy( Filter.szFilterName, "Control1");  
  
// Choose selection elements  
Filter.dwFilter = MSG_FILTER_NR_FROM | MSG_FILTER_NR_TO;  
  
// Message number from  
Filter.dwMsgNr[0] = 2;  
// Message number to  
Filter.dwMsgNr[1] = 2;  
  
ret = AXC_SetFilter("gs_alarm_00","Control1",&Filter,&Error);  
}
```

1. Name the filter.
2. Select the filter type.
3. Specify the filter criteria.
4. Set the filter.



**Note**

The filter type and the filter criteria are to be adapted, all other filter types are described in the filter structure.

---

**ResetFilter example**

```
{
BOOL ret;
MSG_FILTER_STRUCT Filter;
CMN_ERROR Error;

//delete the whole Filter struct
memset( &Filter, 0, sizeof( MSG_FILTER_STRUCT ) );

//set an empty filter struct
AXC_SetFilter("gs_alarm_00","Control1",&Filter,&Error);
}
```

1. Delete the filter structure.
2. Write empty values into the filter structure.

**TlgGetNumberOfColumns example**

```
{
char text[5];
long int columns

//get number of Columns
columns = GetNumberOfColumns("TableControl_01");

//convert long int to char
sprintf(text,"%d",columns);

//set text on TextField5
SetText(lpszPictureName,"StaticText5",text);
}
```

Parameters of the TlgGetNumberOfColumns function:

"TableControl\_01" is the name of the WinCC Table Control.

1. Temporarily store the return value of the TlgGetNumberOfColumns in columns.

2. Temporarily store the return value in the text string.
3. Output the return value to a static text field.

---

**Note**

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### TlgGetNumberOfRows example

```
{
char text[5];
long int rows;

//get number of rows
rows = TlgGetNumberOfRows("TableControl_01");

//convert long int to char
sprintf(text,"%d",rows);

//set text on TextField5
SetText(lpszPictureName,"StaticText5",text);
}
```

Parameters of the TlgGetNumberOfRows function:

TableControl\_01 is the name of the WinCC Table Control.

1. Temporarily store the return value of the TlgGetNumberOfRows in rows.
2. Temporarily store the return value in the text string.
3. Output the return value to a static text field.

## TlgGetRulerTimeTrend example

```
{
SYSTEMTIME systime;
WORD wHour;
WORD wMin;
WORD wSec;

char szTime[10];

//Get the current systemtime
systime = TlgGetRulerTimeTrend("TrendControl_01",0);

//Get the hour
wHour = systime.wHour;
//Get the minute
wMin = systime.wMinute;
//Get the second
wSec = systime.wSecond;

//
sprintf(szTime,"%d:%d:%d",wHour,wMin,wSec);

//output the variable name
SetText(lpszPictureName,"StaticText7",szTime);
}
```

1. Read out the current system time.
2. Read out hour, minute and second from the SYSTEMTIME structure.
3. Create a string containing the time.
4. Output the current time.

### TlgGetRulerVariableNameTrend example

```
{
char* pszVarName = NULL;
char szVarName[20];

//Get the ruler variable name
pszVarName = TlgGetRulerVariableNameTrend("TrendControl_01",0);

if (pszVarName != NULL)
{
//Copy the string
strncpy(szVarName,pszVarName,19);
}
//output the variable name
SetText(lpszPictureName,"StaticText6",szVarName);
}
```

Parameters of the TlgGetRulerVariableNameTrend function:

"TrendControl\_01" is the name of the WinCC Trend Control.

"0" is the number of the trend.

1. Temporarily store the return value of the TlgGetRulerVariableNameTrend function in pszVarName.
2. If a valid value has been returned, copy the return value to szVarName.
3. Output the return value to a static text field.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### TlgTrendWindowPressOpenDlgButton example

```
{
//Opens the Property Dialog
TlgTrendWindowPressOpenDlgButton("TrendControl_01");
}
```

Parameters of the TlgTrendWindowPressOpenDlgButton function:

"TrendControl\_01" is the window title of WinCC Trend Control.

### TlgTrendWindowPressStartStopButton example

```
{  
//start/stop the actualization  
TlgTrendWindowPressStartStopButton("TrendControl_01");  
}
```

Parameters of the TlgTrendWindowPressStartStopButton function:

"TrendControl\_01" is the window title of WinCC Trend Control.

---

#### Note

Various examples are offered for the function descriptions. For functions with a similar syntax, a selected function is used as a template in the example. This example must be adapted as well.

---

### TlgTrendWindowPressZoomInButton example

```
{  
//zoom in  
TlgTrendWindowPressZoomInButton("TrendControl_01");  
}
```

Parameters of the TlgTrendWindowPressZoomInButton function:

"TrendControl\_01" is the window title of WinCC Trend Control.

### TlgTrendWindowPressZoomOutButton example

```
{  
// zoom out  
TlgTrendWindowPressZoomOutButton("TrendControl_01");  
}
```

Parameters of the TlgTrendWindowPressZoomOutButton function:

"TrendControl\_01" is the window title of WinCC Trend Control.

## 2.15.5 Lists

### 2.15.5.1 Bar direction

Bar direction	Numeric value
Up	0
bottom	1
left	2
right	3

### 2.15.5.2 Bar Scaling

Numeric value	Bar Scaling
0	Linear (same weighting)
1	Logarithmic (low values emphasized)
2	Negative logarithmic (high values emphasized)
3	Automatic (linear)
4	Tangential (high and low values emphasized)
5	Square (high values emphasized)
6	Cubic (high values strongly emphasized)

### 2.15.5.3 Flash frequencies

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

#### Note

Since the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time etc.).

The information in the table is therefore only for orientation purposes.

### 2.15.5.4 I/O field, output format

The display of numeric values output into an I/O field is controlled by a format specification.

A format indication consists of one or several formatting characters. The valid formatting characters and their meaning are listed in the following table:

Charac- ters	Meaning	Note
s	Positive numbers are displayed with signs	Always in the first position of the format specification May only appear once in the format specification
0(ZER O)	Leading and ending zeros are output.	Always following s If s is missing, it is in the first position May only appear once in the format specification
9	Specifies the position of a digit in the number to be output	May appear in the format indication as often as required.
,(com- ma)	Position of the decimal point	
e	Returns the number in exponential form	Always at the last position of the format specification

Example:

Num- ber	Format	Representation
123,4 55	999,999	123,455
123,4 55	999,99	123,46
123,4 55	9999,9999	123,4550
123,4 55	s09999.99 99	+0123,4550
123,4 55	9.99999e	1.23455e+002

If the decimal point is left out in the format specification the decimal places are not displayed and the number is rounded to an integer.

If fewer decimal positions are provided in the format specification than the number actually has, only the decimal places specified in the format specification are output.

The number is rounded correspondingly.

If the number has more places before the decimal point than specified in the format specification, three asterisks (\*\*\*) are output which means that the number cannot be displayed in this format.

**2.15.5.5 I/O field, data type of the field content**

Data type	Numeric value
Binary	0
decimal	1
string	2
hexadecimal	3

**2.15.5.6 I/O field, field type**

Type	Numeric value
Edition	0
Input	1
Output and input	2

**2.15.5.7 Element alignment in check boxes and radio boxes**

Alignment	Numeric value
left	0
right	-1

**2.15.5.8 Color chart**

The 16 primary colors are:

Color	Color value (Hex)	symbolic constant
Red	0x000000FF	CO_RED
Dark red	0x00000080	CO_DKRED
Green	0x0000FF00	CO_GREEN
Dark green	0x00008000	CO_DKGREEN
Blue	0x00FF0000	CO_BLUE



Color	Color value (Hex)	symbolic constant
Dark blue	0x00800000	CO_DKBLUE
Cyan	0x00FFFF00	CO_CYAN
Dark cyan	0x00808000	CO_DKCYAN
Yellow	0x0000FFFF	CO_YELLOW
Dark yellow	0x00008080	CO_DKYELLOW
Magenta	0x00FF00FF	CO_MAGENTA
Dark magenta	0x00800080	CO_DKMAGENTA
Light gray	0x00C0C0C0	CO_LTGRAY
Gray	0x00808080	CO_DKGRAY
Black	0x00000000	CO_BLACK
White	0x00FFFFFF	CO_WHITE

**Note**

The symbolic constants are externally predefined by #define and provided by WinCC.

**2.15.5.9 Format descriptors**

For format descriptors the following type is expected:

%d = DWORD / Int

%f = double

%s = char\*

It is also possible e.g. to read a text tag with %d if provisions are made that the value can be mapped in a DWORD.

The following provision makes sure the value can be mapped:

Variable	Format	C-tag
Bit	%d	DWORD / long int signed
Byte	%d	DWORD / long int signed
SByte	%d	DWORD / long int signed
Word	%d	DWORD / long int signed
SWord	%d	DWORD / long int signed
DWord	%d	DWORD / long int signed
SDWord	%d	DWORD / long int signed

2.15 ANSI-C function descriptions































Variable	Format	C-tag
Float	%f	double
Double	%f	double
Char	%s	char*



















**Note**

If a "DWORD," for which the 32nd bit is set, is to be read, a format descriptor must be used for unsigned integers (%u).

2.15.5.10 Fill pattern

Fill pattern	Value
Transparent	65536
Solid	0






Fill pattern	Value	Fill pattern	Value	Fill pattern	Value
	1048576		196611		196627
	1048577		196612		196628
	1048578		196613		196629
	1048579		196614		196630
	1048832		196615		196631
	1048833		196616		196632
	1048834		196617		196633
	1048835		196618		196634
	131072		196619		196635
	131073		196620		196636

Fill pattern	Value	Fill pattern	Value	Fill pattern	Value
	131074		196621		196637
	131075		196622		196638
	131076		196623		196639
	196608		196624		196640
	196609		196625		196641
	196610		196626		196642




**Note**





The "Solid" fill pattern fills the object with the set background color.

**2.15.5.11 Line styles**

Line style	symbolic name	Value
	LS_SOLID	0
	LS_DASH	1
	LS_DOT	2
	LS_DASHDOT	3
	LS_DASHDOT-DOT	4
hidden	LS_INVISIBLE	5

**2.15.5.12 Line end style**

Line end	symbolic name	Value for the left line ends	Value for the right line ends
	LE_NO	0	0
	LE_HOLLOW_ARROW	1	65536
	LE_FULL_ARROW	2	131072

Line end	symbolic name	Value for the left line ends	Value for the right line ends
	LE_CFULL_ARROW	3	196608
	LE_LINE	4	262144
	LE_HOLLOW_CIRCLE	5	327680
	LE_FULL_CIRCLE	6	393216

**Note**

From a line width > 5 the line end "empty circle" is displayed as filled circle.

**2.15.5.13 List types**

List type	Numeric value
decimal	0
Binary	1
bit	2

**2.15.5.14 Language ID**

WinCC only supports the SUBLANG\_DEFAULT languages of Windows.

symbolic name	Value (hexadecimal)	Abbreviation
LANG_ARABIC	0x0401	
LANG_AFRIKAANS	0x0436	
LANG_ALBANIAN	0x041C	
LANG_BASQUE	0x042D	
LANG_BULGARIAN	0x0402	
LANG_BYELORUSSIAN	0x0423	
LANG_CATALAN	0x0403	
LANG_CHINESE	0x0404	
LANG_CROATIAN	0x041A	
LANG_CZECH	0x0405	CSY
LANG_DANISH	0x0406	DAN
LANG_DUTCH	0x0413	NLD
LANG_ENGLISH	0x0409	ENU
LANG_ESTONIAN	0x0425	
LANG_FAEROESE	0x0438	
LANG_FARSI	0x0429	

symbolic name	Value (hexadecimal)	Abbreviation
LANG_FINNISH	0x040B	FIN
LANG_FRENCH	0x040C	FRA
LANG_GERMAN	0x0407	DEU
LANG_GREEK	0x0408	
LANG_HEBREW	0x040D	
LANG_HUNGARIAN	0x040E	HUN
LANG_ICELANDIC	0x040F	ISL
LANG_INDONESIAN	0x0421	
LANG_ITALIAN	0x0410	ITA
LANG_JAPANESE	0x0411	
LANG_KOREAN	0x0412	
LANG_LATVIAN	0x0426	
LANG_LITHUANIAN	0x0427	
LANG_NORWEGIAN	0x0414	NOR
LANG_POLISH	0x0415	PLK
LANG_PORTUGUESE	0x0416	PTB
LANG_ROMANIAN	0x0418	
LANG_RUSSIAN	0x0419	RUS
LANG_SLOVAK	0x041B	SKY
LANG_SLOVENIAN	0x0424	
LANG_SORBIAN	0x042E	
LANG_SPANISH	0x040A	ESP
LANG_SWEDISH	0x041D	SVE
LANG_THAI	0x041E	
LANG_TURKISH	0x041F	TRK
LANG_UKRAINIAN	0x0422	

### 2.15.5.15 Text alignment

Horizontal	Alignment	Numeric value
	left	0
	centered	1
	right	2

Vertical	Align-ment	Numeric value
	Up	0
	centered	1
	bottom	2

### 2.15.5.16 Tag statuses

Value (decimal)	Value (hex-decimal)	Meaning
0	0x0000	No error
1	0x0001	Connection to partner not established
2	0x0002	Handshake error
4	0x0004	Network module defective
8	0x0008	Configured upper limit exceeded
16	0x0010	Configured lower limit exceeded
32	0x0020	Format upper limit exceeded
64	0x0040	Format lower limit exceeded
128	0x0080	Conversion error
256	0x0100	Tag initialization value
512	0x0200	Tag replacement value
1024	0x0400	Channel addressing error
2048	0x0800	Tag not found or not available
4096	0x1000	Access to tag not permitted
8192	0x2000	Timeout, no check-back message from the channel
16384	0x4000	Server not available.

## 2.15.6 Structure definitions

### 2.15.6.1 Structure definition CCAPErrExecute

```
typedef struct {
  DWORD dwCurrentThreadID; Thread ID of the current thread
  DWORD dwErrorCode1;      Error code 1
  DWORD dwErrorCode2;      Error code 2
  BOOL bCycle;             cycle/acycle
  char* szApplicationName; Name of the application
  char* szFunctionName;    Name of the function
  char* szTagName;         Name of the tag
  LPVOID lpParam;          Pointer to the action stack
  DWORD dwParamSize;       Size of the action stack
  DWORD dwCycle;           Cycle of the variable
  CMN_ERROR* pError;       Pointer to CMN_ERROR
} CCAPErrExecute;
```

#### Members

The meaning of the individual error IDs and the structure elements depending on them are specified in the following table:

dwErrorCode1	dwErrorCode2	bCycle	szApplicationName	szFunctionName	szTagName	lpParamSize	dwParamSize	dwCycle	pError	Description
1007001	0	X	X	X		X	X			Action requires exception
1007001	1	X	X	X		X	X			Exception when accessing the return result
1007001	4097	X	X	X		X	X			Stack overflow while executing the action
1007001	4098	X	X	X		X	X			The action contains a division by 0
1007001	4099	X	X	X		X	X			The action contains an access to a non-existing symbol
1007001	4100	X	X	X		X	X			The action contains an access violation
1007004	0	X	X	X						Function is not known

2.15 ANSI-C function descriptions

1007005	1	X	X							Action does not include a P code.
1007005	2	X	X							Incorrect function name
1007005	4	X	X	X		X	X			Return value type is invalid
1007005	32768ff	X	X	X		X	X			Ciss Compiler error when loading the action
1007006	0	X	X	X	X	X	X	X		Tag is not defined
1007006	1	X	X	X	X	X	X	X		Tag timeout
1007006	2	X	X	X	X	X	X	X	X	Tag cannot be returned in the desired format
1007006	3	X	X	X	X	X	X	X	X	Tag returns status violation, status present in CMN_ERROR.dwError1
1007007	1	X	X	X		X	X		X	Error in PDLRTGetProp
1007007	2	X	X	X		X	X		X	Error in PDLRTSetProp
1007007	3	X	X	X		X	X		X	Error with DM call

**Error structure**

The OnErrorExecute function uses the error structure to evaluate or to output error messages, if marked by an "x" in the pError column.

**See also**

Structure definition CMN\_ERROR (Page 1601)

**2.15.6.2 Structure definition CCAPTime**

```
typedef struct {
    DWORD dwCurrentThreadID; ThreadID of the current Thread
    DWORD dwCode;           Code
    BOOL bCycle;           cycle/acycle
    char* szApplicationName; Name of the Application
    char* szFunctionName;   Name of the Function
    LPVOID lpParam;        Pointer to the Action-Stack
    DWORD dwParamSize;     size of the Action-Stack
    double dblTime;
    DWORD dwFlags;         flags
} CCAPTime;
```



## Members

### dwCode

The structure element dwCode provides information on calling OnTime:

dwCode = 113	Call with time definition for each action
dwCode = 114	Call with time monitoring for each action

### dwFlags

The structure element dwFlags provides information on the output type:

dwFlags = TRUE	The results are output to a file
dwFlags = FALSE	The results are output to the diagnostics window

### 2.15.6.3 Structure definition CMN\_ERROR

```

struct CMNERRORSTRUCT {
DWORD      dwError1,
DWORD      dwError2,
DWORD      dwError3,
DWORD      dwError4,
DWORD      dwError5;
TCHAR      szErrorText[MAX_ERROR_LEN];
}
CMN_ERROR

```

## Description

The extended error structure contains the error code and an error text for the error that has occurred. Each application can use the error structure to evaluate or to output error messages.

## Members

### dwError1 .. dwError5

These entries can be used in any way by the API functions.

The API descriptions inform about the values the respective entries contain in case of an error. If not specified otherwise, the error codes are present in dwError1.

**szErrorText**

Buffer for the text description of the error cause

The content is determined from the resources and therefore language-dependent.

**2.15.6.4 Structure definition DM\_TYPEREF**

```
typedef struct {
    DWORD dwType;
    DWORD dwSize;
    char szTypeName[MAX_DM_TYPE_NAME + 1];
}
DM_TYPEREF;
```

**Members**

**dwType**

Specifies the tag type

DM_VARTYPE_BIT	Binary tag
DM_VARTYPE_SBYTE	Signed 8-bit value
DM_VARTYPE_BYTE	Unsigned 8-bit value
DM_VARTYPE_SWORD	Signed 16-bit value
DM_VARTYPE_WORD	Unsigned 16-bit value
DM_VARTYPE_SDWORD	Signed 32-bit value
DM_VARTYPE_DWORD	Unsigned 32-bit value
DM_VARTYPE_FLOAT	Floating-point number 32-bit IEEE 754
DM_VARTYPE_DOUBLE	Floating-point number 64-bit IEEE 754
DM_VARTYPE_TEXT_8	Text tag, 8-bit font
DM_VARTYPE_TEXT_16	Text tag, 16-bit font
DM_VARTYPE_RAW	Raw data type
DM_VARTYPE_STRUCT	Structure tag
DM_VARTYPE_TEXTREF	Text reference tag

**dwSize**

Specifies the length of the data type in bytes.

**szTypeName**

In the case of structure tags, contains the name of the structure type

### 2.15.6.5 Structure definition DM\_VAR\_UPDATE\_STRUCT

```
typedef struct {  
    DM_TYPEREF dmTypeRef;  
    DM_VARKEY dmVarKey;  
    VARIANT dmValue;  
    DWORD dwState;  
}  
DM_VAR_UPDATE_STRUCT;
```

#### Members

##### **dmTypeRef**

Contains information on the tag type. For performance reasons, nothing is entered into this structure in case of cyclic requirements.

##### **dmVarKey**

Specifies the tags to be edited.

##### **dmValue**

Tag value

Upon access to the value of the VARIANT a ".u." has to be inserted between the name of the VARIANT and the name of the member.

Example:

```
// Supply variant  
myVariant.vt = VT_I4;  
myVariant.u.lVal = 233;
```

A description of the data type VARIANT can be found in the associated documentation. The VARIANT dmValue must be initialized with VariantInit() before first use and enabled again with VariantClear(&dmValue) after use. For this reason, the structure DM\_VAR\_UPDATE\_STRUCT must not be deleted with ZeroMemory() or memset().

##### **dwState**

Identifies the tag status.

#### See also

Tag statuses (Page 1598)

Structure definition DM\_VARKEY (Page 1605)

Structure definition DM\_TYPEREF (Page 1602)

### 2.15.6.6 Structure definition DM\_VAR\_UPDATE\_STRUCTEX

```
typedef struct {  
    DM_TYPEREF dmTypeRef;  
    DM_VARKEY dmVarKey;  
    VARIANT dmValue;  
    DWORD dwState;  
    DWORD dwQualityCode;  
}  
DM_VAR_UPDATE_STRUCTEX;
```

#### Members

##### **dmTypeRef**

Contains information on the tag type. For performance reasons, nothing is entered into this structure in case of cyclic requirements.

##### **dmVarKey**

Specifies the tags to be edited.

##### **dmValue**

Tag value

Upon access to the value of the VARIANT a ".u." has to be inserted between the name of the VARIANT and the name of the member.

Example:

```
// Supply variant  
myVariant.vt = VT_I4;  
myVariant.u.lVal = 233;
```

A description of the data type VARIANT can be found in the associated documentation. The VARIANT dmValue must be initialized with VariantInit() before first use and enabled again with VariantClear(&dmValue) after use. For this reason, the structure DM\_VAR\_UPDATE\_STRUCTEX must not be deleted with ZeroMemory() or memset().

##### **dwState**

Identifies the tag status.

##### **dwQualityCode**

Identifies the tag quality code.

## See also

Tag statuses (Page 1598)

Structure definition DM\_VARKEY (Page 1605)

Structure definition DM\_TYPEREF (Page 1602)

### 2.15.6.7 Structure definition DM\_VARKEY

```
typedef struct {
    DWORD dwKeyType;
    DWORD dwID;
    char szName[ MAX_DM_VAR_NAME + 1 ];
    LPVOID lpvUserData;
}
DM_VARKEY;
```

## Members

### dwKeyType

Defines whether the tag is to be addressed by a key ID or by its name.

DM\_VARKEY\_ID Specification via key ID

DM\_VARKEY\_NAME Specification via tag name

### dwID

Contains the key ID of the tags if dwKeyType is set accordingly

### szName

Contains the name of the tag if dwKeyType is set accordingly

### lpvUserData

Pointer to application-specific data

### 2.15.6.8 Structure definition LINKINFO

```
typedef struct {
    LINKTYPE LinkType;
    DWORD dwCycle;
    TCHAR szLinkName[256];
}
LINKINFO;
```

**Members**

**LinkType**

LinkType are enumeration constants defined in the "Trigger.h" file. They are to be integrated into your script with the #include "Trigger.h" command and the corresponding enumeration constants.

BUBRT_LT_NOLINK	0	no shortcut
BUBRT_LT_VARIABLE_DIRECT	1	direct tag
BUBRT_LT_VARIABLE_INDIRECT	2	indirect tag
BUBRT_LT_ACTION	3	C action
BUBRT_LT_ACTION_WIZARD	4	Dynamic Dialog
BUB_LT_DIRECT_CONNECTION	5	Direct connection
BUBRT_LT_ACTION_WIZARD_INPROC	6	Dynamic Dialog

For the function SetLink only the enumeration constants BUBRT\_LT\_VARIABLE\_DIRECT and BUBRT\_LT\_VARIABLE\_INDIRECT may be used. The function GetLink allows to return all listed enumeration constants.

**dwCycle**

Update cycle time

dwCycle	Update Cycle
255	Picture cycle
235	Window Cycle
0	Upon change
1	250ms
2	500 ms
3	1 s
4	2 s
5	5s
6	10s
7	1min
8	5min
9	10min
10	1h
11-15	User cycle 1-5

**szLinkName**

Tag name

### 2.15.6.9 Structure definition MSG\_FILTER\_STRUCT

```
typedef struct {
  CHAR      szFilterName[MSG_MAX_TEXTLEN+1];
  WORD      dwFilter;
  SYSTEMTIME st[2];
  DWORD     dwMsgNr[2];
  DWORD     dwMsgClass;
  DWORD     dwMsgType[MSG_MAX_CLASS];
  DWORD     dwMsgState;
  WORD      wAGNr[2];
  WORD      wAGSubNr[2];
  DWORD     dwArchivMode;
  char      szTB[MSG_MAX_TB] [
MSG_MAX_TB_CONTENT+1]
  DWORD     dwTB;
  Double    dPValue[MSG_MAX_PVALUE][2];
  DWORD     dwPValue[2];
  DWORD     dwMsgCounter[2];
  DWORD     dwQuickSelect;
}
MSG_FILTER_STRUCT;
```

#### Description

In this structure the filter criteria are specified.

#### Members

##### dwFilter

The filter conditions are defined by means of the following constants from the file "m\_global.h":

MSG_FILTER_DATE_FROM	Date from
MSG_FILTER_DATE_TO	Date to
MSG_FILTER_TIME_FROM	Time from
MSG_FILTER_TIME_TO	Time to
MSG_FILTER_NR_FROM	Message number from
MSG_FILTER_NR_TO	Message number to
MSG_FILTER_CLASS	Message classes
MSG_FILTER_STATE	Message status
MSG_FILTER_AG_FROM	AS number from
MSG_FILTER_AG_TO	AS number to
MSG_FILTER_AGSUB_FROM	AG subnumber from
MSG_FILTER_AGSUB_TO	AG subnumber to
MSG_FILTER_TEXT	Message texts
MSG_FILTER_PVALUE	Process values

MSG_FILTER_COUNTER_FROM	Internal message counter from
MSG_FILTER_COUNTER_TO	Internal message counter to
MSG_FILTER_PROCESSMSG	Process messages
MSG_FILTER_SYSMMSG	System messages
MSG_FILTER_BEDMSG	Operator messages
MSG_FILTER_DATE	Date from to
MSG_FILTER_TIME	Time from to
MSG_FILTER_NR	Message number from to
MSG_FILTER_VISIBLEONLY	Display visible messages
MSG_FILTER_HIDDENONLY	Display hidden messages

**st**

Date/time from - to

Where st[0] is the start time (from), st[1] the end time (to)

Assign these fields for the filter criteria: MSG\_FILTER\_DATE, MSG\_FILTER\_DATE\_FROM, MSG\_FILTER\_DATE\_TO, MSG\_FILTER\_TIME, MSG\_FILTER\_TIME\_FROM or MSG\_FILTER\_TIME\_TO

If a current time is needed for the transfer of a SYSTEMTIME parameter the function GetLocalTime is to be used instead of GetSystemTime. As a rule there is a significant time difference between these two functions.

**dwMsgNr**

Message number from - to

Where dwMsgNr[0] is the start no. (from), dwMsgNr[1] the end no. (to)

Assign these fields for the filter criteria: MSG\_FILTER\_NR, MSG\_FILTER\_NR\_FROM or MSG\_FILTER\_NR\_TO

**dwMsgClass**

Message classes bit-coded.

Assign this field for the filter criterion: MSG\_FILTER\_CLASS

**dwMsgType**

Message type per message class, bit-coded

Assign this field for the filter criterion: MSG\_FILTER\_CLASS

**dwMsgState**

Message status bit-coded.

Assign this field for the filter criterion: MSG\_FILTER\_STATE

**wAGNr**

AGNr from - to

Assign these fields for the filter criteria: MSG\_FILTER\_AG\_FROM or MSG\_FILTER\_AG\_TO



**wAGSubNr**

AGSubNr from - to

Assign this field for the filter criteria: MSG\_FILTER\_AGSUB\_FROM or MSG\_FILTER\_AGSUB\_TO

**dwArchivMode**

Archiving / logging

Must be assigned 0.

**szTB**

Texts of the text blocks

Assign these fields for the filter criterion: MSG\_FILTER\_TEXT

**dwTB**

Active text blocks (from - to, bit-coded)

Assign this field for the filter criterion: MSG\_FILTER\_TEXT

**dPValue**

Process values from - to

Assign these fields for the filter criterion: MSG\_FILTER\_PVALUE

**dwPValue**

Active process values (from - to, bit-coded)

Assign this field for the filter criterion: MSG\_FILTER\_PVALUE

**dwMsgCounter**

Internal message counter from - to

Assign these fields for the filter criteria: MSG\_FILTER\_COUNTER\_FROM, MSG\_FILTER\_COUNTER\_TO

**dwQuickSelect**

Quick selection for hour, day, month

The parameter is reserved for future upgrades and must be preset to 0.

Assign this field for the filter criterion: MSG\_FILTER\_QUICKSELECT

LOWORD type:

MSG_FILTER_QUICK_MONTH	Quick selection last n months
MSG_FILTER_QUICK_DAYS	Quick selection last n days
MSG_FILTER_QUICK_HOUR	Quick selection last n hours

HIWORD number: 1...n

The end time of the quick selection refers to the current system time of the local computer. The start time is calculated back n \* ( months, days, hours ).

**2.15.6.10 Structure definition MSG\_RTDATA\_STRUCT**

```
typedef struct {
    DWORD          dwMsgState;
    DWORD          dwMsgNr;
    SYSTEMTIME     stMsgTime;
    DWORD          dwTimeDiff;
    DWORD          dwCounter;
    DWORD          dwFlags;
    WORD           wPValueUsed;
    WORD           wTextValueUsed;
    double         dPValue[MSG_MAX_PVALUE];
    MSG_TEXTVAL_STRUCT mtTextValue[MSG_MAX_PVALUE];
}
MSG_RTDATA_STRUCT;
```

**Members**

**dwMsgState**

Message status

MSG_STATE_COME	0x00000001	Message came in
MSG_STATE_GO	0x00000002	Message went out
MSG_STATE_QUIT	0x00000003	Message acknowledged
MSG_STATE_LOCK	0x00000004	Message locked
MSG_STATE_UNLOCK	0x00000005	Message unlocked
MSG_STATE_QUIT_SYSTEM	0x00000010	Message acknowledged by system
MSG_STATE_QUIT_EMERGENCY	0x00000011	Emergency acknowledgement
MSG_STATE_QUIT_HORN	0x00000012	Horn acknowledgement
MSG_STATE_COMEGO	0x00000013	Message came in and went out, only display in message list
MSG_STATE_UPDATE	0x00010000	Bit for message update
MSG_STATE_RESET	0x00020000	Bit for message reset
MSG_STATE_SUMTIME	0x00040000	Bit active for daylight savings time
MSG_STATE_INSTANCE	0x00080000	Bit for instance message (n messages of a no.)

**dwMsgNr**

Message number

**stMsgTime**

Date/Time: Telegram time depending on the calling function

**dwTimeDiff**

Duration coming/Telegram time in seconds

**dwCounter**

Internal message counter

**dwFlags**

Message flags in the database

MSG_FLAG_SUMTIME	0x00000001	Daylight savings time active
MSG_FLAG_COMMENT	0x00000002	Message has comments
MSG_FLAG_ARCHIV	0x00000004	Archiving
MSG_FLAG_PROTOCOL	0x00000008	Logging
MSG_FLAG_TEXTVALUES	0x00000010	Message has values accompanying the text
MSG_FLAG_TIMEINVALID	0x00000020	Bit for invalid date/time stamp
MSG_FLAG_INSTANCE	0x00000040	Instance message identification (185269)

**wPValueUsed**

Process values used, bit-coded. Every bit may only be set in one of the two structure elements "wPValueUsed" or "wTextValueUsed". An accompanying value may either be a number or a text.

**wTextValueUsed**

text values used, bit-coded. Every bit may only be set in one of the two structure elements "wPValueUsed" or "wTextValueUsed". An accompanying value may either be a number or a text.



# VBA for Automated Configuration

## 3.1 Automated configuration

### Contents

You can use VBA to automate configuration in Graphics Designer. This comprises:

- Adaptation of the Graphics Designer
- Editing of pictures
- Editing of objects
- Dynamizing with VBA
- Access to external applications

A VBA editor is available for this purpose in the "Graphics Designer" editor.

This chapter contains

- a brief introduction on how to use VBA in WinCC,
- basic information on using VBA in Graphics Designer and
- reference to the VBA object model in Graphics Designer.

## 3.2 Introduction: Using VBA in WinCC

### 3.2.1 Introduction: Using VBA in WinCC

#### Introduction

You have a VBA editor available in Graphics Designer which allows you to configure pictures automatically. The VBA editor is identical to the one from the products in the Microsoft Office family. You can make direct use of your VBA programming experience.

#### Principle

With VBA you extend the functionality of the Graphics Designer and automate configuring. You may use VBA in Graphics Designer as follows, including:

- Creating user-defined menus and toolbars
- Creating and editing Standard, Smart and Windows objects
- Adding dynamics to properties of pictures and objects
- Configuring actions in pictures and objects
- Accessing products that support VBA (e.g. products in the MS Office family)

A description of the VBA object model for the Graphics Designer is provided in this documentation in the section under "VBA Reference".

#### See also

Organizing VBA Code in a WinCC Project (Page 1615)

VBA Reference (Page 1745)

VBA in the Graphics Designer (Page 1621)

Executing VBA Macros in Graphics Designer (Page 1619)

Differentiation: Using VBA (Page 1614)

### 3.2.2 Differentiation: Using VBA

#### Introduction

You can use VBA exclusively for configuration and functional enhancement in the Graphics Designer. The following indicates where there are better options available for efficient configuration or where VBA cannot be used.

## VB and C Scripts

VB and C scripts are active only at runtime and are used to dynamize picture and object properties as well as in action configuration.

## Dynamic Wizards

The dynamic wizards are not replaced by VBA. However, VBA allows you to enhance the functionality of the dynamic wizards with ease.

## ODK

ODK comprises function calls that enable access to all the functionality of WinCC both in the configuration system and in runtime. In contrast to ODK, VBA offers simple object-oriented access to the objects of the Graphics Designer.

## See also

VBA in the Graphics Designer (Page 1621)

Executing VBA Macros in Graphics Designer (Page 1619)

Organizing VBA Code in a WinCC Project (Page 1615)

Introduction: Using VBA in WinCC (Page 1614)

## 3.2.3 Organizing VBA Code in a WinCC Project

### Introduction

You organize the VBA code for your WinCC project in the VBA editor. This is where you specify whether the VBA code is to be available in only one picture, in the entire project or in all projects. Depending on where you place the VBA code, the term used to refer to the code is:

- global VBA code,
- project-specific VBA code or
- picture-specific VBA code.

---

**Note**


A picture in the Graphics Designer is known as a "document" in the VBA object model.

---

### The VBA editor

To start the VBA editor in the Graphics Designer, press <ALT+F11> or choose "Tools" > "Macros" > "Visual Basic Editor". If you have not yet opened a picture in the Graphics Designer, you can only edit the global or project-specific VBA code.

The global and project-specific data and all open pictures are displayed in the VBA editor's Project Explorer:

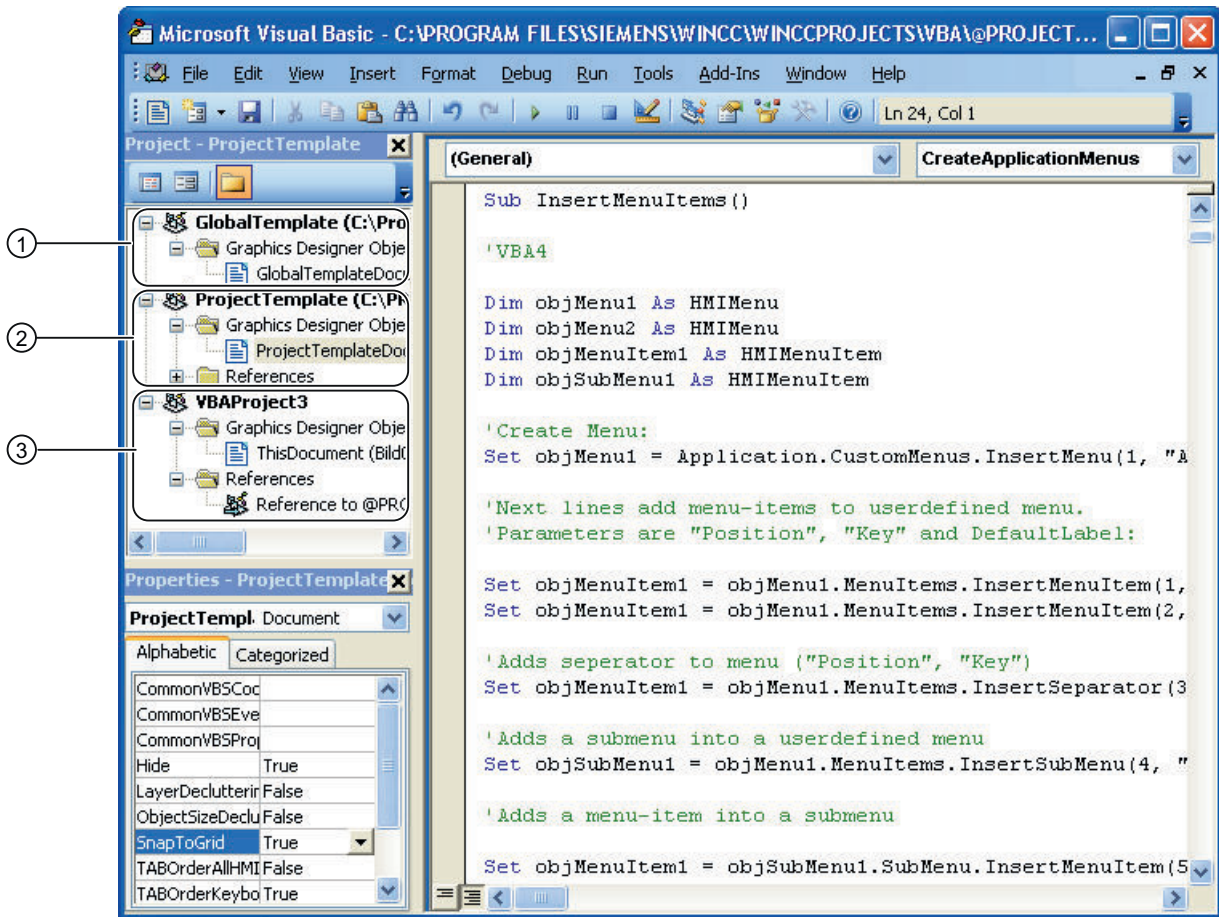

### Global VBA code (1)

Refers to VBA code that you write to the "GlobalTemplateDocument" in the VBA editor. This VBA code is saved in the "@GLOBAL.PDT" file, which is located in the WinCC installation directory.

The VBA code that you put in the "GlobalTemplateDocument" is the code that you want to be made available in all WinCC projects on your computer. If you need the VBA code on a different computer, use the export and import functions in the VBA editor.

A WinCC computer uses only the @GLOBAL.PDT stored locally in the WinCC installation directory (... \Siemens\WinCC\Templates).

### Note

When you perform an update installation, your global "@Global.pdt" template is saved in the "@Global.sav" backup file. The backup file is saved in the ... \Siemens\WinCC\Templates directory. Your VBA code from the old global template is not automatically applied to the new global template.

### Applying the VBA Code from the Old Global Template:



In order to apply the VBA code from the old template after an update installation, proceed as follows:

1. If you have already entered VBA code into the new global template, open the VBA editor in the Graphics Designer and copy the VBA code.
2. Close WinCC.
3. Open the ...\\Siemens\\WinCC\\Templates directory in Windows Explorer.
4. Delete the new global template "@Global.pdt".
5. Rename the "@Global.sav" backup file to "@Global.pdt".
6. If you have already copied VBA code from the new global template, open the VBA editor in the Graphics Designer and insert the copied VBA code.

The VBA code from your old global template is available again.

### **Project-specific VBA code (2)**

Refers to VBA code that you write to the "ProjectTemplateDocument" in the VBA editor. This VBA code is saved in the "@PROJECT.PDT" file, which is located in the root directory of each WinCC project.

The "@PROJECT.PDT" file has a reference to the "@GLOBAL.PDT" file. Functions and procedures which you have saved in the "@GLOBAL.PDT" file can be called up directly in the "ProjectTemplateDocument".

The "ProjectTemplateDocument" is where you put VBA code that you want to use in all pictures in the open project. If you need the VBA code on a different computer, use the export and import functions in the VBA editor.

You can open and edit the "@PROJECT.PDT" file in the same way as a PDL file. This will allow you to use the "@PROJECT.PDT" file as a template: For example, you may create there the basic picture of your system which will then be automatically transferred into each new PDL file of the project. Picture properties such as layers or zoom are not copied to the PDL file, nor is the VBA code.

### **Picture-specific VBA code (3)**

Refers to VBA code that you write to the document "This Document" relating to the corresponding picture in the VBA editor. This VBA code is saved as a PDL file together with the picture.

The PDL file has a reference to the "@PROJECT.PDT" file. Functions and procedures which you have saved in the "@PROJECT.PDT" file can be called up directly from the PDL file. However, you do not have access to functions or procedures that are stored in the "@GLOBAL.PDT" file.

---

### **Note**

You can create modules, class modules and user forms in each document.

You can protect the VBA code of a module against unauthorized access by setting a password. To do this, select the "Tools" > "VBAObject Properties" menu item in the VBA editor.

---

### Special features during the execution of VBA macros

For the execution of VBA macros, the following applies: Initially picture-specific VBA code is executed, followed by project-specific VBA code. If therefore you call a VBA macro that is contained for example both in the picture and in the project-specific VBA code, only the VBA macro from the picture is executed. This has the effect of preventing VBA macros and functions from being executed twice, which otherwise can lead to errors.

In connection with event handling the forwarding of events is activated by default. You can prevent events from being forwarded if you want to respond to an event in the picture-specific VBA code only.

Additional information on this topic is given under "Event Handling".

### Testing with the Debugger

You can test your VB scripts at runtime with the VBA editor's debugger. You may find additional information in the help system of the VBA editor.

### See also

Event Handling (Page 1709)

VBA in the Graphics Designer (Page 1621)

Executing VBA Macros in Graphics Designer (Page 1619)

How to export and import VBA code (Page 1618)

## 3.2.4 How to export and import VBA code

### Principle

In the VBA editor you can import and export VBA code, enabling you to transfer it to another computer. References to procedures and functions which you call within the project are therefore retained.

---

#### Note

When you import VBA code you must enter references to external libraries manually after the import process, on the target computer.

---

### Procedure

#### Exporting VBA code

1. In the VBA editor's Project Explorer, select the module, whose VBA code you want to export.
2. Choose the "File" > "Export File menu command".

3. Select the path and enter the file name.
4. Click "Save".

The VBA code is exported to a file. The file type depends on the module from which the VBA code was exported.

#### Importing VBA code

1. In the VBA editor's Project Explorer, select the document into which you want to import the VBA code.
2. Choose the menu option "File" > "Import File".
3. Select the file and click "Open" in order to import the VBA code as "ThisDocument" into the "Class Modules" folder.
4. In the "Class Modules" folder, open the document "ThisDocument" and copy the VBA code into the document in the required project.

#### See also

Organizing VBA Code in a WinCC Project (Page 1615)

## 3.2.5 Executing VBA Macros in Graphics Designer

### Introduction

Three possibilities are available to you for executing VBA macros in the Graphics Designer:

- Event Handling
- User-defined menu or toolbar
- VBA editor

### Event Handling

Predefined events (such as the opening of a picture) can occur in the Graphics Designer, the active picture or the component library, to which you can respond with VBA event handlers. These events occur only during configuring in the Graphics Designer and have nothing to do with the events of action configuring.

In this example, a brief message is to be issued when a picture is opened. The "Opened event" is used for this:

```
Private Sub Document_Opened(CancelForwarding As Boolean)
MsgBox ("Picture was opened!")
End Sub
```

Further information on the subject of event handling is provided under "Event handling" and "Events".

### User-defined menu or toolbar

VBA allows you to create user-defined menus and toolbars in the Graphics Designer. You can assign a VBA macro to each user-defined menu entry or icon; this macro is then executed when you click on the menu entry or the icon. This way you can extend the functionality of the Graphics Designer to suit your requirements.

Further information on the creation of user-defined menus and toolbars is provided under "Creating your own menus and toolbars".

### VBA editor

You can start a VBA macro in the VBA editor by pressing <F5>. If you press <F8>, you can execute a VBA macro step by step.

### See also

VBA Reference (Page 1745)

Event Handling (Page 1709)

Creating Customized Menus and Toolbars (Page 1627)

VBA in the Graphics Designer (Page 1621)

Organizing VBA Code in a WinCC Project (Page 1615)

Introduction: Using VBA in WinCC (Page 1614)

## **3.3 VBA in the Graphics Designer**

### **3.3.1 VBA in the Graphics Designer**

#### **Introduction**

You use VBA in the Graphics Designer in order to automate frequently recurring steps during configuring. You can create user-defined menus and toolbars in order to make it easier to execute the VBA macros that you have created.

Basically, in the Graphics Designer you can replace all configuring work that you would otherwise perform with the mouse with VBA macros. This applies in particular to the GUI (layers and zoom) and the editing of objects in pictures including dynamics.

#### **Adapting the Graphics Designer with VBA**

The Graphics Designer is represented by the Application object in VBA. With VBA you can carry out configuring in the Graphics Designer in several languages, create user-defined menus and toolbars and access the component library.

#### **Editing Pictures with VBA**

A picture in the Graphics Designer is represented by the Document object.

With VBA you can access the properties of the picture and edit settings for layers and the zoom factors. As well as this you can create picture-specific menus and toolbars. These are only visible, however, for as long as the picture is active.

#### **Editing Objects with VBA**

An object in the picture is represented by the HMIObjekt object. With VBA you can create and delete objects and access the object properties. For example, with VBA you can very quickly create a large number of objects with identical properties for your plant display.

#### **Creating Dynamics with VBA**

VBA enables you to add dynamics to properties and events of pictures and objects.

#### **Event Handling**

With VBA you can respond to events that occur in the Graphics Designer or in a picture, for example when you insert a new object into a picture. You use event handling in order to execute VBA macros in certain program situations.

## Access to external applications

You can use VBA to access programs which support VBA, for example products in the Microsoft Office family. This means that you have an opportunity to read values from an Excel table and then assign them to object properties.

---

### Note

#### Access to applications that were compiled with .net

You need to recompile applications that were compiled with .net to enable access to VBA in Graphics Designer.

---

## See also


Editing Pictures with VBA (Page 1654)  
SymbolLibrary Object (Page 2074)  
HMIObjekt Object (Page 1988)  
Document Object (Page 1949)  
Application Object (Page 1909)  
Accessing External Applications with VBA (Page 1713)  
Event Handling (Page 1709)  
Creating Dynamics with VBA (Page 1686)  
Editing Objects with VBA (Page 1660)  
Adapting the Graphics Designer with VBA (Page 1623)  
Introduction: Using VBA in WinCC (Page 1614)

## 3.3.2 Adapting the Graphics Designer with VBA

### 3.3.2.1 Adapting the Graphics Designer with VBA

#### Introduction

In VBA the Application object represents the Graphics Designer:

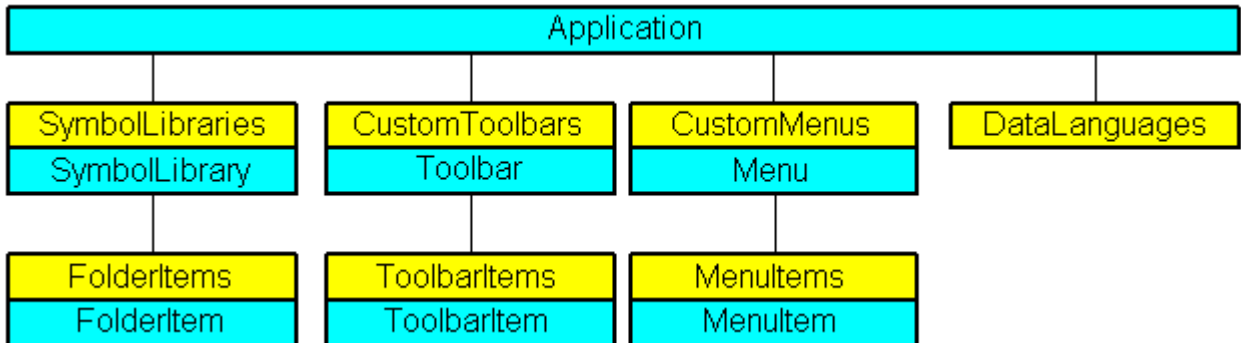

#### Access to the component library

VBA gives you full access to the component library. You can extend the component library with VBA by for example creating and deleting folders or copying objects and inserting them into a picture.

#### User-defined menus and toolbars

You can create user-defined menus and toolbars in order to execute VBA macros in the Graphics Designer. In this way you can extend the functionality of the Graphics Designer to suit your particular requirements.

#### Language-dependent configuring

With VBA you can carry out configuring in the Graphics Designer in more than one language. You therefore have access to the language-dependent object properties and you can create the user-defined menus and toolbars in different languages.

#### See also

- Editing Pictures with VBA (Page 1654)
- Accessing the component library with VBA (Page 1646)
- Creating Customized Menus and Toolbars (Page 1627)
- Language-Dependent Configuration with VBA (Page 1624)
- VBA in the Graphics Designer (Page 1621)

### 3.3.2.2 Language-Dependent Configuration with VBA

#### Introduction

With VBA you can carry out configuring in the Graphics Designer for several different languages. This gives you access to the language-dependent properties of objects in the Graphics Designer, while you can also make the user-defined menus and toolbars available in different languages. In VBA, foreign-language texts are stored in a list of the "LanguageTexts" type. The settings for language-dependent fonts are stored in a list of the "LanguageFonts" type.

Further information about language-dependent configuring is also provided in the WinCC documentation "Setting up multilingual projects".

#### User interface language

You can only switch to a different desktop language in WinCC, not with VBA. When you switch desktop language in WinCC, the "DesktopLanguageChanged" event is triggered. You can adapt the user-defined menus and toolbars to suit the user, for example, by replacing language-dependent tool icons.

The following objects and the associated language-dependent properties react to the switching of the user interface language:

- FolderItem Object
- Menu object and MenuItem object
- ToolbarItem Object
- Further information about the desktop language is provided in the WinCC documentation "Setting up multilingual projects" under "Language terms in WinCC".

As of WinCC V7.3, VBA is installed in all languages that you have selected in the WinCC setup. When you open the "VBA" editor in the Graphics Designer, the "VBA" editor opens in the same user interface language as the Graphics Designer.

#### Project language

You can change the configuring language with VBA using the "CurrentDataLanguage" property.

In this example the configuring language is changed to "English":

```
Sub ChangeCurrentDataLanguage()  
'VBA1  
Application.CurrentDataLanguage = 1033  
MsgBox "The Data language has been changed to english"  
Application.CurrentDataLanguage = 1031  
MsgBox "The Data language has been changed to german"  
End Sub
```

All language-dependent properties, such as ToolTipText, are affected by the change.



## Configuring for more than one language in VBA

There are two possible ways for you to carry out configuring for several languages with VBA.

- Language switching: Text properties of objects.
- Text language lists: Text properties of user-defined menus and toolbars, and objects.

### Language change

You can change the language-dependent properties (e.g., "Text") of objects with VBA. To do this, assign the text to the corresponding property and then change the configuring language in order to assign the text in the other language.

### LanguageTexts listing

You can save the multilingual texts for the respective object directly in the associated listing of the "LanguageTexts" type. To do this, enter the language ID for the language and the associated text.

The list of language codes is available in the WinCC documentation (Index > Language Code).

In this example a German label and an English label are assigned to the button "myButton":

```
Sub AddLanguagesToButton()  
'VBA2  
Dim objLabelText As HMILanguageText  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
'  
'Set defaultlabel:  
objButton.Text = "Default-Text"  
'  
'Add english label:  
Set objLabelText = objButton.LDTexts.Add(1033, "English Text")  
'Add german label:  
Set objLabelText = objButton.LDTexts.Add(1031, "German Text")  
End Sub
```

## See also

[LanguageTexts Object \(Listing\) \(Page 2000\)](#)

[LanguageFonts Object \(Listing\) \(Page 1997\)](#)

[How to assign help texts to menus and toolbars \(Page 1639\)](#)

[How to create menus in multiple languages \(Page 1633\)](#)

[VBA Reference \(Page 1745\)](#)


### 3.3.2.3 Creating Customized Menus and Toolbars

#### Configuring Menu and Toolbars

##### Introduction

You can "liven up" user-defined menus and toolbars so that they respond to certain program situations in the Graphics Designer. For example, if an icon is not available because no object is selected, you can gray out the icon. A check mark before a menu item can indicate, for example, whether a selection is activated.

The following illustration shows you the configuration possibilities, using the example of a user-defined menu:

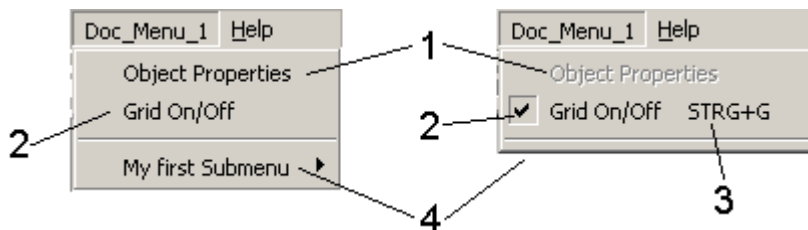

##### Active (yes/no) (1)

Activates the entry or dims it. You can use the "Enabled" property for user-defined menus, menu items and icons:

```
'VBA13  
Application.ActiveDocument.CustomMenus(1).MenuItems(1).Enabled = False
```

##### Marked with check mark (yes/no) (2)

Marks the menu item with a check mark. You can only use the "Checked" property for user-defined menu items:

```
'VBA14  
Application.ActiveDocument.CustomMenus(1).MenuItems(2).Checked = True
```

##### Shortcut (3)

Defines a key combination for a menu item or an icon. You can only use the "Shortcut" property for user-defined menu items and icons:

```
'VBA15  
Application.ActiveDocument.CustomMenus(1).MenuItems(3).Shortcut = "Ctrl+G"
```

### **Visible (yes/no) (4)**

Displays or hides the item. You can use the "Visible" property for user-defined menus, menu items and toolbars and for their icons:

```
'VBA16  
Application.ActiveDocument.CustomMenus(1).MenuItems(4).Visible = False
```

## **Creating Customized Menus and Toolbars**


### **User-defined menus and toolbars in the Graphics Designer**

You can use the following user-defined menus and toolbars in the Graphics Designer to run VBA macros:

- User-defined menus and toolbars are always visible when the Graphics Designer is open. You should use application-specific menus and toolbars when the VBA macros that are to be executed from them have to be accessible at all times.
- Picture-specific menus and toolbars are linked to a specific picture and remain visible for as long as the picture is active. You should use picture-specific menus and toolbars when the VBA macros used there are relevant only for that particular picture.

### Positioning of user-defined menus and toolbars

In the case of user-defined menus, the "Position" parameter determines the final positioning in the menu bar:

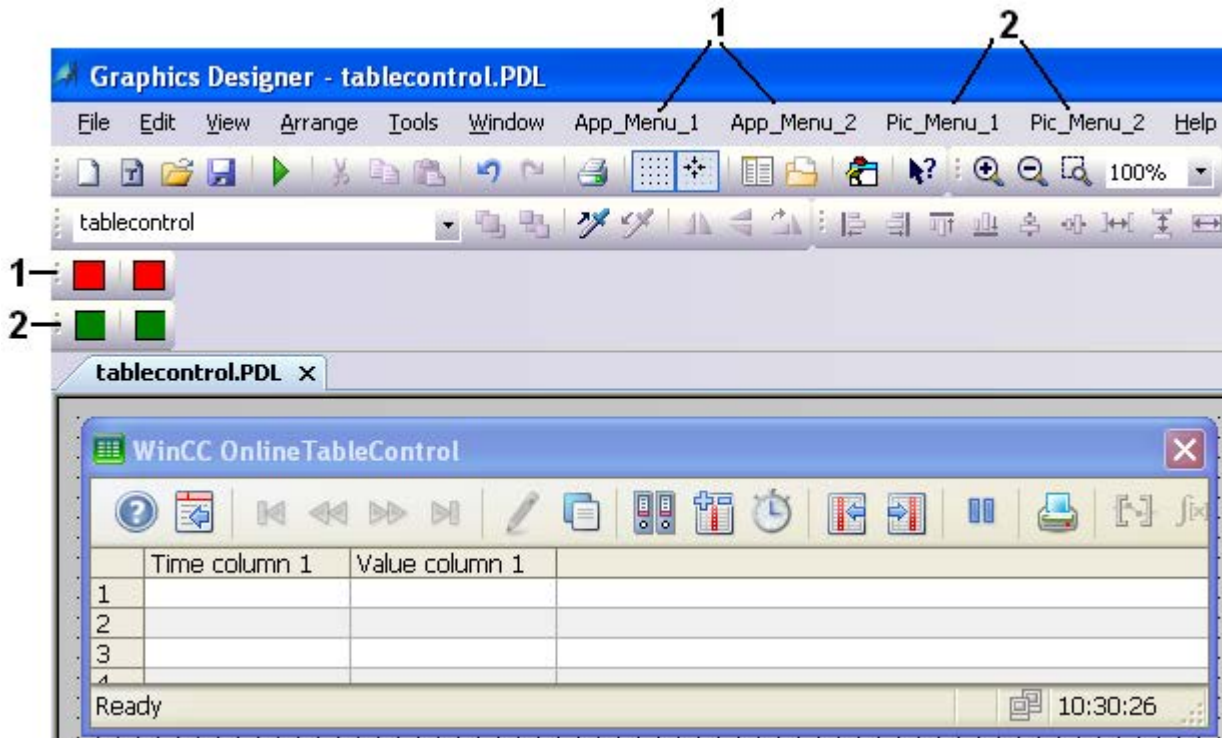

Application-specific menus (1) are always positioned to the right of the "Windows" menu in the Graphics Designer, while picture-specific menus (2) are always positioned to the left of the "Help" menu in the Graphics Designer.

However, application-specific toolbars are not treated as "preferred". In this case, the positioning is determined by the order in which you insert the toolbars. Toolbars are positioned below the Graphics Designer toolbar.

### Properties of user-defined menus and toolbars

In the case of user-defined menus and toolbars you can use hyphens to divide entries, for example according to certain categories. As well as this you can also create submenus in a user-defined menu.

The following configuration options are available to you for user-defined menus and toolbars and their entries:

- Visible (yes/no): Displays or hides the item (visible property).
- Active (yes/no): Activates the entry or dims it (enabled property).
- Marked with check mark (yes/no) - only available for menu command (Checked property).
- Shortcut: Key combination for calling a menu command (ShortCut property).

- Statustext: Text that is displayed in the status bar (StatusText property).
- Tooltip text - only available for an icon (ToolTipText property).

You can hide a menu command, for example, if the macro cannot be executed at a certain time. In this way you can prevent inadvertent wrong operation.

You can create all texts and labels of user-defined menus and toolbars in multiple languages so that the user-defined menus and toolbars can also react to a language change.

## See also

How to assign VBA macros to menus and toolbars (Page 1642)

How to assign help texts to menus and toolbars (Page 1639)

How to Add a New Icon to the Toolbar (Page 1637)

How to Create an Application-specific Toolbar (Page 1635)

How to create menus in multiple languages (Page 1633)

How to add a new menu entry to a menu (Page 1631)

How to Create Picture-specific Menus and Toolbars (Page 1655)

How to Create a New Application-Specific Menu (Page 1629)

Configuring Menus and Toolbars (Page 1626)

Executing VBA Macros in Graphics Designer (Page 1619)

## How to Create a New Application-Specific Menu

### Introduction


Application-specific menus remain visible even when all pictures in Graphics Designer are closed. You can use the Started event, for example, in order to insert an application-specific menu at an early stage.

Position the VBA code either

- in the "GlobalTemplateDocument" if you want the menu to be available in all projects, or
- in the "ProjectTemplateDocument" if you want the menu to be available in the current project.

## Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

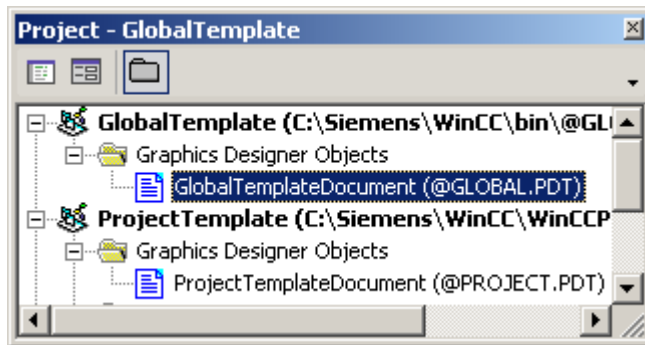


3. To create a user-defined menu in the Graphics Designer, you can for example insert a "CreateApplicationMenus()" procedure in the document. In this example, two user-defined menus are created:

```
Sub CreateApplicationMenus()  
    'VBA3  
    'Declaration of menus...:  
    Dim objMenu1 As HMIMenu  
    Dim objMenu2 As HMIMenu  
    '  
    'Add menus. Parameters are "Position", "Key" und "DefaultLabel":  
    Set objMenu1 = Application.CustomMenus.InsertMenu(1, "AppMenu1",  
    "App_Menu_1")  
    Set objMenu2 = Application.CustomMenus.InsertMenu(2, "AppMenu2",  
    "App_Menu_2")  
End Sub
```

4. Start the procedure with <F5>.

## Result

The two menus "App\_Menu\_1" and "App\_Menu\_2" are inserted to the right of the "Window" menu:



## See also

- Creating Customized Menus and Toolbars (Page 1627)
- InsertMenu Method (Page 1850)
- How to assign VBA macros to menus and toolbars (Page 1642)
- How to assign help texts to menus and toolbars (Page 1639)

- How to create menus in multiple languages (Page 1633)
- How to add a new menu entry to a menu (Page 1631)
- Configuring Menus and Toolbars (Page 1626)
- Organizing VBA Code in a WinCC Project (Page 1615)

## How to add a new menu entry to a menu

### Requirements

You must have created the user-defined menu first.

### Introduction

You can insert three different types of menu items in the user-defined menu:


- Menu entry: To call VBA macros.
- Separator line: For clearer design of user-defined menu.
- Submenu: Same as user-defined menu (e.g. command structuring).

The "Position" parameter determines the order of the menu items within the user-defined menu.

The "Key" parameter is a unique identification of the menu item. This parameter is used if you use the "MenuItemClicked" event for calling VBA macros.

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

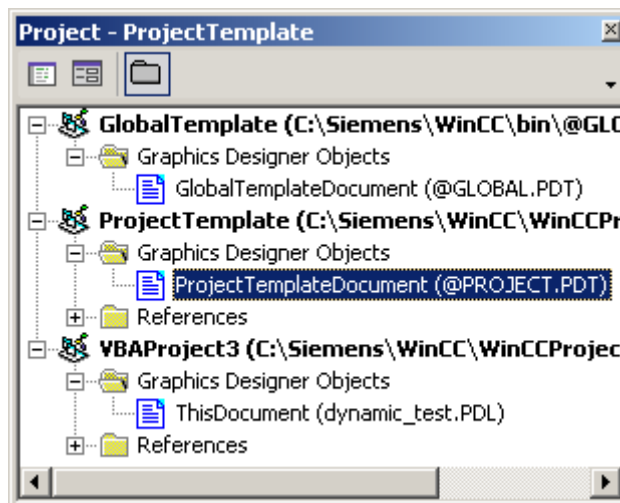


- To create menu items in a previously created user-defined menu, you can for example insert an "InsertMenuItems()" procedure in the document. In this example a number of menu items are created in the user-defined menu "App\_Menu\_1":

```
Sub InsertMenuItems()
    'VBA4
    Dim objMenu1 As HMIMenu
    Dim objMenu2 As HMIMenu
    Dim objMenuItem1 As HMIMenuItem
    Dim objSubMenu1 As HMIMenuItem
    'Create Menu:
    Set objMenu1 = Application.CustomMenus.InsertMenu(1, "AppMenu1",
    "App_Menu_1")
    'Next lines add menu-items to userdefined menu.
    'Parameters are "Position", "Key" and DefaultLabel:
    Set objMenuItem1 = objMenu1.MenuItems.InsertMenuItem(1,
    "mItem1_1", "App_MenuItem_1")
    Set objMenuItem1 = objMenu1.MenuItems.InsertMenuItem(2,
    "mItem1_2", "App_MenuItem_2")
    ,
    'Adds seperator to menu ("Position", "Key")
    Set objMenuItem1 = objMenu1.MenuItems.InsertSeparator(3,
    "mItem1_3")
    ,
    'Adds a submenu into a userdefined menu
    Set objSubMenu1 = objMenu1.MenuItems.InsertSubMenu(4, "mItem1_4",
    "App_SubMenu_1")
    ,
    'Adds a menu-item into a submenu
    Set objMenuItem1 = objSubMenu1.SubMenu.InsertMenuItem(5,
    "mItem1_5", "App_SubMenuItem_1")
    Set objMenuItem1 = objSubMenu1.SubMenu.InsertMenuItem(6,
    "mItem1_6", "App_SubMenuItem_2")
End Sub
```

- Start the procedure with <F5>.

## Result

The "InsertMenuItems()" procedure inserts the menu "App\_Menu\_1" with these menu items:

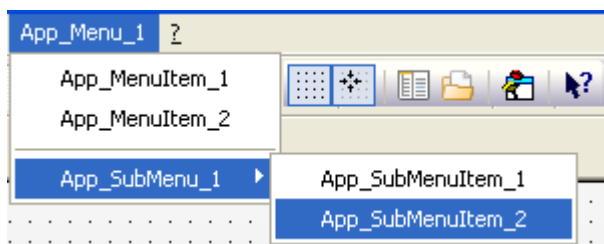



## See also

InsertSeparator Method (Page 1853)  
InsertSubmenu Method (Page 1854)  
InsertMenu Method (Page 1850)  
How to assign VBA macros to menus and toolbars (Page 1642)  
How to assign help texts to menus and toolbars (Page 1639)  
How to create menus in multiple languages (Page 1633)  
How to Create a New Application-Specific Menu (Page 1629)  
Configuring Menus and Toolbars (Page 1626)  
Creating Customized Menus and Toolbars (Page 1627)

## How to create menus in multiple languages

### Introduction


You can create a user-defined menu that responds to a change of language. To do this you need to define the necessary number of labels in other languages for the menu and for each menu item.

The foreign-language label comprises the language ID (LCID) and the foreign-language text (DisplayName).

The list of language codes is available in the WinCC documentation (Index > Language Code).

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

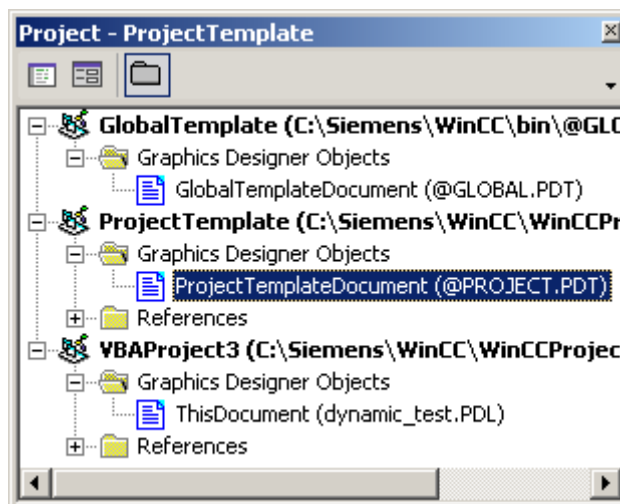

3. To define multilingual labels for a user-defined menu, you can for example insert a "MultipleLanguagesForAppMenu1()" procedure in the document. In this example English labels are defined for the "App\_Menu\_1" menu:

```

Sub InsertMenuItems()
    'VBA5
    'Execute this procedure first
    Dim objMenu1 As HMIMenu
    Dim objMenu2 As HMIMenu
    Dim objMenuItem1 As HMIMenuItem
    Dim objSubMenu1 As HMIMenuItem
    'Insert Menu:
    Set objMenu1 = Application.CustomMenus.InsertMenu(1, "AppMenu1",
    "App_Menu_1")
    'Next lines inserts menu-items to userdefined menu.
    'parameters are "Position", "Key" and DefaultLabel:
    Set objMenuItem1 = objMenu1.MenuItems.InsertMenuItem(1,
    "mItem1_1", "App_MenuItem_1")
    Set objMenuItem1 = objMenu1.MenuItems.InsertMenuItem(2,
    "mItem1_2", "App_MenuItem_2")
    ,
    'Inserts seperator into menu ("Position", "Key")
    Set objMenuItem1 = objMenu1.MenuItems.InsertSeparator(3,
    "mItem1_3")
    ,
    'Inserts a submenu into a userdefined menu
    Set objSubMenu1 = objMenu1.MenuItems.InsertSubMenu(4, "mItem1_4",
    "App_SubMenu_1")
    ,
    'Inserts a menu-item into a submenu
    Set objMenuItem1 = objSubMenu1.SubMenu.InsertMenuItem(5,
    "mItem1_5", "App_SubMenuItem_1")
    Set objMenuItem1 = objSubMenu1.SubMenu.InsertMenuItem(6,
    "mItem1_6", "App_SubMenuItem_2")
End Sub

Sub MultipleLanguagesForAppMenu1()
    ' execute this procedure after "InsertMenuItems()" was run
    'Object "objLanguageTextMenu1" contains the
    'foreign-language labels for the menu
    Dim objLanguageTextMenu1 As HMILanguageText
    ,
    'Object "objLanguageTextMenuItem" contains the
    'foreign-language labels for the menu-items
    Dim objLanguageTextMenuItem1 As HMILanguageText
    Dim objMenu1 As HMIMenu
    Dim objSubMenu1 As HMIMenuItem
    Set objMenu1 = Application.CustomMenus("AppMenu1")
    Set objSubMenu1 =
    Application.CustomMenus("AppMenu1").MenuItems("mItem1_4")
    ,
    'Inserts foreign-language label into a menu:
    ' ("Add(LCID, DisplayName)" method:

```

```
Set objLanguageTextMenu1 = objMenu1.LDLabelTexts.Add(1033,
"English_App_Menu_1")
'
'Inserts foreign-language label into a menuitem:
Set objLanguageTextMenuItem1 =
objMenu1.MenuItems("mItem1_1").LDLabelTexts.Add(1033, "My first
menu item")
'
'Adds a foreign-language label into a submenu:
Set objLanguageTextMenuItem1 =
objSubMenu1.SubMenu.Item("mItem1_5").LDLabelTexts.Add(1033, "My
first submenu item")
End Sub
```

4. Start the procedure with <F5>.

## Result

If you now switch the configuring language to English, certain items in the user-defined menu are shown in English.

## See also

[LanguageTexts Object \(Listing\) \(Page 2000\)](#)

[LDLabelTexts Property \(Page 2299\)](#)

[How to assign VBA macros to menus and toolbars \(Page 1642\)](#)

[How to assign help texts to menus and toolbars \(Page 1639\)](#)

[How to add a new menu entry to a menu \(Page 1631\)](#)

[How to Create a New Application-Specific Menu \(Page 1629\)](#)

[Configuring Menus and Toolbars \(Page 1626\)](#)

[Creating Customized Menus and Toolbars \(Page 1627\)](#)

[Language-Dependent Configuration with VBA \(Page 1624\)](#)

## How to Create an Application-specific Toolbar

### Introduction


Application-specific toolbars remain visible even when all pictures in the Graphics Designer are closed.

Position the VBA code either

- in the "GlobalTemplateDocument" if you want the toolbar to be available in all projects, or
- in the "ProjectTemplateDocument" if you want the toolbar to be available in the current project.

## Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

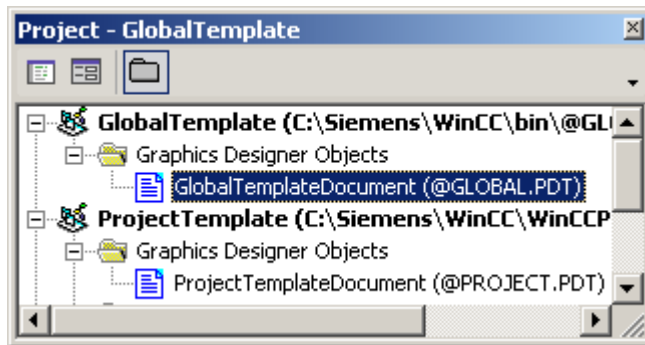

3. To create a user-defined toolbar in the Graphics Designer, you can for example insert a "CreateApplicationToolbars()" procedure in the document. In this example two user-defined toolbars are created:

```
Sub CreateApplicationToolbars()
'VBA6
'Declare toolbar-objects...:
Dim objToolbar1 As HMIToolbar
Dim objToolbar2 As HMIToolbar
'
'Add the toolbars with parameter "Key"
Set objToolbar1 = Application.CustomToolbars.Add("AppToolbar1")
Set objToolbar2 = Application.CustomToolbars.Add("AppToolbar2")
End Sub
```

4. Start the procedure with <F5>.

## Result

The two toolbars are inserted beneath the Graphics Designer toolbars.

## See also

- Add Method (CustomToolbars Listing) (Page 1788)
- How to assign VBA macros to menus and toolbars (Page 1642)
- How to assign help texts to menus and toolbars (Page 1639)
- How to Add a New Icon to the Toolbar (Page 1637)
- Configuring Menus and Toolbars (Page 1626)
- Creating Customized Menus and Toolbars (Page 1627)

## How to Add a New Icon to the Toolbar

### Requirement

You must have created the user-defined toolbar first.

### Introduction

You can insert two different types of objects in the user-defined toolbar:


- Symbol: To call VBA macros.
- Separator line: For clearer design of user-defined toolbars.

The "Position" parameter determines the order of the icons within the user-defined toolbar.

The "Key" parameter is a unique identification of the icon. This parameter is used if you use the "ToolbarItemClicked" event for calling VBA macros.

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

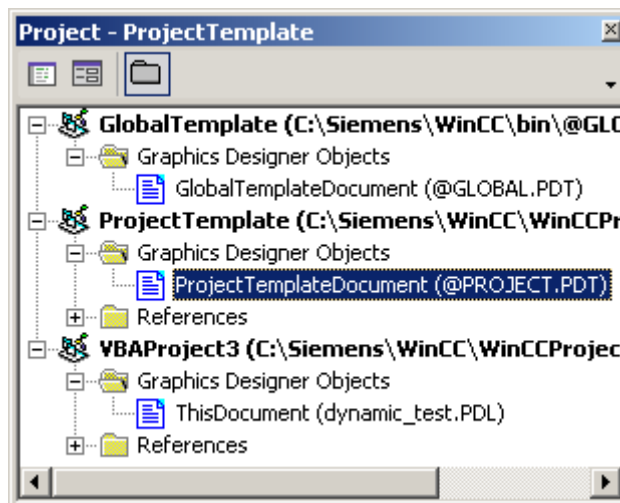


3. To create icons in a previously created user-defined toolbar, you can for example insert an "InsertToolBarItems()" procedure in the document. In this example, two icons separated by a separator line are created in the user-defined toolbar "AppToolBar1":

```
Sub InsertToolBarItems()  
    'VBA7  
    Dim objToolBar1 As HMIToolbar  
    Dim objToolBarItem1 As HMIToolbarItem  
    '  
    'Add a new toolbar:  
    Set objToolBar1 = Application.CustomToolbars.Add("AppToolBar1")  
    'Adds two toolbar-items to the toolbar  
    ' ("InsertToolBarItem(Position, Key, DefaultToolTipText)"-Methode):  
    Set objToolBarItem1 =  
    objToolBar1.ToolbarItems.InsertToolBarItem(1, "tItem1_1", "First  
    Symbol-Icon")  
    Set objToolBarItem1 =  
    objToolBar1.ToolbarItems.InsertToolBarItem(3, "tItem1_2", "Second  
    Symbol-Icon")  
    '  
    'Adds a seperator between the two toolbar-items  
    ' ("InsertSeparator(Position, Key)"-Methode):  
    Set objToolBarItem1 = objToolBar1.ToolbarItems.InsertSeparator(2,  
    "tSeparator1_3")  
End Sub
```

4. Start the procedure with <F5>.

## Result

The "InsertToolBarItems()" procedure adds a toolbar with two icons, separated by a dividing line, to the Graphics Designer toolbars:

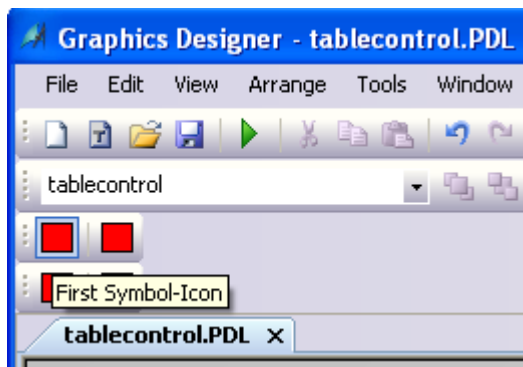

---

### Note

Use the icon property in order to specify a graphic (\*.ICO format) for a tool icon.

---

## See also

Creating Customized Menus and Toolbars (Page 1627)  
Icon Property (Page 2275)  
InsertSeparator Method (Page 1853)  
InsertToolbarItem Method (Page 1856)  
How to assign VBA macros to menus and toolbars (Page 1642)  
How to assign help texts to menus and toolbars (Page 1639)  
How to Create an Application-specific Toolbar (Page 1635)  
Configuring Menus and Toolbars (Page 1626)

## How to assign help texts to menus and toolbars

### Requirements

You must have created the user-defined menu or the user-defined toolbar first.

### Introduction


When the configuring engineer moves the mouse over a user-defined menu item or over a user-defined icon, you can provide additional help text to explain the functionality in more detail:

- You can define a help text for user-defined menu items and icons; the help text is displayed in the status bar.
- For user-defined icons, the default option is to create the help text as a tooltip.

You can also define status texts and tooltip texts for other languages.

## Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

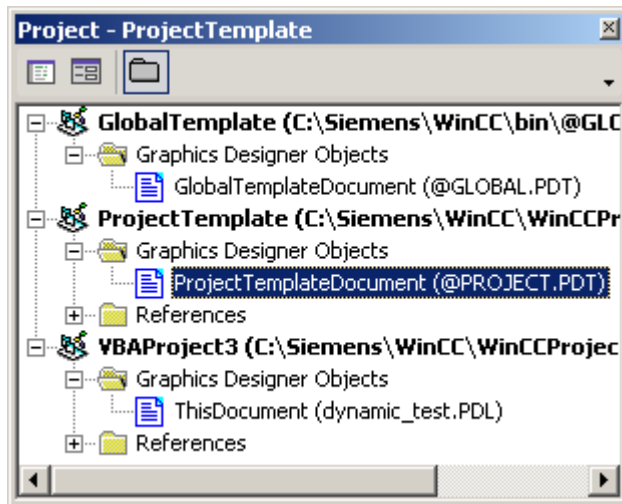

3. To assign a status text to a user-defined menu item, you can for example insert an "AddStatusTextsToAppMenu1()" procedure in the document. In this example one status text in German and one in English is assigned to the first menu item in the previously created "AppMenu1" menu:

```
Sub AddStatusTextsToAppMenu1 ()
'VBA8
Dim objMenu1 As HMIMenu
'
'Object "objStatusTextMenuItem1" contains foreign-language texts
Dim objStatusTextMenuItem1 As HMILanguageText
Set objMenu1 = Application.CustomMenus("AppMenu1")
'
'Assign a statutext to a menuitem:
objMenu1.MenuItems("mItem1_1").StatusText = "Statustext the first
menuitem"
'
'Assign a foreign statutext to a menuitem:
Set objStatusTextMenuItem1 =
objMenu1.MenuItems("mItem1_1").LDStatusTexts.Add(1033, "This is
my first status text in English")
End Sub
```



4. To assign status and foreign-language tool tip text to a user-defined icon on the toolbar, insert a "AddStatusAndTooltipTextsToAppToolbar1()" procedure in the document, for example. In this example, the first icon on the toolbar created is assigned a status text (German/English) and an English tool tip text:

```
Sub AddStatusAndTooltipTextsToAppToolbar1()  
    'VBA9  
    Dim objToolbar1 As HMIToolbar  
    '  
    'Variable "StatusTextToolbarItem1" for foreign statustexts  
    Dim objStatusTextToolbarItem1 As HMILanguageText  
    '  
    'Variable "TooltipTextToolbarItem1" for foreign tooltip texts  
    Dim objTooltipTextToolbarItem1 As HMILanguageText  
    Set objToolbar1 = Application.CustomToolbars("AppToolbar1")  
    '  
    'Assign a statustext to a toolbaritem:  
    objToolbar1.ToolbarItems("tItem1_1").StatusText = "Statustext für  
    das erste Symbol-Icon"  
    '  
    'Assign a foreign statustext to a toolbaritem:  
    Set objStatusTextToolbarItem1 =  
    objToolbar1.ToolbarItems("tItem1_1").LDStatusTexts.Add(1033,  
    "This is my first status text in English")  
    '  
    'Assign a foreign tooltip text to a toolbaritem:  
    Set objTooltipTextToolbarItem1 =  
    objToolbar1.ToolbarItems("tItem1_1").LDTooltipTexts.Add(1033,  
    "This is my first tooltip text in English")  
End Sub
```

5. Start the procedure with <F5>.

## Results

The status text is displayed when you move the mouse pointer over the user-defined menu item or the icon.

## See also

[LDTooltipTexts Property \(Page 2303\)](#)

[LDStatusTexts Property \(Page 2301\)](#)

[LanguageTexts Object \(Listing\) \(Page 2000\)](#)

[Add Method \(Page 1786\)](#)

[How to assign VBA macros to menus and toolbars \(Page 1642\)](#)

[How to Add a New Icon to the Toolbar \(Page 1637\)](#)

[How to add a new menu entry to a menu \(Page 1631\)](#)

[Configuring Menus and Toolbars \(Page 1626\)](#)

[Creating Customized Menus and Toolbars \(Page 1627\)](#)

## How to assign VBA macros to menus and toolbars

### Introduction

There are two possible ways for you to assign VBA macros to user-defined menus and toolbars:

- You can use either the VBA event handlers "MenuItemClicked" and "ToolbarItemClicked" or
- "Macro" property.

---

#### Note

You will find the VBA code for creating the required user-defined menus and toolbars in this documentation under "Adding a New Menu Item to a Menu" and "Adding a New Icon to a Toolbar".

---

### Procedure

#### Assigning a VBA macro with a VBA event handler


---

#### Note

You will find further information on VBA event handlers in this documentation under "Event Handling".

---


1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

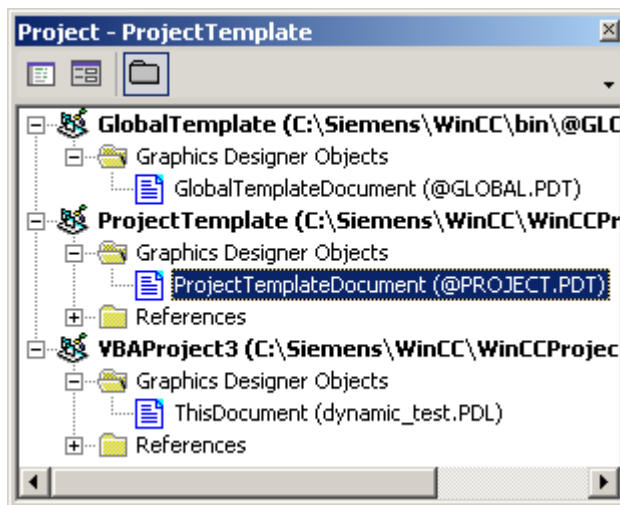

3. To start a VBA macro via the VBA event handlers, use the "MenuItemClicked" or "ToolbarItemClicked" event:
4. Insert the VBA code from the "VBA10" table.
5. Start the procedure with <F5>.

### Assigning a VBA Macro using the "Macro" property

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

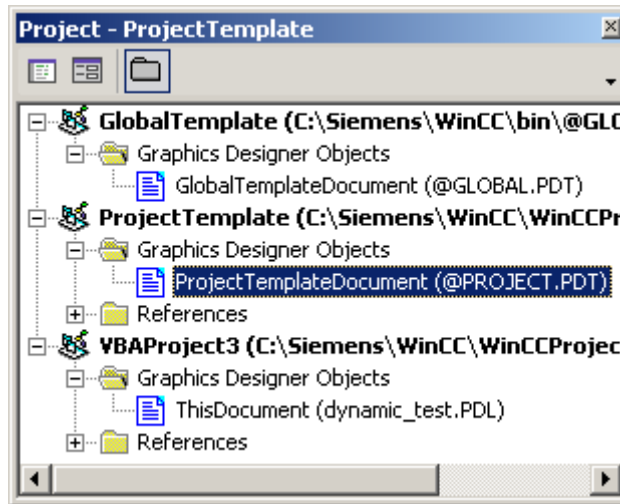

3. To start a VBA macro via the Macro property, assign the VBA macro to each menu item or icon. In the following example, a user-defined menu with two menu entries is created, which retrieve two different VBA macros:  
The VBA code of the following VBA11 example depends on the file type. The VBA code is added as an example for a PDL and a PDT file. Both cases can be distinguished in the following manner:
  - PDL file:  
The VBA code in a PDL file is only executed when this PDL file is being displayed.
  - PDT file:  
The VBA code in a PDT file is always executed when the Graphics Designer is open.
4. Insert the VBA code from the "VBA11" table. Sample code for PDL file or "VBA821: Sample code for PDT file".  
You can call the following two procedures via the menu items in the user-defined menu "DocMenu1":
5. Insert the VBA code from the "VBA12" table.
6. Start the procedure with <F5>.

The following tables show the VBA codes for the example:

### Start VBA via event handler (VBA10)

```
Option Explicit
'VBA10
'The next declaration has to be placed in the module section
Dim WithEvents theApp As grafexe.Application

Private Sub SetApplication()
'This procedure has to be executed (with "F5") first
Set theApp = grafexe.Application
End Sub

Private Sub theApp_MenuItemClicked(ByVal MenuItem As IHMIMenuItem)
Dim objClicked As HMIMenuItem
Dim varMenuItemKey As Variant
Set objClicked = MenuItem
'
'"varMenuItemKey" contains the value of parameter "Key"
'from clicked menu-item
varMenuItemKey = objClicked.Key
Select Case varMenuItemKey
Case "mItem1_1"
MsgBox "The first menuitem was clicked!"
End Select
End Sub

Private Sub theApp_ToolbarItemClicked(ByVal ToolbarItem As IHMIToolbarItem)
Dim objClicked As HMIToolbarItem
Dim varToolbarItemKey As Variant
Set objClicked = ToolbarItem
'
'"varToolbarItemKey" contains the value of parameter "Key"
'from clicked toolbar-item
varToolbarItemKey = objClicked.Key
Select Case varToolbarItemKey
Case "tItem1_1"
MsgBox "The first symbol-icon was clicked!"
End Select
End Sub
```

### Creating a menu (VBA11: Sample code for PDL file)

```
Sub CreateDocumentMenusUsingMacroProperty()  
'VBA11  
Dim objDocMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1",  
"Doc_Menu_1")  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1",  
"First Menuitem")  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2",  
"Second Menuitem")  
,  
'Assign a VBA-macro to every menu item  
With ActiveDocument.CustomMenus("DocMenu1")  
.MenuItems("dmItem1_1").Macro = "TestMacro1"  
.MenuItems("dmItem1_2").Macro = "TestMacro2"  
End With  
End Sub
```

### Creating a menu (VBA821: Sample code for PDT file)

```
Sub CreateDocumentMenusUsingMacroProperty()  
'VBA821  
Dim objDocMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Set objDocMenu = Application.CustomMenus.InsertMenu(1, "DocMenu1",  
"Doc_Menu_1")  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1",  
"First Menuitem")  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2",  
"Second Menuitem")  
,  
'Assign a VBA-macro to every menu item  
With Application.CustomMenus("DocMenu1")  
.MenuItems("dmItem1_1").Macro = "TestMacro1"  
.MenuItems("dmItem1_2").Macro = "TestMacro2"  
End With  
End Sub
```

### Macros for user-defined menu entries (VBA12)

```
Sub TestMacro1()  
'VBA12  
MsgBox "TestMacro1 was executed"  
End Sub  
  
Sub TestMacro2()  
MsgBox "TestMacro2 was executed"  
End Sub
```

### See also

- Macro Property (Page 2320)
- ToolbarItemClicked Event (Page 1782)
- MenuItemClicked Event (Page 1775)
- How to Add a New Icon to the Toolbar (Page 1637)
- How to add a new menu entry to a menu (Page 1631)
- Event Handling (Page 1709)
- Executing VBA Macros in Graphics Designer (Page 1619)

### 3.3.2.4 Accessing the component library with VBA

#### Accessing the component library with VBA


##### Introduction

The component library contains a large selection of ready-made objects which you can use to design your screens efficiently. The component library consists of a global library and a project-related library:

- The "Global Library" contains prepared objects that are supplied with WinCC. The objects are filed in folders, sorted according to subjects, such as valves, motors, cables and many others.
- The "Project Library" contains neither objects nor folders when you have created a new project. You can create objects which you need only in this particular project in the "Project Library".

VBA gives you full access to the component library: You can create and delete folders and save objects in the component library or insert them into pictures.

#### Access to the component library with VBA

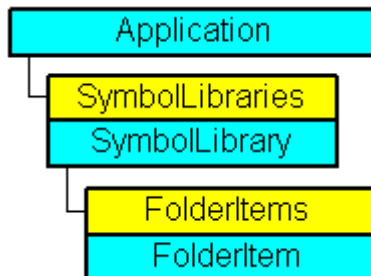


The component library is represented in VBA by the "SymbolLibraries" listing. The listing contains two elements, which represent the "Global Library" and the "Project Library". The "FolderItems" listing contains elements, which represent folders as well as objects.

### Note

To address an object in the "SymbolLibraries" listing you use either the index number or the internal name.

You can find out the internal name by clicking the right mouse button on the relevant object in the component library and then choosing the "Copy path" command in the pop-up menu.

The path to the object within the component library is then copied to the clipboard.

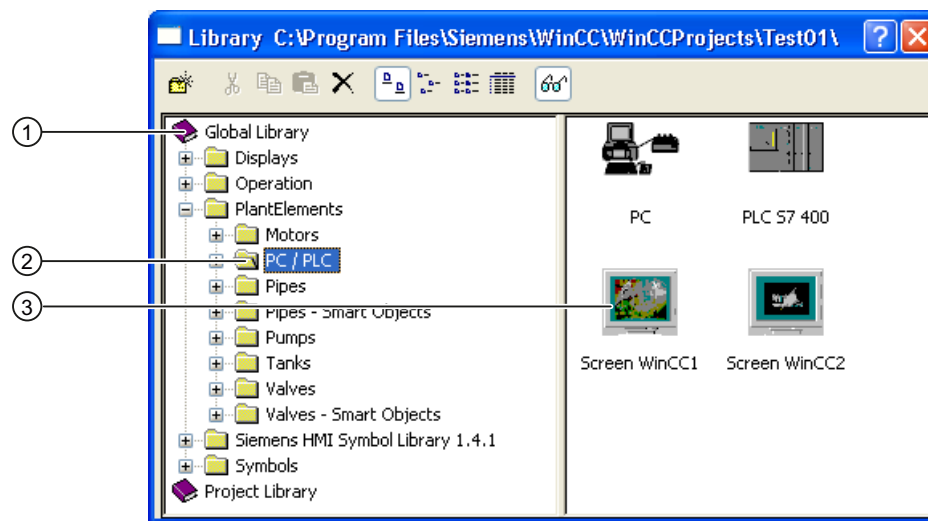

### Global Library (1)

The "Global Library" is the first element in the SymbolLibraries listing, which you address using index number "1". You address the "Project Library" using index number "2".

Access to the "Global Library" with VBA:

```
'VBA17
Application.SymbolLibraries(1)
```

### Folder (2)

A folder in the component library contains either other folders or the objects of a particular subject area. In VBA a folder corresponds to the "FolderItem" object and its type is "Folder". The folders are contained in the "FolderItems" listing. With VBA you can create a new folder or delete an existing one, and add an object to the folder via the clipboard.

Access to the "Plant Components" folder with VBA:

```
'VBA18
Application.SymbolLibraries(1).FolderItems("Folder2")
```

### Object (3)

In VBA an object corresponds to the "FolderItem" object and its type is "Item". The objects are contained in the "Folder" listing. With VBA you can delete an object or copy it to the clipboard.

Access to the "PC" object with VBA:

```
'VBA19  
Application.SymbolLibraries(1).FolderItems("Folder2").Folder("Folder2").Folder.Item("Object1").DisplayName
```

### Creating or deleting folders in the component library

Use the following methods to create or delete folders:

- "AddFolder(DefaultName)" Method: Creates a new folder in the components library. A newly created folder receives the internal name "FolderX", where "X" stands for a consecutive number.
- "Delete()" Method: Deletes an existing folder (including all folders and objects that it contains) from the component library.

### Inserting or deleting an object in the component library

You can copy objects within the component library (for example from the "Global Library" to the "Project Library"), insert an object from a picture into the component library or delete an object from the component library:

- Methoden "CopyToClipboard()" und "AddFromClipboard()": Copies an object to the clipboard within the component library.
- "AddItem(DefaultName, PHMIOject)" method: Copies an existing object in the picture into a folder in the component library.
- "Delete()" Method: Deletes an object.

### Finding an object or folder in the component library

Use the "FindByDisplayName("DisplayName")" method to search for an object or folder. The specified display name is dependent on which language is currently set. The search ends with the first occurrence of the object or folder that you are looking for.

### Inserting an object into a picture from the component library

Use the "CopyToClipboard()" and "PasteClipboard()" methods to insert an object from the component library into the current picture.

### See also

CopyToClipboard Method (Page 1824)

PasteClipboard Method (Page 1868)



GetItemByPath Method (Page 1847)  
FindByDisplayName Method (Page 1842)  
Delete Method (Page 1831)  
AddItem Method (Page 1802)  
AddFromClipboard Method (Page 1799)  
AddFolder Method (Page 1798)  
SymbolLibrary Object (Page 2074)  
SymbolLibraries Object (Listing) (Page 2073)  
How to paste an object from the object library into a picture with VBA (Page 1652)  
How to edit the component library with VBA (Page 1649)

## How to edit the component library with VBA


### Introduction

Here you will find the following instructions for editing the component library with VBA:

- Creating a new folder
- Copying an object within the component library
- Copying an object from the active picture into the component library
- Deleting an object from the component library

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

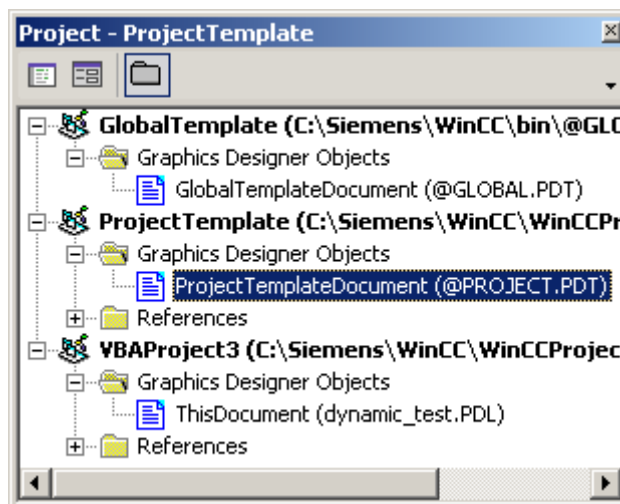

3. To create a new folder in the component library, you can for example insert an "AddNewFolderToProjectLibrary()" procedure in the document. In this example the folder "My folder" is created:

```
Sub AddNewFolderToProjectLibrary()
'VBA20
Dim objProjectLib As HMISymbolLibrary
Set objProjectLib = Application.SymbolLibraries(2)
'
' ("AddFolder(DefaultName)"-Methode) :
objProjectLib.FolderItems.AddFolder ("Custom Folder")
End Sub
```

4. In order to copy an object from the "global library" to the "library project", insert a "CopyObjectFromGlobalLibraryToProjectLibrary()" procedure in the document, for example. In this example, the object "Object1" is copied:

```
Sub CopyObjectFromGlobalLibraryToProjectLibrary()
'VBA21
Dim objGlobalLib As HMISymbolLibrary
Dim objProjectLib As HMISymbolLibrary
Set objGlobalLib = Application.SymbolLibraries(1)
Set objProjectLib = Application.SymbolLibraries(2)
'
'Copies object "PC" from the "Global Library" into the clipboard
objGlobalLib.FolderItems("Folder2").Folder("Folder2").Folder.Item(
"Object1").CopyToClipboard
'
'The folder "Custom Folder" has to be available
objProjectLib.FolderItems("Folder1").Folder.AddFromClipboard
("Copy of PC/PLC")
End Sub
```

5. In order to copy an object from the active picture to the "Project Library", insert a procedure like "AddObjectFromPictureToProjectLibrary()" into document. In this example, the object "Circle1" is created in the active picture and then copied to the folder "Folder1":

```
Sub AddObjectFromPictureToProjectLibrary()
'VBA22
Dim objProjectLib As HMISymbolLibrary
Dim objCircle As HMICircle
Set objProjectLib = Application.SymbolLibraries(2)
'
'Insert new object "Circle1"
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle1",
"HMICircle")
'
'The folder "Custom Folder" has to be available
' ("AddItem(DefaultName, pHMIObject)"-Methode) :
objProjectLib.FolderItems("Folder1").Folder.AddItem "ProjectLib
Circle", ActiveDocument.HMIObjects("Circle1")
End Sub
```

6. To delete an object from the component library, insert a "DeleteObjectFromProjectLibrary()" procedure in the document, for example. In this example the previously created folder "Folder1" is deleted:

```
Sub DeleteObjectFromProjectLibrary()  
  'VBA23  
  Dim objProjectLib As HMISymbolLibrary  
  Set objProjectLib = Application.SymbolLibraries(2)  
  '  
  'The folder "Custom Folder" has to be available  
  "Delete" Method:  
  objProjectLib.FolderItems("Folder1").Delete  
End Sub
```

7. Start the procedure with <F5>.


## See also

- SymbolLibrary Object (Page 2074)
- SymbolLibraries Object (Listing) (Page 2073)
- PasteClipboard Method (Page 1868)
- Delete Method (Page 1831)
- CopyToClipboard Method (Page 1824)
- AddItem Method (Page 1802)
- AddFromClipboard Method (Page 1799)
- AddFolder Method (Page 1798)
- How to paste an object from the object library into a picture with VBA (Page 1652)
- Accessing the component library with VBA (Page 1646)

## How to paste an object from the object library into a picture with VBA

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

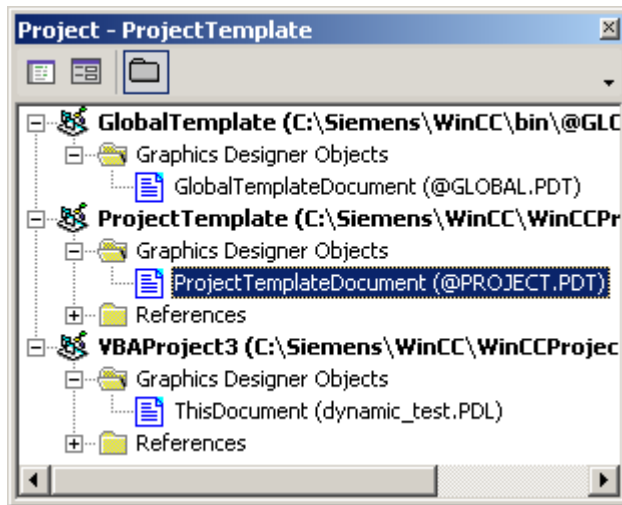

3. To insert an object from the "Global Library" into the active picture, you can for example insert a "CopyObjectFromGlobalLibraryToActiveDocument()" procedure in the document. In this example the object "Object1" is inserted

```
Sub CopyObjectFromGlobalLibraryToActiveDocument()  
'VBA24  
Dim objGlobalLib As HMISymbolLibrary  
Dim objHMIObject As HMIObject  
Dim iLastObject As Integer  
Set objGlobalLib = Application.SymbolLibraries(1)  
,  
'Copy object "PC" from "Global Library" to clipboard  
objGlobalLib.FolderItems("Folder2").Folder("Folder2").Folder.Item(  
"Object1").CopyToClipboard  
,  
'Get object from clipboard and add it to active document  
ActiveDocument.PasteClipboard  
,  
'Get last inserted object  
iLastObject = ActiveDocument.HMIObjects.Count  
Set objHMIObject = ActiveDocument.HMIObjects(iLastObject)  
,  
'Set position of the object:  
With objHMIObject  
.Left = 40  
.Top = 40  
End With  
End Sub
```

4. Start the procedure with <F5>.

## See also

PasteClipboard Method (Page 1868)

CopyToClipboard Method (Page 1824)

How to edit the component library with VBA (Page 1649)


Accessing the component library with VBA (Page 1646)

### 3.3.3 Editing Pictures with VBA

#### 3.3.3.1 Editing Pictures with VBA

##### Introduction

Pictures visualize the process to be executed and observed. They display the important process steps or plant parts and present the production process in a schematic manner. In VBA the picture is represented by the Document object.

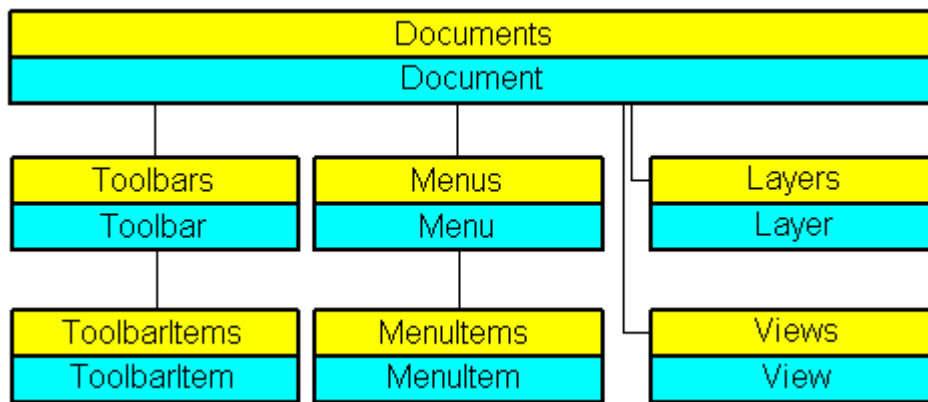

##### Picture-specific menus and toolbars

In contrast with the application-specific menus and toolbars, the picture-specific menus and toolbars are coupled to a specific picture. The picture-specific menus and toolbars remain visible for as long as the picture is active.

You should use picture-specific menus and toolbars when the called VBA macros are only used in that picture.

##### Layers

You can access the layers in the Graphics Designer with VBA. Each layer is represented by the Layer object. By changing the properties of the Layer object you can specify among other things the layer names and the zoom settings.

You control the visibility of the RT layers via the Document object. You control the visibility of the CS layers via the View object.

##### Copies of the picture

You can create copies of a picture with VBA in order to display different views of a picture. The copy of a picture is represented in VBA by the View object.

In the properties of the View object you can among other things set the zoom factor and specify which picture section is to be displayed.

---

**Note**

If you want to run VBA code in a picture saved in WinCC V7.0 SP1 under WinCC V7.0, you need to deactivate the "CCHMIDotNetObj 1.0 Type Library" in the VBA Editor under "Tools > References".

The VBA program will then be executed within the usual functional scope of WinCC V7.0. In this case, you cannot use the new functions of WinCC V7.0 SP1.

---

**See also**

Editing a Copy of a Picture with VBA (Page 1658)

How to Create Picture-specific Menus and Toolbars (Page 1655)

Editing Layers with VBA (Page 1657)

Editing Objects with VBA (Page 1660)

Adapting the Graphics Designer with VBA (Page 1623)


### 3.3.3.2 How to Create Picture-specific Menus and Toolbars

**Introduction**

Picture-specific menus and toolbars are linked to a specific picture and remain visible for as long as the You should use picture-specific menus and toolbars when the VBA macros used there are relevant only for that particular picture.

**Procedure**

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor").
2. Open the document "ThisDocument" in the Project Explorer:

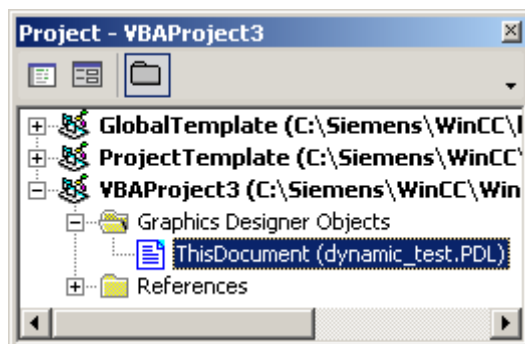

3. To create a picture-specific menu, you can for example insert a "CreateDocumentMenus()" procedure in the document "ThisDocument":

```
Sub CreateDocumentMenus()  
  'VBA25  
  'Declare menuobjects:  
  Dim objMenu1 As HMIMenu  
  Dim objMenu2 As HMIMenu  
  'Insert Menus ("InsertMenu"-Methode) with  
  'Parameters - "Position", "Key", "DefaultLabel":  
  Set objMenu1 = ActiveDocument.CustomMenus.InsertMenu(1,  
  "DocMenu1", "Doc_Menu_1")  
  Set objMenu2 = ActiveDocument.CustomMenus.InsertMenu(2,  
  "DocMenu2", "Doc_Menu_2")  
End Sub
```

4. In order to create a picture-specific toolbar, insert a procedure like "CreateDocumentToolbars()" into the document "ThisDocument":

```
Sub CreateDocumentToolbars()  
  'VBA26  
  'Declare required number of toolbarobjects:  
  Dim objToolbar1 As HMIToolbar  
  Dim objToolbar2 As HMIToolbar  
  '  
  'Insert toolbars ("Add"-Methode) with  
  'Parameter - "Key":  
  Set objToolbar1 = ActiveDocument.CustomToolbars.Add("DocToolbar1")  
  Set objToolbar2 = ActiveDocument.CustomToolbars.Add("DocToolbar2")  
End Sub
```

5. Always start the procedure with <F5>.

## See also


- Add Method (CustomToolbars Listing) (Page 1788)
- InsertMenu Method (Page 1850)
- How to assign VBA macros to menus and toolbars (Page 1642)
- How to assign help texts to menus and toolbars (Page 1639)
- How to Add a New Icon to the Toolbar (Page 1637)
- How to create menus in multiple languages (Page 1633)
- How to add a new menu entry to a menu (Page 1631)
- Creating Customized Menus and Toolbars (Page 1627)
- Configuring Menus and Toolbars (Page 1626)



### 3.3.3.3 Editing Layers with VBA

#### Introduction

You can arrange objects in 32 layers in the Graphics Designer. The layers are differentiated according to CS layers and RT layers so that the visibility of the layers in the picture (CS) and in runtime (RT) can be controlled separately. In VBA a layer is represented by the Layer object:

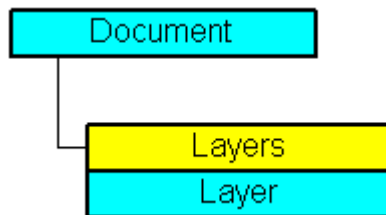

In the Graphics Designer the lowest layer is "Layer 0". To give back the lowest layer with VBA, use the index "1":

```
ActiveDocument.Layers(1)
```

#### Using the Layer object

You use the Layer object in order to specify the minimum and maximum zoom for a layer and to assign a name. In the following example the settings for the lowest layer are configured in the active picture:

```
Sub ConfigureSettingsOfLayer
'VBA27
Dim objLayer As HMLayer
Set objLayer = ActiveDocument.Layers(1)
With objLayer
'Configure "Layer 0"
.MinZoom = 10
.MaxZoom = 100
.Name = "Configured with VBA"
End With
End Sub
```

#### Controlling the visibility of CS and RT layers

You control the visibility of the CS layers via the View object. Use the Document object in order to determine which layers are to be displayed or hidden in runtime. You can control the visibility of the CS and RT layers with the following methods:

- Methode "IsCSLayerVisible(Index)": Checks whether the specified CS layer is displayed.
- Methode "SetCSLayerVisible(Index, Val)": Shows or hides the specified CS layer.

Use the IsRTLayrVisible and SetRTLayrVisible methods for the RT layers in the same way.


## See also

IsRTLLayerVisible Method (Page 1858)  
SetRTLLayerVisible Method (Page 1887)  
SetCSLayerVisible Method (Page 1885)  
IsCSLayerVisible Method (Page 1857)  
Layers Object (Listing) (Page 2003)  
Editing Pictures with VBA (Page 1654)  
Language-Dependent Configuration with VBA (Page 1624)

### 3.3.3.4 Editing a Copy of a Picture with VBA

#### Introduction

You can create copies of a picture with VBA in order to display different views of a picture. Each view is shown in a separate window. The copy of a picture is represented in VBA by the View object:

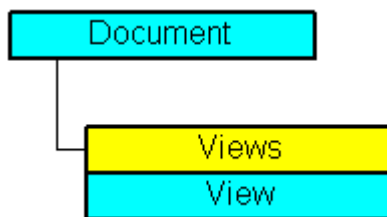

In the properties of the View object you can among other things set the zoom factor and specify which picture section is to be displayed.

#### Creating a copy of a picture

Use the Add method to create a copy of the specified picture. In this example a copy of the active picture is created and activated:

```
Sub CreateAndActivateView()  
'VBA28  
Dim objView As HMIView  
Set objView = ActiveDocument.Views.Add  
objView.Activate  
End Sub
```

## Editing a copy of a picture

You can edit each copy of a screen as follows:

- Adjust zoom factor: Use the zoom property.
- Specify picture zoom area: Specify the picture section: use the "ScrollPosX" and "ScrollPosY" properties to specify the picture zoom area using the scroll bars.
- Showing and Hiding CS layers: You can use the SetCSLayerVisible(Index) method for example to show or hide the specified layer. You can select the layer on which you want to edit the objects with the ActiveLayer property.

In the following example a copy of the active picture is created and activated. The zoom factor is set to 150% and the position of the scrollbars is changed:

```
Sub SetZoomAndScrollPositionInActiveView()  
'VBA29  
Dim objView As HMIView  
Set objView = ActiveDocument.Views.Add  
With objView  
.Activate  
.ScrollPosX = 40  
.ScrollPosY = 10  
.Zoom = 150  
End With  
End Sub
```

## See also

[Add Method \(Views Listing\) \(Page 1793\)](#)

[ScrollPosY Property \(Page 2411\)](#)

[ScrollPosX Property \(Page 2410\)](#)

[ActiveLayer Property \(Page 2108\)](#)

[View Object \(Page 2102\)](#)

[SetCSLayerVisible Method \(Page 1885\)](#)

[IsCSLayerVisible Method \(Page 1857\)](#)

[Activate Method \(Page 1785\)](#)


[Editing Layers with VBA \(Page 1657\)](#)

[Editing Pictures with VBA \(Page 1654\)](#)

### 3.3.4 Editing Objects with VBA

#### 3.3.4.1 Editing Objects with VBA

##### Access to objects in the Graphics Designer

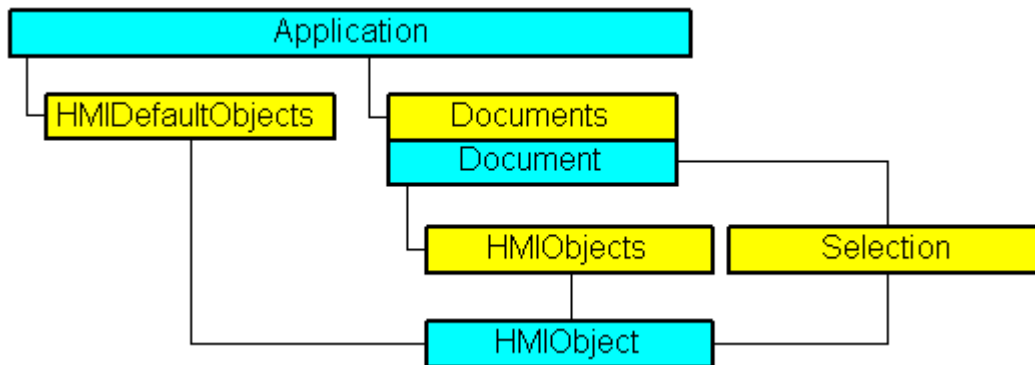

In VBA all object types of the current picture are contained in the "HMIObjets" listing. They are not divided according to object type (Standard, Smart, Windows and Controls objects) as in the Graphics Designer. With VBA you can therefore run through all objects in one or more pictures with a loop.

When you have selected objects in the picture, these objects are contained in the "Selection" listing. Use the "HMIDefaultObjects" listing if you want to change the default settings of the properties of an object.

To address an object in a picture with VBA, use either the object name, e.g. "ActiveDocument.HMIObjets("Circle1"), or the index number. "

ActiveDocument.HMIObjets(1)" references for example the first object in the active picture.

##### Editing objects with VBA

You have the following possibilities for editing objects with VBA:

- Create a new object in a picture
- Delete an existing object
- Copy an existing object
- Group existing objects or cancel the grouping
- Search for objects
- Display or change object properties

When you insert a new object into a picture with VBA, the object behaves in the same way as if you double-clicked it in the Graphics Designer object palette.

The object is given the predefined property values and is inserted in the top left-hand corner of the picture.

Access to the object properties is dependent on how you created the object. Two examples illustrate this:

#### Example 1:

In this example a circle of the type "HMIOBJECT" is inserted into the current picture. You can use a VBA object of the "HMIOBJECT" type or all objects in the Graphics Designer. However, you have to address individual properties of the respective object explicitly via the "Properties(Index)" property:

```
Sub AddObject()  
'VBA30  
Dim objObject As HMIOBJECT  
Set objObject = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("CircleAsHMIOBJECT", "HMIOBJECT")  
'  
'standard-properties (e.g. the position) are available every time:  
objObject.Top = 40  
objObject.Left = 40  
'  
'non-standard properties can be accessed using the Properties-collection:  
objObject.Properties("FlashBackColor") = True  
End Sub
```

#### Example 2:

In this example a circle of the type "HMICircle" is inserted into the current picture. In contrast with Example 1 you can only use the "objCircle" object for objects of the "HMICircle" type, however:

```
Sub AddCircle()  
'VBA31  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("CircleAsHMICircle", "HMICircle")  
'  
'The same as in example 1, but here you can set/get direct the  
'specific properties of the circle:  
objCircle.Top = 80  
objCircle.Left = 80  
objCircle.FlashBackColor = True  
End Sub
```

### See also

[LanguageFonts Object \(Listing\) \(Page 1997\)](#)

[VBA Reference \(Page 1745\)](#)

[Underlined Property \(Page 2460\)](#)

[Size Property \(Page 2419\)](#)

[Parent Property \(Page 2359\)](#)

LanguageID Property (Page 2289)

Italic Property (Page 2282)

Family Property (Page 2229)

Bold Property (Page 2151)


Application Property (Page 2121)

### 3.3.4.2 Default objects, Smart objects, Windows objects and Tube objects

#### Default objects, Smart objects, Windows objects and Tube objects

##### Introduction

You use the Standard, Smart and Windows objects to design your pictures. In the Graphics Designer, these objects are available in the "Default" selection window:

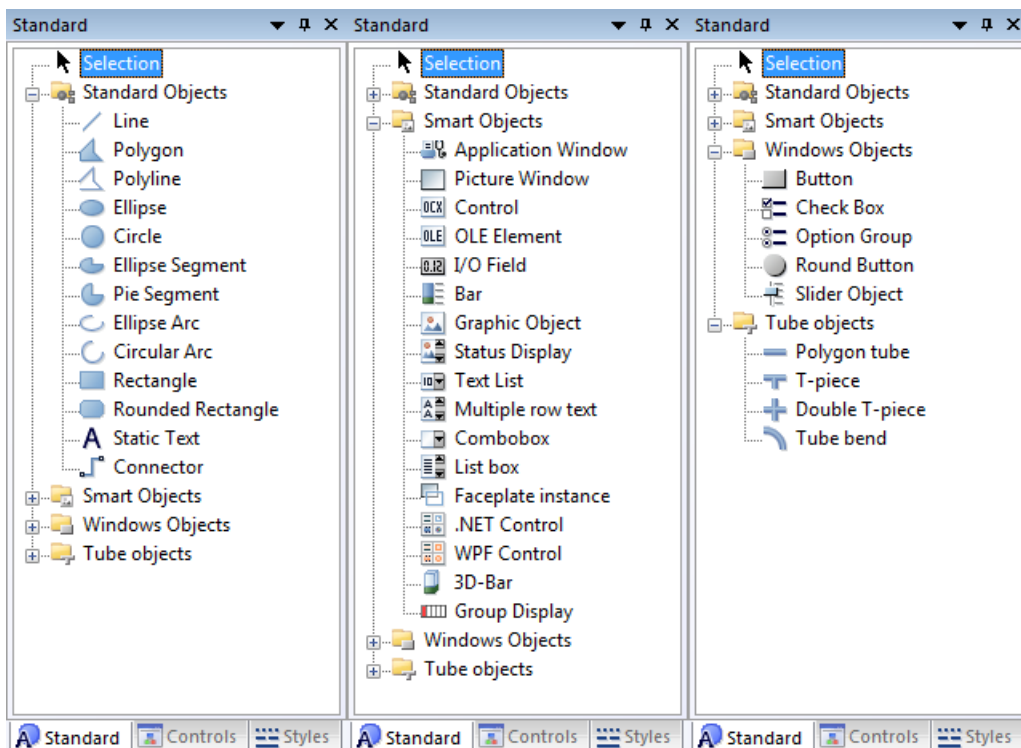

VBA enables you to access these objects in all pictures in your project. If, for example, you want to change the background color of all circles in a project with several pictures, you can do this with a VBA macro.

## Paste Object into Picture

Use the "AddHMIObject(ObjectName, ProgID)" method to insert a new object in a picture. ObjectName" stands for the name of the object (e.g. "my Circle"), and "ProgID" for the VBA object designation (e.g. "HMICircle"):

```
Sub AddCircle()  
'VBA32  
'Creates object of type "HMICircle"  
Dim objCircle As HMICircle  
'  
'Add object in active document  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("My Circle", "HMICircle")  
End Sub
```

## Edit Object

VBA gives you access to all object properties, which you can edit via the object's properties dialog. You can change and output object properties, and select objects in the picture. If you have not selected an object, you can use the following methods:

- "Find()" method: Searches for an object in the "HMIObjects" listing
- "Delete()" Method: Deletes an HMIObject object.

If you have selected objects, you can edit them via the "Selection" listing with the following methods, among others:

- "AlignLeft()", "AlignRight()", "AlignTop()", "AlignBottom()": These methods align objects.
- "CreateGroup()", "CreateCustomizedObject()": These methods create a group object or customized object.
- "DeselectAll()" method: Cancels the selection of all objects

## Remove VBA:references with "Nothing"

Always remove the references used for the Controls, the standard objects, and for the document after you closed the document. For this purpose, set the objects to "Nothing". The following example shows the code for a Control:

```
Public Sub DrawNewControl  
    Const strFct = "CreatePdls"  
    Dim objControl As HMIObject  
    Dim objDoc As Document  
    On Local Error GoTo errorhandler  
    'open the document  
    Set objDoc =  
grafexe.Application.Documents.Open(grafexe.Application.ApplicationDa  
taPath & "PDL1.pdl", hmiOpenDocumentTypeInvisible)  
    'create new object  
    Set objControl = objDoc.HMIObjects.AddActiveXControl("Control1",  
"CCAxUserArchiveControl.AxUserArchiveControl.1")  
    If objControl Is Nothing Then  
        GoTo errorhandler
```

```
End If
'doing something with the control
'.....
'delete reference to new control
Set objControl = Nothing
'saving PDL and deleting reference to it
objDoc.Save
objDoc.Close
Set objDoc = Nothing
Exit Sub
' errorhandler
errorhandler:
  If MsgBox("Error occurred" & vbNewLine & "Yes - resume next" &
vbNewLine & "No - stop script", vbOKCancel + vbCritical, strFct) =
vbOK Then
    Resume Next
  End If
End Sub
```

## See also

Parent Property (Page 2359)  
Item Property (Page 2283)  
Count Property (Page 2201)  
Application Property (Page 2121)

## How to edit Default objects, Smart objects, Windows objects and Tube objects

### Introduction


Here you will find the following instructions for editing Standard, Smart and Windows objects:

- Define properties of a specific object
- Define properties of a nonspecific object
- Select an object in the active picture
- Find objects in the active picture
- Delete object



## Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. Open the document "ThisDocument" in the Project Explorer:

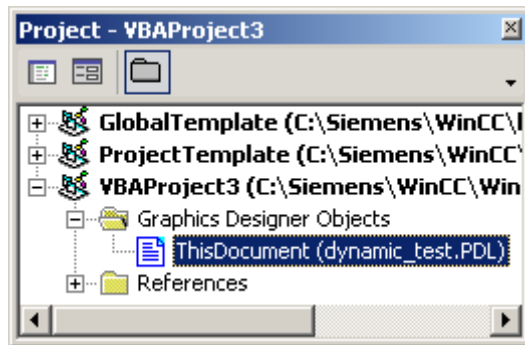

3. To define the properties of a specific object type (e.g. "HMICircle"), you can for example insert an "EditDefinedObjectType()" procedure in the document "ThisDocument". In this example a circle is inserted in the active picture and its line weight and color are modified:

```
Sub EditDefinedObjectType()
'VBA33
Dim objCircle As HMICircle
Set objCircle =
ActiveDocument.HMIObjects.AddHMIObject("myCircleAsCircle",
"HMICircle")
With objCircle
'direct calling of objectproperties available
.BorderWidth = 4
.BorderColor = RGB(255, 0, 255)
End With
End Sub
```

4. To change the properties of a nonspecific object type ("HMIObject"), insert a "EditHMIObject()" procedure in the document "ThisDocument", for example. In this example a circle is inserted in the active picture and its line weight and color are modified:

```
Sub EditHMIObject()
'VBA34
Dim objObject As HMIObject
Set objObject =
ActiveDocument.HMIObjects.AddHMIObject("myCircleAsObject",
"HMICircle")
With objObject
'Access to objectproperties only with property "Properties":
.Properties("BorderWidth") = 4
.Properties("BorderColor") = RGB(255, 0, 0)
End With
End Sub
```

5. To select an object in the current picture, insert a "SelectObject()" procedure in the document "ThisDocument", for example. In this example, a circle will be inserted in the active picture and selected:

```
Sub SelectObject()  
  'VBA35  
  Dim objObject As HMIObject  
  Set objObject =  
  ActiveDocument.HMIObjects.AddHMIObject("mySelectedCircle",  
  "HMICircle")  
  ActiveDocument.HMIObjects("mySelectedCircle").Selected = True  
End Sub
```

6. To search for an object in the current picture, insert a "FindObjectsByName()", "FindObjectsByType()", or "FindObjectsByProperty()" procedure in the document "ThisDocument", for example. In this example, objects containing the string "Circle" in their name are searched for:

```
Sub FindObjectsByName()
'VBA36
Dim colSearchResults As HMICollection
Dim objMember As HMIObject
Dim iResult As Integer
Dim strName As String
'
'Wildcards (?, *) are allowed
Set colSearchResults =
ActiveDocument.HMIObjects.Find(ObjectName:="*Circle*")
For Each objMember In colSearchResults
iResult = colSearchResults.Count
strName = objMember.ObjectName
MsgBox "Found: " & CStr(iResult) & vbCrLf & "Objectname: " &
strName
Next objMember
End Sub
```

In this example a search is run in the active picture for objects of the type "HMICircle":

```
Sub FindObjectsByType()
'VBA37
Dim colSearchResults As HMICollection
Dim objMember As HMIObject
Dim iResult As Integer
Dim strName As String
Set colSearchResults =
ActiveDocument.HMIObjects.Find(ObjectType:="HMICircle")
For Each objMember In colSearchResults
iResult = colSearchResults.Count
strName = objMember.ObjectName
MsgBox "Found: " & CStr(iResult) & vbCrLf & "Objektname: " &
strName
Next objMember
End Sub
```

In this example a search is run in the active picture for objects with the property "BackColor":

```
Sub FindObjectsByProperty()
'VBA38
Dim colSearchResults As HMICollection
Dim objMember As HMIObject
Dim iResult As Integer
Dim strName As String
Set colSearchResults =
ActiveDocument.HMIObjects.Find(PropertyName:="BackColor")
For Each objMember In colSearchResults
iResult = colSearchResults.Count
strName = objMember.ObjectName
MsgBox "Found: " & CStr(iResult) & vbCrLf & "Objectname: " &
strName
Next objMember
```

End Sub

7. To delete an object, you can for example insert a "DeleteObject()" procedure in the document "ThisDocument". In this example the first object in the active picture will be deleted.

```
Sub DeleteObject()  
'VBA39  
'Delete first object in active document:  
ActiveDocument.HMIObjects(1).Delete  
End Sub
```

8. Start the procedure with <F5>.

### See also

[Find Method \(Page 1841\)](#)

[Delete Method \(Page 1831\)](#)

[AddHMIOBJECT Method \(Page 1801\)](#)


[How to edit Default objects, Smart objects, Windows objects and Tube objects \(Page 1664\)](#)

[Editing Objects with VBA \(Page 1660\)](#)

## OLE Objects


### Introduction

You can use VBA to insert OLE Elements into a picture. The OLE Element belongs to the Smart objects. In the Graphics Designer, the object is available in the "Default" selection window:

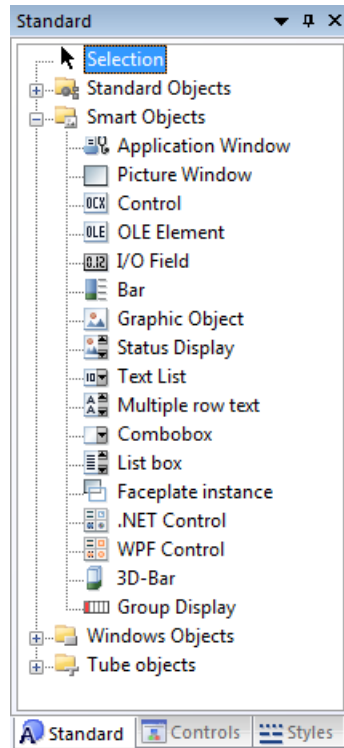

## Paste OLE Element in Picture

Use the "AddOLEControl(ObjectName, ServerName, [CreationType], [UseSymbol])" method to insert an OLE Element into a picture. ObjectName" stands for the object name, and "ServerName" for the application that is to be contained in the OLE Element. The "ServerName" parameter corresponds to the object type in the "object insertion dialog. The last two parameters are optional and represent the possible settings" in the dialog displayed:

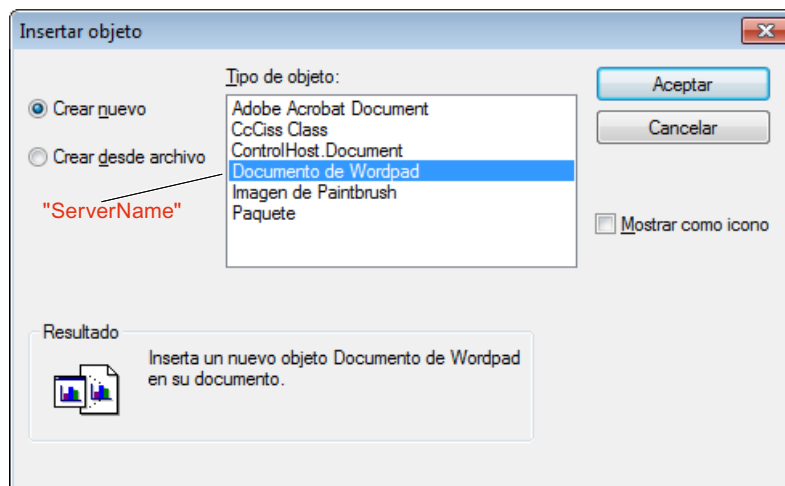

You will find further information on the parameters in this documentation under "AddOLEObject method".

In the following example an OLE Element containing a Wordpad document will be inserted into the active picture:

```
Sub AddOLEObjectToActiveDocument()  
    'VBA40  
    Dim objOLEObject As HMIOLEObject  
    Set objOLEObject = ActiveDocument.HMIOObjects.AddOLEObject("MS Wordpad Document1",  
        "Wordpad.Document.1")  
End Sub
```

The OLEObject object is added to the "HMIOObjects" listing as the last element and inherits the properties of the HMIOObject object.

## See also

[OLEObject Object \(Page 2023\)](#)

[AddOLEObject Method \(Page 1803\)](#)

[How to edit Default objects, Smart objects, Windows objects and Tube objects \(Page 1664\)](#)


[Default objects, Smart objects, Windows objects and Tube objects \(Page 1662\)](#)

[Editing Objects with VBA \(Page 1660\)](#)

## ActiveX controls

### Introduction

You can use VBA to insert ActiveX controls into a picture. In the Graphics Designer, you can find the ActiveX controls supplied with WinCC in the "Controls" selection window:

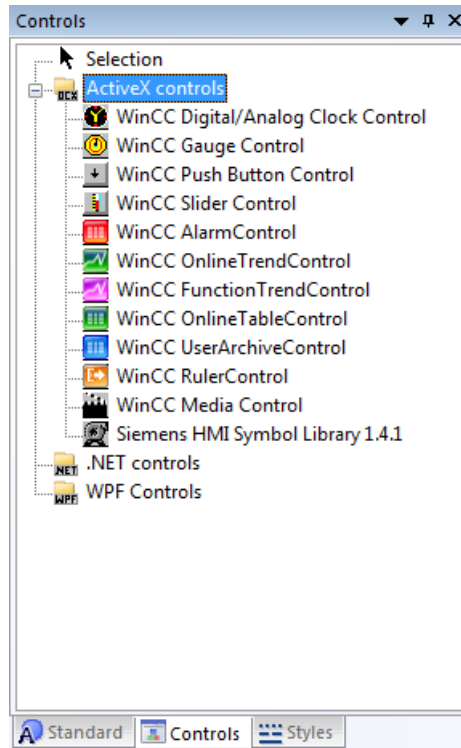

Further information is provided under "AddActiveXControl method" in this documentation and under "Working with controls" in the WinCC documentation.

### Integrating standard ActiveX controls

As well as the ActiveX controls supplied with WinCC, you can insert all standard ActiveX controls registered in the operating system into a picture. This means that you also have the option of using ActiveX controls that you have programmed yourself in your pictures. A list of the standard ActiveX controls tested with WinCC is given in the WinCC documentation.

### Inserting an ActiveX control into a picture

Use the "AddActiveXControl(ObjectName, ProgID)" method to insert a new ActiveX control into a picture. ObjectName" stands for the name of the ActiveX control (e.g. "WinCC Gauge"), and "ProgID" for the VBA object designation (e.g. "XGauge.XGauge.1"):

```
Sub AddActiveXControl()
'VBA41
Dim objActiveXControl As HMIActiveXControl
Set objActiveXControl = ActiveDocument.HMIObjects.AddActiveXControl("WinCC_Gauge",
"XGAUGE.XGaugeCtrl.1")
End Sub
```

The ActiveXControl object is added to the "HMIObjects" listing as the last element and inherits the properties of the HMIObject object.

### Access to the properties of the ActiveX control

You must address the object-specific properties of the ActiveX control via the "Properties(Index)" property. You can find out which properties a ActiveX control possesses from the "Object Properties" dialog in the Graphics Designer or from the Properties listing:

```
Sub AddActiveXControl()
'VBA42
Dim objActiveXControl As HMIActiveXControl
Set objActiveXControl = ActiveDocument.HMIObjects.AddActiveXControl("WinCC_Gauge2",
"XGAUGE.XGaugeCtrl.1")
'
'move ActiveX-control:
objActiveXControl.Top = 40
objActiveXControl.Left = 60
'
'Change individual property:
objActiveXControl.Properties("BackColor").value = RGB(255, 0, 0)
End Sub
```

### Restricted access to background graphics of Controls

The background graphic cannot be configured in VBA for the following Controls:

Control	Attribute
WinCC Digital/Analog Clock Control	Background graphic
WinCC Gauge Control	Background picture Frame picture
WinCC Push Button Control	PictureSelected PictureUnselected
WinCC slider control	Background picture Slider picture



## See also

ActiveXControl Object (Page 1900)

AddActiveXControl Method (Page 1795)

How to edit Default objects, Smart objects, Windows objects and Tube objects (Page 1664)

Default objects, Smart objects, Windows objects and Tube objects (Page 1662)

Editing Objects with VBA (Page 1660)

## .Net controls

### Introduction

You can use VBA to insert .Net controls into a picture. In the Graphics Designer, you can find the .Net controls in the "Controls" selection window.

Additional information is provided under "AddDotNetControl method" in this documentation and under "Creating process pictures > Working with controls > .Net controls" in the WinCC documentation.

### Inserting a .Net control into a picture

Use the "AddDotNetControl(ObjectName, ControlType, InGAC, AssemblyInfo)" method to insert a new .Net control into a picture. "ObjectName" represents the name of the .Net control. "ControlType" shows the name space of the object. If "InGAC" is "TRUE", the object is registered in the Global Assembly Cache and the associated information is available in "AssemblyInfo".

```
Sub AddDotNetControl()  
  'VBA851  
  Dim DotNetControl As HMIDotNetControl  
  Set DotNetControl = ActiveDocument.HMIObjects.AddDotNetControl("MyVBAControl",  
    "System.Windows.Forms.Label", True, "Assembly=System.Windows.Forms, Version=2.0.0.0,  
    Culture=neutral, PublicKeyToken=b77a5c561934e089")  
End Sub
```

The .Net control object is added to the "HMIObjects" listing as an element and inherits the properties of the HMIObject object.

### Access to the properties of the .Net control

You can find out which properties a .Net control has from the "Object Properties > Control Properties" dialog in Graphics Designer.

## WPF controls

### Introduction

You can use VBA to insert WPF controls into a picture. In the Graphics Designer, you can find the WPF controls in the "Controls" selection window.

Additional information is provided under "AddWPFControl method" in this documentation and under "Creating process pictures > Working with controls > WPF controls" in the WinCC documentation.

### Inserting a WPF control into a picture

Use the "AddWPFControl(ObjectName, ControlType, InGAC, AssemblyInfo)" method to insert a new WPF control into a picture. "ObjectName" represents the name of the .Net control. "ControlType" shows the name space of the object. If "InGAC" is "TRUE", the object is registered in the Global Assembly Cache and the associated information is available in "AssemblyInfo".

```
Sub AddWPFControl()  
'VBA852  
Dim WPFControl As HMIWPFControl  
Set WPFControl = ActiveDocument.HMIObjects.AddWPFControl("MyWPFVBAControl",  
"WinCCWPFControl.TestControl", False, "Assembly=Z:\TestControl\WinCCWPFControl.dll")  
End Sub
```

The ActiveXControl object is added to the "HMIObjects" listing as an element and inherits the properties of the HMIObject object.

### Access to the properties of the WPF control

You can find out which properties a WPF control has from the "Object Properties > Control Properties" dialog in Graphics Designer.

#### 3.3.4.3 Group Objects

### Group Objects

#### Introduction

With VBA you can create a group object from selected objects in the Graphics Designer. You can add objects to the group object, or remove objects, without having to ungroup the group object itself. You have unrestricted access to the object properties of the individual objects in the group object. You can also ungroup a group object again, or delete it entirely.

The following object types cannot be part of a group object:

- CustomizedObject (Customized object)
- ActiveXControl
- OLEObject

Further information regarding group objects can be found in the WinCC documentation under "Group Object".

## Creating a group object

To create a group object, select the objects that you want to be part of the group object in the Graphics Designer. The selected objects are then contained in the "Selection" listing. You create the group with the "CreateGroup()" method:

```
Sub CreateGroup()  
'VBA43  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objGroup As HMIGroup  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
Set objGroup = ActiveDocument.Selection.CreateGroup  
objGroup.ObjectName = "myGroup"  
End Sub
```

The group object is inserted at the end of the "HMIObjects" listing. The objects that are contained in the group object retain their index numbers and continue to be available in the "HMIObjects" listing.

The objects in the group object are also included in the "GroupedHMIObjects" listing, although the index numbers are reassigned.

Give the group object a name (`objGroup.Name = "My Group"`) so that you can uniquely identify it. If you do not assign a name, the group object is given the default designation for the group object (e.g. "Group1").

The group object has the same properties as the objects of the "Object" type.

## Editing a group object

You can edit a group object as follows:

- Methode "Add(Index)": Adds a new object to the group object.
- Methode "Remove(Index)": Removes a object from the group object.
- "UnGroup()" method: Ungroups the group object (ungroup).
- "Delete()" Method: Deletes the group object and the objects that it contains.

## Editing objects in a group object

Use the "GroupedHMIObjects" listing in order to select an object in the group object. In order to access its object property you must access the name of the object property via the "Properties" property, for example:

```
Sub ModifyPropertyOfObjectInGroup()  
'VBA44  
Dim objGroup As HMIGroup  
Set objGroup = ActiveDocument.HMIObjects("myGroup")  
objGroup.GroupedHMIObjects(1).Properties("BorderColor") = RGB(255, 0, 0)  
End Sub
```

## See also

- SelectedObjects object (Listing) (Page 2060)
- GroupedObjects Object (Listing) (Page 1983)
- Ungroup Method (Page 1892)
- Remove Method (Page 1871)
- Delete Method (Page 1831)
- Add Method (GroupedObjects Listing) (Page 1791)
- How to Edit Objects in Group Objects Using VBA (Page 1679)
- How to Edit the Group Objects Using VBA (Page 1676)
- Editing Objects with VBA (Page 1660)
- VBA in the Graphics Designer (Page 1621)


## How to Edit the Group Objects Using VBA

### Requirements

You must have created at least two graphic objects in the Graphics Designer and you must have selected them.

## Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor").
2. Open the document "ThisDocument" in the Project Explorer:

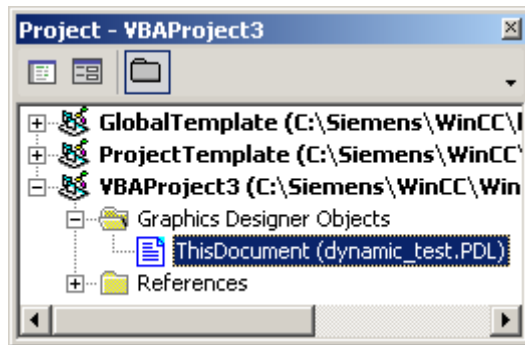

3. To create a group object from selected objects, you can for example insert a "CreateGroup()" procedure in the document "ThisDocument". In this example the group object "My Group" is created from a number of objects.

```
Sub CreateGroup()
    'VBA45
    Dim objCircle As HMICircle
    Dim objRectangle As HMIRectangle
    Dim objGroup As HMIGroup
    Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle",
    "HMICircle")
    Set objRectangle =
    ActiveDocument.HMIObjects.AddHMIObject("sRectangle",
    "HMIRectangle")
    With objCircle
        .Top = 40
        .Left = 40
        .Selected = True
    End With
    With objRectangle
        .Top = 80
        .Left = 80
        .Selected = True
    End With
    MsgBox "Objects selected!"
    Set objGroup = ActiveDocument.Selection.CreateGroup
    'The name identifies the group-object
    objGroup.ObjectName = "My Group"
End Sub
```

4. To add an object to the "My Group" group object, insert a "AddObjectToGroup()" procedure in the document "ThisDocument", for example. In this example, an ellipse is added to the "My Group" group object:

```
Sub AddObjectToGroup()  
    'VBA46  
    Dim objGroup As HMIGroup  
    Dim objEllipseSegment As HMIEllipseSegment  
    'Adds new object to active document  
    Set objEllipseSegment =  
    ActiveDocument.HMIObjects.AddHMIObject("EllipseSegment",  
    "HMIEllipseSegment")  
    Set objGroup = ActiveDocument.HMIObjects("My Group")  
    'Adds the object to the group  
    objGroup.GroupedHMIObjects.Add ("EllipseSegment")  
End Sub
```

5. To remove an object from the "My Group" group object, insert a "RemoveObjectFromGroup()" procedure in the document "ThisDocument", for example. In this example the first object will be removed from the "My Group" group object:

```
Sub RemoveObjectFromGroup()  
    'VBA47  
    Dim objGroup As HMIGroup  
    Set objGroup = ActiveDocument.HMIObjects("My Group")  
    'delete first object of the group-object  
    objGroup.GroupedHMIObjects.Remove (1)  
End Sub
```

6. To ungroup the "My Group" group object again, insert a procedure "UnGroup()" into the document "ThisDocument". In this example, the "My Group" group object is ungrouped:

```
Sub UnGroup()  
    'VBA48  
    Dim objGroup As HMIGroup  
    Set objGroup = ActiveDocument.HMIObjects("My Group")  
    objGroup.UnGroup  
End Sub
```

7. To delete the "My Group" group object, insert a procedure "DeleteGroup()" into the document "ThisDocument". In this example, the "My Group" group object is deleted, together with the objects it contains:

```
Sub DeleteGroup()  
    'VBA49  
    Dim objGroup As HMIGroup  
    Set objGroup = ActiveDocument.HMIObjects("My Group")  
    objGroup.Delete  
End Sub
```

8. Always start the procedure with <F5>.

## See also

[Ungroup Method \(Page 1892\)](#)

[Remove Method \(Page 1871\)](#)

[Delete Method \(Page 1831\)](#)

CreateGroup Method (Page 1829)  
Add Method (GroupedObjects Listing) (Page 1791)  
SelectedObjects object (Listing) (Page 2060)  
GroupedObjects Object (Listing) (Page 1983)  
Group Object (Page 1978)  
How to Edit Objects in Group Objects Using VBA (Page 1679)  
Group Objects (Page 1674)  
Editing Objects with VBA (Page 1660)  
VBA in the Graphics Designer (Page 1621)

## How to Edit Objects in Group Objects Using VBA

### Introduction

Here you will find the following instructions for editing objects in a group object with VBA:


- Editing a property of an object in the group object
- Editing a property of all objects in the group object

### Requirement

You must have created at least two graphic objects in the Graphics Designer and you must have grouped them.

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor").
2. Open the document "ThisDocument" in the Project Explorer:

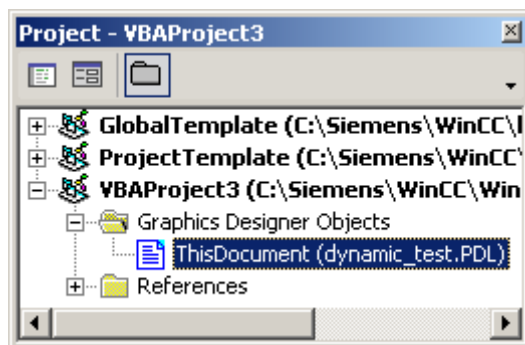

3. To edit a property of an object within the group object, you can for example insert a "ChangePropertiesOfGroupMembers()" procedure into the document "ThisDocument". In this example the properties of three different objects are modified in the group object "My Group":

```
Sub ChangePropertiesOfGroupMembers()  
    'VBA50  
    Dim objCircle As HMICircle  
    Dim objRectangle As HMIRectangle  
    Dim objEllipse As HMIEllipse  
    Dim objGroup As HMIGroup  
    Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle",  
    "HMICircle")  
    Set objRectangle =  
    ActiveDocument.HMIObjects.AddHMIObject("sRectangle",  
    "HMIRectangle")  
    Set objEllipse =  
    ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")  
    With objCircle  
        .Top = 40  
        .Left = 40  
        .Selected = True  
    End With  
    With objRectangle  
        .Top = 80  
        .Left = 80  
        .Selected = True  
    End With  
    With objEllipse  
        .Top = 120  
        .Left = 120  
        .Selected = True  
    End With  
    MsgBox "Objects selected!"  
    Set objGroup = ActiveDocument.Selection.CreateGroup  
    objGroup.ObjectName = "My Group"  
    'Set bordercolor of 1. object = "red":  
    objGroup.GroupedHMIObjects(1).Properties("BorderColor") =  
    RGB(255, 0, 0)  
    'set x-coordinate of 2. object = "120" :  
    objGroup.GroupedHMIObjects(2).Properties("Left") = 120  
    'set x-coordinate of 3. object = "90" :  
    objGroup.GroupedHMIObjects(3).Properties("Top") = 90  
End Sub
```



4. To change the properties of all the objects in the group object, insert a "ChangePropertiesOfAllGroupMembers()" procedure in the document In this example, the "BorderColor" property of each object in the "My Group" group object is changed. This example will not work unless you have created the "My Group" group object:

```
Sub ChangePropertiesOfAllGroupMembers()  
    'VBA51  
    Dim objGroup As HMIGroup  
    Dim iMaxMembers As Integer  
    Dim iIndex As Integer  
    Set objGroup = ActiveDocument.HMIObjects("My Group")  
    iIndex = 1  
    '  
    'Get number of objects in group-object:  
    iMaxMembers = objGroup.GroupedHMIObjects.Count  
    '  
    'set linecolor of all objects = "yellow":  
    For iIndex = 1 To iMaxMembers  
        objGroup.GroupedHMIObjects(iIndex).Properties("BorderColor") =  
        RGB(255, 255, 0)  
    Next iIndex  
End Sub
```

5. Always start the procedure with <F5>.

## See also

Properties Object (Listing) (Page 2041)  
GroupedObjects Object (Listing) (Page 1983)  
Ungroup Method (Page 1892)  
Remove Method (Page 1871)  
Delete Method (Page 1831)  
Add Method (GroupedObjects Listing) (Page 1791)  
How to Edit the Group Objects Using VBA (Page 1676)  
Group Objects (Page 1674)  
Editing Objects with VBA (Page 1660)  
VBA in the Graphics Designer (Page 1621)

### 3.3.4.4 Customized Objects

## Customized Objects

### Introduction

You can use VBA to create a customized object from selected objects in the Graphics Designer. In contrast to the group object, in the case of a customized object only those object properties are available which you have selected in the "Configuration Dialog" for the customized object. It is not possible to configure a customized object with VBA.

Further information regarding customized objects can be found in the WinCC documentation under "Customized Object".

### Creating a customized object with VBA

Use the "CreateCustomizedObject()" method to create a customized object from selected objects:

```
Sub CreateCustomizedObject()  
'VBA52  
Dim objCustomizedObject As HMICustomizedObject  
Set objCustomizedObject = ActiveDocument.Selection.CreateCustomizedObject  
objCustomizedObject.ObjectName = "My Customized Object"  
End Sub
```

When you apply the "CreateCustomizedObject()" method, the "Configuration Dialog" appears in which you select the object properties. The customized object that you have created is added to the "HMIObjets" listing. Give the customized object an appropriate name (objCustomizedObject.Name = "My Customized Object") so that you can uniquely identify it.

---

#### Note

If you open a document as invisible, do not create a user object there with a VBA script. Program execution will otherwise be interrupted by a configuration dialog.

---

### Editing Customized Objects

You can edit a customized object as follows:

- "Destroy" method: Ungroups the customized object.
- "Delete" Method: Deletes the customized object and the objects that it contains.

## Editing objects in a customized object

Use the "Properties" property to access the selected object properties of the objects contained in the customized object.

```
Sub EditCustomizedObjectProperty()  
'VBA53  
Dim objCustomizedObject As HMICustomizedObject  
Set objCustomizedObject = ActiveDocument.HMIObjects(1)  
objCustomizedObject.Properties("BackColor") = RGB(255, 0, 0)  
End Sub
```

If you have selected more than one identical property (for example the background color of a circle and of a rectangle), these properties will be numbered ("BackColor" and "BackColor1").

## See also

[HMIObject Object \(Page 1988\)](#)  
[CustomizedObject Object \(Page 1938\)](#)  
[Destroy Method \(Page 1835\)](#)  
[Delete Method \(Page 1831\)](#)  
[CreateCustomizedObject Method \(Page 1825\)](#)  
[How to Edit a Customized Object with VBA \(Page 1683\)](#)  
[How to Edit the Group Objects Using VBA \(Page 1676\)](#)  
[Group Objects \(Page 1674\)](#)  
[Editing Objects with VBA \(Page 1660\)](#)

## How to Edit a Customized Object with VBA

### Introduction

Here you will find the following instructions for editing a customized object with VBA:

- [Creating a customized object from selected objects](#)
- [Ungrouping Customized Objects](#)
- [Deleting a customized object](#)

---


#### Note

It is not possible to configure a customized object with VBA.

---

## Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor").
2. Open the document "ThisDocument" in the Project Explorer:

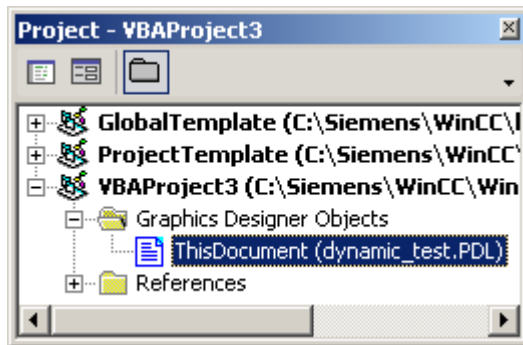

3. To create a customized object from selected objects, you can for example insert a "CreateCustomizedObject()" procedure in the document "ThisDocument". In this example the customized object "My Customized Object" is created from selected objects:

```
Sub CreateCustomizedObject()
'VBA54
Dim objCustomizedObject As HMICustomizedObject
Dim objCircle As HMICircle
Dim objRectangle As HMIRectangle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle",
"HMICircle")
Set objRectangle =
ActiveDocument.HMIObjects.AddHMIObject("sRectangle",
"HMIRectangle")
With objCircle
.Top = 40
.Left = 40
.Selected = True
End With
With objRectangle
.Top = 80
.Left = 80
.Selected = True
End With
MsgBox "Objects selected!"
Set objCustomizedObject =
ActiveDocument.Selection.CreateCustomizedObject
'
'*** The "Configurationdialog" started. ***
'*** Configure the costumize-object with the "configurationdialog"
'***
'
objCustomizedObject.ObjectName = "My Customized Object"
End Sub
```

4. To delete an object, you can for example insert a "DeleteObject()" procedure in the document "ThisDocument". In this example the customized object "My Customized Object" created beforehand is deleted again:

```
Sub DestroyCustomizedObject ()  
  'VBA55  
  Dim objCustomizedObject As HMICustomizedObject  
  Set objCustomizedObject = ActiveDocument.HMIObjects("My  
  Customized Object")  
  objCustomizedObject.Destroy  
End Sub
```

5. To delete a customized object, you can for example insert a "DeleteCustomizedObject()" procedure in the document "ThisDocument". In this example the customized object "My Customized Object" created beforehand is deleted:

```
Sub DeleteCustomizedObject ()  
  'VBA56  
  Dim objCustomizedObject As HMICustomizedObject  
  Set objCustomizedObject = ActiveDocument.HMIObjects("My  
  Customized Object")  
  objCustomizedObject.Delete  
End Sub
```

6. Always start the procedure with <F5>.

## See also

[Destroy Method \(Page 1835\)](#)

[Delete Method \(Page 1831\)](#)

[CreateCustomizedObject Method \(Page 1825\)](#)


[Customized Objects \(Page 1682\)](#)

### 3.3.5 Creating Dynamics with VBA




#### 3.3.5.1 Creating Dynamics with VBA

##### Introduction

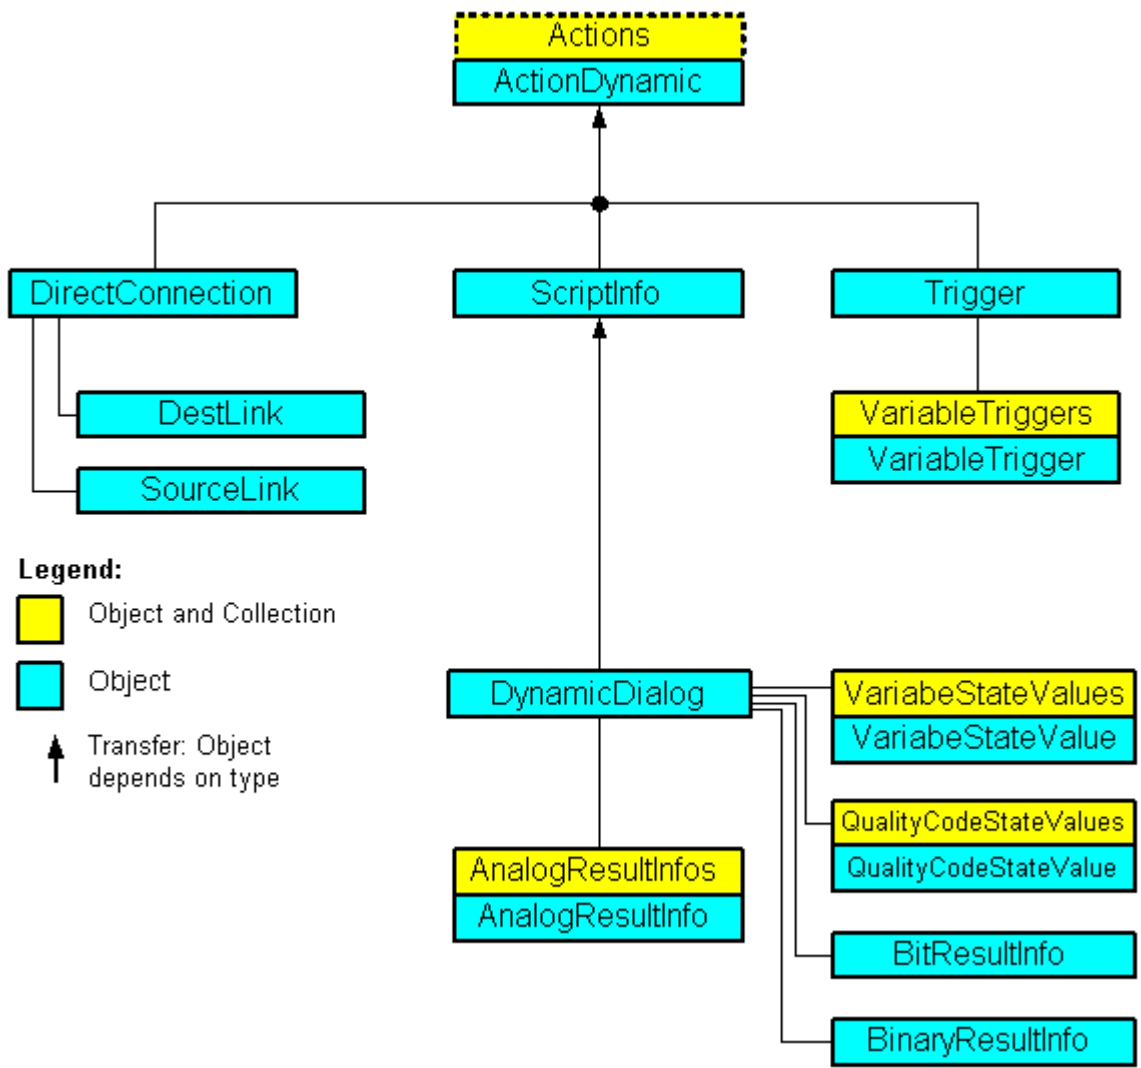VBA allows you to add dynamics to properties of pictures and objects and to configure event-controlled actions. VBA provides you with the ActionDynamic object for this purpose:



**Legend:**

-  Object and Collection
-  Object
-  Transfer: Object depends on type

The ActionDynamic object represents an interface that is dependent on the object type:

- When you configure a dynamic for a property (Property object), the ActionDynamic object inherits the properties of the ScriptInfo, Trigger and DynamicDialog objects.
- When you configure an event-controlled action (Event object), the ActionDynamic object inherits the properties of the ScriptInfo and DirectConnection objects.

## Adding dynamics to properties of pictures and objects

VBA enables you to add dynamics to properties of pictures and objects. You can use tags, scripts or the Dynamic dialog to add dynamics. Using dynamics enables you for example to configure a color change for an object in runtime when the value of a variable changes.

## Configuring event-controlled actions

You can configure event-controlled actions with VBA. An action (script or direct connection) is triggered then the defined event occurs in runtime. An event may be a change to an object property, for example, or the clicking of a button.

## Editing Triggers

You can edit triggers with VBA. Triggers are required when you use dynamics. They determine when a dynamic value is updated in runtime. This may occur at regular intervals, for example, or in the event of a picture change.

When you configure event-controlled actions, the event is the trigger.

## See also

[Editing Triggers \(Page 1707\)](#)

[Configuring Event-Driven Actions with VBA \(Page 1699\)](#)

[Configuring Dynamics in the Properties of Pictures and Objects \(Page 1687\)](#)

### 3.3.5.2 Configuring Dynamics in the Properties of Pictures and Objects

## Configuring Dynamics in the Properties of Pictures and Objects

### Introduction

VBA enables you to add dynamics to properties of pictures and objects. Dynamic object properties can be changed as a function of a variable value in Runtime, for example. The following methods of adding dynamics are possible:

- Tag connection
- Dynamic dialog
- Scripts

## Principle

The following example illustrates the principle of the procedure for adding dynamics to an object property:

```
Sub CreateDynamicOnProperty()  
'VBA57  
Dim objVariableTrigger As HMIVariableTrigger  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle1", "HMICircle")  
,  
'Create dynamic with type "direct Variableconnection" at the  
'property "Radius":  
Set objVariableTrigger =  
objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVariableDirect, "'NewDynamic1'")  
,  
'To complete dynamic, e.g. define cycle:  
With objVariableTrigger  
.CycleType = hmiVariableCycleType_2s  
End With  
End Sub
```

---

### Note

Note that a variable is not created simply by specifying the variable name. Use the variable selection dialog to create the variable.

---

## Tag connection

Use the VariableTrigger object to add a dynamic to a property with a direct or indirect variable connection. The dynamic property then responds in runtime to a change in value to the specified variable. To allow this, in VBA you need to specify the variable name (VarName property) and the cycle (CycleTime property).

## Dynamic dialog

Use the DynamicDialog object to add a dynamic to a property with the aid of the Dynamic dialog. The dynamic property responds in runtime to a variable's value ranges. The following objects are available for specifying the value range:

- AnalogResultInfos-Objekt: Use this object to assign a fixed value to value ranges of a variable or a script. The fixed value is assigned to the dynamic property when the variable value or return value of the script is within the specified value range.
- BinaryResultInfo Object: Use this object to assign a fixed value to binary value ranges (zero and non-zero) of a variable or a script. The fixed value is assigned to the dynamic property when the variable value or return value of the script returns one of the two values.
- VariableStateValue Object Use this object to assign a fixed value to the state (e.g. "Upper limit exceeded") of a specified variable. The fixed value is then allocated to the dynamic property when the state occurs.



## Scripts

Use the ScriptInfo object to add a dynamic to a property with a C or VB script. The property with the dynamic reacts to a script in Runtime and is controlled via a trigger. Use the Trigger object for configuring the trigger.

## See also

VariableTrigger Object (Page 2099)

VariableStateValue Object (Page 2096)

Trigger Object (Page 2087)

ScriptInfo Object (Page 2058)

BinaryResultInfo Object (Page 1918)

AnalogResultInfos Object (Listing) (Page 1908)

How to dynamize a property with a VB script (Page 1697)

How to dynamize a property with a C script (Page 1694)

How to dynamize a property with the Dynamic dialog (Page 1691)

How to dynamize a property with a tag connection (Page 1689)

Creating Dynamics with VBA (Page 1686)

## How to dynamize a property with a tag connection


### Introduction

Here you will find the following instructions for dynamizing a property with tag connection:

- Dynamizing a property with direct tag connection
- Dynamizing a property with indirect tag connection

## Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

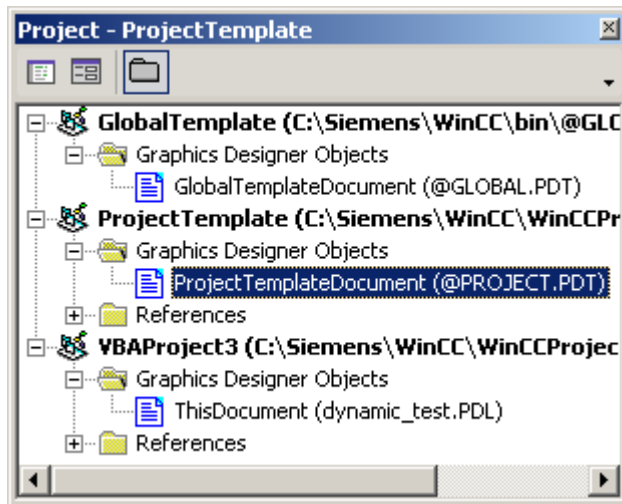

3. To dynamize an object property with a direct tag connection, you can for example insert an "AddDynamicAsVariableDirectToProperty()" procedure in the document. "In this example a circle property "Top" will be made dynamic with the aid of the tag Otto:

```
Sub AddDynamicAsVariableDirectToProperty()
'VBA58
Dim objVariableTrigger As HMIVariableTrigger
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle1",
"HMICircle")
'Create dynamic at property "Top"
Set objVariableTrigger =
objCircle.Top.CreateDynamic(hmiDynamicCreationTypeVariableDirect,
"Otto")
'
'define cycle-time
With objVariableTrigger
.CycleType = hmiVariableCycleType_2s
End With
End Sub
```

4. To dynamize an object property with an indirect tag connection, you can for example insert an "AddDynamicAsVariableInDirectToProperty()" procedure in the document. "In this example a circle property Left" will be made dynamic with the aid of the tag "Anton":

```
Sub AddDynamicAsVariableIndirectToProperty()  
'VBA59  
Dim objVariableTrigger As HMIVariableTrigger  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle2",  
"HMICircle")  
'Create dynamic on property "Left":  
Set objVariableTrigger =  
objCircle.Left.CreateDynamic(hmiDynamicCreationTypeVariableIndirect,  
"Anton")  
'  
'Define cycle-time  
With objVariableTrigger  
.CycleType = hmiVariableCycleType_2s  
End With  
End Sub
```

5. Start the procedure with <F5>.

## See also

[CycleType Property \(Page 2209\)](#)

[VarName Property \(Page 2548\)](#)

[VariableTrigger Object \(Page 2099\)](#)

[CreateDynamic Method \(Page 1828\)](#)

[How to dynamize a property with a VB script \(Page 1697\)](#)

[How to dynamize a property with a C script \(Page 1694\)](#)

[How to dynamize a property with the Dynamic dialog \(Page 1691\)](#)

[Configuring Dynamics in the Properties of Pictures and Objects \(Page 1687\)](#)

[Creating Dynamics with VBA \(Page 1686\)](#)

## How to dynamize a property with the Dynamic dialog

### Introduction


You can use the Dynamic dialog to dynamize properties of pictures and objects depending on certain value ranges or variable states. The following value ranges are available for selection:

- Analog
- Binary
- Bit
- Direct

With VBA you specify the type of value range with the ResultType property. These instructions illustrate the addition of dynamics to an object property with analog value ranges. Additional information dynamization with the dynamic dialog is provided under "DynamicDialog object" in the VBA reference in this documentation.

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

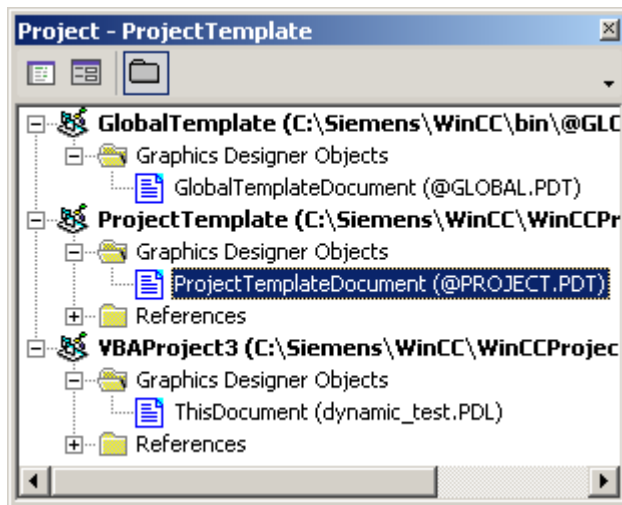

3. To dynamize an object property with the Dynamic dialog, you can for example insert an "AddDynamicDialogToCircleRadiusTypeAnalog()" procedure in the document. In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned and three analog value ranges will be created:
4. Start the procedure with <F5>.

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
  'VBA60  
  Dim objDynDialog As HMIDynamicDialog  
  Dim objCircle As HMICircle  
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
  '  
  'Create dynamic  
  Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog, "NewDynamic1")  
  '  
  'Configure dynamic. "ResultType" defines the type of valuerange:  
  With objDynDialog  
    .ResultType = hmiResultTypeAnalog  
    .AnalogResultInfos.Add 50, 40  
    .AnalogResultInfos.Add 100, 80  
    .AnalogResultInfos.ElseCase = 100  
  End With  
End Sub
```

### New VBA method to configure dynamization using the Dynamic Dialog

For optimization reasons, an additional new method has been provided:

- CreateDynamicDialog([Code as String], iResultType as Long) as HMIActionDynamic

The parameter "IResultType" has the following constants:

- hmiResultTypeDirect = 0
- hmiResultTypeAnalog= 1
- hmiResultTypeBool = 2
- hmiResultTypeBit = 3

In the following example the radius of a circle is given dynamics with the A tag name and a "ResultType" are assigned to the dynamic dialog.

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
  'VBA820  
  Dim objDynDialog As HMIDynamicDialog  
  Dim objCircle As HMICircle  
  'Create Object  
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("myCircle", "HMICircle")  
  'Create dynamic (Tag "myTest" must exist")  
  Set objDynDialog = objCircle.Radius.CreateDynamicDialog("myTest", 0)  
End Sub
```

## Initializing a string property

A string property must be initialized before being made dynamic by assigning a text to it. In the following ToolTipText example, this is done in "objCircle.ToolTipText = "Text".

```
Sub Dyn()  
'VBA823  
Dim objCircle As HMICircle  
Dim doc As Document  
Dim objDynDialog As HMIDynamicDialog  
Set doc = ActiveDocument  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle","HMICircle")  
objCircle.ObjectName = "Circle1"  
objCircle.BorderColor = RGB(255, 0, 0)  
objCircle.BackColor = RGB(0, 255, 0)  
objCircle.ToolTipText = "Text"  
Set objDynDialog = objCircle.ToolTipText.CreateDynamic(hmiDynamicCreationTypeDynamicDialog, "Var")  
End Sub
```

## See also

- [How to dynamize a property with a tag connection \(Page 1689\)](#)
- [ResultType Property \(Page 2399\)](#)
- [DynamicDialog Object \(Page 1955\)](#)
- [CreateDynamic Method \(Page 1828\)](#)
- [How to dynamize a property with a VB script \(Page 1697\)](#)
- [How to dynamize a property with a C script \(Page 1694\)](#)
- [Configuring Dynamics in the Properties of Pictures and Objects \(Page 1687\)](#)
- [Creating Dynamics with VBA \(Page 1686\)](#)
- [ToolTipText Property \(Page 2445\)](#)


## How to dynamize a property with a C script

### Introduction

When you dynamize a property with a C script, you can assign the C code to the "SourceCode" property. The C script is compiled in the background. The "Compiled" property returns "True" when the C code has been successfully compiled.

## Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

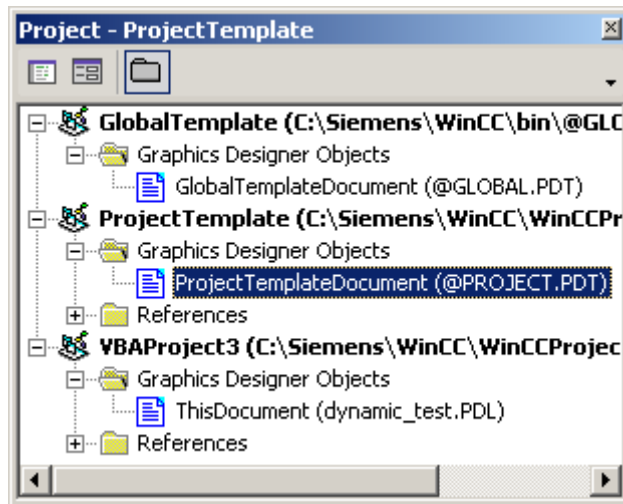

3. To add dynamics to an object property with a C script, you can for example insert an "AddDynamicAsCScriptToProperty()" procedure in the document. In this example the height of a circle is increased by 5 pixels every two seconds in runtime:

```
Sub AddDynamicAsCSkriptToProperty()  
  'VBA61  
  Dim objCScript As HMI_ScriptInfo  
  Dim objCircle As HMICircle  
  Dim strCode As String  
  strCode = "long lHeight;" & vbCrLf & "int check;" & vbCrLf  
  strCode = strCode & "GetHeight(""events.PDL"", ""myCircle"");" &  
  vbCrLf  
  strCode = strCode & "lHeight = lHeight+5;" & vbCrLf  
  strCode = strCode & "check = SetHeight(""events.PDL"",  
  ""myCircle"", lHeight );"  
  strCode = strCode & vbCrLf & "//Return-Type: BOOL" & vbCrLf  
  strCode = strCode & "return check;"  
  Set objCircle =  
  ActiveDocument.HMIObjects.AddHMIObject("myCircle", "HMICircle")  
  'Create dynamic for Property "Height":  
  Set objCScript =  
  objCircle.Height.CreateDynamic(hmiDynamicCreationTypeCScript)  
  '  
  'set Sourcecode and cycletime:  
  With objCScript  
    .SourceCode = strCode  
    .Trigger.Type = hmiTriggerTypeStandardCycle  
    .Trigger.CycleType = hmiCycleType_2s  
    .Trigger.Name = "Trigger1"  
  End With  
End Sub
```

4. Start the procedure with <F5>.

## See also

[Trigger Property \(Page 2449\)](#)

[ScriptType Property \(Page 2407\)](#)

[SourceCode Property \(Page 2424\)](#)

[CycleType Property \(Page 2209\)](#)

[ScriptInfo Object \(Page 2058\)](#)

[CreateDynamic Method \(Page 1828\)](#)

[How to dynamize a property with a VB script \(Page 1697\)](#)

[How to dynamize a property with the Dynamic dialog \(Page 1691\)](#)

[How to dynamize a property with a tag connection \(Page 1689\)](#)

[Configuring Dynamics in the Properties of Pictures and Objects \(Page 1687\)](#)

[Creating Dynamics with VBA \(Page 1686\)](#)




## How to dynamize a property with a VB script

### Introduction

When you dynamize a property with a VB script, you can assign the VB code to the "SourceCode" property. The VB script is compiled in the background. The "Compiled" property returns "True" if the VB code is syntactically correct.

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

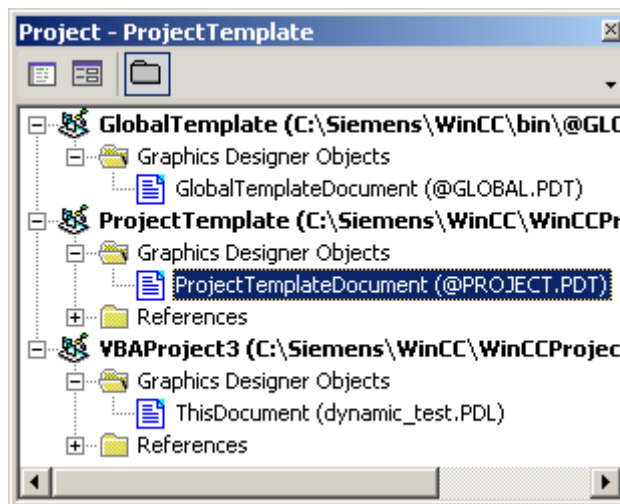

3. To add dynamics to an object property with a VB script, you can for example insert an "AddDynamicAsVBScriptToProperty()" procedure in the document. In this example the radius of a circle is increased by 5 pixels every two seconds in Runtime:

```
Sub AddDynamicAsVBSkriptToProperty()  
  'VBA62  
  Dim objVBScript As HMIScriptInfo  
  Dim objCircle As HMICircle  
  Dim strCode As String  
  strCode = "Dim myCircle" & vbCrLf & "Set myCircle = "  
  strCode = strCode &  
  "HMIRuntime.ActiveScreen.ScreenItems("myCircle")"  
  strCode = strCode & vbCrLf & "myCircle.Radius = myCircle.Radius +  
  5"  
  Set objCircle =  
  ActiveDocument.HMIObjects.AddHMIObject("myCircle", "HMICircle")  
  '  
  'Create dynamic of property "Radius":  
  Set objVBScript =  
  objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)  
  '  
  'Set SourceCode and cycletime:  
  With objVBScript  
    .SourceCode = strCode  
    .Trigger.Type = hmiTriggerTypeStandardCycle  
    .Trigger.CycleType = hmiCycleType_2s  
    .Trigger.Name = "Trigger1"  
  End With  
End Sub
```

4. Start the procedure with <F5>.

## See also

[How to dynamize a property with a C script \(Page 1694\)](#)

[Trigger Property \(Page 2449\)](#)

[SourceCode Property \(Page 2424\)](#)

[CycleType Property \(Page 2209\)](#)

[ScriptInfo Object \(Page 2058\)](#)

[CreateDynamic Method \(Page 1828\)](#)

[How to dynamize a property with the Dynamic dialog \(Page 1691\)](#)

[How to dynamize a property with a tag connection \(Page 1689\)](#)

[Configuring Dynamics in the Properties of Pictures and Objects \(Page 1687\)](#)

[Creating Dynamics with VBA \(Page 1686\)](#)

### 3.3.5.3 Configuring Event-Driven Actions with VBA

## Configuring Event-Driven Actions with VBA

### Introduction

With VBA you can configure actions for pictures and objects which are triggered when predefined events occur. For example, when the mouse is clicked on an object in Runtime a C script is called whose return value is used for the dynamics of an object property. The following methods of adding dynamics are possible:

- Direct connection
- Scripts

The events that are used for configuring event-controlled actions occur only in Runtime and have nothing to do with the VBA event handlers.

### General Procedure

You use the Events property for configuring event-controlled actions with VBA. The way this property is used depends on whether you are configuring an action on an object or picture or a property.

#### Configuring an action on an object or picture

An action that you configure on a picture or object is triggered when a predefined event occurs, for example when the object is clicked on with the mouse. You configure an action on an object with VBA by using the "Events(Index)" property, where "Index" stands for the triggering event:

```
Sub AddActionToObjectTypesCScript()  
'VBA63  
Dim objEvent As HMIEvent  
Dim objCScript As HMIScriptInfo  
Dim objCircle As HMICircle  
'Create circle. Click on object executes an C-action  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_AB", "HMICircle")  
Set objEvent = objCircle.Events(1)  
Set objCScript = objEvent.Actions.AddAction(hmiActionCreationTypeCScript)  
'  
'Assign a corresponding custom-function to the property "SourceCode":  
objCScript.SourceCode = ""  
End Sub
```

### Configuring an action on a property

An action that you configure on a property of a picture or object is triggered when the property value changes. You configure an action on a property with VBA by using the "Events(1)" property, where the index "1" stands for the event "Upon change":

```
Sub AddActionToPropertyTypeCScript()  
'VBA64  
Dim objEvent As HMIEvent  
Dim objCScript As HMIScriptInfo  
Dim objCircle As HMICircle  
'Create circle. Changing of the Property  
'"Radius" should be activate C-Aktion:  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_AB", "HMICircle")  
Set objEvent = objCircle.Radius.Events(1)  
Set objCScript = objEvent.Actions.AddAction(hmiActionCreationTypeCScript)  
'  
'Assign a corresponding custom-function to the property "SourceCode":  
objCScript.SourceCode = ""  
End Sub
```

### Direct connection

Use the DirectConnection object to configure a direct connection.

### Scripts

Use the ScriptInfo object if you want an event to trigger a C or VB action.

### See also

- How to configure a VB action with VBA on an event (Page 1705)
- Events Property (Page 2223)
- ScriptInfo Object (Page 2058)
- Event Object (Page 1966)
- How to configure a C action with VBA on an event (Page 1703)
- How to configure a direct connection with VBA (Page 1701)
- Event Handling (Page 1709)
- Creating Dynamics with VBA (Page 1686)


## How to configure a direct connection with VBA

### Introduction

These instructions show you how to configure a direct connection on the basis of two object properties. Further information on the configuring of direct connections with VBA is given in the VBA reference in this documentation under "AutomationName property" and "ObjectName property"

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

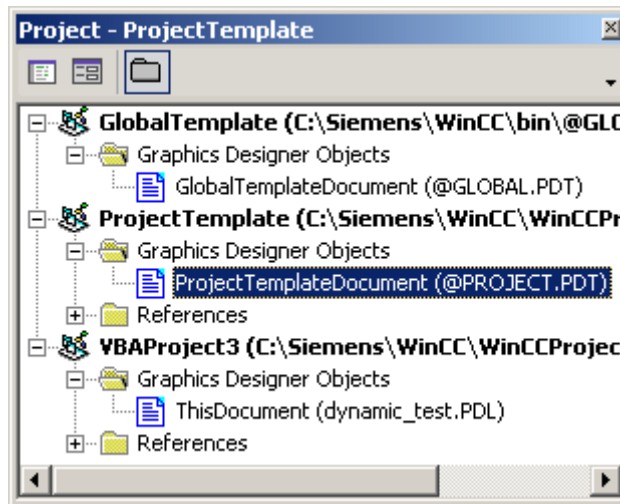

3. To configure a direct connection to an object property, you can for example insert an "AddDirectConnectionToObject()" procedure in the document. In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:

```
Sub DirectConnection()  
    'VBA65  
    Dim objButton As HMIButton  
    Dim objRectangleA As HMIRectangle  
    Dim objRectangleB As HMIRectangle  
    Dim objEvent As HMIEvent  
    Dim objDConnection As HMIDirectConnection  
    '  
    'Create objects:  
    Set objRectangleA =  
    ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A",  
    "HMIRectangle")  
    Set objRectangleB =  
    ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B",  
    "HMIRectangle")  
    Set objButton =  
    ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
    With objRectangleA  
        .Top = 100  
        .Left = 100  
    End With  
    With objRectangleB  
        .Top = 250  
        .Left = 400  
        .BackColor = RGB(255, 0, 0)  
    End With  
    With objButton  
        .Top = 10  
        .Left = 10  
        .Text = "SetPosition"  
    End With  
    '  
    'Directconnection is initiated by mouseclick:  
    Set objDConnection =  
    objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectC  
    onnection)  
    With objDConnection  
        'Sourceobject: Property "Top" of Rectangle_A  
        .SourceLink.Type = hmiSourceTypeProperty  
        .SourceLink.ObjectName = "Rectangle_A"  
        .SourceLink.AutomationName = "Top"  
        '  
        'Destinationobject: Property "Left" of Rectangle_B  
        .DestinationLink.Type = hmiDestTypeProperty  
        .DestinationLink.ObjectName = "Rectangle_B"  
        .DestinationLink.AutomationName = "Left"  
    End With
```

End Sub

4. Start the procedure with <F5>.


## See also

- ObjectName Property (Page 2347)
- AutomationName Property (Page 2124)
- SourceLink Object (Page 2065)
- DestLink Object (Page 1945)
- DirectConnection Object (Page 1947)
- Configuring Event-Driven Actions with VBA (Page 1699)

## How to configure a C action with VBA on an event

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

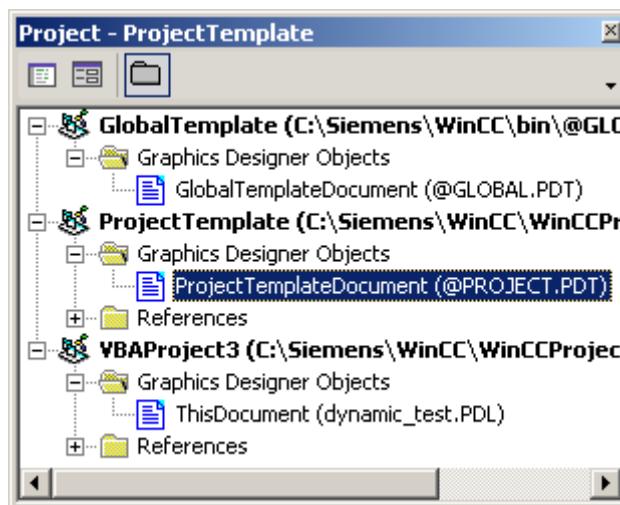

3. To configure a C action on an event with VBA, you can for example insert a "CreateCActionToClickedEvent()" procedure in the document. In this example a button and a circle will be inserted in the active picture. In Runtime the height increases every time you click the button:

```
Sub CreateCActionToClickedEvent()
  'VBA66
  Dim objButton As HMIButton
  Dim objCircle As HMICircle
  Dim objEvent As HMIEvent
  Dim objCScript As HMIScriptInfo
  Dim strCode As String
  strCode = "long lHeight;" & vbCrLf & "int check;" & vbCrLf
  strCode = strCode & "lHeight = GetHeight (""events.PDL"",
  ""myCircle"");"
  strCode = strCode & vbCrLf & "lHeight = lHeight+5;" & vbCrLf &
  "check = "
  strCode = strCode & "SetHeight (""events.PDL"",
  ""myCircle"", lHeight);"
  strCode = strCode & vbCrLf & "//Return-Type: Void"
  Set objCircle =
  ActiveDocument.HMIObjects.AddHMIObject("myCircle", "HMICircle")
  Set objButton =
  ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")
  With objCircle
    .Top = 100
    .Left = 100
    .BackColor = RGB(255, 0, 0)
  End With
  With objButton
    .Top = 10
    .Left = 10
    .Text = "Increase height"
  End With
  'Configure directconnection:
  Set objCScript =
  objButton.Events(1).Actions.AddAction(hmiActionCreationTypeCScript
  )
  With objCScript
    '
    'Note: Replace "events.PDL" with your picturename
    .SourceCode = strCode
  End With
End Sub
```

4. Start the procedure with <F5>.

## See also

ScriptInfo Object (Page 2058)

Events Object (Listing) (Page 1967)




Actions Object (Listing) (Page 1898)

Configuring Event-Driven Actions with VBA (Page 1699)

## How to configure a VB action with VBA on an event

### Procedure

1. Open the VBA editor in Graphics Designer (<ALT+F11> or "Tools" > "Macros" > "Visual Basic Editor")
2. In Project Explorer, open the document in which you want to write the VBA code:

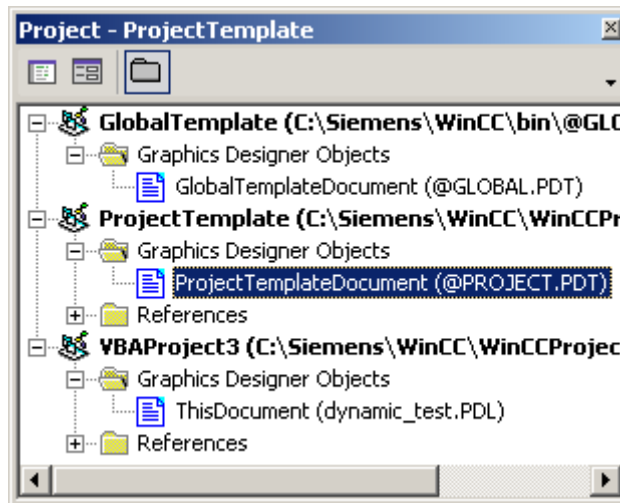

3. To configure an event-oriented VB action with VBA, you can for example insert a "CreateVBAActionToClickedEvent()" procedure in the document. In this example a button and a circle will be inserted in the active picture. In Runtime the radius of the circle enlarges every time you click the button:

```
Sub CreateVBAActionToClickedEvent()  
  'VBA67  
  Dim objButton As HMIButton  
  Dim objCircle As HMICircle  
  Dim objEvent As HMIEvent  
  Dim objVBScript As HMIScriptInfo  
  Dim strCode As String  
  strCode = "Dim myCircle" & vbCrLf & "Set myCircle = "  
  strCode = strCode &  
  "HMIRuntime.ActiveScreen.ScreenItems("Circle_VB")"  
  strCode = strCode & vbCrLf & "myCircle.Radius = myCircle.Radius +  
  5"  
  Set objCircle =  
  ActiveDocument.HMIObjects.AddHMIObject("Circle_VB", "HMICircle")  
  Set objButton =  
  ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
  With objCircle  
    .Top = 100  
    .Left = 100  
    .BackColor = RGB(255, 0, 0)  
  End With  
  With objButton  
    .Top = 10  
    .Left = 10  
    .Width = 120  
    .Text = "Increase Radius"  
  End With  
  'Define event and assign sourcecode:  
  Set objVBScript =  
  objButton.Events(1).Actions.AddAction(hmiActionCreationTypeVBScrip  
  t)  
  With objVBScript  
    .SourceCode = strCode  
  End With  
End Sub
```

4. Start the procedure with <F5>.

## See also

Actions Object (Listing) (Page 1898)

ScriptInfo Object (Page 2058)

Events Object (Listing) (Page 1967)

Configuring Event-Driven Actions with VBA (Page 1699)

### 3.3.5.4 Editing Triggers

## Editing Triggers

### Introduction


You use triggers in connection with dynamics for graphics objects and for triggering actions on object properties. Examples of triggers include:

- Tags: When the value of a tag is changed or its limit is exceeded at either extreme
- Standard cycle: Cyclic execution of the action. The length of the cycles is selectable between 250 ms and 1 h. In addition, you can also use customized cycles that you define yourself.
- Picture cycle: A cyclic trigger is used as the trigger. This cycle provides the option of defining the cycles of all the actions, tag connections and dynamic dialogs used in a picture centrally.
- Window Cycle: A cyclic trigger is used as the trigger. This values applies to all actions, tag links and dynamic dialogs, which were configured with the trigger type "Window cycle".

When you configure an action that responds to an event on a graphics object, the triggering event is the trigger.

### Configuring triggers with VBA

Use the Trigger object to configure a trigger with VBA. If you intend to use a variable as the trigger, use the VariableTrigger object:

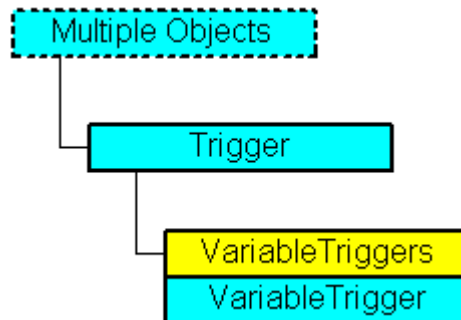

You determine the type of trigger with the Type property. Use the VariableTriggers property when you configure a variable as the trigger.

### See also

Examples of Editing Triggers with VBA (Page 1708)

VariableTrigger Object (Page 2099)

Trigger Object (Page 2087)

ScriptInfo Object (Page 2058)

## Examples of Editing Triggers with VBA

### Introduction

The four examples below illustrate how you can create the following triggers with VBA:

- Standard cycle
- Tag
- Picture cycle
- Window Cycle

In all of these examples a circle is inserted into the active picture, with the radius of the circle being dynamized with a VB action.

The procedure for adding dynamics to a property with variable connection is explained under "Adding dynamics to a property with a variable connection" in this documentation.

### Example 1: Standard cycle

```
Sub DynamicWithStandardCycle()  
'VBA68  
Dim objVBScript As HMIScriptInfo  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_Standard", "HMICircle")  
Set objVBScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)  
With objVBScript  
.Trigger.Type = hmiTriggerTypeStandardCycle  
"CycleType"-specification is necessary:  
.Trigger.CycleType = hmiCycleType_10s  
.Trigger.Name = "VBA_StandardCycle"  
.SourceCode = ""  
End With  
End Sub
```

### Example 2: Tag

```
Sub DynamicWithVariableTriggerCycle()  
'VBA69  
Dim objVBScript As HMIScriptInfo  
Dim objVarTrigger As HMIVariableTrigger  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_VariableTrigger",  
"HMICircle")  
Set objVBScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)  
With objVBScript  
Set objVarTrigger = .Trigger.VariableTriggers.Add("VarTrigger", hmiVariableCycleType_10s)  
.SourceCode = ""  
End With  
End Sub
```

### Example 3: Picture cycle

```
Sub DynamicWithPictureCycle()  
'VBA70  
Dim objVBScript As HMIScriptInfo  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_Picture", "HMICircle")  
Set objVBScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)  
With objVBScript  
.Trigger.Type = hmiTriggerTypePictureCycle  
.Trigger.Name = "VBA_PictureCycle"  
.SourceCode = ""  
End With  
End Sub
```

### Example 4: Window Cycle

```
Sub DynamicWithWindowCycle()  
'VBA71  
Dim objVBScript As HMIScriptInfo  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_Window", "HMICircle")  
Set objVBScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)  
With objVBScript  
.Trigger.Type = hmiTriggerTypeWindowCycle  
.Trigger.Name = "VBA_WindowCycle"  
.SourceCode = ""  
End With  
End Sub
```

### See also

- [VariableTrigger Object \(Page 2099\)](#)
- [Trigger Object \(Page 2087\)](#)
- [ScriptInfo Object \(Page 2058\)](#)
- [Editing Triggers \(Page 1707\)](#)

## 3.3.6 Event Handling

### Introduction

In the Graphics Designer, events occur when certain actions are taken (for example when a picture is opened). You can respond to an event with a predefined VBA event handler in order to execute instructions.

The events occur only during configuring in the Graphics Designer and are not available in Runtime. These events must not be confused with the events (e.g. mouse click, property change) occurring on graphic objects and pictures.

**Note**

When the Graphics Designer is open, events are also triggered by other editors.

. This applies, for example, to the modification of picture properties in WinCCExplorer. Close the Graphics Designer when you are making changes to pictures in other editors. This prevents events from being executed when you do not want them to be.

**Note**

If you open a picture in Graphics Designer, not only the "DocumentOpened event" of the active picture but also that of the "Project Template" and of the "Global Template" are triggered. The VBA code of the "DocumentOpened event" is thereby executed twice.

You must intercept this behavior with the event handler.

**General Procedure**

In event handling there are events with and without forwarding. You can recognize an event with forwarding by the presence of the "CancelForwarding" parameter. An event without forwarding does not have this parameter. When an event occurs, it is sent to the active picture and then forwarded to the "Global Template".



An event with forwarding is therefore forwarded by default via the document "Project Template" to the document "Global Template".

**Preventing forwarding**

You can prevent the forwarding of an event by setting the "CancelForwarding" parameter to "True" in the VBA event handler:


```
Sub Document_HMIObjectPropertyChanged(ByVal Property As IHMIProperty, CancelForwarding As Boolean)
'VBA72
CancelForwarding = True
MsgBox "Object's property has been changed!"
End Sub
```

**Picture-specific and application-specific events**

Quite apart from the information given above about events with and without forwarding, the Graphics Designer differentiates between picture-specific and application-specific events:

### Picture-specific events

Picture-specific events always respond to actions that occur in the active picture in the Graphics Designer. Such actions include, for example, the changing of object properties or saving the active picture. You can obtain a list of available picture-specific events by choosing "Document" in the VBA editor:

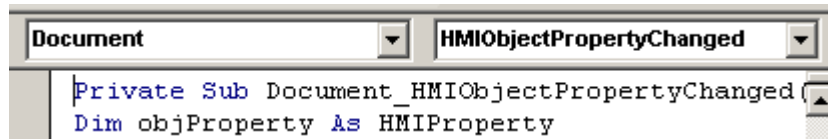

### Application-specific events

Application-specific events respond to actions that occur in the "Graphics Designer" application. Such actions include, for example, starting the Graphics Designer or creating an object in the component library.

To make the application-specific events available, write the following statement in the VBA editor at the start of the document (preferably the "Project Template" or "Global Template"):


```
Dim WithEvents <Name> As grafexe.Application
```

The effect of this statement is that it will now also be possible to select the application-specific events from the list in the Graphics Designer:



### Example 1: Occurrence of an event with forwarding

The illustration shows the sequence that follows from the occurrence of an event with forwarding:

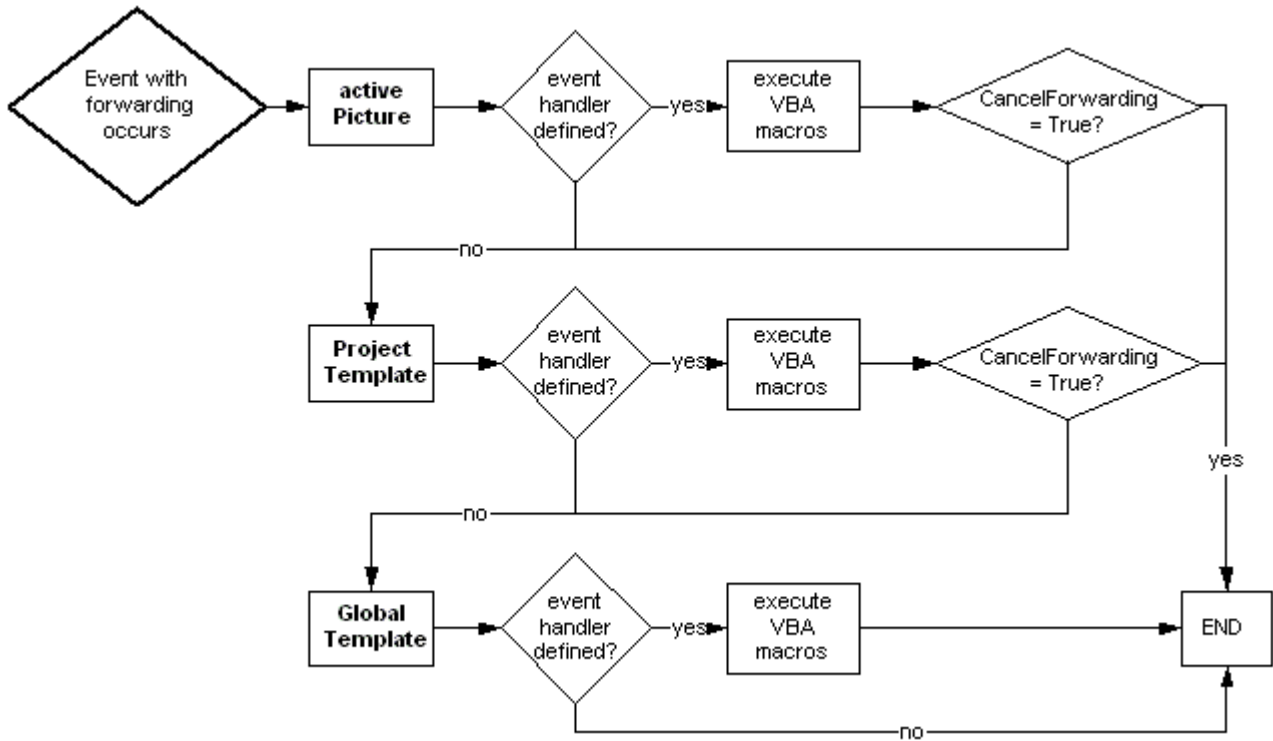


#### Note

There are events which are both picture-specific and application-specific (for example BeforeDocumentSave). When such an event occurs, the program checks whether the corresponding application-specific event handler has been defined. The sequence shown above does not begin until after that.

### Example 2: Occurrence of an event without forwarding

The illustration shows the sequence that follows from the occurrence of an event without forwarding:

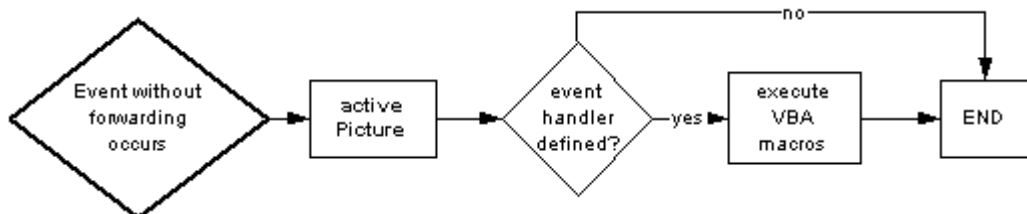



## Disabling event handling

You can disable event handling by setting the "DisableVBAEvents" property for the Application object to "True".

## See also

DisableVBAEvents Property (Page 2214)

Organizing VBA Code in a WinCC Project (Page 1615)

## 3.3.7 Accessing External Applications with VBA

### 3.3.7.1 Accessing External Applications with VBA

#### Introduction

You can use VBA to access programs which support VBA, for example products in the Microsoft Office family. This enables you, for example, to read out values from an MS Excel worksheet and then assign these to object properties.

---

#### Note


##### No direct usage of Unicode in Excel VBA and Word VBA

Excel VBA and Word VBA supports the use of Unicode characters only by means of <ChrW(unicode-id) function.

---

### Registering an external application

You have to integrate an external application in the VBA editor in order to make its object library available. To do this, select the "References" option in the "Tools" menu in the VBA editor. In the "References" dialog you can then select the required object library:

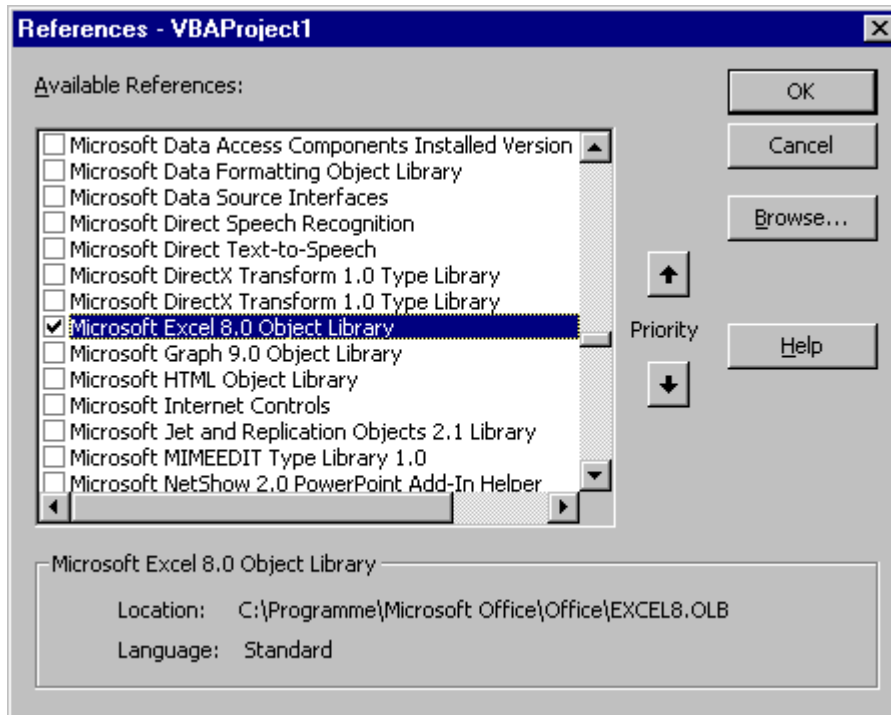

#### Note

You must attach the external application to all projects which you want to be able to access the external application; do this in the VBA editor Project Explorer.

#### See also

Example: Accessing MS Excel with VBA (Page 1714)

### 3.3.7.2 Example: Accessing MS Excel with VBA

#### Introduction

The following three examples illustrate how to access MS Excel. For these examples to work, the MS Excel object library must be integrated via a reference.

---

**Note**

**No direct usage of Unicode in Excel VBA and Word VBA**

Excel VBA and Word VBA supports the use of Unicode characters only by means of <ChrW(unicode-id) function.

---

### Example 1

In this example the default object list of the Graphics Designer is exported in an Excel worksheet. The object properties are taken into account, as is the question of whether dynamics can be used with these properties. The VBA data type is also displayed.

```
Sub ExportDefObjListToXLS()  
'VBA73  
'Microsoft Excel Object Library needs to be referenced  
Dim objGDApplication As grafexe.Application  
Dim objHMIObject As grafexe.HMIObject  
Dim objProperty As grafexe.HMIProperty  
Dim objXLS As Excel.Application  
Dim objWSheet As Excel.Worksheet  
Dim objWBook As Excel.Workbook  
Dim rngSelection As Excel.Range  
Dim lRow As Long  
Dim lRowGroupStart As Long  
  
'define local errorhandler  
On Local Error GoTo LocErrTrap  
  
'Set references to the applications Excel and GraphicsDesigner  
Set objGDApplication = grafexe.Application  
Set objXLS = New Excel.Application  
  
'Create workbook  
Set objWBook = objXLS.Workbooks.Add()  
objWBook.SaveAs objGDApplication.ApplicationDataPath & "DefaultObjekte.xls"  
  
'Adds new worksheet to the new workbook  
Set objWSheet = objWBook.Worksheets.Add  
objWSheet.Name = "DefaultObjekte"  
lRow = 1  
  
'Every object of the DefaultHMIObjects-collection will be written  
'to the worksheet with their objectproperties.  
'For better overview the objects will be grouped.  
For Each objHMIObject In objGDApplication.DefaultHMIObjects  
DoEvents  
objWSheet.Cells(lRow, 1).value = objHMIObject.ObjectName  
objWSheet.Cells(lRow, 2).value = objHMIObject.Type  
lRow = lRow + 1  
lRowGroupStart = lRow  
For Each objProperty In objHMIObject.Properties  
'Write displayed name and automationname of property  
'into the worksheet  
objWSheet.Cells(lRow, 2).value = objProperty.DisplayName  
objWSheet.Cells(lRow, 3).value = objProperty.Name  
'Write the value of property, datatype and if their dynamicable  
'into the worksheet  
If Not IsEmpty(objProperty.value) Then _  
    objWSheet.Cells(lRow, 4).value = objProperty.value  
objWSheet.Cells(lRow, 5).value = objProperty.IsDynamicable  
objWSheet.Cells(lRow, 6).value = TypeName(objProperty.value)  
objWSheet.Cells(lRow, 7).value = VarType(objProperty.value)  
lRow = lRow + 1  
Next objProperty  
'Select and groups the range of object-properties in the worksheet  
Set rngSelection = objWSheet.Range(objWSheet.Rows(lRowGroupStart), _  
    objWSheet.Rows(lRow - 1))
```

```
rngSelection.Select
rngSelection.Group
Set rngSelection = Nothing
'Insert empty row
lRow = lRow + 1
Next objHMIObject
objWSheet.Columns.AutoFit
Set objWSheet = Nothing
objWBook.Save
objWBook.Close
Set objWBook = Nothing
objXLS.Quit
Set objXLS = Nothing
Set objGDApplication = Nothing
Exit Sub
LocErrTrap:
MsgBox Err.Description, , Err.Source
Resume Next
End Sub
```

## **Example 2**

In this example all objects of the active picture are exported to an Excel worksheet. The properties taken into account are Position X, Position Y, Width, Height and Layer:

```
Sub ExportObjectListToXLS()  
  'VBA74  
  Dim objGDApplication As grafexe.Application  
  Dim objDoc As grafexe.Document  
  Dim objHMIObject As grafexe.HMIObject  
  Dim objProperty As grafexe.HMIProperty  
  Dim objXLS As Excel.Application  
  Dim objWSheet As Excel.Worksheet  
  Dim objWBook As Excel.Workbook  
  Dim lRow As Long  
  
  'Define local errorhandler  
  On Local Error GoTo LocErrTrap  
  
  'Set references on the applications Excel and GraphicsDesigner  
  Set objGDApplication = grafexe.Application  
  Set objDoc = objGDApplication.ActiveDocument  
  Set objXLS = New Excel.Application  
  
  'Create workbook  
  Set objWBook = objXLS.Workbooks.Add()  
  objWBook.SaveAs objGDApplication.ApplicationDataPath & "Export.xls"  
  
  'Create worksheet in the new workbook and write headline  
  'The name of the worksheet is equivalent to the documents name  
  Set objWSheet = objWBook.Worksheets.Add  
  objWSheet.Name = objDoc.Name  
  objWSheet.Cells(1, 1) = "Objektname"  
  objWSheet.Cells(1, 2) = "Objekttyp"  
  objWSheet.Cells(1, 3) = "ProgID"  
  objWSheet.Cells(1, 4) = "Position X"  
  objWSheet.Cells(1, 5) = "Position Y"  
  objWSheet.Cells(1, 6) = "Width"  
  objWSheet.Cells(1, 7) = "Höhe"  
  objWSheet.Cells(1, 8) = "Ebene"  
  lRow = 3  
  
  'Every objects will be written with their objectproperties width,  
  'height, pos x, pos y and layer to Excel. If the object is an  
  'ActiveX-Control the ProgID will be also exported.  
  For Each objHMIObject In objDoc.HMIObjects  
  DoEvents  
  objWSheet.Cells(lRow, 1).value = objHMIObject.ObjectName  
  objWSheet.Cells(lRow, 2).value = objHMIObject.Type  
  If UCase(objHMIObject.Type) = "HMIACTIVEXCONTROL" Then  
  objWSheet.Cells(lRow, 3).value = objHMIObject.ProgID  
  End If  
  objWSheet.Cells(lRow, 4).value = objHMIObject.Left  
  objWSheet.Cells(lRow, 5).value = objHMIObject.Top  
  objWSheet.Cells(lRow, 6).value = objHMIObject.Width  
  objWSheet.Cells(lRow, 7).value = objHMIObject.Height  
  objWSheet.Cells(lRow, 8).value = objHMIObject.Layer  
  lRow = lRow + 1  
  Next objHMIObject  
  objWSheet.Columns.AutoFit
```



```
Set objWSheet = Nothing
objWBook.Save
objWBook.Close
Set objWBook = Nothing
objXLS.Quit
Set objXLS = Nothing
Set objDoc = Nothing
Set objGDApplication = Nothing
Exit Sub
LocErrTrap:
MsgBox Err.Description, , Err.Source
Resume Next
End Sub
```

### **Example 3**

In this example objects are imported from the Excel worksheet created in example 2. The properties taken into account are Position X, Position Y, Width, Height and Layer:

```
Sub ImportObjectListFromXLS()  
'VBA75  
Dim objGDApplication As grafexe.Application  
Dim objDoc As grafexe.Document  
Dim objHMIObject As grafexe.HMIObject  
Dim objXLS As Excel.Application  
Dim objWSheet As Excel.Worksheet  
Dim objWBook As Excel.Workbook  
Dim lRow As Long  
Dim strWorkbookName As String  
Dim strWorksheetName As String  
Dim strSheets As String  
  
'define local errorhandler  
On Local Error GoTo LocErrTrap  
  
'Set references on the applications Excel and GraphicsDesigner  
Set objGDApplication = Application  
Set objDoc = objGDApplication.ActiveDocument  
Set objXLS = New Excel.Application  
  
'Open workbook. The workbook have to be in datapath of GraphicsDesigner  
strWorkbookName = InputBox("Name of workbook:", "Import of objects")  
Set objWBook = objXLS.Workbooks.Open(objGDApplication.ApplicationDataPath &  
strWorkbookName)  
If objWBook Is Nothing Then  
MsgBox "Open workbook fails!" & vbCrLf & "This function is canceled!", vbCritical, "Import  
od objects"  
Set objDoc = Nothing  
Set objGDApplication = Nothing  
Set objXLS = Nothing  
Exit Sub  
End If  
  
'Read out the names of all worksheets contained in the workbook  
For Each objWSheet In objWBook.Sheets  
strSheets = strSheets & objWSheet.Name & vbCrLf  
Next objWSheet  
strWorksheetName = InputBox("Name of table to import:" & vbCrLf & strSheets, "Import of  
objects")  
Set objWSheet = objWBook.Sheets(strWorksheetName)  
lRow = 3  
  
'Import the worksheet as long as in actual row the first column is empty.  
'Add with the outreaded data new objects to the active document and  
'assign the values to the objectproperties  
With objWSheet  
While (.Cells(lRow, 1).value <> vbNullString) And (Not IsEmpty(.Cells(lRow, 1).value))  
'Add the objects to the document as its objecttype,  
'do nothing by groups, their have to create before.  
If (UCase(.Cells(lRow, 2).value) = "HMIGROUP") Then  
Else  
If (UCase(.Cells(lRow, 2).value) = "HMIACTIVEXCONTROL") Then  
Set objHMIObject = objDoc.HMIObjects.AddActiveXControl(.Cells(lRow,  
1).value, .Cells(lRow, 3).value)
```

```
Else
    Set objHMIOBJECT = objDoc.HMIOBJECTS.AddHMIOBJECT(.Cells(lRow, 1).value, .Cells(lRow,
2).value)
    End If
    objHMIOBJECT.Left = .Cells(lRow, 4).value
    objHMIOBJECT.Top = .Cells(lRow, 5).value
    objHMIOBJECT.Width = .Cells(lRow, 6).value
    objHMIOBJECT.Height = .Cells(lRow, 7).value
    objHMIOBJECT.Layer = .Cells(lRow, 8).value
End If
Set objHMIOBJECT = Nothing
lRow = lRow + 1
Wend
End With
objWBook.Close
Set objWBook = Nothing
objXLS.Quit
Set objXLS = Nothing
Set objDoc = Nothing
Set objGDApplication = Nothing
Exit Sub
LocErrTrap:
MsgBox Err.Description, , Err.Source
Resume Next
End Sub
```

## 3.4 VBA in the WinCC Configuration Studio

### 3.4.1 VBA in the WinCC Configuration Studio

As of WinCC V7.4 the WinCC Configuration Studio supports the VBA interface.

With VBA, you can access all editors in the WinCC Configuration Studio, for example, to create, change, or delete data. VBA access is also supported for editors of WinCC options that are integrated in the WinCC Configuration Studio.

You open the VBA editor in the WinCC Configuration Studio with "Tools > Visual Basic Editor".

#### VBA in the WinCC editors

The WinCC editors, objects and data records in the WinCC Configuration Studio can be selected either by name or by index.

---

#### Note

##### Notes on VBA scripts in the WinCC Configuration Studio

Note the following when creating VBA scripts:

- To access columns and tabs, note the respective WinCC user interface language.
  - Hidden columns can result in incorrect index assignments when editing via scripts.
  - A sequential index over all hierarchical levels is created with an enumeration.
- 

#### NOTICE

##### Deleting objects

If you delete individual objects in the Configuration Studio with VBA scripts, associated objects are deleted as well.

Examples:

- Message classes and message types including within
- Tag groups and contained tags

#### Important functions:

<code>DataGrid.Tabs</code>	Enumerate tabs
<code>DataGrid.UsedRange</code>	Detect number of data records or rows used
<code>DataGrid.Rows.Name</code>	Detect object type in a DataGrid, e.g. "Tag"

The following script examples introduce other important functions.

### Show hidden columns

To avoid incorrect index assignments, expand the hidden columns.

```
Sub ShowAllColumns()
    For i = 1 To DataGrid.EntireColumns.Count
        DataGrid.EntireColumns(i).Visible = True
    Next i
End Sub
```

### Example "Tag Management, User Administrator, Graphics Designer"

You can find a detailed example under "Example: VBA in the WinCC Configuration Studio (Page 1726)".

The example contains the following functions:

- Change the user interface language  
To run a script for a specific language, set the user interface language at the beginning of the script.
- Select editor in the WinCC Configuration Studio
- Navigation area: Select tree node
- Data area: Use of row names to detect the object type  
To ensure that the script is accesses the correct tab, for example, check the "Name" property of the desired row.
- Data area: Select tab
- Data area: Create new data record  
You determine the row for the new data record and write the values in the cells of this row.
- Data area: Change value
- Data area: Delete entry  
To delete a tag in the data area, for example, check if the tag exists and then delete the entire row.  
When you delete an object, all associated objects are deleted. If you delete a tag group, for example, all tags of the group are deleted.
- Create objects in the Graphics Designer  
To access the class "HMIGO" with VBA, reference the "HMI General Objects 1.0 Type Library" in the VBA script. For each created object, you need in the VBA script to reference the respective block library.

### 3.4.2 Example: VBA in the WinCC Configuration Studio

This example illustrates the object model used.

The following actions are performed:

Example	Action
AddTag	Create a tag in Tag Management
ModifyTag	Change the start value of a newly created tag

<b>Example</b>	<b>Action</b>
RemoveTag	Delete a created tag again
AddGroup	Create a user group in the User Administrator
RemoveGroup	Delete a created user group again
AddUser	Create a user and user group in the User Administrator
RemoveUser	Delete a created user again
DemoUsageGraphicsDesigner	Access to the Graphics Designer A process picture is created with the "Static text" object.

### Example: Tag Management, User Administrator, Graphics Designer

```
'VBA907
' Version of this sample: V1.0
,
' With WinCC V7.4 CCConfigStudio supports a VBA interface.
' The following examples should help understanding the provided objectmodel.
,
' Warning:
' When deleting objects which are containers/parent objects for other objects (message
classes -> message types, tag groups -> tags, ...),
' all child objects will be deleted, too.
,
' Remarks:
' User Administrator -> Setting password: Not supported due to security issues.
```

Option Explicit

```
'This method will run all available sample methods
'Please use a new/empty WinCC project
Sub FullDemo()
```

```
    AddTag
    MsgBox "Tag created", vbOKOnly, "VBA-Demo"

    ModifyTag
    MsgBox "Tag modified", vbOKOnly, "VBA-Demo"

    RemoveTag
    MsgBox "Tag removed", vbOKOnly, "VBA-Demo"

    AddGroup
    MsgBox "User Group created", vbOKOnly, "VBA-Demo"

    AddUser
    MsgBox "User created", vbOKOnly, "VBA-Demo"

    RemoveUser
    MsgBox "User removed", vbOKOnly, "VBA-Demo"

    RemoveGroup
    MsgBox "User group removed", vbOKOnly, "VBA-Demo"

    DemoUsageGraphicsDesigner
    MsgBox "Demo finished.", vbOKOnly, "VBA-Demo"
```

End Sub

```
'Add a tag in Tag Management
Sub AddTag()

    Dim currLang, i, newRowNo

    'Save currently selected language
    currLang = ConfigStudio.Language
```



```

'Set language to English
ConfigStudio.Language = 1033

'Select editor "Tag Management"
' Valid parameters for specifying editor are names and IDs
ConfigStudio.Editors("Tag Management").Select

'Select treenode "Internal tags"
' Valid parameters for specifying treenodes are names and IDs
NavigationTree.Nodes("Internal tags").Select

'Make sure that the correct tab of DataGrid is selected
'One possibility is to check the object type of the rows object with its name property:
'Property "Name" reflects the object type of the currently selected DataGrid
If DataGrid.Rows.Name = "Tag" Then
    'UsedRange.EntireRow returns the number of used rows in DataGrid.
    newRowNo = DataGrid.UsedRange.EntireRow.Count + 1

    'Add tag via entering values into cells of the first empty row in DataGrid
    ' Valid parameters for specifying columns are names and IDs
    DataGrid.Cells(newRowNo, 1) = "NewTag"
    DataGrid.Cells(newRowNo, "Data type") = "Text tag 16-bit character set"
End If

'Reset language
ConfigStudio.Language = currLang

```

End Sub

'Changes the start value of the previously created tag

Sub ModifyTag()

```

Dim currLang, i

currLang = ConfigStudio.Language
ConfigStudio.Language = 1033

ConfigStudio.Editors("Tag Management").Select
NavigationTree.Nodes("Internal tags").Select

If DataGrid.Rows.Name = "Tag" Then
    'Modify tag property via usage of tag name to specify the row
    DataGrid.Cells("NewTag", "Start Value") = "abc"
End If

ConfigStudio.Language = currLang

```

End Sub

'Removes previously created tag

Sub RemoveTag()

```

Dim currLang, i

```

3.4 VBA in the WinCC Configuration Studio

```
currLang = ConfigStudio.Language
ConfigStudio.Language = 1033

ConfigStudio.Editors("Tag Management").Select
NavigationTree.Nodes("Internal tags").Select

If DataGrid.Rows.Name = "Tag" Then
    'Check if tag tag exists via enumerating rows
    For i = 1 To DataGrid.UsedRange.EntireRow.Count
        If DataGrid.Cells(i, "Name") = "NewTag" Then
            'Select the row first before deleting it
            DataGrid.Rows("NewTag").Select
            'Delete the whole row
            DataGrid.Rows("NewTag").EntireRow.Delete
        End If
    Next
End If

ConfigStudio.Language = currLang

End Sub

'Add a group in User Administrator
Sub AddGroup()

    Dim currLang, i

    currLang = ConfigStudio.Language
    ConfigStudio.Language = 1033

    ConfigStudio.Editors("User Administrator").Select
    NavigationTree.Nodes("User Administrator").Select

    'Add user group / Example for enumeration of tabs
    For i = 1 To DataGrid.Tabs.Count
        If DataGrid.Tabs(i).Name = "Groups" Then
            DataGrid.Tabs(i).Select
            DataGrid.Cells(DataGrid.UsedRange.EntireRow.Count + 1, 1) = "NewGroup"
        End If
    Next i

    ConfigStudio.Language = currLang

End Sub

>Delete previously created user group
Sub RemoveGroup()

    Dim currLang, i

    currLang = ConfigStudio.Language
    ConfigStudio.Language = 1033

    ConfigStudio.Editors("User Administrator").Select
```

```
NavigationTree.Nodes("User Administrator").Select

For i = 1 To DataGrid.Tabs.Count
    If DataGrid.Tabs(i).Name = "Groups" Then
        DataGrid.Tabs(i).Select
        DataGrid.Rows("NewGroup").Select
        DataGrid.Rows("NewGroup").EntireRow.Delete
    End If
Next i

ConfigStudio.Language = currLang

End Sub

'Add an user and a group in User Administrator
Sub AddUser()

    Dim currLang, i, newRowNo

    currLang = ConfigStudio.Language
    ConfigStudio.Language = 1033

    ConfigStudio.Editors("User Administrator").Select
    NavigationTree.Nodes("User Administrator").Select

    'Add user
    For i = 1 To DataGrid.Tabs.Count
        If DataGrid.Tabs(i) = "Users" Then
            DataGrid.Tabs(i).Select
            newRowNo = DataGrid.UsedRange.EntireRow.Count + 1
            DataGrid.Cells(newRowNo, "User Name") = "NewUser"
            'NOT SUPPORTED: DataGrid.Cells(newRowNo, "Password") = "MySuperSavePassword"
            DataGrid.Cells(newRowNo, "WebNavigator") = True
            DataGrid.Cells(newRowNo, "Group name") = "NewGroup"
            Exit For
        End If
    Next i

    ConfigStudio.Language = currLang

End Sub

'Delete previously created user
Sub RemoveUser()

    Dim currLang, i

    currLang = ConfigStudio.Language
    ConfigStudio.Language = 1033

    ConfigStudio.Editors("User Administrator").Select
    NavigationTree.Nodes("User Administrator").Select

    'Remove user
```

## 3.4 VBA in the WinCC Configuration Studio

```

For i = 1 To DataGrid.Tabs.Count
    If DataGrid.Tabs(i) = "Users" Then
        DataGrid.Tabs(i).Select
        DataGrid.Rows("NewUser").Select
        DataGrid.Rows("NewUser").EntireRow.Delete
        Exit For
    End If
Next i

ConfigStudio.Language = currLang

End Sub

'Sample for using VBA in Graphics Designer via CConfigStudio
Sub DemoUsageGraphicsDesigner()

'Method 1:
'Use this code to create programmatically a reference to Graphics Designer Type Library
    Dim appGD, screen
    Set appGD = CreateObject("grafexe.Application")
'or
'Method 2:
'Add reference to "WinCC Graphics Designer Type Library V1.0" via menu -> Extras ->
References
'This will also enable IntelliSense functionality
    'Dim appGD As New grafexe.Application
    'Dim screen As grafexe.Document

    appGD.Visible = True
    Set screen = appGD.Documents.Add(1) 'hmiOpenDocumentTypeVisible

'To be able to add screenitems it is necessary to reference the corresponding type library
for each object
'Dim statTxtObj As HMIShadowText 'add reference "HMI ShadowText Object 1.0 Library"
Dim statTxtObj

Set statTxtObj = screen.HMIObjects.AddHMIObject("Static Text", "HMIShadowText")

With statTxtObj
    .Top = 50
    .Left = 50
    .Width = 260
    .Height = 60
    .AlignmentTop = 1
    .AlignmentLeft = 1
    .Text = "Screen created and saved." + vbNewLine + "Please close Graphics Designer
manually."
End With

screen.SaveAs appGD.ApplicationDataPath + "SampleScreen.pdl"

Set statTxtObj = Nothing
Set screen = Nothing
Set appGD = Nothing

```

End Sub

**See also**

VBA in the WinCC Configuration Studio (Page 1725)

## 3.5 AddIns

### 3.5.1 AddIns

#### Introduction

An AddIn is a code which cannot be viewed and is stored as a DLL. Addins can make new functions available by registering the DLL concerned in the operating system and loading

To you as a user, the advantage of addins is that they provide functions which are tailor made for the associated application. For example if you working on different computers during configuration and frequently use VBA macros, you can combine these VBA macros in one or more addins. When you change to a different computer you need only copy the addin and you can then access the customary functions on the new workstation.

As a developer, you can use the Graphics Designer program library in a development environment to create MS Visual Studio 6.0 addins, for example, and protect your code from intrusion.

#### Addins in the Graphics Designer

In the Graphics Designer you can use all the addins that have been developed for the Graphics Designer and registered in the operating system of the computer you are using for configuration.

You can automatically load an addin when you start the Graphics Designer if you frequently need the functions the addins contain.

When you no longer need the functions of an addin, you can unload it again at any time.

#### See also

[How to Configure an AddIn in the Graphics Designer \(Page 1737\)](#)

[Example: Creating Add Ins \(Page 1738\)](#)

[Linking Add Ins \(Page 1734\)](#)

### 3.5.2 Linking Add Ins

#### Introduction


In the Graphics Designer use the Addin Manager to define the way addins that can be used in the Graphics Designer will behave on loading.

## Requirements

- An add-in must be registered in the operating system, e.g. by entering the "regsvr32 filename.dll" command at the input prompt.
- To register VBA addins, "Microsoft Visual Basic for Applications" must be installed. The installation is available in the following ways:
  - Microsoft Office: During installation of Microsoft Office products, for example MS Excel or MS Word, Visual Basic for Applications is automatically installed at the same time.
  - Later installation from Microsoft Office Setup: You can select to only install Visual Basic for Applications in Microsoft Office Setup with the user-defined installation.
  - Download of the VBA Runtime environment: Microsoft offers a download of the VBA Runtime environment at the following links:
    - "VBRun60.exe" file for V6.0: <http://support.microsoft.com/kb/192461/> (<http://support.microsoft.com/kb/192461/>)
    - "VBRun60sp6.exe" file for V6.0 SP6: <http://support.microsoft.com/kb/290887/> (<http://support.microsoft.com/kb/290887/>)
- Make sure that the current file "MSAddndr.DLL" is integrated together with the VB6 add-in DLL. For more detailed information, refer to:
  - <http://support.microsoft.com/kb/192136/> (<http://support.microsoft.com/kb/192136/>)
  - <http://support.microsoft.com/kb/2792179/> (<http://support.microsoft.com/kb/2792179/>)
  - <http://support.microsoft.com/kb/957924/> (<http://support.microsoft.com/kb/957924/>)

## Starting AddIn Manager

To start the Addin Manager, go to the Graphics Designer and select the command "Macros > "AddIn Manager":

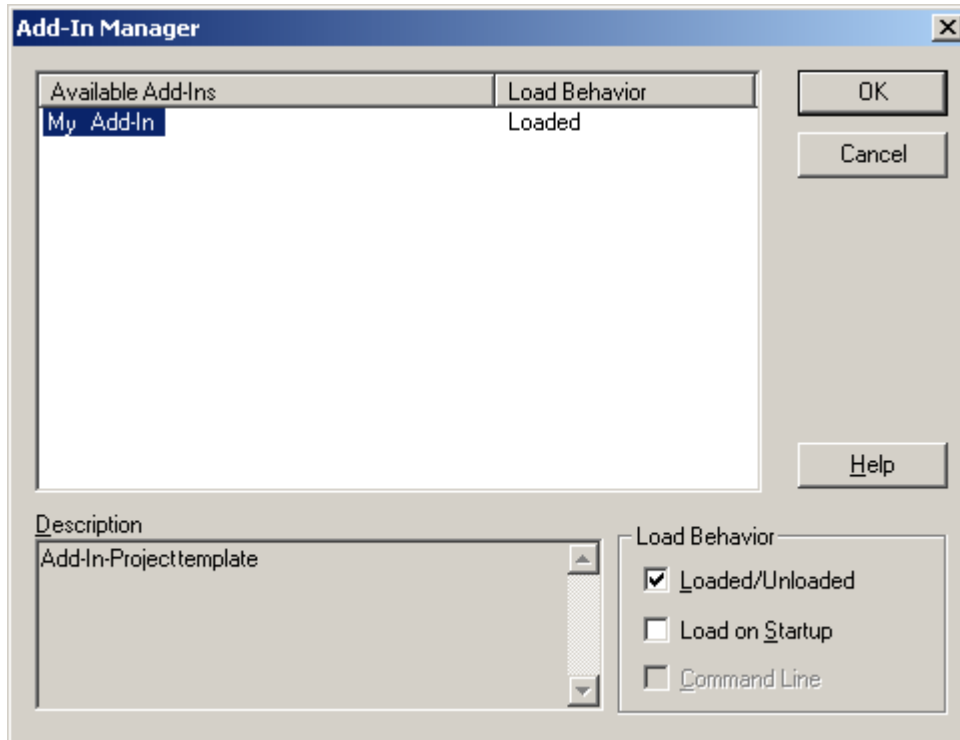

## Automatically Loading an Addin

If the addin contains new functions that you always need in the Graphics Designer, you can load the addin automatically when you open the Graphics Designer.

To do this go to the Addin Manager, select the addin and enable the "Load on Startup" checkbox.

---

### Note

Depending on how the addin is programmed, the function contained in the addin can also be entered in the menu "Tools > Macros > AddIns". You can then start the function just by clicking on it.

---

## Manually Loading or Unloading an Addin

You can also load an addin manually if you need its functions for particular purposes only (such as test routines).

To load or unload an addin manually, go to the Addin Manager, select the addin and enable the "Loaded/Unloaded" checkbox.



**See also**

How to Configure an AddIn in the Graphics Designer (Page 1737)

Example: Creating Add Ins (Page 1738)


AddIns (Page 1734)

**3.5.3 How to Configure an AddIn in the Graphics Designer****Requirements**

An add-in must be registered in the operating system, e.g. by entering the "regsvr32 filename.dll" command at the input prompt.

**Procedure**

1. Start the Graphics Designer and open the project to which you want to link the addin.
2. To call the Addin Manager, select the menu command "Tools" > "AddIn Manager". The Addin Manager opens. The "Available Add-Ins" list shows all the addins that are available, together with their current load status:

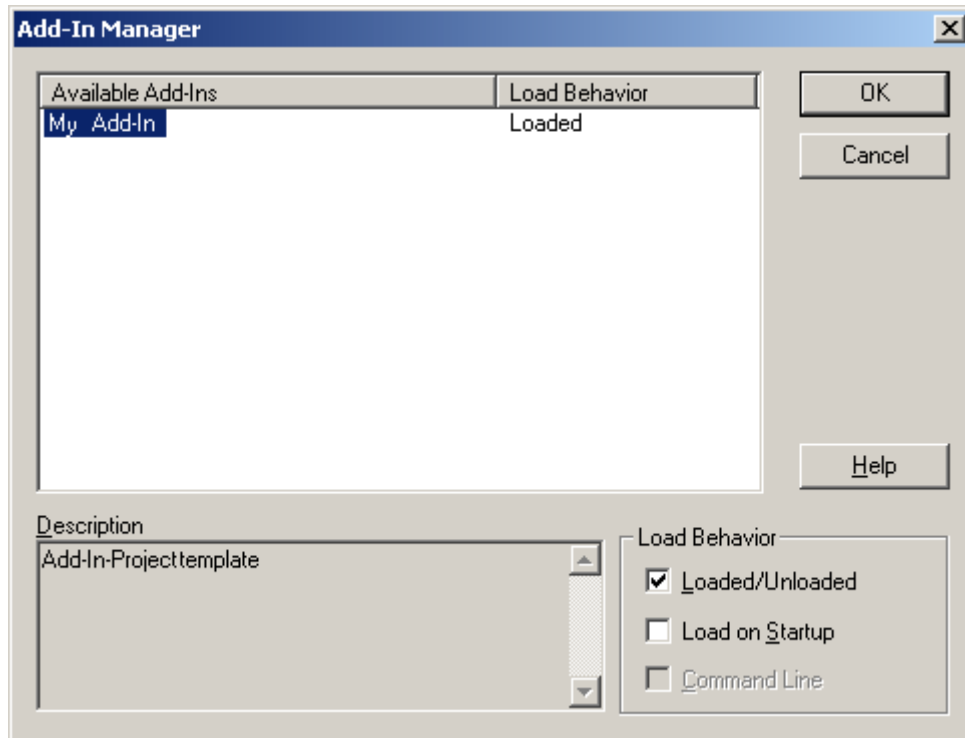

3. For each addin define whether it is to be loaded and if so when. To do this select the addin concerned and enable the appropriate checkbox under "Load Behavior".

### 3.5 AddIns

4. To unload an addin, select the addin concerned and disable the "Load/Unload" checkbox under "Load Behavior".
5. Click OK.

#### Result

Depending how the addin is programmed, the function contained in the addin is either listed in the "Tools" > "AddIns" menu or reacts to an event handler in the Graphics Designer.

If the addin is started by means of an event handler (e.g. Started Event), the "On Startup" checkbox should be enabled for the addin.

#### See also

[Linking Add Ins \(Page 1734\)](#)

[AddIns \(Page 1734\)](#)

## 3.5.4 Example: Creating Add Ins

### 3.5.4.1 Example: Creating Add Ins

#### Introduction

In order to create Addins, this documentation contains an example for Visual Basic 6.0, which creates a runnable Addin for use in the Graphic Designer.

#### Requirements

MS Visual Studio 6.0 must be installed on the configuration computer.

You should have programming experience if you wish to use the sample code as a basis for developing addins of your own.

#### Example: Program Template for Visual Basic 6.0

Use the event handler "AddInInstance\_OnConnection" to generate an instance of the Graphics Designer. In order for the addin to be able to access the Graphics Designer, it is mandatory to declare the application.

#### See also

[Example: Creating an Add In with Visual Basic 6.0 \(Page 1739\)](#)

[Linking Add Ins \(Page 1734\)](#)

### 3.5.4.2 Example: Creating an Add In with Visual Basic 6.0


#### Introduction

The program code in this example produces a file called "MyAddIn.DLL". So that the add-in will work in Graphics Designer, you must enable the "Load on Startup" checkbox for this add-in in the AddIn Manager of Graphics Designer. For this purpose you can also use the "LoadOnStartup" function in the add-in.

When you open Graphics Designer the add-in generates a user-defined menu. You can also use the "Tools" > "AddIns" menu to call the function contained in the add-in.

#### Requirement

In order to create an executable add-in from the sample code, "MS Visual Studio 6.0" must be installed on your computer. You must also have referenced "WinCC Graphics Designer 1.0 Type Library" in "MS Visual Studio 6.0":

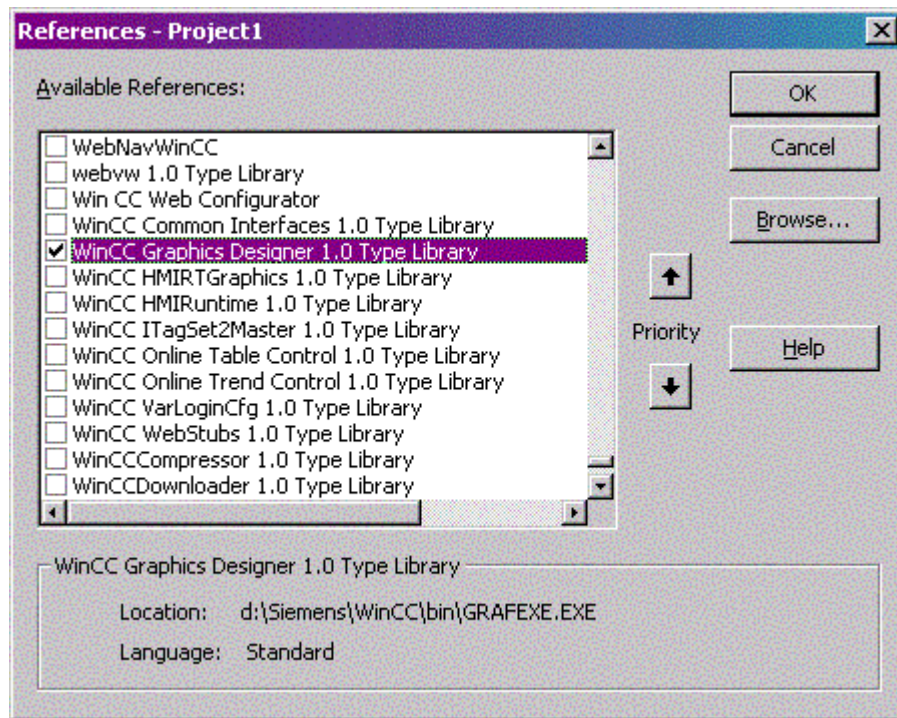

#### Procedure

1. Open "MS Visual Studio 6.0" and create a new project. To create a project, go to the "New Project" dialog, select the "AddIn" entry and click on OK.
2. In Project Explorer, open the "Designer" folder and double click the entry called "Connect". The "Connect (AddIn Designer)" dialog opens.
3. Under "Application", select the entry for "Graphics Designer" and select the "Initial Behavior on Loading" for the add-in. Close the "Connect (AddIn Designer)" dialog.

3.5 AddIns

4. In Project Explorer, open the "Designer" folder and use the shortcut menu to select the command "Display Code" for the "Connect" entry.

## 5. Replace the entire program code with the following program code:

```

Option Explicit
'-----
'Member Variables
'-----
'Reference to the add-in connection
Dim WithEvents ThisAddin As grafexe.AddInHook
'Reference to the Graphics Designer Application
Dim WithEvents GrafApp As grafexe.Application
'-----
'WithEvents AddInInstance IDTExtensibility2 (automatic)
'-----
'-----
'This method connects the add-in to the Graphic Designer
Application
'-----
Private Sub AddInInstance_OnConnection(ByVal Application As
Object, _
                                     ByVal ConnectMode As
AddInDesignerObjects.ext_ConnectMode, _
                                     ByVal AddInInst As Object,
custom() As Variant)
On Error GoTo AddInInstance_OnConnection_Error

'-----
' Hook up to the Graphics Designer application.IAddInHookEvents
interface.
' It is necessary referencing the application this add-in hooks
up to
'-----
Dim GDApplication As grafexe.Application
Set GDApplication = Application
If (Not GDApplication Is Nothing) Then
'-----
' Explanation on filters ( first parameter to
AddIns.Attach() )
'
' sbAddInFilterExecute : Add-in is not shown in the AddIn
menu
'
' sbAddInFilterNone   : Add-in is shown in the AddIn menu
and by
'
' clicking on the AddIn's menu entry
ThisAddin_Execute()
'
' is called (see the figure below)
'-----
Set ThisAddin =
GDApplication.AddIns.Attach(sbAddInFilterNone, "Create Rectangle")
Set GrafApp = GDApplication

RegisterApplicationMenus
End If

```

```

Exit Sub

AddInInstance_OnConnection_Error:
    MsgBox Err.Description
End Sub
'-----
'This method removes the add-in from VB by event disconnect
'-----
Private Sub AddInInstance_OnDisconnection(ByVal RemoveMode As
AddInDesignerObjects.ext_DisconnectMode, _
                                         custom() As Variant)
On Error GoTo AddInInstance_OnDisconnection_Error

    If (RemoveMode = ext_dm_UserClosed) Then
        RemoveApplicationMenus
    End If

    '-----
    ' Release reference to IAddInHookEvents interface - Important
    '-----

    Set ThisAddin = Nothing
    Set GrafApp = Nothing
    Exit Sub

AddInInstance_OnDisconnection_Error:
    MsgBox Err.Description
End Sub
'-----
'This method describes the 2nd way to make add-in functions
available in Graphics Designer
'
'By adding an application menu in Graphics Designer the menu click
events can be caught by
'the MenuItemClicked event from the application object
'-----
Private Sub RegisterApplicationMenus()
    Dim objDocMenu As HMIMenu
    Dim objMenuItem As HMIMenuItem
    Set objDocMenu = GrafApp.CustomMenus.InsertMenu(1, "DocMenu1",
"Doc_Menu_1")
    Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1,
"dmItem1_1", "My first menu entry")
    Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2,
"dmItem1_2", "My second menu entry")

    Set objMenuItem = Nothing
    Set objDocMenu = Nothing
End Sub
'-----
'This method removes the AddIn menus available in Graphics Designer
'-----

```

```

Private Sub RemoveApplicationMenus()
    Dim objDocMenu As HMIMenu
    Dim objMenuItem As HMIMenuItem

    For Each objMenuItem In
GrafApp.CustomMenus("DocMenu1").MenuItems
        Set objMenuItem = Nothing
    Next objMenuItem

    GrafApp.CustomMenus("DocMenu1").Delete

    Set objMenuItem = Nothing
    Set objDocMenu = Nothing
End Sub
Private Sub AddInInstance_Terminate()
    ' -----
    ' Release reference to IAddInHookEvents interface - Important
    ' -----

    Set ThisAddin = Nothing
    Set GrafApp = Nothing
End Sub
Private Sub GrafApp_MenuItemClicked(ByVal MenuItem As
grafexe.IHMIMenuItem)

    Select Case MenuItem.Key
        Case "dmItem1_1"
            TestCall1
        Case "dmItem1_2"
            TestCall2
        Case Else
            Debug.Assert False
    End Select
End Sub
'-----
'You can call both of the following procedures by clicking the menu
command in the "DocMenu1"
'-----
Sub TestCall1()
    Call MsgBox("AddIn Menu: dmItem1_1 Clicked", vbInformation,
"GrafApp_MenuItemClicked")
End Sub
Sub TestCall2()
    Call MsgBox("AddIn Menu: dmItem1_2 Clicked", vbInformation,
"GrafApp_MenuItemClicked")
End Sub
'-----
'Registering an AddInHook creates an object which event
'can be executed by clicking "Extras\Macros\AddIns\

```


3.5 AddIns

```
Dim NewShape As HMIObject
Set NewShape =
GrafApp.ActiveDocument.HMIObjects.AddHMIObject ("Rectangle1",
"HMIRectangle")
  With NewShape
    .Top = 40
    .Left = 40
    .BackColor = 255
  End With
  MsgBox (NewShape.ObjectName)
End Sub
```

- 6. Create the add-in, and load it in the Graphics Designer.

Result

The next time you open it, Graphics Designer contains a user-defined menu titled "Doc\_Menu\_1". The menu "Tools > AddIns" contains an entry called "Create Rectangle", which pastes a rectangle into the active picture:

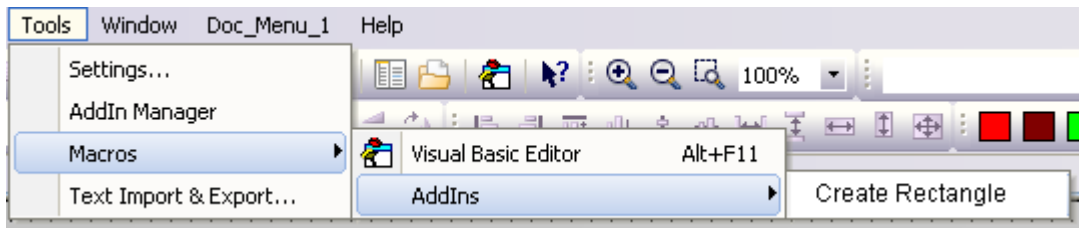

See also

- How to Configure an AddIn in the Graphics Designer (Page 1737)
- Example: Creating Add Ins (Page 1738)



## 3.6 VBA Reference

### 3.6.1 The object model of the Graphics Designer


#### 3.6.1.1 VBA Reference

#### VBA Object Model

When you click an object name, you are shown a detailed description.

#### Note

The prefix "HMI" will be omitted from the following descriptions. Note that in the code you must prefix objects with "HMI", e.g. "HMISymbolLibrary".

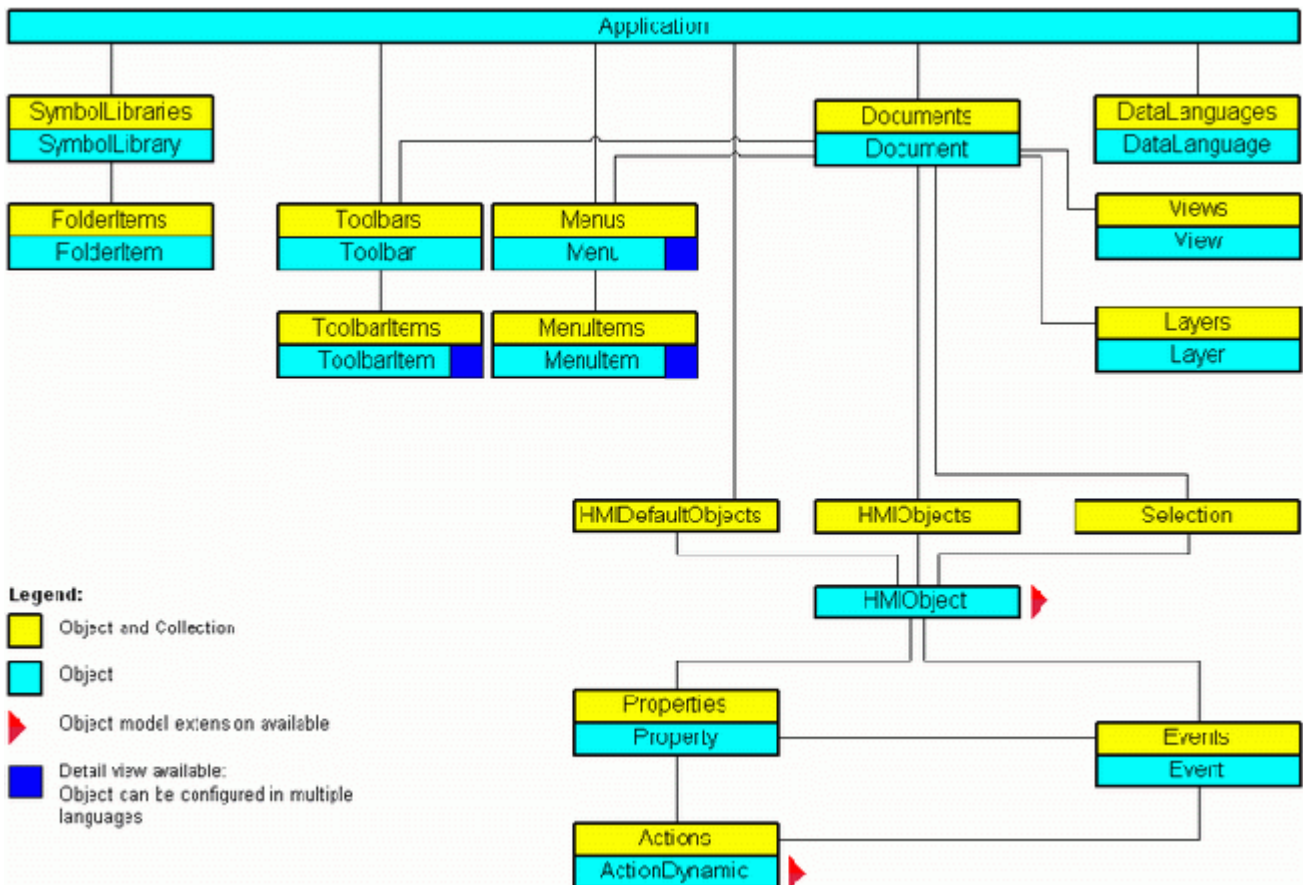

## See also


Events Object (Listing) (Page 1967)  
SymbolLibraries Object (Listing) (Page 2073)  
Actions Object (Listing) (Page 1898)  
Application Object (Page 1909)  
DataLanguage Object (Page 1941)  
DataLanguages Object (Listing) (Page 1942)  
Document Object (Page 1949)  
Documents Object (Listing) (Page 1952)  
Event Object (Page 1966)  
HMIDefaultObjects Object (Listing) (Page 1985)  
HMIOject Object (Page 1988)  
HMIOjects Object (Listing) (Page 1990)  
FolderItem Object (Page 1972)  
FolderItems Object (Listing) (Page 1973)  
VBA Reference: ActionDynamic (Page 1747)  
VBA Reference: HMIOjects (Page 1749)  
VBA Reference: Languages (Page 1751)  
Layer Object (Page 2001)  
Layers Object (Listing) (Page 2003)  
Menu Object (Page 2009)  
Menus Object (Listing) (Page 2011)  
MenuItem Object (Page 2013)  
MenuItems Object (Listing) (Page 2015)  
Properties Object (Listing) (Page 2041)  
Toolbar Object (Page 2080)  
Toolbars Object (Listing) (Page 2081)  
ToolbarItem Object (Page 2083)  
ToolbarItems Object (Listing) (Page 2085)  
View Object (Page 2102)  
Views Object (Listing) (Page 2103)  
SelectedObjects object (Listing) (Page 2060)  
SymbolLibrary Object (Page 2074)  
Property Object (Page 2042)

### 3.6.1.2 VBA Reference: ActionDynamic

#### VBA Object Model: ActionDynamic

"ActionDynamic" represents the interface port for dynamics and actions such as scripts, the dynamic dialog, the direct connection and the triggers.

When you click an object name, you are shown a detailed description.

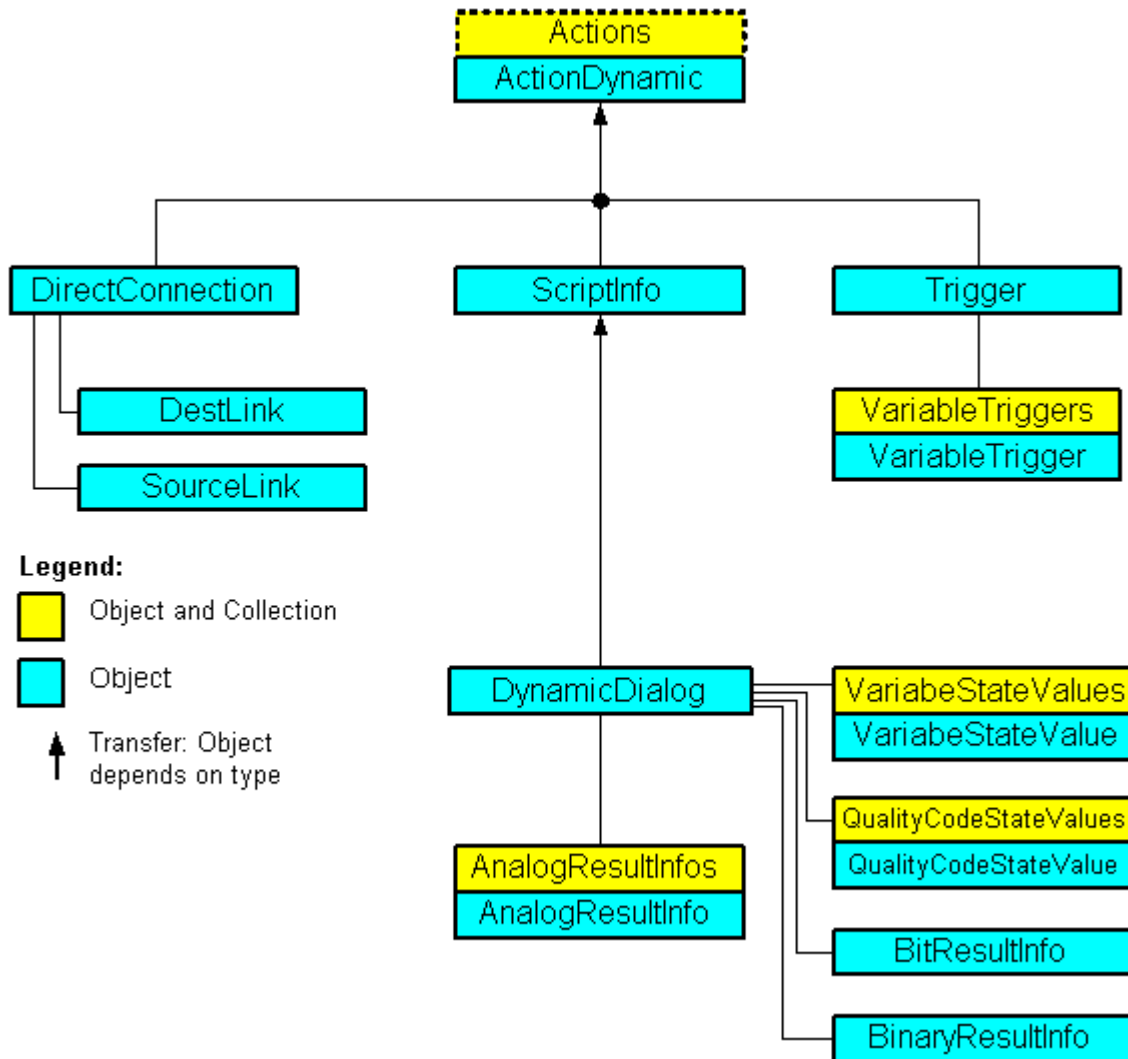

#### See also

- VBA Reference (Page 1745)
- AnalogResultInfo Object (Page 1907)
- AnalogResultInfos Object (Listing) (Page 1908)
- BinaryResultInfo Object (Page 1918)


3.6 VBA Reference

- BitResultInfo Object (Page 1919)
- Actions Object (Listing) (Page 1898)
- DestLink Object (Page 1945)
- DirectConnection Object (Page 1947)
- DynamicDialog Object (Page 1955)
- QualityCodeStateValue Object (Page 2044)
- QualityCodeStateValues Object (Listing) (Page 2046)
- ScriptInfo Object (Page 2058)
- SourceLink Object (Page 2065)
- Trigger Object (Page 2087)
- VariableStateValue Object (Page 2096)
- VariableStateValues Object (Listing) (Page 2097)
- VariableTrigger Object (Page 2099)
- VariableTriggers Object (Listing) (Page 2101)
- ActionType property (Page 2107)
- DynamicStateType property (Page 2219)

### 3.6.1.3 VBA Reference: HMIOObjects

#### VBA Object Model: HMIOObjects

When you click an object name, you are shown a detailed description.

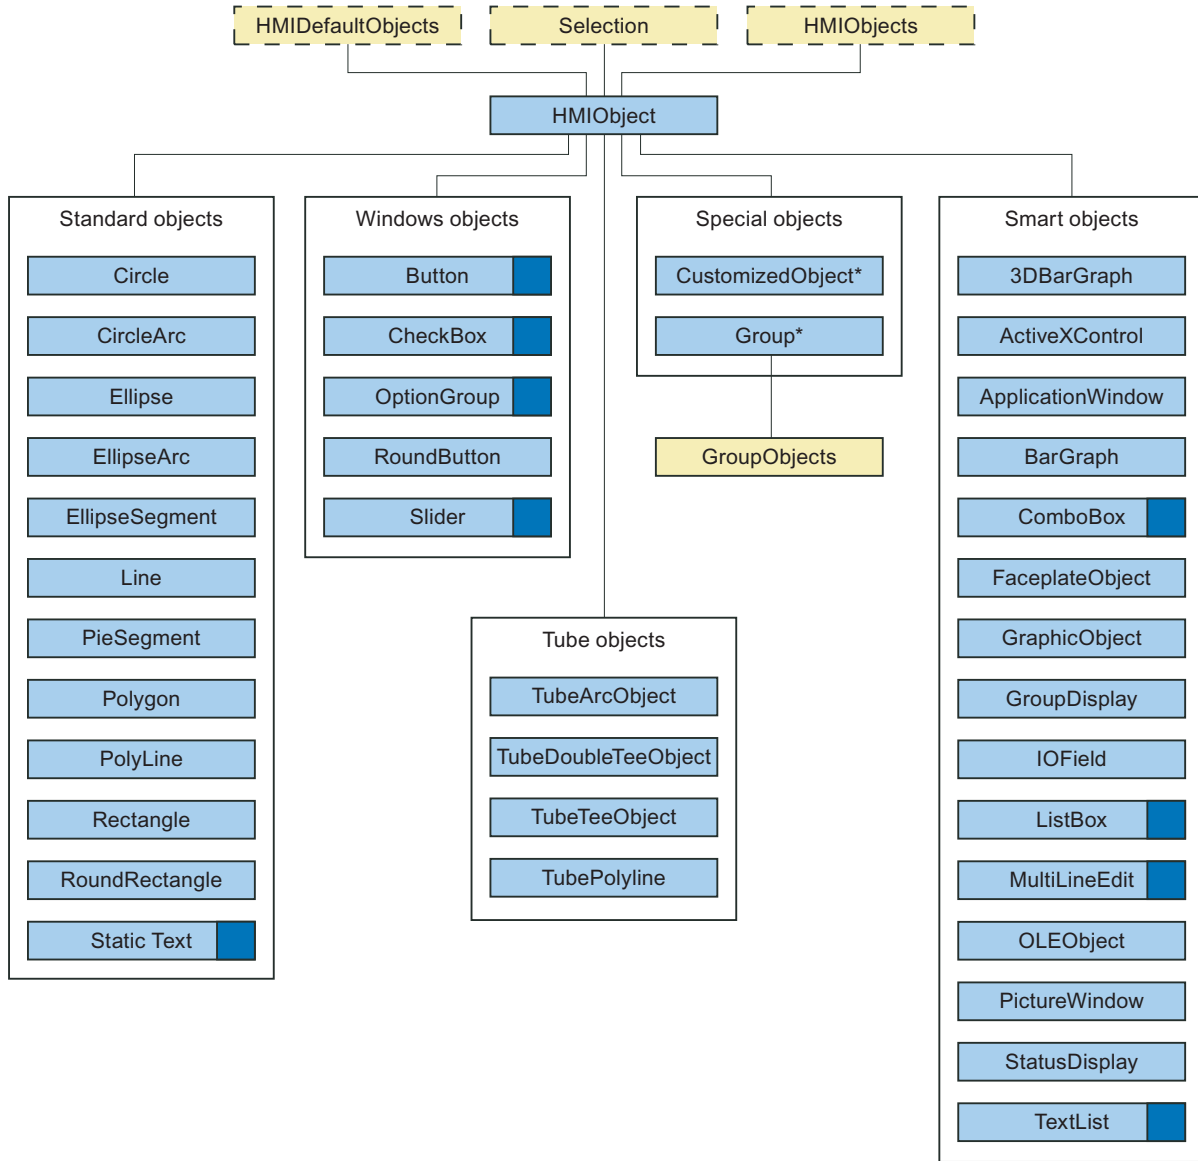

- Object and List
  - Object
  - Detail view available.
- \* Multilingual object configuration is possible.  
 \* Not in DefaultObjects list.

## See also

VBA Reference (Page 1745)  
PolyLine Object (Page 2038)  
GroupDisplay Object (Page 1980)  
3DBarGraph Object (Page 1894)  
ActiveXControl Object (Page 1900)  
ApplicationWindow Object (Page 1911)  
Button Object (Page 1921)  
CheckBox Object (Page 1924)  
Circle Object (Page 1928)  
CircularArc Object (Page 1931)  
Line Object (Page 2004)  
OLEObject Object (Page 2023)  
OptionGroup Object (Page 2025)  
PictureWindow Object (Page 2029)  
PieSegment Object (Page 2032)  
Polygon Object (Page 2035)  
Property Object (Page 2042)  
Rectangle Object (Page 2049)  
RoundButton Object (Page 2052)  
RoundRectangle Object (Page 2055)  
Slider object (Page 2062)  
StaticText Object (Page 2067)  
StatusDisplay Object (Page 2070)  
TextList Object (Page 2076)  
Ellipse Object (Page 1957)  
EllipseArc Object (Page 1960)  
EllipseSegment Object (Page 1963)  
GraphicObject Object (Page 1975)  
Group Object (Page 1978)  
HMIDefaultObjects Object (Listing) (Page 1985)  
HMIOBJECT Object (Page 1988)  
HMIOBJECTS Object (Listing) (Page 1990)  
IOField Object (Page 1992)  
BarGraph Object (Page 1914)

GroupedObjects Object (Listing) (Page 1983)

VBA Reference: Languages (Page 1751)

SelectedObjects object (Listing) (Page 2060)

CustomizedObject Object (Page 1938)

FaceplateObject object (Page 1969)


AdvancedAnalogDisplay object (Page 1901)

AdvancedStateDisplay object (Page 1905)

### 3.6.1.4 VBA Reference: Languages

#### VBA Object Model: Languages

When you click an object name, you are shown a detailed description.

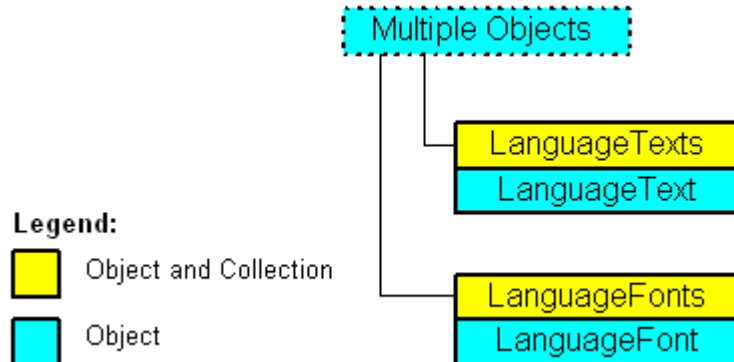

#### See also

VBA Reference (Page 1745)

LanguageFont Object (Page 1996)

LanguageFonts Object (Listing) (Page 1997)

LanguageText Object (Page 1999)

LanguageTexts Object (Listing) (Page 2000)

### 3.6.1.5 Events

#### A-D

#### Activated event

#### Description

Occurs when a picture is activated in the Graphics Designer. This happens when you switch between two pictures, for example.

#### syntax

```
Document_Activated(CancelForwarding As Boolean)
```

#### Parameters

Parameter (Data Type)	Description
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

#### Example:

In the following example a message is output when the picture is activated:

```
Private Sub Document_Activated(CancelForwarding As Boolean)
'VBA76
MsgBox "The document got the focus." & vbCrLf & _
"This event (Document_Activated) is raised by the document itself"
End Sub
```

#### See also

[VBA Reference \(Page 1745\)](#)

[Event Handling \(Page 1709\)](#)

#### BeforeClose Events

#### Description

Occurs immediately before a picture is closed.



**syntax**

```
Document_BeforeClose(Cancel As Boolean, CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
Cancel (Boolean)	TRUE if command processing is to be canceled.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

In the following example a message is output before the picture is closed:

```
Private Sub Document_BeforeClose(Cancel As Boolean, CancelForwarding As Boolean)
'VBA77
MsgBox "Event Document_BeforeClose is raised"
End Sub
```

**See also**

VBA Reference (Page 1745)

**BeforeDocumentClose Event****Description**

Occurs immediately before the picture is closed.

**syntax****Note**

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

```
objGDApplication_BeforeDocumentClose(Document As HMIDocument, Cancel
As Boolean)
```

## Parameters

Parameter (Data Type)	Description
Document (HMIDocument)	The picture that is going to be closed.
Cancel (Boolean)	TRUE if command processing is to be canceled.

## Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()  
'This procedure have to execute with "F5" first  
Set objGDApplication = grafexe.Application  
End Sub
```

In the following example a message is output before the picture is closed:

```
Private Sub objGDApplication_BeforeDocumentClose(ByVal Document As IHMIDocument, Cancel As  
Boolean)  
'VBA78  
MsgBox "The document " & Document.Name & " will be closed after press ok"  
End Sub
```

## See also

VBA Reference (Page 1745)

## BeforeDocumentSave event

### Description

Occurs immediately before the picture is saved.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_BeforeDocumentSave (Document As HMIDocument, Cancel
As Boolean)
```

## Parameters

Parameter (Data Type)	Description
Document (HMIDocument)	The picture that is going to be closed.
Cancel (Boolean)	TRUE if command processing is to be canceled.

## Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
'This procedure have to execute with "F5" first
Set objGDApplication = grafexe.Application
End Sub
```

In the following example a message is output before the picture is closed:

```
Private Sub objGDApplication_BeforeDocumentSave (ByVal Document As IHMIDocument, Cancel As
Boolean)
'VBA79
MsgBox Document.Name & "-saving will start after press ok."
End Sub
```

## See also

VBA Reference (Page 1745)

## BeforeHMIObjectDelete-Ereignis

### Description

Occurs immediately before an object in a picture is deleted.

### syntax

```
BeforeHMIObjectDelete (ByVal HMIObject As IHMIObject, Cancel As
Boolean, CancelForwarding As Boolean)
```

## Parameters

Parameter (Data Type)	Description
HMIObject (IHMIObject)	Identifies the object to be deleted.
Cancel (Boolean)	TRUE if command processing is to be canceled.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

### Example:

In the following example a message is output identifying the object to be deleted:

```
Private Sub Document_BeforeHMIObjectDelete(ByVal HMIObject As IHMIObject, Cancel As Boolean, CancelForwarding As Boolean)
'VBA80
Dim strObjName As String
Dim strAnswer As String
'
'"strObjName" contains the name of the deleted object
strObjName = HMIObject.ObjectName
strAnswer = MsgBox("Are you sure to delete " & strObjName & "?", vbYesNo)
If strAnswer = vbNo Then
'if pressed "No" -> set Cancel to true for prevent delete
Cancel = True
End If
End Sub
```

### See also

VBA Reference (Page 1745)

## BeforeLibraryFolderDelete event

### Description

Occurs immediately before a folder in the components library is deleted.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_BeforeLibraryFolderDelete (LibObject As
HMIFolderItem, Cancel As Boolean)
```

### Parameter (Optional)

Parameter (Data Type)	Description
LibObject (HMIFolderItem)	The folder that is going to be deleted.
Cancel (Boolean)	TRUE if command processing is to be canceled.

### Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
'This procedure have to execute with "F5" first
Set objGDApplication = grafexe.Application
End Sub
```

In the following example a message is output before a folder in the components library is deleted:

```
Private Sub objGDApplication_BeforeLibraryFolderDelete(ByVal LibObject As HMIFolderItem,
Cancel As Boolean)
'VBA81
MsgBox "The library-folder " & LibObject.Name & " will be delete..."
End Sub
```

### See also

VBA Reference (Page 1745)

### BeforeLibraryObjectDelete event

#### Description

Occurs immediately before an object in the components library is deleted.

**syntax****Note**

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

```
objGDApplication_BeforeLibraryObjectDelete(LibObject As
HMIFolderItem, Cancel As Boolean)
```

**Parameter (Optional)**

Parameter (Data Type)	Description
LibObject (HMIFolderItem)	The object that is going to be deleted.
Cancel (Boolean)	TRUE if command processing is to be canceled.

**Example:**

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
'This procedure have to execute with "F5" first
Set objGDApplication = grafexe.Application
End Sub
```

In the following example a message is output before a folder in the components library is deleted:

```
Private Sub objGDApplication_BeforeLibraryObjectDelete(ByVal LibObject As HMIFolderItem,
Cancel As Boolean)
'VBA82
MsgBox "The object " & LibObject.Name & " will be delete..."
End Sub
```

**See also**

VBA Reference (Page 1745)

## BeforeQuit Event

### Description

Occurs immediately before the Graphics Designer is closed.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_BeforeQuit(Cancel As Boolean)
```

### Parameters

Parameter (Data Type)	Description
Cancel (Boolean)	TRUE if command processing is to be canceled.

### Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
'This procedure have to execute with "F5" first
Set objGDApplication = grafexe.Application
End Sub
```

In this example a message is output shortly before the Graphics Designer is closed.

```
Private Sub objGDApplication_BeforeQuit(Cancel As Boolean)
'VBA83
MsgBox "The Graphics Designer will be shut down"
End Sub
```

### See also

VBA Reference (Page 1745)

## BeforeSave Event

### Description

Occurs immediately before a picture is saved.

### syntax

```
Document_BeforeSave(Cancel As Boolean, CancelForwarding As Boolean)
```

### Parameters

Parameter (Data Type)	Description
Cancel (Boolean)	TRUE if command processing is to be canceled.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

### Example:

In the following example a message is output before the picture is saved:

```
Private Sub Document_BeforeSave(Cancel As Boolean, CancelForwarding As Boolean)
'VBA84
MsgBox "The document will be saved..."
End Sub
```

### See also

VBA Reference (Page 1745)

## BeforeVisibleFalse event

### Description

Occurs immediately before the Graphics Designer application is set from Visible to Invisible.

### syntax

```
Document_BeforeVisibleFalse(Cancel As Boolean, CancelForwarding As Boolean)
```



**Parameters**

Parameter (Data Type)	Description
Cancel (Boolean)	TRUE if command processing is to be canceled.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

--

**See also**

VBA Reference (Page 1745)

**ConnectionEvent Event****Description**

Occurs when two objects are connected via the connector.

**syntax**

```
ConnectionEvent(eConnEventType, HMIConnector, HMIConnectedObject,
CancelProcess, CancelForwarding)
```

**Parameter (Optional)**

Parameter (Data Type)	Description
eConnEventType (HMIConnectionEventType)	--
HMIConnector (HMIOject)	--
HMIConnectedObject (HMIOject)	--
CancelProcess (Boolean)	TRUE if command processing is to be canceled.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

--

**See also**

VBA Reference (Page 1745)

## DataLanguageChanged Event

### Description

Occurs when the project language has been changed.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_DataLanguageChanged(lCID As Long)
```

### Parameters

Parameter (Data Type)	Description
lCID (Long)	The project language identifier

### Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()  
'This procedure have to execute with "F5" first  
Set objGDApplication = grafexe.Application  
End Sub
```

In the following example the newly set project language is output:

```
Private Sub objGDApplication_DataLanguageChanged(ByVal lCID As Long)  
'VBA87  
MsgBox "The datalanguage is changed to " & Application.CurrentDataLanguage & "."  
End Sub
```

### See also

Language-Dependent Configuration with VBA (Page 1624)

VBA Reference (Page 1745)

## DesktopLanguageChanged event

### Description

Occurs when the user interface language has been changed.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_DesktopLanguageChanged(1CID As Long)
```

### Parameters

Parameter (Data Type)	Description
1CID (Long)	The user interface language identifier

### Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
  'This procedure have to execute with "F5" first
  Set objGDApplication = grafexe.Application
End Sub
```

In the following example the newly set desktop language is output:

```
Private Sub objGDApplication_DesktopLanguageChanged(ByVal 1CID As Long)
  'VBA88
  MsgBox "The desktop-language is changed to " & Application.CurrentDesktopLanguage & "."
End Sub
```

### See also

VBA Reference (Page 1745)

Language-Dependent Configuration with VBA (Page 1624)

## DocumentActivated Event

### Description

Occurs when a picture is activated in the Graphics Designer. This happens when you switch between two pictures, for example.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_DocumentActivated(Document As HMIDocument)
```

### Parameters

Parameter (Data Type)	Description
Document (HMIDocument)	The picture that is to be activated.

### Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
  'This procedure have to execute with "F5" first
  Set objGDApplication = grafexe.Application
End Sub
```

In the following example a message is output identifying the picture that has been activated:

```
Private Sub objGDApplication_DocumentActivated(ByVal Document As IHMIDocument)
  'VBA89
  MsgBox "The document " & Document.Name & " got the focus." & vbCrLf & _
    "This event is raised by the application."
End Sub
```

### See also

VBA Reference (Page 1745)

## DocumentCreated Event

### Description

Occurs when a new picture has been created in the Graphics Designer.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_DocumentCreated(Document As HMIDocument)
```

### Parameters

Parameter (Data Type)	Description
Document (HMIDocument)	The picture that has been created.

### Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
  'This procedure have to execute with "F5" first
  Set objGDApplication = grafexe.Application
End Sub
```

In the following example the name of the newly created picture is output:

```
Private Sub objGDApplication_DocumentCreated(ByVal Document As IHMIDocument)
  'VBA90
  MsgBox Document.Name & " will be created."
End Sub
```

### See also

VBA Reference (Page 1745)

## DocumentOpened Event

### Description

Occurs when a picture has been opened.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_DocumentOpened(Document As HMIDocument)
```

### Parameters

Parameter (Data Type)	Description
Document (HMIDocument)	The picture that has been opened.

### Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()  
'This procedure have to execute with "F5" first  
Set objGDApplication = grafexe.Application  
End Sub
```

In the following example a message is output identifying the picture that has been opened:

```
Private Sub objGDApplication_DocumentOpened(ByVal Document As IHMIDocument)  
'VBA91  
MsgBox Document.Name & " is opened."  
End Sub
```

### See also

VBA Reference (Page 1745)

## DocumentSaved Event

### Description

Occurs when a picture has been saved in the Graphics Designer.

### syntax

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_DocumentSaved(Document As HMIDocument)
```

### Parameters

Parameter (Data Type)	Description
Document (HMIDocument)	The picture that has been saved.

### Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
'This procedure have to execute with "F5" first
Set objGDApplication = grafexe.Application
End Sub
```

In the following example a message is output identifying the picture that has been saved:

```
Private Sub objGDApplication_DocumentSaved(ByVal Document As IHMIDocument)
'VBA92
MsgBox Document.Name & " is saved."
End Sub
```

### See also

VBA Reference (Page 1745)

## DocumentPropertyChanged event

### Description

Occurs when a picture property is changed.

### syntax

```
Document_DocumentPropertyChanged(ByVal Property As IHMIProperty,  
CancelForwarding As Boolean)
```

### Parameters

Parameter (Data Type)	Description
Property (IHMIProperty)	Identifies the changed property.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

### Example:

In the following example a message is output identifying the picture property being changed:

```
Private Sub Document_DocumentPropertyChanged(ByVal Property As IHMIProperty,  
CancelForwarding As Boolean)  
'VBA93  
Dim strPropName As String  
"strPropName" contains the name of the modified property  
strPropName = Property.Name  
MsgBox "The picture-property " & strPropName & " is modified..."  
End Sub
```

### See also

VBA Reference (Page 1745)

### F-Z

## HMIObjectAdded Event

### Description

Occurs when an object is added.



**syntax**

```
Document_HMIObjectAdded(ByVal HMIObject As IHMIObject,
CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
HMIObject (IHMIObject)	Identifies the object being added.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

In the following example a message is output identifying the object that has been added:

```
Private Sub Document_HMIObjectAdded(ByVal HMIObject As IHMIObject, CancelForwarding As
Boolean)
'VBA94
Dim strObjName As String
'
'"strObjName" contains the name of the added object
strObjName = HMIObject.ObjectName
MsgBox "Object " & strObjName & " is added..."
End Sub
```

**See also**

VBA Reference (Page 1745)

**HMIObjectMoved Event****Description**

Occurs when an object is moved.

**syntax**

```
Document_HMIObjectMoved(ByVal HMIObject As IHMIObject,
CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
HMIObject (IHMIObject)	Identifies the object being moved.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

In the following example a message is output identifying the object that has been moved:

```
Private Sub Document_HMIObjectMoved(ByVal HMIObject As IHMIObject, CancelForwarding As Boolean)
    'VBA95
    Dim strObjName As String
    '
    '"strObjName" contains the name of the moved object
    strObjName = HMIObject.ObjectName
    MsgBox "Object " & strObjName & " was moved..."
End Sub
```

**See also**

VBA Reference (Page 1745)

**HMIObjectPropertyChanged Event****Description**

Occurs when an object property is changed.

**syntax**

```
Document_HMIObjectPropertyChanged(ByVal Property As IHMIProperty, CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
Property (IHMIProperty)	Identifies the changed property.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

In the following example a message is output identifying the object property that has been changed:

```
Private Sub Document_HMIObjectPropertyChanged(ByVal Property As IHMIProperty,
CancelForwarding As Boolean)
'VBA96
Dim strObjProp As String
Dim strObjName As String
Dim varPropValue As Variant
'
'"strObjProp" contains the name of the modified property
'"varPropValue" contains the new value
strObjProp = Property.Name
varPropValue = Property.value
'
'"strObjName" contains the name of the selected object,
'which property is modified
strObjName = Property.Application.ActiveDocument.Selection(1).ObjectName
MsgBox "The property " & strObjProp & " of object " & strObjName & " is modified... " &
vbCrLf & "The new value is: " & varPropValue
End Sub
```

**See also**

VBA Reference (Page 1745)

**HMIObjectResized Event****Description**

Occurs when the size of an object is changed.

**syntax**

```
Document_HMIObjectResized(ByVal HMIObject As IHMIObject,
CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
HMIObject (IHMIObject)	Identifies the object that is being resized.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

In the following example a message is output when an object has been resized:

```
Private Sub Document_HMIObjectResized(ByVal HMIObject As IHMIObject, CancelForwarding As Boolean)
'VBA97
Dim strObjName As String
'
'"strObjName" contains the name of the modified object
strObjName = HMIObject.ObjectName
MsgBox "The size of " & strObjName & " was modified..."
End Sub
```

**See also**

VBA Reference (Page 1745)

**LibraryFolderRenamed Event****Description**

Occurs when a folder in the components library has been renamed.

**syntax****Note**

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

```
objGDApplication_LibraryFolderRenamed(LibObject As HMIFolderItem,
OldName As String)
```

**Parameters**

Parameter (Data Type)	Description
LibObject (HMIFolderItem)	The renamed folder.
OldName (String)	The original name of the renamed folder.

**Example:**

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()  
'This procedure have to execute with "F5" first  
Set objGDApplication = grafexe.Application  
End Sub
```

In the following example the old and new folder names are output:

```
Private Sub objGDApplication_LibraryFolderRenamed(ByVal LibObject As HMIFolderItem, ByVal  
OldName As String)  
'VBA98  
MsgBox "The Library-folder " & OldName & " is renamed in: " & LibObject.DisplayName  
End Sub
```

**See also**

VBA Reference (Page 1745)

Accessing the component library with VBA (Page 1646)

**LibraryObjectRenamed Event****Description**

Occurs when an object in the components library has been renamed.

**syntax**

---

**Note**

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

```
objGDApplication_LibraryObjectRenamed(LibObject As HMIFolderItem,  
OldName As String)
```

## Parameters

Parameter (Data Type)	Description
LibObject (HMIFolderItem)	The renamed object.
OldName (String)	The original name of the renamed object.

## Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()  
'This procedure have to execute with "F5" first  
Set objGDApplication = grafexe.Application  
End Sub
```

In the following example the old and new object names are output:

```
Private Sub objGDApplication_LibraryObjectRenamed(ByVal LibObject As IHMIFolderItem, ByVal  
OldName As String)  
'VBA99  
MsgBox "The object " & OldName & " is renamed in: " & LibObject.DisplayName  
End Sub
```

## See also

[VBA Reference \(Page 1745\)](#)

[Accessing the component library with VBA \(Page 1646\)](#)

## LibraryObjectAdded Event

### Description

Occurs when an object has been added to the components library.

### syntax

```
HMIObjectPropertyChanged(ByVal Property As IHMIProperty,  
CancelForwarding As Boolean)
```

## Parameters

Parameter (Data Type)	Description
LibObject (IHMIFolderItem)	Identifies the library object.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

## Example:

In the following example a message is output when an object has been added to the components library:

```
Private Sub Document_LibraryObjectAdded(ByVal LibObject As IHMIFolderItem,
CancelForwarding As Boolean)
'VBA100
Dim strObjName As String
'
'"strObjName" contains the name of the added object
strObjName = LibObject.DisplayName
MsgBox "Object " & strObjName & " was added to the picture."
End Sub
```

## See also

VBA Reference (Page 1745)

## MenuItemClicked Event

### Description

Occurs when an entry in a user-defined menu is clicked.

---

#### Note

This event is both application-specific and document-specific.

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

---

### syntax

```
Document_MenuItemClicked(ByVal MenuItem As IHMIMenuItem)
```

## Parameters

Parameter (Data Type)	Description
MenuItem (IHMIItem)	Identifies the user-defined menu.

## Example:

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
'This procedure have to execute with "F5" first
Set objGDApplication = grafexe.Application
End Sub
```

In the following example a message is output when the first entry in a user-defined menu is clicked:

```
Private Sub Document_MenuItemClicked(ByVal MenuItem As IHMIItem)
'VBA101
Dim objMenuItem As HMItem
Dim varMenuItemKey As Variant
Set objMenuItem = MenuItem
'
'"objMenuItem" contains the clicked menu-item
'"varMenuItemKey" contains the value of parameter "Key"
'from the clicked userdefined menu-item
varMenuItemKey = objMenuItem.Key
Select Case MenuItem.Key
Case "mItem1_1"
MsgBox "The first menu-item was clicked!"
End Select
End Sub
```

## See also

[How to assign VBA macros to menus and toolbars \(Page 1642\)](#)

[VBA Reference \(Page 1745\)](#)

## NewLibraryFolder Event

### Description

Occurs when a folder has been created in the components library.



**syntax****Note**

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

```
objGDApplication_NewLibraryFolder(LibObject As HMIFolderItem)
```

**Parameters**

Parameter (Data Type)	Description
LibObject (HMIFolderItem)	The newly created folder.

**Example:**

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
  'This procedure have to execute with "F5" first
  Set objGDApplication = grafexe.Application
End Sub
```

In the following example the new folder name is output:

```
Private Sub objGDApplication_NewLibraryFolder(ByVal LibObject As IHMIFolderItem)
  'VBA102
  MsgBox "The library-folder " & LibObject.DisplayName & " was added."
End Sub
```

**See also**

VBA Reference (Page 1745)

Accessing the component library with VBA (Page 1646)

**NewLibraryObject Event****Description**

Occurs when an object has been created in the components library.

**syntax****Note**

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

```
objGDApplication_NewLibraryObject(LibObject As HMIFolderItem)
```

**Parameters**

Parameter (Data Type)	Description
LibObject (HMIFolderItem)	The newly created object.

**Example:**

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
'This procedure have to execute with "F5" first
Set objGDApplication = grafexe.Application
End Sub
```

In the following example the new object name is output:

```
Private Sub objGDApplication_NewLibraryObject(ByVal LibObject As IHMIFolderItem)
'VBA103
MsgBox "The object " & LibObject.DisplayName & " was added."
End Sub
```

**See also**

VBA Reference (Page 1745)

Accessing the component library with VBA (Page 1646)

**Opened Event****Description**

Occurs when a picture is opened.

**syntax**

```
Document_Opened(CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

In the following example a message is output when the picture is opened:

```
Private Sub Document_Opened(CancelForwarding As Boolean)
'VBA104
MsgBox "The Document is open now..."
End Sub
```

**See also**

VBA Reference (Page 1745)

**Saved Event****Description**

Occurs after a picture has been saved.

**syntax**

```
Document_Saved(CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

In the following example a message is output when the picture has been saved:

```
Private Sub Document_Saved(CancelForwarding As Boolean)
'VBA105
MsgBox "The document is saved..."
End Sub
```

**See also**

VBA Reference (Page 1745)

**SelectionChanged Event**

**Description**

Occurs when the selection has been changed.

**syntax**

```
Document_SelectionChanged(CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

In the following example a message is output when a new object has been selected:

```
Private Sub Document_SelectionChanged(CancelForwarding As Boolean)
'VBA106
MsgBox "The selection is changed..."
End Sub
```

**See also**

VBA Reference (Page 1745)

## Started Event

### Description

Occurs when the Graphics Designer has been started.

### Syntax

```
objGDApplication_Started()
```

---

#### Note

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

In the following example, the name "objGDApplication" is substituted for <Name>.

---

### Parameters

--

### Example

Declare application.

```
Dim WithEvents objGDApplication As grafexe.Application
```

Set event tag.

```
Private Sub Document_Opened(CancelForwarding As Boolean)  
    Set objGDApplication = Me.Application  
End Sub
```

Query "Started" event and output message.

```
Private Sub objGDApplication_Started()  
    'VBA107  
    'This event is raised before objGDApplication_Started()  
    MsgBox "The Graphics Designer is started!"  
End Sub
```

**See also**

VBA Reference (Page 1745)

**ToolBarItemClicked Event**

**Description**

Occurs when an icon in a user-defined toolbar has been clicked

---

**Note**

This event is both application-specific and document-specific.

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

`Dim WithEvents <Name> As grafexe.Application`

---

**syntax**

`Document_ToolBarItemClicked(ByVal ToolBarItem As IHMIToolBarItem)`

**Parameters**

Parameter (Data Type)	Description
ToolBarItem (IHMIToolBarItem)	Identifies the symbol.

**Example:**

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()  
'This procedure have to execute with "F5" first  
Set objGDApplication = grafexe.Application  
End Sub
```

In the following example a message is output when the first user-defined icon is clicked:

```
Private Sub Document_ToolbarItemClicked(ByVal ToolbarItem As IHMIToolbarItem)
'VBA108
Dim objToolbarItem As HMIToolbarItem
Dim varToolbarItemKey As Variant
Set objToolbarItem = ToolbarItem
'
'"varToolbarItemKey" contains the value of parameter "Key"
'from the clicked userdefined toolbar-item
varToolbarItemKey = objToolbarItem.Key
'
Select Case varToolbarItemKey
Case "tItem1_1"
MsgBox "The first Toolbar-Icon was clicked!"
End Select
End Sub
```

## See also

[How to assign VBA macros to menus and toolbars \(Page 1642\)](#)

[VBA Reference \(Page 1745\)](#)

## ViewCreated Event

### Description

Occurs when a copy of a picture has been created.

---

### Note

This event is both application-specific and document-specific.

To ensure that the application-specific event is available in the project, the application must be made known to Graphics Designer. This is done by means of the following statement:

```
Dim WithEvents <Name> As grafexe.Application
```

---

### syntax

```
Document_ViewCreated(ByVal pView As IHMIView, CancelForwarding As Boolean)
```

**Parameters**

Parameter (Data Type)	Description
pView (IHMIView)	Identifies the copy of the picture.
CancelForwarding (Boolean)	TRUE if the event is not intended to be forwarded. Default setting is "False".

**Example:**

Carry out the following procedure so that the example shown below will work:

```
Private Sub SetApplication()
'This procedure have to execute with "F5" first
Set objGDApplication = grafexe.Application
End Sub
```

In the following example the number of copy pictures is output when a new copy of the picture has been created.

```
Private Sub Document_ViewCreated(ByVal pView As IHMIView, CancelForwarding As Boolean)
'VBA109
Dim iViewCount As Integer
'
'To read out the number of views
iViewCount = pView.Application.ActiveDocument.Views.Count
MsgBox "A new copy of the picture (number " & iViewCount & ") was created."
End Sub
```

**See also**

VBA Reference (Page 1745)

**WindowStateChange Event****Description**

Occurs when the window size is changed (e.g. from "Minimized" to "Maximized").

**syntax**

```
objGDApplication_WindowStateChanged()
```



**Parameter (Optional)**

--

**Example:**

In the following example a message is output when the window size is changed:

```
Private Sub objGDApplication_WindowStateChanged()  
'VBA110  
MsgBox "The state of the application-window is changed!"  
End Sub
```

**See also**

VBA Reference (Page 1745)

**3.6.1.6 Methods****A-C****Activate Method****Description**

Activates the specified object.

**syntax**

*Expression*.Activate()

**Expression**

Necessary. An expression or element which returns an object of the "Application" or "View" type.

**Parameters**

--

**Example:**

In the following example a copy of the active picture is created and then activated:

```
Sub CreateAndActivateView()
'VBA111
Dim objView As HMIView
Set objView = ActiveDocument.Views.Add
objView.Activate
End Sub
```

**See also**

- View Object (Page 2102)
- Application Object (Page 1909)
- VBA Reference (Page 1745)

**Add Method**

**Description**

Adds another element to a listing.

The following table shows you the listings to which the Add method can be applied. The parameters and syntax for the respective Add methods can be found under "Methods".

Listing	Application for the Add Method
AnalogResultInfos Listing	Adds a new, analog value range in the Dynamic dialog.
Documents Listing	Creates a new picture in the Graphics Designer
GroupedObjects Listing	Adds a new object to a group object.
Toolbars Listing	Creates a new, user-defined toolbar.
Tag Triggers Listing	Creates a new tag trigger.
Views Listing	Creates a copy of the specified picture.

**See also**

- Add Method (Views Listing) (Page 1793)
- Add Method (TagTriggers Listing) (Page 1792)
- Add Method (CustomToolbars Listing) (Page 1788)
- Add Method (GroupedObjects Listing) (Page 1791)

Add Method (Documents Listing) (Page 1790)

Add Method (AnalogResultInfos Listing) (Page 1787)

## Add Method (AnalogResultInfos Listing)

### Description

Adds a new, analog value range in the Dynamic dialog.

### syntax

*Expression*.Add(RangeTo, ResultValue)

### Expression

Necessary. An expression or element which returns an object of the "AnalogResultInfos" type.

### Parameters


Parameter (Data Type)	Description
RangeTo (Variant)	The value range to which the change of property gives rise.
ResultValue (Variant)	The value to which the object property is assigned when the value range is reached.

### Example:

In the following example the radius of a circle is given dynamics with the In the following example a tag name is assigned and three analog value ranges are created:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
  'VBA112
  Dim objDynDialog As HMIDynamicDialog
  Dim objCircle As HMICircle
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
  Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
  "'NewDynamic1'")
  With objDynDialog
    .ResultType = hmiResultTypeAnalog
    .AnalogResultInfos.Add 50, 40
    .AnalogResultInfos.Add 100, 80
    .AnalogResultInfos.ElseCase = 100
  End With
End Sub
```

The diagram shows the Dynamic dialog after the procedure has been carried out:

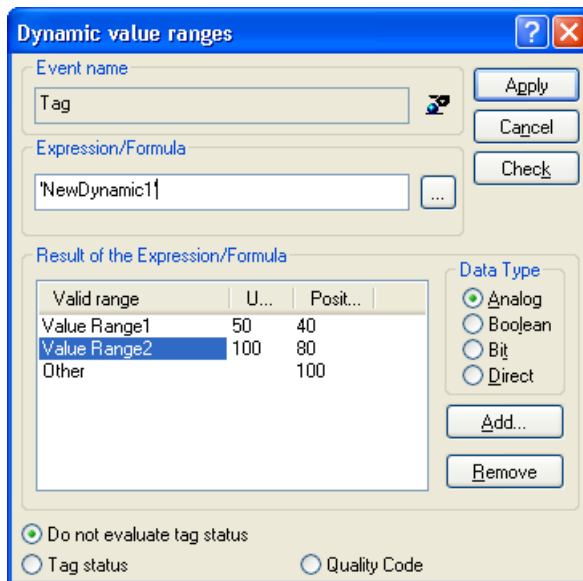

## See also

DynamicDialog Object (Page 1955)

AnalogResultInfos Object (Listing) (Page 1908)

CreateDynamic Method (Page 1828)

How to dynamize a property with the Dynamic dialog (Page 1691)

## Add Method (CustomToolbars Listing)

### Description

Creates a new, user-defined toolbar. There is a difference between application-specific and picture-specific user-defined toolbars:

- Application-specific toolbar: This is linked to the Graphics Designer and is also only visible when all the pictures in the Graphics Designer are closed. Place the VBA code in the document called "GlobalTemplateDocument" or "ProjectTemplateDocument" and use the Application property.
- Picture-specific toolbar: Is linked with a specific picture and remains visible as long as the picture is visible. Place the VBA code in the document called "ThisDocument" for the desired picture and use the ActiveDocument property.

### syntax

*Expression*.Add (Key)

### Expression

Necessary. An expression or element which returns an object of the "CustomToolbars" type.

## Parameters

Parameter (Data Type)	Description
Key (Variant)	Identifies the user-defined toolbar. Use unique names for "Key" (e.g. "DocToolbar1")


## Example:

In the following example a user-defined toolbar with two icons is created in the active picture. These icons are separated by a dividing line:

```
Sub AddDocumentSpecificCustomToolbar()
'VBA115
Dim objToolbar As HMIToolbar
Dim objToolbarItem As HMIToolbarItem

Set objToolbar = ActiveDocument.CustomToolbars.Add("DocToolbar")

'Add toolbar-items to the userdefined toolbar
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(1, "tItem1_1", "My first
Symbol-Icon")
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(3, "tItem1_3", "My second
Symbol-Icon")
'
'Insert seperatorline between the two tollbaritems
Set objToolbarItem = objToolbar.ToolbarItems.InsertSeparator(2, "tSeparator1_2")
End Sub
```

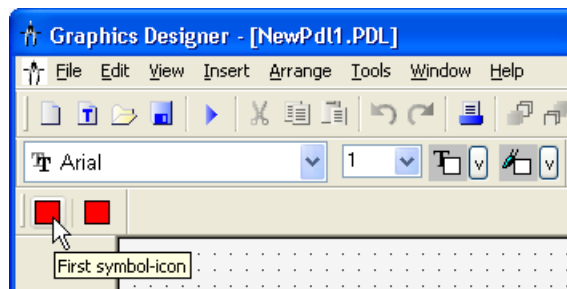

## See also

- [Toolbars Object \(Listing\) \(Page 2081\)](#)
- [InsertToolbarItem Method \(Page 1856\)](#)
- [InsertSeparator Method \(Page 1853\)](#)
- [InsertFromMenuItem Method \(Page 1848\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Creating Customized Menus and Toolbars \(Page 1627\)](#)

## Add Method (Documents Listing)

### Description

Creates a new picture in the Graphics Designer

### syntax

*Expression*.Add [HMIOpenDocumentType]

### Expression

Necessary. An expression or element which returns an object of the "Documents" type.

### Parameters

Parameter (Data Type)	Description
HMIOpenDocumentType (HMIDocumentType)	<p>Defines how the picture will be opened:</p> <ul style="list-style-type: none"> <li>• HMIDocumentTypeVisible: Opens the picture for direct processing. This is the default setting if you do not specify the parameter.</li> <li>• HMIDocumentTypeInvisible: Opens the picture in invisible mode, i.e. it is not displayed in the Graphics Designer. You can only address the picture via the Documents listing, and make it visible again by means of the Hide property.</li> </ul>

### Example:

In the following example a new picture is created in the Graphics Designer:

```
Sub AddNewDocument ()
'VBA113
Application.Documents.Add hmiOpenDocumentTypeVisible
End Sub
```

### See also

- Hide Property (Page 2270)
- Documents Object (Listing) (Page 1952)
- VBA Reference (Page 1745)

## Add Method (GroupedObjects Listing)

### Description

Adds an existing object to the specified group object.

### syntax

*Expression*.Add (Index)

### Expression

Necessary. An expression or element which returns an object of the "GroupedObjects" type.

### Parameters

Parameter (Data Type)	Description
Index (Variant)	The object that is intended to be added. You can either use the index number or the object name.

**Example:**

In this example the group object "My Group" is created from a number of objects. An ellipse segment is then added to the group object:

```
Sub CreateGroup()  
  'VBA114  
  Dim objCircle As HMICircle  
  Dim objRectangle As HMIRectangle  
  Dim objEllipseSegment As HMIEllipseSegment  
  Dim objGroup As HMIGroup  
  
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
  Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
  With objCircle  
    .Top = 40  
    .Left = 40  
    .Selected = True  
  End With  
  With objRectangle  
    .Top = 80  
    .Left = 80  
    .Selected = True  
  End With  
  
  MsgBox "Objects selected!"  
  Set objGroup = ActiveDocument.Selection.CreateGroup  
  
  'Set name for new group-object  
  'The name identifies the group-object  
  objGroup.ObjectName = "My Group"  
  
  'Add new object to active document...  
  Set objEllipseSegment = ActiveDocument.HMIObjects.AddHMIObject("EllipseSegment",  
    "HMIEllipseSegment")  
  Set objGroup = ActiveDocument.HMIObjects("My Group")  
  
  '...and add it to the group:  
  objGroup.GroupedHMIObjects.Add ("EllipseSegment")  
End Sub
```

**See also**

[GroupedObjects Object \(Listing\) \(Page 1983\)](#)

**Add Method (TagTriggers Listing)****Description**

Creates a new tag trigger.



**syntax**

*Expression*.Add (VarName, Type)

**Expression**

Necessary. An expression or element which returns an object of the "TagTriggers" type.

**Parameters**

Parameter (Data Type)	Description
VarName (String)	The name of the tag that is intended to be used as a trigger. Please note that you have to create the tag in the Tag Selection dialog.
Type (CycleType)	This is the cycle type. Select the cycle type from a list in the VBA Editor when you use this method.

**Example:**

In the following example the radius of a circle is made dynamic using a trigger tag:

```
Sub DynamicWithVariableTriggerCycle()
'VBA69
Dim objVBScript As HMIScriptInfo
Dim objVarTrigger As HMIVariableTrigger
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_VariableTrigger",
"HMICircle")
Set objVBScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)
With objVBScript
Set objVarTrigger = .Trigger.VariableTriggers.Add("VarTrigger", hmiVariableCycleType_10s)
.SourceCode = ""
End With
End Sub
```

**See also**

VariableTriggers Object (Listing) (Page 2101)

VBA Reference (Page 1745)

**Add Method (Views Listing)****Description**

Creates a copy of the specified picture.

### **syntax**

*Expression*.Add()

#### **Expression**

Necessary. An expression or element which returns an object of the "Views" type.

### **Parameters**

--

### **Example:**

In the following example a copy of the active picture is created and then activated:

```
Sub CreateViewAndActivateView()  
  'VBA117  
  Dim objView As HMIView  
  Set objView = ActiveDocument.Views.Add  
  objView.Activate  
End Sub
```

### **See also**

[Views Object \(Listing\) \(Page 2103\)](#)

[VBA Reference \(Page 1745\)](#)

### **AddAction Method**

#### **Description**

Configures an action on an object or property. This action is triggered when a defined event occurs.

### **syntax**

*Expression*.Method(HMIActionCreationType)

#### **Expression**

Necessary. An expression or element which returns an object of the "Actions" type.

## Parameters

Parameter (Data Type)	Description
HMIActionCreationType (Variant)	Defines the action: <ul style="list-style-type: none"> <li>• hmiActionCreationTypeCScript: Configures a C action</li> <li>• hmiActionCreationTypeVBScript: Configures a VBS action</li> <li>• hmiActionCreationTypeDirectConnection: Configures a direct connection</li> </ul>

## Example:

In the following example a VBS action for changing the radius of a circle is configured:

```
Sub AddActionToPropertyTypeVBScript()
'VBA118
Dim objEvent As HMIEvent
Dim objVBScript As HMIScriptInfo
Dim objCircle As HMICircle
'Create circle in picture. By changing of property "Radius"
'a VBS-action will be started:
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_AB", "HMICircle")
Set objEvent = objCircle.Radius.Events(1)
Set objVBScript = objEvent.Actions.AddAction(hmiActionCreationTypeVBScript)
End Sub
```

## See also

Event Object (Page 1966)

Actions Object (Listing) (Page 1898)

## AddActiveXControl Method

### Description

Adds a new ActiveXControl object to the "HMIObjects" listing. The object is inserted in the upper left corner of the specified picture.

### syntax

```
Expression.AddActiveXControl("ObjectName", "ProgID")
```

### Expression


Required. An expression or element which returns an object of the "HMIObjects" type.

**Parameter**

Parameter (data type)	Description
ObjectName (String)	The name of the object. You can address the object by its name in a listing.
ProgID (String)	The ActiveX Control that is to be inserted.

**Determining the ProgID**

To determine the ProgID for an ActiveX control, go to the "Object Palette" in the Graphics Designer and in the Default tab under "Smart Objects" insert the control object into the picture. The "Insert a Control" dialog displays the path and ProgID for the selected control:

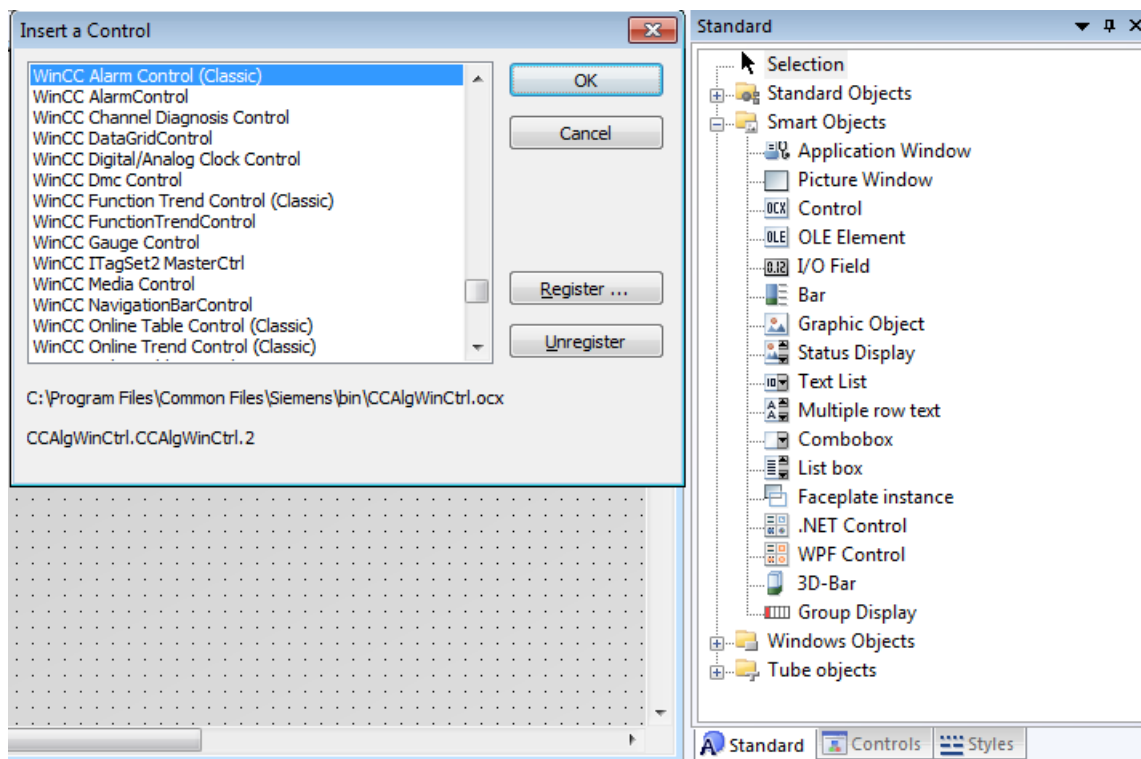

The following table shows a list of ProgIDs of WinCC controls that are installed by WinCC:

Name of the WinCC control	ProgID
Siemens HMI Symbol Library	SiemensHMI.SymbolLibrary.1
WinCC AlarmControl	CCAxAlarmControl.AxAlarmControl.1
WinCC digital/analog clock control	DACLOCK.DaclockCtrl.1
WinCC FunctionTrendControl	CCAxFunctionTrendControl.AxFunctionTrendControl.1
WinCC gauge control	XGAUGE.XGaugeCtrl.1
WinCC media control	CCMediaControl.CCMediaControl.1
WinCC OnlineTableControl	CCAxOnlineTableControl.AxOnlineTableControl.1
WinCC OnlineTrendControl	CCAxOnlineTrendControl.AxOnlineTrendControl.1
WinCC push button control	PBUTTON.PbuttonCtrl.1

Name of the WinCC control	ProgID
WinCC slider control	SLIDER.SliderCtrl.1
WinCC RulerControl	CCAxTrendRulerControl.AxRulerControl.1
WinCC UserArchiveControl	CCAxUserArchiveControl.AxUserArchiveControl.1

**Example:**

In the following example, the ActiveX Control "WinCC Gauge Control" is inserted in the active picture.

```
Sub AddActiveXControl()
    'VBA119
    Dim objActiveXControl As HMIActiveXControl
    Set objActiveXControl = ActiveDocument.HMIObjects.AddActiveXControl("WinCC_Gauge",
    "XGAUGE.XGaugeCtrl.1")
    With ActiveDocument
        .HMIObjects("WinCC_Gauge").Top = 40
        .HMIObjects("WinCC_Gauge").Left = 40
    End With
End Sub
```

**Note**

After executing the method, the Graphics Designer will not be fully shut down. The "Grafexe.exe" file remains in the memory. In order to restart the Graphics Designer, exit the "Grafexe.exe" application in the Task Manager.

**See also**

ActiveX controls (Page 1671)  
HMIObjects Object (Listing) (Page 1990)  
ActiveXControl Object (Page 1900)  
VBA Reference (Page 1745)

**AddDotNetControl method****Description**

Adds a new ".Net-Control" object to the "HMIObjects" listing.

**Syntax**

```
Expression.AddDotNetControl(ObjectName, ControlType, InGAC,
AssemblyInfo)
```

**Expression**

Necessary. An expression or element which returns an object of the "HMIOjects" type.

**Parameters**

Parameter (Data Type)	Description
ObjectName (String)	The name of the object. You can address the object by its name in a listing.
ControlType (String)	The namespace of the object.
InGAC (String)	TRUE: The object is registered in the Global Assembly Cache. FALSE: The object is not registered in the Global Assembly Cache.
AssemblyInfo (String)	If "InGAC=TRUE", then the following information will be specified: Assembly Version Culture PublicKeyToken If "InGAC=FALSE", only the path of the object is specified in "Assembly".

**Example**

In the following example, the ".NETControl" object from the Global Assembly Cache is inserted in the active picture.

```
'VBA851
Dim DotNetControl As HMIDotNetControl
Set DotNetControl = ActiveDocument.HMIOjects.AddDotNetControl("MyVBAControl",
"System.Windows.Forms.Label", True, "Assembly=System.Windows.Forms, Version=2.0.0.0,
Culture=neutral, PublicKeyToken=b77a5c561934e089")
```

**AddFolder Method****Description**

Creates a new folder in the components library. The FolderItem object of the "Folder" type is added to the FolderItems listing.

The new folder created in this way receives the internal name "FolderX", where "X" stands for a consecutive number, starting with 1. Use the internal name to address the folder in the FolderItems listing.

**syntax**

*Expression*.AddFolder(DefaultName)

**Expression**

Necessary. An expression or element which returns an object of the "FolderItems" type.

**Parameters**

Parameter (Data Type)	Description
DefaultName (String)	The name of the folder that is to be created.

**Example:**

In the following example the folder "My Folder" will be created in the "Project Library":

```
Sub AddNewFolderToProjectLibrary()
'VBA120
Dim objProjectLib As HMISymbolLibrary
Set objProjectLib = Application.SymbolLibraries(2)
objProjectLib.FolderItems.AddFolder ("My Folder")
End Sub
```

**See also**

SymbolLibrary Object (Page 2074)  
FolderItems Object (Listing) (Page 1973)  
VBA Reference (Page 1745)  
Accessing the component library with VBA (Page 1646)

**AddFromClipboard Method****Description**

Copies an object from the clipboard into a folder in the Components Library. The FolderItem object of the "Item" type is added to the FolderItems listing.

**Note**

The clipboard must contain objects from the Graphics Designer. Other contents (such as ASCII text) will not be pasted.

**syntax**

*Expression*.AddFromClipboard(DefaultName)

**Expression**

Necessary. An expression or element which returns an object of the "FolderItems" type.

**Parameters**

Parameter (Data Type)	Description
DefaultName (String)	The name to be given to the object pasted into the components library.

**Example:**

In the following example the object "PC" from the "Global Library" will be copied into the folder "Folder 3" in the "Project Library":

```
Sub CopyObjectFromGlobalLibraryToProjectLibrary()
'VBA121
Dim objGlobalLib As HMISymbolLibrary
Dim objProjectLib As HMISymbolLibrary
Set objGlobalLib = Application.SymbolLibraries(1)
Set objProjectLib = Application.SymbolLibraries(2)
objProjectLib.FolderItems.AddFolder ("My Folder3")
'
'copy object from "Global Library" to clipboard
With objGlobalLib
.FolderItems(2).Folder.Item(2).Folder.Item(1).CopyToClipboard
End With
'
'paste object from clipboard into "Project Library"
objProjectLib.FolderItems(objProjectLib.FindByDisplayName("My
Folder3").Name).Folder.AddFromClipboard ("Copy of PC/PLC")
End Sub
```

**See also**

[FolderItems Object \(Listing\) \(Page 1973\)](#)

[SymbolLibrary Object \(Page 2074\)](#)

[VBA Reference \(Page 1745\)](#)

[Accessing the component library with VBA \(Page 1646\)](#)



## AddHMIObject Method

### Description

Adds a new standard, smart or Windows object to the "HMIObjects" listing. The object is inserted in the upper left corner of the specified picture.

#### Note

Use the AddActiveXControl method to insert an ActiveXControl.

Use the AddOLEObject method to insert an OLE Element.

### syntax

*Expression*.AddHMIObject ("ObjectName", "ProgID")

#### Expression

Necessary. An expression or element which returns an object of the "HMIObjects" type.

### Parameters

Parameter (Data Type)	Description
ObjectName (String)	The name of the object. You can address the object by its name in a listing.
ProgID (String)	The object type that is to be inserted. "Obtain the "ProgID" by prefixing the VBA object name with "HMI" "(e.g. HMICircle or HMIRectangle)

### Example:

In the following example a circle will be inserted into the active picture and its background color set to "Red":

```
Sub AddCircleToActiveDocument ()
'VBA122
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject ("VBA_Circle", "HMICircle")
objCircle.BackColor = RGB(255, 0, 0)
End Sub
```

### See also

PieSegment Object (Page 2032)

TextList Object (Page 2076)

### 3.6 VBA Reference

StatusDisplay Object (Page 2070)  
StaticText Object (Page 2067)  
Slider object (Page 2062)  
RoundRectangle Object (Page 2055)  
RoundButton Object (Page 2052)  
Rectangle Object (Page 2049)  
PolyLine Object (Page 2038)  
PictureWindow Object (Page 2029)  
OptionGroup Object (Page 2025)  
HMIObjects Object (Listing) (Page 1990)  
Line Object (Page 2004)  
IOField Object (Page 1992)  
GraphicObject Object (Page 1975)  
EllipseArc Object (Page 1960)  
EllipseSegment Object (Page 1963)  
Ellipse Object (Page 1957)  
CircularArc Object (Page 1931)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)  
BarGraph Object (Page 1914)  
ApplicationWindow Object (Page 1911)  
AddOLEObject Method (Page 1803)  
AddActiveXControl Method (Page 1795)  
VBA Reference (Page 1745)

#### AddItem Method

##### Description

Copies an object from the specified picture into a folder in the Components Library. The FolderItem object of the "Item" type is added to the FolderItems listing.

##### syntax

```
Expression.Folder.AddItem "DefaultName", pHMIObject
```

**Expression**

Necessary. An expression or element which returns an object of the "FolderItems" type.

**Parameters**

Parameter (Data Type)	Description
DefaultName (String)	The name to be given to the object pasted into the components library.
pHMIObject (HMIObject)	The object that is to be inserted into the Components Library from the specified picture.

**Example:**

In the following example a circle will be copied into the "Project Library". For this purpose the circle will be pasted into the active picture and the folder "My Folder 2" will

```
Sub VBA123 ()
  'VBA123
  Dim objProjectLib As HMISymbolLibrary
  Dim objCircle As HMICircle

  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle", "HMICircle")
  Set objProjectLib = Application.SymbolLibraries(2)
  objProjectLib.FolderItems.AddFolder ("My Folder2")
  objProjectLib.FindByDisplayName("My Folder2").Folder.AddItem "ProjectLib Circle",
  ActiveDocument.HMIObjects("Circle")
End Sub
```

**See also**

[FolderItems Object \(Listing\) \(Page 1973\)](#)

[SymbolLibrary Object \(Page 2074\)](#)

[VBA Reference \(Page 1745\)](#)

[Accessing the component library with VBA \(Page 1646\)](#)

**AddOLEObject Method****Description**

Adds a new OLE Element to the "HMIObjects" listing. The object is inserted in the upper left corner of the specified picture.


**syntax**

```
Expression.AddOLEObject(ObjectName, ServerName, [CreationType], [UseSymbol])
```

**Expression**

Necessary. An expression or element which returns an object of the "HMIOObjects" type.

**Parameters**

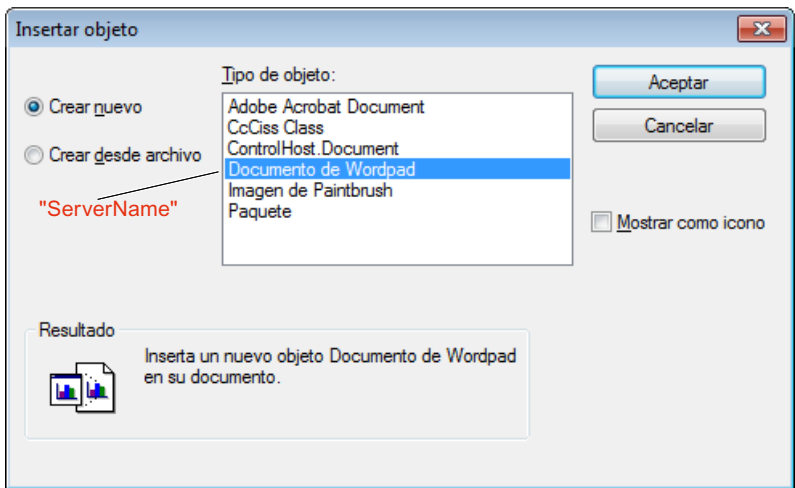Parameter (Data Type)	Description
ObjectName (String)	The name of the object. You can address the object by its name in a listing.
ServerName (String)	<p>The name of the application which is to contain the OLE Element, or the file name complete with path. The value for "ServerName" corresponds to the "Object Type" in the "Insert Object" dialog:</p> 
CreationType (HMIO-OLEObjectCreationType-)	<p>Defines whether the OLE Element will be newly created or an existing file will be used:</p> <ul style="list-style-type: none"> <li>• HMIOLEObjectCreationTypeDirect: Corresponds to setting "Create New". This setting is used if you do not specify the parameter.</li> <li>• HMIOLEObjectCreationTypeByLink: Corresponds to setting "Create from File". This creates a copy of the file. Any changes made to the OLE Element have no effect on the original file. Assign a name to the file via the "ServerName" parameter.</li> <li>• HMIOLEObjectCreationTypeByLinkWithReference: Same as above, except that changes in OLE Element affect the original file. Assign a name to the file via the "ServerName" parameter.</li> </ul>
UseSymbol (Boolean)	TRUE if the standard icon for the file type is to be used. Double clicking on the icon then opens the associated application. The default setting for this parameter is FALSE.

**Example:**

In the following example, an OLE Element containing a Wordpad document will be inserted into the active picture:

```
Sub AddOLEObjectToActiveDocument()  
'VBA124  
Dim objOLEObject As HMIOLEObject  
Set objOLEObject = ActiveDocument.HMIOObjects.AddOLEObject("MS Wordpad Document",  
"Wordpad.Document.1")  
End Sub
```

In the following example, the AddOLEObject method will be used and the "HMIOLEObjectCreationTypeByLink" parameter will be specified:

```
Sub AddOLEObjectByLink()  
'VBA805  
Dim objOLEObject As HMIOLEObject  
Dim strFilename As String  
'  
'Add OLEObject by filename. In this case, the filename has to  
'contain filename and path.  
'Replace the definition of strFilename with a filename with path  
'existing on your system  
strFilename = Application.ApplicationDataPath & "Test.bmp"  
Set objOLEObject = ActiveDocument.HMIOObjects.AddOLEObject("OLEObject1", strFilename,  
hmiOLEObjectCreationTypeByLink, False)  
End Sub
```

In the following example, the AddOLEObject method will be used and the "HMIOLEObjectCreationTypeByLinkWithReference" parameter will be specified:

```
Sub AddOLEObjectByLinkWithReference()  
'VBA806  
Dim objOLEObject As HMIOLEObject  
Dim strFilename As String  
'  
'Add OLEObject by filename. In this case, the filename has to  
'contain filename and path.  
'Replace the definition of strFilename with a filename with path  
'existing on your system  
strFilename = Application.ApplicationDataPath & "Test.bmp"  
Set objOLEObject = ActiveDocument.HMIOObjects.AddOLEObject("OLEObject1", strFilename,  
hmiOLEObjectCreationTypeByLinkWithReference, True)  
End Sub
```

**See also**

OLEObject Object (Page 2023)

HMIObjects Object (Listing) (Page 1990)

VBA Reference (Page 1745)

**AddWPFControl method****Description**

Adds a new "WPF-Control" object to the "HMIObjects" listing.

**Syntax**

```
Expression.AddWPFControl(ObjectName, ControlType, InGAC,
AssemblyInfo)
```

**Expression**

Necessary. An expression or element which returns an object of the "HMIObjects" type.

**Parameters**

Parameter (Data Type)	Description
ObjectName (String)	The name of the object. You can address the object by its name in a listing.
ControlType (String)	The namespace of the object.
InGAC (String)	TRUE: The object is registered in the Global Assembly Cache. FALSE: The object is not registered in the Global Assembly Cache.
AssemblyInfo (String)	If "InGAC=TRUE", then the following information will be specified: Assembly Version Culture PublicKeyToken If "InGAC=FALSE", only the path of the object is specified in "Assembly".

**Example**

In the following example, the "WPF Control" object outside the Global Assembly Cache is inserted in the active picture.

```
'VBA852
Dim WPFControl As HMIWPFControl
Set WPFControl = ActiveDocument.HMIObjects.AddWPFControl("MyWPFVBAControl",
"WinCCWPFControl.TestControl", False, "Assembly=Z:\TestControl\WinCCWPFControl.dll")
```

## AlignBottom Method

### Description

Aligns the objects selected in the specified picture with In so doing the alignment is oriented on the first object that you select.

### syntax

*Expression*.AlignBottom()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example two objects are inserted at different positions in the current picture and then aligned with the bottom:

```
Sub AlignSelectedObjectsBottom()  
'VBA125  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.AlignBottom  
End Sub
```

### See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## AlignLeft Method

### Description

Left-justifies the objects selected in the specified picture. In so doing the alignment is oriented on the first object that you select.

### syntax

*Expression*.AlignLeft()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example two objects are inserted at different positions in the current picture and then aligned to the left:

```
Sub AlignSelectedObjectsLeft()  
'VBA126  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.AlignLeft  
End Sub
```

### See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)



## AlignRight Method

### Description

Right-justifies the objects selected in the specified picture. In so doing the alignment is oriented on the first object that you select.

### syntax

*Expression*.AlignRight()

#### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example two objects are inserted at different positions in the current picture and then aligned to the right:

```
Sub AlignSelectedObjectsRight()  
'VBA127  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.AlignRight  
End Sub
```

### See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## AlignTop Method

### Description

Aligns the objects selected in the specified picture with In so doing the alignment is oriented on the first object that you select.

### syntax

*Expression*.AlignTop()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example two objects are inserted at different positions in the current picture and then aligned with the top:

```
Sub AlignSelectedObjectsTop()  
'VBA128  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.AlignTop  
End Sub
```

### See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## ArrangeMinimizedWindows Method

### Description

Arranges all minimized pictures on the lower margin of the Graphics Designer.

### syntax

*Expression*.ArrangeMinimizedWindows ()

### Expression

Necessary. An expression or element which returns an object of the "Application" type.

### Parameters

--

### Example:

In the following example all minimized pictures are arranged on the lower margin of the Graphics Designer. For this example to work, you must have minimized a number of pictures in the Graphics Designer:

```
Sub ArrangeMinimizedWindows ()  
  'VBA129  
  Application.ArrangeMinimizedWindows  
End Sub
```

### See also

Application Object (Page 1909)

VBA Reference (Page 1745)

## BackwardOneLevel Method

### Description

Moves the selected objects one level backward within their current layer.

### syntax

*Expression*.BackwardOneLevel ()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example two objects are inserted in the active picture. The object inserted last is then moved backward one level:

```
Sub MoveObjectOneLevelBackward()  
'VBA173  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = False  
End With  
With objRectangle  
.Top = 40  
.Left = 40  
.Width = 100  
.Height = 50  
.BackColor = RGB(255, 0, 255)  
.Selected = True  
End With  
MsgBox "Objects created and selected!"  
ActiveDocument.Selection.BackwardOneLevel  
End Sub
```

### See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## BringToFront Method

### Description

Brings the selected objects right to the front within their current layer.

---

### Note

If the "BringToFront" method is used, the sequence of HMI objects can change in the HMIOjects listing.

---

### Syntax

*Expression*.BringToFront ()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example two objects are inserted in the active picture. The object inserted last is then brought to the front:

```
Sub MoveObjectToFront()  
'VBA198  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 40  
.Left = 40  
.Width = 100  
.Height = 50  
.BackColor = RGB(255, 0, 255)  
.Selected = False  
End With  
MsgBox "The objects circle and rectangle are created" & vbCrLf & "Only the circle is  
selected!"  
ActiveDocument.Selection.BringToFront  
MsgBox "The selection is moved to the front."  
End Sub
```

### See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## CascadeWindows Method

### Description

Arranges all open pictures in the Graphics Designer in a cascade (i.e. overlapping).

### syntax

*Expression*.Method(*Parameter*)

#### Expression

Necessary. An expression or element which returns an object of the "Application" type.

## Parameters

--

## Example:

In the following example all open pictures in the Graphics Designer are arranged in a cascade. For this example to work, you must have opened a number of pictures in the Graphics Designer:

```
Sub CascadeWindows()  
'VBA130  
Application.CascadeWindows  
End Sub
```

## See also

VBA Reference (Page 1745)

Application Object (Page 1909)

## CenterHorizontally Method

### Description

Using this method, the objects selected in the specified picture are centered horizontally.

### syntax

*Expression*.CenterHorizontally()

#### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

## Parameters

--

### Example:

In the following example two objects are inserted at different positions in the current picture and then centered horizontally:

```
Sub CenterSelectedObjectsHorizontally()  
'VBA131  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.CenterHorizontally  
End Sub
```

### See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## CenterVertically Method

### Description

Using this method, the objects selected in the specified picture are centered vertically.

### syntax

*Expression*.CenterVertically()

#### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--



**Example:**

In the following example two objects are inserted at different positions in the current picture and then centered vertically:

```
Sub CenterSelectedObjectsVertically()  
'VBA132  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.CenterVertically  
End Sub
```

**See also**

SelectedObjects object (Listing) (Page 2060)  
VBA Reference (Page 1745)

**CheckSyntax Method****Description**

Checks whether the syntax of the specified C script is correct.  
Use the CheckSyntax method in conjunction with the Compiled Property.

**syntax**

*Expression*.CheckSyntax(CheckOK, Error)

**Expression**

Necessary. An expression or element which returns an object of the "DynamicDialog" type.

**Parameters**

Parameter (Data Type)	Description
CheckOK (Boolean)	TRUE if the syntax of the specified C script is correct.
Error (String)	The message text that is output if the C script is incorrect.

**Example:**

--

**See also**

DynamicDialog Object (Page 1955)

VBA Reference (Page 1745)

**Close Method**

**Description**

Closes the specified picture and removes it from the document listing.

---

**Note**

Changes that have not been saved will be lost.

---

**Syntax 1**

*Expression*.Close (FileName)

**Expression**

Necessary. An expression or element which returns an object of the "Documents" type.

**Syntax 2**

*Expression*.Close ()

**Expression**

Necessary. An expression or element which returns an object of the "Document" type.

**Parameters**

Parameter (Data Type)	Description
FileName (String)	The name of the PDL file to be closed.

**Example:**

In the following example the picture "Test.PDL" will be closed. For this example to work, you must have opened the picture "Test.PDL":

```
Sub CloseDocumentUsingTheFileName()  
'VBA134  
Dim strFile As String  
strFile = Application.ApplicationDataPath & "test.pdl"  
Application.Documents.Close (strFile)  
End Sub  
In the following example the active picture in the Graphics Designer will be closed:  
Sub CloseDocumentUsingActiveDocument()  
'VBA135  
ActiveDocument.Close  
End Sub
```

**See also**

Document Object (Page 1949)  
ActiveDocument Property (Page 2107)  
Documents Object (Listing) (Page 1952)  
VBA Reference (Page 1745)

**CloseAll Method****Description**

Closes all the pictures opened in the Graphics Designer and removes them from the documents listing.

---

**Note**

Changes that have not been saved will be lost.

---

**syntax**

*Expression*.CloseAll()

**Expression**

Necessary. An expression or element which returns an object of the "Documents" type.

**Parameters**

--

**Example:**

In the following example all open pictures in the Graphics Designer are closed:

```
Sub CloseAllDocuments()  
'VBA136  
Application.Documents.CloseAll  
End Sub
```

**See also**

- Documents Object (Listing) (Page 1952)
- VBA Reference (Page 1745)

**ConvertToScript Method**

**Description**

Converts the specified Dynamic dialog into a C script.  
On conversion the associated DynamicDialog object is deleted.

---

**Note**

You cannot undo the conversion.

---

**syntax**

```
Expression.ConvertToScript()
```

**Expression**

Necessary. An expression or element which returns an object of the "DynamicDialog" type.

**Parameters**

--

**Example:**

In the following example a circle will be inserted into the active picture and its radius will be dynamically configured using the Dynamic dialog. The Dynamic dialog will then be converted into a C script.

```
Sub ConvertDynamicDialogToScript()  
'VBA137  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
'  
'Create dynamic  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
'  
'configure dynamic. "ResultType" defines the valuerange-type:  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.Add 50, 40  
.AnalogResultInfos.Add 100, 80  
.AnalogResultInfos.ElseCase = 100  
MsgBox "The dynamic-dialog will be changed into a C-script."  
.ConvertToScript  
End With  
End Sub
```

**See also**

[DynamicDialog Object \(Page 1955\)](#)

[VBA Reference \(Page 1745\)](#)

**ConvertToVBScript method****Description**

Converts the specified Dynamic dialog into a VB script.

On conversion, the associated DynamicDialog object is deleted.

---

**Note**

You cannot undo the conversion.

---

**Syntax**

*Expression*.ConvertToVBScript()

**Expression**

Required. An expression which returns an object of the "DynamicDialog" type.

**Parameters**

--

**Example**

In the following example, a circle is inserted into the active picture and its radius is dynamically configured using the Dynamic dialog. The Dynamic dialog is then converted into a VB script.

```
Sub ConvertDynamicDialogToVBScript()  
'VBA908  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
,  
'Create dynamic  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
,  
'configure dynamic. "ResultType" defines the valuerange-type:  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.Add 50, 40  
.AnalogResultInfos.Add 100, 80  
.AnalogResultInfos.ElseCase = 100  
MsgBox "The dynamic-dialog will be changed into a VB-script."  
.ConvertToVBScript  
End With  
End Sub
```

**See also**

[DynamicDialog Object \(Page 1955\)](#)

**ConvertWM method****Description**

Is used internally for PowerCC.

## CopySelection Method

### Description

Using this method, the objects selected in the picture are copied to the clipboard.

### syntax

*Expression*.CopySelection()

#### Expression

Necessary. An expression or element which returns an object of the "Document" or "Selection" type.

### Parameters

--

### Example:

In the following example two of the objects inserted in the active picture are selected. The selection is copied and pasted to a new picture:

```
Sub CopySelectionToNewDocument()  
'VBA138  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim iNewDoc As Integer  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
'Instead of "ActiveDocument.CopySelection" you can also write:  
'"ActiveDocument.Selection.CopySelection".  
ActiveDocument.CopySelection  
Application.Documents.Add hmiOpenDocumentTypeVisible  
iNewDoc = Application.Documents.Count  
Application.Documents(iNewDoc).PasteClipboard  
End Sub
```

## See also

- Document Object (Page 1949)
- ActiveDocument Property (Page 2107)
- SelectedObjects object (Listing) (Page 2060)
- PasteClipboard Method (Page 1868)
- Add Method (Documents Listing) (Page 1790)
- Activate Method (Page 1785)
- VBA Reference (Page 1745)

## CopyToClipboard Method

### Description

Copies an object from a folder in the Components Library to the clipboard.

### Syntax

*Expression*.CopyToClipboard()

#### Expression

Necessary. An expression or element which returns a FolderItem object of the "Item" type.

### Parameters

--



**Example:**

In the following example the object "PC" from the "Global Library" will be copied into the folder "My Folder3" in the "Project Library":

```
Sub CopyObjectFromGlobalLibraryToProjectLibrary()  
'VBA139  
Dim objGlobalLib As HMISymbolLibrary  
Dim objProjectLib As HMISymbolLibrary  
Dim objFolderItem As HMIFolderItem  
  
Set objGlobalLib = Application.SymbolLibraries(1)  
Set objProjectLib = Application.SymbolLibraries(2)  
objProjectLib.FolderItems.AddFolder ("My Folder3")  
'  
'copy object from "Global Library" to clipboard  
With objGlobalLib  
.FolderItems(2).Folder.Item(2).Folder.Item(1).CopyToClipboard  
End With  
'  
'paste object from clipboard into "Project Library"  
Set objFolderItem = objProjectLib.FindByDisplayName("My Folder3")  
objFolderItem.Folder.AddFromClipboard ("Copy of PC/PLC")  
  
End Sub
```

**See also**

[SymbolLibrary Object \(Page 2074\)](#)  
[FolderItem Object \(Page 1972\)](#)  
[VBA Reference \(Page 1745\)](#)  
[Accessing the component library with VBA \(Page 1646\)](#)

**CreateCustomizedObject Method****Description**

Creates a customized object from the objects selected in the specified picture. You then have to configure the customized object in the "Configuration Dialog".

For further information on this topic please refer to "Customized Objects" in this documentation and "Customized Object" in the WinCC documentation.

**syntax**

*Expression*.CreateCustomizedObject ()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example two objects are inserted at different positions in the current picture and a customized object is then created:

```
Sub CreateCustomizedObject()  
    'VBA140  
    Dim objCircle As HMICircle  
    Dim objRectangle As HMIRectangle  
    Dim objCustObject As HMICustomizedObject  
    Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
    Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
    With objCircle  
        .Top = 40  
        .Left = 40  
        .Selected = True  
    End With  
    With objRectangle  
        .Top = 80  
        .Left = 80  
        .Selected = True  
    End With  
    MsgBox "Objects selected!"  
    Set objCustObject = ActiveDocument.Selection.CreateCustomizedObject  
    objCustObject.ObjectName = "myCustomizedObject"  
End Sub
```

### See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[CustomizedObject Object \(Page 1938\)](#)

[VBA Reference \(Page 1745\)](#)

[Customized Objects \(Page 1682\)](#)

## CreateDynamicDialog method

### Description

Dynamizing properties of pictures and objects depending on specific value ranges or variable statuses.

### Syntax

*Expression*.CreateDynamicDialog([Code as String],iResultType as Long)

### Expression

Required. An expression or element which returns an object of the "Property" type.

### Parameter

Parameter (Data Type)	Description
Code (String)	Defines the function or tag that is used for dynamic purposes. Also specify the tag name in single quotation marks: "Tag name"
iResultType (Long)	Defines the type of value range: <ul style="list-style-type: none"> <li>• hmiResultTypeDirect = 0</li> <li>• hmiResultTypeAnalog= 1</li> <li>• hmiResultTypeBool = 2</li> <li>• hmiResultTypeBit = 3</li> </ul>

### Example

In the following example the radius of a circle is given dynamics with the dynamic dialog. A tag name and a "ResultType" are assigned to the dynamic dialog.

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA820
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
'Create Object
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("myCircle","HMICircle")
'Create dynamic (Tag "myTest" must be exist")
Set objDynDialog = objCircle.Radius.CreateDynamicDialog("'myTest'",1)
End Sub
```

### See also

FaceplateProperty object (Page 1971)

## CreateDynamic Method

### Description

Makes the specified property dynamic.

### syntax

*Expression*.CreateDynamic (DynamicType, [SourceCode])

### Expression

Necessary. An expression or element which returns an object of the "Property" type.

### Parameters

You only need use the "SourceCode" parameter if you want to make the specified property dynamic with the aid of the Dynamic dialog.

In all other types of dynamics you can omit the parameter.

Parameter (Data Type)	Description
DynamicType (HMIDynamicCreationType)	Defines the type of dynamics: <ul style="list-style-type: none"> <li>• hmiDynamicCreationTypeVariableDirect: Dynamics with a tag</li> <li>• hmiDynamicCreationTypeVariableIndirect: Dynamics with a tag In this type of dynamics you specify only the name of the tag whose value will be used for dynamic purposes.</li> <li>• hmiDynamicCreationTypeScript: Dynamics with a script (C, VB).</li> <li>• hmiDynamicCreationTypeDynamicDialog: Dynamizing with the dynamic dialog box:</li> </ul>
SourceCode (String)	Defines the function or tag that will be used for dynamic purposes. Also specify the tag name in single quote marks: "Tag name"

**Example:**

In this example a circle property "Top" will be made dynamic with the aid of the tag "NewDynamic":

```
Sub AddDynamicAsVariableDirectToProperty()  
'VBA141  
Dim objVariableTrigger As HMIVariableTrigger  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("MyCircle", "HMICircle")  
'Make property "Top" dynamic:  
Set objVariableTrigger = objCircle.Top.CreateDynamic(hmiDynamicCreationTypeVariableDirect,  
"NewDynamic")  
'  
'Define cycle-time  
With objVariableTrigger  
.CycleType = hmiCycleType_2s  
End With  
End Sub
```

**See also**

[Property Object \(Page 2042\)](#)  
[DeleteDynamic Method \(Page 1833\)](#)  
[VBA Reference \(Page 1745\)](#)

**CreateGroup Method****Description**

Creates a group object from the objects selected in the specified picture.

For further information on this topic please refer to "Group Objects" in this documentation and "Group Object" in the WinCC documentation.

**syntax**

*Expression*.CreateGroup()

**Expression**

Necessary. An expression or element which returns an object of the "Selection" type.

**Parameters**

--

### Example:

In the following example two objects are inserted at different positions in the current picture and a group object is then created:

```
Sub CreateGroup()  
'VBA142  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objGroup As HMIGroup  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
Set objGroup = ActiveDocument.Selection.CreateGroup  
objGroup.ObjectName = "myGroup"  
End Sub
```

### See also

- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [Group Object \(Page 1978\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Group Objects \(Page 1674\)](#)

## D-M

### GetDeclutterObjectSize method

#### Description

Reads the limits displaying and hiding objects (decluttering) in the specified picture.

#### Syntax

*Expression*.GetDeclutterObjectSize (Min, Max)

**Expression**

Required. An expression or element which returns an object of the "Document" type.

**Parameter**

Parameter (data type)	Description
Min (Long)	Lower size range in pixels.
Max (Long)	Upper size range in pixels.

**Example**

In the following example, the decluttering limits of the active picture are read and output:

```
Sub ReadSettingsOfPicture()
'VBA848
Dim objectsize_min As Long, objectsize_max As Long

ActiveDocument.GetDeclutterObjectSize objectsize_min, objectsize_max
MsgBox objectsize_min & " " & objectsize_max

End Sub
```

**Delete Method****Description**

Deletes the specified object and removes it from the listing.

**syntax**

*Expression*.Delete()

**Expression**

Necessary. An expression or element which returns objects of the following types.

- Assignment
- FolderItem
- LanguageText
- Menu
- MenuItem
- Object
- Toolbar

- [ToolbarItem](#)
- [VariableTrigger](#)
- [View](#)

### Parameters

--

### Example:

In the following example the first object in the active picture will be deleted. For this example to work, you must have created at least one object in the active picture:

```
Sub ObjectDelete()  
  'VBA143  
  ActiveDocument.HMIObjects(1).Delete  
End Sub
```

### See also

- [LanguageText Object \(Page 1999\)](#)
- [View Object \(Page 2102\)](#)
- [VariableTrigger Object \(Page 2099\)](#)
- [ToolbarItem Object \(Page 2083\)](#)
- [FolderItem Object \(Page 1972\)](#)
- [HMIOBJECT Object \(Page 1988\)](#)
- [MenuItem Object \(Page 2013\)](#)
- [Menu Object \(Page 2009\)](#)
- [VBA Reference \(Page 1745\)](#)

### DeleteAll Method

#### Description

Deletes all selected objects in the specified picture and removes them from the "Selection" and "HMIObjects" listings.

#### syntax

*Expression*.DeleteAll()



**Expression**

Necessary. An expression or element which returns an object of the "Selection" type.

**Parameters**

--

**Example:**

In the following example two objects are inserted at different positions in the current picture and then selected and deleted:

```
Sub DeleteAllSelectedObjects()  
'VBA145  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.DeleteAll  
End Sub
```

**See also**

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

**DeleteDynamic Method****Description**

Removes the dynamic characteristic from the specified property.

**syntax**

*Expression*.DeleteDynamic

### Expression

Necessary. An expression or element which returns an object of the "Property" type.

### Parameters

--

### Example:

In the following example the dynamic characteristic created with the aid of the CreateDynamic Method will be

```
Sub DeleteDynamicFromObjectMeinKreis()  
'VBA146  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects("MyCircle")  
objCircle.Top.DeleteDynamic  
End Sub
```

### See also

Property Object (Page 2042)  
CreateDynamic Method (Page 1828)  
VBA Reference (Page 1745)

### DeselectAll Method

#### Description

Deselects all selected objects in the specified picture and removes them from the Selection listing.

#### syntax

*Expression*.DeselectAll()

#### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

**Example:**

In the following example two objects are inserted at different positions in the current picture and selected. All selected objects are then deselected:

```
Sub SelectObjectsAndDeselectThemAgain()  
'VBA147  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects created and selected!"  
ActiveDocument.Selection.DeselectAll  
MsgBox "Objects deselected!"  
End Sub
```

**See also**

SelectedObjects object (Listing) (Page 2060)

VBA Reference (Page 1745)

**Destroy Method****Description**

Ungroups the specified customized object. The objects remain intact.

**Syntax**

*Expression*.Destroy()

**Expression**

An expression or element which returns objects of the "CustomizedObject" types.

**Parameters**

--

### Example:

An example showing how to use the Destroy Method can be found in this documentation under the heading "Editing a Customized Object with VBA".

### See also

- CustomizedObject Object (Page 1938)
- Destroy Method (Page 1835)
- Delete Method (Page 1831)
- CreateCustomizedObject Method (Page 1825)
- How to Edit a Customized Object with VBA (Page 1683)

## DuplicateSelection Method

### Description

Duplicates the objects selected in the specified picture. The objects created in this way are added to the HMIObjects listing. The names of new objects are numbered consecutively with each duplication.

For instance if you duplicate an object called "Circle", the duplicate object is called "Circle1". If you duplicate the object called "Circle" once more, the resulting object is called "Circle2" and so on.

### syntax

*Expression*.DuplicateSelection()

#### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

**Example:**

In the following example two objects are inserted at different positions in the current picture and selected. They are then duplicated:

```
Sub DuplicateSelectedObjects()  
'VBA149  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects created and selected!"  
ActiveDocument.Selection.DuplicateSelection  
End Sub
```

**See also**

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[HMIObjects Object \(Listing\) \(Page 1990\)](#)

[VBA Reference \(Page 1745\)](#)

**EvenlySpaceHorizontally Method****Description**

Using this method, the objects selected in the specified picture are spaced horizontally at an even distance from one another.

**syntax**

*Expression*.EvenlySpaceHorizontally()

**Expression**

Necessary. An expression or element which returns an object of the "Selection" type.

## Parameters

--

## Example:

In the following example three objects are inserted at different positions in the current picture and selected. They are then positioned horizontally at an even distance from one another:

```
Sub EvenlySpaceObjectsHorizontally()  
'VBA150  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objEllipse As HMIEllipse  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")  
With objCircle  
.Top = 30  
.Left = 0  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 42  
.Selected = True  
End With  
With objEllipse  
.Top = 48  
.Left = 162  
.BackColor = RGB(255, 0, 0)  
.Selected = True  
End With  
MsgBox "Objects created and selected!"  
ActiveDocument.Selection.EvenlySpaceHorizontally  
End Sub
```

## See also

[VBA Reference \(Page 1745\)](#)

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

## EvenlySpaceVertically Method

### Description

Using this method, the objects selected in the specified picture are spaced vertically at an even distance from one another.

**syntax**

*Expression*.EvenlySpaceVertically()

**Expression**

Necessary. An expression or element which returns an object of the "Selection" type.

**Parameters**

--

**Example:**

In the following example three objects are inserted at different positions in the current picture and selected. They are then positioned vertically at an even distance from one another:

```
Sub EvenlySpaceObjectsVertically()  
'VBA151  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objEllipse As HMIEllipse  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")  
With objCircle  
.Top = 30  
.Left = 0  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 42  
.Selected = True  
End With  
With objEllipse  
.Top = 48  
.Left = 162  
.BackColor = RGB(255, 0, 0)  
.Selected = True  
End With  
MsgBox "Objects created and selected"  
ActiveDocument.Selection.EvenlySpaceVertically  
End Sub
```

**See also**

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## Export Method

### Description

Saves the specified picture as an EMF file.

### Syntax

*Expression*.Export (Type, Path)

### Expression

Required. An expression or element which returns an object of the "Document" type.

### Parameter

Parameter (Data Type)	Description
Type (HMImportExportType)	Defines the format in which the exported picture will be saved.
Path (String)	The path in which the picture is going to be exported. The path must exist.

### Example

```

Sub ExportAllPicturesAsPDL()
'VBA152
Dim iPictureCounter As Integer
Dim strPath As String

strPath = "C:\WinCC_PDL_Export\"

'Count Pictures in Graphics Designer...
For iPictureCounter = 1 To grafexe.Documents.Count
    '...and export each picture as PDL-file to specified path:
    grafexe.Documents(iPictureCounter).Export hmiImportExportTypePDL,
strPath
Next iPictureCounter
End Sub

```

### See also

[View Object \(Page 2102\)](#)

[Document Object \(Page 1949\)](#)



## Find Method

### Description

Searches for objects in the specified picture and returns the search result as a collection object. You can search for the following object properties:

- Type
- Name
- Property

### syntax

*Expression*.Find([ObjectType], [ObjectName], [PropertyName])

### Expression

Necessary. An expression or element which returns an object of the "HMIOjects" type.

### Parameters

You must specify at least one of the three parameters.

Parameter (Data Type)	Description
ObjectType (String)	The object type that is to be searched for. Specify the "ProgID" of the object concerned. "Obtain the "ProgID" by prefixing the VBA object name with "HMI" "(e.g. HMICircle or HMIRectangle)
ObjectName (String)	The name of the object that is to be searched for. You can use placeholders (?,*) in the object name in order to find objects with similar names.
PropertyName (String)	The name of the object property that is to be searched for. Specify the VBA property name concerned (e.g. "BackColor" in place of "Background Color").

**Example:**

In the following example, objects of the "HMICircle" type will be searched for in the active picture and the search result will be output:

```
Sub FindObjectsByType()  
'VBA153  
Dim colSearchResults As HMICollection  
Dim objMember As HMIObject  
Dim iResult As Integer  
Dim strName As String  
Set colSearchResults = ActiveDocument.HMIObjects.Find(ObjectType:="HMICircle")  
For Each objMember In colSearchResults  
iResult = colSearchResults.Count  
strName = objMember.ObjectName  
MsgBox "Found: " & CStr(iResult) & vbCrLf & "objectname: " & strName  
Next objMember  
End Sub
```

---

**Note**

Further information on using the Find Method can be found in this documentation under the heading "Editing Standard Objects, Smart Objects and Windows Objects".

---

**See also**

- Type Property (Page 2450)
- Name Property (Page 2343)
- Property Object (Page 2042)
- HMIObjects Object (Listing) (Page 1990)
- How to edit Default objects, Smart objects, Windows objects and Tube objects (Page 1664)
- VBA Reference (Page 1745)

**FindByDisplayName Method**

**Description**

Searches the entire Components Library for the specified object. A FolderItem object is returned as the search result.

---

**Note**

The display name of the object is language-dependent. Only the language currently set will be taken into account when searching. The search ends with the first object found.

---

**syntax**

*Expression*.FindByDisplayName (DisplayName)

**Expression**

Necessary. An expression or element which returns an object of the "SymbolLibrary" type or the "FolderItems" listing.

**Parameters**

Parameter (Data Type)	Description
DisplayName (String)	The display name of the object that is to be searched for in the Components Library.

**Example:**

In the following example the entire library will be searched for the object "PC" and its display name will be output:

```
Sub FindObjectInSymbolLibrary()
'VBA154
Dim objGlobalLib As HMISymbolLibrary
Dim objFItem As HMIFolderItem
Set objGlobalLib = Application.SymbolLibraries(1)
Set objFItem = objGlobalLib.FindByDisplayName("PC")
MsgBox objFItem.DisplayName
End Sub
```

**See also**

FolderItem Object (Page 1972)

Accessing the component library with VBA (Page 1646)

**FireConnectionEvents method****Description**

Is used internally by the Graphics Designer.

**FlipHorizontally Method****Description**

Mirrors the selected objects in the specified picture along the horizontal midline.

The object type determines whether it is allowed to be mirrored (for instance an OLE Element cannot be mirrored). The properties are appropriately modified when mirroring is performed. For example, if you mirror an object of the "StaticText" type along the horizontal midline, the value of the "AlignmentTop" property changes from "0" to "2".

### **syntax**

*Expression*.FlipHorizontally()

### **Expression**

Necessary. An expression or element which returns an object of the "Selection" type.

### **Parameters**

--

### **Example:**

In the following example a StaticText object will be inserted into the active picture and mirrored along the horizontal midline:

```
Sub FlipObjectHorizontally()  
  'VBA155  
  Dim objStaticText As HMISStaticText  
  Dim strPropertyName As String  
  Dim iPropertyValue As Integer  
  Set objStaticText = ActiveDocument.HMIObjects.AddHMIObject("Textfield", "HMISStaticText")  
  strPropertyName = objStaticText.Properties("Text").Name  
  With objStaticText  
    .Width = 120  
    .Text = "Sample Text"  
    .Selected = True  
    iPropertyValue = .AlignmentTop  
    MsgBox "Value of '" & strPropertyName & "' before flip: " & iPropertyValue  
    ActiveDocument.Selection.FlipHorizontally  
    iPropertyValue = objStaticText.AlignmentTop  
    MsgBox "Value of '" & strPropertyName & "' after flip: " & iPropertyValue  
  End With  
End Sub
```

### **See also**

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## FlipVertically Method

### Description

Mirrors the selected objects in the specified picture along the vertical midline.

The object type determines whether it is allowed to be mirrored (for instance an OLE Element cannot be mirrored). The properties are appropriately modified when mirroring is performed. For example if you mirror an object of the "StaticText" type along the vertical midline, the value of the "AlignmentLeft" property changes from "0" to "2".

### syntax

```
Expression.FlipVertically()
```

#### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example a StaticText object will be inserted into the active picture and mirrored along the vertical midline:

```
Sub FlipObjectVertically()  
  'VBA156  
  Dim objStaticText As HMISStaticText  
  Dim strPropertyName As String  
  Dim iPropertyValue As Integer  
  Set objStaticText = ActiveDocument.HMIObjects.AddHMIObject("Textfield", "HMISStaticText")  
  strPropertyName = objStaticText.Properties("Text").Name  
  With objStaticText  
    .Width = 120  
    .Text = "Sample Text"  
    .Selected = True  
    .AlignmentLeft = 0  
    iPropertyValue = .AlignmentLeft  
    MsgBox "Value of '" & strPropertyName & "' before flip: " & iPropertyValue  
    ActiveDocument.Selection.FlipVertically  
    iPropertyValue = objStaticText.AlignmentLeft  
    MsgBox "Value of '" & strPropertyName & "' after flip: " & iPropertyValue  
  End With  
End Sub
```

## See also

SelectedObjects object (Listing) (Page 2060)

VBA Reference (Page 1745)

## ForwardOneLevel Method

### Description

Moves the selected objects one level forward within their current layer.

### syntax

*Expression*.ForwardOneLevel ()

#### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

### Example:

In the following example two objects are inserted in the active picture. The object inserted first is then moved forward one level:

```
Sub MoveObjectOneLevelForward()  
'VBA174  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 40  
.Left = 40  
.Width = 100  
.Height = 50  
.BackColor = RGB(255, 0, 255)  
.Selected = False  
End With  
MsgBox "Objects created and selected!"  
ActiveDocument.Selection.ForwardOneLevel  
End Sub
```

**See also**

SelectedObjects object (Listing) (Page 2060)

VBA Reference (Page 1745)

**GetItemByPath Method****Description**

Returns a FolderItem object (folder or object) located on the specified internal access path in the Components Library.

**Note**

To obtain the internal access path, select the "Copy Path" command from The internal access path to the folder or object will then be copied to the clipboard.

**syntax**

*Expression*.GetItemByPath (PathName)

**Expression**

Necessary. An expression or element which returns an object of the "SymbolLibrary" type.

**Parameters**

Parameter (Data Type)	Description
PathName (String)	The internal access path on which the object is located in the Components Library.

**Example:**

In this example one object from the entire library will be returned and its display name will be output:

```
Sub ShowDisplayName ()
  'VBA157
  Dim objGlobalLib As HMISymbolLibrary
  Dim objFItem As HMIFolderItem
  Set objGlobalLib = Application.SymbolLibraries(1)
  Set objFItem = objGlobalLib.GetItemByPath ("\Folder1\Folder2\Object1")
  MsgBox objFItem.DisplayName
End Sub
```

**See also**

SymbolLibrary Object (Page 2074)

FolderItem Object (Page 1972)

Accessing the component library with VBA (Page 1646)

**InsertFromMenuItem Method****Description**

Inserts into an existing, user-defined toolbar a new icon that references an existing menu entry in a user-defined menu.

Use this method if you wish to set up a toolbar so that it contains the same commands as an existing user-defined menu.

**Syntax**

```
Expression.InsertFromMenuItem(Position, Key, pMenuItem,
DefaultToolTipText)
```

**Expression**

Required. An expression or element which returns an object of the "ToolbarItems" type.

**Parameters**

Parameter (Data Type)	Description
Position (Long)	Defines the position of the icon within the user-defined toolbar.
Key (Variant)	Identifies the symbol. Use unique names for "Key" (e.g. tItem1_1).
pMenuItem (HMIMenuItem)	The MenuItem object that is intended to be referenced.
DefaultToolTipText (String)	Defines for the icon concerned the tool tip text that will be displayed when you move the mouse over the icon.



**Example:**

In this example a user-defined menu and a user-defined toolbar will be inserted in the active picture. The icon calls up the menu entry "Hello World" from the user-defined menu:

```
Sub ToolbarItem_InsertFromMenuItem()
'VBA158
Dim objMenu As HMIMenu
Dim objToolbarItem As HMIToolbarItem
Dim objToolbar As HMIToolbar
Dim objMenuItem As HMIMenuItem
Set objMenu = Application.CustomMenus.InsertMenu(1, "Menu1", "TestMenu")
'
'*****
'* Note:
'* The object-reference has to be unique.
'*****
'
Set objMenuItem = Application.CustomMenus(1).MenuItems.InsertMenuItem(1, "MenuItem1",
"Hello World")
Application.CustomMenus(1).MenuItems(1).Macro = "HelloWorld"
Set objToolbar = Application.CustomToolbars.Add("Toolbar1")
Set objToolbarItem = Application.CustomToolbars(1).ToolbarItems.InsertFromMenuItem(1,
"ToolbarItem1", objMenuItem, "Call's Hello World of TestMenu")
End Sub

Sub HelloWorld()
MsgBox "Procedure 'HelloWorld()' is execute."
End Sub
```

**See also**

[ToolbarItems Object \(Listing\) \(Page 2085\)](#)  
[InsertSeparator Method \(Page 1853\)](#)  
[Add Method \(CustomToolbars Listing\) \(Page 1788\)](#)  
[VBA Reference \(Page 1745\)](#)  
[Creating Customized Menus and Toolbars \(Page 1627\)](#)

## InsertMenu Method

### Description

Creates a new, user-defined menu. There is a difference between application-specific and picture-specific user-defined menus:

- Application-specific menu: This is linked to the Graphics Designer and is also only visible when all the pictures in the Graphics Designer are closed. Place the VBA code in the document called "GlobalTemplateDocument" or "ProjectTemplateDocument" and use the Application property.
- Picture-specific menu: Is linked with a specific picture and remains visible as long as the picture is visible. Place the VBA code in the document called "ThisDocument" for the desired picture and use the ActiveDocument property.

### syntax

*Expression*.InsertMenu(Position, Key, DefaultLabel)

### Expression

Necessary. An expression or element which returns an object of the "CustomMenus" type.

### Parameters


Parameter (Data Type)	Description
Position (Long)	Defines the position of the user-defined menu within the menu bar. However, picture-specific menus are always positioned to the right of application-specific menus.
Key (Variant)	Identifies the user-defined menu. Use unique names for "Key" (e.g. "DocMenu1")
DefaultLabel (String)	The name of the user-defined menu.

**Example:**

In the following example, a user-defined menu with two menu entries and a submenu with two entries will be created in the active picture. The submenu will be visually distinguished by a dividing line:

```
Sub CreateDocumentMenus()
'VBA159
Dim objDocMenu As HMIMenu
Dim objMenuItem As HMIMenuItem
Dim objSubMenu As HMIMenuItem
'
Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1", "Doc_Menu_1")
'
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1", "First MenuItem")
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2", "Second MenuItem")
'
'Insert a dividing rule into customized menu:
Set objMenuItem = objDocMenu.MenuItems.InsertSeparator(3, "dSeparator1_3")
'
Set objSubMenu = objDocMenu.MenuItems.InsertSubMenu(4, "dSubMenu1_4", "First SubMenu")
'
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(5, "dmItem1_5", "First item in sub-
menu")
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(6, "dmItem1_6", "Second item in sub-
menu")
End Sub
```

The diagram shows the generated menu structure.

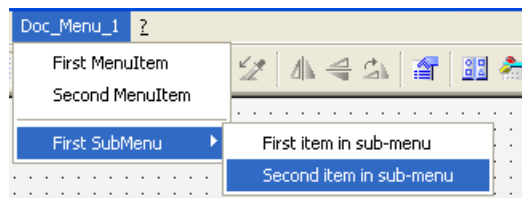**See also**

- Menus Object (Listing) (Page 2011)
- InsertSubMenu Method (Page 1854)
- InsertSeparator Method (Page 1853)
- InsertMenuItem Method (Page 1852)
- VBA Reference (Page 1745)
- Creating Customized Menus and Toolbars (Page 1627)

## InsertMenuItem Method

### Description

Inserts a new entry in a user-defined menu.

### syntax

*Expression*.InsertMenuItem(*Position*, *Key*, *DefaultLabel*)

### Expression

Necessary. An expression or element which returns an object of the "MenuItem" type.

### Parameters


Parameter (Data Type)	Description
Position (Long)	Defines the position of the submenu within the user-defined menu.
Key (Variant)	Identifies the submenu. Use unique names for "Key" "(e.g. dSubMenu1_4).
DefaultLabel (String)	Defines the name of the submenu.

### Example:

In the following example, a user-defined menu with two menu entries and a submenu with two entries will be created in the active picture. The submenu will be visually distinguished by a dividing line:

```
Sub CreateDocumentMenus()
'VBA160
Dim objDocMenu As HMIMenu
Dim objMenuItem As HMIMenuItem
Dim objSubMenu As HMIMenuItem
'
Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1", "Doc_Menu_1")
'
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1", "First MenuItem")
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2", "Second MenuItem")
'
'Insert a dividing rule into customized menu:
Set objMenuItem = objDocMenu.MenuItems.InsertSeparator(3, "dSeparator1_3")
'
Set objSubMenu = objDocMenu.MenuItems.InsertSubMenu(4, "dSubMenu1_4", "First SubMenu")
'
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(5, "dmItem1_5", "First item in sub-
menu")
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(6, "dmItem1_6", "Second item in sub-
menu")
End Sub
```

The diagram shows the menu structure.

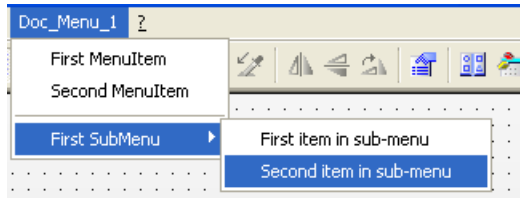

## See also

MenuItems Object (Listing) (Page 2015)

MenuItem Object (Page 2013)

InsertSubmenu Method (Page 1854)

InsertSeparator Method (Page 1853)

InsertMenu Method (Page 1850)

VBA Reference (Page 1745)

Creating Customized Menus and Toolbars (Page 1627)

## InsertSeparator Method

### Description

Inserts a dividing line in a user-defined menu or user-defined toolbar.

### syntax

*Expression*.InsertSeparator(*Position*, *Key*)

### Expression

Necessary. An expression or element which returns an object of the "MenuItems" or "ToolbarItems" type.

### Parameters

Parameter (Data Type)	Description
Position (Long)	Defines the position of the dividing line within the user-defined menu or user-defined toolbar.
Key (Variant)	Identifies the dividing line. Use unique names for "Key" (e.g. "tSeparator1_2").

**Example:**

In the following example a user-defined toolbar with two icons is created in the active picture. These icons are separated by a dividing line:

```
Sub AddDocumentSpecificCustomToolbar()  
'VBA161  
Dim objToolbar As HMIToolbar  
Dim objToolbarItem As HMIToolbarItem  
Set objToolbar = ActiveDocument.CustomToolbars.Add("DocToolbar")  
'Add toolbar-item to userdefined toolbar  
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(1, "tItem1_1", "First  
symbol-icon")  
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(3, "tItem1_3", "Second  
symbol-icon")  
'  
'Insert dividing rule between first and second symbol-icon  
Set objToolbarItem = objToolbar.ToolbarItems.InsertSeparator(2, "tSeparator1_2")  
End Sub
```

**See also**

- [ToolbarItems Object \(Listing\) \(Page 2085\)](#)
- [MenuItems Object \(Listing\) \(Page 2015\)](#)
- [InsertToolbarItem Method \(Page 1856\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Creating Customized Menus and Toolbars \(Page 1627\)](#)

**InsertSubmenu Method****Description**

Inserts a submenu into an existing user-defined menu.

**syntax**

*Expression*.InsertSubmenu(Position, Key, DefaultLabel)

**Expression**

Necessary. An expression or element which returns an object of the "MenuItem" type

## Parameters


Parameter (Data Type)	Description
Position (Long)	Defines the position of the submenu within the user-defined menu.
Key (Variant)	Identifies the submenu. Use unique names for "Key" (e.g. dSubMenu1_4).
DefaultLabel (String)	Defines the name of the submenu.

## Example:

In the following example, a user-defined menu with two menu entries and a submenu with two entries will be created in the active picture. The submenu will be visually distinguished by a dividing line:

```
Sub CreateDocumentMenus()
'VBA162
Dim objDocMenu As HMIMenu
Dim objMenuItem As HMIMenuItem
Dim objSubMenu As HMIMenuItem
'
Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1", "Doc_Menu_1")
'
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1", "First MenuItem")
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2", "Second MenuItem")
'
'Insert a dividing rule into customized menu:
Set objMenuItem = objDocMenu.MenuItems.InsertSeparator(3, "dSeparator1_3")
'
Set objSubMenu = objDocMenu.MenuItems.InsertSubMenu(4, "dSubMenu1_4", "First SubMenu")
'
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(5, "dmItem1_5", "First item in sub-
menu")
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(6, "dmItem1_6", "Second item in sub-
menu")
End Sub
```

The diagram shows the menu structure:

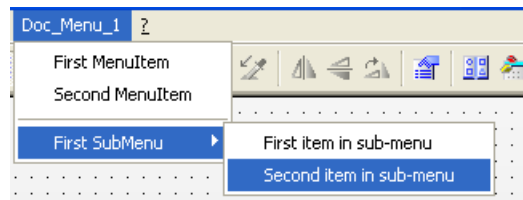

**See also**

- MenuItem Object (Page 2013)
- InsertSeparator Method (Page 1853)
- InsertMenuItem Method (Page 1852)
- InsertMenu Method (Page 1850)
- VBA Reference (Page 1745)
- Creating Customized Menus and Toolbars (Page 1627)

**InsertToolBarItem Method**

**Description**

Inserts a new icon in an existing user-defined toolbar.

**syntax**

```
Expression.InsertToolBarItem(Position, Key, DefaultToolTipText)
```

**Expression**

Necessary. An expression or element which returns an object of the "ToolBarItems" type.

**Parameters**


Parameter (Data Type)	Description
Position (Long)	Defines the position of the icon within the user-defined toolbar.
Key (Variant)	Identifies the symbol. Use unique names for "Key" (e.g. tItem1_1).
DefaultToolTipText (String)	Defines for the icon concerned the tool tip text that will be displayed when you move the mouse over the icon.



**Example:**

In the following example a user-defined toolbar with two icons is created in the active picture. These icons are separated by a dividing line:

```
Sub AddDocumentSpecificCustomToolbar()  
'VBA163  
Dim objToolbar As HMIToolbar  
Dim objToolbarItem As HMIToolbarItem  
Set objToolbar = ActiveDocument.CustomToolbars.Add("DocToolbar")  
'Add toolbar-item to userdefined toolbar  
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(1, "tItem1_1", "First  
symbol-icon")  
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(3, "tItem1_3", "Second  
symbol-icon")  
'  
'Insert dividing rule between first and second symbol-icon  
Set objToolbarItem = objToolbar.ToolbarItems.InsertSeparator(2, "tSeparator1_2")  
End Sub
```

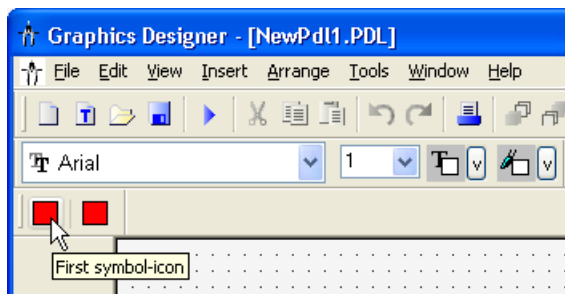**See also**

[ToolbarItems Object \(Listing\) \(Page 2085\)](#)  
[InsertSeparator Method \(Page 1853\)](#)  
[Add Method \(CustomToolbars Listing\) \(Page 1788\)](#)  
[VBA Reference \(Page 1745\)](#)  
[Creating Customized Menus and Toolbars \(Page 1627\)](#)

**IsCSLayerVisible Method****Description**

Returns TRUE if the specified CS layer is visible.

**syntax**

*Expression*.IsCSLayerVisible(*Index*)

**Expression**

Necessary. An expression or element which returns an object of the "Document" type.

**Parameters**

Parameter (Data Type)	Description
Index (Variant)	Defines the CS layer. Value range from 1 to 32. Layer0 corresponds to the index value "1".

**Example:**

The following example determines whether CS layer 1 in the copy of the active picture is visible and outputs the result:

```
Sub IsCSLayerVisible()
'VBA164
Dim objView As HMIView
Dim strLayerName As String
Dim iLayerIdx As Integer
Set objView = ActiveDocument.Views(1)
objView.Activate
iLayerIdx = 2
strLayerName = ActiveDocument.Layers(iLayerIdx).Name
If objView.IsCSLayerVisible(iLayerIdx) = True Then
MsgBox "CS " & strLayerName & " is visible"
Else
MsgBox "CS " & strLayerName & " is invisible"
End If
End Sub
```

**See also**

Document Object (Page 1949)

VBA Reference (Page 1745)

Editing Layers with VBA (Page 1657)

**IsRTLayrVisible Method****Description**

Returns TRUE if the specified RT layer is visible.

**syntax**

*Expression*.IsRTLayrVisible(Index)

**Expression**

Necessary. An expression or element which returns an object of the "Document" type.

**Parameters**

Parameter (Data Type)	Description
Index (Variant)	Defines the RT layer. Value range from 1 to 32. Layer0 corresponds to the index value "1".

**Example:**

The following example determines whether RT layer 1 is visible and outputs the result:

```
Sub RTLayerVisibility()
'VBA165
Dim strLayerName As String
Dim iLayerIdx As Integer
iLayerIdx = 2
strLayerName = ActiveDocument.Layers(iLayerIdx).Name
If ActiveDocument.IsRTLayervisible(iLayerIdx) = True Then
MsgBox "RT " & strLayerName & " is visible"
Else
MsgBox "RT " & strLayerName & " is invisible"
End If
End Sub
```

**See also**

[Document Object \(Page 1949\)](#)

[VBA Reference \(Page 1745\)](#)

[Editing Layers with VBA \(Page 1657\)](#)

**Item Method****Description**

Returns an element from a listing.

**syntax**

*Expression*.Item(Index)

**Expression**

Necessary. An expression or element which returns an object.

## Parameters

Parameter (Data Type)	Description
Index (Variant)	<p>The name or index number of an element from the listing.</p> <p>You can use the Object Name as the name. As the index number you can use a numerical expression (from 1 up to the value of the Count property of the listing).</p> <p>If the entered value fails to match any element in the listing, this counts as an error.</p>

## Example:

---

### Note

The Item Method is the default method for listings. Both the following examples give the same result.

---

In the following example the name of the first picture in the Graphics Designer is output:

```

Sub ShowDocumentNameLongVersion()
'VBA166
Dim strDocName As String
strDocName = Application.Documents.Item(3).Name
MsgBox strDocName
End Sub

Sub ShowDocumentNameShortVersion()
'VBA167
Dim strDocName As String
strDocName = Application.Documents(3).Name
MsgBox strDocName
End Sub

```

## See also

- VariableStateValues Object (Listing) (Page 2097)
- Count Property (Page 2201)
- Views Object (Listing) (Page 2103)
- VariableTriggers Object (Listing) (Page 2101)
- ToolbarItems Object (Listing) (Page 2085)
- Toolbars Object (Listing) (Page 2081)
- SymbolLibraries Object (Listing) (Page 2073)
- SelectedObjects object (Listing) (Page 2060)

Properties Object (Listing) (Page 2041)  
HMIOjects Object (Listing) (Page 1990)  
HMIDefaultObjects Object (Listing) (Page 1985)  
MenuItems Object (Listing) (Page 2015)  
Menus Object (Listing) (Page 2011)  
Layers Object (Listing) (Page 2003)  
LanguageTexts Object (Listing) (Page 2000)  
LanguageFonts Object (Listing) (Page 1997)  
GroupedObjects Object (Listing) (Page 1983)  
FolderItems Object (Listing) (Page 1973)  
Events Object (Listing) (Page 1967)  
Documents Object (Listing) (Page 1952)  
DataLanguages Object (Listing) (Page 1942)  
ConnectionPoints Object (Listing) (Page 1936)  
AnalogResultInfos Object (Listing) (Page 1908)  
Actions Object (Listing) (Page 1898)  
VBA Reference (Page 1745)

## ItemByLcid Method

### Description

Selects the language for which you wish to enter the font settings. Read only access.

---

#### Note

You can only select languages in which you have already configured.

---

### Syntax

*Expression*.ItemByLcid (LangID)

#### Expression

Required. An expression or element which returns an object of the "LanguageFonts" type.

**Parameter**

Parameter (Data Type)	Description
LangID (Long)	This is the language identifier. The list of language identifiers is contained, for example, in the "Languages.csv" file that is found in the index of the WinCC documentation.

**Example**

The following example sets the font attributes of a button for French and English. In contrast to English, French is displayed on the button in a smaller font with a constant tracking (Courier New, 12pt):

```
Sub ExampleForLanguageFonts ()
'VBA168
Dim objLangFonts As HMILanguageFonts
Dim objButton As HMIButton
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")
objButton.Text = "Hello"
Set objLangFonts = objButton.LDFonts
'
'To make fontsettings for English:
With objLangFonts.ItemByLCID(1033)
.Family = "Times New Roman"
.Bold = False
.Italic = True
.Underlined = False
.Size = 14
End With
'
'To make fontsettings for French:
With objLangFonts.ItemByLCID(1036)
.Family = "Courier New"
.Bold = True
.Italic = False
.Underlined = True
.Size = 12
End With

End Sub
```

**See also**

LanguageFonts Object (Listing) (Page 1997)

## LoadDefaultConfig Method

### Description

Loads the file in which the default settings for objects are saved. The PDD file is located in the "GraCS" folder of the current project.

### syntax

*Expression*.LoadDefaultConfig (FileName)

### Expression

Necessary. An expression or element which returns an object of the "Application" type.

### Parameters

Parameter (Data Type)	Description
FileName (String)	The name of the PDD file which it is intended to load.

### Example:

In the following example the file "Test.PDD" will be loaded. For this example to work, you must have previously saved the file. You can do this with the aid of the SaveDefaultConfig Method:

```
Sub LoadDefaultConfig()
  'VBA169
  Application.LoadDefaultConfig ("Test.PDD")
End Sub
```

### See also

Application Object (Page 1909)  
 SaveDefaultConfig Method (Page 1881)  
 VBA Reference (Page 1745)

## MoveOneLayerDown Method

### Description

Moves the selected object in the specified picture into the next lowest layer.

## **syntax**

*Expression*.MoveOneLayerDown ()

### **Expression**

Necessary. An expression or element which returns an object of the "Selection" type.

## **Parameters**

--

## **Example:**

In the following example a circle in the active picture is inserted in the third layer and then moved to the next lowest layer:

```
Sub MoveObjectOneLayerDown ()
  'VBA170
  Dim objCircle As HMICircle
  Dim objRectangle As HMIRectangle
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")
  With objCircle
    .Top = 40
    .Left = 40
    .Selected = True
    .Layer = 3
  MsgBox "Circle is inserted into layer" & Str(.Layer)
  ActiveDocument.Selection.MoveOneLayerDown
  MsgBox "Circle is moved into layer" & Str(.Layer)
  End With
End Sub
```

## **See also**

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## **MoveOneLayerUp Method**

### **Description**

Moves the selected object in the specified picture into the next highest layer.

## **syntax**

*Expression*.MoveOneLayerUp ()



## Expression

Necessary. An expression or element which returns an object of the "Selection" type.

## Parameters

--

## Example:

In the following example a circle in the active picture is inserted in the third layer and then moved to the next highest layer:

```
Sub MoveObjectOneLayerUp()  
'VBA171  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
.Layer = 3  
MsgBox "Circle is inserted into layer" & Str(.Layer)  
ActiveDocument.Selection.MoveOneLayerUp  
MsgBox "Circle is moved into layer" & Str(.Layer)  
End With  
End Sub
```

## See also

SelectedObjects object (Listing) (Page 2060)

VBA Reference (Page 1745)

## MoveSelection Method

### Description

Moves one or more objects selected in the picture by the specified coordinates.

---

### Note

When you want to reposition one or more selected objects, use the properties "Left" and "Top".

---

### syntax

*Expression*.MoveSelection(PosX, PosY)

**Expression**

Required. An expression or element which returns an object of the "Document" or "Selection" type.

**Parameters**

Parameter (Data Type)	Description
PosX (Long)	The number of pixels by which the selection is to be moved horizontally.
PosY (Long)	The number of pixels by which the selection is to be moved vertically.

**Example:**

In the following example two objects are inserted at different positions in the current picture and selected. The selection is then moved 30 pixels to the right and 40 pixels down:

```
Sub MoveSelectionToNewPostion()
'VBA172
Dim nPosX As Long
Dim nPosY As Long
Dim objCircle As HMICircle
Dim objRectangle As HMIRectangle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")
With objCircle
.Top = 40
.Left = 40
.Selected = True
End With
With objRectangle
.Top = 80
.Left = 80
.Selected = True
End With
MsgBox "Objects selected!"
nPosX = 30
nPosY = 40
ActiveDocument.MoveSelection nPosX, nPosY
End Sub
```

**See also**

Top Property (Page 2446)  
Left Property (Page 2305)  
Document Object (Page 1949)  
VBA Reference (Page 1745)

## O-Z

## Open Method

## Description

Opens an existing picture in the Graphics Designer and adds it to the documents listing.

## syntax

*Expression*.Open (FileName, [HMIOpenDocumentType])

## Expression

Necessary. An expression or element which returns an object of the "Documents" type.

## Parameters

Parameter (Data Type)	Description
FileName (String)	The name of the PDL file to be opened. Unless you saved the PDL file in the "GraCS" folder of the open project, you must also specify the path at the same time.
HMIOpenDocumentType (HMIDocumentType)	Defines how the picture will be opened: <ul style="list-style-type: none"> <li>• HMIDocumentTypeVisible: Opens the picture for direct processing. This is the default setting if you do not specify the parameter.</li> <li>• HMIDocumentTypeInvisible: Opens the picture in invisible mode, i.e. it is not displayed in the Graphics Designer. You can only address the picture via the Documents listing, and make it visible again by means of the Hide property.</li> </ul>

## Example:

In the following example the picture "Test" will be opened. For this example to work, you must have previously saved a picture with the name "Test" in the "GraCS" folder of the open project.

```
Sub OpenDocument ()
'VBA175
Application.Documents.Open "Test.PDL", hmiOpenDocumentTypeVisible
End Sub
```

## See also

Hide Property (Page 2270)  
Documents Object (Listing) (Page 1952)  
VBA Reference (Page 1745)

## PasteClipboard Method

### Description

Pastes the contents of the clipboard into the specified picture.

---

#### Note

The clipboard must contain objects from the Graphics Designer. Other contents (such as ASCII text) will not be pasted.

---

### syntax

*Expression*.PasteClipboard()

#### Expression

Necessary. An expression or element which returns an object of the "Document" type.

### Parameters

--

### Example:

In the following example all the objects selected in the active picture are copied to the clipboard and then pasted into a new picture. For this example to work, you must have selected at least one object in the active picture:

```
Sub CopySelectionToNewDocument()  
'VBA176  
Dim iNewDoc As String  
ActiveDocument.CopySelection  
Application.Documents.Add hmiOpenDocumentTypeVisible  
iNewDoc = Application.Documents.Count  
Application.Documents(iNewDoc).PasteClipboard  
End Sub
```

## See also

ActiveDocument Property (Page 2107)  
Document Object (Page 1949)  
CopySelection Method (Page 1823)  
Add Method (Documents Listing) (Page 1790)  
Activate Method (Page 1785)  
VBA Reference (Page 1745)

## PrintDocument Method

### Description

Prints the specified copy of the picture using the current printer settings.

### syntax

*Expression*.PrintDocument()

#### Expression

Necessary. An expression or element which returns an object of the "View" type.

### Parameters

--

### Example:

In the following example a copy of the active picture is created and then activated and printed:

```
Sub CreateAndPrintView()  
'VBA177  
Dim objView As HMIView  
Set objView = ActiveDocument.Views.Add  
objView.Activate  
objView.PrintDocument  
End Sub
```

## See also

View Object (Page 2102)  
VBA Reference (Page 1745)

## PrintProjectDocumentation Method

### Description

Prints out the project documentation for the current picture complete with all the objects it contains and their properties via the reporting system in WinCC (Report Designer).

You must first have set the print settings (such as page range) in the "Print Job Properties" dialog. To do this, go to the Graphics Designer and select the menu command "File" > "Project Documentation - Setup".

---

### Note

The project documentation will be output on the printer that was set up in the Report Designer. You can design the print layout to suit your needs with the aid of the Report Designer.

---

### syntax

*Expression*.PrintProjectDocumentation()

### Expression

Necessary. An expression or element which returns an object of the "Document" type.

### Parameters

--

### Example:

In the following example the project documentation for the active picture will be printed:

```
Sub ToPrintProjectDocumentation()  
'VBA178  
ActiveDocument.PrintProjectDocumentation  
End Sub
```

### See also

Document Object (Page 1949)

VBA Reference (Page 1745)

## Remove Method

### Description

Removes an object from a selection of objects or from a group object.

### syntax

*Expression*.Remove (Index)

### Expression

Necessary. An expression or element which returns an object of the "GroupedObjects" or "Selection" type.

### Parameters

Parameter (Data Type)	Description
Index (Variant)	<p>The name or index number of the object that is intended to be removed.</p> <p>You can use the Object Name as the name. As the index number you can use a numerical expression (from 1 up to the value of the Count property of the listing).</p> <p>If the entered value fails to match any element in the listing, this counts as an error.</p>

**Example:**

In the following example three objects will first be inserted in the active picture and selected. Then one object will be removed from the selection and the remaining objects will be grouped. Then the first object will be removed from the group object:

```
Sub RemoveObjectFromGroup()  
'VBA179  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objEllipse As HMIEllipse  
Dim objGroup As HMIGroup  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")  
With objCircle  
.Top = 30  
.Left = 0  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 42  
.Selected = True  
End With  
With objEllipse  
.Top = 48  
.Left = 162  
.Width = 40  
.BackColor = RGB(255, 0, 0)  
.Selected = True  
End With  
MsgBox "Objects selected!"  
Set objGroup = ActiveDocument.Selection.CreateGroup  
MsgBox "Group-object is created."  
objGroup.GroupedHMIObjects.Remove ("sEllipse")  
MsgBox "The ellipse is removed from group-object."  
End Sub
```

**See also**

[SelectedObjects object \(Listing\) \(Page 2060\)](#)  
[GroupedObjects Object \(Listing\) \(Page 1983\)](#)  
[VBA Reference \(Page 1745\)](#)

**Rotate Method****Description**

Rotates the object selected in the specified picture by 90° clockwise.



**syntax**

*Expression*.Rotate()

**Expression**

Necessary. An expression or element which returns an object of the "Selection" type.

**Parameters**

--

**Example:**

In the following example two objects will be inserted in the active picture and then grouped. The group object will then be rotated once:

```
Sub RotateGroupObject()  
'VBA180  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objGroup As HMIGroup  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
With objRectangle  
.Top = 30  
.Left = 30  
.Width = 80  
.Height = 40  
.Selected = True  
End With  
With objCircle  
.Top = 30  
.Left = 30  
.BackColor = RGB(255, 255, 255)  
.Selected = True  
End With  
MsgBox "Objects selected!"  
Set objGroup = ActiveDocument.Selection.CreateGroup  
MsgBox "Group-object created."  
objGroup.Selected = True  
ActiveDocument.Selection.Rotate  
End Sub
```

**See also**

VBA Reference (Page 1745)

SelectedObjects object (Listing) (Page 2060)

## SameHeight Method

### Description

Sets the "Height" property for all selected objects in the specified picture to the smallest available value.

### syntax

*Expression*.SameHeight ()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

**Example:**

In the following example three objects of different sizes will be inserted in the active picture. Then all objects will be selected and set to the same height:

```
Sub ApplySameHeightToSelectedObjects()  
'VBA181  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objEllipse As HMIEllipse  
Dim objGroup As HMIGroup  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")  
With objCircle  
.Top = 30  
.Left = 0  
.Height = 15  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 42  
.Height = 40  
.Selected = True  
End With  
With objEllipse  
.Top = 48  
.Left = 162  
.Width = 40  
.Height = 120  
.BackColor = RGB(255, 0, 0)  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.SameHeight  
End Sub
```

**See also**

[Height Property \(Page 2269\)](#)  
[SelectedObjects object \(Listing\) \(Page 2060\)](#)  
[VBA Reference \(Page 1745\)](#)

## SameWidth Method

### Description

Sets the "Width" property for all selected objects in the specified picture to the smallest available value.

### syntax

*Expression*.SameWidth()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

### Parameters

--

**Example:**

In the following example three objects of different sizes will be inserted in the active picture. Then all objects will be selected and set to the same width:

```
Sub ApplySameWidthToSelectedObjects()  
'VBA182  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objEllipse As HMIEllipse  
Dim objGroup As HMIGroup  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")  
With objCircle  
.Top = 30  
.Left = 0  
.Width = 15  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 42  
.Width = 40  
.Selected = True  
End With  
With objEllipse  
.Top = 48  
.Left = 162  
.Width = 120  
.BackColor = RGB(255, 0, 0)  
.Selected = True  
End With  
MsgBox "Objects selected!"  
ActiveDocument.Selection.SameWidth  
End Sub
```

**See also**

[Width Property \(Page 2553\)](#)  
[SelectedObjects object \(Listing\) \(Page 2060\)](#)  
[VBA Reference \(Page 1745\)](#)

**SameWidthAndHeight Method****Description**

Sets the "Height" and "Width" properties for all selected objects in the specified picture to the smallest available value.

**syntax**

*Expression*.SameWidthAndHeight ()

**Expression**

Necessary. An expression or element which returns an object of the "Selection" type.

**Parameters**

--

**Example:**

In the following example three objects of different sizes will be inserted in the active picture. Then all objects will be selected and set to the same height:

```
Sub ApplySameWidthAndHeightToSelectedObjects ()
'VBA183
Dim objCircle As HMICircle
Dim objRectangle As HMIRectangle
Dim objEllipse As HMIEllipse
Dim objGroup As HMIGroup
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")
With objCircle
.Top = 30
.Left = 0
.Height = 15
.Selected = True
End With
With objRectangle
.Top = 80
.Left = 42
.Width = 25
.Height = 40
.Selected = True
End With
With objEllipse
.Top = 48
.Left = 162
.Width = 40
.Height = 120
.BackColor = RGB(255, 0, 0)
.Selected = True
End With
MsgBox "Objects selected!"
ActiveDocument.Selection.SameWidthAndHeight
End Sub
```

**See also**

Width Property (Page 2553)  
Height Property (Page 2269)  
SelectedObjects object (Listing) (Page 2060)  
VBA Reference (Page 1745)

**Save Method****Description**

Saves the specified picture under its current name.

**syntax**

*Expression*.Save ( )

**Expression**

Necessary. An expression or element which returns an object of the "Document" type.

**Parameters**

--

**Example:**

In the following example the active picture in the Graphics Designer will be saved:

```
Sub SaveDocument ()  
    'VBA184  
    ActiveDocument.Save  
End Sub
```

**See also**

ActiveDocument Property (Page 2107)  
Document Object (Page 1949)  
VBA Reference (Page 1745)

## SaveAll Method

### Description

Saves all the open pictures in the Graphics Designer under their current names.

### syntax

*Expression*.SaveAll ()

#### Expression

Necessary. An expression or element which returns an object of the "Documents" type.

### Parameters

--

### Example:

In the following example all open pictures in the Graphics Designer are saved:

```
Sub SaveAllDocuments()  
    'VBA185  
    Application.Documents.SaveAll  
End Sub
```

### See also

Documents Object (Listing) (Page 1952)

VBA Reference (Page 1745)

## SaveAs Method

### Description

Saves the specified picture under a new name.

If a previously existing picture is to be overwritten, it must be ascertained prior to the SaveAs method call that this picture is permitted to be overwritten. You must inquire the LockedByCreatorID property of the picture to be overwritten to do so. Otherwise an error will be triggered in VBA.

### syntax

*Expression*.SaveAs (FileName)



**Expression**

Necessary. An expression or element which returns an object of the "Document" type.

**Parameters**

Parameter (Data Type)	Description
FileName (String)	The file name under which the picture is to be saved.

**Example:**

In the following example the active picture will be saved under the name "Test2.PDL":

```
Sub SaveDocumentAs ()
  'VBA186
  ActiveDocument.SaveAs ("Test2.PDL")
End Sub
```

**See also**

[LockedByCreatorID Property \(Page 2314\)](#)

[ActiveDocument Property \(Page 2107\)](#)

[Document Object \(Page 1949\)](#)

[VBA Reference \(Page 1745\)](#)

**SaveDefaultConfig Method****Description**

Saves the default settings for objects to a PDD file. The file is saved to the "GraCS" folder of the current project.

**syntax**

*Expression*.SaveDefaultConfig(FileName)

**Expression**

Necessary. An expression or element which returns an object of the "Application" type.

## Parameters

Parameter (Data Type)	Description
FileName (String)	The name of the PDD file.

## Example:

In the following example the default settings for objects are saved to the file "Test.PDD".

```
Sub SaveDefaultConfig()  
  'VBA187  
  Application.SaveDefaultConfig ("Test.PDD")  
End Sub
```

## See also

Application Object (Page 1909)  
LoadDefaultConfig Method (Page 1863)  
VBA Reference (Page 1745)

## SelectAll Method

### Description

Selects all the objects in the specified picture and adds them to the selection listing.

### syntax

*Expression*.SelectAll()

#### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

## Parameters

--

**Example:**

In the following example three objects will be inserted in the active picture and then selected.

```
Sub SelectAllObjectsInActiveDocument()  
'VBA188  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objEllipse As HMIEllipse  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")  
With objCircle  
.Top = 30  
.Left = 0  
.Height = 15  
End With  
With objRectangle  
.Top = 80  
.Left = 42  
.Width = 25  
.Height = 40  
End With  
With objEllipse  
.Top = 48  
.Left = 162  
.Width = 40  
.Height = 120  
.BackColor = RGB(255, 0, 0)  
End With  
ActiveDocument.Selection.SelectAll  
End Sub
```

**See also**

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

**SendToBack Method****Description**

Sends the selected objects right to the back within their current layer.

---

**Note**

If the "SendToBack" method is used, the sequence of HMI objects can change in the HMIObjects listing.

---

## Syntax

*Expression*.SendToBack()

### Expression

Necessary. An expression or element which returns an object of the "Selection" type.

## Parameters

--

## Example:

In the following example two objects are inserted in the active picture. The object inserted first is then sent to the back:

```
Sub SendObjectToBack()  
  'VBA197  
  Dim objCircle As HMICircle  
  Dim objRectangle As HMIRectangle  
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
  Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
  With objCircle  
    .Top = 40  
    .Left = 40  
    .Selected = False  
  End With  
  With objRectangle  
    .Top = 40  
    .Left = 40  
    .Width = 100  
    .Height = 50  
    .BackColor = RGB(255, 0, 255)  
    .Selected = True  
  End With  
  MsgBox "The objects circle and rectangle are created" & vbCrLf & "Only the rectangle is  
  selected!"  
  ActiveDocument.Selection.SendToBack  
  MsgBox "The selection is moved to the back."  
End Sub
```

## See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)

[VBA Reference \(Page 1745\)](#)

## SetCSLayerVisible Method

### Description

Shows or hides the specified CS layer.

### syntax

*Expression*.SetCSLayerVisible(Index, Val)

### Expression

Necessary. An expression or element which returns an object of the "View" type.

### Parameters

Parameter (Data Type)	Description
Index (Variant)	Defines the CS layer that is going to be shown or hidden. Value range from 1 up to 32.
Val (Boolean)	TRUE if the specified CS layer is intended to be visible.

### Example:

In the following example the second CS layer in the copy of the active picture is hidden (i.e. made invisible):

```
Sub SetCSLayerVisible()
  'VBA189
  Dim objView As HMIView
  Set objView = ActiveDocument.Views.Add
  objView.Activate
  objView.SetCSLayerVisible 2, False
End Sub
```

### See also

Document Object (Page 1949)  
 VBA Reference (Page 1745)  
 Editing Layers with VBA (Page 1657)

## SetOpenContext method

### Description

The SetOpenContext method sets the password. Password-protected process pictures can then be opened.

### Syntax

*Expression*.SetOpenContext (Password)

### Expression

Required. An expression or element which returns an object of the "Documents" type.

### Parameter

Parameter (Data Type)	Description
Password (String)	Password of the available picture.

### Example

Several pictures ("A.pdl", "B.pdl" und "C.pdl") are opened in the following example using the same password string "Test123". Enter the password for the pictures to open these. Terminate the SetOpenContext method with an empty string "" to prevent further access to the password.

```

Sub OpenProtectedPicture()
'VBA853
Documents.SetOpenContext ("Test123")
Documents.Open ("A.pdl")
Documents.Open ("B.pdl")
Documents.Open ("C.pdl")
Documents.SetOpenContext ("")
End Sub

```

## SetDeclutterObjectSize Method

### Description

Specifies the size area for fading in and out of objects in the specified picture. If height and width of the object are outside the specified size area, the objects are faded out.

The "ObjectSizeDecluttering" property must be set to TRUE.

**syntax**

*Expression*.SetDeclutterObjectSize (Min, Max)

**Expression**

Necessary. An expression or element which returns an object of the "Document" type.

**Parameters**

Parameter (Data Type)	Description
Min (Long)	Lower size range in pixels.
Max (Long)	Upper size range in pixels.

**Example:**

In the following example the settings for the lowest layer are configured in the active picture:

```
Sub ConfigureSettingsOfLayer ()
'VBA190
Dim objLayer As HMIlayer
Set objLayer = ActiveDocument.Layers(1)
With objLayer
'Configure "Layer 0"
.MinZoom = 10
.MaxZoom = 100
.Name = "Configured with VBA"
End With
'Define decluttering of objects:
With ActiveDocument
.LayerDecluttering = True
.ObjectSizeDecluttering = True
.SetDeclutterObjectSize 50, 100
End With
End Sub
```

**See also**

[ObjectSizeDecluttering Property \(Page 2350\)](#)

[Document Object \(Page 1949\)](#)

[VBA Reference \(Page 1745\)](#)

**SetRTLayervisible Method****Description**

Shows or hides the specified RT layer.

**syntax**

*Expression*.SetRTLayVisible (Index, Val)

**Expression**

Necessary. An expression or element which returns an object of the "Document" type.

**Parameters**

Parameter (Data Type)	Description
Index (Variant)	Defines the RT layer that is going to be shown or hidden. Value range from 1 to 32.
Val (Boolean)	TRUE if the specified RT layer is intended to be visible.

**Example:**

In the following example the first RT layer in the active picture will be made visible:

```
Sub SetRTLayVisibleWithVBA()
'VBA191
ActiveDocument.SetRTLayVisible 1, False
End Sub
```

**See also**

Document Object (Page 1949)

VBA Reference (Page 1745)

Editing Layers with VBA (Page 1657)

**ShowPropertiesDialog Method****Description**

Opens the "Object Properties" dialog.

**syntax**

*Expression*.ShowPropertiesDialog()

**Expression**

Necessary. An expression or element which returns an object of the "Application" type.



## Parameters

--

## Example:

In the following example the "Object Properties" dialog is opened:

```
Sub ShowPropertiesDialog()  
'VBA192  
Application.ShowPropertiesDialog  
End Sub
```

## See also

[Application Object \(Page 1909\)](#)

[VBA Reference \(Page 1745\)](#)

## ShowSymbolLibraryDialog Method

### Description

Opens the Components Library.

### syntax

*Expression*.ShowSymbolLibraryDialog()

#### Expression

Necessary. An expression or element which returns an object of the "Application" type.

## Parameters

--

## Example:

In the following example the Components Library is opened:

```
Sub ShowSymbolLibraryDialog()  
'VBA193  
Application.ShowSymbolLibraryDialog  
End Sub
```

## See also

Application Object (Page 1909)

VBA Reference (Page 1745)

## ShowTagDialog Method

### Description

Opens the "Tags" dialog.

### syntax

*Expression*.ShowTagDialog()

#### Expression

Necessary. An expression or element which returns an object of the "Application" type.

### Parameters

--

### Example:

In the following example the "Tags" dialog is opened:

```
Sub ShowTagDialog()  
    'VBA194  
    Application.ShowTagDialog  
End Sub
```

## See also

Application Object (Page 1909)

VBA Reference (Page 1745)

## TileWindowsHorizontally Method

### Description

Arranges all open pictures in the Graphics Designer so that they are tiled horizontally.

**syntax**

*Expression*.Method()

**Expression**

Necessary. An expression or element which returns an object of the "Application" type.

**Parameters**

--

**Example:**

In the following example all open pictures in the Graphics Designer are tiled horizontally. For this example to work, you must have opened a number of pictures in the Graphics Designer:

```
Sub TileWindowsHorizontally()  
'VBA195  
Application.TileWindowsHorizontally  
End Sub
```

**See also**

Application Object (Page 1909)

VBA Reference (Page 1745)

**TileWindowsVertically Method****Description**

Arranges all open pictures in the Graphics Designer so that they are tiled vertically.

**syntax**

*Expression*.Method()

**Expression**

Necessary. An expression or element which returns an object of the "Application" type.

**Parameters**

--

**Example:**

In the following example all open pictures in the Graphics Designer are tiled vertically. For this example to work, you must have opened a number of pictures in the Graphics Designer:

```
Sub TileWindowsVertically()  
'VBA196  
Application.TileWindowsVertically  
End Sub
```

**See also**

- Application Object (Page 1909)
- VBA Reference (Page 1745)

**TransformDisplayCoordinate method**

**Description**

Is used internally for PowerCC.

**TransformPixelCoordinate method**

**Description**

Is used internally for PowerCC.

**Ungroup Method**

**Description**

Ungroups a group object. The objects remain intact.

**syntax**

```
Expression.Ungroup (Parameter)
```

**Expression**

Necessary. An expression or element which returns an object of the "Group" type.

**Parameters**

--

**Example:**

In the following example three objects are created in the current picture and a group object is then created from them: The group object is then moved and ungrouped.

```
Sub DissolveGroup()  
'VBA199  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objEllipse As HMIEllipse  
Dim objGroup As HMIGroup  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")  
With objCircle  
.Top = 30  
.Left = 0  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 42  
.Selected = True  
End With  
With objEllipse  
.Top = 48  
.Left = 162  
.Width = 40  
.BackColor = RGB(255, 0, 0)  
.Selected = True  
End With  
MsgBox "Objects selected!"  
Set objGroup = ActiveDocument.Selection.CreateGroup  
MsgBox "Group-object is created."  
With objGroup  
.Left = 120  
.Top = 300  
MsgBox "Group-object is moved."  
.UnGroup  
MsgBox "Group is dissolved."  
End With  
End Sub
```

**See also**


[Group Object \(Page 1978\)](#)  
[CreateGroup Method \(Page 1829\)](#)  
[VBA Reference \(Page 1745\)](#)  
[Group Objects \(Page 1674\)](#)

## 3.6.1.7 Objects and Lists

## 0-9, A-C

## 3DBarGraph Object

## Description

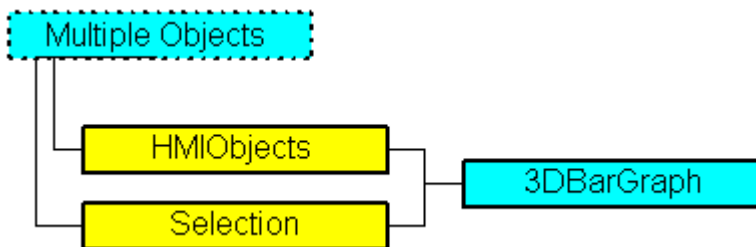

Represents the "3D Bar" object. The 3DBarGraph object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.

## VBA Object Name

HMI3DBarGraph

## Application

Use the Add method to create a new "3D Bar" object in a picture:

```

Sub Add3DBarGraph()
'VBA200
Dim obj3DBarGraph As HMI3DBarGraph
Set obj3DBarGraph = ActiveDocument.HMIObjects.AddHMIObject("3DBar", "HMI3DBarGraph")
End Sub
  
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where "Index" in this case identifies the object by name:

```

Sub Edit3DBarGraph()
'VBA201
Dim obj3DBarGraph As HMI3DBarGraph
Set obj3DBarGraph = ActiveDocument.HMIObjects("3DBar")
obj3DBarGraph.BorderColor = RGB(255, 0, 0)
End Sub
  
```

Use "Selection(Index)" to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA202  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## Object properties

The 3D Bar object possesses the following properties:

- AngleAlpha
- AngleBeta
- Application
- Axe
- BackColor
- Background
- BarDepth
- BarHeight
- BarWidth
- BaseX
- BaseY
- BorderColor
- BorderStyle
- BorderWidth
- Direction
- FillColor
- FillStyle
- GlobalColorScheme
- GlobalShadow
- GroupParent
- Height
- Layer
- Layer00Checked ... Layer10Checked
- Layer00Color ... Layer10Color
- Layer00FillColor ... Layer10FillColor

### 3.6 VBA Reference

- Layer00FillStyle ... Layer10FillStyle
- Layer00Value ... Layer10Value
- Left
- LightEffect
- Max.
- Min.
- ObjectName
- Operation
- Parent
- PasswordLevel
- PredefinedAngles
- Process
- Selected
- ShowBadTagState
- TabOrderAlpha
- TabOrderSwitch
- ToolTipText
- Top
- Transparency
- Type
- Visible
- Width
- ZeroPointValue

#### See also

SelectedObjects object (Listing) (Page 2060)  
HMIOBJECTS Object (Listing) (Page 1990)  
HMIDefaultObjects Object (Listing) (Page 1985)  
AddHMIObject Method (Page 1801)  
VBA Reference (Page 1745)  
Editing Objects with VBA (Page 1660)  
ZeroPointValue Property (Page 2559)  
Width Property (Page 2553)  
Visible Property (Page 2551)  
Top Property (Page 2446)




ToolTipText Property (Page 2445)  
Process Property (Page 2383)  
PredefinedAngels Property (Page 2381)  
PasswordLevel Property (Page 2362)  
Operation Property (Page 2353)  
Name Property (Page 2343)  
Min Property (Page 2340)  
Max Property (Page 2322)  
LightEffect Property (Page 2306)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
Layer00..10Value property (Page 2296)  
Height Property (Page 2269)  
Direction Property (Page 2213)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderColor Property (Page 2153)  
BaseY Property (Page 2147)  
BaseX Property (Page 2146)  
BarWidth Property (Page 2143)  
BarHeight Property (Page 2142)  
BarDepth Property (Page 2141)  
Background Property (Page 2140)  
Axe Property (Page 2129)  
AngleBeta Property (Page 2120)  
AngleAlpha Property (Page 2119)  
Layer00..10Checked property (Page 2293)  
Layer00..10Color property (Page 2294)  
Application Property (Page 2121)  
BackColor Property (Page 2131)  
FillColor Property (Page 2231)  
FillStyle Property (Page 2235)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)

- ObjectName Property (Page 2347)
- Parent Property (Page 2359)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Transparency property (Page 2447)
- Type Property (Page 2450)
- Layer00..10FillColor property (Page 2295)
- Layer00..10FillStyle property (Page 2295)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### Actions Object (Listing)

#### Description

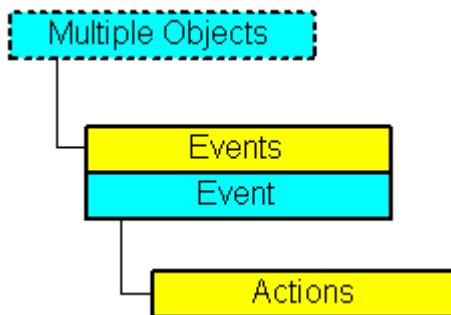

Displays a listing of the actions that are configured on an event.

#### VBA Object Name

HMIActions

## Usage

Use the `AddAction` method to configure one or more actions on an event. In this example a button and a circle will be inserted in the active picture. In runtime the radius of the circle enlarges every time you click the button:


```
Sub CreateVBActionToClickedEvent()  
'VBA203  
Dim objButton As HMIButton  
Dim objCircle As HMICircle  
Dim objVBScript As HMIScriptInfo  
Dim strVBCode As String  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_VB", "HMICircle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objCircle  
.Top = 100  
.Left = 100  
.BackColor = RGB(255, 0, 0)  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Text = "Increase Radius"  
End With  
'define event and assign sourcecode to it:  
Set objVBScript = objButton.Events(1).Actions.AddAction(hmiActionCreationTypeVBScript)  
strVBCode = "Dim myCircle" & vbCrLf & "Set myCircle = "  
strVBCode = strVBCode & "HMIruntime.ActiveScreen.ScreenItems(""Circle_VB"")"  
strVBCode = strVBCode & vbCrLf & "myCircle.Radius = myCircle.Radius + 5"  
With objVBScript  
.SourceCode = strVBCode  
End With  
End Sub
```

## See also

- [AddAction Method \(Page 1794\)](#)
- [Configuring Event-Driven Actions with VBA \(Page 1699\)](#)
- [Parent Property \(Page 2359\)](#)
- [Item Property \(Page 2283\)](#)
- [Count Property \(Page 2201\)](#)
- [Application Property \(Page 2121\)](#)

## ActiveXControl Object

### Description

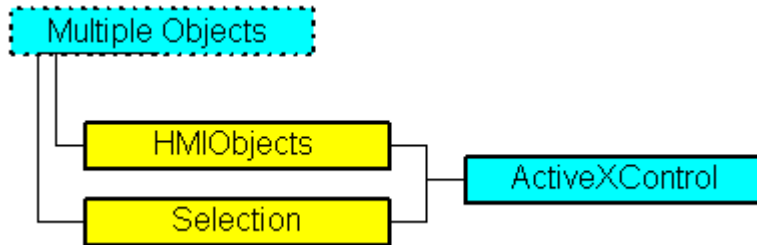

Represents the ActiveX Control object. The ActiveXControl object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.

### VBA Object Name

HMIActiveXControl

### Usage

Use the AddActiveXControl method to insert an ActiveX Control in a picture, for instance. In the following example the ActiveX Control "WinCC Gauge Control" is inserted in the active picture.

```
Sub AddActiveXControl()  
'VBA204  
Dim objActiveXControl As HMIActiveXControl  
Set objActiveXControl = ActiveDocument.HMIObjects.AddActiveXControl("WinCC_Gauge",  
"XGAUGE.XGaugeCtrl.1")  
With ActiveDocument  
.HMIObjects("WinCC_Gauge").Top = 40  
.HMIObjects("WinCC_Gauge").Left = 40  
End With  
End Sub
```

### See also

ServerName Property (Page 2415)  
AddActiveXControl Method (Page 1795)  
VBA Reference (Page 1745)  
ActiveX controls (Page 1671)

ProgID Property (Page 2386)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
Height Property (Page 2269)  
Layer Property (Page 2293)  
LDTooltipTexts Property (Page 2303)  
Left Property (Page 2305)  
ObjectName Property (Page 2347)  
Operation Property (Page 2353)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
ToolTipText Property (Page 2445)  
Top Property (Page 2446)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
Visible Property (Page 2551)  
Width Property (Page 2553)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## AdvancedAnalogDisplay object

### Description

Represents the "Analog Display (Advanced)" object. The "AdvancedAnalogDisplay" object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

## VBA Object Name

HMIAdvancedAnalogDisplay

## Application

Use the AddHMIObject method to create a new "Analog Display (Advanced)" object in a picture:

```
Sub AddAdvancedAnalogDisplay()  
'VBA857  
Dim objAdvancedAnalogDisplay As HMIAdvancedAnalogDisplay  
Set objAdvancedAnalogDisplay = ActiveDocument.HMIObjects.AddHMIObject("Analogdisplay1",  
"HMIAdvancedAnalogDisplay")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where "Index" in this case identifies the object by name:

```
Sub EditAdvancedAnalogDisplay()  
'VBA858  
Dim objAdvancedAnalogDisplay As HMIAdvancedAnalogDisplay  
Set objAdvancedAnalogDisplay = ActiveDocument.HMIObjects("Analogdisplay1")  
objAdvancedAnalogDisplay.BackColor_Simulation = RGB(255, 0, 0)  
End Sub
```

## See also

- AlarmGoneVisible property (Page 2114)
- AlignmentLeft Property (Page 2117)
- AlignmentTop Property (Page 2118)
- Application Property (Page 2121)
- BackColor Property (Page 2131)
- BackColor\_Alarm..\_Warning property (Page 2134)
- BackFillColor property (Page 2136)
- BackFillColor\_OK property (Page 2136)
- BackFillColor\_Simulation property (Page 2137)
- BackFillStyle property (Page 2137)
- BackFillStyle\_OK property (Page 2137)
- BackFillStyle\_Simulation property (Page 2137)
- BorderColor Property (Page 2153)
- BorderWidth Property (Page 2161)
- UseGlobalAlarmClasses property (Page 2465)

CBackColorOff..ColorOn property (Page 2169)  
CBackFlash property (Page 2170)  
CollectValue property (Page 2182)  
CornerRadius property (Page 2201)  
CQBackColorOff..ColorOn property (Page 2203)  
CQBackFlash property (Page 2203)  
CQTextColorOff..ColorOn property (Page 2203)  
CTextColorOff..ColorOn property (Page 2204)  
CQTextFlash property (Page 2204)  
CTextFlash property (Page 2204)  
EventQuitMask property (Page 2222)  
EnableFlashing property (Page 2221)  
Events Property (Page 2223)  
FontBold Property (Page 2256)  
FontItalic Property (Page 2257)  
FontName Property (Page 2257)  
FontSize Property (Page 2258)  
FontUnderline Property (Page 2259)  
ForeColor Property (Page 2260)  
Format property (Page 2263)  
ForeColor\_Alarm..\_Warning property (Page 2261)  
GlobalShadow property (Page 2264)  
GNQBackColorOff..ColorOn property (Page 2264)  
GNQBackFlash property (Page 2265)  
GNQTextColorOff..ColorOn property (Page 2265)  
GNQTextFlash property (Page 2265)  
GroupParent Property (Page 2268)  
Height Property (Page 2269)  
Layer Property (Page 2293)  
LDTooltipTexts Property (Page 2303)  
Left Property (Page 2305)  
MessageClass Property (Page 2339)  
ObjectName Property (Page 2347)  
Operation Property (Page 2353)  
Orientation Property (Page 2356)

### 3.6 VBA Reference

OutputValue property (Page 2359)  
PaintColor\_QualityCodeBad property (Page 2359)  
PaintColor\_QualityCodeUnCertain property (Page 2359)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
PrioAlarm..Warning property (Page 2383)  
PrioBit16..31 property (Page 2383)  
Properties Property (Page 2388)  
Relevant Property (Page 2398)  
Selected Property (Page 2412)  
ServerName Property (Page 2415)  
ShowBadTagState property (Page 2418)  
Simulation property (Page 2419)  
SimulationBit property (Page 2419)  
Tag property (Page 2435)  
tagname property (Page 2436)  
tagtype property (Page 2438)  
trend property (Page 2448)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
ToolTipText Property (Page 2445)  
Top Property (Page 2446)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
UseValueText property (Page 2469)  
Visible Property (Page 2551)  
Width Property (Page 2553)  
ConnectionPoints property (Page 2198)  
FlashState property (Page 2252)  
ConnectorObjects property (Page 2199)



## AdvancedStateDisplay object

### Description

Represents the "State Display (Advanced)" object. The "AdvancedStateDisplay" object is an element of the following listings:

- **Objects:** Contains all objects of a picture.
- **Selection:** Contains all selected objects of a picture.
- **HMIDefaultObjects:** Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIAdvancedStateDisplay

### Application

Use the AddHMIObject method to create a new "State Display (Advanced)" object in a picture:

```
Sub AddAdvancedStateDisplay()  
'VBA859  
Dim objAdvancedStateDisplay As HMIAdvancedStateDisplay  
Set objAdvancedStateDisplay = ActiveDocument.HMIObjects.AddHMIObject("Statedisplay1",  
"HMIAdvancedStateDisplay")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where "Index" in this case identifies the object by name:

```
Sub EditAdvancedStateDisplay()  
'VBA860  
Dim objAdvancedStateDisplay As HMIAdvancedStateDisplay  
Set objAdvancedStateDisplay = ActiveDocument.HMIObjects("Statedisplay1")  
objAdvancedStateDisplay.PaintColor_QualityCodeBad = RGB(255, 0, 0)  
End Sub
```

### See also

[UseGlobalAlarmClasses property \(Page 2465\)](#)

[EventQuitMask property \(Page 2222\)](#)

[TabOrderSwitch Property \(Page 2433\)](#)

[TabOrderAlpha Property \(Page 2429\)](#)

[Tag property \(Page 2435\)](#)

[tagname property \(Page 2436\)](#)

[tagtype property \(Page 2438\)](#)


### 3.6 VBA Reference

ToolTipText Property (Page 2445)  
Top Property (Page 2446)  
Transparency property (Page 2447)  
trend property (Page 2448)  
Type Property (Page 2450)  
UseEventState property (Page 2464)  
Visible Property (Page 2551)  
Width Property (Page 2553)  
Selected Property (Page 2412)  
ServerName Property (Page 2415)  
ShowBadTagState property (Page 2418)  
Properties Property (Page 2388)  
Relevant Property (Page 2398)  
Process property (Page 2384)  
Process1 property (Page 2384)  
Process2 property (Page 2385)  
Process3 property (Page 2385)  
PaintColor\_QualityCodeBad property (Page 2359)  
PaintColor\_QualityCodeUnCertain property (Page 2359)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
PrioAlarm..Warning property (Page 2383)  
PrioBit16..31 property (Page 2383)  
MaxIndex property (Page 2322)  
ObjectName Property (Page 2347)  
Operation Property (Page 2353)  
Layer Property (Page 2293)  
LDTooltipTexts Property (Page 2303)  
Left Property (Page 2305)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
Height Property (Page 2269)  
Index Property (Page 2276)  
Events Property (Page 2223)  
CollectValue property (Page 2182)

AlarmGoneVisible property (Page 2114)  
Application Property (Page 2121)  
BasePicture property (Page 2145)  
BitPosition0..3 property (Page 2149)  
BitSelect0..3 property (Page 2150)  
ConnectionPoints property (Page 2198)  
FlashPictureState property (Page 2245)  
NibbleSelect property (Page 2345)  
ConnectorObjects property (Page 2199)

## AnalogResultInfo Object

### Description

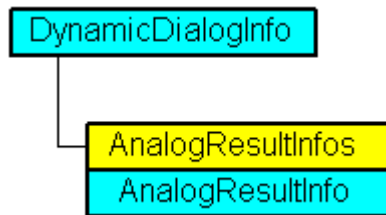

Displays an analog value range and associated property value in the Dynamic dialog. The AnalogResultInfo object is an element of the AnalogResultInfos listing:

### VBA Object Name

HMIAnalogResultInfo

### Usage


Use the AnalogResultInfo object to return an individual value range and property value. For a detailed example, please refer to "AnalogResultInfos Object (Listing)" in this documentation.

### See also

AnalogResultInfos Object (Listing) (Page 1908)  
Delete Method (Page 1831)  
Value Property (Page 2469)  
RangeTo Property (Page 2396)  
Parent Property (Page 2359)  
Application Property (Page 2121)

## AnalogResultInfos Object (Listing)

### Description

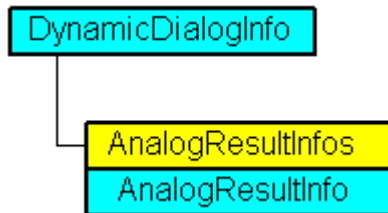

A listing of AnalogResultInfo objects that contain all the analog value ranges and the associated property value in the Dynamic dialog.

### VBA Object Name

HMIAnalogResultInfos

### Usage

Use the Add method to add a new value range in the Dynamic dialog. In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned and three analog value ranges will be created:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA206  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"'NewDynamic1'")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.Add 50, 40  
.AnalogResultInfos.Add 100, 80  
.AnalogResultInfos.ElseCase = 100  
End With  
End Sub
```

Use `AnalogResultInfos` to return the `AnalogResultInfos` listing. In this example the value ranges created in the above example will be output:

```
Sub ShowAnalogResultInfosOfCircleRadius()
'VBA207
Dim colAResultInfos As HMIAnalogResultInfos
Dim objAResultInfo As HMIAnalogResultInfo
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Dim iAnswer As Integer
Dim varRange As Variant
Dim varValue As Variant
Set objCircle = ActiveDocument.HMIObjects("Circle_A")
Set objDynDialog = objCircle.Radius.Dynamic
Set colAResultInfos = objDynDialog.AnalogResultInfos
For Each objAResultInfo In colAResultInfos
varRange = objAResultInfo.RangeTo
varValue = objAResultInfo.value
iAnswer = MsgBox("Ranges of values from Circle_A-Radius:" & vbCrLf & "Range of value to: " & varRange & vbCrLf & "Value of property: " & varValue, vbOKCancel)
If vbCancel = iAnswer Then Exit For
Next objAResultInfo
End Sub
```

## See also

[Add Method \(AnalogResultInfos Listing\) \(Page 1787\)](#)

[Parent Property \(Page 2359\)](#)

[Item Property \(Page 2283\)](#)


[ElseCase Property \(Page 2220\)](#)

[Count Property \(Page 2201\)](#)

[Application Property \(Page 2121\)](#)

## Application Object

### Description

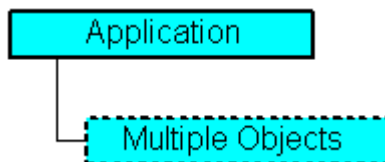

Represents the Graphics Designer editor. The Application object contains properties and methods that return objects from the top layer. For example `ActiveDocument` returns a Document object.

## VBA Object Name

HMIApplication

## Usage

Use Application to return the Application object. In the following example the application version is output:

```
Sub ShowApplicationVersion()  
  'VBA208  
  MsgBox Application.Version  
End Sub
```


## See also

- [ShowTagDialog Method \(Page 1890\)](#)
- [CurrentDesktopLanguage Property \(Page 2205\)](#)
- [TileWindowsVertically Method \(Page 1891\)](#)
- [TileWindowsHorizontally Method \(Page 1890\)](#)
- [ShowSymbolLibraryDialog Method \(Page 1889\)](#)
- [ShowPropertiesDialog Method \(Page 1888\)](#)
- [SaveDefaultConfig Method \(Page 1881\)](#)
- [LoadDefaultConfig Method \(Page 1863\)](#)
- [CascadeWindows Method \(Page 1814\)](#)
- [ArrangeMinimizedWindows Method \(Page 1811\)](#)
- [Activate Method \(Page 1785\)](#)
- [VBA Reference \(Page 1745\)](#)
- [WindowState Property \(Page 2557\)](#)
- [Visible Property \(Page 2551\)](#)
- [Version Property \(Page 2550\)](#)
- [VBE Property \(Page 2550\)](#)
- [VBAVersion Property \(Page 2549\)](#)
- [SymbolLibraries Property \(Page 2428\)](#)
- [ProjectType Property \(Page 2387\)](#)
- [ProjectName Property \(Page 2386\)](#)
- [ProfileName Property \(Page 2385\)](#)
- [Parent Property \(Page 2359\)](#)

Name Property (Page 2343)  
IsConnectedToProject Property (Page 2280)  
Documents Property (Page 2217)  
DefaultHMIObjects Property (Page 2210)  
CustomToolbars Property (Page 2208)  
CustomMenus Property (Page 2207)  
CurrentDataLanguage Property (Page 2204)  
ConfigurationFileName Property (Page 2198)  
AvailableDataLanguages Property (Page 2127)  
ApplicationDataPath Property (Page 2121)  
Application Property (Page 2121)  
ActiveDocument Property (Page 2107)  
CommandLine Property (Page 2196)  
DisableVBAEvents Property (Page 2214)  
AddIns property (Page 2113)  
CopyPasteSettings property (Page 2201)  
DisablePerformanceWarnings property (Page 2213)

## ApplicationWindow Object

### Description

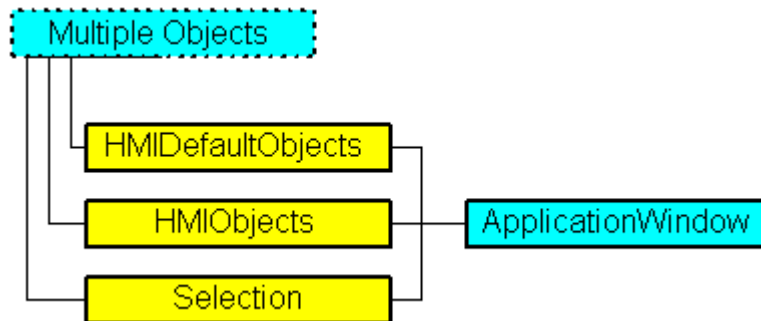

Represents the "Application Window" object. The ApplicationWindow object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

## VBA Object Name

HMIApplicationWindow

## Usage

Use the Add method to create a new "Application Window" object in a picture:

```
Sub AddApplicationWindow()  
'VBA209  
Dim objApplicationWindow As HMIApplicationWindow  
Set objApplicationWindow = ActiveDocument.HMIObjects.AddHMIObject("AppWindow",  
"HMIApplicationWindow")  
End Sub
```

Use "HMIObjects(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditApplicationWindow()  
'VBA210  
Dim objApplicationWindow As HMIApplicationWindow  
Set objApplicationWindow = ActiveDocument.HMIObjects("AppWindow")  
objApplicationWindow.Sizeable = True  
End Sub  
Use "Selection(Index)" to return an object from the Selection listing:  
Sub ShowNameOfFirstSelectedObject()  
'VBA211  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also


- Caption Property (Page 2168)
- SelectedObjects object (Listing) (Page 2060)
- HMIObjects Object (Listing) (Page 1990)
- HMIDefaultObjects Object (Listing) (Page 1985)
- AddHMIObject Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- WindowBorder Property (Page 2555)
- Width Property (Page 2553)
- Visible Property (Page 2551)



Top Property (Page 2446)  
Sizeable Property (Page 2421)  
OnTop Property (Page 2352)  
Name Property (Page 2343)  
Moveable Property (Page 2342)  
MaximizeButton Property (Page 2322)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
Height Property (Page 2269)  
CloseButton Property (Page 2182)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Operation Property (Page 2353)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
ToolTipText Property (Page 2445)  
ConnectionPoints property (Page 2198)  
Template property (Page 2438)  
ConnectorObjects property (Page 2199)

## BarGraph Object

### Description

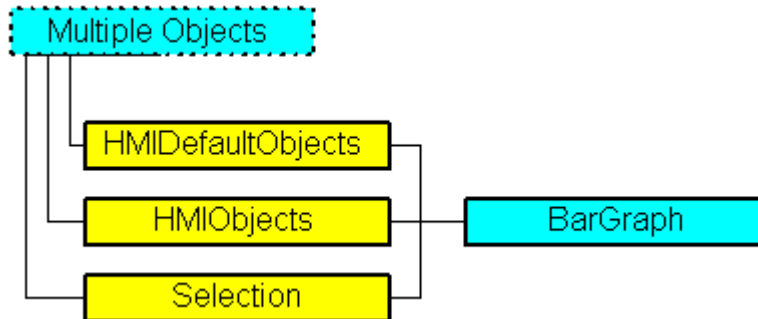

Represents the "Bar" object. The BarGraph object is an element of the following listings:

- HMIOBJECTS: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default settings of property values of all Standard, Windows and Smart objects.

### VBA Object Name

HMIBarGraph

### Application

Use the Add method to create a new "Bar" object in a picture:

```

Sub AddBarGraph()
'VBA212
Dim objBarGraph As HMIBarGraph
Set objBarGraph = ActiveDocument.HMIOBJECTS.AddHMIObject("Bar1", "HMIBarGraph")
End Sub
  
```

Use "HMIOBJECTS"(Index)" to return an object from the HMIOBJECTS listing, where "Index" in this case identifies the object by name:

```

Sub EditBarGraph()
'VBA213
Dim objBarGraph As HMIBarGraph
Set objBarGraph = ActiveDocument.HMIOBJECTS("Bar1")
objBarGraph.BorderColor = RGB(255, 0, 0)
End Sub
  
```

Use "Selection(Index)" to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA214  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

- TypeWarningHigh Property (Page 2458)
- Max Property (Page 2322)
- FillColor Property (Page 2231)
- BorderStyle Property (Page 2160)
- SelectedObjects object (Listing) (Page 2060)
- HMIObjects Object (Listing) (Page 1990)
- HMIDefaultObjects Object (Listing) (Page 1985)
- AddHMIOBJECT Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- ZeroPointValue Property (Page 2559)
- ZeroPoint Property (Page 2558)
- Width Property (Page 2553)
- WarningLow Property (Page 2553)
- WarningHigh Property (Page 2552)
- Visible Property (Page 2551)
- TypeWarningLow Property (Page 2459)
- TypeToleranceLow Property (Page 2457)
- TypeToleranceHigh Property (Page 2456)
- TypeLimitLow4 Property (Page 2454)
- TypeLimitHigh4 Property (Page 2453)
- TypeAlarmLow Property (Page 2452)
- TypeAlarmHigh Property (Page 2451)
- Trend Property (Page 2448)
- TrendColor Property (Page 2449)

### 3.6 VBA Reference


Top Property (Page 2446)  
ToolTipText Property (Page 2445)  
ToleranceLow Property (Page 2442)  
ToleranceHigh Property (Page 2442)  
ScalingType Property (Page 2406)  
Scaling Property (Page 2405)  
ScaleTicks Property (Page 2404)  
ScaleColor Property (Page 2403)  
RightComma Property (Page 2399)  
Process Property (Page 2383)  
PasswordLevel Property (Page 2362)  
Operation Property (Page 2353)  
Name Property (Page 2343)  
Min Property (Page 2340)  
Marker Property (Page 2321)  
LongStrokesTextEach Property (Page 2319)  
LongStrokesSize Property (Page 2319)  
LongStrokesOnly Property (Page 2318)  
LongStrokesBold Property (Page 2318)  
LimitLow4 Property (Page 2308)  
LimitHigh4 Property (Page 2307)  
Left Property (Page 2305)  
LeftComma Property (Page 2305)  
Layer Property (Page 2293)  
HysteresisRange Property (Page 2274)  
Hysteresis Property (Page 2273)  
Height Property (Page 2269)  
FontSize Property (Page 2258)  
FontName Property (Page 2257)  
FontBold Property (Page 2256)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)

Exponent Property (Page 2227)  
Direction Property (Page 2213)  
ColorWarningLow Property (Page 2193)  
ColorWarningHigh Property (Page 2192)  
ColorToleranceLow Property (Page 2190)  
ColorToleranceHigh Property (Page 2189)  
ColorLimitLow4 Property (Page 2187)  
ColorLimitHigh4 Property (Page 2186)  
ColorChangeType Property (Page 2185)  
ColorAlarmLow Property (Page 2183)  
ColorAlarmHigh Property (Page 2182)  
CheckWarningLow Property (Page 2179)  
CheckWarningHigh Property (Page 2178)  
CheckToleranceLow Property (Page 2177)  
CheckToleranceHigh Property (Page 2176)  
CheckLimitLow4 Property (Page 2174)  
CheckLimitHigh4 Property (Page 2172)  
CheckAlarmLow Property (Page 2171)  
CheckAlarmHigh Property (Page 2170)  
BorderWidth Property (Page 2161)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
BackColor3 Property (Page 2133)  
BackColor2 Property (Page 2133)  
AxisSection Property (Page 2130)  
Average Property (Page 2128)  
Alignment Property (Page 2116)  
AlarmLow Property (Page 2115)  
AlarmHigh Property (Page 2114)  
FillStyle2 Property (Page 2237)

- Application Property (Page 2121)
- Events Property (Page 2223)
- ObjectName Property (Page 2347)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Transparency property (Page 2447)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### BinaryResultInfo Object

#### Description

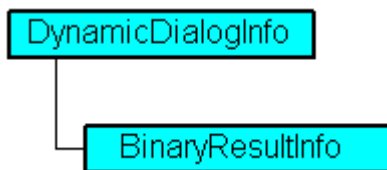

Displays both the binary (boolean) value ranges and the associated property values in the Dynamic dialog.

#### VBA Object Name

HMIBinaryResultInfo

## Usage

Use `BinaryResultInfo` to return the `BinaryResultInfo` object. In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned and the associated property values will be assigned to both the binary value ranges:


```
Sub AddDynamicDialogToCircleRadiusTypeBinary()
'VBA215
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_C", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"'NewDynamic1'")
With objDynDialog
.ResultType = hmiResultTypeBool
.BinaryResultInfo.NegativeValue = 20
.BinaryResultInfo.PositiveValue = 40
End With
End Sub
```

## See also

VBA Reference (Page 1745)  
PositiveValue Property (Page 2380)  
Parent Property (Page 2359)  
NegativeValue Property (Page 2344)  
Application Property (Page 2121)

## BitResultInfo Object

### Description

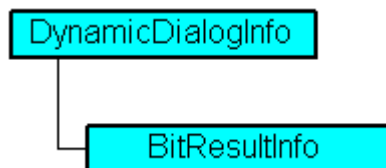

Displays both the value ranges for bit set/not set and the associated property values in the Dynamic dialog.

### VBA Object Name

HMIBitResultInfo

## Usage

Use `BitResultInfo` to return a `BitResultInfo` object. In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned, the bit to be set will be defined and the associated property values will be assigned to the "set"/"not set" states:

```
Sub AddDynamicDialogToCircleRadiusTypeBit()  
'VBA216  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_B", "HMICircle")  
'Tag "NewDynamic1" must exist  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeBit  
.BitResultInfo.BitNumber = 1  
.BitResultInfo.BitSetValue = 40  
.BitResultInfo.BitNotSetValue = 80  
End With  
End Sub
```


## See also

- [Delete Method \(Page 1831\)](#)
- [VBA Reference \(Page 1745\)](#)
- [BitSetValue Property \(Page 2150\)](#)
- [BitNumber Property \(Page 2148\)](#)
- [BitNotSetValue Property \(Page 2148\)](#)
- [Application Property \(Page 2121\)](#)
- [Parent Property \(Page 2359\)](#)



## Button Object

### Description

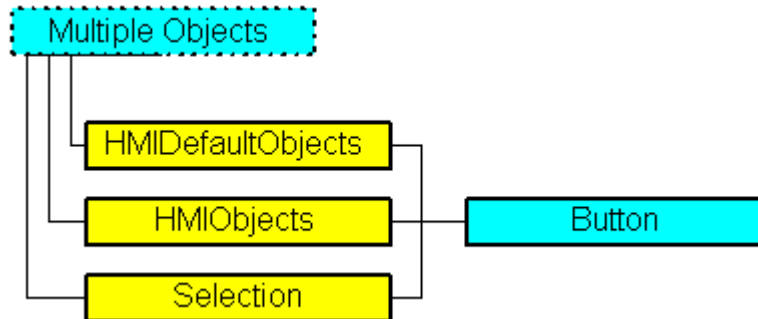

Represents the "Button" object. The Button object is an element of the following listings:

- HMIOjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default settings of property values of all Standard, Windows and Smart objects.

### VBA Object Name

HMIButton

### Application

Use the Add method to create a new "Button" object in a picture:

```

Sub AddButton()
'VBA217
Dim objButton As HMIButton
Set objButton = ActiveDocument.HMIOjects.AddHMIObject("Button", "HMIButton")
End Sub
  
```

Use "HMIOjects"(Index)" to return an object from the HMIOjects listing, where "Index" in this case identifies the object by name:

```

Sub EditButton()
'VBA218
Dim objButton As HMIButton
Set objButton = ActiveDocument.HMIOjects("Button")
objButton.BorderColor = RGB(255, 0, 0)
End Sub
  
```

Use "Selection(Index)" to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA219  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

### See also


- [ForeFlashColorOn Property \(Page 2262\)](#)
- [BorderColorBottom Property \(Page 2155\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIOBJECTS Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIOBJECT Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [Text Property \(Page 2439\)](#)
- [PictureUp Property \(Page 2374\)](#)
- [PictureDown Property \(Page 2372\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Orientation Property \(Page 2356\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)
- [Hotkey Property \(Page 2272\)](#)
- [Height Property \(Page 2269\)](#)
- [ForeFlashColorOff Property \(Page 2261\)](#)
- [ForeColor Property \(Page 2260\)](#)
- [FontUnderline Property \(Page 2259\)](#)

FontSize Property (Page 2258)  
FontName Property (Page 2257)  
FontItalic Property (Page 2257)  
FontBold Property (Page 2256)  
FlashRateForeColor Property (Page 2251)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashForeColor Property (Page 2242)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
FillingIndex Property (Page 2233)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
DisplayOptions Property (Page 2215)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColorTop Property (Page 2155)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
BackBorderWidth Property (Page 2131)  
AlignmentTop Property (Page 2118)  
AlignmentLeft Property (Page 2117)  
AdaptBorder Property (Page 2111)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDFonts Property (Page 2298)  
LDTexts Property (Page 2303)

- LDTooltipTexts Property (Page 2303)
- ObjectName Property (Page 2347)
- Parent Property (Page 2359)
- PicDownReferenced Property (Page 2367)
- PicDownTransparent Property (Page 2368)
- PicDownUseTransColor Property (Page 2369)
- PictAlignment property (Page 2370)
- PicUpReferenced Property (Page 2375)
- PicUpTransparent Property (Page 2376)
- PicUpUseTransColor Property (Page 2377)
- PicUseTransColor Property (Page 2377)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Transparency property (Page 2447)
- Type Property (Page 2450)
- WinCCStyle property (Page 2554)
- WindowsStyle property (Page 2557)
- DrawInsideFrame property (Page 2218)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### CheckBox Object

#### Description

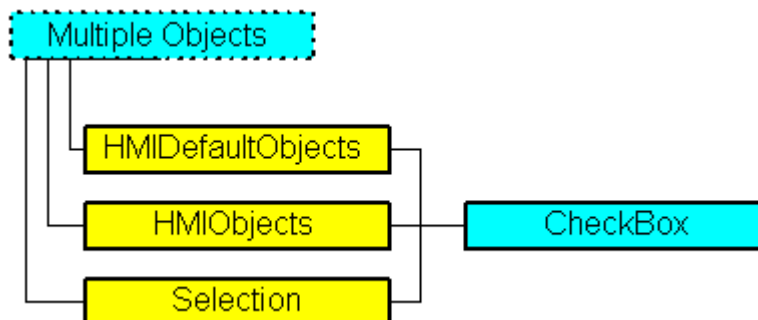

Represents the "Check Box" object. The CheckBox object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default settings of property values of all Standard, Windows and Smart objects.

## VBA Object Name

HMICheckBox

## Application

Use the Add method to create a new "Check Box" object in a picture:

```
Sub AddCheckBox()  
'VBA220  
Dim objCheckBox As HMICheckBox  
Set objCheckBox = ActiveDocument.HMIObjects.AddHMIObject("CheckBox", "HMICheckBox")  
End Sub
```

Use "HMIObjects(Index)" to return an object from the HMIObjects listing, where "Index" in this case identifies the object by name:

```
Sub EditCheckBox()  
'VBA221  
Dim objCheckBox As HMICheckBox  
Set objCheckBox = ActiveDocument.HMIObjects("CheckBox")  
objCheckBox.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection(Index)" to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA222  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

SelectedObjects object (Listing) (Page 2060)

HMIObjects Object (Listing) (Page 1990)

HMIDefaultObjects Object (Listing) (Page 1985)


### 3.6 VBA Reference

AddHMIOObject Method (Page 1801)  
VBA Reference (Page 1745)  
Editing Objects with VBA (Page 1660)  
Application Property (Page 2121)  
AdaptBorder Property (Page 2111)  
AlignmentLeft Property (Page 2117)  
AlignmentTop Property (Page 2118)  
BackColor Property (Page 2131)  
BackFlashColorOff Property (Page 2138)  
BackFlashColorOn Property (Page 2139)  
BorderBackColor Property (Page 2152)  
BorderColor Property (Page 2153)  
BorderFlashColorOff Property (Page 2157)  
BorderFlashColorOn Property (Page 2159)  
BorderStyle Property (Page 2160)  
BorderWidth Property (Page 2161)  
BoxAlignment Property (Page 2163)  
BoxCount Property (Page 2164)  
Events Property (Page 2223)  
FillColor Property (Page 2231)  
Filling Property (Page 2232)  
FillingIndex Property (Page 2233)  
FillStyle Property (Page 2235)  
FlashBackColor Property (Page 2239)  
FlashBorderColor Property (Page 2240)  
FlashForeColor Property (Page 2242)  
FlashRateBackColor Property (Page 2247)  
FlashRateBorderColor Property (Page 2249)  
FlashRateForeColor Property (Page 2251)  
FontBold Property (Page 2256)  
FontItalic Property (Page 2257)  
FontName Property (Page 2257)  
FontSize Property (Page 2258)  
FontUnderline Property (Page 2259)  
ForeColor Property (Page 2260)

ForeFlashColorOff Property (Page 2261)  
ForeFlashColorOn Property (Page 2262)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
Height Property (Page 2269)  
Index Property (Page 2276)  
Layer Property (Page 2293)  
LDFonts Property (Page 2298)  
LDTexts Property (Page 2303)  
LDTooltipTexts Property (Page 2303)  
Left Property (Page 2305)  
ObjectName Property (Page 2347)  
Operation Property (Page 2353)  
OperationMessage Property (Page 2354)  
Orientation Property (Page 2356)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
Process Property (Page 2383)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Text Property (Page 2439)  
ToolTipText Property (Page 2445)  
Top Property (Page 2446)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
Visible Property (Page 2551)  
Width Property (Page 2553)  
WindowsStyle property (Page 2557)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## Circle Object

### Description

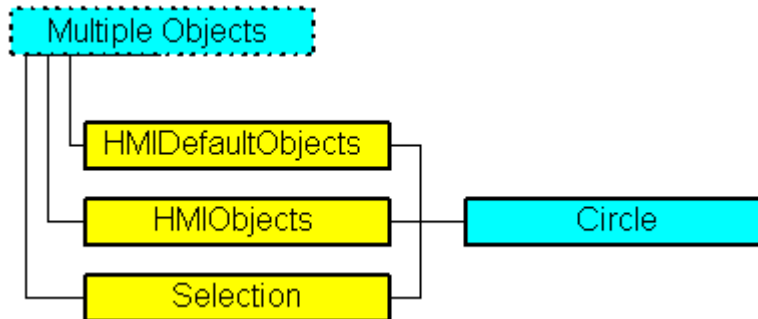

Represents the "Circle" object. The Circle object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMICircle

### Usage

Use the Add method to create a new "Circle" object in a picture:

```

Sub AddCircle()
'VBA223
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjets.AddHMIObject("Circle", "HMICircle")
End Sub
  
```

Use "HMIObjets"(Index)" to return an object from the HMIObjets listing, where Index in this case identifies the object by name:

```

Sub EditCircle()
'VBA224
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjets("Circle")
objCircle.BorderColor = RGB(255, 0, 0)
End Sub
  
```



Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA225  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also


- [FillColor Property \(Page 2231\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjets Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObjct Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [Radius Property \(Page 2394\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)
- [Height Property \(Page 2269\)](#)
- [FlashRateBorderColor Property \(Page 2249\)](#)
- [FlashRateBackColor Property \(Page 2247\)](#)
- [FlashBorderColor Property \(Page 2240\)](#)
- [FlashBackColor Property \(Page 2239\)](#)
- [FillStyle Property \(Page 2235\)](#)
- [FillingIndex Property \(Page 2233\)](#)
- [Filling Property \(Page 2232\)](#)
- [BorderWidth Property \(Page 2161\)](#)

3.6 VBA Reference

- BorderStyle Property (Page 2160)
- BorderFlashColorOn Property (Page 2159)
- BorderFlashColorOff Property (Page 2157)
- BorderColor Property (Page 2153)
- BorderBackColor Property (Page 2152)
- BackFlashColorOn Property (Page 2139)
- BackFlashColorOff Property (Page 2138)
- BackColor Property (Page 2131)
- Application Property (Page 2121)
- Events Property (Page 2223)
- GlobalColorScheme property (Page 2264)
- GlobalShadow property (Page 2264)
- GroupParent Property (Page 2268)
- LDTooltipTexts Property (Page 2303)
- ObjectName Property (Page 2347)
- Parent Property (Page 2359)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Transparency property (Page 2447)
- Type Property (Page 2450)
- DrawInsideFrame property (Page 2218)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

## CircularArc Object

### Description

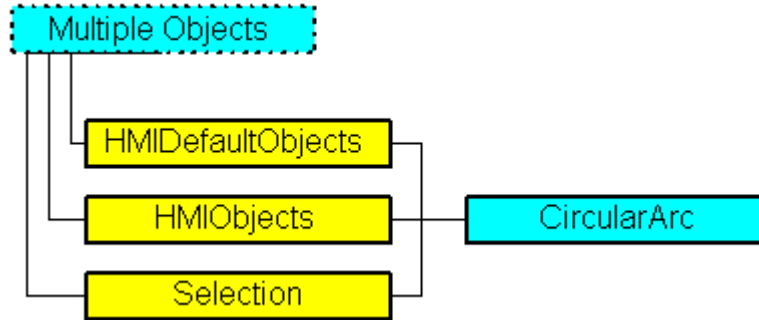

Represents the "Circular Arc" object. The CircularArc object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMICircularArc

### Usage

Use the Add method to create a new "Circular Arc" object in a picture:

```

Sub AddCiruarArc ()
'VBA226
Dim objCiruarArc As HMICircularArc
Set objCiruarArc = ActiveDocument.HMIObjects.AddHMIObject("CircularArc",
"HMICircularArc")
End Sub
  
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```

Sub EditCiruarArc ()
'VBA227
Dim objCiruarArc As HMICircularArc
Set objCiruarArc = ActiveDocument.HMIObjects("CircularArc")
objCiruarArc.BorderColor = RGB(255, 0, 0)
End Sub
  
```

### 3.6 VBA Reference

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA228  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

#### See also

- [HMIObjects Object \(Listing\) \(Page 1990\)](#)
- [BorderBackColor Property \(Page 2152\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObject Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [StartAngle Property \(Page 2426\)](#)
- [Radius Property \(Page 2394\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)
- [Height Property \(Page 2269\)](#)
- [FlashRateBorderColor Property \(Page 2249\)](#)
- [FlashBorderColor Property \(Page 2240\)](#)
- [EndAngle Property \(Page 2222\)](#)
- [BorderWidth Property \(Page 2161\)](#)
- [BorderStyle Property \(Page 2160\)](#)
- [BorderFlashColorOn Property \(Page 2159\)](#)
- [BorderFlashColorOff Property \(Page 2157\)](#)

BorderColor Property (Page 2153)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## Collection object

### Description


Allows access to a listing of objects of the same type, for example, "Documents" objects.

### See also

Application Property (Page 2121)  
Count Property (Page 2201)  
Item Property (Page 2283)  
Parent Property (Page 2359)

## ComboBox object

### Description

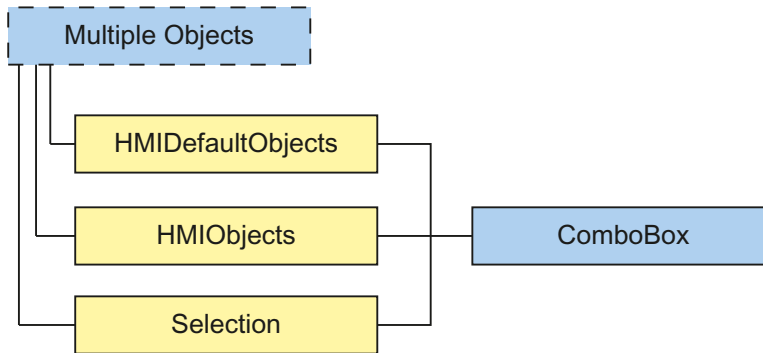

Represents the "ComboBox" object. The ComboBox object is an element of the following lists:

- HMIOObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all default, smart, window and tube objects.

### VBA object name

HMIComboBox

### Usage

Use the Add method to create a new "ComboBox" object in a picture:

```

Sub AddComboBox()
'VBA822
Dim objComboBox As HMIComboBox
Set objComboBox = ActiveDocument.HMIOObjects.AddHMIObject("ComboBox", "HMIComboBox")
End Sub
  
```

Use "HMIOObjects"(Index)" to return an object from the HMIOObjects listing, where Index in this case identifies the object by name:

```

Sub EditComboBox()
'VBA850
Dim objComboBox As HMIComboBox
Set objComboBox = ActiveDocument.HMIOObjects("ComboBox")
objComboBox.BorderColor = RGB(255, 0, 0)
End Sub
  
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA824  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```


## See also

- ObjectName Property (Page 2347)
- Left Property (Page 2305)
- Layer Property (Page 2293)
- Top Property (Page 2446)
- Width Property (Page 2553)
- Height Property (Page 2269)
- NumberLines Property (Page 2346)
- ForeColor Property (Page 2260)
- BorderColor Property (Page 2153)
- BorderBackColor Property (Page 2152)
- BackColor Property (Page 2131)
- BorderStyle Property (Page 2160)
- BorderWidth Property (Page 2161)
- FillColor Property (Page 2231)
- FillStyle Property (Page 2235)
- FontName Property (Page 2257)
- FontSize Property (Page 2258)
- FontBold Property (Page 2256)
- FontItalic Property (Page 2257)
- FontUnderline Property (Page 2259)
- AlignmentLeft Property (Page 2117)
- GlobalShadow property (Page 2264)
- Index Property (Page 2276)
- Text Property (Page 2439)
- Operation Property (Page 2353)

- PasswordLevel Property (Page 2362)
- Visible Property (Page 2551)
- ToolTipText Property (Page 2445)
- SelText property (Page 2414)
- SelIndex property (Page 2414)
- Application Property (Page 2121)
- Events Property (Page 2223)
- GlobalColorScheme property (Page 2264)
- GroupParent Property (Page 2268)
- LDFonts Property (Page 2298)
- LDTexts Property (Page 2303)
- LDTooltipTexts Property (Page 2303)
- Parent Property (Page 2359)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Type Property (Page 2450)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### ConnectionPoints Object (Listing)

#### Description

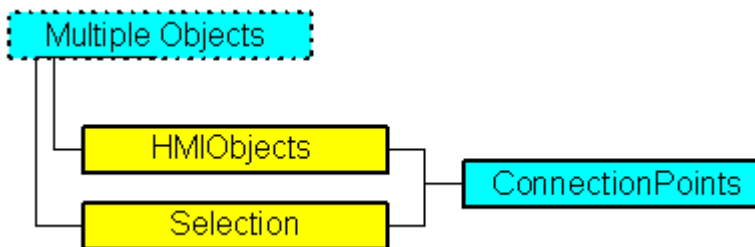

The listing returns the number of points to which the connector can be appended in the specified object.

#### VBA object name

HMIConnectionPoints



## Object properties

The ConnectionPoints object possesses the following properties:

- Application
- Count
- Item
- Parent

### Example 1

In this example, a rectangle is inserted and the number of connection points is output:

```
Sub CountConnectionPoints()
'VBA229
Dim objRectangle As HMIRectangle
Dim objConnPoints As HMIConnectionPoints
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")
Set objConnPoints = ActiveDocument.HMIObjects("Rectangle1").ConnectionPoints
MsgBox "Rectangle1 has " & objConnPoints.Count & " connectionpoints."
End Sub
```

### Example 2:

In this example, a text field is inserted and the connection points are accessed via "ConnectionPoints.Item". The coordinates of the connection points are shown in an output window.


```
Sub GetConnectionPoints()
'VBA825
Dim xPos As Long
Dim yPos As Long
Dim objConnPoints As HMIConnectionPoints

Set objDoc = Application.ActiveDocument
Set objObject = objDoc.HMIObjects.AddHMIObject("Text", "HMIStaticText")
Set objConnPoints = ActiveDocument.HMIObjects("Text").ConnectionPoints

For i = 1 To objConnPoints.Count
    xPos = objObject.ConnectionPoints.Item(i)(0)
    yPos = objObject.ConnectionPoints.Item(i)(1)
    MsgBox "Coordinates " & i & ". ConnectionPoint:" & Chr(13) & "x: " & xPos & Chr(13) &
    "y: " & yPos
Next

End Sub
```

The diagram below shows the positions of the 4 connection points of the text field.

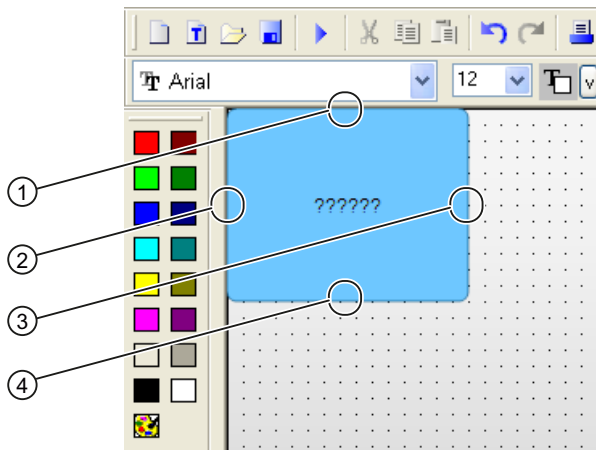

**Note**

If you activate the connection points of a connector with VBA, the connection point index begins with "1".

If you determine the connection points in the property window of the connector in the graphical interface, the connection point index begins with "0".

The index numbers e.g. of the lower connection point in the picture are assigned as follows:


- VBA: Index = 3
- Graphical interface: Index = 2

**See also**

- Parent Property (Page 2359)
- Item Property (Page 2283)
- Count Property (Page 2201)
- Application Property (Page 2121)

**CustomizedObject Object**

**Description**

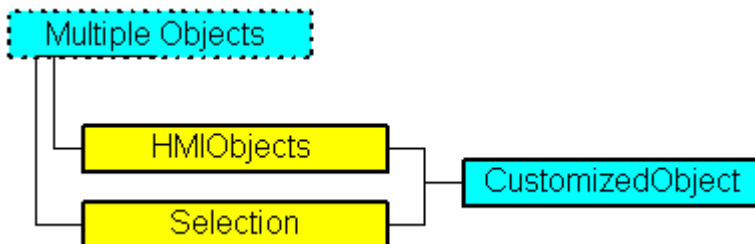

Represents the object called "Customized Object". The CustomizedObject object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.

In the case of the CustomizedObject object, the only properties that are available in the object are those that you have selected in the "Configuration" dialog for the customized object concerned.

---

**Note**

You cannot configure the CustomizedObject object with VBA.

---

Further information regarding customized objects can be found in the WinCC documentation under "Customized Object".

## VBA Object Name

HMICustomizedObject

## Application

Use the CreateCustomizedObject Method with the Selection listing to create a new "Customized Object" object in a picture:

```
Sub CreateCustomizedObject()  
'VBA230  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objCustomizedObject As HMICustomizedObject  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
With objCircle  
.Left = 10  
.Top = 10  
.Selected = True  
End With  
With objRectangle  
.Left = 50  
.Top = 50  
.Selected = True  
End With  
MsgBox "objects created and selected!"  
Set objCustomizedObject = ActiveDocument.Selection.CreateCustomizedObject  
objCustomizedObject.ObjectName = "Customer-Object"  
End Sub
```

### 3.6 VBA Reference

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where "Index" in this case identifies the object by name:

```
Sub EditCustomizedObject()  
    'VBA231  
    Dim objCustomizedObject As HMICustomizedObject  
    Set objCustomizedObject = ActiveDocument.HMIObjects("Customer-Object")  
    MsgBox objCustomizedObject.ObjectName  
End Sub
```

#### See also


- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjects Object \(Listing\) \(Page 1990\)](#)
- [Destroy Method \(Page 1835\)](#)
- [Delete Method \(Page 1831\)](#)
- [CreateCustomizedObject Method \(Page 1825\)](#)
- [How to Edit a Customized Object with VBA \(Page 1683\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Customized Objects \(Page 1682\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Application Property \(Page 2121\)](#)
- [Events Property \(Page 2223\)](#)
- [GroupParent Property \(Page 2268\)](#)
- [Height Property \(Page 2269\)](#)
- [InheritState property \(Page 2278\)](#)
- [Layer Property \(Page 2293\)](#)
- [LDTooltipTexts Property \(Page 2303\)](#)
- [Left Property \(Page 2305\)](#)
- [ObjectName Property \(Page 2347\)](#)
- [Operation Property \(Page 2353\)](#)
- [Parent Property \(Page 2359\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Properties Property \(Page 2388\)](#)
- [Selected Property \(Page 2412\)](#)
- [TabOrderSwitch Property \(Page 2433\)](#)
- [TabOrderAlpha Property \(Page 2429\)](#)

ToolTipText Property (Page 2445)  
 Top Property (Page 2446)  
 Type Property (Page 2450)  
 Visible Property (Page 2551)  
 Width Property (Page 2553)  
 ConnectionPoints property (Page 2198)  
 HMIUdoObjects property (Page 2272)  
 ConnectorObjects property (Page 2199)

## D-I

### DataLanguage Object

#### Description

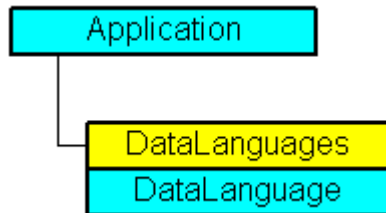

Represents the installed project language, which is identified by its name and language identifier. The DataLanguage object is an element of the DataLanguages listing:

The list of language codes is available in the WinCC documentation (Index > Language Code). The hexadecimal value specified in the list has to be converted to its equivalent decimal value.

#### VBA Object Name

HMIDataLanguage

#### Usage

Use the DataLanguages property to return an individual DataLanguage object. In the following example the first installed project language is output:

```


Sub ShowFirstObjectOfCollection()
'VBA232
Dim strName As String
strName = ActiveDocument.Application.AvailableDataLanguages(1).LanguageName
MsgBox strName
End Sub
  
```

**See also**

- DataLanguages Object (Listing) (Page 1942)
- VBA Reference (Page 1745)
- Language-Dependent Configuration with VBA (Page 1624)
- Parent Property (Page 2359)
- LanguageName Property (Page 2290)
- LanguageID Property (Page 2289)
- Application Property (Page 2121)

**DataLanguages Object (Listing)**

**Description**

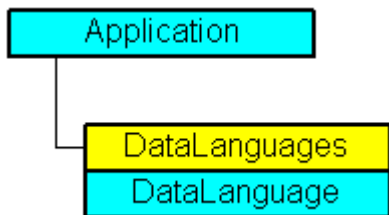

A listing of the DataLanguage objects that represent all the installed project languages.

**VBA Object Name**

HMIDataLanguages

## Usage

Use the `AvailableDataLanguages` property to return the `DataLanguages` listing. In the following example the installed project language is output:

```
Sub ShowDataLanguage()  
'VBA233  
Dim colDataLanguages As HMIDataLanguages  
Dim objDataLanguage As HMIDataLanguage  
Dim strLanguages As String  
Dim iCount As Integer  
iCount = 0  
Set colDataLanguages = Application.AvailableDataLanguages  
For Each objDataLanguage In colDataLanguages  
If "" <> strLanguages Then strLanguages = strLanguages & "/"  
strLanguages = strLanguages & objDataLanguage.LanguageName & " "  
'Every 15 items of datalanguages output in a messagebox  
If 0 = iCount Mod 15 And 0 <> iCount Then  
MsgBox strLanguages  
strLanguages = ""  
End If  
iCount = iCount + 1  
Next objDataLanguage  
MsgBox strLanguages  
End Sub
```

## See also

[Language-Dependent Configuration with VBA \(Page 1624\)](#)

[DataLanguage Object \(Page 1941\)](#)

[Item Method \(Page 1859\)](#)

[VBA Reference \(Page 1745\)](#)

[Parent Property \(Page 2359\)](#)

[Count Property \(Page 2201\)](#)

[Application Property \(Page 2121\)](#)

## DataSetObj object

### Description

The "DataSetObj" object serves as a container for the internal storage of data of the user objects or faceplate types. The DataSetObj object is an element of the following listings:

- **Objects:** Contains all objects of a picture.
- **Selection:** Contains all selected objects of a picture.

## VBA Object Name

HMIDDataSetObj


## See also

Application Property (Page 2121)  
ConnectionPoints property (Page 2198)  
Events Property (Page 2223)  
GroupParent Property (Page 2268)  
Height Property (Page 2269)  
Layer Property (Page 2293)  
LDFonts Property (Page 2298)  
Left Property (Page 2305)  
ObjectName Property (Page 2347)  
Operation Property (Page 2353)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
ToolTipText Property (Page 2445)  
Top Property (Page 2446)  
Type Property (Page 2450)  
Visible Property (Page 2551)  
Width Property (Page 2553)  
ConnectorObjects property (Page 2199)



**DestLink Object**

**Description**

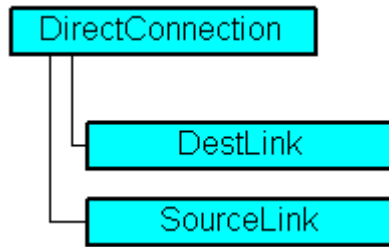

Represents the destination for a direct connection.

**VBA Object Name**

HMIDestLink


## Usage

Use the `DestinationLink` property to return the `DestLink` object. In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:

```
Sub DirectConnection()  
  'VBA234  
  Dim objButton As HMIButton  
  Dim objRectangleA As HMIRectangle  
  Dim objRectangleB As HMIRectangle  
  Dim objEvent As HMIEvent  
  Dim objDirConnection As HMIDirectConnection  
  Set objRectangleA = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A", "HMIRectangle")  
  Set objRectangleB = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
  With objRectangleA  
    .Top = 100  
    .Left = 100  
  End With  
  With objRectangleB  
    .Top = 250  
    .Left = 400  
    .BackColor = RGB(255, 0, 0)  
  End With  
  With objButton  
    .Top = 10  
    .Left = 10  
    .Width = 90  
    .Height = 50  
    .Text = "SetPosition"  
  End With  
  '  
  'Directconnection is initiated on mouseclick:  
  Set objDirConnection =  
  objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectConnection)  
  With objDirConnection  
    'Sourceobject: Property "Top" of "Rectangle_A"  
    .SourceLink.Type = hmiSourceTypeProperty  
    .SourceLink.ObjectName = "Rectangle_A"  
    .SourceLink.AutomationName = "Top"  
    '  
    'Targetobject: Property "Left" of "Rectangle_B"  
    .DestinationLink.Type = hmiDestTypeProperty  
    .DestinationLink.ObjectName = "Rectangle_B"  
    .DestinationLink.AutomationName = "Left"  
  End With  
End Sub
```

**See also**

DirectConnection Object (Page 1947)  
VBA Reference (Page 1745)  
Type Property (Page 2450)  
ObjectName Property (Page 2347)  
AutomationName Property (Page 2124)  
Parent Property (Page 2359)

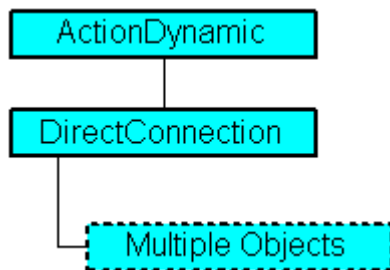**DirectConnection Object****Description**

Represents a direct connection.

**VBA Object Name**

HMIDirectConnection

## Usage

Use the `DestinationLink` and `SourceLink` properties to configure the source and destination of a direct connection. In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:

```
Sub DirectConnection()  
'VBA235  
Dim objButton As HMIButton  
Dim objRectangleA As HMIRectangle  
Dim objRectangleB As HMIRectangle  
Dim objEvent As HMIEvent  
Dim objDirConnection As HMIDirectConnection  
Set objRectangleA = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A", "HMIRectangle")  
Set objRectangleB = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objRectangleA  
.Top = 100  
.Left = 100  
End With  
With objRectangleB  
.Top = 250  
.Left = 400  
.BackColor = RGB(255, 0, 0)  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 90  
.Height = 50  
.Text = "SetPosition"  
End With  
,  
'Directconnection is initiated on mouseclick:  
Set objDirConnection =  
objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectConnection)  
With objDirConnection  
'Sourceobject: Property "Top" of "Rectangle_A"  
.SourceLink.Type = hmiSourceTypeProperty  
.SourceLink.ObjectName = "Rectangle_A"  
.SourceLink.AutomationName = "Top"  
,  
'Targetobject: Property "Left" of "Rectangle_B"  
.DestinationLink.Type = hmiDestTypeProperty  
.DestinationLink.ObjectName = "Rectangle_B"  
.DestinationLink.AutomationName = "Left"  
End With  
End Sub
```

## See also

DestinationLink Property (Page 2211)

SourceLink Object (Page 2065)

DestLink Object (Page 1945)

VBA Reference (Page 1745)


SourceLink Property (Page 2422)

Application Property (Page 2121)

Parent Property (Page 2359)

## Document Object

### Description

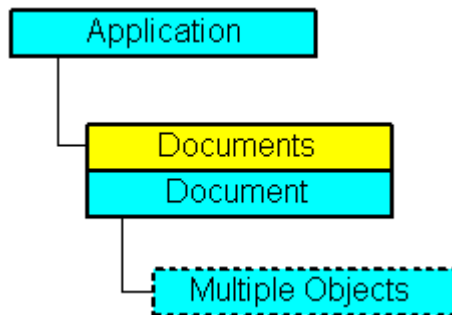

Displays a picture in Graphics Designer. The document object is an element of the documents listing.

### VBA Object Name

HMIDocument

### Usage

Use Documents(Index) to return an individual document object. In the following example the file name of the first picture is displayed:

```
Sub ShowFirstObjectOfCollection()  
'VBA236  
Dim strName As String  
strName = Application.Documents(3).Name  
MsgBox strName  
End Sub
```

### 3.6 VBA Reference

You may also use the object "Me" if you wish to address the current document:

```
Sub ShowDocumentName()  
'VBA812  
Dim obj As Document  
set obj = Me  
MsgBox obj.Name  
End Sub
```

For example, use the SaveAs method to save the picture under a different name. In the following example the first picture will be saved under the name "CopyOfPicture1":

```
Sub SaveDocumentAs()  
'VBA237  
Application.Documents(3).SaveAs ("CopyOfPicture1")  
End Sub
```

#### See also


- [Editing Pictures with VBA \(Page 1654\)](#)
- [GridHeight Property \(Page 2267\)](#)
- [Documents Object \(Listing\) \(Page 1952\)](#)
- [SetRTLayVisible Method \(Page 1887\)](#)
- [SaveAs Method \(Page 1880\)](#)
- [Save Method \(Page 1879\)](#)
- [PrintProjectDocumentation Method \(Page 1870\)](#)
- [PasteClipboard Method \(Page 1868\)](#)
- [MoveSelection Method \(Page 1865\)](#)
- [IsRTLayVisible Method \(Page 1858\)](#)
- [Export Method \(Page 1840\)](#)
- [CopySelection Method \(Page 1823\)](#)
- [Close Method \(Page 1818\)](#)
- [VBA Reference \(Page 1745\)](#)
- [ExtendedZoomingEnable Property \(Page 2228\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Views Property \(Page 2550\)](#)
- [UpdateCycle Property \(Page 2463\)](#)
- [TabOrderOtherAction Property \(Page 2432\)](#)

TabOrderMouse Property (Page 2432)  
TabOrderKeyboard Property (Page 2431)  
TabOrderAllHMIOBJECTS Property (Page 2430)  
SnapToGrid Property (Page 2422)  
HMIDefaultObjects Object (Listing) (Page 1985)  
Selection Property (Page 2413)  
Properties Property (Page 2388)  
Path Property (Page 2363)  
PasswordLevel Property (Page 2362)  
Parent Property (Page 2359)  
Operation Property (Page 2353)  
Name Property (Page 2343)  
LockedByCreatorID Property (Page 2314)  
LastChange Property (Page 2292)  
HMIOBJECTS Property (Page 2272)  
Hide Property (Page 2270)  
Height Property (Page 2269)  
GridWidth Property (Page 2267)  
GridColor Property (Page 2266)  
Grid Property (Page 2265)  
FillStyle Property (Page 2235)  
Events Property (Page 2223)  
CustomToolbars Property (Page 2208)  
CustomMenus Property (Page 2207)  
CursorMode Property (Page 2206)  
BackColor Property (Page 2131)  
Application Property (Page 2121)  
BackPictureAlignment property (Page 2141)  
BackPictureName property (Page 2141)  
CommonVBSCODE Property (Page 2194)  
CommonVBSEventArea property (Page 2195)  
CommonVBSPropertyArea property (Page 2196)  
GlobalColorScheme property (Page 2264)  
LayerDecluttering Property (Page 2296)  
Layers Property (Page 2297)

- Modified Property (Page 2341)
- ObjectSizeDecluttering Property (Page 2350)
- PdIProtection property (Page 2364)
- GetDeclutterObjectSize method (Page 1830)
- SetDeclutterObjectSize Method (Page 1886)
- FireConnectionEvents method (Page 1843)
- TransformDisplayCoordinate method (Page 1892)
- TransformPixelCoordinate method (Page 1892)
- FillBackColor property (Page 2231)

### Documents Object (Listing)

#### Description

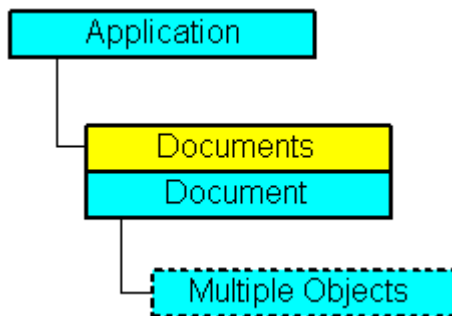

#### VBA Object Name

HMIDocuments

#### Usage

---

##### Note

Use the "ActiveDocument" property if you wish to refer to the active picture.

---



Use the Documents property to return the Documents listing. In the following example the names of all open pictures are output:

```
Sub ShowDocuments()  
'VBA238  
Dim colDocuments As Documents  
Dim objDocument As Document  
Set colDocuments = Application.Documents  
For Each objDocument In colDocuments  
MsgBox objDocument.Name  
Next objDocument  
End Sub
```

Use the Add method to add a new Document object to the Documents listing. In the following example a new picture is created:

```
Sub AddNewDocument()  
'VBA239  
Dim objDocument As Document  
Set objDocument = Application.Documents.Add  
End Sub
```

## See also

- [Add Method \(Page 1786\)](#)
- [Document Object \(Page 1949\)](#)
- [SaveAll Method \(Page 1880\)](#)
- [Open Method \(Page 1867\)](#)
- [CloseAll Method \(Page 1819\)](#)
- [Close Method \(Page 1818\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Pictures with VBA \(Page 1654\)](#)
- [Parent Property \(Page 2359\)](#)
- [Count Property \(Page 2201\)](#)
- [Application Property \(Page 2121\)](#)
- [ActiveDocument Property \(Page 2107\)](#)
- [Item Property \(Page 2283\)](#)
- [SetOpenContext method \(Page 1886\)](#)
- [ConvertWM method \(Page 1822\)](#)

## DotNetControl object

### Description

Represents the "DotNetControl" object. The DotNetControl object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.

### VBA Object Name

HMIDotNetControl

### Application

Use the AddDotNetControl method to insert a DotNetControl in a picture.

In the following example, the ".NETControl" object from the Global Assembly Cache is inserted in the active picture.

```
'VBA851
Dim DotNetControl As HMIDotNetControl
Set DotNetControl = ActiveDocument.HMIObjects.AddDotNetControl("MyVBAControl",
"System.Windows.Forms.Label", True, "Assembly=System.Windows.Forms, Version=2.0.0.0,
Culture=neutral, PublicKeyToken=b77a5c561934e089")
```


### See also

[AddDotNetControl method \(Page 1797\)](#)  
[Delete Method \(Page 1831\)](#)  
[Application Property \(Page 2121\)](#)  
[AssemblyInfo property \(Page 2122\)](#)  
[ControlType property \(Page 2201\)](#)  
[Events Property \(Page 2223\)](#)  
[GroupParent Property \(Page 2268\)](#)  
[Height Property \(Page 2269\)](#)  
[Layer Property \(Page 2293\)](#)  
[LDTooltipTexts Property \(Page 2303\)](#)  
[Left Property \(Page 2305\)](#)  
[ObjectName Property \(Page 2347\)](#)  
[Operation Property \(Page 2353\)](#)  
[Parent Property \(Page 2359\)](#)

PasswordLevel Property (Page 2362)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
ToolTipText Property (Page 2445)  
Top Property (Page 2446)  
Type Property (Page 2450)  
Visible Property (Page 2551)  
Width Property (Page 2553)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## DynamicDialog Object

### Description

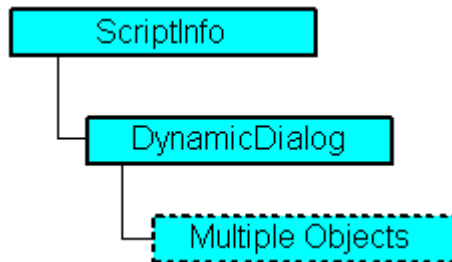

Represents the Dynamic dialog. You can use the dynamic dialog to make the properties of pictures and objects respond dynamically to different value ranges.

Define the value range with the aid of the ResultType property.

### VBA Object Name

HMIDynamicDialog

## Usage

Use the DynamicDialog object to make an object property dynamic. In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned and three analog value ranges will be created:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA240  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.Trigger.VariableTriggers.Add "NewDynamic2", hmiVariableCycleType_5s  
.AnalogResultInfos.Add 50, 40  
.AnalogResultInfos.Add 100, 80  
.AnalogResultInfos.ElseCase = 100  
End With  
End Sub
```

## See also

- Delete Method (Page 1831)
- ConvertToScript Method (Page 1820)
- CheckSyntax Method (Page 1817)
- VariableStateValues Property (Page 2546)
- VariableStateChecked Property (Page 2545)
- Trigger Property (Page 2449)
- SourceCode Property (Page 2424)
- ScriptType Property (Page 2407)
- ResultType Property (Page 2399)
- Parent Property (Page 2359)
- Compiled Property (Page 2197)
- BitResultInfo Property (Page 2149)
- BinaryResultInfo Property (Page 2147)
- Application Property (Page 2121)
- AnalogResultInfos Property (Page 2118)
- Prototype Property (Page 2389)
- QualityCodeStateChecked Properties (Page 2390)
- QualityCodeStateValues Property (Page 2392)

UsedLanguage property (Page 2464)


VariablesExist Property (Page 2544)

VariableStateType Property (Page 2546)

ConvertToVBScript method (Page 1821)

## Ellipse Object

### Description

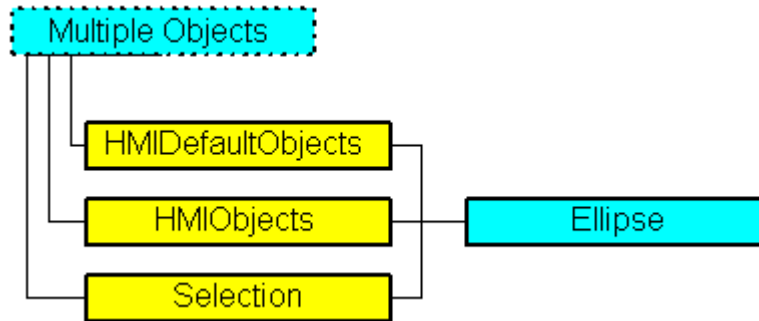

Represents the "Ellipse" object. The Ellipse object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIEllipse

### Usage

Use the Add method to create a new "Ellipse" object in a picture:

```
Sub AddEllipse()
  'VBA241
  Dim objEllipse As HMIEllipse
  Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("Ellipse", "HMIEllipse")
End Sub
```

### 3.6 VBA Reference

Use "HMIObjets"(Index)" to return an object from the HMIObjets listing, where Index in this case identifies the object by name:

```
Sub EditEllipse()  
'VBA242  
Dim objEllipse As HMIEllipse  
Set objEllipse = ActiveDocument.HMIObjets("Ellipse")  
objEllipse.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing.

```
Sub ShowNameOfFirstSelectedObject()  
'VBA243  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```


#### See also

- FillingIndex Property (Page 2233)
- SelectedObjects object (Listing) (Page 2060)
- HMIObjets Object (Listing) (Page 1990)
- HMIDefaultObjects Object (Listing) (Page 1985)
- AddHMIObjets Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- Width Property (Page 2553)
- Visible Property (Page 2551)
- Top Property (Page 2446)
- ToolTipText Property (Page 2445)
- RadiusWidth Property (Page 2395)
- RadiusHeight Property (Page 2394)
- PasswordLevel Property (Page 2362)
- Operation Property (Page 2353)
- Left Property (Page 2305)
- Layer Property (Page 2293)
- Height Property (Page 2269)

FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## EllipseArc Object

### Description

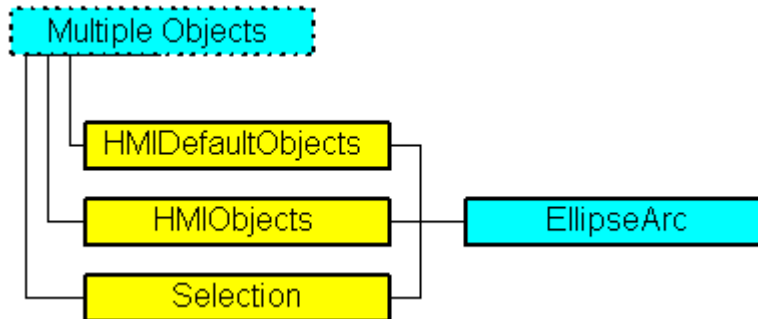

Represents the "Ellipse Arc" object. The EllipseArc object is an element of the following listings:

- HMIOBJECTS: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIEllipseArc

### Usage

Use the Add method to create a new "Ellipse Arc" object in a picture:

```

Sub AddEllipseArc()
'VBA244
Dim objEllipseArc As HMIEllipseArc
Set objEllipseArc = ActiveDocument.HMIOBJECTS.AddHMIObject("EllipseArc", "HMIEllipseArc")
End Sub
  
```

Use "HMIOBJECTS(Index)" to return an object from the HMIOBJECTS listing, where Index in this case identifies the object by name:

```

Sub EditEllipseArc()
'VBA245
Dim objEllipseArc As HMIEllipseArc
Set objEllipseArc = ActiveDocument.HMIOBJECTS("EllipseArc")
objEllipseArc.BorderColor = RGB(255, 0, 0)
End Sub
  
```



Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA246  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

Use the "HMIDefaultObjects(Index)" to return an object from the HMIDefaultObjects Listing:

```
Sub EditDefaultPropertiesOfEllipseArc()  
'VBA247  
Dim objEllipseArc As HMIEllipseArc  
Set objEllipseArc = Application.DefaultHMIObjects("HMIEllipseArc")  
objEllipseArc.BorderColor = RGB(255, 255, 0)  
'create new "EllipseArc"-object  
Set objEllipseArc = ActiveDocument.HMIObjects.AddHMIObject("EllipseArc2", "HMIEllipseArc")  
End Sub
```

## See also


- [ToolTipText Property \(Page 2445\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjects Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObject Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [StartAngle Property \(Page 2426\)](#)
- [RadiusWidth Property \(Page 2395\)](#)
- [RadiusHeight Property \(Page 2394\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)
- [Height Property \(Page 2269\)](#)

### 3.6 VBA Reference

FlashRateBorderColor Property (Page 2249)  
FlashBorderColor Property (Page 2240)  
EndAngle Property (Page 2222)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## EllipseSegment Object

### Description

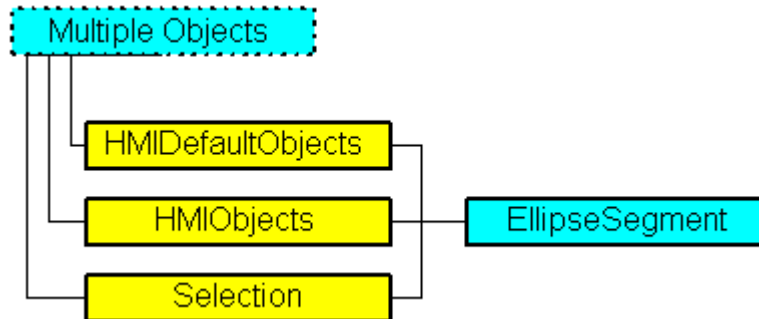

Represents the "Ellipse Segment" object. The EllipseSegment object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIEllipseSegment

### Usage

Use the Add method to create a new "Ellipse Segment" object in a picture:

```

Sub AddEllipseSegment()
'VBA248
Dim objEllipseSegment As HMIEllipseSegment
Set objEllipseSegment = ActiveDocument.HMIObjects.AddHMIObject("EllipseSegment",
"HMIEllipseSegment")
End Sub
  
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```

Sub EditEllipseSegment()
'VBA249
Dim objEllipseSegment As HMIEllipseSegment
Set objEllipseSegment = ActiveDocument.HMIObjects("EllipseSegment")
objEllipseSegment.BorderColor = RGB(255, 0, 0)
End Sub
  
```

### 3.6 VBA Reference

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA250  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```


#### See also

- [ToolTipText Property \(Page 2445\)](#)
- [BackFlashColorOn Property \(Page 2139\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIOBJECTS Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObject Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [StartAngle Property \(Page 2426\)](#)
- [RadiusWidth Property \(Page 2395\)](#)
- [RadiusHeight Property \(Page 2394\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)
- [Height Property \(Page 2269\)](#)
- [FlashRateBorderColor Property \(Page 2249\)](#)
- [FlashRateBackColor Property \(Page 2247\)](#)
- [FlashBorderColor Property \(Page 2240\)](#)
- [FlashBackColor Property \(Page 2239\)](#)
- [FillStyle Property \(Page 2235\)](#)
- [FillingIndex Property \(Page 2233\)](#)

Filling Property (Page 2232)  
FillColor Property (Page 2231)  
EndAngle Property (Page 2222)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## Event Object

### Description

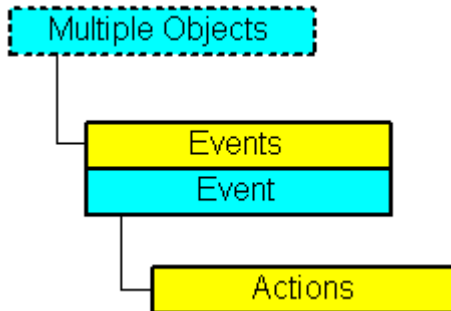

Represents an event that triggers one or more actions in Runtime (e.g. a direct connection). An event can be configured onto an object and a property.

### VBA Object Name

HMIEvent

### Usage

Use the AddAction method to configure an action on an event. In this example a C action is to be triggered in the event of a change of radius in Runtime:

```

Sub AddActionToPropertyTypeCScript ()
  'VBA251
  Dim objEvent As HMIEvent
  Dim objCScript As HMIScriptInfo
  Dim objCircle As HMICircle
  'Create circle in the picture. If property "Radius" is changed,
  'a C-action is added:
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_AB", "HMICircle")
  Set objEvent = objCircle.Radius.Events(1)
  Set objCScript = objEvent.Actions.AddAction(hmiActionCreationTypeCScript)
End Sub
  
```

### See also

- Application Property (Page 2121)
- Delete Method (Page 1831)
- AddAction Method (Page 1794)
- VBA Reference (Page 1745)
- Parent Property (Page 2359)


EventType Property (Page 2225)

Actions Property (Page 2106)

EventName property (Page 2225)

## Events Object (Listing)

### Description

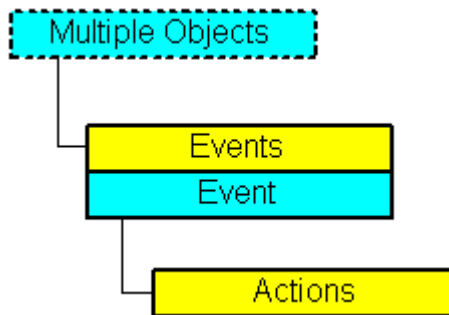

A listing of the Event objects that represent all the events configured onto an object. Use the Item method to define the event that is intended to be configured:

- You configure an action on a property with VBA by using the "Events(1)" property, where the index "1" stands for the event "Upon change":
- To configure an action onto an object with the aid of VBA, use the "Events(Index)" property, where "Index" stands for the trigger event (see table):

Index	EventType (depending upon the object used)
0	hmiEventTypeNotDefined
1	hmiEventTypeMouseClicked
2	hmiEventTypeMouseButtonDown
3	hmiEventTypeMouseButtonUp
4	hmiEventTypeMouseButtonDown
5	hmiEventTypeMouseButtonUp
6	hmiEventTypeKeyboardDown
7	hmiEventTypeKeyboardUp
8	hmiEventTypeFocusEnter
9	hmiEventTypeObjectChange
10	hmiEventTypePictureOpen

### VBA Object Name

HMIEvents

## Usage

Use the Item method to return an individual Event object. In this example the event names and event types of all objects in the active pictures are put out. In order for this example to work, insert some objects into the active picture and configure different events.

```
Sub ShowEventsOfAllObjectsInActiveDocument()  
'VBA252  
Dim colEvents As HMIEvents  
Dim objEvent As HMIEvent  
Dim iMax As Integer  
Dim iIndex As Integer  
Dim iAnswer As Integer  
Dim strEventName As String  
Dim strObjectName As String  
Dim varEventType As Variant  
iIndex = 1  
iMax = ActiveDocument.HMIObjects.Count  
For iIndex = 1 To iMax  
Set colEvents = ActiveDocument.HMIObjects(iIndex).Events  
strObjectName = ActiveDocument.HMIObjects(iIndex).ObjectName  
For Each objEvent In colEvents  
strEventName = objEvent.EventName  
varEventType = objEvent.EventType  
iAnswer = MsgBox("Objectname: " & strObjectName & vbCrLf & "Eventtype: " & varEventType &  
vbCrLf & "Eventname: " & strEventName, vbOKCancel)  
If vbCancel = iAnswer Then Exit For  
Next objEvent  
If vbCancel = iAnswer Then Exit For  
Next iIndex  
End Sub
```

## See also

- [Item Method \(Page 1859\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Parent Property \(Page 2359\)](#)
- [Count Property \(Page 2201\)](#)
- [Application Property \(Page 2121\)](#)

## ExternalShapeInfo object


### Description

Is used for internal purposes in Graphics Designer.



## FaceplateObject object

### Description

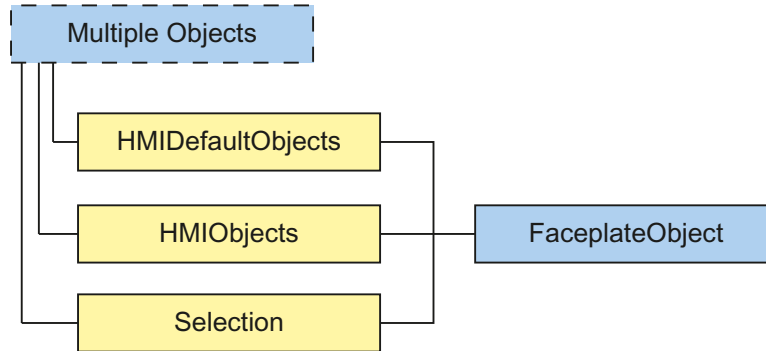

Represents the "faceplate instance" object. The FaceplateObject object is an element of the following lists:

- HMIOObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all default, smart, window and tube objects.

### VBA object name

HMIFaceplateObject

### Usage

Use the Add method to create a new "faceplate instance" object in a picture:

```

Sub AddFaceplateInstance()
'VBA826
Dim objFaceplateInstance As HMIFaceplateObject
Set objFaceplateInstance = ActiveDocument.HMIOObjects.AddHMIObject("faceplate instance",
"HMIFaceplateObject")
objFaceplateInstance.Properties.Item(3).value = "Faceplate1.fpt"
End Sub
  
```

Use "HMIOObjects"(Index)" to return an object from the HMIOObjects listing, where Index in this case identifies the object by name:

```

Sub EditFaceplateInstance()
'VBA827
Dim objFaceplateInstance As HMIFaceplateObject
Set objFaceplateInstance = ActiveDocument.HMIOObjects("faceplate instance")
objFaceplateInstance.visible = True
End Sub
  
```

### 3.6 VBA Reference

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA828  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

#### See also

- ObjectName Property (Page 2347)
- Layer Property (Page 2293)
- Left Property (Page 2305)
- Top Property (Page 2446)
- Width Property (Page 2553)
- Height Property (Page 2269)
- Operation Property (Page 2353)
- PasswordLevel Property (Page 2362)
- Visible Property (Page 2551)
- ToolTipText Property (Page 2445)
- ScalingMode property (Page 2405)
- FaceplateType property (Page 2228)
- Delete Method (Page 1831)
- Destroy Method (Page 1835)
- Application Property (Page 2121)
- Events Property (Page 2223)
- GroupParent Property (Page 2268)
- InheritState property (Page 2278)
- LDToolTipTexts Property (Page 2303)
- Parent Property (Page 2359)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Type Property (Page 2450)

ConnectionPoints property (Page 2198)

ConnectorObjects property (Page 2199)

## FaceplateObjects object

### Description

A listing of the HMIFaceplateObject objects that represent all faceplate objects in the picture.

### VBA Object Name

HMIFaceplateObjects

### See also

Parent Property (Page 2359)

OriginalPropertyName property (Page 2357)

## FaceplateProperty object

### Description

Represents the property of a faceplate object. In the case of the FaceplateProperty object, the use of the Value property is set as the default. For this reason you can use the following notation, for example, to assign a new value to an object property:

```
<FaceplateObject>.<FaceplateProperty> = <Value>
```

You can use the "Dynamic" property to make an object property dynamic with VBA. Use the "Events" listing to configure actions with VBA.

### See also

CreateDynamic Method (Page 1828)

DeleteDynamic Method (Page 1833)

Application Property (Page 2121)

DisplayName Property (Page 2214)

Dynamic Property (Page 2218)

Events Property (Page 2223)

IsDynamicable Property (Page 2280)

LDFonts Property (Page 2298)


LDTexts Property (Page 2303)

Name Property (Page 2343)

- Parent Property (Page 2359)
- Value Property (Page 2469)
- IsPublished property (Page 2281)
- LDFontsType property (Page 2299)
- ParentCookie property (Page 2362)

## FolderItem Object

### Description

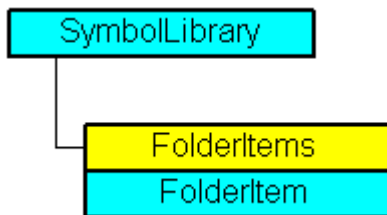

Represents a folder or object in the Components Library. A FolderItem object of the "Folder" type is an element of the FolderItems listing. A FolderItem object of the "Item" type is an element of the Folder listing.

### VBA Object Name

HMIFolderItem

### Usage

Use the FolderItems property to return the FolderItems listing. In the following example the names of folders in the "Global Library will be output:

```
Sub ShowFolderItemsOfGlobalLibrary()  
'VBA253  
Dim colFolderItems As HMIFolderItems  
Dim objFolderItem As HMIFolderItem  
Set colFolderItems = Application.SymbolLibraries(1).FolderItems  
For Each objFolderItem In colFolderItems  
MsgBox objFolderItem.Name  
Next objFolderItem  
End Sub
```

Use the `CopyToClipboard` method to copy a "FolderItem" object of the "Item" type to the clipboard. In the following example the object "PC" will be copied to the clipboard.


```
Sub CopyFolderItemToClipboard()  
'VBA254  
Dim objGlobalLib As HMISymbolLibrary  
Set objGlobalLib = Application.SymbolLibraries(1)  
objGlobalLib.FolderItems("Folder2").Folder("Folder2").Folder.Item("Object1").CopyToClipboa  
rd  
End Sub
```

## See also

- Type Property (Page 2450)
- FolderItems Object (Listing) (Page 1973)
- Delete Method (Page 1831)
- CopyToClipboard Method (Page 1824)
- How to paste an object from the object library into a picture with VBA (Page 1652)
- How to edit the component library with VBA (Page 1649)
- VBA Reference (Page 1745)
- Accessing the component library with VBA (Page 1646)
- Parent Property (Page 2359)
- Name Property (Page 2343)
- LDNames Property (Page 2301)
- Folder Property (Page 2252)
- Application Property (Page 2121)
- DisplayName Property (Page 2214)
- Pathname Property (Page 2364)

## FolderItems Object (Listing)

### Description

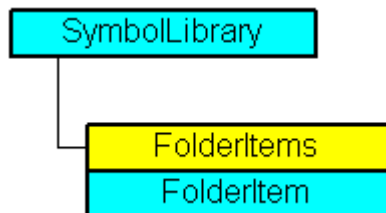

A listing of the FolderItem objects that represent all the folders and objects in the Components Library.

## VBA Object Name

HMIFolderItems

## Usage

Use the FolderItems property to return the FolderItems listing. In the following example the names of folders in the "Global Library" will be output:

```
Sub ShowFolderItemsOfGlobalLibrary()  
'VBA255  
Dim colFolderItems As HMIFolderItems  
Dim objFolderItem As HMIFolderItem  
Set colFolderItems = Application.SymbolLibraries(1).FolderItems  
For Each objFolderItem In colFolderItems  
MsgBox objFolderItem.Name  
Next objFolderItem  
End Sub
```

Use the AddFolder method, for instance, to create a new folder in the Components Library. In the following example the folder "Project Folder" will be created in the "Project Library":

```
Sub AddNewFolderToProjectLibrary()  
'VBA256  
Dim objProjectLib As HMISymbolLibrary  
Set objProjectLib = Application.SymbolLibraries(2)  
objProjectLib.FolderItems.AddFolder ("My Folder")  
End Sub
```


## See also

- [AddItem Method \(Page 1802\)](#)
- [SymbolLibrary Object \(Page 2074\)](#)
- [FolderItem Object \(Page 1972\)](#)
- [AddFromClipboard Method \(Page 1799\)](#)
- [AddFolder Method \(Page 1798\)](#)
- [How to paste an object from the object library into a picture with VBA \(Page 1652\)](#)
- [How to edit the component library with VBA \(Page 1649\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Accessing the component library with VBA \(Page 1646\)](#)
- [Parent Property \(Page 2359\)](#)

Count Property (Page 2201)  
 Application Property (Page 2121)  
 FindByDisplayName Method (Page 1842)  
 Item Property (Page 2283)

## GraphicObject Object

### Description

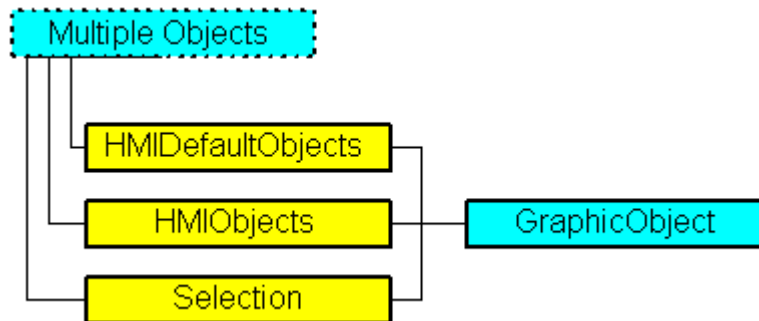

Represents the object called "Graphic Object". The GraphicObject object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIGraphicObject

### Usage

Use the Add method to create a new "Graphic Object" object in a picture:

```

Sub AddGraphicObject()
  'VBA257
  Dim objGraphicObject As HMIGraphicObject
  Set objGraphicObject = ActiveDocument.HMIObjects.AddHMIObject("Graphic-Object",
  "HMIGraphicObject")
End Sub
  
```

### 3.6 VBA Reference

Use "HMIOjects"(Index)" to return an object from the HMIOjects listing, where Index in this case identifies the object by name:

```
Sub EditGraphicObject()  
'VBA258  
Dim objGraphicObject As HMIGraphicObject  
Set objGraphicObject = ActiveDocument.HMIOjects("Graphic-Object")  
objGraphicObject.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA259  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

#### See also

- Left Property (Page 2305)
- SelectedObjects object (Listing) (Page 2060)
- HMIOjects Object (Listing) (Page 1990)
- HMIDefaultObjects Object (Listing) (Page 1985)
- AddHMIOject Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- Width Property (Page 2553)
- Visible Property (Page 2551)
- Top Property (Page 2446)
- ToolTipText Property (Page 2445)
- PicUseTransColor Property (Page 2377)
- PictureName Property (Page 2373)
- PicTransColor Property (Page 2371)
- PicReferenced Property (Page 2370)
- PasswordLevel Property (Page 2362)
- Operation Property (Page 2353)
- Name Property (Page 2343)




Layer Property (Page 2293)  
Height Property (Page 2269)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
FillingIndex Property (Page 2233)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
DrawInsideFrame property (Page 2218)

ConnectionPoints property (Page 2198)

ConnectorObjects property (Page 2199)

## Group Object

### Description

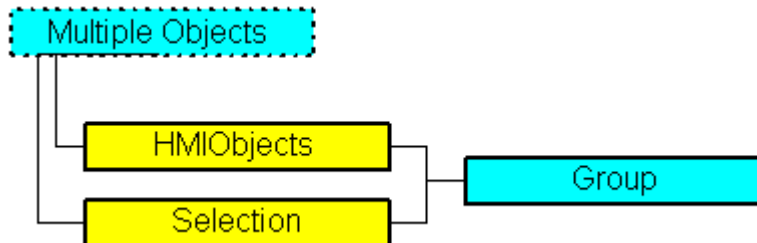

Represents the object called "Group Object". The Group Object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.

A group object is created from the objects selected in a picture. The objects in the Group Object are also saved in the "GroupedHMIObjects" listing and index numbers are newly allocated.

You have unrestricted access to the properties of all objects in the Group Object.

Further information regarding group objects can be found in the WinCC documentation under "Group Object".

### VBA Object Name

HMIGroup

### Usage

Use the CreateGroup Method with the Selection listing to create a new "Group Object" object in a picture:

```

Sub DoCreateGroup()
'VBA260
Dim objGroup As HMIGroup
Set objGroup = ActiveDocument.Selection.CreateGroup
objGroup.ObjectName = "Group-Object"
End Sub
  
```

Use the following methods to edit an existing Group Object:

- Methode "Add(Index)": Adds a new object to the group object.
- Methode "Remove(Index)": Removes a object from the group object.

- "UnGroup()" method: Ungroups the group object (ungroup).
- "Delete()" Method: Deletes the group object and the objects that it contains.

Use "HMIObjecs"(Index)" to return an object from the HMIObjecs listing, where Index in this case identifies the object by name:

```
Sub EditGroup()  
'VBA261  
Dim objGroup As HMIGroup  
Set objGroup = ActiveDocument.HMIObjecs("Group-Object")  
MsgBox objGroup.ObjectName  
End Sub
```


## See also

[SelectedObjects object \(Listing\) \(Page 2060\)](#)  
[HMIObjecs Object \(Listing\) \(Page 1990\)](#)  
[GroupedObjects Object \(Listing\) \(Page 1983\)](#)  
[Ungroup Method \(Page 1892\)](#)  
[Remove Method \(Page 1871\)](#)  
[Delete Method \(Page 1831\)](#)  
[Add Method \(GroupedObjects Listing\) \(Page 1791\)](#)  
[How to Edit Objects in Group Objects Using VBA \(Page 1679\)](#)  
[How to Edit the Group Objects Using VBA \(Page 1676\)](#)  
[VBA Reference \(Page 1745\)](#)  
[Group Objects \(Page 1674\)](#)  
[Editing Objects with VBA \(Page 1660\)](#)  
[Application Property \(Page 2121\)](#)  
[Events Property \(Page 2223\)](#)  
[GroupParent Property \(Page 2268\)](#)  
[GroupedHMIObjecs Property \(Page 2269\)](#)  
[Height Property \(Page 2269\)](#)  
[Layer Property \(Page 2293\)](#)  
[LDTooltipTexts Property \(Page 2303\)](#)  
[Left Property \(Page 2305\)](#)  
[ObjectName Property \(Page 2347\)](#)  
[Operation Property \(Page 2353\)](#)  
[Parent Property \(Page 2359\)](#)

- PasswordLevel Property (Page 2362)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- ToolTipText Property (Page 2445)
- Top Property (Page 2446)
- Type Property (Page 2450)
- Visible Property (Page 2551)
- Width Property (Page 2553)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### GroupDisplay Object

#### Description

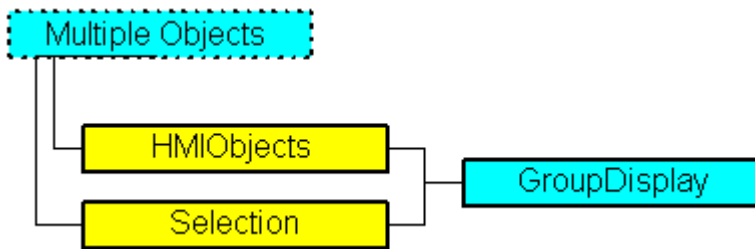

Represents the "Group Display" object. The GroupDisplay object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.

#### VBA Object Name

HMIGroupDisplay

## Usage

Use the Add method to create a new "Group Display" object in a picture:

```
Sub AddGroupDisplay()  
'VBA262  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("Groupdisplay",  
"HMIGroupDisplay")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditGroupDisplay()  
'VBA263  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects("Groupdisplay")  
objGroupDisplay.BackColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA264  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

- MCText Property (Page 2336)
- Height Property (Page 2269)
- SelectedObjects object (Listing) (Page 2060)
- HMIObjects Object (Listing) (Page 1990)
- AddHMIObject Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- Width Property (Page 2553)
- Visible Property (Page 2551)
- UserValue1 Property (Page 2466)
- Top Property (Page 2446)


### 3.6 VBA Reference

ToolTipText Property (Page 2445)  
SignificantMask Property (Page 2419)  
SameSize Property (Page 2403)  
Relevant Property (Page 2398)  
PasswordLevel Property (Page 2362)  
Operation Property (Page 2353)  
MessageClass Property (Page 2339)  
MCGUTextFlash Property (Page 2327)  
MCGUTextColorOn Property (Page 2326)  
MCGUTextColorOff Property (Page 2326)  
MCGUBackFlash Property (Page 2325)  
MCGUBackColorOn Property (Page 2324)  
MCGUBackColorOff-Eigenschaft (Page 2324)  
LockText Property (Page 2316)  
LockTextColor Property (Page 2317)  
LockStatus Property (Page 2315)  
LockBackColor Property (Page 2313)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
FontUnderline Property (Page 2259)  
FontSize Property (Page 2258)  
FontName Property (Page 2257)  
FontItalic Property (Page 2257)  
FontBold Property (Page 2256)  
FlashRate Property (Page 2246)  
Button1..8Width property (Page 2166)  
BackColor Property (Page 2131)  
BackBorderWidth Property (Page 2131)  
AlignmentTop Property (Page 2118)  
AlignmentLeft Property (Page 2117)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)

LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
Button1..8MessageClasses (Page 2166)  
UseGlobalAlarmClasses property (Page 2465)  
UseGlobalSettings property (Page 2466)  
CollectValue property (Page 2182)  
EventQuitMask property (Page 2222)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## GroupedObjects Object (Listing)

### Description

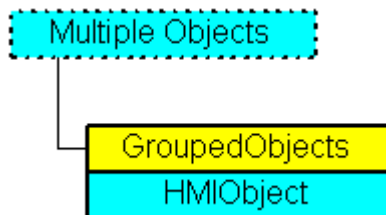

A listing of the HMIObject objects that represent all the objects in the group object.

### VBA Object Name

HMIGroupedObjects

## Usage

Use the GroupedHMIObjects property to return the GroupedObjects listing. In the following example all the objects in the first group object are output in the active picture. The group object called "Group1" must first have been created:

```
Sub ShowGroupedObjectsOfFirstGroup()  
'VBA265  
Dim colGroupedObjects As HMIGroupedObjects  
Dim objObject As HMIObject  
Set colGroupedObjects = ActiveDocument.HMIObjects("Group1").GroupedHMIObjects  
For Each objObject In colGroupedObjects  
MsgBox objObject.ObjectName  
Next objObject  
End Sub
```

Use the Remove method, for instance, to remove an object from the group object. In the following example the first object will be removed from the group object called "Group1":

```
Sub RemoveObjectFromGroup()  
'VBA266  
Dim objGroup As HMIGroup  
Set objGroup = ActiveDocument.HMIObjects("Group1")  
objGroup.GroupedHMIObjects.Remove 1  
End Sub
```


## See also

- [Group Object \(Page 1978\)](#)
- [Remove Method \(Page 1871\)](#)
- [Add Method \(GroupedObjects Listing\) \(Page 1791\)](#)
- [How to Edit the Group Objects Using VBA \(Page 1676\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Group Objects \(Page 1674\)](#)
- [Parent Property \(Page 2359\)](#)
- [GroupedHMIObjects Property \(Page 2269\)](#)
- [Count Property \(Page 2201\)](#)
- [Application Property \(Page 2121\)](#)
- [Item Property \(Page 2283\)](#)



## HMIDefaultObjects Object (Listing)

### Description

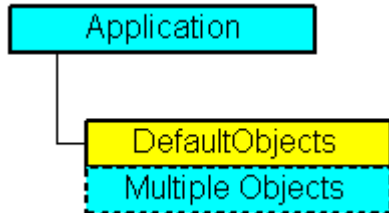

A listing of the following HMIObj object objects:

Object	VBA object name
Line	HMILine
Polygon	HMIPolygon
Polyline	HMIPolyLine
Ellipse	HMIEllipse
Circle	HMICircle
Ellipse segment	HMIEllipseSegment
Pie segment	HMIPieSegment
Ellipse arc	HMIEllipseArc
Circular arc	HMICircularArc
Rectangle	HMIRectangle
Rounded rectangle	HMIRoundRectangle
Application window	HMIApplicationWindow
Screen Window	HMIPictureWindow
Static text	HMIStaticText
I/O Field	HMIIField
Button	HMIButton
Check box	HMICheckBox
Radio box	HMIOptionGroup
Round button	HMIRoundButton
Bar	HMIBarGraph
Slider object	HMISlider
Graphic Object	HMIGraphicObject
Status display	HMIStatusDisplay
Text list	HMITextList
Connector	HMIObjConnection
Multiple row text	HMIMultiLineEdit
Combo box	HMIComboBox
List box	HMIListBox
Polygon tube	HMITubePolyline
T-piece	HMITubeTeeObject

Object	VBA object name
Double T-piece	HMITubeDoubleTeeObject
Tube bend	HMITubeArcObject
3D bar	HMI3DBarGraph
Group display	HMIGroupDisplay
Faceplate instance	HMIFaceplateObject

## VBA object name

HMIDefaultObjects

## Usage

Use the DefaultHMIObjects property to change the default property values of the included objects. In this example all the objects contained in the listing will be output:

```
Sub ShowDefaultObjects()
  'VBA267
  Dim strType As String
  Dim strName As String
  Dim strMessage As String
  Dim iMax As Integer
  Dim iIndex As Integer
  iMax = Application.DefaultHMIObjects.Count
  iIndex = 1
  For iIndex = 1 To iMax
    With Application.DefaultHMIObjects(iIndex)
      strType = .Type
      strName = .ObjectName
      strMessage = strMessage & "Element: " & iIndex & " / Objecttype: " & strType & " /
      Objectname: " & strName
    End With
    If 0 = iIndex Mod 10 Then
      MsgBox strMessage
      strMessage = ""
    Else
      strMessage = strMessage & vbCrLf & vbCrLf
    End If
  Next iIndex
  MsgBox "Element: " & iIndex & vbCrLf & "Objecttype: " & strType & vbCrLf & "Objectname: "
  & strName
End Sub
```

## See also

[Button Object \(Page 1921\)](#)


[TextList Object \(Page 2076\)](#)

[StatusDisplay Object \(Page 2070\)](#)

StaticText Object (Page 2067)  
Slider object (Page 2062)  
RoundRectangle Object (Page 2055)  
RoundButton Object (Page 2052)  
Rectangle Object (Page 2049)  
PolyLine Object (Page 2038)  
Polygon Object (Page 2035)  
PieSegment Object (Page 2032)  
PictureWindow Object (Page 2029)  
OptionGroup Object (Page 2025)  
Line Object (Page 2004)  
IOField Object (Page 1992)  
EllipseSegment Object (Page 1963)  
EllipseArc Object (Page 1960)  
Ellipse Object (Page 1957)  
CircularArc Object (Page 1931)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
BarGraph Object (Page 1914)  
ApplicationWindow Object (Page 1911)  
VBA Reference (Page 1745)  
Parent Property (Page 2359)  
Count Property (Page 2201)  
DefaultHMIObjects Property (Page 2210)  
Application Property (Page 2121)  
Item Property (Page 2283)

## HMIObject Object

### Description

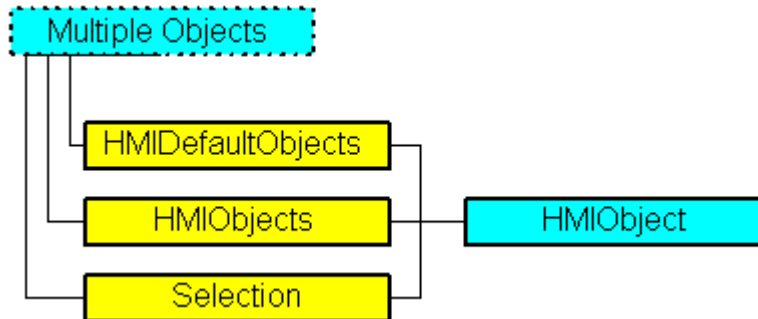

Represents an object from the Object Palette of the Graphics Designer. The HMIObject object is an element of the following listings:

- HMIOBJECTS: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

This object contains the object properties that apply to all standard, smart and Windows objects (incl. Width, Height, Top and Left).

### VBA Object Name

HMIObject

### Usage

Use HMIOBJECTS(Index), for instance, to return an individual HMIObject object. "For Index you can use either the index number or the name of the object. In the following example the name of the first object in the active picture is output:

```
Sub ShowFirstObjectOfCollection()  
'VBA268  
Dim strName As String  
strName = ActiveDocument.HMIOBJECTS(1).ObjectName  
MsgBox strName  
End Sub
```

Use the Delete method to remove an object from the HMIObjects listing. In the following example the first object in the active picture will be removed:

```
Sub DeleteObject()  
'VBA269  
ActiveDocument.HMIObjects(1).Delete  
End Sub
```

## See also


- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjects Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [Delete Method \(Page 1831\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Default objects, Smart objects, Windows objects and Tube objects \(Page 1662\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Type Property \(Page 2450\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [TabOrderAlpha Property \(Page 2429\)](#)
- [TabOrderSwitch Property \(Page 2433\)](#)
- [Selected Property \(Page 2412\)](#)
- [Properties Property \(Page 2388\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Parent Property \(Page 2359\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [LDTooltipTexts Property \(Page 2303\)](#)
- [Layer Property \(Page 2293\)](#)
- [Height Property \(Page 2269\)](#)
- [GroupParent Property \(Page 2268\)](#)
- [Events Property \(Page 2223\)](#)
- [Application Property \(Page 2121\)](#)

ObjectName Property (Page 2347)

ConnectionPoints property (Page 2198)

## HMIObjects Object (Listing)

### Description

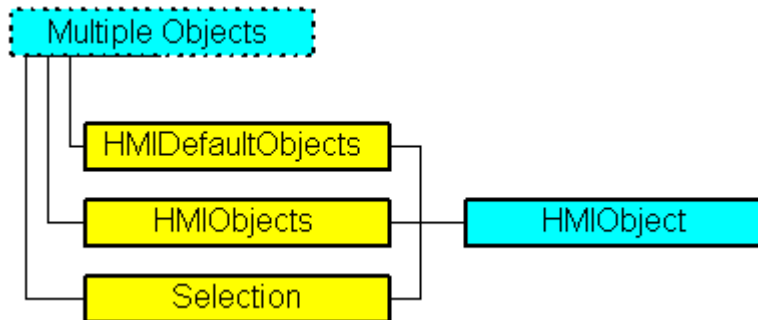

A listing of the HMIObject objects that represent all the objects in the picture.

### VBA Object Name

HMIObjects

---

#### Note

The sequence of HMI objects in the HMIObjects list can be altered by adding and/or deleting HMI objects.

The sequence of listing can also change if HMI objects are processed in the current listing. This behavior can occur if the Layers property is modified and/or if the methods "SendToBack" and "BringToFront" are used.

---

### Usage

Use the HMIObjects property to return the HMIObjects listing. In the following example all the object names in the active picture are output:

```
Sub ShowObjectsOfDocument()  
    'VBA270  
    Dim colObjects As HMIObjects  
    Dim objObject As HMIObject  
    Set colObjects = ActiveDocument.HMIObjects  
    For Each objObject In colObjects  
        MsgBox objObject.ObjectName  
    Next objObject  
End Sub
```

Use the `AddHMIObject` method to create a new object in the picture. In the following example a circle will be inserted into the active picture:

```
Sub AddCircle()  
'VBA271  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_1", "HMICircle")  
End Sub
```

Use the `Find` method to search for one or more objects in the picture. In the following example, objects of the "HMICircle" type will be searched for in the active picture:

```
Sub FindObjectsByType()  
'VBA272  
Dim colSearchResults As HMICollection  
Dim objMember As HMIObject  
Dim iResult As Integer  
Dim strName As String  
Set colSearchResults = ActiveDocument.HMIObjects.Find(ObjectType:="HMICircle")  
For Each objMember In colSearchResults  
iResult = colSearchResults.Count  
strName = objMember.ObjectName  
MsgBox "Found: " & CStr(iResult) & vbCrLf & "Objectname: " & strName  
Next objMember  
End Sub
```

## See also


- [Count Property \(Page 2201\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [Find Method \(Page 1841\)](#)
- [AddOLEObject Method \(Page 1803\)](#)
- [AddHMIObject Method \(Page 1801\)](#)
- [AddActiveXControl Method \(Page 1795\)](#)
- [How to edit Default objects, Smart objects, Windows objects and Tube objects \(Page 1664\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Default objects, Smart objects, Windows objects and Tube objects \(Page 1662\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Parent Property \(Page 2359\)](#)
- [Application Property \(Page 2121\)](#)
- [AddDotNetControl method \(Page 1797\)](#)

AddWPFControl method (Page 1806)

Item Property (Page 2283)

## IOField Object

### Description

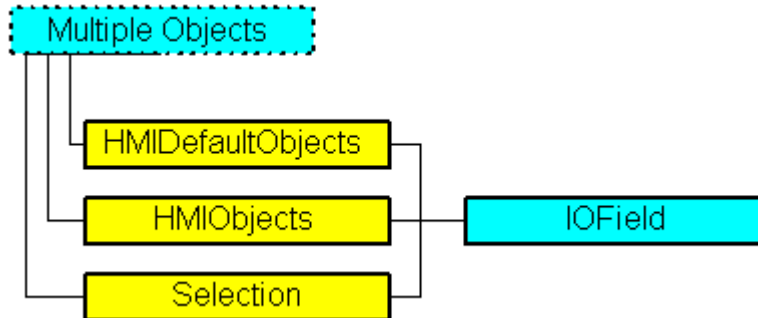

Represents the "I/O Field" object. The IOField object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIIOField

### Usage

Use the Add method to create a new "I/O Field" object in a picture:

```
Sub AddIOField()  
'VBA273  
Dim objIOField As HMIIOField  
Set objIOField = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("IO-Field", "HMIIOField")  
End Sub
```



Use "HMIObjets"(Index)" to return an object from the HMIObjets listing, where Index in this case identifies the object by name:

```
Sub EditIOField()  
'VBA274  
Dim objIOField As HMIOField  
Set objIOField = ActiveDocument.HMIObjets("IO-Field")  
objIOField.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA275  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

Use the "HMIDefaultObjects(Index)" to return an object from the HMIDefaultObjects Listing:

```
Sub EditDefaultPropertiesOfIOField()  
'VBA276  
Dim objIOField As HMIOField  
Set objIOField = Application.DefaultHMIObjets("HMIOField")  
objIOField.BorderColor = RGB(255, 255, 0)  
End Sub
```

## See also

- LimitMin Property (Page 2311)
- ClearOnNew Property (Page 2181)
- SelectedObjects object (Listing) (Page 2060)
- HMIObjets Object (Listing) (Page 1990)
- HMIDefaultObjects Object (Listing) (Page 1985)
- AddHMIObjets Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- Width Property (Page 2553)
- Visible Property (Page 2551)
- Top Property (Page 2446)
- ToolTipText Property (Page 2445)

### 3.6 VBA Reference


PasswordLevel Property (Page 2362)  
OutputValue Property (Page 2358)  
OutputFormat Property (Page 2357)  
Orientation Property (Page 2356)  
OperationReport Property (Page 2355)  
OperationMessage Property (Page 2354)  
Operation Property (Page 2353)  
LimitMax Property (Page 2310)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
HiddenInput Property (Page 2271)  
Height Property (Page 2269)  
ForeFlashColorOn Property (Page 2262)  
ForeFlashColorOff Property (Page 2261)  
ForeColor Property (Page 2260)  
FontUnderline Property (Page 2259)  
FontSize Property (Page 2258)  
FontName Property (Page 2257)  
FontItalic Property (Page 2257)  
FontBold Property (Page 2256)  
FlashRateForeColor Property (Page 2251)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashForeColor Property (Page 2242)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
EditAtOnce Property (Page 2219)  
DataFormat Property (Page 2210)  
CursorControl Property (Page 2206)  
ClearOnError Property (Page 2180)  
BoxType Property (Page 2165)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)

BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
AssumeOnFull Property (Page 2123)  
AssumeOnExit Property (Page 2123)  
AlignmentTop Property (Page 2118)  
AlignmentLeft Property (Page 2117)  
AdaptBorder Property (Page 2111)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
InputValue property (Page 2279)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## L-Q

### LanguageFont Object

#### Description

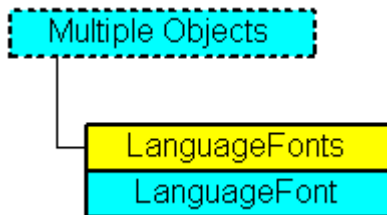

Contains the font settings for the project language. The LanguageFont object is an element of the LanguageFonts listing.

#### VBA Object Name

HMLanguageFont

#### Usage

Use LDFonts(Index) to return an individual LanguageFont object. In the following example a Button object will be created and the name of the first configured font will be output:

```
Sub ShowFirstObjectOfCollection()  
'VBA277  
Dim strName As String  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button", "HMIButton")  
strName = objButton.LDFonts(1).Family  
MsgBox strName  
End Sub
```

#### Object properties

The LanguageFont object possesses the following properties:


#### See also

- LanguageFonts Object (Listing) (Page 1997)
- VBA Reference (Page 1745)
- Underlined Property (Page 2460)
- Size Property (Page 2419)
- Parent Property (Page 2359)

[LanguageID Property \(Page 2289\)](#)  
[Italic Property \(Page 2282\)](#)  
[Family Property \(Page 2229\)](#)  
[Bold Property \(Page 2151\)](#)  
[Application Property \(Page 2121\)](#)

## LanguageFonts Object (Listing)

### Description

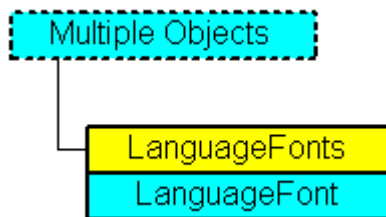

A listing of the LanguageFont objects that represent all the language-dependent fonts in an object.

### VBA Object Name

HMILanguageFonts

### Usage

Use the LDFonts property to return the LanguageFonts listing. In the following example the language identifiers of the configured fonts will be output:

```

Sub ShowLanguageFont ()
'VBA278
Dim colLanguageFonts As HMILanguageFonts
Dim objLanguageFont As HMILanguageFont
Dim objButton As HMIButton
Dim iMax As Integer
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")
Set colLanguageFonts = objButton.LDFonts
iMax = colLanguageFonts.Count
For Each objLanguageFont In colLanguageFonts
MsgBox "Planned fonts: " & iMax & vbCrLf & "Language-ID: " & objLanguageFont.LanguageID
Next objLanguageFont
End Sub

```

Use the `ItemByLcid` method to define the language for which it is intended to enter font settings. The following example sets the font attributes of a button for French and English.

---

**Note**

For this example to work, you must already have configured in the languages concerned.

---


```
Sub ExampleForLanguageFonts()  
    'VBA279  
    Dim collLangFonts As HMILanguageFonts  
    Dim objButton As HMIButton  
    Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
    objButton.Text = "DefText"  
    Set collLangFonts = objButton.LDFonts  
  
    'Adjust fontsettings for french:  
    With collLangFonts.ItemByLCID(1036)  
        .Family = "Courier New"  
        .Bold = True  
        .Italic = False  
        .Underlined = True  
        .Size = 12  
    End With  
    'Adjust fontsettings for english:  
    With collLangFonts.ItemByLCID(1033)  
        .Family = "Times New Roman"  
        .Bold = False  
        .Italic = True  
        .Underlined = False  
        .Size = 14  
    End With  
End Sub
```

**See also**

- LanguageFont Object (Page 1996)
- ItemByLcid Method (Page 1861)
- Item Method (Page 1859)
- VBA Reference (Page 1745)
- Parent Property (Page 2359)
- Count Property (Page 2201)
- Application Property (Page 2121)

## LanguageText Object

### Description

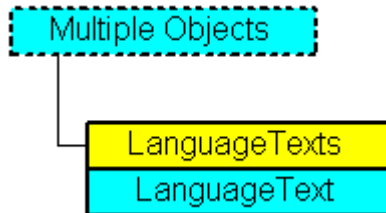

Contains the multilingual labels for an object. The LanguageText object is an element of the LanguageTexts listing.

### VBA Object Name

HMILanguageText

### Usage

In the following example a German label and an English label will be assigned to the button called "myButton":

```
Sub AddLanguagesToButton()  
'VBA280  
Dim objLabelText As HMILanguageText  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
'  
'Add text in actual datalanguage:  
objButton.Text = "Actual-Language Text"  
'  
'Add english text:  
Set objLabelText = ActiveDocument.HMIObjects("myButton").LDTexts.Add(1033, "English Text")  
End Sub
```

### See also

[LanguageTexts Object \(Listing\) \(Page 2000\)](#)

[Delete Method \(Page 1831\)](#)

[VBA Reference \(Page 1745\)](#)

[Parent Property \(Page 2359\)](#)


[LanguageID Property \(Page 2289\)](#)

DisplayText Property (Page 2216)

Application Property (Page 2121)

## LanguageTexts Object (Listing)

### Description

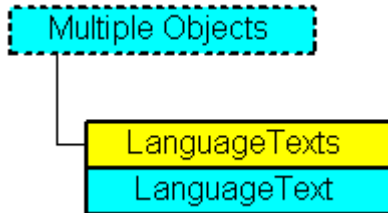

A listing of the LanguageText objects that represent all the multilingual texts in an object.

### VBA Object Name

HMLanguageTexts

### Usage

Use one of the following properties to return the LanguageTexts listing:

- LDLabelTexts Property
- LDNames Property
- LDStatusTexts Property
- LDTtexts Property
- LDTooltipTexts Property

An example showing how to use the LanguageTexts listing can be found in this documentation under the heading "LDStatusTexts Property".



Use the Add method to add multilingual texts to an object. In the following example a German label and an English label will be assigned to the button called "myButton":


```
Sub AddLanguagesToButton()
'VBA281
Dim objLabelText As HMILanguageText
Dim objButton As HMIButton
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")
'
'Add text in actual datalanguage:
objButton.Text = "Actual-Language Text"
'
'Add english text:
Set objLabelText = ActiveDocument.HMIObjects("myButton").LDTexts.Add(1033, "English Text")
End Sub
```

## See also

- LanguageText Object (Page 1999)
- ItemByLcid Method (Page 1861)
- Item Method (Page 1859)
- VBA Reference (Page 1745)
- Parent Property (Page 2359)
- LDTooltipTexts Property (Page 2303)
- LDTexts Property (Page 2303)
- LDStatusTexts Property (Page 2301)
- LDNames Property (Page 2301)
- LDLabelTexts Property (Page 2299)
- Count Property (Page 2201)
- Application Property (Page 2121)

## Layer Object

### Description

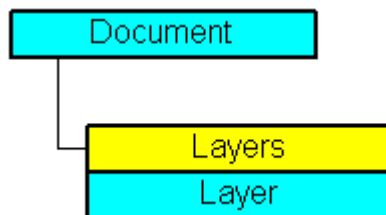

Represents one of the 32 layers that are available in the picture.

## VBA Object Name

HMI Layer

## Usage

Use the Layer object to define a name and the minimum and maximum zoom for a layer. You define the visibility of layers separately by CS and RT layers:

- Document Object: Controls the visibility of the RT layers.
- View Object: Controls the visibility of the RT layers.

Use the Layers listing to return a Layer object. In the following example the settings for the lowest layer are configured in the active picture:

```
Sub ConfigureSettingsOfLayer()  
'VBA282  
Dim objLayer As HMI Layer  
Set objLayer = ActiveDocument.Layers(1)  
With objLayer  
'configure "Layer 0"  
.MinZoom = 10  
.MaxZoom = 100  
.Name = "Configured with VBA"  
End With  
End Sub
```

## See also

[Layers Property \(Page 2297\)](#)

[VBA Reference \(Page 1745\)](#)

[Editing Layers with VBA \(Page 1657\)](#)

[Visible Property \(Page 2551\)](#)

[Number Property \(Page 2345\)](#)

[Name Property \(Page 2343\)](#)

[MinZoom Property \(Page 2340\)](#)


[MaxZoom Property \(Page 2323\)](#)

[LDNames Property \(Page 2301\)](#)

[ActiveLayer Property \(Page 2108\)](#)

## Layers Object (Listing)

### Description

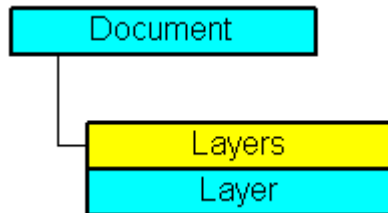

A listing of the Layer objects that represent the 32 layers in the picture.

### VBA Object Name

HMI Layer

### Usage

Use the LayersCS or LayersRT property to return the Layers listing. In the following example the layer names in the copy of the active picture will be output:

```

Sub ShowLayer()
'VBA283
Dim collayers As HMILayers
Dim objLayer As HMI Layer
Dim strLayerList As String
Dim iCounter As Integer
iCounter = 1
Set collayers = ActiveDocument.Layers
For Each objLayer In collayers
If 1 = iCounter Mod 2 And 32 > iCounter Then
strLayerList = strLayerList & vbCrLf
ElseIf 11 > iCounter Then
strLayerList = strLayerList & "      "
Else
strLayerList = strLayerList & "      "
End If
strLayerList = strLayerList & objLayer.Name
iCounter = iCounter + 1
Next objLayer
MsgBox strLayerList
End Sub
  
```

### See also


[Layer Object \(Page 2001\)](#)

[Item Method \(Page 1859\)](#)

- VBA Reference (Page 1745)
- Parent Property (Page 2359)
- Count Property (Page 2201)
- Application Property (Page 2121)

## Line Object

### Description

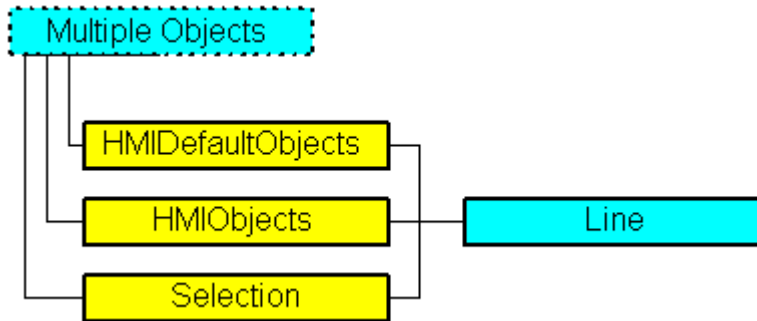

Represents the "Line" object. The Line object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMILine

### Usage

Use the Add method to create a new "Line" object in a picture:

```
Sub AddLine()  
  'VBA285  
  Dim objLine As HMILine  
  Set objLine = ActiveDocument.HMIObjects.AddHMIObject("Line1", "HMILine")  
End Sub
```

Use "HMIObjets"(Index)" to return an object from the HMIObjets listing, where Index in this case identifies the object by name:

```
Sub EditLine()  
'VBA286  
Dim objLine As HMILine  
Set objLine = ActiveDocument.HMIObjets("Line1")  
objLine.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA287  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also


- [AddHMIObjct Method \(Page 1801\)](#)
- [BorderBackColor Property \(Page 2152\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjets Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [RotationAngle Property \(Page 2400\)](#)
- [ReferenceRotationTop Property \(Page 2397\)](#)
- [ReferenceRotationLeft Property \(Page 2396\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)

### 3.6 VBA Reference

Index Property (Page 2276)  
Height Property (Page 2269)  
FlashRateBorderColor Property (Page 2249)  
FlashBorderColor Property (Page 2240)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderEndStyle Property (Page 2156)  
BorderColor Property (Page 2153)  
ActualPointTop Property (Page 2110)  
ActualPointLeft Property (Page 2109)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## ListBox object

### Description

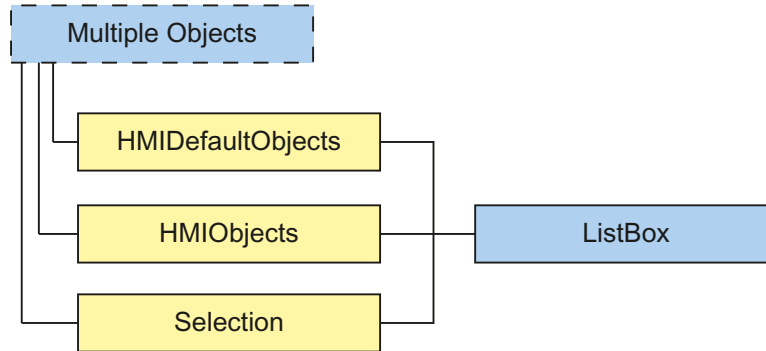

Represents the "ListBox" object. The ListBox object is an element of the following listings:

- HMIOObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all default, smart, window and tube objects.

### VBA object name

HMIListBox

### Usage

Use the Add method to create a new "ListBox" object in a picture:

```

Sub AddListBox()
'VBA829
Dim objListBox As HMIListBox
Set objListBox = ActiveDocument.HMIOObjects.AddHMIObject("ListBox", "HMIListBox")
End Sub
  
```

Use "HMIOObjects"(Index)" to return an object from the HMIOObjects listing, where Index in this case identifies the object by name:

```

Sub EditListBox()
'VBA830
Dim objListBox As HMIListBox
Set objListBox = ActiveDocument.HMIOObjects("ListBox")
objListBox.BorderColor = RGB(255, 0, 0)
End Sub
  
```

### 3.6 VBA Reference

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA831  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

#### See also


- ObjectName Property (Page 2347)
- Layer Property (Page 2293)
- Left Property (Page 2305)
- Top Property (Page 2446)
- Width Property (Page 2553)
- Height Property (Page 2269)
- NumberLines Property (Page 2346)
- ForeColor Property (Page 2260)
- BorderColor Property (Page 2153)
- BorderBackColor Property (Page 2152)
- BackColor Property (Page 2131)
- FillColor Property (Page 2231)
- BorderStyle Property (Page 2160)
- BorderWidth Property (Page 2161)
- FillStyle Property (Page 2235)
- GlobalShadow property (Page 2264)
- FontName Property (Page 2257)
- FontSize Property (Page 2258)
- FontBold Property (Page 2256)
- FontItalic Property (Page 2257)
- FontUnderline Property (Page 2259)
- AlignmentLeft Property (Page 2117)
- Index Property (Page 2276)
- Text Property (Page 2439)
- Operation Property (Page 2353)



PasswordLevel Property (Page 2362)  
 Visible Property (Page 2551)  
 ToolTipText Property (Page 2445)  
 OperationMessage Property (Page 2354)  
 OperationReport Property (Page 2355)  
 SelIndex property (Page 2414)  
 SelText property (Page 2414)  
 Application Property (Page 2121)  
 Events Property (Page 2223)  
 GroupParent Property (Page 2268)  
 LDFonts Property (Page 2298)  
 LDTexts Property (Page 2303)  
 LDTooltipTexts Property (Page 2303)  
 Parent Property (Page 2359)  
 Properties Property (Page 2388)  
 Selected Property (Page 2412)  
 TabOrderSwitch Property (Page 2433)  
 TabOrderAlpha Property (Page 2429)  
 Type Property (Page 2450)  
 ConnectionPoints property (Page 2198)  
 ConnectorObjects property (Page 2199)

## Menu Object

### Description

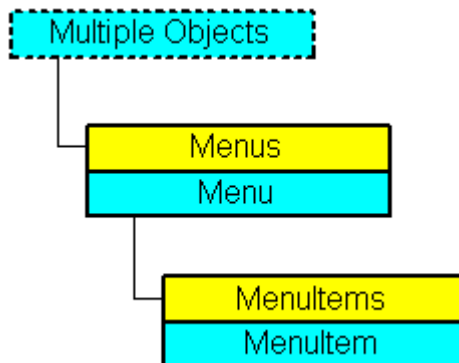

Represents the "User Defined Menu" object. The Menu object is an element of the CustomMenus listing.

## VBA Object Name

HMIMenu

## Usage

Use CustomMenus(Index) to return an individual Menu object. "For Index you can use either the index number or the name of the object. In order for the following example to work, create a user defined menu. For an example of this, please refer to "Creating a New Application-Specific Menu" in this documentation. In the following example the name of the first user-defined menu in the active picture will be output:

```
Sub ShowFirstMenuOfMenucollection()  
'VBA288  
Dim strName As String  
strName = ActiveDocument.CustomMenus(1).Label  
MsgBox strName  
End Sub
```

Use the Delete method to remove a "Menu" object from the "CustomMenus" listing. In the following example the first user-defined menu in the active picture will be removed:

```
Sub DeleteMenu()  
'VBA289  
Dim objMenu As HMIMenu  
Set objMenu = ActiveDocument.CustomMenus(1)  
objMenu.Delete  
End Sub
```

## See also

- [Menus Object \(Listing\) \(Page 2011\)](#)
- [Delete Method \(Page 1831\)](#)
- [How to Create Picture-specific Menus and Toolbars \(Page 1655\)](#)
- [How to Create a New Application-Specific Menu \(Page 1629\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Creating Customized Menus and Toolbars \(Page 1627\)](#)
- [Visible Property \(Page 2551\)](#)
- [StatusText Property \(Page 2426\)](#)
- [Position Property \(Page 2380\)](#)
- [Parent Property \(Page 2359\)](#)
- [MenuItems Property \(Page 2337\)](#)
- [LDStatusTexts Property \(Page 2301\)](#)

LDLabelTexts Property (Page 2299)

Label Property (Page 2288)


Key Property (Page 2287)

Enabled Property (Page 2220)

Application Property (Page 2121)

## Menus Object (Listing)

### Description

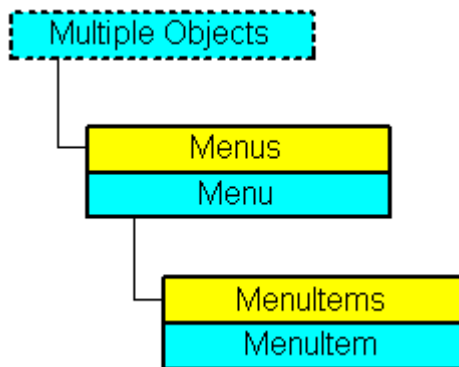

A listing of the Menu objects that represent all the user-defined menus in the Graphics Designer.

### VBA Object Name

HMIMenus

### Usage

Use the CustomMenus property to return the Menus listing. In the following example all the user-defined menus in the active picture will be output.

---

#### Note

The Menu listing does not distinguish between application-specific and picture-specific menus in the output.

---

### 3.6 VBA Reference

```
Sub ShowCustomMenusOfDocument()  
'VBA290  
Dim colMenus As HMIMenus  
Dim objMenu As HMIMenu  
Dim strMenuList As String  
Set colMenus = ActiveDocument.CustomMenus  
For Each objMenu In colMenus  
strMenuList = strMenuList & objMenu.Label & vbCrLf  
Next objMenu  
MsgBox strMenuList  
End Sub
```

Use the Application property and the InsertMenu method if you want to create an application-specific menu. Create the VBA code in either the "Project Template" document or the "Global Template" document. In the following example a user-defined menu called "myApplicationMenu" will be created:

```
Sub InsertApplicationSpecificMenu()  
'VBA291  
Dim objMenu As HMIMenu  
Set objMenu = Application.CustomMenus.InsertMenu(1, "a_Menu1", "myApplicationMenu")  
End Sub
```

Use the ActiveDocument property and the InsertMenu method if you want to create a picture-specific menu. Create the VBA code in the document called "ThisDocument": In the following example a picture-specific menu called "myDocumentMenu" will be created;

```
Sub InsertDocumentSpecificMenu()  
'VBA292  
Dim objMenu As HMIMenu  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "d_Menu1", "myDocumentMenu")  
End Sub
```

#### See also


- Menu Object (Page 2009)
- Item Method (Page 1859)
- InsertMenu Method (Page 1850)
- How to Create Picture-specific Menus and Toolbars (Page 1655)
- How to Create a New Application-Specific Menu (Page 1629)
- VBA Reference (Page 1745)
- Creating Customized Menus and Toolbars (Page 1627)
- Parent Property (Page 2359)

Count Property (Page 2201)

Application Property (Page 2121)

## MenuItem Object

### Description

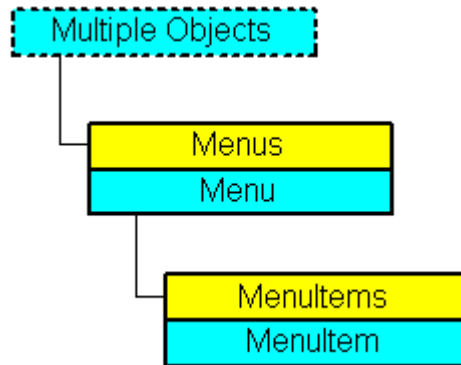

Represents a menu entry for a user-defined menu in the Graphics Designer. The MenuItem object is an element of the MenuItems listing.

### VBA Object Name

HMIMenuItem

### Usage

---

#### Note

In order for the examples to work, first create a user-defined menu. For an example of this, please refer to "Adding a New Entry to the Menu" in this documentation.

---

Use `MenuItems(Index)` to return an individual MenuItem object. "For Index you can use either the index number or the name of the object. In the following example the first entry in the first user-defined menu in the active picture will be output:

```
Sub ShowFirstObjectOfCollection()
'VBA293
Dim strName As String
strName = ActiveDocument.CustomMenus(1).MenuItems(1).Label
MsgBox strName
End Sub
```

### 3.6 VBA Reference

Use the Delete method to remove an object from the "MenuItems" listing. In the following example the first entry in the first user-defined menu in the active picture will be deleted:


```
Sub DeleteMenuItem()  
'VBA294  
ActiveDocument.CustomMenus(1).MenuItems(1).Delete  
End Sub
```

#### See also

- Parent Property (Page 2359)
- MenuItems Object (Listing) (Page 2015)
- Delete Method (Page 1831)
- Configuring Menus and Toolbars (Page 1626)
- How to assign VBA macros to menus and toolbars (Page 1642)
- How to assign help texts to menus and toolbars (Page 1639)
- How to add a new menu entry to a menu (Page 1631)
- VBA Reference (Page 1745)
- Creating Customized Menus and Toolbars (Page 1627)
- Visible Property (Page 2551)
- Tag Property (Page 2434)
- SubMenu Property (Page 2427)
- StatusText Property (Page 2426)
- ShortCut Property (Page 2416)
- Position Property (Page 2380)
- MenuItemType Property (Page 2338)
- Macro Property (Page 2320)
- LDStatusTexts Property (Page 2301)
- LDLabelTexts Property (Page 2299)
- Label Property (Page 2288)
- Key Property (Page 2287)
- Icon Property (Page 2275)
- Enabled Property (Page 2220)
- Checked Property (Page 2172)
- Application Property (Page 2121)

## MenuItems Object (Listing)

### Description

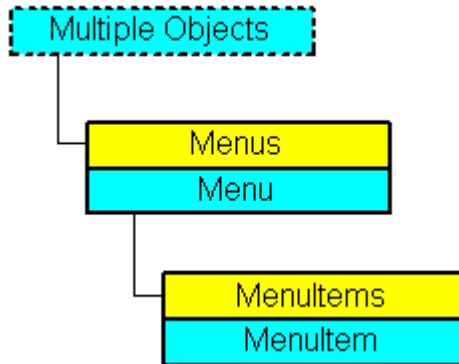

A listing of the MenuItem objects that represent all the entries in a user-defined menu.

### Usage

---

#### Note

In order for the examples to work, first create a user-defined menu. For an example of this, please refer to "Adding a New Entry to the Menu" in this documentation.

---

Use the MenuItem property to return the MenuItem listing. In the following example all the entries in the first user-defined menu in the active picture will be output:

---

#### Note

The MenuItem listing does not distinguish between an application-specific and a picture-specific menu in the output.

---

```

Sub ShowMenuItems ()
'VBA295
Dim colMenuItems As HMIMenuItems
Dim objMenuItem As HMIMenuItem
Dim strItemList As String
Set colMenuItems = ActiveDocument.CustomMenus(1).MenuItems
For Each objMenuItem In colMenuItems
strItemList = strItemList & objMenuItem.Label & vbCrLf
Next objMenuItem
MsgBox strItemList
End Sub
  
```

Use the InsertMenuItem method, for instance, to insert an entry into an existing user-defined menu. In the following example the picture-specific menu "DocMenu2" will be created in the active picture and the menu entry "MenuItem1" is inserted:


```
Sub InsertMenuItem()  
'VBA296  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(2, "d_Menu2", "DocMenu2")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "m_Item2_1", "MenuItem 1")  
End Sub
```

**See also**

- InsertSubmenu Method (Page 1854)
- MenuItem Object (Page 2013)
- InsertSeparator Method (Page 1853)
- InsertMenuItem Method (Page 1852)
- How to add a new menu entry to a menu (Page 1631)
- VBA Reference (Page 1745)
- Creating Customized Menus and Toolbars (Page 1627)
- Parent Property (Page 2359)
- Count Property (Page 2201)
- Application Property (Page 2121)

**MultiLineEdit object**

**Description**

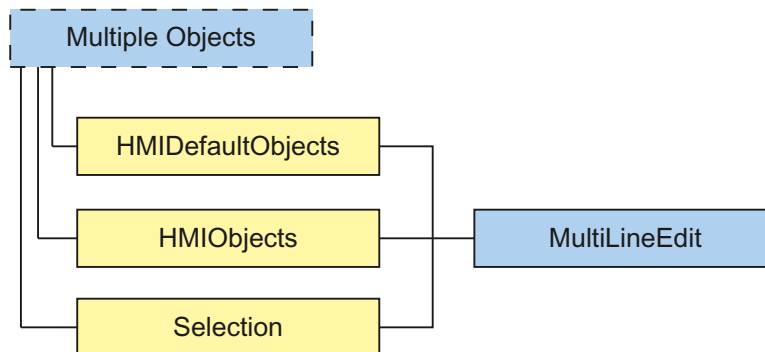



Represents the "MultiLineEdit" object. The MultiLineEdit object is an element of the following listings:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all default, smart, window and tube objects.

## VBA object name

HMIMultiLineEdit

## Usage

Use the Add method to create a new "MultiLineEdit" object in a picture:

```
Sub AddMultiLineEdit()
'VBA832
Dim objMultiLineEdit As HMIMultiLineEdit
Set objMultiLineEdit = ActiveDocument.HMIObjects.AddHMIObject("MultiLineEdit",
"HMIMultiLineEdit")
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditMultiLineEdit()
'VBA833
Dim objMultiLineEdit As HMIMultiLineEdit
Set objMultiLineEdit = ActiveDocument.HMIObjects("MultiLineEdit")
objMultiLineEdit.BorderColor = RGB(255, 0, 0)
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()
'VBA834
'Select all objects in the picture:
ActiveDocument.Selection.SelectAll
'Get the name from the first object of the selection:
MsgBox ActiveDocument.Selection(1).ObjectName
End Sub
```

## See also

[Layer Property \(Page 2293\)](#)

[Left Property \(Page 2305\)](#)

### 3.6 VBA Reference

BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BorderStyle Property (Page 2160)  
BorderWidth Property (Page 2161)  
BackColor Property (Page 2131)  
FontName Property (Page 2257)  
FontSize Property (Page 2258)  
FontBold Property (Page 2256)  
FontItalic Property (Page 2257)  
FontUnderline Property (Page 2259)  
ForeColor Property (Page 2260)  
AlignmentLeft Property (Page 2117)  
Top Property (Page 2446)  
Width Property (Page 2553)  
Height Property (Page 2269)  
Text Property (Page 2439)  
Operation Property (Page 2353)  
PasswordLevel Property (Page 2362)  
Visible Property (Page 2551)  
ToolTipText Property (Page 2445)  
ObjectName Property (Page 2347)  
GlobalShadow property (Page 2264)  
Application Property (Page 2121)  
GroupParent Property (Page 2268)  
LDFonts Property (Page 2298)  
LDTexts Property (Page 2303)  
LDTooltipTexts Property (Page 2303)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Type Property (Page 2450)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## ObjConnection object

### Description

Represents the "Connector" object. The ObjConnection object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.

---

### Note

You have read-only access to the properties of the ObjConnection object.

---

### VBA Object Name

HMIObjConnection

### Application

From the properties of the ObjConnection object you can find out which objects are connected.

### Example

In order for the following example to work you must have connected two objects to the connector in the active picture of the Graphics Designer. You can find the Connector object in the Graphics Designer in the Object Palette under "Standard Objects". For this example to work, give the connector the name "Connector1".

*3.6 VBA Reference*

In the user-defined menu "Connector Info" you can click on the "Connector Info" entry and display the objects connected via the connector:

```
Sub ShowConnectorInfo_Menu()  
'VBA297  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Dim strDocName As String  
strDocName = Application.ApplicationDataPath & ActiveDocument.Name  
Set objMenu = Documents(strDocName).CustomMenus.InsertMenu(1, "ConnectorMenu",  
"Connector_Info")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "ShowConnectInfo", "Info Connector")  
End Sub  
  
Sub ShowConnectorInfo()  
Dim objConnector As HMIObjConnection  
Dim iStart As Integer  
Dim iEnd As Integer  
Dim strStart As String  
Dim strEnd As String  
Dim strObjStart As String  
Dim strObjEnd As String  
Set objConnector = ActiveDocument.HMIObjects("Connector1")  
iStart = objConnector.BottomConnectedConnectionPointIndex  
iEnd = objConnector.TopConnectedConnectionPointIndex  
strObjStart = objConnector.BottomConnectedObjectName  
strObjEnd = objConnector.TopConnectedObjectName  
Select Case iStart  
Case 0  
strStart = "top"  
Case 1  
strStart = "right"  
Case 2  
strStart = "bottom"  
Case 3  
strStart = "left"  
End Select  
Select Case iEnd  
Case 0  
strEnd = "top"  
Case 1  
strEnd = "right"  
Case 2  
strEnd = "bottom"  
Case 3  
strEnd = "left"  
End Select  
MsgBox "The selected connector links the objects " & vbCrLf & "" & strObjStart & "' and '"  
& strObjEnd & "' & vbCrLf & "Connected points: " & vbCrLf & strObjStart & ": " & strStart  
& vbCrLf & strObjEnd & ": " & strEnd  
End Sub  
  
Private Sub Document_MenuItemClicked(ByVal MenuItem As IHMIMenuItem)  
Select Case MenuItem.Key  
Case "ShowConnectInfo"  
Call ShowConnectorInfo  
End Select  
End Sub
```


## See also

TopConnectedConnectionPointIndex Property (Page 2447)  
TopConnectedObjectName Property (Page 2446)  
BottomConnectedConnectionPointIndex Property (Page 2163)  
BottomConnectedObjectName Property (Page 2162)  
Application Property (Page 2121)  
BorderBackColor Property (Page 2152)  
BorderColor Property (Page 2153)  
BorderEndStyle Property (Page 2156)  
BorderFlashColorOff Property (Page 2157)  
BorderFlashColorOn Property (Page 2159)  
BorderStyle Property (Page 2160)  
BorderWidth Property (Page 2161)  
Events Property (Page 2223)  
FlashBorderColor Property (Page 2240)  
FlashRateBorderColor Property (Page 2249)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
Height Property (Page 2269)  
Layer Property (Page 2293)  
LDTooltipTexts Property (Page 2303)  
Left Property (Page 2305)  
ObjectName Property (Page 2347)  
Operation Property (Page 2353)  
Orientation Property (Page 2356)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
ToolTipText Property (Page 2445)

Top Property (Page 2446)  
 Transparency property (Page 2447)  
 Type Property (Page 2450)  
 Visible Property (Page 2551)  
 Width Property (Page 2553)  
 ConnectorType property (Page 2200)  
 ConnectionPoints property (Page 2198)  
 Display property (Page 2214)  
 ConnectorObjects property (Page 2199)

## OLEObject Object

### Description

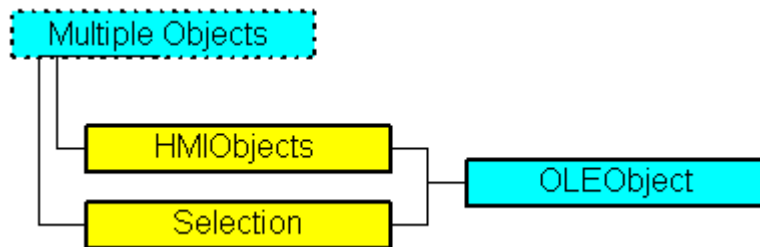

Represents the object called "OLE Element". The OLEObject object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.

### VBA Object Name

HMIOLEObject

### Usage

Use the AddOLEObject method to create a new "OLE Element" object in a picture: In the following example an OLE Element containing a Wordpad document will be inserted into the active picture:

```

Sub AddOLEObjectToActiveDocument()
  'VBA298
  Dim objOleObject As HMIOLEObject
  Set objOleObject = ActiveDocument.HMIObjects.AddOLEObject("Wordpad Document",
  "Wordpad.Document.1")
End Sub
  
```

### 3.6 VBA Reference

Use "HMIObjects(Index)" to return an object from the HMIObjects listing, where "Index" in this case identifies the object by name: In this example the X coordinate of the OLE Element "Wordpad Document" is set to 140:

```
Sub EditOLEObject()  
'VBA299  
Dim objOleObject As HMIOLEObject  
Set objOleObject = ActiveDocument.HMIObjects("Wordpad Document")  
objOleObject.Left = 140  
End Sub
```

Use "Selection(Index)" to return an object from the Selection listing. "For Index you can use either the index number or the name of the object. In this example the name of the first selected object will be output:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA300  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

#### See also


- [How to Create Picture-specific Menus and Toolbars \(Page 1655\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjects Object \(Listing\) \(Page 1990\)](#)
- [Delete Method \(Page 1831\)](#)
- [AddOLEObject Method \(Page 1803\)](#)
- [How to Create an Application-specific Toolbar \(Page 1635\)](#)
- [VBA Reference \(Page 1745\)](#)
- [OLE Objects \(Page 1669\)](#)
- [Application Property \(Page 2121\)](#)
- [Events Property \(Page 2223\)](#)
- [GroupParent Property \(Page 2268\)](#)
- [Height Property \(Page 2269\)](#)
- [Layer Property \(Page 2293\)](#)
- [LDTooltipTexts Property \(Page 2303\)](#)
- [Left Property \(Page 2305\)](#)
- [ObjectName Property \(Page 2347\)](#)



Operation Property (Page 2353)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
ToolTipText Property (Page 2445)  
Top Property (Page 2446)  
Type Property (Page 2450)  
Visible Property (Page 2551)  
Width Property (Page 2553)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## OptionGroup Object

### Description

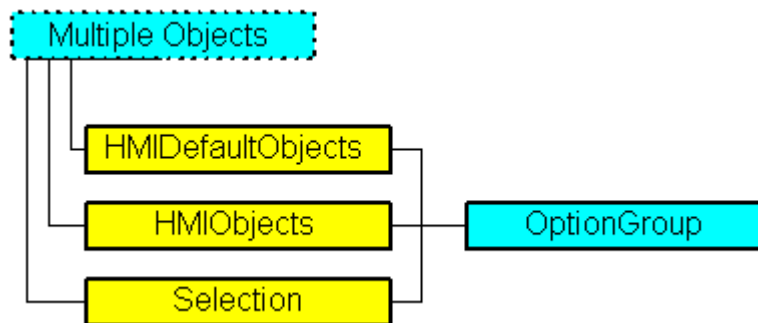

Represents the "Radio Box" object. The OptionGroup object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIOptionGroup

## Usage

Use the Add method to create a new "Option Group" object in a picture:

```
Sub AddOptionGroup()  
'VBA301  
Dim objOptionGroup As HMIOptionGroup  
Set objOptionGroup = ActiveDocument.HMIObjects.AddHMIObject("Radio-Box", "HMIOptionGroup")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditOptionGroup()  
'VBA302  
Dim objOptionGroup As HMIOptionGroup  
Set objOptionGroup = ActiveDocument.HMIObjects("Radio-Box")  
objOptionGroup.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA303  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

- Left Property (Page 2305)
- BorderStyle Property (Page 2160)
- SelectedObjects object (Listing) (Page 2060)
- HMIObjects Object (Listing) (Page 1990)
- HMIDefaultObjects Object (Listing) (Page 1985)
- AddHMIObject Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- Width Property (Page 2553)
- Visible Property (Page 2551)
- Top Property (Page 2446)
- ToolTipText Property (Page 2445)


Text Property (Page 2439)  
Process Property (Page 2383)  
PasswordLevel Property (Page 2362)  
Orientation Property (Page 2356)  
OperationMessage Property (Page 2354)  
Operation Property (Page 2353)  
Layer Property (Page 2293)  
Index Property (Page 2276)  
Height Property (Page 2269)  
ForeFlashColorOn Property (Page 2262)  
ForeFlashColorOff Property (Page 2261)  
ForeColor Property (Page 2260)  
FontUnderline Property (Page 2259)  
FontSize Property (Page 2258)  
FontName Property (Page 2257)  
FontItalic Property (Page 2257)  
FontBold Property (Page 2256)  
FlashRateForeColor Property (Page 2251)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashForeColor Property (Page 2242)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
FillingIndex Property (Page 2233)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
BoxCount Property (Page 2164)  
BoxAlignment Property (Page 2163)  
BorderWidth Property (Page 2161)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)

3.6 VBA Reference

BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
AlignmentTop Property (Page 2118)  
AlignmentLeft Property (Page 2117)  
AdaptBorder Property (Page 2111)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDFonts Property (Page 2298)  
LDTexts Property (Page 2303)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
WindowsStyle property (Page 2557)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## PictureWindow Object

### Description

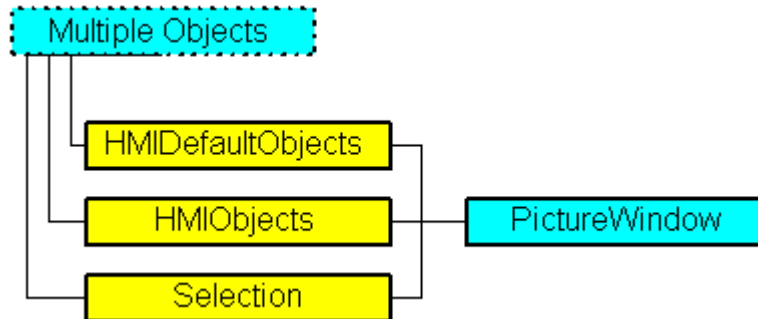

Represents the "Picture Window" object. The PictureWindow object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIPictureWindow

### Usage

Use the Add method to create a new "Picture Window" object in a picture:

```

Sub AddPictureWindow()
'VBA304
Dim objPictureWindow As HMIPictureWindow
Set objPictureWindow = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("PictureWindow1",
"HMIPictureWindow")
End Sub
  
```

Use "HMIOBJECTS"(Index)" to return an object from the HMIOBJECTS listing, where Index in this case identifies the object by name:

```

Sub EditPictureWindow()
'VBA305
Dim objPictureWindow As HMIPictureWindow
Set objPictureWindow = ActiveDocument.HMIOBJECTS("PictureWindow1")
objPictureWindow.Sizeable = True
End Sub
  
```

### 3.6 VBA Reference

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA306  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```


#### See also

- [MaximizeButton Property \(Page 2322\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjets Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObjct Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Zoom Property \(Page 2559\)](#)
- [WindowBorder Property \(Page 2555\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [UpdateCycle Property \(Page 2463\)](#)
- [Top Property \(Page 2446\)](#)
- [TagPrefix Property \(Page 2436\)](#)
- [Sizeable Property \(Page 2421\)](#)
- [ServerPrefix Property \(Page 2416\)](#)
- [ScrollPositionY Property \(Page 2409\)](#)
- [ScrollPositionX Property \(Page 2408\)](#)
- [ScrollBars Property \(Page 2408\)](#)
- [PictureName Property \(Page 2373\)](#)
- [OnTop Property \(Page 2352\)](#)
- [OffsetTop Property \(Page 2351\)](#)
- [OffsetLeft Property \(Page 2350\)](#)
- [Moveable Property \(Page 2342\)](#)
- [Left Property \(Page 2305\)](#)

Layer Property (Page 2293)  
Height Property (Page 2269)  
CloseButton Property (Page 2182)  
CaptionText Property (Page 2169)  
Caption Property (Page 2168)  
AdaptSize Property (Page 2112)  
AdaptPicture Property (Page 2111)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GroupParent Property (Page 2268)  
IndependentWindow property (Page 2276)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Operation Property (Page 2353)  
Parent Property (Page 2359)  
PasswordLevel Property (Page 2362)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
ToolTipText Property (Page 2445)  
Type Property (Page 2450)  
WindowMonitorNumber property (Page 2556)  
WindowPositionMode property (Page 2556)  
ConnectionPoints property (Page 2198)  
MenuToolBarConfig Property (Page 2339)  
TitleBackColorActiveEnd property (Page 2440)  
TitleBackColorActiveStart property (Page 2440)  
TitleBackColorInactiveEnd property (Page 2440)  
TitleBackColorInactiveStart property (Page 2440)  
TitleForeColorActive property (Page 2441)  
TitleForeColorInactive property (Page 2441)  
Pinnable property (Page 2378)  
Pinned property (Page 2378)  
ConnectorObjects property (Page 2199)

## PieSegment Object

### Description

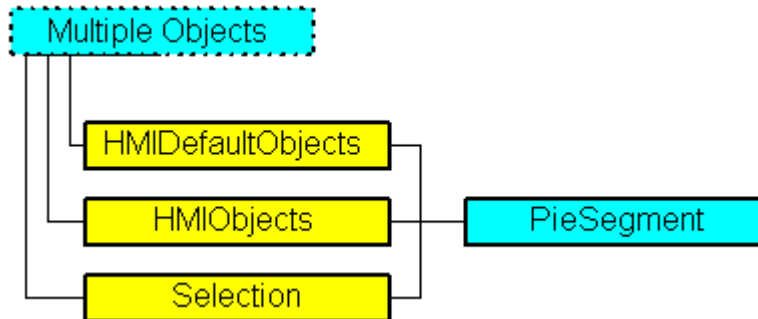

Represents the "Pie Segment" object. The PieSegment object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIPieSegment

### Usage

Use the Add method to create a new "Pie Segment" object in a picture:

```

Sub AddPieSegment()
'VBA307
Dim objPieSegment As HMIPieSegment
Set objPieSegment = ActiveDocument.HMIOBJECTS.AddHMIObject("PieSegment1", "HMIPieSegment")
End Sub
  
```

Use "HMIOBJECTS(Index)" to return an object from the HMIOBJECTS listing, where Index in this case identifies the object by name:

```

Sub EditPieSegment()
'VBA308
Dim objPieSegment As HMIPieSegment
Set objPieSegment = ActiveDocument.HMIOBJECTS("PieSegment1")
objPieSegment.BorderColor = RGB(255, 0, 0)
End Sub
  
```



Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA309  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also


- [Filling Property \(Page 2232\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjets Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObjct Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [StartAngle Property \(Page 2426\)](#)
- [Radius Property \(Page 2394\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)
- [Height Property \(Page 2269\)](#)
- [FlashRateBorderColor Property \(Page 2249\)](#)
- [FlashRateBackColor Property \(Page 2247\)](#)
- [FlashBorderColor Property \(Page 2240\)](#)
- [FlashBackColor Property \(Page 2239\)](#)
- [FillStyle Property \(Page 2235\)](#)
- [FillingIndex Property \(Page 2233\)](#)
- [FillColor Property \(Page 2231\)](#)

### 3.6 VBA Reference

EndAngle Property (Page 2222)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## Polygon Object

### Description

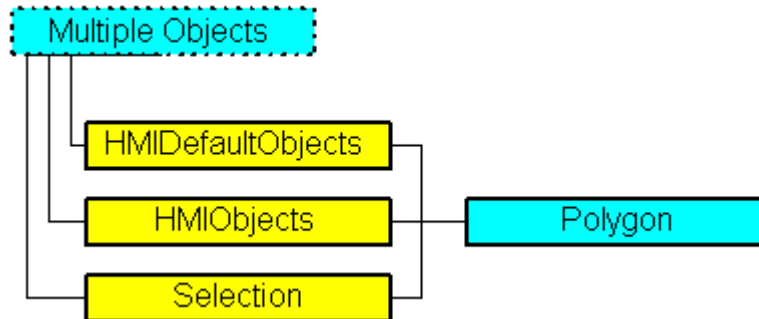

Represents the "Polygon" object. The Polygon object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIPolygon

### Usage

Use the Add method to create a new "Polygon" object in a picture:

```
Sub AddPolygon()  
'VBA310  
Dim objPolygon As HMIPolygon  
Set objPolygon = ActiveDocument.HMIOBJECTS.AddHMIObject("Polygon", "HMIPolygon")  
End Sub
```

Use "HMIOBJECTS"(Index)" to return an object from the HMIOBJECTS listing, where Index in this case identifies the object by name:

```
Sub EditPolygon()  
'VBA311  
Dim objPolygon As HMIPolygon  
Set objPolygon = ActiveDocument.HMIOBJECTS("Polygon")  
objPolygon.BorderColor = RGB (255, 0, 0)  
End Sub
```

### 3.6 VBA Reference

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA312  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```


#### See also

- [ToolTipText Property \(Page 2445\)](#)
- [BorderBackColor Property \(Page 2152\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIOBJECTS Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObject Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [RotationAngle Property \(Page 2400\)](#)
- [ReferenceRotationTop Property \(Page 2397\)](#)
- [ReferenceRotationLeft Property \(Page 2396\)](#)
- [PointCount Property \(Page 2379\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)
- [Index Property \(Page 2276\)](#)
- [Height Property \(Page 2269\)](#)
- [FlashRateBorderColor Property \(Page 2249\)](#)
- [FlashRateBackColor Property \(Page 2247\)](#)
- [FlashBorderColor Property \(Page 2240\)](#)
- [FlashBackColor Property \(Page 2239\)](#)

FillStyle Property (Page 2235)  
FillingIndex Property (Page 2233)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
ActualPointTop Property (Page 2110)  
ActualPointLeft Property (Page 2109)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## PolyLine Object

### Description

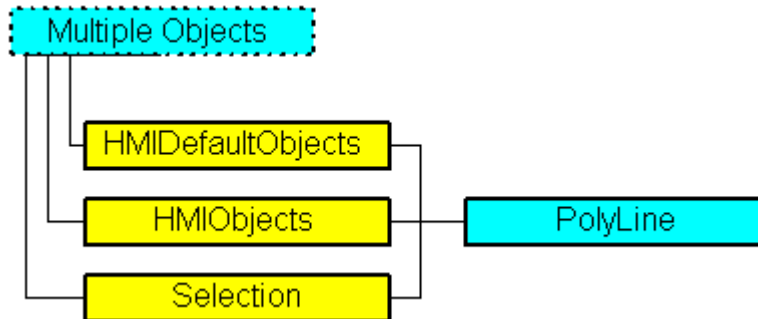

Represents the "Polyline" object. The PolyLine object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIPolyLine

### Usage

Use the Add method to create a new "Polyline" object in a picture:

```

Sub AddPolyLine()
'VBA313
Dim objPolyLine As HMIPolyLine
Set objPolyLine = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("PolyLine1", "HMIPolyLine")
End Sub
  
```

Use "HMIOBJECTS(Index)" to return an object from the HMIOBJECTS listing, where Index in this case identifies the object by name:

```

Sub EditPolyLine()
'VBA314
Dim objPolyLine As HMIPolyLine
Set objPolyLine = ActiveDocument.HMIOBJECTS("PolyLine1")
objPolyLine.BorderColor = RGB(255, 0, 0)
End Sub
  
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA315  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

Use the "HMIDefaultObjects(Index)" to return an object from the HMIDefaultObjects Listing:

```
Sub EditDefaultPropertiesOfPolyLine()  
'VBA316  
Dim objPolyLine As HMIPolyLine  
Set objPolyLine = Application.DefaultHMIObjects("HMIPolyLine")  
objPolyLine.BorderColor = RGB(255, 255, 0)  
End Sub
```

## See also

- HMIDefaultObjects Object (Listing) (Page 1985)
- BorderEndStyle Property (Page 2156)
- SelectedObjects object (Listing) (Page 2060)
- HMIObjects Object (Listing) (Page 1990)
- AddHMIObject Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- Width Property (Page 2553)
- Visible Property (Page 2551)
- Top Property (Page 2446)
- ToolTipText Property (Page 2445)
- RotationAngle Property (Page 2400)
- ReferenceRotationTop Property (Page 2397)
- ReferenceRotationLeft Property (Page 2396)
- PointCount Property (Page 2379)
- PasswordLevel Property (Page 2362)
- Operation Property (Page 2353)
- Left Property (Page 2305)
- Layer Property (Page 2293)


### 3.6 VBA Reference

Index Property (Page 2276)  
Height Property (Page 2269)  
FlashRateBorderColor Property (Page 2249)  
FlashBorderColor Property (Page 2240)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
ActualPointTop Property (Page 2110)  
ActualPointLeft Property (Page 2109)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)



## Properties Object (Listing)

### Description

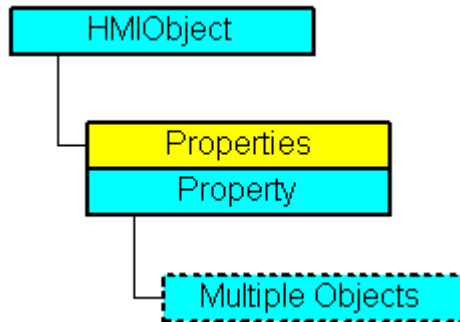

A listing of the Property objects that represent all the properties of an object.

### VBA Object Name

HMIProperties

### Usage

Use the Properties(Index) property in order to return a Property object if you cannot access an object property directly. For "Index" you can use either the index number or the VBA property name of the object. In the following example the Properties property has to be used to access the individual properties of a circle. The circle will be inserted into the picture as an HMIOBJECT object:

```

Sub AddObject()
'VBA319
Dim objObject As HMIOBJECT
Set objObject = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("CircleAsHMIOBJECT", "HMICircle")
'
'Standard properties (e.g. "Position") are available every time:
objObject.Top = 40
objObject.Left = 40
'
'Individual properties have to be called using
'property "Properties":
objObject.Properties("FlashBackColor") = True
End Sub
  
```

### See also


VBA Reference (Page 1745)

Editing Objects with VBA (Page 1660)

Parent Property (Page 2359)  
 Count Property (Page 2201)  
 Application Property (Page 2121)  
 Item Property (Page 2283)

## Property Object

### Description

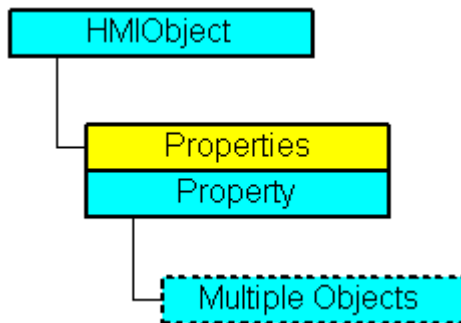

Represents the property of an object. In the case of the Property object the use of the Value property is set as the default. For this reason you can use the following notation in order for example to assign a new value to an object property:

```
<Object>.<Property> = <Value>
```

You can use the "Dynamic" property in order to make an object property dynamic with VBA. Use the "Events" listing in order to configure actions with VBA.

The Property object is an element of the Properties listing.

### VBA Object Name

HMIProperty

### Usage

Use Properties(Index) to return an individual Property object. For "Index" you can use either the index number or the name of the object property. In the following example the name of the first property of the Circle object will be output:

```
Sub ShowFirstObjectOfCollection()
  'VBA317
  Dim objCircle As HMICircle
  Dim strName As String
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle", "HMICircle")
  strName = objCircle.Properties(1).Name
  MsgBox strName
End Sub
```

Use the `CreateDynamic` method to make an object property dynamic. In the following example the "Radius" property of a circle object will be made dynamic with the aid of the tag "Otto", which is updated every two seconds:


```
Sub DynamicToRadiusOfNewCircle()  
'VBA318  
Dim objVariableTrigger As HMIVariableTrigger  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects("Circle")  
Set objVariableTrigger =  
objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVariableDirect, "NewDynamic1")  
objVariableTrigger.CycleType = hmiCycleType_2s  
End Sub
```

## See also

- [DisplayName Property \(Page 2214\)](#)
- [Properties Object \(Listing\) \(Page 2041\)](#)
- [DeleteDynamic Method \(Page 1833\)](#)
- [CreateDynamic Method \(Page 1828\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Creating Dynamics with VBA \(Page 1686\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Value Property \(Page 2469\)](#)
- [Parent Property \(Page 2359\)](#)
- [Name Property \(Page 2343\)](#)
- [IsDynamicable Property \(Page 2280\)](#)
- [Events Property \(Page 2223\)](#)
- [Dynamic Property \(Page 2218\)](#)
- [Application Property \(Page 2121\)](#)
- [IsPublished property \(Page 2281\)](#)

## QualityCodeStateValue Object

### Description

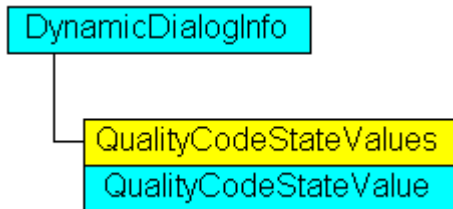

Represents the quality code of a tag which is assigned in the dynamic dialog and used for dynamization.

### VBA Object Name

HMIQualityCodeStateValue

### Object properties

The object QualityCodeStateValue has the following properties:

- Application
- Parent
- VALUE\_BAD\_COMMLUV
- VALUE\_BAD\_COMMLUV
- VALUE\_BAD\_CONFERROR
- VALUE\_BAD\_DEVICE
- VALUE\_BAD\_MISCSTATES
- VALUE\_BAD\_NONSPECIFIC
- VALUE\_BAD\_NOTCONNECTED
- VALUE\_BAD\_OUTOFSERV
- VALUE\_BAD\_PROCRELNOM
- VALUE\_BAD\_PROCRELSUB
- VALUE\_HIGHLIMITED
- VALUE\_LOWLIMITED
- VALUE\_UNCERT\_ENGVHIGHLIM
- VALUE\_UNCERT\_ENGVLOWLIM
- VALUE\_UNCERT\_ENGVONLIM
- VALUE\_UNCERT\_INITVAL
- VALUE\_UNCERT\_LUV

- VALUE\_UNCERT\_MAINTDEM
- VALUE\_UNCERT\_MISCSTATES
- VALUE\_UNCERT\_NONSPECIFIC
- VALUE\_UNCERT\_PROCRELNOM
- VALUE\_UNCERT\_SIMVAL
- VALUE\_UNCERT\_SUBSTSET
- VarName

## See also


VALUE\_BAD\_CONFERROR Property (Page 2478)  
VBA Reference (Page 1745)  
VarName Property (Page 2548)  
VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)

Parent Property (Page 2359)

Application Property (Page 2121)

### QualityCodeStateValues Object (Listing)

#### Description

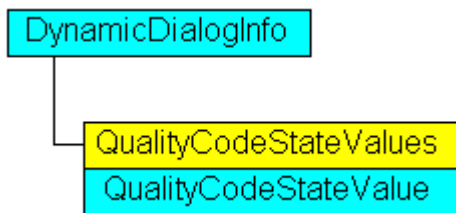

A listing of QualityCodeStateValue objects which contain all quality codes in Dynamic dialog and are used for dynamization.

#### VBA Object Name

HMIQualityCodeStateValues

## Application

For example, use the Item property to define values in Dynamic dialog which will be used for dynamization when the specified tag returns the configured quality code. In the following example the radius of a circle is given dynamics with the dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA813
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'Activate qualitycode-statecheck
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

## Object properties

The object QualityCodeStateValues has the following properties:

- Application
- Count

### 3.6 VBA Reference

- Item
- Parent

#### See also


VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VBA Reference (Page 1745)  
VarName Property (Page 2548)  
VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
Parent Property (Page 2359)  
Item Property (Page 2283)  
Count Property (Page 2201)  
Application Property (Page 2121)



## R-Z

## Rectangle Object

## Description

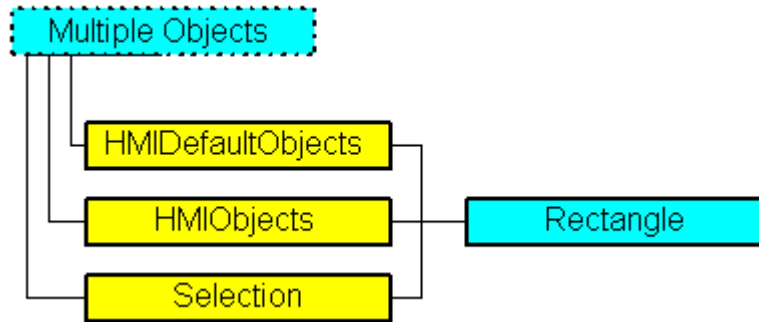

Represents the "Rectangle" object. The Rectangle object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

## VBA Object Name

HMIRectangle

## Usage

Use the Add method to create a new "Rectangle" object in a picture:

```

Sub AddRectangle()
'VBA320
Dim objRectangle As HMIRectangle
Set objRectangle = ActiveDocument.HMIOBJECTS.AddHMIObject("Rectangle1", "HMIRectangle")
End Sub
  
```

Use "HMIOBJECTS"(Index)" to return an object from the HMIOBJECTS listing, where Index in this case identifies the object by name:

```

Sub EditRectangle()
'VBA321
Dim objRectangle As HMIRectangle
Set objRectangle = ActiveDocument.HMIOBJECTS("Rectangle1")
objRectangle.BorderColor = RGB(255, 0, 0)
End Sub
  
```

### 3.6 VBA Reference

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA322  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

#### See also


- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIOBJECTS Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIOBJECT Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Operation Property \(Page 2353\)](#)
- [Left Property \(Page 2305\)](#)
- [Layer Property \(Page 2293\)](#)
- [Height Property \(Page 2269\)](#)
- [FlashRateBorderColor Property \(Page 2249\)](#)
- [FlashRateBackColor Property \(Page 2247\)](#)
- [FlashBorderColor Property \(Page 2240\)](#)
- [FlashBackColor Property \(Page 2239\)](#)
- [FillStyle Property \(Page 2235\)](#)
- [FillingIndex Property \(Page 2233\)](#)
- [Filling Property \(Page 2232\)](#)
- [FillColor Property \(Page 2231\)](#)
- [BorderWidth Property \(Page 2161\)](#)
- [BorderStyle Property \(Page 2160\)](#)

---

BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## RoundButton Object

### Description

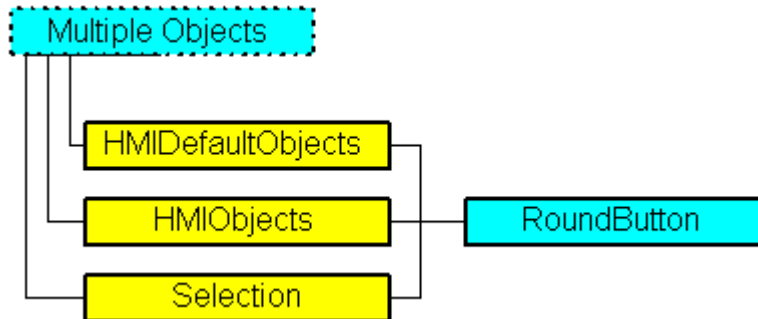

Represents the "Round Button" object. The RoundButton object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMIRoundButton

### Usage

Use the Add method to create a new "Round Button" object in a picture:

```

Sub AddRoundButton()
'VBA323
Dim objRoundButton As HMIRoundButton
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("Roundbutton1",
"HMIRoundButton")
End Sub
  
```

Use "HMIObjects(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```

Sub EditRoundButton()
'VBA324
Dim objRoundButton As HMIRoundButton
Set objRoundButton = ActiveDocument.HMIObjects("Roundbutton1")
objRoundButton.BorderColor = RGB(255, 0, 0)
End Sub
  
```

Use "Selection"(Index) to return an object from the Selection listing.:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA325  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

- [ToolTipText Property \(Page 2445\)](#)
- [FlashBackColor Property \(Page 2239\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIOBJECTS Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIOBJECT Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [Toggle Property \(Page 2441\)](#)
- [Radius Property \(Page 2394\)](#)
- [Pressed Property \(Page 2382\)](#)
- [PicUpUseTransColor Property \(Page 2377\)](#)
- [PicUpTransparent Property \(Page 2376\)](#)
- [PicUpReferenced Property \(Page 2375\)](#)
- [PictureUp Property \(Page 2374\)](#)
- [PictureDown Property \(Page 2372\)](#)
- [PictureDeactivated Property \(Page 2371\)](#)
- [PicDownUseTransColor Property \(Page 2369\)](#)
- [PicDownTransparent Property \(Page 2368\)](#)
- [PicDownReferenced Property \(Page 2367\)](#)
- [PicDeactUseTransColor Property \(Page 2367\)](#)
- [PicDeactTransparent Property \(Page 2366\)](#)


### 3.6 VBA Reference

PicDeactReferenced-Eigenschaft (Page 2365)  
PasswordLevel Property (Page 2362)  
Operation Property (Page 2353)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
Height Property (Page 2269)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashBorderColor Property (Page 2240)  
FillStyle Property (Page 2235)  
FillingIndex Property (Page 2233)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColorTop Property (Page 2155)  
BorderColor Property (Page 2153)  
BorderColorBottom Property (Page 2155)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
BackBorderWidth Property (Page 2131)  
AlignmentLeft Property (Page 2117)  
AlignmentTop Property (Page 2118)  
Application Property (Page 2121)  
DisplayOptions Property (Page 2215)  
Events Property (Page 2223)  
FontBold Property (Page 2256)  
FontItalic Property (Page 2257)  
FontName Property (Page 2257)  
FontSize Property (Page 2258)  
FontUnderline Property (Page 2259)

ForeColor Property (Page 2260)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDFonts Property (Page 2298)  
LDTexts Property (Page 2303)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
PictAlignment property (Page 2370)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Text Property (Page 2439)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
WinCCStyle property (Page 2554)  
WindowsStyle property (Page 2557)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## RoundRectangle Object

### Description

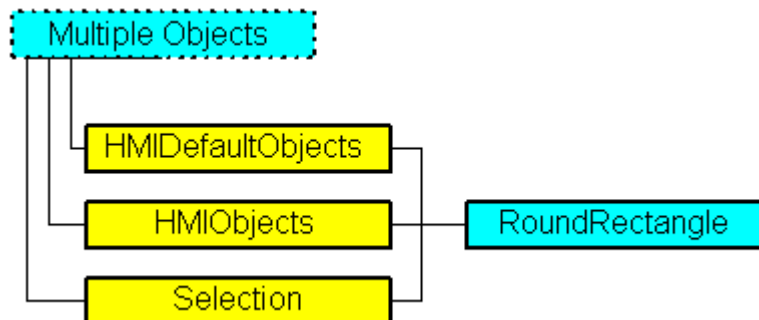

Represents the "Rounded Rectangle" object. The RoundRectangle object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

## VBA Object Name

HMIRoundRectangle

## Usage

Use the Add method to create a new "Rounded Rectangle" object in a picture:

```
Sub AddRoundRectangle()  
'VBA326  
Dim objRoundRectangle As HMIRoundRectangle  
Set objRoundRectangle = ActiveDocument.HMIObjects.AddHMIObject("Roundrectangle1",  
"HMIRoundRectangle")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditRoundRectangle()  
'VBA327  
Dim objRoundRectangle As HMIRoundRectangle  
Set objRoundRectangle = ActiveDocument.HMIObjects("Roundrectangle1")  
objRoundRectangle.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA328  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

Width Property (Page 2553)

BorderBackColor Property (Page 2152)




SelectedObjects object (Listing) (Page 2060)  
HMIOjects Object (Listing) (Page 1990)  
HMIDefaultObjects Object (Listing) (Page 1985)  
AddHMIOject Method (Page 1801)  
VBA Reference (Page 1745)  
Editing Objects with VBA (Page 1660)  
Visible Property (Page 2551)  
Top Property (Page 2446)  
ToolTipText Property (Page 2445)  
RoundCornerWidth Property (Page 2402)  
RoundCornerHeight Property (Page 2401)  
PasswordLevel Property (Page 2362)  
Operation Property (Page 2353)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
Height Property (Page 2269)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
FillingIndex Property (Page 2233)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)

- GlobalShadow property (Page 2264)
- GroupParent Property (Page 2268)
- LDTooltipTexts Property (Page 2303)
- ObjectName Property (Page 2347)
- Parent Property (Page 2359)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Transparency property (Page 2447)
- Type Property (Page 2450)
- DrawInsideFrame property (Page 2218)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### ScriptInfo Object

#### Description

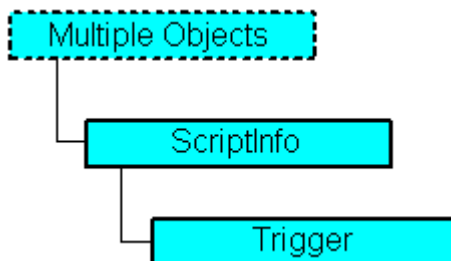

Represents a script (C, VB) that is configured for adding dynamics to a property or action to an event.

#### VBA Object Name

HMIScriptInfo

## Usage

Use the `CreateDynamic` method to make a property dynamic with the aid of a script. In the following example...

```
Sub AddDynamicAsCSkriptToProperty()  
'VBA329  
Dim objCScript As HMIScriptInfo  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle1", "HMICircle")  
Set objCScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeCScript)  
'  
'Define triggertype and cycletime:  
With objCScript  
.SourceCode = ""  
.Trigger.Type = hmiTriggerTypeStandardCycle  
.Trigger.CycleType = hmiCycleType_2s  
.Trigger.Name = "Trigger1"  
End With  
End Sub
```

Use the `AddAction` method to configure an action on an event. In the following example...

```
Sub AddActionToPropertyTypeCScript()  
'VBA330  
Dim objEvent As HMIEvent  
Dim objCScript As HMIScriptInfo  
Dim objCircle As HMICircle  
'Add circle to picture. By changing of property "Radius"  
'a C-action is added:  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_AB", "HMICircle")  
Set objEvent = objCircle.Radius.Events(1)  
Set objCScript = objEvent.Actions.AddAction(hmiActionCreationTypeCScript)  
End Sub
```

## See also


- [Prototype Property \(Page 2389\)](#)
- [Delete Method \(Page 1831\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Creating Dynamics with VBA \(Page 1686\)](#)
- [Trigger Property \(Page 2449\)](#)
- [SourceCode Property \(Page 2424\)](#)
- [ScriptType Property \(Page 2407\)](#)
- [Parent Property \(Page 2359\)](#)
- [Compiled Property \(Page 2197\)](#)

Application Property (Page 2121)

UsedLanguage property (Page 2464)

### SelectedObjects object (Listing)

#### Description

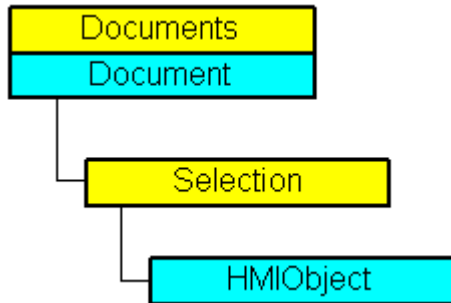

A listing of the HMIObject objects that represent all the selected objects in a picture.

#### VBA Object Name

HMISelectedObjects

#### Usage

Use the Selection property to return the Selection listing. In the following example the names of all the selected objects in the active picture will be output:

```
Sub ShowSelectionOfDocument()  
    'VBA331  
    Dim colSelection As HMISelectedObjects  
    Dim objObject As HMIObject  
    Dim strObjectList As String  
    Set colSelection = ActiveDocument.Selection  
    If colSelection.Count <> 0 Then  
        strObjectList = "List of selected objects:"  
        For Each objObject In colSelection  
            strObjectList = strObjectList & vbCrLf & objObject.ObjectName  
        Next objObject  
    Else  
        strObjectList = "No objects selected"  
    End If  
    MsgBox strObjectList  
End Sub
```

Use the `SelectAll` method, for example, to select all the objects in the picture. In the following example all the objects in the active picture are selected:

```
Sub SelectAllObjects()  
'VBA332  
ActiveDocument.Selection.SelectAll  
End Sub
```


## See also

- [HMIObjets Object \(Listing\) \(Page 1990\)](#)
- [AlignTop Method \(Page 1810\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [BringToFront Method \(Page 1813\)](#)
- [SendToBack Method \(Page 1883\)](#)
- [SelectAll Method \(Page 1882\)](#)
- [SameWidthAndHeight Method \(Page 1877\)](#)
- [SameWidth Method \(Page 1876\)](#)
- [SameHeight Method \(Page 1874\)](#)
- [Rotate Method \(Page 1872\)](#)
- [Remove Method \(Page 1871\)](#)
- [ForwardOneLevel Method \(Page 1846\)](#)
- [BackwardOneLevel Method \(Page 1811\)](#)
- [MoveSelection Method \(Page 1865\)](#)
- [Item Method \(Page 1859\)](#)
- [FlipVertically Method \(Page 1845\)](#)
- [FlipHorizontally Method \(Page 1843\)](#)
- [EvenlySpaceVertically Method \(Page 1838\)](#)
- [EvenlySpaceHorizontally Method \(Page 1837\)](#)
- [DuplicateSelection Method \(Page 1836\)](#)
- [DeselectAll Method \(Page 1834\)](#)
- [DeleteAll Method \(Page 1832\)](#)
- [CreateGroup Method \(Page 1829\)](#)
- [CreateCustomizedObject Method \(Page 1825\)](#)
- [CopySelection Method \(Page 1823\)](#)
- [CenterVertically Method \(Page 1816\)](#)

- CenterHorizontally Method (Page 1815)
- AlignRight Method (Page 1809)
- AlignLeft Method (Page 1808)
- AlignBottom Method (Page 1807)
- How to Edit a Customized Object with VBA (Page 1683)
- How to Edit the Group Objects Using VBA (Page 1676)
- How to edit Default objects, Smart objects, Windows objects and Tube objects (Page 1664)
- VBA Reference (Page 1745)
- Customized Objects (Page 1682)
- Group Objects (Page 1674)
- Default objects, Smart objects, Windows objects and Tube objects (Page 1662)
- Editing Objects with VBA (Page 1660)
- Parent Property (Page 2359)
- Count Property (Page 2201)
- Application Property (Page 2121)

## Slider object

### Description

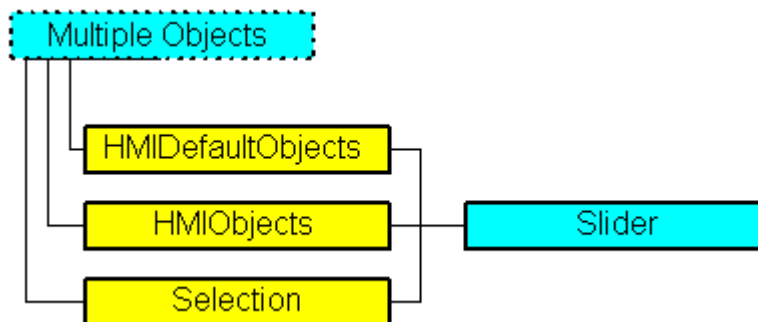

Represents the object called "Slider Object". The Slider object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMISlider

## Usage

Use the Add method to create a new "Slider Object" object in a picture:

```
Sub AddSlider()  
'VBA333  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("Slider1", "HMISlider")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditSlider()  
'VBA334  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects("Slider1")  
objSlider.ButtonColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA335  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

- OperationReport Property (Page 2355)
- BorderFlashColorOff Property (Page 2157)
- SelectedObjects object (Listing) (Page 2060)
- HMIObjects Object (Listing) (Page 1990)
- HMIDefaultObjects Object (Listing) (Page 1985)
- AddHMIObject Method (Page 1801)
- VBA Reference (Page 1745)
- Editing Objects with VBA (Page 1660)
- Width Property (Page 2553)
- Visible Property (Page 2551)
- Top Property (Page 2446)
- ToolTipText Property (Page 2445)

### 3.6 VBA Reference


SmallChange Property (Page 2421)  
Process Property (Page 2383)  
PasswordLevel Property (Page 2362)  
OperationMessage Property (Page 2354)  
Operation Property (Page 2353)  
Min Property (Page 2340)  
Max Property (Page 2322)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
Height Property (Page 2269)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
FillingIndex Property (Page 2233)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
ExtendedOperation Property (Page 2227)  
Direction Property (Page 2213)  
ColorTop Property (Page 2191)  
ColorBottom Property (Page 2184)  
ButtonColor Property (Page 2167)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColorTop Property (Page 2135)  
BackColor Property (Page 2131)  
BackColorBottom Property (Page 2135)  
BackBorderWidth Property (Page 2131)  
Application Property (Page 2121)



Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
WinCCStyle property (Page 2554)  
WindowsStyle property (Page 2557)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## SourceLink Object

### Description

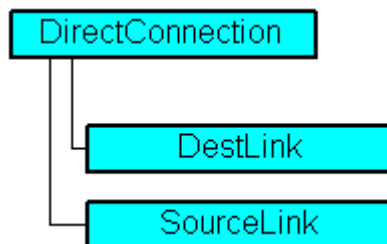

Represents the source for a direct connection.

### VBA Object Name

HMISourceLink

## Usage

Use the SourceLink property to return the SourceLink object. In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:


```
Sub DirectConnection()  
'VBA336  
Dim objButton As HMIButton  
Dim objRectangleA As HMIRectangle  
Dim objRectangleB As HMIRectangle  
Dim objEvent As HMIEvent  
Dim objDirConnection As HMIDirectConnection  
,  
'Add objects to active document:  
Set objRectangleA = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A", "HMIRectangle")  
Set objRectangleB = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objRectangleA  
.Top = 100  
.Left = 100  
End With  
With objRectangleB  
.Top = 250  
.Left = 400  
.BackColor = RGB(255, 0, 0)  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Text = "SetPosition"  
End With  
,  
'Initiation of directconnection by mouseclick:  
Set objDirConnection =  
objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectConnection)  
With objDirConnection  
'Sourceobject: Top-property of Rectangle_A  
.SourceLink.Type = hmiSourceTypeProperty  
.SourceLink.ObjectName = "Rectangle_A"  
.SourceLink.AutomationName = "Top"  
,  
'Targetobject: Left-property of Rectangle_B  
.DestinationLink.Type = hmiDestTypeProperty  
.DestinationLink.ObjectName = "Rectangle_B"  
.DestinationLink.AutomationName = "Left"  
End With  
End Sub
```

## See also

DirectConnection Object (Page 1947)  
VBA Reference (Page 1745)  
Type Property (Page 2450)  
SourceLink Property (Page 2422)  
ObjectName Property (Page 2347)  
AutomationName Property (Page 2124)  
Application Property (Page 2121)  
Parent Property (Page 2359)

## StaticText Object

### Description

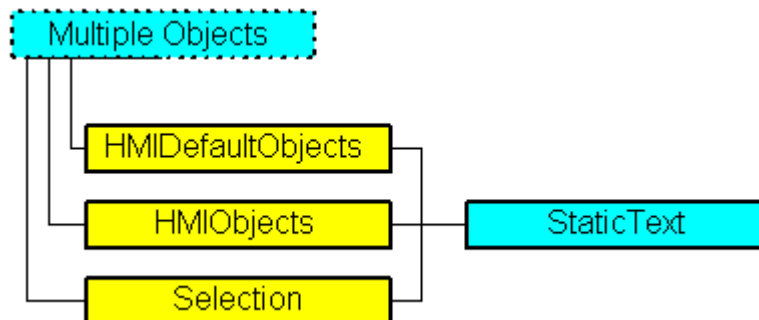

Represents the "Static Text" object. The StaticText object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

## VBA Object Name

HMIShadowText

## Usage

Use the Add method to create a new "Static Text" object in a picture:

```
Sub AddStaticText()  
'VBA337  
Dim objStaticText As HMIShadowText  
Set objStaticText = ActiveDocument.HMIObjects.AddHMIObject("Static_Text1", "HMIShadowText")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditStaticText()  
'VBA338  
Dim objStaticText As HMIShadowText  
Set objStaticText = ActiveDocument.HMIObjects("Static_Text1")  
objStaticText.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA339  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also


- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [FontBold Property \(Page 2256\)](#)
- [HMIObjects Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObject Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Width Property \(Page 2553\)](#)
- [Visible Property \(Page 2551\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [Text Property \(Page 2439\)](#)

PasswordLevel Property (Page 2362)  
Orientation Property (Page 2356)  
Operation Property (Page 2353)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
Height Property (Page 2269)  
ForeFlashColorOn Property (Page 2262)  
ForeFlashColorOff Property (Page 2261)  
ForeColor Property (Page 2260)  
FontUnderline Property (Page 2259)  
FontSize Property (Page 2258)  
FontName Property (Page 2257)  
FontItalic Property (Page 2257)  
FlashRateForeColor Property (Page 2251)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashForeColor Property (Page 2242)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
FillingIndex Property (Page 2233)  
Filling Property (Page 2232)  
FillColor Property (Page 2231)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
AlignmentTop Property (Page 2118)  
AlignmentLeft Property (Page 2117)  
AdaptBorder Property (Page 2111)

- Application Property (Page 2121)
- Events Property (Page 2223)
- GlobalColorScheme property (Page 2264)
- GlobalShadow property (Page 2264)
- GroupParent Property (Page 2268)
- LDFonts Property (Page 2298)
- LDTexts Property (Page 2303)
- LDTooltipTexts Property (Page 2303)
- ObjectName Property (Page 2347)
- Parent Property (Page 2359)
- Properties Property (Page 2388)
- ReferenceRotationLeft Property (Page 2396)
- ReferenceRotationTop Property (Page 2397)
- RotationAngle Property (Page 2400)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Transparency property (Page 2447)
- Type Property (Page 2450)
- DrawInsideFrame property (Page 2218)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### StatusDisplay Object

#### Description

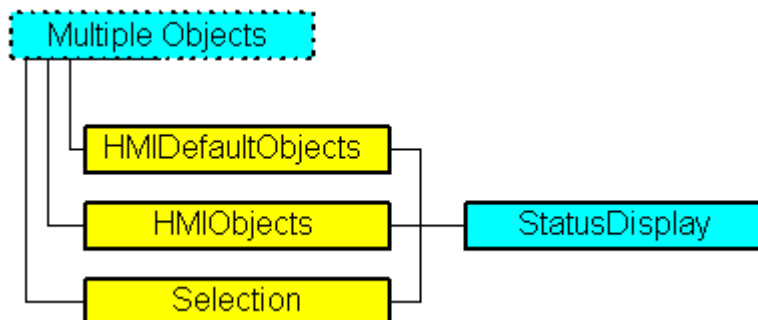

Represents the "Status Display" object. The "StatusDisplay" object is an element of the following listings:

- **Objects:** Contains all objects of a picture.
- **Selection:** Contains all selected objects of a picture.
- **HMIDefaultObjects:** Contains the default property values of all standard, Windows, and smart objects.

## VBA Object Name

HMIStatusDisplay

## Usage

Use the Add method to create a new "Status Display" object in a picture:

```
Sub AddStatusDisplay()  
'VBA340  
Dim objStatusDisplay As HMIStatusDisplay  
Set objStatusDisplay = ActiveDocument.HMIObjects.AddHMIObject("Statusdisplay1",  
"HMIStatusDisplay")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditStatusDisplay()  
'VBA341  
Dim objStatusDisplay As HMIStatusDisplay  
Set objStatusDisplay = ActiveDocument.HMIObjects("Statusdisplay1")  
objStatusDisplay.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA342  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

[ToolTipText Property \(Page 2445\)](#)

[BasePicReferenced Property \(Page 2143\)](#)

### 3.6 VBA Reference


SelectedObjects object (Listing) (Page 2060)  
HMIOjects Object (Listing) (Page 1990)  
HMIDefaultObjects Object (Listing) (Page 1985)  
AddHMIOject Method (Page 1801)  
VBA Reference (Page 1745)  
Editing Objects with VBA (Page 1660)  
Width Property (Page 2553)  
Visible Property (Page 2551)  
Top Property (Page 2446)  
PasswordLevel Property (Page 2362)  
Operation Property (Page 2353)  
Left Property (Page 2305)  
Layer Property (Page 2293)  
Index Property (Page 2276)  
Height Property (Page 2269)  
FlashRateFlashPic Property (Page 2250)  
FlashRateBorderColor Property (Page 2249)  
FlashPicUseTransColor Property (Page 2246)  
FlashPicture Property (Page 2244)  
FlashPicTransColor Property (Page 2243)  
FlashPicReferenced Property (Page 2242)  
FlashFlashPicture Property (Page 2241)  
FlashBorderColor Property (Page 2240)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BasePicUseTransColor Property (Page 2145)  
BasePicture Property (Page 2144)  
BasePicTransColor Property (Page 2144)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)



GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
Selected Property (Page 2412)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
DrawInsideFrame property (Page 2218)  
ConnectionPoints property (Page 2198)  
ConnectorObjects property (Page 2199)

## SymbolLibraries Object (Listing)

### Description

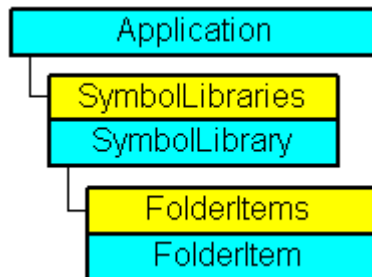

A listing of the SymbolLibrary objects that represent the Components Library. The listing contains two objects: The first object is the "Global Library" and the second object is the "Project Library".

### VBA Object Name

HMISymbolLibraries

## Usage

Use the SymbolLibraries property to return the SymbolLibraries listing. In the following example the names of the libraries will be output:

```
Sub ShowSymbolLibraries()  
  'VBA344  
  Dim colSymbolLibraries As HMISymbolLibraries  
  Dim objSymbolLibrary As HMISymbolLibrary  
  Dim strLibraryList As String  
  Set colSymbolLibraries = Application.SymbolLibraries  
  For Each objSymbolLibrary In colSymbolLibraries  
    strLibraryList = strLibraryList & objSymbolLibrary.Name & vbCrLf  
  Next objSymbolLibrary  
  MsgBox strLibraryList  
End Sub
```

## See also

[SymbolLibrary Object \(Page 2074\)](#)

[Item Method \(Page 1859\)](#)

[VBA Reference \(Page 1745\)](#)

[Accessing the component library with VBA \(Page 1646\)](#)


[Parent Property \(Page 2359\)](#)

[Count Property \(Page 2201\)](#)

[Application Property \(Page 2121\)](#)

## SymbolLibrary Object

### Description

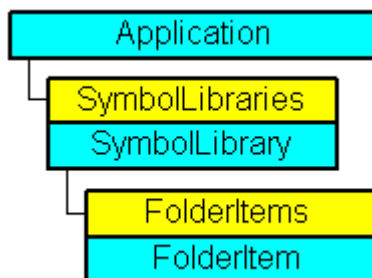

Represents the "Global Library" or "Project Library". The SymbolLibrary object is an element of the SymbolLibraries listing.

## VBA Object Name

HMISymbolLibrary

## Usage

Use `SymbolLibraries(Index)` to return an individual `SymbolLibrary` object. "For Index you can use either the index number or the name of the object. In the following example the name of the "Global Library" will be output:


```
Sub ShowFirstObjectOfCollection()  
  'VBA343  
  Dim strName As String  
  strName = Application.SymbolLibraries(1).Name  
  MsgBox strName  
End Sub
```

## See also

- [SymbolLibraries Object \(Listing\) \(Page 2073\)](#)
- [GetItemByPath Method \(Page 1847\)](#)
- [FindByDisplayName Method \(Page 1842\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Accessing the component library with VBA \(Page 1646\)](#)
- [Parent Property \(Page 2359\)](#)
- [Name Property \(Page 2343\)](#)
- [FolderItems Property \(Page 2254\)](#)
- [Application Property \(Page 2121\)](#)

## TextList Object

### Description

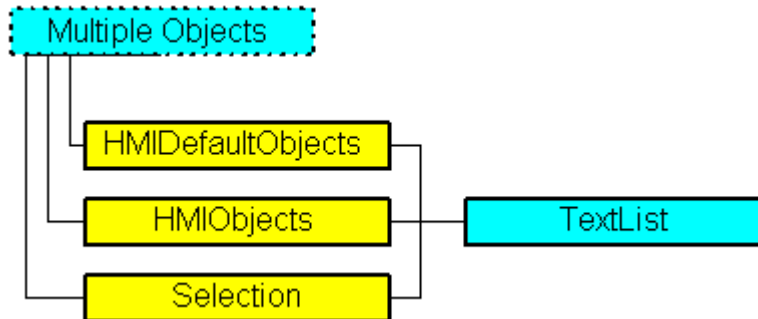

Represents the "Text List" object. The TextList object is an element of the following listings:

- Objects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all standard, Windows, and smart objects.

### VBA Object Name

HMITextList

### Usage

Use the Add method to create a new "Text List" object in a picture:

```

Sub AddTextList()
'VBA345
Dim objTextList As HMITextList
Set objTextList = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("Textlist1", "HMITextList")
End Sub
  
```

Use "HMIOBJECTS(Index)" to return an object from the HMIOBJECTS listing, where Index in this case identifies the object by name:

```

Sub EditTextList()
'VBA346
Dim objTextList As HMITextList
Set objTextList = ActiveDocument.HMIOBJECTS("Textlist1")
objTextList.BorderColor = RGB(255, 0, 0)
End Sub
  
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA347  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name of the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also

- [Width Property \(Page 2553\)](#)
- [ForeFlashColorOn Property \(Page 2262\)](#)
- [BitNumber Property \(Page 2148\)](#)
- [SelectedObjects object \(Listing\) \(Page 2060\)](#)
- [HMIObjets Object \(Listing\) \(Page 1990\)](#)
- [HMIDefaultObjects Object \(Listing\) \(Page 1985\)](#)
- [AddHMIObjct Method \(Page 1801\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Editing Objects with VBA \(Page 1660\)](#)
- [Visible Property \(Page 2551\)](#)
- [UnselTextColor Property \(Page 2462\)](#)
- [UnselBGColor Property \(Page 2462\)](#)
- [Top Property \(Page 2446\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [SelTextColor Property \(Page 2414\)](#)
- [SelBGColor Property \(Page 2412\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [OutputValue Property \(Page 2358\)](#)
- [Orientation Property \(Page 2356\)](#)
- [OperationReport Property \(Page 2355\)](#)
- [OperationMessage Property \(Page 2354\)](#)
- [Operation Property \(Page 2353\)](#)
- [NumberLines Property \(Page 2346\)](#)
- [ListType Property \(Page 2312\)](#)
- [Left Property \(Page 2305\)](#)


### 3.6 VBA Reference

Layer Property (Page 2293)  
LanguageSwitch Property (Page 2291)  
ItemBorderWidth Property (Page 2286)  
ItemBorderStyle Property (Page 2285)  
ItemBorderColor Property (Page 2284)  
ItemBorderBackColor Property (Page 2283)  
Height Property (Page 2269)  
ForeFlashColorOff Property (Page 2261)  
ForeColor Property (Page 2260)  
FontUnderline Property (Page 2259)  
FontSize Property (Page 2258)  
FontName Property (Page 2257)  
FontItalic Property (Page 2257)  
FontBold Property (Page 2256)  
FlashRateForeColor Property (Page 2251)  
FlashRateBorderColor Property (Page 2249)  
FlashRateBackColor Property (Page 2247)  
FlashForeColor Property (Page 2242)  
FlashBorderColor Property (Page 2240)  
FlashBackColor Property (Page 2239)  
FillStyle Property (Page 2235)  
FillColor Property (Page 2231)  
EditAtOnce Property (Page 2219)  
CursorControl Property (Page 2206)  
BoxType Property (Page 2165)  
BorderWidth Property (Page 2161)  
BorderStyle Property (Page 2160)  
BorderFlashColorOn Property (Page 2159)  
BorderFlashColorOff Property (Page 2157)  
BorderColor Property (Page 2153)  
BorderBackColor Property (Page 2152)  
BackFlashColorOn Property (Page 2139)  
BackFlashColorOff Property (Page 2138)  
BackColor Property (Page 2131)  
AssumeOnExit Property (Page 2123)

Assignments Property (Page 2122)  
AlignmentTop Property (Page 2118)  
AlignmentLeft Property (Page 2117)  
AdaptBorder Property (Page 2111)  
Application Property (Page 2121)  
Events Property (Page 2223)  
GlobalColorScheme property (Page 2264)  
GlobalShadow property (Page 2264)  
GroupParent Property (Page 2268)  
InputValue property (Page 2279)  
LDTooltipTexts Property (Page 2303)  
ObjectName Property (Page 2347)  
Parent Property (Page 2359)  
Properties Property (Page 2388)  
TabOrderSwitch Property (Page 2433)  
TabOrderAlpha Property (Page 2429)  
Transparency property (Page 2447)  
Type Property (Page 2450)  
ConnectionPoints property (Page 2198)  
DropDownListStyle property (Page 2218)  
LDAssignments property (Page 2298)  
TextBiblIDs property (Page 2439)  
ConnectorObjects property (Page 2199)

## Toolbar Object

### Description

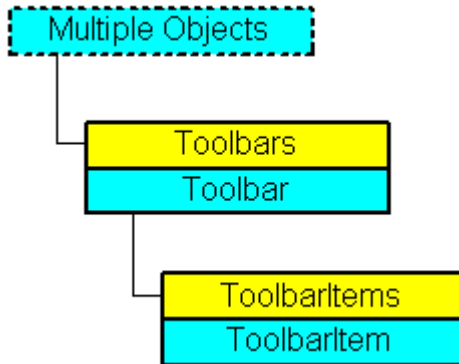

Represents the "User Defined Toolbar" object. The Toolbar object is an element of the CustomToolbars listing.

### VBA Object Name

HMIToolbar

### Usage

Use CustomToolbars(Index) to return an individual Toolbar object. "For Index you can use either the index number or the name of the object. In the following example the "Key" parameter of the first user-defined toolbar in the active picture will be output:

```

Sub ShowFirstObjectOfCollection()
'VBA348
Dim strName As String
strName = ActiveDocument.CustomToolbars(1).Key
MsgBox strName
End Sub
  
```

Use the Delete method to remove a "Toolbar" object from the "CustomToolbars" listing. In the following example the first user-defined toolbar in the active picture will be removed:

```

Sub DeleteToolbar()
'VBA349
Dim objToolbar As HMIToolbar
Set objToolbar = ActiveDocument.CustomToolbars(1)
objToolbar.Delete
End Sub
  
```




## See also

Key Property (Page 2287)  
Toolbars Object (Listing) (Page 2081)  
Delete Method (Page 1831)  
How to Create Picture-specific Menus and Toolbars (Page 1655)  
How to Create an Application-specific Toolbar (Page 1635)  
VBA Reference (Page 1745)  
Creating Customized Menus and Toolbars (Page 1627)  
Visible Property (Page 2551)  
ToolbarItems Property (Page 2443)  
Parent Property (Page 2359)  
Application Property (Page 2121)

## Toolbars Object (Listing)

### Description

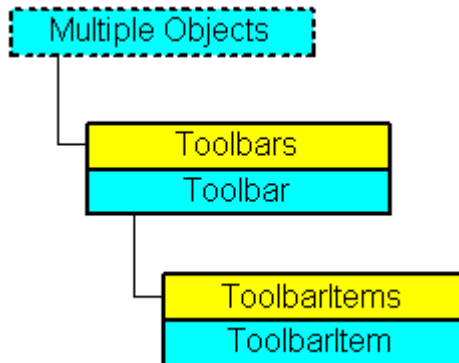

A listing of the Toolbar objects that represent all the user-defined toolbars in the Graphics Designer.

### VBA Object Name

HMICustomToolbars

### Usage

---

#### Note

In order for the examples to work, first create a user-defined toolbar. For an example of this, please refer to "Creating a New Application-Specific Toolbar" in this documentation.

---

Use the CustomToolbars property to return the Toolbars listing. In the following example, values for the "Key" property of all user-defined toolbars in the active picture will be output:

---

**Note**

The Toolbars listing does not distinguish between application-specific and picture-specific toolbars in the output.

---

```
Sub ShowCustomToolbarsOfDocument()  
'VBA350  
Dim colToolbars As HMIToolbars  
Dim objToolbar As HMIToolbar  
Dim strToolbarList As String  
Set colToolbars = ActiveDocument.CustomToolbars  
If 0 <> colToolbars.Count Then  
For Each objToolbar In colToolbars  
strToolbarList = strToolbarList & objToolbar.Key & vbCrLf  
Next objToolbar  
Else  
strToolbarList = "No toolbars existing"  
End If  
MsgBox strToolbarList  
End Sub
```

Use the Application property and the Add method if you want to create an application-specific toolbar. Create the VBA code in either the "Project Template" document or the "Global Template" document.

```
Sub InsertApplicationSpecificToolbar()  
'VBA351  
Dim objToolbar As HMIToolbar  
Set objToolbar = Application.CustomToolbars.Add("a_Toolbar1")  
End Sub
```

Use the ActiveDocument property and the Add method if you want to create a picture-specific toolbar. Create the VBA code in the document called "ThisDocument":

```
Sub InsertDocumentSpecificToolbar()  
'VBA352  
Dim objToolbar As HMIToolbar  
Set objToolbar = ActiveDocument.CustomToolbars.Add("d_Toolbar1")  
End Sub
```

**See also**

[Toolbar Object \(Page 2080\)](#)

[Item Method \(Page 1859\)](#)

Add Method (Page 1786)

How to Create Picture-specific Menus and Toolbars (Page 1655)

How to Create an Application-specific Toolbar (Page 1635)

VBA Reference (Page 1745)

Creating Customized Menus and Toolbars (Page 1627)


Parent Property (Page 2359)

Count Property (Page 2201)

Application Property (Page 2121)

## ToolbarItem Object

### Description

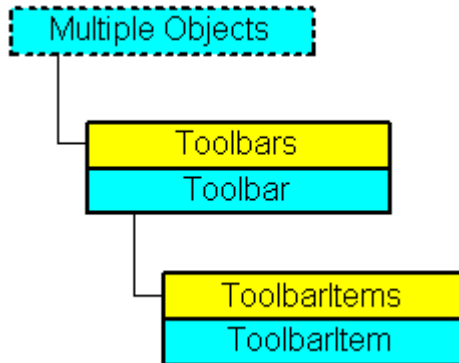

Represents an object (icon or dividing line) in a user-defined toolbar in the GraphicsDesigner. The ToolbarItem object is an element of the ToolbarItems listing.

### VBA Object Name

HMIToolBarItem

### Usage

---

#### Note

In order for the examples to work, first create a user-defined toolbar. For an example of this, please refer to "Creating a New Application-Specific Toolbar" in this documentation.

---

### 3.6 VBA Reference

Use `ToolbarItems(Index)` to return an individual `ToolbarItem` object. "For Index you can use either the index number or the name of the object. In the following example the type of the first object in the first user-defined toolbar in the active picture will be output:

```
Sub ShowFirstObjectOfCollection()  
'VBA353  
Dim strType As String  
strType = ActiveDocument.CustomToolbars(1).ToolbarItems(1).ToolbarItemType  
MsgBox strType  
End Sub
```

Use the `Delete` method to remove an object from the "ToolbarItems" listing. In the following example the first object will be deleted from the first user-defined toolbar in the active picture:

```
Sub DeleteToolbarItem()  
'VBA354  
ActiveDocument.CustomToolbars(1).ToolbarItems(1).Delete  
End Sub
```


#### See also

- Macro Property (Page 2320)
- ToolbarItems Object (Listing) (Page 2085)
- Delete Method (Page 1831)
- Configuring Menus and Toolbars (Page 1626)
- How to assign VBA macros to menus and toolbars (Page 1642)
- How to assign help texts to menus and toolbars (Page 1639)
- How to Add a New Icon to the Toolbar (Page 1637)
- VBA Reference (Page 1745)
- Creating Customized Menus and Toolbars (Page 1627)
- Visible Property (Page 2551)
- Type Property (Page 2450)
- ToolTipText Property (Page 2445)
- Tag Property (Page 2434)
- StatusText Property (Page 2426)
- ShortCut Property (Page 2416)
- Position Property (Page 2380)
- Parent Property (Page 2359)
- LDToolTipTexts Property (Page 2303)
- LDStatusTexts Property (Page 2301)

Key Property (Page 2287)  
Icon Property (Page 2275)  
Enabled Property (Page 2220)  
Application Property (Page 2121)  
ToolbarItemType property (Page 2444)

## Toolbars Object (Listing)

### Description

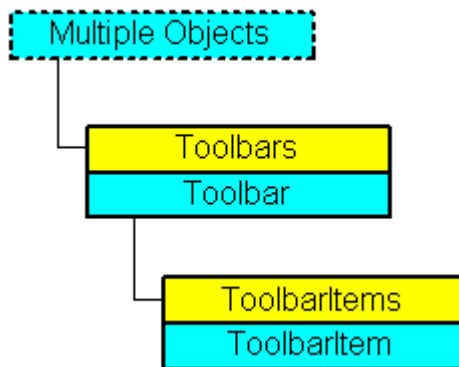

A listing of the ToolbarItem objects that represent all the objects in a user-defined toolbar.

### VBA Object Name

HMIToolbarItems

### Usage

Use the ToolbarItems property to return the ToolbarItems listing. In the following example, all object types in the first user-defined toolbar in the active picture will be output:

---

#### Note

The ToolbarItems listing does not distinguish between application-specific and picture-specific toolbars in the output.

---

### 3.6 VBA Reference

```
Sub ShowToolBarItems()  
'VBA355  
Dim colToolBarItems As HMIToolbarItems  
Dim objToolBarItem As HMIToolbarItem  
Dim strTypeList As String  
Set colToolBarItems = ActiveDocument.CustomToolbars(1).ToolBarItems  
If 0 <> colToolBarItems.Count Then  
For Each objToolBarItem In colToolBarItems  
strTypeList = strTypeList & objToolBarItem.ToolBarItemType & vbCrLf  
Next objToolBarItem  
Else  
strTypeList = "No Toolbaritems existing"  
End If  
MsgBox strTypeList  
End Sub
```

Use the `InsertToolBarItem` method, for instance, to insert an icon into an existing user-defined toolbar. In the following example a picture-specific toolbar will be created in the active picture and an icon will be added:


```
Sub InsertToolBarItem()  
'VBA356  
Dim objToolBar As HMIToolbar  
Dim objToolBarItem As HMIToolbarItem  
Set objToolBar = ActiveDocument.CustomToolbars.Add("d_Toolbar2")  
Set objToolBarItem = objToolBar.ToolBarItems.InsertToolBarItem(1, "t_Item2_1",  
"ToolBarItem 1")  
End Sub
```

#### See also

- [ToolBarItem Object \(Page 2083\)](#)
- [InsertToolBarItem Method \(Page 1856\)](#)
- [InsertSeparator Method \(Page 1853\)](#)
- [InsertFromMenuItem Method \(Page 1848\)](#)
- [How to Add a New Icon to the Toolbar \(Page 1637\)](#)
- [VBA Reference \(Page 1745\)](#)
- [Creating Customized Menus and Toolbars \(Page 1627\)](#)
- [Parent Property \(Page 2359\)](#)
- [Count Property \(Page 2201\)](#)
- [Application Property \(Page 2121\)](#)

## Trigger Object

### Description

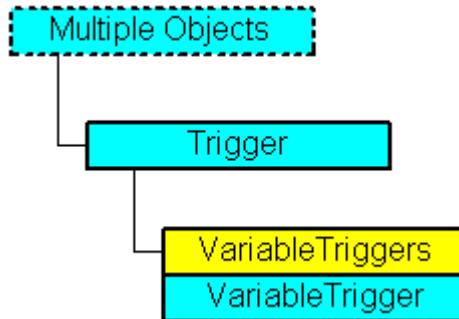

Represents the trigger (e.g. Picture Cycle) that is necessary for adding dynamics to properties with the aid of scripts. A trigger can possess multiple tag triggers.

### VBA Object Name

HMITrigger

### Usage

Use the Trigger property to return the Trigger object. In this example the "Radius" property of a circle will be made dynamic with the aid of a VB script (the output value sets the radius):

```

Sub AddDynamicAsVBSkriptToProperty()
'VBA357
Dim objVBSkript As HMISkriptInfo
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle1", "HMICircle")
Set objVBSkript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBSkript)
'
'Define cycletime and sourcecode
With objVBSkript
.SourceCode = ""
.Trigger.Type = hmiTriggerTypeStandardCycle
.Trigger.CycleType = hmiCycleType_2s
.Trigger.Name = "Trigger1"
End With
End Sub
  
```

### See also

[Delete Method \(Page 1831\)](#)

[VBA Reference \(Page 1745\)](#)

VariableTriggers Property (Page 2548)

Type Property (Page 2450)

Trigger Property (Page 2449)

Parent Property (Page 2359)


Name Property (Page 2343)

CycleType Property (Page 2209)

Application Property (Page 2121)

## TubeArcObject object

### Description

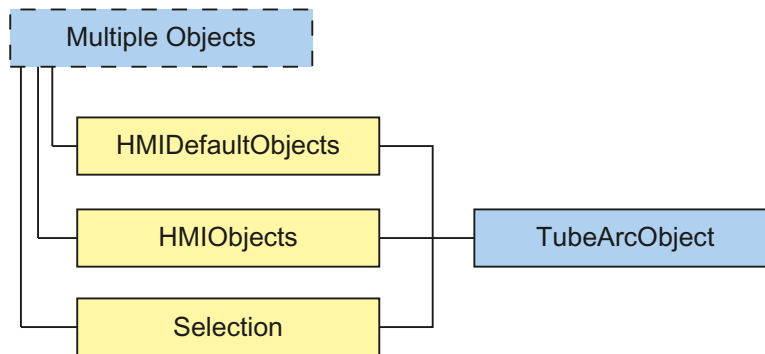

Represents the "Tube arc" object. The TubeArcObject object is an element of the following lists:

- HMIOBJECTS: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all default, smart, window and tube objects.

### VBA object name

HMITubeArcObject



## Usage

Use the Add method to create a new "Tube arc" object in a picture:

```
Sub AddTubeArcObject()  
'VBA835  
Dim objTubeArcObject As HMITubeArcObject  
Set objTubeArcObject = ActiveDocument.HMIObjects.AddHMIObject("TubeArcObject",  
"HMITubeArcObject")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditTubeArcObject()  
'VBA836  
Dim objTubeArcObject As HMITubeArcObject  
Set objTubeArcObject = ActiveDocument.HMIObjects("TubeArcObject")  
objTubeArcObject.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA837  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```


## See also

- ObjectName Property (Page 2347)
- Left Property (Page 2305)
- Layer Property (Page 2293)
- Top Property (Page 2446)
- Width Property (Page 2553)
- Height Property (Page 2269)
- BorderColor Property (Page 2153)
- BorderWidth Property (Page 2161)
- ToolTipText Property (Page 2445)
- Visible Property (Page 2551)
- PasswordLevel Property (Page 2362)

- Operation Property (Page 2353)
- Transparency property (Page 2447)
- GlobalShadow property (Page 2264)
- GlobalColorScheme property (Page 2264)
- StartAngle Property (Page 2426)
- EndAngle Property (Page 2222)
- RadiusHeight Property (Page 2394)
- RadiusWidth Property (Page 2395)
- Application Property (Page 2121)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### TubeDoubleTeeObject object

#### Description

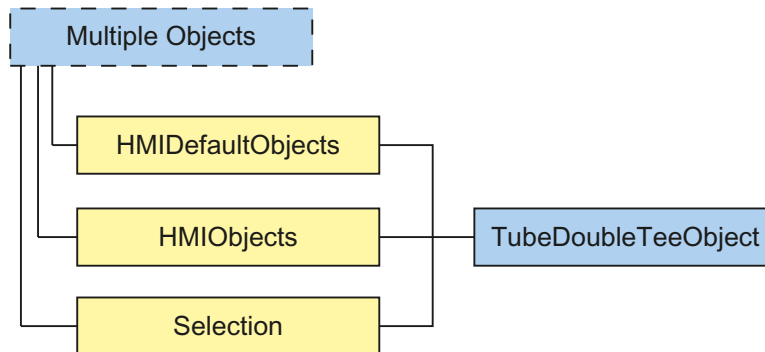

Represents the "Double T-piece" object. The TubeDoubleTeeObject object is an element of the following listings:

- HMIOBJECTS: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all default, smart, window and tube objects.

#### VBA object name

HMITubeDoubleTeeObject

## Usage

Use the Add method to create a new "Double T-piece" object in a picture:

```
Sub AddTubeDoubleTeeObject()  
'VBA838  
Dim objTubeDoubleTeeObject As HMITubeDoubleTeeObject  
Set objTubeDoubleTeeObject = ActiveDocument.HMIObjects.AddHMIObject("Double T-piece",  
"HMITubeDoubleTeeObject")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditTubeDoubleTeeObject()  
'VBA839  
Dim objTubeDoubleTeeObject As HMITubeDoubleTeeObject  
Set objTubeDoubleTeeObject = ActiveDocument.HMIObjects("Double T-piece")  
objTubeDoubleTeeObject.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA840  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```


## See also

- ObjectName Property (Page 2347)
- Left Property (Page 2305)
- Layer Property (Page 2293)
- Top Property (Page 2446)
- Width Property (Page 2553)
- Height Property (Page 2269)
- BorderColor Property (Page 2153)
- BorderWidth Property (Page 2161)
- ToolTipText Property (Page 2445)
- Visible Property (Page 2551)
- PasswordLevel Property (Page 2362)

- Operation Property (Page 2353)
- Transparency property (Page 2447)
- GlobalShadow property (Page 2264)
- GlobalColorScheme property (Page 2264)
- Application Property (Page 2121)
- Events Property (Page 2223)
- GroupParent Property (Page 2268)
- LDTooltipTexts Property (Page 2303)
- Parent Property (Page 2359)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Type Property (Page 2450)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### TubePolyline object

#### Description

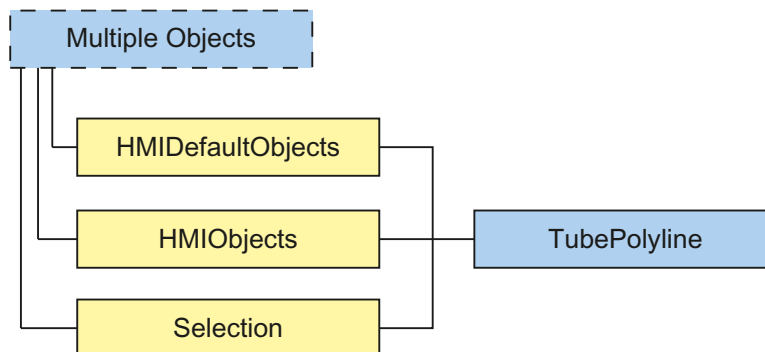

Represents the "TubePolyline" object. The TubePolyline object is an element of the following listings:

- HMIOBJECTS: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all default, smart, window and tube objects.

**VBA object name**

HMITubePolyline

**Usage**

Use the Add method to create a new "TubePolyline" object in a picture:

```
Sub AddTubePolyline()  
'VBA841  
Dim objTubePolyline As HMITubePolyline  
Set objTubePolyline = ActiveDocument.HMIObjects.AddHMIObject("TubePolyline",  
"HMITubePolyline")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditTubePolyline()  
'VBA842  
Dim objTubePolyline As HMITubePolyline  
Set objTubePolyline = ActiveDocument.HMIObjects("TubePolyline")  
objTubePolyline.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA843  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

**See also**

ObjectName Property (Page 2347)

Left Property (Page 2305)

Layer Property (Page 2293)

Top Property (Page 2446)

Width Property (Page 2553)

Height Property (Page 2269)


BorderColor Property (Page 2153)

BorderWidth Property (Page 2161)

- ToolTipText Property (Page 2445)
- Visible Property (Page 2551)
- PasswordLevel Property (Page 2362)
- Operation Property (Page 2353)
- Transparency property (Page 2447)
- GlobalShadow property (Page 2264)
- GlobalColorScheme property (Page 2264)
- PointCount Property (Page 2379)
- ActualPointLeft Property (Page 2109)
- ActualPointTop Property (Page 2110)
- Index Property (Page 2276)
- Application Property (Page 2121)
- Events Property (Page 2223)
- BorderStyle Property (Page 2160)
- GroupParent Property (Page 2268)
- LDTooltipTexts Property (Page 2303)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Type Property (Page 2450)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

### TubeTeeObject object

#### Description

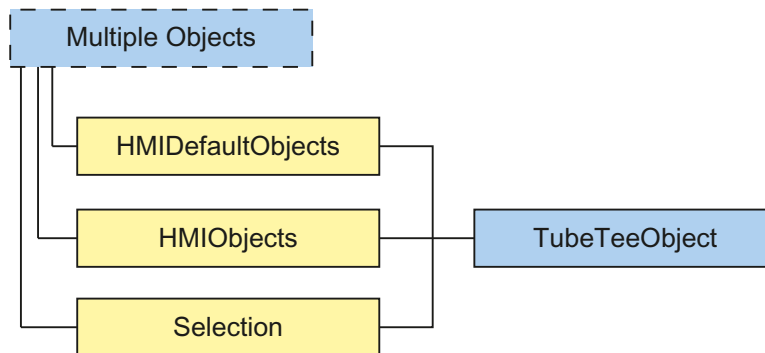

Represents the "T-piece" object. The TubeTeeObject object is an element of the following lists:

- HMIObjects: Contains all objects of a picture.
- Selection: Contains all selected objects of a picture.
- HMIDefaultObjects: Contains the default property values of all default, smart, window and tube objects.

## VBA object name

HMITubeTeeObject

## Usage

Use the Add method to create a new "T-piece" object in a picture:

```
Sub AddTubeTeeObject()  
'VBA844  
Dim objTubeTeeObject As HMITubeTeeObject  
Set objTubeTeeObject = ActiveDocument.HMIObjects.AddHMIObject("T-piece",  
"HMITubeTeeObject")  
End Sub
```

Use "HMIObjects"(Index)" to return an object from the HMIObjects listing, where Index in this case identifies the object by name:

```
Sub EditTubeTeeObject()  
'VBA845  
Dim objTubeTeeObject As HMITubeTeeObject  
Set objTubeTeeObject = ActiveDocument.HMIObjects("T-piece")  
objTubeTeeObject.BorderColor = RGB(255, 0, 0)  
End Sub
```

Use "Selection"(Index) to return an object from the Selection listing:

```
Sub ShowNameOfFirstSelectedObject()  
'VBA846  
'Select all objects in the picture:  
ActiveDocument.Selection.SelectAll  
'Get the name from the first object of the selection:  
MsgBox ActiveDocument.Selection(1).ObjectName  
End Sub
```

## See also


ObjectName Property (Page 2347)

Left Property (Page 2305)

- Layer Property (Page 2293)
- Top Property (Page 2446)
- Width Property (Page 2553)
- Height Property (Page 2269)
- BorderColor Property (Page 2153)
- BorderWidth Property (Page 2161)
- ToolTipText Property (Page 2445)
- Visible Property (Page 2551)
- PasswordLevel Property (Page 2362)
- Operation Property (Page 2353)
- Transparency property (Page 2447)
- GlobalShadow property (Page 2264)
- GlobalColorScheme property (Page 2264)
- RotationAngle Property (Page 2400)
- Application Property (Page 2121)
- Events Property (Page 2223)
- GroupParent Property (Page 2268)
- LDTooltipTexts Property (Page 2303)
- Parent Property (Page 2359)
- Properties Property (Page 2388)
- Selected Property (Page 2412)
- TabOrderSwitch Property (Page 2433)
- TabOrderAlpha Property (Page 2429)
- Type Property (Page 2450)
- ConnectionPoints property (Page 2198)
- ConnectorObjects property (Page 2199)

## VariableStateValue Object

### Description

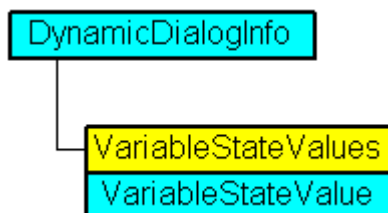



Represents the state of a tag, the value of which is assigned in the Dynamic dialog and used

## VBA Object Name


HMIVariableStateValue

## See also

[VALUE\\_SERVERDOWN Property \(Page 2516\)](#)  
[VBA Reference \(Page 1745\)](#)  
[VarName Property \(Page 2548\)](#)  
[VALUE\\_TIMEOUT Property \(Page 2520\)](#)  
[VALUE\\_STARTUP\\_VALUE Property \(Page 2518\)](#)  
[VALUE\\_NOT\\_ESTABLISHED Property \(Page 2514\)](#)  
[VALUE\\_MIN\\_RANGE Property \(Page 2512\)](#)  
[VALUE\\_MIN\\_LIMIT Property \(Page 2510\)](#)  
[VALUE\\_MAX\\_RANGE Property \(Page 2508\)](#)  
[VALUE\\_MAX\\_LIMIT Property \(Page 2506\)](#)  
[VALUE\\_INVALID\\_KEY Property \(Page 2502\)](#)  
[VALUE\\_HARDWARE\\_ERROR Property \(Page 2498\)](#)  
[VALUE\\_HANDSHAKE\\_ERROR Property \(Page 2496\)](#)  
[VALUE\\_CONVERSION\\_ERROR Property \(Page 2494\)](#)  
[VALUE\\_ADDRESS\\_ERROR Property \(Page 2472\)](#)  
[VALUE\\_ACCESS\\_FAULT Property \(Page 2470\)](#)  
[Parent Property \(Page 2359\)](#)  
[Application Property \(Page 2121\)](#)

## VariableStateValues Object (Listing)

### Description

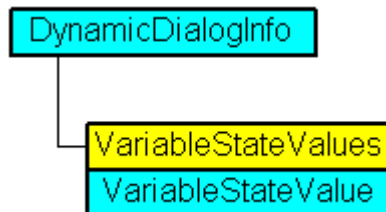

A listing of VariableStateValue objects containing all tag statuses in Dynamic dialog to be used for dynamization.

## VBA Object Name

HMIVariableStateValues

## Usage

Use the Item property in the Dynamic dialog to define values that will be used for creating dynamics when the specified tag returns the configured state. In the following example the radius of a circle is given dynamics with the The dynamization takes place be evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA358  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'Activate variable-statecheck  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

## See also

[VALUE\\_MAX\\_RANGE Property \(Page 2508\)](#)

[VBA Reference \(Page 1745\)](#)


[VarName Property \(Page 2548\)](#)

[VALUE\\_TIMEOUT Property \(Page 2520\)](#)

VALUE\_STARTUP\_VALUE Property (Page 2518)  
VALUE\_SERVERDOWN Property (Page 2516)  
VALUE\_NOT\_ESTABLISHED Property (Page 2514)  
VALUE\_MIN\_RANGE Property (Page 2512)  
VALUE\_MIN\_LIMIT Property (Page 2510)  
VALUE\_MAX\_LIMIT Property (Page 2506)  
VALUE\_INVALID\_KEY Property (Page 2502)  
VALUE\_HARDWARE\_ERROR Property (Page 2498)  
VALUE\_HANDSHAKE\_ERROR Property (Page 2496)  
VALUE\_CONVERSION\_ERROR Property (Page 2494)  
VALUE\_ADDRESS\_ERROR Property (Page 2472)  
VALUE\_ACCESS\_FAULT Property (Page 2470)  
Parent Property (Page 2359)  
Item Property (Page 2283)  
Application Property (Page 2121)

## VariableTrigger Object

### Description

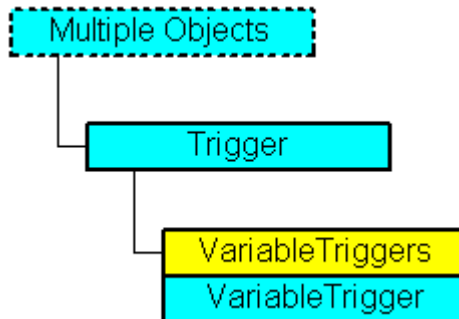

Represents a tag trigger.

### VBA Object Name

HMIVariableTrigger

## Application

Use the VariableTrigger object in order to edit or delete an existing tag trigger. In this example a circle property "Top" is made dynamic with the aid of the tag "NewDynamic1":


```
Sub AddDynamicAsVariableDirectToProperty()  
'VBA359  
Dim objVariableTrigger As HMIVariableTrigger  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle1", "HMICircle")  
Set objVariableTrigger = objCircle.Top.CreateDynamic(hmiDynamicCreationTypeVariableDirect,  
'NewDynamic1')  
,  
'Define cycletime  
With objVariableTrigger  
.CycleType = hmiCycleType_2s  
End With  
End Sub
```

## See also

- [Delete Method \(Page 1831\)](#)
- [VariableTriggers Object \(Listing\) \(Page 2101\)](#)
- [VBA Reference \(Page 1745\)](#)
- [VariableTriggers Property \(Page 2548\)](#)
- [Type Property \(Page 2450\)](#)
- [Parent Property \(Page 2359\)](#)
- [Name Property \(Page 2343\)](#)
- [CycleType Property \(Page 2209\)](#)
- [Application Property \(Page 2121\)](#)
- [CycleName Property \(Page 2208\)](#)
- [CycleTime Property \(Page 2209\)](#)
- [VarName Property \(Page 2548\)](#)

## VariableTriggers Object (Listing)

### Description

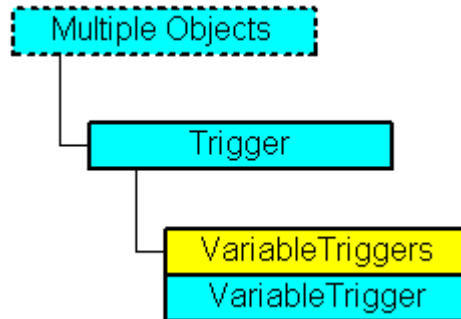

A listing of the VariableTrigger objects that represent all the tag triggers in use.

### VBA Object Name

HMIVariableTriggers

### Usage

Use the Add method to create a new tag trigger. In the following example the radius of a circle is made dynamic with the aid of a VB script. A tag trigger is used as the trigger:

```

Sub DynamicWithVariableTriggerCycle()
'VBA360
Dim objVBScript As HMIScriptInfo
Dim objVarTrigger As HMIVariableTrigger
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_VariableTrigger",
"HMICircle")
Set objVBScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)
With objVBScript
'Definition of triggername and cycletime is to do with the Add-methode
Set objVarTrigger = .Trigger.VariableTriggers.Add("VarTrigger", hmiVariableCycleType_10s)
.SourceCode = ""
End With
End Sub
  
```

### See also

Add Method (TagTriggers Listing) (Page 1792)

VBA Reference (Page 1745)

Parent Property (Page 2359)


Item Property (Page 2283)

Count Property (Page 2201)

Application Property (Page 2121)

## View Object

### Description

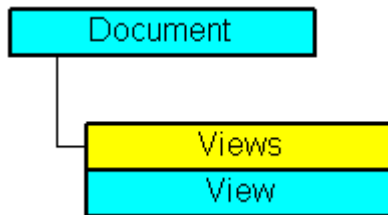

Represents a copy of a picture. The View object is an element of the Views listing.

You can use the properties of the View object among other things to control the visibility of the CS layers and to define the zoom.

### VBA Object Name

HMIView

### Usage

Use Views(Index) to return an individual View object. In the following example the number of copies of the active picture will be output:

```
Sub ShowNumberOfExistingViews()  
'VBA361  
Dim iMaxViews As Integer  
iMaxViews = ActiveDocument.Views.Count  
MsgBox "Number of copies from active document: " & iMaxViews  
End Sub
```

Use the Add method to add a new View object to the "Views" listing. In the following example a copy of the active picture is created and then activated:


```
Sub AddView()  
'VBA362  
Dim objView As HMIView  
Set objView = ActiveDocument.Views.Add  
objView.Activate  
End Sub
```

## See also

Height Property (Page 2269)  
Views Object (Listing) (Page 2103)  
SetCSLayerVisible Method (Page 1885)  
PrintDocument Method (Page 1869)  
IsCSLayerVisible Method (Page 1857)  
Delete Method (Page 1831)  
Add Method (Views Listing) (Page 1793)  
Activate Method (Page 1785)  
VBA Reference (Page 1745)  
Editing a Copy of a Picture with VBA (Page 1658)  
Editing Layers with VBA (Page 1657)  
ExtendedZoomingEnable Property (Page 2228)  
Zoom Property (Page 2559)  
WindowState Property (Page 2557)  
Width Property (Page 2553)  
Top Property (Page 2446)  
ScrollPosY Property (Page 2411)  
ScrollPosX Property (Page 2410)  
Parent Property (Page 2359)  
Left Property (Page 2305)  
IsActive Property (Page 2279)  
Application Property (Page 2121)  
ActiveLayer Property (Page 2108)

## Views Object (Listing)

### Description

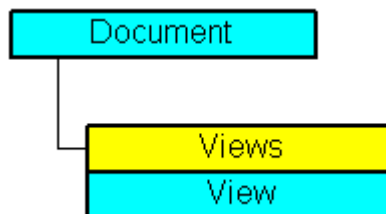

A listing of the View objects that represent a copy of a picture.

## VBA Object Name

HMIViews

## Usage

Use the Views listing to return a View object. In the following example the number of existing copies of the active picture will be output:

```
Sub ShowNumberOfExistingViews()  
'VBA363  
Dim iMaxViews As Integer  
iMaxViews = ActiveDocument.Views.Count  
MsgBox "Number of copies from active document: " & iMaxViews  
End Sub
```

Use the Add method to create a copy of a picture. In the following example a copy of the active picture is created and then activated:

```
Sub AddViewToActiveDocument()  
'VBA364  
Dim objView As HMIView  
Set objView = ActiveDocument.Views.Add  
objView.Activate  
End Sub
```

## See also

[Item Method \(Page 1859\)](#)  
[View Object \(Page 2102\)](#)  
[Add Method \(Page 1786\)](#)  
[VBA Reference \(Page 1745\)](#)  
[Parent Property \(Page 2359\)](#)  
[Count Property \(Page 2201\)](#)  
[Application Property \(Page 2121\)](#)

## WPFFControl object

### Description

Represents the "WPFFControl" object. The WPFFControl object is an element of the following listings:

- **HMIOjects:** Contains all objects of a picture.
- **Selection:** Contains all selected objects of a picture.



## VBA Object Name

HMIWPFControl

## Application

Use the AddWPFControl method to insert a WPFControl in a picture.

In the following example, the "WPF Control" object outside the Global Assembly Cache is inserted in the active picture.

```
'VBA852
Dim WPFControl As HMIWPFControl
Set WPFControl = ActiveDocument.HMIObjects.AddWPFControl("MyWPFVBAControl",
"WinCCWPFControl.TestControl", False, "Assembly=Z:\TestControl\WinCCWPFControl.dll")
```

## See also

- [AddWPFControl method \(Page 1806\)](#)
- [Delete Method \(Page 1831\)](#)
- [Application Property \(Page 2121\)](#)
- [AssemblyInfo property \(Page 2122\)](#)
- [ControlType property \(Page 2201\)](#)
- [Events Property \(Page 2223\)](#)
- [GroupParent Property \(Page 2268\)](#)
- [Height Property \(Page 2269\)](#)
- [Layer Property \(Page 2293\)](#)
- [LDTooltipTexts Property \(Page 2303\)](#)
- [Left Property \(Page 2305\)](#)
- [ObjectName Property \(Page 2347\)](#)
- [Operation Property \(Page 2353\)](#)
- [Parent Property \(Page 2359\)](#)
- [PasswordLevel Property \(Page 2362\)](#)
- [Properties Property \(Page 2388\)](#)
- [Selected Property \(Page 2412\)](#)
- [TabOrderSwitch Property \(Page 2433\)](#)
- [TabOrderAlpha Property \(Page 2429\)](#)
- [ToolTipText Property \(Page 2445\)](#)
- [Top Property \(Page 2446\)](#)
- [Type Property \(Page 2450\)](#)

### 3.6 VBA Reference

Visible Property (Page 2551)

Width Property (Page 2553)

ConnectorObjects property (Page 2199)

#### 3.6.1.8 Properties

##### A

#### Actions Property

##### Description

Returns the Actions listing. Use the Actions property to configure an event-driven action.

##### Example:

In this example a button and a circle will be inserted in the active picture. In Runtime the radius of the circle enlarges every time you click the button:

```
Sub CreateVBActionToClickedEvent()  
  'VBA365  
  Dim objButton As HMIButton  
  Dim objCircle As HMICircle  
  Dim objEvent As HMIEvent  
  Dim objVBScript As HMIScriptInfo  
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_VB", "HMICircle")  
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
  With objCircle  
    .Top = 100  
    .Left = 100  
    .BackColor = RGB(255, 0, 0)  
  End With  
  With objButton  
    .Top = 10  
    .Left = 10  
    .Width = 120  
    .Text = "Increase Radius"  
  End With  
  'Define event and assign sourcecode:  
  Set objVBScript = objButton.Events(1).Actions.AddAction(hmiActionCreationTypeVBScript)  
  With objVBScript  
    .SourceCode = "Dim myCircle" & vbCrLf & _  
      "Set myCircle = HMIRuntime.ActiveScreen.ScreenItems("Circle_VB")" & _  
      vbCrLf & "myCircle.Radius = myCircle.Radius + 5"  
  End With  
End Sub
```

## See also

Actions Object (Listing) (Page 1898)  
AddAction Method (Page 1794)  
Configuring Event-Driven Actions with VBA (Page 1699)

## ActionType property

### Description

Only used internally.

## See also

VBA Reference: ActionDynamic (Page 1747)

## ActiveDocument Property

### Description

Returns an object of the "Document" type which represents the active picture in the Graphics Designer. If there is no open or active picture in the Graphics Designer, you receive an error message.

---

### Note

The "ActiveDocument" property refers to the window that possesses the input focus. If other editors (e.g. CrossReference) access a picture, the input focus can change. To prevent this situation leading to errors, reference the picture unambiguously via the Documents listing.

---

**Example:**

The "CreateMenuItem()" procedure creates the "Delete Objects" menu and adds two menu entries ("Delete Rectangles" and "Delete Circles").

```
Sub CreateMenuItem()  
'VBA366  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
,  
'Create new menu "Delete Objects":  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DeleteObjects", "Delete Objects")  
,  
'Add two menuitems to the menu "Delete Objects  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "DeleteAllRectangles", "Delete  
Rectangles")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(2, "DeleteAllCircles", "Delete Circles")  
End Sub
```

**See also**

Documents Object (Listing) (Page 1952)

**ActiveLayer Property**

**Description**

Defines or returns the active layer for the View object. The value range is from 0 to 31, where "0" represents the uppermost layer and "31" the lowest layer.

**Example:**

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example a new View object is created and layer 1 is set to "Active":

```
Sub ActiveDocumentConfiguration()  
'VBA367  
Application.ActiveDocument.Views.Add  
Application.ActiveDocument.Views(1).ActiveLayer = 2  
End Sub
```

**See also**

View Object (Page 2102)

## ActualPointLeft Property

### Description

Defines or returns the X coordinate of the current corner point by reference to the picture origin (top left) for the objects "Polygon" and "Polyline". Each corner point is identified by an index which is derived from the number ("PointCount") of corner point available.

A change of the value can affect the properties "Width" (object width) and "Left" (x-coordinate of the object position).

### Example:

The "PolygonCoordinatesOutput()" procedure outputs the coordinates of all the corner points in the first polyline in the current picture:

```
Sub PolygonCoordinatesOutput ()
'VBA368
Dim objPolyline As HMIPolyLine
Dim iPosX As Integer
Dim iPosY As Integer
Dim iCounter As Integer
Dim strResult As String
iCounter = 1
Set objPolyline = ActiveDocument.HMIObjects.AddHMIObject("Polyline1", "HMIPolyLine")
For iCounter = 1 To objPolyline.PointCount
With objPolyline
.index = iCounter
iPosX = .ActualPointLeft
iPosY = .ActualPointTop
End With
strResult = strResult & vbCrLf & "Corner " & iCounter & ": x=" & iPosX & " y=" & iPosY
Next iCounter
MsgBox strResult
End Sub
```

### See also

- [PointCount Property \(Page 2379\)](#)
- [Index Property \(Page 2276\)](#)
- [ActualPointTop Property \(Page 2110\)](#)
- [PolyLine Object \(Page 2038\)](#)
- [Polygon Object \(Page 2035\)](#)
- [Line Object \(Page 2004\)](#)

## ActualPointTop Property

### Description

Defines or returns the Y coordinate of the current corner point by reference to the picture origin (top left) for the objects "Polygon" and "Polyline". Each corner point is identified by an index which is derived from the number ("PointCount") of corner point available.

A change of the value can affect the properties "Height" (object height) and "Top" (y-coordinate of the position).

### Example:

The "Polygon()" procedure outputs the coordinates of all the corner points in the first polyline in the current picture:

```
Sub PolygonCoordinatesOutput()  
'VBA369  
Dim objPolyline As HMIPolyLine  
Dim iPosX As Integer  
Dim iPosY As Integer  
Dim iCounter As Integer  
Dim strResult As String  
iCounter = 1  
Set objPolyline = ActiveDocument.HMIObjects.AddHMIObject("Polyline1", "HMIPolyLine")  
For iCounter = 1 To objPolyline.PointCount  
With objPolyline  
.index = iCounter  
iPosX = .ActualPointLeft  
iPosY = .ActualPointTop  
End With  
strResult = strResult & vbCrLf & "Corner " & iCounter & ": x=" & iPosX & " y=" & iPosY  
Next iCounter  
MsgBox strResult  
End Sub
```

### See also

- PointCount Property (Page 2379)
- Index Property (Page 2276)
- ActualPointLeft Property (Page 2109)
- PolyLine Object (Page 2038)
- Polygon Object (Page 2035)
- Line Object (Page 2004)

## AdaptBorder Property

### Description

TRUE if the field border is intended to adapt dynamically to the size of the text. BOOLEAN write-read access.

---

### Note

Changing the contents of a field dynamically can cause pumping in the field.

Performance is improved in Runtime by using "AdaptBorder = False".

---

### Example:

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the text size is dynamically adapted to the field size.

```
Sub IOFieldConfiguration()  
'VBA372  
Dim objIOField As HMIOField  
'  
'Add new IO-Feld to active document:  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIOField")  
With objIOField  
.AdaptBorder = True  
End With  
End Sub
```

### See also

[OptionGroup Object \(Page 2025\)](#)

[TextList Object \(Page 2076\)](#)

[StaticText Object \(Page 2067\)](#)

[IOField Object \(Page 1992\)](#)

[CheckBox Object \(Page 1924\)](#)

[Button Object \(Page 1921\)](#)

## AdaptPicture Property

### Description

TRUE if the picture size is to be adapted to the picture window size. BOOLEAN write-read access.

**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured:

```
Sub PictureWindowConfig()  
'VBA373  
Dim objPicWindow As HMIPictureWindow  
'  
'Add new picturewindow into active document:  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
.AdaptPicture = False  
.AdaptSize = False  
.Caption = True  
.CaptionText = "Picturewindow in runtime"  
.OffsetLeft = 5  
.OffsetTop = 10  
'  
'Replace the picturename "Test.PDL" with the name of  
'an existing document from your "GraCS"-Folder of your active project  
.PictureName = "Test.PDL"  
.ScrollBars = True  
.ServerPrefix = ""  
.TagPrefix = "Struct."  
.UpdateCycle = 5  
.Zoom = 100  
End With  
End Sub
```

**See also**

[PictureWindow Object \(Page 2029\)](#)

**AdaptSize Property****Description**

TRUE if the picture window size is to be adapted to the picture size. BOOLEAN write-read access.



**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured:

```
Sub PictureWindowConfig()  
'VBA374  
Dim objPicWindow As HMIPictureWindow  
'  
'Add new picturewindow into active document:  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
.AdaptPicture = False  
.AdaptSize = False  
.Caption = True  
.CaptionText = "Picturewindow in runtime"  
.OffsetLeft = 5  
.OffsetTop = 10  
'  
'Replace the picturename "Test.PDL" with the name of  
'an existing document from your "GraCS"-Folder of your active project  
.PictureName = "Test.PDL"  
.ScrollBars = True  
.ServerPrefix = ""  
.TagPrefix = "Struct."  
.UpdateCycle = 5  
.Zoom = 100  
End With  
End Sub
```

**See also**

[PictureWindow Object \(Page 2029\)](#)

**AddIns property****Description**

Only used internally.

**See also**

[Application Object \(Page 1909\)](#)

## AlarmGoneVisible property

### Description

Defines whether an outgoing state is visible.

Assigned Value	Description
True	The outgoing state is visible.
False	The outgoing state is suppressed.

## AlarmHigh Property

### Description

Defines the top limit value at which an alarm should be triggered or returned.

The type of the evaluation (in percent or absolute) is defined in the "TypeAlarmHigh" property.

The "CheckAlarmHigh" property defines whether the monitoring function for the limit value is activated.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "50".

```

Sub BarGraphLimitConfiguration()
'VBA375
Dim objBarGraph As HMIBarGraph
'
'Add new BarGraph to active document:
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")
With objBarGraph
'Set analysis to absolut
.TypeAlarmHigh = False
'Activate monitoring
.CheckAlarmHigh = True
'Set barcolor to "yellow"
.ColorAlarmHigh = RGB(255, 255, 0)
'set upper limit to "50"
.AlarmHigh = 50
End With
End Sub

```

## See also

TypeAlarmHigh Property (Page 2451)

ColorAlarmHigh Property (Page 2182)

CheckAlarmHigh Property (Page 2170)

BarGraph Object (Page 1914)

## AlarmLow Property

### Description

Defines the bottom limit value at which an alarm should be triggered or returned.

The type of the evaluation (in percent or absolute) is defined in the "TypeAlarmLow" property.

The "CheckAlarmLow" property defines whether the monitoring function for the limit value is activated.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "10".

```
Sub BarGraphLimitConfiguration()  
'VBA376  
Dim objBarGraph As HMIBarGraph  
'  
'Add new BarGraph to active document:  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolut  
.TypeAlarmLow = False  
'Activate monitoring  
.CheckAlarmLow = True  
'Set Barcolor to "yellow"  
.ColorAlarmLow = RGB(255, 255, 0)  
'set lower limit to "10"  
.AlarmLow = 10  
End With  
End Sub
```

## See also

TypeAlarmLow Property (Page 2452)

ColorAlarmLow Property (Page 2183)

CheckAlarmLow Property (Page 2171)

BarGraph Object (Page 1914)

## Alignment Property

### Description

Defines or returns the scale display (left/right or top/bottom) depending on the position of the BarGraph object. The Scaling property must be set to TRUE for the scale to be displayed.

Display	Assigned Value
Right or bottom	TRUE
Left or top	FALSE

### Example:

The "BarGraphConfiguration()" procedure configures In this example the scale is to be located to the right of the bar:

```
Sub BarGraphConfiguration()
'VBA377
Dim objBarGraph As HMIBarGraph
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")
With objBarGraph
.Alignment = True
.Scaling = True
End With
End Sub
```

### See also

Scaling Property (Page 2405)

Direction Property (Page 2213)

BarGraph Object (Page 1914)

## AlignmentLeft Property

### Description

Defines or returns the horizontal alignment of the text. Value range from 0 to 2.

Horizontal Alignment	Assigned Value
Left	0
Centered	1
Right	2

### Example:

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the text in the I/O field will be centered horizontally:

```
Sub IOFieldConfiguration()  
'VBA378  
Dim objIOField As HMIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")  
With objIOField  
.AlignmentLeft = 1  
End With  
End Sub
```

### Related topics

### See also

[AlignmentTop Property \(Page 2118\)](#)  
[TextList Object \(Page 2076\)](#)  
[StaticText Object \(Page 2067\)](#)  
[OptionGroup Object \(Page 2025\)](#)  
[GroupDisplay Object \(Page 1980\)](#)  
[IOField Object \(Page 1992\)](#)  
[CheckBox Object \(Page 1924\)](#)  
[Button Object \(Page 1921\)](#)

## AlignmentTop Property

### Description

Defines or returns the vertical alignment of the text. Value range from 0 to 2.

Horizontal Alignment	Assigned Value
Up	0
Centered	1
Down	2

### Example:

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the text in the I/O field will be centered in the middle:

```
Sub IOFieldConfiguration()
  'VBA379
  Dim objIOField As HMIIOField
  Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")
  With objIOField
    .AlignmentLeft = 1
    .AlignmentTop = 1
  End With
End Sub
```

### See also

[AlignmentLeft Property \(Page 2117\)](#)  
[TextList Object \(Page 2076\)](#)  
[StaticText Object \(Page 2067\)](#)  
[OptionGroup Object \(Page 2025\)](#)  
[GroupDisplay Object \(Page 1980\)](#)  
[IOField Object \(Page 1992\)](#)  
[CheckBox Object \(Page 1924\)](#)  
[Button Object \(Page 1921\)](#)

## AnalogResultInfos Property

### Description

Returns the AnalogResultInfos listing. Use the AnalogResultInfos property to define value ranges and property values in the Dynamic dialog.

**Example:**

An example showing how to use the AnalogResultInfos property can be found in this documentation under the heading "AnalogResultInfos Object (Listing)".


**See also**

DynamicDialog Object (Page 1955)

AnalogResultInfos Object (Listing) (Page 1908)

**AngleAlpha Property****Description**

Defines or returns depth angle a for the 3D-effect of the "3DBarGraph" object. Value range in degrees from 0 to 90.

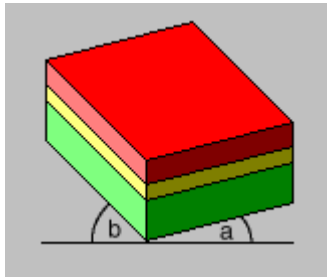**Example:**

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example depth angles A and B will be assigned the values "15" and 45:

```
Sub HMI3DBarGraphConfiguration()
'VBA380
Dim obj3DBar As HMI3DBarGraph
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")
With obj3DBar
'Depth-angle a = 15 degrees
.AngleAlpha = 15
'Depth-angle b = 45 degrees
.AngleBeta = 45
End With
End Sub
```

## See also


[AngleBeta Property \(Page 2120\)](#)

[3DBarGraph Object \(Page 1894\)](#)

## AngleBeta Property

### Description

Defines or returns depth angle b for the 3D-effect of the "3DBarGraph" object. Value range in degrees from 0 to 90.

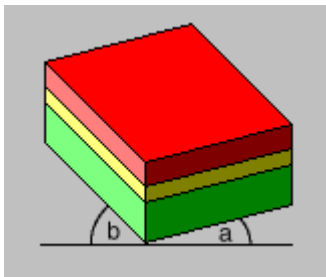

### Example:

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example depth angles A and B will be assigned the values "15" and 45:

```
Sub HMI3DBarGraphConfiguration()  
  'VBA381  
  Dim obj3DBar As HMI3DBarGraph  
  Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
  With obj3DBar  
    'Depth-angle a = 15 degrees  
    .AngleAlpha = 15  
    'Depth-angle b = 45 degrees  
    .AngleBeta = 45  
  End With  
End Sub
```

## See also

[AngleAlpha Property \(Page 2119\)](#)

[3DBarGraph Object \(Page 1894\)](#)



## Application Property

### Description

Returns the Graphics Designer application when the application property is used without an object identifier. If the application property is used with object identifier, it returns an application object which displays the application with which the defined object was created. Read only access.

### Example:

In this example an Excel object is created and the application name is output:

```
Sub CreateExcelApplication()  
'VBA382  
'  
'Open Excel invisible  
Dim objExcelApp As New Excel.Application  
MsgBox objExcelApp  
'Delete the reference to Excel and close it  
Set objExcelApp = Nothing  
End Sub
```

### See also

[Application Object \(Page 1909\)](#)

## ApplicationDataPath Property


### Description

Returns the complete path of the active picture in the Graphics Designer. Read-only access.

### Example:

The "ShowApplicationDataPath()" procedure outputs the path of the current picture:

```
Sub ShowApplicationDataPath()  
'VBA383  
MsgBox Application.ApplicationDataPath  
End Sub
```

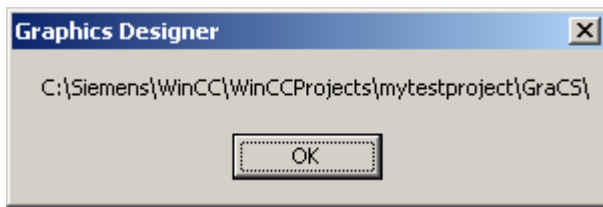

**See also**

Application Property (Page 2121)

Application Object (Page 1909)

**AssemblyInfo property**

**Description**

Displays the information of the object registered in the Global Assembly Cache. The information is made up of "Assembly", "Version", "Culture" and "PublicKeyToken".

If the object is not registered in the Global Assembly Cache, the path of the object is only displayed in "Assembly".

**Assignments Property**

**Description**

A list which contains the assignments between the output values and the actual output texts to be output.

The assignments are dependent on the list type set. The list type is defined with the ListType property.

The number of entries depends on the total length of the string passed to the "Assignments" property. This string cannot be longer than 500,000 bytes. This may be checked prior to dropping access to the "Assignments" property by using the function LenB().

**Example:**

--

**See also**

ListType Property (Page 2312)

TextList Object (Page 2076)

## AssumeOnExit Property

### Description

TRUE, if the entered text is assumed after exiting the input field (by using the <TAB> key or mouse click, for example). BOOLEAN write-read access.

### Example:

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the text that has been entered will be taken over as input on exit from the input field.

```
Sub IOFieldConfiguration()  
  'VBA385  
  Dim objIOField As HMIIOField  
  Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")  
  With objIOField  
    .AssumeOnExit = True  
  End With  
End Sub
```

### See also

[TextList Object \(Page 2076\)](#)

[IOField Object \(Page 1992\)](#)

## AssumeOnFull Property

### Description

TRUE, when the content of the input field is full (specified number of characters have been entered) and should be exited automatically and the input accepted. BOOLEAN write-read access.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the text that has been entered will be taken over as input on exit from the input field.

```
Sub IOFieldConfiguration()
'VBA386
Dim objIOField As HMIIIOField
Set objIOField = ActiveDocument.HMIObjects.AddHMIOObject("IOField1", "HMIIIOField")
With objIOField
.AssumeOnFull = True
End With
End Sub
```

**See also**

- OutputFormat Property (Page 2357)
- DataFormat Property (Page 2210)
- IOField Object (Page 1992)

**AutomationName Property**

**Description**

Depending on the source and destination object types for the direct connection, either defines or returns the name of a property.

The two tables show you when you must use the AutomationName property. A "--" means that the property is assigned an empty string ("") by default when the DirectConnection object is created.

**Source object type (SourceLink Property)**

Type Property	AutomationName Property	ObjectName Property
hmiSourceTypeConstant	--	Name of the constant (e.g. the picture name)
hmiSourceTypeProperty	Property of the source object (e.g. "Top")	Name of the source object (e.g. "Rectangle_A")
hmiSourceTypePropertyOfThisObject	--	--
hmiSourceTypeVariableDirect	--	Tag name
hmiSourceTypeVariableIndirect	--	Tag name

**Destination object type (DestinationLink Property)**

Type Property	AutomationName Property	ObjectName Property
hmiDestTypeProperty	Property of the destination object (e.g. "Left")	Name of the destination object (e.g. "Rectangle_A")
hmiDestTypePropertyOfThisObject	--	--
hmiDestTypePropertyOfActual-Window	Property of the destination object (e.g. "Left")	--
hmiDestTypeVariableDirect	--	Tag name
hmiDestTypeVariableIndirect	--	Tag name
hmiDestTypeDirectMessage	--	Tag name
hmiDestTypeIndirectMessage	--	Tag name

**Example:**

In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:

```
Sub DirectConnection()  
'VBA387  
Dim objButton As HMIButton  
Dim objRectangleA As HMIRectangle  
Dim objRectangleB As HMIRectangle  
Dim objEvent As HMIEvent  
Dim objDynConnection As HMIDirectConnection  
,  
'Add objects to active document:  
Set objRectangleA = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A", "HMIRectangle")  
Set objRectangleB = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
,  
'to position and configure objects:  
With objRectangleA  
.Top = 100  
.Left = 100  
End With  
With objRectangleB  
.Top = 250  
.Left = 400  
.BackColor = RGB(255, 0, 0)  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Text = "SetPosition"  
End With  
,  
'Directconnection is initiate by mouseclick:  
Set objDynConnection =  
objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectConnection)  
With objDynConnection  
'Sourceobject: Top-Property of Rectangle_A  
.SourceLink.Type = hmiSourceTypeProperty  
.SourceLink.ObjectName = "Rectangle_A"  
.SourceLink.AutomationName = "Top"  
,  
'Targetobject: Left-Property of Rectangle_B  
.DestinationLink.Type = hmiDestTypeProperty  
.DestinationLink.ObjectName = "Rectangle_B"  
.DestinationLink.AutomationName = "Left"  
End With  
End Sub
```

## See also

DestinationLink Property (Page 2211)  
Type Property (Page 2450)  
SourceLink Property (Page 2422)  
ObjectName Property (Page 2347)  
SourceLink Object (Page 2065)  
DestLink Object (Page 1945)

## AvailableDataLanguages Property

### Description

Returns a listing of the available project languages.

### Example:

The "AusgabetDataLanguages()" procedure outputs all the existing project languages together with their language identifiers (as a decimal value):

```
Sub OutputDataLanguages()  
  'VBA388  
  Dim colDataLang As HMIDataLanguages  
  Dim objDataLang As HMIDataLanguage  
  Dim strLangList As String  
  Dim iCounter As Integer  
  '  
  'Save collection of datalanguages  
  'into variable "colDataLang"  
  Set colDataLang = Application.AvailableDataLanguages  
  iCounter = 1  
  '  
  'Get every languagename and the assigned ID  
  For Each objDataLang In colDataLang  
  With objDataLang  
  If 0 = iCounter Mod 3 Or 1 = iCounter Then  
    strLangList = strLangList & vbCrLf & .LanguageID & " " & .LanguageName  
  Else  
    strLangList = strLangList & " / " & .LanguageID & " " & .LanguageName  
  End If  
  End With  
  iCounter = iCounter + 1  
  Next objDataLang  
  MsgBox strLangList  
End Sub
```

## See also

LanguageName Property (Page 2290)  
LanguageID Property (Page 2289)  
How to assign help texts to menus and toolbars (Page 1639)  
How to create menus in multiple languages (Page 1633)  
Language-Dependent Configuration with VBA (Page 1624)

## Average Property

### Description

TRUE, if the mean value is calculated based on the last 10 values. A value change is conditional for calculation of a new mean value. The mean value is reset when you change a picture. If only one value is available when you change the picture, the following mean value is calculated:  $(5+0+0+0+0+0+0+0+0+0)/10=0,5$ .

BOOLEAN write-read access.

### Example

The "BarGraphConfiguration()" procedure configures In this example, value averaging will be activated:

```
Sub BarGraphConfiguration()  
'VBA389  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.Average = True  
End With  
End Sub
```

## See also

BarGraph Object (Page 1914)



## Axe Property

### Description

Defines or returns the axis for displaying the measured value. Value range from 0 to 2.

Axis	Assigned Value
X	0
Y	1
Z	2

### Example:

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the Y axis for displaying the measured value will be defined:

```
Sub HMI3DBarGraphConfiguration()  
'VBA390  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
  .Axe = 1  
End With  
End Sub
```


### See also

[3DBarGraph Object \(Page 1894\)](#)

## AxisSection Property

### Description

Defines or returns the distance between two long axis sections. The information on the distance is given in scale units and is dependent on the minimum and maximum values configured.

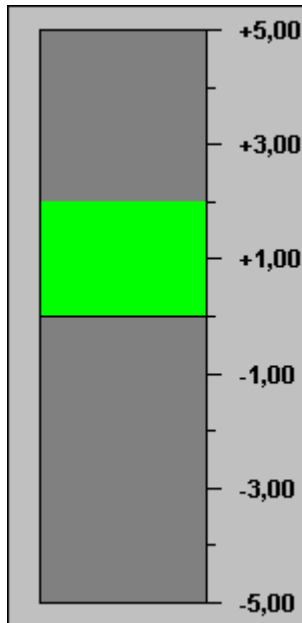

BarGraph Object (Minimum/Maximum Value: -5/5; AxisSection = 2)

### Example

The "BarGraphConfiguration()" procedure accesses the properties of the BarGraph object. In this example the axis section will be set to "2".

```
Sub BarGraphConfiguration()  
    'VBA391  
    Dim objBar As HMIBarGraph  
    Set objBar = ActiveDocument.HMIObjects.AddHMIObject("Bar1",  
        "HMIBarGraph")  
    With objBar  
        .AxisSection = 2  
    End With  
End Sub
```

### See also

BarGraph Object (Page 1914)

**B****BackBorderWidth Property****Description**

Defines or returns the width of the 3D border in pixels. The value for the width is dependent on the size of the object.

**Slider**

Defines or returns the width of the border in pixels. BackBorderWidth = 0 prevents the border being displayed on the Slider object.

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the width of the 3D border will be set to "2".

```
Sub ButtonConfiguration()  
'VBA392  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
.BackBorderWidth = 2  
End With  
End Sub
```

**See also**

Slider object (Page 2062)

RoundButton Object (Page 2052)

GroupDisplay Object (Page 1980)

Button Object (Page 1921)

**BackColor Property****Description**

Defines or returns the background color for the object. LONG read-write access.

The background color is not displayed if "transparent" is defined as the fill pattern.

### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the background color will be set to "Yellow".

```
Sub RectangleConfiguration()  
'VBA393  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
.BackColor = RGB(255, 255, 0)  
End With  
End Sub
```

### See also

- [EllipseSegment Object \(Page 1963\)](#)
- [StaticText Object \(Page 2067\)](#)
- [Slider object \(Page 2062\)](#)
- [TextList Object \(Page 2076\)](#)
- [RoundRectangle Object \(Page 2055\)](#)
- [RoundButton Object \(Page 2052\)](#)
- [Rectangle Object \(Page 2049\)](#)
- [Polygon Object \(Page 2035\)](#)
- [PieSegment Object \(Page 2032\)](#)
- [OptionGroup Object \(Page 2025\)](#)
- [GroupDisplay Object \(Page 1980\)](#)
- [GraphicObject Object \(Page 1975\)](#)
- [IOField Object \(Page 1992\)](#)
- [Ellipse Object \(Page 1957\)](#)
- [Document Object \(Page 1949\)](#)
- [Circle Object \(Page 1928\)](#)
- [CheckBox Object \(Page 1924\)](#)
- [Button Object \(Page 1921\)](#)

BarGraph Object (Page 1914)

3DBarGraph Object (Page 1894)

## BackColor2 Property

### Description

Defines or returns the bar color for the display of the current value. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "BarGraphConfiguration()" procedure configures In this example the bar color for displaying the current value will be set to "Yellow":

```
Sub BarGraphConfiguration()  
'VBA394  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.BackColor2 = RGB(255, 255, 0)  
End With  
End Sub
```

### See also

BarGraph Object (Page 1914)

## BackColor3 Property

### Description

Defines or returns the color of the bar background. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

### 3.6 VBA Reference

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

#### Example:

The "BarGraphConfiguration()" procedure configures In this example the color of the bar background will be set to "Blue":

```
Sub BarGraphConfiguration()  
'VBA395  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.BackColor3 = RGB(0, 0, 255)  
End With  
End Sub
```

#### See also

BarGraph Object (Page 1914)

### BackColor\_Alarm..\_Warning property

#### Description

Defines the color used for the background of one of the following states or message types:

- Alarm
- Warning
- Tolerance
- AS Process Control Error
- AS Control System Fault
- Operator request
- OK
- Simulation

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

## BackColorBottom Property

### Description

Defines or returns the color for the bottom/right part of the slider. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "SliderConfiguration()" procedure accesses the properties of the slider. In this example the color of the bottom part of the slider will be set to "Blue":

```
Sub SliderConfiguration()  
'VBA396  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("SliderObject1", "HMISlider")  
With objSlider  
.BackColorBottom = RGB(0, 0, 255)  
End With  
End Sub
```

### See also

Slider object (Page 2062)

## BackColorTop Property

### Description

Defines or returns the color for the top/left part of the slider. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "SliderConfiguration()" procedure accesses the properties of the slider. In this example the color of the top part of the slider will be set to "Yellow":

```
Sub SliderConfiguration()  
'VBA397  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("SliderObject1", "HMISlider")  
With objSlider  
  .BackColorTop = RGB(255, 255, 0)  
End With  
End Sub
```

### See also

Slider object (Page 2062)

### BackFillColor property

#### Description

Defines the color with which the background is filled at an advanced analog display.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### BackFillColor\_OK property

#### Description

Defines the color with which the background is filled at the state "OK".

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)



## BackFillColor\_Simulation property

### Description

Defines the color with which the background is filled at the "Simulation" state.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

## BackFillStyle property

### Description

Defines the pattern with which the background is filled at an advanced analog display.

There is a choice of 50 fill patterns. The fill pattern 0 "Solid" fills the object with the set background color; the fill pattern 1 "Transparent" defines that neither a background nor a fill pattern is displayed.

## BackFillStyle\_OK property

### Description

Defines the pattern with which the background is displayed at the state "OK".

There is a choice of 50 fill patterns. The fill pattern 0 "Solid" fills the object with the set background color; the fill pattern 1 "Transparent" defines that neither a background nor a fill pattern is displayed.

## BackFillStyle\_Simulation property

### Description

Defines the pattern with which the background is displayed at the "Simulation" state.

There is a choice of 50 fill patterns. The fill pattern 0 "Solid" fills the object with the set background color; the fill pattern 1 "Transparent" defines that neither a background nor a fill pattern is displayed.

## BackFlashColorOff Property

### Description

Defines or returns the color of the object background for the flash status "Off". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the color when the flash status is "Off" will be set to "Yellow":

```
Sub RectangleConfiguration()  
  'VBA398  
  Dim objRectangle As HMIRectangle  
  Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
  With objRectangle  
    .BackFlashColorOff = RGB(255, 255, 0)  
  End With  
End Sub
```

### See also

- BarGraph Object (Page 1914)
- StaticText Object (Page 2067)
- Slider object (Page 2062)
- TextList Object (Page 2076)
- RoundRectangle Object (Page 2055)
- RoundButton Object (Page 2052)
- Rectangle Object (Page 2049)
- Polygon Object (Page 2035)
- PieSegment Object (Page 2032)
- OptionGroup Object (Page 2025)
- GraphicObject Object (Page 1975)
- IOField Object (Page 1992)
- EllipseSegment Object (Page 1963)

Ellipse Object (Page 1957)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)

## BackFlashColorOn Property

### Description

Defines or returns the color of the object background for the flash status "On". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the color when the flash status is "On" will be set to "Blue":

```
Sub RectangleConfiguration()  
'VBA399  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
.BackFlashColorOn = RGB(0, 0, 255)  
End With  
End Sub
```

### See also

RoundButton Object (Page 2052)  
StaticText Object (Page 2067)  
Slider object (Page 2062)  
TextList Object (Page 2076)  
RoundRectangle Object (Page 2055)  
Rectangle Object (Page 2049)  
Polygon Object (Page 2035)  
PieSegment Object (Page 2032)

- OptionGroup Object (Page 2025)
- GraphicObject Object (Page 1975)
- IOField Object (Page 1992)
- EllipseSegment Object (Page 1963)
- Ellipse Object (Page 1957)
- Circle Object (Page 1928)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)
- BarGraph Object (Page 1914)

## Background Property

### Description

TRUE, when the background of the 3D-bar graph object should be visible. BOOLEAN write-read access.

### Example:

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the background will be set to "Transparent":

```
Sub HMI3DBarGraphConfiguration()  
  'VBA400  
  Dim obj3DBar As HMI3DBarGraph  
  Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
  With obj3DBar  
    .Background = False  
  End With  
End Sub
```

### See also

3DBarGraph Object (Page 1894)

## BackPictureAlignment property

### Description

As the "Display type" attribute, defines the position and scaling for the background image of the process picture.

normal	The background picture is centered in the original size. When opening the picture in runtime, it remains in the location.
Stretched (window)	The background picture is scaled to the runtime window and process picture of the larger of the two windows. In runtime, it is scaled to the size of the runtime window and is scaled when you resize the picture.
Tiled	Graphics Designer and process picture are exhibited with the picture in its original size.
Stretched (picture)	The background picture is scaled to the configured size of the process picture. When opening the picture in runtime, it retains its size.

## BackPictureName property

### Description

Defines or returns the path and name of the file used as the background image in the process picture.

Files of format EMF, WMF, DB, BMP, GIF, JPG, JPEG and ICO are suitable.

If no path is specified, the file is searched for in the subdirectory \GraCS. If you specify a different path, a copy is created in the \GraCS directory.

#### Path specifications

The following path specification formats are possible:

- Absolute: z.B. "C:\Siemens\WinCC\Icons\myIcon.ICO."
- Relative: The starting folder for relative path specification is the "GraCS" folder of the current project.
- <global>: Refers to the installation path for WinCC. The path specification "<global>\Icons\myIcon" is the same as the path specification under "Absolute".
- <project>: Refers to the current project directory.

## BarDepth Property

### Description

Defines or returns the depth of the bar in pixels.

**Example:**

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the bar depth will be set to "40":

```
Sub HMI3DBarGraphConfiguration()  
'VBA401  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
.BarDepth = 40  
End With  
End Sub
```

**See also**

3DBarGraph Object (Page 1894)

**BarHeight Property**

**Description**

Defines or returns the height of the bar in pixels.

**Example:**

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the bar height will be set to "60":

```
Sub HMI3DBarGraphConfiguration()  
'VBA402  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
.BarHeight = 60  
End With  
End Sub
```

**See also**

3DBarGraph Object (Page 1894)

## BarWidth Property

### Description

Defines or returns the width of the bar in pixels.

### Example:

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the bar width will be set to "80":

```
Sub HMI3DBarGraphConfiguration()  
'VBA403  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
.BarWidth = 80  
End With  
End Sub
```

### See also

3DBarGraph Object (Page 1894)

## BasePicReferenced Property

### Description

TRUE, when the picture assigned in the object status display should be saved. Otherwise, only the associated object reference is saved. BOOLEAN write-read access.

### Example:

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example the picture assigned in the Status Display object is to be saved.

```
Sub StatusDisplayConfiguration()  
'VBA404  
Dim objStatDisp As HMIStatusDisplay  
Set objStatDisp = ActiveDocument.HMIObjects.AddHMIObject("Statusdisplay1",  
"HMIStatusDisplay")  
With objStatDisp  
.BasePicReferenced = True  
End With  
End Sub
```

## See also

StatusDisplay Object (Page 2070)

## BasePicTransColor Property

### Description

Defines or returns which color of the assigned bitmap object (.bmp, .dib) should be set to "transparent". LONG write-read access.

The color is only set to "Transparent" if the value of the "BasePicUseTransColor" property is "True".

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example the color "Yellow" will be set to "Transparent".

```
Sub StatusDisplayConfiguration()  
  'VBA405  
  Dim objStatDisp As HMIStatusDisplay  
  Set objStatDisp = ActiveDocument.HMIObjects.AddHMIObject("Statusdisplay1",  
  "HMIStatusDisplay")  
  With objStatDisp  
    .BasePicTransColor = RGB(255, 255, 0)  
    .BasePicUseTransColor = True  
  End With  
End Sub
```

## See also

BasePicUseTransColor Property (Page 2145)

StatusDisplay Object (Page 2070)

## BasePicture Property

### Description

Defines or returns the basic picture for the Status Display object.



The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

In this context, the "BasePicReferenced" property defines whether the basic picture should be saved together with the object status display or referenced.

### Example:

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example the picture "Testpicture.BMP" will be used as the basic picture:

```
Sub StatusDisplayConfiguration()  
  'VBA406  
  Dim objStatDisp As HMIStatusDisplay  
  Set objStatDisp = ActiveDocument.HMIObjects.AddHMIObject("Statusdisplay1",  
  "HMIStatusDisplay")  
  With objStatDisp  
    '  
    'To use this example copy a Bitmap-Graphic  
    'to the "GraCS"-Folder of the actual project.  
    'Replace the picturename "Testpicture.BMP" with the name of  
    'the picture you copied  
    .BasePicture = "Testpicture.BMP"  
  End With  
End Sub
```

### See also

[BasePicReferenced Property \(Page 2143\)](#)

[StatusDisplay Object \(Page 2070\)](#)

## BasePicture property

### Description

Specifies which picture is to be displayed for the currently selected status. Pictures with the following formats can be inserted: EMF, WMF, BMP, GIF, JPG.

If no picture that you want to display is defined for a status, the symbol for the status display is shown as a placeholder.

## BasePicUseTransColor Property

### Description

TRUE, when the configured color ("BasePicTransColor" property) of the bitmap objects should be set to "transparent". BOOLEAN write-read access.

**Example:**

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example the color "Yellow" will be set to "Transparent":

```
Sub StatusDisplayConfiguration()  
'VBA407  
Dim objStatDisp As HMIStatusDisplay  
Set objStatDisp = ActiveDocument.HMIObjects.AddHMIObject("Statusdisplay1",  
"HMIStatusDisplay")  
With objStatDisp  
.BasePicTransColor = RGB(255, 255, 0)  
.BasePicUseTransColor = True  
End With  
End Sub
```

**See also**

[BasePicTransColor Property \(Page 2144\)](#)

[StatusDisplay Object \(Page 2070\)](#)

**BaseX Property**

**Description**

Defines or returns for the 3DBarGraph object the horizontal distance in pixels between the right-hand border of the bar and the left-hand border of the object field.

**Example:**

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the horizontal distance will be set to "80".

```
Sub HMI3DBarGraphConfiguration()  
'VBA408  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
.BaseX = 80  
End With  
End Sub
```

**See also**

[3DBarGraph Object \(Page 1894\)](#)

## BaseY Property

### Description

Defines or returns for the 3DBarGraph object the vertical distance in pixels between the lower border of the bar and the upper border of the object field.

### Example:

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the vertical distance will be set to "100".

```
Sub HMI3DBarGraphConfiguration()  
  'VBA409  
  Dim obj3DBar As HMI3DBarGraph  
  Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
  With obj3DBar  
    .BaseY = 100  
  End With  
End Sub
```

### See also

[3DBarGraph Object \(Page 1894\)](#)

## BinaryResultInfo Property

### Description

Returns the BinaryResultInfo object.

### Example:

An example showing how to use the BinaryResultInfo property can be found in this documentation under the heading "BinaryResultInfo Object".

### See also

[BinaryResultInfo Object \(Page 1918\)](#)

## BitNotSetValue Property

### Description

Defines or returns the value for the dynamic property if the specified bit of a configured tag is not set.

To define which bit must be set in order to trigger a change of value, use the BitNumber property.

### Example:

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned, the bit to be set will be defined and the associated property values will be assigned to the "set"/"not set" states:

```
Sub AddDynamicDialogToCircleRadiusTypeBit()  
'VBA410  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_B", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeBit  
.Trigger.VariableTriggers(1).CycleType = hmiVariableCycleType_5s  
.BitResultInfo.BitNumber = 1  
.BitResultInfo.BitSetValue = 40  
.BitResultInfo.BitNotSetValue = 80  
End With  
End Sub
```

### See also

[BitNumber Property \(Page 2148\)](#)

[BitResultInfo Object \(Page 1919\)](#)

## BitNumber Property

### Description

Defines or returns the bit whose status must change in order to trigger a change of value. The tag used must be of the type BYTE, WORD or DWORD.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned, the bit to be set will be defined and the associated property values will be assigned to the "set"/"not set" states:

```
Sub AddDynamicDialogToCircleRadiusTypeBit()  
'VBA411  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_B", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeBit  
.BitResultInfo.BitNumber = 1  
.BitResultInfo.BitSetValue = 40  
.BitResultInfo.BitNotSetValue = 80  
End With  
End Sub
```

**See also**

[BitResultInfo Object \(Page 1919\)](#)

[VBA Reference \(Page 1745\)](#)

**BitPosition0..3 property****Description**

Specifies the bit position of the selected tag for which the respective bit (0 to 3) of the status value is used. The content is only evaluated when a tag is selected for the respective property "BitSelect0..3". The tags are specified using "Process" and "Process1..3".

You can enter a value from "0" to "31". Each value can only be assigned once.

**BitResultInfo Property****Description**

Returns the BitResultInfo object.

**Example:**

An example showing how to use the BitResultInfo property can be found in this documentation under the heading "BitResultInfo Object".

**See also**

BitResultInfo Object (Page 1919)

**BitSelect0..3 property****Description**

Specifies the status tag for which the respective (first to fourth) bit of the status value is specified. The tags are specified using the properties "Process" and "Process1..3".

0	The respective bit of the status value is not evaluated. No status tag is used.
1	Status tag "Process" is used for the respective bit of the status value.
2	Status tag "Process1" is used for the respective bit of the status value.
3	Status tag "Process2" is used for the respective bit of the status value.
4	Status tag "Process3" is used for the respective bit of the status value.

**BitSetValue Property****Description**

Defines or returns the value for the dynamic property if the specified bit of a configured tag is set.

To define which bit must be set in order to trigger a change of value, use the BitNumber property.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned, the bit to be set will be defined and the associated property values will be assigned to the "set"/"not set" states:

```
Sub AddDynamicDialogToCircleRadiusTypeBit()
'VBA412
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_B", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"'NewDynamic1'")
With objDynDialog
.ResultType = hmiResultTypeBit
.BitResultInfo.BitNumber = 1
.BitResultInfo.BitSetValue = 40
.BitResultInfo.BitNotSetValue = 80
End With
End Sub
```

**See also**

BitNumber Property (Page 2148)

BitResultInfo Object (Page 1919)

**Bold Property****Description**

TRUE if the font attribute "Bold" is set for the language-dependent text in the object. BOOLEAN write-read access.

**Example:**

---

**Note**

For this example to work, you must already have configured in the languages concerned.

---

The following example sets the font attributes of a button for French and English:

```
Sub ExampleForLanguageFonts ()
  'VBA413
  Dim collLangFonts As HMILanguageFonts
  Dim objButton As HMIButton
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")
  objButton.Text = "Displaytext"
  Set collLangFonts = objButton.LDFonts
  'Set french fontproperties:
  With collLangFonts.ItemByLCID(1036)
    .Family = "Courier New"
    .Bold = True
    .Italic = False
    .Underlined = True
    .Size = 12
  End With
  'Set english fontproperties:
  With collLangFonts.ItemByLCID(1033)
    .Family = "Times New Roman"
    .Bold = False
    .Italic = True
    .Underlined = False
    .Size = 14
  End With
End Sub
```

## See also

Underlined Property (Page 2460)  
Size Property (Page 2419)  
Parent Property (Page 2359)  
LanguageID Property (Page 2289)  
Italic Property (Page 2282)  
Family Property (Page 2229)  
Application Property (Page 2121)  
LanguageFont Object (Page 1996)

## BorderBackColor Property

### Description

Defines or returns the background color of the line for the object. LONG write-read access.  
The background color is only visible if the BorderStyle property is set >0.

### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the background color for the line will be set to "Yellow":

```
Sub RectangleConfiguration()  
    'VBA415  
    Dim objRectangle As HMIRectangle  
    Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
    With objRectangle  
        .BackColor = RGB(255, 255, 0)  
    End With  
End Sub
```

## See also

PieSegment Object (Page 2032)  
BorderStyle Property (Page 2160)



TextList Object (Page 2076)  
StatusDisplay Object (Page 2070)  
StaticText Object (Page 2067)  
Slider object (Page 2062)  
RoundRectangle Object (Page 2055)  
RoundButton Object (Page 2052)  
Rectangle Object (Page 2049)  
PolyLine Object (Page 2038)  
OptionGroup Object (Page 2025)  
Line Object (Page 2004)  
IOField Object (Page 1992)  
GraphicObject Object (Page 1975)  
EllipseArc Object (Page 1960)  
EllipseSegment Object (Page 1963)  
Ellipse Object (Page 1957)  
CircularArc Object (Page 1931)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)  
BarGraph Object (Page 1914)

## BorderColor Property

### Description

Defines or returns the line color for the object. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the line color will be set to "Blue":

```
Sub RectangleConfiguration()  
'VBA416  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
.BorderColor = RGB(0, 0, 255)  
End With  
End Sub
```

**See also**

- GraphicObject Object (Page 1975)
- TextList Object (Page 2076)
- StatusDisplay Object (Page 2070)
- StaticText Object (Page 2067)
- Slider object (Page 2062)
- RoundRectangle Object (Page 2055)
- RoundButton Object (Page 2052)
- Rectangle Object (Page 2049)
- PolyLine Object (Page 2038)
- PieSegment Object (Page 2032)
- OptionGroup Object (Page 2025)
- Line Object (Page 2004)
- IOField Object (Page 1992)
- EllipseArc Object (Page 1960)
- EllipseSegment Object (Page 1963)
- Ellipse Object (Page 1957)
- CircularArc Object (Page 1931)
- Circle Object (Page 1928)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)
- BarGraph Object (Page 1914)

## BorderColorBottom Property

### Description

Defines or returns the color for the bottom right-hand part of the 3D-border. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the 3D-border color will be defined:

```
Sub ButtonConfiguration()  
'VBA417  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
.BorderColorBottom = RGB(255, 0, 0)  
.BorderColorTop = RGB(0, 0, 255)  
End With  
End Sub
```

### See also

RoundButton Object (Page 2052)

Button Object (Page 1921)

## BorderColorTop Property

### Description

Defines or returns the color for the top left-hand part of the 3D-border. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the 3D-border color will be defined:

```
Sub ButtonConfiguration()  
'VBA418  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
.BorderColorBottom = RGB(255, 0, 0)  
.BorderColorTop = RGB(0, 0, 255)  
End With  
End Sub
```

**See also**

RoundButton Object (Page 2052)

Button Object (Page 1921)


**BorderEndStyle Property**

**Description**

Defines or returns the line end style of the object. LONG read-write access.

**Determination of Line End Style**

Determine the line end type with the aid of a five-character hexadecimal value which you then convert into its equivalent decimal value.

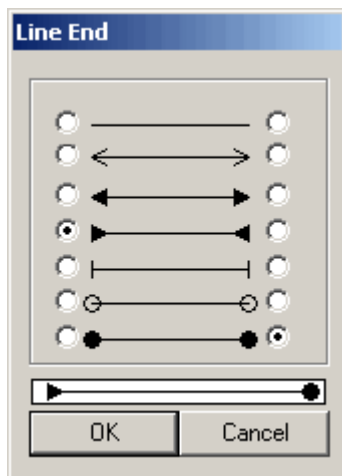

To determine the line ends for the object, go to the "Line End Style" window and proceed as follows:

- **Left column:** Configures the start of the line. Value range (from the top down) 0 to 6. The start of the line corresponds to the first character in the hexadecimal value. In the configuration shown, the value of the first character is "3".
- **Right Column:** Configures the end of the line. Value range (from the top down) 0 to 6. The line end corresponds to the fifth character in the hexadecimal value. In the configuration shown, the value of the fifth character is "6".

This gives a hexadecimal value of "60003". This corresponds to a decimal value of "393219", which you then assign to the `BorderEndStyle` property.

### Example:

The `"LineConfiguration()"` procedure accesses the properties of the line. In this example the type of line end will be set to the configuration illustrated above:

```
Sub LineConfiguration()  
'VBA419  
Dim objLine As HMILine  
Set objLine = ActiveDocument.HMIObjects.AddHMIObject("Line1", "HMILine")  
With objLine  
  .BorderEndStyle = 393219  
End With  
End Sub
```

### See also

[PolyLine Object \(Page 2038\)](#)

[Line Object \(Page 2004\)](#)

## BorderFlashColorOff Property

### Description

Defines or returns the color of the object lines for the flashing status "Off". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: `RGB(255, 0, 0)`

**Example:**

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the color when the flash status is "Off" will be set to "Black":

```
Sub RectangleConfiguration()  
'VBA420  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
.BorderFlashColorOff = RGB(0, 0, 0)  
End With  
End Sub
```

**See also**

- RoundButton Object (Page 2052)
- StatusDisplay Object (Page 2070)
- StaticText Object (Page 2067)
- Slider object (Page 2062)
- TextList Object (Page 2076)
- RoundRectangle Object (Page 2055)
- Rectangle Object (Page 2049)
- PolyLine Object (Page 2038)
- Polygon Object (Page 2035)
- PieSegment Object (Page 2032)
- OptionGroup Object (Page 2025)
- Line Object (Page 2004)
- GraphicObject Object (Page 1975)
- IOField Object (Page 1992)
- EllipseSegment Object (Page 1963)
- EllipseArc Object (Page 1960)
- Ellipse Object (Page 1957)
- CircularArc Object (Page 1931)
- Circle Object (Page 1928)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)

## BorderFlashColorOn Property

### Description

Defines or returns the color of the object lines for the flashing status "On". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the color when the flash status is "On" will be set to "Red":

```
Sub RectangleConfiguration()  
'VBA421  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
.BorderFlashColorOn = RGB(255, 0, 0)  
End With  
End Sub
```

### See also

- StaticText Object (Page 2067)
- StatusDisplay Object (Page 2070)
- Slider object (Page 2062)
- TextList Object (Page 2076)
- RoundRectangle Object (Page 2055)
- RoundButton Object (Page 2052)
- Rectangle Object (Page 2049)
- PolyLine Object (Page 2038)
- Polygon Object (Page 2035)
- PieSegment Object (Page 2032)
- OptionGroup Object (Page 2025)
- Line Object (Page 2004)
- GraphicObject Object (Page 1975)

- IOField Object (Page 1992)
- EllipseSegment Object (Page 1963)
- EllipseArc Object (Page 1960)
- Ellipse Object (Page 1957)
- CircularArc Object (Page 1931)
- Circle Object (Page 1928)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)

## BorderStyle Property

### Description

Defines or returns the line style for the object. Value range from 0 to 4:

Line style	Assigned Value
_____	0
— — —	1
-----	2
- - -	3
----	4

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the line style will be set to "1":

```
Sub RectangleConfiguration()
'VBA422
Dim objRectangle As HMIRectangle
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")
With objRectangle
.BorderStyle = 1
End With
End Sub
```

### See also

- IOField Object (Page 1992)
- StatusDisplay Object (Page 2070)
- StaticText Object (Page 2067)



Slider object (Page 2062)  
RoundRectangle Object (Page 2055)  
RoundButton Object (Page 2052)  
Rectangle Object (Page 2049)  
Polygon Object (Page 2035)  
PolyLine Object (Page 2038)  
TextList Object (Page 2076)  
PieSegment Object (Page 2032)  
OptionGroup Object (Page 2025)  
Line Object (Page 2004)  
GraphicObject Object (Page 1975)  
EllipseSegment Object (Page 1963)  
EllipseArc Object (Page 1960)  
Ellipse Object (Page 1957)  
CircularArc Object (Page 1931)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)  
BarGraph Object (Page 1914)  
3DBarGraph Object (Page 1894)

## BorderWidth Property

### Description

Defines or returns the line weight (in pixels) for the object.

### Example:

in the following example the line weight of a newly added circle will be set to "2".

```
Sub CircleConfiguration()  
  'VBA423  
  Dim objCircle As IHMICircle  
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle1", "HMICircle")  
  With objCircle  
    .BorderWidth = 2  
  End With  
End Sub
```

## See also

IOField Object (Page 1992)  
StatusDisplay Object (Page 2070)  
StaticText Object (Page 2067)  
Slider object (Page 2062)  
TextList Object (Page 2076)  
RoundRectangle Object (Page 2055)  
RoundButton Object (Page 2052)  
Rectangle Object (Page 2049)  
PolyLine Object (Page 2038)  
Polygon Object (Page 2035)  
PieSegment Object (Page 2032)  
OptionGroup Object (Page 2025)  
Line Object (Page 2004)  
GraphicObject Object (Page 1975)  
EllipseSegment Object (Page 1963)  
EllipseArc Object (Page 1960)  
Ellipse Object (Page 1957)  
CircularArc Object (Page 1931)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)

## BottomConnectedObjectName Property

### Description

Returns the name of the starting object to which the connector is Read only access.

### Example:

An example showing how to use the BottomConnectedObjectName property can be found in this documentation under the heading "ObjConnection Object".

## See also


ObjConnection object (Page 2019)

## BottomConnectedConnectionPointIndex Property

### Description

Returns the connection point on the object to which the connector is connected.

Connection Point	Assigned Value
Up	0
Right	1
Down	2
Left	3

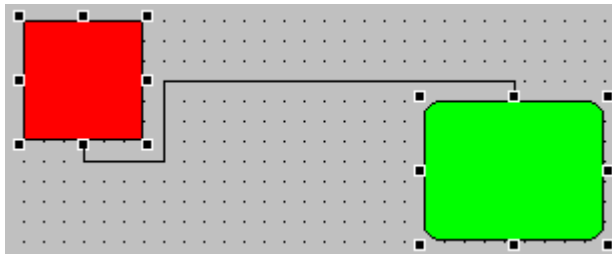

### Example:

An example showing how to use the BottomConnectedObjectName property can be found in this documentation under the heading "ObjConnection Object".

### See also

ObjConnection object (Page 2019)

## BoxAlignment Property

### Description

TRUE, when the fields are arranged aligned to the right. BOOLEAN write-read access.

**Example:**

The "CreateOptionGroup()" procedure creates the OptionGroup object with four option buttons. Each option button is assigned the default name "myCustomText<Number>":

```
Sub CreateOptionGroup()  
'VBA424  
Dim objRadioBox As HMIOptionGroup  
Dim iCounter As Integer  
Set objRadioBox = ActiveDocument.HMIObjects.AddHMIObject("RadioBox_1", "HMIOptionGroup")  
iCounter = 1  
With objRadioBox  
.Height = 100  
.Width = 180  
.BoxCount = 4  
.BoxAlignment = False  
For iCounter = 1 To .BoxCount  
.index = iCounter  
.Text = "CustomText" & .index  
Next iCounter  
End With  
End Sub
```

**See also**

- BoxCount Property (Page 2164)
- OptionGroup Object (Page 2025)
- CheckBox Object (Page 1924)

**BoxCount Property**

**Description**

Defines or returns the number of fields. Value range from 1 to 32.

**Example:**

The "CreateOptionGroup()" procedure creates the OptionGroup object with four option buttons. Each option button is assigned the default name "myCustomText<Number>":

```
Sub CreateOptionGroup()
'VBA425
Dim objRadioBox As HMIOptionGroup
Dim iCounter As Integer
Set objRadioBox = ActiveDocument.HMIObjects.AddHMIObject("RadioBox_1", "HMIOptionGroup")
iCounter = 1
With objRadioBox
.Height = 100
.Width = 180
.BoxCount = 4
.BoxAlignment = True
For iCounter = 1 To .BoxCount
.index = iCounter
.Text = "CustomText" & .index
Next iCounter
End With
End Sub
```

**See also**

[BoxAlignment Property \(Page 2163\)](#)

[OptionGroup Object \(Page 2025\)](#)

[CheckBox Object \(Page 1924\)](#)

**BoxType Property****Description**

Defines or returns the field type. Value range from 0 to 2.

Field type	Assigned Value
Edition	0
Input	1
I/O field	2

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the field type is configured as "Input":

```
Sub IOFieldConfiguration()  
'VBA426  
Dim objIOField As HMIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")  
With objIOField  
  .BoxType = 1  
End With  
End Sub
```

**See also**

IOField Object (Page 1992)

**Button1..8MessageClasses**

**Description**

Defines one or more message events in the group display for representing the respective command button. This is done by entering the numbers of the bits in the collective value.

If you want to assign several message events, delimit the numbers with a comma. The order of assignment defines the priority. If there is more than one selected event for one button, the event that has been entered first is displayed.

The same event can be visualized simultaneously in several buttons.

**Button1..8Width property**

**Description**

Defines or returns for the "Group Display" object the width of the respective button in pixels.

When the "SameSize" property is set to "TRUE", all buttons are set to the same width.

## Example

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the width of button "1" is set to "50":

```
Sub GroupDisplayConfiguration()  
'VBA427  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.Button1Width = 50  
End With  
End Sub
```

## See also

SameSize Property (Page 2403)

GroupDisplay Object (Page 1980)

## ButtonColor Property

### Description

Defines or returns the color of the slider for the Slider object. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "SliderConfiguration()" procedure accesses the properties of the slider. In this example the color of the slider will be set to "Yellow".

```
Sub SliderConfiguration()  
'VBA431  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("SliderObject1", "HMISlider")  
With objSlider  
.ButtonColor = RGB(255, 255, 0)  
End With  
End Sub
```

## See also

Slider object (Page 2062)

## C

### Caption Property

#### Description

TRUE, when the application or picture window has a title bar in Runtime. BOOLEAN write-read access.

The Caption property must be set to "True" if the intention is that the application window or picture window shall have Maximize and Close buttons.

#### Example:

The "ApplicationWindowConfig" procedure accesses the properties of the application window. In this example the application window will

```
Sub ApplicationWindowConfig()  
'VBA432  
Dim objAppWindow As HMIApplicationWindow  
Set objAppWindow = ActiveDocument.HMIObjects.AddHMIObject("AppWindow",  
"HMIApplicationWindow")  
With objAppWindow  
.Caption = True  
.CloseButton = False  
.Height = 200  
.Left = 10  
.MaximizeButton = True  
.Moveable = False  
.OnTop = True  
.Sizeable = True  
.Top = 20  
.Visible = True  
.Width = 250  
.WindowBorder = True  
End With  
End Sub
```

## See also

PictureWindow Object (Page 2029)

ApplicationWindow Object (Page 1911)



## CaptionText Property

### Description

Defines or returns the window title that will be displayed for the PictureWindow object in Runtime.

The Caption property must be set to TRUE."

### Example:

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will

```
Sub PictureWindowConfig()  
'VBA433  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
  .AdaptPicture = False  
  .AdaptSize = False  
  .Caption = True  
  .CaptionText = "Picturewindow in runtime"  
  .OffsetLeft = 5  
  .OffsetTop = 10  
  'Replace the picturename "Test.PDL" with the name of  
  'an existing document from your "GraCS"-Folder of your active project  
  .PictureName = "Test.PDL"  
  .ScrollBars = True  
  .ServerPrefix = ""  
  .TagPrefix = "Struct."  
  .UpdateCycle = 5  
  .Zoom = 100  
End With  
End Sub
```

### See also

[PictureWindow Object \(Page 2029\)](#)

## CBackColorOff..ColorOn property

### Description

Specifies for the selected message type and the state "Came In" which color the background of the value to be displayed assumes for flashing status "Off" (CBackColorOff) or "On" (CBackColorOn).

### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0).

## CBackFlash property

### Description

Specifies for the selected message type and status "Came In" whether the background of the value to be displayed flashes when a message is received.

## CheckAlarmHigh Property

### Description

TRUE if the "Alarm High" limit value is being monitored for the BarGraph object. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties AlarmHigh, ColorAlarmHigh and TypeAlarmHigh.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "50".

```
Sub BarGraphLimitConfiguration()  
  'VBA434  
  Dim objBarGraph As HMIBarGraph  
  Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
  With objBarGraph  
    'Set analysis to absolute  
    .TypeAlarmHigh = False  
    'Activate monitoring  
    .CheckAlarmHigh = True  
    'Set barcolor to "yellow"  
    .ColorAlarmHigh = RGB(255, 255, 0)  
    'Set upper limit to "50"  
    .AlarmHigh = 50  
  End With  
End Sub
```

## See also

TypeAlarmHigh Property (Page 2451)  
ColorAlarmHigh Property (Page 2182)  
AlarmHigh Property (Page 2114)  
BarGraph Object (Page 1914)

## CheckAlarmLow Property

### Description

TRUE if the "Alarm Low" limit value is being monitored for the BarGraph object. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties AlarmLow, ColorAlarmLow and TypeAlarmLow.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "10".

```
Sub BarGraphLimitConfiguration()  
'VBA435  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeAlarmLow = False  
'Activate monitoring  
.CheckAlarmLow = True  
'Set barcolor to "yellow"  
.ColorAlarmLow = RGB(255, 255, 0)  
'Set lower limit to "10"  
.AlarmLow = 10  
End With  
End Sub
```

## See also

ColorAlarmLow Property (Page 2183)  
TypeAlarmLow Property (Page 2452)  
AlarmLow Property (Page 2115)  
BarGraph Object (Page 1914)

## Checked Property

### Description

TRUE if a check mark is to appear in front of the user-defined menu entry. BOOLEAN write-read access.

### Example:

The "CreateMenuItem()" procedure creates the "Delete Objects" menu and adds two menu entries ("Delete Rectangles" and "Delete Circles"): The first menu entry is also marked with a tick:

```
Sub CreateMenuItem()  
'VBA436  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
'  
'Add new menu "Delete objects" to menubar:  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DeleteObjects", "Delete objects")  
'  
'Add two menuitems to the new menu  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "DeleteAllRectangles", "Delete  
Rectangles")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(2, "DeleteAllCircles", "Delete Circles")  
With objMenu.MenuItems  
.Item("DeleteAllRectangles").Checked = True  
End With  
End Sub
```

### See also

[MenuItems Property \(Page 2337\)](#)

[Configuring Menus and Toolbars \(Page 1626\)](#)

## CheckLimitHigh4 Property

### Description

TRUE if the "Reserve 4" high limit value of the bar graph object is to be monitored. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties LimitHigh4, ColorLimitHigh4 and TypeLimitHigh4.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "70".

```
Sub BarGraphLimitConfiguration()  
'VBA437  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitHigh4 = False  
'Activate monitoring  
.CheckLimitHigh4 = True  
'set barcolor to "red"  
.ColorLimitHigh4 = RGB(255, 0, 0)  
'Set upper limit to "70"  
.LimitHigh4 = 70  
End With  
End Sub
```

**See also**

[TypeLimitHigh4 Property \(Page 2453\)](#)  
[LimitHigh4 Property \(Page 2307\)](#)  
[ColorLimitHigh4 Property \(Page 2186\)](#)  
[BarGraph Object \(Page 1914\)](#)

**CheckLimitHigh5 Property****Description**

TRUE if the "Reserve 5" high limit value of the bar graph object is to be monitored. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties LimitHigh5, ColorLimitHigh5 and TypeLimitHigh5.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "80".

```
Sub BarGraphLimitConfiguration()  
'VBA438  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitHigh5 = False  
'Activate monitoring  
.CheckLimitHigh5 = True  
'set barcolor to "black"  
.ColorLimitHigh5 = RGB(0, 0, 0)  
'Set upper limit to "80"  
.LimitHigh5 = 80  
End With  
End Sub
```

**See also**

- ColorLimitHigh5 Property (Page 2186)
- TypeLimitHigh5 Property (Page 2453)
- LimitHigh4 Property (Page 2307)
- BarGraph Object (Page 1914)

**CheckLimitLow4 Property**

**Description**

TRUE if the "Reserve 4" low limit value of the bar graph object is to be monitored. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties LimitLow4, ColorLimitLow4 and TypeLimitLow4.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "5".

```
Sub BarGraphLimitConfiguration()  
'VBA439  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitLow4 = False  
'Activate monitoring  
.CheckLimitLow4 = True  
'Set barcolor to "green"  
.ColorLimitLow4 = RGB(0, 255, 0)  
'set lower limit to "5"  
.LimitLow4 = 5  
End With  
End Sub
```

**See also**

[TypeLimitLow4 Property \(Page 2454\)](#)

[LimitLow4 Property \(Page 2308\)](#)

[ColorLimitLow4 Property \(Page 2187\)](#)

[BarGraph Object \(Page 1914\)](#)

**CheckLimitLow5 Property****Description**

TRUE if the "Reserve 5" low limit value of the bar graph object is to be monitored. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties LimitLow5, ColorLimitLow5 and TypeLimitLow5.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "0".

```
Sub BarGraphLimitConfiguration()  
'VBA440  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitLow5 = False  
'Activate monitoring  
.CheckLimitLow5 = True  
'Set barcolor to "white"  
.ColorLimitLow5 = RGB(255, 255, 255)  
'set lower limit to "0"  
.LimitLow5 = 0  
End With  
End Sub
```

**See also**

- TypeLimitLow5 Property (Page 2455)
- LimitLow5 Property (Page 2309)
- ColorLimitLow5 Property (Page 2188)
- BarGraph Object (Page 1914)

**CheckToleranceHigh Property**

**Description**

TRUE if the "Tolerance High" limit value is being monitored for the BarGraph object. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties ToleranceHigh, ColorToleranceHigh and TypeToleranceHigh.



**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "45".

```
Sub BarGraphLimitConfiguration()  
'VBA441  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeToleranceHigh = False  
'Activate monitoring  
.CheckToleranceHigh = True  
'Set barcolor to "yellow"  
.ColorToleranceHigh = RGB(255, 255, 0)  
'Set upper limit to "45"  
.ToleranceHigh = 45  
End With  
End Sub
```

**See also**

[TypeToleranceHigh Property \(Page 2456\)](#)  
[ToleranceHigh Property \(Page 2442\)](#)  
[ColorToleranceHigh Property \(Page 2189\)](#)  
[BarGraph Object \(Page 1914\)](#)

**CheckToleranceLow Property****Description**

TRUE if the "Tolerance Low" limit value is being monitored for the BarGraph object. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties ToleranceLow, ColorToleranceLow and TypeToleranceLow.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "15".

```
Sub BarGraphLimitConfiguration()  
'VBA442  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeToleranceLow = False  
'Activate monitoring  
.CheckToleranceLow = True  
'Set barcolor to "yellow"  
.ColorToleranceLow = RGB(255, 255, 0)  
'Set lower limit to "15"  
.ToleranceLow = 15  
End With  
End Sub
```

**See also**

- BarGraph Object (Page 1914)
- TypeToleranceLow Property (Page 2457)
- ToleranceLow Property (Page 2442)
- ColorToleranceLow Property (Page 2190)

**CheckWarningHigh Property**

**Description**

TRUE if the "Warning High" limit value is being monitored for the BarGraph object. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties WarningHigh, ColorWarningHigh and TypeWarningHigh.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "75".

```
Sub BarGraphLimitConfiguration()  
'VBA443  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeWarningHigh = False  
'Activate monitoring  
.CheckWarningHigh = True  
'Set barcolor to "red"  
.ColorWarningHigh = RGB(255, 0, 0)  
'Set upper limit to "75"  
.WarningHigh = 75  
End With  
End Sub
```

**See also**

[WarningHigh Property \(Page 2552\)](#)  
[TypeWarningHigh Property \(Page 2458\)](#)  
[ColorWarningHigh Property \(Page 2192\)](#)  
[BarGraph Object \(Page 1914\)](#)

**CheckWarningLow Property****Description**

TRUE if the "Warning Low" limit value is being monitored for the BarGraph object. BOOLEAN write-read access.

The limit value, the display on reaching the limit value and the type of evaluation are defined via the properties WarningLow, ColorWarningLow and TypeWarningLow.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "12".

```
Sub BarGraphLimitConfiguration()  
'VBA444  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeWarningLow = False  
'Activate monitoring  
.CheckWarningLow = True  
'Set barcolor to "magenta"  
.ColorWarningLow = RGB(255, 0, 255)  
'Set lower limit to "12"  
.WarningLow = 12  
End With  
End Sub
```

**See also**

- WarningLow Property (Page 2553)
- TypeWarningLow Property (Page 2459)
- ColorWarningLow Property (Page 2193)
- BarGraph Object (Page 1914)

**ClearOnError Property**

**Description**

TRUE if the entry in the I/O field is automatically deleted when the input is incorrect. BOOLEAN write-read access.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the I/O field is to be cleared when the input is incorrect:

```
Sub IOFieldConfiguration()  
'VBA445  
Dim objIOField As HMIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")  
With objIOField  
  .ClearOnError = True  
End With  
End Sub
```

**See also**

IOField Object (Page 1992)

**ClearOnNew Property****Description**

TRUE if the entry in the I/O field is deleted as soon as the I/O field gets the focus. BOOLEAN write-read access.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the entry in the I/O field is deleted as soon as the field gets the focus:

```
Sub IOFieldConfiguration()  
'VBA446  
Dim objIOField As HMIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")  
With objIOField  
  .ClearOnNew = True  
End With  
End Sub
```

**See also**

IOField Object (Page 1992)

## CloseButton Property

### Description

TRUE if the ApplicationWindow and PictureWindow objects possess a "Close" button in Runtime. BOOLEAN write-read access.

### Example:

The "ApplicationWindowConfig" procedure accesses the properties of the application window. In this example the application window will have a "Close" button in Runtime:

```
Sub ApplicationWindowConfig()  
'VBA447  
Dim objAppWindow As HMIApplicationWindow  
Set objAppWindow = ActiveDocument.HMIObjects.AddHMIObject("AppWindow1",  
"HMIApplicationWindow")  
With objAppWindow  
.CloseButton = True  
End With  
End Sub
```

### See also

[PictureWindow Object \(Page 2029\)](#)

[ApplicationWindow Object \(Page 1911\)](#)

## CollectValue property

### Description

The CollectValue property specifies as an initial value the current status of the active message classes in each case.

The "Relevant" property has to have the value "TRUE" so that the advanced analog display is taken into account when forming the group display .

## ColorAlarmHigh Property

### Description

Defines or returns the bar color for the "Alarm High" limit value. LONG write-read access.

The "CheckAlarmHigh" property must have been set to TRUE if the bar color should change on reaching the limit value.

### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "50 " and the bar color will change to Red.

```
Sub BarGraphLimitConfiguration()  
'VBA449  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeAlarmHigh = False  
'Activate monitoring  
.CheckAlarmHigh = True  
'Set barcolor to "red"  
.ColorAlarmHigh = RGB(255, 0, 0)  
'Set upper limit to "50"  
.AlarmHigh = 50  
End With  
End Sub
```

### See also

[CheckAlarmHigh Property \(Page 2170\)](#)

[BarGraph Object \(Page 1914\)](#)

### ColorAlarmLow Property

#### Description

Defines or returns the bar color for the "Alarm Low" limit value. LONG write-read access.

The "CheckAlarmLow" property must have been set to TRUE if the bar color should change on reaching the limit value.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "10 " and the bar color will change to Red.

```
Sub BarGraphLimitConfiguration()  
'VBA450  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeAlarmLow = False  
'Activate monitoring  
.CheckAlarmLow = True  
'Set barcolor to "red"  
.ColorAlarmLow = RGB(255, 0, 0)  
'Set lower limit to "10"  
.AlarmLow = 10  
End With  
End Sub
```

**See also**

- CheckAlarmLow Property (Page 2171)
- BarGraph Object (Page 1914)

**ColorBottom Property**

**Description**

Defines or returns the color for the bottom/right stop of the slider object. LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)



**Example:**

The "SliderConfiguration()" procedure accesses the properties of the slider. In this example the color for the lower/right view will be set to "Red":

```
Sub SliderConfiguration()  
'VBA451  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("SliderObject1", "HMISlider")  
With objSlider  
.ColorBottom = RGB(255, 0, 0)  
End With  
End Sub
```

**See also**

Slider object (Page 2062)

**ColorChangeType Property****Description**

TRUE if a color change in the BarGraph object (for instance when a limit value is reached) is to take place segment by segment. If set to FALSE, it defines the change of color for the entire bar. BOOLEAN write-read access.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures In this example the color change will apply to the whole bar:

```
Sub BarGraphLimitConfiguration()  
'VBA452  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.ColorChangeType = False  
End With  
End Sub
```

**See also**

BarGraph Object (Page 1914)

## ColorLimitHigh4 Property

### Description

Defines or returns the color for the "Reserve 4" upper limit value. LONG write-read access.

The "CheckLimitHigh4" property must have been set to TRUE if the bar color should change on reaching the limit value.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "70 " and the bar color will change to Red.

```
Sub BarGraphLimitConfiguration()  
'VBA453  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitHigh4 = False  
'Activate monitoring  
.CheckLimitHigh4 = True  
'Set barcolor to "red"  
.ColorLimitHigh4 = RGB(255, 0, 0)  
'Set upper limit to "70"  
.LimitHigh4 = 70  
End With  
End Sub
```

### See also

[CheckLimitHigh4 Property \(Page 2172\)](#)

[BarGraph Object \(Page 1914\)](#)

## ColorLimitHigh5 Property

### Description

Defines or returns the color for the "Reserve 5" upper limit value. LONG write-read access.

The "CheckLimitHigh5" property must have been set to TRUE if the bar color should change on reaching the limit value.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

#### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "80" and the bar color will change to "Black".

```
Sub BarGraphLimitConfiguration()  
  'VBA454  
  Dim objBarGraph As HMIBarGraph  
  Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
  With objBarGraph  
    'Set analysis to absolute  
    .TypeLimitHigh5 = False  
    'Activate monitoring  
    .CheckLimitHigh5 = True  
    'Set barcolor to "black"  
    .ColorLimitHigh5 = RGB(0, 0, 0)  
    'Set upper limit to "80"  
    .LimitHigh5 = 80  
  End With  
End Sub
```

#### See also

[CheckLimitHigh5 Property \(Page 2173\)](#)

[BarGraph Object \(Page 1914\)](#)

#### ColorLimitLow4 Property

##### Description

Defines or returns the color for the "Reserve 4" lower limit value. LONG write-read access.

The "CheckLimitLow4" property must have been set to TRUE if the bar color should change on reaching the limit value.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "5" and the bar color will change to "Green".

```
Sub BarGraphLimitConfiguration()  
'VBA455  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitLow4 = False  
'Activate monitoring  
.CheckLimitLow4 = True  
'Set barcolor to "green"  
.ColorLimitLow4 = RGB(0, 255, 0)  
'Set lower limit to "5"  
.LimitLow4 = 5  
End With  
End Sub
```

**See also**

[CheckLimitLow4 Property \(Page 2174\)](#)

[BarGraph Object \(Page 1914\)](#)

**ColorLimitLow5 Property****Description**

Defines or returns the color for the "Reserve 5" lower limit value. LONG write-read access.

The "CheckLimitLow5" property must have been set to TRUE if the bar color should change on reaching the limit value.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "0" and the bar color will change to "White".

```
Sub BarGraphLimitConfiguration()  
'VBA456  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitLow5 = False  
'Activate monitoring  
.CheckLimitLow5 = True  
'Set barcolor to "white"  
.ColorLimitLow5 = RGB(255, 255, 255)  
'Set lower limit to "0"  
.LimitLow5 = 0  
End With  
End Sub
```

**See also**

[CheckLimitLow5 Property \(Page 2175\)](#)

[BarGraph Object \(Page 1914\)](#)

**ColorToleranceHigh Property****Description**

Defines or returns the color for the "Tolerance High" high limit value. LONG write-read access.

The "CheckToleranceHigh" property must have been set to TRUE if the bar color should change on reaching the limit value.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "45" and the bar color will change to "Yellow".

```
Sub BarGraphLimitConfiguration()  
'VBA457  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
  'Set analysis to absolute  
  .TypeToleranceHigh = False  
  'Activate monitoring  
  .CheckToleranceHigh = True  
  'Set barcolor to "yellow"  
  .ColorToleranceHigh = RGB(255, 255, 0)  
  'Set upper limit to "45"  
  .ToleranceHigh = 45  
End With  
End Sub
```

**See also**

[CheckToleranceHigh Property \(Page 2176\)](#)

[BarGraph Object \(Page 1914\)](#)

**ColorToleranceLow Property****Description**

Defines or returns the color for the "Tolerance Low" low limit value. LONG write-read access.

The "CheckToleranceLow" property must have been set to TRUE if the bar color should change on reaching the limit value.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "12" and the bar color will change to "Yellow".

```
Sub BarGraphLimitConfiguration()  
'VBA458  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeToleranceLow = False  
'Activate monitoring  
.CheckToleranceLow = True  
'Set barcolor to "yellow"  
.ColorToleranceLow = RGB(255, 255, 0)  
'Set lower limit to "15"  
.ToleranceLow = 15  
End With  
End Sub
```

**See also**

[CheckToleranceLow Property \(Page 2177\)](#)

[BarGraph Object \(Page 1914\)](#)

**ColorTop Property****Description**

Defines or returns the color for the top/left stop of the slider object. LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "SliderConfiguration()" procedure accesses the properties of the slider. In this example the color for the upper/left view will be set to "Orange":

```
Sub SliderConfiguration()  
'VBA459  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("SliderObject1", "HMISlider")  
With objSlider  
.ColorTop = RGB(255, 128, 0)  
End With  
End Sub
```

### See also

Slider object (Page 2062)

## ColorWarningHigh Property

### Description

Defines or returns the color for the "Warning High" high limit value. LONG write-read access. The "CheckWarningHigh" property must have been set to TRUE if the bar color should change on reaching the limit value.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)



**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "75" and the bar color will change to "Red".

```
Sub BarGraphLimitConfiguration()  
'VBA460  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeWarningHigh = False  
'Activate monitoring  
.CheckWarningHigh = True  
'Set barcolor to "red"  
.ColorWarningHigh = RGB(255, 0, 0)  
'Set upper limit to "75"  
.WarningHigh = 75  
End With  
End Sub
```

**See also**

[CheckWarningHigh Property \(Page 2178\)](#)

[BarGraph Object \(Page 1914\)](#)

**ColorWarningLow Property****Description**

Defines or returns the color for the "Warning Low" low limit value. LONG write-read access.

The "CheckWarningLow" property must have been set to TRUE if the bar color should change on reaching the limit value.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "12" and the bar color will change to "Magenta".

```
Sub BarGraphLimitConfiguration()  
'VBA461  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeWarningLow = False  
'Activate monitoring  
.CheckWarningLow = True  
'Set barcolor to "magenta"  
.ColorWarningLow = RGB(255, 0, 255)  
'Set lower limit to "12"  
.WarningLow = 12  
End With  
End Sub
```

### See also

[CheckWarningLow Property \(Page 2179\)](#)  
[BarGraph Object \(Page 1914\)](#)

### CommonVBSCode Property

#### Description

Defines the higher-level common declaration section of the actions for the active picture or returns it.

The action editor of the Graphics Designer is used to configure actions at events and properties. In the declaration section of the actions, you can declare tags for a process image as well as create functions and procedures. In Runtime, each VBS action can access these tags, functions and procedures if the picture is active.

If you set "CommonVBSCode", the string is copied to the "Event" and "Property" declaration sections in the action editor. Any code there is overwritten. Therefore, set "CommonVBSCode" first before setting the subordinate declaration sections with "CommonVBSEventArea" or "CommonVBSPROPERTYArea".

## Example

In the following example, a tag that is common to all picture objects is declared in the active picture. The common declaration section is then output :

```
Sub DefineTagInActiveDocument
ActiveDocument.CommonVBSCode = "DIM actionIsdone" & vbCrLf
MsgBox ActiveDocument.CommonVBSCode
End Sub
```

## See also

Document Object (Page 1949)

## CommonVBSEventArea property

### Description

Defines the "Event" declaration section of the actions for the active picture or returns it.

The action editor of the Graphics Designer is used to configure actions, for example, at events. To this purpose, you can declare tags for a process image as well as create functions and procedures in the "Event" declaration section of the actions. In Runtime each VBS action that was configured for an event can access these tags, functions and procedures if the picture is active.

If you set "CommonVBSEventArea", the string is copied to the "Event" declaration section in the action editor. Any code there is overwritten. Therefore, first read the code set, for example with "CommonVBSCode" before you set the declaration section with "CommonVBSEventArea".

## Example

In the following example, two tags are declared in the active picture. The "Event" declaration section is the output:

```
Sub DefineTagInActiveDocument
ActiveDocument.CommonVBSCode = "DIM actionIsdone" & vbCrLf
ActiveDocument.CommonVBSEventArea = ActiveDocument.CommonVBSEventArea & "DIM
"eventHasOccurred"
MsgBox ActiveDocument.CommonVBSEventArea
End Sub
```

## CommonVBSPROPERTYArea property

### Description

Defines the "Property" declaration section of the actions for the active picture or returns it.

The action editor of the Graphics Designer is used to configure actions for example at properties. To this purpose you can declare tags for a process image as well as create functions and procedures in the "Property" declaration section of the actions. In Runtime each VBS action that was configured for a property can access these tags, functions and procedures if the picture is active.

If you set "CommonVBSPROPERTYArea", the string is copied to the "Property" declaration section in the action editor. Any code there is overwritten. Therefore, first read the code set, for example with "CommonVBSCODE" before you set the declaration section with "CommonVBSPROPERTYArea".

### Example

In the following example, two tags are declared in the active picture. The "Property" declaration section is then output:

```
Sub DefineTagInActiveDocument
ActiveDocument.CommonVBSCODE = "DIM actionIsdone" & vbCrLf
ActiveDocument CommonVBSPROPERTYArea = ActiveDocument.CommonVBSPROPERTYArea & "DIM
propertyIsChanged"
MsgBox ActiveDocument.CommonVBSPROPERTYArea
End Sub
```

## CommandLine Property

### Description

Returns the start parameter as a string if the application is opened via Start>Execute "Grafexe.exe start parameter". Read only access.

### Example:

In this example a message containing the start parameter is output on opening the document.

```
Sub Document_Opened(CancelForwarding As Boolean)
'VBA462
MsgBox Application.Commandline
End Sub
```

## See also

Application Object (Page 1909)

## Compiled Property

### Description

TRUE if the source code of a C script or VB script was successfully compiled. BOOLEAN read access.

### Example:

In the following example a button and a circle will be inserted in the active picture. In Runtime the radius of the circle will enlarge every time you click the button. A VB script will be used for this purpose:

```
Sub IncreaseCircleRadiusWithVBScript()  
'VBA463  
Dim objButton As HMIButton  
Dim objCircleA As HMICircle  
Dim objEvent As HMIEvent  
Dim objVBScript As HMIScriptInfo  
Dim strCode As String  
strCode = "Dim objCircle" & vbCrLf & "Set objCircle = "  
strCode = strCode & "hmiRuntime.ActiveScreen.ScreenItems("CircleVB")"  
strCode = strCode & vbCrLf & "objCircle.Radius = objCircle.Radius + 5"  
Set objCircleA = ActiveDocument.HMIObjects.AddHMIObject("CircleVB", "HMICircle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objCircleA  
.Top = 100  
.Left = 100  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 200  
.Text = "Increase Radius"  
End With  
'On every mouseclick the radius will be increased:  
Set objEvent = objButton.Events(1)  
Set objVBScript = objButton.Events(1).Actions.AddAction(hmiActionCreationTypeVBScript)  
objVBScript.SourceCode = strCode  
Select Case objVBScript.Compiled  
Case True  
MsgBox "Compilation OK!"  
Case False  
MsgBox "Errors by compilation!"  
End Select  
End Sub
```

## See also

SourceCode Property (Page 2424)

ScriptInfo Object (Page 2058)

## ConfigurationFileName Property


### Description

Returns the file name and full path of the configuration file for the open project. STRING read access.

### Example:

The "ShowConfigurationFileName()" procedure outputs the configuration file path for the current picture:

```
Sub ShowConfigurationFileName()  
    'VBA464  
    MsgBox ActiveDocument.Application.ConfigurationFileName  
End Sub
```

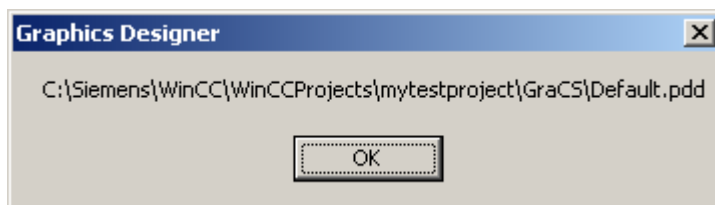

## See also

Application Property (Page 2121)

Application Object (Page 1909)

## ConnectionPoints property

### Description

Returns the number of connection points of an object.

### Example: Number of connection points of a rectangle

In this example, a rectangle is inserted and the number of connection points is output:

```
Sub CountConnectionPoints()  
'VBA229  
Dim objRectangle As HMIRectangle  
Dim objConnPoints As HMIConnectionPoints  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
Set objConnPoints = ActiveDocument.HMIObjects("Rectangle1").ConnectionPoints  
MsgBox "Rectangle1 has " & objConnPoints.Count & " connectionpoints."  
End Sub
```

### ConnectorObjects property

#### Description

Only used internally.

#### See also

- 3DBarGraph Object (Page 1894)
- ActiveXControl Object (Page 1900)
- AdvancedAnalogDisplay object (Page 1901)
- AdvancedStateDisplay object (Page 1905)
- ApplicationWindow Object (Page 1911)
- BarGraph Object (Page 1914)
- Button Object (Page 1921)
- CheckBox Object (Page 1924)
- Circle Object (Page 1928)
- CircularArc Object (Page 1931)
- ComboBox object (Page 1934)
- CustomizedObject Object (Page 1938)
- DataSetObj object (Page 1943)
- DotNetControl object (Page 1954)
- Ellipse Object (Page 1957)
- EllipseArc Object (Page 1960)
- EllipseSegment Object (Page 1963)
- FaceplateObject object (Page 1969)
- GraphicObject Object (Page 1975)
- Group Object (Page 1978)

- GroupDisplay Object (Page 1980)
- IOField Object (Page 1992)
- Line Object (Page 2004)
- ListBox object (Page 2007)
- MultiLineEdit object (Page 2016)
- ObjConnection object (Page 2019)
- OLEObject Object (Page 2023)
- OptionGroup Object (Page 2025)
- PictureWindow Object (Page 2029)
- PieSegment Object (Page 2032)
- Polygon Object (Page 2035)
- PolyLine Object (Page 2038)
- Rectangle Object (Page 2049)
- RoundButton Object (Page 2052)
- RoundRectangle Object (Page 2055)
- Slider object (Page 2062)
- StaticText Object (Page 2067)
- StatusDisplay Object (Page 2070)
- TextList Object (Page 2076)
- TubeArcObject object (Page 2088)
- TubeDoubleTeeObject object (Page 2090)
- TubePolyline object (Page 2092)
- TubeTeeObject object (Page 2094)
- WPFControl object (Page 2104)

### ConnectorType property

#### Description

Defines the type of connector:

Automatic	Both objects are connected by a polyline made up of horizontal and vertical parts.
Simple	Both objects are connected by a straight line between the connecting points.



### **ControlType property**

#### **Description**

Returns the name range of the control.

### **CopyPasteSettings property**

#### **Description**

Only used internally.

#### **See also**

Application Object (Page 1909)

### **CornerRadius property**

#### **Description**

Defines the rounding radius of the rectangle which enclose objects in the advanced analog display. The values are defined in pixels.

The range of values which can be displayed for the corner radius depends on the values set for the "height" and "width" properties. The maximum corner radius value which can be displayed is equivalent to 50% of the lower one of the "height" or "width" values. The maximum value is used if higher values are entered.

### **Count Property**

#### **Description**

Returns the number of elements in the specified listing. LONG read access

**Example:**

In the following example a new picture will be created and a pair of objects will be inserted. The number of inserted objects will be output at the end:

```
Sub ObjectsInActiveDocument()  
'VBA465  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objDocument As Document  
Set objDocument = Application.Documents.Add(hmiOpenDocumentTypeVisible)  
Dim iIndex As Integer  
iIndex = 1  
For iIndex = 1 To 5  
Set objCircle = objDocument.HMIObjects.AddHMIObject("Circle" & iIndex, "HMICircle")  
Set objRectangle = objDocument.HMIObjects.AddHMIObject("Rectangle" & iIndex,  
"HMIRectangle")  
With objCircle  
.Top = (10 * iIndex)  
.Left = (10 * iIndex)  
End With  
With objRectangle  
.Top = ((10 * iIndex) + 50)  
.Left = (10 * iIndex)  
End With  
Next iIndex  
MsgBox "There are " & objDocument.HMIObjects.Count & " objects in the document"  
End Sub
```

**See also**

- VariableTriggers Object (Listing) (Page 2101)
- Views Object (Listing) (Page 2103)
- VariableStateValues Object (Listing) (Page 2097)
- ToolBarItems Object (Listing) (Page 2085)
- Toolbars Object (Listing) (Page 2081)
- SymbolLibraries Object (Listing) (Page 2073)
- SelectedObjects object (Listing) (Page 2060)
- Properties Object (Listing) (Page 2041)
- HMIObjects Object (Listing) (Page 1990)
- MenuItems Object (Listing) (Page 2015)
- Menus Object (Listing) (Page 2011)
- Layers Object (Listing) (Page 2003)
- LanguageTexts Object (Listing) (Page 2000)
- LanguageFonts Object (Listing) (Page 1997)

GroupedObjects Object (Listing) (Page 1983)  
FolderItems Object (Listing) (Page 1973)  
Events Object (Listing) (Page 1967)  
Documents Object (Listing) (Page 1952)  
HMIDefaultObjects Object (Listing) (Page 1985)  
DataLanguages Object (Listing) (Page 1942)  
ConnectionPoints Object (Listing) (Page 1936)  
AnalogResultInfos Object (Listing) (Page 1908)  
Actions Object (Listing) (Page 1898)

### **CQBackColorOff..ColorOn property**

#### **Description**

Specifies for the selected message type and the state "Came In Acknowledged" which color the background of the value to be displayed assumes for flashing status "Off" (CBackColorOff) or "On" (CBackColorOn) when the arrival of a message is acknowledged..

#### **Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0).

### **CQBackFlash property**

#### **Description**

Specifies for the selected message type and status "Came In Acknowledged" whether the background of the value to be displayed flashes when the arrival of a message is acknowledged.

### **CQTextColorOff..ColorOn property**

#### **Description**

Specifies for the selected message type and the state "Came In Acknowledged" which color the text of the value to be displayed assumes for flashing status "Off" (CTextColorOff) or "On" (CTextColorOn) when the arrival of a message is acknowledged..

#### **Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0).

### **CQTextFlash property**

#### **Description**

Specifies for the selected message type and status "Came In Acknowledged" whether the background of the text to be displayed flashes when the arrival of a message is acknowledged.

### **CTextColorOff..ColorOn property**

#### **Description**

Specifies for the selected message type and the state "Came In" which color the text of the value to be displayed assumes for flashing status "Off" (CTextColorOff) or "On" (CTextColorOn).

#### **Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0).

### **CTextFlash property**

#### **Description**

Specifies for the selected message type and status "Came In" whether the text of the value to be displayed flashes when a message is received.

### **CurrentDataLanguage Property**

#### **Description**

Defines the project language or returns the language identifier as a decimal value. LONG read-write access.

**Example:**

The "ShowDataLanguage()" procedure outputs the currently set project language:

```
Sub ShowDataLanguage()  
'VBA466  
MsgBox Application.CurrentDataLanguage  
End Sub
```

**See also**

[Application Property \(Page 2121\)](#)

[DataLanguageChanged Event \(Page 1762\)](#)

[Language-Dependent Configuration with VBA \(Page 1624\)](#)

**CurrentDesktopLanguage Property****Description**

Returns the language identifier of the currently set user interface language as a decimal value. LONG read access.

**Example:**

The "ShowDesktopLanguage()" procedure outputs the currently set user interface language:

```
Sub ShowDesktopLanguage()  
'VBA467  
MsgBox Application.CurrentDesktopLanguage  
End Sub
```

**See also**

[Application Property \(Page 2121\)](#)

[Application Object \(Page 1909\)](#)

[DesktopLanguageChanged event \(Page 1763\)](#)

[Language-Dependent Configuration with VBA \(Page 1624\)](#)

## CursorControl Property

### Description

TRUE, when Alpha Cursor mode is activated, the cursor skips to the next field in the TAB sequence after exiting the field. BOOLEAN write-read access.

The CursorMode property must be set to TRUE.

### Example:

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the cursor will skip into the next field when another field is exited. For this to work, the Cursor mode property must first be set to TRUE.

```
Sub IOFieldConfiguration()  
'VBA468  
Dim objIOField As HMIIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIIOField")  
Application.ActiveDocument.CursorMode = True  
With objIOField  
  .CursorControl = True  
End With  
End Sub
```

### See also

[TabOrderAlpha Property \(Page 2429\)](#)  
[TabOrderSwitch Property \(Page 2433\)](#)  
[CursorMode Property \(Page 2206\)](#)  
[ActiveDocument Property \(Page 2107\)](#)  
[TextList Object \(Page 2076\)](#)  
[IOField Object \(Page 1992\)](#)

## CursorMode Property

### Description

TRUE if the "Alpha Cursor" mode is to be activated. FALSE if the "Tab order" mode is to be activated. BOOLEAN write-read access.

**Example:**

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example the "Alpha Cursor" mode will be activated:

```
Sub ActiveDocumentConfiguration()  
'VBA469  
Application.ActiveDocument.CursorMode = True  
End Sub
```

**See also**

[CursorControl Property \(Page 2206\)](#)  
[ActiveDocument Property \(Page 2107\)](#)  
[Documents Object \(Listing\) \(Page 1952\)](#)

**CustomMenus Property****Description**

Returns a listing of the available user-defined menus.

**Example:**

The "ShowCustomMenuInformation()" procedure outputs the Key and Label of all user-defined menus in the current picture:

```
Sub ShowCustomMenuInformation()  
'VBA470  
Dim strKey As String  
Dim strLabel As String  
Dim strOutput As String  
Dim iIndex As Integer  
For iIndex = 1 To ActiveDocument.CustomMenus.Count  
strKey = ActiveDocument.CustomMenus(iIndex).Key  
strLabel = ActiveDocument.CustomMenus(iIndex).Label  
strOutput = strOutput & vbCrLf & "Key: " & strKey & " Label: " & strLabel  
Next iIndex  
If 0 = ActiveDocument.CustomMenus.Count Then  
strOutput = "There are no custommenus for the document created."  
End If  
MsgBox strOutput  
End Sub
```

## See also

Application Property (Page 2121)

ActiveDocument Property (Page 2107)

Menu Object (Page 2009)

## CustomToolbars Property

### Description

Returns a listing of the available user-defined toolbars.

### Example:

The "ShowCustomToolbarInformation()" procedure outputs the Key values of all user-defined toolbars in the current picture:

```
Sub ShowCustomToolbarInformation()  
  'VBA471  
  Dim strKey As String  
  Dim strOutput As String  
  Dim iIndex As Integer  
  For iIndex = 1 To ActiveDocument.CustomToolbars.Count  
    strKey = ActiveDocument.CustomToolbars(iIndex).Key  
    strOutput = strOutput & vbCrLf & "Key: " & strKey  
  Next iIndex  
  If 0 = ActiveDocument.CustomToolbars.Count Then  
    strOutput = "There are no toolbars created for this document."  
  End If  
  MsgBox strOutput  
End Sub
```

## See also

Application Property (Page 2121)

ActiveDocument Property (Page 2107)

Toolbar Object (Page 2080)

## CycleName Property

### Description

Returns the name of the specified tag trigger. Read only access.



**Example:**

--

**See also**

VariableTrigger Object (Page 2099)

**CycleTime Property****Description**

Returns the cycle time of the specified tag trigger. Read only access.

**Example:**

--

**See also**

VariableTrigger Object (Page 2099)

**CycleType Property****Description**

Defines or returns the cycle type.

**Example:**

The "DynamicToRadiusOfNewCircle(hmiCircle As IHMICircle)" procedure creates a dynamic for the radius of a circle. In this example the radius of the circle will be set every two seconds:

```
Sub DynamicToRadiusOfNewCircle()  
'VBA474  
Dim objCircle As hmiCircle  
Dim VariableTrigger As HMIVariableTrigger  
Set objCircle = Application.ActiveDocument.HMIObjects.AddHMIObject("Circle1", "HMICircle")  
Set VariableTrigger = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVariableDirect,  
"NewDynamic1")  
VariableTrigger.CycleType = hmiVariableCycleType_2s  
End Sub
```

**See also**

VariableTrigger Object (Page 2099)

Configuring Dynamics in the Properties of Pictures and Objects (Page 1687)

**D**

**DataFormat Property**

**Description**

Defines or returns the data type of the IOField object. Value range from 0 to 3.

Data type	Assigned Value
Binary	0
Decimal	1
String	2
Hexadecimal	3

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example, data type "Decimal" will be set for the I/O field:

```
Sub IOFieldConfiguration()
'VBA475
Dim objIOField As HMIIOField
Set objIOField = ActiveDocument.HMIObjects.AddHMIOObject("IOField1", "HMIIOField")
With objIOField
.DataFormat = 1
End With
End Sub
```

**See also**

IOField Object (Page 1992)

**DefaultHMIOObjects Property**

**Description**

Returns the HMIDefaultObjects listing.

**Example:**

The "ShowDefaultObjectNames()" procedure outputs all the object names contained in the HMIDefaultObjects listing:

```
Sub ShowDefaultObjectNames()  
'VBA476  
Dim strOutput As String  
Dim iIndex As Integer  
For iIndex = 1 To Application.DefaultHMIObjects.Count  
strOutput = strOutput & vbCrLf & Application.DefaultHMIObjects(iIndex).ObjectName  
Next iIndex  
MsgBox strOutput  
End Sub
```

**See also**

HMIDefaultObjects Object (Listing) (Page 1985)

**DestinationLink Property****Description**

Returns the Destination object. Use the DestinationLink property to configure the destination object in the case of a direct connection.

**Example:**

Use the `DestinationLink` property to return the `DestLink` object. In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:

```
Sub DirectConnection()  
'VBA477  
Dim objButton As HMIButton  
Dim objRectangleA As HMIRectangle  
Dim objRectangleB As HMIRectangle  
Dim objEvent As HMIEvent  
Dim objDirConnection As HMIDirectConnection  
Set objRectangleA = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A", "HMIRectangle")  
Set objRectangleB = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objRectangleA  
.Top = 100  
.Left = 100  
End With  
With objRectangleB  
.Top = 250  
.Left = 400  
.BackColor = RGB(255, 0, 0)  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 100  
.Text = "SetPosition"  
End With  
'  
'Directconnection is initiated by mouseclick:  
Set objDirConnection =  
objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectConnection)  
With objDirConnection  
'Sourceobject: Property "Top" of Rectangle_A  
.SourceLink.Type = hmiSourceTypeProperty  
.SourceLink.ObjectName = "Rectangle_A"  
.SourceLink.AutomationName = "Top"  
'  
'Targetobject: Property "Left" of Rectangle_B  
.DestinationLink.Type = hmiDestTypeProperty  
.DestinationLink.ObjectName = "Rectangle_B"  
.DestinationLink.AutomationName = "Left"  
End With  
End Sub
```

**See also**

[AutomationName Property \(Page 2124\)](#)

[ObjectName Property \(Page 2347\)](#)

Type Property (Page 2450)

DirectConnection Object (Page 1947)

## Direction Property

### Description

Defines or returns the bar direction. BOOLEAN write-read access.

#### Slider

Defines or returns the position of the Slider object. BOOLEAN write-read access.

Position/Bar Axis	Assigned Value
Vertical/Negative	TRUE
Horizontal/Positive	FALSE

### Example:

The "SliderConfiguration()" procedure accesses the properties of the slider. In this example the position of the Slider object will be set to "Vertical":

```
Sub SliderConfiguration()
  'VBA478
  Dim objSlider As HMISlider
  Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("SliderObject1", "HMISlider")
  With objSlider
    .Direction = True
  End With
End Sub
```

### See also

Slider object (Page 2062)

3DBarGraph Object (Page 1894)

## DisablePerformanceWarnings property

### Description

Only used internally.

### See also

Application Object (Page 1909)

## DisableVBAEvents Property

### Description

TRUE if Event Handling is disabled. BOOLEAN write-read access.

### Example:

The "DisableVBAEvents()" procedure disables Event Handling:

```
Sub DisableVBAEvents()  
'VBA479  
Application.DisableVBAEvents = False  
End Sub
```

### See also

[Application Object \(Page 1909\)](#)

[Event Handling \(Page 1709\)](#)

## Display property

### Description

Only used internally.

### See also

[ObjConnection object \(Page 2019\)](#)

## DisplayName Property

### Description

Returns the name of the property attribute. STRING read access.

Thus the expression "MsgBox ActiveDocument.HMIObjects("Circle\_1").Properties("Height").DisplayName" would output the result "Height".

**Example:**

The "ShowAllObjectDisplayNames()" procedure outputs all the property attribute names of standard objects contained in the message box:

```
Sub ShowAllObjectDisplayNames ()
'VBA480
Dim strOutput As String
Dim iIndex1 As Integer
iIndex1 = 1
strOutput = "List of all properties-displaynames from object "" " &
Application.DefaultHMIObjects(1).ObjectName & """" & vbCrLf & vbCrLf
For iIndex1 = 1 To Application.DefaultHMIObjects(1).Properties.Count
strOutput = strOutput & Application.DefaultHMIObjects(1).Properties(iIndex1).DisplayName &
" / "
Next iIndex1
MsgBox strOutput
End Sub
```

**See also**

Property Object (Page 2042)

**DisplayOptions Property****Description**

Defines the assignment of the "Button" or "Round button" object or returns its value. Value range from 0 to 3.

Assignment	Assigned Value
Graphic or text	0
Graphic and text	1
Text only	2
Graphic only	3

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button.

In this example the button is assigned "Graphic and text":

```
Sub ButtonConfiguration()  
  'VBA814  
  Dim objbutton As HMIButton  
  Set objbutton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
  With objbutton  
    .DisplayOptions = 1  
  End With  
End Sub
```

## See also

Button Object (Page 1921)

## DisplayText Property

### Description

Returns the value for the "Label" or "TooltipText" property of the following objects (STRING read access):

- Menu Object
- MenuItem Object
- ToolbarItem Object

### Example:

The "ShowLabelTexts()" procedure outputs all the labels of the first user-defined menu in the current picture:

```
Sub ShowLabelTexts()  
  'VBA481  
  Dim objLangText As HMILanguageText  
  Dim iIndex As Integer  
  For iIndex = 1 To ActiveDocument.CustomMenus(1).LDLabelTexts.Count  
    Set objLangText = ActiveDocument.CustomMenus(1).LDLabelTexts(iIndex)  
    MsgBox objLangText.DisplayName  
  Next iIndex  
End Sub
```



## See also

ToolTipText Property (Page 2445)

Label Property (Page 2288)

ToolBarItem Object (Page 2083)

LanguageText Object (Page 1999)

MenuItem Object (Page 2013)

Menu Object (Page 2009)

## Documents Property

### Description

Returns the Documents listing containing all open pictures. The open pictures are in chronological order.

### Example:

In the following example the names of all open pictures are output:

```
Sub ShowDocuments()  
  'VBA482  
  Dim colDocuments As Documents  
  Dim objDocument As Document  
  Dim strOutput As String  
  Set colDocuments = Application.Documents  
  strOutput = "List of all opened documents:" & vbCrLf  
  For Each objDocument In colDocuments  
    strOutput = strOutput & vbCrLf & objDocument.Name  
  Next objDocument  
  MsgBox strOutput  
End Sub
```

## See also

Application Property (Page 2121)

Application Object (Page 1909)

## DrawInsideFrame property

### Description

Defines for all line thicknesses greater than "1" whether the border lines are to be drawn inside the object frame or symmetrically on the frame.

Yes	The border lines are drawn inside the object frame.
No	The border lines are drawn symmetrically on the object frame.

## DropDownListStyle property

### Description

Defines whether the entries in the "TextList" object are displayed in a drop-down list box.

## Dynamic Property

### Description

Returns the dynamics of a property.

### Example:

Use the Dynamic property if you wish to return, say, an existing dynamic. In the following example all possibly available object property dynamics are output in the active picture:

```
Sub ShowPropertiesDynamicsofAllObjects ()
  'VBA483
  Dim objObject As HMIObject
  Dim colObjects As HMIObjects
  Dim colProperties As HMIProperties
  Dim objProperty As HMIProperty
  Dim strOutput As String
  Set colObjects = Application.ActiveDocument.HMIObjects
  For Each objObject In colObjects
    Set colProperties = objObject.Properties
    For Each objProperty In colProperties
      If 0 <> objProperty.DynamicStateType Then
        strOutput = strOutput & vbCrLf & objObject.ObjectName & " - " & objProperty.DisplayName
        & ": Statetype " & objProperty.Dynamic.DynamicStateType
      End If
    Next objProperty
  Next objObject
  MsgBox strOutput
End Sub
```

**See also**

Property Object (Page 2042)

**DynamicStateType property****Description**

Only used internally.

**See also**

VBA Reference: ActionDynamic (Page 1747)

**E****EditAtOnce Property****Description**

TRUE, if accessing the field with the <TAB> key permits input immediately and without further action. BOOLEAN write-read access.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example it shall be possible to enter input on skipping into the I/O field:

```
Sub IOFieldConfiguration()  
'VBA484  
Dim objIOField As HMIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")  
With objIOField  
.EditAtOnce = True  
End With  
End Sub
```

**See also**

TextList Object (Page 2076)

IOField Object (Page 1992)

## ElseCase Property

### Description

Defines or returns the value for the dynamic property outside of the configured value range.

### Example:

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned and three analog value ranges will be created:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA485  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
'NewDynamic1')  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.Add 50, 40  
.AnalogResultInfos.Add 100, 80  
.AnalogResultInfos.ElseCase = 100  
End With  
End Sub
```

### See also

[AnalogResultInfos Object \(Listing\) \(Page 1908\)](#)

[AnalogResultInfo Object \(Page 1907\)](#)

[Add Method \(AnalogResultInfos Listing\) \(Page 1787\)](#)

## Enabled Property

### Description

TRUE if the menu, the menu entry or the icon is activated and can be selected. Applies only to user-defined menus and toolbars. BOOLEAN write-read access.

**Example:**

The "CreateMenuItem()" procedure creates the "Delete Objects" menu and adds two menu entries ("Delete Rectangles" and "Delete Circles"): In this example the second menu point in user-defined menu "Delete Objects" is grayed out and cannot be selected in the Graphics Designer:

```
Sub DisableMenuItem()  
'VBA486  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
'  
'Add a new menu "Delete objects"  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DeleteObjects", "Delete objects")  
'  
'Add two menuitems to the new menu  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "DeleteAllRectangles", "Delete  
rectangles")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(2, "DeleteAllCircles", "Delete circles")  
'  
'Disable menuitem "Delete circles"  
With ActiveDocument.CustomMenus("DeleteObjects").MenuItems("DeleteAllCircles")  
.Enabled = False  
End With  
End Sub
```

**See also**

[ToolbarItem Object \(Page 2083\)](#)  
[MenuItem Object \(Page 2013\)](#)  
[Menu Object \(Page 2009\)](#)  
[Configuring Menus and Toolbars \(Page 1626\)](#)

**EnableFlashing property****Description**

Specifies whether the value for status "OK" and "Simulation" appears flashing or not in the advanced analog display in Runtime.

For the flashing to be visible in Runtime, the font flashing color must be different to the background flashing color.

## EndAngle Property

### Description

Defines or returns the end of the object for the CircularArc, EllipseArc, EllipseSegment and PieSegment objects. The information is in counterclockwise direction in degrees, beginning at the 12:00 clock position.

### Example:

The "PieSegmentConfiguration()" procedure accesses the properties of the Pie Segment. In this example the pie segment begins at 40° and ends at 180°:

```
Sub PieSegmentConfiguration()  
'VBA487  
Dim objPieSegment As HMIPieSegment  
Set objPieSegment = ActiveDocument.HMIObjects.AddHMIObject("PieSegment1", "HMIPieSegment")  
With objPieSegment  
.StartAngle = 40  
.EndAngle = 180  
End With  
End Sub
```

### See also

[StartAngle Property \(Page 2426\)](#)  
[PieSegment Object \(Page 2032\)](#)  
[EllipseSegment Object \(Page 1963\)](#)  
[EllipseArc Object \(Page 1960\)](#)  
[CircularArc Object \(Page 1931\)](#)

## EventQuitMask property

### Description

The events "Operator request" and "Measuring point blocked" are not acknowledgeable events in the PCS 7 environment. Using the "@EventQuit" tag and the "EventQuitMask" property in Runtime, these events are automatically indicated as acknowledged to prevent flashing during the calculation of the group displays. The start value of the attribute is then 0x00000011 (17). The value of the "EventQuitMask" property should be identical for all group display objects, advanced analog display and advanced status display, and for the "@EventQuit" tag.

By setting further acknowledgment bits, you can indicate other events as being acknowledged as well with the display of the group display object and the advanced analog and status display.

## Events Property

### Description

Returns the Events listing. Use the Events property to define the event that will trigger an action. Use the index number to define the event that is intended to be configured:

- You configure an action on a property with VBA by using the "Events(9)" property, where the index "1" stands for the event "Upon change":
- To configure an action onto an object with the aid of VBA, use the "Events(Index)" property, where "Index" stands for the trigger event (see table):

Index	EventType (depending upon the object used)
0	hmiEventTypeNotDefined
1	hmiEventTypeMouseClicked
2	hmiEventTypeMouseButtonDown
3	hmiEventTypeMouseButtonUp
4	hmiEventTypeMouseButtonDown
5	hmiEventTypeMouseButtonUp
6	hmiEventTypeKeyboardDown
7	hmiEventTypeKeyboardUp
8	hmiEventTypeFocusEnter
9	hmiEventTypeObjectChange
10	hmiEventTypeOpenPicture
11	hmiEventTypePictureOpen
12	hmiEventTypePictureClose
13	hmiEventTypeObjectDefined
14	hmiEventTypeFocusEnter
15	hmiEventTypeLastTriggerType
16	hmiEventTypeObjSpecificTriggerStart

**Example:**

In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:

```
Sub DirectConnection()  
'VBA488  
Dim objButton As HMIButton  
Dim objRectangleA As HMIRectangle  
Dim objRectangleB As HMIRectangle  
Dim objEvent As HMIEvent  
Dim objDirConnection As HMIDirectConnection  
Set objRectangleA = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A", "HMIRectangle")  
Set objRectangleB = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objRectangleA  
.Top = 100  
.Left = 100  
End With  
With objRectangleB  
.Top = 250  
.Left = 400  
.BackColor = RGB(255, 0, 0)  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 100  
.Text = "SetPosition"  
End With  
,  
'Directconnection is initiated by mouseclick:  
Set objDirConnection =  
objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectConnection)  
With objDirConnection  
'Sourceobject: Property "Top" of Rectangle_A  
.SourceLink.Type = hmiSourceTypeProperty  
.SourceLink.ObjectName = "Rectangle_A"  
.SourceLink.AutomationName = "Top"  
,  
'Targetobject: Property "Left" of Rectangle_B  
.DestinationLink.Type = hmiDestTypeProperty  
.DestinationLink.ObjectName = "Rectangle_B"  
.DestinationLink.AutomationName = "Left"  
End With  
End Sub
```

**See also**

[Events Object \(Listing\) \(Page 1967\)](#)

[Configuring Event-Driven Actions with VBA \(Page 1699\)](#)



## EventName property

### Description

Returns the name of the "Event" object.

### Example

In this example the event names and event types of all objects in the active pictures are put out. In order for this example to work, insert some objects into the active picture and configure different events.

```
Sub ShowEventsOfAllObjectsInActiveDocument()
'VBA252
Dim colEvents As HMIEvents
Dim objEvent As HMIEvent
Dim iMax As Integer
Dim iIndex As Integer
Dim iAnswer As Integer
Dim strEventName As String
Dim strObjectName As String
Dim varEventType As Variant
iIndex = 1
iMax = ActiveDocument.HMIObjects.Count
For iIndex = 1 To iMax
Set colEvents = ActiveDocument.HMIObjects(iIndex).Events
strObjectName = ActiveDocument.HMIObjects(iIndex).ObjectName
For Each objEvent In colEvents
strEventName = objEvent.EventName
varEventType = objEvent.EventType
iAnswer = MsgBox("Objectname: " & strObjectName & vbCrLf & "Eventtype: " & varEventType &
vbCrLf & "Eventname: " & strEventName, vbOKCancel)
If vbCancel = iAnswer Then Exit For
Next objEvent
If vbCancel = iAnswer Then Exit For
Next iIndex
End Sub
```

## EventType Property

### Description

Returns the event type that is configured on the specified object.

Index	EventType (depending upon the object used)
0	hmiEventTypeNotDefined
1	hmiEventTypeMouseClicked
2	hmiEventTypeMouseButtonDown
3	hmiEventTypeMouseButtonUp

Index	EventType (depending upon the object used)
4	hmiEventTypeMouseButtonDown
5	hmiEventTypeMouseButtonUp
6	hmiEventTypeKeyboardDown
7	hmiEventTypeKeyboardUp
8	hmiEventTypeFocusEnter
9	hmiEventTypeObjectChange
10	hmiEventTypeOpenPicture
11	hmiEventTypePictureOpen
12	hmiEventTypePictureClose
13	hmiEventTypeObjectDefined
14	hmiEventTypeFocusEnter
15	hmiEventTypeLastTriggerType
16	hmiEventTypeObjSpecificTriggerStart

**Example:**

Use the EventType property to edit a previously configured event. In the following example the event "Mouse Action" will be configured, but then changed to "Pressed":

```
Sub AddActionToObjectTypesCScript()
  'VBA489
  Dim objEvent As HMIEvent
  Dim objCScript As HMIScriptInfo
  Dim objCircle As HMICircle
  Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_AB", "HMICircle")
  '
  'C-action is initiated by click on object circle
  Set objEvent = objCircle.Events(1)
  Set objCScript = objEvent.Actions.AddAction(hmiActionCreationTypeCScript)
  MsgBox "the type of the projected event is " & objEvent.EventType
End Sub
```

**See also**

[Events Object \(Listing\) \(Page 1967\)](#)

[Configuring Event-Driven Actions with VBA \(Page 1699\)](#)

## Exponent Property

### Description

TRUE if numbers are to be displayed on the BarGraph object using exponents (e.g. "1.00e+000"). BOOLEAN write-read access.

### Example:

The "BarGraphConfiguration()" procedure configures In this example numbers are to be displayed on the bar using exponents:

```
Sub BarGraphConfiguration()  
'VBA490  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.Exponent = True  
End With  
End Sub
```

### See also

BarGraph Object (Page 1914)

## ExtendedOperation Property

### Description

TRUE if the slider on the Slider object is set to the associated end value (minimum value/ maximum value). This is done by clicking the mouse in an area outside the current regulator setting. BOOLEAN write-read access.

### Example:

The "SliderConfiguration()" procedure accesses the properties of the slider. In this example the ExtendedOperation property will be set to TRUE:

```
Sub SliderConfiguration()  
'VBA491  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("SliderObject1", "HMISlider")  
With objSlider  
.ExtendedOperation = True  
End With  
End Sub
```

## See also

Slider object (Page 2062)

## ExtendedZoomingEnable Property

### Description

TRUE, if the selected process picture in Runtime may be zoomed in or out using the mouse wheel. This happens by pushing the <CTRL> key while the mouse wheel is turned. If the mouse wheel is turned away from the palm of the hand, the zoom factor increases.

BOOLEAN write-read access.

Requirements for using the zoom function:

- Mouse driver by Logitech or Microsoft Intellimouse
- Mouse wheel must be set to "Autoscroll".
- In the computer properties, the "Graphics Runtime" tab control must have the "Extended zooming" function enabled for all process pictures.

### Example:

The procedure "DocConfiguration()" accesses picture properties.

In this example, the property ExtendedZoomingEnable is set to TRUE:

```
Sub DocConfiguration()  
  'VBA815  
  Dim objDoc As Document  
  Set objDoc = ActiveDocument  
  With objDoc  
    .ExtendedZoomingEnable = True  
  End With  
End Sub
```

## F

### FaceplateType property

#### Description

Sets the faceplate type of the faceplate instance and returns its name. The faceplate type is "Const" and can therefore only be set once.

## Usage

Use the Add method to create a new "faceplate instance" object in a picture. "Properties.Item(3)" is used to access the FaceplateType property:

```
Sub FaceplateInstance_and_Properties()  
'VBA847  
Dim objFaceplateInstance As HMIFaceplateObject  
  
Set objFaceplateInstance = ActiveDocument.HMIObjects.AddHMIObject("faceplate instance",  
"HMIFaceplateObject")  
objFaceplateInstance.Properties.Item(3).value = "Faceplatel.fpt"  
MsgBox "Faceplate "" & objFaceplateInstance.Properties.Item(3).value & "" is used."  
  
End Sub
```

## Family Property

## Description

Defines or returns the language-dependent font.

**Example:**

The following example sets the font attributes of a button for French and English:

```
Sub ExampleForLanguageFonts ()
'VBA492
Dim colLangFonts As HMILanguageFonts
Dim objButton As HMIButton
Dim iStartLangID As Integer
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")
iStartLangID = Application.CurrentDataLanguage
With objButton
.Text = "Command"
.Width = 100
End With
Set colLangFonts = objButton.LDFonts
'
'To do typesettings for french:
With colLangFonts.ItemByLCID(1036)
.Family = "Courier New"
.Bold = True
.Italic = False
.Underlined = True
.Size = 12
End With
'
'To do typesettings for english:
With colLangFonts.ItemByLCID(1033)
.Family = "Times New Roman"
.Bold = False
.Italic = True
.Underlined = False
.Size = 14
End With
With objButton
Application.CurrentDataLanguage = 1036
.Text = "Command"
MsgBox "Datalanguage is changed in french"
Application.CurrentDataLanguage = 1033
.Text = "Command"
MsgBox "Datalanguage is changed in english"
Application.CurrentDataLanguage = iStartLangID
MsgBox "Datalanguage is changed back to startlanguage."
End With
End Sub
```

**See also**

[Underlined Property \(Page 2460\)](#)

[Size Property \(Page 2419\)](#)

[Parent Property \(Page 2359\)](#)

Italic Property (Page 2282)  
LanguageID Property (Page 2289)  
Bold Property (Page 2151)  
Application Property (Page 2121)  
LanguageFont Object (Page 1996)

## FillBackColor property

### Description

Only used internally.

### See also

Document Object (Page 1949)

## FillColor Property

### Description

Defines or returns the fill pattern color for the object. LONG read-write access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the background color will be set to "Yellow".

```
Sub RectangleConfiguration()  
'VBA493  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
.FillColor = RGB(255, 255, 0)  
End With  
End Sub
```

## See also

Button Object (Page 1921)  
StaticText Object (Page 2067)  
Slider object (Page 2062)  
TextList Object (Page 2076)  
RoundRectangle Object (Page 2055)  
RoundButton Object (Page 2052)  
Rectangle Object (Page 2049)  
Polygon Object (Page 2035)  
PieSegment Object (Page 2032)  
OptionGroup Object (Page 2025)  
GroupDisplay Object (Page 1980)  
GraphicObject Object (Page 1975)  
IOField Object (Page 1992)  
EllipseSegment Object (Page 1963)  
Ellipse Object (Page 1957)  
Document Object (Page 1949)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
BarGraph Object (Page 1914)  
3DBarGraph Object (Page 1894)

## Filling Property

### Description

TRUE if an object with closed frame lines (such as a Circle or Rectangle) can be filled (as in the fill level of a tank, for example). BOOLEAN write-read access.

To set the fill level of the object, use the FillingIndex property.



**Example:**

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example a rectangle can be used to display the fill level:

```
Sub RectangleConfiguration()  
'VBA494  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
    .Filling = True  
End With  
End Sub
```

**See also**

- FillingIndex Property (Page 2233)
- StaticText Object (Page 2067)
- Slider object (Page 2062)
- RoundRectangle Object (Page 2055)
- RoundButton Object (Page 2052)
- Rectangle Object (Page 2049)
- Polygon Object (Page 2035)
- PieSegment Object (Page 2032)
- OptionGroup Object (Page 2025)
- GraphicObject Object (Page 1975)
- EllipseSegment Object (Page 1963)
- Ellipse Object (Page 1957)
- Circle Object (Page 1928)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)

**FillingIndex Property****Description**

Defines the percentage value (relative to the height of the object) to which to fill an object with closed frame lines (such as a Circle or Rectangle).

The fill level is represented by the current background color. The unfilled background is transparent.

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the rectangle will be filled to 50%:

```
Sub RectangleConfiguration()  
'VBA495  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
    .Filling = True  
    .FillingIndex = 50  
End With  
End Sub
```

### See also

- [PieSegment Object \(Page 2032\)](#)
- [FillColor Property \(Page 2231\)](#)
- [BackColor Property \(Page 2131\)](#)
- [StaticText Object \(Page 2067\)](#)
- [Slider object \(Page 2062\)](#)
- [RoundRectangle Object \(Page 2055\)](#)
- [RoundButton Object \(Page 2052\)](#)
- [Rectangle Object \(Page 2049\)](#)
- [Polygon Object \(Page 2035\)](#)
- [OptionGroup Object \(Page 2025\)](#)
- [GraphicObject Object \(Page 1975\)](#)
- [EllipseSegment Object \(Page 1963\)](#)
- [Ellipse Object \(Page 1957\)](#)
- [Circle Object \(Page 1928\)](#)
- [CheckBox Object \(Page 1924\)](#)
- [Button Object \(Page 1921\)](#)

### FillingDirection property

#### Description

- 0 = the object enclosed in a frame line is filled from bottom to top.
- 1 = the object enclosed in a frame line is filled from top to bottom.

2 = the object enclosed in a frame line is filled from left to right.  
 3 = the object enclosed in a frame line is filled from right to left.  
 Write/Read access.  
 Use the "FillingDirection" property to set the object fill direction.

**Example**



















The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example, the object is filled from left to right.































```
Sub RectangleConfiguration()
    'VBA906
    Dim objRectangle As HMIRectangle
    Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")
    With objRectangle
        .FillingDirection = 2
    End With
End Sub
```

**FillStyle Property**

**Description**

Defines or returns the fill style for the object.

Fill pattern	Value	Fill pattern	Value	Fill pattern	Value
< Transparent >	65536				
< Solid >	0				
	1048576		196611		196627
	1048577		196612		196628
	1048578		196613		196629
	1048579		196614		196630
	1048832		196615		196631
	1048833		196616		196632

Fill pattern	Value	Fill pattern	Value	Fill pattern	Value
	1048834		196617		196633
	1048835		196618		196634
	131072		196619		196635
	131073		196620		196636
	131074		196621		196637
	131075		196622		196638
	131076		196623		196639
	196608		196624		196640
	196609		196625		196641
	196610		196626		196642

**Example**

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the fill pattern will be set to the value "196642":

```

Sub RectangleConfiguration()
'VBA496
Dim objRectangle As HMIRectangle
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")
With objRectangle
.FillStyle = 196642
End With
End Sub

```

**See also**



















- TextList Object (Page 2076)
- StaticText Object (Page 2067)
- Slider object (Page 2062)































- RoundRectangle Object (Page 2055)
- RoundButton Object (Page 2052)
- Rectangle Object (Page 2049)
- Polygon Object (Page 2035)
- PieSegment Object (Page 2032)
- OptionGroup Object (Page 2025)
- IOField Object (Page 1992)
- GraphicObject Object (Page 1975)
- EllipseSegment Object (Page 1963)
- Ellipse Object (Page 1957)
- Document Object (Page 1949)
- Circle Object (Page 1928)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)
- BarGraph Object (Page 1914)

## FillStyle2 Property

### Description

Defines or returns the fill pattern of the bar for the BarGraph object.

Fill pattern	Value	Fill pattern	Value	Fill pattern	Value
< Transparent >	65536				
< Solid >	0				
	1048576		196611		196627
	1048577		196612		196628
	1048578		196613		196629
	1048579		196614		196630
	1048832		196615		196631
	1048833		196616		196632

Fill pattern	Value	Fill pattern	Value	Fill pattern	Value
	1048834		196617		196633
	1048835		196618		196634
	131072		196619		196635
	131073		196620		196636
	131074		196621		196637
	131075		196622		196638
	131076		196623		196639
	196608		196624		196640
	196609		196625		196641
	196610		196626		196642

**Example**

The "BarGraphConfiguration()" procedure configures In this example the bar pattern will be set to "196642":

```

Sub BarGraphConfiguration()
'VBA497
Dim objBarGraph As HMIBarGraph
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")
With objBarGraph
.FillStyle2 = 196642
End With
End Sub

```

**See also**

BarGraph Object (Page 1914)

## FillStyleAlignment property

### Description

Defines the alignment of the fill pattern for the process picture.

Normal	The fill pattern refers to the process picture. In runtime, no scaling is performed when opening the picture.
Stretched (window)	The fill pattern refers to the window in the Graphics Designer. In runtime, scaling is performed when opening the picture.

## FlashBackColor Property

### Description

TRUE, when flashing of the background is activated. BOOLEAN write-read access

---

#### Note

A change to the attribute does not automatically deactivate the "Windows Style" attribute.

---

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example, background flashing is activated:

```
Sub RectangleConfiguration()  
'VBA498  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
.FlashBackColor = True  
End With  
End Sub
```

### See also

RoundButton Object (Page 2052)  
StaticText Object (Page 2067)  
Slider object (Page 2062)  
TextList Object (Page 2076)  
RoundRectangle Object (Page 2055)

### 3.6 VBA Reference

Rectangle Object (Page 2049)  
Polygon Object (Page 2035)  
PieSegment Object (Page 2032)  
OptionGroup Object (Page 2025)  
GraphicObject Object (Page 1975)  
IOField Object (Page 1992)  
EllipseSegment Object (Page 1963)  
Ellipse Object (Page 1957)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)  
BarGraph Object (Page 1914)

## FlashBorderColor Property

### Description

TRUE, when flashing of the object lines is activated. BOOLEAN write-read access.

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example, flashing of the border is activated:

```
Sub RectangleConfiguration()  
'VBA499  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
    .FlashBorderColor = True  
End With  
End Sub
```

### See also

StaticText Object (Page 2067)  
StatusDisplay Object (Page 2070)  
Slider object (Page 2062)  
TextList Object (Page 2076)  
RoundRectangle Object (Page 2055)



RoundButton Object (Page 2052)  
Rectangle Object (Page 2049)  
PolyLine Object (Page 2038)  
Polygon Object (Page 2035)  
PieSegment Object (Page 2032)  
OptionGroup Object (Page 2025)  
Line Object (Page 2004)  
GraphicObject Object (Page 1975)  
IOField Object (Page 1992)  
EllipseSegment Object (Page 1963)  
EllipseArc Object (Page 1960)  
Ellipse Object (Page 1957)  
CircularArc Object (Page 1931)  
Circle Object (Page 1928)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)

## FlashFlashPicture Property

### Description

TRUE, when flashing of the flash picture is activated. BOOLEAN write-read access

### Example:

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example, flashing of the Flash Picture is activated:

```
Sub StatusDisplayConfiguration()  
'VBA500  
Dim objsDisplay As HMIStatusDisplay  
Set objsDisplay = ActiveDocument.HMIObjects.AddHMIObject("StatusDisplay1",  
"HMIStatusDisplay")  
With objsDisplay  
.FlashFlashPicture = True  
End With  
End Sub
```

## See also

StatusDisplay Object (Page 2070)

## FlashForeColor Property

### Description

TRUE, when flashing of the text is activated. BOOLEAN write-read access.

---

### Note

A change to the attribute does not automatically deactivate the "Windows Style" attribute.

---

### Example:

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example, text flashing is activated:

```
Sub ButtonConfiguration()  
  'VBA501  
  Dim objButton As HMIButton  
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
  With objButton  
    .FlashForeColor = True  
  End With  
End Sub
```

## See also

TextList Object (Page 2076)  
StaticText Object (Page 2067)  
OptionGroup Object (Page 2025)  
IOField Object (Page 1992)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)

## FlashPicReferenced Property

### Description

TRUE if the Flash Picture assigned in the Status Display object is to be saved. Otherwise, only the associated object reference is saved. BOOLEAN write-read access.

**Example:**

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example the picture assigned in the Status Display object is to be saved.

```
Sub StatusDisplayConfiguration()  
'VBA502  
Dim objStatusDisplay As HMIStatusDisplay  
Set objStatusDisplay = ActiveDocument.HMIObjects.AddHMIObject("StatusDisplay1",  
"HMIStatusDisplay")  
With objStatusDisplay  
.FlashPicReferenced = True  
End With  
End Sub
```

**See also**

StatusDisplay Object (Page 2070)

**FlashPicTransColor Property****Description**

Defines which color of the bitmap object (.bmp, .dib) assigned to the flash picture should be set to "transparent". LONG write-read access.

The color is only set to "Transparent" if the value of the "FlashPicUseTransColor" property is "True".

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example the color "Yellow" will be set to "Transparent".

```
Sub StatusDisplayConfiguration()  
'VBA503  
Dim objStatusDisplay As HMIStatusDisplay  
Set objStatusDisplay = ActiveDocument.HMIObjects.AddHMIObject("StatusDisplay1",  
"HMIStatusDisplay")  
With objStatusDisplay  
.FlashPicTransColor = RGB(255, 255, 0)  
.FlashPicUseTransColor = True  
End With  
End Sub
```

**See also**

[FlashPicUseTransColor Property \(Page 2246\)](#)

[StatusDisplay Object \(Page 2070\)](#)

**FlashPicture Property**

**Description**

Defines or returns the Flash Picture for the Status Display object.

The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

The "FlashPicReferenced" property defines in this case whether the flash picture will be saved with the Status Display object or referenced.

**Example:**

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example the picture "Testpicture.BMP" will be used as the flash picture:

```
Sub StatusDisplayConfiguration()  
'VBA504  
Dim objStatusDisplay As HMIStatusDisplay  
Set objStatusDisplay = ActiveDocument.HMIObjects.AddHMIObject("StatusDisplay1",  
"HMIStatusDisplay")  
With objStatusDisplay  
'  
'To use this example copy a Bitmap-Graphic  
'to the "GraCS"-Folder of the actual project.  
'Replace the picturename "Testpicture.BMP" with the name of  
'the picture you copied  
.FlashPicture = "Testpicture.BMP"  
End With  
End Sub
```

**See also**

[FlashPicReferenced Property \(Page 2242\)](#)

[StatusDisplay Object \(Page 2070\)](#)

**FlashPicture property****Description**

Specifies which flashing picture is to be displayed for the currently selected status. Pictures with the following formats can be inserted: EMF, WMF, BMP, GIF, JPG.

The flash picture should have the same picture size as the basic picture, otherwise its display is distorted.

**FlashPictureState property****Description**

Only used internally.

**See also**

[AdvancedStateDisplay object \(Page 1905\)](#)

## FlashPicUseTransparentColor Property

### Description

TRUE, when the configured color ("FlashPicTransparentColor" property) of the bitmap objects assigned to the flash picture should be set to "transparent". BOOLEAN write-read access.

### Example:

The "StatusDisplayConfiguration()" procedure accesses the properties of the Status Display. In this example the color "Yellow" will be set to "Transparent":

```

Sub StatusDisplayConfiguration()
'VBA505
Dim objStatusDisplay As HMISStatusDisplay
Set objStatusDisplay = ActiveDocument.HMIObjects.AddHMIObject("StatusDisplay1",
"HMISStatusDisplay")
With objStatusDisplay
.FlashPicTransparentColor = RGB(255, 255, 0)
.FlashPicUseTransparentColor = True
End With
End Sub

```

### See also

[FlashPicTransparentColor Property \(Page 2243\)](#)

[StatusDisplay Object \(Page 2070\)](#)

## FlashRate Property

### Description

Defines or returns the flash frequency of the "GroupDisplay", "AdvancedAnalogDisplay" and "AdvancedStateDisplay" objects. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

---

**Note**

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

---

**Example**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the flash frequency will be set to "Medium":

```
Sub GroupDisplayConfiguration()
  'VBA506
  Dim objGroupDisplay As HMIGroupDisplay
  Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",
  "HMIGroupDisplay")
  With objGroupDisplay
    .FlashRate = 1
  End With
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**FlashRateBackColor Property****Description**

Defines or returns the flash frequency for the object background. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

**Note**

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

---

## Example

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the flash frequency for the background will be set to "Medium":

```
Sub ButtonConfiguration()  
'VBA507  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
    .FlashRateBackColor = 1  
End With  
End Sub
```

## See also

- [StaticText Object \(Page 2067\)](#)
- [Slider object \(Page 2062\)](#)
- [TextList Object \(Page 2076\)](#)
- [RoundRectangle Object \(Page 2055\)](#)
- [RoundButton Object \(Page 2052\)](#)
- [Rectangle Object \(Page 2049\)](#)
- [Polygon Object \(Page 2035\)](#)
- [PieSegment Object \(Page 2032\)](#)
- [OptionGroup Object \(Page 2025\)](#)
- [GraphicObject Object \(Page 1975\)](#)
- [IOField Object \(Page 1992\)](#)
- [EllipseSegment Object \(Page 1963\)](#)
- [Ellipse Object \(Page 1957\)](#)
- [Circle Object \(Page 1928\)](#)
- [CheckBox Object \(Page 1924\)](#)
- [Button Object \(Page 1921\)](#)
- [BarGraph Object \(Page 1914\)](#)



## FlashRateBorderColor Property

### Description

Defines or returns the flash frequency for the lines of the object. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

### Note

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

### Example

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the flash frequency for the border will be set to "Medium":

```
Sub ButtonConfiguration()
  'VBA508
  Dim objButton As HMIButton
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")
  With objButton
    .FlashRateBorderColor = 1
  End With
End Sub
```

### See also

- Slider object (Page 2062)
- StatusDisplay Object (Page 2070)
- StaticText Object (Page 2067)
- TextList Object (Page 2076)
- RoundRectangle Object (Page 2055)
- RoundButton Object (Page 2052)
- Rectangle Object (Page 2049)
- PolyLine Object (Page 2038)
- Polygon Object (Page 2035)

- PieSegment Object (Page 2032)
- OptionGroup Object (Page 2025)
- Line Object (Page 2004)
- GraphicObject Object (Page 1975)
- IOField Object (Page 1992)
- EllipseSegment Object (Page 1963)
- EllipseArc Object (Page 1960)
- Ellipse Object (Page 1957)
- CircularArc Object (Page 1931)
- Circle Object (Page 1928)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)

## FlashRateFlashPic Property

### Description

Defines or returns the flash frequency for the status display. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.25 Hz)	0
Medium (approx. 0.5 Hz)	1
Fast (approx. 1 Hz)	2

---

### Note

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

---

## Example

The "GroupDisplayConfiguration()" procedure accesses the properties of the status display. In this example the flash frequency for the flash picture will be set to "Medium":

```
Sub StatusDisplayConfiguration()
'VBA509
Dim objStatusDisplay As HMIStatusDisplay
Set objStatusDisplay = ActiveDocument.HMIObjects.AddHMIObject("StatusDisplay1",
"HMIStatusDisplay")
With objStatusDisplay
.FlashRateFlashPic = 1
End With
End Sub
```

## See also

StatusDisplay Object (Page 2070)

## FlashRateForeColor Property

### Description

Defines or returns the flash frequency for the object label. Value range from 0 to 2.

Flash frequency	Assigned Value
Slow (approx. 0.5 Hz)	0
Medium (approx. 2 Hz)	1
Fast (approx. 8 Hz)	2

### Note

Because the flashing is performed by means of software engineering, the flash frequency is both system-dependent and hardware-bound (number of objects, processor speed, RAM size, update time, etc.).

The information in the table is therefore only for orientation purposes.

## Example

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the flash frequency for the label will be set to "Medium":

```
Sub ButtonConfiguration()  
'VBA510  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
    .FlashRateForeColor = 1  
End With  
End Sub
```

## See also

- [TextList Object \(Page 2076\)](#)
- [StaticText Object \(Page 2067\)](#)
- [OptionGroup Object \(Page 2025\)](#)
- [IOField Object \(Page 1992\)](#)
- [CheckBox Object \(Page 1924\)](#)
- [Button Object \(Page 1921\)](#)

## FlashState property

### Description

Only used internally.

### See also

- [AdvancedAnalogDisplay object \(Page 1901\)](#)

## Folder Property

### Description

Returns a folder from the components library.

**Example:**

The "ShowFolderItems()" procedure accesses the symbol libraries. In this example all the folder names in the global symbol library and project symbol library will be output:

```

Sub ShowFolderItems()
'VBA511
Dim colFolderItems As HMIFolderItems
Dim objFolderItem As HMIFolderItem
Dim iAnswer As Integer
Dim iMaxFolder As Integer
Dim iMaxSymbolLib As Integer
Dim iSymbolLibIndex As Integer
Dim iSubFolderIndex As Integer
Dim strSubFolderName As String
Dim strFolderItemName As String
'To determine the number of symbollibraries:
iMaxSymbolLib = Application.SymbolLibraries.Count
iSymbolLibIndex = 1
For iSymbolLibIndex = 1 To iMaxSymbolLib
With Application.SymbolLibraries(iSymbolLibIndex)
Set colFolderItems = .FolderItems
'
'To determine the number of folders in actual symbollibrary:
iMaxFolder = .FolderItems.Count
MsgBox "Number of FolderItems in " & .Name & " : " & iMaxFolder
'
'Output of all subfolder names from actual folder:
For Each objFolderItem In colFolderItems
iSubFolderIndex = 1
For iSubFolderIndex = 1 To iMaxFolder
strFolderItemName = objFolderItem.DisplayName
If 0 <> objFolderItem.Folder.Count Then
strSubFolderName = objFolderItem.Folder(iSubFolderIndex).DisplayName
iAnswer = MsgBox("SymbolLibrary: " & .Name & vbCrLf & "act. Folder: " &
strFolderItemName & vbCrLf & "act. Subfolder: " & strSubFolderName, vbOKCancel)
'
'If "Cancel" is clicked, continued with next FolderItem
If vbCancel = iAnswer Then
Exit For
End If
Else
MsgBox "There are no subfolders in " & objFolderItem.DisplayName
Exit For
End If
Next iSubFolderIndex
Next objFolderItem
End With
Next iSymbolLibIndex
End Sub

```

## See also

SymbolLibraries Object (Listing) (Page 2073)

SymbolLibrary Object (Page 2074)

FolderItems Object (Listing) (Page 1973)

FolderItem Object (Page 1972)

Accessing the component library with VBA (Page 1646)

## FolderItems Property

### Description

Returns a listing containing all the folders in the symbol library.

**Example:**

The "ShowFolderItems()" procedure accesses the symbol libraries. In this example all the folder names in the global symbol library and project symbol library will be output:

```

Sub ShowFolderItems()
'VBA512
Dim colFolderItems As HMIFolderItems
Dim objFolderItem As HMIFolderItem
Dim iAnswer As Integer
Dim iMaxFolder As Integer
Dim iMaxSymbolLib As Integer
Dim iSymbolLibIndex As Integer
Dim iSubFolderIndex As Integer
Dim strSubFolderName As String
Dim strFolderItemName As String
'To determine the number of symbollibraries:
iMaxSymbolLib = Application.SymbolLibraries.Count
iSymbolLibIndex = 1
For iSymbolLibIndex = 1 To iMaxSymbolLib
With Application.SymbolLibraries(iSymbolLibIndex)
Set colFolderItems = .FolderItems
'
'To determine the number of folders in actual symbollibrary:
iMaxFolder = .FolderItems.Count
MsgBox "Number of FolderItems in " & .Name & " : " & iMaxFolder
'
'Output of all subfolder names from actual folder:
For Each objFolderItem In colFolderItems
    iSubFolderIndex = 1
    For iSubFolderIndex = 1 To iMaxFolder
        strFolderItemName = objFolderItem.DisplayName
        If 0 <> objFolderItem.Folder.Count Then
            strSubFolderName = objFolderItem.Folder(iSubFolderIndex).DisplayName
            iAnswer = MsgBox("SymbolLibrary: " & .Name & vbCrLf & "act. Folder: " &
strFolderItemName & vbCrLf & "act. Subfolder: " & strSubFolderName, vbOKCancel)
            '
            'If "Cancel" is clicked, continued with next FolderItem
            If vbCancel = iAnswer Then
                Exit For
            End If
        End If
    Else
        MsgBox "There are no subfolders in " & objFolderItem.DisplayName
        Exit For
    End If
    Next iSubFolderIndex
Next objFolderItem
End With
Next iSymbolLibIndex
End Sub

```

## See also

- FolderItem Object (Page 1972)
- SymbolLibraries Object (Listing) (Page 2073)
- SymbolLibrary Object (Page 2074)
- FolderItems Object (Listing) (Page 1973)
- Accessing the component library with VBA (Page 1646)

## FontBold Property

### Description

TRUE, when the text in the object should be assigned the "bold" attribute. BOOLEAN write-read access.

### Example:

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the font attribute will be set to "Bold":

```
Sub ButtonConfiguration()  
  'VBA513  
  Dim objButton As HMIButton  
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
  With objButton  
    .FontBold = True  
  End With  
End Sub
```

## See also

- TextList Object (Page 2076)
- StaticText Object (Page 2067)
- OptionGroup Object (Page 2025)
- IOField Object (Page 1992)
- GroupDisplay Object (Page 1980)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)
- BarGraph Object (Page 1914)



## FontItalic Property

### Description

TRUE, when the text in the object should be assigned the "italic" attribute. BOOLEAN write-read access.

### Example:

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the font attribute will be set to "Italic":

```
Sub ButtonConfiguration()  
  'VBA514  
  Dim objButton As HMIButton  
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
  With objButton  
    .FontItalic = True  
  End With  
End Sub
```

### See also

- StaticText Object (Page 2067)
- TextList Object (Page 2076)
- OptionGroup Object (Page 2025)
- IOField Object (Page 1992)
- GroupDisplay Object (Page 1980)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)
- BarGraph Object (Page 1914)

## FontName Property

### Description

Defines or returns the font name of the text in the object.  
All the fonts installed in Windows are available for selection.

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the font is set to Arial:

```
Sub ButtonConfiguration()  
'VBA515  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
.FontName = "Arial"  
End With  
End Sub
```

**See also**

- CheckBox Object (Page 1924)
- TextList Object (Page 2076)
- StaticText Object (Page 2067)
- OptionGroup Object (Page 2025)
- IOField Object (Page 1992)
- GroupDisplay Object (Page 1980)
- Button Object (Page 1921)
- BarGraph Object (Page 1914)

**FontSize Property**

**Description**

Defines or returns the font size of the text in the object in points.

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the font size will be set to 10 points:

```
Sub ButtonConfiguration()  
'VBA516  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
.FONTSIZE = 10  
End With  
End Sub
```

## See also

TextList Object (Page 2076)  
StaticText Object (Page 2067)  
OptionGroup Object (Page 2025)  
IOField Object (Page 1992)  
GroupDisplay Object (Page 1980)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)  
BarGraph Object (Page 1914)

## FontUnderline Property

### Description

TRUE, when the text in the object should be assigned the "underline" attribute. BOOLEAN write-read access.

### Example:

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the font attribute will be set to "Underline":

```
Sub ButtonConfiguration()  
'VBA517  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
    .FontUnderline = True  
End With  
End Sub
```

## See also

TextList Object (Page 2076)  
StaticText Object (Page 2067)  
OptionGroup Object (Page 2025)  
IOField Object (Page 1992)  
GroupDisplay Object (Page 1980)

CheckBox Object (Page 1924)

Button Object (Page 1921)

BarGraph Object (Page 1914)

## ForeColor Property

### Description

Defines or returns the color of the font for the text in the object. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the font color will be set to "Red":

```
Sub ButtonConfiguration()  
  'VBA518  
  Dim objButton As HMIButton  
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
  With objButton  
    .ForeColor = RGB(255, 0, 0)  
  End With  
End Sub
```

### See also

Button Object (Page 1921)

TextList Object (Page 2076)

StaticText Object (Page 2067)

OptionGroup Object (Page 2025)

IOField Object (Page 1992)

GroupDisplay Object (Page 1980)

CheckBox Object (Page 1924)

BarGraph Object (Page 1914)

## ForeColor\_Alarm..\_Warning property

### Description

Defines the color used for the foreground of one of the following states or message types:

- Alarm
- Warning
- Tolerance
- AS Process Control Error
- AS Control System Fault
- Operator request
- OK
- Simulation

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

## ForeFlashColorOff Property

### Description

Defines or returns the color of the text for flash status "Off". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the font color when the flash status is "Off" will be set to "Red":

```
Sub ButtonConfiguration()  
'VBA519  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
.ForeColorOff = RGB(255, 0, 0)  
End With  
End Sub
```

### See also

- CheckBox Object (Page 1924)
- TextList Object (Page 2076)
- StaticText Object (Page 2067)
- OptionGroup Object (Page 2025)
- IOField Object (Page 1992)
- GroupDisplay Object (Page 1980)
- Button Object (Page 1921)
- BarGraph Object (Page 1914)

### ForeColorOff Property

#### Description

Defines or returns the color of the text for flash status "On". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the font color when the flash status is "On" will be set to "White":

```
Sub ButtonConfiguration()
'VBA520
Dim objButton As HMIButton
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")
With objButton
.ForeFlashColorOn = RGB(255, 255, 255)
End With
End Sub
```

**See also**

TextList Object (Page 2076)  
StaticText Object (Page 2067)  
OptionGroup Object (Page 2025)  
IOField Object (Page 1992)  
GroupDisplay Object (Page 1980)  
CheckBox Object (Page 1924)  
Button Object (Page 1921)  
BarGraph Object (Page 1914)

**Format property****Description**

Specifies the format in which the value is displayed in the advanced analog display.

No Character	Displays the number without formatting.
( 0 )	Displays a digit or a zero.
( # )	Displays a digit or no output.
( . )	Placeholder for decimal character.
( % )	Placeholder for percentage.
( , )	Thousand separator.
( ( E- E+ e- e+ )	Scientific format.
- + \$ ( )	Display of a literal character.
( \ )	Display the next character in the format character sequence.
( "ABC" )	Displays the string in inverted commas ( " ").

## G-H

### GlobalColorScheme property

#### Description

Defines whether the colors defined for the current design in the global color scheme will be used for this object.

yes	Uses the colors from the global color scheme defined for this type of object.
No	Uses the colors from the color scheme defined for this type of object under "Colors".

#### Example

--

### GlobalShadow property

#### Description

Defines whether the object will be displayed with the shadowing defined in the active design.

yes	Uses the global shadowing defined for this object type.
No	No shadowing.

#### Example

--

### GNQBackColorOff..ColorOn property

#### Description

Specifies for the selected message type and the state "Went Out Unacknowledged" which color the background of the value to be displayed assumes for flashing status "Off" (GNQBackColorOff) or "On" (GNQBackColorOn).

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0).



## GNQBackFlash property

### Description

Specifies for the selected message type and status "Went Out Unacknowledged" whether the background of the value to be displayed flashes when a message goes out unacknowledged.

## GNQTextColorOff..ColorOn property

### Description

Specifies for the selected message type and the state "Went Out Unacknowledged" which color the text of the value to be displayed assumes for flashing status "Off" (GNQTextColorOff) or "On" (GNQTextColorOn).

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0).

## GNQTextFlash property

### Description

Specifies for the selected message type and status "Went Out Unacknowledged" whether the text of the value to be displayed flashes when a message goes out unacknowledged.

## Grid Property

### Description

TRUE if the grid is enabled for the active picture. BOOLEAN write-read access.

The grid is only visible during the configuration phase.

### Example:

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example the grid for the active picture will be enabled:

```
Sub ActiveDocumentConfiguration()  
  'VBA521  
  Application.ActiveDocument.Grid = True  
End Sub
```

## See also

GridWidth Property (Page 2267)  
GridHeight Property (Page 2267)  
GridColor Property (Page 2266)  
ActiveDocument Property (Page 2107)  
Application Property (Page 2121)  
Document Object (Page 1949)  
Application Object (Page 1909)

## GridColor Property

### Description

Defines or returns the color of the grid during the configuration phase. The Grid property must be set to TRUE for the grid to be displayed. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example the grid color for the active picture will be set to "Blue":

```
Sub ActiveDocumentConfiguration()  
    'VBA522  
    Application.ActiveDocument.Grid = True  
    Application.ActiveDocument.GridColor = RGB(0, 0, 255)  
End Sub
```

## See also

Grid Property (Page 2265)  
ActiveDocument Property (Page 2107)  
Application Property (Page 2121)

Document Object (Page 1949)

Application Object (Page 1909)

## GridHeight Property

### Description

Defines or returns the height (in pixels) of the grid in the current picture during the configuration phase. The Grid property must be set to TRUE for the grid to be displayed.

### Example:

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example the grid height for the active picture will be set to "8":

```
Sub ActiveDocumentConfiguration()  
'VBA523  
Application.ActiveDocument.Grid = True  
Application.ActiveDocument.GridHeight = 8  
End Sub
```

### See also

GridWidth Property (Page 2267)

Grid Property (Page 2265)

ActiveDocument Property (Page 2107)

Application Property (Page 2121)

Document Object (Page 1949)

Application Object (Page 1909)

## GridWidth Property

### Description

Defines or returns the width (in pixels) of the grid in the current picture during the configuration phase. The Grid property must be set to TRUE for the grid to be displayed.

**Example:**

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example the grid width for the active picture will be set to "8":

```
Sub ActiveDocumentConfiguration()  
'VBA524  
Application.ActiveDocument.Grid = True  
Application.ActiveDocument.GridWidth = 8  
End Sub
```

**See also**

- Grid Property (Page 2265)
- GridHeight Property (Page 2267)
- ActiveDocument Property (Page 2107)
- Application Property (Page 2121)
- Document Object (Page 1949)
- Application Object (Page 1909)

**GroupParent Property**

**Description**

Returns the higher-ranking object in the specified group object. Read-only access.

**Example:**

--

**See also**

- Group Object (Page 1978)
- ActiveDocument Property (Page 2107)
- GroupedObjects Object (Listing) (Page 1983)
- Document Object (Page 1949)
- Application Object (Page 1909)

## GroupedHMIObjects Property

### Description

Returns a listing containing all the objects in the current group.

### Example:

In this example the group object "Group1" is created from a number of objects. An ellipse segment is then added to the group object:

```
Sub CreateGroup()  
'VBA526  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objEllipseSegment As HMIEllipseSegment  
Dim objGroup As HMIGroup  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
Set objGroup = ActiveDocument.Selection.CreateGroup  
objGroup.ObjectName = "Group1"  
Set objEllipseSegment = ActiveDocument.HMIObjects.AddHMIObject("EllipseSegment",  
"HMIEllipseSegment")  
'  
'Add one object to the existing group  
objGroup.GroupedHMIObjects.Add ("EllipseSegment")  
End Sub
```

### See also

Group Object (Page 1978)

## Height Property

### Description

Defines or returns the height of the object (Document, View, Object) in pixels.

**Note concerning the Document and View objects:**

The default value corresponds to the vertical screen resolution set by the operating system. The specified value can be higher than the current screen resolution. The picture can then be moved with the aid of scroll bars.

The maximum picture height that can be set is 10000 pixels.

**Example:**

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example the height of the current picture will be set to "1600":

```
Sub ActiveDocumentConfiguration()  
  'VBA527  
  Application.ActiveDocument.Height = 1600  
End Sub
```

**See also**

- View Object (Page 2102)
- HMIObject Object (Page 1988)
- Document Object (Page 1949)

**Hide Property**

**Description**

TRUE if the specified picture is opened as "Visible". BOOLEAN write-read access.

Use the Hide property in order to test, for example, whether a picture is to be visible or invisible when opened. Other WinCC editors (such as CrossReference) open pictures so that they are invisible, i.e. they are not displayed in the Graphics Designer. If you use the DocumentOpened event, for example, you can use the Hide property to prevent the code in the event from being executed by testing that the Hide property is FALSE.

Use the Add and Open methods to define whether a picture is to be visible or invisible when opened.

---

**Note**

If you set a picture to "Invisible" (Hide = FALSE), you can then only address it via the Documents listing. The picture is no longer available in the Graphics Designer.

---

**Example:**

In the following example, when a picture opens an output indicates whether the picture was opened as visible or invisible:

```
Private Sub Document_Opened(CancelForwarding As Boolean)
'VBA802
MsgBox Me.Hide
End Sub
```

**See also**

Open Method (Page 1867)  
Add Method (Documents Listing) (Page 1790)  
Document Object (Page 1949)

**HiddenInput Property****Description**

TRUE, when the input value should not be displayed when being entered. Each character entered is substituted by a \*. BOOLEAN write-read access.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the input will be hidden:

```
Sub IOFieldConfiguration()
'VBA528
Dim objIOField As HMIIIOField
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIIOField")
With objIOField
.HiddenInput = True
End With
End Sub
```

**See also**

IOField Object (Page 1992)

## HMIObjects Property

### Description

Returns a listing containing all the objects in the specified picture.

To return an element from the HMIObjects listing you can use either the index number or the object name.

### Example:

Use the "AddHMIObject(ObjectName, ProgID)" method to insert a new object in a picture: :

```
Sub AddCircle()  
'VBA529  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("my Circle", "HMICircle")  
End Sub
```

### See also

Document Object (Page 1949)

## HMIUdoObjects property

### Description

Supplies a collection of HMIObject objects that represent the inner objects of the "CustomizedObjects" object.

### See also

CustomizedObject Object (Page 1938)

## Hotkey Property

### Description

Defines or returns the function key for a mouse action in the case of the Button object.

Function key	Assigned Value
F1	112
F2	113
F3	114



Function key	Assigned Value
F4	115
F5	116
F6	117
F7	118
F8	119
F9	120
F10	121
F11	122
F12	123

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example it is intended that the button can also be launched with function key "F5":

```
Sub ButtonConfiguration()
'VBA530
Dim objButton As HMIButton
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")
With objButton
.Hotkey = 116
End With
End Sub
```

**See also**

Button Object (Page 1921)

**Hysteresis Property****Description**

TRUE if the display must include hysteresis (deadband) in the case of the BarGraph object. BOOLEAN write-read access.

**Example:**

The "BarGraphConfiguration()" procedure configures In this example the display shall take place with hysteresis:

```
Sub BarGraphConfiguration()  
'VBA531  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.Hysteresis = True  
End With  
End Sub
```

**See also**

[BarGraph Object \(Page 1914\)](#)

**HysteresisRange Property**

**Description**

Defines or returns the hysteresis (deadband) as a percentage of the display value.  
The Hysteresis property must be set to TRUE for the hysteresis to be calculated.

**Example:**

The "BarGraphConfiguration()" procedure configures In this example the hysteresis will be set to "4%":

```
Sub BarGraphConfiguration()  
'VBA532  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.Hysteresis = True  
.HysteresisRange = 4  
End With  
End Sub
```

**See also**

[BarGraph Object \(Page 1914\)](#)

[Hysteresis Property \(Page 2273\)](#)

## I - K

## Icon Property

## Description

Defines the icon (\*.ICO, full path and file name) or returns the path and file name for a button on a user-defined toolbar.

**Path specifications**

The following path specification formats are possible:

- Absolute: z.B. "C:\Siemens\WinCC\Icons\myIcon.ICO."
- Relative: The starting folder for relative path specification is the "GraCS" folder of the current project.
- <global>: Refers to the installation path for WinCC. The path specification "<global>\Icons\myIcon" is the same as the path specification under "Absolute".
- <project>: Refers to the current project directory (see example).

**Example:**

The "CreateToolbar()" procedure creates a user-defined toolbar with two icons:

```
Sub CreateToolbar()
'VBA533
Dim objToolbar As HMIToolbar
Dim objToolbarItem As HMIToolbarItem
Dim strFileWithPath
Set objToolbar = ActiveDocument.CustomToolbars.Add("Tool1_1")
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(1, "til_1",
"myFirstToolbaritem")
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(2, "til_2",
"mySecondToolbaritem")
'
'To use this example copy a *.ICO-Graphic
'to the "GraCS"-Folder of the actual project.
'Replace the filename "EZSTART.ICO" in the next commandline
'with the name of the ICO-Graphic you copied
strFileWithPath = Application.ApplicationDataPath & "EZSTART.ICO"
'
'To assign the symbol-icon to the first toolbaritem
objToolbar.ToolbarItems(1).Icon = strFileWithPath
End Sub
```

## See also

ToolBarItems Object (Listing) (Page 2085)

ToolBarItem Object (Page 2083)

How to Add a New Icon to the Toolbar (Page 1637)

How to Create an Application-specific Toolbar (Page 1635)

## IndependentWindow property

### Description

Defines whether the display of the picture window in Runtime depends on the process picture in which the picture window was configured.

yes	Size and position of the picture window are independent of the process picture and only defined by the "Window mode" attribute
No	Size and position of the picture window change with the shift or scaling of the process picture

## Index Property

### Description

#### Status display

Defines the status (0 bis 255) or returns it. A basic picture and flash picture can be defined for each status value.

#### Line Object

Defines the start and end point for a line, and so also defines the direction. Use the ActualPointLeft and ActualPointTop properties to define the coordinates for each starting and finishing point.

#### Polygon object, PolyLine object and TubePolyline object

Defines or returns the number of the corner point whose position coordinates you want to change or display.

#### CheckBox and OptionGroup objects

Defines or returns the number (1 to 32) of the field whose text is to be defined.

#### ComboBox and ListBox object

Defines or returns the number (1 to 32) of the line whose text is to be defined.

**Example 1: Line**

In the following example a line will be inserted into the active picture and the starting and finishing points will be defined:

```
Sub LineAdd()
'VBA682
Dim objLine As HMILine
Dim objEvent As HMIEvent
Set objLine = ActiveDocument.HMIObjects.AddHMIObject("myLine", "HMILine")
With objLine
.BorderColor = RGB(255, 0, 0)
.index = hmiLineIndexTypeStartPoint
.ActualPointLeft = 12
.ActualPointTop = 34
.index = hmiLineIndexTypeEndPoint
.ActualPointLeft = 74
.ActualPointTop = 64
End With
End Sub
```

**Example 2: Polyline**

For this example to work, insert a polyline called "Polyline1" into the active picture: The "PolyLineCoordsOutput" procedure then outputs the coordinates of all the corner points in the polyline:

```
Sub PolyLineCoordsOutput()
'VBA534
Dim iPcIndex As Integer
Dim iPosX As Integer
Dim iPosY As Integer
Dim iIndex As Integer
Dim objPolyLine As HMIPolyLine
Set objPolyLine = Application.ActiveDocument.HMIObjects.AddHMIObject("PolyLine1",
"HMIPolyLine")
'
'Determine number of corners from "PolyLine1":
iPcIndex = objPolyLine.PointCount
'
'Output of x/y-coordinates from every corner:
For iIndex = 1 To iPcIndex
With objPolyLine
.index = iIndex
iPosX = .ActualPointLeft
iPosY = .ActualPointTop
MsgBox iIndex & ". corner:" & vbCrLf & "x-coordinate: " & iPosX & vbCrLf & "y-coordinate:
" & iPosY
End With
Next iIndex
End Sub
```

### Example 3: Check box

The "CreateOptionGroup()" procedure creates the OptionGroup object with four option buttons. Each option button is assigned the default name "myCustomText<Number>":

```
Sub CreateOptionGroup()  
'VBA535  
Dim objRadioBox As HMIOptionGroup  
Dim iIndex As Integer  
Set objRadioBox = ActiveDocument.HMIObjects.AddHMIObject("RadioBox_1", "HMIOptionGroup")  
With objRadioBox  
    .Height = 100  
    .Width = 180  
    .BoxCount = 4  
    For iIndex = 1 To .BoxCount  
        .index = iIndex  
        .Text = "myCustomText" & .index  
    Next iIndex  
End With  
End Sub
```

### See also

- Line Object (Page 2004)
- FlashPicture Property (Page 2244)
- BasePicture Property (Page 2144)
- ActualPointTop Property (Page 2110)
- ActualPointLeft Property (Page 2109)
- StatusDisplay Object (Page 2070)
- PolyLine Object (Page 2038)
- Polygon Object (Page 2035)
- OptionGroup Object (Page 2025)

### InheritState property

#### Description

Defines whether the "Display" and "Operator Control Enable" properties of the user object can be inherited by the individual objects of the user object.

## InputValue property

### Description

Defines the value to be entered by the user in the I/O field. The value is not displayed in the I/O field when the property is set.

If you want the value to be displayed in the I/O field after confirmation with the <Return> key, configure a direct connection between the properties "input value" and "output value". The direct connection is only practical when no tag is connected to the output value, but the user can nevertheless query the specified value, for example, through a script.

### Example:

## IsActive Property

### Description

Returns TRUE if a copy of the current picture is active. BOOLEAN read access.

### Example:

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example a copy of the current picture will be created and an output will indicate whether the copy is active.

```
Sub ActiveDocumentConfiguration()  
'VBA537  
Application.ActiveDocument.Views.Add  
'If you comment out the following line  
'and recall the procedure, the output of  
'the messagebox is different  
Application.ActiveDocument.Views(1).Activate  
'  
'Output state of copy:  
MsgBox Application.ActiveDocument.Views(1).IsActive  
End Sub
```

## See also

ActiveDocument Property (Page 2107)

View Object (Page 2102)

## IsConnectedToProject Property

### Description

Returns TRUE if the project connection is available. BOOLEAN read access.

### Example:

The "ConnectCheck()" procedure checks whether a project connection exists and outputs the result:

```
Sub ConnectCheck()  
  'VBA538  
  Dim bCheck As Boolean  
  Dim strStatus As String  
  bCheck = Application.IsConnectedToProject  
  If bCheck = True Then  
    strStatus = "yes"  
  Else  
    strStatus = "no"  
  End If  
  MsgBox "Connection to project available: " & strStatus  
End Sub
```

## See also

Application Object (Page 1909)

## IsDynamicable Property

### Description

TRUE if a property can be made dynamic. BOOLEAN read access.



**Example:**

The HMIObjectPropertyChanged event always occurs when you change an object property in the Graphics Designer. In this example the property name and value will be output. A check will also be made on whether the property can be made dynamic:

```
Sub Document_HMIObjectPropertyChanged(ByVal Property As IHMIProperty, CancelForwarding As Boolean)
'VBA539
Dim objProp As HMIProperty
Dim strStatus As String
Set objProp = Property
'
'Checks whether property is dynamicable
If objProp.IsDynamicable = True Then
    strStatus = "yes"
Else
    strStatus = "no"
End If
MsgBox "Property: " & objProp.Name & vbCrLf & "Value: " & objProp.value & vbCrLf & "Dynamicable: " & strStatus
End Sub
```

Further information on the "Events" topic can be found under the heading "Executing VBA macros in Graphics Designer".

**See also**

Property Object (Page 2042)  
HMIObject Object (Page 1988)  
HMIObjectPropertyChanged Event (Page 1770)  
Executing VBA Macros in Graphics Designer (Page 1619)

**IsPublished property****Description**

Only used internally.

**See also**

FaceplateProperty object (Page 1971)  
Property Object (Page 2042)

## Italic Property

### Description

TRUE if the font attribute "Italic" is set for the language-dependent text in the object. BOOLEAN write-read access.

### Example:

The following example sets the font attributes of a button for French and English:

```
Sub ExampleForLanguageFonts()  
'VBA540  
Dim objLangFonts As HMILanguageFonts  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
objButton.Text = "Hello"  
Set objLangFonts = objButton.LDFonts  
'  
'To make fontsettings for french:  
With objLangFonts.ItemByLCID(1036)  
.Family = "Courier New"  
.Bold = True  
.Italic = False  
.Underlined = True  
.Size = 12  
End With  
'  
'To make fontsettings for english:  
With objLangFonts.ItemByLCID(1033)  
.Family = "Times New Roman"  
.Bold = False  
.Italic = True  
.Underlined = False  
.Size = 14  
End With  
End Sub
```

### See also

[Underlined Property \(Page 2460\)](#)  
[Size Property \(Page 2419\)](#)  
[Parent Property \(Page 2359\)](#)  
[LanguageID Property \(Page 2289\)](#)  
[Family Property \(Page 2229\)](#)  
[Bold Property \(Page 2151\)](#)

Application Property (Page 2121)

LanguageFont Object (Page 1996)

## Item Property

### Description

Returns an element from a listing. Depending on the specified object, you can use either the index number or the name to return a particular element.

### Example:

This example shows both kinds of indexing. In order for the example to work, create a group object ("Group1") with two objects. The example outputs the height of the second object in a group:

```
Sub GetHeight()  
'VBA541  
Dim objGroup As HMIGroup  
'Next line uses the property "Item" to get a group by name  
Set objGroup = ActiveDocument.HMIObjects.Item("Group1")  
'Otherwise next line uses index to identify a groupobject  
MsgBox "The height of object 2 is: " & objGroup.GroupedHMIObjects.Item(2).Height  
End Sub
```

### See also

VariableTriggers Object (Listing) (Page 2101)

VariableStateValues Object (Listing) (Page 2097)

AnalogResultInfos Object (Listing) (Page 1908)

## ItemBorderBackColor Property

### Description

Defines or returns the background color of the separation lines in the selection list for the TextList object. LONG write-read access.

The background color is only visible with the property setting ItemBorderStyle > 0.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

### 3.6 VBA Reference

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

#### Example:

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the background color for the separation lines will be set to "Red":

```
Sub TextListConfiguration()  
'VBA542  
Dim objTextList As HMITextList  
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")  
With objTextList  
  .ItemBorderStyle = 1  
  .ItemBorderBackColor = RGB(255, 0, 0)  
End With  
End Sub
```

#### See also

[ItemBorderStyle Property \(Page 2285\)](#)

[TextList Object \(Page 2076\)](#)

## ItemBorderColor Property

### Description

Defines or returns the color of the separation lines in the selection list for the TextList object. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the color for the separation lines will be set to "White":

```
Sub TextListConfiguration()
'VBA543
Dim objTextList As HMITextList
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")
With objTextList
.ItemBorderStyle = 1
.ItemBorderColor = RGB(255, 255, 255)
End With
End Sub
```

**See also**

TextList Object (Page 2076)

**ItemBorderStyle Property****Description**

Defines or returns the dividing line style in the selection list for the TextList object. Value range from 0 to 4.

Line style	Assigned Value
————	0
— — —	1
-----	2
- - - -	3
- - - -	4

**Example:**

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the dividing line style will be set to "1":

```
Sub TextListConfiguration()  
'VBA544  
Dim objTextList As HMITextList  
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")  
With objTextList  
.ItemBorderStyle = 1  
.ItemBorderBackColor = RGB(255, 0, 0)  
End With  
End Sub
```

**See also**

[TextList Object \(Page 2076\)](#)

**ItemBorderWidth Property**

**Description**

Defines or returns the weight in pixels of the dividing lines in the selection list for the TextList object.

**Example:**

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the dividing line width will be set to "4":

```
'Sub E_628_TextListConfiguration()  
Sub E_629_TextListConfiguration()  
'VBA545  
Dim objTextList As HMITextList  
Set objTextList =  
ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")  
With objTextList  
.ItemBorderWidth = 4  
End With  
End Sub
```

## See also

TextList Object (Page 2076)

## Key Property

## Description

Returns the name that identifies the entry (menu point or icon) in the user-defined menu or user-defined toolbar. Read only access.

Use the Key property to determine which entry was clicked. For this purpose you can use, say, the events "MenuItemClicked" and "ToolBarItemClicked".

## Example:

The "CreateMenuItem()" procedure creates the "Delete Objects" menu and adds two menu entries ("Delete Rectangles" and "Delete Circles"):

```
Sub CreateMenuItem()  
'VBA546  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
'  
'Add new menu "Delete objects" to menubar:  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DeleteObjects", "Delete objects")  
'  
'Adds two menuitems to menu "Delete objects"  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "DeleteAllRectangles", "Delete  
Rectangles")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(2, "DeleteAllCircles", "Delete Circles")  
End Sub
```

### 3.6 VBA Reference

In connection with the "MenuItemClicked" event, you can connect the menu entries with procedure calls, for instance. In this example the names of the menu entries will be output:

```
Sub Document_MenuItemClicked(ByVal MenuItem As IHMIMenuItem)
'VBA547
Dim strClicked As String
Dim objMenuItem As HMIMenuItem
Set objMenuItem = MenuItem
'
'"strClicked can get two values:
'(1) "DeleteAllRectangles" and
'(2) "DeleteAllCircles"
strClicked = objMenuItem.Key
'
'To analyse "strClicked" with "Select Case"
Select Case strClicked
Case "DeleteAllRectangles"
'
'Instead of "MsgBox" a procedurecall (e.g. "Call <Prozedurname>") can stay here
MsgBox "'Delete rectangle' was clicked"
Case "DeleteAllCircles"
MsgBox "'Delete Circles' was clicked"
End Select
End Sub
```

#### See also

- [ToolbarItem Object \(Page 2083\)](#)
- [MenuItem Object \(Page 2013\)](#)
- [InsertToolbarItem Method \(Page 1856\)](#)
- [InsertMenuItem Method \(Page 1852\)](#)
- [ToolbarItemClicked Event \(Page 1782\)](#)
- [MenuItemClicked Event \(Page 1775\)](#)
- [Creating Customized Menus and Toolbars \(Page 1627\)](#)

## L

### Label Property

#### Description

Returns the label of the user-defined menu or menu entry in the currently set language. Read only access.



**Example:**

The "CreateMenuItem()" procedure creates the "Delete Objects" menu and adds two menu entries ("Delete Rectangles" and "Delete Circles"): In this example the labels will then be output:

```
Sub CreateMenuItem()  
'VBA548  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Dim iIndex As Integer  
iIndex = 1  
'  
'Add new menu "Delete objects" to menubar  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DeleteObjects", "Delete objects")  
'  
'Adds two menuitems to menu "Delete objects"  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "DeleteAllRectangles", "Delete  
rectangles")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(2, "DeleteAllCircles", "Delete circles")  
MsgBox ActiveDocument.CustomMenus(1).Label  
For iIndex = 1 To objMenu.MenuItems.Count  
MsgBox objMenu.MenuItems(iIndex).Label  
Next iIndex  
End Sub
```

**See also**

[CustomMenus Property \(Page 2207\)](#)  
[MenuItems Object \(Listing\) \(Page 2015\)](#)  
[MenuItem Object \(Page 2013\)](#)  
[Menu Object \(Page 2009\)](#)

**LanguageID Property****Description**

Returns the language identifier of the project language as a decimal value. LONG read access

**Example:**

The "DataLanguages()" procedure outputs the project languages together with their language identifiers:

```
Sub DataLanguages()  
'VBA549  
Dim colDataLang As HMIDataLanguages  
Dim objDataLang As HMIDataLanguage  
Dim nLangID As Long  
Dim strLangName As String  
Dim iAnswer As Integer  
Set colDataLang = Application.AvailableDataLanguages  
For Each objDataLang In colDataLang  
nLangID = objDataLang.LanguageID  
strLangName = objDataLang.LanguageName  
iAnswer = MsgBox(nLangID & " " & strLangName, vbOKCancel)  
If vbCancel = iAnswer Then Exit For  
Next objDataLang  
End Sub
```

**See also**

[DataLanguages Object \(Listing\) \(Page 1942\)](#)

[DataLanguage Object \(Page 1941\)](#)

**LanguageName Property**

**Description**

Returns the project language. STRING read access.

**Example:**

The "DataLanguages()" procedure outputs the project languages together with their language identifiers:

```
Sub DataLanguages ()
'VBA550
Dim colDataLang As HMIDataLanguages
Dim objDataLang As HMIDataLanguage
Dim nLangID As Long
Dim strLangName As String
Dim iAnswer As Integer
Set colDataLang = Application.AvailableDataLanguages
For Each objDataLang In colDataLang
nLangID = objDataLang.LanguageID
strLangName = objDataLang.LanguageName
iAnswer = MsgBox(nLangID & " " & strLangName, vbOKCancel)
If vbCancel = iAnswer Then Exit For
Next objDataLang
End Sub
```

**See also**

DataLanguages Object (Listing) (Page 1942)

DataLanguage Object (Page 1941)

**LanguageSwitch Property****Description**

Defines where the language-dependent assignment texts are stored or returns the value.  
BOOLEAN write-read access.

TRUE, when the texts in the Text Library are managed. Translation to other language occurs in the Text Library.

FALSE, when the texts are managed directly in the object. Translation to other language can be carried out using Text Distributor.

**Example:**

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the texts will be managed in the Text Library:


```
Sub TextListConfiguration()  
'VBA551  
Dim objTextList As HMITextList  
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")  
With objTextList  
    .LanguageSwitch = True  
End With  
End Sub
```

**See also**

TextList Object (Page 2076)

**LastChange Property****Description**

Returns the date on which the current picture was last changed. READ access.

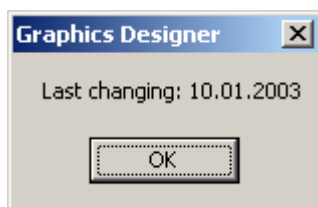**Example:**

The "ActiveDocumentConfiguration()" procedure accesses the properties of the current picture in the Graphics Designer. In this example the date of the last change to the current picture will be output:

```
Sub ActiveDocumentConfiguration()  
'VBA552  
Dim varLastDocChange As Variant  
varLastDocChange = Application.ActiveDocument.LastChange  
MsgBox "Last changing: " & varLastDocChange  
End Sub
```

**See also**

Document Object (Page 1949)

**Layer Property****Description**

Defines which layer of the picture an object is located in, or returns that information. There is a total of 32 layers available, whereby Layer "0" is the bottom layer and Layer "31" the top layer.

The configured objects are initially in the background of a layer.

---

**Note**

In VBA the numbering starts at "1". An entry of "objRectangle.Layer = 1" is therefore located in the lowest layer.

---

**Example:**

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the Rectangle object will be inserted in layer "4":

```
Sub RectangleConfiguration()  
  'VBA553  
  Dim objRectangle As HMIRectangle  
  Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
  With objRectangle  
    .Layer = 4  
  End With  
End Sub
```

**See also**

HMIObject Object (Page 1988)

Editing Layers with VBA (Page 1657)

**Layer00..10Checked property****Description**

TRUE if the respective limit "0" to "10" is monitored in the case of the "3DBarGraph" object. BOOLEAN write-read access.

The limit and the color representation are specified with the properties "Layer00..10Value" and "Layer00..10Color".

The bar fill color and the fill pattern are specified with the properties "Layer00..10FillColor" and "Layer00..10FillStyle".

## Example

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example, limit "0" is to be monitored:

```
Sub HMI3DBarGraphConfiguration()  
'VBA554  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
  .Layer00Checked = True  
End With  
End Sub
```

## See also

[Layer00..10Value property \(Page 2296\)](#)

[Layer00..10Color property \(Page 2294\)](#)

[3DBarGraph Object \(Page 1894\)](#)

## Layer00..10Color property

### Description

Defines or returns the color for the respective limit "0" to "10" of the "3DBarGraph" object. LONG write-read access.

When monitoring of the limit value is activated using the "Layer00..10Checked" property, the bar turns to the color defined by this attribute on reaching the limit value.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0).

## Example

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the color for limit "0" is defined as "Magenta":

```
Sub HMI3DBarGraphConfiguration()  
'VBA555  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
  .Layer00Checked = True  
  .Layer00Color = RGB(255, 0, 255)  
End With  
End Sub
```

## See also

Layer00..10Checked property (Page 2293)

3DBarGraph Object (Page 1894)

## Layer00..10FillColor property

### Description

Defines or returns the bar fill color for the respective limit "0" to "10" of the "3DBarGraph" object. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0).

## Layer00..10FillStyle property

### Description

Defines or returns the bar fill pattern for the respective limit "0" to "10" of the "3DBarGraph" object.

The bar fill color has to differ from the bar color to make the fill pattern visible.

There is a choice of 50 fill patterns. The "0" fill pattern fills the object with the set background color. The "1" fill pattern means neither a background nor a fill pattern is displayed.

## Layer00..10Value property

### Description

Defines or returns the value for "Limit 0" to "Limit 10" in the case of the "3DBarGraph" object. Monitoring only takes effect when the "Layer00..10Checked" property value is set to "TRUE".

### Example

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the value for limit "0" is defined as "0":

```
Sub HMI3DBarGraphConfiguration()  
'VBA556  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
  .Layer00Checked = True  
  .Layer00Value = 0  
End With  
End Sub
```

### See also

[Layer00..10Checked property \(Page 2293\)](#)

[3DBarGraph Object \(Page 1894\)](#)

## LayerDecluttering Property

### Description

TRUE if showing and hiding objects dependent upon the minimum and maximum zoom set for a layer has been enabled. BOOLEAN write-read access.



**Example:**

In the following example the settings for the lowest layer are configured in the active picture:

```
Sub ConfigureSettingsOfLayer()  
'VBA587  
Dim objLayer As HMILayer  
Set objLayer = ActiveDocument.Layers(1)  
With objLayer  
'configure "Layer 0"  
.MinZoom = 10  
.MaxZoom = 100  
.Name = "Configured with VBA"  
End With  
'define fade-in and fade-out of objects:  
With ActiveDocument  
.LayerDecluttering = True  
.ObjectSizeDecluttering = True  
.SetDeclutterObjectSize 50, 100  
End With  
End Sub
```

**See also**

[Document Object \(Page 1949\)](#)

[Editing Layers with VBA \(Page 1657\)](#)

**Layers Property****Description**

Returns a listing containing the properties of the layers in the current picture.

---

**Note**

If the "Layers" property is used, the sequence of HMI objects in the HMIObjets listing can change.

---

**Example:**

The "LayerInfo()" procedure outputs the name and zoom configuration for each layer of the current picture:

```
Sub LayerInfo()  
'VBA588  
Dim collayers As HMIlayers  
Dim objLayer As HMILayer  
Dim iAnswer As Integer  
Set collayers = ActiveDocument.layers  
For Each objLayer In collayers  
With objLayer  
iAnswer = MsgBox("Layername: " & .Name & vbCrLf & "max. zoom: " & .MaxZoom & vbCrLf & "min.  
zoom: " & .MinZoom, vbOKCancel)  
End With  
If vbCancel = iAnswer Then Exit For  
Next objLayer  
End Sub
```

**See also**

- Name Property (Page 2343)
- MinZoom Property (Page 2340)
- MaxZoom Property (Page 2323)
- Layers Object (Listing) (Page 2003)
- Layer Object (Page 2001)

**LDAssignments property**

**Description**

Returns a listing with the (foreign language) assignments of display texts that are displayed depending on the current "Output Value" in the "TextList" object.

The assignments depend on the set list type. Specify the list type with the "ListType" property.

**LDFonts Property**

**Description**

Returns a listing containing the language identifiers for the configured fonts.

**Example:**

Use the LDFonts property to return the LanguageFonts listing. In the following example the language identifiers of the configured fonts will be output:

```
Sub ShowLanguageFont()  
'VBA589  
Dim colLanguageFonts As HMILanguageFonts  
Dim objLanguageFont As HMILanguageFont  
Dim objButton As HMIButton  
Dim iMax As Integer  
Dim iAnswer As Integer  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
Set colLanguageFonts = objButton.LDFonts  
iMax = colLanguageFonts.Count  
For Each objLanguageFont In colLanguageFonts  
iAnswer = MsgBox("Projected fonts: " & iMax & vbCrLf & "Language-ID: " &  
objLanguageFont.LanguageID, vbOKCancel)  
If vbCancel = iAnswer Then Exit For  
Next objLanguageFont  
End Sub
```

**See also**

[StaticText Object \(Page 2067\)](#)  
[OptionGroup Object \(Page 2025\)](#)  
[LanguageFonts Object \(Listing\) \(Page 1997\)](#)  
[CheckBox Object \(Page 1924\)](#)  
[Button Object \(Page 1921\)](#)

**LDFontsType property****Description**

Only used internally.

**See also**

[FaceplateProperty object \(Page 1971\)](#)

**LDLabelTexts Property****Description**

Returns a listing containing the multilingual labels of the user-defined menu or menu entry.

**Example:**

The "CreateMenuItem()" procedure creates the "Delete Objects" menu and adds two menu entries ("Delete Rectangles" and "Delete Circles"): In this example, multilingual menu labels will be created:

```
Sub CreateMenuItem()  
'VBA590  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Dim objLangText As HMILanguageText  
,  
'Add new menu "Delete objects" to menubar:  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DeleteObjects", "Delete objects")  
,  
'Add two menuitems to the new menu  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "DeleteAllRectangles", "Delete  
rectangles")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(2, "DeleteAllCircles", "Delete circles")  
,  
'Define foreign-language labels for menu "Delete objects":  
Set objLangText = objMenu.LDLabelTexts.Add(1033, "English_Delete objects")  
Set objLangText = objMenu.LDLabelTexts.Add(1032, "Greek_Delete objects")  
Set objLangText = objMenu.LDLabelTexts.Add(1034, "Spanish_Delete objects")  
Set objLangText = objMenu.LDLabelTexts.Add(1036, "French_Delete objects")  
End Sub
```

The "LDLabelInfo()" procedure outputs the labels configured for the "Delete Objects" menu:

```
Sub LDLabelInfo()  
'VBA591  
Dim colLangTexts As HMILanguageTexts  
Dim objLangText As HMILanguageText  
Dim iAnswer As Integer  
,  
'Save all labels of menu into collection "colLangTexts":  
Set colLangTexts = ActiveDocument.CustomMenus("DeleteObjects").LDLabelTexts  
For Each objLangText In colLangTexts  
iAnswer = MsgBox(objLangText.DisplayName, vbOKCancel)  
If vbCancel = iAnswer Then Exit For  
Next objLangText  
End Sub
```

**See also**

[MenuItem Object \(Page 2013\)](#)

[Menu Object \(Page 2009\)](#)

## LDNames Property

### Description

Returns a listing containing the multilingual names of a folder in the Components Library or of a layer.

### Example:

Use the LDNames property to return the LanguageTexts listing. In the following example all multilingual layer names will be output:

Explanation: What the example shows

```
Sub LDLabelInfo()  
'VBA592  
Dim colLayerLngTexts As HMILanguageTexts  
Dim objLayerLngText As HMILanguageText  
Dim iIndex As Integer  
Dim iAnswer As Integer  
Dim strResult As String  
iIndex = 1  
For iIndex = 1 To ActiveDocument.Layers.Count  
'  
'Save all labels of layers into collection of "colLayerLngTexts":  
Set colLayerLngTexts = ActiveDocument.Layers(iIndex).LDNames  
For Each objLayerLngText In colLayerLngTexts  
strResult = strResult & vbCrLf & objLayerLngText.LanguageID & " - " &  
objLayerLngText.DisplayName  
Next objLayerLngText  
iAnswer = MsgBox(strResult, vbOKCancel)  
strResult = ""  
If vbCancel = iAnswer Then Exit For  
Next iIndex  
End Sub
```

### See also

Layer Object (Page 2001)  
LanguageTexts Object (Listing) (Page 2000)  
FolderItem Object (Page 1972)

## LDStatusTexts Property

### Description

Returns a listing containing the multilingual status line texts of a user-defined icon or menu entry.

**Example:**

The "CreateMenuItem()" procedure creates the "Delete Objects" menu and adds two menu entries ("Delete Rectangles" and "Delete Circles"). In this example, multilingual status line texts will be created:

```
Sub CreateMenuItem()
'VBA593
Dim objMenu As HMIMenu
Dim objMenuItem1 As HMIMenuItem
Dim objMenuItem2 As HMIMenuItem
Dim objLangStateText As HMILanguageText
'
'Add new menu "Delete objects" to menubar:
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DeleteObjects", "Delete objects")
'
'Add two menuitems to the new menu
Set objMenuItem1 = objMenu.MenuItems.InsertMenuItem(1, "DeleteAllRectangles", "Delete
rectangles")
Set objMenuItem2 = objMenu.MenuItems.InsertMenuItem(2, "DeleteAllCircles", "Delete
circles")
'
'Define foreign-language labels for menuitem "Delete rectangles":
Set objLangStateText = objMenuItem1.LDStatusTexts.Add(1033, "English_Delete rectangles")
Set objLangStateText = objMenuItem1.LDStatusTexts.Add(1032, "Greek_Delete rectangles")
Set objLangStateText = objMenuItem1.LDStatusTexts.Add(1034, "Spanish_Delete rectangles")
Set objLangStateText = objMenuItem1.LDStatusTexts.Add(1036, "French_Delete rectangles")
End Sub
```

The "LDStatusTextInfo()" procedure outputs the status line texts configured for the "Delete Objects" menu:

```
Sub LDStatusTextInfo()
'VBA594
Dim colMenuItems As HMIMenuItems
Dim objMenuItem As HMIMenuItem
Dim colStatusLngTexts As HMILanguageTexts
Dim objStatusLngText As HMILanguageText
Dim strResult As String
Dim iAnswer As Integer
Set colMenuItems = ActiveDocument.CustomMenus("DeleteObjects").MenuItems
For Each objMenuItem In colMenuItems
strResult = "Statustexts of menuitem "" & objMenuItem.Label & """"
Set colStatusLngTexts = objMenuItem.LDStatusTexts
For Each objStatusLngText In colStatusLngTexts
strResult = strResult & vbCrLf & objStatusLngText.DisplayName
Next objStatusLngText
iAnswer = MsgBox(strResult, vbOKCancel)
If vbCancel = iAnswer Then Exit For
Next objMenuItem
End Sub
```

## See also

ToolStripItem Object (Page 2083)

MenuItem Object (Page 2013)

Menu Object (Page 2009)

## LDTexts Property

### Description

Returns a listing containing the multilingual labels of an object.

### Example:

The "LDTextInfo()" procedure outputs the labels configured for the Button object. For this example to work, create the object "myButton" in the Graphics Designer and configure a number of multilingual labels:

```
Sub LDTextInfo()  
'VBA595  
Dim colLDLngTexts As HMILanguageTexts  
Dim objLDLngText As HMILanguageText  
Dim objButton As HMIButton  
Dim iAnswer As Integer  
Set objButton = ActiveDocument.HMIObjects("myButton")  
Set colLDLngTexts = objButton.LDTexts  
For Each objLDLngText In colLDLngTexts  
iAnswer = MsgBox(objLDLngText.DisplayName, vbOKCancel)  
If vbCancel = iAnswer Then Exit For  
Next objLDLngText  
End Sub
```

## See also

Button Object (Page 1921)

StaticText Object (Page 2067)

OptionGroup Object (Page 2025)

CheckBox Object (Page 1924)

## LDTooltipTexts Property

### Description

Returns a listing containing the multilingual Tooltip texts for a user-defined icon or for an object.

**Example**

The "CreateToolbar()" procedure creates a user-defined toolbar with two icons. Two multilingual Tooltip texts are assigned to the first icon:

```
Sub CreateToolbar()
'VBA596
Dim objToolbar As HMIToolbar
Dim objToolbarItem As HMIToolbarItem
Dim objLangText As HMILanguageText
Dim strFileWithPath
'
'Create toolbar with two toolbar-items:
Set objToolbar = ActiveDocument.CustomToolbars.Add("Tooll_1")
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(1, "ti1_1",
"myFirstToolbaritem")
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(2, "ti1_2",
"mySecondToolbaritem")
'
'In order that the example runs correct copy a *.ICO-Graphic
'into the "GraCS"-Folder of the actual project.
'Replace the filename "EZSTART.ICO" in the next commandline
'with the name of the ICO-Graphic you copied
strFileWithPath = Application.ApplicationDataPath & "EZSTART.ICO"
'
'
'To assign the symbol-icon to the first toolbaritem
objToolbar.ToolbarItems(1).Icon = strFileWithPath
'
'Define foreign-language tooltip texts
Set objLangText = objToolbar.ToolbarItems(1).LDTooltipTexts.Add(1036, "French_TooltipText")
Set objLangText = objToolbar.ToolbarItems(1).LDTooltipTexts.Add(1034,
"Spanish_TooltipText")
End Sub
```

The "LDTooltipInfo()" procedure outputs all the Tooltip texts configured for the first icon in the first user-defined toolbar:

```
Sub LDTooltipInfo()
'VBA597
Dim collLangTexts As HMILanguageTexts
Dim objLangText As HMILanguageText
Dim iAnswer As Integer
Set collLangTexts = ActiveDocument.CustomToolbars(1).ToolbarItems(1).LDTooltipTexts
For Each objLangText In collLangTexts
iAnswer = MsgBox(objLangText.DisplayName, vbOKCancel)
If vbCancel = iAnswer Then Exit For
Next objLangText
End Sub
```



**See also**

ToolBarItem Object (Page 2083)

HMIObject Object (Page 1988)

**Left Property****Description**

Defines or returns the X coordinate of the object (measured from the top left-hand edge of the picture) in pixels. The X-coordinate relates to the top left corner of the rectangle enclosing the object.

**View Object**

Defines or returns the X coordinate of the window (measured from the top left-hand edge of the Graphics Designer working area) in pixels.

**Example:**

The "RectangleConfiguration()" procedure accesses the properties of the rectangle. In this example the rectangle will be moved 40 pixels to the right:

```
Sub RectangleConfiguration()  
'VBA598  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
.Left = 40  
End With  
End Sub
```

**See also**

View Object (Page 2102)

HMIObject Object (Page 1988)

**LeftComma Property****Description**

Defines or returns the number of digits to the left of the decimal point (0 to 20) for the BarGraph object.

**Example:**

The "BarGraphConfiguration()" procedure configures In this example the number of digits to the left of the decimal point will be set to "4".

```
Sub BarGraphConfiguration()  
'VBA599  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.LeftComma = 4  
End With  
End Sub
```

**See also**

[BarGraph Object \(Page 1914\)](#)

**LightEffect Property**

**Description**

TRUE if the light effect of the 3DBarGraph object is activated. BOOLEAN write-read access.

**Example:**

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the light effect will be activated:

```
Sub HMI3DBarGraphConfiguration()  
'VBA600  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
.LightEffect = True  
End With  
End Sub
```

**See also**

[3DBarGraph Object \(Page 1894\)](#)

## LimitHigh4 Property

### Description

Defines or returns the high limit value for "Reserve 4" in the case of the BarGraph object.

The CheckLimitHigh4 property must be set to TRUE in order that the "Reserve 4" limit value can be monitored.

The type of the evaluation (in percent or absolute) is defined in the TypeLimitHigh4 property.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "70".

```
Sub BarGraphLimitConfiguration()  
'VBA601  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitHigh4 = False  
'Activate monitoring  
.CheckLimitHigh4 = True  
'Set barcolor to "red"  
.ColorLimitHigh4 = RGB(255, 0, 0)  
'Set upper limit to "70"  
.LimitHigh4 = 70  
End With  
End Sub
```

### See also

[TypeLimitHigh4 Property \(Page 2453\)](#)

[CheckLimitHigh4 Property \(Page 2172\)](#)

[BarGraph Object \(Page 1914\)](#)

## LimitHigh5 Property

### Description

Defines or returns the high limit value for "Reserve 5" in the case of the BarGraph object.

The CheckLimitHigh5 property must be set to TRUE in order that the "Reserve 5" limit value can be monitored.

The type of the evaluation (in percent or absolute) is defined in the TypeLimitHigh5 property.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "80".

```
Sub BarGraphLimitConfiguration()  
'VBA602  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitHigh5 = False  
'Activate monitoring  
.CheckLimitHigh5 = True  
'Set barcolor to "black"  
.ColorLimitHigh5 = RGB(0, 0, 0)  
'Set upper limit to "80"  
.LimitHigh4 = 80  
End With  
End Sub
```

**See also**

- TypeLimitHigh5 Property (Page 2453)
- CheckLimitHigh5 Property (Page 2173)
- BarGraph Object (Page 1914)

**LimitLow4 Property**

**Description**

Defines or returns the low limit value for "Reserve 4" in the case of the BarGraph object.

The CheckLimitLow4 property must be set to TRUE in order that the "Reserve 4" limit value can be monitored.

The type of the evaluation (in percent or absolute) is defined in the TypeLimitLow4 property.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "5".

```
Sub BarGraphLimitConfiguration()  
'VBA603  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitLow4 = False  
'Activate monitoring  
.CheckLimitLow4 = True  
'Set barcolor to "green"  
.ColorLimitLow4 = RGB(0, 255, 0)  
'Set lower limit to "5"  
.LimitLow4 = 5  
End With  
End Sub
```

**See also**

[CheckLimitLow4 Property \(Page 2174\)](#)  
[TypeLimitLow4 Property \(Page 2454\)](#)  
[BarGraph Object \(Page 1914\)](#)

**LimitLow5 Property****Description**

Defines or returns the low limit value for "Reserve 5" in the case of the BarGraph object.

The CheckLimitLow5 property must be set to TRUE in order that the "Reserve 5" limit value can be monitored.

The type of the evaluation (in percent or absolute) is defined in the TypeLimitLow5 property.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "0".

```
Sub BarGraphLimitConfiguration()  
'VBA604  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis to absolute  
.TypeLimitLow5 = False  
'Activate monitoring  
.CheckLimitLow5 = True  
'Set barcolor to "white"  
.ColorLimitLow5 = RGB(255, 255, 255)  
'Set lower limit to "0"  
.LimitLow5 = 0  
End With  
End Sub
```

**See also**

- BarGraph Object (Page 1914)
- TypeLimitLow5 Property (Page 2455)
- CheckLimitLow5 Property (Page 2175)

**LimitMax Property**

**Description**

Defines or returns the high limit value as an absolute value dependent on the data format in the case of the IOField object.

If the value to be displayed exceeds the upper limit value, it is identified by a series of \*\*\* , indicating it cannot be displayed.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the high limit for a decimal value will be set to "100":

```
Sub IOFieldConfiguration()  
'VBA605  
Dim objIOField As HMIIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIIOField")  
With objIOField  
.DataFormat = 1  
.LimitMax = 100  
End With  
End Sub
```

**See also**

DataFormat Property (Page 2210)

IOField Object (Page 1992)

**LimitMin Property****Description**

Defines or returns the low limit value as an absolute value dependent on the data format in the case of the IOField object.

If the value to be displayed exceeds the upper limit value, it is identified by a series of \*\*\* , indicating it cannot be displayed.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example the high limit for a decimal value will be set to "0":

```
Sub IOFieldConfiguration()  
'VBA606  
Dim objIOField As HMIIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIIOField")  
With objIOField  
.DataFormat = 1  
.LimitMin = 0  
End With  
End Sub
```

### See also

DataFormat Property (Page 2210)

IOField Object (Page 1992)

### LineJoinStyle property

#### Description

Defines the way that corners are displayed in a tube polygon.

Angle     The tubes are joined at corner points without rounding.

Round     The tubes are rounded at the outside corner points.

#### Example

### ListType Property

#### Description

Defines or returns the list type in the case of the TextList object. Value range from 0 to 2.

List type	Assigned Value
Decimal	0
Binary	1
Bit	2

#### Example:

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the list type will be set to "Decimal":

```
Sub TextListConfiguration()  
  'VBA607  
  Dim objTextList As HMITextList  
  Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")  
  With objTextList  
    .ListType = 0  
  End With  
End Sub
```



**See also**

TextList Object (Page 2076)

**LockBackColor Property****Description**

Defines or returns the background color of the button for a locked measuring point in the case of the GroupDisplay object. LONG write-read access.

The LockStatus property must be set to TRUE for the background color to be displayed.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color for a locked measuring point will be set to "Red":

```
Sub GroupDisplayConfiguration()  
  'VBA608  
  Dim objGroupDisplay As HMIGroupDisplay  
  Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
  "HMIGroupDisplay")  
  With objGroupDisplay  
    .LockStatus = True  
    .LockBackColor = RGB(255, 0, 0)  
  End With  
End Sub
```

**See also**

LockStatus Property (Page 2315)

GroupDisplay Object (Page 1980)

## LockedByCreatorID Property

### Description

TRUE, if a picture was created and/or referenced by SIMATIC Manager. BOOLEAN read access.

If a picture was created in SIMATIC Manager, you may process and subsequently save it in WinCC. You may, however, not delete this picture in WinCC. SIMATIC Manager administers a code for each picture, the so-called CreatorID, which cannot be changed in WinCC.

You may process the picture in WinCC, however, overwriting the picture with a WinCC picture (LockedByCreatorID = FALSE) will be prevented. This may be checked by examining the LockedByCreatorID property of an existing file prior to writing during the SaveAs method. If such a picture is saved into a new (not yet existing) or an existing WinCC picture using the SaveAs method, the CreatorID will not be passed on.

### Example 1

Inn the following example, a picture created with SIMATIC Manager (LockedByCreatorID = TRUE) is opened, processed, and saved. The value of the LockedByCreatorID property is not changed.

```
Sub SaveDocAs_1()  
'VBA810  
'open an existing file, change it and save it  
Dim docOld As Document  
Const strFile As String = "Simatic_001.Pdl"  
'  
Set docOld = Application.Documents.Open(Application.ApplicationDataPath & strFile,  
hmiOpenDocumentTypeInvisible)  
docOld.Width = docOld.Width + 1  
docOld.Save  
'  
MsgBox "LockedByCreatorID = " & docOld.LOckedByCreatorID, vbOKOnly, "Result"  
'  
docOld.Close  
Set docOld = Nothing  
'  
End Sub
```

## Example 2

In this example, a new picture is saved as a new file using the SaveAs method. To check if the picture is permitted to be saved, the LockedByCreatorID property is checked. In the new file the LockedByCreator property is reset.

```
Sub SaveDocAs_2()  
'VBA811  
'create a new file and overwrite it to an existing file,  
'if it is not 'locked by CreatorID'  
Dim docNew As Document  
Dim docOld As Document  
Const strFile As String = "Simatic_001.Pdl"  
'  
Set docNew = Application.Documents.Add(hmiOpenDocumentTypeInvisible)  
Set docOld = Application.Documents.Open(Application.ApplicationDataPath & strFile,  
hmiOpenDocumentTypeInvisible)  
'  
If docOld.LockedByCreatorID = False Then  
docOld.Close  
docNew.SaveAs(Application.ApplicationDataPath & strFile)  
Else  
MsgBox "File cannot be stored (LockedByCreatorID). ", vbOKOnly, "Result"  
End If  
'  
docOld.Close  
docNew.Close  
Set docOld = Nothing  
Set docNew = Nothing  
'  
End Sub
```

## See also

[SaveAs Method \(Page 1880\)](#)

[Document Object \(Page 1949\)](#)

## LockStatus Property

### Description

TRUE if a locked measuring point is to be displayed with the Object GroupDisplay. BOOLEAN write-read access.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color for a locked measuring point will be set to "Red":

```
Sub GroupDisplayConfiguration()  
'VBA609  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.LockStatus = True  
.LockBackColor = RGB(255, 0, 0)  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**LockText Property**

**Description**

Defines the button labels for a locked measuring point in the case of the GroupDisplay object. The LockStatus property must be set to TRUE for the label to be displayed.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the label for a locked measuring point will be set to "Locked":

```
Sub GroupDisplayConfiguration()  
'VBA610  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.LockStatus = True  
.LockText = "gesperrt"  
End With  
End Sub
```

**See also**

LockStatus Property (Page 2315)

GroupDisplay Object (Page 1980)

**LockTextColor Property****Description**

Defines or returns the color of the button label for a locked measuring point in the case of the GroupDisplay object. LONG write-read access.

The LockStatus property must be set to TRUE for the background color to be displayed.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the button label for a locked measuring point will be set to "Yellow":

```
Sub GroupDisplayConfiguration()  
'VBA611  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.LockStatus = True  
.LockTextColor = RGB(0, 255, 255)  
End With  
End Sub
```

**See also**

LockStatus Property (Page 2315)

GroupDisplay Object (Page 1980)

## LongStrokesBold Property

### Description

TRUE if the long strokes on the scale of the BarGraph object are to be displayed in bold.  
BOOLEAN write-read access.

### Example:

The "BarGraphConfiguration()" procedure configures In this example the long strokes will not be displayed in bold:

```
Sub BarGraphConfiguration()  
'VBA612  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.LongStrokesBold = False  
End With  
End Sub
```

### See also

BarGraph Object (Page 1914)

## LongStrokesOnly Property

### Description

TRUE if just the long strokes on the scale of the BarGraph object are to be displayed.  
BOOLEAN write-read access.

### Example:

The "BarGraphConfiguration()" procedure configures In this example, only the long strokes will be displayed:

```
Sub BarGraphConfiguration()  
'VBA613  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.LongStrokesOnly = True  
End With  
End Sub
```

**See also**

BarGraph Object (Page 1914)

**LongStrokesSize Property****Description**

The "BarGraphConfiguration()" procedure configures

**Example:**

In this example the length of the axis section strokes will be set to "10".

```
Sub BarGraphConfiguration()  
'VBA614  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
    .LongStrokesSize = 10  
End With  
End Sub
```

**See also**

AxisSection Property (Page 2130)

BarGraph Object (Page 1914)

**LongStrokesTextEach Property****Description**

Defines or returns which strokes will be labeled when displaying the scale on the BarGraph object (1 = every stroke, 2 = every second stroke, etc.).

**Example:**

The "BarGraphConfiguration()" procedure configures In this example every third stroke will be labeled:

```
Sub BarGraphConfiguration()  
'VBA615  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
LongStrokesTextEach = 3  
End With  
End Sub
```

**See also**

[BarGraph Object \(Page 1914\)](#)

**M**

**Macro Property**

**Description**

For a user-defined menu entry or icon, defines the VBA macro that will be executed upon selection.

**Example:**

In the following example, a user-defined menu with two menu entries is created, which retrieve two different VBA macros:

```
Sub CreateDocumentMenusUsingMacroProperty()  
'VBA616  
Dim objDocMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1", "Doc_Menu_1")  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1", "My first menuitem")  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2", "My second menuitem")  
'  
'To assign a macro to every menuitem:  
With ActiveDocument.CustomMenus("DocMenu1")  
.MenuItems("dmItem1_1").Macro = "TestMacro1"  
.MenuItems("dmItem1_2").Macro = "TestMacro2"  
End With  
End Sub
```



You can call the following two procedures via the menu items in the user-defined menu "DocMenu1":

```
Sub TestMacro1()  
MsgBox "TestMacro1 is executed"  
End Sub
```

```
Sub TestMacro2()  
MsgBox "TestMacro2 is executed"  
End Sub
```

## See also

[ToolbarItem Object \(Page 2083\)](#)

[MenuItem Object \(Page 2013\)](#)

[How to assign VBA macros to menus and toolbars \(Page 1642\)](#)

## Marker Property

### Description

TRUE if the limit values are to be displayed as a scale value in the case of the BarGraph object. BOOLEAN write-read access.

### Example:

The "BarGraphConfiguration()" procedure configures In this example, the limit values will be displayed as scale values:

```
Sub BarGraphConfiguration()  
'VBA617  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.Marker = True  
End With  
End Sub
```

## See also

[BarGraph Object \(Page 1914\)](#)

## Max Property

### Description

Defines or returns the absolute value in the case of a full value display.

This value is displayed if the scale display is active.

### Example:

The "BarGraphConfiguration()" procedure configures In this example the absolute value will be set to "10".

```
Sub BarGraphConfiguration()  
  'VBA618  
  Dim objBarGraph As HMIBarGraph  
  Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
  With objBarGraph  
    .Max = 10  
  End With  
End Sub
```

### See also

Slider object (Page 2062)

BarGraph Object (Page 1914)

3DBarGraph Object (Page 1894)

## MaxIndex property

### Description

Shows the highest index of all configurable alarm and status combinations at the "HMIAdvancedStateDisplay" object.

## MaximizeButton Property

### Description

TRUE if the ApplicationWindow object can be maximized in Runtime. BOOLEAN write-read access.

**Example:**

The "ApplicationWindowConfig" procedure accesses the properties of the application window. In this example the application window will receive a Maximize button in Runtime:

```
Sub ApplicationWindowConfig()  
'VBA619  
Dim objAppWindow As HMIApplicationWindow  
Set objAppWindow = ActiveDocument.HMIObjects.AddHMIObject("AppWindow1",  
"HMIApplicationWindow")  
With objAppWindow  
.MaximizeButton = True  
End With  
End Sub
```

**See also**

ApplicationWindow Object (Page 1911)

**MaxZoom Property****Description**

Defines or returns the maximum zoom level for the layer.

**Example:**

The "LayerInfo()" procedure outputs the name and zoom configuration for each layer of the current picture:

```
Sub LayerInfo()  
'VBA620  
Dim colLayers As HMILayers  
Dim objSingleLayer As HMILayer  
Dim iAnswer As Integer  
Set colLayers = ActiveDocument.Layers  
For Each objSingleLayer In colLayers  
With objSingleLayer  
iAnswer = MsgBox("Layername: " & .Name & vbCrLf & "Min. zoom: " & .MinZoom & vbCrLf & "Max.  
zoom: " & .MaxZoom, vbOKCancel)  
End With  
If vbCancel = iAnswer Then Exit For  
Next objSingleLayer  
End Sub
```

## See also

Layer Object (Page 2001)

Editing Layers with VBA (Page 1657)

## MCGUBackColorOff-Eigenschaft

### Description

In the case of the GroupDisplay object, defines or returns the background color for the "Went Out Unacknowledged" status when the flash status is "Off". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color when the flash status is "Off" will be set to "Red":

```
Sub GroupDisplayConfiguration()  
  'VBA621  
  Dim objGroupDisplay As HMIGroupDisplay  
  Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
  "HMIGroupDisplay")  
  With objGroupDisplay  
    .MCGUBackColorOff = RGB(255, 0, 0)  
  End With  
End Sub
```

## See also

GroupDisplay Object (Page 1980)

## MCGUBackColorOn Property

### Description

In the case of the GroupDisplay object, defines or returns the background color for the "Went Out Unacknowledged" status when the flash status is "On". LONG write-read access.

### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

#### Example:

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color when the flash status is "On" will be set to "White":

```
Sub GroupDisplayConfiguration()  
'VBA622  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCGUBackColorOn = RGB(255, 255, 255)  
End With  
End Sub
```

#### See also

[GroupDisplay Object \(Page 1980\)](#)

### MCGUBackFlash Property

#### Description

TRUE if the background to the GroupDisplay object is to flash when a message goes out unacknowledged. BOOLEAN write-read access.

#### Example:

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color is to flash when a message goes out unacknowledged:

```
Sub GroupDisplayConfiguration()  
'VBA623  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCGUBackFlash = True  
End With  
End Sub
```

## See also

GroupDisplay Object (Page 1980)

## MCGUTextColorOff Property

### Description

In the case of the GroupDisplay object, defines or returns the text color for the "Went Out Unacknowledged" status when the flash status is "Off". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color to the text when the flash status is "Off" will be set to "Blue":

```
Sub GroupDisplayConfiguration()  
  'VBA624  
  Dim objGroupDisplay As HMIGroupDisplay  
  Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
  "HMIGroupDisplay")  
  With objGroupDisplay  
    .MCGUTextColorOff = RGB(0, 0, 255)  
  End With  
End Sub
```

## See also

GroupDisplay Object (Page 1980)

## MCGUTextColorOn Property

### Description

In the case of the GroupDisplay object, defines or returns the background color to the text for the "Went Out Unacknowledged" status when the flash status is "On". LONG write-read access.

### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color to the text when the flash status is "On" will be set to "Black":

```
Sub GroupDisplayConfiguration()  
'VBA625  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCGUTextColorOn = RGB(0, 0, 0)  
End With  
End Sub
```

### See also

GroupDisplay Object (Page 1980)

### MCGUTextFlash Property

#### Description

TRUE if the font for the GroupDisplay object is to flash when a message goes out unacknowledged. BOOLEAN write-read access.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the font is to flash when a message goes out unacknowledged:

```
Sub GroupDisplayConfiguration()  
'VBA626  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCGUTextFlash = True  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKOBackColorOff Property****Description**

In the case of the GroupDisplay object, defines or returns the background color for the "Came In" status when the flash status is "Off". LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color when the flash status is "Off" will be set to "Red":

```
Sub GroupDisplayConfiguration()  
'VBA627  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKOBackColorOff = RGB(255, 0, 0)  
End With  
End Sub
```



**See also**

GroupDisplay Object (Page 1980)

**MCKOBackColorOn Property****Description**

In the case of the GroupDisplay object, defines or returns the background color for the "Came In" status when the flash status is "On". LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color when the flash status is "On" will be set to "White":

```
Sub GroupDisplayConfiguration()  
'VBA628  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKOBackColorOn = RGB(255, 255, 255)  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKOBackFlash Property****Description**

TRUE if the background to the GroupDisplay object is to flash when a message goes out unacknowledged. BOOLEAN write-read access.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color is to flash when a message goes out unacknowledged:

```
Sub GroupDisplayConfiguration()  
'VBA629  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKOBackFlash = True  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKOTextColorOff Property**

**Description**

In the case of the GroupDisplay object, defines or returns the text color for the "Came In" status when the flash status is "Off". LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color to the text when the flash status is "Off" will be set to "Blue":

```
Sub GroupDisplayConfiguration()  
'VBA630  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKOTextColorOff = RGB(0, 0, 255)  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKOTextColorOn Property****Description**

In the case of the GroupDisplay object, defines or returns the background color to the text for the "Came In" status when the flash status is "On". LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color to the text when the flash status is "On" will be set to "Black":

```
Sub GroupDisplayConfiguration()  
'VBA631  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKOTextColorOn = RGB(0, 0, 0)  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKOTextFlash Property****Description**

TRUE if the font for the GroupDisplay object is to flash when a message goes out unacknowledged. BOOLEAN write-read access.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the font is to flash when a message goes out unacknowledged:

```
Sub GroupDisplayConfiguration()  
'VBA632  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKOTextFlash = True  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKQBackColorOff Property****Description**

In the case of the GroupDisplay object, defines or returns the background color for the "Went Out Acknowledged" status when the flash status is "Off". LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color when the flash status is "Off" will be set to "Red":

```
Sub GroupDisplayConfiguration()  
'VBA633  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKQBackColorOff = RGB(255, 0, 0)  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKQBackColorOn Property****Description**

In the case of the GroupDisplay object, defines or returns the background color for the "Went Out Acknowledged" status when the flash status is "On". LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color when the flash status is "On" will be set to "White":

```
Sub GroupDisplayConfiguration()  
'VBA634  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKQBackColorOn = RGB(255, 255, 255)  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKQBackFlash Property****Description**

TRUE if the background to the GroupDisplay object is to flash when a message goes out acknowledged. BOOLEAN write-read access.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color is to flash when a message goes out unacknowledged:

```
Sub GroupDisplayConfiguration()  
'VBA635  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKQBackFlash = True  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKQTextColorOff Property****Description**

In the case of the GroupDisplay object, defines or returns the text color for the "Went Out Acknowledged" status when the flash status is "Off". LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color to the text when the flash status is "Off" will be set to "Blue":

```
Sub GroupDisplayConfiguration()  
'VBA636  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKQTextColorOff = RGB(0, 0, 255)  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKQTextColorOn Property****Description**

In the case of the GroupDisplay object, defines or returns the background color to the text for the "Went Out Acknowledged" status when the flash status is "On". LONG write-read access.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color to the text when the flash status is "On" will be set to "Black":

```
Sub GroupDisplayConfiguration()  
'VBA637  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKQTextColorOn = RGB(0, 0, 0)  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCKQTextFlash Property****Description**

TRUE if the font for the GroupDisplay object is to flash when a message goes out acknowledged. BOOLEAN write-read access.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the font is to flash when a message goes out unacknowledged:

```
Sub GroupDisplayConfiguration()  
'VBA638  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MCKQTextFlash = True  
End With  
End Sub
```

**See also**

GroupDisplay Object (Page 1980)

**MCText Property**

**Description**

Defines or returns the label for the appropriate message class in the case of the GroupDisplay object.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the label for the "Alarm High" message class will be set to "Alarm High":

```
Sub GroupDisplayConfiguration()  
'VBA639  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.MessageClass = 0  
.MCText = "Alarm High"  
End With  
End Sub
```



**See also**

MessageClass Property (Page 2339)

GroupDisplay Object (Page 1980)

**MenuItems Property****Description**

Returns a listing containing all the menu entries in the user-defined menu.

**Example:**

The "CreateMenuItem()" procedure creates the "Delete Objects" menu and adds two menu entries ("Delete Rectangles" and "Delete Circles"). In this example the labels will then be output:

```
Sub CreateMenuItem()  
'VBA640  
Dim objMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Dim iIndex As Integer  
iIndex = 1  
'  
'Add new menu "Delete objects" to the menubar:  
Set objMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DeleteObjects", "Delete objects")  
'  
'Add two menuitems to menu "Delete objects"  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(1, "DeleteAllRectangles", "Delete  
rectangles")  
Set objMenuItem = objMenu.MenuItems.InsertMenuItem(2, "DeleteAllCircles", "Delete circles")  
'  
'Output label of menu:  
MsgBox ActiveDocument.CustomMenus(1).Label  
'  
'Output labels of all menuitems:  
For iIndex = 1 To objMenu.MenuItems.Count  
MsgBox objMenu.MenuItems(iIndex).Label  
Next iIndex  
End Sub
```

**See also**

Menu Object (Page 2009)

MenuItem Object (Page 2013)

## MenuItemType Property

### Description

Returns the type for a user-defined menu entry. Read only access.

Returned Value	Type of Menu Entry
0	Separator (Separator)
1	Submenu (SubMenu)
2	Menu Entry (MenuItem)

### Example:

The "ShowMenuTypes()" procedure outputs the types for the menu entries in the first user-defined menu:

```
Sub ShowMenuTypes ()
  'VBA641
  Dim iMaxMenuItems As Integer
  Dim iMenuItemType As Integer
  Dim strMenuItemType As String
  Dim iIndex As Integer
  iMaxMenuItems = ActiveDocument.CustomMenus(1).MenuItems.Count
  For iIndex = 1 To iMaxMenuItems
    iMenuItemType = ActiveDocument.CustomMenus(1).MenuItems(iIndex).MenuItemType
    Select Case iMenuItemType
    Case 0
      strMenuItemType = "Trennstrich (Separator)"
    Case 1
      strMenuItemType = "Untermenü (SubMenu)"
    Case 2
      strMenuItemType = "Menüeintrag (MenuItem)"
    End Select
    MsgBox iIndex & ". MenuItemType: " & strMenuItemType
  Next iIndex
End Sub
```

### See also

[MenuItem Object \(Page 2013\)](#)

[Menu Object \(Page 2009\)](#)

## MenuToolBarConfig Property

### Description

Specifies the configuration file with the user-defined menu and toolbars for the "HMIPictureWindow" object or returns the name of the configuration file. STRING write-read access.

## MessageClass Property

### Description

Specifies the respective message type (Alarm High, Alarm Low, Warning High, Warning Low, etc.) for which the attribute settings "Display Text", "Came In", "Came In Acknowledged" and "Went Out Unacknowledged" are configured for the "GroupDisplay" and "AdvancedAnalogDisplay" objects.

MessageClass	Assigned Value
AlarmHigh	0
AlarmLow	1
WarningHigh	2
WarningLow	3
Tolerance High	4
Tolerance Low	5
AS Control System Fault	6
AS Process Control Error	7
OS Process Control Error	8

### Example

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the background color for the "AlarmHigh" message type when the flash status is "Off" will be set to "Red":

```
Sub GroupDisplayConfiguration()
'VBA642
Dim objGroupDisplay As HMIGroupDisplay
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",
"HMIGroupDisplay")
With objGroupDisplay
.MessageClass = 0
.MCGUBackColorOff = RGB(255, 0, 0)
End With
End Sub
```

## See also

GroupDisplay Object (Page 1980)

## Min Property

### Description

Defines or returns the absolute value in the case of the smallest value display.  
This value is displayed if the scale display is active.

### Example:

The "BarGraphConfiguration()" procedure configures In this example the absolute value will be set to "1".

```
Sub BarGraphConfiguration()  
'VBA643  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
  .Min = 1  
End With  
End Sub
```

## See also

Slider object (Page 2062)

BarGraph Object (Page 1914)

3DBarGraph Object (Page 1894)

## MinZoom Property

### Description

Defines or returns the minimum zoom level for the layer.

**Example:**

The "LayerInfo()" procedure outputs the name and zoom configuration for each layer of the current picture:

```
Sub LayerInfo()  
'VBA644  
Dim collayers As HMILayers  
Dim objLayer As HMILayer  
Dim strMaxZoom As String  
Dim strMinZoom As String  
Dim strLayerName As String  
Dim iAnswer As Integer  
Set collayers = ActiveDocument.Layers  
For Each objLayer In collayers  
With objLayer  
strMinZoom = .MinZoom  
strMaxZoom = .MaxZoom  
strLayerName = .Name  
iAnswer = MsgBox("Layername: " & strLayerName & vbCrLf & "Min. zoom: " & strMinZoom &  
vbCrLf & "Max. zoom: " & strMaxZoom, vbOKCancel)  
End With  
If vbCancel = iAnswer Then Exit For  
Next objLayer  
End Sub
```

**See also**

[Layer Object \(Page 2001\)](#)

[Editing Layers with VBA \(Page 1657\)](#)

**Modified Property****Description**

TRUE if the source code for a script or picture has been changed. BOOLEAN read access.

**Example:**

In the following example a check will be made on whether the active picture has been changed:

```
Sub CheckModificationOfActiveDocument()  
'VBA645  
Dim strCheck As String  
Dim bModified As Boolean  
bModified = ActiveDocument.Modified  
Select Case bModified  
Case True  
strCheck = "Active document is modified"  
Case False  
strCheck = "Active document is not modified"  
End Select  
MsgBox strCheck  
End Sub
```

**See also**

[ScriptInfo Object \(Page 2058\)](#)

[Document Object \(Page 1949\)](#)

**Moveable Property**

**Description**

TRUE if the ApplicationWindow and PictureWindow objects can be moved in Runtime.  
BOOLEAN write-read access.

**Example:**

The "ApplicationWindowConfig" procedure accesses the properties of the application window.  
In this example it shall be possible to move the application window in Runtime:

```
Sub ApplicationWindowConfig()  
'VBA646  
Dim objAppWindow As HMIApplicationWindow  
Set objAppWindow = ActiveDocument.HMIObjects.AddHMIObject("AppWindow1",  
"HMIApplicationWindow")  
With objAppWindow  
.Moveable = True  
End With  
End Sub
```

**See also**

PictureWindow Object (Page 2029)

ApplicationWindow Object (Page 1911)

**N-O****Name Property****Description**

Returns the name of the object. STRING read access.

**Example:**

The "LayerInfo()" procedure outputs the name and zoom configuration for each layer of the current picture:

```
Sub LayerInfo()  
'VBA647  
Dim collayers As HMILayers  
Dim objLayer As HMILayer  
Dim strMaxZoom As String  
Dim strMinZoom As String  
Dim strLayerName As String  
Dim iAnswer As Integer  
Set collayers = ActiveDocument.Layers  
For Each objLayer In collayers  
With objLayer  
strMinZoom = .MinZoom  
strMaxZoom = .MaxZoom  
strLayerName = .Name  
iAnswer = MsgBox("Layername: " & strLayerName & vbCrLf & "Min. zoom: " & strMinZoom &  
vbCrLf & "Max. zoom: " & strMaxZoom, vbOKCancel)  
End With  
If vbCancel = iAnswer Then Exit For  
Next objLayer  
End Sub
```

**See also**

Trigger Object (Page 2087)

SymbolLibrary Object (Page 2074)

Property Object (Page 2042)

HMIOBJECT Object (Page 1988)

Layer Object (Page 2001)

### 3.6 VBA Reference

FolderItem Object (Page 1972)

Document Object (Page 1949)

Application Object (Page 1909)

#### Name Property (FolderItem)

##### Description

Returns the internal name of the specified object of the "FolderItem" type. Read only access.

##### Example:

In this example the internal name is output for the "PC" object contained in the Global Components Library:

```
Sub ShowInternalNameOfFolderItem()  
'VBA536  
Dim objGlobalLib As HMISymbolLibrary  
Set objGlobalLib = Application.SymbolLibraries(1)  
MsgBox objGlobalLib.FolderItems(2).Folder(2).Folder.Item(1).Name  
End Sub
```

##### See also

FolderItem Object (Page 1972)

Accessing the component library with VBA (Page 1646)

#### NegativeValue Property

##### Description

Use the BinaryResultInfo property to return the BinaryResultInfo object.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned and the associated property values will be assigned to both the binary value ranges:

```
Sub AddDynamicDialogToCircleRadiusTypeBinary()  
'VBA648  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_C", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeBool  
.BinaryResultInfo.NegativeValue = 20  
.BinaryResultInfo.PositiveValue = 40  
End With  
End Sub
```

**See also**

VBA Reference (Page 1745)  
PositiveValue Property (Page 2380)  
BinaryResultInfo Object (Page 1918)

**NibbleSelect property****Description**

Only used internally.

**See also**

AdvancedStateDisplay object (Page 1905)

**Number Property****Description**

Returns the layer number of a "Layer" type object. The counting starts with 1. The first layer, "Layer0", returns the value "0". READ access.

### Example:

This example outputs the name, number and index of a layer:

```
Sub ShowLayerWithNumbers()  
'VBA803  
Dim colLayers As HMIlayers  
Dim objLayer As HMILayer  
Dim iAnswer As Integer  
Dim iIndex As Integer  
iIndex = 1  
Set colLayers = ActiveDocument.Layers  
For Each objLayer In colLayers  
iAnswer = MsgBox("Layername: " & objLayer.Name & vbCrLf & "Layernumber: " & objLayer.Number  
& vbCrLf & "Layersindex: " & iIndex, vbOKCancel)  
iIndex = iIndex + 1  
If vbCancel = iAnswer Then Exit For  
Next objLayer  
End Sub
```

### See also

Layer Object (Page 2001)

## NumberLines Property

### Description

#### TextList

Defines for the "TextList object" how many lines the selection list should contain or returns the value. If the configured lines with their number, font size and font do not fit into the dimensions of the object, a vertical scroll bar is added to the selection list.

#### Combo box and list box

Defines or returns the number of lines of text for the "Combo box" and "List box" objects. You can define a maximum of 32,000 lines.

At the same time, the value of the "Number of rows" attribute specifies the high limit value for the "Index" attribute in the "Font" property group. Changing the value can have the following effects:

- Increasing the number: New lines are added at the bottom. The default labeling of the new filed can be changed using the "Text" attribute in the "Font" property group.
- Reducing the number: All lines are removed for which the value of the "Index" attribute is higher than the new number.

## Example

The "TextListConfiguration()" procedure accesses the properties of the "TextList" object. In this example a selection list is created and the number of visible lines is set to three:

```
Sub TextListConfiguration()
'VBA649
Dim objTextList As HMITextList
'
'Insert new TextList in current picture:
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")
With objTextList
.NumberLines=3
End With
End Sub
```

## See also

TextList Object (Page 2076)

## ObjectName Property

### Description

Depending on the source and destination object types for the direct connection, either defines or returns the name of the constant, object or tag.

The two tables show you when you must use the ObjectName property. A "--" means that the property is assigned an empty string ("") by default when the DirectConnection object is created.

#### Source object type (SourceLink Property)

Type Property	AutomationName Property	ObjectName Property
hmiSourceTypeConstant	--	Name of the constant (e.g. the picture name)
hmiSourceTypeProperty	Property of the source object (e.g. "Top")	Name of the source object (e.g. "Rectangle_A")
hmiSourceTypePropertyOfThisObject	--	--
hmiSourceTypeVariableDirect	--	Tag name
hmiSourceTypeVariableIndirect	--	Tag name

#### Destination object type (DestinationLink Property)

Type Property	AutomationName Property	ObjectName Property
hmiDestTypeProperty	Property of the destination object (e.g. "Left")	Name of the destination object (e.g. "Rectangle_A")
hmiDestTypePropertyOfThisObject	--	--

3.6 VBA Reference

Type Property	AutomationName Property	ObjectName Property
hmiDestTypePropertyOfActual-Window	Property of the destination object (e.g. "Left")	--
hmiDestTypeVariableDirect	--	Tag name
hmiDestTypeVariableIndirect	--	Tag name
hmiDestTypeDirectMessage	--	Tag name
hmiDestTypeIndirectMessage	--	Tag name

**Example:**

In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:

```
Sub DirectConnection()  
'VBA650  
Dim objButton As HMIButton  
Dim objRectangleA As HMIRectangle  
Dim objRectangleB As HMIRectangle  
Dim objEvent As HMIEvent  
Dim objDirConnection As HMIDirectConnection  
Set objRectangleA = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A", "HMIRectangle")  
Set objRectangleB = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objRectangleA  
.Top = 100  
.Left = 100  
End With  
With objRectangleB  
.Top = 250  
.Left = 400  
.BackColor = RGB(255, 0, 0)  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 100  
.Text = "SetPosition"  
End With  
'  
'Directconnection is initiated by mouseclick:  
Set objDirConnection =  
objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectConnection)  
With objDirConnection  
'Sourceobject: Property "Top" of Rectangle_A  
.SourceLink.Type = hmiSourceTypeProperty  
.SourceLink.ObjectName = "Rectangle_A"  
.SourceLink.AutomationName = "Top"  
'  
'Targetobject: Property "Left" of Rectangle_B  
.DestinationLink.Type = hmiDestTypeProperty  
.DestinationLink.ObjectName = "Rectangle_B"  
.DestinationLink.AutomationName = "Left"  
End With  
End Sub
```

**See also**

Type Property (Page 2450)

SourceLink Property (Page 2422)

DestinationLink Property (Page 2211)

### 3.6 VBA Reference

AutomationName Property (Page 2124)

SourceLink Object (Page 2065)

DestLink Object (Page 1945)

## ObjectSizeDecluttering Property

### Description

TRUE, if objects of the specified picture outside of two configured sizes are to be faded out. BOOLEAN write-read access.

Define the size range with the aid of the SetDeclutterObjectSize method.

### Example:

In the following example the settings for the lowest layer are configured in the active picture:

```
Sub ConfigureSettingsOfLayer()  
  'VBA651  
  Dim objLayer As HMIlayer  
  Set objLayer = ActiveDocument.Layers(1)  
  With objLayer  
    'Configure "Layer 0"  
    .MinZoom = 10  
    .MaxZoom = 100  
    .Name = "Configured with VBA"  
  End With  
  'Define fade-in and fade-out of objects:  
  With ActiveDocument  
    .LayerDecluttering = True  
    .ObjectSizeDecluttering = True  
    .SetDeclutterObjectSize 50, 100  
  End With  
End Sub
```

### See also

Document Object (Page 1949)

Editing Layers with VBA (Page 1657)

## OffsetLeft Property

### Description

Defines or returns the distance of the picture from the left edge of the picture window.

**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured

```
Sub PictureWindowConfig()  
'VBA652  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
    .AdaptPicture = False  
    .AdaptSize = False  
    .Caption = True  
    .CaptionText = "Picturewindow in runtime"  
    .OffsetLeft = 5  
    .OffsetTop = 10  
    'Replace the picturename "Test.PDL" with the name of  
    'an existing document from your "GraCS"-Folder of your active project  
    .PictureName = "Test.PDL"  
    .ScrollBars = True  
    .ServerPrefix = ""  
    .TagPrefix = "Struct."  
    .UpdateCycle = 5  
    .Zoom = 100  
End With  
End Sub
```

**See also**

PictureWindow Object (Page 2029)

**OffsetTop Property****Description**

Defines or returns the distance of the picture from the top edge of the picture window.

**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured

```
Sub PictureWindowConfig()  
'VBA653  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
.AdaptPicture = False  
.AdaptSize = False  
.Caption = True  
.CaptionText = "Picturewindow in runtime"  
.OffsetLeft = 5  
.OffsetTop = 10  
'Replace the picturename "Test.PDL" with the name of  
'an existing document from your "GraCS"-Folder of your active project  
.PictureName = "Test.PDL"  
.ScrollBars = True  
.ServerPrefix = ""  
.TagPrefix = "Struct."  
.UpdateCycle = 5  
.Zoom = 100  
End With  
End Sub
```

**See also**

[PictureWindow Object \(Page 2029\)](#)

**OnTop Property**

**Description**

TRUE if the ApplicationWindow object is always in the foreground in Runtime. BOOLEAN write-read access.



**Example:**

The "ApplicationWindowConfig" procedure accesses the properties of the application window. In this example the application window will always be in the foreground in Runtime:

```
Sub ApplicationWindowConfig()  
'VBA654  
Dim objAppWindow As HMIApplicationWindow  
Set objAppWindow = ActiveDocument.HMIObjects.AddHMIObject("AppWindow1",  
"HMIApplicationWindow")  
With objAppWindow  
  .OnTop = True  
End With  
End Sub
```

**See also**

[ApplicationWindow Object \(Page 1911\)](#)

**Operation Property****Description**

TRUE if the object can be used or operated in Runtime. BOOLEAN write-read access.

**Example:**

In this example the status of the operator-control enables will be output for all objects in the active picture:

```
Sub ShowOperationStatusOfAllObjects()  
'VBA655  
Dim objObject As HMIObject  
Dim bStatus As Boolean  
Dim strStatus As String  
Dim strName As String  
Dim iMax As Integer  
Dim iIndex As Integer  
Dim iAnswer As Integer  
iMax = ActiveDocument.HMIObjects.Count  
iIndex = 1  
For iIndex = 1 To iMax  
strName = ActiveDocument.HMIObjects(iIndex).ObjectName  
bStatus = ActiveDocument.HMIObjects(iIndex).Operation  
Select Case bStatus  
Case True  
strStatus = "yes"  
Case False  
strStatus = "no"  
End Select  
iAnswer = MsgBox("Object: " & strName & vbCrLf & "Operator-Control enable: " & strStatus,  
vbOKCancel)  
If vbCancel = iAnswer Then Exit For  
Next iIndex  
If 0 = iMax Then MsgBox "No objects in the active document."  
End Sub
```

**See also**

[HMIObject Object \(Page 1988\)](#)

[Document Object \(Page 1949\)](#)

**OperationMessage Property****Description**

TRUE, if a message should be output upon successful operation. The reason for the operation can only be input if the "OperationReport" property is set to "True". BOOLEAN write-read access.

The operation is sent to the message system, and is archived. Using the message system, a message may be output in a message line, for example.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example, an operation is supposed to be sent to the message system:

```
Sub IOFieldConfiguration()  
'VBA656  
Dim objIOField As HMIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")  
With objIOField  
  .OperationReport = True  
  .OperationMessage = True  
End With  
End Sub
```

**See also**

[OperationReport Property \(Page 2355\)](#)

[TextList Object \(Page 2076\)](#)

[Slider object \(Page 2062\)](#)

[OptionGroup Object \(Page 2025\)](#)

[IOField Object \(Page 1992\)](#)

[CheckBox Object \(Page 1924\)](#)

**OperationReport Property****Description**

TRUE, if the reason for an operation should be recorded. BOOLEAN write-read access.

When the object is used or operated in Runtime, a dialog opens in which the operator can input the reason for the operation in the form of text. The operation is sent to the message system, and is archived.

**Example:**

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example, an operation is supposed to be sent to the message system:

```
Sub IOFieldConfiguration()  
'VBA657  
Dim objIOField As HMIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIOField")  
With objIOField  
.OperationReport = True  
.OperationMessage = True  
End With  
End Sub
```

**See also**

- OperationMessage Property (Page 2354)
- TextList Object (Page 2076)
- Slider object (Page 2062)
- OptionGroup Object (Page 2025)
- IOField Object (Page 1992)
- CheckBox Object (Page 1924)

**Orientation Property**

**Description**

TRUE, when the text in the object should be displayed horizontally. BOOLEAN write-read access.

---

**Note**

It is only the text that is displayed either horizontally or vertically. The position of the object remains unchanged.

---

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the text will be displayed vertically:

```
Sub ButtonConfiguration()  
  'VBA658  
  Dim objButton As HMIButton  
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
  With objButton  
    .Width = 150  
    .Height = 150  
    .Text = "Text is displayed vertical"  
    .Orientation = False  
  End With  
End Sub
```

**See also**

[TextList Object \(Page 2076\)](#)  
[StaticText Object \(Page 2067\)](#)  
[OptionGroup Object \(Page 2025\)](#)  
[IOField Object \(Page 1992\)](#)  
[CheckBox Object \(Page 1924\)](#)  
[Button Object \(Page 1921\)](#)

**OriginalPropertyName property****Description**

Only used internally.

**See also**

[FaceplateObjects object \(Page 1971\)](#)

**OutputFormat Property****Description**

Defines how the output value shall be displayed, or returns the set value. The representation is dependent on the data format.

### Example:

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example, data type "Decimal" will be set for the I/O field: The output value will be displayed with two decimals and three digits to the right of the decimal point:

```
Sub IOFieldConfiguration()  
'VBA659  
Dim objIOField As HMIIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIIOField")  
With objIOField  
    .DataFormat = 1  
    .OutputFormat = "99,999"  
End With  
End Sub
```

### See also

[DataFormat Property \(Page 2210\)](#)

[IOField Object \(Page 1992\)](#)

### OutputValue Property

#### Description

Defines or returns presetting for the value to be displayed.

This value is used in Runtime when the associated tag cannot be connected or updated when a picture is started.

#### Example

The "IOFieldConfiguration()" procedure accesses the properties of the I/O field. In this example, the output value is set to "0":

```
Sub IOFieldConfiguration()  
'VBA660  
Dim objIOField As HMIIIOField  
Set objIOField = ActiveDocument.HMIObjects.AddHMIObject("IOField1", "HMIIIOField")  
With objIOField  
    .OutputValue = "0"  
End With  
End Sub
```

**See also**

TextList Object (Page 2076)

IOField Object (Page 1992)

**OutputValue property****Description**

Specifies the interconnection with any analog / text tag. The analog display represents the value of this tag in the configured colors depending on the alarm state.

**P-Q****PaintColor\_QualityCodeBad property****Description**

Defines the color in which the grid is shown when a poor status exists, for example, if the connection to the server is interrupted.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**PaintColor\_QualityCodeUnCertain property****Description**

Defines the color with which the grid is shown in an uncertain status.

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Parent Property****Description**

Returns the higher-ranking object in the specified object. Read only access.

**Example:**

In the following example a copy of the active picture is created and the name of the picture is then output with the aid of the Parent property:

```
Sub ExampleForParent()  
    'VBA661  
    Dim objView As HMIView  
    Set objView = ActiveDocument.Views.Add  
    MsgBox objView.Parent.Name  
End Sub
```

**See also**

- Toolbars Object (Listing) (Page 2081)
- Menu Object (Page 2009)
- Document Object (Page 1949)
- Views Object (Listing) (Page 2103)
- View Object (Page 2102)
- VariableTriggers Object (Listing) (Page 2101)
- VariableTrigger Object (Page 2099)
- VariableStateValues Object (Listing) (Page 2097)
- VariableStateValue Object (Page 2096)
- Trigger Object (Page 2087)
- ToolbarItems Object (Listing) (Page 2085)
- ToolbarItem Object (Page 2083)
- Toolbar Object (Page 2080)
- TextList Object (Page 2076)
- SymbolLibraries Object (Listing) (Page 2073)
- SymbolLibrary Object (Page 2074)
- StatusDisplay Object (Page 2070)
- StaticText Object (Page 2067)
- SourceLink Object (Page 2065)
- Slider object (Page 2062)
- SelectedObjects object (Listing) (Page 2060)
- ScriptInfo Object (Page 2058)
- RoundRectangle Object (Page 2055)
- RoundButton Object (Page 2052)



Rectangle Object (Page 2049)  
Properties Object (Listing) (Page 2041)  
Property Object (Page 2042)  
PolyLine Object (Page 2038)  
Polygon Object (Page 2035)  
PictureWindow Object (Page 2029)  
PieSegment Object (Page 2032)  
OptionGroup Object (Page 2025)  
OLEObject Object (Page 2023)  
MenuItems Object (Listing) (Page 2015)  
MenuItem Object (Page 2013)  
Menus Object (Listing) (Page 2011)  
Line Object (Page 2004)  
Layers Object (Listing) (Page 2003)  
Layer Object (Page 2001)  
LanguageTexts Object (Listing) (Page 2000)  
LanguageText Object (Page 1999)  
LanguageFonts Object (Listing) (Page 1997)  
LanguageFont Object (Page 1996)  
IOField Object (Page 1992)  
HMIOObjects Object (Listing) (Page 1990)  
HMIOObject Object (Page 1988)  
HMIDefaultObjects Object (Listing) (Page 1985)  
GroupedObjects Object (Listing) (Page 1983)  
GroupDisplay Object (Page 1980)  
Group Object (Page 1978)  
GraphicObject Object (Page 1975)  
FolderItems Object (Listing) (Page 1973)  
FolderItem Object (Page 1972)  
Events Object (Listing) (Page 1967)  
Event Object (Page 1966)  
EllipseSegment Object (Page 1963)  
EllipseArc Object (Page 1960)  
Ellipse Object (Page 1957)  
DynamicDialog Object (Page 1955)

3.6 VBA Reference

- Documents Object (Listing) (Page 1952)
- DirectConnection Object (Page 1947)
- DestLink Object (Page 1945)
- DataLanguages Object (Listing) (Page 1942)
- DataLanguage Object (Page 1941)
- CustomizedObject Object (Page 1938)
- ConnectionPoints Object (Listing) (Page 1936)
- CircularArc Object (Page 1931)
- Circle Object (Page 1928)
- CheckBox Object (Page 1924)
- Button Object (Page 1921)
- BitResultInfo Object (Page 1919)
- BinaryResultInfo Object (Page 1918)
- BarGraph Object (Page 1914)
- ApplicationWindow Object (Page 1911)
- Actions Object (Listing) (Page 1898)
- 3DBarGraph Object (Page 1894)

**ParentCookie property**

**Description**

Only used internally.

**See also**

FaceplateProperty object (Page 1971)

**PasswordLevel Property**

**Description**

Defines the authorization for operation (e.g. no input or no triggering actions) of the object.

<b>PasswordLevel</b>	<b>Assigned Value</b>
<No Access Security>	0
User Administration	1
Value input	2
Process controlling	3
Picture editing	4

PasswordLevel	Assigned Value
Screen change	5
Window selection	6
Hard copy	7
Confirm alarms	8
Lock alarms	9
Free alarms	10
Message editing	11
Start archive	12
Stop archive	13
Edit archive values	14
Archive editing	15
Action editing	16
Project Manager	17
Activate remote	1000
Configure remote	1001
Just monitor	1002

You must first define the operator authorizations in the User Administrator.

### Example:

--

### See also

HMIOject Object (Page 1988)

### Path Property

### Description

Returns the full path of the folder in which the specified picture is stored. Read only access.

### Example:

In this example the path to the folder of the active picture will be output:

```
Sub ShowDocumentPath()
'VBA663
MsgBox ActiveDocument.Path
End Sub
```

## See also

Document Object (Page 1949)

## Pathname Property

### Description

Returns the internal access path to the Components Library for the specified object of the "FolderItem" type. Read only access.

### Example:

In this example the internal access path is output for the "PC" object contained in the Global Components Library:

```
Sub ShowInternalNameOfFolderItem()  
  'VBA664  
  Dim objGlobalLib As HMISymbolLibrary  
  Set objGlobalLib = Application.SymbolLibraries(1)  
  MsgBox objGlobalLib.FolderItems(2).Folder(2).Folder.Item(1).PathName  
End Sub
```

## See also

FolderItem Object (Page 1972)

Accessing the component library with VBA (Page 1646)

## PdIProtection property

### Description

Sets a password for a process picture or faceplate type or deletes the password. Write access.

---

#### Note

##### Significance of the password protection

With the PdIProtection property, you can only assign a password to process pictures or faceplate types to, for example, protect the VBA scripts contained in the pictures against unauthorized access.

---

## Examples

In this example, a password is set for the active picture:

```
Sub ProtectPicture()  
'VBA854  
ActiveDocument.PdlProtection = "Test123"  
End Sub
```

Password protection for the active picture is removed in this example:

```
Sub UnprotectPicture()  
'VBA855  
ActiveDocument.PdlProtection = ""  
End Sub
```

---

### Note

#### Write access only

Read access to the password is prevented due to security reasons.

---

## PicDeactReferenced-Eigenschaft

### Description

TRUE if the picture assigned to the "Deactivated" status is to be saved in the RoundButton object. Otherwise, only the associated object reference is saved. BOOLEAN write-read access.

### Example:

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the picture assigned to the "Deactivated" status will be referenced:

```
Sub RoundButtonConfiguration()  
'VBA665  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
.PicDeactReferenced = False  
End With  
End Sub
```

## See also

RoundButton Object (Page 2052)

## PicDeactTransparent Property

### Description

Defines or returns which color of the bitmap object (.bmp, .dib) assigned to the "Disabled" status should be set to "transparent". LONG write-read access.

The color is only set to "Transparent" if the value of the "PicDeactUseTransColor" property is "True".

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the color "Red" assigned in the Bitmap object is to be displayed transparent when in the "Deactivated" status.

```
Sub RoundButtonConfiguration()  
  'VBA666  
  Dim objRoundButton As HMIRoundButton  
  Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
  With objRoundButton  
    .PicDeactTransparent = RGB(255, 0, 0)  
    .PicDeactUseTransColor = True  
  End With  
End Sub
```

## See also

PicDeactUseTransColor Property (Page 2367)

RoundButton Object (Page 2052)

## PicDeactUseTransColor Property

### Description

TRUE, when the transparent color defined by the "PicDeactTransparent" property for the "Disable" status should be used. BOOLEAN write-read access.

### Example:

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the color "Red" assigned in the Bitmap object is to be displayed transparent when in the "Deactivated" status:

```
Sub RoundButtonConfiguration()  
'VBA667  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
    .PicDeactTransparent = RGB(255, 0, 0)  
    .PicDeactUseTransColor = True  
End With  
End Sub
```

### See also

[PicDeactTransparent Property \(Page 2366\)](#)

[RoundButton Object \(Page 2052\)](#)

## PicDownReferenced Property

### Description

TRUE if the picture assigned to the "On" status is to be saved in the RoundButton object. Otherwise, only the associated object reference is saved. BOOLEAN write-read access.

**Example:**

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the picture assigned to the "On" status will be referenced:

```
Sub RoundButtonConfiguration()  
'VBA668  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
    .PicDownReferenced = False  
End With  
End Sub
```

**See also**

RoundButton Object (Page 2052)

**PicDownTransparent Property**

**Description**

Defines or returns which color of the bitmap object (.bmp, .dib) assigned to the "On" status should be set to "transparent". LONG write-read access.

The color is only set to "Transparent" if the value of the "PicDownUseTransColor" property is "True".

**Determination of Color Value**

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)



**Example:**

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the color "Yellow" assigned in the Bitmap object is to be displayed transparent when in the "Deactivated" status.

```
Sub RoundButtonConfiguration()  
'VBA669  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
.PicDownTransparent = RGB(255, 255, 0)  
.PicDownUseTransColor = True  
End With  
End Sub
```

**See also**

[PicDownUseTransColor Property \(Page 2369\)](#)

[RoundButton Object \(Page 2052\)](#)

**PicDownUseTransColor Property****Description**

TRUE, when the transparent color defined by the "PicDownTransparent" property for the "On" status should be used. BOOLEAN write-read access.

**Example:**

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the color "Yellow" assigned in the Bitmap object is to be displayed transparent when in the "Deactivated" status:

```
Sub RoundButtonConfiguration()  
'VBA670  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
.PicDownTransparent = RGB(255, 255, 0)  
.PicDownUseTransColor = True  
End With  
End Sub
```

## See also

PicDownTransparent Property (Page 2368)

RoundButton Object (Page 2052)

## PicReferenced Property

### Description

TRUE if the picture assigned to the GraphicObject object is to be referenced and not saved in the object. BOOLEAN write-read access.

### Example:

The "GraphicObjectConfiguration()" procedure accesses the properties of the graphics object. In this example the assigned picture will be referenced:

```
Sub GraphicObjectConfiguration()  
'VBA671  
Dim objGraphicObject As HMIGraphicObject  
Set objGraphicObject = ActiveDocument.HMIObjects.AddHMIObject("GraphicObject1",  
"HMIGraphicObject")  
With objGraphicObject  
.PicReferenced = True  
End With  
End Sub
```

## See also

GraphicObject Object (Page 1975)

## PictAlignment property

### Description

As the "Picture alignment" attribute, it defines the position and scaling of the picture placed on the button or round button.

centered	The picture is positioned, centered in the original proportions.
Left justified	The picture is positioned with original proportions, with left justification on the left side of the button.
Right justified	The picture is positioned with original proportions, with right justification on the right side of the button.
Stretched	The picture is scaled to a square and is adapted to the size of the button.

## PicTransparentColor Property

### Description

Defines or returns which color of the assigned bitmap object (.bmp, .dib) should be set to "transparent". LONG write-read access.

The color is only set to "Transparent" if the value of the "PicUseTransparentColor" property is "True".

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "GraphicObjectConfiguration()" procedure accesses the properties of the graphics object. In this example the color "Blue" assigned in the Bitmap object is to be displayed transparent:

```
Sub GraphicObjectConfiguration()  
'VBA672  
Dim objGraphicObject As HMIGraphicObject  
Set objGraphicObject = ActiveDocument.HMIObjects.AddHMIObject("GraphicObject1",  
"HMIGraphicObject")  
With objGraphicObject  
.PicTransparentColor = 16711680  
.PicUseTransparentColor = True  
End With  
End Sub
```

### See also

GraphicObject Object (Page 1975)

## PictureDeactivated Property

### Description

Defines the picture to be displayed in the "Disable" status or returns the picture name.

The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

### Example:

The "ButtonConfiguration()" procedure accesses the properties of the round button. In this example the pictures for the "On" and "Off" states will be defined:

```
Sub ButtonConfiguration()  
'VBA673  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
,  
'Toi use this example copy a Bitmap-Graphic  
'to the "GraCS"-Folder of the actual project.  
'Replace the picturename "TestPicture1.BMP" with the name of  
'the picture you copied  
.PictureDeactivated = "TestPicture1.BMP"  
End With  
End Sub
```

### See also

[RoundButton Object \(Page 2052\)](#)

[PicReferenced Property \(Page 2370\)](#)

### PictureDown Property

#### Description

Defines the picture to be displayed in the "On" status or returns the picture name.

The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the round button. In this example the pictures for the "On" and "Off" states will be defined:

```
Sub ButtonConfiguration()  
'VBA674  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
'  
'To use this example copy two Bitmap-Graphics  
'to the "GraCS"-Folder of the actual project.  
'Replace the picturenames "TestPicture1.BMP" and "TestPicture2.BMP"  
'with the names of the pictures you copied  
.PictureDown = "TestPicture1.BMP"  
.PictureUp = "TestPicture2.BMP"  
End With  
End Sub
```

**See also**

[RoundButton Object \(Page 2052\)](#)

**PictureName Property****Description**

Defines the picture to be displayed in the picture window in Runtime or returns the picture name.

The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured:

```
Sub PictureWindowConfig()  
'VBA675  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
.AdaptPicture = False  
.AdaptSize = False  
.Caption = True  
.CaptionText = "Picturewindow in runtime"  
.OffsetLeft = 5  
.OffsetTop = 10  
'Replace the picturename "Test.PDL" with the name of  
'an existing document from your "GraCS"-Folder of your active project  
.PictureName = "Test.PDL"  
.ScrollBars = True  
.ServerPrefix = ""  
.TagPrefix = "Struct."  
.UpdateCycle = 5  
.Zoom = 100  
End With  
End Sub
```

**See also**

[PictureWindow Object \(Page 2029\)](#)

**PictureUp Property**

**Description**

Defines the picture to be displayed in the "Off" status or returns the picture name.

The picture (\*.BMP or \*.DIB) must be located in the "GraCS" directory of the current project so that it can be integrated.

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the pictures for the "On" and "Off" states will be defined:

```
Sub ButtonConfiguration()  
'VBA676  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")  
With objButton  
'  
'To use this example copy two Bitmap-Graphics  
'to the "GraCS"-Folder of the actual project.  
'Replace the picturenames "TestPicture1.BMP" and "TestPicture2.BMP"  
'with the names of the pictures you copied  
.PictureDown = "TestPicture1.BMP"  
.PictureUp = "TestPicture2.BMP"  
End With  
End Sub
```

**See also**

[RoundButton Object \(Page 2052\)](#)

[Button Object \(Page 1921\)](#)

**PicUpReferenced Property****Description**

TRUE if the picture assigned to the "Off" status is to be saved in the RoundButton object. Otherwise, only the associated object reference is saved. BOOLEAN write-read access.

**Example:**

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the picture assigned to the "Off" status will be referenced:

```
Sub RoundButtonConfiguration()  
'VBA677  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
.PicUpReferenced = False  
End With  
End Sub
```

## See also

[RoundButton Object \(Page 2052\)](#)

## PicUpTransparent Property

### Description

Defines or returns which color of the bitmap object (.bmp, .dib) assigned to the "Off" status should be set to "transparent". LONG write-read access.

The color is only set to "Transparent" if the value of the "PicUpUseTransColor" property is "True".

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the color "Blue" assigned in the Bitmap object is to be displayed transparent in the status "Off".

```
Sub RoundButtonConfiguration()  
    'VBA678  
    Dim objRoundButton As HMIRoundButton  
    Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
    With objRoundButton  
        .PicUpTransparent = RGB(0, 0, 255)  
        .PicUpUseTransColor = True  
    End With  
End Sub
```

## See also

[PicUpUseTransColor Property \(Page 2377\)](#)

[RoundButton Object \(Page 2052\)](#)



## PicUpUseTransColor Property

### Description

TRUE, when the transparent color defined by the "PicUpTransparent" property for "Off" status should be used. BOOLEAN write-read access.

### Example:

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the color "Blue" assigned in the Bitmap object is to be displayed transparent in the status "Off":

```
Sub RoundButtonConfiguration()  
'VBA679  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
    .PicUpTransparent = RGB(0, 0, 255)  
    .PicUpUseTransColor = True  
End With  
End Sub
```

### See also

[PicUpTransparent Property \(Page 2376\)](#)

[RoundButton Object \(Page 2052\)](#)

## PicUseTransColor Property

### Description

TRUE if the transparent color defined with the "PicTransColor" property is to be used for the "Deactivated" status. BOOLEAN write-read access.

**Example:**

The "GraphicObjectConfiguration()" procedure accesses the properties of the graphics object. In this example the color "Blue" assigned in the Bitmap object is to be displayed transparent:

```
Sub GraphicObjectConfiguration()  
  'VBA680  
  Dim objGraphicObject As HMIGraphicObject  
  Set objGraphicObject = ActiveDocument.HMIObjects.AddHMIObject("GraphicObject1",  
  "HMIGraphicObject")  
  With objGraphicObject  
    .PicTransColor = RGB(0, 0, 255)  
    .PicUseTransColor = True  
  End With  
End Sub
```

**See also**

- PicTransColor Property (Page 2371)
- GraphicObject Object (Page 1975)

**Pinnable property**

**Description**

Only used internally.

**See also**

- PictureWindow Object (Page 2029)

**Pinned property**

**Description**

Only used internally.

**See also**

- PictureWindow Object (Page 2029)

## PointCount Property

### Description

Defines or returns the number of corner points in the case of the Polygon and Polyline objects. Each corner point has position coordinates and is identified via an index.

### Example:

For this example to work, insert a polyline called "Polyline1" into the active picture: The "PolyLineCoordsOutput" procedure then outputs the coordinates of all the corner points in the polyline:

```
Sub PolyLineCoordsOutput()  
'VBA681  
Dim iPcIndex As Integer  
Dim iPosX As Integer  
Dim iPosY As Integer  
Dim iIndex As Integer  
Dim objPolyLine As HMIPolyLine  
Set objPolyLine = Application.ActiveDocument.HMIObjects.AddHMIObject("PolyLine1",  
"HMIPolyLine")  
  
'  
'Determine number of corners from "PolyLine1":  
iPcIndex = objPolyLine.PointCount  
'  
'Output of x/y-coordinates from every corner:  
For iIndex = 1 To iPcIndex  
With objPolyLine  
.index = iIndex  
iPosX = .ActualPointLeft  
iPosY = .ActualPointTop  
MsgBox iIndex & ". corner:" & vbCrLf & "x-coordinate: " & iPosX & vbCrLf & "y-coordinate:  
& iPosY  
End With  
Next iIndex  
End Sub
```

List of links

### See also

- [Index Property \(Page 2276\)](#)
- [ActualPointTop Property \(Page 2110\)](#)
- [ActualPointLeft Property \(Page 2109\)](#)
- [PolyLine Object \(Page 2038\)](#)
- [Polygon Object \(Page 2035\)](#)

## Position Property

### Description

The value for position determines the sequence, in which menu entries and icons are assigned in user-defined menus and toolbars or how user-defined menus are arranged in the menu bar. Write/Read access.

A value of "1" means position 1 (start).

### Example:

In the following example the position of all menu entries in the first user-defined menu in the active picture will be output: So that this example will work, first carry out the example shown under the heading "InsertSubMenu".

```
Sub ShowPositionOfCustomMenuItems()  
'VBA683  
Dim objMenu As HMIMenu  
Dim iMaxMenuItems As Integer  
Dim iPosition As Integer  
Dim iIndex As Integer  
Set objMenu = ActiveDocument.CustomMenus(1)  
iMaxMenuItems = objMenu.MenuItems.Count  
For iIndex = 1 To iMaxMenuItems  
iPosition = objMenu.MenuItems(iIndex).Position  
MsgBox "Position of the " & iIndex & ". menuitem: " & iPosition  
Next iIndex  
End Sub
```

### See also

[ToolbarItem Object \(Page 2083\)](#)

[MenuItem Object \(Page 2013\)](#)

[Menu Object \(Page 2009\)](#)

[InsertSubMenu Method \(Page 1854\)](#)

## PositiveValue Property

### Description

Defines the value for the dynamic property if the configured tag returns a non-zero value, or returns the value.

**Example:**

Use the BinaryResultInfo property to return the BinaryResultInfo object. In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned and the associated property values will be assigned to both the binary value ranges:

```
Sub AddDynamicDialogToCircleRadiusTypeBool()
'VBA684
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_C", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeBool
.BinaryResultInfo.NegativeValue = 20
.BinaryResultInfo.PositiveValue = 40
End With
End Sub
```

**See also**

NegativeValue Property (Page 2344)  
BinaryResultInfo Object (Page 1918)  
VBA Reference (Page 1745)

**PredefinedAngels Property****Description**

Defines or returns the depth of the display of the 3DBarGraph object. Value range from 0 to 3.

Display	Assigned Value
Cavalier	0
Isometric	1
Axonometric	2
Freely Defined	3

**Example:**

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the depth display will be set to "Isometric":

```
Sub HMI3DBarGraphConfiguration()  
'VBA685  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
'Depth-angle a = 15 degrees  
.AngleAlpha = 15  
.PredefinedAngles = 1  
'Depth-angle b = 45 degrees  
.AngleBeta = 45  
End With  
End Sub
```

**See also**

3DBarGraph Object (Page 1894)

**Pressed Property**

**Description**

TRUE, when the Button or RoundButton object is pressed. BOOLEAN write-read access.

**Example:**

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the RoundButton object will be set to "Pressed":

```
Sub RoundButtonConfiguration()  
'VBA686  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
.Pressed = True  
End With  
End Sub
```

**See also**

RoundButton Object (Page 2052)

## PrioAlarm..Warning property

### Description

Specifies the priority at one of the following states or message types:

- Alarm
- Warning
- Tolerance
- AS Process Control Error
- AS Control System Fault
- Operator request

## PrioBit16..31 property

### Description

The property indicates the priority of the respective bit in the group value for the alarm evaluation for the advanced analog and status display. The alarm evaluation starts at the highest priority (priority 1). Bits that are not used for the alarm evaluation are assigned priority 0.

If the group value contains multiple bits, the priority determines which status is displayed.

## Process Property

### Description

Defines or returns presetting for the value to be displayed.

This value is used in Runtime when the associated tag cannot be connected or updated when a picture is started.

**Example:**

The "HMI3DBarGraphConfiguration()" procedure accesses the properties of the 3DBarGraph object. In this example the default value will be set to "100":

```
Sub HMI3DBarGraphConfiguration()  
'VBA687  
Dim obj3DBar As HMI3DBarGraph  
Set obj3DBar = ActiveDocument.HMIObjects.AddHMIObject("3DBar1", "HMI3DBarGraph")  
With obj3DBar  
'Depth-angle a = 15 degrees  
.AngleAlpha = 15  
'Depth-angle b = 45 degrees  
.AngleBeta = 45  
.Process = 100  
End With  
End Sub
```

**See also**

- Slider object (Page 2062)
- OptionGroup Object (Page 2025)
- CheckBox Object (Page 1924)
- BarGraph Object (Page 1914)
- 3DBarGraph Object (Page 1894)

**Process property**

**Description**

Here the first tag is stored that is used for status value calculation for the "HMIAdvancedStateDisplay" object.

Use the "BitPosition0..3" properties to specify the bit position of these tags that is taken into account for the status value calculation. This results in the statuses to which you can then assign pictures.

**Process1 property**

**Description**

Here the second tag is stored that is used for status value calculation for the "HMIAdvancedStateDisplay" object.



Use the "BitPosition0..3" properties to specify the bit position of these tags that is taken into account for the status value calculation. This results in the statuses to which you can then assign pictures.

### Process2 property

#### Description

Here the third tag is stored that is used for status value calculation for the "HMIAdvancedStateDisplay" object.

Use the "BitPosition0..3" properties to specify the bit position of these tags that is taken into account for the status value calculation. This results in the statuses to which you can then assign pictures.

### Process3 property

#### Description

Here the fourth tag is stored that is used for status value calculation for the "HMIAdvancedStateDisplay" object.

Use the "BitPosition0..3" properties to specify the bit position of these tags that is taken into account for the status value calculation. This results in the statuses to which you can then assign pictures.

### ProfileName Property

#### Description

Returns the name of the specified application. Read only access.

#### Example:

In this example the name of the "Graphics Designer" application will be output:

```
Sub ShowProfileName()  
    'VBA688  
    MsgBox Application.ProfileName  
End Sub
```

#### See also

Application Object (Page 1909)

## ProgID Property

### Description

Returns the ProgID of an ActiveX Control. STRING read access.

### Example:

In the following example the ActiveX Control "WinCC Gauge Control" is inserted in the active picture. The ProgID is then output:

```
Sub AddActiveXControl()  
'VBA689  
Dim objActiveXControl As HMIActiveXControl  
Set objActiveXControl = ActiveDocument.HMIObjects.AddActiveXControl("WinCC_Gauge",  
"XGAUGE.XGaugeCtrl.1")  
With ActiveDocument  
.HMIObjects("WinCC_Gauge").Top = 40  
.HMIObjects("WinCC_Gauge").Left = 40  
MsgBox "ProgID of ActiveX-control: " & .HMIObjects("WinCC_Gauge").ProgID  
End With  
End Sub
```

### See also

[ActiveXControl Object \(Page 1900\)](#)

[AddActiveXControl Method \(Page 1795\)](#)

## ProjectName Property

### Description

Returns the project name. Read access.

**Example:**

In this example the name and type of the loaded project will be output.

```
Sub ShowProjectInfo()  
'VBA690  
Dim iProjectType As Integer  
Dim strProjectName As String  
Dim strProjectType As String  
iProjectType = Application.ProjectType  
strProjectName = Application.ProjectName  
Select Case iProjectType  
Case 0  
strProjectType = "Single-User System"  
Case 1  
strProjectType = "Multi-User System"  
Case 2  
strProjectType = "Client System"  
End Select  
MsgBox "Projecttype: " & strProjectType & vbCrLf & "Projectname: " & strProjectName  
End Sub
```

**See also**

Application Object (Page 1909)

**ProjectType Property****Description**

Returns the project type. Value range from 0 to 2. Read access.

Project type	Assigned Value
Single-user project	0
Multi-user project	1
client project	2

### Example:

In this example the name and type of the loaded project will be output:

```
Sub ShowProjectInfo()  
'VBA691  
Dim iProjectType As Integer  
Dim strProjectName As String  
Dim strProjectType As String  
iProjectType = Application.ProjectType  
strProjectName = Application.ProjectName  
Select Case iProjectType  
Case 0  
strProjectType = "Single-User System"  
Case 1  
strProjectType = "Multi-User System"  
Case 2  
strProjectType = "Client System"  
End Select  
MsgBox "Projecttype: " & strProjectType & vbCrLf & "Projectname: " & strProjectName  
End Sub
```

### See also

[Application Object \(Page 1909\)](#)

## Properties Property

### Description

Returns a Properties listing containing all the properties of the specified object. Read only access.

To return an element from the Properties listing you can use either the index number or the name of the VBA property.

You must use the Properties property if, for example, you wish to access the properties of objects located in a group object.

### Example:

Examples showing how to use the Properties property can be found in this documentation under the following headings:

- "Editing Objects with VBA"
- "Group objects"
- "Customized Objects"

## See also

HMIOBJECT Object (Page 1988)  
Customized Objects (Page 1682)  
Group Objects (Page 1674)  
Editing Objects with VBA (Page 1660)

## Prototype Property

### Description

Returns the function heading of a script. The function heading is assigned by default if no source code is configured.

### Example:

In the following example a button and a circle will be inserted in the active picture. In Runtime the radius of the circle will enlarge every time you click the button. In this case only the prototype of the VB script is output:

```
Sub ExampleForPrototype()  
'VBA692  
Dim objButton As HMIButton  
Dim objCircleA As HMICircle  
Dim objEvent As HMIEvent  
Dim objVBScript As HMIScriptInfo  
Set objCircleA = ActiveDocument.HMIObjects.AddHMIObject("CircleA", "HMICircle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objCircleA  
.Top = 100  
.Left = 100  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 200  
.Text = "Increase Radius"  
End With  
'On every mouseclick the radius have to increase:  
Set objEvent = objButton.Events(1)  
Set objVBScript = objButton.Events(1).Actions.AddAction(hmiActionCreationTypeVBScript)  
MsgBox objVBScript.Prototype  
End Sub
```

## See also

ScriptInfo Object (Page 2058)

## QualityCodeStateChecked Properties

### Description

TRUE, if the quality code of the specified tag is used in Dynamic dialog for dynamization.  
BOOLEAN write-read access.

**Example:**

In the following example the radius of a circle is given dynamics with the Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA816
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[DynamicDialog Object \(Page 1955\)](#)

## QualityCodeStateValues Property

### Description

Returns the QualityCodeStateValues listing. Use the QualityCodeStateValues property with the Item property to assign a value to the quality code status to be used for dynamization.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA817
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[DynamicDialog Object \(Page 1955\)](#)

[QualityCodeStateValues Object \(Listing\) \(Page 2046\)](#)

## R

### Radius Property

#### Description

Defines or returns the radius in the case of the following objects:

- Circle: Radius in pixels (0 to 10000)
- CircularArc: Radius in pixels (0 to 10000)
- PieSegment: Radius in pixels (0 to 10000)
- RoundButton: Radius in pixels (0 to 10000)

#### Example:

The "PieSegmentConfiguration()" procedure accesses the properties of the Pie Segment. In this example the radius will be set to "80":

```
Sub PieSegmentConfiguration()  
'VBA693  
Dim objPieSegment As HMIPieSegment  
Set objPieSegment = ActiveDocument.HMIObjects.AddHMIObject("PieSegment1", "HMIPieSegment")  
With objPieSegment  
.StartAngle = 40  
.EndAngle = 180  
.Radius = 80  
End With  
End Sub
```

#### See also

[RoundButton Object \(Page 2052\)](#)

[PieSegment Object \(Page 2032\)](#)

[CircularArc Object \(Page 1931\)](#)

[Circle Object \(Page 1928\)](#)

### RadiusHeight Property

#### Description

Defines or returns the vertical radius in pixels (0 to 5000) in the case of elliptical objects (Ellipse, EllipseArc, EllipseSegment).

**Example:**

The "EllipseConfiguration()" procedure accesses the properties of the ellipse object. In this example the horizontal radius will be set to "60":

```
Sub EllipseConfiguration()  
'VBA694  
Dim objEllipse As HMIEllipse  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("Ellipse1", "HMIEllipse")  
With objEllipse  
.RadiusHeight = 60  
.RadiusWidth = 40  
End With  
End Sub
```

**See also**

[RadiusWidth Property \(Page 2395\)](#)

[EllipseSegment Object \(Page 1963\)](#)

[EllipseArc Object \(Page 1960\)](#)

[Ellipse Object \(Page 1957\)](#)

**RadiusWidth Property****Description**

Defines or returns the horizontal radius in pixels (0 to 5000) in the case of elliptical objects (Ellipse, EllipseArc, EllipseSegment).

**Example:**

The "EllipseConfiguration()" procedure accesses the properties of the ellipse object. In this example the horizontal radius will be set to "40":

```
Sub EllipseConfiguration()  
'VBA695  
Dim objEllipse As HMIEllipse  
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("Ellipse1", "HMIEllipse")  
With objEllipse  
.RadiusHeight = 60  
.RadiusWidth = 40  
End With  
End Sub
```

### See also

- RadiusHeight Property (Page 2394)
- EllipseSegment Object (Page 1963)
- EllipseArc Object (Page 1960)
- Ellipse Object (Page 1957)

## RangeTo Property

### Description

Defines or returns the analog value range.

### Example:

An example showing how to use the RangeTo property can be found in this documentation under the heading "AnalogResultInfos Object (Listing)".

### See also

- Value Property (Page 2469)
- AnalogResultInfos Object (Listing) (Page 1908)
- AnalogResultInfo Object (Page 1907)

## ReferenceRotationLeft Property

### Description

Defines or returns the X-coordinate of the reference point about which the object should be rotated in Runtime.

The value of the X-coordinate is relative to the object width. Enter the value in percent starting from the left edge of the rectangle enclosing the object.

**Example:**

The "PolyLineConfiguration()" procedure accesses the properties of the PolyLine object. In this example, the coordinates of the reference point will be set to 50% of the object width and 50% of the object height:

```
Sub PolyLineConfiguration()  
'VBA696  
Dim objPolyLine As HMIPolyLine  
Set objPolyLine = ActiveDocument.HMIObjects.AddHMIObject("PolyLine1", "HMIPolyLine")  
With objPolyLine  
.ReferenceRotationLeft = 50  
.ReferenceRotationTop = 50  
End With  
End Sub
```

**See also**

[RotationAngle Property \(Page 2400\)](#)  
[ReferenceRotationTop Property \(Page 2397\)](#)  
[PolyLine Object \(Page 2038\)](#)  
[Polygon Object \(Page 2035\)](#)  
[Line Object \(Page 2004\)](#)

**ReferenceRotationTop Property****Description**

Defines or returns the Y-coordinate of the reference point about which the object should be rotated in Runtime.

The value of the Y-coordinate is relative to the object width. Enter the value in percent starting from the top edge of the rectangle enclosing the object.

### Example:

The "PolyLineConfiguration()" procedure accesses the properties of the PolyLine object. In this example, the coordinates of the reference point will be set to 50% of the object width and 50% of the object height:

```
Sub PolyLineConfiguration()  
'VBA697  
Dim objPolyLine As HMIPolyLine  
Set objPolyLine = ActiveDocument.HMIObjects.AddHMIObject("PolyLine1", "HMIPolyLine")  
With objPolyLine  
  .ReferenceRotationLeft = 50  
  .ReferenceRotationTop = 50  
End With  
End Sub
```

### See also

- RotationAngle Property (Page 2400)
- ReferenceRotationLeft Property (Page 2396)
- PolyLine Object (Page 2038)
- Polygon Object (Page 2035)
- Line Object (Page 2004)

### Relevant Property

### Description

TRUE when the "GroupDisplay", "AdvancedAnalogDisplay" or "AdvancedStateDisplay" object is taken into account when forming the group display. BOOLEAN write-read access.

### Example

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example the object for forming the group display will be considered:

```
Sub GroupDisplayConfiguration()  
'VBA698  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
  .Relevant = True  
End With  
End Sub
```

**See also**

Group Object (Page 1978)

**ResultType Property****Description**

Defines or returns the value range evaluation type in the Dynamic dialog.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog, a tag name will be assigned and the associated property values will be assigned to both the binary value ranges:

```
Sub AddDynamicDialogToCircleRadiusTypeBinary()  
'VBA699  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_C", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeBool  
.BinaryResultInfo.NegativeValue = 20  
.BinaryResultInfo.PositiveValue = 40  
End With  
End Sub
```

**See also**

DynamicDialog Object (Page 1955)

**RightComma Property****Description**

Defines or returns the number of decimal places (0 to 20) for the BarGraph object.

**Example:**

The "BarGraphConfiguration()" procedure configures In this example the number of decimal places will be limited to 4.

```
Sub BarGraphConfiguration()  
'VBA700  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
.RightComma = 4  
End With  
End Sub
```

**See also**

BarGraph Object (Page 1914)

**RotationAngle Property**

**Description**

**Line, Polygon and PolyLine**

Defines or returns the rotation angle of the following objects in degrees: Line, Polygon, PolyLine.

The object is displayed in Runtime only rotated clockwise around the reference point by the specified value (starting from the configured starting position).

**T-piece**

Defines or returns the orientation of a T-piece in degrees. The attribute can only assume one of four values:

- 0 The standard position of the T-piece is the shape of the letter "T"
- 90 The "leg" of the "T" points towards the left
- 180 The "leg" of the "T" points upwards
- 270 The "leg" of the "T" points to the right

Other values are automatically converted to modulus 360 and rounded up or down to the nearest permissible value.

The T-piece is shown rotated around the center point in the project and in Runtime.



**Example:**

The "PolyLineConfiguration()" procedure accesses the properties of the PolyLine object. In this example the object will be rotated by 45° in Runtime:

```
Sub PolyLineConfiguration()  
'VBA701  
Dim objPolyLine As HMIPolyLine  
Set objPolyLine = ActiveDocument.HMIObjects.AddHMIObject("PolyLine1", "HMIPolyLine")  
With objPolyLine  
    .ReferenceRotationLeft = 50  
    .ReferenceRotationTop = 50  
    .RotationAngle = 45  
End With  
End Sub
```

**See also**

[ReferenceRotationTop Property \(Page 2397\)](#)

[ReferenceRotationLeft Property \(Page 2396\)](#)

[PolyLine Object \(Page 2038\)](#)

[Polygon Object \(Page 2035\)](#)

[Line Object \(Page 2004\)](#)

**RoundCornerHeight Property****Description**

Defines or returns the corner radius of the RoundRectangle object.

Enter the value as a percentage of half the height of the object.

**Example:**

The "RoundRectangleConfiguration()" procedure accesses the properties of the object RoundRectangle. In this example the corner radius will be set to 25% (height) and 50% (width).

```
Sub RoundRectangleConfiguration()  
'VBA702  
Dim objRoundRectangle As HMIRoundRectangle  
Set objRoundRectangle = ActiveDocument.HMIObjects.AddHMIObject("RoundRectangle1",  
"HMIRoundRectangle")  
With objRoundRectangle  
.RoundCornerHeight = 25  
.RoundCornerWidth = 50  
End With  
End Sub
```

**See also**

[RoundCornerWidth Property \(Page 2402\)](#)

[RoundRectangle Object \(Page 2055\)](#)

**RoundCornerWidth Property**

**Description**

Defines or returns the corner radius of the RoundRectangle object.

Enter the value as a percentage of half the width of the object.

**Example:**

The "RoundRectangleConfiguration()" procedure accesses the properties of the object RoundRectangle. In this example the corner radius will be set to 25% (height) and 50% (width):

```
Sub RoundRectangleConfiguration()  
'VBA703  
Dim objRoundRectangle As HMIRoundRectangle  
Set objRoundRectangle = ActiveDocument.HMIObjects.AddHMIObject("RoundRectangle1",  
"HMIRoundRectangle")  
With objRoundRectangle  
.RoundCornerHeight = 25  
.RoundCornerWidth = 50  
End With  
End Sub
```

## See also

RoundCornerHeight Property (Page 2401)

RoundRectangle Object (Page 2055)

## S

### SameSize Property

#### Description

TRUE, when all four buttons of a Group Display object have the same size. BOOLEAN write-read access.

#### Example:

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example all four buttons will have the same size.

```
Sub GroupDisplayConfiguration()  
  'VBA704  
  Dim objGroupDisplay As HMIGroupDisplay  
  Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
  "HMIGroupDisplay")  
  With objGroupDisplay  
    .SameSize = True  
  End With  
End Sub
```

## See also

GroupDisplay Object (Page 1980)

### ScaleColor Property

#### Description

Defines or returns the color of the scale. LONG write-read access.

The "Scaling" property must be set to TRUE for the color to be displayed.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "BarGraphConfiguration()" procedure configures In this example the scale will be displayed and the scale color will be set to "Red":

```
Sub BarGraphConfiguration()  
'VBA705  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
  .Scaling = True  
  .ScaleColor = RGB(255, 0, 0)  
End With  
End Sub
```

**See also**

- Scaling Property (Page 2405)
- BarGraph Object (Page 1914)

**ScaleTicks Property**

**Description**

Defines or returns the number of scale sections for the BarGraph object.

A scale section is a part of the scale bounded by two long scale strokes or division ticks. If you assign a value of "0" to the property, the appropriate scale marks will be calculated automatically.

**Example:**

The "BarGraphConfiguration()" procedure configures In this example the number of scale sections will be set to "10".

```
Sub BarGraphConfiguration()  
'VBA706  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
  .Scaling = True  
  .ScaleTicks = 10  
End With  
End Sub
```

**See also**

BarGraph Object (Page 1914)

**Scaling Property****Description**

TRUE if a scale is also used to display the values in the case of the BarGraph object. BOOLEAN write-read access.

**Example:**

The "BarGraphConfiguration()" procedure configures the properties of the BarGraph object. In this example the scale will be displayed and the scale color will be set to "Red":

```
Sub BarGraphConfiguration()  
'VBA707  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
    .Scaling = True  
    .ScaleColor = RGB(255, 0, 0)  
End With  
End Sub
```

**See also**

BarGraph Object (Page 1914)

**ScalingMode property****Description**

Defines the size to display the objects of the faceplate instance.

Default	Like scaling mode "proportional"
1 : 1	The faceplate type is displayed in the original size in the faceplate instance. If the faceplate instance is too small, the size of the faceplate instance is adapted to the size of the faceplate type.
Proportional	The faceplate type is scaled in proportion with the size of the faceplate instance.

## Example

### ScalingType Property

#### Description

Defines or returns the type of bar scaling. Value range from 0 to 2.

The "Scaling" property must be set to TRUE for the color to be displayed.

Bar Scaling	Assigned Value
Linear	0
Logarithmic	1
Automatic	2

#### Example:

The "BarGraphConfiguration()" procedure configures In this example the bar scaling will be set to "Linear":

```
Sub BarGraphConfiguration()  
  'VBA708  
  Dim objBarGraph As HMIBarGraph  
  Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
  With objBarGraph  
    .ScalingType = 0  
    .Scaling = True  
  End With  
End Sub
```

#### See also

[Scaling Property \(Page 2405\)](#)

[BarGraph Object \(Page 1914\)](#)

## ScriptType Property

### Description

Returns the script type (C or VBS) which was used to make a property or event dynamic. Read only access.

### Example:

In the following example a button and a circle will be inserted in the active picture. In Runtime the radius of the circle will enlarge every time you click the button. In this case the script type will be output:

```
Sub ExampleForPrototype()  
'VBA709  
Dim objButton As HMIButton  
Dim objCircleA As HMICircle  
Dim objEvent As HMIEvent  
Dim objVBScript As HMIScriptInfo  
Dim strScriptType As String  
Set objCircleA = ActiveDocument.HMIObjects.AddHMIObject("CircleA", "HMICircle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objCircleA  
.Top = 100  
.Left = 100  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 200  
.Text = "Increase Radius"  
End With  
'On every mouseclick the radius have to increase:  
Set objEvent = objButton.Events(1)  
Set objVBScript = objButton.Events(1).Actions.AddAction(hmiActionCreationTypeVBScript)  
Select Case objVBScript.ScriptType  
Case 0  
strScriptType = "VB script is used"  
Case 1  
strScriptType = "C-Skript is used"  
End Select  
MsgBox strScriptType  
End Sub
```

### See also

[ScriptInfo Object \(Page 2058\)](#)

## ScrollBars Property

### Description

TRUE if the picture window has scroll bars in Runtime. BOOLEAN write-read access.

### Example:

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured:

```
Sub PictureWindowConfig()  
'VBA710  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
.AdaptPicture = False  
.AdaptSize = False  
.Caption = True  
.CaptionText = "Picturewindow in runtime"  
.OffsetLeft = 5  
.OffsetTop = 10  
'Replace the picturename "Test.PDL" with the name of  
'an existing document from your "GraCS"-Folder of your active project  
.PictureName = "Test.PDL"  
.ScrollBars = True  
.ServerPrefix = ""  
.TagPrefix = "Struct."  
.UpdateCycle = 5  
.Zoom = 100  
End With  
End Sub
```

### See also

[PictureWindow Object \(Page 2029\)](#)

## ScrollPositionX Property

### Description

Specifies the horizontal positioning of the scroll bar in a picture window with slider, or returns its value.



**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured:

```
Sub PictureWindowConfig()  
'VBA808  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
    .AdaptPicture = False  
    .AdaptSize = False  
    .Caption = True  
    .CaptionText = "Picturewindow in runtime"  
    .OffsetLeft = 5  
    .OffsetTop = 10  
    'Replace the picturename "Test.PDL" with the name of  
    'an existing document from your "GraCS"-Folder of your active project  
    .PictureName = "Test.PDL"  
    .ScrollBars = True  
    .ScrollPositionX = 50  
    .ScrollPositionY = 50  
    .ServerPrefix = ""  
    .TagPrefix = "Struct."  
    .UpdateCycle = 5  
    .Zoom = 100  
End With  
End Sub
```

**See also**

[PictureWindow Object \(Page 2029\)](#)

**ScrollPositionY Property****Description**

Specifies the vertical positioning of the scroll bar in a picture window with slider, or returns its value.

**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured:

```
Sub PictureWindowConfig()  
'VBA809  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
.AdaptPicture = False  
.AdaptSize = False  
.Caption = True  
.CaptionText = "Picturewindow in runtime"  
.OffsetLeft = 5  
.OffsetTop = 10  
'Replace the picturename "Test.PDL" with the name of  
'an existing document from your "GraCS"-Folder of your active project  
.PictureName = "Test.PDL"  
.ScrollBars = True  
.ScrollPositionX = 50  
.ScrollPositionY = 50  
.ServerPrefix = ""  
.TagPrefix = "Struct."  
.UpdateCycle = 5  
.Zoom = 100  
End With  
End Sub
```

**See also**

[PictureWindow Object \(Page 2029\)](#)

**ScrollPosX Property**

**Description**

Defines or returns the X position of the scroll bars for the View object.

**Example:**

In the following example a copy of the active picture is created and then activated. The position of the scroll bars will be set to 40 (X) and 10 (Y):

```
Sub CreateViewAndActivateView()  
Dim objView As HMIView  
Set objView = ActiveDocument.Views.Add  
objView.Activate  
objView.ScrollPosX = 40  
objView.ScrollPosY = 10  
End Sub
```

**See also**

[ScrollPosY Property \(Page 2411\)](#)

[View Object \(Page 2102\)](#)

**ScrollPosY Property****Description**

Defines or returns the Y position of the scroll bars for the View object.

**Example:**

In the following example a copy of the active picture is created and then activated. The position of the scroll bars will be set to 40 (X) and 10 (Y):

```
Sub CreateViewAndActivateView()  
Dim objView As HMIView  
Set objView = ActiveDocument.Views.Add  
objView.Activate  
objView.ScrollPosX = 40  
objView.ScrollPosY = 10  
End Sub
```

**See also**

[ScrollPosX Property \(Page 2410\)](#)

[View Object \(Page 2102\)](#)

## SelBGColor Property

### Description

Defines or returns the background color for the selected entry in the case of the TextList object. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the background color for the selected entry will be set to "Red":

```
Sub TextListConfiguration()  
Dim objTextList As HMITextList  
'  
'Neue TextListe ins aktuelle Bild einfügen:  
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")  
With objTextList  
.SelBGColor = RGB (255, 0, 0)  
End With  
End Sub
```

### See also

[TextList Object \(Page 2076\)](#)

## Selected Property

### Description

TRUE if an object is selected in the picture. BOOLEAN write-read access.

**Example:**

In the following example two new objects will be inserted in the active picture and then selected:

```
Sub SelectObjects()  
'VBA714  
Dim objCircle As HMICircle  
Dim objRectangle As HMIRectangle  
Dim objGroup As HMIGroup  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")  
With objCircle  
.Top = 40  
.Left = 40  
.Selected = True  
End With  
With objRectangle  
.Top = 80  
.Left = 80  
.Selected = True  
End With  
MsgBox "Objects selected!"  
End Sub
```

**See also**

[HMIObject Object \(Page 1988\)](#)

**Selection Property****Description**

Returns a listing containing all the objects selected in the specified picture.

To return an element from the Selection listing you can use either the index number or the object name.

You can use the Selection property, for example, to select all the objects in the picture.

**Example:**

In the following example all the objects in the active picture are selected:

```
Sub SelectAllObjectsInActiveDocument()  
'VBA715  
ActiveDocument.Selection.SelectAll  
End Sub
```

## See also

SelectedObjects object (Listing) (Page 2060)

Document Object (Page 1949)

## SelIndex property

### Description

Defines or returns the index of which the associated text is highlighted in the combobox or list box.

## SelText property

### Description

Shows the text defined with the "SelIndex" property which is highlighted in the ComboBox or ListBox object. You cannot directly change the "Selected text" attribute. You change the "Selected text" attribute by changing the "Selected box" attribute or the text itself in the "Font" properties group.

## SelTextColor Property

### Description

Defines or returns the text color for the selected entry in the TextList object. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the text color for the selected entry will be set to "Yellow":

```
Sub TextListConfiguration()  
'VBA716  
Dim objTextList As HMITextList  
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")  
With objTextList  
.SelTextColor = RGB(255, 255, 0)  
End With  
End Sub
```

**See also**

[TextList Object \(Page 2076\)](#)

**ServerName Property****Description**

Returns the name of the specified ActiveX Control or of the embedded object. Read only access.

**Example**

In the following example the ActiveX Control "WinCC Gauge Control" will be inserted in the active picture and the name of the ActiveX Control will be output:

```
Sub AddActiveXControl()  
'VBA717  
Dim objActiveXControl As HMIActiveXControl  
Set objActiveXControl = ActiveDocument.HMIObjects.AddActiveXControl("WinCC_Gauge",  
"XGAUGE.XGaugeCtrl.1")  
With objActiveXControl  
.Top = 40  
.Left = 60  
MsgBox .Properties("ServerName").value  
End With  
End Sub
```

**See also**

[ActiveXControl Object \(Page 1900\)](#)

## ServerPrefix Property

### Description

Defines the server which will hold the picture that is displayed in the picture window in Runtime, or returns the name of the server.

Enter the server name followed by two colons: "<Servername>:". No check is made as to whether the server actually exists.

### Example:

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured:

```
Sub PictureWindowConfig()  
'VBA718  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
    .AdaptPicture = False  
    .AdaptSize = False  
    .Caption = True  
    .CaptionText = "Picturewindow in runtime"  
    .OffsetLeft = 5  
    .OffsetTop = 10  
    'Replace the picturename "Test.PDL" with the name of  
    'an existing document from your "GraCS"-Folder of your active project  
    .PictureName = "Test.PDL"  
    .ScrollBars = True  
    .ServerPrefix = "my_Server::  
    .TagPrefix = "Struct."  
    .UpdateCycle = 5  
    .Zoom = 100  
End With  
End Sub
```

### See also

[PictureWindow Object \(Page 2029\)](#)

## ShortCut Property

### Description

Defines or returns a shortcut key sequence for a user-defined menu entry or user-defined icon.



The following keys are permitted in combination with <CTRL>, <ALT> and <SHIFT>:

- Function keys <F1> to <F12>
- The letter keys <A> to <Z> and the number keys <0> to <9>.

The following are not supported: the keys on the alphanumeric keypad, the cursor keys (e.g. <Page Up>) and the remaining function keys such as <RETURN> and <ESC>. No distinction is made upper and lower case. Key combinations with two or more letters or numbers are not permitted, such as "CTRL+A+B", but the combination with two additional keys such as <CTRL+ALT+A" is allowed.

### Notes on using the ShortCut property

The key sequences used must be unique within the user-defined menus and toolbars in a picture. Key sequences that you configure with VBA have priority over any key sequences that may be present in the Graphics Designer. Within the user-defined menus and toolbars, picture-specific key sequences have priority over application-specific key sequences.

---

#### Note

Shortcut key sequences are only executed if the menu entry or the icon is visible and active.

**Example:**

In the following example, a user-defined menu with two menu entries and a submenu with two entries will be created in the active picture. The submenu will be visually distinguished by a dividing line. The first menu entry receives the shortcut key sequence <CTRL+SHIFT+M> for retrieval:

```
Sub CreateDocumentMenus()  
'VBA719  
Dim objDocMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Dim objSubMenu As HMIMenuItem  
,  
'Add menu to menubar:  
Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1", "Doc_Menu_1")  
,  
'Add menuitems to the new menu:  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1", "&My first Menuitem")  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2", "My second Menuitem")  
,  
'Add seperator to menu:  
Set objMenuItem = objDocMenu.MenuItems.InsertSeparator(3, "dSeparator1_3")  
,  
'Add submenu to the menu:  
Set objSubMenu = objDocMenu.MenuItems.InsertSubMenu(4, "dSubMenu1_4", "My first submenu")  
,  
'Add menuitems to the submenu:  
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(5, "dmItem1_5", "My first submenuitem")  
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(6, "dmItem1_6", "My second  
submenuitem")  
,  
ActiveDocument.CustomMenus("DocMenu1").MenuItems(1).ShortCut = "CTRL+SHIFT+M"  
End Sub
```

**See also**

[Configuring Menus and Toolbars \(Page 1626\)](#)  
[ToolbarItem Object \(Page 2083\)](#)  
[MenuItem Object \(Page 2013\)](#)

**ShowBadTagState property****Description**

Determines if the object is grayed out when a bad quality code or tag status is detected. At both objects, "HMIAdvancedAnalogDisplay" and "HMIAdvancedStateAnalogDisplay", the property is used to specify whether the settings for the "PaintColor\_QualityCodeBad" and "PaintColor\_QualityCodeUncertain" properties are used.

## SignificantMask Property

### Description

Needed in Runtime for displaying the active message class with the highest priority in the GroupDisplay object.

The value of the SignificantMask property represents an internal system output value does not require any specific configuration by the user. Updating takes place in Runtime by clicking on the object.

### Example:

--

### See also

GroupDisplay Object (Page 1980)

## Simulation property

### Description

Specifies the interconnection with any tag that is used for simulation.

## SimulationBit property

### Description

Shows the bit position of the linked simulation tags that is used for evaluation.

The value of the simulation tag is only evaluated with the alarm status "OK".

## Size Property

### Description

Defines or returns the font size in points for a language-dependent font.

**Example:**

The following example sets the font attributes of a button for French and English:

```
Sub ExampleForLanguageFonts()  
  'VBA721  
  Dim colLangFonts As HMILanguageFonts  
  Dim objButton As HMIButton  
  Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
  objButton.Text = "DefText"  
  Set colLangFonts = objButton.LDFonts  
  '  
  'Set font-properties for french:  
  With colLangFonts.ItemByLCID(1036)  
    .Family = "Courier New"  
    .Bold = True  
    .Italic = False  
    .Underlined = True  
    .Size = 12  
  End With  
  '  
  'Set font-properties for english:  
  With colLangFonts.ItemByLCID(1033)  
    .Family = "Times New Roman"  
    .Bold = False  
    .Italic = True  
    .Underlined = False  
    .Size = 14  
  End With  
End Sub
```

**See also**

- [Underlined Property \(Page 2460\)](#)
- [Parent Property \(Page 2359\)](#)
- [LanguageID Property \(Page 2289\)](#)
- [Italic Property \(Page 2282\)](#)
- [Family Property \(Page 2229\)](#)
- [Bold Property \(Page 2151\)](#)
- [Application Property \(Page 2121\)](#)
- [LanguageFont Object \(Page 1996\)](#)

## Sizeable Property

### Description

TRUE if the size of the ApplicationWindow and PictureWindow objects can be changed in Runtime. BOOLEAN write-read access.

### Example:

The "ApplicationWindowConfig" procedure accesses the properties of the application window. In this example it is intended that the application window can be resized in Runtime:

```
Sub ApplicationWindowConfig()  
'VBA722  
Dim objAppWindow As HMIApplicationWindow  
Set objAppWindow = ActiveDocument.HMIObjects.AddHMIObject("AppWindow1",  
"HMIApplicationWindow")  
With objAppWindow  
.Sizeable = True  
End With  
End Sub
```

### See also

[PictureWindow Object \(Page 2029\)](#)

[ApplicationWindow Object \(Page 1911\)](#)

## SmallChange Property

### Description

Defines how many steps the controller can be moved with one mouse click or returns the value.

### Example:

The "SliderConfiguration()" procedure accesses the properties of the slider. In this example the number of steps will be set to "4":

```
Sub SliderConfiguration()  
'VBA723  
Dim objSlider As HMISlider  
Set objSlider = ActiveDocument.HMIObjects.AddHMIObject("SliderObject1", "HMISlider")  
With objSlider  
.SmallChange = 4  
End With  
End Sub
```

## See also

Slider object (Page 2062)

## SnapToGrid Property

### Description

TRUE if objects in the picture are aligned on the grid (which is invisible). BOOLEAN write-read access.

### Example:

In the following example, the alignment of objects in the active picture on the grid is activated:

```
Sub ActivateSnapToGrid()  
'VBA724  
ActiveDocument.SnapToGrid = True  
End Sub
```

## See also

Document Object (Page 1949)

## SourceLink Property

### Description

Returns the Source object. Use the SourceLink property to configure the source object in the case of a direct connection.

**Example:**

In the following example the X position of "Rectangle\_A" is copied to the Y position of "Rectangle\_B" in Runtime by clicking on the button:

```
Sub DirectConnection()  
'VBA725  
Dim objButton As HMIButton  
Dim objRectangleA As HMIRectangle  
Dim objRectangleB As HMIRectangle  
Dim objEvent As HMIEvent  
Dim objDirConnection As HMIDirectConnection  
Set objRectangleA = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_A", "HMIRectangle")  
Set objRectangleB = ActiveDocument.HMIObjects.AddHMIObject("Rectangle_B", "HMIRectangle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objRectangleA  
.Top = 100  
.Left = 100  
End With  
With objRectangleB  
.Top = 250  
.Left = 400  
.BackColor = RGB(255, 0, 0)  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 100  
.Text = "SetPosition"  
End With  
'  
'Directconnection is initiated by mouseclick:  
Set objDirConnection =  
objButton.Events(1).Actions.AddAction(hmiActionCreationTypeDirectConnection)  
With objDirConnection  
'Sourceobject: Property "Top" of Rectangle_A  
.SourceLink.Type = hmiSourceTypeProperty  
.SourceLink.ObjectName = "Rectangle_A"  
.SourceLink.AutomationName = "Top"  
'  
'Targetobject: Property "Left" of Rectangle_B  
.DestinationLink.Type = hmiDestTypeProperty  
.DestinationLink.ObjectName = "Rectangle_B"  
.DestinationLink.AutomationName = "Left"  
End With  
End Sub
```

**See also**

[Type Property \(Page 2450\)](#)

[ObjectName Property \(Page 2347\)](#)

[AutomationName Property \(Page 2124\)](#)

SourceLink Object (Page 2065)

DirectConnection Object (Page 1947)

## SourceCode Property

### Description

Defines or returns the source code of a C script or VB script.

If you assign a C script to the SourceCode property, you must enter only the program code located between the braces ("{}").

If you assign a VB script to the SourceCode property, you must enter only the program code located between the Sub and EndSub keywords.

---

### Note

If you use single quote marks (') or double quote marks (") in the program code, you must enter an additional quote mark in front of every single or double quote mark so that the program code can be correctly interpreted in the VBA editor.

---

The Compiled property returns TRUE if the source code was successfully compiled.



**Example:**

In the following example a button and a circle will be inserted in the active picture. In Runtime the radius of the circle will enlarge every time you click the button. A VB script will be used for this purpose:

```
Sub IncreaseCircleRadiusWithVBScript()  
'VBA726  
Dim objButton As HMIButton  
Dim objCircleA As HMICircle  
Dim objEvent As HMIEvent  
Dim objVBScript As HMIScriptInfo  
Dim strCode As String  
strCode = "Dim objCircle" & vbCrLf & "Set objCircle = "  
strCode = strCode & "hmiRuntime.ActiveScreen.ScreenItems("CircleVB")"  
strCode = strCode & vbCrLf & "objCircle.Radius = objCircle.Radius + 5"  
Set objCircleA = ActiveDocument.HMIObjects.AddHMIObject("CircleVB", "HMICircle")  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
With objCircleA  
.Top = 100  
.Left = 100  
End With  
With objButton  
.Top = 10  
.Left = 10  
.Width = 200  
.Text = "Increase Radius"  
End With  
'  
'On every mouseclick the radius have to increase:  
Set objEvent = objButton.Events(1)  
Set objVBScript = objButton.Events(1).Actions.AddAction(hmiActionCreationTypeVBScript)  
objVBScript.SourceCode = strCode  
Select Case objVBScript.Compiled  
Case True  
MsgBox "Compilation ok!"  
Case False  
MsgBox "Error on compilation!"  
End Select  
End Sub
```

**See also**

[Compiled Property \(Page 2197\)](#)

[ScriptInfo Object \(Page 2058\)](#)

## StartAngle Property

### Description

Defines or returns the start of the object for the CircularArc, EllipseArc, EllipseSegment and PieSegment objects. The information is in counterclockwise direction in degrees, beginning at the 12:00 clock position.

### Example:

The "PieSegmentConfiguration()" procedure accesses the properties of the Pie Segment. In this example the pie segment begins at 40° and ends at 180°:

```
Sub PieSegmentConfiguration()  
'VBA727  
Dim PieSegment As HMIPieSegment  
Set PieSegment = ActiveDocument.HMIObjects.AddHMIObject("PieSegment1", "HMIPieSegment")  
With PieSegment  
.StartAngle = 40  
.EndAngle = 180  
End With  
End Sub
```

### See also

[EndAngle Property \(Page 2222\)](#)  
[PieSegment Object \(Page 2032\)](#)  
[EllipseSegment Object \(Page 1963\)](#)  
[EllipseArc Object \(Page 1960\)](#)  
[CircularArc Object \(Page 1931\)](#)

## StatusText Property

### Description

Defines or returns the text that will be displayed in the status bar when you point with the mouse to a user-defined menu entry or user-defined icon.

**Example:**

In the following example, a user-defined menu with two menu entries and a submenu with two entries will be created in the active picture. The submenu will be visually distinguished by a dividing line. A status bar entry will be defined for each menu entry:

```
Sub CreateDocumentMenus()
'VBA728
Dim objDocMenu As HMIMenu
Dim objMenuItem As HMIMenuItem
Dim objSubMenu As HMIMenuItem
'
'Add menu:
Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1", "Doc_Menu_1")
'
'Add menuitems to custom-menu:
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1", "My first menuitem")
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2", "My second menuitem")
'
'Add separator to custom-menu:
Set objMenuItem = objDocMenu.MenuItems.InsertSeparator(3, "dSeparator1_3")
'
'Add submenu to custom-menu:
Set objSubMenu = objDocMenu.MenuItems.InsertSubMenu(4, "dSubMenu1_4", "My first submenu")
'
'Add menuitems to submenu:
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(5, "dmItem1_5", "My first submenuitem")
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(6, "dmItem1_6", "My second
submenuitem")
'
'Assign statustexts to every menuitem
With objDocMenu
.MenuItems(1).StatusText = "My first menuitem"
.MenuItems(2).StatusText = "My second menuitem"
.MenuItems(4).SubMenu.Item(1).StatusText = "My first submenuitem"
.MenuItems(4).SubMenu.Item(2).StatusText = "My second submenuitem"
End With
End Sub
```

**See also**

[ToolbarItem Object \(Page 2083\)](#)

[MenuItem Object \(Page 2013\)](#)

**SubMenu Property****Description**

Returns a MenuItems listing if the specified object is the "SubMenu" type.

Use the SubMenu listing if you wish to create a submenu in a user-defined menu.

**Example:**

In the following example, a user-defined menu with two menu entries and a submenu with two entries will be created in the active picture. The submenu will be visually distinguished by a dividing line:

```
Sub CreateDocumentMenus()  
    'VBA730  
    Dim objDocMenu As HMIMenu  
    Dim objMenuItem As HMIMenuItem  
    Dim objSubMenu As HMIMenuItem  
    '  
    'Add menu:  
    Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1", "Doc_Menu_1")  
    '  
    'Add menuitems to custom-menu:  
    Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1", "My first menuitem")  
    Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2", "My second menuitem")  
    '  
    'Add separator to custom-menu:  
    Set objMenuItem = objDocMenu.MenuItems.InsertSeparator(3, "dSeparator1_3")  
    '  
    'Add submenu to custom-menu:  
    Set objSubMenu = objDocMenu.MenuItems.InsertSubMenu(4, "dSubMenu1_4", "My first submenu")  
    '  
    'Add menuitems to submenu:  
    Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(5, "dmItem1_5", "My first submenuitem")  
    Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(6, "dmItem1_6", "My second submenuitem")  
End Sub
```

**See also**

[MenuItem Object \(Page 2013\)](#)

**SymbolLibraries Property****Description**

Returns a `SymbolLibraries` listing containing objects of the "SymbolLibrary" type.

Use `SymbolLibraries(1)` to return the "Global Library". Use `SymbolLibraries(2)` to return the "Project Library".

**Example:**

In the following example the names of the libraries will be output:

```
Sub ShowSymbolLibraries()  
'VBA731  
Dim colSymbolLibraries As HMISymbolLibraries  
Dim objSymbolLibrary As HMISymbolLibrary  
Set colSymbolLibraries = Application.SymbolLibraries  
For Each objSymbolLibrary In colSymbolLibraries  
MsgBox objSymbolLibrary.Name  
Next objSymbolLibrary  
End Sub
```

**See also**

[Application Object \(Page 1909\)](#)

**T****TabOrderAlpha Property****Description**

Defines or returns the position of the object in the TAB sequence for the alpha / tab order cursor.

**Example:**

In this example two I/O fields will be inserted in the active picture and the TAB sequence will then be defined:

```
Sub IOFieldConfig()  
'VBA734  
Dim objIOField1 As HMIOField  
Dim objIOField2 As HMIOField  
Set objIOField1 = ActiveDocument.HMIObjects.AddHMIOObject("IOField1", "HMIOField")  
Set objIOField2 = ActiveDocument.HMIObjects.AddHMIOObject("IOField2", "HMIOField")  
With objIOField1  
.Top = 10  
.Left = 10  
.TabOrderAlpha = 1  
End With  
With objIOField2  
.Top = 100  
.Left = 10  
.TabOrderAlpha = 2  
End With  
End Sub
```

**See also**

Document Object (Page 1949)

**TabOrderAllHMIOObjects Property**

**Description**

TRUE if all the objects in a picture are to be included in the configured TAB sequence.  
BOOLEAN write-read access.

**Example:**

The "ConfigureTabOrder()" procedure defines which objects in the active picture are to be included in the configured TAB sequence. In this example all the objects will be included in the TAB sequence:

```
Sub ConfigureTabOrder()  
'VBA733  
With ActiveDocument  
.TABOrderAllHMIObjects = True  
.TABOrderKeyboard = False  
.TABOrderMouse = False  
.TABOrderOtherAction = False  
End With  
End Sub
```

**See also**

[TabOrderOtherAction Property \(Page 2432\)](#)

[TabOrderMouse Property \(Page 2432\)](#)

[TabOrderKeyboard Property \(Page 2431\)](#)

[Document Object \(Page 1949\)](#)

**TabOrderKeyboard Property****Description**

TRUE if objects with a keyboard operation event configured to them are to be included in the configured TAB sequence. BOOLEAN write-read access.

**Example:**

The "ConfigureTabOrder()" procedure defines which objects in the active picture are to be included in the configured TAB sequence. In this example objects with a keyboard operation will be included in the TAB sequence:

```
Sub ConfigureTabOrder()  
'VBA735  
With ActiveDocument  
.TABOrderAllHMIObjects = True  
.TABOrderKeyboard = False  
.TABOrderMouse = False  
.TABOrderOtherAction = False  
End With  
End Sub
```

## See also

TabOrderOtherAction Property (Page 2432)  
TabOrderMouse Property (Page 2432)  
TabOrderAllHMIOBJECTS Property (Page 2430)  
Document Object (Page 1949)

## TabOrderMouse Property

### Description

TRUE if objects with a mouse operation event configured to them are to be included in the configured TAB sequence. BOOLEAN write-read access.

### Example:

The "ConfigureTabOrder()" procedure defines which objects in the active picture are to be included in the configured TAB sequence. In this example objects with a mouse operation event will be included in the TAB sequence:

```
Sub ConfigureTabOrder()  
  'VBA736  
  With ActiveDocument  
    .TABOrderAllHMIOBJECTS = True  
    .TABOrderKeyboard = False  
    .TABOrderMouse = False  
    .TABOrderOtherAction = False  
  End With  
End Sub
```

## See also

TabOrderOtherAction Property (Page 2432)  
TabOrderKeyboard Property (Page 2431)  
TabOrderAllHMIOBJECTS Property (Page 2430)  
Document Object (Page 1949)

## TabOrderOtherAction Property

### Description

TRUE if objects with an event other than a mouse or keyboard operation event configured to them are to be included in the configured TAB sequence. BOOLEAN write-read access.



**Example:**

The "ConfigureTabOrder()" procedure defines which objects in the active picture are to be included in the configured TAB sequence. In this example objects with events other than a mouse or keyboard operation will be included in the TAB sequence:

```
Sub ConfigureTabOrder()  
'VBA737  
With ActiveDocument  
.TABOrderAllHMIObjects = True  
.TABOrderKeyboard = False  
.TABOrderMouse = False  
.TABOrderOtherAction = False  
End With  
End Sub
```

**See also**

[TabOrderMouse Property \(Page 2432\)](#)  
[TabOrderKeyboard Property \(Page 2431\)](#)  
[TabOrderAllHMIObjects Property \(Page 2430\)](#)  
[Document Object \(Page 1949\)](#)

**TabOrderSwitch Property****Description**

Defines or returns the position of the object in the TAB sequence.

**Example:**

In this example two I/O fields will be inserted in the active picture and the TAB sequence will then be defined:

```
Sub IOFieldConfig()  
'VBA732  
Dim objIOField1 As HMIOField  
Dim objIOField2 As HMIOField  
Set objIOField1 = ActiveDocument.HMIObjects.AddHMIOObject("IOField1", "HMIOField")  
Set objIOField2 = ActiveDocument.HMIObjects.AddHMIOObject("IOField2", "HMIOField")  
With objIOField1  
.Top = 10  
.Left = 10  
.TabOrderSwitch = 1  
End With  
With objIOField2  
.Top = 100  
.Left = 10  
.TabOrderSwitch = 2  
End With  
End Sub
```

**See also**

[HMIOObject Object \(Page 1988\)](#)

**Tag Property**

**Description**

Defines or returns information text for a user-defined menu entry or user-defined icon. You can use the Tag property for example to briefly describe what the menu entry does.

**Example:**

In the following example, a user-defined menu with two menu entries and a submenu with two entries will be created in the active picture. The submenu will be visually distinguished by a dividing line:

```
Sub CreateDocumentMenus()  
'VBA738  
Dim objDocMenu As HMIMenu  
Dim objMenuItem As HMIMenuItem  
Dim objSubMenu As HMIMenuItem  
'  
'Add menu:  
Set objDocMenu = ActiveDocument.CustomMenus.InsertMenu(1, "DocMenu1", "Doc_Menu_1")  
'  
'Add menuitems to custom-menu:  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(1, "dmItem1_1", "My first menuitem")  
Set objMenuItem = objDocMenu.MenuItems.InsertMenuItem(2, "dmItem1_2", "My second menuitem")  
'  
'Add separator to custom-menu:  
Set objMenuItem = objDocMenu.MenuItems.InsertSeparator(3, "dSeparator1_3")  
'  
'Add submenu to custom-menu:  
Set objSubMenu = objDocMenu.MenuItems.InsertSubMenu(4, "dSubMenu1_4", "My first submenu")  
'  
'Add menuitems to submenu:  
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(5, "dmItem1_5", "My first submenuitem")  
Set objMenuItem = objSubMenu.SubMenu.InsertMenuItem(6, "dmItem1_6", "My second  
submenuitem")  
'  
'To place an additional information:  
With objDocMenu  
.MenuItems(1).Tag = "This is the first menuitem"  
End With  
End Sub
```

**See also**

[ToolbarItem Object \(Page 2083\)](#)

[MenuItem Object \(Page 2013\)](#)

**Tag property****Description**

Is used for the "Graphic Object Update Wizard" tool and is not evaluated for the "HMIAdvancedAnalogDisplay" and "HMIAdvancedStateAnalogDisplay" objects.

## tagname property

### Description

Is used for the "Graphic Object Update Wizard" tool and is not evaluated for the "HMIAdvancedAnalogDisplay" and "HMIAdvancedStateAnalogDisplay" objects.

## TagPrefix Property

### Description

Defines or returns the tag prefix for all the tags contained in the Picture Window object.

#### Example:

The picture "InputOutput" is to be displayed in the picture window. The picture "InputOutput" contains three I/O fields which are linked to a structure tag. The structure tag consists of the elements EA1, EA2, EA3; one element each for each I/O field.

Three such structure tags have been define in the project, with structure names Struct1, Struct2 and Struct3.

The tag prefix is in this case the structure name followed by a period. Specify the tag prefix as, say, Struct2. (the period is necessary in order to address the elements of the structure tag as structure elements in a syntactically correct way). The I/O fields in the picture "InputOutput" are then linked to the elements in structure tag Struct2:

Tag Prefix: "Struct2."

- Output value (first I/O field): EA1
- Output value (second I/O field): EA2
- Output value (third I/O field): EA3

The current tag connection in the picture window is then

- Output value (first I/O field): Struct2.EA1
- Output value (second I/O field): Struct2.EA2
- Output value (third I/O field): Struct2.EA3

**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be configured:

```
Sub PictureWindowConfig()  
'VBA739  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
    .AdaptPicture = False  
    .AdaptSize = False  
    .Caption = True  
    .CaptionText = "Picturewindow in runtime"  
    .OffsetLeft = 5  
    .OffsetTop = 10  
    'Replace the picturename "Test.PDL" with the name of  
    'an existing document from your "GraCS"-Folder of your active project  
    .PictureName = "Test.PDL"  
    .ScrollBars = True  
    .ServerPrefix = "my_Server::  
    .TagPrefix = "Struct."  
    .UpdateCycle = 5  
    .Zoom = 100  
End With  
End Sub
```

**See also**

[PictureWindow Object \(Page 2029\)](#)

**TagScaleParam1 property****Description**

Sets the value1 for the value range process.

**TagScaleParam2 property****Description**

Sets the value2 for the value range process.

### TagScaleParam3 property

#### Description

Sets the value3 for the value range process.

### TagScaleParam4 property

#### Description

Sets the value4 for the value range process.

### TagStartvaluePersistence property

#### Description

Defines whether an internal tag is set as persistent. You can only set internal tags as persistent.

### tagtype property

#### Description

Is used for the "Graphic Object Update Wizard" tool and is not evaluated for the "HMIAdvancedAnalogDisplay" and "HMIAdvancedStateAnalogDisplay" objects.

### Template property

#### Description

Returns the template for displaying the window content of the "ApplicationWindow" object.  
Read only access.

The "ApplicationWindow" object can be supplied from applications of the Global Script and the report system:

GSC Diagnostics	The application window is supplied by applications of the Global Script. The results of the diagnostics system are displayed.
GSC Runtime	The application window is supplied by applications of the Global Script. The analysis results regarding characteristics in Runtime are displayed.
All Jobs	The application window is supplied by the report system. The available reports are displayed as a list.
All Jobs – Shortcut Menu	The application window is supplied by the report system. The available reports are displayed as a list. The shortcut menu enables the selection of print options, display of a print preview as well as a printout of the report.

Job Detail View	The application window is supplied by the report system. The available reports are displayed in a selection menu. Detailed information is displayed for the selected report.
Selected Jobs - Shortcut Menu	The application window is supplied by the report system. The available reports are displayed as a list. This list only contains reports which you have activated the option "Mark for print job list" in the "Print Job Properties" dialog. The shortcut menu enables the selection of print options, display of a print preview as well as a printout of the report.

**See also**

ApplicationWindow Object (Page 1911)

**Text Property****Description**

Defines or returns the labeling for an object.

**Example:**

The "ButtonConfiguration()" procedure accesses the properties of the button. In this example the label will be defined:

```
Sub ButtonConfiguration()
'VBA740
Dim objButton As HMIButton
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("Button1", "HMIButton")
With objButton
.Text = "Button1"
End With
End Sub
```

**See also**

Button Object (Page 1921)

StaticText Object (Page 2067)

OptionGroup Object (Page 2025)

CheckBox Object (Page 1924)

**TextBibIDs property****Description**

Only used internally.

**See also**

TextList Object (Page 2076)

**TitleBackColorActiveEnd property**

**Description**

Only used internally.

**See also**

PictureWindow Object (Page 2029)

**TitleBackColorActiveStart property**

**Description**

Only used internally.

**See also**

PictureWindow Object (Page 2029)

**TitleBackColorInactiveEnd property**

**Description**

Only used internally.

**See also**

PictureWindow Object (Page 2029)

**TitleBackColorInactiveStart property**

**Description**

Only used internally.

**See also**

PictureWindow Object (Page 2029)



## TitleForeColorActive property

### Description

Only used internally.

### See also

PictureWindow Object (Page 2029)

## TitleForeColorInactive property

### Description

Only used internally.

### See also

PictureWindow Object (Page 2029)

## Toggle Property

### Description

TRUE, if the button or round button should lock after being operated in Runtime. BOOLEAN write-read access.

### Example:

The "RoundButtonConfiguration()" procedure accesses the properties of the RoundButton. In this example the round button is intended to latch down when pressed in Runtime:

```
Sub RoundButtonConfiguration()  
'VBA741  
Dim objRoundButton As HMIRoundButton  
Set objRoundButton = ActiveDocument.HMIObjects.AddHMIObject("RButton1", "HMIRoundButton")  
With objRoundButton  
    .Toggle = True  
End With  
End Sub
```

### See also

RoundButton Object (Page 2052)

## ToleranceHigh Property

### Description

Defines or returns the limit value for "Tolerance high".

The type of the evaluation (in percent or absolute) is defined in the TypeToleranceHigh property.

Monitoring of the limit value only takes effect when the CheckToleranceHigh property is set to "True".

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the limit values. In this example the limit value for "Tolerance High" will be configured:

```
Sub BarGraphLimitConfiguration()  
'VBA742  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
  'Set analysis = absolute  
  .TypeToleranceHigh = False  
  'Activate monitoring  
  .CheckToleranceHigh = True  
  'Set barcolor = "yellow"  
  .ColorToleranceHigh = RGB(255, 255, 0)  
  'Set upper limit to "40"  
  .ToleranceHigh = 40  
End With  
End Sub
```

### See also

[TypeToleranceHigh Property \(Page 2456\)](#)

[CheckToleranceHigh Property \(Page 2176\)](#)

[BarGraph Object \(Page 1914\)](#)

## ToleranceLow Property

### Description

Defines or returns the limit value for "Tolerance low".

The type of the evaluation (in percent or absolute) is defined in the TypeToleranceLow property.

Monitoring of the limit value only takes effect when the CheckToleranceLow property is set to "True".

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the limit values. In this example the limit value for "Tolerance Low" will be configured.

```
Sub BarGraphLimitConfiguration()  
'VBA743  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeToleranceLow = False  
'Activate monitoring  
.CheckToleranceLow = True  
'Set barcolor = "red"  
.ColorToleranceLow = RGB(255, 0, 0)  
'Set lower limit to "40"  
.ToleranceLow = 40  
End With  
End Sub
```

**See also**

[TypeToleranceLow Property \(Page 2457\)](#)  
[CheckToleranceLow Property \(Page 2177\)](#)  
[BarGraph Object \(Page 1914\)](#)

**ToolbarItems Property****Description**

Returns a listing containing all the elements (icons and separation lines) of a user-defined toolbar.

## Example

In the following example a user-defined toolbar with two icons is created in the active picture. These icons are separated by a dividing line:

```
Sub AddDocumentSpecificCustomToolbar()
'VBA744
Dim objToolbar As HMIToolbar
Dim objToolbarItem As HMIToolbarItem
Set objToolbar = ActiveDocument.CustomToolbars.Add("DocToolbar")
'
'Add symbol-icon to userdefined toolbar
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(1, "tItem1_1", "My first
symbol-icon")
Set objToolbarItem = objToolbar.ToolbarItems.InsertToolbarItem(3, "tItem1_3", "My second
symbol-icon")
Set objToolbarItem = objToolbar.ToolbarItems.InsertSeparator(2, "tSeparator1_2")
End Sub
```

## See also

[ToolbarItem Object \(Page 2083\)](#)

[Toolbar Object \(Page 2080\)](#)

## ToolbarItemType property

### Description

Returns the type of the "HMIToolbarItem" object of a user-defined toolbar as a "string".

Returned Value	Type in the toolbar
0	Separator
1	Icon

## Example

In the following example the type of the first object in the first user-defined toolbar in the active picture is output:

```
Sub ShowFirstObjectOfCollection()
'VBA353
Dim strType As String
strType = ActiveDocument.CustomToolbars(1).ToolbarItems(1).ToolbarItemType
MsgBox strType
End Sub
```

## ToolTipText Property

### Description

Defines or returns the text that will be displayed as a Tooltip when you run the mouse over an object (HMIOBJECT, icon).

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the Rectangle object. In this example a tool tip text will be assigned to the rectangle:

```
Sub RectangleConfiguration()  
'VBA745  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("Rectangle1", "HMIRectangle")  
With objRectangle  
.ToolTipText = "This is a rectangle"  
End With  
End Sub
```

The following example shows how you have to initialize the property prior to dynamization:

```
Sub Dyn()  
'VBA823  
Dim objCircle As HMICircle  
Dim doc As Document  
Dim objDynDialog As HMIIDynamicDialog  
Set doc = ActiveDocument  
Set objCircle = ActiveDocument.HMIOBJECTS.AddHMIOBJECT("Circle", "HMICircle")  
objCircle.ObjectName = "Circle1"  
objCircle.BorderColor = RGB(255, 0, 0)  
objCircle.BackColor = RGB(0, 255, 0)  
objCircle.ToolTipText = "Text"  
Set objDynDialog =  
objCircle.ToolTipText.CreateDynamic(hmiDynamicCreationTypeDynamicDialog, "'Var'")  
End Sub
```

### See also

[ToolbarItem Object \(Page 2083\)](#)

[HMIOBJECT Object \(Page 1988\)](#)

[How to dynamize a property with the Dynamic dialog \(Page 1691\)](#)

## Top Property

### Description

Defines or returns the Y-coordinate of an object (measured from the top left edge of the picture) in pixels. The Y-coordinate relates to the top left corner of the rectangle enclosing the object.

### Example:

The "RectangleConfiguration()" procedure accesses the properties of the Rectangle object. In this example the rectangle will be set to position 10/40:

```
Sub RectangleConfiguration()  
'VBA746  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
    .Left = 10  
    .Top = 40  
End With  
End Sub
```

### See also

[View Object \(Page 2102\)](#)

[HMIObject Object \(Page 1988\)](#)

## TopConnectedObjectName Property

### Description

Returns the name of the end object to which the connector is connected. Read only access.

### Example:

An example showing how to use the BottomConnectedObjectName property can be found in this documentation under the heading "ObjConnection Object".

### See also


[ObjConnection object \(Page 2019\)](#)

## TopConnectedConnectionPointIndex Property

### Description

Returns the connection point on the object to which the connector is connected.

Connection Point	Assigned Value
Up	0
Right	1
Down	2
Left	3

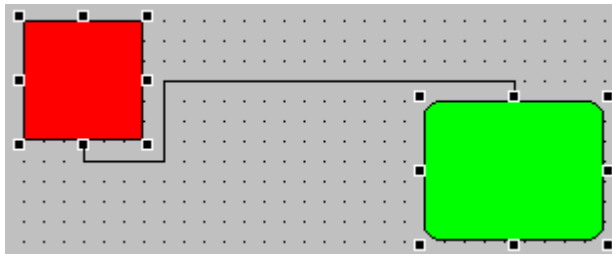

### Example:

An example showing how to use the BottomConnectedObjectName property can be found in this documentation under the heading "ObjConnection Object".

### See also

ObjConnection object (Page 2019)

## Transparency property

### Description

Defines the degree of transparency of the object display. Values between 0 and 100 indicate the transparency as a percentage. In the case of a semi-transparent objects other objects shine through. A 100% transparent object is invisible. An invisible object can also be controlled in Runtime.

## Example

```
Sub addTransparentObject()  
    'VBA849  
    Dim objHMICircle As HMICircle  
    Set objHMICircle = ActiveDocument.HMIObjects.AddHMIObject("Circle", "HMICircle")  
    objHMICircle.Transparency = 40  
End Sub
```

## Trend Property

### Description

TRUE if the trend or tendency of the measured value being monitored (rising or falling) is to be indicated by a little arrow. BOOLEAN write-read access.

### Example:

The "BarGraphConfiguration()" procedure configures In this example the trend of the measured value will be indicated:

```
Sub BarGraphConfiguration()  
    'VBA747  
    Dim objBarGraph As HMIBarGraph  
    Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
    With objBarGraph  
        .trend = True  
    End With  
End Sub
```

### See also

[BarGraph Object \(Page 1914\)](#)

### trend property

### Description

Is used for the "Graphic Object Update Wizard" tool and is not evaluated for the "HMIAdvancedAnalogDisplay" and "HMIAdvancedStateAnalogDisplay" objects.



## TrendColor Property

### Description

Defines or returns the color of the trend display.

The trend display indicates the tendency (rising or falling) of the measuring value being monitored by a small arrow. In order to activate the trend display, the Trend property must be set to "True". LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "BarGraphConfiguration()" procedure configures In this example the trend in the measured value will be indicated. The trend display will be set to "Red":

```
Sub BarGraphConfiguration()  
'VBA748  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
    .trend = True  
    .TrendColor = RGB(255, 0, 0)  
End With  
End Sub
```

### See also

Trend Property (Page 2448)

BarGraph Object (Page 1914)

## Trigger Property

### Description

Returns a Trigger object. Use the Trigger property when making a property dynamic with the aid of a script.

**Example:**

In this example the "Radius" property of a circle will be made dynamic with the aid of a C script (the output value sets the radius):

```
Sub AddDynamicAsCSkriptToProperty()  
'VBA749  
Dim objVBScript As HMIScriptInfo  
Dim objCircle As HMICircle  
  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("myCircle", "HMICircle")  
Set objVBScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)  
With objVBScript  
.Trigger.Type = hmiTriggerTypeStandardCycle  
.Trigger.CycleType = hmiCycleType_2s  
.Trigger.Name = "Trigger1"  
End With  
End Sub
```

**See also**

Trigger Object (Page 2087)  
ScriptInfo Object (Page 2058)

**Type Property**

**Description**

Returns or defines the type of an object.  
The object type is returned as either a string or and integer.

**Example:**

The "RectangleConfiguration()" procedure accesses the properties of the Rectangle object. In this example the object type will be output:

```
Sub RectangleConfiguration()  
'VBA750  
Dim objRectangle As HMIRectangle  
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("Rectangle1", "HMIRectangle")  
With objRectangle  
MsgBox "Objecttype: " & .Type  
End With  
End Sub
```

## See also

Trigger Object (Page 2087)  
ToolBarItem Object (Page 2083)  
SourceLink Object (Page 2065)  
Property Object (Page 2042)  
HMIOBJECT Object (Page 1988)  
FolderItem Object (Page 1972)  
DestLink Object (Page 1945)

## TypeAlarmHigh Property

### Description

TRUE, when the upper limit value, at which an alarm is triggered, should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "50".

```
Sub BarGraphLimitConfiguration()  
  'VBA751  
  Dim objBarGraph As HMIBarGraph  
  Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
  With objBarGraph  
    'Set analysis = absolute  
    .TypeAlarmHigh = False  
    'Activate monitoring  
    .CheckAlarmHigh = True  
    'Set barcolor = "yellow"  
    .ColorAlarmHigh = RGB(255, 255, 0)  
    'Set upper limit = "50"  
    .AlarmHigh = 50  
  End With  
End Sub
```

## See also

ColorAlarmHigh Property (Page 2182)  
CheckAlarmHigh Property (Page 2170)

[AlarmHigh Property \(Page 2114\)](#)

[BarGraph Object \(Page 1914\)](#)

## TypeAlarmLow Property

### Description

TRUE, when the lower limit value, at which an alarm is triggered, should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "10".

```
Sub BarGraphLimitConfiguration()  
'VBA752  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
  'Set analysis = absolute  
  .TypeAlarmLow = False  
  'Activate monitoring  
  .CheckAlarmLow = True  
  'Set barcolor = "yellow"  
  .ColorAlarmLow = RGB(255, 255, 0)  
  'Set lower limit = "10"  
  .AlarmLow = 10  
End With  
End Sub
```

### See also

[ColorAlarmLow Property \(Page 2183\)](#)

[CheckAlarmLow Property \(Page 2171\)](#)

[AlarmLow Property \(Page 2115\)](#)

[BarGraph Object \(Page 1914\)](#)

## TypeLimitHigh4 Property

### Description

TRUE, when the "Reserve 4" upper limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "70".

```
Sub BarGraphLimitConfiguration()  
'VBA753  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeLimitHigh4 = False  
'Activate monitoring  
.CheckLimitHigh4 = True  
'Set barcolor = "red"  
.ColorLimitHigh4 = RGB(255, 0, 0)  
'Set upper limit = "70"  
.LimitHigh4 = 70  
End With  
End Sub
```

### See also

[LimitHigh4 Property \(Page 2307\)](#)

[CheckLimitHigh4 Property \(Page 2172\)](#)

[BarGraph Object \(Page 1914\)](#)

## TypeLimitHigh5 Property

### Description

TRUE, when the "Reserve 5" upper limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "80".

```
Sub BarGraphLimitConfiguration()  
'VBA754  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeLimitHigh5 = False  
'Activate monitoring  
.CheckLimitHigh5 = True  
'Set barcolor = "black"  
.ColorLimitHigh5 = RGB(0, 0, 0)  
'Set upper limit = "70"  
.LimitHigh5 = 70  
End With  
End Sub
```

**See also**

- LimitHigh5 Property (Page 2307)
- CheckLimitHigh5 Property (Page 2173)
- BarGraph Object (Page 1914)

**TypeLimitLow4 Property**

**Description**

TRUE, when the "Reserve 4" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "5".

```
Sub BarGraphLimitConfiguration()  
'VBA755  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeLimitLow4 = False  
'Activate monitoring  
.CheckLimitLow4 = True  
'Set barcolor = "green"  
.ColorLimitLow4 = RGB(0, 255, 0)  
'Set lower limit = "5"  
.LimitLow4 = 5  
End With  
End Sub
```

**See also**

[LimitLow4 Property \(Page 2308\)](#)  
[ColorLimitLow4 Property \(Page 2187\)](#)  
[CheckLimitLow4 Property \(Page 2174\)](#)  
[BarGraph Object \(Page 1914\)](#)

**TypeLimitLow5 Property****Description**

TRUE, when the "Reserve 5" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "0".

```
Sub BarGraphLimitConfiguration()  
'VBA756  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeLimitLow5 = False  
'Activate monitoring  
.CheckLimitLow5 = True  
'Set barcolor = "white"  
.ColorLimitLow5 = RGB(255, 255, 255)  
'Set lower limit = "0"  
.LimitLow5 = 0  
End With  
End Sub
```

**See also**

- LimitLow5 Property (Page 2309)
- ColorLimitLow5 Property (Page 2188)
- CheckLimitLow5 Property (Page 2175)
- BarGraph Object (Page 1914)

**TypeToleranceHigh Property**

**Description**

TRUE, when the "Tolerance high" lower limit value should be evaluated as a percentage.  
FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.



**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the limit values. In this example the limit value for "Tolerance High" will be configured:

```
Sub BarGraphLimitConfiguration()  
'VBA757  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeToleranceHigh = False  
'Activate monitoring  
.CheckToleranceHigh = True  
'Set barcolor = "yellow"  
.ColorToleranceHigh = RGB(255, 255, 0)  
'Set upper limit = "40"  
.ToleranceHigh = 40  
End With  
End Sub
```

**See also**

[ColorToleranceHigh Property \(Page 2189\)](#)

[CheckToleranceHigh Property \(Page 2176\)](#)

[BarGraph Object \(Page 1914\)](#)

**TypeToleranceLow Property****Description**

TRUE, when the "Tolerance low" lower limit value should be evaluated as a percentage.  
FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the limit values. In this example the limit value for "Tolerance Low" will be configured:

```
Sub BarGraphLimitConfiguration()  
'VBA758  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
  'Set analysis = absolute  
  .TypeToleranceLow = False  
  'Activate monitoring  
  .CheckToleranceLow = True  
  'Set barcolor = "red"  
  .ColorToleranceLow = RGB(255, 0, 0)  
  'Set lower limit = "10"  
  .ToleranceLow = 10  
End With  
End Sub
```

**See also**

- ToleranceLow Property (Page 2442)
- ColorToleranceLow Property (Page 2190)
- CheckToleranceLow Property (Page 2177)
- BarGraph Object (Page 1914)

**TypeWarningHigh Property**

**Description**

TRUE, when the "Warning high" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "75".

```
Sub BarGraphLimitConfiguration()  
'VBA759  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeWarningHigh = False  
'Activate monitoring  
.CheckWarningHigh = True  
'Set barcolor = "red"  
.ColorWarningHigh = RGB(255, 0, 0)  
'Set upper limit = "75"  
.WarningHigh = 75  
End With  
End Sub
```

**See also**

[WarningHigh Property \(Page 2552\)](#)

[ColorWarningHigh Property \(Page 2192\)](#)

[CheckWarningHigh Property \(Page 2178\)](#)

[BarGraph Object \(Page 1914\)](#)

**TypeWarningLow Property****Description**

TRUE, when the "Warning low" lower limit value should be evaluated as a percentage. FALSE, when the evaluation should be as an absolute value. BOOLEAN write-read access.

**Example:**

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "12".

```
Sub BarGraphLimitConfiguration()  
'VBA760  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeWarningLow = False  
'Activate monitoring  
.CheckWarningLow = True  
'Set barcolor = "magenta"  
.ColorWarningLow = RGB(255, 0, 255)  
'Set lower limit = "12"  
.WarningLow = 12  
End With  
End Sub
```

**See also**

- WarningLow Property (Page 2553)
- ColorWarningLow Property (Page 2193)
- CheckWarningLow Property (Page 2179)
- BarGraph Object (Page 1914)

**U**

**Underlined Property**

**Description**

TRUE if the font attribute "Underline" is set for the language-dependent text in the object.  
BOOLEAN write-read access.

**Example:**

The following example sets the font attributes of a button for French and English:

```
Sub ExampleForLanguageFonts()  
'VBA761  
Dim collLangFonts As HMILanguageFonts  
Dim objButton As HMIButton  
Set objButton = ActiveDocument.HMIObjects.AddHMIObject("myButton", "HMIButton")  
objButton.Text = "DefText"  
Set collLangFonts = objButton.LDFonts  
'  
'Set font-properties for french:  
With collLangFonts.ItemByLCID(1036)  
.Family = "Courier New"  
.Bold = True  
.Italic = False  
.Underlined = True  
.Size = 12  
End With  
'  
'Set font-properties for english:  
With collLangFonts.ItemByLCID(1033)  
.Family = "Times New Roman"  
.Bold = False  
.Italic = True  
.Underlined = False  
.Size = 14  
End With  
End Sub
```

**See also**

- [Size Property \(Page 2419\)](#)
- [Parent Property \(Page 2359\)](#)
- [LanguageID Property \(Page 2289\)](#)
- [Italic Property \(Page 2282\)](#)
- [Family Property \(Page 2229\)](#)
- [Bold Property \(Page 2151\)](#)
- [Application Property \(Page 2121\)](#)
- [LanguageFont Object \(Page 1996\)](#)

## UnselBGColor Property

### Description

Defines or returns the background color of entries in the text list object which are not selected. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

### Example:

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the colors will be defined for entries that are not selected in the selection list:

```
Sub TextListConfiguration()  
'VBA762  
Dim objTextList As HMITextList  
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")  
With objTextList  
.UnselBGColor = RGB(255, 0, 0)  
.UnselTextColor = RGB(0, 0, 0)  
End With  
End Sub
```

### See also

[TextList Object \(Page 2076\)](#)

## UnselTextColor Property

### Description

In the case of the TextList object, defines or returns the color of text in the selection list for entries that are not selected. LONG write-read access.

#### Determination of Color Value

The color is displayed in RGB format (Red, Green, Blue). Specify the corresponding decimal value for each of the three RGB values (value range from 0 to 255).

Use VBA function "RGB" to assign a color to a property. The color "red", for example, is represented as follows: RGB(255, 0, 0)

**Example:**

The "TextListConfiguration()" procedure accesses the properties of the object TextList. In this example the colors will be defined for entries that are not selected in the selection list:

```
Sub TextListConfiguration()
'VBA763
Dim objTextList As HMITextList
Set objTextList = ActiveDocument.HMIObjects.AddHMIObject("myTextList", "HMITextList")
With objTextList
.UnselBGColor = RGB(255, 0, 0)
.UnselTextColor = RGB(0, 0, 0)
End With
End Sub
```

**See also**

TextList Object (Page 2076)

**UpdateCycle Property****Description**

Defines or returns the type and frequency of updates to the picture window in Runtime.

Update Cycle	Assigned Value
Upon change	0
250 ms	1
500 ms	2
1 s	3
2 s	4
5 s	5
10 s	6
1 min	7
5 min	8
10 min	9
1 h	10
User cycle 1	11
User cycle 2	12
User cycle 3	13
User cycle 4	14
User cycle 5	15
Picture cycle	255

**Example:**

The "PictureWindowConfig" procedure accesses the properties of the picture window. In this example the picture window will be updated every 5 seconds in Runtime:

```
Sub PictureWindowConfig()  
'VBA764  
Dim objPicWindow As HMIPictureWindow  
Set objPicWindow = ActiveDocument.HMIObjects.AddHMIObject("PicWindow1", "HMIPictureWindow")  
With objPicWindow  
    .UpdateCycle = 5  
End With  
End Sub
```

**See also**

[PictureWindow Object \(Page 2029\)](#)

**UseEventState property**

**Description**

Specifies for the "HMIAdvancedStateDisplay" object whether the group value is evaluated for the representation of the states.

If the group value is used, you can assign pictures for the individual alarm statuses.

**UsedLanguage property**

**Description**

Use the UsedLanguage property to set the code page that matches the character set used.

LONG write-read access.



## Example

The "UsedLanguage" property and language ID "1033" are used in the following example to set the code page to English US.

```
Sub AddDynamicAsCSkriptToProperty()
'VBA856
Dim objCScript As HMIScriptInfo
Dim objCircle As HMICircle
Dim strCode As String
strCode = "long lHeight;" & vbCrLf & "int check;" & vbCrLf
strCode = strCode & "GetHeight (" & ""events.PDL"" & ", ""myCircle""); & vbCrLf"
strCode = strCode & "lHeight = lHeight+5;" & vbCrLf
strCode = strCode & "check = SetHeight (" & ""events.PDL"" & ", ""myCircle"", lHeight);"
strCode = strCode & vbCrLf & "//Return-Type: BOOL" & vbCrLf
strCode = strCode & "return check;"
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_C", "HMICircle")
'Create dynamic for Property "Radius":
Set objCScript = objCircle.Height.CreateDynamic(hmiDynamicCreationTypeCScript)
'set Sourcecode and cycletime:
  With objCScript
    .SourceCode = strCode
    .Trigger.Type = hmiTriggerTypeStandardCycle
    .Trigger.CycleType = hmiCycleType_2s
    .Trigger.Name = "Trigger1"
  'Set language English-US
  .UsedLanguage = 1033
  End With
End Sub
```

## UseGlobalAlarmClasses property

### Description

Defines whether to use globally configured alarm classes to visualize message events. The property is only relevant for PCS7 projects.

Value	Description
TRUE	Activates the global settings made in PCS7 alarm editor for visualizing the message events.
FALSE	Visualization of the message events is defined locally for each message class.

## UseGlobalSettings property

### Description

Specify whether to use global settings to assign message events to the buttons visualized in the group view. The display of the message events is configured using the "MessageClass" properties. The property is only relevant for PCS7 projects.

Value	Description
TRUE	Activates the settings made in the PCS7 alarm editor for the assignment of message events to the buttons in the group display. The bit numbers in the group value are assigned to the respective buttons.
FALSE	The message types are assigned locally to the buttons in the group display.

## UserValue1 Property

### Description

Defines or returns any value in the case of the GroupDisplay object.

The value can be evaluated by a script, for example. This value is neither evaluated nor displayed in Runtime.

### Example:

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example four different user values will be assigned:

```
Sub GroupDisplayConfiguration()
  'VBA765
  Dim objGroupDisplay As HMIGroupDisplay
  Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",
  "HMIGroupDisplay")
  With objGroupDisplay
    .UserValue1 = 0
    .UserValue2 = 25
    .UserValue3 = 50
    .UserValue4 = 75
  End With
End Sub
```

### See also

[UserValue4 Property \(Page 2468\)](#)

[UserValue3 Property \(Page 2467\)](#)

UserValue2-Eigenschaft (Page 2467)

GroupDisplay Object (Page 1980)

## UserValue2-Eigenschaft

### Description

Defines or returns any value in the case of the GroupDisplay object.

The value can be evaluated by a script, for example. This value is neither evaluated nor displayed in Runtime.

### Example:

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example four different user values will be assigned:

```
Sub GroupDisplayConfiguration()  
  'VBA766  
  Dim objGroupDisplay As HMIGroupDisplay  
  Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
  "HMIGroupDisplay")  
  With objGroupDisplay  
    .UserValue1 = 0  
    .UserValue2 = 25  
    .UserValue3 = 50  
    .UserValue4 = 75  
  End With  
End Sub
```

### See also

UserValue4 Property (Page 2468)

UserValue3 Property (Page 2467)

UserValue1 Property (Page 2466)

GroupDisplay Object (Page 1980)

## UserValue3 Property

### Description

Defines or returns any value in the case of the GroupDisplay object.

The value can be evaluated by a script, for example. This value is neither evaluated nor displayed in Runtime.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example four different user values will be assigned:

```
Sub GroupDisplayConfiguration()  
'VBA767  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.UserValue1 = 0  
.UserValue2 = 25  
.UserValue3 = 50  
.UserValue4 = 75  
End With  
End Sub
```

**See also**

- UserValue4 Property (Page 2468)
- UserValue2-Eigenschaft (Page 2467)
- UserValue1 Property (Page 2466)
- GroupDisplay Object (Page 1980)

**UserValue4 Property**

**Description**

Defines or returns any value in the case of the GroupDisplay object.  
The value can be evaluated by a script, for example. This value is neither evaluated nor displayed in Runtime.

**Example:**

The "GroupDisplayConfiguration()" procedure accesses the properties of the Group Display. In this example four different user values will be assigned:

```
Sub GroupDisplayConfiguration()  
'VBA768  
Dim objGroupDisplay As HMIGroupDisplay  
Set objGroupDisplay = ActiveDocument.HMIObjects.AddHMIObject("GroupDisplay1",  
"HMIGroupDisplay")  
With objGroupDisplay  
.UserValue1 = 0  
.UserValue2 = 25  
.UserValue3 = 50  
.UserValue4 = 75  
End With  
End Sub
```

**See also**

[UserValue3 Property \(Page 2467\)](#)  
[UserValue2-Eigenschaft \(Page 2467\)](#)  
[UserValue1 Property \(Page 2466\)](#)  
[GroupDisplay Object \(Page 1980\)](#)

**UseValueText property****Description**

Specifies whether a text tag is used instead of a formatted analog value.

**V****Value****Value Property****Description**

Returns or defines the value of an object property.

**Example:**

Use the Value property if you wish to return or define a value with the aid of the Properties listing. In this example the property of an ActiveX Control will be accessed via the Value property:

```
Sub AddActiveXControl()  
'VBA769  
Dim objActiveXControl As HMIActiveXControl  
Set objActiveXControl = ActiveDocument.HMIObjects.AddActiveXControl("WinCC_Gauge2",  
"XGAUGE.XGaugeCtrl.1")  
,  
,  
'Move ActiveX-Control:  
objActiveXControl.Top = 40  
objActiveXControl.Left = 60  
,  
'Modify individual properties:  
objActiveXControl.Properties("BackColor").value = RGB(255, 0, 0)  
End Sub
```

**See also**

Property Object (Page 2042)

**VALUE\_ACCESS\_FAULT Property**

**Description**

Defines or returns the value that will be assigned to the dynamic property if tag status "Access to tag not permitted" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle is given dynamics with the The dynamization takes place be evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA770  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VALUE\_MAX\_LIMIT Property (Page 2506)
- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)

- VALUE\_MIN\_LIMIT Property (Page 2510)
- VALUE\_MAX\_RANGE Property (Page 2508)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VariableStateValue Object (Page 2096)

## VALUE\_ADDRESS\_ERROR Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Addressing error" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA771  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)

3.6 VBA Reference

- VALUE\_MAX\_RANGE Property (Page 2508)
- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

### VALUE\_BAD\_COMMLUV Property

#### Description

Specifies the value assigned to a dynamized property if quality code "bad, no communication (last usable value)" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA818
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_BAD\\_DEVICE Property \(Page 2480\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_BAD\_COMMNUV Property

### Description

Specifies the value assigned to a dynamized property if quality code "bad, no communication (last usable value)" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[QualityCodeStateChecked Properties \(Page 2390\)](#)

[VALUE\\_UNCERT\\_SUBSTSET Property \(Page 2542\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

#### **VALUE\_BAD\_CONFERROR Property**

##### **Description**

Specifies the value assigned to a dynamized property if quality code "bad, no communication, value not accepted" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

## See also

VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
QualityCodeStateChecked Properties (Page 2390)  
VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_BAD\_DEVICE Property

### Description

Specifies a value assigned to a dynamized property if quality code "bad, device failure" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_UNCERT\\_ENGVHIGHLIM Property \(Page 2522\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

#### **VALUE\_BAD\_MISCSTATES Property**

##### **Description**

Specifies the value assigned to a dynamized property if quality code "bad miscellaneous states" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_UNCERT\\_ENGVONLIM Property \(Page 2526\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

#### **VALUE\_BAD\_NONSPECIFIC Property**

##### **Description**

Specifies the value assigned to a dynamized property if quality code "bad, non-specific" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA770  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of qualitycodestate  
.QualityCodeStateChecked = True  
End With  
With objDynDialog.QualityCodeStateValues(1)  
'  
'define a value for every state:  
.VALUE_BAD_COMMLUV = 20  
.VALUE_BAD_COMMNUV = 30  
.VALUE_BAD_CONFERROR = 40  
.VALUE_BAD_DEVICE = 60  
.VALUE_BAD_MISCSTATES = 70  
.VALUE_BAD_NONSPECIFIC = 80  
.VALUE_BAD_NOTCONNECTED = 90  
.VALUE_BAD_OUTOFSERV = 100  
.VALUE_BAD_PROCRELNOM = 110  
.VALUE_BAD_PROCRELSUB = 120  
.VALUE_HIGHLIMITED = 130  
.VALUE_LOWLIMITED = 140  
.VALUE_UNCERT_ENGVHIGHLIM = 150  
.VALUE_UNCERT_ENGVLOWLIM = 160  
.VALUE_UNCERT_INITVAL = 170  
.VALUE_UNCERT_LUV = 180  
.VALUE_UNCERT_MAINTDEM = 190  
.VALUE_UNCERT_MISCSTATES = 200  
.VALUE_UNCERT_NONSPECIFIC = 210  
.VALUE_UNCERT_PROCRELNOM = 220  
.VALUE_UNCERT_SIMVAL = 230  
.VALUE_UNCERT_SUBSTSET = 240  
End With  
End Sub
```

**See also**

[VALUE\\_UNCERT\\_ENGVONLIM Property \(Page 2526\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

#### **VALUE\_BAD\_NOTCONNECTED Property**

##### **Description**

Specifies a value assigned to a dynamized property if quality code "bad, not connected" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA770  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of qualitycodestate  
.QualityCodeStateChecked = True  
End With  
With objDynDialog.QualityCodeStateValues(1)  
'  
'define a value for every state:  
.VALUE_BAD_COMMLUV = 20  
.VALUE_BAD_COMMNUV = 30  
.VALUE_BAD_CONFERROR = 40  
.VALUE_BAD_DEVICE = 60  
.VALUE_BAD_MISCSTATES = 70  
.VALUE_BAD_NONSPECIFIC = 80  
.VALUE_BAD_NOTCONNECTED = 90  
.VALUE_BAD_OUTOFSERV = 100  
.VALUE_BAD_PROCRELNOM = 110  
.VALUE_BAD_PROCRELSUB = 120  
.VALUE_HIGHLIMITED = 130  
.VALUE_LOWLIMITED = 140  
.VALUE_UNCERT_ENGVHIGHLIM = 150  
.VALUE_UNCERT_ENGVLOWLIM = 160  
.VALUE_UNCERT_INITVAL = 170  
.VALUE_UNCERT_LUV = 180  
.VALUE_UNCERT_MAINTDEM = 190  
.VALUE_UNCERT_MISCSTATES = 200  
.VALUE_UNCERT_NONSPECIFIC = 210  
.VALUE_UNCERT_PROCRELNOM = 220  
.VALUE_UNCERT_SIMVAL = 230  
.VALUE_UNCERT_SUBSTSET = 240  
End With  
End Sub
```

**See also**

[VALUE\\_HIGHLIMITED Property \(Page 2500\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_BAD\_OUTOFSERV Property

### Description

Specifies a value assigned to a dynamized property if quality code "bad, out of service" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_BAD\\_CONFERROR Property \(Page 2478\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

#### VALUE\_BAD\_PROCRELNOM Property

##### Description

Specifies the value assigned to a dynamized property if quality code "bad, process related, no maintenance" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_UNCERT\\_LUV Property \(Page 2530\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_BAD\_PROCRELSUB Property

### Description

Specifies the value assigned to a dynamized property if quality code "bad, process related, substitute value" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_UNCERT\\_PROCRELNOM Property \(Page 2538\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_CONVERSION\_ERROR Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Conversion error" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA772  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)

- VALUE\_MAX\_RANGE Property (Page 2508)
- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_HANDSHAKE\_ERROR Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Handshake error" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA773  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)

VALUE\_MAX\_RANGE Property (Page 2508)

VALUE\_MAX\_LIMIT Property (Page 2506)

VALUE\_INVALID\_KEY Property (Page 2502)

VALUE\_HARDWARE\_ERROR Property (Page 2498)

VALUE\_CONVERSION\_ERROR Property (Page 2494)

VALUE\_ADDRESS\_ERROR Property (Page 2472)

VALUE\_ACCESS\_FAULT Property (Page 2470)

VariableStateValue Object (Page 2096)

## VALUE\_HARDWARE\_ERROR Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "No network module" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA774  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VALUE\_MAX\_RANGE Property (Page 2508)
- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)

- VALUE\_MIN\_LIMIT Property (Page 2510)
- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_HIGHLIMITED Property

### Description

Specifies the value assigned to a dynamized property if quality code "high limited" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[QualityCodeStateChecked Properties \(Page 2390\)](#)

[VALUE\\_UNCERT\\_SUBSTSET Property \(Page 2542\)](#)

- VALUE\_UNCERT\_SIMVAL Property (Page 2540)
- VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)
- VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)
- VALUE\_UNCERT\_MISCSTATES Property (Page 2534)
- VALUE\_UNCERT\_MAINTDEM Property (Page 2532)
- VALUE\_UNCERT\_LUV Property (Page 2530)
- VALUE\_UNCERT\_INITVAL Property (Page 2528)
- VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)
- VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)
- VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)
- VALUE\_LOWLIMITED Property (Page 2504)
- VALUE\_BAD\_PROCRELSUB Property (Page 2492)
- VALUE\_BAD\_PROCRELNOM Property (Page 2490)
- VALUE\_BAD\_OUTOFSERV Property (Page 2488)
- VALUE\_BAD\_NOTCONNECTED Property (Page 2486)
- VALUE\_BAD\_NONSPECIFIC Property (Page 2484)
- VALUE\_BAD\_MISCSTATES Property (Page 2482)
- VALUE\_BAD\_DEVICE Property (Page 2480)
- VALUE\_BAD\_CONFERROR Property (Page 2478)
- VALUE\_BAD\_COMMNUV Property (Page 2476)
- VALUE\_BAD\_COMMLUV Property (Page 2474)
- QualityCodeStateValue Object (Page 2044)

## VALUE\_INVALID\_KEY Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Tag not found" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA775  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)

- VALUE\_MAX\_RANGE Property (Page 2508)
- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_LOWLIMITED Property

### Description

Specifies the value assigned to a dynamized property if quality code "low limited" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA770  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of qualitycodestate  
.QualityCodeStateChecked = True  
End With  
With objDynDialog.QualityCodeStateValues(1)  
'  
'define a value for every state:  
.VALUE_BAD_COMMLUV = 20  
.VALUE_BAD_COMMNUV = 30  
.VALUE_BAD_CONFERROR = 40  
.VALUE_BAD_DEVICE = 60  
.VALUE_BAD_MISCSTATES = 70  
.VALUE_BAD_NONSPECIFIC = 80  
.VALUE_BAD_NOTCONNECTED = 90  
.VALUE_BAD_OUTOFSERV = 100  
.VALUE_BAD_PROCRELNOM = 110  
.VALUE_BAD_PROCRELSUB = 120  
.VALUE_HIGHLIMITED = 130  
.VALUE_LOWLIMITED = 140  
.VALUE_UNCERT_ENGVHIGHLIM = 150  
.VALUE_UNCERT_ENGVLOWLIM = 160  
.VALUE_UNCERT_INITVAL = 170  
.VALUE_UNCERT_LUV = 180  
.VALUE_UNCERT_MAINTDEM = 190  
.VALUE_UNCERT_MISCSTATES = 200  
.VALUE_UNCERT_NONSPECIFIC = 210  
.VALUE_UNCERT_PROCRELNOM = 220  
.VALUE_UNCERT_SIMVAL = 230  
.VALUE_UNCERT_SUBSTSET = 240  
End With  
End Sub
```

**See also**

[VALUE\\_BAD\\_PROCRELSUB Property \(Page 2492\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

- VALUE\_UNCERT\_SUBSTSET Property (Page 2542)
- VALUE\_UNCERT\_SIMVAL Property (Page 2540)
- VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)
- VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)
- VALUE\_UNCERT\_MISCSTATES Property (Page 2534)
- VALUE\_UNCERT\_MAINTDEM Property (Page 2532)
- VALUE\_UNCERT\_LUV Property (Page 2530)
- VALUE\_UNCERT\_INITVAL Property (Page 2528)
- VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)
- VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)
- VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)
- VALUE\_HIGHLIMITED Property (Page 2500)
- VALUE\_BAD\_PROCRELNOM Property (Page 2490)
- VALUE\_BAD\_OUTOFSERV Property (Page 2488)
- VALUE\_BAD\_NOTCONNECTED Property (Page 2486)
- VALUE\_BAD\_NONSPECIFIC Property (Page 2484)
- VALUE\_BAD\_MISCSTATES Property (Page 2482)
- VALUE\_BAD\_DEVICE Property (Page 2480)
- VALUE\_BAD\_CONFERROR Property (Page 2478)
- VALUE\_BAD\_COMMNUV Property (Page 2476)
- VALUE\_BAD\_COMMLUV Property (Page 2474)
- QualityCodeStateValue Object (Page 2044)

## VALUE\_MAX\_LIMIT Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Upper limit exceeded" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA776  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VALUE\_MIN\_LIMIT Property (Page 2510)
- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)

- VALUE\_MAX\_RANGE Property (Page 2508)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_MAX\_RANGE Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Format upper limit exceeded" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA777  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)

### 3.6 VBA Reference

- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_MIN\_LIMIT Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Lower limit exceeded" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA778  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MAX\_RANGE Property (Page 2508)

- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_MIN\_RANGE Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Format lower limit exceeded" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA779  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_LIMIT Property (Page 2510)
- VALUE\_MAX\_RANGE Property (Page 2508)

- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_NOT\_ESTABLISHED Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "No check-back message from the channel" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA780  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)
- VALUE\_MAX\_RANGE Property (Page 2508)

- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_SERVERDOWN Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Server not available" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA781  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)
- VALUE\_MAX\_RANGE Property (Page 2508)

### 3.6 VBA Reference

- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_STARTUP\_VALUE Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "Start value" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA782  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_TIMEOUT Property (Page 2520)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)
- VALUE\_MAX\_RANGE Property (Page 2508)

### 3.6 VBA Reference

- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

## VALUE\_TIMEOUT Property

### Description

Defines or returns the value that will be assigned to the dynamic property if tag status "No connection" occurs.

The value of the VariableStateChecked property must be TRUE in order for the status to be evaluated.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If the tag does not return a status, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA783  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

- VariableStateChecked Property (Page 2545)
- VALUE\_STARTUP\_VALUE Property (Page 2518)
- VALUE\_SERVERDOWN Property (Page 2516)
- VALUE\_NOT\_ESTABLISHED Property (Page 2514)
- VALUE\_MIN\_RANGE Property (Page 2512)
- VALUE\_MIN\_LIMIT Property (Page 2510)
- VALUE\_MAX\_RANGE Property (Page 2508)

- VALUE\_MAX\_LIMIT Property (Page 2506)
- VALUE\_INVALID\_KEY Property (Page 2502)
- VALUE\_HARDWARE\_ERROR Property (Page 2498)
- VALUE\_HANDSHAKE\_ERROR Property (Page 2496)
- VALUE\_CONVERSION\_ERROR Property (Page 2494)
- VALUE\_ADDRESS\_ERROR Property (Page 2472)
- VALUE\_ACCESS\_FAULT Property (Page 2470)
- VariableStateValue Object (Page 2096)

### **VALUE\_UNCERT\_ENGVHIGHLIM Property**

#### **Description**

Specifies the value assigned to a dynamized property if quality code "uncertain, engineering unit range violation, high limit set" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA770  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of qualitycodestate  
.QualityCodeStateChecked = True  
End With  
With objDynDialog.QualityCodeStateValues(1)  
'  
'define a value for every state:  
.VALUE_BAD_COMMLUV = 20  
.VALUE_BAD_COMMNUV = 30  
.VALUE_BAD_CONFERROR = 40  
.VALUE_BAD_DEVICE = 60  
.VALUE_BAD_MISCSTATES = 70  
.VALUE_BAD_NONSPECIFIC = 80  
.VALUE_BAD_NOTCONNECTED = 90  
.VALUE_BAD_OUTOFSERV = 100  
.VALUE_BAD_PROCRELNOM = 110  
.VALUE_BAD_PROCRELSUB = 120  
.VALUE_HIGHLIMITED = 130  
.VALUE_LOWLIMITED = 140  
.VALUE_UNCERT_ENGVHIGHLIM = 150  
.VALUE_UNCERT_ENGVLOWLIM = 160  
.VALUE_UNCERT_INITVAL = 170  
.VALUE_UNCERT_LUV = 180  
.VALUE_UNCERT_MAINTDEM = 190  
.VALUE_UNCERT_MISCSTATES = 200  
.VALUE_UNCERT_NONSPECIFIC = 210  
.VALUE_UNCERT_PROCRELNOM = 220  
.VALUE_UNCERT_SIMVAL = 230  
.VALUE_UNCERT_SUBSTSET = 240  
End With  
End Sub
```

**See also**

[VALUE\\_BAD\\_PROCRELSUB Property \(Page 2492\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

#### **VALUE\_UNCERT\_ENGVLOWLIM Property**

##### **Description**

Specifies the value assigned to a dynamized property if quality code "uncertain, engineering unit range violation, low limit set" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_UNCERT\\_PROCRELNOM Property \(Page 2538\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

#### **VALUE\_UNCERT\_ENGVONLIM Property**

##### **Description**

Specifies the value assigned to a dynamized property if quality code "uncertain, engineering unit range violation, on limits set" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA770  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of qualitycodestate  
.QualityCodeStateChecked = True  
End With  
With objDynDialog.QualityCodeStateValues(1)  
'  
'define a value for every state:  
.VALUE_BAD_COMMLUV = 20  
.VALUE_BAD_COMMNUV = 30  
.VALUE_BAD_CONFERROR = 40  
.VALUE_BAD_DEVICE = 60  
.VALUE_BAD_MISCSTATES = 70  
.VALUE_BAD_NONSPECIFIC = 80  
.VALUE_BAD_NOTCONNECTED = 90  
.VALUE_BAD_OUTOFSERV = 100  
.VALUE_BAD_PROCRELNOM = 110  
.VALUE_BAD_PROCRELSUB = 120  
.VALUE_HIGHLIMITED = 130  
.VALUE_LOWLIMITED = 140  
.VALUE_UNCERT_ENGVHIGHLIM = 150  
.VALUE_UNCERT_ENGVLOWLIM = 160  
.VALUE_UNCERT_INITVAL = 170  
.VALUE_UNCERT_LUV = 180  
.VALUE_UNCERT_MAINTDEM = 190  
.VALUE_UNCERT_MISCSTATES = 200  
.VALUE_UNCERT_NONSPECIFIC = 210  
.VALUE_UNCERT_PROCRELNOM = 220  
.VALUE_UNCERT_SIMVAL = 230  
.VALUE_UNCERT_SUBSTSET = 240  
End With  
End Sub
```

**See also**

[VALUE\\_UNCERT\\_SIMVAL Property \(Page 2540\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_UNCERT\_INITVAL Property

### Description

Specifies a value assigned to a dynamized property if quality code "uncertain, initial value" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_UNCERT\\_LUV Property \(Page 2530\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

- VALUE\_UNCERT\_SUBSTSET Property (Page 2542)
- VALUE\_UNCERT\_SIMVAL Property (Page 2540)
- VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)
- VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)
- VALUE\_UNCERT\_MISCSTATES Property (Page 2534)
- VALUE\_UNCERT\_MAINTDEM Property (Page 2532)
- VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)
- VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)
- VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)
- VALUE\_LOWLIMITED Property (Page 2504)
- VALUE\_HIGHLIMITED Property (Page 2500)
- VALUE\_BAD\_PROCRELSUB Property (Page 2492)
- VALUE\_BAD\_PROCRELNOM Property (Page 2490)
- VALUE\_BAD\_OUTOFSERV Property (Page 2488)
- VALUE\_BAD\_NOTCONNECTED Property (Page 2486)
- VALUE\_BAD\_NONSPECIFIC Property (Page 2484)
- VALUE\_BAD\_MISCSTATES Property (Page 2482)
- VALUE\_BAD\_DEVICE Property (Page 2480)
- VALUE\_BAD\_CONFERROR Property (Page 2478)
- VALUE\_BAD\_COMMNUV Property (Page 2476)
- VALUE\_BAD\_COMMLUV Property (Page 2474)
- QualityCodeStateValue Object (Page 2044)

## VALUE\_UNCERT\_LUV Property

### Description

Specifies a value assigned to a dynamized property if quality code "uncertain, last usable value" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_HIGHLIMITED Property \(Page 2500\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_UNCERT\_MAINTDEM Property

### Description

Specifies a value assigned to a dynamized property if quality code "uncertain, maintenance demanded" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_UNCERT\\_NONSPECIFIC Property \(Page 2536\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_UNCERT\_MISCSTATES Property

### Description

Specifies the value assigned to a dynamized property if quality code "uncertain miscellaneous states" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_LOWLIMITED Property \(Page 2504\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

- VALUE\_UNCERT\_SUBSTSET Property (Page 2542)
- VALUE\_UNCERT\_SIMVAL Property (Page 2540)
- VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)
- VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)
- VALUE\_UNCERT\_MAINTDEM Property (Page 2532)
- VALUE\_UNCERT\_LUV Property (Page 2530)
- VALUE\_UNCERT\_INITVAL Property (Page 2528)
- VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)
- VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)
- VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)
- VALUE\_HIGHLIMITED Property (Page 2500)
- VALUE\_BAD\_PROCRELSUB Property (Page 2492)
- VALUE\_BAD\_PROCRELNOM Property (Page 2490)
- VALUE\_BAD\_OUTOFSERV Property (Page 2488)
- VALUE\_BAD\_NOTCONNECTED Property (Page 2486)
- VALUE\_BAD\_NONSPECIFIC Property (Page 2484)
- VALUE\_BAD\_MISCSTATES Property (Page 2482)
- VALUE\_BAD\_DEVICE Property (Page 2480)
- VALUE\_BAD\_CONFERROR Property (Page 2478)
- VALUE\_BAD\_COMMNUV Property (Page 2476)
- VALUE\_BAD\_COMMLUV Property (Page 2474)
- QualityCodeStateValue Object (Page 2044)

## VALUE\_UNCERT\_NONSPECIFIC Property

### Description

Specifies the value assigned to a dynamized property if quality code "uncertain, non-specific" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.



**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_UNCERT\\_MAINTDEM Property \(Page 2532\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_UNCERT\_PROCRELNOM Property

### Description

Specifies the value assigned to a dynamized property if quality code "uncertain, process related, no maintenance" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_BAD\\_COMMNUV Property \(Page 2476\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

### 3.6 VBA Reference

- VALUE\_UNCERT\_SUBSTSET Property (Page 2542)
- VALUE\_UNCERT\_SIMVAL Property (Page 2540)
- VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)
- VALUE\_UNCERT\_MISCSTATES Property (Page 2534)
- VALUE\_UNCERT\_MAINTDEM Property (Page 2532)
- VALUE\_UNCERT\_LUV Property (Page 2530)
- VALUE\_UNCERT\_INITVAL Property (Page 2528)
- VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)
- VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)
- VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)
- VALUE\_LOWLIMITED Property (Page 2504)
- VALUE\_HIGHLIMITED Property (Page 2500)
- VALUE\_BAD\_PROCRELSUB Property (Page 2492)
- VALUE\_BAD\_PROCRELNOM Property (Page 2490)
- VALUE\_BAD\_OUTOFSERV Property (Page 2488)
- VALUE\_BAD\_NOTCONNECTED Property (Page 2486)
- VALUE\_BAD\_NONSPECIFIC Property (Page 2484)
- VALUE\_BAD\_MISCSTATES Property (Page 2482)
- VALUE\_BAD\_DEVICE Property (Page 2480)
- VALUE\_BAD\_CONFERROR Property (Page 2478)
- VALUE\_BAD\_COMMLUV Property (Page 2474)
- QualityCodeStateValue Object (Page 2044)

## VALUE\_UNCERT\_SIMVAL Property

### Description

Specifies a value assigned to a dynamized property if quality code "uncertain, simulated value" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()
'VBA770
Dim objDynDialog As HMIDynamicDialog
Dim objCircle As HMICircle
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,
"NewDynamic1")
With objDynDialog
.ResultType = hmiResultTypeAnalog
.AnalogResultInfos.ElseCase = 200
'
'Activate analysis of qualitycodestate
.QualityCodeStateChecked = True
End With
With objDynDialog.QualityCodeStateValues(1)
'
'define a value for every state:
.VALUE_BAD_COMMLUV = 20
.VALUE_BAD_COMMNUV = 30
.VALUE_BAD_CONFERROR = 40
.VALUE_BAD_DEVICE = 60
.VALUE_BAD_MISCSTATES = 70
.VALUE_BAD_NONSPECIFIC = 80
.VALUE_BAD_NOTCONNECTED = 90
.VALUE_BAD_OUTOFSERV = 100
.VALUE_BAD_PROCRELNOM = 110
.VALUE_BAD_PROCRELSUB = 120
.VALUE_HIGHLIMITED = 130
.VALUE_LOWLIMITED = 140
.VALUE_UNCERT_ENGVHIGHLIM = 150
.VALUE_UNCERT_ENGVLOWLIM = 160
.VALUE_UNCERT_INITVAL = 170
.VALUE_UNCERT_LUV = 180
.VALUE_UNCERT_MAINTDEM = 190
.VALUE_UNCERT_MISCSTATES = 200
.VALUE_UNCERT_NONSPECIFIC = 210
.VALUE_UNCERT_PROCRELNOM = 220
.VALUE_UNCERT_SIMVAL = 230
.VALUE_UNCERT_SUBSTSET = 240
End With
End Sub
```

**See also**

[VALUE\\_BAD\\_PROCRELNOM Property \(Page 2490\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

VALUE\_UNCERT\_SUBSTSET Property (Page 2542)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MISCSTATES Property (Page 2534)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VALUE\_UNCERT\_SUBSTSET Property

### Description

Specifies a value assigned to a dynamized property if quality code "uncertain, substitute set" occurs, or returns its value.

In order for the quality code to be analyzed, the QualityCodeStateChecked property must be TRUE.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. Dynamization uses the analysis of the quality code of a tag. If the tag fails to return a quality code, a substitute value (ElseCase property) is defined:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA770  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of qualitycodestate  
.QualityCodeStateChecked = True  
End With  
With objDynDialog.QualityCodeStateValues(1)  
'  
'define a value for every state:  
.VALUE_BAD_COMMLUV = 20  
.VALUE_BAD_COMMNUV = 30  
.VALUE_BAD_CONFERROR = 40  
.VALUE_BAD_DEVICE = 60  
.VALUE_BAD_MISCSTATES = 70  
.VALUE_BAD_NONSPECIFIC = 80  
.VALUE_BAD_NOTCONNECTED = 90  
.VALUE_BAD_OUTOFSERV = 100  
.VALUE_BAD_PROCRELNOM = 110  
.VALUE_BAD_PROCRELSUB = 120  
.VALUE_HIGHLIMITED = 130  
.VALUE_LOWLIMITED = 140  
.VALUE_UNCERT_ENGVHIGHLIM = 150  
.VALUE_UNCERT_ENGVLOWLIM = 160  
.VALUE_UNCERT_INITVAL = 170  
.VALUE_UNCERT_LUV = 180  
.VALUE_UNCERT_MAINTDEM = 190  
.VALUE_UNCERT_MISCSTATES = 200  
.VALUE_UNCERT_NONSPECIFIC = 210  
.VALUE_UNCERT_PROCRELNOM = 220  
.VALUE_UNCERT_SIMVAL = 230  
.VALUE_UNCERT_SUBSTSET = 240  
End With  
End Sub
```

**See also**

[VALUE\\_UNCERT\\_MISCSTATES Property \(Page 2534\)](#)

[QualityCodeStateChecked Properties \(Page 2390\)](#)

VALUE\_UNCERT\_SIMVAL Property (Page 2540)  
VALUE\_UNCERT\_PROCRELNOM Property (Page 2538)  
VALUE\_UNCERT\_NONSPECIFIC Property (Page 2536)  
VALUE\_UNCERT\_MAINTDEM Property (Page 2532)  
VALUE\_UNCERT\_LUV Property (Page 2530)  
VALUE\_UNCERT\_INITVAL Property (Page 2528)  
VALUE\_UNCERT\_ENGVONLIM Property (Page 2526)  
VALUE\_UNCERT\_ENGVLOWLIM Property (Page 2524)  
VALUE\_UNCERT\_ENGVHIGHLIM Property (Page 2522)  
VALUE\_LOWLIMITED Property (Page 2504)  
VALUE\_HIGHLIMITED Property (Page 2500)  
VALUE\_BAD\_PROCRELSUB Property (Page 2492)  
VALUE\_BAD\_PROCRELNOM Property (Page 2490)  
VALUE\_BAD\_OUTOFSERV Property (Page 2488)  
VALUE\_BAD\_NOTCONNECTED Property (Page 2486)  
VALUE\_BAD\_NONSPECIFIC Property (Page 2484)  
VALUE\_BAD\_MISCSTATES Property (Page 2482)  
VALUE\_BAD\_DEVICE Property (Page 2480)  
VALUE\_BAD\_CONFERROR Property (Page 2478)  
VALUE\_BAD\_COMMNUV Property (Page 2476)  
VALUE\_BAD\_COMMLUV Property (Page 2474)  
QualityCodeStateValue Object (Page 2044)

## VariablesExist Property

### Description

TRUE when all the tags used in the source code of a DynamicDialog object are defined. Read only access.

You can use this property to check whether all the tags that you have defined in the source code of the Dynamic dialog are created in WinCC.

### Example:

--

### See also

DynamicDialog Object (Page 1955)



## VariableStateChecked Property

### Description

TRUE if the status of the specified tag is used in the dynamic dialog for dynamization.  
BOOLEAN write-read access.

### Example:

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If a tag does not return a status, a substitute value (ElseCase property) is defined, a tag name is issued and three analog value ranges are created:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA785  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

### See also

[DynamicDialog Object \(Page 1955\)](#)

## VariableStateType Property

### Description

Returns the type of tag monitoring used to dynamize a property or an event: No monitoring, quality code, or tag status. Read only access.

Index	VariableStateType
0	hmiNoVariableState
1	hmiVariableQCState
2	hmiVariableState

### Example:

The procedure "GetVariableStateType()" reads the type of monitoring from the current document. In this example, the type of monitoring is output in a message:

```
Sub GetVariableStateType()  
  'VBA819  
  Dim objDyn As HMIDynamicDialog  
  Set objDyn =  
  ActiveDocument.Properties("Width").CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
  "'TestVal'")  
  MsgBox objDyn.VariableStateType  
  objDyn.Delete  
End Sub
```

### See also

[DynamicDialog Object \(Page 1955\)](#)

## VariableStateValues Property

### Description

Returns the VariableStateValues listing. Use the VariableStateValues property with the Item property to assign a value to the tag status to be used for dynamization.

**Example:**

In the following example the radius of a circle will be dynamically configured using the Dynamic dialog. The dynamization takes place by evaluating the status of a tag. If a tag does not return a status, a substitute value (ElseCase property) is defined, a tag name is issued and three analog value ranges are created:

```
Sub AddDynamicDialogToCircleRadiusTypeAnalog()  
'VBA786  
Dim objDynDialog As HMIDynamicDialog  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_A", "HMICircle")  
Set objDynDialog = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeDynamicDialog,  
"NewDynamic1")  
With objDynDialog  
.ResultType = hmiResultTypeAnalog  
.AnalogResultInfos.ElseCase = 200  
'  
'Activate analysis of variablestate  
.VariableStateChecked = True  
End With  
With objDynDialog.VariableStateValues(1)  
'  
'define a value for every state:  
.VALUE_ACCESS_FAULT = 20  
.VALUE_ADDRESS_ERROR = 30  
.VALUE_CONVERSION_ERROR = 40  
.VALUE_HANDSHAKE_ERROR = 60  
.VALUE_HARDWARE_ERROR = 70  
.VALUE_INVALID_KEY = 80  
.VALUE_MAX_LIMIT = 90  
.VALUE_MAX_RANGE = 100  
.VALUE_MIN_LIMIT = 110  
.VALUE_MIN_RANGE = 120  
.VALUE_NOT_ESTABLISHED = 130  
.VALUE_SERVERDOWN = 140  
.VALUE_STARTUP_VALUE = 150  
.VALUE_TIMEOUT = 160  
End With  
End Sub
```

**See also**

[VariableStateValues Object \(Listing\) \(Page 2097\)](#)

[DynamicDialog Object \(Page 1955\)](#)

## VariableTriggers Property

### Description

Returns the VariableTriggers listing. Use the VariableTriggers property in order to add a tag trigger to a VB action or C action.

### Example:

In the following example the radius of a circle is made dynamic with the aid of a VB script. A tag trigger is used as the trigger:

```
Sub DynamicWithVariableTrigger()  
'VBA787  
Dim objVBScript As HMIScriptInfo  
Dim objVarTrigger As HMIVariableTrigger  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("Circle_VariableTrigger",  
"HMICircle")  
Set objVBScript = objCircle.Radius.CreateDynamic(hmiDynamicCreationTypeVBScript)  
With objVBScript  
'Triggername and cycletime are defined by add-methode  
Set objVarTrigger = .Trigger.VariableTriggers.Add("VarTrigger", hmiVariableCycleType_10s)  
.SourceCode = ""  
End With  
End Sub
```

### See also

[VariableTriggers Object \(Listing\) \(Page 2101\)](#)

## VarName Property

### Description

Defines the tag whose status is to be used in the Dynamic dialog for the purpose of dynamics, or returns the name.

**Example:**

In this example the name of the trigger tag used for creating dynamics in the radius of a circle will be output:

```
Sub GetVarName()  
'VBA788  
Dim objVBScript As HMIScriptInfo  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.Item("Circle_VariableTrigger")  
Set objVBScript = objCircle.Radius.Dynamic  
With objVBScript  
'Reading out of variablename  
MsgBox "The radius is dynamicabled with: " & .Trigger.VariableTriggers.Item(1).VarName  
End With  
End Sub
```

**See also**

VariableStateValue Object (Page 2096)

**VBAVersion Property****Description**

Returns the VBA version number. Read only access.

**Example:**

In the following example the current VBA version number is output:

```
Sub ShowVBAVersion()  
'VBA789  
MsgBox Application.VBAVersion  
End Sub
```

**See also**

Application Object (Page 1909)

## VBE Property

### Description

Returns the VB Extensibility object. Read access.

### Example:

--

### See also

Application Object (Page 1909)

## Version Property

### Description

Returns the version number of the specified application. Read only access.

### Example:

In the following example the version number of the Graphics Designer is output:

```
Sub ShowVersionOfGraphicsDesigner()  
    'VBA791  
    MsgBox Application.Version  
End Sub
```

### See also

Application Object (Page 1909)

## Views Property

### Description

Returns the Views listing. Use the Views listing to create a new copy of a picture, for instance.

**Example:**

In the following example a copy of the active picture is created and then activated:

```
Sub AddView()  
'VBA792  
Dim objView As HMIView  
Set objView = ActiveDocument.Views.Add  
objView.Activate  
End Sub
```

**See also**

[Views Object \(Listing\) \(Page 2103\)](#)

**Visible Property****Description**

TRUE if the specified object is intended to be visible. BOOLEAN write-read access.

**Example:**

In the following example a circle will be inserted into the active picture. This circle is not intended to be visible in Runtime:

```
Sub HideCircleInRuntime()  
'VBA793  
Dim objCircle As HMICircle  
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("myCircle", "HMICircle")  
objCircle.Visible = False  
End Sub
```

**See also**

[ToolbarItem Object \(Page 2083\)](#)

[MenuItem Object \(Page 2013\)](#)

[HMIObject Object \(Page 1988\)](#)

[Document Object \(Page 1949\)](#)

[Toolbar Object \(Page 2080\)](#)

[Menu Object \(Page 2009\)](#)

[Application Object \(Page 1909\)](#)

## W - Z

### WarningHigh Property

#### Description

Defines or returns the high limit value "Warning High" in the case of the BarGraph object.

The "CheckWarningHigh" property must be set to "True" in order for the limit value to be monitored.

The display on reaching the limit value and the type of evaluation are defined via the properties ColorWarningHigh and TypeWarningHigh.

#### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the high limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "75".

```
Sub BarGraphLimitConfiguration()  
'VBA794  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
  'Set analysis = absolute  
  .TypeWarningHigh = False  
  'Activate monitoring  
  .CheckWarningHigh = True  
  'Set barcolor = "red"  
  .ColorWarningHigh = RGB(255, 0, 0)  
  'Set upper limit = "75"  
  .WarningHigh = 75  
End With  
End Sub
```

#### See also

[TypeWarningHigh Property \(Page 2458\)](#)

[ColorWarningHigh Property \(Page 2192\)](#)

[CheckWarningHigh Property \(Page 2178\)](#)

[BarGraph Object \(Page 1914\)](#)



## WarningLow Property

### Description

Defines or returns the low limit value "Warning Low" in the case of the BarGraph object.

The "CheckWarningLow" property must be set to "True" in order for the limit value to be monitored.

The display on reaching the limit value and the type of evaluation are defined via the properties ColorWarningLow and TypeWarningLow.

### Example:

The "BarGraphLimitConfiguration()" procedure configures the properties of the low limit value for an alarm. In this example the type of evaluation will be set to "Absolute". The alarm will be triggered at a value of "12".

```
Sub BarGraphLimitConfiguration()  
'VBA795  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
'Set analysis = absolute  
.TypeWarningLow = False  
'Activate monitoring  
.CheckWarningLow = True  
'Set barcolor = "magenta"  
.ColorWarningLow = RGB(255, 0, 255)  
'Set lower limit = "12"  
.WarningLow = 75  
End With  
End Sub
```

### See also

TypeWarningLow Property (Page 2459)  
ColorWarningLow Property (Page 2193)  
CheckWarningLow Property (Page 2179)  
BarGraph Object (Page 1914)

## Width Property

### Description

Defines or returns the width of an object in pixels.

**Example:**

In the following example three objects of different sizes will be inserted in the active picture. Then all objects will be selected and set to the same width:

```
Sub ApplySameWidthToSelectedObjects ()
'VBA796
Dim objCircle As HMICircle
Dim objRectangle As HMIRectangle
Dim objEllipse As HMIEllipse
Set objCircle = ActiveDocument.HMIObjects.AddHMIObject("sCircle", "HMICircle")
Set objRectangle = ActiveDocument.HMIObjects.AddHMIObject("sRectangle", "HMIRectangle")
Set objEllipse = ActiveDocument.HMIObjects.AddHMIObject("sEllipse", "HMIEllipse")
With objCircle
.Top = 30
.Left = 0
.Width = 15
.Selected = True
End With
With objRectangle
.Top = 80
.Left = 42
.Width = 40
.Selected = True
End With
With objEllipse
.Top = 48
.Left = 162
.Width = 120
.BackColor = RGB(255, 0, 0)
.Selected = True
End With
MsgBox "Objects selected!"
ActiveDocument.Selection.SameWidth
End Sub
```

**See also**

[HMIObject Object \(Page 1988\)](#)

**WinCCStyle property****Description**

Defines the style in which the object is displayed.

User-defined	Shows the object according to the respective settings.
global	Shows the object in a globally defined design.
Windows Style	Shows the object in Windows style.

## Example

## WindowBorder Property

### Description

TRUE if it is intended that the application window or picture window shall be displayed with a border in Runtime. BOOLEAN write-read access.

### Example:

The "ApplicationWindowConfig" procedure accesses the properties of the application window. In this example the application window will

```
Sub ApplicationWindowConfig()  
'VBA797  
Dim objAppWindow As HMIApplicationWindow  
Set objAppWindow = ActiveDocument.HMIObjects.AddHMIObject("AppWindow",  
"HMIApplicationWindow")  
With objAppWindow  
.Caption = True  
.CloseButton = False  
.Height = 200  
.Left = 10  
.MaximizeButton = True  
.Moveable = False  
.OnTop = True  
.Sizeable = True  
.Top = 20  
.Visible = True  
.Width = 250  
.WindowBorder = True  
End With  
End Sub
```

### See also

[PictureWindow Object \(Page 2029\)](#)

[ApplicationWindow Object \(Page 1911\)](#)

## WindowMonitorNumber property

### Description

Defines the monitor on which the picture window is displayed. This requires that the system supports more than one monitor. The attribute is only effective if the "Independent window" attribute is set to "Yes".

1-n The number of the monitor in the operating system on which the picture window is displayed.

### Example

## WindowPositionMode property

### Description

Defines the position and scaling of the picture window on the screen. The property is only effective if the "Independent window" attribute is set to "Yes".

Standard	The picture window is positioned in its original size in the configured position on the screen.
Center	The picture window is positioned in its original size, centered on the screen.
Maximize	The picture window is scaled to the size of the screen.

### Example

## WindowsStyle property

### Description

Defines whether the object is displayed in the Windows style of WinCC version 6.2. It can only be selected if "WinCC Classic" is chosen as the current design.

- yes Shows the object using the Windows style from WinCC version 6.2.  
 No Shows the object not using the Windows style from WinCC version 6.2.

### Example

## WindowState Property

### Description

Returns the status of the window containing the specified application. READ access.

WindowState	Assigned Value
Maximized	0
Minimized	1
Custom sized	2

### Example:

In the following example the window status of the Graphics Designer is output:

```
Sub ShowWindowState ()
  'VBA798
  Dim strState As String
  Select Case Application.WindowState
  Case 0
    strState = "The application-window is maximized"
  Case 1
    strState = "The applicationwindow is minimized"
  Case 2
    strState = "The application-window has a userdefined size"
  End Select
  MsgBox strState
End Sub
```

## See also

Application Object (Page 1909)

## ZeroPoint Property

### Description

Defines or returns the position of the zero point on the bar in the case of the BarGraph object.

Specify the value as a %age of the total bar height. The zero point can also be outside of the range represented.

The "ScalingType" property must be set to "2" and "Scaling" must be set to "True".

### Example:

The "BarGraphConfiguration()" procedure configures In this example the zero point is located halfway up the bar height:

```
Sub BarGraphConfiguration()  
'VBA799  
Dim objBarGraph As HMIBarGraph  
Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
With objBarGraph  
    .Scaling = True  
    .ScalingType = 2  
    .ZeroPoint = 50  
    .ZeroPointValue = 0  
End With  
End Sub
```

## See also

ZeroPointValue Property (Page 2559)

ScalingType Property (Page 2406)

Scaling Property (Page 2405)

BarGraph Object (Page 1914)

## ZeroPointValue Property

### Description

Defines or returns the absolute value for the zero point.

### Example:

The "BarGraphConfiguration()" procedure configures In this example the absolute value of the zero point will be set to "0".

```
Sub BarGraphConfiguration()  
  'VBA800  
  Dim objBarGraph As HMIBarGraph  
  Set objBarGraph = ActiveDocument.HMIObjects.AddHMIObject("Bar1", "HMIBarGraph")  
  With objBarGraph  
    .Scaling = True  
    .ScalingType = 2  
    .ZeroPointValue = 0  
  End With  
End Sub
```

### See also

[ZeroPoint Property \(Page 2558\)](#)  
[ScalingType Property \(Page 2406\)](#)  
[Scaling Property \(Page 2405\)](#)  
[BarGraph Object \(Page 1914\)](#)  
[3DBarGraph Object \(Page 1894\)](#)

## Zoom Property

### Description

Defines or returns the zoom factor.

### Example:

In this example a copy of the active picture is created and the zoom factor is set to 50%:

```
Sub CreateViewFromActiveDocument()  
  'VBA801  
  Dim objView As HMIView  
  Set objView = ActiveDocument.Views.Add  
  objView.Zoom = 50  
End Sub
```

### See also

[View Object \(Page 2102\)](#)

[PictureWindow Object \(Page 2029\)](#)

## 3.6.2 VBA in Other WinCC Editors

### 3.6.2.1 VBA in Other WinCC Editors

#### Introduction

In addition to Graphics Designer, you can automate the following WinCC editors with VBA:

- Tag Management
- Tag Logging
- Text library
- Alarm Logging

The functions for accessing the editors are contained in the "HMIGO" class.

#### Requirement

- The "HMIGenObjects.dll" file is referenced. This happens automatically during WinCC installation.

#### Principle

For access to the "HMIGO" class with VBA, you must reference the "HMI GeneralObjects 1.0 Type Library" in the VBA editor via the "Tools > References" menu. You must create a new instance of this class in the program code, e.g.:

```
'Dim HMIGOObject As New HMIGO
```



Create several different objects of this class if access several objects at the same time. Two instances of the "HMIGO" class are required, for example, in Tag Logging: The first instance is required for access to the archive tags, the second instance for access to the process value archive.

## Application

To enable you to use the functions and properties of the editors in VBA, you must have opened a project in WinCC.

You can then, for example, do the following directly from the program code:

- Create several tags and change the values
- Edit text entries in the TextLibrary
- Adapt messages.

## Querying Object State

The "HMIGO" class has the enumeration "HMIGO\_OBJECT\_STATE" which returns the state of the specified object. The enumeration can return the following values:

- OBJECT\_EMPTY (2): Connection to the object is not available.
- OBJECT\_OPENED (3): Connection to objects exists. You can change and read its parameters.
- OBJECT\_MODIFIED (4): An object's parameters have been changed. If the corresponding Commit function is not called, the changes are not saved.
- WINCC\_CONNECTED (1): The object is connected to the WinCC project. By default this connection is established when a function is called the first time. To release the connection, use the instruction "HMIGO = nothing", for example.

## Error Handling

Errors can occur when you use the "HMIGO" class. Use the "OnError" statement to respond to these error messages. The "OnError" statement must come before the call of a function from the HMIGeneralObjects class:

```
Sub CreateTag()
  'HMIGO_000
  Dim hmiGOTag as New HMIGO
  On Error GoTo ErrorHandlerHMIGO
  hmiGOTag.CreateTag "NewTag", TAG_BINARY_TAG, "ExistingConnection", "DB1,DD0,QC",
  "NewOrExistingGroupName"

  '...
Exit Sub
ErrorHandlerHMIGO:
MsgBox ("Error: " & Err.Number & " " & Err.Description & " " & Err.Source)
Resume Next
End Sub
```

As a result, an error text returned by the interface is output.

## See also

VBA in Alarm Logging (Page 2622)

VBA in the Text Library (Page 2608)

VBA in Tag Logging (Page 2573)

VBA in Tag Management (Page 2562)

### 3.6.2.2 VBA in Tag Management

## VBA in Tag Management

### Introduction

VBA can be used to:

- Create tags directly from the program code
- Modify and delete tags
- Read out and change the properties of the tags
- Read out and change the types of the tags
- Read out and change the values of the tags

---

#### Note

The tags may not be open or opened in tag management when editing with VBA. If you wish to change the data type of a tag, you must first delete the tag and then regenerate it. You must save the parameters first in order to be able to transfer them following the generation of tags.

---

### Principle

When you have created the instance of the "HMIGO" class, the following functions are available to you to access the tag management facility:

- CloseTag
- CommitTag
- CreateTag
- DeleteTag
- GetTag
- ListTag

The following enumerations are available for the parameter supply of these functions:

- HMIGO\_TAG\_TYPE
- HMIGO\_TAG\_LIST\_TYPE

---

#### Note

If you set the start value to a binary tag, use the values "0" or "1". Do not use the values "False" or "True". These values are no longer valid for VBA programming in WinCC and will result in an error message.

Replace the values "False" and "True" with "0" and "1" in your existing VBA code.

---

### Access to the Object Properties

You can also access the parameters of the above-mentioned functions directly in VBA by means of the following object properties:

Object property	Description	Read/Write
ObjectStateTag	Returns the object state via the enumeration HMIGO_OBJECT_STATE. Further information on this enumeration can be found in this documentation under "VBA in other WinCC Editors".	Yes/no
TagName	Name of the tag	Yes/no
TagGroupName	Name of a group in which the tag is inserted. If the group does not yet exist, it is created. If no group name is specified, the tag is created outside all groups.	Yes/no
TagConnection	Name of a connection in which the tag and/or group is to be created. The connection must already be in existence, otherwise a tag cannot be created. If the name is omitted, an internal tag is created.	Yes/no
TagMaximum	Sets the new value of the upper limit	Yes/yes
TagMinimum	Sets the new value of the lower limit	Yes/yes
TagStart	Sets the new start value	Yes/yes
TagS5S7Address	Address of the S7 or S5 PLC to which the tag is connected. If no address is specified, a blank entry is passed.	Yes/yes

Object property	Description	Read/Write
TagType (HMI- GO_TAG_TYPE)	Data type of the tag. The possible types are: <ul style="list-style-type: none"> <li>• TAG_BINARY_TAG (1)</li> <li>• TAG_SIGNED_8BIT_VALUE (2)</li> <li>• TAG_UNSIGNED_8BIT_VALUE (3)</li> <li>• TAG_SIGNED_16BIT_VALUE (4)</li> <li>• TAG_UNSIGNED_16BIT_VALUE (5)</li> <li>• TAG_SIGNED_32BIT_VALUE (6)</li> <li>• TAG_UNSIGNED_32BIT_VALUE (7)</li> <li>• TAG_FLOATINGPOINT_NUMBER_32BIT_IEEE_754 (8)</li> <li>• TAG_FLOATINGPOINT_NUMBER_64BIT_IEEE_754 (9)</li> <li>• TAG_TEXT_TAG_8BIT_CHARACTER_SET (10)</li> <li>• TAG_TEXT_TAG_16BIT_CHARACTER_SET (11)</li> <li>• TAG_RAW_DATA_TYPE (12)</li> <li>• TAG_STRUCT (14)</li> <li>• TAG_TEXT_REFERENCE (18)</li> </ul>	Yes/no
TagUpdate (HMIGO_TAG_UP- DATE)	Defines whether the tag is updated on the local computer or for the entire project. (for internal tag only) <ul style="list-style-type: none"> <li>• TAG_COMPUTER_LOCAL (1)</li> <li>• TAG_PROJECT_WIDE (2)</li> </ul>	Yes/yes
LengthText	Length of a text tag (0...255) "LengthText" can also be used for the length of the raw data tag. A testing of the correctness of the length will not be conducted. Observe the instructions of the communication channels.	yes/yes (only for external tag of type text)
TagScaleValid	Defines a linear scaling.	Yes/yes
TagScaleParam1	Sets the value1 for the value range process.	Yes/yes
TagScaleParam2	Sets the value2 for the value range process.	Yes/yes
TagScaleParam3	Sets the value1 for the value range tag.	Yes/yes
TagScaleParam4	Sets the value2 for the value range tag.	Yes/yes
TagStartvaluePersistence	Defines whether an internal tag is set as persistent.	Yes/yes
TagSubst	Replacement value (only for external variables)	Yes/yes
UseSubstValueOn-CommonError	Set the replacement value for connection errors.	Yes/yes
UseSubstValueOn-MaxLimit	Set the replacement value for upper limit.	Yes/yes
UseSubstValueOn-MinLimit	Set the replacement value for lower limit.	Yes/yes
UseSubstValueOn-StartValue	Set the replacement value for the start value.	Yes/yes

You will find a description of the properties under the parameter descriptions for the corresponding functions.

---

**Note**

The "Tag synchronization" point in the property dialog of tags is not addressable with VBA. Tag synchronization is only available for internal tags.

For external tags, the "Type Conversion" point is not addressable with VBA.

---

**See also**

ListTag function (Page 2572)  
GetTag Function (Page 2571)  
DeleteTag Function (Page 2570)  
CreateTag Function (Page 2568)  
CommitTag Function (Page 2566)  
CloseTag Function (Page 2565)  
VBA in Other WinCC Editors (Page 2560)

**CloseTag Function****Description**

Closes the open tag.

---

**Note**

Modified parameters are not saved.

---

**Syntax**

```
Expression.CloseTag()
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

--

**Example:**

```
Sub CloseTag()  
  ' HMIGO_001  
  ' procedure to close a variable  
  ' tag need to be created before  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim strVariableName As String  
  Set objHMIGO = New HMIGO  
  strVariableName = "NewVariable"  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"  
  'open a tag  
  objHMIGO.GetTag strVariableName  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"  
  'open a tag  
  objHMIGO.CloseTag  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"  
  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

- ListTag function (Page 2572)
- GetTag Function (Page 2571)
- DeleteTag Function (Page 2570)
- CreateTag Function (Page 2568)
- CommitTag Function (Page 2566)
- VBA in Tag Management (Page 2562)

**CommitTag Function**

**Description**

Writes the changed parameters of the open tag to WinCC.

---

**Note**

If further parameters are changed after a CommitTag call, write the changes to WinCC by calling this function again.

---

**syntax**

```
Expression.CommitTag()
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

--

**Example:**

```
Sub CommitTag()  
' HMIGO_002  
' procedure to change a property of a variable  
' tag need to be created before  
' declarations  
  Dim objHMIGO As HMIGO  
  Dim strVariableName As String  
  Set objHMIGO = New HMIGO  
  strVariableName = "NewVariable"  
'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"  
'open a tag  
  objHMIGO.GetTag strVariableName  
'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"  
'change a property  
  objHMIGO.TagStart = 10  
'current status is "MODIFIED"  
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"  
'commit a tag  
  objHMIGO.CommitTag  
'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"  
  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

[ListTag function \(Page 2572\)](#)

[GetTag Function \(Page 2571\)](#)

[DeleteTag Function \(Page 2570\)](#)

[CreateTag Function \(Page 2568\)](#)

CloseTag Function (Page 2565)

VBA in Tag Management (Page 2562)

## CreateTag Function

### Description

Creates a new tag.

### syntax

```
Expression.CreateTag(TagName, TagType, [Connection], [S7S5Address], [GroupName])
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
TagName (string)	Name of the tag to be created.
TagType (HMIGO_TAG_TYPE)	Data type of the tag. The possible types are: TAG_BINARY_TAG TAG_SIGNED_8BIT_VALUE TAG_UNSIGNED_8BIT_VALUE TAG_SIGNED_16BIT_VALUE TAG_UNSIGNED_16BIT_VALUE TAG_SIGNED_32BIT_VALUE TAG_UNSIGNED_32BIT_VALUE TAG_FLOATINGPOINT_NUMBER_32BIT_IEEE_754 TAG_FLOATINGPOINT_NUMBER_64BIT_IEEE_754 TAG_TEXT_TAG_8BIT_CHARACTER_SET TAG_TEXT_TAG_16BIT_CHARACTER_SET TAG_RAW_DATA_TYPE TAG_TEXT_REFERENCE
Connection (String, optional)	Name of a connection in which the tag and/or group is to be created. The connection must already be in existence, otherwise a tag cannot be created. If the name is omitted, an internal tag and/or group is recreated.



Parameter (Data Type)	Description
S7S5Address (String, optional)	Address of the S7 or S5 PLC to which the tag is connected. Without an address indication, an empty entry will be handed over. The parameter "S7S5Address" must be supplemented by the string ",QC" for the configuration of the Quality Code, for example: "DB1,DD0,QC". If the Quality Code of the tag is no longer to be monitored, the string ",QC" must be deleted.
GroupName (String, optional)	Name of a group in which the tag is inserted. If the group does not exist, it will be newly created. If the group name is not indicated, the tag will be created outside all groups.

**Example:**

```

Sub CreateTag()
' HMIGO_003
' procedure to create a variable
' tag must not be created before
' declarations
Dim objHMIGO As HMIGO
Dim strVariableName As String
Set objHMIGO = New HMIGO
strVariableName = "NewVariable"
'current status is "EMPTY"
MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"
'create a tag
objHMIGO.CreateTag strVariableName, TAG_SIGNED_32BIT_VALUE
'current status is "OPENED"
MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"
Set objHMIGO = Nothing
End Sub

```

**See also**

[ListTag function \(Page 2572\)](#)  
[GetTag Function \(Page 2571\)](#)  
[DeleteTag Function \(Page 2570\)](#)  
[CommitTag Function \(Page 2566\)](#)  
[CloseTag Function \(Page 2565\)](#)  
[VBA in Tag Management \(Page 2562\)](#)

## DeleteTag Function

### Description

Deletes the specified tag.

### syntax

```
Expression.DeleteTag (TagName)
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
TagName (string)	Name of the tag to be deleted.

### Example:

```
Sub DeleteTag()  
' HMIGO_004  
' procedure to delete a variable  
' tag need to be created before  
' declarations  
Dim objHMIGO As HMIGO  
Dim strVariableName As String  
Set objHMIGO = New HMIGO  
strVariableName = "NewVariable"  
'current status is "EMPTY"  
MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"  
  
'delete a tag  
objHMIGO.DeleteTag strVariableName  
Set objHMIGO = Nothing  
End Sub
```

### See also

ListTag function (Page 2572)

GetTag Function (Page 2571)

CreateTag Function (Page 2568)

CommitTag Function (Page 2566)

CloseTag Function (Page 2565)

VBA in Tag Management (Page 2562)

## GetTag Function

### Description

Reads in the parameters of the specified tag.

You can change or read the parameters by means of the object properties. You will find a list of the available object properties in this documentation under "VBA in Tag Management".

### syntax

```
Expression.GetTag (TagName)
```

#### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
TagName (string)	Name of the tag whose values are to be read in.

### Example:

```
Sub GetTag()
' HMIGO_005
' procedure to open a variable
' tag need to be created before
' declarations
  Dim objHMIGO As HMIGO
  Dim strVariableName As String
  Set objHMIGO = New HMIGO
  strVariableName = "NewVariable"
'current status is "EMPTY"
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"
'open/ get a tag
  objHMIGO.GetTag strVariableName
'current status is "OPENED"
  MsgBox objHMIGO.ObjectStateTag, vbOKOnly, "Status Variable"
  Set objHMIGO = Nothing
End Sub
```

**See also**

- ListTag function (Page 2572)
- DeleteTag Function (Page 2570)
- CreateTag Function (Page 2568)
- CommitTag Function (Page 2566)
- CloseTag Function (Page 2565)
- VBA in Tag Management (Page 2562)

**ListTag function**

**Description**

Alternatively, the ListTag function returns the following contents of the Tag Management as a list:

- All the channel units created
- All the channels created
- All the connections created
- All the tag groups created
- All the tags created

**syntax**

`Expression.ListTag(ListType,pListArray,[Filter])`

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

Parameter (Data Type)	Description
ListType (HMIGO_TAG_LIST_TYPE)	Defines which content should be returned as a list. Possibilities are: <ul style="list-style-type: none"> <li>• TAG_CHANNEL_UNITS (0) all channel units created</li> <li>• TAG_CHANNELS (2) all channels created</li> <li>• TAG_CONNECTIONS (3) all connections created</li> <li>• TAG_GROUPS (4) all tag groups created</li> <li>• TAG_NAMES (5) all tags created</li> </ul>
pListArray (Variant)	List with the requested content.
Filter (String)	Filters can be set optionally. Wildcards "*" and "?" are also possible.

**Example:**

In the following example, a check is made whether the list with the connections created is empty because no connections have been set up:

```
Sub ReadTagByConnection()  
'HMIGO_027  
'read content in data manager by connections  
'no conections are implemented  
  Dim objHMIGO As New HMIGO  
Dim varRange As Variant  
'read all connections  
  objHMIGO.ListTag TAG_CONNECTIONS, arrContent  
'check result  
  If (UBound(arrContent) - LBound(arrContent) + 1) <= 0 Then  
    MsgBox "no entries because no connections are implemented"  
  End If  
End Sub
```

**See also**

[GetTag Function \(Page 2571\)](#)  
[DeleteTag Function \(Page 2570\)](#)  
[CreateTag Function \(Page 2568\)](#)  
[CommitTag Function \(Page 2566\)](#)  
[CloseTag Function \(Page 2565\)](#)  
[VBA in Tag Management \(Page 2562\)](#)

**3.6.2.3 VBA im Tag Logging****VBA in Tag Logging****Introduction**

VBA allows you to create process value archives, archive tags and triggers directly from the program code, modify them, and delete them.

---

**Note**

You should not have or should not open the "Tag Logging" editor when editing with VBA.

---

## Principle

When you have created the instance of the "HMIGO" class, the following functions are available to you to access Tag Logging:

- CloseTlgArchive
- CloseTlgTag
- CloseTlgTrigger
- CommitTlgArchive
- CommitTlgTag
- CommitTlgTrigger
- CreateTlgArchive
- CreateTlgTag
- CreateTlgTrigger
- DeleteTlgArchive
- DeleteTlgTag
- DeleteTlgTrigger
- GetTlgArchive
- GetTlgTag
- GetTlgTrigger
- ListTlgArchive
- ListTlgTag
- ListTlgTrigger

The following enumerations are available for the parameter supply of these functions:

- HMIGO\_TLG\_ARCHIVE\_TYPE
- HMIGO\_TLG\_ARCHIVE\_LIST\_TYPE
- HMIGO\_TLG\_TAG\_TYPE
- HMIGO\_TLG\_TAG\_LIST\_TYPE
- HMIGO\_TLG\_TRIGGER\_BASE
- HMIGO\_TLG\_TRIGGER\_LIST\_TYPE

## Direct Access to the Object Properties

You can also access the parameters of the above-mentioned functions directly in VBA by means of the following object properties. The column "is used in" will display whether you will be able to access the object property in the process value archive (P) and/or in the compressed archive (V).

Object property	Description	Read/Write	is used in
ObjectStateTlgArchive	Returns the object state for the archive via the enumeration "HMIGO_OBJECT_STATE". Further information on this enumeration can be found in this documentation under "VBA in other WinCC Editors".	Yes/no	P, V
ObjectStateTlgTag	Returns the object state for the archive tag via the enumeration "HMIGO_OBJECT_STATE".	Yes/no	P, V
TlgArchiveAccessLevelRead	The authorization level for reading.	Yes/no	P, V
TlgArchiveAccessLevelWrite	The authorization level for writing.	Yes/no	P, V
TlgArchiveArchiveState	Specifies whether archiving is disabled or enabled at system startup. Possible values of the enum "HMIGO_TLG_ARCHIVE_STATE": <ul style="list-style-type: none"> <li>• TLG_ARCHIVE_STATE_LOCKED (1)</li> <li>• TLG_ARCHIVE_STATE_ACTIVATED (0)</li> </ul>	Yes/yes	P, V
TlgArchiveBufferSize	Specifies the number of records for a short-term archive.	Yes/yes	P
TlgArchiveBufferType	Specifies the tag storage location. The possible types of the enum "HMIGO_TLG_ARCHIVE_BUFFER_TYPE": <ul style="list-style-type: none"> <li>• TLG_ARCHIVE_BUFFER_TYPE_DISK (2)</li> <li>• TLG_ARCHIVE_BUFFER_TYPE_RAM (1)</li> </ul>	Yes/yes	P
TlgArchiveCompressRange	Specifies the compression time period. Name of the timer, greater than or equal to 1, defined under "Times" in the Tag Logging editor. Since the format is a string, it is language dependent. Can be determined via the function "ListTlgArchive(TLG_ARCHIVE_TRIGGER_NAMES, arrTrigger)"	Yes/yes	V
TlgArchiveCompressType	Specifies the algorithm for compressing the values. The possible types of the enum "HMIGO_TLG_ARCHIVE_COMPRESS_TYPE": <ul style="list-style-type: none"> <li>• TLG_COMPRESS_TYPE_CALC (1)</li> <li>• TLG_COMPRESS_TYPE_CALC_COPY (2)</li> <li>• TLG_COMPRESS_TYPE_CALC_DEL (3)</li> <li>• TLG_COMPRESS_TYPE_CALC_COPY_DEL (4)</li> </ul>	Yes/yes	V
TlgArchiveFlags	Used internally.		
TlgArchiveName	Name of the process value archive or compressed archive.	Yes/no	P, V

## 3.6 VBA Reference

Object property	Description	Read/ Write	is used in
TlgArchiveQCRActive	Specifies for the compressed archive whether weighted quality codes are used during archiving. The possible types of the enum "HMIGO_TLG_QCR_ACTIVE_FLAGS": <ul style="list-style-type: none"> <li>• TLG_QCR_ALL (15)</li> <li>• TLG_QCR_BAD (1)</li> <li>• TLG_QCR_GOOD_CASCADED (8)</li> <li>• TLG_QCR_GOOD_NONCASCADED (4)</li> <li>• TLG_QCR_OFF (0)</li> <li>• TLG_QCR_UNCERTAIN (2)</li> </ul>		V
TlgArchiveQCRBad	If weighted quality codes are used and the "Bad" option is activated, you define for the compression archive the percentage as of which the "Bad" state of process values is archived in the compression tag.		V
TlgArchiveQCRGoodCascade	If weighted quality codes are used and the "Good (Cascade)" option is activated, you define for the compression tag the percentage as of which the "Good (Cascade)" state of process values is archived in the compression tag.		V
TlgArchiveQCRGoodNonCascade	If weighted quality codes are used and the "Good (Non-Cascade)" option is activated, you define for the compression archive the percentage as of which the "Good (Non-Cascade)" state of process values is archived in the compression tag.		V
TlgArchiveQCRUncertain	If weighted quality codes are used and the "Uncertain" option is activated, you define for the compression archive the percentage as of which the "Uncertain" state of process values is archived in the compression tag.		V
TlgArchiveType	Specifies whether the archive is a process value archive or a compressed archive.	Yes/no	P, V
TlgTagAliasName	The alternative name by means of which the tag can be addressed (alias).	Yes/yes	P
TlgTagArchiveName	Name of the archive.	Yes/no	P, V
TlgTagArchiving	Specifies the acquisition type. Possible values of the enum "HMIGO_TLG_TAG_ARCHIVING": <ul style="list-style-type: none"> <li>• TLG_TAG_ACYCLIC (8388609)</li> <li>• TLG_TAG_CYCLIC_CONTINUOUS (8388610)</li> <li>• TLG_TAG_CYCLIC_SELECTIVE (8388612)</li> <li>• TLG_TAG_ON_EVERY_CHANGE (8388616)</li> </ul>	Yes/yes	P
TlgTagArchivingState	Specifies whether archiving is enabled or disabled at system startup. Possible values of the enum "HMIGO_TLG_TAG_ARCHIVING_STATE": <ul style="list-style-type: none"> <li>• TLG_TAG_LOCKED (1)</li> <li>• TLG_TAG_ACTIVATED (0)</li> </ul>	Yes/yes	P, V
TlgTagConvertModule	Name of the conversion DLL used for data conversion.	Yes/yes	P



Object property	Description	Read/ Write	is used in
TlgTagFlags	Possible values of the enum "HMI-GO_TLG_TAG_FLAGS": <ul style="list-style-type: none"> <li>• TLG_TAG_LONGTERM_DISABLED (1)</li> <li>• TLG_TAG_NOFLAGS (0)</li> </ul>		
TlgTagHysteresis	Value for the hysteresis by means of which a check is carried out to establish whether a value has changed.	Yes/yes	P
TlgTagLowerLimit	Value for the scaling of the tag's lower limit.	Yes/yes	P
TlgTagMethodType	Specifies the method by which the value is edited before archiving. Possible values of the enum "HMI-GO_TLG_TAG_METHOD_TYPE": <ul style="list-style-type: none"> <li>• TLG_TAG_ACTUAL (1)</li> <li>• TLG_TAG_SUM (3)</li> <li>• TLG_TAG_MaxValue (5)</li> <li>• TLG_TAG_MinValue (4)</li> <li>• TLG_TAG_AVERAGE (2)</li> </ul>	Yes/yes	P, V
TlgTagName	Name of the archive tag.	Yes/no	P, V
TlgTagNameCompressArchive	In the case of compressed archives, contains the name of the source archive.	Yes/yes	V
TlgTagNameCompressTag	In the case of compressed archives, contains the name of the source tag.	Yes/yes	V
TlgTagNameProcTag	Name of the process tag from which the value to be acquired is taken.	Yes/yes	P
TlgTagNameRawValue	In the case of process-controlled archives, contains the name of the raw-data tag.	Yes/yes	P
TlgTagOnChange	Specifies whether archiving is to be carried out in the event of a change. Possible values of the enum "HMI-GO_TLG_TAG_ON_CHANGE": <ul style="list-style-type: none"> <li>• TLG_TAG_EVERY_VALUE (0)</li> <li>• TLG_TAG_RELATIVE_HYSTERESE (1)</li> <li>• TLG_TAG_ABSOLUTE_HYSTERESE (2)</li> </ul>	Yes/yes	P
TlgTagOnError	Specifies whether, in the event of a problem, the most recently acquired value or the substitute value is saved. Possible values of the enum "HMI-GO_TLG_TAG_ON_ERROR": <ul style="list-style-type: none"> <li>• TLG_TAG_LAST_VALUE (1)</li> <li>• TLG_TAG_SUBSTITUTE (2)</li> </ul>	Yes/yes	P
TlgTagPreviousOSGUID	Used internally.		

## 3.6 VBA Reference

Object property	Description	Read/ Write	is used in
TlgTagQCRActive	Specifies for the compression tag whether weighted quality codes are used during archiving. The possible types of the enum "HMIGO_TLG_QCR_ACTIVE_FLAGS": <ul style="list-style-type: none"> <li>• TLG_QCR_ALL (15)</li> <li>• TLG_QCR_BAD (1)</li> <li>• TLG_QCR_GOOD_CASCADED (8)</li> <li>• TLG_QCR_GOOD_NONCASCADED (4)</li> <li>• TLG_QCR_OFF (0)</li> <li>• TLG_QCR_UNCERTAIN (2)</li> </ul>		V
TlgTagQCRBad	If weighted quality codes are used and the "Bad" option is activated, you define for the compression tag the percentage as of which the "Bad" state of process values is archived in the compression tag.		V
TlgTagQCRGoodCascade	If weighted quality codes are used and the "Good (Cascade)" option is activated, you define for the compression tag the percentage as of which the "Good (Cascade)" state of process values is archived in the compression tag.		V
TlgTagQCRGoodNonCascade	If weighted quality codes are used and the "Good (Non-Cascade)" option is activated, you define for the compression tag the percentage as of which the "Good (Non-Cascade)" state of process values is archived in the compression tag.		V
TlgTagQCRUncertain	If weighted quality codes are used and the "Uncertain" option is activated, you define for the compression tag the percentage as of which the "Uncertain" state of process values is archived in the compression tag.		V
TlgTagSDCompressDeviation	Specifies the absolute or relative value of the deviation, which is permitted for the calculation of the increase by the algorithm. Basic value is the process value saved last.		P
TlgTagSDCompression	Specifies whether the swinging door compression is activated.		P
TlgTagSDLowLimit	Specifies the low limit of the swinging door compression distribution when a relative deviation is activated.		P
TlgTagSDRelativeDecision	Specifies whether the relative value of the deviation is taken into consideration at the swinging door algorithm.		P
TlgTagSDtMax	Specifies the maximum duration between two archived values as the detection limit for swinging door compression.		P
TlgTagSDtMin	Specifies the minimum duration between two archived values as the detection limit for swinging door compression.		P
TlgTagSDUpperLimit	Specifies the upper limit of the swinging door compression distribution when a relative deviation is activated.		P
TlgTagStartEvent	Name of the tag by means of which the start of archiving is checked.	Yes/yes	P

Object property	Description	Read/Write	is used in
TlgTagStartTriggerFunction	Specifies the name of a script function by means of which a check is carried out for a start event for the start of archiving.	Yes/yes	P
TlgTagStopEvent	Name of the tag by means of which the stopping of archiving is checked.	Yes/yes	P
TlgTagStopTriggerFunction	Specifies the name of a script function by means of which a check is carried out for a stop event for the start of archiving.	Yes/yes	P
TlgTagTriggerArchiving	Name of the timer for the archiving cycle.	Yes/yes	P
TlgTagTriggerFactor	Contains the factor for the display cycle as a multiple of the archiving cycle.	Yes/yes	P
TlgTagTriggerFunction	Specifies the name of a script function for the dynamic switching of the acquisition and archiving cycles.	Yes/yes	P
TlgTagTriggerScan	Name of the timer for the acquisition cycle	Yes/yes	P
TlgTagTriggerType	Specifies how archiving is carried out at a signal change. Possible values of the enum "HMIGO_TLG_TAG_TRIGGER_TYPE": <ul style="list-style-type: none"> <li>• TLG_TAG_FROM_0_TO_1 (2)</li> <li>• TLG_TAG_FROM_1_TO_0 (3)</li> <li>• TLG_TAG_ALWAYS (4)</li> <li>• TLG_TAG_EVERY_CHANGE (1)</li> </ul>	Yes/yes	P
TlgTagType	Specifies the tag type. The possible types of the enum "HMIGO_TLG_TAG_TYPE": <ul style="list-style-type: none"> <li>• TLG_TAG_TYP_ANALOG (65537)</li> <li>• TLG_TAG_TYP_BINARY (65538)</li> <li>• TLG_TAG_TYP_PROCESS (65544)</li> <li>• TLG_TAG_TYP_COMPRESS (65540)</li> </ul>	Yes/yes	P, V
TlgTagUpperLimit	Value for the scaling of the tag's upper limit.	Yes/yes	P
TlgTriggerBase	Time base for the trigger. Possible values of the enum "HMIGO_TLG_TRIGGER_BASE": <ul style="list-style-type: none"> <li>• TLG_TRIGGER_BASE_250MS (250)</li> <li>• TLG_TRIGGER_BASE_500MS (500)</li> <li>• TLG_TRIGGER_BASE_DAY (&amp;H5265C00)</li> <li>• TLG_TRIGGER_BASE_HOUR (&amp;H36EE80)</li> <li>• TLG_TRIGGER_BASE_MIN (&amp;HEA60)</li> <li>• TLG_TRIGGER_BASE_SEC (&amp;H3E8)</li> </ul>		P
TlgTriggerCreatorID	Used internally.		P
TlgTriggerFactor	Integer factor that is taken into consideration for the trigger together with the time base.		P
TlgTriggerName	Name of the trigger.		P
TlgTriggerScheduleDayOfMonth	Specifies the day for the trigger for the "Monthly" time series.		P

Object property	Description	Read/ Write	is used in
TlgTriggerScheduleDaysOfWeek	Specifies the days for the trigger for the "Weekly" time series. Possible values of the enum "HMIGO_TLG_TRIGGER_SCHEDULE_DAYSOFWEEK": <ul style="list-style-type: none"> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_EVERY_DAY (127)</li> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_FRIDAY (32)</li> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_MONDAY (2)</li> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_NO_DAY (0)</li> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_SATURDAY (64)</li> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_SUNDAY (1)</li> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_THURSDAY (16)</li> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_TUESDAY (4)</li> <li>• TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_WEDNESDAY (8)</li> </ul>		P
TlgTriggerScheduleInterval	Specifies the interval for the trigger for the calendar times.		P
TlgTriggerScheduleMonthOfYear	Specifies the month for the trigger for the "Yearly" time series.		P
TlgTriggerScheduleType	Defines the type of trigger. Possible time series of the enum "HMIGO_TLG_TRIGGER_SCHEDULE_TYPE": <ul style="list-style-type: none"> <li>• TLG_TRIGGER_SCHEDULE_TYPE_CYCLIC (0)</li> <li>• TLG_TRIGGER_SCHEDULE_TYPE_DAILY (1)</li> <li>• TLG_TRIGGER_SCHEDULE_TYPE_MONTHLY (3)</li> <li>• TLG_TRIGGER_SCHEDULE_TYPE_WEEKLY (2)</li> <li>• TLG_TRIGGER_SCHEDULE_TYPE_YEARLY (4)</li> </ul>		P
TlgTriggerStartByShutdown	The trigger is initiated additionally when the system is shut down regardless of the configured triggers.		P
TlgTriggerStartByStartup	The trigger is initiated additionally when the system is started up regardless of the configured triggers.		P
TlgTriggerStartDay	Specifies the day for the starting point of the trigger.		P
TlgTriggerStartHour	Specifies the hour for the starting point of the trigger.		P
TlgTriggerStartMilliSecond	Specifies the milliseconds for the starting point of the trigger.		P
TlgTriggerStartMinute	Specifies the minute for the starting point of the trigger.		P
TlgTriggerStartMonth	Specifies the month for the starting point of the trigger.		P
TlgTriggerStartSecond	Specifies the seconds for the starting point of the trigger.		P
TlgTriggerStartYear	Specifies the year for the starting point of the trigger.		P

**See also**

ListTlgTag Function (Page 2606)  
ListTlgArchive Function (Page 2604)  
GetTlgArchive Function (Page 2601)  
DeleteTlgTag Function (Page 2599)  
DeleteTlgArchive Function (Page 2598)  
CreateTlgTag Function (Page 2592)  
CreateTlgArchive Function (Page 2589)  
CommitTlgTag Function (Page 2587)  
CommitTlgArchive Function (Page 2585)  
CloseTlgTag Function (Page 2583)  
CloseTlgArchive Function (Page 2581)  
VBA in Other WinCC Editors (Page 2560)  
CloseTlgTrigger function (Page 2584)  
CommitTlgTrigger function (Page 2589)  
CreateTlgTrigger function (Page 2596)  
DeleteTlgTrigger function (Page 2600)  
GetTlgTrigger function (Page 2604)  
ListTlgTrigger function (Page 2607)

**CloseTlgArchive Function****Description**

Closes the process value or compressed archive which is open.

---

**Note**

Modified parameters are not saved.

---

**syntax**

```
Expression.CloseTlgArchive ()
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

--

**Example:**

```
Sub CloseTlgArchive()  
  ' HMIGO_006  
  ' procedure to close an archive  
  ' the archive need to be created before  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim strArchiveName As String  
  Set objHMIGO = New HMIGO  
  strArchiveName = "NewArchive"  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  'open archive  
  objHMIGO.GetTlgArchive strArchiveName  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  'close archive  
  objHMIGO.CloseTlgArchive  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

- ListTlgTag Function (Page 2606)
- ListTlgArchive Function (Page 2604)
- GetTlgArchive Function (Page 2601)
- DeleteTlgTag Function (Page 2599)
- DeleteTlgArchive Function (Page 2598)
- CreateTlgTag Function (Page 2592)
- CreateTlgArchive Function (Page 2589)
- CommitTlgTag Function (Page 2587)
- CommitTlgArchive Function (Page 2585)
- CloseTlgTag Function (Page 2583)
- VBA in Tag Logging (Page 2573)

## CloseTlgTag Function

### Description

Closes the archive tag which is open.

---

#### Note

Modified parameters are not saved.

---

### syntax

```
Expression.CloseTlgTag()
```

#### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

--

### Example:

```
Sub CloseTlgTag()  
  ' HMIGO_007  
  ' procedure to close a tag logging tag  
  ' the archive need to be created before  
  ' the tag logging tag need to be created before  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim strArchiveName As String  
  Dim strTlgTagName As String  
  Set objHMIGO = New HMIGO  
  strArchiveName = "NewArchive"  
  strTlgTagName = "NewTag"  
  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Tag"  
  'open/ get tag logging tag  
  objHMIGO.GetTlgTag strArchiveName, strTlgTagName  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Archive"  
  'close tag logging tag  
  objHMIGO.CloseTlgTag  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Archive"  
  Set objHMIGO = Nothing  
End Sub
```

## See also

ListTlgTag Function (Page 2606)  
ListTlgArchive Function (Page 2604)  
GetTlgArchive Function (Page 2601)  
DeleteTlgTag Function (Page 2599)  
DeleteTlgArchive Function (Page 2598)  
CreateTlgTag Function (Page 2592)  
CreateTlgArchive Function (Page 2589)  
CommitTlgTag Function (Page 2587)  
CommitTlgArchive Function (Page 2585)  
CloseTlgArchive Function (Page 2581)  
VBA in Tag Logging (Page 2573)

## CloseTlgTrigger function

### Description

Closes the opened trigger.

---

### Note

Modified parameters are not saved.

---

### Syntax

```
Expression.CloseTlgTrigger()
```

### Expression

Required. An expression which returns a "HMIGO" type object.

### Parameter

--



## CommitTlgArchive Function

### Description

Writes the changed parameters of the specified archive to WinCC.

---

### Note

If further parameters are changed after a CommitTlgArchive call, write the changes to WinCC by calling this function again.

---

### syntax

```
Expression.CommitTlgArchive()
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

--

**Example:**

```
Sub CommitTlgArchive()  
  ' HMIGO_008  
  ' procedure to change a property of an archive  
  ' the archive need to be created before  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim strArchiveName As String  
  Set objHMIGO = New HMIGO  
  strArchiveName = "NewArchive"  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  'open archive  
  objHMIGO.GetTlgArchive strArchiveName  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  'change a property  
  objHMIGO.TlgArchiveArchiveState = TLG_STATE_LOCKED  
  'current status is "MODIFIED"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  'commit archive  
  objHMIGO.CommitTlgArchive  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

- DeleteTlgArchive Function (Page 2598)
- ListTlgTag Function (Page 2606)
- ListTlgArchive Function (Page 2604)
- GetTlgArchive Function (Page 2601)
- DeleteTlgTag Function (Page 2599)
- CreateTlgTag Function (Page 2592)
- CreateTlgArchive Function (Page 2589)
- CommitTlgTag Function (Page 2587)
- CloseTlgTag Function (Page 2583)
- CloseTlgArchive Function (Page 2581)
- VBA in Tag Logging (Page 2573)

## CommitTlgTag Function

### Description

Writes the changed parameters of the specified archive tag to WinCC.

---

### Note

If further parameters are changed after a CommitTlgTag call, write the changes to WinCC by calling this function again.

---

### syntax

```
Expression.CommitTlgTag()
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

--

**Example:**

```
Sub CommitTlgTag()  
  ' HMIGO_009  
  ' procedure to change a property of a tag logging tag  
  ' the archive need to be created before  
  ' the tag logging tag need to be created before  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim strArchiveName As String  
  Dim strTlgTagName As String  
  Set objHMIGO = New HMIGO  
  strArchiveName = "NewArchive"  
  strTlgTagName = "NewTag"  
  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Tag"  
  'open/ get tag logging tag  
  objHMIGO.GetTlgTag strArchiveName, strTlgTagName  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Archive"  
  'change a property  
  objHMIGO.TlgTagArchiving = Tlg_TAG_ON_EVERY_CHANGE  
  'current status is "MODIFIED"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Archive"  
  'commit tag logging tag  
  objHMIGO.CommitTlgTag  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Archive"  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

- ListTlgTag Function (Page 2606)
- ListTlgArchive Function (Page 2604)
- GetTlgArchive Function (Page 2601)
- DeleteTlgTag Function (Page 2599)
- DeleteTlgArchive Function (Page 2598)
- CreateTlgTag Function (Page 2592)
- CreateTlgArchive Function (Page 2589)
- CommitTlgTag Function (Page 2587)
- CommitTlgArchive Function (Page 2585)
- CloseTlgTag Function (Page 2583)
- CloseTlgArchive Function (Page 2581)
- VBA in Tag Logging (Page 2573)

## CommitTlgTrigger function

### Description

Writes the changed parameters of the specified trigger to WinCC.

---

#### Note

If further parameters are changed after a CommitTlgTrigger call, write the changes to WinCC by calling this function again.

---

### Syntax

```
Expression.CommitTlgTrigger()
```

#### Expression

Required. An expression which returns a "HMIGO" type object.

### Parameter

--

## CreateTlgArchive Function

### Description

Creates a process value archive or compressed archive.

### syntax

```
Expression.CreateTlgArchive(ArchiveName, ArchiveType)
```

#### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
ArchiveName (String)	Name of the archive to be created
ArchiveType (HMIGO_TLG_ARCHIVE_TYPE)	Type of the archive. The possible types are: <ul style="list-style-type: none"> <li>• TLG_PROCESSARCHIVE (131073) for a process value archive</li> <li>• TLG_COMPRESSARCHIVE (131074) for a compressed archive</li> </ul>

### Default Values when Creating a New Tag Archive

The following table indicates the default values that are entered when a new process value archive or compressed archive is created. These values can be modified later and written using the CommitTlgArchive function.

Property	Default Value (Enum Name => Value)	Comment
TlgArchiveAccessLevel-Read	0	Without authorization level
TlgArchiveAccessLevel-Write	0	Without authorization level
TlgArchiveArchiveState	TLG_ARCHIVE_STATE_ACTIVATED (0)	Archiving is started at start of Runtime.
TlgArchiveBufferSize	1000	Number of data records
TlgArchiveBufferType	TLG_ARCHIVE_BUFFER_TYPE_DISK (2)	The values are stored on hard disk in the database.
TlgArchiveCompress-Range	"1 Tag". This string must be created individually for each language (e.g. English: "1 day")	Corresponds to exactly one day. Only relevant in the case of compressed tags. Special Feature: the user is responsible for values >= 1 minute
TlgArchiveCompressType	TLG_COMPRESS_TYPE_CALC (1)	Only calculate compression values. Only relevant in the case of compressed tags.

### Enum HMIGO\_TLG\_ARCHIVE\_STATE

Parameters	Description
TLG_ARCHIVE_STATE_LOCKED (1)	Archiving is disabled at system startup.
TLG_ARCHIVE_STATE_ACTIVATED (0)	Archiving is started at start of Runtime.

### Enum HMIGO\_TLG\_ARCHIVE\_BUFFER\_TYPE

Parameters	Description
TLG_ARCHIVE_BUFFER_TYPE_DISK (2)	The values are archived on hard disk.
TLG_ARCHIVE_BUFFER_TYPE_RAM (1)	The values are only archived in working memory.

### Enum HMIGO\_TLG\_ARCHIVE\_COMPRESS\_TYPE

Parameters	Description
TLG_COMPRESS_TYPE_CALC (1)	Only the compression values are calculated.
TLG_COMPRESS_TYPE_CALC_COPY (2)	The compression values are calculated and the original values copied.

Parameters	Description
TLG_COMPRESS_TYPE_CALC_DEL (3)	The compression values are calculated and the original values then deleted.
TLG_COMPRESS_TYPE_CALC_COPY_DEL (4)	The compression values are calculated and the original values copied and then deleted.

**Example:**

```

Sub CreateTlgArchive()
' HMIGO_010
' procedure to create an archive
' the archive must not be created before
' declarations
  Dim objHMIGO As HMIGO
  Dim strArchiveName As String
  Set objHMIGO = New HMIGO
  strArchiveName = "NewArchive"
'current status is "EMPTY"
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"
'create tag logging archive
  objHMIGO.CreateTlgArchive strArchiveName, TLG_PROCESSARCHIVE
'current status is "OPENED"
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"
  Set objHMIGO = Nothing
End Sub

```

**See also**

[GetTlgArchive Function \(Page 2601\)](#)  
[ListTlgTag Function \(Page 2606\)](#)  
[ListTlgArchive Function \(Page 2604\)](#)  
[DeleteTlgTag Function \(Page 2599\)](#)  
[DeleteTlgArchive Function \(Page 2598\)](#)  
[CreateTlgTag Function \(Page 2592\)](#)  
[CommitTlgTag Function \(Page 2587\)](#)  
[CommitTlgArchive Function \(Page 2585\)](#)  
[CloseTlgTag Function \(Page 2583\)](#)  
[CloseTlgArchive Function \(Page 2581\)](#)  
[VBA in Tag Logging \(Page 2573\)](#)

## CreateTlgTag Function

### Description

Creates a new archive tag.

### Syntax

```
Expression.CreateTlgTag (ArchiveName, TagName, [TagType])
```

### Expression

Required. An expression which returns a "HMIGO" type object.

### Parameter

Parameter (Data Type)	Description
ArchiveName (String)	Name of an existing archive in which the tag is to be entered
TagName (string)	Name of the tag to be created
TagType (HMIGO_TLG_TAG_TYPE, optional)	Specifies the type of the tag. If no type is specified, the default value TLG_VAR_TYP_ANALOG is entered. Possible types are: <ul style="list-style-type: none"> <li>• TLG_VAR_TYP_ANALOG (65537) for an analog tag.</li> <li>• TLG_VAT_TYP_BINARY (65538) for a binary tag.</li> <li>• TLG_VAR_TYP_PROCESS (65544) for a process tag.</li> <li>• TLG_VAT_TYP_COMPRESS (65540) for a compression tag.</li> </ul>

### Default Values When a New Archive Tag Is Created

The following table indicates the default values that are entered when a new archive tag is created. These values can be modified later and written using the CommitTlgTag function.

Property	Default Value (Enum Name => Value)	Note
TlgTagType	TLG_VAR_TYP_ANALOG (65537)	Acquired by means of an analog data manager tag
TlgTagArchiving	TLG_TAG_CYCLIC_CONTINUOUS (8388610)	Cyclic, continuous acquisition
TlgTagArchivingState	TLG_TAG_ACTIVATED (0)	Archiving is started at start of Runtime.
TlgTagTriggerScan	1 second	Please note that "1 second" is only the name of the trigger. You must ensure yourself that the trigger exists and actually has a cycle of 1 s.



Property	Default Value (Enum Name => Value)	Note
TlgTagTriggerArchiving	1 second	Please note that "1 second" is only the name of the trigger. You must ensure yourself that the trigger exists and actually has a cycle of 1 s.
TlgTagTriggerFactor	1	The display cycle and archiving cycle are identical.
TlgTagOnError	TLG_TAG_LAST_VALUE (1)	The last valid value is taken as the substitute value.
TlgTagTriggerType	TLG_TAG_ALWAYS (4)	Every value is archived.
TlgTagMethodType	TLG_TAG_ACTUAL (1)	No editing. The value is accepted immediately.
TlgTagStartTriggerFunction	No function specified	--
TlgTagStopTriggerFunction	No function specified	--
TlgTagTriggerFunction	No function specified	--
TlgTagUpperLimit	No value specified	--
TlgTagLowerLimit	No value specified	--
TlgTagNameCompressArchive	No archive name specified	--
TlgTagNameCompressTag	No tag name specified	--
TlgTagNameRawValue	No raw data tag specified	--
TlgTagNameProcTag	Corresponds to "TagName"	--
TlgTagOnChange	TLG_TAG_EVERY_VALUE (0)	Every value is archived.
TlgTagHysteresis	0	No check is carried out by means of hysteresis.
TlgTagAliasName	No value specified	--
TlgTagStartEvent	No tag specified	--
TlgTagStopEvent	No tag specified	--

### List of the enumerators for Tag Logging

Enum types	Description
TLG_TAG_TYPE	The passed parameter specifies the type of the tag. The possible types are in the table Enum HMIGO_TLG_TAG_TYPE.
TLG_TAG_ARCHIVING	The passed parameter specifies the acquisition type. The possible values are in the table Enum HMIGO_TLG_TAG_ARCHIVING.
TLG_TAG_ARCHIVING_STATE	The passed parameter specifies whether archiving is disabled or enabled at system startup. The possible values are in the table Enum HMIGO_TLG_TAG_ARCHIVING_STATE.
TLG_TAG_ON_ERROR	The passed parameter specifies which value is stored in the event of a problem: the most recently acquired value or the substitute value. The possible values are in the table Enum HMIGO_TLG_TAG_ON_ERROR.

Enum types	Description
TLG_TAG_TRIGGER_TYPE	The passed parameter specifies how archiving is carried out at a signal change. The possible values are in the table Enum HMIGO_TLG_TAG_TRIGGER_TYPE.
TLG_TAG_METHOD_TYPE	The passed parameter specifies the method by which the value is edited before archiving. The possible values are in the table Enum HMIGO_TLG_TAG_METHOD_TYPE.
TLG_TAG_ON_CHANGE	The passed parameter specifies whether archiving is to be carried out in the event of a change. The possible values are in the table Enum HMIGO_TLG_TAG_ON_CHANGE.

#### Enum HMIGO\_TLG\_TAG\_TYPE

Values	Description
TLG_TAG_TYP_ANALOG (65537)	Analog tag
TLG_TAG_TYP_BINARY (65538)	Binary tag
TLG_TAG_TYP_PROCESS (65544)	Process tag
TLG_TAG_TYP_COMPRESS (65540)	Compressed archive tag

#### Enum HMIGO\_TLG\_TAG\_ARCHIVING

Values	Description
TLG_TAG_ACYCLIC (8388609)	Acyclic acquisition
TLG_TAG_CYCLIC_CONTINUOUS (8388610)	Cyclic-continuous acquisition
TLG_TAG_CYCLIC_SELECTIVE (8388612)	Cyclic-selective acquisition
TLG_TAG_ON EVERY CHANGE (8388616)	Acquisition only in the event of a change

#### Enum HMIGO\_TLG\_TAG\_ARCHIVING\_STATE

Values	Description
TLG_TAG_LOCKED (1)	Acquisition disabled at system startup
TLG_TAG_ACTIVATED (0)	Acquisition enabled at system startup

#### Enum HMIGO\_TLG\_TAG\_ON\_ERROR

Values	Description
TLG_TAG_LAST_VALUE (1)	The most recently acquired value is used.
TLG_TAG_SUBSTITUTE (2)	A substitute value is entered.

**Enum HMIGO\_TLG\_TAG\_TRIGGER\_TYPE**

Values	Description
TLG_TAG_FROM_0_TO_1 (2)	Signal change from the value 0 to 1.
TLG_TAG_FROM_1_TO_0 (3)	Signal change from the value 1 to 0.
TLG_TAG_ALWAYS (4)	Always archive.
TLG_TAG_EVERY_CHANGE (1)	Archive at every signal change.

**Enum HMIGO\_TLG\_TAG\_METHOD\_TYPE**

Values	Description
TLG_TAG_ACTUAL (1)	The current value is accepted.
TLG_TAG_SUM (3)	The sum is formed.
TLG_TAG_MaxValue (5)	The greatest value is saved.
TLG_TAG_MinValue (4)	The smallest value is saved.
TLG_TAG_AVERAGE (2)	The average value is saved.

**Enum HMIGO\_TLG\_TAG\_ON\_CHANGE**

Values	Description
TLG_TAG_EVERY_VALUE (0)	The current value is accepted.
TLG_TAG_RELATIVE_HYSTERESE (1)	A hysteresis specified as a percentage is used for the calculation as to whether the value is to be archived.
TLG_TAG_ABSOLUTE_HYSTERESE (2)	A hysteresis specified as an absolute value is used for the calculation as to whether the value is to be archived.

## Example

```
Sub CreateTlgTag()  
  ' HMIGO_011  
  ' procedure to create a tag logging tag  
  ' the archive need to be created before  
  ' the tag logging tag must not be created before  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim strArchiveName As String  
  Dim strTlgTagName As String  
  Set objHMIGO = New HMIGO  
    strArchiveName = "NewArchive"  
    strTlgTagName = "NewTag"  
  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Tag"  
  'create tag logging tag  
  objHMIGO.CreateTlgTag strArchiveName, strTlgTagName, TLG_TAG_TYPE_ANALOG  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Archive"  
  Set objHMIGO = Nothing  
End Sub
```

## See also

- ListTlgTag Function (Page 2606)
- ListTlgArchive Function (Page 2604)
- GetTlgArchive Function (Page 2601)
- DeleteTlgTag Function (Page 2599)
- DeleteTlgArchive Function (Page 2598)
- CreateTlgArchive Function (Page 2589)
- CommitTlgTag Function (Page 2587)
- CloseTlgArchive Function (Page 2581)
- CloseTlgTag Function (Page 2583)
- VBA in Tag Logging (Page 2573)

## CreateTlgTrigger function

### Description

Creates a new trigger that is used as a timer for the acquisition and archiving cycle.

**Syntax**

Expression.CreateTlgTrigger (TriggerName, TriggerBase, TriggerFactor)

**Expression**

Required. An expression which returns a "HMIGO" type object.

**Parameter**

Parameter (Data Type)	Description
TriggerName (String)	Name of the trigger to be created
TriggerBase (HMIGO_TLG_TRIGGER_BASE)	Time base of the trigger. Possible values: <ul style="list-style-type: none"> <li>• TLG_TRIGGER_BASE_250MS (250)</li> <li>• TLG_TRIGGER_BASE_500MS (500)</li> <li>• TLG_TRIGGER_BASE_DAY (&amp;H5265C00)</li> <li>• TLG_TRIGGER_BASE_HOUR (&amp;H36EE80)</li> <li>• TLG_TRIGGER_BASE_MIN (&amp;HEA60)</li> <li>• TLG_TRIGGER_BASE_SEC (&amp;H3E8)</li> </ul>
TriggerFactor	Integer factor that is taken into consideration for the trigger together with the time base.

**Enum HMIGO\_TLG\_TRIGGER\_BASE**

Parameter	Description
TLG_TRIGGER_BASE_250MS (250)	The time base is "250 ms".
TLG_TRIGGER_BASE_500MS (500)	The time base is "500 ms".
TLG_TRIGGER_BASE_DAY (&H5265C00)	The time base is "1 day".
TLG_TRIGGER_BASE_HOUR (&H36EE80)	The time base is "1 hour".
TLG_TRIGGER_BASE_MIN (&HEA60)	The time base is "1 minute".
TLG_TRIGGER_BASE_SEC (&H3E8)	The time base is "1 second".

**Enum HMIGO\_TLG\_TRIGGER\_SCHEDULE\_DAYSOFWEEK**

Parameter	Description
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_EVERY_DAY (127)	Every day is used for the "Weekly" trigger.
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_FRIDAY (32)	Friday is used for the "Weekly" trigger.
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_MONDAY (2)	Monday is used for the "Weekly" trigger.
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_NO_DAY (0)	No day is used for the "Weekly" trigger.
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_SATURDAY (64)	Saturday is used for the "Weekly" trigger.
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_SUNDAY (1)	Sunday is used for the "Weekly" trigger.
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_THURSDAY (16)	Thursday is used for the "Weekly" trigger.
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_TUESDAY (4)	Tuesday is used for the "Weekly" trigger.
TLG_TRIGGER_SCHEDULE_DAYSOFWEEK_WEDNESDAY (8)	Wednesday is used for the "Weekly" trigger.

## Enum HMIGO\_TLG\_TRIGGER\_SCHEDULE\_TYPE

Parameter	Description
TLG_TRIGGER_SCHEDULE_TYPE_CYCLIC (0)	The time series "Standard (cyclic)" is used for the trigger.
TLG_TRIGGER_SCHEDULE_TYPE_DAILY (1)	The time series "Daily" is used for the trigger.
TLG_TRIGGER_SCHEDULE_TYPE_MONTHLY (3)	The time series "Monthly" is used for the trigger.
TLG_TRIGGER_SCHEDULE_TYPE_WEEKLY (2)	The time series "Weekly" is used for the trigger.
TLG_TRIGGER_SCHEDULE_TYPE_YEARLY (4)	The time series "Yearly" is used for the trigger.

## DeleteTlgArchive Function

## Description

Deletes the specified archive.

## Syntax

Expression.DeleteTlgArchive (ArchiveName)

## Expression

Necessary. An expression which returns a "HMIGO" type object.

## Parameters

Parameter (Data Type)	Description
ArchiveName (String)	Name of the archive to be deleted. Archive tags contained in the archive are also deleted.

## Example:

```
Sub DeleteTlgArchive()
' HMIGO_012
' procedure to delete an archive
' the archive need to be created before
' declarations
Dim objHMIGO As HMIGO
Dim strArchiveName As String
Set objHMIGO = New HMIGO
strArchiveName = "NewArchive"
'current status is "EMPTY"
MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"

'delete tag logging archive
objHMIGO.DeleteTlgArchive strArchiveName
Set objHMIGO = Nothing
End Sub
```

## See also

ListTlgTag Function (Page 2606)  
ListTlgArchive Function (Page 2604)  
GetTlgArchive Function (Page 2601)  
DeleteTlgTag Function (Page 2599)  
CreateTlgTag Function (Page 2592)  
CreateTlgArchive Function (Page 2589)  
CommitTlgTag Function (Page 2587)  
CommitTlgArchive Function (Page 2585)  
CloseTlgTag Function (Page 2583)  
CloseTlgArchive Function (Page 2581)  
VBA in Tag Logging (Page 2573)

## DeleteTlgTag Function

### Description

Deletes the specified archive tag.

### syntax

```
Expression.DeleteTlgTag (ArchiveName, TagName)
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
ArchiveName (String)	Name of the archive containing the archive tag to be deleted
TagName (string)	Name of the archive tag to be deleted.

### Example:

```
Sub DeleteTlgTag()  
' HMIGO_013  
' procedure to delete a tag logging tag  
' the archive need to be created before  
' the tag logging tag need to be created before  
' declarations  
Dim objHMIGO As HMIGO  
Dim strArchiveName As String  
Dim strTlgTagName As String  
Set objHMIGO = New HMIGO  
strArchiveName = "NewArchive"  
strTlgTagName = "NewTag"  
  
'current status is "EMPTY"  
MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Tag"  
'delete tag logging tag  
objHMIGO.DeleteTlgTag strArchiveName, strTlgTagName  
Set objHMIGO = Nothing  
End Sub
```

### See also

- ListTlgTag Function (Page 2606)
- ListTlgArchive Function (Page 2604)
- GetTlgArchive Function (Page 2601)
- DeleteTlgArchive Function (Page 2598)
- CreateTlgTag Function (Page 2592)
- CreateTlgArchive Function (Page 2589)
- CommitTlgTag Function (Page 2587)
- CommitTlgArchive Function (Page 2585)
- CloseTlgTag Function (Page 2583)
- CloseTlgArchive Function (Page 2581)
- VBA in Tag Logging (Page 2573)

### DeleteTlgTrigger function

#### Description

Deletes the specified trigger.



**Syntax**

```
Expression.DeleteTlgTrigger (TriggerName)
```

**Expression**

Required. An expression which returns a "HMIGO" type object.

**Parameter**

Parameter (Data Type)	Description
TriggerName (String)	Name of the trigger that is deleted.

**GetTlgArchive Function****Description**

Reads in the parameters of the specified archive.

You can change or read the parameters by means of the object properties. You will find a list of the available object properties in this documentation under "VBA in TagLogging".

**syntax**

```
Expression.GetTlgArchive (ArchiveName)
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

Parameter (Data Type)	Description
ArchiveName (String)	Name of the archive whose values are to be read in.

### Example:

```
Sub GetTlgArchive()  
  ' HMIGO_014  
  ' procedure to open an archive  
  ' the archive need to be created before  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim strArchiveName As String  
  Set objHMIGO = New HMIGO  
  strArchiveName = "NewArchive"  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  'open/ get tag logging archive  
  objHMIGO.GetTlgArchive strArchiveName  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateTlgArchive, vbOKOnly, "Status Tlg Archive"  
  Set objHMIGO = Nothing  
End Sub
```

### See also

- [CreateTlgTag Function \(Page 2592\)](#)
- [ListTlgTag Function \(Page 2606\)](#)
- [ListTlgArchive Function \(Page 2604\)](#)
- [GetTlgArchive Function \(Page 2601\)](#)
- [DeleteTlgTag Function \(Page 2599\)](#)
- [DeleteTlgArchive Function \(Page 2598\)](#)
- [CreateTlgArchive Function \(Page 2589\)](#)
- [CommitTlgTag Function \(Page 2587\)](#)
- [CommitTlgArchive Function \(Page 2585\)](#)
- [CloseTlgTag Function \(Page 2583\)](#)
- [CloseTlgArchive Function \(Page 2581\)](#)
- [VBA in Tag Logging \(Page 2573\)](#)

## GetTlgTag Function

### Description

Reads in the parameters of the specified archive tag.

You can change or read the parameters by means of the object properties. You will find a list of the available object properties in this documentation under "VBA in TagLogging".

**syntax**

```
Expression.GetTlgTag (ArchiveName, TagName)
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

Parameter (Data Type)	Description
ArchiveName (String)	Name of the archive containing the archive tag.
TagName	Name of the archive tag whose parameters are to be read in.

**Example:**

```
Sub GetTlgTag()
' HMIGO_015
' procedure to close a tag logging tag
' the archive need to be created before
' the tag logging need to be created before
' declarations
Dim objHMIGO As HMIGO
Dim strArchiveName As String
Dim strTlgTagName As String
Set objHMIGO = New HMIGO
strArchiveName = "NewArchive"
strTlgTagName = "NewTag"

'current status is "EMPTY"
MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Tag"
'open/ get tag logging tag
objHMIGO.GetTlgTag strArchiveName, strTlgTagName
'current status is "OPENED"
MsgBox objHMIGO.ObjectStateTlgTag, vbOKOnly, "Status Tlg Archive"
Set objHMIGO = Nothing
End Sub
```

**See also**

[CreateTlgTag Function \(Page 2592\)](#)  
[ListTlgTag Function \(Page 2606\)](#)  
[ListTlgArchive Function \(Page 2604\)](#)  
[GetTlgArchive Function \(Page 2601\)](#)  
[DeleteTlgTag Function \(Page 2599\)](#)  
[DeleteTlgArchive Function \(Page 2598\)](#)

- CreateTlgArchive Function (Page 2589)
- CommitTlgTag Function (Page 2587)
- CommitTlgArchive Function (Page 2585)
- CloseTlgTag Function (Page 2583)
- CloseTlgArchive Function (Page 2581)
- VBA in Tag Logging (Page 2573)

## GetTlgTrigger function

### Description

Reads in the parameters of the specified trigger.

You can change or read the parameters by means of the object properties. You will find a list of the available object properties in this documentation under "VBA in TagLogging".

### Syntax

```
Expression.GetTlgTrigger (TriggerName)
```

#### Expression

Required. An expression which returns a "HMIGO" type object.

### Parameter

Parameter (Data Type)	Description
TriggerName (String)	Name of the trigger whose values are read in.

## ListTlgArchive Function

### Description

Alternatively, the ListTlgArchive function returns the following Tag Logging values in a list:

- All existing Tag Logging archives
- All existing cycles / timers

### syntax

```
Expression.ListTlgArchive (ListType,pListArray, [Filter])
```

#### Expression

Necessary. An expression which returns a "HMIGO" type object.

## Parameters

Parameter (Data Type)	Description
ListType (HMIGO_TLG_ARCHIVE_LIST_TYPE)	Defines which content should be returned in a list. Possibilities are: <ul style="list-style-type: none"> <li>• TLG_ARCHIVE_NAMES (1) All created Tag Logging archives</li> <li>• TLG_ARCHIVE_TRIGGER_NAMES (2) All created cycles / timers</li> </ul>
pListArray (Variant)	List with the requested content.
Filter (String)	Filters can be set optionally. A trigger name can be used as a filter. Wildcards "*" and "?" are also possible.

## Example:

In the following example, a check is made whether archives are configured:

```
Sub ReadTlgArchives()
'HMIGO_028
'read content in tag logging
'no archives are implemented
  Dim objHMIGO As New HMIGO
Dim varRange As Variant
'read all tlg archives
  objHMIGO.ListTlgArchive TLG_ARCHIVE_NAMES, arrContent
'check result
  If (UBound(arrContent) - LBound(arrContent) + 1) <= 0 Then
    MsgBox "no entries because no tag logging archives are implemented"
  End If
End Sub
```

## See also

[ListTlgTag Function \(Page 2606\)](#)  
[GetTlgArchive Function \(Page 2601\)](#)  
[DeleteTlgTag Function \(Page 2599\)](#)  
[DeleteTlgArchive Function \(Page 2598\)](#)  
[CreateTlgTag Function \(Page 2592\)](#)  
[CreateTlgArchive Function \(Page 2589\)](#)  
[CommitTlgTag Function \(Page 2587\)](#)  
[CommitTlgArchive Function \(Page 2585\)](#)  
[CloseTlgTag Function \(Page 2583\)](#)

CloseTlgArchive Function (Page 2581)

VBA in Tag Logging (Page 2573)

## ListTlgTag Function

### Description

The ListTlgTag function returns all the tags created in a Tag Logging archive in a list.

### syntax

```
Expression.ListTlgTag(ListType,ListArray,[ArchiveName],[Filter])
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
ListType (HMIGO_TLG_TAG_LIST_TYPE)	Defines which content should be returned in a list. Possibilities are: TLG_TG_NAMES (1) All tags created in a Tag Logging archive
ListArray (Variant)	List with the requested content.
ArchiveName (String)	Name of the archive in Tag Logging (optional). If the name of the archive is not specified, all,archive tags are returned.
Filter (String)	Filters can be set optionally. Wildcards "*" and "?" are also possible.

**Example:**

In the following example, a check is made whether the archive tags are configured in the "Process Archive":

```
Sub ReadTlgTag()  
'HMIGO_029  
'read content in tag logging  
'no tags within archives are implemented  
    Dim objHMIGO As New HMIGO  
Dim varRange As Variant  
    Dim strArchive as String  
'set tlg archive name  
    strArchive = "processarchive"  
'read all tlg tags in specified archive  
    objHMIGO.ListTlgTag TLG_TAG_NAMES, arrContent, strArchive  
'check result  
    If (UBound(arrContent) - LBound(arrContent) + 1) <= 0 Then  
        MsgBox "no entries because no tag logging tags in specified archive are implemented"  
    End If  
End Sub
```

**See also**

- ListTlgArchive Function (Page 2604)
- GetTlgArchive Function (Page 2601)
- DeleteTlgTag Function (Page 2599)
- DeleteTlgArchive Function (Page 2598)
- CreateTlgTag Function (Page 2592)
- CreateTlgArchive Function (Page 2589)
- CommitTlgTag Function (Page 2587)
- CommitTlgArchive Function (Page 2585)
- CloseTlgTag Function (Page 2583)
- CloseTlgArchive Function (Page 2581)
- VBA in Tag Logging (Page 2573)

**ListTlgTrigger function****Description**

The function returns all created triggers in a list.

## Syntax

```
Expression.ListTlgTrigger(ListType,ListArray,[Filter])
```

### Expression

Required. An expression which returns a "HMIGO" type object.

## Parameter

Parameter (Data Type)	Description
ListType (HMIGO_TLG_TRIGGER_LIST_TYPE)	Defines the content that is to be returned in a list. Possibilities are: <ul style="list-style-type: none"> <li>• TLG_TRIGGER_NAMES (1) all created triggers</li> </ul>
ListArray (Variant)	List with the requested content.
Filter (String)	Filters can be set optionally. A trigger name can be used as a filter. Wildcards "*" and "?" are also possible.

### 3.6.2.4 VBA in the Text Library

## VBA in the Text Library

### Introduction

VBA allows you to generate Text Library texts directly from the program code, modify and delete them, and display text IDs and texts.

#### Note

You should not have or should not open the "TextLibrary" editor when editing with VBA.

## Principle

When you have created the instance of the "HMIGO" class, the following functions are available to you to access the TextLibrary:

- CreateTextLanguage
- CreateText
- DeleteText
- DeleteTextLanguage
- GetText
- GetTextID



- ListText
- ModifyText

The following enumerations are available for the parameter supply of these functions:

- HMIGO\_TEXT\_CREATE\_MODE
- HMIGO\_TEXT\_LIST\_TYPE

## See also

ModifyText Function (Page 2620)  
 ListText Function (Page 2619)  
 GetTextID Function (Page 2616)  
 GetText Function (Page 2615)  
 DeleteTextLanguage Function (Page 2614)  
 DeleteText Function (Page 2612)  
 CreateText Function (Page 2610)  
 CreateTextLanguage Function (Page 2609)  
 VBA in Other WinCC Editors (Page 2560)

## CreateTextLanguage Function

### Description

Creates a language in the Text Library.

### syntax

```
Expression.CreateTextLanguage (LanguageID)
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
LanguageID (Long)	ID for the language to be created (e.g. 1031 for German, 1033 for English, etc.) For a table of all language codes refer to the WinCC online help on "Language Identifiers".

### Example:

```
Sub CreateTextLanguage()  
  ' HMIGO_016  
  ' procedure to create a language in text library  
  ' language must not be created before  
  ' LanguageID german = 1031  
  ' LanguageID english(US) = 1033  
  ' LanguageID spanish = 1034  
  ' LanguageID french = 1040  
  ' LanguageID farsi= 1065  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim lngLangugeNumber As Long  
  Set objHMIGO = New HMIGO  
  lngLangugeNumber = 1065      'farsi  
  'create new language  
  objHMIGO.CreateTextLanguage lngLangugeNumber  
  Set objHMIGO = Nothing  
End Sub
```

### See also

- ModifyText Function (Page 2620)
- ListText Function (Page 2619)
- GetTextID Function (Page 2616)
- GetText Function (Page 2615)
- DeleteTextLanguage Function (Page 2614)
- DeleteText Function (Page 2612)
- CreateText Function (Page 2610)
- VBA in the Text Library (Page 2608)

## CreateText Function

### Description

Creates a new text for the language specified. Text input for other languages can be added using ModifyText.

### syntax

```
Expression.CreateText (LanguageID, Text, CreateMode, TextID)
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

## Parameters

Parameter (Data Type)	Description
LanguageID (Long)	ID of the language for which the text will be created.
Text (string)	Text to be created.
CreateMode (HMIGO_TEXT_CREATE_MODE)	Mode of text creation: <ul style="list-style-type: none"> <li>TEXT_ADD_REFCOUNT (0) only increases the reference counter when an identical text already exists.</li> <li>TEXT_CREATE_ALWAYS (1) always sets up a new text line and inserts the text in it.</li> </ul>
TextID (long)	Returns the TextID assigned to the new text or the TextID whose reference counter is increased. This ID is required for processing the text in other functions.

## Example:

```

Sub CreateText()
' HMIGO_017
' procedure to create a new text
' declarations
Dim objHMIGO As HMIGO
Dim lngLanguageID As Long
Dim lngTextCreateMode As Long
Dim lngTextID As Long      'return value of ".CreateText"
Dim strText As String
Set objHMIGO = New HMIGO
    strText = "new text"
'LanguageID = english
lngLanguageID = 1033
'"TEXT_ADD_REFCOUNT" check if text exists, if not create new text
lngTextCreateMode = 0
'"TEXT_CREATE_ALWAYS" create always a new text (for messages)
' lngTextCreateMode = 1

'create new text
objHMIGO.CreateText lngLanguageID, strText, lngTextCreateMode, lngTextID
'show TextID of created text
MsgBox "TextID: " & lngTextID, vbOKOnly, "Result CreateText"
Set objHMIGO = Nothing
End Sub

```

## See also

[ModifyText Function \(Page 2620\)](#)

[ListText Function \(Page 2619\)](#)

[GetTextID Function \(Page 2616\)](#)

- GetText Function (Page 2615)
- DeleteTextLanguage Function (Page 2614)
- DeleteText Function (Page 2612)
- CreateTextLanguage Function (Page 2609)
- VBA in the Text Library (Page 2608)

## DeleteText Function

### Description

Deletes a line of text. All the languages for the corresponding line of text and the line of text itself are deleted.

### syntax

```
Expression.DeleteText (TextID)
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
TextID (long)	ID of the line of text to be deleted

**Example:**

```

Sub DeleteText()
' HMIGO_018
' procedure to delete a text
' text will be searched and deleted
' declarations
  Dim objHMIGO As HMIGO
  Dim lngLanguageID As Long
  Dim lngTextID As Long           'return value of GetTextID
  Dim strText As String
On Error GoTo ErrorHandler
  Set objHMIGO = New HMIGO
  strText = "new text"
  lngLanguageID = 1033

'first: find text in text library and return TextID
objHMIGO.GetTextID 1033, strText, lngTextID

'if searched text exists: delete this text
If Not lngTextID = -1 Then
  objHMIGO.DeleteText lngTextID
  MsgBox "Text : "" & strText & "" found in TextID: " & lngTextID & vbNewLine & _
    "TextID is deleted!", vbOKOnly, "Result DeleteText"
Else
  MsgBox "Text : "" & strText & "" not found." & vbNewLine & _
    "No Text deleted!", vbOKOnly, "Result DeleteText"
End If
  Set objHMIGO = Nothing
  Exit Sub
ErrorHandler:
'if lngText = (-1), searched text does not exist
If lngTextID = -1 Then
  'reset errorhandler
  Err.Clear
  Resume Next
End If
  MsgBox "ErrNr. : " & Err.Number & vbNewLine & _
    "ErrDes.: " & Err.Description, vbOKOnly, "Error ocurred"
  'reset errorhandler
  Err.Clear
End Sub

```

**See also**

[VBA in the Text Library \(Page 2608\)](#)  
[ModifyText Function \(Page 2620\)](#)  
[ListText Function \(Page 2619\)](#)  
[GetTextID Function \(Page 2616\)](#)  
[GetText Function \(Page 2615\)](#)

DeleteTextLanguage Function (Page 2614)

CreateText Function (Page 2610)

CreateTextLanguage Function (Page 2609)

## DeleteTextLanguage Function

### Description

Enables a language to be deleted from the TextLibrary. In this case, all the texts in this language are also deleted.

### syntax

Expression.DeleteTextLanguage(LanguageID)

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
LanguageID (Long)	ID of the language to be deleted

### Example:

In the following example, a check is made whether the language '1036' exists. If it does, it will be deleted.

```
Sub DeleteLanguage()
    'HMIGO_030
    ' delete an existing languages in TextLibrary
    ' language '1036'/spanish has to exist
    Dim objHMIGO As New HMIGO
    Dim varRange As Variant
    Dim intLanguage As Long
    Dim lngPointer As Long
    ' get all existing languages
    objHMIGO.ListText TEXT_LANGUAGE_IDS, arrContent
    ' check requested list for language '1036'/ spanish and delete
    For lngPointer = LBound(arrContent) To UBound(arrContent)
        intLanguage = arrContent(lngPointer) + Val("&H400")
        If intLanguage = 1036 Then
            'delete language
            objHMIGO.DeleteTextLanguage intLanguage
        End If
    Next lngPointer
End Sub
```

## See also

GetText Function (Page 2615)  
ModifyText Function (Page 2620)  
ListText Function (Page 2619)  
GetTextID Function (Page 2616)  
DeleteText Function (Page 2612)  
CreateText Function (Page 2610)  
CreateTextLanguage Function (Page 2609)  
VBA in the Text Library (Page 2608)

## GetText Function

### Description

Returns the text for the selected text ID in the selected language.

### syntax

```
Expression.GetText (LanguageID, TextID, Text)
```

### Expression

Necessary. An expression that returns an object of the type "HMIGeneralObjects".

### Parameters

Parameter (Data Type)	Description
LanguageID (Long)	ID of the language of the text to be read
TextID (long)	ID of the line of text from which text is to be read
Text (string)	Returns the text of the selected line of text and language.

**Example:**

```
Sub GetText()  
  ' HMIGO_019  
  ' procedure to get a text  
  ' text with TextID = '69' need to be created  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim lngLanguageID As Long  
  Dim lngTextID As Long  
  Dim strText As String          'return value of GetText  
  Set objHMIGO = New HMIGO  
  lngTextID = 69  
  lngLanguageID = 1033  
  
  'find text text library  
  objHMIGO.GetText lngLanguageID, lngTextID, strText  
  
  'show found text  
  MsgBox "Read Text in TextID : " & lngTextID & " is "" & strText & "" !", _  
        vbOKOnly, "Result GetText"  
  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

- [ModifyText Function \(Page 2620\)](#)
- [ListText Function \(Page 2619\)](#)
- [GetTextID Function \(Page 2616\)](#)
- [DeleteTextLanguage Function \(Page 2614\)](#)
- [DeleteText Function \(Page 2612\)](#)
- [CreateText Function \(Page 2610\)](#)
- [CreateTextLanguage Function \(Page 2609\)](#)
- [VBA in the Text Library \(Page 2608\)](#)

**GetTextID Function****Description**

Returns the ID of the text searched for in the selected language.

If there are several texts with the same contents, only the line of text with the lowest ID is returned. Whether there are several lines of text with the same contents depends on the CreateMode of the CreateText function.



**syntax**

```
Expression.GetTextID(LanguageID, Text, TextID)
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

Parameter (Data Type)	Description
LanguageID (Long)	ID of the language of the text searched for
Text (string)	The text searched for
TextID (long)	ID of the line of text in which the text searched for was found

**Example:**

```
Sub GetTextID()  
  ' HMIGO_020  
  ' procedure to search a TextID  
  ' text will be searched and a TextID will be returned  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim lngLanguageID As Long  
  Dim lngTextID As Long           'return value of GetTextID  
  Dim strText As String  
On Error GoTo ErrorHandler  
  Set objHMIGO = New HMIGO  
  strText = "old text"  
  lngLanguageID = 1033  
  
  'first: find text in text library and return TextID  
  objHMIGO.GetTextID 1033, strText, lngTextID  
  
  'if searched text exists: delete this text  
  If Not lngTextID = -1 Then  
    MsgBox "Text : "" & strText & "" found in TextID: " & lngTextID, _  
          vbOKOnly, "Result GetTextID"  
  Else  
    MsgBox "Text : "" & strText & "" not found!", vbOKOnly, "Result GetTextID"  
  End If  
  Set objHMIGO = Nothing  
  Exit Sub  
ErrorHandler:  
  'if lngText = (-1), searched text does not exit  
  If lngTextID = -1 Then  
    'reset errorhandler  
  Err.Clear  
  Resume Next  
  End If  
  MsgBox "ErrNr. : " & Err.Number & vbNewLine & _  
        "ErrDes.: " & Err.Description, vbOKOnly, "Error ocurred"  
  'reset errorhandler  
  Err.Clear  
End Sub
```

**See also**

- ModifyText Function (Page 2620)
- ListText Function (Page 2619)
- GetText Function (Page 2615)
- DeleteTextLanguage Function (Page 2614)
- DeleteText Function (Page 2612)
- CreateText Function (Page 2610)

CreateTextLanguage Function (Page 2609)

VBA in the Text Library (Page 2608)

## ListText Function

### Description

Alternatively, the ListText function returns the following contents of the TextLibrary as a list:

- All languages created
- All text IDs
- All texts in a specific language

### syntax

```
Exoression.ListText(ListType,pListArray,[LanguageID],[Filter])
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
ListType (HMIGO_TEXT_LIST_TYPE)	Defines which content should be returned as a list. Possibilities are: <ul style="list-style-type: none"> <li>• TEXT_LANGUAGE_IDS (1) All the created languages. The result still has to be converted by adding 40hex.</li> <li>• TEXT_IDS (2) All text IDs.</li> <li>• TEXT_TEXTS (3) All texts in a language.</li> </ul>
pListArray (Variant)	List with the requested content.
LanguageID (Long)	The language ID whose text is to be returned.
Filter (String)	Filters can be set optionally. Wildcards "*" and "?" are also possible.

**Example:**

In the following example, a check is made whether the list with the text of a language is empty because the language does not exist:

```
Sub ReadTextsByLanguage()  
  'HMIGO_031  
  'read content in textLibrary by language  
  Dim objHMIGO As New HMIGO  
  Dim varRange As Variant  
  Dim intLanguage As Integer  
  'set invalid language ID  
  intLanguage = 1051 'language does not exist  
  'read all texts  
  objHMIGO.ListText TEXT_TEXTS, arrContent, intLanguage  
  'check result  
  If (UBound(arrContent) - LBound(arrContent) + 1) <= 0 Then  
    MsgBox "no entries because wrong language selection"  
  End If  
End Sub
```

**See also**

- ModifyText Function (Page 2620)
- GetTextID Function (Page 2616)
- GetText Function (Page 2615)
- DeleteTextLanguage Function (Page 2614)
- DeleteText Function (Page 2612)
- CreateTextLanguage Function (Page 2609)
- VBA in the Text Library (Page 2608)

**ModifyText Function**

**Description**

Modifies the text for the selected language with the ID specified.

**syntax**

```
Expression.ModifyText(LanguageID, TextID, Text)
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

## Parameters

Parameter (Data Type)	Description
LanguageID (Long)	ID of the language of the text to be changed.
TextID (long)	ID of the language of the text to be changed.
Text (string)	New text to be inserted.

## Example:

```

Sub ModifyText()
' HMIGO_021
' procedure to modify a text
' text will be searched and replaced
' declarations
  Dim objHMIGO As HMIGO
  Dim lngLanguageID As Long
  Dim lngTextID As Long      'return value of GetTextID
  Dim strOldText As String
  Dim strNewText As String
On Error GoTo ErrorHandler
  Set objHMIGO = New HMIGO
  strOldText = "old text"
  strNewText = "new text"
  lngLanguageID = 1033

'first: find text in text library and return TextID
objHMIGO.GetTextID 1033, strOldText, lngTextID

'if searched text exists: replace this text
If Not lngTextID = -1 Then
  objHMIGO.ModifyText lngLanguageID, lngTextID, strNewText
  MsgBox "Text : "" & strOldText & "" found in TextID: " & lngTextID & vbNewLine & _
    "Text replaced with : "" & strNewText & "" !", vbOKOnly, "Result DeleteText"
Else
  MsgBox "Text : "" & strOldText & "" not found." & vbNewLine & _
    "No Replacements done!", vbOKOnly, "Result DeleteText"
End If
  Set objHMIGO = Nothing
  Exit Sub
ErrorHandler:
'if lngText = (-1), searched text does not exist
  If lngTextID = -1 Then
    'reset errorhandler
  Err.Clear
  Resume Next
  End If
  MsgBox "ErrNr. : " & Err.Number & vbNewLine & _
    "ErrDes.: " & Err.Description, vbOKOnly, "Error ocurred"
  'reset errorhandler
  Err.Clear
End Sub

```

## See also

ListText Function (Page 2619)  
GetTextID Function (Page 2616)  
GetText Function (Page 2615)  
DeleteTextLanguage Function (Page 2614)  
DeleteText Function (Page 2612)  
CreateText Function (Page 2610)  
CreateTextLanguage Function (Page 2609)  
VBA in the Text Library (Page 2608)

### 3.6.2.5 VBA in Alarm Logging

## VBA in Alarm Logging

### Introduction

VBA allows you to create messages directly from the program code, modify them, and delete them.

---

#### Note

You should not have or should not open the "Alarm Logging" editor when editing with VBA.

---

### Principle

When you have created the instance of the "HMIGO" class, the following functions are available to you to access Alarm Logging:

- CloseSingleAlarm
- CommitSingleAlarm
- CreateSingleAlarm
- DeleteSingleAlarm
- GetSingleAlarm
- ListSingleAlarm

The following enumerations are available for the parameter supply of these functions:

- HMIGO\_SINGLE\_ALARM\_CLASS\_IDS
- HMIGO\_SINGLE\_ALARM\_LIST\_TYPE

## Access to the Object Properties

You can also access the parameters of the above-mentioned functions directly in VBA by means of the following object properties:

Object property	Description	Read/Write
ObjectStateSingleAlarm	Returns the object state via the enumeration HMIGO_OBJECT_STATE. Further information on this enumeration can be found in this documentation under "VBA in other WinCC Editors".	Yes/no
SingleAlarmMessageNumber	Number of the message	Yes/no
SingleAlarmAGNumber	AS Number	Yes/yes
SingleAlarmCPUNumber	CPU number of the AGs.	Yes/yes
SingleAlarmClassID	<p>Message class of the message. Possible values of the Enum SINGLE_ALARM_CLASS_IDS:</p> <ul style="list-style-type: none"> <li>• SINGLE_ALARM_ERROR (1)</li> <li>• SINGLE_ALARM_CLASS_2 (2)</li> <li>• SINGLE_ALARM_CLASS_3 (3)</li> <li>• SINGLE_ALARM_CLASS_4 (4)</li> <li>• SINGLE_ALARM_CLASS_5 (5)</li> <li>• SINGLE_ALARM_CLASS_6 (6)</li> <li>• SINGLE_ALARM_CLASS_7 (7)</li> <li>• SINGLE_ALARM_CLASS_8 (8)</li> <li>• SINGLE_ALARM_CLASS_9 (9)</li> <li>• SINGLE_ALARM_CLASS_10 (10)</li> <li>• SINGLE_ALARM_CLASS_11 (11)</li> <li>• SINGLE_ALARM_CLASS_12 (12)</li> <li>• SINGLE_ALARM_CLASS_13 (13)</li> <li>• SINGLE_ALARM_CLASS_14 (14)</li> <li>• SINGLE_ALARM_CLASS_15 (15)</li> <li>• SINGLE_ALARM_CLASS_16 (16)</li> <li>• SINGLE_ALARM_CLASS_SYSTEM_REQUIRE_ACKNOWLEDGEMENT (17)</li> <li>• SINGLE_ALARM_CLASS_SYSTEM_WITHOUT_ACKNOWLEDGEMENT (18)</li> </ul>	Yes/yes
SingleAlarmMessageTypeID	<p>Type ID of the message. The permissible values depend on the message class:</p> <ul style="list-style-type: none"> <li>• Class 1: Values from 1 to 16</li> <li>• Class 2: Values from 17 to 32</li> <li>• Class 3: Values from 33 to 48</li> <li>• ...</li> <li>• Class 18: 273 and 274</li> </ul>	Yes/yes
SingleAlarmTextXXID XX = 1...10	The properties SingleAlarmText1ID to SingleAlarmText10ID exist for the user texts 1 to 10.	Yes/yes

## 3.6 VBA Reference

Object property	Description	Read/Write
SingleAlarmTagNameProcessValueXX XX = 1...10	For the process values there are the properties SingleAlarmTagName-ProcessValue1 through 10 If you want to delete a configured process value, you must describe this parameter with a tag of the type "Long", which has the value "0". <sup>1)</sup>	Yes/yes
SingleAlarmTagName	Tag name for event	Yes/yes
SingleAlarmMessageBit	Bits for bit reporting procedure	Yes/yes
SingleAlarmQuitTag	Tag name for acknowledgment status	Yes/yes
SingleAlarmQuitBits	Bit for bit reporting procedure	Yes/yes
SingleAlarmStateTag	Tag for status query	Yes/yes
SingleAlarmStateBits	Bit for status tag	Yes/yes
SingleAlarmNormDLL	Name of the conversion DLL	Yes/yes
SingleAlarmQuitSingle	Acknowledgment of the messages, TRUE or FALSE possible	Yes/yes
SingleAlarmHornActivate	Activation of the horn, TRUE or FALSE possible	Yes/yes
SingleAlarmArchiving	Archiving of the message, TRUE or FALSE possible	Yes/yes
SingleAlarmProtocol	Logging of the message, TRUE or FALSE possible	Yes/yes
SingleAlarmFlankInvert	Triggering of message at falling edge, TRUE or FALSE possible	Yes/yes
SingleAlarmLockedOnStart	Message is disabled at system startup, TRUE or FALSE possible	Yes/yes
SingleAlarmGlobalAPFunction	Forward message to global AP function, TRUE or FALSE possible	Yes/yes
SingleAlarmActionName	Name of the action	Yes/yes
SingleAlarmActionParams	Parameters of the action	Yes/yes
SingleAlarmInfoText	Information text for message	Yes/yes
SingleAlarmGroup	Name of the user-defined group message assigned to a message.	Yes/yes

1)

```

Sub DeleteSingleAlarmTagNameProcessValue1()
    'HMIGO_033
    Dim objGO as HMIGO
    Dim var as Long
    var = 0
    Set objGO = new HMIGO
    'message 1 will be modified
    objGO.GetSingleAlarm 1
    objGO.SingleAlarmTagNameProcessValue1 = var
    objGO.CommitSingleAlarm
    Set objGO = nothing
End Sub

```

**See also**

[ListSingleAlarm Function \(Page 2633\)](#)  
[GetSingleAlarm Function \(Page 2632\)](#)  
[DeleteSingleAlarm Function \(Page 2631\)](#)  
[CreateSingleAlarm Function \(Page 2628\)](#)



CommitSingleAlarm Function (Page 2626)

CloseSingleAlarm Function (Page 2625)

VBA in Other WinCC Editors (Page 2560)

## CloseSingleAlarm Function

### Description

Closes the message which is open.

---

### Note

Modified parameters are not saved. If the current value should be saved, execute the CommitSingleAlarm() function again.

---

### syntax

```
Expression.CloseSingleAlarm()
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

--

**Example:**

```
Sub CloseSingleAlarm()  
  ' HMIGO_22  
  ' procedure to open a singlealarm  
  ' message #100 need to be created before  
  ' declarations  
  Dim objHMIGO As HMIGO  
  Dim lngMsgNumber As Long  
  Set objHMIGO = New HMIGO  
  lngMsgNumber = 100  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
  'open a singlealarm  
  objHMIGO.GetSingleAlarm lngMsgNumber  
  'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
  'close a singlealarm  
  objHMIGO.CloseSingleAlarm  
  'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

- ListSingleAlarm Function (Page 2633)
- GetSingleAlarm Function (Page 2632)
- DeleteSingleAlarm Function (Page 2631)
- CreateSingleAlarm Function (Page 2628)
- CommitSingleAlarm Function (Page 2626)
- VBA in Alarm Logging (Page 2622)

**CommitSingleAlarm Function**

**Description**

Writes the changed parameters of the open message to WinCC.

---

**Note**

To change further parameters after a CommitSingleAlarm call, write these changes to WinCC by calling the function again.

---

**syntax**

```
Expression.CommitSingleAlarm()
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

--

**Example:**

```
Sub CommitSingleAlarm()  
' HMIGO_023  
' procedure to change a property of a singlealarm  
' message #100 need to be created before  
' declarations  
  Dim objHMIGO As HMIGO  
  Dim lngMsgNumber As Long  
  Dim lngMsgBitNumber As Long  
  Set objHMIGO = New HMIGO  
  lngMsgNumber = 100  
  lngMsgBitNumber = 10  
'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
'open a singlealarm  
  objHMIGO.GetSingleAlarm lngMsgNumber  
'current status is "OPENED" for changes  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
'change a property  
  objHMIGO.SingleAlarmMessageBit = lngMsgBitNumber  
'current status is "MODIFIED" for changes  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
'commit a single alarm  
  objHMIGO.CommitSingleAlarm  
'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

[ListSingleAlarm Function \(Page 2633\)](#)

[GetSingleAlarm Function \(Page 2632\)](#)

[DeleteSingleAlarm Function \(Page 2631\)](#)

[CreateSingleAlarm Function \(Page 2628\)](#)

CloseSingleAlarm Function (Page 2625)

VBA in Alarm Logging (Page 2622)

## CreateSingleAlarm Function

### Description

Creates a new message.

### syntax

```
Expression.CreateSingleAlarm(MessageNumber, ClassID, MessageTypeID, Text1ID, MessageTagName, MessageBit)
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
MessageNumber (long)	Number of the message. <ul style="list-style-type: none"> <li>If an unused message number is specified here, it is accepted.</li> <li>If the value "0" is entered, the message number is freely assigned by the system. In this case, the message number is given back here.</li> </ul>
ClassID (HMIGO_SINGLE_ALARM_CLASS_IDS)	Message class. The possible values are in the table Enum HMIGO_SINGLE_ALARM_CLASS_IDS.
MessageTypeID (Integer)	The permissible values depend on the message class: <ul style="list-style-type: none"> <li>Class 1: Values from 1 to 16</li> <li>Class 2: Values from 17 to 32</li> <li>Class 3: Values from 33 to 48</li> <li>...</li> <li>Class 18: Values from 263 to 288</li> </ul>
Text1ID (Long)	ID for the first user text. The ModifySingleAlarm function can be used to define nine further user texts (1-10).
MessageTagName (String)	Tag name for the event.
MessageBit (integer)	Bit in bit reporting process (0...31)

### Default Values When a New Message Is Created

The following table indicates the default values that are entered when a new message is created. These properties can be modified. The modifications are saved using the `ModifySingleAlarm` function.

Parameters	Default Value (Enum Name => Value)	Comment
SingleAlarmAGNumber	0	--
SingleAlarmCPUNumber	0	--
SingleAlarmTextXXID	No text entered	--
SingleAlarmTagNameProcessValueXX	No tag entered	--
SingleAlarmQuitTag	No tag entered	--
SingleAlarmQuitBits	0	No bits set.
SingleAlarmStateTag	No tag entered	Corresponds to exactly one day. Only relevant in the case of compressed tags.
SingleAlarmStateBits	0	No bits set.
SingleAlarmNormDLL	No name entered	--
SingleAlarmQuitSingle	FALSE	Single acknowledgment, no group acknowledgment
SingleAlarmHornActivate	FALSE	Horn Not active.
SingleAlarmArchiving	TRUE	Message will be archived.
SingleAlarmProtocol	TRUE	Message is logged.
SingleAlarmFlankInvert	FALSE	Not activated.
SingleAlarmLockedOnStart	FALSE	Message is not disabled.
SingleAlarmGlobalAPIFunction	FALSE	Message is not forwarded.
SingleAlarmActionName	No name entered	--
SingleAlarmActionParams	No parameters entered for the action	--
SingleAlarmInfoText	No text entered	--
SingleAlarmGroup	No text entered	--

### Enum HMIGO\_SINGLE\_ALARM\_CLASS\_IDS

The following message classes are available for selection:

Values	Description
SINGLE_ALARM_ERROR (1)	--
SINGLE_ALARM_CLASS_2 (2)	--
SINGLE_ALARM_CLASS_3 (3)	--
SINGLE_ALARM_CLASS_4 (4)	--
SINGLE_ALARM_CLASS_5 (5)	--
SINGLE_ALARM_CLASS_6 (6)	--
SINGLE_ALARM_CLASS_7 (7)	--
SINGLE_ALARM_CLASS_8 (8)	--

Values	Description
SINGLE_ALARM_CLASS_9 (9)	--
SINGLE_ALARM_CLASS_10 (10)	--
SINGLE_ALARM_CLASS_11 (11)	--
SINGLE_ALARM_CLASS_12 (12)	--
SINGLE_ALARM_CLASS_13 (13)	--
SINGLE_ALARM_CLASS_14 (14)	--
SINGLE_ALARM_CLASS_15 (15)	--
SINGLE_ALARM_CLASS_16 (16)	--
SINGLE_ALARM_CLASS_SYSTEM_REQUIRE_ACKNOWLEDGEMENT (17)	--
SINGLE_ALARM_CLASS_SYSTEM_WITHOUT_ACKNOWLEDGEMENT (18)	--

**Example:**

```

Sub CreateSingleAlarm()
' HMIGO_024
' procedure to create a SingleAlarm
' message must not be created before
' message Text ID need to be created before in text library
' declarations
Dim objHMIGO As HMIGO
Dim strMsgText As String      'message text
Dim strMsgTagName As String  'message variable
Dim lngMsgNumber As Long     'message number
Dim lngMsgBitNumber As Long  'bit number within the message variable
Dim lngMsgTypeID As Long     'message type
Dim lngMsgClassID           'SINGLE_ALARM_ERROR
Dim lngMsgTextID As Long    'message text ID from textlibrary
Set objHMIGO = New HMIGO
strMsgText = "NewText"
'current status is "EMPTY"
MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"
'preset required parameter
lngMsgNumber = 50
lngMsgClassID = 1
lngMsgTypeID = 2
lngMsgTextID = 69
strMsgText = "new text message"
strMsgTagName = "NewVariable"
lngMsgBitNumber = 5

'create a tag
objHMIGO.CreateSingleAlarm lngMsgNumber,SINGLE_ALARM_ERROR, lngMsgTypeID,lngMsgTextID,
strMsgTagName, lngMsgBitNumber

'current status is "OPENED"
MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"
Set objHMIGO = Nothing
End Sub

```

**See also**

ListSingleAlarm Function (Page 2633)  
 GetSingleAlarm Function (Page 2632)  
 DeleteSingleAlarm Function (Page 2631)  
 CommitSingleAlarm Function (Page 2626)  
 CloseSingleAlarm Function (Page 2625)  
 VBA in Alarm Logging (Page 2622)

**DeleteSingleAlarm Function****Description**

Deletes the specified message.

**syntax**

Expression.DeleteSingleAlarm(MessageNumber)

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

Parameter (Data Type)	Description
MessageNumber (long)	Number of the message to be deleted.

**Example:**

```
Sub DeleteSingleAlarm()
' HMIGO_025
' procedure to delete a singlealarm
' message #100 need to be created before
' declarations
  Dim objHMIGO As HMIGO
  Dim lngMsgNumber As Long

  Set objHMIGO = New HMIGO
  lngMsgNumber = 100
'current status is "EMPTY"
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"

'delete a singlealarm
  objHMIGO.DeleteSingleAlarm lngMsgNumber
  Set objHMIGO = Nothing
End Sub
```

## See also

- VBA in Alarm Logging (Page 2622)
- ListSingleAlarm Function (Page 2633)
- GetSingleAlarm Function (Page 2632)
- CreateSingleAlarm Function (Page 2628)
- CommitSingleAlarm Function (Page 2626)
- CloseSingleAlarm Function (Page 2625)

## GetSingleAlarm Function

### Description

Reads in the parameters of the message entered.

You can change or read the parameters by means of the object properties. You will find a list of the available object properties in this documentation under "VBA in Alarm Logging".

### syntax

```
Expression.GetSingleAlarm(MessageNumber)
```

### Expression

Necessary. An expression which returns a "HMIGO" type object.

### Parameters

Parameter (Data Type)	Description
MessageNumber (long)	The message number of the message to be read in.



**Example:**

```
Sub GetSingleAlarm()  
' HMIGO_026  
' procedure to open a singlealarm  
' message #100 need to be created before  
' declarations  
  Dim objHMIGO As HMIGO  
  Dim lngMsgNumber As Long  
  Set objHMIGO = New HMIGO  
  lngMsgNumber = 100  
'current status is "EMPTY"  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
'open/ get a tag  
  objHMIGO.GetSingleAlarm lngMsgNumber  
'current status is "OPENED"  
  MsgBox objHMIGO.ObjectStateSingleAlarm, vbOKOnly, "Status SingleAlarm"  
  Set objHMIGO = Nothing  
End Sub
```

**See also**

[ListSingleAlarm Function \(Page 2633\)](#)  
[DeleteSingleAlarm Function \(Page 2631\)](#)  
[CreateSingleAlarm Function \(Page 2628\)](#)  
[CommitSingleAlarm Function \(Page 2626\)](#)  
[CloseSingleAlarm Function \(Page 2625\)](#)  
[VBA in Alarm Logging \(Page 2622\)](#)

**ListSingleAlarm Function****Description**

The ListSingleAlarm function returns the content of Alarm Logging in a list:

- All actions created which are linked to messages
- All message class IDs created
- All info texts created
- All message numbers created
- All message type IDs created
- All message classes created
- All group messages created

**syntax**

```
Expression.ListSingleAlarm(ListType,pListArray,[Filter])
```

**Expression**

Necessary. An expression which returns a "HMIGO" type object.

**Parameters**

Parameter (Data Type)	Description
ListType (HMIGO_SINGLE_ALARM_LIST_TYPE)	<p>Defines which content should be returned in a list. Possibilities are:</p> <ul style="list-style-type: none"> <li>• SINGLE_ALARM_ACTION_NAMES (1) All actions created for Loop In Alarm when the parameter is set in the configuration as a string</li> <li>• SINGLE_ALARM_CLASS_IDS (2) All message class IDs created</li> <li>• SINGLE_ALARM_INFO_TEXTS (3) All info texts created</li> <li>• SINGLE_ALARM_MESSAGE_NUMBERS (4) All message numbers created</li> <li>• SINGLE_ALARM_MESSAGE_TYPE_IDS (5) All message type IDs created</li> <li>• SINGLE_ALARM_GROUP_MESSAGE_CLASSES (6) All message classes created</li> <li>• SINGLE_ALARM_GROUP_MESSAGE_USER_DEFINED (7) All group messages created</li> </ul>
pListArray (Variant)	List with the requested content.
Filter (String)	Filters can be set optionally. Wildcards "*" and "?" are also possible.

**Example:**

In the following example, a check is made whether info texts have been configured:

```
Sub ReadSingleAlarm()
  'HMIGO_032
  'read content in alarm logging
  'no info texts are implemented
  Dim objHMIGO As New HMIGO
  Dim varRange As Variant
  'read all info texts
  objHMIGO.ListSingleAlarm SINGLE_ALARM_INFO_TEXTS, arrContent
  'check result
  If (UBound(arrContent) - LBound(arrContent) + 1) <= 0 Then
    MsgBox "no entries because no info texts are implemented"
  End If
End Sub
```

**See also**

- CreateSingleAlarm Function (Page 2628)
- CommitSingleAlarm Function (Page 2626)
- CloseSingleAlarm Function (Page 2625)
- VBA in Alarm Logging (Page 2622)



# Index

Adding,  
DeactivateRTProject,  
InquireLanguage,  
TlgTrendWindowPressReportSaveButton ,

## A

abort, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
abs, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
AcknowledgeMessage, 938, 939  
acos, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
Action, 20, 35, 60, 62, 64, 70, 72, 1699  
    Adding information, 60  
    Cause for non-execution of an action, 905  
    Compiling, 905, 913

    Configuring with VBA, 1699  
    Create, 52  
    Creating functions and actions, 864, 905  
    Creating new actions, 909  
    CrossReference, 52  
    Defining, 864  
    Deleting, 887  
    Dialog "Info", 60, 62  
    Differences between actions and functions, 905  
    Edit, 52  
    Editing, 910, 932  
    Exporting, 922  
    Finding, 905  
    Importing, 923  
    Printing, 890  
    Protecting with a Password, 62  
    Protection against read and write access, 912  
    Renaming, 905, 924  
    Runtime behavior, 927  
    Saving, 913  
    Structuring, 864  
    Trigger:Configuring type "Timer", 70  
    Trigger:Configuring type Tag, 72  
    Use of DLLs, 876  
    Using actions from outside the project, 925  
Action configuring, 1699  
    with VBA, 1699  
Action icon  
    Features, 905  
Action:Corrective measure, 63  
Action>Delete, 35  
Action:Editing, 57  
Action:new creation, 56  
Action:Save, 63  
Action:Trigger, 18  
ActionType property, 2107  
Activating, 78  
    of global actions in Runtime, 78  
ActiveX controls, 1671  
    Inserting with VBA, 1671  
AddIn, 1734  
    AddIn Manager, 1734  
    create (example), 1738  
    create with VB (example), 1739  
    load automatically, 1734  
    load manually, 1734  
    Loading (instructions), 1737  
    Loading behavior, 1734

- unload, 1734
  - Use in Graphics Designer, 1734
- Adding Timer trigger ,
- adding to picture, 82
- Adding trigger, 918
- AddIns property, 2113
- AdvancedAnalogDisplay, 1901
- AdvancedStateDisplay, 1905
- Aktion:Renaming, 76
- Aktion:use multiple times, 20
- Alarm Control, 286
- Alarm Logging, 2622
  - Creating message with VBA, 2622
  - Deleting message with VBA, 2622
  - Editing message with VBA, 2622
  - Modifying message with VBA, 2622
- Alarm object, 110
- AlarmControl, 241
  - VBS example, 853
- AlarmGoneVisible, 2114
- AlarmLogs Object, 112
- Alarms object (list), 110
- Analog Clock, 246
- Animation trigger, 68
- Application-specific menu, 1627
  - Add menu entry, 1631
  - Assigning help text, 1639
  - Assigning status text, 1639
  - Assigning VBA macro, 1642
  - Configuring, 1626
  - Creating, 1629
  - creating multiple languages, 1633
- Application-specific toolbar, 1627
  - Add icon, 1637
  - Assigning help text, 1639
  - Assigning status text, 1639
  - Assigning VBA macro, 1642
  - Configuring, 1626
  - Creating, 1635
- Archive backup: Connect via VBS, 838
- asctime, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- asin, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- AssemblyInfo, 2122
- atan, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- atan2, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- atof, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

atoi, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 atol, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 AttachDB, 715  
 Attribute:GSC Runtime, 86  
 Authorization  
     Assigning, 922  
 Authorizations, 922  
 AXC\_OnBtnAlarmHidingList, 947  
 AXC\_OnBtnArcLong, 948  
 AXC\_OnBtnArcShort, 949  
 AXC\_OnBtnComment, 949  
 AXC\_OnBtnEmergAckn, 950  
 AXC\_OnBtnHideDlg, 951  
 AXC\_OnBtnHideUnhideMsg, 952  
 AXC\_OnBtnHit, 952  
 AXC\_OnBtnHornAckn, 953  
 AXC\_OnBtnInfo, 954  
 AXC\_OnBtnLock, 955  
 AXC\_OnBtnLockUnlock, 955  
 AXC\_OnBtnLockWin, 956  
 AXC\_OnBtnLoop, 957  
 AXC\_OnBtnMsgFirst, 958  
 AXC\_OnBtnMsgLast, 958  
 AXC\_OnBtnMsgNext, 959  
 AXC\_OnBtnMsgPrev, 960  
 AXC\_OnBtnMsgWin, 961  
 AXC\_OnBtnPrint, 961  
 AXC\_OnBtnProtocol, 962  
 AXC\_OnBtnScroll, 963  
 AXC\_OnBtnSelect, 964  
 AXC\_OnBtnSinglAckn, 964  
 AXC\_OnBtnSortDlg, 965

AXC\_OnBtnTimeBase, 966  
 AXC\_OnBtnVisibleAckn, 967  
 AXC\_SetFilter, 967

## B

BackColor\_Alarm, 2134  
 BackFillColor, 2136  
 BackFillColor\_OK, 2136  
 BackFillColor\_Simulation, 2137  
 BackFillStyle, 2137  
 BackFillStyle\_OK, 2137  
 BackFillStyle\_Simulation, 2137  
 Backup: Connect via VBS, 838  
 BasePicture, 2145  
 basics, 861  
     from VBS,  
 BitPosition0, 2149  
 BitSelect0, 2150  
 Bookmark:delete in Debugger, 100  
 Bookmark:set in Debugger, 100  
 Bookmark:skip to, 100  
 Bookmarks, 100  
 Breakpoint, 98, 99  
 Breakpoint:Deleting, 99  
 Breakpoint:set in Debugger, 98  
 bsearch, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 Button1MessageClasses, 2166

## C

C action, 1703  
     Configuring on an event with VBA, 1703  
 C script, 1694  
     Dynamize property with VBA, 1694

- c\_bib, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- CalculateStatistic, 716
- calloc, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- CBackColorOff, 2169
- CBackFlash, 2170
- ceil, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- Change, 74
  - Triggers, 74
- char\_io, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- Character set, 2464
- Class, 2560
  - HMIGO, 2560
- clearerr, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- clock, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- CloseTlgTrigger (VBA), 2584
- Code, 41, 104
- Code page, 2464
- Code Templates, 57
- Code templates for VBS, 41
- Code:of a Procedure, 41
- Code:print, 104
- Collection, 1933
- Collections, 1745
  - Overview, 1745
- CollectValue, 2182
- Color code, 880
- Column object, 221
- ComboBox object, 1934
- CommitTlgTrigger (VBA), 2589
- CommonVBSEventArea properties, 2195
- CommonVBSPropertyArea property, 2196
- Component library, 1646
  - Access with VBA, 1646
  - Copying an object with VBA, 1649
  - Creating a folder with VBA, 1649
  - Deleting a folder with VBA, 1649
  - Editing with VBA, 1649
  - Paste Object into a Picture with VBA, 1652
- Computer properties, 89, 873
  - Runtime Tab, 89
- Configuring, 1624, 1701, 1703
  - C action with VBA, 1703
  - Direct connection, 1701
  - for multiple languages with VBA, 1624



- Trigger with VBA, 1707
  - VB action with VBA, 1705
  - ConnectionPoints, 2198
  - ConnectorObjects property, 2199
  - ConnectorType, 2200
  - Contents, 11
  - Controls
    - WinCC Alarm Control, 286
    - WinCC MediaControl, 256
  - Controls:HMI Symbol Library, 239
  - Controls:WinCC Digital Analog Clock, 246
  - Controls:WinCC Function Trend Control, 288
  - Controls:WinCC FunctionTrendControl, 248
  - Controls:WinCC Online Table Control, 292
  - Controls:WinCC Online Trend Control, 295
  - Controls:WinCC OnlineTableControl, 257
  - Controls:WinCC OnlineTrendControl, 262
  - Controls:WinCC RulerControl, 272
  - Controls:WinCC Slider Control, WinCC:WinCC Slider Control, 277
  - Controls:WinCC UserArchiveControl, 280
  - ControlType, 2201
  - ConvertWM, 1822
  - CopyPasteSettings property, 2201
  - CopyRows, 716
  - CornerRadius, 2201
  - cos, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - cosh, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - CQBackColorOff, 2203
  - CQBackFlash, 2203
  - CQTextColorOff, 2203
  - CQTextFlash, 2204
  - Create, 52, 56
    - Action, 52
  - Create:Action, 56
  - Create:Procedure, 39
  - CreateDynamicDialog, 1827
  - CreateTagSet, 717
  - CreateTlgTrigger (VBA), 2596
  - Creating
    - Procedures, 36
  - Cross-reference, 64
  - CTextColorOff, 2204
  - CTextFlash, 2204
  - ctime, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - ctype, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - Customized Object, 1682
    - Access with VBA, 1682
    - Deleting, 1683
    - Editing with VBA, 1683
    - Properties, 1682
    - ungroup, 1683
  - CutRows, 718
  - Cyclic, 64
- ## D
- DataItem Object, 113
  - DataLogs-Objekt, 114
  - DataSet Object (List), 116
  - DataSetObj, 1943
  - Debugger, 89, 90, 92, 94, 96, 97, 98, 99, 100, 101, 102
    - Activating in WinCC, 89

- Opening after error message, 89
- Opening automatically, 89
- Starting for Global Script, 89
- Starting for Graphics Runtime, 89
- Debugger:Basic Principles, 90, 97
- Debugger:Change Picture During Debug, 90
- Debugger>Delete bookmark, 100
- Debugger:Deleting Breakpoints, 99
- Debugger:Determine property values, 101
- Debugger:Determine tag values, 101
- Debugger:Executing Script Commands, 102
- Debugger:modify property values, 101
- Debugger:Modify tag values, 101
- Debugger:Name of actions in the script file, 94
- Debugger:Processing Scripts Step-by-Step, 97
- Debugger:select running script, 96
- Debugger:Set bookmark, 100
- Debugger:Setting Breakpoints, 98
- Debugger:skip to bookmark, 100
- Debugger:Structure of the Script Files, 92
- Declaration area, 57
- Declaration Area:of an Action, 57
- Delete:Actions and Procedures, 35
- DeleteRows, 719
- DeleteTextLanguage, 2614
- DeleteTlgTrigger function (VBA), 2600
- Deleting
  - Triggers, 75
- Design of Global Script, 27
- Design tool, 864
- DetachDB, 719
- Diagnostics, 81, 82, 84, 85, 86, 87
- Diagnostics:Attributes:GSC Diagnostics, 82
- Diagnostics:Debugger, 87
- Diagnostics:GSC Diagnostics, 81
- Diagnostics:GSC Runtime, 84
- Diagnostics:GSC Runtime Attributes, 86
- Diagnostics:Inserting GSC Diagnostics Window into a Picture, 82
- Diagnostics:Inserting GSC Runtime into a Picture, 85
- Diagnostics:VBS:Diagnostics, 80
- difftime, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- Digital Analog Clock, 246
- Digital Clock, 246
- Direct connection, 1701
  - Configuring with VBA, 1701
- Directio, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- DisablePerformanceWarnings, 2213
- Display property, 2214
- div, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- DotNetControl, 1954
- DrawInsideFrame, 2218
- DropDownListStyle, 2218
- Dynamic dialog, 1691
  - Dynamize property with VBA, 1691
- DynamicStateType property, 2219
- Dynamization, 1687
  - Dynamic dialog with VBA, 1687
  - of properties with VBA, 1687
  - Scripts with VBA, 1687
  - Tag connection with VBA, 1687
- Dynamizing, 1689, 1694
  - Property with C script with VBA, 1694

Property with Dynamic dialog with VBA, 1691  
 Property with Tag Connection, 1689  
 Property with VB script with VBA, 1697

## E

Edit, 52, 719, 1657  
   Action, 52  
   Copy of a Picture with VBA, 1658  
   Layer with VBA, 1657  
 Edit window  
   Working in the edit window, 880  
 Edit:Action, 57  
 Editing, 57  
   Procedures, 36  
 Editing function, 882  
   Editing functions with the keyboard, 881  
   Editing functions with the mouse, 882  
 Editing Objects with VBA, 1660  
 Editing Window, 30  
 Editing window:Color coding, 30  
 Editing Window:Global Script, 30  
 Editor, 26, 27, 33  
 Editor toolbars, 33  
 Editor:Global Script, 26  
 Editor:VBS-Editor in the Graphics Designer, 26  
 EnableFlashing, 2221  
 Error, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 Error codes, 459  
 Error Messages, 411, 820  
 Error types, 90  
 Error types:Logical error, 90  
 Error types:Runtime Error, 90  
 Error types:Syntax Error, 90  
 Error:syntax, 63  
 Event, 1709  
   application-specific, 1709  
   Forwarding, 1709  
   picture-specific, 1709  
 Event Handling, 1619, 1709, 1745  
   Activated event, 1752  
   Forwarding of events, 1615  
   Overview, 1745  
   prevent, 1709  
   Shutting down, 1709  
 Event Handling VBA Events ,  
 Event-driven, 64  
 EventName, 2225  
 EventQuitMask, 2222  
 Events, 1745  
   Activated, 1752  
   BeforeClose, 1752  
   BeforeDocumentClose, 1753  
   BeforeDocumentSave, 1754  
   BeforeHMIObjectDelete, 1755  
   BeforeLibraryFolderDelete, 1756  
   BeforeLibraryObjectDelete, 1757  
   BeforeQuit, 1759  
   BeforeSave, 1760  
   BeforeVisibleFalse, 1760  
   ConnectionEvent, 1761  
   DataLanguageChanged, 1762  
   DesktopLanguageChanged, 1763  
   DocumentActivated, 1764  
   DocumentCreated, 1765  
   DocumentOpened, 1766  
   DocumentPropertyChanged, 1768  
   DocumentSaved, 1767  
   HMIObjectAdded, 1768  
   HMIObjectMoved, 1769  
   HMIObjectPropertyChanged, 1770  
   HMIObjectResized, 1771  
   LibraryFolderRenamed, 1772  
   LibraryObjectAdded, 1774  
   LibraryObjectRenamed, 1773  
   MenuItemClicked, 1775  
   NewLibraryFolder, 1776  
   NewLibraryObject, 1777  
   Opened, 1778  
   Saved, 1779  
   see reference:Events ,  
   SelectionChanged, 1780  
   Started, 1781  
   ToolBarItemClicked, 1782  
   VBA Event Handling, 1745  
   ViewCreated, 1783  
   WindowStateChange, 1784  
 Example for VBS, 823  
 Example in WinCC:Configuring a diagnostics output via Trace, 827  
 Example in WinCC:Configuring a language change, 825  
 Example in WinCC:Configuring a picture change globally, 826

Example in WinCC:Configuring a picture change via Property, 827  
 Example in WinCC:Defining the color of objects, 825  
 Examples, 823  
 Examples in WinCC, 824, 825, 826, 827, 828, 830, 833, 836, 838  
   VBS in WinCC, 823  
   Writing object properties, 833  
 Examples in WinCC: Connect database backup with VBS, 838  
 Examples in WinCC:Accessing objects in Graphics Designer, 824  
 Examples in WinCC:Deactivate Runtime, 826  
 Examples in WinCC:Read tag values, 830  
 Examples in WinCC:Start an Action on the Server (Logging Object), 836  
 Executing, 1619  
   VBA Macros, 1619  
 exit, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 ExitWinCC, 1511  
 exp, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 Export, 720  
 External application, 1713  
   Access with VBA, 1713  
   Accessing MS Excel with VBA, 1714  
   log on, 1713  
 ExternalShapelInfo, 1968

## F

fabs, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 FaceplateObject object, 1969  
 FaceplateObjects, 1971  
 FaceplateProperty, 1971  
 FaceplateType property, 2228  
 fclose, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 Features, 905  
   LockStatus, 2315  
   LockText, 2316  
   LockTextColor, 2317  
   LongStrokesBold, 2318  
   LongStrokesOnly, 2318  
   LongStrokesSize, 2319  
   LongStrokesTextEach, 2319  
   Marker, 2321  
   Max, 2322  
   MaximizeButton, 2322  
   MaxZoom, 2323  
   MCGUBackColorOff, 2324  
   MCGUBackColorOn, 2324  
   MCGUBackFlash, 2325  
   MCGUTextColorOff, 2326  
   MCGUTextColorOn, 2326  
   MCGUTextFlash, 2327  
   MCKOBackColorOff, 2328  
   MCKOBackColorOn, 2329  
   MCKOBackFlash, 2329  
   MCKOTextColorOff, 2330  
   MCKOTextColorOn, 2331

MCKOTextFlash, 2331  
MCKQBackColorOff, 2332  
MCKQBackColorOn, 2333  
MCKQBackFlash, 2333  
MCKQTextColorOff, 2334  
MCKQTextColorOn, 2335  
MCKQTextFlash, 2335  
MCText, 2336  
MenuItems, 2337  
MenuItemType, 2338  
Min, 2340  
MinZoom, 2340  
Modified, 2341  
Moveable, 2342  
Name, 2343  
NegativeValue, 2344  
Number, 2345  
ObjectName, 2347  
ObjectSizeDecluttering, 2350  
OffsetLeft, 2350  
feof, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
ferror, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
fflush, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
fgetc, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
fgetpos, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
fgets, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095

File, 889, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
    Searching, 889  
File\_pos, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
FillBackColor property, 2231  
FillDiagnoseInTags, 1514  
FireConnectionEvents, 1843  
FlashPicture, 2245  
FlashPictureState property, 2245  
FlashState property, 2252  
floor, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
fmod, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

Font style  
    Setting, 885  
fopen, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
ForeColor\_Alarm, 2261  
Format, 2263  
Forwarding, 1709  
    of events, 1709  
fputc, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
fputs, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
fread, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

- free**, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- freopen**, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- frexp**, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- fseek**, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- fsetpos**, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- ftell**, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- Function**
  - Application, 892
  - Compiling, 888, 892, 901
  - Creating, 864, 892
  - Creating new function, 895
  - Defining, 864
  - Differences between actions and functions, 905
  - Editing, 892
  - Finding, 892
  - Functions from other sources, 903
  - Printing, 890
  - Protection against read and write access, 900
  - Renaming, 902
  - Saving, 901
  - Structuring, 864
  - Use of DLLs, 876
  - Using internal functions, 897
- Function code**, 896
- Function Trend Control**, 288
- Functions**, 2571
- CloseSingleAlarm (VBA), 2625
  - CloseTag (VBA), 2565
  - CloseTlgArchive (VBA), 2581
  - CloseTlgTag (VBA), 2583
  - CommitSingleAlarm (VBA), 2626
  - CommitTag (VBA), 2566
  - CommitTlgArchive (VBA), 2585
  - CommitTlgTag (VBA), 2587
  - CreateSingleAlarm (VBA), 2628

CreateTag (VBA), 2568  
CreateText (VBA), 2610  
CreateTextLanguage (VBA), 2609  
CreateTlgArchive (VBA), 2589  
CreateTlgTag (VBA), 2592  
DeleteSingleAlarm (VBA), 2631  
DeleteTag (VBA), 2570  
DeleteText (VBA), 2612  
DeleteTlgArchive (VBA), 2598  
DeleteTlgTag (VBA), 2599  
GetSingleAlarm (VBA), 2632  
GetTag (VBA), 2571  
GetText (VBA), 2615  
GetTextID (VBA), 2616  
GetTlgArchive (VBA), 2601  
GetTlgTag (VBA), 2602  
ListSingleAlarm (VBA), 2633  
ListTag (VBA), 2572  
ListText (VBA), 2619  
ListTlgArchive (VBA), 2604  
ListTlgTag (VBA), 2606  
ModifyText (VBA), 2620  
FunctionTrendControl, 248  
fwrite, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095

**G**

Gauge Control, 254  
GCreateMyOperationMsg, 938  
GCS-Runtime, 84  
GCS-Runtime:Attribute, 86  
General Examples, 855, 856, 858, 859  
General examples:Configuring a database  
connection with VBS, 856  
General examples:Retrieve MS automation  
interfaces, 858  
General examples:Starting external application, 859  
Get\_Focus, 1128  
GetActualPointLeft, 1136  
GetActualPointTop, 1137  
GetAdaptBorder, 1189  
GetAdaptPicture, 1190  
GetAdaptSize, 1191  
GetAlarmHigh, 1160  
GetAlarmLow, 1161  
GetAlignment, 1096  
GetAlignmentLeft, 1129  
GetAlignmentTop, 1130  
GetAssignments, 1150  
GetAssumeOnExit, 1151  
GetAssumeOnFull, 1151  
GetAverage, 1191  
GetAxisSection, 1097  
GetBackBorderWidth, 1240  
GetBackColor, 1104  
GetBackColor2, 1105  
GetBackColor3, 1105  
GetBackColorBottom, 1106  
GetBackColorTop, 1106  
GetBackFlashColorOff, 1120  
GetBackFlashColorOn, 1121  
GetBasePicReferenced, 1232  
GetBasePicTransColor, 1233  
GetBasePicture, 1234  
GetBasePicUseTransColor, 1234  
GetBitNumber, 1152  
GetBorderBackColor, 1107  
GetBorderColor, 1108  
GetBorderColorBottom, 1108  
GetBorderColorTop, 1109  
GetBorderEndStyle, 1240  
GetBorderFlashColorOff, 1121  
GetBorderFlashColorOn, 1122  
GetBorderStyle, 1241  
GetBorderWidth, 1241  
GetBoxAlignment, 1242  
GetBoxCount, 1137  
GetBoxType, 1192  
GetButtonColor, 1109  
GetCaption, 1193  
GetCheckAlarmHigh, 1161  
GetCheckAlarmLow, 1162  
GetCheckLimitHigh4, 1162  
GetCheckLimitHigh5, 1163  
GetCheckLimitLow4, 1164  
GetCheckLimitLow5, 1165  
GetCheckToleranceHigh, 1165  
GetCheckToleranceLow, 1166  
GetCheckWarningHigh, 1167  
GetCheckWarningLow, 1167  
GetClearOnError, 1153  
GetClearOnNew, 1153  
GetCloseButton, 1193  
GetColorAlarmHigh, 1168



GetColorAlarmLow, 1169  
 GetColorBottom, 1110  
 GetColorChangeType, 1194  
 GetColorLimitHigh4, 1169  
 GetColorLimitHigh5, 1170  
 GetColorLimitLow4, 1170  
 GetColorLimitLow5, 1171  
 GetColorToleranceHigh, 1172  
 GetColorToleranceLow, 1172  
 GetColorTop, 1111  
 GetColorWarningHigh, 1173  
 GetColorWarningLow, 1173  
 GetColumn, 720, 731, 738, 739, 797, 798, 812, 813  
 GetColumnCollection, 721  
 GetCursorControl, 1195  
 GetCursorMode, 1195  
 GetDataFormat, 1154  
 GetDirection, 1138  
 GetEditAtOnce, 1196  
 GetEndAngle, 1139  
 getenv, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 GetExponent, 1097  
 GetExtendedOperation, 1197  
 GetFillColor, 1111  
 GetFilling, 1118  
 GetFillingIndex, 1119  
 GetFillStyle, 1243  
 GetFillStyle2, 1243  
 GetFlashBackColor, 1122  
 GetFlashBorderColor, 1123  
 GetFlashFlashPicture, 1235  
 GetFlashForeColor, 1124  
 GetFlashPicReferenced, 1235  
 GetFlashPicTransColor, 1236  
 GetFlashPicture, 1237  
 GetFlashPicUseTransColor, 1237  
 GetFlashRateBackColor, 1125  
 GetFlashRateBorderColor, 1125  
 GetFlashRateFlashPic, 1238  
 GetFlashRateForeColor, 1126  
 GetFontBold, 1130  
 GetFontItalic, 1131  
 GetFontName, 1132  
 GetFontSize, 1132  
 GetFontUnderline, 1133  
 GetForeColor, 1112  
 GetForeFlashColorOff, 1126  
 GetForeFlashColorOn, 1127  
 GetGrid, 1139  
 GetGridColor, 1113  
 GetGridHeight, 1140  
 GetGridWidth, 1140  
 GetHeight, 1141  
 GetHiddenInput, 1154  
 GetHitlistColumn, 722  
 GetHitlistColumnCollection, 723  
 GetHotkey, 1198  
 GetHWDiag, 1002  
 GetHWDiagLevel, 1003  
 GetHysteresis, 1198  
 GetHysteresisRange, 1199  
 GetIndex, 1239  
 GetInputValueChar, 1155  
 GetInputValueDouble, 1156  
 GetItemBorderBackColor, 1113  
 GetItemBorderColor, 1114  
 GetItemBorderStyle, 1244  
 GetItemBorderWidth, 1245  
 GetKopFupAwl, 1005  
 GetKopFupAwlLevel, 1006  
 GetLanguage, 1512  
 GetLanguageSwitch, 1199  
 GetLastChange, 1200  
 GetLayer, 1135  
 GetLeft, 1141  
 GetLeftComma, 1098  
 GetLimitHigh4, 1174  
 GetLimitHigh5, 1175  
 GetLimitLow4, 1175  
 GetLimitLow5, 1176  
 GetLimitMax, 1176  
 GetLimitMin, 1177  
 GetLink, 1188  
 GetLinkedVariable, 942  
 GetListType, 1156  
 GetLocalPicture, 943  
 GetLongStrokesBold, 1098  
 GetLongStrokesOnly, 1099  
 GetLongStrokesSize, 1100  
 GetLongStrokesTextEach, 1100  
 GetMarker, 1178  
 GetMax, 1201  
 GetMaximizeButton, 1201  
 GetMessageBlock, 724

GetMessageBlockCollection , 725  
GetMessageColumn, 727  
GetMessageColumnCollection , 728, 732  
GetMin, 1202  
GetMoveable, 1202  
GetNumberLines, 1157  
GetOffsetLeft, 1203  
GetOffsetTop, 1204  
GetOnTop, 1204  
GetOperation, 1205  
GetOperationMessage, 1205  
GetOperationReport, 1206  
GetOperatorMessage , 729  
GetOperatorMessageCollection , 730  
GetOrientation, 1134  
GetOutputFormat, 1158  
GetOutputValueChar, 1158  
GetOutputValueDouble, 1159  
GetParentPicture, 943  
GetParentPictureWindow, 944  
GetPasswordLevel, 1207  
GetPicDeactReferenced, 1219  
GetPicDeactTransparent, 1219  
GetPicDeactUseTransColor, 1220  
GetPicDownReferenced, 1221  
GetPicDownTransparent, 1221  
GetPicDownUseTransColor, 1222  
GetPicReferenced, 1223  
GetPicTransColor, 1223  
GetPictureDeactivated, 1224  
GetPictureDown, 1225  
GetPictureName, 1208  
GetPictureUp, 1226  
GetPicUpReferenced, 1226  
GetPicUpTransparent, 1227  
GetPicUpUseTransColor, 1228  
GetPicUseTransColor, 1228  
GetPointCount, 1142  
GetPosition, 1217  
GetPressed, 1245  
GetProcess, 1208  
GetPropBOOL, 1229  
GetPropChar, 1230  
GetPropDouble, 1231  
GetPropWord, 1231  
GetRadius, 1143  
GetRadiusHeight, 1143  
GetRadiusWidth, 1144  
GetRangeMax, 1217  
GetRangeMin, 1218  
GetReferenceRotationLeft, 1144  
GetReferenceRotationTop, 1145  
GetRightComma, 1101  
GetRotationAngle, 1145  
GetRoundCornerHeight, 1146  
GetRoundCornerWidth, 1147  
GetRulerBlock , 733  
GetRulerBlockCollection , 734  
GetRulerColumn, 735  
GetRulerColumnCollection , 736  
GetRulerData, 737  
GetScaleColor, 1114  
GetScaleTicks, 1102  
GetScaling, 1102  
GetScalingType, 1103  
GetScrollBars, 1209  
GetSelBGColor, 1115  
GetSelTextColor, 1116  
GetServerName, 1210  
GetServerTagPrefix, 1515  
GetSizeable, 1210  
GetSmallChange, 1211  
GetStartAngle, 1147  
GetStatisticAreaColumn, 741  
GetStatisticAreaColumnCollection, 742  
GetStatisticResultColumn, 743  
GetStatisticResultColumnCollection, 744  
GetStatusBarElement, 745  
GetStatusBarElementCollection, 746  
GetTagBit, 1459  
GetTagBitState, 1422  
GetTagBitStateQC, 1441  
GetTagBitStateQCWait, 1430  
GetTagBitStateWait, 1413  
GetTagBitWait, 1451  
GetTagByte, 1460  
GetTagByteState, 1423  
GetTagByteStateQC, 1442  
GetTagByteStateQCWait, 1431  
GetTagByteStateWait, 1414  
GetTagByteWait, 1452  
GetTagChar, 1461  
GetTagCharState, 1423  
GetTagCharStateQC, 1443  
GetTagCharStateQCWait, 1431  
GetTagCharStateWait, 1414  
GetTagCharWait, 1452  
GetTagDateTime, 1461  
GetTagDouble, 1462  
GetTagDoubleState, 1424  
GetTagDoubleStateQC, 1443  
GetTagDoubleStateQCWait, 1432  
GetTagDoubleStateWait, 1415  
GetTagDoubleWait, 1453

GetTagDWord, 1462  
 GetTagDWordState, 1425  
 GetTagDWordStateQC, 1444  
 GetTagDWordStateQCWait, 1433  
 GetTagDWordStateWait, 1416  
 GetTagDWordWait, 1454  
 GetTagFloat, 1463  
 GetTagFloatState, 1426  
 GetTagFloatStateQC, 1445  
 GetTagFloatStateQCWait, 1434  
 GetTagFloatStateWait, 1417  
 GetTagFloatWait, 1454  
 GetTagMultiStateQCWait, 1435  
 GetTagMultiStateWait, 1417  
 GetTagMultiWait, 1455  
 GetTagPrefix, 1212  
 GetTagRaw, 1463  
 GetTagRawState, 1426  
 GetTagRawStateQC, 1446  
 GetTagRawStateQCWait, 1436  
 GetTagRawStateWait, 1418  
 GetTagRawWait, 1455  
 GetTagSByte, 1464  
 GetTagSByteState, 1427  
 GetTagSByteStateQC, 1447  
 GetTagSByteStateQCWait, 1437  
 GetTagSByteStateWait, 1419  
 GetTagSByteWait, 1456  
 GetTagSDWord, 1465  
 GetTagSDWordState, 1428  
 GetTagSDWordStateQC, 1448  
 GetTagSDWordStateQCWait, 1438  
 GetTagSDWordStateWait, 1420  
 GetTagSDWordWait, 1457  
 GetTagSWord, 1465  
 GetTagSWordState, 1428  
 GetTagSWordStateQC, 1449  
 GetTagSWordStateQCWait, 1438  
 GetTagSWordStateWait, 1421  
 GetTagSWordWait, 1457  
 GetTagValue, 1466  
 GetTagValueStateQC, 1449  
 GetTagValueStateQCWait, 1439  
 GetTagValueWait, 1458  
 GetTagWord, 1467  
 GetTagWordState, 1429  
 GetTagWordStateQC, 1450  
 GetTagWordStateQCWait, 1440  
 GetTagWordStateWait, 1421  
 GetTagWordWait, 1459  
 GetText, 1134  
 GetTimeAxis, 747  
 GetTimeAxisCollection, 748  
 GetTimeColumn, 750  
 GetTimeColumnCollection, 751  
 GetTlgTrigger (VBA), 2604  
 GetToggle, 1246  
 GetToleranceHigh, 1178  
 GetToleranceLow, 1179  
 GetToolBarButton, 752  
 GetToolBarButtonCollection, 753  
 GetTop, 1148  
 GetTrend, 754, 1212  
 GetTrendCollection, 755  
 GetTrendColor, 1116  
 GetTrendWindow, 757  
 GetTrendWindowCollection, 758  
 GetTypeAlarmHigh, 1180  
 GetTypeAlarmLow, 1180  
 GetTypeLimitHigh4, 1181  
 GetTypeLimitHigh5, 1182  
 GetTypeLimitLow4, 1182  
 GetTypeLimitLow5, 1183  
 GetTypeToleranceHigh, 1184  
 GetTypeToleranceLow, 1185  
 GetTypeWarningHigh, 1185  
 GetTypeWarningLow, 1186  
 GetUnselBGColor, 1117  
 GetUnselTextColor, 1117  
 GetUpdateCycle, 1213  
 GetValueAxis, 759  
 GetValueAxisCollection, 760  
 GetValueColumn, 761  
 GetValueColumnCollection, 762  
 GetVisible, 1214  
 GetWarningHigh, 1187  
 GetWarningLow, 1187  
 GetWidth, 1148  
 GetWindowBorder, 1214  
 GetWindowsStyle, 1246  
 GetXAxis, 764  
 GetXAxisCollection, 765  
 GetYAxis, 766  
 GetYAxisCollection, 767  
 GetZeroPoint, 1149  
 GetZeroPointValue, 1215  
 GetZoom, 1216  
 Global action, 872  
     Application, 872  
     Characteristics, 872  
 Global C tags, 874  
     Application, 874  
     Definition, 874

- Global Script, 878
  - Action icon, 905
  - Action structure, 864
  - Adding action-related information, 910
  - Adding function-related Information, 898
  - Assigning authorization, 922
  - Authorizations, 922
  - Cause for non-execution of an action, 905
  - Changing trigger, 920
  - Characteristics of global actions, 872
  - Characteristics of internal functions, 870
  - Characteristics of local actions, 871
  - Characteristics of project functions, 867
  - Characteristics of standard functions, 868
  - Color code, 880
  - Compiling action, 905, 913
  - Compiling function, 888, 892, 901
  - Computer properties, 873
  - Creating action, 864, 905
  - Creating function, 864
  - Creating internal function, 895
  - Creating new actions, 909
  - Creating new function, 895
  - Defining action, 864
  - Defining function, 864
  - Definition of global C tags,
  - Deleting action, 887
  - Deleting project functions, 887
  - Deleting standard functions, 887
  - Deleting trigger, 921
  - Design tool, 864
  - Differences between actions and functions, 905
  - Editing action, 905, 910, 932
  - Editing function, 892
  - Editing functions with the keyboard, 882
  - Editing functions with the mouse, 882
  - Effect of triggers on actions, 914
  - Exporting action, 922
  - Features, 905
  - Finding actions, 905
  - Finding functions, 892
  - Function structure, 864
  - Generating new header, 887
  - GSC Diagnose toolbar,
  - GSC Runtime, 928
  - GSC Runtime attributes, 932
  - Identification of actions in the navigation window, 914
  - Import action, 923
  - Including Global Script Runtime in the startup list of the project ,
  - Including GSC Runtime in a process picture, 931
  - Inserting GSC Diagnose in a process picture, 934
  - New trigger of type Trigger:new trigger of type Global Script:Adding trigger, 917
  - New trigger of type Trigger:New trigger of type TagGlobalScript:Adding trigger ,
  - Opening, 923
  - Opening page view, 891
  - Password input, 900, 912
  - Printing action, 890
  - Printing function, 890
  - Printing project documentation, 891
  - Properties, 898, 900, 910, 912, 920, 921
  - Protecting function against read and write access, 900
  - Protection against read and write access, 912
  - Renaming action, 905, 924
  - Renaming function, 902
  - Runtime behavior of actions, 927
  - Saving action, 913
  - Saving file as, 922
  - Saving function, 901
  - Searching files, 889
  - Setting different views, 885
  - Setting print parameters, 890
  - Setting the font style, 885
  - Structure of Global Script editor, 878
  - System behavior, 905
  - Trigger type, 864
  - Use of DLLs in actions, 876
  - Use of DLLs in functions, 876
  - Use of global actions, 872
  - Use of global C tags,
  - Use of Internal Functions, 870
  - Use of local actions, 871
  - Use of project functions, 867
  - Use of standard functions, 868
  - Using "Save As...", 886
  - Using actions from other sources, 925
  - Using functions, 892
  - Using Functions from other sources, 903
  - Using internal functions, 897
  - Using project functions, 897
  - Using standard functions, 897
  - Validity range,
  - WinCC coding rules, 908
  - Working in the edit window, 880
  - Working with toolbars, 882
  - Writing function code, 896
- Global Script editor, 27, 878
  - Structure, 878
- Global Script Runtime, 873
  - Adding to startup list of the project, 873

- Global Script:Deleting Actions and Procedures, 35
  - Global Script:Toolbars, 33
  - Global Script:Working in the Editing Window, 30
  - Global Tag, 24
  - Global tag:Use in VBS, 24
  - GMsgFunction, 940
  - gmtime, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - GNQBackColorOff, 2264
  - GNQBackFlash, 2265
  - GNQTextColorOff, 2265
  - GNQTextFlash, 2265
  - Graphic object, 143
  - Graphic Object:Properties, 143
  - Graphic Object:Types in VBS, 143
  - Graphic object:WinCC Gauge Control, 254
  - Graphics Designer, 1623
    - @GLOBAL.PDT, 1615
    - @PROJECT.PDT, 1615
    - Access to objects, 1660
    - Access to the component library with VBA, 1646
    - Access to the symbol library with VBA, 1646
    - Adapting with VBA, 1621, 1623
    - Add menu entry to user-defined menu, 1631
    - Adding a New Icon to the used-defined Toolbar, 1637
    - Application-specific menu, 1627
    - Application-specific toolbar, 1627
    - Assigning VBA macro to user-defined menu, 1642
    - Assigning VBA macro to user-defined toolbar, 1642
    - Configure user-defined menu, 1626
    - Configure user-defined toolbar, 1626
    - Create an application-specific menu, 1629
    - Create toolbar, 1635
    - Creating Menus in Multiple Languages, 1633
    - Editing objects with VBA, 1660
    - Executing VBA macros, 1619
    - Exporting VBA code, 1618
    - Importing VBA code, 1618
    - Object model, 1745
    - Organizing the VBA code, 1615
  - Paste Object from the component library into a picture with VBA, 1652
  - Paste Object from the symbol library into a picture with VBA, 1652
    - picture-specific menu, 1627
    - picture-specific toolbar, 1627
    - Template file, 1615
    - User-defined menu, 1627
    - User-defined toolbar, 1627
  - Group Object
    - Editing existing objects, 1679
    - Editing with VBA, 1676
    - Removing an object with VBA, 1676
  - Group Objects, 1674
    - Access to object properties, 1674
    - Adding an object with VBA, 1676
    - basics, 1674
    - Creating with VBA, 1676
    - Deleting with VBA, 1676
    - Editing with VBA, 1674
    - Ungrouping with VBA, 1676
  - Grouping, 1674
    - Access to object properties, 1674
    - Adding an object with VBA, 1676
    - basics, 1674
    - Creating with VBA, 1676
    - Deleting with VBA, 1676
    - Editing existing objects, 1679
    - Editing with VBA, 1674, 1676
    - Removing an object with VBA, 1676
    - Ungrouping with VBA, 1676
  - GSC Diagnose
    - Including in process picture, 934
    - Toolbar,
  - GSC Diagnostics, 83
  - GSC Diagnostics Attributes, 82
  - GSC Diagnostics: inserting into a Picture, 85
  - GSC Diagnostics:Attributes, 82
  - GSC Diagnostics:Toolbar, 83
  - GSC Runtime
    - Attributes, 932
    - Including in process picture, 931
  - GSC Runtime:Inserting into a Picture, 85
- ## H
- Header, 887
    - Regenerating, 887
  - HideAlarm, 769
  - Highlight Syntax, 41, 57
  - HitlistColumn object, 222
  - HitlistRelTimeFactorType, 449

HMIGO class, 2560  
  Application, 2560  
  Error Handling, 2560  
HMIObjects, 1745  
  see HMIObjects ,  
  see the lists ,  
HMIRuntime Object, 118  
HMIUdoObjects, 2272

I

Information, 45, 60  
  Adding action-related information, 910  
  Adding to action, 60  
  Adding to module, 45  
  Adding to procedure, 45  
Insert:GSC Diagnostics, 82  
Insert:GSC Runtime, 85  
Intellisense, 41, 57  
Internal function, 870  
  Application, 870  
  Characteristics, 870  
isahum, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
isalpha, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095

isdigit, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
isgraph, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
islower, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
isprint, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
IsPublished property, 2281

ispunct, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

isspace, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

isupper, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

isxdigit, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

Item Object, 119

## L

labs, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

Language, 458

Layer, 1657

- Controlling the visibility with VBA, 1657
- CS, 1657
- Editing with VBA, 1657
- RT, 1657

Layer Object, 120

Layer00FillColor ..., 2295

Layer00FillStyle ..., 2295

Layers Object (Listing), 121

LDAssignments, 2298

ldexp, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

LDFontsType property, 2299

ldiv, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

ListBox object, 2007

Lists

- Actions, 1898
- AnalogResultInfo, 1908

- Application, 1909
  - DataLanguages, 1942
  - Documents, 1952
  - Events, 1967
  - FolderItems, 1973
  - GroupedObjects, 1983
  - HMIDefaultObjects, 1985
  - HMIObjects, 1990
  - LanguageFonts, 1997
  - LanguageTexts, 2000
  - Layers, 2003
  - MenuItems, 2015
  - Menus, 2011
  - Overview, 1745
  - Properties, 2041
  - QualityCodeStateValues, 2046
  - Selection, 2060
  - SymbolLibraries, 2073
  - ToolBarItems, 2085
  - Toolbars, 2081
  - VariableStateValues, 2097
  - VariableTriggers, 2101
  - Views, 2103
  - Lists in VBS
    - Alarms object (list), 110
    - DataSet Object (List), 116
    - Layers Object (Listing), 121
    - ProcessValues Object (Lists), 124
    - ScreenItems object (list), 129
    - Screens Object (Lists), 134
    - Tags Object (List), 140
    - TagSet Object (List), 141
  - ListTlgTrigger (VBA), 2607
  - Local actions, 871
    - Application, 871
    - Characteristics, 871
  - localtime, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - LockAlarm, 771
  - log, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - log10, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - Logging Object, 122
  - Logical errors, 90
  - LoopInAlarm, 772
  - IpszPictureName, 937
- ## M
- malloc, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - math, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - MaxIndex, 2322



- MediaControl, 256
- memchr, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- memcmp, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- memcpy, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- memmove, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- memory, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- memset, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- Menu, 1627, 1654
  - Add menu entry, 1631
  - application-specific, 1627
  - Assigning help text, 1639
  - Assigning status text, 1639
  - Assigning VBA macro, 1642
  - Configuring, 1626
  - Creating, 1629
  - creating multiple languages, 1633
  - picture-specific, 1627, 1654
  - Placement, 1627
  - Properties, 1627
  - User-defined, 1627
- Menu bar, 878
- Menus and toolbars
  - VBScript, 12
- MenuToolBarConfig, 2339
- MessageBlock object, 223
- MessageColumn object, 223
- Methods, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 741, 742, 743, 744, 745, 746, 747, 748, 750, 751, 752, 753, 754, 755, 757, 758, 759, 760, 761, 762, 764, 765, 766, 767, 769, 771, 772, 775, 776, 777, 778, 779, 780, 781, 782, 783, 787, 797, 798, 799, 800, 801, 802, 803, 804, 805, 806, 807, 808, 809, 810, 812, 813, 817, 818, 819, 820, 1745
  - Activate, 1785
  - Add, 1786
  - Add (AnalogResultInfos Listing), 1787

Add (CustomToolbars Listing), 1788  
Add (Documents Listing), 1790  
Add (GroupedObjects), 1791  
Add (TagTriggers Listing), 1792  
Add (Views Listing), 1793  
AddAction, 1794  
AddActiveXControl, 1795  
AddFolder, 1798  
AddFromClipboard, 1799  
AddHMIObject, 1801  
AddItem, 1802  
AddOLEObject, 1797, 1803, 1806  
AlignBottom, 1807  
AlignLeft, 1808  
AlignRight, 1809  
AlignTop, 1810  
ArrangeMinimizedWindows, 1811  
BackwardOneLevel, 1811  
BringToFront, 1813  
CascadeWindows, 1814  
CenterHorizontally, 1815  
CenterVertically, 1816  
CheckSyntax, 1817  
Close, 1818  
CloseAll, 1819  
ConvertToScript, 1820  
ConvertToVBScript, 1821  
CopySelection, 1823  
CopyToClipboard, 1824  
CreateCustomizedObject, 1825  
CreateDynamic, 1828  
CreateGroup, 1829  
Delete, 1831  
DeleteAll, 1832  
DeleteDynamic, 1833  
Destroy, 1835  
DuplicateSelection, 1836  
EvenlySpaceHorizontally, 1837  
EvenlySpaceVertically, 1838  
Export, 1840  
Find, 1841  
FindByDisplayName, 1842  
FlipHorizontally, 1843  
FlipVertically, 1845  
ForwardOneLevel, 1846  
GetDeclutterObjectSize, 1830  
GetItemByPath, 1847  
InsertFromMenuItem, 1848  
InsertMenu, 1850  
InsertMenuItem, 1852  
InsertSeparator, 1853  
InsertSubmenu, 1854  
InsertToolBarItem, 1856  
IsCSLayerVisible, 1857  
IsRTLLayerVisible, 1858  
Item, 770, 1859  
ItemByLcid, 1861  
LoadDefaultConfig, 1863  
MoveOneLayerDown, 1863  
MoveOneLayerUp, 1864  
MoveSelection, 1865  
Open, 1867  
Overview, 1745  
PasteClipboard, 1868  
PrintDocument, 1869  
PrintProjectDocumentation, 1870  
Remove, 1871  
Rotate, 1872  
SameHeight, 1874  
SameWidth, 1876  
SameWidthAndHeight, 1877  
Save, 1879  
SaveAll, 1880  
SaveAs, 1880  
SaveDefaultConfig, 1881  
SelectAll, 1882  
SendToBack, 1883  
SetCSLayerVisible, 1885  
SetDeclutterObjectSize, 1886  
SetOpenContext, 1886  
SetRTLLayerVisible, 1887  
ShowPropertiesDialog, 1888  
ShowSymbolLibraryDialog, 1889  
ShowTagDialog, 1890  
TileWindowsHorizontally, 1890  
TileWindowsVertically, 1891  
Ungroup, 1892  
Methods in VBS  
  ActivateDynamic, 713  
  Create, 716  
  DeactivateDynamic, 718  
Methods:Activate, 712  
Methods:Add, 713  
Methods:Read, 783  
Methods:Refresh, 788  
Methods:Remove, 789  
Methods:RemoveAll, 792  
Methods:Restore, 794  
Methods:Stop, 810  
Methods:Trace, 811  
Methods:Write, 813  
Microsoft Script Debugger, 87

mktime, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 modf, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 Module, 36, 39  
     Adding information, 45  
     Dialog "Info", 45, 47  
     Editing, 36  
     Name, 36  
     Protecting with a Password, 47  
     Save, 48  
 Module:Create, 39  
 Module:Renaming, 50  
 MoveAxis, 772  
 MoveRuler, 772  
 MoveToFirst, 775  
 MoveToFirstLine, 775  
 MoveToFirstPage, 775  
 MoveToLast, 776  
 MoveToLastLine, 776  
 MoveToLastPage, 777  
 MoveToNext, 777  
 MoveToNextLine, 777  
 MoveToNextPage, 778  
 MoveToPrevious, 778  
 MoveToPreviousLine, 779  
 MoveToPreviousPage, 779  
 MultiLineEdit object, 2016

## N

Names, 94  
 Names:of actions in VBScript Files, 94

Navigation window  
     Identification of actions in the navigation  
     window, 914  
 New, 39, 56  
 New:Action, 56  
 New:Procedure, 39  
 NextColumn, 779  
 NextTrend, 780  
 NibbleSelect property, 2345

## O

Object model, 1745  
     Lists, 107  
     Methods, 710  
     Objects, 107  
 Object model:Properties, 301  
 Object names, 94  
 Object Types  
     Controls, 218  
     Customized object, 298  
 Object Types:Group, 300  
 Objects, 1745  
     3DBarGraph, 1894  
     ActiveXControl, 1900  
     AnalogResultInfo, 1907  
     ApplicationWindow, 1911  
     BarGraph, 1914  
     BinaryResultInfo, 1918  
     BitResultInfo, 1919  
     Button, 1921  
     CheckBox, 1924  
     Circle, 1928  
     CircularArc, 1931  
     ConnectorPoints (Listing), 1936  
     CustomizedObject, 1938  
     DataLanguage, 1941  
     DestLink, 1945  
     DirectConnection, 1947  
     Document, 1949  
     DynamicDialog, 1955  
     Ellipse, 1957  
     EllipseArc, 1960  
     EllipseSegment, 1963  
     Event, 1966  
     FolderItem ,  
     GraphicObject, 1975  
     Group, 1978  
     GroupDisplay, 1980  
     HMIObject, 1988  
     IOField, 1992  
     LanguageFont, 1996

- LanguageText ,
- Layer, 2001
- Line, 2004
- Menu, 2009
- MenuItem ,
- objConnection, 2019
- OLEObject, 2023
- OptionGroup, 2025
- Overview, 1745
- PictureWindow, 2029
- PieSegment, 2032
- Polygon, 2035
- PolyLine, 2038
- Property, 2042
- QualityCodeStateValue, 2044
- Rectangle, 2049
- RoundButton, 2052
- RoundRectangle, 2055
- ScriptInfo, 2058
- Slider, 2062
- SourceLink, 2065
- StaticText, 2067
- StatusDisplay, 2070
- SymbolLibrary, 2074
- TextList, 2076
- Toolbar, 2080
- ToolbarItem ,
- Trigger, 2087
- VariableStateValue, 2096
- VariableTrigger ,
- View, 2102
- Objects in VBA
  - ComboBox ,
  - FaceplateObject, 1969
  - ListBox, 2007
  - MultiLineEdit, 2016
  - TubeArcObject, 2088
  - TubeDoubleTeeObject, 2090
  - TubePolyline, 2092
  - TubeTeeObject, 2094
- Objects in VBS
  - Alarm object, 110
  - AlarmLogs Object, 112
  - DataItem Object, 113
  - DataLogs Object, 114
  - HMIRuntime Object, 118
  - Item Object, 119
  - Layer Object, 120
  - Logging Object, 122
  - ProcessValue Object, 123
  - Project Object, 124
  - Screen Object, 131
  - ScreenItem Object, 125
  - Smart tags, 136
  - Tag Object, 137
- Objects VBA Reference
  - Objects and Lists ,
  - Objektnames:define in Runtime, 94
  - OnDeactivateExecute, 1007
  - OnErrorExecute, 1007
  - OneToOneView, 780
  - Online Trend Control, 295
  - OnlineTableControl, 257
    - Example of C script, 1579
    - VBS example, 851
  - OnlineTrendControl, 262
    - Example of C script, 1581
    - TimeAxis object, 230
    - ValueAxis object, 235
    - VBS example, 846
    - VBS example to setpoint trend, 849
  - OnTime, 1009
  - OpenHomePicture, 1405
  - Opening, 923
  - OpenNextPicture, 1406
  - OpenPicture, 946
  - OpenPrevPicture, 1406
  - OpenStoredPicture, 1407
  - OperatorMessage object, 224
  - OriginalPropertyName property, 2357
  - Output, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - Output window, 878
  - OutputValue, 2359

**P**

- Page view
  - Opening, 891
- PaintColor\_QualityCodeBad, 2359
- PaintColor\_QualityCodeUnCertain, 2359
- ParentCookie property, 2362
- Password, 47, 62
  - assign fro action, 62

- for a module, 47
- for a Procedure, 47
- Password input, 900, 912
- Paste, 82, 85
- PasteRows , 781
- Picture, 1658
  - Editing copy with VBA, 1658
- Picture-specific menu, 1655
  - Assigning help text, 1639
  - Assigning status text, 1639
  - Assigning VBA macro, 1642
  - Configuring, 1626
  - Creating, 1655
  - creating multiple languages, 1633
- Picture-specific toolbar, 1655
  - Assigning status text, 1639
  - Assigning VBA macro, 1642
  - Configuring, 1626
  - Creating, 1655
- Pinnable property, 2378
- Pinned property, 2378
- pow, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- PreviousColumn, 781
- PreviousTrend, 781
- Print, 782
- Print parameters, 890
  - Setting, 890
- Print:VBScript, 104
- PrioAlarm, 2383
- PrioBit16, 2383
- procedure, 1619
  - Adding information, 45
  - Creating, 36
  - Dialog "Info", 45, 47
  - Editing, 36
  - Name, 36
  - Protecting with a Password, 47
  - Save, 48
  - Version, 1619
- Procedure:Change, 41
- Procedure>Delete, 35
- Procedure:New creation, 39
- Procedure:Project Procedure, 44
- Procedure:Rename, 50
- Procedure:Standard procedure, 44
- Procedure:Storage location in WinCC, 20
- Procedure:use multiple times, 20
- Procedure:Write Code, 41
- Process, 2384
- Process1, 2384
- Process2, 2385
- Process3, 2385
- ProcessValue Object, 123
- ProcessValues Object (List), 124
- ProgramExecute, 1009
- Project documentation
  - Printing, 891
- Project function, 867
  - Application, 867
  - Applying, 897
  - Characteristics, 867
  - Deleting, 887
- Project language, 1624
  - Access with VBA, 1624
- Project Object, 124
- Project Procedure:Use, 44
- Properties, 898, 900, 910, 912, 920, 921, 1745
  - Actions, 2106
  - ActiveDocument, 2107
  - ActiveLayer, 2108
  - ActualPointLeft, 2109
  - ActualPointTop, 2110
  - AdaptBorder, 2111
  - AdaptPicture, 2111
  - AdaptSize, 2112
  - AlarmHigh, 2114
  - AlarmLow, 2115
  - Alignment, 2116
  - AlignmentLeft, 2117
  - AlignmentTop, 2118
  - AnalogResultInfos, 2118
  - AngleAlpha, 2119
  - AngleBeta, 2120
  - Application, 2121
  - ApplicationDataPath, 2121
  - Assignments, 2122
  - AssumeOnExit, 2123
  - AssumeOnFull, 2123
  - AutomationName, 2124
  - AvailableDataLanguages, 2127
  - Average, 2128
  - Axe, 2129
  - AxisSection, 2130
  - BackBorderWidth, 2131

BackColor, 2131  
BackColor2, 2133  
BackColor3, 2133  
BackColorBottom, 2135  
BackColorTop, 2135  
BackFlashColorOff, 2138  
BackFlashColorOn, 2139  
Background, 2140  
BackPictureAlignment, 2141  
BackPictureName, 2141  
BarDepth, 2141  
BarHeight, 2142  
BarWidth, 2143  
BasePicReferenced, 2143  
BasePicTransColor, 2144  
BasePicture, 2144  
BasePicUseTransColor, 2145  
BaseX, 2146  
BaseY, 2147  
BinaryResultInfo, 2147  
BitNotSetValue, 2148  
BitNumber, 2148  
BitResultInfo, 2149  
BitSetValue, 2150  
Bold, 2151  
BorderBackColor, 2152  
BorderColor, 2153  
BorderColorBottom, 2155  
BorderColorTop, 2155  
BorderEndStyle, 2156  
BorderFlashColorOff, 2157  
BorderFlashColorOn, 2159  
BorderStyle, 2160  
BorderWidth, 2161  
BottomConnectedConnectionPointIndex, 2163  
BottomConnectedObjectName, 2162  
BoxAlignment, 2163  
BoxCount, 2164  
BoxType, 2165  
Button1Width, 2166  
ButtonColor, 2167  
Caption, 2168  
CaptionText, 2169  
CheckAlarmHigh, 2170  
CheckAlarmLow, 2171  
Checked, 2172  
CheckLimitHigh4, 2172  
CheckLimitHigh5, 2173  
CheckLimitLow4, 2174  
CheckLimitLow5, 2175  
CheckToleranceHigh, 2176  
CheckToleranceLow, 2177  
CheckWarningHigh, 2178  
CheckWarningLow, 2179  
ClearOnError, 2180  
ClearOnNew, 2181  
CloseButton, 2182  
ColorAlarmHigh, 2182  
ColorAlarmLow, 2183  
ColorBottom, 2184  
ColorChangeType, 2185  
ColorLimitHigh4, 2186  
ColorLimitHigh5, 2186  
ColorLimitLow4, 2187  
ColorLimitLow5, 2188  
ColorToleranceHigh, 2189  
ColorToleranceLow, 2190  
ColorTop, 2191  
ColorWarningHigh, 2192  
ColorWarningLow, 2193  
CommandLine Property, 2196  
CommonVBSCode, 2194  
Compiled, 2197  
ConfigurationFileName, 2198  
Count, 2201  
CurrentDataLanguage, 2204  
CurrentDesktopLanguage, 2205  
CursorControl, 2206  
CursorMode, 2206  
CustomMenus, 2207  
CustomToolbars, 2208  
CycleName, 2208  
CycleTime, 2209  
CycleType, 2209  
DataFormat, 2210  
DefaultHMIObjects, 2210  
DeselectAll Method, 1834  
DestinationLink, 2211  
Direction, 2213  
DisableVBAEvents, 2214  
DisplayName, 2214  
DisplayOptions, 2215  
DisplayText, 2216  
Documents, 2217  
Dynamic, 2218  
EditAtOnce, 2219  
ElseCase, 2220  
Enabled, 2220  
EndAngle, 2222  
Events, 2223  
EventType, 2225  
Exponent, 2227  
ExtendedOperation, 2227  
ExtendedZoomingEnable, 2228

Family, 2229  
FillColor, 2231  
Filling, 2232  
FillingIndex, 2233  
FillStyle, 2235  
FillStyle2, 2237  
FillStyleAlignment, 2239  
FlashBackColor, 2239  
FlashBorderColor, 2240  
FlashFlashPicture, 2241  
FlashForeColor, 2242  
FlashPicReferenced, 2242  
FlashPicTransColor, 2243  
FlashPicture, 2244  
FlashPicUseTransColor, 2246  
FlashRate, 2246  
FlashRateBackColor, 2247  
FlashRateBorderColor, 2249  
FlashRateFlashPic, 2250  
FlashRateForeColor, 2251  
FolderItems, 2254  
FontBold, 2256  
FontColor, 2260  
FontFlashColorOff, 2261  
FontFlashColorOn, 2262  
FontItalic, 2257  
FontName, 2257  
FontSize, 2258  
FontUnderline, 2259  
ForeColor, 2260  
ForeFlashColorOff, 2261  
ForeFlashColorOn, 2262  
GlobalColorScheme, 2264  
GlobalShadow, 2264  
Grid, 2265  
GridColor, 2266  
GridHeight, 2267  
GridWidth, 2267  
GroupedHMIObjects, 2269  
GroupParent, 2268  
Height, 2269  
HiddenInput, 2271  
Hide, 2270  
Hotkeys, 2272  
Hysteresis, 2273  
HysteresisRange, 2274  
Icon, 2275, 2276, 2278  
Index, 2276  
InputValue, 2279  
IsActive, 2279  
IsConnectedToProject, 2280  
IsDynamicable, 2280  
Italic, 2282  
Item, 2283  
ItemBorderBackColor, 2283  
ItemBorderColor, 2284  
ItemBorderStyle, 2285  
ItemBorderWidth, 2286  
Key, 2287  
Label, 2288  
LanguageID, 2289  
LanguageName, 2290  
LanguageSwitch, 2291  
Layer, 2292, 2293  
Layer00Checked, 2293  
Layer00Color, 2294  
Layer00Value, 2296  
LayerDecluttering, 2296  
Layers, 2297  
LDFonts, 2298  
LDLabelTexts, 2299  
LDNames, 2301  
LDStatusTexts, 2301  
LDTTexts, 2303  
LDTTooltipTexts, 2303  
Left, 2305  
LeftComma, 2305  
LightEffect, 2306  
LimitHigh4, 2307  
LimitHigh5, 2307  
LimitLow4, 2308  
LimitLow5, 2309  
LimitMax, 2310  
LimitMin, 2311  
LineJoinStyle, 2312  
ListType, 2312  
LockBackColor, 2313  
LockedByCreatorID, 2314  
Macro, 2320  
MessageClass, 2339  
NumberLines, 2346  
OffsetTop, 2351  
OnTop, 2352  
Operation, 2353  
OperationMessage, 2354  
OperationReport, 2355  
Orientation, 2356  
OutputFormat, 2357  
OutputValue, 2358  
Overview, 1745  
Parent, 2359  
PasswordLevel, 2362  
Path, 2363  
PdIProtection, 2364

PicDeactReferenced, 2365  
PicDeactTransparent, 2366  
PicDeactUseTransColor, 2367  
PicDownReferenced, 2367  
PicDownTransparent, 2368  
PicDownUseTransColor, 2369  
PicReferenced, 2370  
PicTransColor, 2371  
PictureDeactivated, 2371  
PictureDown, 2372  
PictureName, 2373  
PictureUp, 2374  
PicUpReferenced, 2375  
PicUpTransparent, 2376  
PicUpUseTransColor, 2377  
PicUseTransColor, 2377  
PointCount, 2379  
Position, 2380  
PositiveValue, 2380  
PredefinedAngels, 2381  
Pressed, 2382  
Process, 2383  
ProfileName, 2385  
ProgID, 2386  
ProjectName, 2386  
ProjectType, 2387  
Properties, 2388  
prototype, 2389  
QualityCodeStateChecked, 2390  
QualityCodeStateValues, 2392  
Radius, 2394  
RadiusHeight, 2394  
RadiusWidth, 2395  
RangeTo, 2396  
ReferenceRotationLeft, 2396  
ReferenceRotationTop, 2397  
Relevant, 2398  
ResultType, 2399  
RightComma, 2399  
RotationAngle, 2400  
RoundCornerHeight, 2401  
RoundCornerWidth, 2402  
SameSize, 2403  
ScaleColor, 2403  
ScaleTicks, 2404  
Scaling, 2405  
ScalingMode, 2405  
ScalingType, 2406  
ScriptType, 2407  
ScrollBars, 2408  
ScrollPositionX, 2408  
ScrollPositionY, 2409  
ScrollPosX, 2411  
ScrollPosY, 2411  
see properties ,  
SelBGColor, 2412  
Selected, 2412  
SelIndex, 2414  
SelText, 2414  
SelTextColor, 2414  
ServerName, 2415  
ServerPrefix, 2416  
ShortCut, 2416  
SignificantMask, 2419  
Size, 2419  
Sizeable, 2421  
SmallChange, 2421  
SnapToGrid, 2422  
SourceCode, 2424  
SourceLink, 2422  
StartAngle, 2426  
StatusText, 2426  
SubMenu, 2427  
SymbolLibraries, 2428  
TabOrderAllHMIObjects, 2430  
TabOrderAlpha, 2429  
TabOrderKeyboard, 2431  
TabOrderMouse, 2432  
TabOrderOtherAction, 2432  
TabOrderSwitch, 2433  
Tag, 2434  
TagPrefix, 2436  
Text, 2439  
Toggle, 2441  
ToleranceHigh, 2442  
ToleranceLow, 2442  
ToolbarItems, 2443  
ToolTipText, 2445  
Top, 2446  
TopConnectedObjectName, 2446  
TopConnectedPointIndex, 2447  
Transparency, 2447  
Trend, 2448  
TrendColor, 2449  
Trigger, 2449  
Type:, 2450  
TypeAlarmHigh, 2451  
TypeAlarmLow, 2452  
TypeLimitHigh4, 2453  
TypeLimitHigh5, 2453  
TypeLimitLow4, 2454  
TypeLimitLow5, 2455  
TypeToleranceHigh, 2456  
TypeToleranceLow, 2457



TypeWarningHigh, 2458  
 TypeWarningLow, 2459  
 Underlined, 2460  
 UnselBGColor, 2462  
 UnselTextColor, 2462  
 UpdateCycle, 2463  
 UserValue1, 2466  
 UserValue2, 2467  
 UserValue3, 2467  
 UserValue4, 2468  
 Value, 2469  
 VALUE\_ACCESS\_FAULT, 2470  
 VALUE\_ADDRESS\_ERROR, 2472  
 VALUE\_BAD\_COMMLUV, 2474, 2476  
 VALUE\_BAD\_CONFERROR, 2478  
 VALUE\_BAD\_DEVICE, 2480  
 VALUE\_BAD\_MISCSTATES, 2482  
 VALUE\_BAD\_NONSPECIFIC, 2484  
 VALUE\_BAD\_NOTCONNECTED, 2486  
 VALUE\_BAD\_OUTOFSERV, 2488  
 VALUE\_BAD\_PROCRELNOM, 2490  
 VALUE\_BAD\_PROCRELSUB, 2492  
 VALUE\_CONVERSION\_ERROR, 2494  
 VALUE\_HANDSHAKE\_ERROR, 2496  
 VALUE\_HARDWARE\_ERROR, 2498  
 VALUE\_HIGHLIMITED, 2500  
 VALUE\_INVALID\_KEY, 2502  
 VALUE\_LOWLIMITED, 2504  
 VALUE\_MAX\_LIMIT, 2506  
 VALUE\_MAX\_RANGE, 2508  
 VALUE\_MIN\_LIMIT, 2510  
 VALUE\_MIN\_RANGE, 2512  
 VALUE\_NOT\_ESTABLISHED, 2514  
 VALUE\_SERVERDOWN, 2516  
 VALUE\_STARTUP\_VALUE, 2518  
 VALUE\_TIMEOUT, 2520  
 VALUE\_UNCERT\_ENGVHIGHLIM, 2522  
 VALUE\_UNCERT\_ENGVLOWLIM, 2524  
 VALUE\_UNCERT\_ENGVONLIM, 2526  
 VALUE\_UNCERT\_INITVAL, 2528  
 VALUE\_UNCERT\_LUV, 2530  
 VALUE\_UNCERT\_MAINTDEM, 2532  
 VALUE\_UNCERT\_MISCSTATES, 2534  
 VALUE\_UNCERT\_NONSPECIFIC, 2536  
 VALUE\_UNCERT\_PROCRELNOM, 2538  
 VALUE\_UNCERT\_SIMVAL, 2540  
 VALUE\_UNCERT\_SUBSTSET, 2542  
 VariablesExist, 2544  
 VariableStateChecked, 2545  
 VariableStateType, 2546  
 VariableStateValues, 2546  
 VariableTriggers, 2548  
 VarName, 2548  
 VBAVersion, 2549  
 VBE, 2550  
 Version, 2550  
 Views, 2550  
 Visible, 2551  
 WarningHigh, 2552  
 WarningLow, 2553  
 Width, 2553, 2554  
 WindowBorder, 2555  
 WindowMonitorNumber, 2556  
 WindowPositionMode, 2556  
 WindowsStyle, 2557  
 WindowState, 2557  
 ZeroPoint, 2558  
 ZeroPointValue, 2559  
 Zoom, 2559  
 Properties ,  
 Properties in VBA  
     CommonVBSEventArea, 2195  
     CommonVBSPPropertyArea, 2196  
     FaceplateType, 2228  
     TagScaleParam1, 2437  
     TagScaleParam2, 2437  
     TagScaleParam3, 2438  
     TagScaleParam4, 2438  
 Properties in VBS, 301  
     AlarmID, 308  
     BackStyle, 325  
     Comment, 390  
     ComputerName, 391  
     Context, 391  
     FillStyle, 419  
     FillStyleAlignment, 421  
     GlobalColorScheme, 438  
     HiddenInput, 311, 312, 445, 483, 516, 543, 577, 676, 702  
     IndependentWindow, 451  
     Index, 452  
     InputValue, 454  
     Instance, 454  
     ItemProviderClsid, 456  
     LineJoinStyle, 480  
     NumberLines, 511  
     ProcessValue, 545  
     RotationAngle, 552  
     SavedTrend, 557  
     Selected Trend, 565  
     SelIndex, 568  
     SelText, 568  
     Smart tag, 580  
     SortOrder, 580

- State, 587
- TableFocusOnButtonCommand, 595
- Transparency, 644
- UserName, 676
- WinCCStyle, 699
- WindowPositionMode, 700
- WindowsStyle, 700
- Properties in VBS/ScrollPositionX, 562
- Properties in VBS/ScrollPositionY, 562
- Properties in VBS:
  - DesiredCurveSourceUAColumnY, 404
  - Properties in VBS:AccessPath, 302
  - Properties in VBS:Activate, 302
  - Properties in VBS:ActiveProject, 303
  - Properties in VBS:ActiveScreen, 304
  - Properties in VBS:ActiveScreenItem, 304
  - Properties in VBS:Actualize, 305
  - Properties in VBS:ActualPointLeft, 305
  - Properties in VBS:ActualPointTop, 306
  - Properties in VBS:AdaptBorder, 306
  - Properties in VBS:AdaptPicture, 307
  - Properties in VBS:AdaptSize, 307
  - Properties in VBS:AdjustRuler, 307
  - Properties in VBS:AlarmHigh, 308
  - Properties in VBS:AlarmLogs, 308
  - Properties in VBS:AlarmLow, 309
  - Properties in VBS:Alignment, 309
  - Properties in VBS:AlignmentLeft, 309
  - Properties in VBS:AlignmentTop, 310
  - Properties in VBS:AllowPersistence, 310
  - Properties in VBS:AllServer, 311
  - Properties in VBS:Analog, 311
  - Properties in VBS:AngleAlpha, 312
  - Properties in VBS:AngleBeta, 312
  - Properties in VBS:AngleMax, 312
  - Properties in VBS:AngleMin, 313
  - Properties in VBS:Application, 313
  - Properties in VBS:Archive, 314
  - Properties in VBS:Assignments, 315
  - Properties in VBS:AssumeOnExit, 315
  - Properties in VBS:AssumeOnFull, 315
  - Properties in VBS:AutoRange, 317
  - Properties in VBS:AutoRangeX, 317
  - Properties in VBS:AutoRangeY, 317
  - Properties in VBS:AutoScroll, 317
  - Properties in VBS:AutoSize, 319
  - Properties in VBS:Average, 320
  - Properties in VBS:Axe, 320
  - Properties in VBS:Axis, 602
  - Properties in VBS:AxisSection, 321
  - Properties in VBS:BackBorderWidth, 321
  - Properties in VBS:BackColor, 322
  - Properties in VBS:BackColor2, 323
  - Properties in VBS:BackColor3, 323
  - Properties in VBS:BackColorBottom, 323
  - Properties in VBS:BackColorTop, 323
  - Properties in VBS:BackFlashColorOff, 324
  - Properties in VBS:BackFlashColorOn, 324
  - Properties in VBS:Background, 324
  - Properties in VBS:Background Picture, 324
  - Properties in VBS:BackPictureAlignment, 325, 536
  - Properties in VBS:BackPictureName, 325
  - Properties in VBS:BarBackColor, 326
  - Properties in VBS:BarDepth, 328
  - Properties in VBS:BarFillColor, 329
  - Properties in VBS:BarHeight, 329
  - Properties in VBS:BarWidth, 340
  - Properties in VBS:BasePicReferenced, 340
  - Properties in VBS:BasePicTransColor, 341
  - Properties in VBS:BasePicture, 341
  - Properties in VBS:BasePicUseTransColor, 341
  - Properties in VBS:BaseScreenName, 342
  - Properties in VBS:BaseX, 343
  - Properties in VBS:BaseY, 342
  - Properties in VBS:BeginTime, 343
  - Properties in VBS:BeginValue, 343
  - Properties in VBS:BeginWidth, 346
  - Properties in VBS:BeginX, 344
  - Properties in VBS:BeginY, 344
  - Properties in VBS:BevelColorDown, 344
  - Properties in VBS:BevelColorUp, 345
  - Properties in VBS:BevellInner, 345
  - Properties in VBS:BevelOuter, 345
  - Properties in VBS:BitNumber, 346
  - Properties in VBS:BlinkColor, 346
  - Properties in VBS:BorderBackColor, 353
  - Properties in VBS:BorderColor, 353
  - Properties in VBS:BorderColorBottom, 354
  - Properties in VBS:BorderColorTop, 354
  - Properties in VBS:BorderEndStyle, 354
  - Properties in VBS:BorderFlashColorOff, 354
  - Properties in VBS:BorderFlashColorOn, 355
  - Properties in VBS:BorderStyle, 355
  - Properties in VBS:BorderWidth, 355
  - Properties in VBS:BottomConnectedConnectionPointIndex, 356
  - Properties in VBS:BottomConnectedObjectName, 356
  - Properties in VBS:BoxAlignment, 356
  - Properties in VBS:BoxCount, 357
  - Properties in VBS:BoxType, 357
  - Properties in VBS:Button1Width, 361
  - Properties in VBS:Button2Width, 361
  - Properties in VBS:Button3Width, 362

Properties in VBS:Button4Width, 362  
Properties in VBS:ButtonColor, 357  
Properties in VBS:ButtonCommand, 358  
Properties in VBS:Caption, 362  
Properties in VBS:CaptionColor, 363  
Properties in VBS:CaptionFont, 363  
Properties in VBS:CaptionOffset, 364  
Properties in VBS:CaptionText, 364  
Properties in VBS:CellCut, 364  
Properties in VBS:CenterColor, 366  
Properties in VBS:CenterScale, 366  
Properties in VBS:CheckAlarmHigh, 367  
Properties in VBS:CheckAlarmLow, 367  
Properties in VBS:CheckLimitHigh4, 367  
Properties in VBS:CheckLimitHigh5, 368  
Properties in VBS:CheckLimitLow4, 368  
Properties in VBS:CheckLimitLow5, 368  
Properties in VBS:CheckToleranceHigh, 369  
Properties in VBS:CheckToleranceLow, 369  
Properties in VBS:CheckWarningHigh, 369  
Properties in VBS:CheckWarningLow, 370  
Properties in VBS:ClearOnError, 370  
Properties in VBS:ClearOnNew, 370  
Properties in VBS:Closeable, 370  
Properties in VBS:CloseButton, 371  
Properties in VBS:CoarseGrid, 371  
Properties in VBS:CoarseGridValue, 372  
Properties in VBS:CoarseGridValueX, 373  
Properties in VBS:CoarseGridValueY, 373  
Properties in VBS:CoarseGridX, 372  
Properties in VBS:CoarseGridY, 372  
Properties in VBS:CollectValue, 373  
Properties in VBS:ColMove, 374  
Properties in VBS:Color, 374  
Properties in VBS:ColorAlarmHigh, 374  
Properties in VBS:ColorAlarmLow, 375  
Properties in VBS:ColorBottom, 375  
Properties in VBS:ColorChangeType, 375  
Properties in VBS:ColorLimitHigh4, 376  
Properties in VBS:ColorLimitHigh5, 376  
Properties in VBS:ColorLimitLow4, 376  
Properties in VBS:ColorLimitLow5, 377  
Properties in VBS:ColorToleranceHigh, 377  
Properties in VBS:ColorToleranceLow, 377  
Properties in VBS:ColorTop, 377  
Properties in VBS:ColorWarningHigh, 378  
Properties in VBS:ColorWarningLow, 378  
Properties in VBS:ColTitle, 378  
Properties in VBS:ColWidth, 389  
Properties in VBS:Command, 390  
Properties in VBS:CommonTime, 390  
Properties in VBS:CommonX, 391  
Properties in VBS:CommonY, 391  
Properties in VBS:ContinuousChange, 393  
Properties in VBS:Count, 393  
Properties in VBS:CurrentContext, 394  
Properties in VBS:Cursor, 395  
Properties in VBS:CursorControl, 395  
Properties in VBS:CurveForm, 396  
Properties in VBS:Danger, 397  
Properties in VBS:DangerColor, 397, 400  
Properties in VBS:DataFormat, 397  
Properties in VBS:DataIndex, 398  
Properties in VBS:DataLogs, 398  
Properties in VBS:DataSet, 398  
Properties in VBS:DataX, 399  
Properties in VBS:DataXY, 399  
Properties in VBS:DataY, 400  
Properties in VBS>DeleteData, 402  
Properties in VBS:Delta, 402  
Properties in VBS:DesiredCurveColor, 402  
Properties in VBS:DesiredCurveCurveForm, 403  
Properties in  
VBS:DesiredCurveSourceNumberOfUAValues, 403  
Properties in  
VBS:DesiredCurveSourceUAArchive, 403  
Properties in  
VBS:DesiredCurveSourceUAArchiveStartID, 404  
Properties in  
VBS:DesiredCurveSourceUAColumnX, 404  
Properties in VBS:DesiredCurveVisible, 405  
Properties in VBS:Direction, 405  
Properties in VBS:DisplayOptions, 406  
Properties in VBS>Edit, 407  
Properties in VBS:Editable, 407  
Properties in VBS>EditAtOnce, 407  
Properties in VBS:Enabled, 408  
Properties in VBS:EndAngle, 409  
Properties in VBS:EndTime, 410  
Properties in VBS:EndValue, 410  
Properties in VBS:EndX, 411  
Properties in VBS:EndY, 411  
Properties in VBS:ErrorDescription, 411  
Properties in VBS:Exponent, 412  
Properties in VBS:ExtendedOperation, 415  
Properties in VBS:ExtendedZoomingEnable, 416  
Properties in VBS:FillColor, 418  
Properties in VBS:Filling, 419  
Properties in VBS:FillingIndex, 419  
Properties in VBS:FillStyle2, 421  
Properties in VBS:FineGrid, 422  
Properties in VBS:FineGridValue, 422  
Properties in VBS:FineGridValueX, 422  
Properties in VBS:FineGridValueY, 423

Properties in VBS:FineGridX, 423  
Properties in VBS:FineGridY, 423  
Properties in VBS:FlashBackColor, 423  
Properties in VBS:FlashBorderColor, 424  
Properties in VBS:FlashFlashPicture, 424  
Properties in VBS:FlashForeColor, 424  
Properties in VBS:FlashPicReferenced, 425  
Properties in VBS:FlashPicTransColor, 425  
Properties in VBS:FlashPicture, 425  
Properties in VBS:FlashPicUseTransColor, 426  
Properties in VBS:FlashRate, 426  
Properties in VBS:FlashRateBackColor, 427  
Properties in VBS:FlashRateBorderColor, 427  
Properties in VBS:FlashRateFlashPic, 428  
Properties in VBS:FlashRateForeColor, 428  
Properties in VBS:Flip, 429  
Properties in VBS:FocusColor, 430  
Properties in VBS:FocusRect, 430  
Properties in VBS:FocusWidth, 430  
Properties in VBS:Font, 431  
Properties in VBS:FontBold, 432  
Properties in VBS:FontItalic, 432  
Properties in VBS:FontName, 433  
Properties in VBS:FontPosition, 433  
Properties in VBS:FontSize, 433  
Properties in VBS:FontStrikeThru, 434  
Properties in VBS:FontUnderline, 434  
Properties in VBS:ForeColor, 435  
Properties in VBS:ForeFlashColorOff, 435  
Properties in VBS:ForeFlashColorOn, 436  
Properties in VBS:FrameColor, 436  
Properties in VBS:FrameColorDown, 436  
Properties in VBS:FrameColorUp, 437  
Properties in VBS:FramePicture, 437  
Properties in VBS:FrameScale, 437  
Properties in VBS:FrameWidth, 438  
Properties in VBS:FreezeProviderConnections, 438  
Properties in VBS:GraphDirection, 439  
Properties in VBS:GridLineHorz, 440  
Properties in VBS:Gridlines, 439, 440  
Properties in VBS:GridLinesValueX, 440  
Properties in VBS:GridLinesValueY, 441  
Properties in VBS:GridlinesX, 441  
Properties in VBS:GridLinesY, 441  
Properties in VBS:GridLineValue, 442  
Properties in VBS:GridLineVert, 442  
Properties in VBS:HandFillColor, 442  
Properties in VBS:Handtype, 443  
Properties in VBS:HeaderSort, 443  
Properties in VBS:Height, 443  
Properties in VBS:HiddenInput, 444  
Properties in VBS:Hotkey, 450  
Properties in VBS:HourNeedleHeight, 450  
Properties in VBS:HourNeedleWidth, 450  
Properties in VBS:Hysteresis, 451  
Properties in VBS:HysteresisRange, 451  
Properties in VBS:InnerBevelOffset, 453  
Properties in VBS:InnerBevelStyle, 453  
Properties in VBS:InnerBevelWidth, 453  
Properties in VBS:InsertData, 454  
Properties in VBS:ItemBorderBackColor, 455  
Properties in VBS:ItemBorderColor, 455  
Properties in VBS:ItemBorderStyle, 455  
Properties in VBS:ItemBorderWidth, 456  
Properties in VBS:ItemVisible, 456  
Properties in VBS:Label, 457  
Properties in VBS:LabelColor, 457  
Properties in VBS:LabelX, 457  
Properties in VBS:LabelY, 458  
Properties in VBS:Language-IDs, 458  
Properties in VBS:LanguageSwitch, 458  
Properties in VBS:LastError, 459  
Properties in VBS:Layer, 460  
Properties in VBS:Layer00Checked, 461  
Properties in VBS:Layer00Color, 465  
Properties in VBS:Layer00Value, 472  
Properties in VBS:Layer01Checked, 461  
Properties in VBS:Layer01Color, 465  
Properties in VBS:Layer01Value, 473  
Properties in VBS:Layer02Checked, 462  
Properties in VBS:Layer02Color, 465  
Properties in VBS:Layer02Value, 473  
Properties in VBS:Layer03Checked, 462  
Properties in VBS:Layer03Color, 466  
Properties in VBS:Layer03Value, 473  
Properties in VBS:Layer04Checked, 462  
Properties in VBS:Layer04Color, 466  
Properties in VBS:Layer04Value, 473  
Properties in VBS:Layer05Checked, 463  
Properties in VBS:Layer05Color, 466  
Properties in VBS:Layer05Value, 474  
Properties in VBS:Layer06Checked, 463  
Properties in VBS:Layer06Color, 467  
Properties in VBS:Layer06Value, 474  
Properties in VBS:Layer07Checked, 463  
Properties in VBS:Layer07Color, 467  
Properties in VBS:Layer07Value, 474  
Properties in VBS:Layer08Checked, 464  
Properties in VBS:Layer08Color, 467  
Properties in VBS:Layer08Value, 475  
Properties in VBS:Layer09Checked, 464  
Properties in VBS:Layer09Color, 468  
Properties in VBS:Layer09Value, 475  
Properties in VBS:Layer10Checked, 464

- Properties in VBS:Layer10Color, 468
- Properties in VBS:Layer10Value, 475
- Properties in VBS:LayerDeclutteringEnable, 475
- Properties in VBS:Layers, 476
- Properties in VBS:Left, 476
- Properties in VBS:LeftComma, 477
- Properties in VBS:LightEffect, 477
- Properties in VBS:LimitHigh4, 478
- Properties in VBS:LimitHigh5, 478
- Properties in VBS:LimitLow4, 478
- Properties in VBS:LimitLow5, 479
- Properties in VBS:LimitMax, 479
- Properties in VBS:LimitMin, 479
- Properties in VBS:LineFont, 480
- Properties in VBS:LineHeight, 480
- Properties in VBS:LineTitle, 481
- Properties in VBS:LineWidth, 481
- Properties in VBS:ListType, 481
- Properties in VBS:LoadDataImmediately, 482
- Properties in VBS:LocaleID, 482
- Properties in VBS:LockBackColor, 483
- Properties in VBS:LockStatus, 483
- Properties in VBS:LockText, 484
- Properties in VBS:LockTextColor, 484
- Properties in VBS:Logging, 484
- Properties in VBS:LongStrokesBold, 484
- Properties in VBS:LongStrokesOnly, 485
- Properties in VBS:LongStrokesSize, 485
- Properties in VBS:LongStrokesTextEach, 485
- Properties in VBS:LowerLimit, 486
- Properties in VBS:LowerLimitColor, 487
- Properties in VBS:LowerLimitValue, 487
- Properties in VBS:Marker, 488
- Properties in VBS:Max, 488
- Properties in VBS:MaximizeButton, 488
- Properties in VBS:MCGUBackColorOff, 489
- Properties in VBS:MCGUBackColorOn, 489
- Properties in VBS:MCGUBackFlash, 489
- Properties in VBS:MCGUTextColorOff, 490
- Properties in VBS:MCGUTextColorOn, 490
- Properties in VBS:MCGUTextFlash, 490
- Properties in VBS:MCKOBackColorOff, 490
- Properties in VBS:MCKOBackColorOn, 491
- Properties in VBS:MCKOBackFlash, 491
- Properties in VBS:MCKOTextColorOff, 491
- Properties in VBS:MCKOTextColorOn, 492
- Properties in VBS:MCKOTextFlash, 492
- Properties in VBS:MCKQBackColorOff, 492
- Properties in VBS:MCKQBackColorOn, 492
- Properties in VBS:MCKQBackFlash, 493
- Properties in VBS:MCKQTextColorOff, 493
- Properties in VBS:MCKQTextColorOn, 493
- Properties in VBS:MCKQTextFlash, 494
- Properties in VBS:MCText, 494
- Properties in VBS:MeasurePoints, 494
- Properties in VBS:MessageClass, 503
- Properties in VBS:Min, 506
- Properties in VBS:MinuteNeedleHeight, 507
- Properties in VBS:MinuteNeedleWidth, 507
- Properties in VBS:Movable, 507
- Properties in VBS:MsgCtrlFlags, 508
- Properties in VBS:MsgFilterSQL, 508
- Properties in VBS:Name, 509
- Properties in VBS:NeedleColor, 510
- Properties in VBS:NormalColor, 510
- Properties in VBS:NumItems, 511
- Properties in VBS:Object, 512
- Properties in VBS:ObjectName, 512
- Properties in VBS:ObjectSizeDeclutteringEnable, 513
- Properties in VBS:ObjectSizeDeclutteringMax, 514
- Properties in VBS:ObjectSizeDeclutteringMin, 515
- Properties in VBS:OffsetLeft, 515
- Properties in VBS:OffsetTop, 516
- Properties in VBS:Online, 516
- Properties in VBS:OnTop, 517
- Properties in VBS:OperationMessage, 517
- Properties in VBS:OperationReport, 525
- Properties in VBS:Orientation, 526
- Properties in VBS:OuterBevelStyle, 526
- Properties in VBS:OuterBevelWidth, 527
- Properties in VBS:Outline, 527
- Properties in VBS:OutputFormat, 527
- Properties in VBS:OutputValue, 528
- Properties in VBS:Parent, 529
- Properties in VBS>PasswordLevel, 530
- Properties in VBS:Path, 531
- Properties in VBS:PersistentRT, 532
- Properties in VBS:PersistentRTCS, 532
- Properties in VBS:PersistentRTCSPermission, 533
- Properties in VBS:PersistentRTPermission, 533
- Properties in VBS:PicDeactReferenced, 534
- Properties in VBS:PicDeactTransparent, 534
- Properties in VBS:PicDeactUseTransColor, 534
- Properties in VBS:PicDownReferenced, 535
- Properties in VBS:PicDownTransparent, 535
- Properties in VBS:PicDownUseTransColor, 535
- Properties in VBS:PicReferenced, 535
- Properties in VBS:PicTransColor, 536
- Properties in VBS:Picture, 536
- Properties in VBS:PictureBack, 536
- Properties in VBS:PictureDeactivated, 537
- Properties in VBS:PictureDown, 537
- Properties in VBS:PictureName, 538

Properties in VBS:PictureSelected, 538  
Properties in VBS:PictureThumb, 538  
Properties in VBS:PictureUnselected, 539  
Properties in VBS:PictureUp, 539  
Properties in VBS:PicUpReferenced, 539  
Properties in VBS:PicUpTransparent, 540  
Properties in VBS:PicUpUseTransColor, 540  
Properties in VBS:PicUseTransColor, 540  
Properties in VBS:PointCount, 541  
Properties in VBS:Position, 541  
Properties in VBS:Precisions, 542  
Properties in VBS:PrecisionX, 542  
Properties in VBS:PrecisionY, 542  
Properties in VBS:PredefinedAngles, 543  
Properties in VBS:Pressed, 543  
Properties in VBS:PrintJob, 544  
Properties in VBS:Process, 544  
Properties in VBS:ProjectPath, 545  
Properties in VBS:ProviderClsID, 545  
Properties in VBS:ProviderType, 545  
Properties in VBS:QualityCode, 546  
Properties in VBS:Radius, 547  
Properties in VBS:RadiusHeight, 547  
Properties in VBS:RadiusWidth, 548  
Properties in VBS:RangeMax, 548  
Properties in VBS:RangeMin, 548  
Properties in VBS:Rectangular, 549  
Properties in VBS:ReferenceRotationLeft, 549  
Properties in VBS:ReferenceRotationTop, 549  
Properties in VBS:RelayCurves, 550  
Properties in VBS:Relevant, 550  
Properties in VBS:Replacement, 550  
Properties in VBS:ReplacementColor, 551  
Properties in VBS:RightComma, 551  
Properties in VBS:RoundCornerHeight, 553  
Properties in VBS:RoundCornerWidth, 553  
Properties in VBS:RulerPrecisions, 556  
Properties in VBS:RulerPrecisionX, 556  
Properties in VBS:RulerPrecisionY, 556  
Properties in VBS:SameSize, 557  
Properties in VBS:ScaleColor, 558  
Properties in VBS:ScaleTicks, 558  
Properties in VBS:Scaling, 558  
Properties in VBS:ScalingType, 558  
Properties in VBS:ScalingTypeX, 559  
Properties in VBS:ScalingTypeY, 560  
Properties in VBS:Screen, 560  
Properties in VBS:ScreenItems, 561  
Properties in VBS:ScreenName, 560  
Properties in VBS:Screens, 309  
Properties in VBS:ScrollBars, 561  
Properties in VBS:SecondNeedleHeight, 563  
Properties in VBS:SecondNeedleWidth, 563  
Properties in VBS:SelBGColor, 563  
Properties in VBS:SelectionMode, 566  
Properties in VBS:SelectionRectColor, 567  
Properties in VBS:SelectionRectWidth, 567  
Properties in VBS:SelectionType, 568  
Properties in VBS:SelTextColor, 569  
Properties in VBS:ServerData, 569  
Properties in VBS:ServerNames, 571  
Properties in VBS:ServerPrefix, 571  
Properties in VBS:ShowBar, 572  
Properties in VBS:ShowDanger, 573  
Properties in VBS:ShowDecimalPoint, 573  
Properties in VBS:ShowNormal, 573  
Properties in VBS:ShowPeak, 574  
Properties in VBS:ShowPosition, 574  
Properties in VBS:ShowRulerImmediately, 575  
Properties in VBS:ShowThumb, 577  
Properties in VBS:ShowValuesExponentialX, 578  
Properties in VBS:ShowValuesExponentialY, 578  
Properties in VBS:ShowWarning, 579  
Properties in VBS:SignificantMask, 579  
Properties in VBS:SmallChange, 580  
Properties in VBS:SourceBeginTime, 581  
Properties in VBS:SourceEndTime, 582  
Properties in VBS:SourceNumberOfUAValues, 582  
Properties in VBS:SourceNumberOfValues, 583  
Properties in VBS:SourceTagNameX, 583  
Properties in VBS:SourceTagNameY, 584  
Properties in VBS:SourceTagProviderDataX, 584  
Properties in VBS:SourceTagProviderDataY, 584  
Properties in VBS:SourceTimeRange, 585  
Properties in VBS:SourceUAArchive, 585  
Properties in VBS:SourceUAArchiveStartID, 585  
Properties in VBS:SourceUAColumnX, 586  
Properties in VBS:SourceUAColumnY, 586  
Properties in VBS:SquareExtent, 587  
Properties in VBS:StartAngle, 587  
Properties in VBS:Statusbar, 588  
Properties in VBS:StatusbarPanels, 592  
Properties in VBS:StatusbarStretch, 594  
Properties in VBS:Tag, 695  
Properties in VBS:TagName, 596  
Properties in VBS:TagPrefix, 596  
Properties in VBS:TagProviderClsid, 597  
Properties in VBS:Tags, 597  
Properties in VBS:Template, 598  
Properties in VBS:Text, 598  
Properties in VBS:ThumbBackColor, 599  
Properties in VBS:TicColor, 599  
Properties in VBS:TicFont, 599  
Properties in VBS:Ticks, 601

- Properties in VBS:TicksColor, 601
- Properties in VBS:TickStyle, 602
- Properties in VBS:TicOffset, 600
- Properties in VBS:TicTextColor, 600
- Properties in VBS:TicTextOffset, 600
- Properties in VBS:TicWidth, 601
- Properties in VBS:TimeAxisFormat, 605
- Properties in VBS:TimeAxisX, 609
- Properties in VBS:TimeColumnAlignment, 611
- Properties in VBS:TimeFormat, 619
- Properties in VBS:TimeJump, 619
- Properties in VBS:TimeJumpColor, 620
- Properties in VBS:TimeOverlap, 620
- Properties in VBS:TimeOverlapColor, 620
- Properties in VBS:TimeRange, 621
- Properties in VBS:TimeRangeBase, 621
- Properties in VBS:TimeRangeFactor, 622
- Properties in VBS:TimeStamp, 622
- Properties in VBS:TimeZone, 624
- Properties in VBS:TitleCut, 625
- Properties in VBS:Titleline, 626
- Properties in VBS:Toggle, 627
- Properties in VBS:ToleranceHigh, 628
- Properties in VBS:ToleranceLow, 628
- Properties in VBS:Toolbar, 628
- Properties in VBS:ToolbarAlignment, 629
- Properties in VBS:ToolbarButtons, 638
- Properties in VBS:ToolbarHotKeys, 640
- Properties in VBS:ToolTipText, 641
- Properties in VBS:Top, 643
- Properties in
  - VBS:TopConnectedConnectionPointIndex, 644
  - Properties in VBS:TopConnectedObjectName, 644
- Properties in VBS:Transparent, 644
- Properties in VBS:Trend, 645
- Properties in VBS:TrendColor, 647
- Properties in VBS:Type, 666
- Properties in VBS:TypeAlarmHigh, 668
- Properties in VBS:TypeAlarmLow, 668
- Properties in VBS:TypeLimitHigh4, 669
- Properties in VBS:TypeLimitHigh5, 669
- Properties in VBS:TypeLimitLow4, 669
- Properties in VBS:TypeLimitLow5, 670
- Properties in VBS:TypeToleranceHigh, 670
- Properties in VBS:TypeToleranceLow, 670
- Properties in VBS:TypeWarningHigh, 670
- Properties in VBS:TypeWarningLow, 671
- Properties in VBS:UnitColor, 671
- Properties in VBS:UnitFont, 671
- Properties in VBS:UnitOffset, 672
- Properties in VBS:UnitText, 672
- Properties in VBS:UnselBGColor, 672
- Properties in VBS:UnselTextColor, 673
- Properties in VBS:UpdateCycle, 673
- Properties in VBS:UpperLimit, 673
- Properties in VBS:UpperLimitColor, 674
- Properties in VBS:UpperLimitValue, 674
- Properties in VBS:UserValue1, 677
- Properties in VBS:UserValue2, 677
- Properties in VBS:UserValue3, 677
- Properties in VBS:UserValue4, 678
- Properties in VBS:Value, 680
- Properties in VBS:ValueColumnAlignment, 688
- Properties in VBS:ValueMax, 695
- Properties in VBS:ValueMin, 695
- Properties in VBS:Visible, 696
- Properties in VBS:Warning, 697
- Properties in VBS:WarningColor, 697
- Properties in VBS:WarningHigh, 697
- Properties in VBS:WarningLow, 698
- Properties in VBS:Width, 698
- Properties in VBS:WindowBorder, 699
- Properties in VBS:WindowsStyle, 700
- Properties in VBS:WindowType, 701
- Properties in VBS:WithAxes, 701
- Properties in VBS:WithLabels, 701
- Properties in VBS:ZeroPoint, 709
- Properties in VBS:ZeroPointValue, 709
- Properties in VBS:Zoom, 709
- Properties: FillingDirection, 2234
- Property, 2464
- Protect VBA Code, 1615
- Push Button Control, 269
- putc, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

- Q**
- qsort, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - QuitHorn, 782
  - QuitSelected, 783
  - QuitVisible, 783
- R**
- rand, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - ReadTags, 787
  - realloc, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - Reference, 1745
    - Event Handling, 1745
    - Methods, 1745
    - Object model, 1745
    - Objects and Lists, 1745
    - Properties, 1745
    - VBA Object Model, 1745
  - References, 1615
  - Registry2, 946
  - remove, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - rename, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - Rename:Module, 50
  - Renaming, 50, 76
  - Renaming:Action, 76
  - Renaming:Procedure, 50
  - ReportJob, 968
  - rewind, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - RPTJobPreview, 1000
  - RPTJobPrint, 1000
  - RptShowError, 1001
  - RulerBlock object, 226
  - RulerColumn object, 227
  - RulerControl, 272
  - Runtime, 78
    - Activating Global Actions, 78



**S**

- Save, 63
  - Module, 48
  - procedure, 48
- Save As...
  - Applying, 886
- Save:Action, 63
- Saving file as, 922
- Screen Object, 131
- ScreenItem, 256, 262, 272, 280, 295
  - Control, 181
  - Controls, 218
  - Customized object, 298
  - Faceplate instance, 187
  - WinCC Alarm Control, 286
  - WinCC AlarmControl, 241
- ScreenItem Object, 125
- ScreenItem:3D bar, 169
- ScreenItem:Application window, 173
- ScreenItem:Bar, 174
- ScreenItem:Button, 201
- ScreenItem:Check Box, 204
- ScreenItem:Circle, 149
- ScreenItem:Circle segment, 152
- ScreenItem:Circular arc, 151
- ScreenItem:Combobox, 189
- ScreenItem:Connector, 167
- ScreenItem:Double T-piece, 216
- ScreenItem:Ellipse, 144
- ScreenItem:Ellipse arc, 146
- ScreenItem:Ellipse segment, 147
- ScreenItem:Graphic Object, 187
- ScreenItem:Group, 300
- ScreenItem:Group Display, 194
- ScreenItem:HMI Symbol Library, 239
- ScreenItem:I/O Field, 184
- ScreenItem:Line, 154
- ScreenItem:ListBox, 190
- ScreenItem:Multiline Text, 191
- ScreenItem:Object types, 143
- ScreenItem:OLE Element, 191
- ScreenItem:Picture window, 179
- ScreenItem:Polygon, 156
- ScreenItem:Polygon Tube, 215
- ScreenItem:Polyline, 158
- ScreenItem:Radio Box, 207
- ScreenItem:Rectangle, 159
- ScreenItem:Roundbutton, 209
- ScreenItem:Rounded Rectangle, 162
- ScreenItem:Slider, 212
- ScreenItem:Static Text, 165
- ScreenItem>Status Display, 199
- ScreenItem:Text list, 196
- ScreenItem:T-piece, 216
- ScreenItem:Tube Arc, 217
- ScreenItem:WinCC Digital Analog Clock, 246
- ScreenItem:WinCC Function Trend Control, 288
- ScreenItem:WinCC FunctionTrendControl, 248
- ScreenItem:WinCC Gauge Control, 254
- ScreenItem:WinCC Online Table Control, 292
- ScreenItem:WinCC OnlineTableControl, 257
- ScreenItem:WinCC Push Button Control, 269
- ScreenItem:WinCC Slider Control, 277
- ScreenItems object (list), 129
- Screens Object (List), 134
- Script file, 92
- Script File:Action Names, 94
- Script file:open in Debugger, 96
- Script File:Permissible action name length, 94
- Script File:Set bookmark, 100
- Script files of VBScripts, 92
- SelectedStatisticArea, 799
- ServerExport, 799
- ServerImport, 799
- Set\_Focus, 1287
- SetActualPointLeft, 1295
- SetActualPointTop, 1296
- SetAlarmHigh, 1319
- SetAlarmLow, 1320
- SetAlignment, 1247
- SetAlignmentLeft, 1288
- SetAlignmentTop, 1289
- SetAssumeOnExit, 1312
- SetAssumeOnFull, 1312
- SetAverage, 1355
- SetAxisSection, 1248
- SetBackBorderWidth, 1396
- SetBackColor, 1257
- SetBackColor2, 1258
- SetBackColor3, 1258
- SetBackColorBottom, 1259
- SetBackColorTop, 1260
- SetBackFlashColorOff, 1277
- SetBackFlashColorOn, 1278
- SetBasePicTransColor, 1390
- SetBasePicUseTransColor, 1391
- SetBitNumber, 1313
- SetBorderBackColor, 1261
- SetBorderColor, 1262
- SetBorderColorBottom, 1262
- SetBorderColorTop, 1263
- SetBorderEndStyle, 1397

SetBorderFlashColorOff, 1279  
SetBorderFlashColorOn, 1279  
SetBorderStyle, 1398  
SetBorderWidth, 1398  
SetBoxAlignment, 1399  
SetBoxCount, 1297  
SetBoxType, 1355  
setbuf, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095  
SetButtonColor, 1264  
SetCheckAlarmHigh, 1321  
SetCheckAlarmLow, 1321  
SetCheckLimitHigh4, 1322  
SetCheckLimitHigh5, 1323  
SetCheckLimitLow4, 1324  
SetCheckLimitLow5, 1324  
SetCheckToleranceHigh, 1325  
SetCheckToleranceLow, 1326  
SetCheckWarningHigh, 1327  
SetCheckWarningLow, 1327  
SetClearOnError, 1314  
SetClearOnNew, 1315  
SetColorAlarmHigh, 1328  
SetColorAlarmLow, 1329  
SetColorBottom, 1265  
SetColorChangeType, 1356  
SetColorLimitHigh4, 1330  
SetColorLimitHigh5, 1331  
SetColorLimitLow4, 1331  
SetColorLimitLow5, 1332  
SetColorToleranceHigh, 1333  
SetColorToleranceLow, 1334  
SetColorTop, 1266  
SetColorWarningHigh, 1335  
SetColorWarningLow, 1335  
SetCursorControl, 1357  
SetCursorMode, 1358  
SetDirection, 1298  
SetEditAtOnce, 1359  
SetEndAngle, 1299  
SetExponent, 1249  
SetExtendedOperation, 1359  
SetFillColor, 1266  
SetFilling, 1275  
SetFillingIndex, 1276  
SetFillStyle, 1400  
SetFillStyle2, 1401  
SetFlashBackColor, 1280  
SetFlashBorderColor, 1281  
SetFlashFlashPicture, 1392  
SetFlashForeColor, 1282  
SetFlashPicTransColor, 1392  
SetFlashPicUseTransColor, 1393  
SetFlashRateBackColor, 1282  
SetFlashRateBorderColor, 1283  
SetFlashRateFlashPic, 1394  
SetFlashRateForeColor, 1284  
SetFontBold, 1290  
SetFontItalic, 1290  
SetFontName, 1291  
SetFontSize, 1292  
SetFontUnderline, 1293  
SetForeColor, 1267  
SetForeFlashColorOff, 1285  
SetForeFlashColorOn, 1286  
SetHeight, 1299  
SetHiddenInput, 1315  
SetHysteresis, 1360  
SetHysteresisRange, 1361  
SetIndex, 1395  
SetItemBorderBackColor, 1268  
SetItemBorderColor, 1269  
SetItemBorderStyle, 1402  
SetItemBorderWidth, 1402  
SetLanguage, 1513  
SetLeft, 1300  
SetLeftComma, 1250  
SetLimitHigh4, 1336  
SetLimitHigh5, 1337  
SetLimitLow4, 1338  
SetLimitLow5, 1338  
SetLimitMax, 1339  
SetLimitMin, 1340  
SetLink, 1353  
SetLongStrokesBold, 1251  
SetLongStrokesOnly, 1252  
SetLongStrokesSize, 1252  
SetMarker, 1341  
SetMax, 1362  
SetMin, 1362  
SetNumberLines, 1316  
SetOffsetLeft, 1363  
SetOffsetTop, 1364  
SetOperation, 1364  
SetOperationMessage, 1365

SetOperationReport, 1366  
SetOrientation, 1293  
SetOutputValueChar, 1317  
SetOutputValueDouble, 1318  
SetPasswordLevel, 1367  
SetPicDeactTransparent, 1377  
SetPicDeactUseTransColor, 1378  
SetPicDownTransparent, 1379  
SetPicDownUseTransColor, 1380  
SetPicTransColor, 1380  
SetPictureDeactivated, 1381  
SetPictureDown, 1382  
SetPictureName, 1368  
SetPictureUp, 1383  
SetPicUpTransparent, 1384  
SetPicUpUseTransColor, 1385  
SetPicUseTransColor, 1385  
SetPointCount, 1301  
SetPosition, 1374  
SetPressed, 1403  
SetProcess, 1369  
SetPropBOOL, 1386  
SetPropChar, 1387  
SetPropDouble  
  0, 1388  
SetPropWord, 1389  
SetRadius, 1302  
SetRadiusHeight, 1303  
SetRadiusWidth, 1303  
SetRangeMax, 1375  
SetRangeMin, 1376  
SetReferenceRotationLeft, 1304  
SetReferenceRotationTop, 1305  
SetRightComma, 1253  
SetRotationAngle, 1306  
SetRoundCornerHeight, 1307  
SetRoundCornerWidth, 1307  
SetScaleColor, 1270  
SetScaleTicks, 1254  
SetScaling, 1255  
SetScalingType, 1256  
SetSelBGColor, 1271  
SetSelTextColor, 1271  
SetSmallChange, 1369  
SetStartAngle, 1308  
SetTagBit, 1500  
SetTagBitState, 1480  
SetTagBitStateWait, 1469  
SetTagBitWait, 1489  
SetTagByte, 1501  
SetTagByteState, 1481  
SetTagByteStateWait, 1469  
SetTagByteWait, 1490  
SetTagChar, 1501  
SetTagCharState, 1481  
SetTagCharStateWait, 1470  
SetTagCharWait, 1491  
SetTagDateTime, 1502  
SetTagDouble, 1503  
SetTagDoubleState, 1482  
SetTagDoubleStateWait, 1471  
SetTagDoubleWait, 1492  
SetTagDWord, 1503  
SetTagDWordState, 1483  
SetTagDWordStateWait, 1472  
SetTagDWordWait, 1493  
SetTagFloat, 1504  
SetTagFloatState, 1484  
SetTagFloatStateWait, 1473  
SetTagFloatWait, 1493  
SetTagMultiStateWait, 1474  
SetTagMultiWait, 1494  
SetTagPrefix, 1370  
SetTagRaw, 1505  
SetTagRawState, 1485  
SetTagRawStateWait, 1475  
SetTagRawWait, 1495  
SetTagSByte, 1506  
SetTagSByteState, 1486  
SetTagSByteStateWait, 1476  
SetTagSByteWait, 1496  
SetTagSDWord, 1507  
SetTagSDWordState, 1487  
SetTagSDWordStateWait, 1477  
SetTagSDWordWait, 1496  
SetTagSWord, 1507  
SetTagSWordState, 1488  
SetTagSWordStateWait, 1478  
SetTagSWordWait, 1497  
SetTagValue, 1508  
SetTagValueWait, 1498  
SetTagWord, 1509  
SetTagWordState, 1489  
SetTagWordStateWait, 1479  
SetTagWordWait, 1499  
SetText, 1294  
SetToggle, 1404  
SetToleranceHigh, 1341  
SetToleranceLow, 1342  
SetTop, 1309  
SetTrend, 1371  
SetTrendColor, 1272  
SetTypeAlarmHigh, 1343  
SetTypeAlarmLow, 1344

- SetTypeLimitHigh4, 1345
- SetTypeLimitHigh5, 1346
- SetTypeLimitLow4, 1346
- SetTypeLimitLow5, 1347
- SetTypeToleranceHigh, 1348
- SetTypeToleranceLow, 1349
- SetTypeWarningHigh, 1350
- SetTypeWarningLow, 1351
- SetUnselBGColor, 1273
- SetUnselTextColor, 1274
- setvbuf, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- SetVisible, 1372
- SetWarningHigh, 1352
- SetWarningLow, 1352
- SetWidth, 1310
- SetWindowsStyle, 1405
- SetZeroPoint, 1311
- SetZeroPointValue, 1373
- SetZoom, 1373
- ShowBadTagState, 2418
- ShowColumnSelection, 800
- ShowComment, 800
- ShowDisplayOptionsDialog, 801
- ShowEmergencyQuitDialog, 801
- ShowHelp, 801
- ShowHideList, 802
- ShowHitList, 802
- ShowInfoText, 803
- ShowLockDialog, 803
- ShowLockList, 804
- ShowLongTermArchiveList, 804
- ShowMessageList, 804
- ShowPercentageAxis, 805
- ShowPropertyDialog, 805
- ShowSelectArchive, 806
- ShowSelection, 806
- ShowSelectionDialog, 807
- ShowSelectTimeBase, 806
- ShowShortTermArchiveList, 807
- ShowSort, 808
- ShowSortDialog, 808
- ShowTagSelection, 808
- ShowTimebaseDialog, 809
- ShowTimeSelection, 809
- ShowTrendSelection, 810
- Simulation, 2419
- SimulationBit, 2419
- sin, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- sinh, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- Slider control, 277
- Smart object, 1662
  - Editing with VBA, 1664
- Smart Objects
  - Combobox, Control, 181
  - Faceplate instance,
- Smart objects:3D bar, 169
- Smart objects:Application window, 173
- Smart objects:Bar, 174
- Smart Objects:Graphic Object, 187
- Smart objects:Group Display, 194
- Smart objects:I/O Field, 184
- Smart objects>List Box, 190
- Smart Objects:Multiline Text, 191
- Smart Objects:OLE Element, 191
- Smart objects:Picture window, 179
- Smart objects:Status Display, 199
- Smart objects:Text list, 196
- Smart tag object, 136
- SmartTag property, 580

- sqrt, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 srand, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 Standard function  
     Application, 868  
     Applying, 897  
     Characteristics, 868  
     Deleting, 887  
 Standard object, 1662  
     Editing with VBA, 1664  
 Standard Objects:Circle, 149  
 Standard Objects:Circle segment, 152  
 Standard Objects:Circular arc, 151  
 Standard Objects:Connector, 167  
 Standard Objects:Ellipse, 144  
 Standard Objects:Ellipse arc, 146  
 Standard Objects:Ellipse segment, 147  
 Standard Objects:Line, 154  
 Standard Objects:Polygon, 156  
 Standard Objects:Polyline, 158  
 Standard Objects:Rectangle, 159  
 Standard Objects:Rounded Rectangle, 162  
 Standard objects:Static Text, 165  
 Standard procedure, 44  
 Standard procedure:Use, 44  
 Start, 1619  
     VBA editor, 1615  
     VBA Macros, 1619  
 Starting Global Script, 27  
 StartStopUpdate, 810  
 StatisticAreaColumn object, 228  
 StatisticResultColumn object, 229  
 Status bar, 878  
 StatusBarElement object, 229  
 stdio, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 stdlib, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 StorePicture, 1407  
 strcat, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095  
 strchr, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095





strtol, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 strtoul, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 Symbol Library, 239  
     Access with VBA,  
     Copying an object with VBA,  
     Creating a folder with VBA,  
     Deleting a folder with VBA,  
     Editing with VBA,  
     Paste Object into a Picture with VBA,  
 Syntax, 63  
 Syntax:Control, 63  
 Syntax:Error, 63  
 SysFree, 1011  
 SysMalloc, 1011  
 system, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 System behavior, 905

## T

Table Control, 292  
 Tag, 24, 64, 72, 2435, 2562  
     Change limits with VBA, 2562

    Change type with VBA, 2562  
     Configure a Trigger to an Action, 72  
     Creating with VBA, 2562  
     Define type with VBA, 2562  
     Deleting with VBA, 2562  
     Read limits with VBA, 2562  
     Read properties with VBA, 2562  
 Tag Logging, 2573  
     Create archive tag with VBA, 2573  
     Create process value archive with VBA, 2573  
     Delete archive tag with VBA, 2573  
     Delete process value archive with VBA, 2573  
     Edit archive tag with VBA, 2573  
     Edit process value archive with VBA, 2573  
 Tag Object, 137  
 Tag:global in VBS, 24  
 tagname, 2436  
 Tags Object (List), 140  
 TagScaleParam1 properties, 2437  
 TagScaleParam2 properties, 2437  
 TagScaleParam3 properties, 2438  
 TagScaleParam4 properties, 2438  
 TagSet Object (List), 141  
 tagtype, 2438  
 tan, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018,  
 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026,  
 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034,  
 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042,  
 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050,  
 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058,  
 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066,  
 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074,  
 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082,  
 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090,  
 1091, 1092, 1093, 1094, 1095  
 tanh, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
 1090, 1091, 1092, 1093, 1094, 1095  
 Template, 2438  
 Testing, 87  
 Testing:with the Debugger, 87  
 Text library, 2608  
     Changing text with VBA, 2608  
     Creating language with VBA, 2608



- Creating text with VBA, 2608
- Deleting text with VBA, 2608
- Read text with VBA, 2608
- Read TextID with VBA, 2608
- TextBibliIDs, 2439
- time, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- TimeAxis object, 230
- TimeColumn object, 231
- Timer, 64, 70
  - Configure a Trigger to an Action, 70
- TitleBackColorActiveEnd property, 2440
- TitleBackColorActiveStart property, 2440
- TitleBackColorInactiveEnd property, 2440
- TitleBackColorInactiveStart property ,
- TitleForeColorActive property, 2441
- TitleForeColorInactive property, 2441
- TlgGetColumnPosition, 998
- TlgGetNumberOfColumns, 992
- TlgGetNumberOfRows, 993
- TlgGetNumberOfTrends, 993
- TlgGetRowPosition, 994
- TlgGetRulerArchivNameTrend, 994
- TlgGetRulerTimeTrend, 995
- TlgGetRulerValueTrend, 996
- TlgGetRulerVariableNameTrend, 997
- TlgGetTextAtPos, 997
- TlgTableWindowPressEditRecordButton, 969
- TlgTableWindowPressFirstButton, 970
- TlgTableWindowPressInsertRecordButton, 971
- TlgTableWindowPressLastButton, 972
- TlgTableWindowPressNextButton, 972
- TlgTableWindowPressNextItemButton, 973
- TlgTableWindowPressOpenArchiveVariableSelectio  
nDlgButton, 974
- TlgTableWindowPressOpenDlgButton, 974
- TlgTableWindowPressOpenItemSelectDlgButton,  
975
- TlgTableWindowPressOpenTimeSelectDlgButton,  
976
- TlgTableWindowPressPrevButton, 976
- TlgTableWindowPressPrevItemButton, 977
- TlgTableWindowPressRemoveRecordButton, 978
- TlgTableWindowPressStartStopButton, 978
- TlgTrendWindowActivateCurve, 999
- TlgTrendWindowPressFirstButton, 979
- TlgTrendWindowPressHelpButton, 979
- TlgTrendWindowPressLastButton, 980
- TlgTrendWindowPressLinealButton, 981
- TlgTrendWindowPressNextButton, 981
- TlgTrendWindowPressNextItemButton, 982
- TlgTrendWindowPressOneToOneButton, 983
- TlgTrendWindowPressOpenArchiveVariableSelectio  
nDlgButton, 983
- TlgTrendWindowPressOpenDlgButton, 984
- TlgTrendWindowPressOpenItemSelectDlgButton,  
985
- TlgTrendWindowPressOpenTimeSelectDlgButton,  
985
- TlgTrendWindowPressPrevButton, 986
- TlgTrendWindowPressPrevItemButton, 987
- TlgTrendWindowPressPrintButton, 987
- TlgTrendWindowPressStartStopButton, 989
- TlgTrendWindowPressStatsResultButton, 989
- TlgTrendWindowPressStatsSelectRangeButton, 990
- TlgTrendWindowPressZoomInButton, 991
- TlgTrendWindowPressZoomOutButton, 991
- tmpfile, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095
- tmpnam, 1011, 1012, 1013, 1014, 1015, 1016, 1017,  
1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025,  
1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033,  
1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041,  
1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049,  
1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057,  
1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065,  
1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073,  
1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081,  
1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089,  
1090, 1091, 1092, 1093, 1094, 1095

tolower, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

Toolbar, 1627

- Add icon, 1637
- application-specific, 1627
- Assigning help text,
- Assigning status text,
- Assigning VBA macro,
- Configuring,
- Insert,
- picture-specific, 1627
- Placement, 1627
- Properties, 1627
- user-defined, 1627
- Working with toolbars, 882

Toolbar:GSC Diagnostics, 83

ToolbarButton object, 232

ToolbarItemType, 2444

toupper, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

TraceText, 1515

TraceTime, 1516

TransformDisplayCoordinate, 1892

TransformPixelCoordinate, 1892

trend, 2448

Trend object, 233

TrendWindow object, 234

Trigger, 64

- Changing, 920
- Deleting, 921
- Effect on actions, 914
- Picture cycle, 1708
- Standard cycle, 1708

Tag, 1708

- Window Cycle, 1708

Trigger type, 864, 914

Triggers, 70, 72, 1707

- Adding type "Timer", 70
- Adding type Tag, 72
- Changing, 74
- Configuring with VBA, 1707
- Deleting, 75

Tube objects:Double T-piece, 216

Tube objects:Polygon tube, 215

Tube objects:T-piece, 216

Tube objects:Tube Arc, 217

TubeArcObject object, 2088

TubeDoubleTeeObject object, 2090

TubePolyline object, 2092

TubeTeeObject object, 2094

## U

ungetc, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095

UnhideAlarm, 812

UnlockAlarm, 812

UsedLanguage, 2464

UseEventState, 2464

UseGlobalAlarmClasses, 2465

UseGlobalSettings, 2466

User interface language, 1624

- Access with VBA, 1624

UserArchiveControl, 280

User-defined menu, 1619, 1627

- Add menu entry, 1631
- Assigning help text, 1639
- Assigning status text, 1639
- Assigning VBA macro, 1642
- Configuring, 1626
- Creating, 1629
- creating multiple languages, 1633
- Placement, 1627
- Properties, 1627

User-defined toolbar, 1619, 1627

- Add icon, 1637

- Assigning help text, 1639
- Assigning status text, 1639
- Assigning VBA macro, 1642
- Configuring, 1626
- Creating, 1635
- Placement, 1627
- Properties, 1627
- UseValueText, 2469

## V

- Validity range, 874
- ValueAxis object, 235
- ValueColumn object, 236
- VB action, 1705
  - Configuring on an event with VBA, 1705
- VB Scripts, 1697
  - Dynamize property with VBA, 1697
- VBA, 1614
  - Access to a copy of the pictures, 1654
  - Access to external applications, 1713
  - Access to group objects, 1674
  - Access to layers, 1654
  - Access to objects in the Graphics Designer, 1660
  - Access to other programs, 1713
  - Access to the component library, 1646
  - Access to the symbol library, 1646
  - Accessing MS Excel with VBA, 1714
  - Action configuring, 1699
  - Add menu entry to user-defined menu, 1631
  - Adding a New Icon to the used-defined Toolbar, 1637
  - Alarm Logging, 2622
  - Assign help text to user-defined menu, 1639
  - Assign help text to user-defined toolbar, 1639
  - Assigning VBA macro to user-defined menu, 1642
  - Assigning VBA macro to user-defined toolbar, 1642
  - C Scripts (Delimitation), 1614
  - Configure user-defined menu, 1626
  - Configure user-defined toolbar, 1626
  - Configuring a Direct Connection, 1701
  - Configuring C Action on an Event, 1703
  - Configuring Dynamics in a Property with C Script, 1694
  - Configuring Dynamics in a Property with Dynamic Dialog, 1691
  - Configuring Dynamics in a Property with VB Script, 1697
  - Configuring event-controlled actions, 1699
  - Configuring for multiple languages, 1624
  - Configuring triggers, 1707
  - Configuring VB Action on an Event, 1705
  - Controlling the visibility of layers, 1657
  - Create an application-specific menu, 1629
  - Create application-specific toolbar, 1635
  - Create user-defined menu, 1629
  - Create user-defined menu in multiple languages, 1633
  - Create user-defined toolbar, 1635
  - Creating a group object, 1676
  - Customized Object, 1682
  - Deleting Group Objects, 1676
  - Dynamic Wizards (Delimitation), 1614
  - Dynamization, 1686
  - Edit component library, 1649
  - Edit layers, 1657
  - Edit Smart object, 1664
  - Edit standard object, 1664
  - Edit Windows object, 1664
  - Editing a copy of a picture, 1658
  - Editing a group object, 1676
  - Editing Customized Objects, 1683
  - Editing objects in a group object, 1679
  - Editing objects in Graphic Designer, 1660
  - Editing objects in Graphics Designer, 1660
  - Editing picture, 1654
  - Editing symbol library, 1649
  - Event Handling, 1709
  - Executing VBA macros, 1619
  - Export code, 1618
    - global VBA code, 1615
  - Group Objects, 1674
  - HMIGO class, 2560
  - Import code, 1618
    - in Graphics Designer, 1621
    - in other WinCC Editors, 2560
  - Inserting an ActiveX control into a picture, 1671
  - Language-dependent configuration, 1624
  - Making properties dynamic, 1687
  - ODK (Delimitation), 1614
  - OLE Element, 1669
  - Paste Object from component library into a Picture, 1652
  - Paste Object from symbol library into a Picture, 1652
  - Paste Object into Picture, 1662
  - picture-specific VBA code, 1615
  - Project language, 1624
    - project-specific VBA Code, 1615
  - Tag Logging, 2573
  - Tag Management, 2562
  - Text library, 2608

- Ungrouping Group Object, 1676
  - Usage, 1614
  - User interface language, 1624
  - User-defined menu, 1627
  - User-defined toolbar, 1627
  - VB Scripts (Delimitation), 1614
  - VBA Code, 1618
    - Execution sequence, 1615
    - Exporting, 1618
    - global, 1615
    - Importing, 1618
    - Organization within the WinCC Project, 1615
    - Password protection, 1615
    - picture-specific, 1615
    - project-specific, 1615
    - protecting, 1615
    - References, 1615
  - VBA editor, 1615
    - Start, 1615
  - VBA events
    - see VBA Events:VBA Event Handling ,
  - VBA in the Graphics Designer, 1621
  - VBA Macros, 1619
    - Specifics during the execution, 1615
    - Version, 1619
  - VBA Object Model, 1745
  - VBA Reference, 1745
    - Event Handling, 1745
    - Events, 1745
    - Methods, 1745
    - Object model, 1745
    - Properties, 1745
    - VBA Object Model, 1745
  - VBS, 24, 823
    - Application Scenarios, 12
    - Basics, 861
    - Examples, 855
    - Examples in WinCC, 823
    - Methods, 710
    - Object model, 105
    - Objects, 107
    - Reference, 105
    - Target Group of the Documentation, 12
  - VBS:Action, 18
  - VBS:CrossReference, 22
  - VBS:Editors, 26
  - VBS:Module, 15
  - VBS:Object Types, 143
  - VBS:Procedure, 15
  - VBS:Properties, 301
  - VBS:Standard Functions, 41
  - VBS:Using Global Tags, 24
  - VBScript
    - Activating in Runtime, 78
  - VBScript Files, 92
  - VBScript Files:Structure, 92
  - VBScript:debugging, 87
  - VBScript:open in Debugger, 96
  - VBScript:print, 104
  - vfprintf, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
  - View, 885
    - Setting different views, 885
  - Visual Basic Script in WinCC, 12
  - Visual Basic Scripts, 12
  - vsprintf, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095
- ## W
- WinCC, 12, 143
    - Script Languages, 12
    - Visual Basic Scripts, 12
    - WinCC Alarm Control, 286
    - WinCC AlarmControl, 241
    - WinCC MediaControl, 256
  - WinCC AlarmControl
    - HitlistColumn object, 222
    - MessageBlock object, 223
    - MessageColumn object, 223
    - OperatorMessage object, 224
    - StatusbarElement object, 229
    - ToolbarButton object, 232
    - VBS example, 853
  - WinCC coding rules, 908

- WinCC FunctionTrendControl
  - StatusbarElement object, 229
  - ToolBarButton object, 232
  - Trend object, 233
  - TrendWindow object, 234
  - XAxis object, 237
  - YAxis object, 238
- WinCC OnlineTableControl
  - Example of C script, 1579
  - StatusbarElement object, 229
  - TimeColumn object, 231
  - ToolBarButton object, 232
  - ValueColumn object, 236
  - VBS example, 851
- WinCC OnlineTrendControl
  - Example of C script, 1581
  - StatusbarElement object, 229
  - ToolBarButton object, 232
  - Trend object, 233
  - TrendWindow object, 234
  - VBS example, 846
  - VBS example to setpoint trend, 849
- WinCC RulerControl
  - RulerBlock object, 226
  - RulerColumn object, 227
  - StatisticAreaColumn object, 228
  - StatisticResultColumn object, 229
  - StatusbarElement object, 229
  - ToolBarButton object, 232
- WinCC UserArchiveControl
  - Column object, 221
  - StatusbarElement object, 229
  - ToolBarButton object, 232
- WinCC:Graphic object types, 143
- WinCC:WinCC Digital Analog Clock, 246
- WinCC:WinCC Function Trend Control, 288
- WinCC:WinCC FunctionTrendControl, 248
- WinCC:WinCC Gauge Control, 254
- WinCC:WinCC Online Table Control Online, 292
- WinCC:WinCC Online Trend Control, 295
- WinCC:WinCC OnlineTableControl, 257
- WinCC:WinCC OnlineTrendControl, 262
- WinCC:WinCC Push Button Control Controls:WinCC Push Button Control, 269
- WinCC:WinCC RulerControl, 272
- WinCC:WinCC UserArchiveControl, 280
- Window, 81, 84
- Windows object, 1662
  - Editing with VBA, 1664
- Windows Objects:Button, 201
- Windows Objects:Check Box, 204
- Windows Objects:Radio Box, 207
- Windows Objects:Roundbutton, 209
- Windows Objects:Slider, 212
- WPFControl, 2104
- WriteTag, 817
- Writing tag values, 828

**X**

- XAxis object, 237

**Y**

- YAxis object, 238

**Z**

- ZoomArea, 818
- ZoomInOut, 818
- ZoomInOutTime, 818
- ZoomInOutValues, 819
- ZoomInOutX, 819
- ZoomInOutY, 820
- ZoomMove, 820

