



Reyrolle  
Protection  
Devices

# 7SR10 Argus User Manual

Overcurrent and Earth Fault Relay

**SIEMENS**



# Contents

## Technical Manual Chapters

1. Description of Operation
2. Settings, Configuration & Instruments
3. Performance Specification
4. Data Communications
5. Installation
6. Commissioning and Maintenance
7. Applications Guide

The copyright and other intellectual property rights in this document, and in any model or article produced from it (and including any registered or unregistered design rights) are the property of Siemens Protection Devices Limited. No part of this document shall be reproduced or modified or stored in another form, in any data retrieval system, without the permission of Siemens Protection Devices Limited, nor shall any model or article be reproduced from this document unless Siemens Protection Devices Limited consent.

While the information and guidance given in this document is believed to be correct, no liability shall be accepted for any loss or damage caused by any error or omission, whether such error or omission is the result of negligence or any other cause. Any and all such liability is disclaimed.

# 7SR10

Description of Operation

## Document Release History

This document is issue 2017/07. The list of revisions up to and including this issue is:

2013/11	First Issue
2015/02	Second Issue
2015/03	Third Issue
2015/06	Fourth Issue
2015/09	Fifth Issue
2016/11	Sixth Issue
2017/03	Seventh Issue
2017/04	Eighth Issue
2017/07	Nineth Issue

## Software Revision History

2013/11	2436H80015 R2d-1a	First Release
2015/02	2437H80001 R4b-1d	Second Release
2015/03	2437H80001 R4b-1e	Third Release
2015/06	2437H80001 R4b-1f	Fourth Release
2015/09	2437H80001 R4b-2a	Fifth Release
2016/11	2437H80001 R4b-2b	Sixth Release
2017/04	2437H80001 R4c-2b	Seventh Release

The copyright and other intellectual property rights in this document, and in any model or article produced from it (and including any registered or unregistered design rights) are the property of Siemens Protection Devices Limited. No part of this document shall be reproduced or modified or stored in another form, in any data retrieval system, without the permission of Siemens Protection Devices Limited, nor shall any model or article be reproduced from this document unless Siemens Protection Devices Limited consent.

While the information and guidance given in this document is believed to be correct, no liability shall be accepted for any loss or damage caused by any error or omission, whether such error or omission is the result of negligence or any other cause. Any and all such liability is disclaimed.

# Contents

Section 1: Introduction .....	6
1.1 Current Transformer Circuits .....	6
1.2 External Resistors.....	6
1.3 Description .....	6
1.4 Ordering Options .....	7
1.5 Functional Diagram.....	8
1.6 Terminal Diagram .....	9
1.6.1 Terminal Diagram with Control Push Buttons .....	9
Section 2: Hardware Description .....	10
2.1 General .....	10
2.2 Front Fascia .....	11
2.2.1 Front Fascia with Control Push Buttons.....	11
2.3 CB Open/Close .....	11
2.4 Power Supply Unit (PSU).....	12
2.5 Connectors.....	13
2.5.1 Connectors with Control Push Buttons .....	13
2.6 Relay Information .....	13
2.7 Operator Interface.....	14
2.7.1 Liquid Crystal Display (LCD).....	14
2.7.2 LCD Indication .....	15
2.7.3 Standard Keys .....	15
2.7.4 Protection Healthy LED .....	15
2.7.5 Indication LEDs.....	15
2.8 Current Inputs.....	16
2.9 Binary Inputs .....	16
2.10 Binary Outputs (Output Relays).....	17
2.11 Virtual Input/Outputs .....	18
2.12 Self Monitoring .....	18
2.12.1 Protection Healthy/Defective.....	19
Section 3: Protection Functions .....	21
3.1 Current Protection: Phase Overcurrent (50, 51) .....	21
3.1.1 Instantaneous Overcurrent Protection (50) .....	21
3.1.2 Time Delayed Overcurrent Protection (51) .....	21
3.2 Current Protection: Derived Earth Fault (50N, 51N).....	22
3.2.1 Instantaneous Derived Earth Fault Protection (50N) .....	22
3.2.2 Time Delayed Derived Earth Fault Protection (51N).....	23
3.3 Current Protection: Measured Earth Fault (50G, 51G).....	24
3.3.1 Instantaneous Measured Earth Fault Protection (50G).....	24
3.3.2 Time Delayed Measured Earth Fault Protection (51G).....	24
3.4 Current Protection: Cold Load (51C).....	25
3.5 Instantaneous Sensitive Earth Protection (50SEF).....	26
3.6 Time Delayed Sensitive Earth Fault Protection (51SEF).....	27
3.7 Broken Conductor (46BC).....	28
3.8 Negative Phase Sequence Overcurrent (46NPS).....	28
3.9 Thermal Overload (49).....	29
Section 4: Control and Logic Functions.....	31
4.1 Auto-Reclose (79) Optional Function .....	31
4.1.1 Overview.....	31
4.1.2 Auto Reclose sequences .....	32
4.1.3 Autoreclose Prot'n Menu .....	33
4.1.4 Autoreclose Config Menu .....	33
4.1.5 P/F Shots sub-menu.....	35
4.1.6 E/F Shots sub-menu.....	35
4.1.7 SEF Shots sub-menu .....	35
4.1.8 Extern Shots sub-menu .....	36

---

4.2	Quick Logic .....	38
4.3	Manual CB Control .....	39
4.4	Circuit Breaker (CB).....	40
Section 5: Supervision Functions.....		42
5.1	Circuit Breaker Failure (50BF).....	42
5.2	2nd Harmonic Block/Inrush Restraint (81HBL2) Phase Elements Only .....	43
5.3	Total Harmonic Distortion Supervision (81THD).....	43
Section 6: Other Features .....		45
6.1	Data Communications.....	45
6.1.1	Communication Ports .....	45
6.2	CB Maintenance.....	48
6.2.1	Output Matrix Test.....	48
6.2.2	CB Counters .....	48
6.2.3	I <sup>2</sup> t CB Wear.....	49
6.3	Data Storage .....	49
6.3.1	General.....	49
6.3.2	Demand.....	49
6.3.3	Event Records .....	49
6.3.4	Waveform Records.....	50
6.3.5	Fault Records.....	50
6.3.6	Disk Activity Warning.....	50
6.4	Metering.....	51
6.5	Operating Mode.....	52
6.6	Control Mode.....	52
6.7	Real Time Clock .....	53
6.7.1	Time Synchronisation – Data Communication Interface .....	53
6.7.2	Time Synchronisation – Binary Input .....	53
6.8	Settings Groups.....	53
6.9	Password Feature.....	53

## List of Figures

Figure 1-1	Functional Diagram of 7SR10 Overcurrent and Earth Fault Relay .....	8
Figure 1-2	Terminal Diagram of 7SR10 Overcurrent and Earth Fault Relay (Extended/Basic Version) .....	9
Figure 2-1	7SR10 Overcurrent and Earth Fault Relay with control push buttons.....	11
Figure 2-2	7SR10 Overcurrent and Earth Fault Relay with Connectors .....	13
Figure 2-3	Relay Rating Label .....	13
Figure 2-4	Fascia Relay Rating Label .....	14
Figure 2-5	Safety Symbols .....	14
Figure 2-6	Close up of Relay Identifier .....	14
Figure 2-8	Binary Input Logic.....	17
Figure 2-9	Binary Output Logic.....	18
Figure 2-10	Start-up Counter Meter .....	18
Figure 2-11	Unexpected Restarts Lockout Text.....	19
Figure 2-12	Start-up Events .....	20
Figure 3-1	Logic Diagram: Instantaneous Overcurrent Element .....	21
Figure 3-2	Logic Diagram: Time Delayed Overcurrent Element.....	22
Figure 3-3	Logic Diagram: Derived Instantaneous Earth Fault Element.....	23
Figure 3-4	Logic Diagram: Derived Time Delayed Earth Fault Protection .....	23
Figure 3-5	Logic Diagram: Measured Instantaneous Earth-fault Element .....	24
Figure 3-6	Logic Diagram: Measured Time Delayed Earth Fault Element (51G) .....	25
Figure 3-7	Logic Diagram: Cold Load Settings (51C).....	26
Figure 3-8	Logic Diagram: 7SR10 SEF Instantaneous Element .....	26
Figure 3-9	Logic Diagram: 7SR10 SEF Time Delayed Element (51SEF) .....	27
Figure 3-10	Logic Diagram: Broken Conductor Function (46BC).....	28
Figure 3-11	Logic Diagram: Negative Phase Sequence Overcurrent (46NPS).....	29
Figure 3-12	Logic Diagram: Thermal Overload Protection (49) .....	30
Figure 4-1	Typical AR Sequence with 3 Inst and 1 Delayed trip .....	33
Figure 4-2	Basic Auto-Reclose Sequence Diagram .....	37
Figure 4-4	Logic Diagram: Circuit Breaker Status.....	41
Figure 5-1	Logic Diagram: Circuit Breaker Fail Protection (50BF) .....	42
Figure 5-3	Logic Diagram: Total Harmonic Distortion Supervision Element (81THD) .....	44
Figure 6-1	Communication to Front USB Port.....	45
Figure 6-2	Connect Icon.....	45
Figure 6-3	Port Selection in Connection Manager.....	46
Figure 6-4	System Information Icon .....	46
Figure 6-5	System Information Icon .....	47
Figure 6-6	Communication to Multiple Devices from Control System using RS485 .....	48


## List of Tables

Table 2-1	Summary of 7SR10 Overcurrent and Earth Fault Relay Configurations .....	10
Table 6-1	Operation Mode .....	52

### Symbols and Nomenclature

The following notational and formatting conventions are used within the remainder of this document:

- **Setting Menu Location**                      **MAIN MENU>SUB-MENU**
- **Setting:**                                      ***Elem name -Setting***
- **Setting value:**                              **value**
- **Alternatives:**                              **[1st] [2nd] [3rd]**

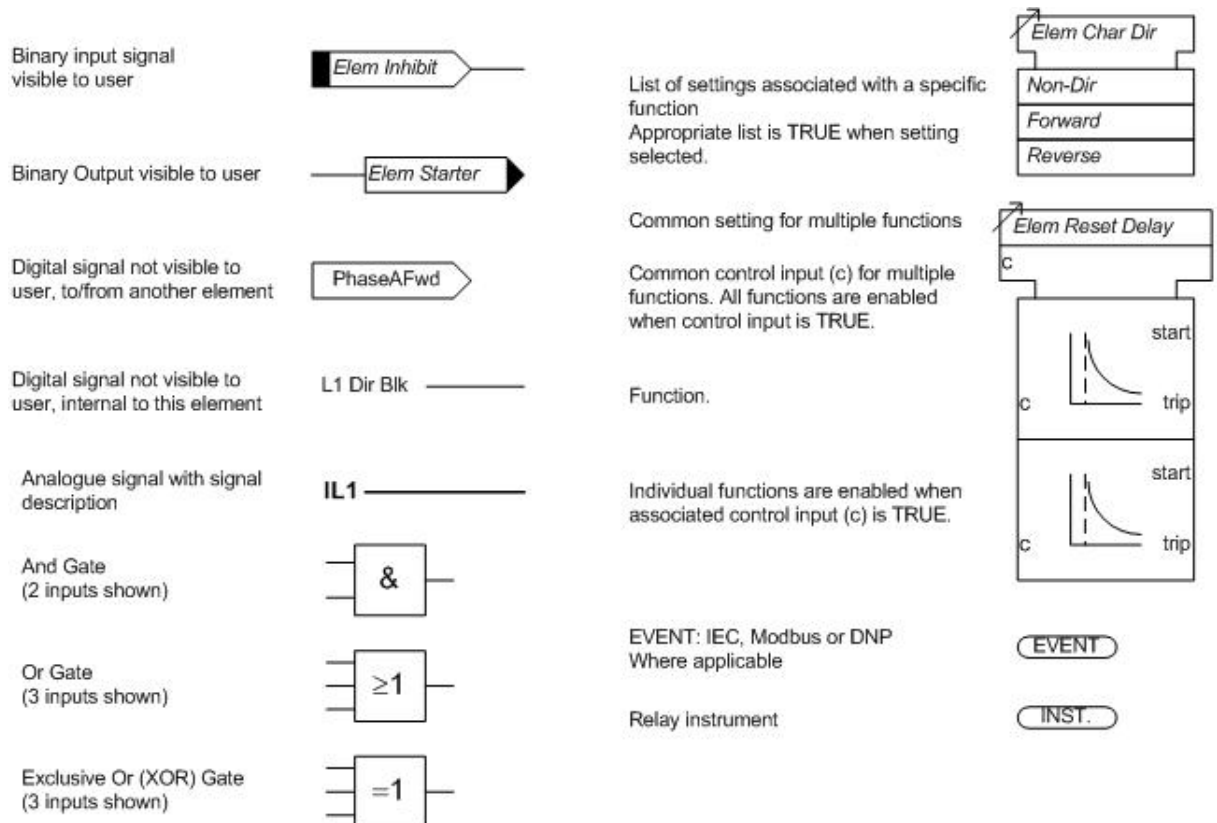



## Section 1: Introduction

This manual is applicable to the following relay:

- 7SR10 Overcurrent and Earth Fault relay

### General Safety Precautions

#### 1.1 Current Transformer Circuits



The secondary circuit of a live CT must not be open circuited. Non-observance of this precaution can result in injury to personnel or damage to equipment.

#### 1.2 External Resistors



Where external resistors are connected to the relay circuitry, these may present a danger of electric shock or burns, if touched.

#### 1.3 Description

The 7SR10 Overcurrent and Earth Fault relay is developed by using the latest generation of hardware technology and is available in multiple variants depending on power supply, binary input/output configuration and data communication facility. 7SR10 is a member of Siemens Reyrolle<sup>®</sup> protection devices Argus product family.

The 7SR10 Overcurrent and Earth Fault relay is housed in a 4U high, size 4 non draw-out case and these relays provide protection, monitoring, instrumentation, and metering with integrated input and output logic, data logging and fault reports.

Communication access to the relay functionality is via a front USB port for local PC connection or rear electrical RS485 (optional) port for remote connection.

## 1.4 Ordering Options

Product Description	Variants	Order No.																				
		1	2	3	4	5	6	7	-	8	9	10	11	12	-	13	14	15	16			
<b>7SR10 Argus</b>		7	S	R	1	0	0	<input type="checkbox"/>	-	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	0	-	<input type="checkbox"/>	A	0	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>Nondirectional O/C Relay (Argus)</b>								↑		↑	↑	↑	↑		↑	↑	↑		↑	↑	↑	↑
<u>Case, I/O and Fascia</u>																						
Size 4 Moulded case, 4 CT, 3 Binary Inputs/3 Binary Outputs, 10 LEDs						2				1			1									
Size 4 Moulded case, 4CT, 6 Binary Inputs/6 Binary Outputs, 10 LEDs						3																
<u>Measuring input</u>																						
1/5 A, 50/60Hz <sup>1)</sup>						2/3				1												
1/5 A, 50/60Hz with SEF input <sup>2)</sup>						3				2												
<u>Auxiliary voltage</u>																						
AC/DC 60-240V, Binary input threshold 44 V AC/VDC												L										
AC/DC 60-240V, Binary input threshold 88 V AC/VDC												K										
DC 24-60 V, Binary input threshold 19 VDC												J										
<u>Protective Cover</u>																						
Standard version – No Cover																						
Plastic Cover with 1 Push Button for Test/Reset												A										
												B										
<u>Communication</u>																						
Front Port : USB						2							1									
Front Port : USB and Rear Port : RS-485 supporting IEC 60870-5-103 or Modbus RTU or DNP 3.0						3							2									
<u>Front Fascia</u>																						
Standard Version – with Breaker Control Push Buttons																					2	
<u>Protection Function Packages</u>																						
Standard version - included in all models																						
46BC Broken Conductor/Load Unbalance																						
46NPS Negative Phase Sequence Overcurrent																						
49 Thermal overload																						
50 Instantaneous Phase Fault Overcurrent																						
50BF Circuit Breaker fail																						
50G/N Instantaneous Earth Fault																						
50SEF <sup>2)4)</sup> Instantaneous Sensitive Earth Fault Overcurrent																						
51 Timed Delayed Phase Fault Overcurrent																						
51 G/N Timed Delayed Earth Fault																						
51SEF <sup>2)4)</sup> Time Delayed Sensitive Earth Fault																						
74T/CCS Trip/Close Circuit Supervision																						
81HBL2 <sup>3)</sup> 2 <sup>nd</sup> Harmonic block/Inrush restraint																						
86 Hand Reset Contacts																						
51C Cold Load Pickup																						
Programmable Logic																						
81THD Total Harmonic Distortion Supervision																						
<u>Standard version – plus</u>																						
79 Autoreclose																					D	
<u>Additional Functionality</u>																						
No Additional Functionality																					A	
<u>Special version <sup>5)</sup></u>																						
																						Z Y 2 0

1) 4CT is configured as 3PF + EF  
 2) 4CT is configured as 3PF + SEF  
 3) Not available on SEF input  
 4) Only with position 7 = 3  
 5) Special version for Turkey market with thermal withstand capability of 500 A (5A CT), 1 sec and supporting Turkish scripts. Available only with position 8 = 1

## 1.5 Functional Diagram

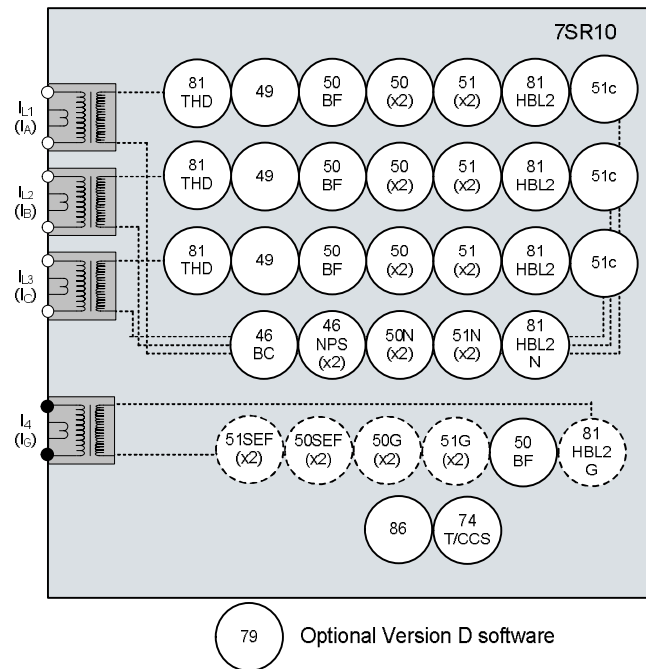


Figure 1-1 Functional Diagram of 7SR10 Overcurrent and Earth Fault Relay

## 1.6 Terminal Diagram

The relay is housed in a non draw-out case 4U high Size 4 case. The rear connection comprises of user-friendly pluggable type terminals for BI, BO, communication, and power supply wire connections.

The CT terminals are suitable for ring type lug connection and to provide a secure and reliable termination.

### 1.6.1 Terminal Diagram with Control Push Buttons

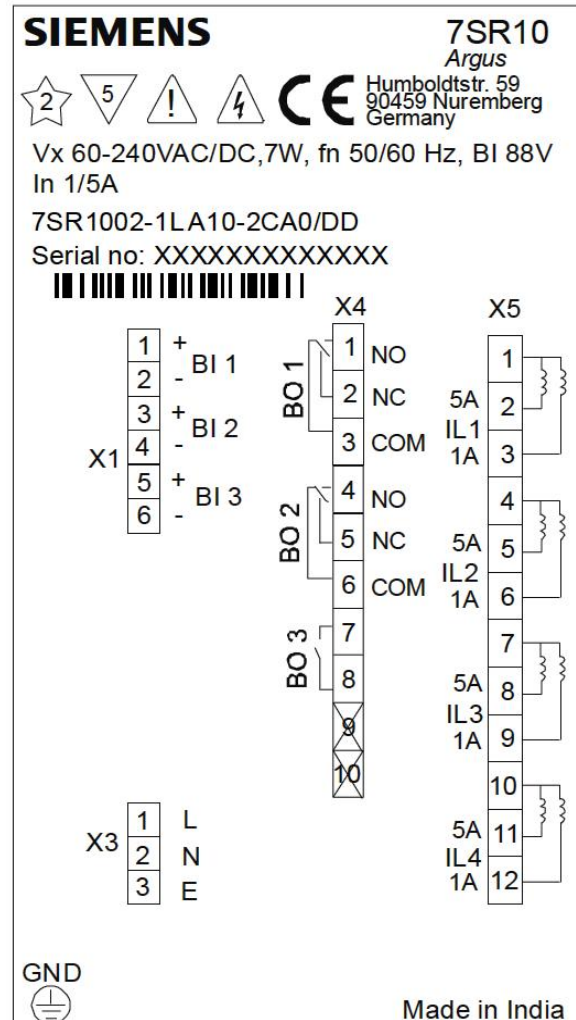
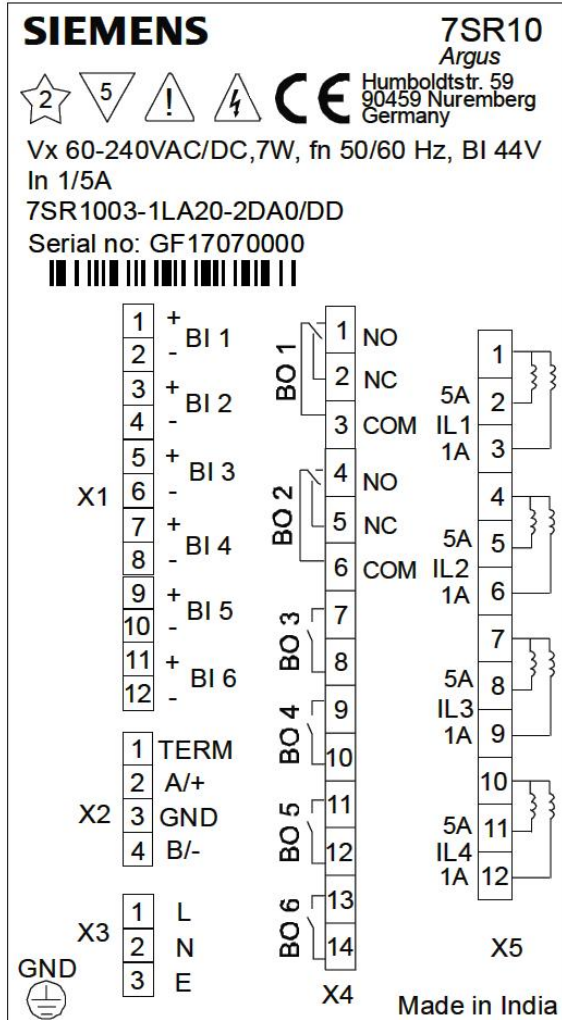


Figure 1-2 Terminal Diagram of 7SR10 Overcurrent and Earth Fault Relay (Extended/Basic Version)

## Section 2: Hardware Description

### 2.1 General

The structure of the relay is based upon the compact hardware platform. The relays are supplied in a Size 4 case. The hardware design provides a commonality between the products and components across the range of relays.

Table 2-1 Summary of 7SR10 Overcurrent and Earth Fault Relay Configurations

Relay	Current Inputs	Voltage Inputs	Binary Inputs	Binary Outputs	LEDs
7SR1002	4	0	3	3	10
7SR1003	4	0	6	6	10

The 7SR10 Overcurrent and Earth Fault relay are assembled from the following modules:

1. Front Fascia with 9 configurable LEDs and 1 Relay Healthy LED
2. Processor module
3. Current Analogue, Input module and Output module

<b>With control push buttons</b>
4 x Current (Terminal X5)
6 x Binary Input (Terminal X1)
6 x Binary Outputs (Terminal X4)

4. Communication and Power Supply module

<b>With control push buttons</b>
RS485 (Terminal X2)
Power supply (Terminal X3)

## 2.2 Front Fascia

The front fascia is an integral part of the relay and allows the user to access all the push buttons and performs the setting changes and control actions. The fascia provides an option to reset the fault data display, latched binary outputs, and LEDs by using the TEST/RESET button. The front fascia contains the label strip which provides the information about LED indicators.

Front Fascia consists of CB control push buttons to open and close.



### 2.2.1 Front Fascia with Control Push Buttons



Figure 2-1 7SR10 Overcurrent and Earth Fault Relay with control push buttons

## 2.3 CB Open/Close


The circuit breaker (CB) control function is used to manually open and close the CB when it is connected to the network. Two dedicated push buttons are provided on the HMI to execute the CB manual close and open operations.

Button	Function	Description
	<b>Close</b>	Press <b>Close</b> button and confirm ENTER to execute the close operation of circuit breaker.
	<b>Open</b>	Press <b>Open</b> button and confirm ENTER to execute the open operation of circuit breaker.


The user can configure the binary input, binary output, and LED configuration for the CB open and close control functions.

To perform the CB open and close control operations, follow the procedure given below:

1. Apply **CB Close** Binary Input (BI) to get the breaker status.
2. Press **CB OPEN** control key. The confirmation pop-up appears.

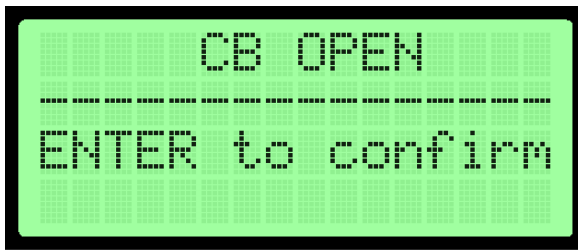

3. Press **ENTER** key to confirm.
4. The **CB Open** delay count-down starts and reaches to zero.

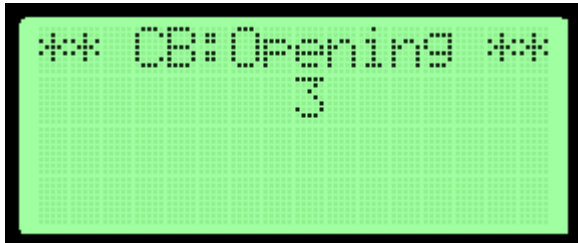

5. The configured BO and LED's for the **CB OPEN** control functions will operate.
6. Press **RESET** button to reset LED and BO states.

Repeat the same procedure for CB CLOSE control logic operation.

**NOTE:**

If the "Control Password" is already configured in the settings, use the control password to execute the CB open/close via control keys. For more information about the Control Password function, see [Section 6.9](#)

**NOTE:**

If the operating mode of 7SR10 Relay is remote, the user can perform the CB open and close operations when the "FUNCTION KEY CONFIG" setting is enabled.

## 2.4 Power Supply Unit (PSU)

The relay is supplied with the following nominal power supply ranges:

- 88 V AC/DC or 44 V AC/DC BI threshold available with 60 V - 240 V AC/DC power supply version
- 19 V DC BI threshold with 24 V - 60 V DC power supply version

The power supply module is equipped with 6 Binary Inputs. It also consists of one RS485 communication interface (half duplex) for communicating with RTUs and parameterization of relays via remote locations.

For AC connections, the auxiliary supply is made with the live connection to positive terminal and neutral connection to negative for consistency and safety.

In the event of the supply voltage levels are falling below the relay minimum operate level, the PSU will automatically switch off itself and latch out and this prevents any PSU overload conditions occurring. The PSU is reset by switching the auxiliary supply off and on.

## 2.5 Connectors

In 7SR10 Overcurrent and Earth Fault relay, all the connectors are pluggable type except the CT connectors and it consists of Binary Inputs and Binary Outputs connectors. The connector terminals are designated suitably.

### 2.5.1 Connectors with Control Push Buttons

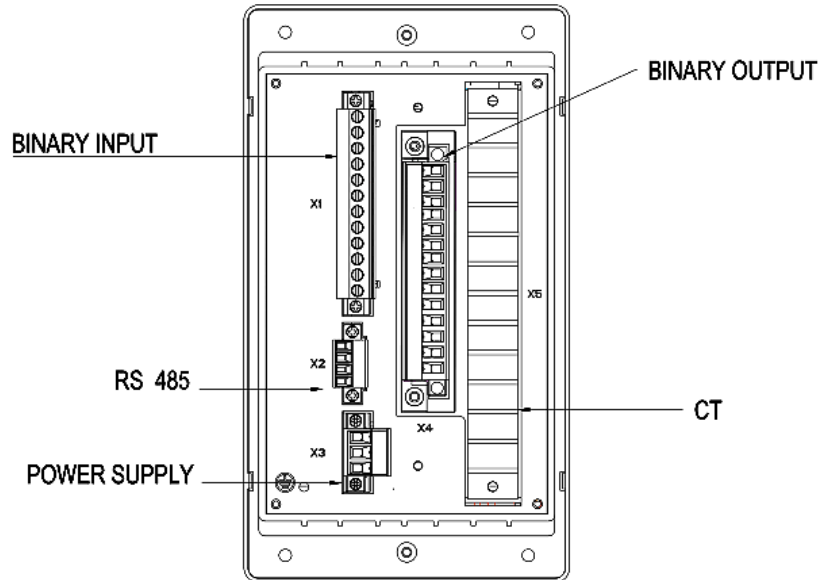


Figure 2-2 7SR10 Overcurrent and Earth Fault Relay with Connectors

## 2.6 Relay Information

The rating label is located on the housing and provides more technical information about the 7SR10 Overcurrent and Earth Fault relay.

### Relay Information

The rating label contains the following product information:

- Product name
- MLFB ordering code, with hardware version suffix
- Nominal current rating
- Rated frequency
- Auxiliary supply rating
- Binary input supply rating
- Serial number

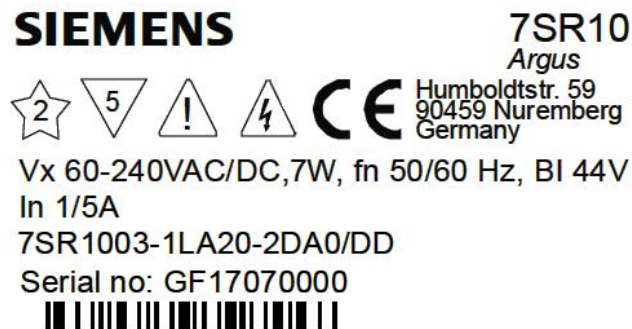


Figure 2-3 Relay Rating Label



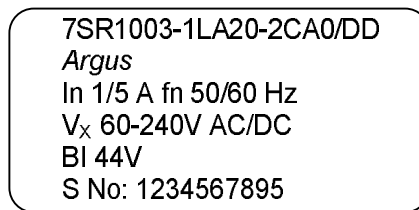


Figure 2-4 Fascia Relay Rating Label

For safety reasons, the following symbols are displayed on the label.

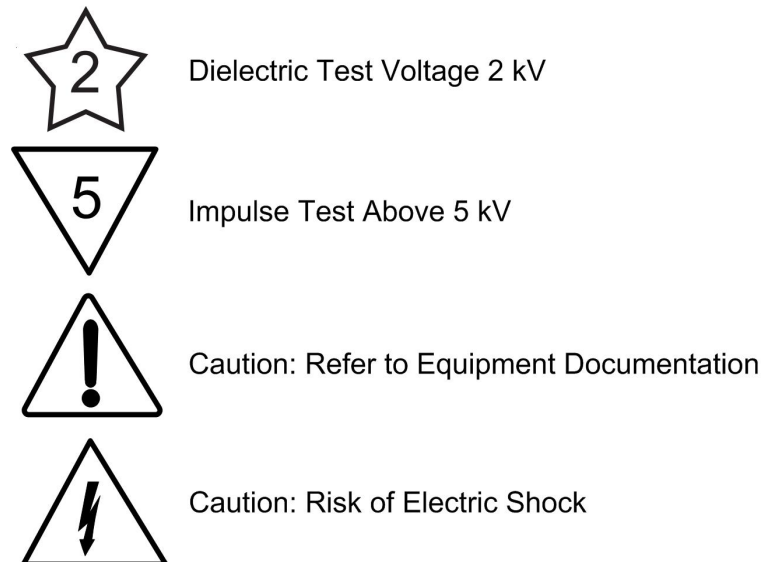


Figure 2-5 Safety Symbols

## 2.7 Operator Interface

### 2.7.1 Liquid Crystal Display (LCD)

A 4 line by 20-character alpha-numeric liquid crystal display indicates settings, instrumentation, fault data, and control commands.

To conserve power, the display backlighting is extinguished when no buttons are pressed for a user-defined period. The 'backlight timer' setting within the "SYSTEM CONFIG" menu allows the timeout to be adjusted from 1 to 60 minutes and "Off" (backlight permanently on). Pressing any key will reactivate the display.

User-defined identifying text can be programmed into the relay by using the **System config/Relay Identifier** and **System config/Circuit Identifier** setting. The 'Identifier' texts are displayed on the LCD display in two lines at the top level of the menu structure. The 'Relay Identifier' is used in communication with Reydisp to identify the relay. By pressing the Cancel button several times will return the user to this screen.



Figure 2-6 Close up of Relay Identifier

## 2.7.2 LCD Indication

**General Alarms** are user defined text messages displayed on the LCD when mapped to binary inputs or virtual inputs. Up to six general alarms of 16 characters can be programmed, each triggered from one or more input. Each general alarm will also generate an event.

If multiple alarms are activated simultaneously, the messages are displayed on a separate page in a rolling display on the LCD. The *System Config* > **General Alarm Alert** setting **Enabled/Disabled** allows the user to select if the alarms are to be displayed on the LCD when active.

All general alarms are raised when a fault trigger is generated and will be logged into the Fault Data record.

## 2.7.3 Standard Keys

The relay is supplied as standard with five push buttons. The buttons are used to navigate the menu structure and control the relay functions. They are labelled:

▲	Increases a setting or moves up menu.
▼	Decreases a setting or moves down menu.
TEST/RESET▶	Moves right, can be used to reset selected functionality and for LED test (at relay identifier screen).
ENTER	Used to initiate and accept settings changes.
CANCEL	Used to cancel settings changes and/or move up the menu structure by one level per press.
OPEN	Used to execute the open of circuit breaker (optional)
CLOSE	Used to execute the close of circuit breaker (optional)

### NOTE:

All settings and configuration of LEDs, BI and BO can be accessed and set by the user using these keys. Alternatively, the configuration/settings files can be loaded into the relay using 'Reydisp' software. When the System Config > **Setting Dependencies** is ENABLED, only the functions that are enabled will appear in the menu structure.

## 2.7.4 Protection Healthy LED

This green LED is steadily illuminated to indicate that auxiliary voltage has been applied to the relay power supply and that the relay is operating correctly. If the internal relay watchdog detects an internal fault then the LED will continuously flash.

## 2.7.5 Indication LEDs

Relays have 9 user programmable LED indicators. Each LED can be programmed to be illuminated as either green, orange, or red. Where an LED is programmed to be lit both red and green, it will illuminate yellow. The same LED can be assigned two different colours dependent upon whether a Start/Pickup or Operate condition exists. LED's can be assigned to the pickup condition and colour selected in the OUTPUT CONFIG > LED CONFIG menu.

Functions are assigned to the LEDs in the OUTPUT CONFIG > OUTPUT MATRIX menu.

Each LED can be labelled by inserting a label strip into the pocket behind the front fascia. A 'template' is available in the Reydisp software tool to allow users to create and print customised legends.

Each LED can be programmed as hand reset or self reset. Hand reset LEDs can be reset either by pressing the TEST/RESET ▶ button, energising a suitably programmed binary input or by sending an appropriate command over the data communications channel(s).

The status of hand reset LEDs is maintained by a back up storage capacitor in the event of an interruption to the supply voltage.

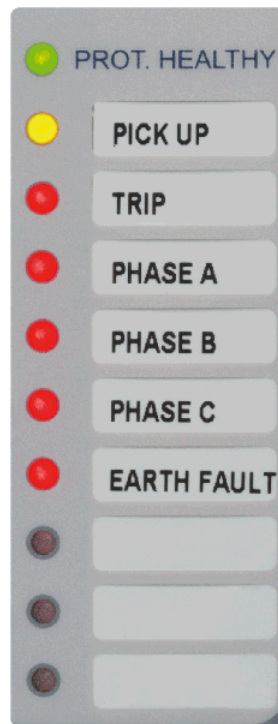


Figure 2-7 LED Indication Label

## 2.8 Current Inputs

Four current inputs are provided on the Analogue Input module. Terminals are available for both 1 A and 5 A inputs.

The current input is incorporated within the relay and is used for phase fault and earth fault protection.

Current is sampled at 1600 Hz for both 50 Hz and 60 Hz system frequencies. Protection and monitoring functions of the relay use either the Fundamental Frequency RMS or the True RMS value of current appropriate to the individual function.

The waveform recorder samples and displays current input waveforms at 1600 Hz.

The primary CT ratio used for the relay instruments can be set in the CT/VT configuration menu.

## 2.9 Binary Inputs

The binary inputs are opto-couplers operated from a suitably rated power supply.

Relays are fitted with 3 or 6 binary inputs (BI) depending on the variant. The user can assign any binary input to any of the available functions (INPUT CONFIG > INPUT MATRIX).

Pick-up (PU) and Drop-off (DO) time delays are associated with each binary input. Where no pick-up time delay has been applied the input may pick up due to induced AC voltage on the wiring connections (e.g. cross site wiring). The default pick-up time of 20 ms provides AC immunity. Each input can be programmed independently.

Each input may be logically inverted to facilitate integration of the relay within the user scheme. When inverted the relay indicates that the BI is energised when no voltage is applied. Inversion occurs before the PU and DO time delay.

Each input may be mapped to any front Fascia indication LED and/or to any Binary output contact and can also be used with the internal user programmable logic. This allows the relay to provide panel indications and alarms.

Each binary input is set by default to be read when the relay is in both the local or remote condition. A setting is provided to allow the user to select if each individual input shall be read when the relay is in the local or remote condition in the INPUT CONFIG > BINARY INPUT CONFIG menu.

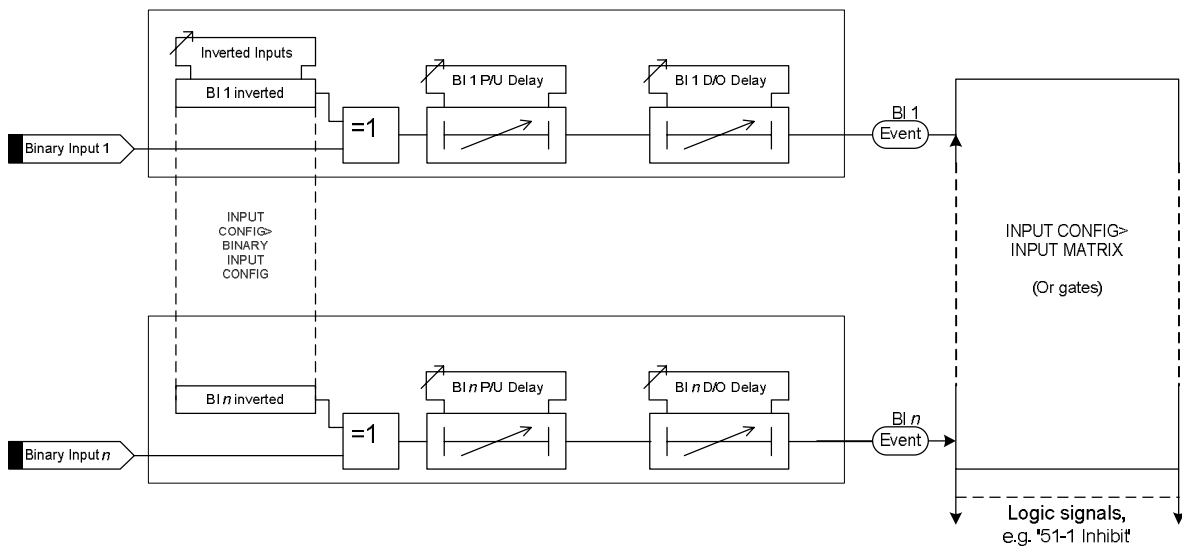


Figure 2-8 Binary Input Logic

## 2.10 Binary Outputs (Output Relays)

Relays are fitted with 3 or 6 binary outputs (BO). All outputs are fully user configurable and can be programmed to operate from any or all of the available functions.

In the default mode of operation, binary outputs are self reset and remain energised for a user configurable minimum time of up to 60 s. If required, the outputs can be programmed to operate as 'hand reset' or 'pulsed'. If the output is programmed to be 'hand reset' and 'pulsed' then the output will be 'hand reset' only.

The binary outputs can be used to operate the trip coils of the circuit breaker directly where the trip coil current does not exceed the 'make and carry' contact rating. The circuit breaker auxiliary contacts or other in-series auxiliary device must be used to break the trip coil current.

Any BO can be assigned as a 'Trip Contact' in the OUTPUT CONFIG > TRIP CONFIG menu. Operation of a 'Trip Contact' will operate any LED or virtual assigned from the 'Trip Triggered' feature in the same menu and will initiate the fault record storage, actuate the 'Trip Alert' screen where enabled and CB Fail protection when enabled.

Where a protection function is mapped to an output contact, the output contact can be configured to trigger when the protection function picks-up rather than when it operates. Such output contacts are configured via the OUTPUT CONFIG > BINARY OUTPUT CONFIG > Pickup Outputs setting.

### Notes on Pulsed Outputs

When operated, the output will reset after a user configurable time of up to 60 s regardless of the initiating condition.

### Notes on Self Reset Outputs

Self reset operation has a minimum reset time of 100 ms.

With a failed breaker condition, the relay may remain operated until current flow is interrupted by an upstream device. When the current is removed, the relay will then reset and attempt to interrupt trip coil current flowing via its output contact. When this current level is above the break rating of the output contact, an auxiliary relay with heavy-duty contacts should be utilised in the primary system to avoid damage to the relay.

### Notes on Hand Reset Outputs – 86 Lockout

Any binary output can be programmed to provide an 86 lockout function by selecting it to be hand reset. Hand reset outputs can be reset by either pressing the **TEST/RESET** button, by energising a suitably programmed binary input, or, by sending an appropriate command over the data communications channel(s).

On loss of the auxiliary supply hand-reset outputs will reset. When the auxiliary supply is re-established the binary output will remain in the reset state unless the initiating condition is still present.

### Notes on General Pickup

An output, General Pickup, is available to indicate that the pickup level has been exceeded for one or more protection functions. Any protection function can be mapped to trigger this output in the OUTPUT CONFIG > PICKUP CONFIG menu.

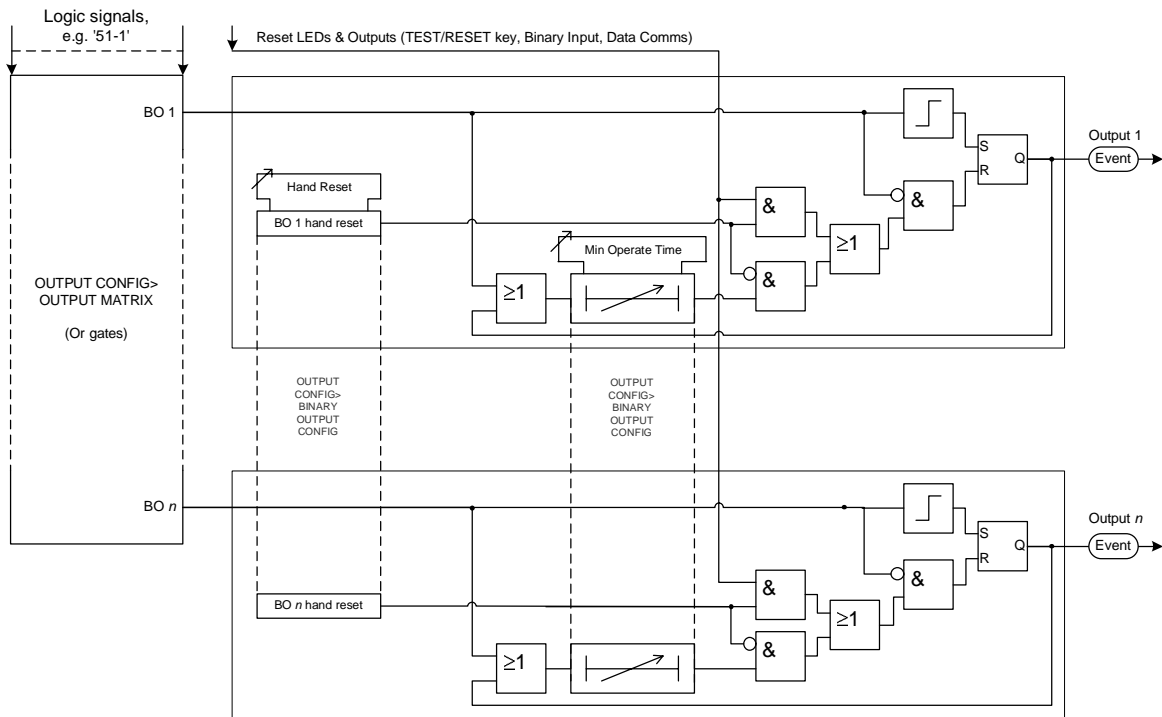


Figure 2-9 Binary Output Logic

## 2.11 Virtual Input/Outputs

The relays have 8 virtual input/outputs these are internal binary stores. By assigning the status of data items like starters, alarms, and equations to a virtual input/output, the status of these items can be used to fulfil higher levels of functionality.

The status of various data items can be assigned to virtual inputs/outputs using the INPUT CONFIG > OUTPUT MATRIX menu.

Virtual input/outputs can be used as inputs to various functions including blocks, inhibits, triggers, and alarms using the INPUT CONFIG > INPUT MATRIX menu.

Virtual input/outputs can also be used as data items in equations.

The status of the virtual inputs and outputs is volatile i.e. not stored during power loss.

## 2.12 Self Monitoring

The relay incorporates a number of self-monitoring features. Each of these features can initiate a controlled reset recovery sequence.

Supervision includes a power supply watchdog, code execution watchdog, memory checks by checksum, and processor/ADC health checks. When all checks indicate the relay is operating correctly the 'Protection Healthy' LED is illuminated.

If an internal failure is detected, a message will be displayed. The relay will reset in an attempt to rectify the failure. This will result in de-energisation of any binary output mapped to 'protection healthy' and flashing of the protection healthy LED. If a successful reset is achieved by the relay, the LED and output contact will revert back to normal operational mode and the relay will restart, therefore ensuring the circuit is protected for the maximum time.

A start-up counter meter is provided to display the number of start-ups the relay has performed. Once the number of start-ups has exceeded a set number, an alarm output can be given.

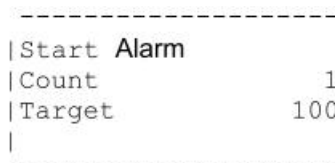


Figure 2-10 Start-up Counter Meter

Reset of the counter can be done from the meter or via a binary input or a command.

Various types of start-up are monitored by the relay:

1. **power-on** starts
2. **expected starts** (user initiated via communications)
3. **unexpected starts** (caused by the relay watchdog)

Any combination of these can be selected for the start-up count. This is done in the MAINTENANCE MENU > START COUNT menu using the **Start Types** setting. All the start-up types selected (ticked) will be added to the overall start-up count.

The number of restarts before the alarm output is raised is set in the MAINTENANCE MENU > START COUNT menu using the **Start Count Target** setting.

When the number of relay start-ups reaches the target value an output is raised, OUTPUT MATRIX > **Start Count Alarm**, which can be programmed to any combination of binary outputs, LED's or virtual outputs.

The following screen-shot show the events which are generated when the relay restarts. The highlighted events show the cause of the re-start. The event which comes next shows the type of restart followed by the relay: Warm, Cold or Re-Start.

As a further safeguard, if the Relay performs a number of unexpected starts **SYSTEM CONFIG>Unexpected Restart Count** in a given time **SYSTEM CONFIG>Unexpected Restart Period**, it can be configured using the **SYSTEM CONFIG>Unexpected Restart Blocking** setting to remove itself from service. In this case the Relay will display an error message:

```

| UNEXPECTED RESTART |
| COUNTS EXCEEDED!  |
| DEVICE LOCKED OUT |
|                   |

```

-----  
**Figure 2-11 Unexpected Restarts Lockout Text**

And enter a locked-up mode. In this mode the Relay will disable operation of all LED's and Binary Outputs, including Protection Healthy, all pushbuttons and any data communications.

Once the Relay has failed in this manner, it is non-recoverable at site and must be returned to the manufacturer for repair.

A meter, Miscellaneous Meters>Unexpected Restarts, is provided to show how many Unexpected Restarts have occurred during the previous Unexpected Restart Period. This is resettable from the front fascia.

### 2.12.1 Protection Healthy/Defective

When the relay has an auxiliary supply and it has successfully passed its self-checking procedure, then the front fascia **Protection Healthy** LED is turned on.

A changeover or open contact can be mapped via the binary output matrix to provide an external protection healthy signal.

A changeover or closed contact can be mapped via the binary output matrix to provide an external protection defective signal. With the 'Protection Healthy' this contact is open. When the auxiliary supply is not applied to the relay or a problem is detected within the relay then this output contact closes to provide external indication.

The screenshot shows the 'Event Record' tab in the 'Reydisp Evolution' software. The table below contains the recorded events:

Time	Type	Action	Description
15:00:00.500,01/10/2013	160	Raised	Power On
	60	Raised	Re-Start
	160	Raised	Setting G1 selected
15:00:08.570,01/10/2013	60	Raised	Local & Remote
15:00:09.315,01/10/2013	183	Raised	CB Alarm
15:03:00.500,01/10/2013	160	Raised	Power On
	60	Raised	Re-Start
	160	Raised	Setting G1 selected
15:03:08.575,01/10/2013	60	Raised	Local & Remote
15:03:09.315,01/10/2013	183	Raised	CB Alarm
15:03:57.670,01/10/2013	160	Raised	LED Reset
15:07:16.500,01/10/2013	160	Raised	Power On
	60	Raised	Re-Start
	160	Raised	Setting G1 selected
15:07:23.505,01/10/2013	91	Raised	LED PU 1
15:07:25.315,01/10/2013	183	Raised	CB Alarm
15:07:40.115,01/10/2013	60	Raised	Local & Remote

Address 1 : 7SR1003-1xA20-xCA0 : 7SR10

Address 1 @ COM12:57600,e

Figure 2-12 Start-up Events

## Section 3: Protection Functions

### 3.1 Current Protection: Phase Overcurrent (50, 51)

All phase overcurrent elements have a common setting for the 50 elements and 51 elements to measure either the fundamental frequency RMS or True RMS current:

True RMS current: 50 Measurement = RMS, 51 Measurement = RMS

Fundamental Frequency RMS current: 50 Measurement = Fundamental, 51 Measurement = Fundamental

#### 3.1.1 Instantaneous Overcurrent Protection (50)

Two Instantaneous overcurrent elements are provided in the 7SR10 Overcurrent and Earth Fault relay.

##### 50-1, 50-2

Each instantaneous element (50-n) has independent settings. **50-n Setting** for pick-up current and **50-n Delay** follower time delay. The instantaneous elements have transient free operation.

Operation of the instantaneous overcurrent elements can be inhibited from:

<b>Inhibit 50-n</b>	A binary or virtual input.
<b>50-n Inrush Action: Block</b>	Operation of the inrush current detector function.
<b>79 P/F Inst Trips: 50-n</b>	When 'delayed' trips only are allowed in the auto-reclose sequence ( <b>79 P/F Prot'n Trip n = Delayed</b> )

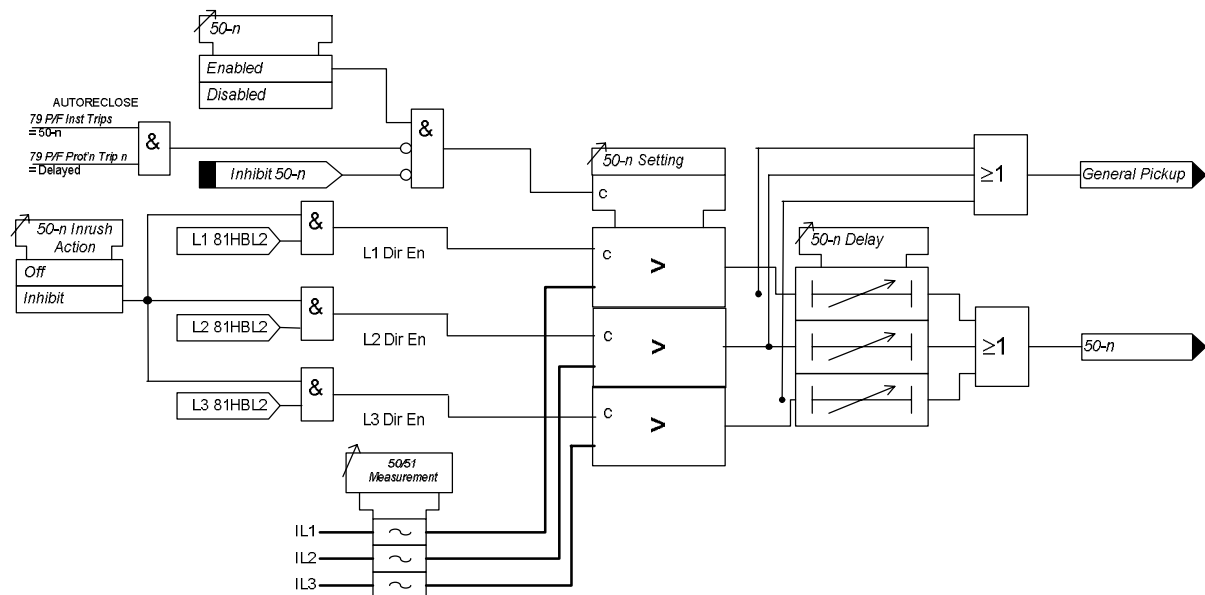


Figure 3-1 Logic Diagram: Instantaneous Overcurrent Element

#### 3.1.2 Time Delayed Overcurrent Protection (51)

Two time delayed overcurrent elements are provided in the 7SR10 Overcurrent and Earth Fault relay.

##### 51-1, 51-2

**51-n Setting** sets the pick-up current level.

A number of shaped characteristics are provided. An inverse definite minimum time (IDMT) characteristic is selected from IEC, ANSI curves using **51-n Char**. A time multiplier is applied to the characteristic curves using the **51-n Time Mult** setting. Alternatively, a definite time lag delay (DTL) can be chosen using **51-n Char**. Alternatively, a definite time lag (DTL) is selected the time multiplier is not applied and the **51-n Delay (DTL)** setting is used instead.



The **51-n Reset** setting can apply a **definite time delayed** reset, or when the operation is configured as an IEC or ANSI if the reset is selected as **(IEC/ANSI) DECAYING** reset the associated reset curve will be used. The reset mode is significant where the characteristic has reset before issuing a trip output.

A minimum operating time for the characteristic can be set using **51-n Min. Operate Time** setting.

A fixed additional operating time can be added to the characteristic using **51-n Follower DTL** setting.

Operation of the time delayed overcurrent protection elements can be inhibited from:

<b>Inhibit 51-n</b>	A binary or virtual input.
<b>79 P/F Inst Trips: 51-n</b>	When 'delayed' trips only are allowed in the auto-reclose sequence ( <b>79 P/F Prot'n Trip n = Delayed</b> ).
<b>51c</b>	Activation of the cold load settings.
<b>50-n Inrush Action: Block</b>	Operation of the inrush current detector function.

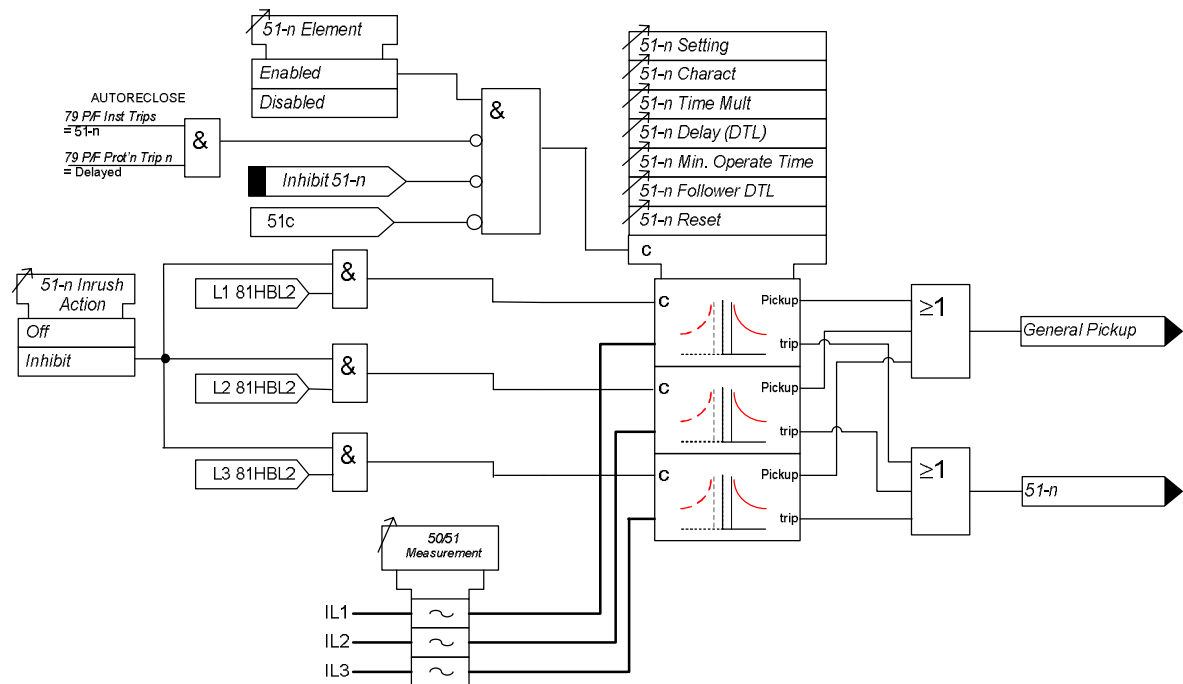


Figure 3-2 Logic Diagram: Time Delayed Overcurrent Element

## 3.2 Current Protection: Derived Earth Fault (50N, 51N)

The earth current is derived by calculating the sum of the measured line currents. The elements measure the fundamental frequency RMS current.

### 3.2.1 Instantaneous Derived Earth Fault Protection (50N)

Two instantaneous derived earth fault elements are provided in the 7SR10 Overcurrent and Earth Fault relay.

#### 50N-1, 50N-2

Each instantaneous element has independent settings for pick-up current **50N-n Setting** and a follower time delay **50N-n Delay**. The instantaneous elements have transient free operation.

Operation of the instantaneous earth fault elements can be inhibited from:

<b>Inhibit 50N-n</b>	A binary or virtual input.
<b>79 E/F Inst Trips: 50N-n</b>	When 'delayed' trips only are allowed in the auto-reclose sequence ( <b>79 E/F Prot'n Trip n = Delayed</b> ).
<b>50-n Inrush Action: Block</b>	Operation of the inrush current detector function.

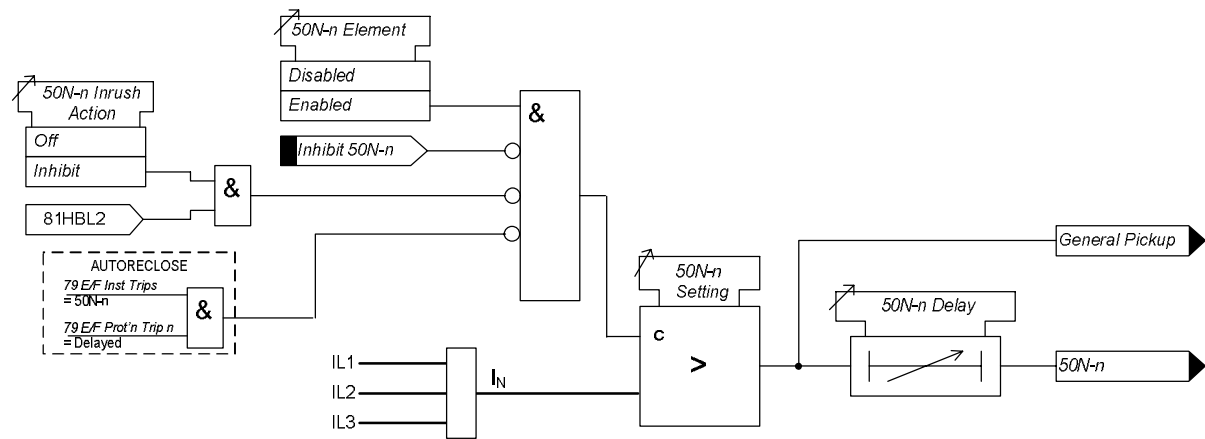


Figure 3-3 Logic Diagram: Derived Instantaneous Earth Fault Element

### 3.2.2 Time Delayed Derived Earth Fault Protection (51N)

Two time delayed derived earth fault elements are provided in the 7SR10 Overcurrent and Earth Fault relay.

#### 51N-1, 51N-2

**51N-n Setting** sets the pick-up current level.

A number of shaped characteristics are provided. An inverse definite minimum time (IDMT) characteristic is selected from IEC and ANSI curves using **51N-n Char**. A time multiplier is applied to the characteristic curves using the **51N-n Time Mult** setting. Alternatively, a definite time lag delay (DTL) can be chosen using **51N-n Char**. When definite time lag (DTL) is selected, the time multiplier is not applied and the **51N-n Delay (DTL)** setting is used instead.

The **51N-n Reset** setting can apply a **definite time delayed** reset, or when configured as an IEC or ANSI if the reset is selected as IEC/ANSI (DECAYING) reset the associated reset curve will be used. The reset mode is significant where the characteristic has reset before issuing a trip output.

A minimum operate time for the characteristic can be set using the **51N-n Min. Operate Time** setting.

A fixed additional operate time can be added to the characteristic using the **51N-n Follower DTL** setting.

Operation of the time delayed earth fault elements can be inhibited from:

- |                                  |   |
|----------------------------------|---|
| <b>Inhibit 51N-n</b>             | A binary or virtual input.  |
| <b>79 E/F Inst Trips: 51N-n</b>  | When 'delayed' trips only are allowed in the auto-reclose sequence ( <b>79 E/F Prot'n Trip n = Delayed</b> ). |
| <b>50-n Inrush Action: Block</b> | Operation of the inrush current detector function.  |

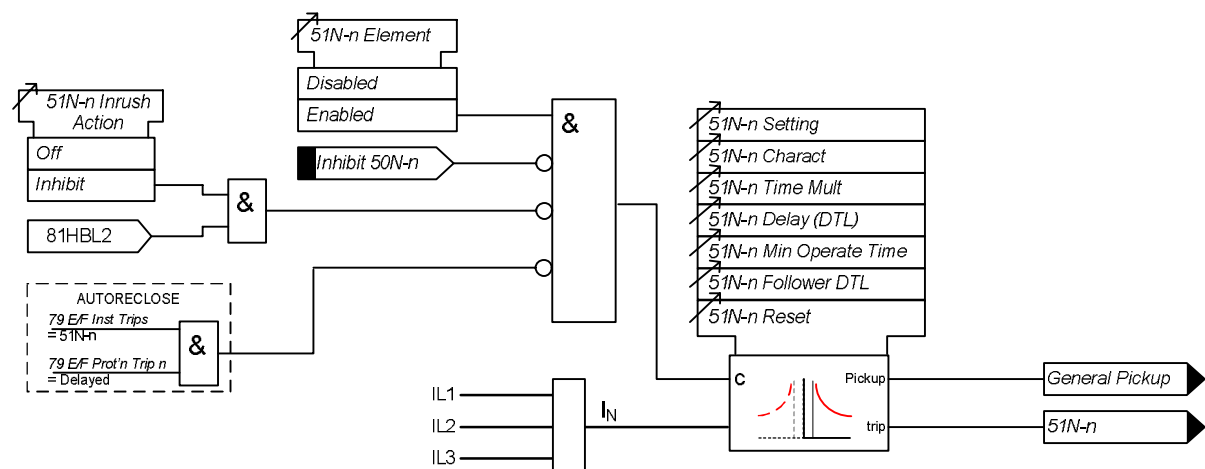


Figure 3-4 Logic Diagram: Derived Time Delayed Earth Fault Protection

### 3.3 Current Protection: Measured Earth Fault (50G, 51G)

The earth current is measured directly via a dedicated current analogue input, IL4.

All measured earth fault elements have a common setting to measure either the fundamental frequency RMS or True RMS current:

True RMS current:  $51/50 \text{ Measurement} = \text{RMS}$

Fundamental Frequency RMS current:  $51/50 \text{ Measurement} = \text{Fundamental}$

#### 3.3.1 Instantaneous Measured Earth Fault Protection (50G)

Two instantaneous derived earth fault elements are provided in the 7SR10 Overcurrent and Earth Fault relay.

##### 50G-1, 50G-2

Each instantaneous element has independent settings for pick-up current **50G-n Setting** and a follower time delay **50G-n Delay**. The instantaneous elements have transient free operation.

Operation of the instantaneous measured earth fault elements can be inhibited from:

**Inhibit 50G-n** A binary or virtual input.

**79 E/F Inst Trips: 50G-n** When 'delayed' trips only are allowed in the auto-reclose sequence (**79 E/F Prot'n Trip n = Delayed**).

**50-n Inrush Action: Block** Operation of the inrush current detector function.

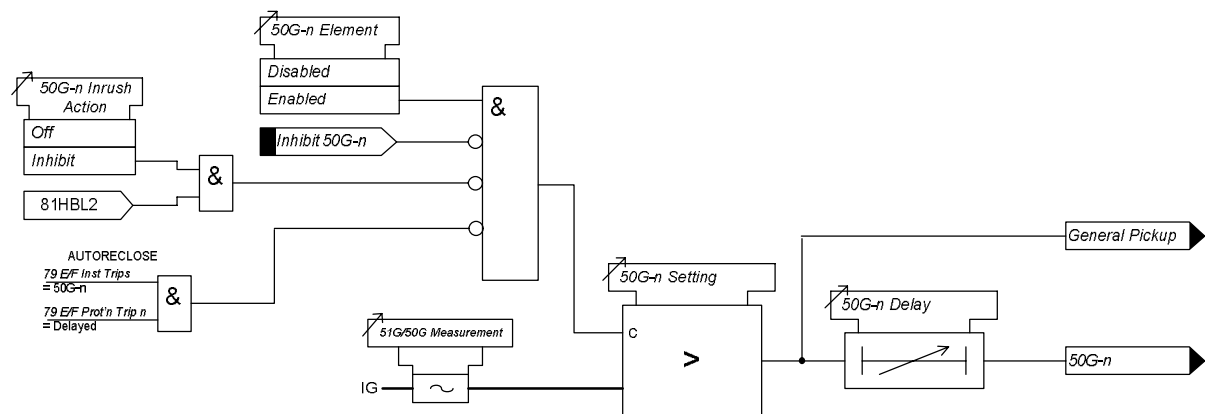


Figure 3-5 Logic Diagram: Measured Instantaneous Earth-fault Element

#### 3.3.2 Time Delayed Measured Earth Fault Protection (51G)

Two instantaneous derived earth fault elements are provided in the 7SR10 Overcurrent and Earth Fault relay.

##### 51G-1, 51G-2

**51G-n Setting** sets the pick-up current level.

A number of shaped characteristics are provided. An inverse definite minimum time (IDMT) characteristic is selected from IEC and ANSI curves using **51G-n Char**. A time multiplier is applied to the characteristic curves using the **51G-n Time Mult** setting. Alternatively, a definite time lag (DTL) can be chosen using **51G-n Char**. When DTL is selected the time multiplier is not applied and the **51G-n Delay (DTL)** setting is used instead.

The **51-n Reset** setting can apply a **definite time delayed** reset or when the operation is configured as an IEC or ANSI curves if the reset is selected as **IEC/ANSI (DECAYING)** reset the associated reset curve will be used. The reset mode is significant where the characteristic has reset before issuing a trip output.

A minimum operate time for the characteristic can be set using **51G-n Min. Operate Time** setting.

A fixed additional operate time can be added to the characteristic using **51G-n Follower DTL** setting.

Operation of the time delayed measured earth fault elements can be inhibited from:

**Inhibit 51G-n** A binary or virtual input.

**79 E/F Inst Trips: 51G-n** When 'delayed' trips only are allowed in the auto-reclose sequence (**79 E/F Prot'n Trip n = Delayed**).

**50-n Inrush Action: Block** Operation of the inrush current detector function.

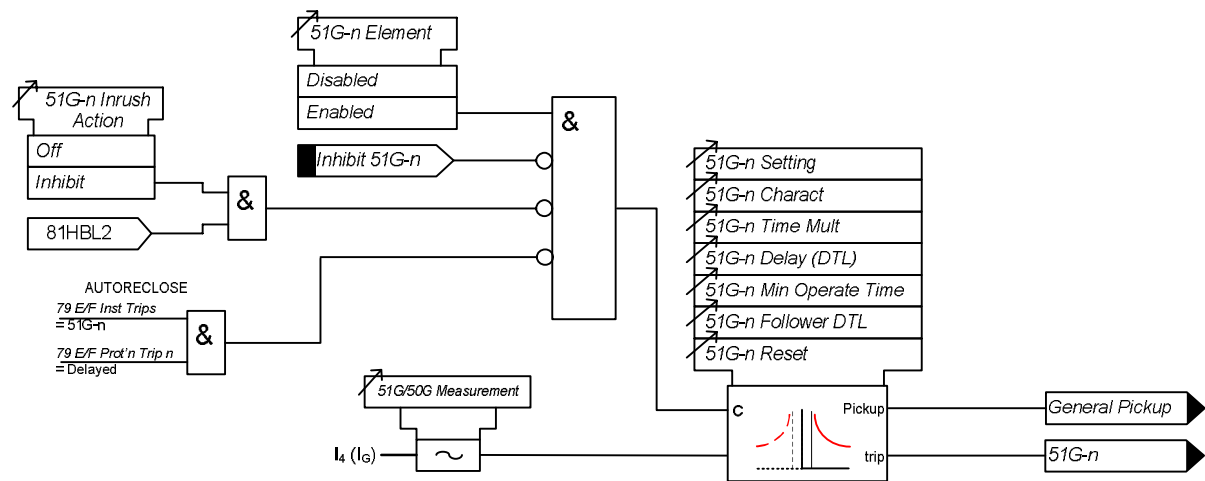


Figure 3-6 Logic Diagram: Measured Time Delayed Earth Fault Element (51G)

### 3.4 Current Protection: Cold Load (51C)

The setting of each shaped overcurrent element (51-n) can be inhibited and alternative 'cold load' settings (51c-n) can be applied for a period following circuit switch in.

The Cold Load settings are applied after the circuit breaker has been open for longer than the **Pick-Up Time** setting.

Following the circuit breaker closure, the 'cold load' overcurrent settings will revert to those defined in the Phase Overcurrent menu (51-n) after either elapse of the **Drop-Off Time** setting or when the measured current falls below the **Reduced Current Level** setting for a time in excess of **Reduced Current Time** setting.

A Circuit Breaker 'Don't Believe It' (DBI) alarm condition, see [section 4.3](#) is not acted on, causing the element to remain operating in accordance with the relevant 51-n settings. Where the **Reduced Current** setting is set to **OFF** reversion to 51-n settings will only occur at the end of the **Drop-Off Time**. If any element is picked up on expiry of **Drop-Off Time**, the relay will issue a trip (and lockout if a recloser is present).

If the circuit breaker is re-opened before expiry of the **Drop-Off Time** the drop-off timer is held but not reset. Resetting the timer for each trip could result in damaging levels of current flowing for a prolonged period during a rapid sequence of trips/closes.

Cold load trips use the same binary output(s) as the associated 51-n element.

Operation of the cold load element can be inhibited from:

**Inhibit Cold Load** A binary or virtual input.

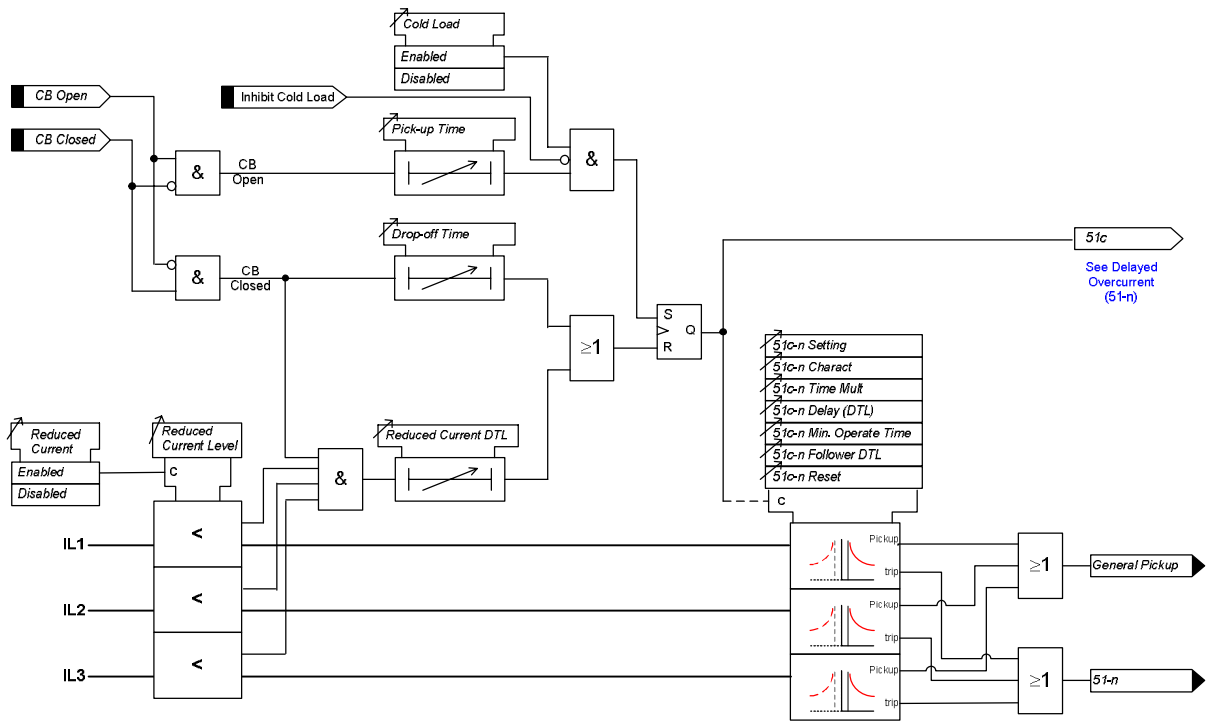


Figure 3-7 Logic Diagram: Cold Load Settings (51C)

### 3.5 Instantaneous Sensitive Earth Protection (50SEF)

Two sensitive earth fault elements are provided in the 7SR11 relay.

#### 50SEF-1, 50SEF-2

Each instantaneous element has independent settings for pick-up current **50SEF-n Setting** and a follower time delay **50SEF-n Delay**. The instantaneous elements have transient free operation.

Operation of the instantaneous earth fault elements can be inhibited from:

#### Inhibit 50SEF-n

A binary or virtual input.

#### 79 SEF Inst Trips: 50SEF-n

When 'delayed' trips only are allowed in the auto-reclose sequence (**79 SEF Prot'n Trip n = Delayed**).

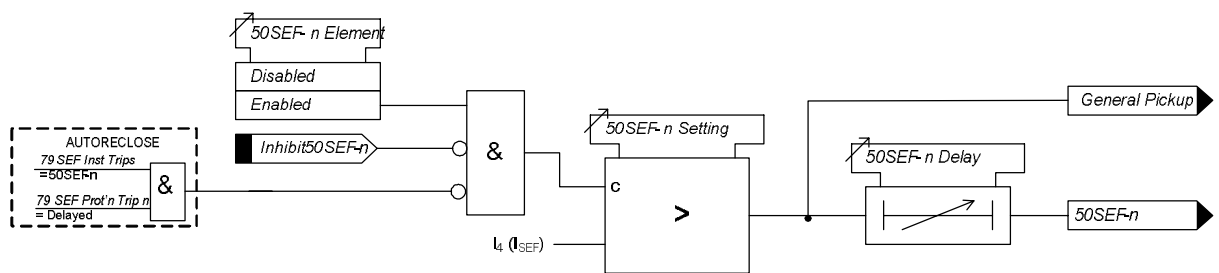


Figure 3-8 Logic Diagram: 7SR10 SEF Instantaneous Element

### 3.6 Time Delayed Sensitive Earth Fault Protection (51SEF)

Two sensitive earth fault elements are provided in the 7SR10 relay.

#### 51SEF-1, 51SEF-2

**51SEF-n Setting** sets the pick-up current level.

A number of shaped characteristics are provided. An inverse definite minimum time (IDMT) characteristic is selected from IEC and ANSI curves using **51SEF-n Char**. A time multiplier is applied to the characteristic curves using the **51SEF-n Time Mult** setting. Alternatively, a definite time lag (DTL) can be chosen using **51SEF-n Char**. When DTL is selected the time multiplier is not applied and the **51SEF-n Delay (DTL)** setting is used instead.

The **51SEF-n Reset** setting can apply a **definite time delayed reset**, or when configured as an IEC or ANSI characteristic an **IEC/ANSI (DECAYING)** reset. The reset mode is significant where the characteristic has reset before issuing a trip output.

A minimum operate time for the characteristic can be set using **51SEF-n Min. Operate Time** setting.

A fixed additional operate time can be added to the characteristic using **51SEF-n Follower DTL** setting.

Operation of the time delayed earth fault elements can be inhibited from:

#### Inhibit 51SEF-n

A binary or virtual input

#### 79 SEF Inst Trips: 51SEF-n

When 'delayed' trips only are allowed in the auto-reclose sequence (**79 SEF Prot'n Trip n = Delayed**).

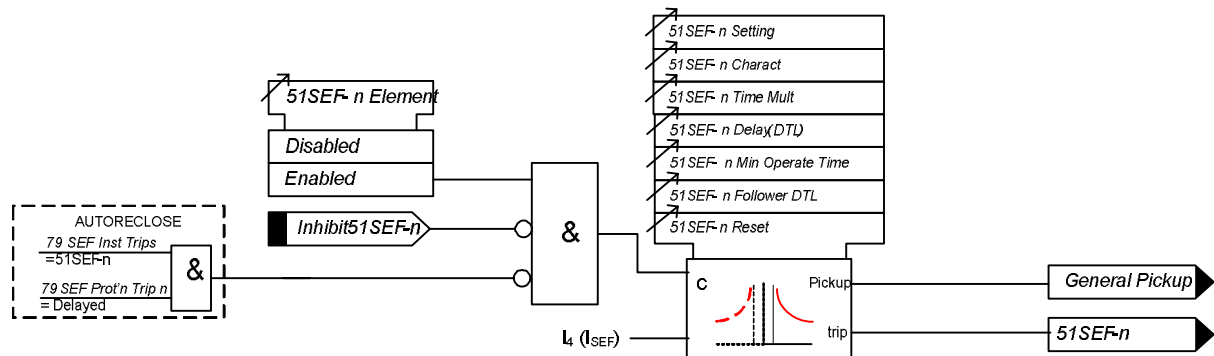


Figure 3-9 Logic Diagram: 7SR10 SEF Time Delayed Element (51SEF)

### 3.7 Broken Conductor (46BC)

The element calculates the ratio of NPS to PPS currents. Where the NPS: PPS current ratio is above **46BC Setting** an output is given after the **46BC Delay**.

The Broken Conductor function can be inhibited from

**Inhibit 46BC** A binary or virtual input

**46BC U/I Guard** A minimum load current

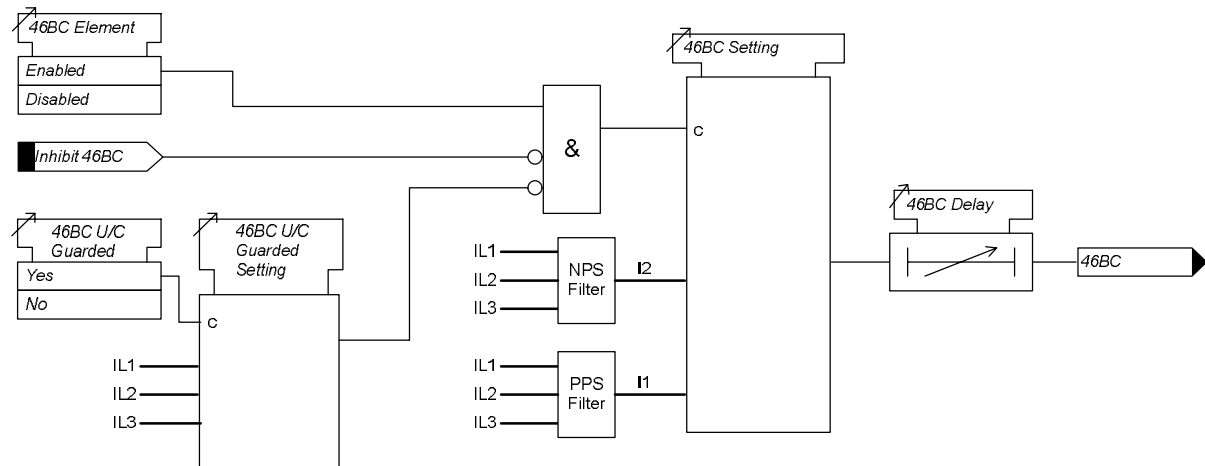


Figure 3-10 Logic Diagram: Broken Conductor Function (46BC)

#### NOTE:

In 46BC, an under-current guard setting with drop-off delay of 600 ms is preset.

### 3.8 Negative Phase Sequence Overcurrent (46NPS)

The negative sequence phase (NPS) component of current ( $I_2$ ) is derived from the three phase currents. It is a measure of the quantity of unbalanced current in the system.

Two NPS current elements are provided – **46IT** and **46DT**.

The 46IT element can be configured to be either definite time lag (DTL) or inverse definite minimum time (IDMT).

**46IT Setting** sets the pick-up current level for the element.

A number of shaped characteristics are provided. An inverse definite minimum time (IDMT) characteristic is selected from IEC and ANSI curves using **46IT Char**. A time multiplier is applied to the characteristic curves using the **46IT Time Mult** setting. Alternatively, a definite time lag delay (DTL) can be chosen using **46ITChar**. When Definite Time Lag (DTL) is selected the time multiplier is not applied and the **46IT Delay (DTL)** setting is used instead.

The **46IT Reset** setting can apply a definite time delayed or ANSI (DECAYING) reset.

The 46DT element has a DTL characteristic. **46DT Setting** sets the pick-up current and **46DT Delay** the follower time delay.

Operation of the negative phase sequence overcurrent elements can be inhibited from:

**Inhibit 46IT** A binary or virtual input.

**Inhibit 46DT** A binary or virtual input.

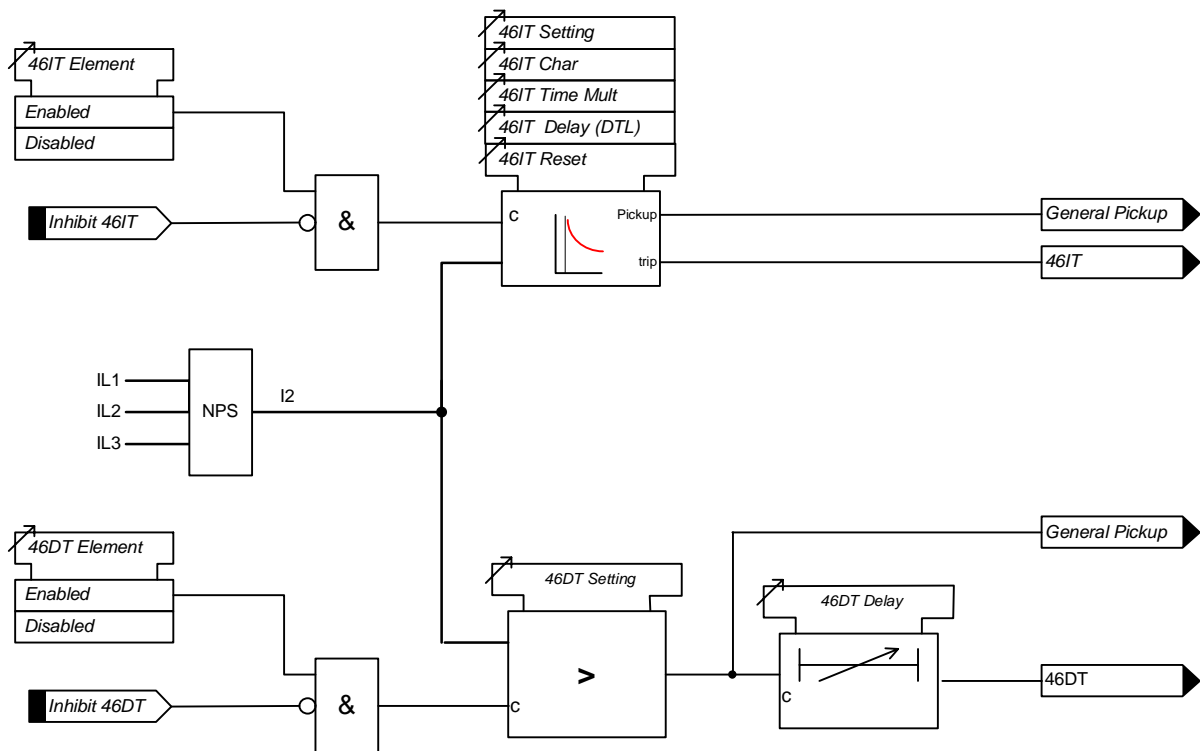


Figure 3-11 Logic Diagram: Negative Phase Sequence Overcurrent (46NPS)

### 3.9 Thermal Overload (49)

The relay provides a thermal overload suitable for the protection of static plant. Phase segregated elements are provided. The temperature of the protected equipment is not measured directly. Instead, thermal overload conditions are calculated using the measure True RMS current.

Should the current rise above the **49 Overload Setting** for a defined time an output signal will be initiated. The operating time is a function of thermal time constant **49 Time Constant** and previous current levels.

Operate Time (t):-

$$t = t' \cdot \ln \left[ \frac{I^2 - I_p^2}{I^2 - (k \cdot I_B)^2} \right] \cdot \frac{\ddot{u}}{\dot{y}_p}$$

Where

T = Time in minutes

t = **49 Time Constant** setting (minutes)

ln = Log Natural

I = measured current

I<sub>p</sub> = Previous steady state current level

k = Constant (recommended value, k = 1.05)

I<sub>B</sub> = Basic current, typically the same as I<sub>n</sub>

k · I<sub>B</sub> = **49 Overload** Setting (I<sub>q</sub>)

Additionally, an alarm can be given if the thermal state of the system exceeds a specified percentage of the protected equipment's thermal capacity **49 Capacity Alarm** setting.

For the heating curve:

$$\theta = \frac{I^2}{I_\theta^2} \times (1 - e^{-t/\tau}) \cdot 100\%$$



Where:  $q$  = thermal state at time  $t$

$I$  = measured thermal current

$I_q$  = **49 Overload** setting (or  $k \cdot I_B$ )

The final steady state thermal condition can be predicted for any steady state value of input current where  $t > t_c$ ,

$$\theta_F = \frac{I^2}{I_0^2} \cdot 100\%$$

Where:  $q_F$  = final thermal state before disconnection of device

**49 Overload Setting**  $I_q$  is expressed as a multiple of the relay nominal current and is equivalent to the factor  $k \cdot I_B$  as defined in the IEC255-8 thermal operating characteristics. It is the value of current above which 100% of thermal capacity will be reached after a period of time and it is therefore normally set slightly above the full load current of the protected device.

The thermal state may be reset from the fascia or externally via a binary input.

Thermal overload protection can be inhibited from:

**Inhibit 49** A binary or virtual input.

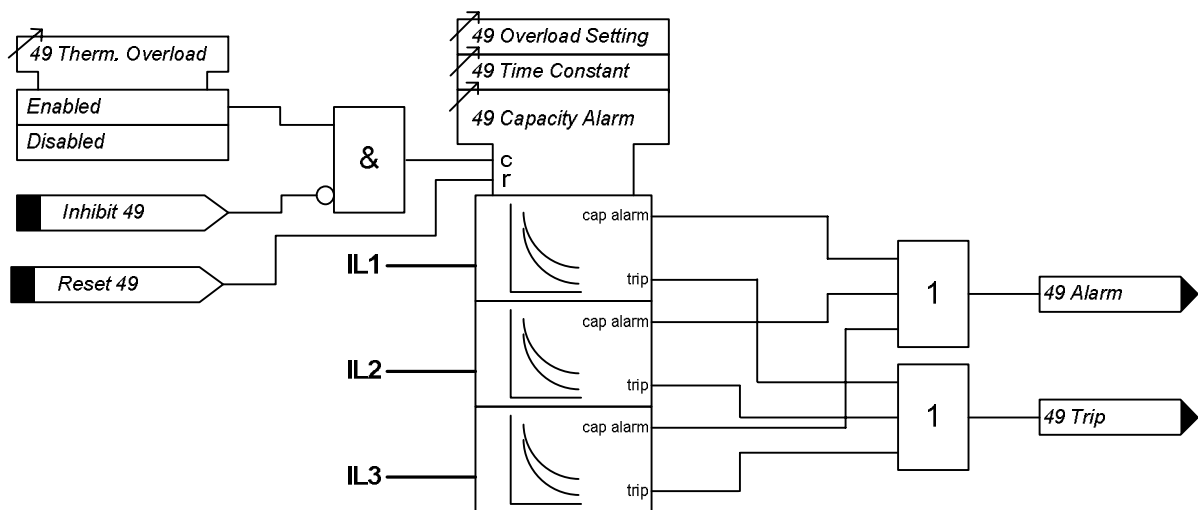


Figure 3-12 Logic Diagram: Thermal Overload Protection (49)

## Section 4: Control and Logic Functions

### 4.1 Auto-Reclose (79) Optional Function

#### 4.1.1 Overview

A high proportion of faults on an Overhead Line (OHL) network are transient. These faults can be cleared and the network restored quickly by using Instantaneous (Fast) Protection trips followed by an automated sequence of Circuit Breaker reclosures after the line has been dead for a short time, this 'deadtime' allows the fault current arc to fully extinguish.

Typically this auto reclose (AR) sequence of Instantaneous Trip(s) and Reclose Delays (Dead times) followed by Delayed Trip(s) provide the automatic optimum method of clearing all types of fault i.e. both Transient and Permanent, as quickly as possible and achieving the desired outcome of keeping as much of the Network in-service as possible.

The AR function, therefore, has to:

- Control the type of Protection trip applied at each stage (shot) of a sequence

- Control the Auto Reclose of the Circuit Breaker to provide the necessary network Dead times, to allow time for Arc extinction

- Co-ordinate its Protection and Auto Reclose sequence with other fault clearing devices.

A typical sequence would be – 2 Instantaneous/Highset+1Delayed/HighSet Trips with 1 sec & 10 sec dead times.

The Autoreclose feature may be switched in and out of service by a number of methods, these are:

- Changing Relay Setting **79 Autoreclose ENABLE/DISABLE** (AUTORECLOSE CONFIG menu)

- Enable/Disable in the CONTROL MODE accessed from the fascia

- Via the data communications channel(s),

- From a **79 OUT** binary input. Note the **79 OUT** binary input has priority over the **79 IN** binary input - if both are raised the auto-reclose will be Out of Service.

Knowledge of the CB position status is integral to the auto-reclose functionality. CB auxiliary switches must be connected to **CB Closed** and **CB Open** binary inputs. A circuit breaker's service status is determined by its position i.e. from the binary inputs programmed **CB Open** and **CB Closed**. The circuit breaker is defined as being in service when it is closed. The circuit memory functionality prevents autoreclosing when the line is de-energised, or normally open.

AR is started by a valid protection operation that is internally mapped to trip in the 79 Autoreclose protection menu or an external trip received via a binary input **79 Ext Trip**, while the associated circuit breaker is in service.

The transition from AR started to deadtime initiation takes place when the CB has opened and the protection pickups have reset and the trip relay has reset. If any of these do not occur within the **79 Sequence Fail Timer** setting the relay will Lockout. This prevents the AR being primed indefinitely. **79 Sequence Fail Timer** can be switched to **0** (= OFF).

Once an AR sequence has been initiated, up to 4 reclose operations can be attempted before the AR is locked-out. The relay is programmed to initiate a number of AR attempts, the number is determined by **79 Num Shots**. Each reclosure (shot) is preceded by a time delay - **79 Elem Deadtime n** - giving transient faults time to clear. Separate dead-time settings are provided for each of the 4 recloses and for each of the four fault types – P/F, E/F, SEF and External.

Once a CB has reclosed and remained closed for a specified time period (the Reclaim time), the AR sequence is re-initialised and a Successful Close output issued. A single, common Reclaim time is used (**Reclaim Timer**). When an auto-reclose sequence does not result in a successful reclosure the relay goes to the lockout state.

#### Indications

The Instruments Menu includes the following meters relevant to the status of the Auto-Reclose and Manual Closing of the circuit breaker: -

- Status of the AR sequence , AR Shot Count, CB Open Countdown Timer and CB Close Countdown Timer

## Inputs

External inputs to the AR functionality are wired to binary inputs. Functions which can be mapped to these binary inputs include: -

79 In (edge triggered)	79 Block Reclose	79 Line Check
79 Out (level detected)	Block Close CB	79 Reset Lockout
CB Closed	Close CB	79 Lockout
CB Open	Open CB	Hot Line In
79 Ext Trip	79 Trip & Reclose	Hot Line Out
79 Ext Pickup	79 Trip & Lockout	

## Outputs

Outputs are fully programmable to either binary outputs or LEDs. Programmable outputs include: -

<b>79 Out Of Service</b>	<b>79 Successful AR</b>	<b>79 Block External</b>
<b>79 In Service</b>	<b>79 Lockout</b>	<b>Successful Manual Close</b>
<b>79 In Progress</b>	<b>79 Close Onto Fault</b>	<b>79 Last Trip Lockout</b>
<b>79 AR Close CB</b>	<b>79 Trip &amp; Reclose</b>	<b>CB fail to close</b>
<b>Manual Close CB</b>	<b>79 Trip &amp; Lockout</b>	

### 4.1.2 Auto Reclose sequences

The CONTROL & LOGIC>AUTO RECLOSE PROT'N and CONTROL & LOGIC>AUTORECLOSE CONFIG' menus, allow the user to set independent Protection and Auto Reclose sequences for each type of fault i.e. Phase Fault (P/F), Derived/Measured Earth Fault (E/F), Sensitive Earth Fault (SEF) or External Protections (EXTERN). Each Auto Reclose sequence can be user set to up to four-shots i.e. five trips + four reclose sequence, with independently configurable type of Protection Trip. Overcurrent and earth fault elements can be assigned to any combination of Fast (**Inst**), **Delayed** or highset (**HS**) trips. **Deadtime** Delay time settings are independent for each AR shot. The user has programming options for Auto Reclose Sequences up to the maximum shot count i.e.:-

- Inst or Delayed Trip 1 + (DeadTime 1: 0.1s-14400s)**
- + **Inst or Delayed Trip 2 + (DeadTime 2: 0.1s-14400s)**
- + **Inst or Delayed Trip 3 + (DeadTime 3: 0.1s-14400s)**
- + **Inst or Delayed Trip 4 + (DeadTime 4: 0.1s-14400s)**
- + **Inst or Delayed Trip 5 – Lockout.**

The AR function recognizes developing faults and, as the shot count advances, automatically applies the correct type of Protection and associated Dead time for that fault-type at that point in the sequence.

A typical sequence would consist of two **Inst** trips followed by at least one **Delayed** trip. This sequence enables transient faults to be cleared quickly by the **Inst** trip(s) and permanent fault to be cleared by the combined Delayed trip. The delayed trip must be 'graded' with other Recloser/CB's to ensure system discrimination is maintained, i.e.. that as much of the system as possible is live after the fault is cleared.

A **HS trips to lockout** setting is provided such that when the number of operations of elements assigned as HS trips reach the setting the relay will go to lockout.

The number of Shots (Closes) is user programmable, note: - only one Shot Counter is used to advance the sequence, the Controller selects the next Protection characteristic/Dead time according to the type of the last Trip in the sequence e.g. PF, EF, SEF or EXTERNAL.

#### Reclose Dead Time

User programmable dead times are available for each protection trip operation.

The dead time is initiated when the trip output contact reset, the pickup is reset and the CB is open.

The CB close output relay is energised after the dead time has elapsed.

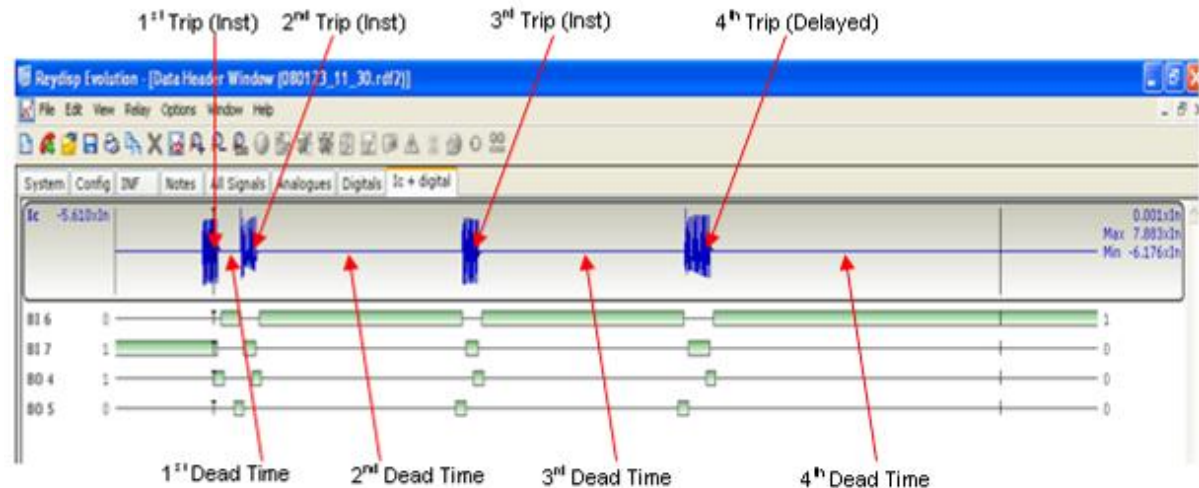


Figure 4-1 Typical AR Sequence with 3 Inst and 1 Delayed trip

#### 4.1.3 Autoreclose Prot'n Menu

This menu presents the Overcurrent Protection elements available for each type of Fault i.e. P/F, E/F (N/G) or SEF and allows the user to select those that are to be applied as **Inst trips**; those that are to be applied as **Delayed Trips**; and those that are to be applied as **HS Trips** (HighSet), as required by the selected sequence. There is no corresponding setting for External as the External protection type is not normally controlled by the Auto Reclose Relay. The resultant configuration enables the Auto Reclose function to correctly apply the required Protection for each shot in a sequence.

#### 4.1.4 Autoreclose Config Menu

This menu allows the following settings to be made:-

<b>79 Autoreclose</b>	<b>Enabled</b> turns ON all AutoReclose Functions.
<b>79 Num Shots</b>	Sets the allowed number of AutoReclose attempts in a sequence.
<b>79 Retry Enable</b>	<b>Enabled</b> configures the relay to perform further attempts to automatically Close the Circuit Breaker where the CB has initially failed to close in response to a Close command. If the first attempt fails the relay will wait for the <b>79 Retry Interval</b> to expire then attempt to Close the CB again.
<b>79 Retry Attempts</b>	Sets the maximum number of retry attempts.
<b>79 Retry Interval</b>	Sets the time delay between retry attempts.
<b>79 Reclose Blocked Delay</b>	If the CB is not ready to receive a Close command or if system conditions are such that the CB should not be closed immediately e.g. a close-spring is not charged, then a Binary input mapped to <b>Reclose Block</b> can be raised and the Close pulse will not be issued but will be held-back. The <b>79 Reclose Blocked Delay</b> sets the time <b>Reclose Block</b> is allowed to be raised, if this time delay expires the Relay will go to Lockout. If Reclose Block is cleared, before this time expires, then the CB Close pulse will be issued at that point in time. Dead Time + Reclose Blocked Delay = Lockout.
<b>79 Sequence Fail Timer</b>	Sets the time that AutoReclose start can be primed. Where this time expires before all the DAR start signals are not received i.e. the CB has opened, protection pickups have reset and the trip relay has reset, the Relay goes to Lockout.
<b>79 Sequence Co-Ord</b>	When set to <b>Enabled</b> the Relay will co-ordinate its sequence and shot count such that it automatically keeps in step with downstream devices as they advance through their sequence. The Relay detects that a pickup has operated but has dropped-off before its associated time delay has expired, it then increments its Shot count and advances to the next stage of the auto-reclose sequence without issuing a trip, this is repeated as long as the fault is being cleared by the downstream device such that the Relay moves

through the sequence bypassing the INST Trips and moving on to the Delayed Trip to maintain Grading margins.

#### Notes on the 'Lockout' State

The Lockout state can be reached for a number of reasons. Lockout will occur for the following: -

- **At the end of the 79 Sequence Fail Timer.**
- **At the end of the Reclaim timer if the CB is in the open position.**
- **A protection operates during the final Reclaim time.**
- **If a Close Pulse is given and the CB fails to close.**
- **The 79 Lockout binary input is active.**
- **At the end of the 79 Reclose Blocked Delay due to presence of a persistent Block signal.**
- **When the 79 Elem HS Trips to Lockout count is reached.**
- **When the 79 Elem Delayed Trips to Lockout count is reached.**

An alarm output is provided to indicate **last trip to lockout**.

Once lockout has occurred, an alarm (**79 Lockout**) is issued and all further Close commands, except manual close, are inhibited.

If the Lockout command is received while a Manual Close operation is in progress, the feature is immediately locked-out.

Once the Lockout condition has been reached, it will be maintained until reset. The following will reset lockout: -

- **By a Manual Close command, from fascia, comms or Close CB binary input.**
- **By a 79 Reset Lockout binary input, provided there is no signal present that will cause Lockout.**
- **At the end of the 79 Minimum LO Delay time setting if 79 Reset LO by Timer is selected to ENABLED, provided there is no signal present which will cause Lockout.**
- **Where Lockout was entered by an A/R Out signal during an Autoreclose sequence then a 79 In signal must be received before Lockout can reset.**
- **By the CB Closed binary input, provided there is no signal present which will cause Lockout.**

The Lockout condition has a delayed drop-off of 2s. The Lockout condition can not be reset if there is an active lockout input.

#### 4.1.5 P/F Shots sub-menu

This menu allows the Phase fault trip/reclose sequence to be parameterized:-

- |  |   |
|--|---|
| <b>79 P/F Prot'n Trip1</b>             | The first protection Trip in the P/F sequence can be set to either <b>Inst</b> or <b>Delayed</b> .  |
| <b>79 P/F Deadtime 1</b>               | Sets the first Reclose Delay (Dead time) in the P/F sequence.   |
| <b>79 P/F Prot'n Trip2</b>             | The second protection Trip in the P/F sequence can be set to either <b>Inst</b> or <b>Delayed</b> .   |
| <b>79 P/F Deadtime 2</b>               | Sets the second Reclose Delay (Dead time) in the P/F sequence.  |
| <b>79 P/F Prot'n Trip3</b>             | The third protection Trip in the P/F sequence can be set to either <b>Inst</b> or <b>Delayed</b> .  |
| <b>79 P/F Deadtime 3</b>               | Sets the third Reclose Delay (Dead time) in the P/F sequence.   |
| <b>79 P/F Prot'n Trip 4</b>            | The fourth protection Trip in the P/F sequence can be set to either <b>Inst</b> or <b>Delayed</b> .   |
| <b>79 P/F Deadtime 4</b>               | Sets the fourth Reclose Delay (Dead time) in the P/F sequence.  |
| <b>79 P/F Prot'n Trip5</b>             | The fifth and last protection Trip in the P/F sequence can be set to either <b>Inst</b> or <b>Delayed</b> .   |
| <b>79 P/F HighSet Trips to Lockout</b> | Sets the number of allowed HighSet trips. The relay will go to Lockout on the last HighSet Trip. This function can be used to limit the duration and number of high current trips that the Circuit Breaker is required to perform, if the fault is permanent and close to the Circuit Breaker then there is no point in forcing a number of Delayed Trips before the Relay goes to Lockout – that sequence will be truncated. |
| <b>79 P/F Delayed Trips to Lockout</b> | Sets the number of allowed Delayed trips, Relay will go to Lockout on the last Delayed Trip. This function limits the number of Delayed trips that the Relay can perform when the Instantaneous protection Elements are externally inhibited for system operating reasons - sequences are truncated.  |

#### 4.1.6 E/F Shots sub-menu

This menu allows the Earth Fault trip/reclose sequence to be parameterized:-

As above but E/F settings.

#### 4.1.7 SEF Shots sub-menu

This menu allows the Sensitive Earth trip/reclose sequence to be parameterized:-

As above but SEF Settings, Note: - SEF does not have HighSets

#### 4.1.8 Extern Shots sub-menu

This menu allows the External Protection auto-reclose sequence to be parameterized:-

<b>79 P/F Prot'n Trip1</b>	<b>Not Blocked/Blocked</b> - Blocked raises an output which can be mapped to a Binary output to Block an External Protection's Trip Output.
<b>79 P/F Deadtime 1</b>	Sets the first Reclose Delay ( Deadtime) for the External sequence.
<b>79 P/F Prot'n Trip2</b>	<b>Not Blocked/Blocked</b> - Blocked raises an output which can be mapped to a Binary Output to Block an External Protection's second Trip output.
<b>79 P/F Deadtime 2</b>	Sets the second Reclose Delay ( Deadtime) in the External sequence.
<b>79 P/F Prot'n Trip3</b>	<b>Not Blocked/Blocked</b> - Blocked raises an output which can be mapped to a Binary output to Block an External Protection's third Trip Output.
<b>79 P/F Deadtime 3</b>	Sets the third Reclose Delay (Deadtime) in the External sequence.
<b>79 P/F Prot'n Trip4</b>	<b>Not Blocked/Blocked</b> - Blocked raises an output which can be mapped to a Binary output to Block an External Protection's fourth Trip Output.
<b>79 P/F Deadtime 4</b>	Sets the fourth Reclose Delay (Deadtime) in the External sequence.
<b>79 P/F Prot'n Trip5</b>	<b>Not Blocked/Blocked</b> - Blocked raises an output which can be mapped to a Binary output to Block an External Protection's fifth Trip Output.
<b>79 P/F Extern Trips to Lockout</b>	- Sets the number of allowed External protection' trips, Relay will go to Lockout on the last Trip.

These settings allow the user to set-up a separate AutoReclose sequence for external protection(s) having a different sequence to P/F, E/F or SEF protections. The '**Blocked**' setting allows the Autoreclose sequence to raise an output at any point in the sequence to Block further Trips by the External Protection thus allowing the Overcurrent P/F or Earth Fault or SEF elements to apply Overcurrent Grading to clear the fault.

Other Protection Elements in the Relay can also be the cause of trips and it may be that AutoReclose is required; the External AutoReclose sequence can be applied for this purpose. By setting-up internal Quick Logic equation(s) the user can define and set what should occur when any one of these other elements operates.





## 4.2 Quick Logic

The 'Quick Logic' feature allows the user to input up to 4 logic equations (E1 to E4) in text format. Equations can be entered using Reydisp or at the relay fascia.

Each logic equation is built up from text representing the control characters. Each can be up to 20 characters long. The allowable characters are:


- 0, 1, 2, 3, 4, 5, 6, 7, 8, 9    Digit
- ( )    Parenthesis
- !    'NOT' Function
- .    'AND' Function
- ^    'EXCLUSIVE OR' Function
- +    'OR' Function
- En**    Equation (number)
- In**    Binary Input (number)  
           '1' = Input energised, '0' = Input de-energised
- Ln**    LED (number)  
           '1' = LED energised, '0' = LED de-energised
- On**    Binary output (number)  
           '1' = Output energised, '0' = Output de-energised
- Vn**    Virtual Input/Output (number)  
           '1' = Virtual I/O energised, '0' = Virtual I/O de-energised

Example Showing Use of Nomenclature

$$E1 = ((I1 \wedge F1) \cdot !O2) + L1$$

Equation 1 = ((Binary Input 1 XOR Function Key 1) AND NOT Binary Output 2) OR LED 1

When the equation is satisfied (=1) it is routed through a pick-up timer (**En Pickup Delay**), a drop-off timer (**En Dropoff Delay**), and a counter which instantaneously picks up and increments towards its target (**En Counter Target**).

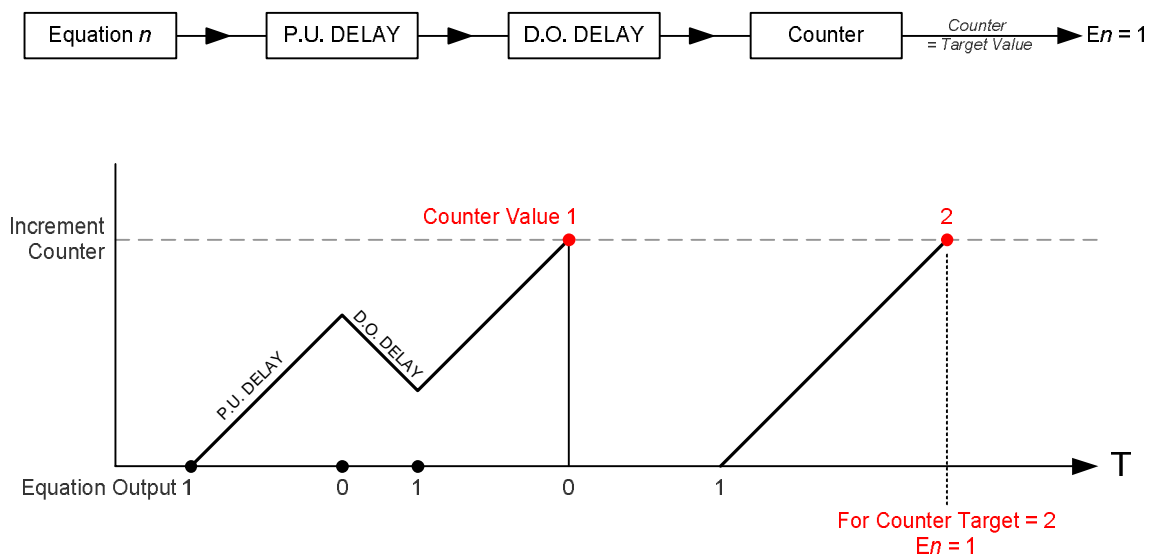

**Figure 4-3 Sequence Diagram: Quick Logic PU/DO Timers (Counter Reset Mode Off)**

When the count value = **En Counter Target** the output of the counter ( $E_n$ ) = 1 and this value is held until the initiating conditions are removed when  $E_n$  is instantaneously reset.

The output of En is assigned in the OUTPUT CONFIG > OUTPUT MATRIX menu where it can be programmed to any Binary Output (O), LED (L) or Virtual Input/Output (V) combination.

Protection functions can be used in Quick Logic by mapping them to a Virtual Input/Output.

## 4.3 Manual CB Control

A Manual Close Command can be initiated in one of four ways: via a **Close CB** binary input, via the data communication Channel(s) or CB close push button or from the relay CONTROL MODE menu. It causes an instantaneous operation via **Manual Close CB** binary output, over-riding any DAR sequence in progress.

Repeated Manual Closes are avoided by checking for Positive edge triggers. Even if the Manual Close input is constantly energised the relay will only attempt one close.

A Manual Close will initiate Line Check if **Line Check Trip** is enabled. If a fault appears on the line during the Close Pulse or during the Reclaim Time with Line Check enabled, the relay will initiate a Trip and Lockout. This prevents a CB being repeatedly closed onto a faulted line. Where **Line Check Trip = DELAYED** then instantaneous protection is inhibited until the reclaim time has elapsed.

Manual Close resets Lockout, if the conditions that caused Lockout have reset, i.e. there is no trip or Lockout input present.

Manual Close cannot proceed if there is a Lockout input present.

With the Autoreclose function set to Disabled the Manual Close control is still active.

If a fault appears on the line during the Close Pulse or during the Reclaim Time with protection function is enabled, the relay will initiate a trip. If there is no fault appears during the reclaim time, then 'Successful Man Close' indication will be initiated.

### CB Controls Latched

CB controls for manually closing and tripping can be latched for extra security.

With Reset operation, the control resets when the binary input drops off. This can lead to multiple control restarts due to bounce on the binary input signal.

With Latch operation, the close or trip sequence always continues to completion (or sequence failure) and bounce on the binary input is ignored.

Reset operation can be useful, however, as it allows a close or trip sequence to be aborted by dropping off the binary input signal.

### Close CB Delay

The Close CB Delay is applicable to manual CB close commands received through a **Close CB** binary input or via the Control Menu. The status of this delay is displayed on the relay fascia as it decrements towards zero. Only when the delay reaches zero will the close command be issued and related functionality initiated.

### Blocked Close Delay

The close command may be delayed by a **Block Close CB** signal applied to a binary input. This causes the feature to pause before it issues the CB close command and can be used, for example, to delay CB closure until the CB energy has reached an acceptable level. If the Block signal has not been removed before the end of the defined time, **Blocked Close Delay**, the relay will go to the lockout state. The output **Close CB Blocked** indicates this condition.

### Open CB Delay

The Open CB Delay setting is applicable to CB trip commands received through an **Open CB** binary input or via the Control Menu. Operation of the **Open CB** binary output is delayed by the **Open CB Delay** setting. The status of this delay is displayed on the relay fascia as it decrements towards zero. Only when the delay reaches zero will the trip command be issued and related functionality initiated.

It should be noted that a CB trip initiated by an Open CB command is fundamentally different from a CB trip initiated by a protection function. A CB trip caused by a CB Open command will not initiate functionality such as circuit-breaker fail, fault data storage,  $I^2t$  measurement and operation counters.

## 4.4 Circuit Breaker (CB)

This menu includes relay settings applicable to both manual close (MC) and auto-reclose (AR) functionality.

'CB Failed To Open' and 'CB Failed to Close' features are used to confirm that a CB has not responded correctly to each Trip and Close Command. If a CB fails to operate, the DAR feature will go to lockout.

### Close CB Pulse

The duration of the **CB Close Pulse** is settable to allow a range of CBs to be used. . The **Close CB Pulse** must be long enough for the CB to physically close.

The Close pulse will be terminated if any protection pick-up operates or a trip occurs. This is to prevent Close and Trip Command pulses existing simultaneously. A **79 Close Onto Fault** output is given if a pick-up or trip operates during the Close Pulse. This can be independently wired to Lockout.

The output **CB Fail to Close** is issued if the CB is not closed at the end of the close pulse, **Close CB Pulse**.

### Reclaim Timer

The 'Reclaim time' will start each time a Close Pulse has timed out and the CB has closed.

Where a protection pickup is raised during the reclaim time the relay advances to the next part of the reclose sequence.

The relay goes to the Lockout state if the CB is open at the end of the reclaim time or a protection operates during the final reclaim time.

### CB Control Trip Time

When this is set to **Enabled**, the relay will measure the CB trip time following operation of either a CB control open output or a CB Trip output. The trip time is displayed by the MAINTENANCE METERS > CB Trip Time meter.

When this is set to Disabled, the relay will measure the trip time following operation of a CB Trip output only. Operation of a CB control open output will then not cause the trip time to be measured.

### Open CB Pulse

The duration of the CB open pulse is user settable to allow a range of CBs to be used.

The CB open pulse must be long enough for the CB to physically open.

### CB Travel Alarm

The **CB Open** and **CB Closed** binary inputs are continually monitored to track the CB Status.

The CB should only ever be in 3 states:

CB Status	CB Open binary input	CB Closed binary input
CB is Open	1	0
CB is Closed	0	1
CB is Travelling between the above 2 states	0	0

The Relay goes to Lockout and the **CB Alarm** output is given where the Travelling condition exists for longer than the **CB Travel Alarm** setting.

An instantaneous **CB Alarm** is given for a 1/1 state – i.e. where the CB indicates it is both Open and Closed at the same time.

### CB DBI Delay

The **CB Open** and **CB Closed** binary inputs are continually monitored to track the CB Status.

A Don't Believe it (DBI) condition exists for a 1/1 state– i.e. where the CB indicates it is both Open and Closed at the same time

The Relay goes to Lockout and the **CB Alarm** output is given where the DBI condition exists for longer than the **CB DBI Delay** setting.

### Hot Line In/Out

When 'Hot Line' is enabled all auto reclose sequences are inhibited and any fault causes an instantaneous trip to lockout.

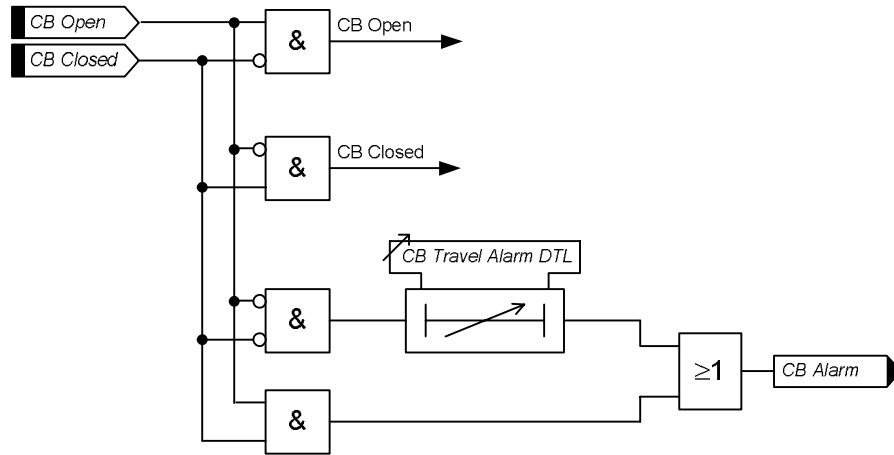


Figure 4-4 Logic Diagram: Circuit Breaker Status

### 79 Minimum LO Delay (Only in Auto-reclose models)

Sets the time that the Relay's Lockout condition is maintained. After the last allowed Trip operation in a specific sequence the Circuit Breaker will be left locked-out in the open position and can only be closed by manual or remote SCADA operation. The **79 Minimum Lockout Delay** timer can be set to delay a too-fast manual close after lockout, this prevents an operator from manually closing onto the same fault too quickly and thus performing multiple sequences and possibly burning-out Plant.

### 79 Reset LO by Timer (Only in Auto-reclose models)

Set to **Enabled** this ensures that the Lockout condition is reset when the timer expires, Lockout indication will be cleared; otherwise, set to Disabled, the Lockout condition will be maintained until the CB is Closed by a Close command.

### Trip Time Alarm

The CB Trip Time meter displays the measured time between the trip being issued and the CB auxiliary contacts changing state. If this measured time exceeds the **Trip Time Alarm** time, a Trip Time Alarm output is issued.

### Trip Time Adjust

This allows for the internal delays caused by the relay – especially the delay before a binary input operates – to be subtracted from the measured CB trip time. This gives a more accurate measurement of the time it took for the CB to actually trip.

## Section 5: Supervision Functions

### 5.1 Circuit Breaker Failure (50BF)

The circuit breaker fail function has two time delayed outputs that can be used for combinations of re-tripping or back-tripping. CB fail outputs are given after elapse of the **50BF-1 Delay** or **50BF-2 Delay** settings. The two timers run concurrently.

The circuit breaker fail protection time delays are initiated either from:

An output **Trip Contact** of the relay (MENU: OUTPUT CONFIG\TRIP CONFIG\Trip Contacts), or

A binary or virtual input assigned to **50BF Ext Trig** (MENU: INPUT CONFIG\INPUT MATRIX\ 50BF Ext Trig).

A binary or virtual input assigned to **50BF Mech Trip** (MENU: INPUT CONFIG\INPUT MATRIX\50BF Mech Trip).

CB fail outputs will be issued by providing any of the 3 phase currents are above the **50BF Setting** or the current in the fourth CT is above **50BF-I4** for longer than the **50BF-n Delay** setting, or for a mechanical protection trip the circuit breaker is still closed when the **50BF-n Delay** setting has expired – indicating that the fault has not been cleared.

Both **50BF-1** and **50BF-2** can be mapped to any output contact or LED.

If the **CB Faulty** input (MENU: INPUT CONFIG\INPUT MATRIX\CB Faulty) is energised when a CB trip is given the time delays **50BF-n Delay** will be by-passed and the output given immediately.

Operation of the CB Fail elements can be inhibited from:

#### Inhibit 50BF

A binary or virtual input.

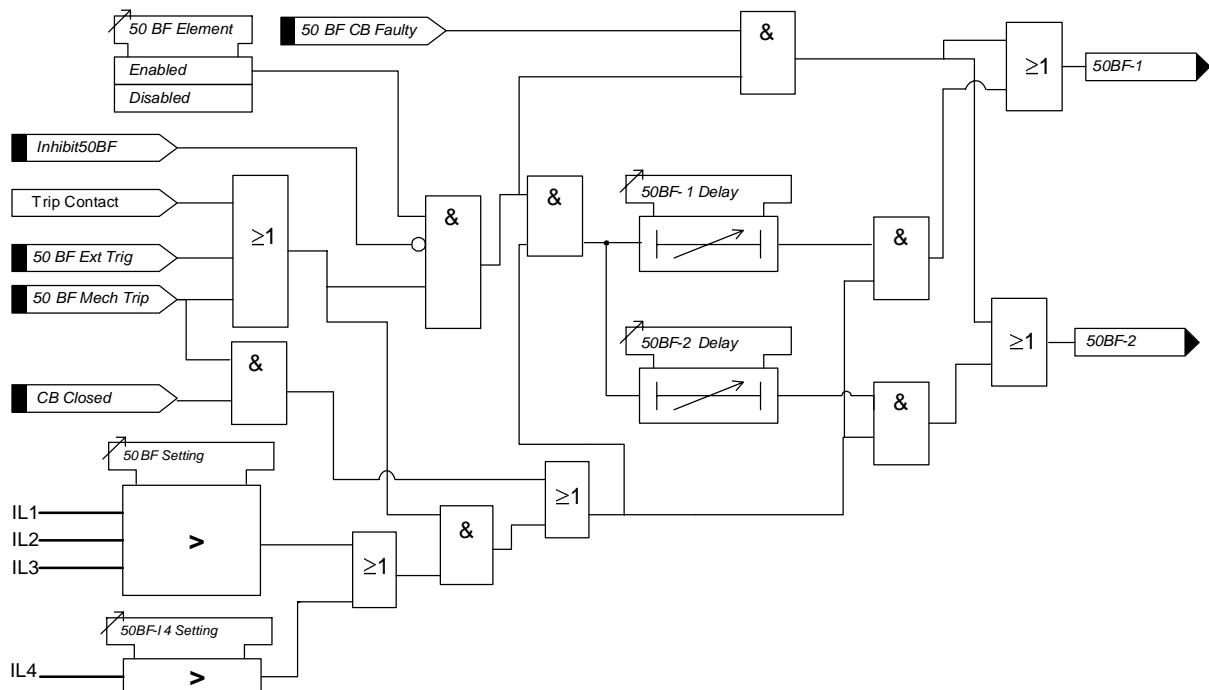


Figure 5-1 Logic Diagram: Circuit Breaker Fail Protection (50BF)

## 5.2 2nd Harmonic Block/Inrush Restraint (81HBL2) Phase Elements Only

Inrush restraint detector elements are provided, these monitor the line currents.

The inrush restraint detector can be used to block the operation of selected elements during transformer magnetising inrush conditions.

The **81HBL2 Bias** setting allows the user to select between **Phase**, **Sum** and **Cross** methods of measurement:

**Phase** Each phase is inhibited separately.

**Sum** With this method the square root of the sum of the squares of the second harmonic in each phase is compared to each operate current individually.

**Cross** All phases are inhibited when any phase detects an inrush condition.

An output is given where the measured value of the second harmonic component is above the **81HBL2** setting.

**NOTE:** The output should be configured as either "Pulse output" or "Hand-reset output" only.

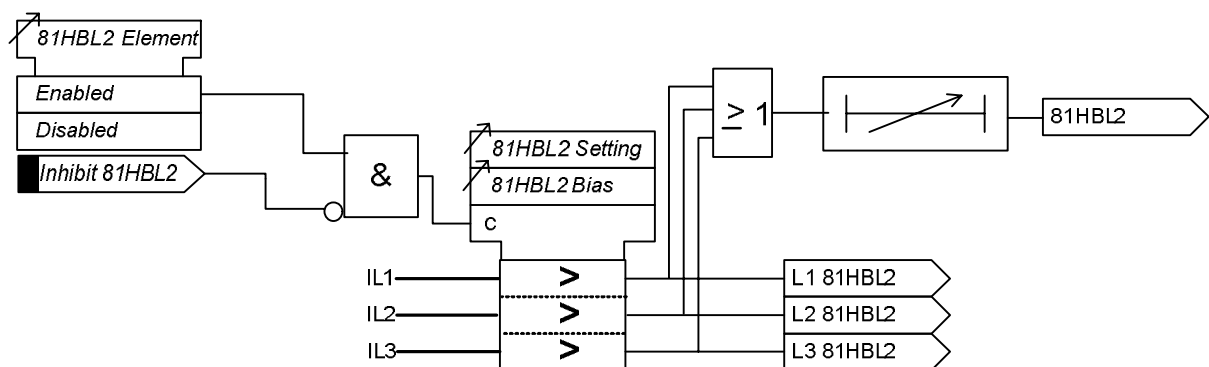


Figure 5-2 Logic Diagram: Harmonic Block Feature (81HBL2)

## 5.3 Total Harmonic Distortion Supervision (81THD)

Single stage THD supervision element is provided in the 7SR10 Overcurrent and Earth Fault relay.

THD calculates the 2<sup>nd</sup> to 15<sup>th</sup> harmonic currents presents in line current and displayed in the 'THD Meter' window as a percentage of fundamental frequency current.


### 81THD

Total harmonic distortion supervision (81THD) has independent settings. **81THD Setting** for pick-up current and **81THD Delay** follower time delay.

Operation of the Total harmonic distortion supervision elements can be inhibited from:

**Inhibit 81THD** A binary or virtual input.

**81THD Inrush Action: Block** Operation of the inrush current detector function.

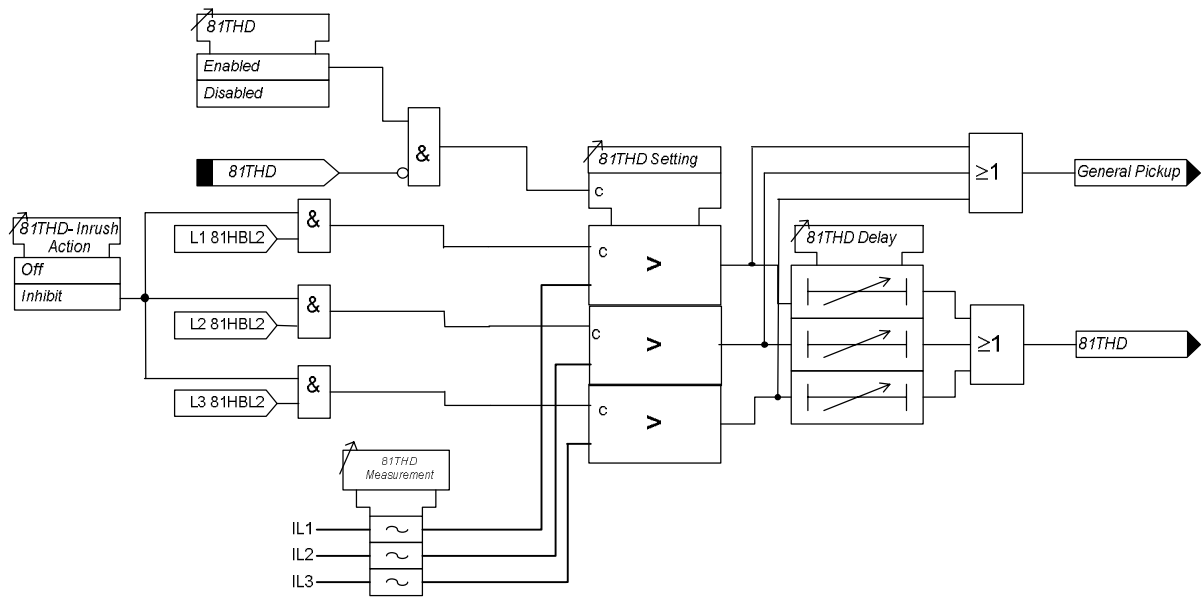

**Figure 5-3** Logic Diagram: Total Harmonic Distortion Supervision Element (81THD)

## Section 6: Other Features

### 6.1 Data Communications

Two communication ports, COM1 and COM2 are provided. RS485 connections are available on the terminal blocks at the rear of the relay (COM1). A USB port, (COM 2) is provided at the front of the relay for local access using a PC.

The rear com1 port can be selected to operate as a local or a remote port operation.

Communication is compatible with Modbus RTU, IEC 60870-5-103 FT 1.2, and DNP 3.0 transmission and application standards.

For communication with the relay via a PC (personal computer) a user-friendly software package, Reydisp is available to allow transfer of relay settings, waveform records, event records, fault data records, Instruments/meters, and control functions. Reydisp is compatible with IEC 60870-5-103.

#### 6.1.1 Communication Ports

##### 6.1.1.1 USB Interface

The USB communication port is connected using a standard USB cable with a type B connection to the relay and type A to the PC.

The PC will require a suitable USB driver to be installed, this will be carried out automatically when the Reydisp software is installed. When the Reydisp software is running, with the USB cable connected to a device, an additional connection is shown in the Reydisp connection window, connections to the USB port are not shown when they are not connected.

The USB communication interface on the relay is labelled Com 2 and its associated settings are located in the Data communications menu. When connecting to Reydisp using this connection the default settings can be used without the need to first change any settings, otherwise the Com 2 port must be set to IEC60870-5-103 (the relay address and baud rate do not need to be set).

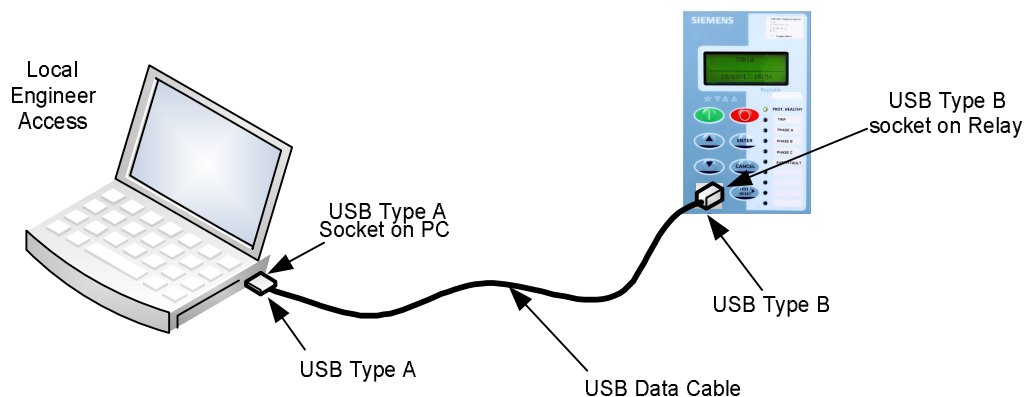


Figure 6-1 Communication to Front USB Port

To establish the connection between the Relay and Reydisp software, follow the procedure given below:

1. Click **Connect**.


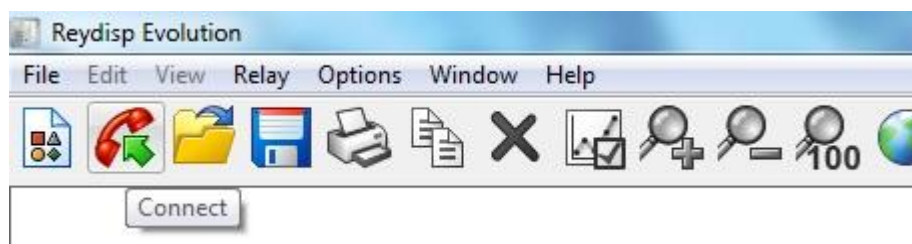


Figure 6-2 Connect Icon



2. Select **COM port** where the 7SR10 relay is connected.

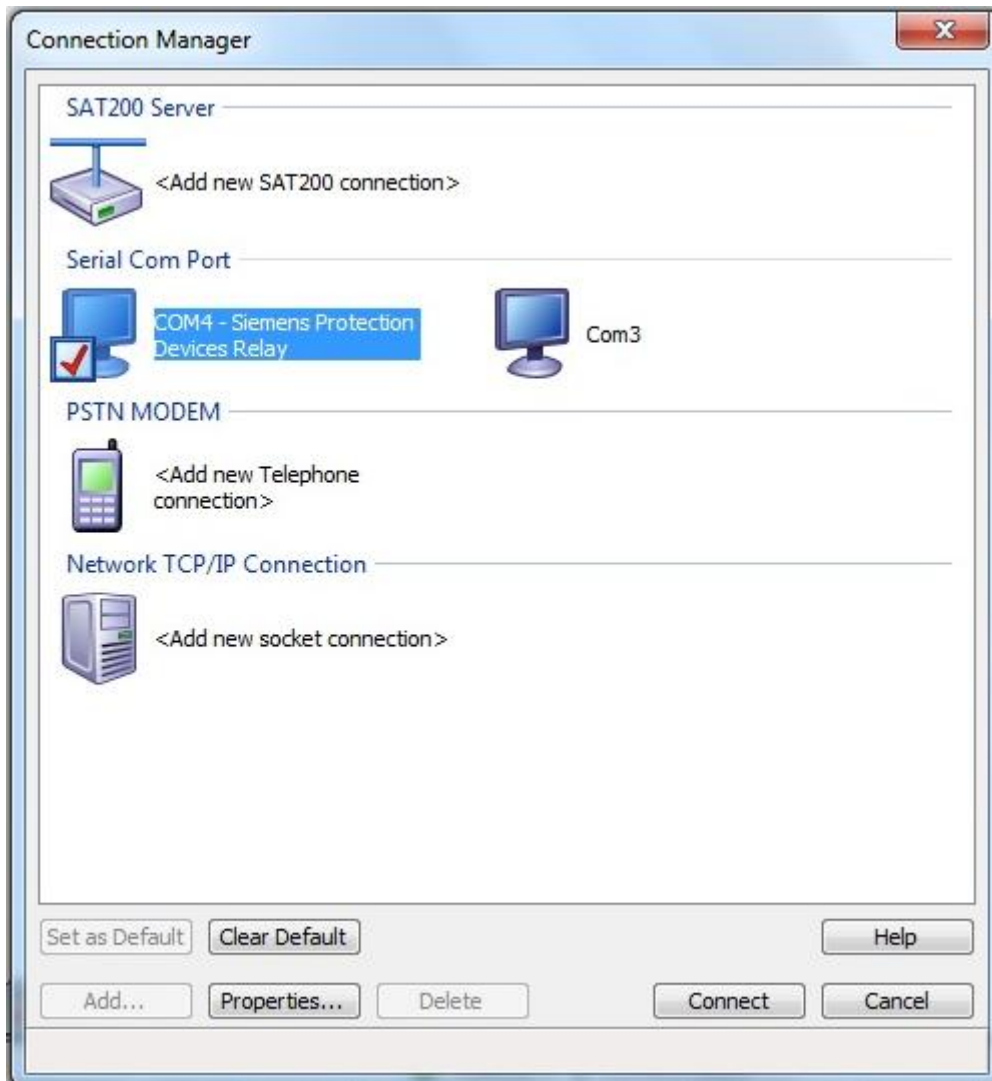

**Figure 6-3** Port Selection in Connection Manager

3. Select **System Information** icon.



**Figure 6-4** System Information Icon

4. Confirm the connection establishment with the Reydisp.

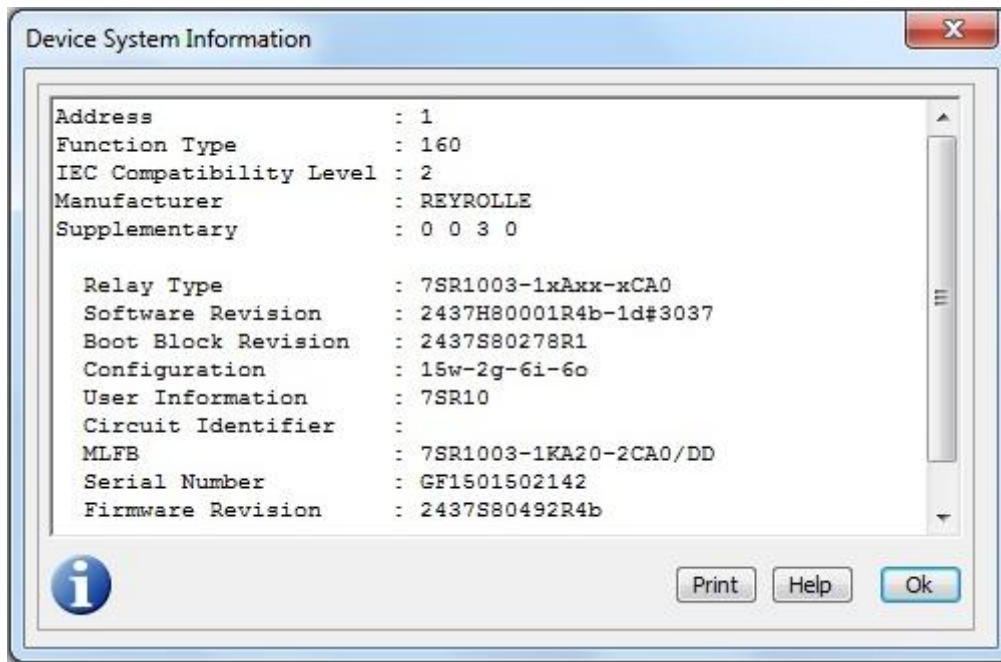


Figure 6-5 System Information Icon

#### NOTE

The Reysdisp and the relay will show only the standard MLFB information. For special variant (for example, ZY20), refer to the label information on the device.

#### 6.1.1.2 RS485 Interface

The RS485 communication port is located on the rear of the relay and can be connected using a suitable RS485 120 ohm screened twisted pair cable.

The RS485 electrical connection can be used in a single or multi-drop configuration. The RS485 master must support and use the Auto Device Enable (ADE) feature. The last device in the connection must be terminated correctly in accordance with the master device driving the connection. The relays are fitted with an internal terminating resistor which can be connected between A and B by fitting an external wire loop between terminals 18 and 20 on the power supply module.

The maximum number of relays that can be connected to the bus is 64.

The following settings must be configured via the relay fascia when using the RS485 interface. The shaded settings are only visible when DNP3.0 is selected.

Setting name	Range	Default	Setting	Notes
<b>Station Address</b>	0 ... 254 (IEC60870-5-103) 0 ... 247 (MODBUS) 0 ... 65534 (DNP3)	0	1...	An address must be given to identify the relay. Each relay must have a unique address.
<b>COM1-RS485 Protocol</b>	OFF, IEC60870-5-103, MODBUS-RTU, DNP3.0	IEC60870-5-103	As Required	Sets the protocol used to communicate on the RS485 connection.
<b>COM1-RS485 Baud Rate</b>	75 110 150 300 600 1200 2400 4800 9600 19200 38400	19200	As Required	The baud rate set on all of the relays connected to the same RS485 bus must be the same as the one set on the master device.

Setting name	Range	Default	Setting	Notes
<b>COM1-RS485 Parity</b>	NONE, ODD, EVEN	EVEN	As Required	The parity set on all of the relays connected to the same RS485 bus must be the same and in accordance with the master device.
<b>COM1-RS485 Mode</b>	Local, Remote, Local Or Remote	Remote	Remote	Selects whether the port is Local or Remote.
<b>Unsolicited Mode</b>	DISABLED ENABLED	DISABLED	As Required	Setting is only visible when COM1 Protocol is set to DNP3
<b>Destination Address</b>	0 ... 65534	0	As Required	Setting is only visible when COM1 Protocol is set to DNP3

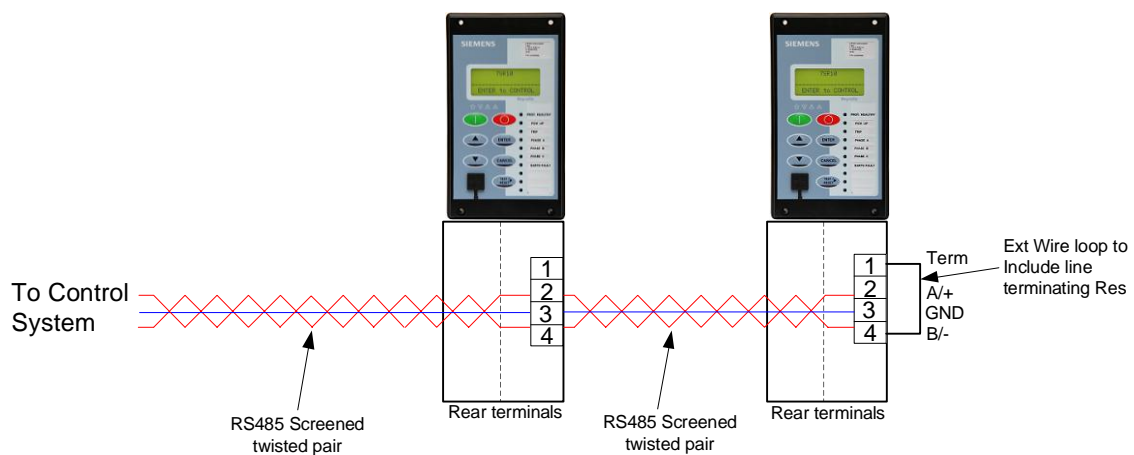


Figure 6-6 Communication to Multiple Devices from Control System using RS485

## 6.2 CB Maintenance

### 6.2.1 Output Matrix Test

The feature is only visible from the Relay fascia and allows the user to operate the relays functions. The test of the function will automatically operate any Binary Inputs or LED's already assigned to that function.

Any protection function which is enabled in the setting menu will appear in the Output Matrix Test.

### 6.2.2 CB Counters

The following CB maintenance counters are provided:

CB Total Trip Count:	Increments on each trip command issued.
CB Total Trip Manual Open	Selects whether the CB Total Trip Counter is incremented for Manual Open Operations. If disabled, the CB Total Counter will only increment for protection trip commands.
CB Delta Trip Count:	Additional counter which can be reset independently of the Total Trip Counter. This can be used, for example, for recording trip operations between visits to a substation.
CB Delta Trip Manual Open	Selects whether the CB Delta Trip Counter is incremented for Manual Open Operations. If disabled, the CB Delta Trip Counter will only increment for protection trip commands.
CB Count to AR Block: (Only in Auto-reclose models)	Displays the number of CB trips experienced by the CB before the AR is blocked. When the target is reached the

	relay will only do 1 Delayed Trip to Lockout. An output is available to reset this value.
CB Count to AR Block Manual Open: (Only in Auto-reclose models)	Selects whether the CB Count to AR Block is incremented for Manual Open Operations. If disabled, the CB Count to AR Block will only increment for protection trip commands.
CB Frequent Ops Count	Logs the number of trip operations in a rolling window period of one hour. An output is available to reset this counter.

Binary outputs can be mapped to each of the above counters, these outputs are energised when the user defined **Count Target** or **Alarm Limit** is reached.

### 6.2.3 I<sup>2</sup>t CB Wear

An I<sup>2</sup>t counter is also included and this can provide an estimation of contact wear and maintenance requirements. The algorithm works on a per phase basis, measuring the arcing current during faults. The I<sup>2</sup>t value at the time of trip is added to the previously stored value and an alarm is given when any one of the three phase running counts exceeds the set **Alarm limit**. The t value is the time between CB contacts separation when an arc is formed, **Separation Time**, and the CB **Clearance time**.

The I<sup>2</sup>t value can also triggered and reset from a binary input or command.

## 6.3 Data Storage

### 6.3.1 General

The relay stores three types of data- relay event records, analogue/digital waveform records, and fault records. Data records are backed up in non-volatile memory and are permanently stored even in the event of loss of auxiliary supply voltage. The data storage menu contains the settings for the Demand, Waveform, and Fault storage features.

#### NOTE

ZY20 - The user selectable language parameter will be available in Turkish, while the default data like events and waveform recorder will be available in English.

### 6.3.2 Demand

Maximum, minimum and mean values of line currents, voltages and power (where applicable) are available as instruments which can be read in the relay INSTRUMENTS MENU or via Reydisp.

The **Gn Demand Window** setting defines the maximum period of time over which the demand values are valid. A new set of demand values is established after expiry of the set time.

The **Gn Demand Window Type** can be set to **FIXED** or **PEAK** or **ROLLING**.

When set to **FIXED** the maximum, minimum and mean values demand statistics are calculated over fixed Window duration. At the end of each window the internal statistics are reset and a new window is started.

When set to **PEAK** the maximum and minimum values since the feature was reset are recorded.

When set to **ROLLING** the maximum, minimum and mean values demand statistics are calculated over a moving Window duration. The internal statistics are updated when the window advances every **Updated Period**.

The statistics can be reset from a binary input or communication command, after a reset the update period and window are immediately restarted.

### 6.3.3 Event Records

The event recorder feature allows the time tagging of any change of state (Event) in the relay. As an event occurs, the actual event condition is logged as a record along with a time and date stamp to a resolution of 1 ms. There is capacity for a maximum of 1000 event records that can be stored in the relay and when the event buffer is full any new record will over-write the oldest. Stored events can be erased using the **DATA STORAGE > Clear Events** setting or from Reydisp.

The following events are logged:

- Change of state of Binary outputs

- Change of state of Binary inputs
- Change of settings and settings group
- Change of state of any of the control functions of the relay
- Protection element operation

All events can be uploaded over the data communications channel(s) and can be displayed in the 'Reydisp' package in chronological order allowing the sequence of events to be viewed. Events can be selected to be made available spontaneously to an IEC 60870-5-103, Modbus RTU, or DNP 3.0 compliant control system. The function number and event number can also be changed. The events are selected and edited using the Reydisp software tool.

### 6.3.4 Waveform Records

Relay waveform storage can be triggered either by user selecting the relay operations from the relay fascia from a suitably programmed binary input or via the data communications channel(s). The stored analogue and digital waveforms illustrates the system and relay conditions at the time of trigger. An output is provided to indicate when a new record has been stored.

A waveform can also be stored from the fascia using the **DATA STORAGE/Waveform Storage > Trigger Waveform** setting.

In total, the relay provides 15 s of waveform storage; this is user selectable to 15 Rec x 1 Sec, 7 Rec x 2 Sec, 3 Rec x 5 Sec, 1 Rec x 15 Sec records. When the waveform recorder buffer is full any new waveform record will over-write the oldest. The most recent record is Waveform 1.

As well as defining the stored waveform record duration, the user can select the percentage of the waveform storage prior to triggering.

Waveforms are sampled at a rate of 1600 Hz.

Stored waveforms can be erased using the **DATA STORAGE > Clear Waveforms** setting or from Reydisp.

### 6.3.5 Fault Records

Up to fifteen fault records can be stored and displayed on the Fascia LCD. Fault records can be triggered by user selected via relay operations or via a suitably programmed binary input. An output is provided to indicate when a new record has been stored.

Fault records provide a summary of the relay status at the time of trip, i.e. the element that issued the trip, any elements that were picked up, the fault type, LED indications, date and time. The **Max Fault Rec. Time** setting sets the time period from fault trigger during which the operation of any LEDs is recorded.

The relay can be set to automatically display the fault record on the LCD when a fault occurs by enabling the **SYSTEM CONFIG > Trip Alert** setting. When the trip alert is enabled the fault record will be displayed until the fault is removed.

When examined together the event records and the fault records will detail the full sequence of events leading to a trip.

Fault records are stored in a rolling buffer, with the oldest faults overwritten. The fault storage can be cleared with the **DATA STORAGE > Clear Faults** setting or from Reydisp.

### 6.3.6 Disk Activity Warning

The Data Storage facilities offered by the Relay involve archiving a huge amount of data to non-volatile memory. Since such functionality is always secondary to the Protection functionality offered by the Relay, this means that data transfers can take significant amounts of time; perhaps several minutes. If the Relay is power-cycled during a storage cycle, some of the data will be lost. For this reason, the Relay can provide a visual warning (at the top-right position of the LCD) that data storage is taking place:

The 'œ' disk symbol shows that the copying of Events, Waveform Records or Fault Records, to non volatile disk storage, is currently in progress.

Whether this symbol is displayed or not is set by the **SYS CONFIG > Disk Activity Symbol** setting.

To avoid such data archiving causing a sluggish response of the HMI during Testing or Commissioning – when a considerable number of new Data records are likely to be created – it is possible to temporarily suspend it. The duration of this block is set by the **SYS CONFIG > Archiver Blocking Time** setting. Once this Time has elapsed, the block is removed and all stored data will be archived as usual.

The 'A' symbol at the top-right position of the LCD indicates that new Events, Waveform Records or Fault Records are currently being held in volatile RAM and the archiving, to non-volatile flash disk storage, is being temporarily blocked.

## 6.4 Metering

The metering feature provides real-time data available from the relay fascia in the 'Instruments Mode' or via the data communications interface.

The primary values are calculated using the CT ratios set in the **CT/VT Config** menu.

The text displayed in the relays 'Instruments Mode' associated with each value can be changed from the default text using the Reydisp software tool.

The user can add the meters that are most commonly viewed to a 'Favourites' window by pressing 'ENTER' key when viewing a meter. The relay will scroll through these meters at an interval set in the **System Config/ Favourite Meters Timer** menu.

## 6.5 Operating Mode

The relay has three operating modes - Local, Remote, and Out of Service. The following table identifies the functions operation in each mode.

The modes can be selected by the following methods:

**SYSTEM CONFIG > OPERATING MODE** setting, a Binary Input or Command

Table 6-1      Operation Mode

OPERATION	REMOTE MODE	LOCAL MODE	SERVICE MODE
<b>Control</b>			
Rear Ports	Enabled	Disabled	Disabled
Fascia (Control Mode)	Disabled	Enabled	Disabled
USB	Disabled	Enabled	Disabled
Binary Inputs	Setting Option	Setting Option	Disabled
Binary Outputs	Enabled	Enabled	Disabled
<b>Reporting</b>			
Spontaneous			
IEC	Enabled	Enabled	Disabled
DNP	Enabled	Enabled	Disabled
General Interrogation			
IEC	Enabled	Enabled	Disabled
DNP	Enabled	Enabled	Disabled
MODBUS	Enabled	Enabled	Enabled
<b>Changing of Settings</b>			
Rear Ports	Enabled	Disabled	Enabled
Fascia	Enabled	Enabled	Enabled
USB	Disabled	Enabled	Enabled
<b>Historical Information</b>			
Waveform Records	Enabled	Enabled	Enabled
Event Records	Enabled	Enabled	Enabled
Fault Information	Enabled	Enabled	Enabled
Setting Information	Enabled	Enabled	Enabled

## 6.6 Control Mode

This mode provides convenient access to commonly used relay control and test functions. When any of the items listed in the control menu are selected control is initiated by pressing the **ENTER** key. The user is prompted to confirm the action, again by pressing the **ENTER** key, before the command is executed.

Note that a CB must be in a Closed state before an Open command will be accepted. And that a CB must be in an Open state before a Close command will be accepted. If not, the Relay reports that the requested command is 'Interlocked'.

Note also that switching a protection function IN/OUT via the Control Menu will not change that function's ENABLED/DISABLED setting. The Control Menu selection will over-ride the setting, however.

Control Mode commands are password protected using the Control Password function, see [Section 6.9](#).

## 6.7 Real Time Clock

Time and date can be set either via the relay fascia using appropriate commands in the System Config menu or via the data communications channel(s). Time and date are maintained while the relay is de-energised by a back up storage capacitor. The length of time for which this data will be maintained will depend on such things as temperature, length of time in service, etc. However the data will be maintained for a minimum of 1.0 day.

In order to maintain synchronism within a substation, the relay can be synchronised to the nearest second or minute using the communications interface, or a binary input.

The devices without an external synchronization can have a maximum drift of  $\pm 2$  s/day. The following attribute is applicable only when no synchronization signal (e.g. IEC 60870-5-103) is received.

Attribute	Value
Accuracy (-10 °C to 60°C)	$\pm 60$ p.p.m

The default date is set at 01/01/2000 deliberately to indicate the date has not yet been set. When editing the **Time**, only the hours and minutes can be edited. When the user presses **ENTER** after editing the seconds are zeroed and the clock begins running.

### 6.7.1 Time Synchronisation – Data Communication Interface

Where the data communications channel(s) is connected the relay can be directly time synchronised using the global time synchronisation. This can be from a dedicated substation automation system or from 'Reydisp Evolution' communications support software.

### 6.7.2 Time Synchronisation – Binary Input

A binary input can be mapped **Clock Sync from BI**. The seconds or minutes will be rounded up or down to the nearest value when the BI is energised. This input is leading edge triggered.

## 6.8 Settings Groups

The relay provides four groups of settings – Group number (Gn) 1 to 2. At any one time, only one group of settings can be 'active' – **SYSTEM CONFIG > Active Group** setting.

It is possible to edit one group while the relay operates in accordance with settings from another 'active' group using the **View/Edit Group** setting.

Some settings are independent of the active group setting i.e. they apply to all settings groups. This is indicated on the top line of the relay LCD, where only the **Active Group No.** is identified. Where settings are group dependent this is indicated on the top line of the LCD by both the **Active Group No.** and the **View Group No.** being displayed.

A change of settings group can be achieved both locally at the relay fascia and remotely over the data communications channel(s) or via a binary input. When using a binary input an alternative settings group is selected only whilst the input is energised (**Select Grp Mode: Level triggered**) or latches into the selected group after energisation of the input (**Select Grp Mode: Edge triggered**).

Settings are stored in a non-volatile memory.

## 6.9 Password Feature

The relay incorporates two levels of password protection - one for settings, the other for control functions.

The programmable password feature enables the user to enter a 4 character alpha-numeric code to secure access to the relay functions. The relay is supplied with the passwords set to **NONE**, i.e. the password feature is disabled. The password must be entered twice as a security measure against the accidental changes. Once a password has been entered then it will be required thereafter to change settings or initiate control commands. Passwords can be de-activated by using the password to gain access and by entering the password **NONE**. Again this must be entered twice to deactivate the security system.

As soon as the user attempts to change a setting or initiate control the password is requested before any changes are allowed. Once the password has been validated, the user is 'logged on' and any further changes can be made without re-entering the password. If no more changes are made within 1 hour then the user will automatically be 'logged off', re-enabling the password feature.



The Settings Password prevents unauthorised changes to settings from the front fascia or over the data communications channel(s). The Control Password prevents unauthorised operation of controls in the relay Control Menu from the front fascia.

The password validation screen also displays a numerical code. If the password is lost or forgotten, this code should be communicated to Siemens Limited and the password can be retrieved.

**NOTE:**

The default control password is "AAAA". It is recommended to change the default password after the final configuration.

# 7SR10

Settings and Instruments

## Document Release History

This document is issue 2017/07. The list of revisions up to and including this issue is:

2013/11	First Issue
2015/02	Second Issue
2015/03	Third Issue
2015/06	Fourth Issue
2015/09	Fifth Issue
2016/11	Sixth Issue
2017/03	Seventh Issue
2017/04	Eighth Issue
2017/07	Nineth Issue

## Software Revision History

2013/11	2436H80015 R2d-1a	First Release
2015/02	2437H80001 R4b-1d	Second Release
2015/03	2437H80001 R4b-1e	Third Release
2015/06	2437H80001 R4b-1f	Fourth Release
2015/09	2437H80001 R4b-2a	Fifth Release
2016/11	2437H80001 R4b-2b	Sixth Release
2017/04	2437H80001 R4c-2b	Seventh Release

## Contents

Section 1: Introduction .....	4
1.1 Relay Menus And Display .....	4
1.2 Operation Guide .....	6
1.2.1 User Interface Operation .....	6
1.3 Setting Mode .....	7
1.4 Instruments Mode .....	8
1.5 Fault Data Mode .....	11
Section 2: Setting & Configuring the Relay Using Reydisp Evolution .....	12
2.1 Physical Connection .....	12
2.1.1 Front USB connection .....	12
2.1.2 Rear RS485 connection .....	12
2.1.3 Configuring Relay Serial Data Communication .....	13
2.1.4 Connecting to the Relay for setting via Reydisp .....	14
2.1.5 Configuring the user texts using Reydisp Language Editor .....	15

---

## List of Figures

Figure 1.1-1 Menu .....	4
Figure 2.1-1 USB connection to PC.....	12
Figure 2.1-2 RS485 connection to PC.....	12
Figure 2.1-3 PC Comm Port Selection.....	14
Figure 2.1-4 PC Language File Editor.....	15

## Section 1: Introduction

### 1.1 Relay Menu And Display

All relay fascias have the same appearance and support the same access keys. The basic menu structure is also the same in all products and consists of four main menus, these being,

**Settings Mode** - allows the user to view and (if allowed via passwords) change settings in the relay.

**Instruments Mode** - allows the user to see the conditions that the relay is experiencing i.e. current.

**Fault Data Mode** - allows the user to see type and data of any fault that the relay has detected.

**Control Mode** - allows the user to control external plant under the relays control for example the CB

All menus may be viewed without entering a password but actions will not be permitted if the relevant passwords have been set.

The menus can be viewed via the LCD by pressing the access keys as below,

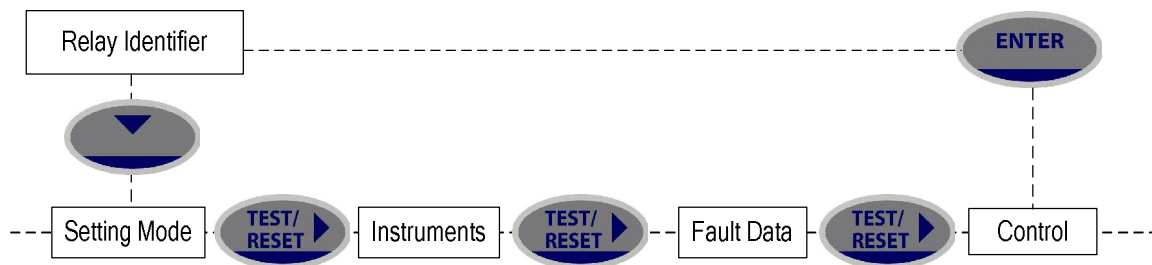


Figure 1.1-1 Menu

Pressing CANCEL returns to the Identifier screen

This document describes the text descriptions as they appear in the menu structure when the relay is using the default files. The user can programme the relay to use alternative text descriptions by installing user language files through the Reydisp Evolution software language configuration tool – see 2.1.5



Figure 1.1-3 Fascia of a 7SR10 relay (Size 4 Case)


## 1.2 Operation Guide

### 1.2.1 User Interface Operation

The basic menu structure flow diagram is shown in Figure 1.2-2. This diagram shows the main modes of display: Settings Mode, Instrument Mode, Fault Data Mode and Control Mode.

When the relay leaves the factory all data storage areas are cleared and the settings set to default as specified in settings document.

When the relay is first energised the user is presented with the following, or similar, message:-

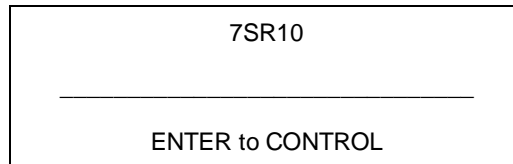

**Figure 1.2-1 Relay Identifier Screen**

On the factory default setup the relay LCD should display the relay identifier, on each subsequent power-on the screen that was showing before the last power-off will be displayed.

The push-buttons on the fascia are used to display and edit the relay settings via the LCD, to display and activate the control segment of the relay, to display the relays instrumentation and Fault data and to reset the output relays and LED's.

The five push-buttons have the following functions:



Used to navigate the menu structure.



The ENTER push-button is used to initiate and accept setting changes.

When a setting is displayed pressing the ENTER key will enter the edit mode, the setting will flash and can now be changed using the ▲ or ▼ buttons. When the required value is displayed the ENTER button is pressed again to accept the change.

When an instrument is displayed pressing ENTER will toggle the instruments favourite screen status.



This push-button is used to return the relay display to its initial status or one level up in the menu structure. Pressed repeatedly will return to the Relay Identifier screen. It is also used to reject any alterations to a setting while in the edit mode.



This push-button is used to reset the fault indication on the fascia. When on the Relay Identifier screen it also acts as a lamp test button, when pressed all LEDs will momentarily light up to indicate their correct operation. It also moves the cursor right ► when navigating through menus and settings.

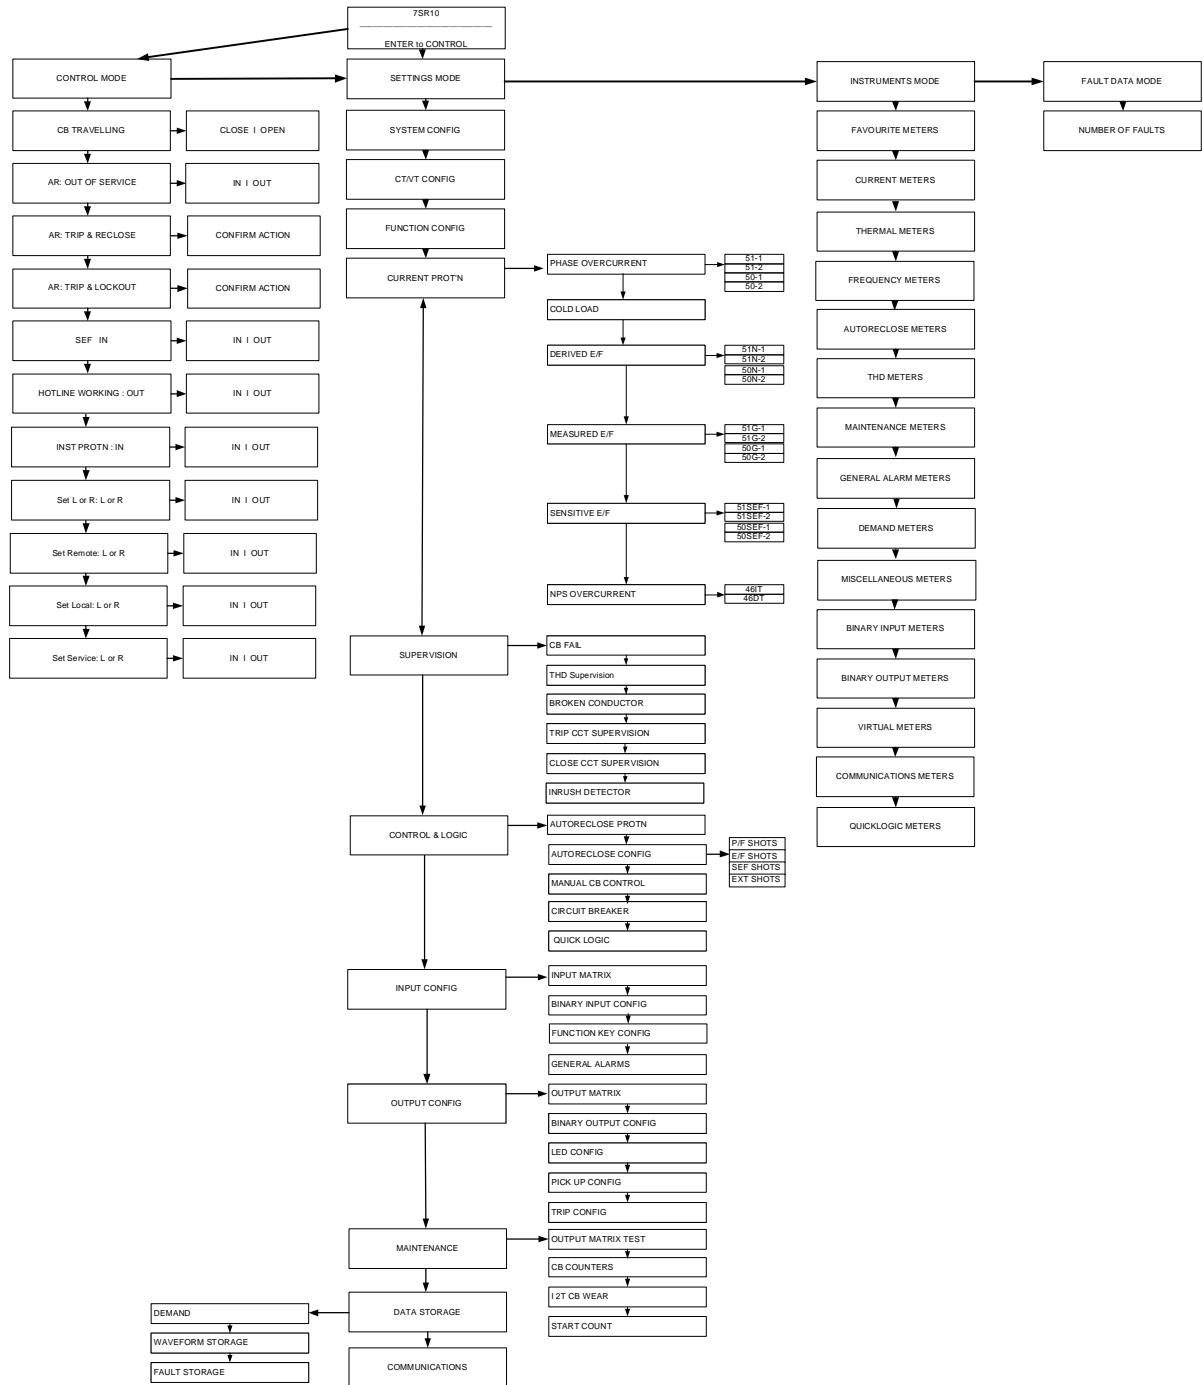


Figure 1.2-2 Menu Structure

### 1.3 Setting Mode

The Settings Mode is reached by pressing the READ DOWN ▼ button from the relay identifier screen.

Once the Settings Mode title screen has been located pressing the READ DOWN ▼ button takes the user into the Settings mode sub-menus.

Each sub-menu contains the programmable settings of the relay in separate logical groups. The sub menus are accessed by pressing the TEST/RESET ► button. Pressing the ▼ button will scroll through the settings, after the last setting in each sub menu is reached the next sub menu will be displayed. If a particular sub menu is not required to be viewed then pressing ▼ will move directly to the next one in the list.



While a setting is being displayed on the screen the ENTER button can be pressed to edit the setting value. If the relay is setting password protected the user will be asked to enter the password. If an incorrect password is entered editing will not be permitted. All screens can be viewed if the password is not known.

While a setting is being edited flashing characters indicate the edit field. Pressing the ▲ or ▼ buttons will scroll through the valid field values. If these buttons are held on, the rate of scrolling will increase.

Once editing is complete pressing the ENTER button stores the new setting into the non-volatile memory.

The actual setting ranges and default values for each relay model can be found in the appendix to this manual.

## 1.4 Instruments Mode

The Instrument Mode sub-menu displays key quantities and information to aid with commissioning. The following meters are available and are navigated around by using the ▲, ▼ and TEST/RESET buttons. The text description shown here is the default information. Depending upon the relay model you have, you may not have all of the meters shown.

Instrument	Description
<b>FAVOURITE METERS</b> →to view	<p>This allows the user to view his previously constructed list of 'favourite meters' by pressing TEST/RESET ► button and the READ DOWN button to scroll through the meters added to this sub-group</p> <p>To construct a sub-group of favourite meters, first go to the desired meter then press ENTER this will cause a message to appear on the LCD 'Add To Favourites YES' pressing ENTER again will add this to the FAVOURITE METERS Sub-menu. To remove a meter from the FAVOURITE METERS sub-menu go to that meter each in the FAVOURITE METERS sub-menu or at its Primary location press ENTER and the message 'Remove From Favourites' will appear press ENTER again and this meter will be removed from the FAVOURITE METERS sub-group</p>
<b>CURRENT METERS</b> →to view	<p>This is the sub-group that includes all the meters that are associated with Current TEST/RESET ► allows access to this sub-group</p>
<b>Primary Current</b> Ia                    0.00A Ib                    0.00A Ic                    0.00A	<p>Displays the 3 phase currents Primary RMS values</p>
<b>Secondary Current</b> Ia                    0.00A Ib                    0.00A Ic                    0.00A	<p>Displays the 3 phase currents Secondary RMS values</p>
<b>Nom Current</b> Ia                    0.00xIn ---° Ib                    0.00xIn ---° Ic                    0.00xIn ---°	<p>Displays the 3 Phase currents Nominal RMS values &amp; phase angles with respect to PPS voltage.</p>
<b>Pri Earth Current</b> In                    0.00A Ig                    0.00A	<p>Displays the 3 Earth currents Primary RMS values</p>
<b>Sec Earth Current</b> In                    0.00A Ig                    0.00A	<p>Displays the 3 Earth currents Secondary RMS values</p>
<b>Nom Earth Current</b> In                    0.00xIn ---° Ig                    0.00xIn ---°	<p>Displays the 3 Earth currents Nominal RMS values &amp; phase angles with respect to PPS voltage.</p>
<b>I Seq Components</b> Izps                0.00xIn --° Ipps                0.00xIn --° Inps                0.00xIn --°	<p>Displays the Current Sequence components Nominal RMS values &amp; phase angles with respect to PPS voltage.</p>

Instrument	Description
2nd Harmonic Current Ia 0.00xIn Ib 0.00xIn Ic 0.00xIn	Displays the Second Harmonic Current.
Last Trip P/F Ia 0.00A Ib 0.00A Ic 0.00A	Displays the Last Trip Fault Current..
Last Trip E/F In 0.00A Ig 0.00A	Displays the Last Trip Fault Current.
<b>THD METERS</b> Total Harmonic Dist. Ia THD 0.0% Ib THD 0.0% Ic THD 0.0%	This displays the percentage of 2 <sup>nd</sup> to 15 <sup>th</sup> harmonics current present in the fundamental frequency current.
<b>FREQUENCY METERS</b> →to view	This is the sub-group that includes all the meters that are associated with Thermal TEST/RESET ► allows access to this sub-group
Frequency 0.000Hz Last Trip 0.000Hz	Displays the frequency
<b>AUTORECLOSE METERS</b> →to view	This is the sub-group that includes all the meters that are associated with Autoreclose TEST/RESET ► allows access to this sub-group. Only seen on models that have the 79 option
Autoreclose Status 79 AR State AR Close Shot 0	
<b>MAINTENANCE METERS</b> →to view	This is the sub-group that includes all the meters that are associated with Maintenance TEST/RESET ► allows access to this sub-group
CB Total Trips Count 0 Target 100	Displays the number of CB trips experienced by the CB
CB Delta Trips Count 0 Target 100	Displays the number of CB trips experienced by the CB
CB Count To AR Block Count 0 Target 100	Displays the number of CB trips experienced by the CB. When the target is reached the relay will only do 1 Delayed Trip to Lockout.
CB Freq Ops Count Count 0 Target 10	Displays the number of CB trips experienced by the CB over the last rolling 1 hr period. When the target is reached the relay will only do 1 Delayed Trip to Lockout.
CB Wear Phase A 0.00MA^2s Phase B 0.00MA^2s Phase C 0.00MA^2s	Displays the current measure of circuit breaker wear.
CB Trip Time Time 0.0ms	Displays the circuit breaker trip time to open time. Measured from CB auxiliary contacts.
<b>GENERAL ALARM METERS</b> →to view	This is the sub-group that includes all the meters that are associated with the Binary inputs TEST/RESET ► allows access to this sub-group
General Alarms ALARM 1 Cleared	Displays the state of General Alarm

Instrument	Description
General Alarms ALARM 2                      Cleared	
General Alarms ALARM 3                      Cleared	
General Alarms ALARM 4                      Cleared	
General Alarms ALARM 5                      Cleared	
General Alarms ALARM 6                      Cleared	
<b>DEMAND METERS</b>  →to view	This is the sub-group that includes all the meters that are associated with DEMAND. TEST/RESET ► allows access to this sub-group
I Phase A Demand Max                              0.00A Min                                0.00A Mean                              0.00A	Displays the Current demand based on Ia.
I Phase B Demand Max                              0.00A Min                                0.00A Mean                              0.00A	Displays the Current demand based on Ib.
I Phase C Demand Max                              0.00A Min                                0.00A Mean                              0.00A	Displays the Current demand based on Ic.
<b>MISCELLANEOUS METERS</b>  →to view	This is the sub-group that includes indication such as the relays time and date, the amount of fault and waveform records stored in the relay TEST/RESET ► allows access to this sub-group
Start Alarm Count                              0 Target                              100	Count of configurable type of Relay starts
Date                                01/01/2000 Time                                22:41:44 Waveform Recs                      0 Fault Recs                            0 Event Recs                            0 Data Log Recs                        0 Setting Group                        1	This meter displays the date and time and the number of Fault records and Event records stored in the relay
<b>BINARY INPUT METERS</b>  →to view	This is the sub-group that includes all the meters that are associated with the Binary inputs TEST/RESET ► allows access to this sub-group
BI 1-6                              ---- --	Displays the state of DC binary inputs 1 to 6 (The number of binary inputs may vary depending on model)
<b>BINARY OUTPUT METERS</b>  →to view	This is the sub-group that includes all the meters that are associated with the Binary Outputs TEST/RESET ► allows access to this sub-group
BO 1-6                              ---- ----	Displays the state of DC binary Outputs 1 to 8. (The number of binary outputs may vary depending on model)
<b>VIRTUAL METERS</b>  →to view	This is the sub-group that shows the state of the virtual status inputs in the relay TEST/RESET ► allows access to this sub-group
V 1-8                                ---- ----	Displays the state of Virtual Outputs 1 to 8 (The number of virtual inputs will vary depending on model)
<b>COMMUNICATION METERS</b>	This is the sub-group that includes all the meters that are

Instrument	Description
→to view	associated with Communications ports TEST/RESET ► allows access to this sub-group
COM1 COM2	X Displays which com ports are currently active
COM1 TRAFFIC COM1 Tx1 COM1 Rx1 Error COM1 Rx1	0 0 0 Displays data traffic on Communications Port 1
COM2 TRAFFIC COM2 Tx1 COM2 Rx1 Error COM2 Rx1	0 0 0 Displays data traffic on Communications Port 2
<b>QUICK LOGIC METERS</b> →to view	This is the sub-group that includes all the meters that are associated with QuickLogic Equations TEST/RESET ► allows access to this sub-group
E 1-4	----
E1 Equation EQN TMR CNT	=0 0-0 0-1 =0 =0 =0
E2 Equation EQN TMR CNT	=0 0-0 0-1 =0 =0 =0
E3 Equation EQN TMR CNT	=0 0-0 0-1 =0 =0 =0
E4 Equation EQN TMR CNT	=0 0-0 0-1 =0 =0 =0

## 1.5 Fault Data Mode

The Fault Data Mode sub menu lists the time and date of the previous ten protection operations. The stored data about each fault can be viewed by pressing the TEST/RESET► button. Each record contains data on the operated elements, analogue values and LED flag states at the time of the fault. The data is viewed by scrolling down using the ▼ button.

## Section 2: Setting & Configuring the Relay Using Reydisp Evolution

To set the relay using a communication port the user will need the following:-

PC with Reydisp Evolution Version 7.1.5.6 or later Installed. (This can be downloaded from our website and found under the submenu 'Software') This software requires windows 2000-service pack 4 or above, or windows XP with service pack 2 or above and Microsoft.NET framework for tools.

### 2.1 Physical Connection

The relay can be connected to Reydisp via any of the communication ports on the relay. Suitable communication Interface cable and converters are required depending which port is being used.

#### 2.1.1 Front USB connection

To connect your pc locally via the front USB port.

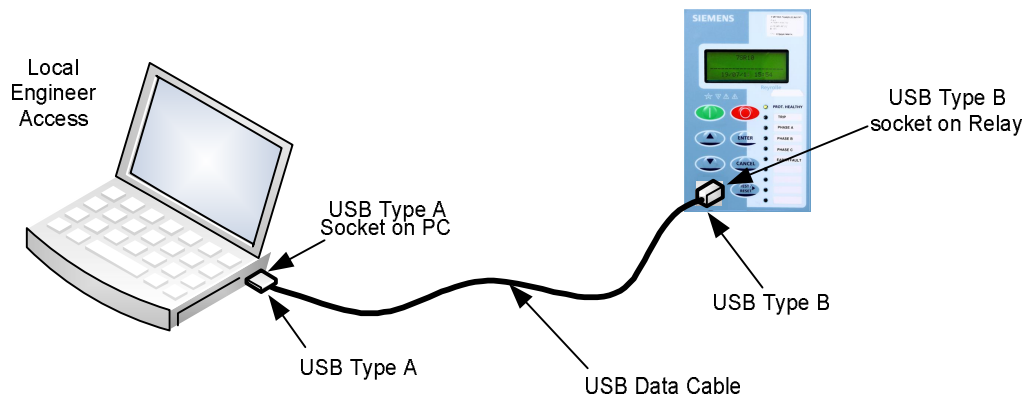


Figure 2.1-1 USB connection to PC

#### 2.1.2 Rear RS485 connection

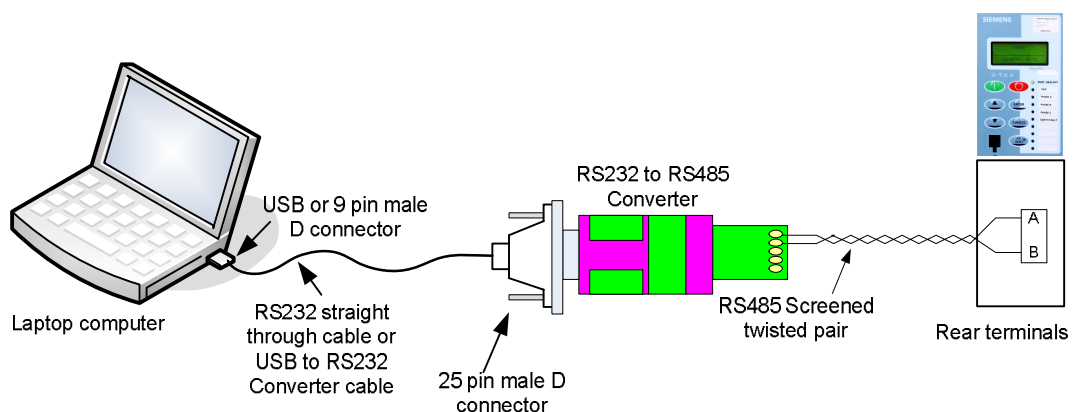


Figure 2.1-2 RS485 connection to PC

### 2.1.3 Configuring Relay Serial Data Communication

Using the keys on the relay fascia scroll down the settings menus into the 'communications' menu and if necessary change the settings for the communication port you are using on the relay. Reydisp software uses IEC60870-5-103 protocol to communicate.

When connecting the relay to a pc using the front USB port, the Reydisp setting software will automatically detect the relay without making any setting changes in the relay first as long as the USB is selected to IEC60870-5-103.


#### COM1-RS485 Port and COM2-USB Port

Description	Range	Default	Notes
COM1-RS485 Protocol <i>Selects protocol to use for COM1-RS485</i>	OFF, IEC60870-5-103, MODBUS-RTU, DNP3	IEC60870-5-103	
COM1-RS485 Station Address <i>IEC 60870-5-103 Station Address</i>	0, 1 ... 65533, 65534	0	Address given to relay to identify that relay from others which may be using the same path for communication as other relays for example in a fibre optic hub
COM1-RS485 Baud Rate <i>Sets the communications baud rate for COM1-RS485</i>	75, 110, 150, 300, 600, 1200, 2400, 4800, 9600, 19200, 38400	19200	19200
COM1-RS485 Parity <i>Selects whether parity information is used</i>	NONE, ODD, EVEN	EVEN	EVEN
COM1-RS485 Mode <i>Selects whether the port is Local or Remote.</i>	Local, Remote, Local Or Remote	Remote	Remote
COM2-USB Protocol <i>Selects protocol to use for COM2-USB</i>	OFF, DNP3, ASCII, MODBUS-RTU, IEC60870-5-103	IEC60870-5-103	
COM2-USB Station Address <i>IEC 60870-5-103 Station Address</i>	0, 1 ... 65533, 65534	0	Address given to relay to identify it for connection to the USB front port
COM2-USB Mode <i>Selects whether the port is Local or Remote.</i>	Local, Remote, Local Or Remote	Local	Local
DNP3 Unsolicited Events <i>Allows unsolicited event support in the relay. When Enabled, unsolicited event transmission can be controlled by the Master. When Disabled, Master requests are ignored.</i>	Disabled, Enabled	Disabled	Disabled
DNP3 Destination Address <i>The address of the master to which unsolicited events will be sent.</i>	0, 1 ... 65533, 65534	0	This setting is only visible when DNP3 Unsolicited Events is Enabled
DNP3 Application Timeout	5, 6 ... 299, 300	10s	10s

## 2.1.4 Connecting to the Relay for setting via Reydisp

When Reydisp software is running all available communication ports will automatically be detected. On the start page tool bar open up the sub-menu 'File' and select 'Connect'.

The 'Connection Manager' window will display all available communication ports. With the preferred port highlighted select the 'Properties' option and ensure the baud rate and parity match that selected in the relay settings. Select 'Connect' to initiate the relay-PC connection.

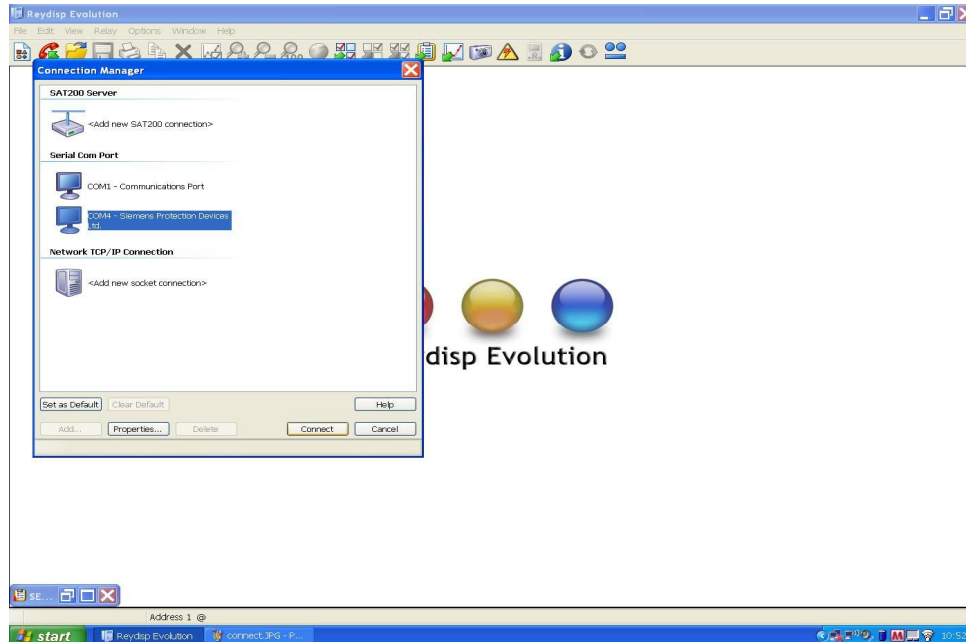

**Figure 2.1-3 PC Comm Port Selection**

The relay settings can now be configured using the Reydisp software. Please refer to the Reydisp Evolution Manual for further guidance.

## 2.1.5 Configuring the user texts using Reydisp Language Editor

As default the relay uses the text descriptions in all menus as they appear in this manual. These descriptions can be changed by installing a user language file in the relay, allowing the user to edit all views to meet their needs and provide easier operation.

The Reyrolle Language File Editor tool and its user manual are installed as part of the Reydisp Evolution software package. They can be found in your pc as sub menus of the Reydisp Evolution installation.

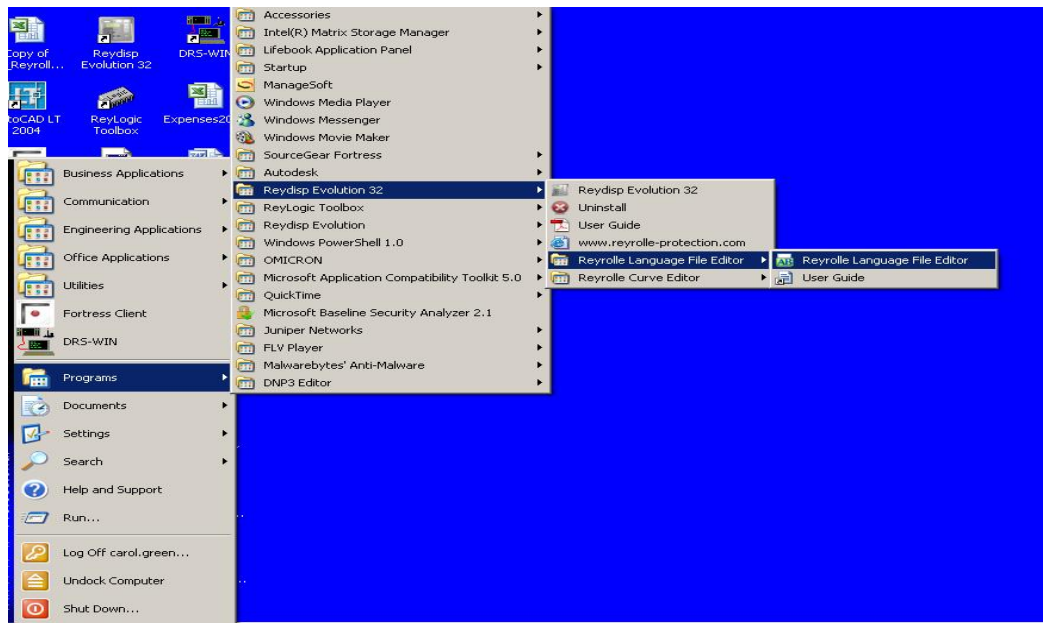


Figure 2.1-4 PC Language File Editor

When the software is opened a 'new project from template' should be used to generate your file. The file will display all default 'Original' text descriptions in one column and the 'Alternative' text in the other column. The descriptions in the 'Alternative' list can be changed and will be used in the relays menu structures. Once the file is complete, a language file can be created and loaded into the relay using the 'send file to relay' function. The communication properties in the software and on the relay must be set. The relay must be restarted after the file is installed.

To activate the language file it must be selected in the relay configuration menu, the 'Original' file is the file labelled 'ENGLISH' and the new file will be displayed using the file name allocated by the user.

Care should be taken to ensure a unique file name is given including a version control reference. The user will be prompted to restart the relay to activate the language file.

Please refer to the Language Editor Manual for further guidance.



# 7SR10

Performance Specification

## Document Release History

This document is issue 2017/07. The list of revisions up to and including this issue is:

2013/11	First Issue
2015/02	Second Issue
2015/03	Third Issue
2015/06	Fourth Issue
2015/09	Fifth Issue
2016/11	Sixth Issue
2017/03	Seventh Issue
2017/04	Eighth Issue
2017/07	Nineth Issue

## Software Revision History

2013/11	2436H80015 R2d-1a	First Release
2015/02	2437H80001 R4b-1d	Second Release
2015/03	2437H80001 R4b-1e	Third Release
2015/06	2437H80001 R4b-1f	Fourth Release
2015/09	2437H80001 R4b-2a	Fifth Release
2016/11	2437H80001 R4b-2b	Sixth Release
2017/04	2437H80001 R4c-2b	Seventh Release

## Contents

Section 1: Performance Specification .....	3
1.1 Indication of Conformity .....	3
1.2 Technical Specifications.....	3
1.3 Environmental Performance.....	7
1.4 Performance Specification .....	12

## List of Tables

Table 1-1	Technical Data Overview .....	3
Table 1-2	Mechanical Specifications.....	3
Table 1-3	Terminal Blocks with Push Buttons .....	4
Table 1-4	Current Inputs .....	4
Table 1-5	Auxiliary Supply.....	4
Table 1-6	Auxiliary Supply.....	5
Table 1-8	DC Performance .....	5
Table 1-9	Binary Outputs .....	5
Table 1-10	Rear Communication Port.....	6
Table 1-12	Data Storage.....	6
Table 1-13	Mechanical Tests .....	7
Table 1-14	Electrical Tests.....	7
Table 1-15	Safety Tests.....	9
Table 1-16	Auxiliary Supply Variation .....	9
Table 1-17	Environmental Test .....	9
Table 1-18	Product Safety Test.....	10
Table 1-19	46 Negative Phase Sequence Overcurrent.....	12
Table 1-20	49 Thermal Overload.....	12
Table 1-21	50 Instantaneous & DTL OC & EF .....	12
Table 1-22	81HBL2 Inrush Detector .....	13
Table 1-23	46BC Broken Conductor .....	13
Table 1-24	51 Time Delayed OC & EF .....	13
Table 1-25	50BF Circuit Breaker Fail.....	14
Table 1-26	74T/CCS Trip/Close Circuit Supervision.....	15
Table 1-27	Control Functions .....	15
Table 1-28	CB Maintenance.....	15
Table 1-29	81THD Total Harmonic Distortion Supervision.....	15
Table 1-30	79 Auto Reclose.....	16

## Section 1: Performance Specification

### 1.1 Indication of Conformity



This product complies with the directive of the Council of the European Communities on harmonization of the laws of the Member States relating to electromagnetic compatibility (EMC Council Directive 2004/108/EC) and concerning electrical equipment for use within specified voltage limits (Low Voltage Directive 2006/95/EC).

This conformity has been proved by tests performed according to the Council Directive in accordance with the generic standard IEC/EN 60255-26 (for EMC directive) and with the standards IEC/EN 60255-27 (for Low Voltage Directive) by Siemens AG.

### 1.2 Technical Specifications

This section provides the technical information of 7SR10 over current and Earth Fault relay.

Table 1-1 Technical Data Overview

Product Family (Auxiliary powered)	Non Directional Overcurrent and Earth Fault Protection Relay
Case and LEDs	Non Draw-out Polycarbonate case (Size 4 standard, Non Draw-out design), 10 LEDs
Measuring Inputs (Current)	1 A/5 A, 50 Hz/60 Hz
Auxiliary Voltage	60 V - 240 V AC/DC 24 V - 60 V DC
Communication	Default front communication port (IEC 60870-5-103 or MODBUS RTU) Rear port: RS485 (optional - IEC 60870-5-103 or Modbus RTU or DNP 3.0)
Protection Functions	50, 50G/N, 51, 51G/N, 50BF, 50SEF, 51SEF, 49, 46BC, 46NPS
Supervision and control functions	74 T/CCS, 86, 81HBL2 - (inrush restraint), 51 c, 81 THD, 79
Binary Input and Binary Output	3 BI or 6 BI 3 BO or 6 BO, (2 changeover contact) Threshold voltage - 88 V AC/DC or 44 V AC/DC available with 60 V - 240 V AC/DC power supply version - 19 V DC with 24 V - 60 V DC power supply version

Table 1-2 Mechanical Specifications

Design	Flush mounting, Non Draw-out Polycarbonate moulded case
Enclosure	IP 54 (front panel) IP 20 Protection for terminals (rear side) Depth is 199 mm
Weight	1.6 kgs (appx)

Table 1-3 Terminal Blocks with Push Buttons

Current Inputs	12 position (Terminal X5), M4 Screw-type Barrier Terminal block suitable for 2.5 mm <sup>2</sup> /4 mm <sup>2</sup> cable
Auxiliary Supply	3 position (Terminal X3), M3 screw-type plug-in terminals suitable for 2.5 mm <sup>2</sup> cable
Rear Communication Port	4 position (Terminal X2), M2 screw-type plug-in terminals suitable for 1.5 mm <sup>2</sup> cable
Front Communication Port	USB, Type B
Binary Input	6 or 12 position (Terminal X1), M3 screw-type plug-in terminals suitable for 2.5 mm <sup>2</sup> cable
Binary Output	8 or 14 position (Terminal X4), M3 screw-type plug-in terminals suitable for 2.5 mm <sup>2</sup> cable

Table 1-4 Current Inputs

Quantity	3 x Phase & 1 x Earth
Rated Current In	1 A/5 A
Measuring Range	80*I <sub>n</sub> 8*I <sub>n</sub> (SEF)
Instrumentation	± 1% (typical) (≥ 0.1xI <sub>n</sub> to 3xI <sub>n</sub> ) ± 3% (> 3xI <sub>n</sub> to 80xI <sub>n</sub> )
Frequency	50 Hz (Range: 47 Hz to 52 Hz) 60 Hz (Range: 57 Hz to 62 Hz)
Thermal Withstand:	
Continuous	4 x I <sub>n</sub>
10 s	30 I <sub>n</sub>
1 s	100 A (1 A) 350 A (5 A)
Burden @ I <sub>n</sub>	≤ 0.3 VA per phase and earth for both 1 A and 5 A

Table 1-5 Auxiliary Supply

Rated Voltage	60 V - 240 V AC/DC, Tolerance - 20% to +10%
Allowable superimposed AC component	15% of DC voltage
Typical Power consumption (DC)	< 7 W
Typical Power consumption (AC)	< 7 VA 0.5 PF
Max Interruption time (Collapse to Zero)	≤ 100 ms (110 V DC) ≤ 1000 ms (230 V AC)

Table 1-6 Auxiliary Supply

Rated Voltage	24 V - 60 V DC, Tolerance - 20% to +10%
Allowable superimposed AC component	15% of DC voltage
Typical Power consumption (DC)	< 7 W
Max Interruption time (Collapse to Zero)	20 ms (24 V DC)

Table 1-7 Binary Inputs

Number	3 or 6	
Operating Voltage*	19 V DC	Range 24 V - 66 V DC
	44 V AC/DC	Range 44 V - 265 V
	Range	DC 44 V - 265 V DC AC 36 V - 265 V AC
	88 V AC/DC	Range 88 V - 265 V
	Range	DC 88 V - 265 V DC AC 68 V - 265 V AC
Maximum AC/DC current for operation	3.5 mA	
Pick Up Delay	User selectable 0 to 14,400,000 ms (up to 4 hours)	
Drop Off Delay	User selectable 0 to 14,400,000 ms (up to 4 hours)	

\* Refer to ordering information for more details

Table 1-8 DC Performance

Attribute	Value
Reset/Operate voltage ratio	≥ 90%
Response time	< 9 ms
Response time when programmed to energise an output relay contact (i.e. includes output relay operation)	< 20 ms

Table 1-9 Binary Outputs

Number	3 or 6 (2 change over contacts)
Operating Voltage	Voltage Free
Operating Mode	User selectable - Self or Hand/Electrical Reset or pulsed
Operating Time from energizing Binary Input	< 20 ms
Making Capacity: Carry continuously Make and carry (L/R £ 40 ms and V £ 300 V)	5 A AC or DC 20 A AC or DC for 0.5 s 30 A AC or DC for 0.5 s

Breaking Capacity ( £ 5 A and £ 300 V):	
AC Resistive	1250 VA
AC Inductive	250 VA at p.f. £ 0.4
DC Resistive	75 W
DC Inductive	30 W at L/R £ 40 ms 50 W at L/R £ 10 ms

Table 1-10 Rear Communication Port

Quantity	1 No. (Optional)
Electrical connection	RS485, 2 wire electrical
Protocol Support	MODBUS RTU, IEC 60870-5-103, DNP 3.0
Rate	Data Transfer rate: 2400 - 38400 bps

Table 1-11 Front Communication Port

Quantity	1 No.
Electrical connection	USB, Type B

Table 1-12 Data Storage

Fault Record	15
Waveform Record	15 Rec x 1 Sec 7 Rec x 2 Sec 3 Rec x 5 Sec 1 Rec x 15 Sec Pre trigger 10...90%
Events	1000 events (1 ms resolution)

### 1.3 Environmental Performance

This section describes about the environmental tests performed with 7SR10 Overcurrent and Earth Fault relay under different conditions.

Table 1-13 Mechanical Tests

Type Test	Reference	Requirement
Vibration	IEC 60255-21-1	Response, Class I Endurance, Class I
Shock and Bump	IEC 60255-21-2	Shock response, Class I Shock withstand, Class I Bump, Class I
Degree of Protection	IEC 60529	IP54 front IP20 back
Seismic	IEC 60255-21-3, Class I	In single axis sine sweep in X-axis Sweep (@a sweep rate of 1 octave/min) vibration in the frequency range (1 Hz - 35 Hz) at amplitude of 3.5 mm or 1.0 gn (whichever is less) In single axis sine sweep in Y-axis: sweep (@a sweep rate of 1 octave/min) vibration in the frequency range (1 Hz - 35 Hz) at amplitude of 1.5 mm or 0.5 gn (whichever is less)
Contact	IEC 60255-1 (Ref: Std IEC 61810-1)	Making capacity, Make and carry capacity, Breaking capacity
Electrical Endurance Test	IEC 60255-1 (Ref: Std IEC 61810-1)	10000 operations at 250 V, 5 A

Table 1-14 Electrical Tests

Type Test	Reference	Requirement
Insulation Resistance	IEC 60255-27 <sup>#</sup>	Insulation resistance >100 M Ohms at 500 V DC Test Duration: > 5 s
Impulse Voltage Withstand	IEC 60255-27 <sup>#</sup>	5 kV, 1.2/50 $\mu$ s, 0.5 J 5 +ve, -ve pulses Between all terminals and case earth and any two independent circuits.
Hi Voltage (Dielectric) Voltage	IEC 60255-27 <sup>#</sup>	<ul style="list-style-type: none"> <li>· All case terminals connected together 2.0 kV AC RMS, 50 Hz, 1 min between terminals of independent circuits</li> <li>· 1.0 kV AC RMS, 1 min across normally open contacts</li> </ul>
High Frequency Disturbance	IEC 60255-26	<ul style="list-style-type: none"> <li>· Common-mode test voltage: 2.5 kV</li> <li>· Differential test voltage: 1.0 kV</li> <li>· Test duration: 2 s</li> <li>· Source impedance: 200 <math>\Omega</math></li> </ul>
Electrostatic Discharge	IEC 60255-26	<ul style="list-style-type: none"> <li>· 8 kV air discharge</li> </ul>

Type Test	Reference	Requirement
Electrical Fast Transient or Burst*	IEC 60255-26, Zone A	Test severity Amplitude: Power ports: 4 kV, burst frequency 5 kHz (Class III and IV) Other ports: 4 kV, burst frequency 5 kHz (Class III and IV)
Surge Immunity*	IEC 60255-26, Zone A	Time to half-value: 1.2/50 $\mu$ s <ul style="list-style-type: none"> <li>· Amplitude: 4 kV between all groups and case earth (CM)</li> <li>· Amplitude: 2 kV between terminals of each group (DM)</li> </ul>
Radiated Immunity	IEC 60255-26	Test field strength, frequency band 80 MHz to 1000 MHz and 1400 MHz to 2700 MHz: 10 V/m, Test using AM: 1 kHz/80 %
Conducted Radio Frequency Interference	IEC 60255-26, Class III	0.15 MHz to 80 MHz 10 V
Power Frequency Magnetic Field	IEC 60255-26	30 A/m applied continuously, 300 A/m applied for 3 s
Conducted Emissions	IEC 60255-26 CISPR 22, Class A	0.15 MHz - 0.5 MHz, 79dB $\mu$ V (quasi peak) 66 dB $\mu$ V (average) 0.5 MHz - 30 MHz, 73dB $\mu$ V (quasi peak) 60 dB $\mu$ V (average)
Radiated Emissions	IEC 60255-26 CISPR 11, Class A	30 MHz - 230 MHz, 40 dB $\mu$ V/m at 10 m measurement distance 230 MHz - 1 GHz, 47 dB $\mu$ V/m at 10 m measurement distance
Thermal & Burden	IEC 60255-27 and IEC 60255-1	<b>Thermal:</b> <b>1 A CT:</b> 4 A continuous 30 A for 10 s 100 A for 1 s <b>5 A CT:</b> 20 A Continuous 150 A for 10 s 500 A for 1s <b>Burden:</b> $\leq 0.3$ VA for 1 A and 5 A CT
Functional	IEC 60255-3	for both 1 A and 5 A CTs
Maximum Allowable Temperature	IEC 60255-6	Max. temperature limit +100 <sup>0</sup> C
Limiting Dynamic Value	IEC 60255-6	<b>1 A CT:</b> 700 A for 10 ms <b>5 A CT:</b> 2500 A for 10 ms

\* **NOTE:** 45 ms DTL pick-up delay applied to binary inputs

# **NOTE:** All aspect of IEC 60255-5 have been covered under IEC 60255-27



Table 1-15 Safety Tests

Type Test	Reference	Requirement
Safety IEC 61010-1 (Third Edition): 2010	IEC 61010-1	Protection Against Electric Shock as per Cl.No.6 Resistance to mechanical stresses as per Cl.No.8 Protection Against Spread of Fire as per Cl.No.9 Equipment Temperature Limits and Resistance to heat as per Cl.No.10

Table 1-16 Auxiliary Supply Variation

Type Test	Reference	Parameters	Declared Operation
Voltage Dips (AC auxiliary supply) RV = 230 V AC	IEC 60255-11, IEC61000-4-11	0% RV at 1000 ms	Normal Operation <sup>1</sup>
		40% RV at 200 ms	Normal Operation <sup>1</sup> except where Dip falls below the relay minimum voltage then Relay Restart <sup>2</sup>
		70% RV at 500 ms	Normal Operation <sup>1</sup> except where Dip falls below the relay minimum voltage then Relay Restart <sup>2</sup>
Voltage Dips (DC auxiliary supply) RV = 110 V DC	IEC 60255-11, IEC61000-4-29	0% RV at 100 ms	Normal Operation <sup>1</sup>
		40% RV at 200 ms	Normal Operation <sup>1</sup> except where Dip falls below the relay minimum voltage then Relay Restart <sup>2</sup>
		70% RV at 500 ms	Normal Operation <sup>1</sup> except where Dip falls below the relay minimum voltage then Relay Restart <sup>2</sup>
Gradual shutdown / Start-up test	IEC 60255-26		Shut down ramp 60 s Power off 5 min Start up ramp 60 s

<sup>1</sup> No effect on relay performance

<sup>2</sup> Restart with no mal-operation, loss of data or relay damage

Table 1-17 Environmental Test

Type Test	Reference	Requirement
Climatic Environmental Test	IEC 60068-2-1, IEC 60068-2-2	Operating Temperature -10 <sup>0</sup> C to +60 <sup>0</sup> C Storage Range -25 <sup>0</sup> C to +70 <sup>0</sup> C
Humidity	IEC 60068-2-30,	Damp heat test, Cyclic 4 days at 40 <sup>0</sup> C and 93% relative humidity
	IEC 60068-2-78	Damp heat test, Steady state 4 days at 95% RH, +40 <sup>0</sup> C

Table 1-18 Product Safety Test

Type Test	Reference	Parameters	Values
Clearances and Creepage Distances	IEC/EN 60255-27: Edition 2: 2013-10	Clearances and creepage distances between external circuits mutual and to the enclosure	≥ 4 mm
IP Rating	IEC/EN 60255-27: Edition 2: 2013-10	For Unit Front side	IP54
		For Unit Rear side	IP20
AC Dielectric Voltage	IEC/EN 60255-27: Edition 2: 2013-10	Test voltage (AC): 2 kV	After test, the relay should be operative (Reinforced Insulation with communication circuit)
		Test frequency: 50 Hz	
		Test duration: 1 min	
Insulation Resistance	IEC/EN 60255-27: Edition 2: 2013-10	Test voltage: 500 V DC	> 100 M ohm
		Test duration: > 5 s	
Protective Bonding Resistance	IEC/EN 60255-27: Edition 2: 2013-10	Test voltage: < 12V AC/DC	< 0.1 Ohm
		Test duration: 1 min	
		Bonding resistance	
Protective Bonding Continuity	IEC/EN 60255-27: Edition 2: 2013-10	Accessible conductive parts should be bonded with the protective conductor terminal	Low current continuity test
Flammability of Insulating Materials, Components and Fire enclosures	IEC/EN 60255-27: Edition 2: 2013-10	Structure Part	Standard for insulating material of flammability class
		Terminals	Class UL 94 V-0
		Terminal Mounting	Class UL 94 V-0
		Wiring (CT)	(N)2GFAF (VDE)
		Components mounting	Class UL 94 V-0
		Enclosure	Class UL 94 V-0
		PCB	Class UL 94 V-0
		LCD	Class UL 94 V-0

Type Test	Reference	Parameters	Values
Single Fault Condition	IEC/EN 60255-27: Edition 2: 2013-10	Assessment of: <ul style="list-style-type: none"> <li>· Insulation between circuits and parts</li> <li>· Compliance with requirements for protection against the spread of fire</li> <li>· Overloads</li> <li>· Intermittently rated resistors</li> <li>· Compliance with requirements for mechanical protection</li> </ul>	The equipment shall not present a risk of electric shock or fire after a single-fault test.
Marking and Documentation	IEC 61010-1 : 2010	Clause No. 5	-
Protection against electric shock		Clause No. 6	-
Protection against mechanical hazard		Clause No. 7	-
Resistance to mechanical stresses		Clause No. 8	-
Protection against the spread of fire		Clause No. 9	-
Equipment temperature limits and resistance to heat		Clause No. 10	-
Protection against liberated gases and substances, explosion and implosion		Clause No. 13	-
Components and sub assemblies		Clause No. 14	-
HAZARDS resulting from application		Clause No. 16	-
Risk Assessment		Clause No. 17	-

## 1.4 Performance Specification

This section describes about the settings available for different protection functions and its tolerance limits.

Table 1-19 46 Negative Phase Sequence Overcurrent

Number of Elements	DT & IT
DT Setting Range Is	0.05, 0.06, 0.07... 4xIn
DT Operate Level	100% Is, ±5% or ±1%xIn
DT Delay Setting td	0.00, 0.01... 20, 20.1...100,101...1000, 1010..... 10000,10100...14400 s
DT Basic Operate Time 0 to 2 x Is 0 to 5 x Is	40 ms ±10 ms 30 ms ±10 ms
DT Operate time following delay	Tbasic +td , ±1% or ±10 ms
IT Char Setting	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL
IT Setting Range	0.05..2.5
Tm Time Multiplier	0.025,0.03,... 1.6,1.7,...100
Char Operate Level	105% Is, ±4% or ±1%In
Overshoot Time	< 40 ms
Inhibited by	Binary or Virtual Input

Table 1-20 49 Thermal Overload

Operate levels	Operate and Alarm
Setting Range Is	0.10,0.11...3.0 x In
Operate Level	100% Is, ±5% or ±1%xIn
Time Constant Setting	1,1.5...1000 min
Operate time	$t = t' \cdot In \sqrt{\frac{I^2 \times I_p^2}{I^2 \times (k' \cdot I_B)^2}}$ ±5% absolute or ±100 ms where Ip = prior current
Alarm Level	Disabled, 50,51...100%
Inhibited by	Binary or Virtual Input

Table 1-21 50 Instantaneous & DTL OC & EF

Operation	Non directional
Elements	Phase, Derived Earth, Measured Earth, Sensitive Earth Fault
Setting Range Is (50/50N/50G)	0.05, 0.06...2.5, 2.55...25, 25.5,.....50xIn
Setting Range Is (50SEF)	0.005, 0.006, ... 0.1, 0.105, ..... 5xIn
Time Delay	0.00, 0.01... 20, 20.1...100,101...1000,1010..... 10000,10100...14400 s
Operate Level I <sub>op</sub>	100% Is, ±5% or ±1%xIn
Reset level	<sup>3</sup> 95 % I <sub>op</sub>
Reset level (50 SEF)	<sup>3</sup> 95 % I <sub>op</sub> or I <sub>op</sub> - 0.1% In
Operate time: 50, 50G, 50SEF 50N	0 to 2x Is - 35 ms, ±10 ms, 0 to 5x Is - 25 ms, ±10 ms # 0 to 2x Is - 40 ms, ±10 ms, 0 to 5x Is - 30 ms, ±10 ms #
Operate time following delay	Tbasic +td , ±1% or ±10 ms
Inhibited by	Binary or Virtual Input Inrush detector

# The operating timings are measured on the basis of fundamental measurement algorithm, with protection functions and communication ports configured in the relay.

Table 1-22 81HBL2 Inrush Detector

## Reference

	Parameter	Value
$I$	Setting (Ratio of 2nd Harmonic current to Fundamental component current)	0.10, 0.11... 0.5

## Operate and Reset Time

	Attribute	Value
$t_{basic}$	Element basic operate time	Will pick-up before operation of any protection element due to magnetic inrush
	Reset Time	Will operate until drop-off of any protection element due to magnetic inrush

Table 1-23 46BC Broken Conductor

## Reference

	Parameter	Value
	NPS to PPS ratio	20, 21... 100%
$t_f$	Delay setting	0.03,04,20.0,20.1,100,101,1000,1010.....14400 s

## Operate and Reset Level

	Attribute	Value
$I_{curr}$	Operate level	100 % $I_{set} \pm 5\%$
	Reset level	90 % $I_{curr}, \pm 5\%$
	Repeatability	$\pm 1\%$
	Variation	-10°C to +60°C
		$f_{nom} \pm 5\%$
		harmonics to $f_{cutoff}$
		$\leq 5\%$

## Operate and Reset Time

	Attribute	Value
$t_{basic}$	Basic operate time	1x $I_n$ to 0 A
	Operate time	$t_f + t_{basic}, \pm 1\%$ or $\pm 20$ ms
	Repeatability	$\pm 1\%$ or $\pm 20$ ms
	Variation	$f_{nom} \pm 5\%$
		harmonics to $f_{cutoff}$
		$\leq 5\%$

Table 1-24 51 Time Delayed OC &amp; EF

Operation	Non directional
Elements	Phase, Derived Earth, Measured Earth, Sensitive Earth fault
Characteristic	IEC-NI, -VI, -EI, -LTI; ANSI-MI, -VI, -EI; DTL
Setting Range $I_s$ (51/51G)	0.05, 0.06...2.5, 2.55..4
Setting Range $I_s$ (51SEF)	0.005, 0.006....0.1,0.105,...0.5
Time Multiplier	0.01, 0.015.... 1.6,1.7,...5,6... 100
Time Delay	0,0.01... 20 s
Operate Level	105% $I_s, \pm 4\%$ or $\pm 1\% \times I_n$
Reset level	<sup>3</sup> 95 % $I_{op}$

Reset level (51 SEF)		<sup>3</sup> 95 % $I_{op} \pm 4\%$ or $\pm 1\% \times I_n$
Operate time IEC	char = IEC-NI, IEC-VI, IEC-EI, IEC-LTI	$t_{op} = \frac{K}{\left[\frac{I}{I_s}\right]^a - 1} \cdot T_m$  $\pm 5\%$ absolute or $\pm 40$ ms for TMS setting (0.01 to 0.245) $\pm 5\%$ absolute or $\pm 30$ ms for TMS setting (0.25 to 100) for char = IEC-NI : K = 0.14, a = 0.02 IEC-VI : K = 13.5, a = 1.0 IEC-EI : K = 80.0, a = 2.0 IEC-LTI : K = 120.0, a = 1.0
ANSI	char = ANSI-MI, ANSI-VI, ANSI-EI	$t_{op} = \frac{A}{\left[\frac{I}{I_s}\right]^P - 1} + B \frac{U}{U} \cdot T_m$  $\pm 5\%$ absolute or $\pm 40$ ms for TMS setting (0.01 to 0.245) $\pm 5\%$ absolute or $\pm 30$ ms for TMS setting (0.25 to 100) for char = ANSI-MI : A = 0.0515, B = 0.114, P = 0.02 ANSI-VI : A = 19.61, B = 0.491, P = 2.0 ANSI-EI : A = 28.2, B = 0.1217, P = 2.0
Follower Delay		0, 0.01.....20 s
Reset time	ANSI decaying	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \cdot T_m$  $\pm 5\%$ absolute or $\pm 50$ ms, for char = ANSI-MI : R = 4.85 ANSI-VI : R = 21.6 ANSI-EI : R = 29.1
	IEC decaying	$t_{res} = \frac{R}{\left[\frac{I}{I_s}\right]^2 - 1} \cdot T_m$  $\pm 5\%$ absolute or $\pm 50$ ms, for char = IEC-NI : R = 9.7 IEC-VI : R = 43.2 IEC-EI : R = 58.2 IEC-LTI : R = 80
	$t_{res}^1$ DECAYING	$t_{res}, \pm 1\%$ or $\pm 20$ ms
Inhibited by		Binary or Virtual Input Inrush detector

Table 1-25 50BF Circuit Breaker Fail

Operation	Current check - Phase and Measured Earth with independent settings Mechanical Trip CB Faulty Monitor
Setting Range $I_s$	0.05, 0.055...2.0 x $I_n$
2 Stage Time Delays	Timer 1 20...60000 ms Timer 2 20, 25.....60000 ms
Operate Level	100% $I_s$ , $\pm 5\%$ or $\pm 1\% \times I_n$
Disengaging time	< 20 ms
Operate time following delay	$T_{cbf} \pm 1\%$ or $\pm 20$ ms
Triggered by	Any function mapped as trip contact.
Inhibited by	Binary/Virtual Input
Timer By pass	Yes, 50BF CB Faulty Input

Table 1-26 74T/CCS Trip/Close Circuit Supervision

Number of supervisable circuits	3 x Trip and 3 x Close
Number of BI's Required	1 or 2 per function

Table 1-27 Control Functions

CB	Open/Close
Inst Prot	IN/OUT
EF	IN/OUT
SEF	IN/OUT
Hot Line	IN/OUT
Relay Mode	Local/Remote/Local or Remote
Reset	LED's & Outputs (Test/Reset key)

Table 1-28 CB Maintenance

Trip Counter	Total & Delta 0...10000
I <sup>2</sup> t Alarm	10...100000

Table 1-29 81THD Total Harmonic Distortion Supervision

## Reference

	Parameter	Value
<i>lthd</i>	Setting	5,6,.....100%
<i>t<sub>d</sub></i>	Delay setting	0.02, 0.03...20.00, 20.10... 100, 101... 1000, 1010... 10000, 10100... 14400 s

## Operate and Reset Level

	Attribute	Value
<i>lthd<sub>op</sub></i>	Operate level	100 % <i>lthd</i> , ± 5 % (Applied harmonic magnitude) or ± 1% <i>lthd</i>
	Operating range	0.2 to 20In
	Repeatability	± 1 %
	Transient overreach (X/R ≤ 100)	≤ -5 %
	Variation	-10 °C to +60 °C
		<i>f<sub>nom</sub></i> ± 5 %

## Operate and Reset Time

	Attribute	Value
<i>t<sub>basic</sub></i>	Element basic operate time	0 to 2 x <i>lthd</i> : 55 ms, ± 15 ms
<i>t<sub>op</sub></i>	Operate time following delay	<i>t<sub>basic</sub></i> + <i>t<sub>d</sub></i> , ± 1 % or ± 10 ms
	Repeatability	± 1 % or ± 10 ms
	Overshoot time	< 40 ms
	Disengaging time	< 60 ms

Table 1-30 79 Auto Reclose

Operating Mode	Phase, Earth, SEF External
Number of Reclose	1..4
Number of Trips to Lockout	1..5
Dead Time	0...14400
Reclaim Timer	0...600
Lockout Reset	CB, Timer & BI



# 7SR10, 7SR11, and 7SR12

Data Communications

## Document Release History

This document is issue 2017/07. The list of revisions up to and including this issue is:

2013/11	First Issue
2015/02	Second Issue
2015/03	Third Issue
2015/06	Fourth Issue
2015/09	Fifth Issue
2016/11	Sixth Issue
2017/03	Seventh Issue
2017/04	Eighth Issue
2017/07	Nineth Issue

## Software Revision History

2013/11	2436H80015 R2d-1a	First Release
2015/02	2437H80001 R4b-1d	Second Release
2015/03	2437H80001 R4b-1e	Third Release
2015/06	2437H80001 R4b-1f	Fourth Release
2015/09	2437H80001 R4b-2a	Fifth Release
2016/11	2437H80001 R4b-2b	Sixth Release
2017/04	2437H80001 R4c-2b	Seventh Release

# Contents

Section 1: Introduction .....	4
Section 2: Physical Connection .....	5
2.1 Communication ports .....	6
2.1.1 USB Interface (Com2) .....	6
2.1.2 RS485 Interface (Com1) .....	7
2.1.3 Optional Rear EN100 Ethernet Module (COM3) .....	8
Section 3: IEC 60870-5-103 Definitions .....	9
3.1 Introduction .....	9
3.2 Points List .....	10
3.3 Events List by Relay Model .....	17
3.3.1 7SR10 .....	17
3.3.2 7SR11 .....	21
3.3.3 7SR12 .....	25
Section 4: Modbus Definitions .....	30
4.1 Introduction .....	30
4.2 MODBUS Register Data Types .....	30
4.2.1 FLOAT_IEEE_754 .....	30
4.2.2 FP_32BITS_3DP .....	31
4.2.3 UINT32 .....	31
4.2.4 UINT16 .....	31
4.2.5 EVENT .....	32
4.2.6 EVENTCOUNT .....	33
4.2.7 TIME_METER .....	33
4.2.8 STR32 & STR64 .....	33
4.2.9 BITSTRING .....	33
4.3 Points List .....	34
4.3.1 Coils (Read Write Binary values) .....	34
4.3.2 Inputs (Read Only Binary values) .....	35
4.3.3 Registers .....	38
4.3.4 Holding Registers (Read Write values) .....	40
4.3.5 Event Record .....	40
Section 5: DNP3.0 Definitions .....	41
5.1 Device Profile .....	41
5.2 Implementation Table .....	44
5.3 Point List .....	53
5.3.1 Binary Input Points .....	53
5.3.2 Double Bit Binary Input Points .....	58
5.3.3 Binary Output Status Points and Control Relay Output Blocks .....	58
5.3.4 Analogue Inputs .....	60
5.3.5 Binary Counters .....	62
5.3.6 Frozen Counters .....	62
Section 6: IEC61850 Protocol Support .....	64
Section 7: Modems .....	65
7.1 Introduction .....	65
7.2 Connecting a Modem to the Relay(s) .....	65
7.3 Setting the Remote Modem .....	65
7.4 Connecting to the Remote Modem .....	65
Section 8: Configuration .....	66
8.1 DNP3 .....	66
8.2 IEC60870-5-103 .....	66
8.3 MODBUS-RTU .....	66
Section 9: Glossary .....	67

## List of Figures

Figure 6-1	Communication to Front USB Port .....	6
Figure 6-2	Communication to Multiple Devices from Control System using RS485 .....	7
Figure 6-3	EN100 Ethernet Module .....	8

## Section 1: Introduction

The relay data communication facility is compatible with control and automation systems and PCs running Reydisp software. The relay can provide operational information, post-fault analysis, settings interrogation and editing facilities. This section describes how to use the Communication Interface with a control system or interrogating computer. Appropriate software within the control system or on the interrogating computer (e.g. Reydisp Evolution/Manager) is required to access the interface.

The relay data communication facility incorporates user selectable protocols to provide compatibility with control and automation systems.

This section specifies connection details and lists the events, commands and measurands available in the IEC60870-5-103, Modbus RTU, DNP3.0 and optional IEC60870-5-101 protocols.

For further information regarding the IEC60870-5-103 interface, reference should be made to the separate Informative Communications Interface manual.

For further information regarding the IEC61850 protocol, refer to the IEC61850 technical publications.

The Communications Interface for dialogue communications by the Protection Engineer is provided by the Reydisp Evolution software package, also available from the website, using the IEC60870-5-103 protocol.

## Section 2: Physical Connection

The relay range provides one 'Front' USB communication interface (Com2) located on the fascia and one RS485 (Com1) located on the 'Rear'. Access to the communication settings for the USB port is only available from the relay front fascia via the key pad setting menu **COMMUNICATIONS MENU**. The communication settings for the RS485 port are available from the relay front fascia via the key pad setting menu or through Reydisp via the USB connection. Optional Ethernet ports for IEC 61850 protocol are also fitted at the rear.

1. Com2-USB: this port is used for IEC60870-5-103 (default setting) communication with the Reydisp software. An ASCII protocol, the main use of which is to allow firmware to be updated from the front connection, is also available through this port.
2. Com1-RS485: this port can be used for IEC60870-5-103 or MODBUS RTU or DNP 3.0 communications to a substation SCADA or integrated control system or engineer remote access.
3. Ethernet Ports: Located on the rear of the relay these optional ports can be used for IEC61850 communications to a substation SCADA, integrated control system or for engineer remote access. Ethernet ports using IEC 61850 protocol can also provide an IEC 60870-5-103 protocol connection to Reydisp.

The ports can be independently mapped to the IEC60870-5-103 or MODBUS RTU or DNP3.0 protocol or switched OFF in the relay settings. The same protocol can be used simultaneously on both ports.

SPDL can provide a range of interface devices, please refer to product portfolio catalogue.

Full details of the interface devices can be found by referring to the website.

## 2.1 COMMUNICATION PORTS

### 2.1.1 USB Interface (Com2)

The USB communication port is connected using a standard USB cable with a type B connection to the relay and type A to the PC.

The PC will require a suitable USB driver to be installed, this will be carried out automatically when the Reydisp software is installed. When the Reydisp software is running, with the USB cable connected to a device, an additional connection is shown in the Reydisp connection window, connections to the USB port are not shown when they are not connected.

The USB communication interface on the relay is labelled Com 2 and its associated settings are located in the Data communications menu. When connecting to Reydisp using this connection the default settings can be used without the need to first change any settings, otherwise the Com 2 port must be set to IEC60870-5-103 (the relay address and baud rate do not need to be set).

The following settings must be configured via the relay fascia when using the USB interface.

Description	Range	Default	Notes
COM2-USB Protocol <i>Selects protocol to use for COM2-USB</i>	OFF, DNP3, ASCII, MODBUS-RTU, IEC60870-5-103	IEC60870-5-103	
COM2-USB Station Address <i>IEC 60870-5-103 Station Address</i>	0, 1 ... 65533, 65534	0	Address given to relay to identify it for connection to the USB front port
COM2-USB Mode <i>Selects whether the port is Local or Remote.</i>	Local, Remote, Local Or Remote	Local	Local

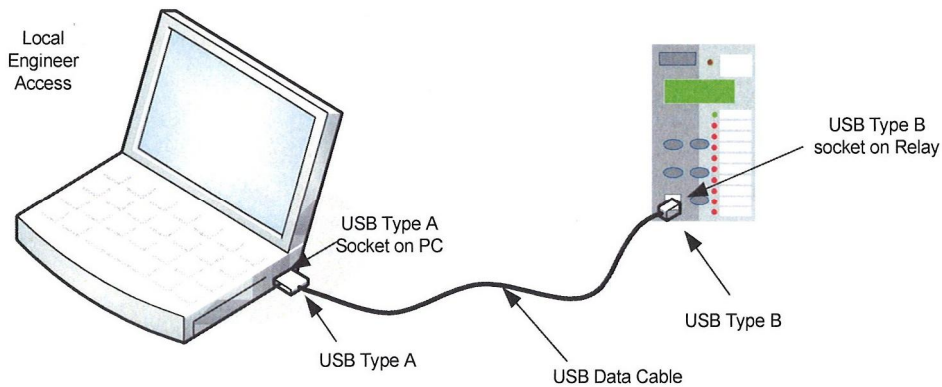


Figure 6-1 Communication to Front USB Port

### 2.1.2 RS485 Interface (Com1)


The RS485 communication port is located on the rear of the relay and can be connected using a suitable RS485 120 ohm screened twisted pair cable.

The RS485 electrical connection can be used in a single or multi-drop configuration. The RS485 master must support and use the Auto Device Enable (ADE) feature. The last device in the connection must be terminated correctly in accordance with the master device driving the connection. The relays are fitted with an internal terminating resistor which can be connected between A and B by fitting an external wire loop between terminals 18 and 20 on the power supply module.

The maximum number of relays that can be connected to the bus is 64.

The following settings must be configured via the relay fascia when using the RS485 interface. The shaded settings are only visible when DNP3.0 is selected.

Setting name	Range	Default	Setting	Notes
<b>Station Address</b>	0 ... 254 (IEC60870-5-103) 0 ... 247 (MODBUS) 0 ... 65534 (DNP3)	0	1...	An address must be given to identify the relay. Each relay must have a unique address.
<b>COM1-RS485 Protocol</b>	OFF, IEC60870-5-103, MODBUS-RTU, DNP3.0	IEC60870-5-103	As Required	Sets the protocol used to communicate on the RS485 connection.
<b>COM1-RS485 Baud Rate</b>	75 110 150 300 600 1200 2400 4800 9600 19200 38400	19200	As Required	The baud rate set on all of the relays connected to the same RS485 bus must be the same as the one set on the master device.
<b>COM1-RS485 Parity</b>	NONE, ODD, EVEN	EVEN	As Required	The parity set on all of the relays connected to the same RS485 bus must be the same and in accordance with the master device.
<b>COM1-RS485 Mode</b>	Local, Remote, Local Or Remote	Remote	Remote	Selects whether the port is Local or Remote.
<b>Unsolicited Mode</b>	DISABLED ENABLED	DISABLED	As Required	Setting is only visible when COM1 Protocol is set to DNP3
<b>Destination Address</b>	0 ... 65534	0	As Required	Setting is only visible when COM1 Protocol is set to DNP3

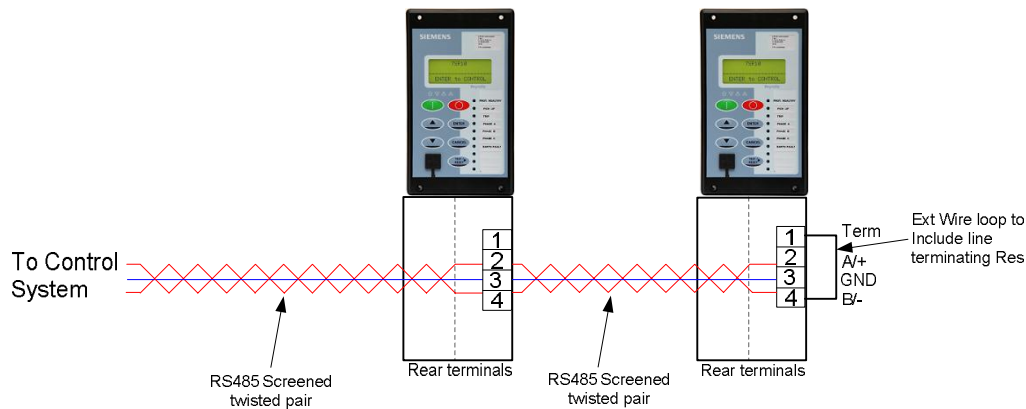

**Figure 6-2 Communication to Multiple Devices from Control System using RS485**

### 2.1.3 Optional Rear EN100 Ethernet Module (COM3)


The optional Ethernet interface is primarily provided for support of IEC 61850 protocol. Support for IEC 60870-5-103 is also provided over this interface to allow connection with Reydisp Evolution and Reydisp Manager software for interrogation, editing and download of relay settings and other data. Ordering options are available with two RJ45 electrical connectors or with two duplex LC fibre optic connectors.

Setting name	Range	Default	Setting	Notes
LAN Protocol	OFF, IEC60870-5-103	IEC60870-5-103		

If this setting is set to Off, access to relay data using Reydisp Evolution and Reydisp Manager software via the Ethernet interface is not available.

Connections to the optional EN100 Ethernet module are made on the rear side of the relay.

Connections are made to either RJ45 sockets (electrical) or Duplex LC (fibre optic) connectors.

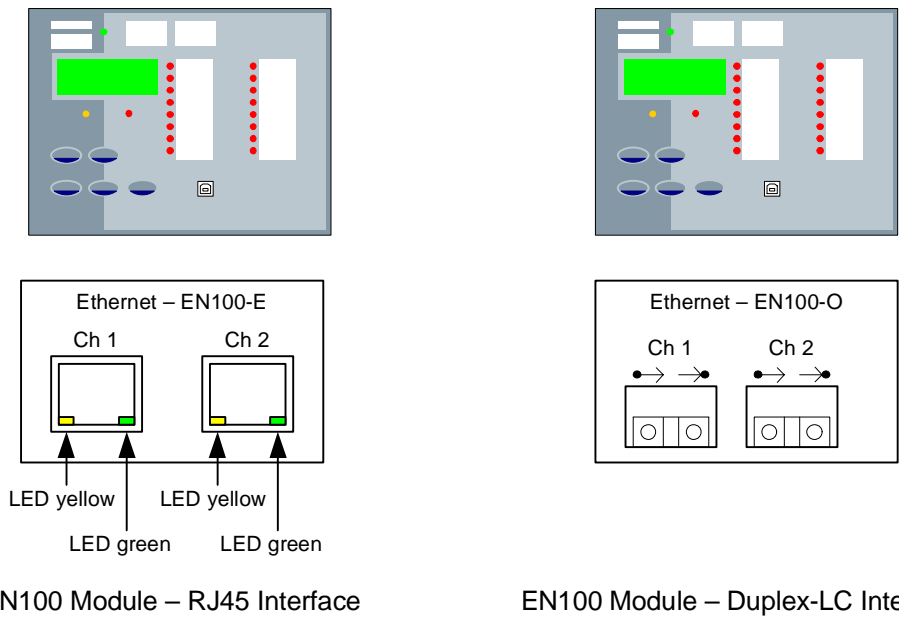

EN100 Module – RJ45 Interface

EN100 Module – Duplex-LC Interface

Green LED (Physical Link)

- Off – No link
- On – Link present

Yellow LED (Activity)

- Off – No traffic
- On/flashing - Traffic

Figure 6-3 EN100 Ethernet Module



## Section 3: IEC 60870-5-103 Definitions

### 3.1 INTRODUCTION

This section describes the IEC 60870-5-103 protocol implementation in the relays. This protocol is used for the communication with Reydisp software and can also be used for communication with a suitable control system. The control system or local PC acts as the master in the system with the relay operating as a slave responding to the master's commands. The implementation provides event information, time synchronising, commands and measurands and also supports the transfer of disturbance records.

This protocol can be set to use any or all of the relays hardware interfaces and is the standard protocol used by the USB port. The relay can communicate simultaneously on all ports regardless of protocol used.

Each relay must be given an address to enable communication and can be set by the *Communication Interface:Relay Address*. A relay with the default address of **0** will not be able to communicate.

#### Cause of Transmission

The cause of transmission (COT) column of the 'Information Number and Function' table lists possible causes of transmission for these frames. The following abbreviations are used:

Abbreviation	Description
SE	spontaneous event
T	test mode
GI	general interrogation
Loc	local operation
Rem	remote operation
Ack	command acknowledge
Nak	Negative command acknowledge

Note: Events listing a GI cause of transmission can be raised and cleared; other events are raised only.

#### ASDU Type

Abbreviation	Description
1	Time tagged message (monitor direction)
2	Time tagged message (relative time) (monitor direction)
3.1	Measurands I
4	Time-tagged measurands with relative time
5	Identification message
6	Time synchronisation
7	General Interrogation Initialization
9	Measurands II
20	General command

#### Information Number and Function

The following table lists information number and function definitions together with a description of the message and function type and cause of transmission that can result in that message. The table shows all events available from the relay range.

Note that not all events are available on all relay models.

## 3.2 POINTS LIST

Function	Information Number	Description	ASDU Type	Cause of Transmission
60	4	Remote Mode	1	SE, GI
			20	Ack, Nak
60	5	Out of Service Mode	1	SE, GI
			20	Ack, Nak
60	6	Local Mode	1	SE, GI
			20	Ack, Nak
60	7	Local & Remote Mode	1	SE, GI
			20	Ack, Nak
60	12	Control Received	1	SE
60	13	Command Received	1	SE
60	128	Cold Start	1	SE, GI
60	129	Warm Start	1	SE, GI
60	130	Re-Start	1	SE, GI
60	131	Expected Restart	1	SE, GI
60	132	Unexpected Restart	1	SE, GI
60	133	Reset Start Count	1	SE, GI
			20	Ack, Nak
60	135	Trigger Storage	1	SE
60	136	Clear Waveform Records	1	SE
60	137	Clear Fault Records	1	SE
60	138	Clear Event Records	1	SE
60	140	Demand Metering Reset	1	SE
			20	Ack, Nak
60	170	General Alarm 1	1	SE, GI
60	171	General Alarm 2	1	SE, GI
60	172	General Alarm 3	1	SE, GI
60	173	General Alarm 4	1	SE, GI
60	174	General Alarm 5	1	SE, GI
60	175	General Alarm 6	1	SE, GI
60	182	Quick Logic E1	1	SE, GI
60	183	Quick Logic E2	1	SE, GI
60	184	Quick Logic E3	1	SE, GI
60	185	Quick Logic E4	1	SE, GI
70	5	Binary Input 5	1	SE, GI
70	6	Binary Input 6	1	SE, GI
75	1	Virtual Input 1	1	SE, GI
75	2	Virtual Input 2	1	SE, GI
75	3	Virtual Input 3	1	SE, GI
75	4	Virtual Input 4	1	SE, GI
75	5	Virtual Input 5	1	SE, GI
75	6	Virtual Input 6	1	SE, GI
75	7	Virtual Input 7	1	SE, GI
75	8	Virtual Input 8	1	SE, GI
80	1	Binary Output 1	1	SE, GI
			20	Ack, Nak
80	2	Binary Output 2	1	SE, GI

Function	Information Number	Description	ASDU Type	Cause of Transmission
			20	Ack, Nak
80	3	Binary Output 3	1	SE, GI
			20	Ack, Nak
80	4	Binary Output 4	1	SE, GI
			20	Ack, Nak
80	5	Binary Output 5	1	SE, GI
			20	Ack, Nak
80	6	Binary Output 6	1	SE, GI
			20	Ack, Nak
80	7	Binary Output 7	1	SE, GI
			20	Ack, Nak
80	8	Binary Output 8	1	SE, GI
			20	Ack, Nak
90	1	LED 1	1	SE, GI
90	2	LED 2	1	SE, GI
90	3	LED 3	1	SE, GI
90	4	LED 4	1	SE, GI
90	5	LED 5	1	SE, GI
90	6	LED 6	1	SE, GI
90	7	LED 7	1	SE, GI
90	8	LED 8	1	SE, GI
90	9	LED 9	1	SE, GI
91	1	LED PU 1	1	SE, GI
91	2	LED PU 2	1	SE, GI
91	3	LED PU 3	1	SE, GI
91	4	LED PU 4	1	SE, GI
91	5	LED PU 5	1	SE, GI
91	6	LED PU 6	1	SE, GI
91	7	LED PU 7	1	SE, GI
91	8	LED PU 8	1	SE, GI
91	9	LED PU 9	1	SE, GI
160	2	Reset FCB	5	SE
160	3	Reset CU	5	SE
160	4	Start/Restart	5	SE
160	5	Power On	1	SE, GI
160	16	Auto-reclose active (In/Out)	1	SE, GI
			20	Ack, Nak
160	19	LEDs reset (Reset Flag & Outputs)	1	SE
			20	Ack, Nak
160	22	Settings changed	1	SE
160	23	Settings Group 1 Select	1	SE, GI
			20	Ack, Nak
160	24	Settings Group 2 Select	1	SE, GI
			20	Ack, Nak
160	25	Settings Group 3 Select	1	SE, GI
			20	Ack, Nak
160	26	Settings Group 4 Select	1	SE, GI
			20	Ack, Nak
160	27	Binary Input 1	1	SE, GI
160	28	Binary Input 2	1	SE, GI

Function	Information Number	Description	ASDU Type	Cause of Transmission
160	29	Binary Input 3	1	SE, GI
160	30	Binary Input 4	1	SE, GI
160	36	Trip circuit fail	1	SE, GI
160	38	VT Fuse Failure	1	SE, GI
160	51	Earth Fault Forward/Line	2	SE, GI
160	52	Earth Fault Reverse/Busbar	2	SE, GI
160	64	Start/Pick-up L1	2	SE, GI
160	65	Start/Pick-up L2	2	SE, GI
160	66	Start/Pick-up L3	2	SE, GI
160	67	Start/Pick-up N	2	SE, GI
160	68	General Trip	2	SE
160	69	Trip L1	2	SE
160	70	Trip L2	2	SE
160	71	Trip L3	2	SE
160	74	Fault Forward/Line	2	SE, GI
160	75	Fault Reverse/Busbar	2	SE, GI
160	84	General Starter/Pick Up	2	SE, GI
160	85	Circuit breaker fail	2	SE
160	90	Trip I>	2	SE
160	91	Trip I>>	2	SE
160	92	Trip In>	2	SE
160	93	Trip In>>	2	SE
160	128	CB on by auto reclose	1	SE
160	130	Reclose Blocked	1	SE, GI
183	0	Data lost	1	SE
183	10	51-1	2	SE, GI
183	11	50-1	2	SE, GI
183	12	51N-1	2	SE, GI
183	13	50N-1	2	SE, GI
183	14	51G-1	2	SE, GI
183	15	50G-1	2	SE, GI
183	16	51-2	2	SE, GI
183	17	50-2	2	SE, GI
183	18	51N-2	2	SE, GI
183	19	50N-2	2	SE, GI
183	20	51G-2	2	SE, GI
183	21	50G-2	2	SE, GI
183	22	51-3	2	SE, GI
183	23	50-3	2	SE, GI
183	24	51N-3	2	SE, GI
183	25	50N-3	2	SE, GI
183	26	51G-3	2	SE, GI
183	27	50G-3	2	SE, GI
183	28	51-4	2	SE, GI
183	29	50-4	2	SE, GI
183	30	51N-4	2	SE, GI
183	31	50N-4	2	SE, GI
183	32	51G-4	2	SE, GI
183	33	50G-4	2	SE, GI
183	34	50BF Stage 2	2	SE, GI

Function	Information Number	Description	ASDU Type	Cause of Transmission
183	35	49-Alarm	2	SE, GI
183	36	49-Trip	2	SE, GI
183	40	60CTS	2	SE, GI
183	41	51SEF-1	2	SE, GI
183	42	50SEF-1	2	SE, GI
183	43	51SEF-2	2	SE, GI
183	44	50SEF-2	2	SE, GI
183	45	51SEF-3	2	SE, GI
183	46	50SEF-3	2	SE, GI
183	47	51SEF-4	2	SE, GI
183	48	50SEF-4	2	SE, GI
183	49	SEF Out/In	2	SE, GI
			20	Ack, Nak
183	50	46IT	2	SE, GI
183	51	46DT	2	SE, GI
183	52	64H	2	SE, GI
183	53	EF Out/In	2	SE, GI
			20	Ack, Nak
183	54	SEF Forward/Line	2	SE, GI
183	55	SEF Reverse/Bus	2	SE, GI
183	56	50BF Stage 1	2	SE, GI
183	60	47-1	2	SE, GI
183	61	47-2	2	SE, GI
183	62	37-1	2	SE, GI
183	63	37-2	2	SE, GI
183	64	37G-1	2	SE, GI
183	65	37G-2	2	SE, GI
183	66	37SEF-1	2	SE, GI
183	67	37SEF-2	2	SE, GI
183	70	46BC	2	SE, GI
183	81	27/59-1	2	SE, GI
183	82	27/59-2	2	SE, GI
183	83	27/59-3	2	SE, GI
183	84	27/59-4	2	SE, GI
183	85	59NIT	2	SE, GI
183	86	59NDT	2	SE, GI
183	90	81-1	2	SE, GI
183	91	81-2	2	SE, GI
183	92	81-3	2	SE, GI
183	93	81-4	2	SE, GI
183	96	81HBL2	1	SE, GI
183	97	81THD	2	SE, GI
183	101	Trip Circuit Fail 1	2	SE, GI
183	102	Trip Circuit Fail 2	2	SE, GI
183	103	Trip Circuit Fail 3	2	SE, GI
183	114	Close CB Failed	1	SE
183	115	Open CB Failed	1	SE
183	116	Reclaim	1	SE, GI
183	117	Lockout	1	SE, GI
183	119	Successful DAR Close	1	SE

Function	Information Number	Description	ASDU Type	Cause of Transmission
183	120	Successful Man Close	1	SE
183	121	Hotline Working	1	SE, GI
			20	Ack, Nak
183	122	Inst Protection Out	1	SE, GI
			20	Ack, Nak
183	123	CB Total Trip Count	1	SE, GI
183	124	CB Delta Trip Count	1	SE, GI
183	125	CB Count To AR Block	1	SE, GI
183	126	Reset CB Total Trip Count	1	SE
			20	Ack, Nak
183	127	Reset CB Delta Trip Count	1	SE
			20	Ack, Nak
183	128	Reset CB Count To AR Block	1	SE
			20	Ack, Nak
183	129	1 <sup>st</sup> CB Wear	1	SE, GI
183	130	Reset 1 <sup>st</sup> CB Wear	1	SE
			20	Ack, Nak
183	131	79 AR In Progress	1	SE, GI
183	132	CB Frequent Ops Count	1	SE, GI
183	133	Reset CB Frequent Ops Count	1	SE
			20	Ack, Nak
183	140	Cold Load Active	1	SE,GI
183	141	P/F Inst Protection Inhibited	1	SE, GI
183	142	E/F Inst Protection Inhibited	1	SE, GI
183	143	SEF Inst Protection Inhibited	1	SE, GI
183	144	Ext Inst Protection Inhibited	1	SE, GI
183	163	Trip Time Alarm	1	SE
183	164	Close Circuit Fail 1	2	SE
183	165	Close Circuit Fail 2	2	SE
183	166	Close Circuit Fail 3	2	SE
183	167	Close Circuit Fail	2	SE
183	171	60 CTS-I	2	SE
183	172	Act Energy Exp	4	SE
183	173	Act Energy Imp	4	SE
183	174	React Energy Exp	4	SE
183	175	React Energy Imp	4	SE
183	176	Reset Energy Meters	1	SE
			20	Ack, Nak
183	177	Active Exp Meter Reset	1	SE
183	178	Active Imp Meter Reset	1	SE
183	179	Reactive Exp Meter Reset	1	SE
183	180	Reactive Imp Meter Reset	1	SE
183	181	CB Total Trip Count	4	SE
183	182	CB Delta Trip Count	4	SE
183	183	CB Count To AR Block	4	SE
183	184	CB Freq Ops Count	4	SE
183	221	Wattmetric Po>	1	SE, GI
183	222	37-PhA	2	SE, GI
183	223	37-PhB	2	SE, GI
183	224	37-PhC	2	SE, GI

Function	Information Number	Description	ASDU Type	Cause of Transmission
183	225	50 LC-1	2	SE, GI
183	226	50 LC-2	2	SE, GI
183	227	50G LC-1	2	SE, GI
183	228	50G LC-2	2	SE, GI
183	229	50SEF LC-1	2	SE, GI
183	230	50SEF LC-2	2	SE, GI
183	231	50BF-PhA	2	SE, GI
183	232	50BF-PhB	2	SE, GI
183	233	50BF-PhC	2	SE, GI
183	234	50BF-EF	2	SE, GI
183	235	79 Last Trip Lockout	2	SE, GI
183	239	In Fault Current	4	SE
183	240	Ia Fault Current	4	SE
183	241	Ib Fault Current	4	SE
183	242	Ic Fault Current	4	SE
183	243	Ig Fault Current	4	SE
183	244	Isef Fault Current	4	SE
183	245	Va Fault Voltage	4	SE
183	246	Vb Fault Voltage	4	SE
183	247	Vc Fault Voltage	4	SE
183	249	60 CTS-I-PhA	2	SE, GI
183	250	60 CTS-I-PhB	2	SE, GI
183	251	60 CTS-I-PhC	2	SE, GI
200	1	CB 1	1	SE, GI
			20	Ack, Nak
200	150	User SP Command 1	1	SE, GI
			20	Ack, Nak
200	151	User SP Command 2	1	SE, GI
			20	Ack, Nak
200	152	User SP Command 3	1	SE, GI
			20	Ack, Nak
200	153	User SP Command 4	1	SE, GI
			20	Ack, Nak
200	154	User SP Command 5	1	SE, GI
			20	Ack, Nak
200	155	User SP Command 6	1	SE, GI
			20	Ack, Nak
200	156	User SP Command 7	1	SE, GI
			20	Ack, Nak
200	157	User SP Command 8	1	SE, GI
			20	Ack, Nak
200	158	User DP Command 1	1	SE
			20	Ack, Nak
200	159	User DP Command 2	1	SE
			20	Ack, Nak
200	160	User DP Command 3	1	SE
			20	Ack, Nak
200	161	User DP Command 4	1	SE
			20	Ack, Nak
200	162	User DP Command 5	1	SE
			20	Ack, Nak
200	163	User DP Command 6	1	SE

Function	Information Number	Description	ASDU Type	Cause of Transmission
			20	Ack, Nak
200	164	User DP Command 7	1	SE
			20	Ack, Nak
200	165	User DP Command 8	1	SE
			20	Ack, Nak
200	200	Trip & Reclose	1	SE
			20	Ack, Nak
200	201	Trip & Lockout	1	SE
			20	Ack, Nak
200	255	Blocked by Interlocking	1	SE,GI
255	0	Time Synchronisation	6	Time Synchronisation
255	0	GI Initiation	7	End of GI
255	0	End of GI	8	End of GI

**Measurand**

Function	Information Number	Description	Function Type	Cause of Transmission
183	148	Measurand I <sub>L1</sub> (2.4 x) I <sub>L2</sub> (2.4 x) I <sub>L3</sub> (2.4 x) V <sub>L1</sub> (1.2 x) V <sub>L2</sub> (1.2 x) V <sub>L3</sub> (1.2 x) P (2.4 x) Q (2.4 x) F (1.2 x) V <sub>L1-2</sub> (1.2 x) V <sub>L2-3</sub> (1.2 x) V <sub>L3-1</sub> (1.2 x)	9	Cyclic – Refresh rate 5 seconds or value change greater than 1%

**Disturbance Recorder Actual Channel (ACC) Numbers**

Function	ACC Number	Description
182	0	Global
182	1	Va
182	2	Vb
182	3	Vc
182	4	Not Used
182	5	Ia
182	6	Ib
182	7	Ic
182	8	Ig1



### 3.3 EVENTS LIST BY RELAY MODEL

#### 3.3.1 7SR10

FUN	INF	Event						
			7SR1002-1xx10-xCA0	7SR1003-1xx10-xCA0	7SR1003-2xx10-xCA0	7SR1002-1xx10-xDA0	7SR1003-1xx10-xDA0	7SR1003-2xx10-xDA0
60	4	Remote Mode	•	•	•	•	•	•
60	5	Out of Service Mode	•	•	•	•	•	•
60	6	Local Mode	•	•	•	•	•	•
60	7	Local & Remote	•	•	•	•	•	•
60	12	Control Received	•	•	•	•	•	•
60	13	Command Received	•	•	•	•	•	•
60	128	Cold Start	•	•	•	•	•	•
60	129	Warm Start	•	•	•	•	•	•
60	130	Re-Start	•	•	•	•	•	•
60	131	Expected Restart	•	•	•	•	•	•
60	132	Unexpected Restart	•	•	•	•	•	•
60	133	Reset Start Count	•	•	•	•	•	•
60	135	Trigger Storage	•	•	•	•	•	•
60	136	Clear Waveform Records	•	•	•	•	•	•
60	137	Clear Fault Records	•	•	•	•	•	•
60	138	Clear Event Records	•	•	•	•	•	•
60	140	Demand metering reset	•	•	•	•	•	•
60	170	General Alarm 1	•	•	•	•	•	•
60	171	General Alarm 2	•	•	•	•	•	•
60	172	General Alarm 3	•	•	•	•	•	•
60	173	General Alarm 4	•	•	•	•	•	•
60	174	General Alarm 5	•	•	•	•	•	•
60	175	General Alarm 6	•	•	•	•	•	•
60	182	Quick Logic E1	•	•	•	•	•	•
60	183	Quick Logic E2	•	•	•	•	•	•
60	184	Quick Logic E3	•	•	•	•	•	•
60	185	Quick Logic E4	•	•	•	•	•	•
70	5	Binary Input 5		•	•	•	•	•
70	6	Binary Input 6		•	•	•	•	•
75	1	Virtual Input 1	•	•	•	•	•	•
75	2	Virtual Input 2	•	•	•	•	•	•
75	3	Virtual Input 3	•	•	•	•	•	•
75	4	Virtual Input 4	•	•	•	•	•	•
75	5	Virtual Input 5	•	•	•	•	•	•
75	6	Virtual Input 6	•	•	•	•	•	•
75	7	Virtual Input 7	•	•	•	•	•	•
75	8	Virtual Input 8	•	•	•	•	•	•
80	1	Binary Output 1	•	•	•	•	•	•
80	2	Binary Output 2	•	•	•	•	•	•
80	3	Binary Output 3	•	•	•	•	•	•
80	4	Binary Output 4		•	•		•	•
80	5	Binary Output 5		•	•		•	•
80	6	Binary Output 6		•	•		•	•
80	7	Binary Output 7						
80	8	Binary Output 8						
90	1	LED 1	•	•	•	•	•	•

FUN	INF	Event						
			7SR1002-1xx10-xCA0	7SR1003-1xx10-xCA0	7SR1003-2xx10-xCA0	7SR1002-1xx10-xDA0	7SR1003-1xx10-xDA0	7SR1003-2xx10-xDA0
90	2	LED 2	•	•	•	•	•	•
90	3	LED 3	•	•	•	•	•	•
90	4	LED 4	•	•	•	•	•	•
90	5	LED 5	•	•	•	•	•	•
90	6	LED 6	•	•	•	•	•	•
90	7	LED 7	•	•	•	•	•	•
90	8	LED 8	•	•	•	•	•	•
90	9	LED 9	•	•	•	•	•	•
91	1	LED PU 1	•	•	•	•	•	•
91	2	LED PU 2	•	•	•	•	•	•
91	3	LED PU 3	•	•	•	•	•	•
91	4	LED PU 4	•	•	•	•	•	•
91	5	LED PU 5	•	•	•	•	•	•
91	6	LED PU 6	•	•	•	•	•	•
91	7	LED PU 7	•	•	•	•	•	•
91	8	LED PU 8	•	•	•	•	•	•
91	9	LED PU 9	•	•	•	•	•	•
160	2	Reset FCB	•	•	•	•	•	•
160	3	Reset CU	•	•	•	•	•	•
160	4	Start/Restart	•	•	•	•	•	•
160	5	Power On	•	•	•	•	•	•
160	16	Auto-reclose active				•	•	•
160	19	LED Reset	•	•	•	•	•	•
160	22	Settings changed	•	•	•	•	•	•
160	23	Setting Group 1 selected	•	•	•	•	•	•
160	24	Setting Group 2 selected	•	•	•	•	•	•
160	25	Setting Group 3 selected						
160	26	Setting Group 4 selected						
160	27	Binary Input 1	•	•	•	•	•	•
160	28	Binary Input 2	•	•	•	•	•	•
160	29	Binary Input 3	•	•	•	•	•	•
160	30	Binary Input 4		•	•		•	•
160	36	Trip Circuit Fail	•	•	•	•	•	•
160	64	Start/Pick-up L1	•	•	•	•	•	•
160	65	Start/Pick-up L2	•	•	•	•	•	•
160	66	Start/Pick-up L3	•	•	•	•	•	•
160	67	Start/Pick-up N	•	•	•	•	•	•
160	68	General Trip	•	•	•	•	•	•
160	69	Trip L1	•	•	•	•	•	•
160	70	Trip L2	•	•	•	•	•	•
160	71	Trip L3	•	•	•	•	•	•
160	84	General Start/Pick-up	•	•	•	•	•	•
160	85	Circuit Breaker Failure	•	•	•	•	•	•
160	90	Trip I>	•	•	•	•	•	•
160	91	Trip I>>	•	•	•	•	•	•
160	92	Trip In>	•	•	•	•	•	•
160	93	Trip In>>	•	•	•	•	•	•
160	128	CB on by auto reclose				•	•	•
160	130	Reclose blocked				•	•	•
183	0	Data Lost	•	•	•	•	•	•
183	10	51-1	•	•	•	•	•	•

FUN	INF	Event						
			7SR1002-1xx10-xCA0	7SR1003-1xx10-xCA0	7SR1003-2xx10-xCA0	7SR1002-1xx10-xDA0	7SR1003-1xx10-xDA0	7SR1003-2xx10-xDA0
183	11	50-1	•	•	•	•	•	•
183	12	51N-1	•	•	•	•	•	•
183	13	50N-1	•	•	•	•	•	•
183	14	51G-1	•	•	•	•	•	•
183	15	50G-1	•	•	•	•	•	•
183	16	51-2	•	•	•	•	•	•
183	17	50-2	•	•	•	•	•	•
183	18	51N-2	•	•	•	•	•	•
183	19	50N-2	•	•	•	•	•	•
183	20	51G-2	•	•	•	•	•	•
183	21	50G-2	•	•	•	•	•	•
183	34	50BF Stage 2	•	•	•	•	•	•
183	35	49-Alarm	•	•	•	•	•	•
183	36	49-Trip	•	•	•	•	•	•
183	40	60 CTS						
183	41	51SEF-1			•			•
183	42	50SEF-1			•			•
183	43	51SEF-2			•			•
183	44	50SEF-2			•			•
183	49	SEF Out/In			•			•
183	50	46IT	•	•	•	•	•	•
183	51	46DT	•	•	•	•	•	•
183	52	64H						
183	53	E/F Out/In	•	•	•	•	•	•
183	62	37-1						
183	63	37-2						
183	70	46BC	•	•	•	•	•	•
183	96	81HBL2	•	•	•	•	•	•
183	97	81THD	•	•	•	•	•	•
183	101	Trip Circuit Fail 1	•	•	•	•	•	•
183	102	Trip Circuit Fail 2	•	•	•	•	•	•
183	103	Trip Circuit Fail 3	•	•	•	•	•	•
183	114	Close CB Failed	•	•	•	•	•	•
183	115	Open CB Failed	•	•	•	•	•	•
183	116	Reclaim	•	•	•	•	•	•
183	117	Lockout				•	•	•
183	119	Successful DAR Close				•	•	•
183	120	Successful Man Close	•	•	•	•	•	•
183	121	Hotline Working				•	•	•
183	122	Inst Protection Out	•	•	•	•	•	•
183	123	CB Total Trip Count	•	•	•	•	•	•
183	124	CB Delta Trip Count	•	•	•	•	•	•
183	125	CB Count To AR Block				•	•	•
183	126	Reset CB Total Trip Count	•	•	•	•	•	•
183	127	Reset CB Delta Trip Count	•	•	•	•	•	•
183	128	Reset CB Count To AR Block				•	•	•
183	129	I <sup>2</sup> t CB Wear	•	•	•	•	•	•
183	130	Reset I <sup>2</sup> t CB Wear	•	•	•	•	•	•
183	131	79 AR In progress				•	•	•
183	132	CB Frequent Ops Count				•	•	•
183	133	Reset CB Frequent Ops Count				•	•	•

FUN	INF	Event						
			7SR1002-1xx10-xCA0	7SR1003-1xx10-xCA0	7SR1003-2xx10-xCA0	7SR1002-1xx10-xDA0	7SR1003-1xx10-xDA0	7SR1003-2xx10-xDA0
183	140	Cold Load Active	•	•	•	•	•	•
183	141	P/F Inst Protection Inhibited				•	•	•
183	142	E/F Inst Protection Inhibited				•	•	•
183	143	SEF Inst Protection Inhibited						•
183	144	Ext Inst Protection Inhibited				•	•	•
183	163	Trip Time Alarm	•	•	•	•	•	•
183	164	Close Circuit Fail 1	•	•	•	•	•	•
183	165	Close Circuit Fail 2	•	•	•	•	•	•
183	166	Close Circuit Fail 3	•	•	•	•	•	•
183	167	Close Circuit Fail	•	•	•	•	•	•
183	171	60 CTS-I						
183	181	CB Total Trip Count	•	•	•	•	•	•
183	182	CB Delta Trip Count	•	•	•	•	•	•
183	183	CB Count To AR Block				•	•	•
183	184	CB Freq Ops Count				•	•	•
183	222	37-PhA						
183	223	37-PhB						
183	224	37-PhC						
183	225	50 LC-1						
183	226	50 LC-2						
183	227	50G LC-1						
183	228	50G LC-2						
183	229	50SEF LC-1						
183	230	50SEF LC-2						
183	231	50BF-PhA	•	•	•	•	•	•
183	232	50BF-PhB	•	•	•	•	•	•
183	233	50BF-PhC	•	•	•	•	•	•
183	234	50BF-EF	•	•	•	•	•	•
183	235	79 Last Trip Lockout				•	•	•
183	239	In Fault Current	•	•	•	•	•	•
183	240	Ia Fault Current	•	•	•	•	•	•
183	241	Ib Fault Current	•	•	•	•	•	•
183	242	Ic Fault Current	•	•	•	•	•	•
183	243	Ig Fault Current	•	•		•	•	
183	244	Isef Fault Current			•			•
183	249	60 CTS-I-PhA						
183	250	60 CTS-I-PhB						
183	251	60 CTS-I-PhC						
200	1	CB 1	•	•	•	•	•	•
200	200	CB 1 Trip & Reclose				•	•	•
200	201	CB 1 Trip & Lockout				•	•	•
200	255	Blocked By Interlocking				•	•	•
255	0	Time Synchronisation	•	•	•	•	•	•
255	0	GI Initiation	•	•	•	•	•	•
255	0	End of GI	•	•	•	•	•	•

3.3.2 7SR11

FUN	INF	Event														
			7SR1101-1xA12-xCA0	7SR1101-3xA12-xCA0	7SR1102-1xA12-xAA0	7SR1102-1xA12-xCA0	7SR1102-1xA12-xDA0	7SR1102-3xA12-xCA0	7SR1102-3xA12-xDA0	7SR1103-1xA12-xCA0	7SR1103-1xA12-xDA0	7SR1103-3xA12-xCA0	7SR1103-3xA12-xDA0			
60	4	Remote Mode	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	5	Out of Service Mode	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	6	Local Mode	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	7	Local & Remote	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	12	Control Received	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	13	Command Received	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	128	Cold Start	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	129	Warm Start	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	130	Re-Start	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	131	Expected Restart	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	132	Unexpected Restart	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	133	Reset Start Count	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	135	Trigger Storage	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	136	Clear Waveform Records	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	137	Clear Fault Records	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	138	Clear Event Records	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	140	Demand metering reset	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	170	General Alarm 1	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	171	General Alarm 2	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	172	General Alarm 3	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	173	General Alarm 4	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	174	General Alarm 5	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	175	General Alarm 6	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	182	Quick Logic E1	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	183	Quick Logic E2	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	184	Quick Logic E3	•	•	•	•	•	•	•	•	•	•	•	•	•	•
60	185	Quick Logic E4	•	•	•	•	•	•	•	•	•	•	•	•	•	•
70	5	Binary Input 5									•	•	•	•	•	•
70	6	Binary Input 6									•	•	•	•	•	•
75	1	Virtual Input 1	•	•	•	•	•	•	•	•	•	•	•	•	•	•
75	2	Virtual Input 2	•	•	•	•	•	•	•	•	•	•	•	•	•	•
75	3	Virtual Input 3	•	•	•	•	•	•	•	•	•	•	•	•	•	•
75	4	Virtual Input 4	•	•	•	•	•	•	•	•	•	•	•	•	•	•
75	5	Virtual Input 5	•	•	•	•	•	•	•	•	•	•	•	•	•	•
75	6	Virtual Input 6	•	•	•	•	•	•	•	•	•	•	•	•	•	•
75	7	Virtual Input 7	•	•	•	•	•	•	•	•	•	•	•	•	•	•
75	8	Virtual Input 8	•	•	•	•	•	•	•	•	•	•	•	•	•	•
80	1	Binary Output 1	•	•	•	•	•	•	•	•	•	•	•	•	•	•
80	2	Binary Output 2	•	•	•	•	•	•	•	•	•	•	•	•	•	•
80	3	Binary Output 3	•	•	•	•	•	•	•	•	•	•	•	•	•	•
80	4	Binary Output 4	•	•	•	•	•	•	•	•	•	•	•	•	•	•
80	5	Binary Output 5	•	•	•	•	•	•	•	•	•	•	•	•	•	•
80	6	Binary Output 6									•	•	•	•	•	•
80	7	Binary Output 7									•	•	•	•	•	•
80	8	Binary Output 8									•	•	•	•	•	•
90	1	LED 1	•	•	•	•	•	•	•	•	•	•	•	•	•	•
90	2	LED 2	•	•	•	•	•	•	•	•	•	•	•	•	•	•
90	3	LED 3	•	•	•	•	•	•	•	•	•	•	•	•	•	•
90	4	LED 4	•	•	•	•	•	•	•	•	•	•	•	•	•	•
90	5	LED 5	•	•	•	•	•	•	•	•	•	•	•	•	•	•

FUN	INF	Event													
			7SR1101-1xA12-xCA0	7SR1101-3xA12-xCA0	7SR1102-1xA12-xAA0	7SR1102-1xA12-xCA0	7SR1102-1xA12-xDA0	7SR1102-3xA12-xCA0	7SR1102-3xA12-xDA0	7SR1103-1xA12-xCA0	7SR1103-1xA12-xDA0	7SR1103-3xA12-xCA0	7SR1103-3xA12-xDA0		
90	6	LED 6	•	•	•	•	•	•	•	•	•	•	•	•	•
90	7	LED 7	•	•	•	•	•	•	•	•	•	•	•	•	•
90	8	LED 8	•	•	•	•	•	•	•	•	•	•	•	•	•
90	9	LED 9	•	•	•	•	•	•	•	•	•	•	•	•	•
91	1	LED PU 1	•	•	•	•	•	•	•	•	•	•	•	•	•
91	2	LED PU 2	•	•	•	•	•	•	•	•	•	•	•	•	•
91	3	LED PU 3	•	•	•	•	•	•	•	•	•	•	•	•	•
91	4	LED PU 4	•	•	•	•	•	•	•	•	•	•	•	•	•
91	5	LED PU 5	•	•	•	•	•	•	•	•	•	•	•	•	•
91	6	LED PU 6	•	•	•	•	•	•	•	•	•	•	•	•	•
91	7	LED PU 7	•	•	•	•	•	•	•	•	•	•	•	•	•
91	8	LED PU 8	•	•	•	•	•	•	•	•	•	•	•	•	•
91	9	LED PU 9	•	•	•	•	•	•	•	•	•	•	•	•	•
160	2	Reset FCB	•	•	•	•	•	•	•	•	•	•	•	•	•
160	3	Reset CU	•	•	•	•	•	•	•	•	•	•	•	•	•
160	4	Start/Restart	•	•	•	•	•	•	•	•	•	•	•	•	•
160	5	Power On	•	•	•	•	•	•	•	•	•	•	•	•	•
160	16	Auto-reclose active						•		•		•			•
160	19	LED Reset	•	•	•	•	•	•	•	•	•	•	•	•	•
160	22	Settings changed	•	•	•	•	•	•	•	•	•	•	•	•	•
160	23	Setting Group 1 selected	•	•	•	•	•	•	•	•	•	•	•	•	•
160	24	Setting Group 2 selected	•	•	•	•	•	•	•	•	•	•	•	•	•
160	25	Setting Group 3 selected	•	•	•	•	•	•	•	•	•	•	•	•	•
160	26	Setting Group 4 selected	•	•	•	•	•	•	•	•	•	•	•	•	•
160	27	Binary Input 1	•	•	•	•	•	•	•	•	•	•	•	•	•
160	28	Binary Input 2	•	•	•	•	•	•	•	•	•	•	•	•	•
160	29	Binary Input 3	•	•	•	•	•	•	•	•	•	•	•	•	•
160	30	Binary Input 4	•	•	•	•	•	•	•	•	•	•	•	•	•
160	36	Trip Circuit Fail	•	•	•	•	•	•	•	•	•	•	•	•	•
160	64	Start/Pick-up L1			•	•	•	•	•	•	•	•	•	•	•
160	65	Start/Pick-up L2			•	•	•	•	•	•	•	•	•	•	•
160	66	Start/Pick-up L3			•	•	•	•	•	•	•	•	•	•	•
160	67	Start/Pick-up N			•	•	•	•	•	•	•	•	•	•	•
160	68	General Trip	•	•	•	•	•	•	•	•	•	•	•	•	•
160	69	Trip L1			•	•	•	•	•	•	•	•	•	•	•
160	70	Trip L2			•	•	•	•	•	•	•	•	•	•	•
160	71	Trip L3			•	•	•	•	•	•	•	•	•	•	•
160	84	General Start/Pick-up	•	•	•	•	•	•	•	•	•	•	•	•	•
160	85	Circuit Breaker Failure			•	•	•	•	•	•	•	•	•	•	•
160	90	Trip I>			•	•	•	•	•	•	•	•	•	•	•
160	91	Trip I>>			•	•	•	•	•	•	•	•	•	•	•
160	92	Trip In>	•		•	•	•	•	•	•	•	•	•	•	•
160	93	Trip In>>	•		•	•	•	•	•	•	•	•	•	•	•
160	128	CB on by auto reclose						•							•
160	130	Reclose blocked						•							•
183	0	Data Lost	•	•	•	•	•	•	•	•	•	•	•	•	•
183	10	51-1			•	•	•	•	•	•	•	•	•	•	•
183	11	50-1			•	•	•	•	•	•	•	•	•	•	•
183	12	51N-1			•	•	•	•	•	•	•	•	•	•	•
183	13	50N-1			•	•	•	•	•	•	•	•	•	•	•
183	14	51G-1	•		•	•	•	•			•	•			

FUN	INF	Event													
			7SR1101-1xA12-xCA0	7SR1101-3xA12-xCA0	7SR1102-1xA12-xAA0	7SR1102-1xA12-xCA0	7SR1102-1xA12-xDA0	7SR1102-3xA12-xCA0	7SR1102-3xA12-xDA0	7SR1103-1xA12-xCA0	7SR1103-1xA12-xDA0	7SR1103-3xA12-xCA0	7SR1103-3xA12-xDA0		
183	15	50G-1	•		•	•	•	•	•	•	•	•	•	•	•
183	16	51-2			•	•	•	•	•	•	•	•	•	•	•
183	17	50-2			•	•	•	•	•	•	•	•	•	•	•
183	18	51N-2			•	•	•	•	•	•	•	•	•	•	•
183	19	50N-2			•	•	•	•	•	•	•	•	•	•	•
183	20	51G-2	•		•	•	•	•	•	•	•	•	•	•	•
183	21	50G-2	•		•	•	•	•	•	•	•	•	•	•	•
183	34	50BF Stage 2			•	•	•	•	•	•	•	•	•	•	•
183	35	49-Alarm			•	•	•	•	•	•	•	•	•	•	•
183	36	49-Trip			•	•	•	•	•	•	•	•	•	•	•
183	40	60 CTS			•	•	•	•	•	•	•	•	•	•	•
183	41	51SEF-1		•				•	•	•	•	•	•	•	•
183	42	50SEF-1		•				•	•	•	•	•	•	•	•
183	43	51SEF-2		•				•	•	•	•	•	•	•	•
183	44	50SEF-2		•				•	•	•	•	•	•	•	•
183	49	SEF Out/In		•				•	•	•	•	•	•	•	•
183	50	46IT				•	•	•	•	•	•	•	•	•	•
183	51	46DT				•	•	•	•	•	•	•	•	•	•
183	52	64H	•	•				•	•	•	•	•	•	•	•
183	53	E/F Out/In	•			•	•	•	•	•	•	•	•	•	•
183	62	37-1	•	•		•	•	•	•	•	•	•	•	•	•
183	63	37-2	•	•		•	•	•	•	•	•	•	•	•	•
183	70	46BC			•	•	•	•	•	•	•	•	•	•	•
183	96	81HBL2	•		•	•	•	•	•	•	•	•	•	•	•
183	101	Trip Circuit Fail 1	•	•	•	•	•	•	•	•	•	•	•	•	•
183	102	Trip Circuit Fail 2	•	•	•	•	•	•	•	•	•	•	•	•	•
183	103	Trip Circuit Fail 3	•	•	•	•	•	•	•	•	•	•	•	•	•
183	114	Close CB Failed	•	•		•	•	•	•	•	•	•	•	•	•
183	115	Open CB Failed	•	•		•	•	•	•	•	•	•	•	•	•
183	116	Reclaim	•	•		•	•	•	•	•	•	•	•	•	•
183	117	Lockout	•	•		•	•	•	•	•	•	•	•	•	•
183	119	Successful DAR Close						•		•		•		•	
183	120	Successful Man Close	•	•		•	•	•	•	•	•	•	•	•	•
183	121	Hotline Working						•		•		•		•	
183	122	Inst Protection Out						•		•		•		•	
183	123	CB Total Trip Count	•	•	•	•	•	•	•	•	•	•	•	•	•
183	124	CB Delta Trip Count	•	•	•	•	•	•	•	•	•	•	•	•	•
183	125	CB Count To AR Block						•		•		•		•	
183	126	Reset CB Total Trip Count	•	•	•	•	•	•	•	•	•	•	•	•	•
183	127	Reset CB Delta Trip Count	•	•	•	•	•	•	•	•	•	•	•	•	•
183	128	Reset CB Count To AR Block						•		•		•		•	
183	129	I^2t CB Wear			•	•	•	•	•	•	•	•	•	•	•
183	130	Reset I^2t CB Wear			•	•	•	•	•	•	•	•	•	•	•
183	131	79 AR In progress						•		•		•		•	
183	132	CB Frequent Ops Count						•		•		•		•	
183	133	Reset CB Frequent Ops Count						•		•		•		•	
183	140	Cold Load Active				•	•	•	•	•	•	•	•	•	•
183	141	P/F Inst Protection Inhibited						•		•		•		•	
183	142	E/F Inst Protection Inhibited						•		•		•		•	
183	143	SEF Inst Protection Inhibited						•		•		•		•	
183	144	Ext Inst Protection Inhibited						•		•		•		•	

FUN	INF	Event												
			7SR1101-1xA12-xCA0	7SR1101-3xA12-xCA0	7SR1102-1xA12-xAA0	7SR1102-1xA12-xCA0	7SR1102-1xA12-xDA0	7SR1102-3xA12-xCA0	7SR1102-3xA12-xDA0	7SR1103-1xA12-xCA0	7SR1103-1xA12-xDA0	7SR1103-3xA12-xCA0	7SR1103-3xA12-xDA0	
183	163	Trip Time Alarm	•	•	•	•	•	•	•	•	•	•	•	•
183	164	Close Circuit Fail 1	•	•	•	•	•	•	•	•	•	•	•	•
183	165	Close Circuit Fail 2	•	•	•	•	•	•	•	•	•	•	•	•
183	166	Close Circuit Fail 3	•	•	•	•	•	•	•	•	•	•	•	•
183	167	Close Circuit Fail	•	•	•	•	•	•	•	•	•	•	•	•
183	171	60 CTS-I												
183	181	CB Total Trip Count	•	•	•	•	•	•	•	•	•	•	•	•
183	182	CB Delta Trip Count	•	•	•	•	•	•	•	•	•	•	•	•
183	183	CB Count To AR Block												
183	184	CB Freq Ops Count	•	•	•	•	•	•	•	•	•	•	•	•
183	222	37-PhA	•	•		•	•	•	•	•	•	•	•	•
183	223	37-PhB	•	•		•	•	•	•	•	•	•	•	•
183	224	37-PhC	•	•		•	•	•	•	•	•	•	•	•
183	225	50 LC-1				•	•	•	•	•	•	•	•	•
183	226	50 LC-2				•	•	•	•	•	•	•	•	•
183	227	50G LC-1				•	•	•	•	•	•	•	•	•
183	228	50G LC-2				•	•	•	•	•	•	•	•	•
183	229	50SEF LC-1							•					•
183	230	50SEF LC-2							•					•
183	231	50BF-PhA	•	•	•	•	•	•	•	•	•	•	•	•
183	232	50BF-PhB	•	•	•	•	•	•	•	•	•	•	•	•
183	233	50BF-PhC	•	•	•	•	•	•	•	•	•	•	•	•
183	234	50BF-EF	•	•	•	•	•	•	•	•	•	•	•	•
183	235	79 Last Trip Lockout						•		•				•
183	239	In Fault Current			•	•	•	•	•	•	•	•	•	•
183	240	Ia Fault Current			•	•	•	•	•	•	•	•	•	•
183	241	Ib Fault Current			•	•	•	•	•	•	•	•	•	•
183	242	Ic Fault Current			•	•	•	•	•	•	•	•	•	•
183	243	Ig Fault Current	•	•	•	•	•	•	•	•	•	•	•	•
183	244	Isef Fault Current		•				•	•				•	•
183	249	60 CTS-I-PhA	•	•	•	•	•	•	•	•	•	•	•	•
183	250	60 CTS-I-PhB	•	•	•	•	•	•	•	•	•	•	•	•
183	251	60 CTS-I-PhC	•	•	•	•	•	•	•	•	•	•	•	•
200	1	CB 1	•	•	•	•	•	•	•	•	•	•	•	•
200	200	CB 1 Trip & Reclose						•		•				•
200	201	CB 1 Trip & Lockout						•		•				•
200	255	Blocked By Interlocking	•	•	•	•	•	•	•	•	•	•	•	•
255	0	Time Synchronisation	•	•	•	•	•	•	•	•	•	•	•	•
255	0	GI Initiation	•	•	•	•	•	•	•	•	•	•	•	•
255	0	End of GI	•	•	•	•	•	•	•	•	•	•	•	•



3.3.3 7SR12

FUN	INF	Event	7SR1204-2xA12-xCA0	7SR1204-4xA12-xCA0	7SR1205-2xA12-xCA0	7SR1205-2xA12-xDA0	7SR1205-4xA12-xCA0	7SR1205-4xA12-xDA0	7SR1206-2xA12-xCA0	7SR1206-2xA12-xDA0	7SR1206-4xA12-xCA0	7SR1206-4xA12-xDA0
60	4	Remote Mode	•	•	•	•	•	•	•	•	•	•
60	5	Out of Service Mode	•	•	•	•	•	•	•	•	•	•
60	6	Local Mode	•	•	•	•	•	•	•	•	•	•
60	7	Local & Remote	•	•	•	•	•	•	•	•	•	•
60	12	Control Received	•	•	•	•	•	•	•	•	•	•
60	13	Command Received	•	•	•	•	•	•	•	•	•	•
60	128	Cold Start	•	•	•	•	•	•	•	•	•	•
60	129	Warm Start	•	•	•	•	•	•	•	•	•	•
60	130	Re-Start	•	•	•	•	•	•	•	•	•	•
60	131	Expected Restart	•	•	•	•	•	•	•	•	•	•
60	132	Unexpected Restart	•	•	•	•	•	•	•	•	•	•
60	133	Reset Start Count	•	•	•	•	•	•	•	•	•	•
60	135	Trigger Storage	•	•	•	•	•	•	•	•	•	•
60	136	Clear Waveform Records	•	•	•	•	•	•	•	•	•	•
60	137	Clear Fault Records	•	•	•	•	•	•	•	•	•	•
60	138	Clear Event Records	•	•	•	•	•	•	•	•	•	•
60	140	Demand metering reset	•	•	•	•	•	•	•	•	•	•
60	170	General Alarm 1	•	•	•	•	•	•	•	•	•	•
60	171	General Alarm 2	•	•	•	•	•	•	•	•	•	•
60	172	General Alarm 3	•	•	•	•	•	•	•	•	•	•
60	173	General Alarm 4	•	•	•	•	•	•	•	•	•	•
60	174	General Alarm 5	•	•	•	•	•	•	•	•	•	•
60	175	General Alarm 6	•	•	•	•	•	•	•	•	•	•
60	182	Quick Logic E1	•	•	•	•	•	•	•	•	•	•
60	183	Quick Logic E2	•	•	•	•	•	•	•	•	•	•
60	184	Quick Logic E3	•	•	•	•	•	•	•	•	•	•
60	185	Quick Logic E4	•	•	•	•	•	•	•	•	•	•
70	5	Binary Input 5							•	•	•	•
70	6	Binary Input 6							•	•	•	•
75	1	Virtual Input 1	•	•	•	•	•	•	•	•	•	•
75	2	Virtual Input 2	•	•	•	•	•	•	•	•	•	•
75	3	Virtual Input 3	•	•	•	•	•	•	•	•	•	•
75	4	Virtual Input 4	•	•	•	•	•	•	•	•	•	•
75	5	Virtual Input 5	•	•	•	•	•	•	•	•	•	•
75	6	Virtual Input 6	•	•	•	•	•	•	•	•	•	•
75	7	Virtual Input 7	•	•	•	•	•	•	•	•	•	•
75	8	Virtual Input 8	•	•	•	•	•	•	•	•	•	•
80	1	Binary Output 1	•	•	•	•	•	•	•	•	•	•
80	2	Binary Output 2	•	•	•	•	•	•	•	•	•	•
80	3	Binary Output 3	•	•	•	•	•	•	•	•	•	•
80	4	Binary Output 4	•	•	•	•	•	•	•	•	•	•
80	5	Binary Output 5	•	•	•	•	•	•	•	•	•	•
80	6	Binary Output 6							•	•	•	•
80	7	Binary Output 7							•	•	•	•
80	8	Binary Output 8							•	•	•	•
90	1	LED 1	•	•	•	•	•	•	•	•	•	•
90	2	LED 2	•	•	•	•	•	•	•	•	•	•
90	3	LED 3	•	•	•	•	•	•	•	•	•	•

FUN	INF	Event													
			7SR1204-2xA12-xCA0	7SR1204-4xA12-xCA0	7SR1205-2xA12-xCA0	7SR1205-2xA12-xDA0	7SR1205-4xA12-xCA0	7SR1205-4xA12-xDA0	7SR1206-2xA12-xCA0	7SR1206-2xA12-xDA0	7SR1206-4xA12-xCA0	7SR1206-4xA12-xDA0			
90	4	LED 4	•	•	•	•	•	•	•	•	•	•	•	•	•
90	5	LED 5	•	•	•	•	•	•	•	•	•	•	•	•	•
90	6	LED 6	•	•	•	•	•	•	•	•	•	•	•	•	•
90	7	LED 7	•	•	•	•	•	•	•	•	•	•	•	•	•
90	8	LED 8	•	•	•	•	•	•	•	•	•	•	•	•	•
90	9	LED 9	•	•	•	•	•	•	•	•	•	•	•	•	•
91	1	LED PU 1	•	•	•	•	•	•	•	•	•	•	•	•	•
91	2	LED PU 2	•	•	•	•	•	•	•	•	•	•	•	•	•
91	3	LED PU 3	•	•	•	•	•	•	•	•	•	•	•	•	•
91	4	LED PU 4	•	•	•	•	•	•	•	•	•	•	•	•	•
91	5	LED PU 5	•	•	•	•	•	•	•	•	•	•	•	•	•
91	6	LED PU 6	•	•	•	•	•	•	•	•	•	•	•	•	•
91	7	LED PU 7	•	•	•	•	•	•	•	•	•	•	•	•	•
91	8	LED PU 8	•	•	•	•	•	•	•	•	•	•	•	•	•
91	9	LED PU 9	•	•	•	•	•	•	•	•	•	•	•	•	•
160	2	Reset FCB	•	•	•	•	•	•	•	•	•	•	•	•	•
160	3	Reset CU	•	•	•	•	•	•	•	•	•	•	•	•	•
160	4	Start/Restart	•	•	•	•	•	•	•	•	•	•	•	•	•
160	5	Power On	•	•	•	•	•	•	•	•	•	•	•	•	•
160	16	Auto-reclose active				•		•		•		•		•	
160	19	LED Reset	•	•	•	•	•	•	•	•	•	•	•	•	•
160	22	Settings changed	•	•	•	•	•	•	•	•	•	•	•	•	•
160	23	Setting G1 selected	•	•	•	•	•	•	•	•	•	•	•	•	•
160	24	Setting G2 selected	•	•	•	•	•	•	•	•	•	•	•	•	•
160	25	Setting G3 selected	•	•	•	•	•	•	•	•	•	•	•	•	•
160	26	Setting G4 selected	•	•	•	•	•	•	•	•	•	•	•	•	•
160	27	Binary Input 1	•	•	•	•	•	•	•	•	•	•	•	•	•
160	28	Binary Input 2	•	•	•	•	•	•	•	•	•	•	•	•	•
160	29	Binary Input 3	•	•	•	•	•	•	•	•	•	•	•	•	•
160	30	Binary Input 4								•	•	•	•	•	•
160	36	Trip Circuit Fail	•	•	•	•	•	•	•	•	•	•	•	•	•
160	38	VT Fuse Failure			•	•	•	•	•	•	•	•	•	•	•
160	51	Earth Fault Forward/Line	•		•	•	•	•	•	•	•	•	•	•	•
160	52	Earth Fault Reverse/Busbar	•		•	•	•	•	•	•	•	•	•	•	•
160	64	Start/Pick-up L1			•	•	•	•	•	•	•	•	•	•	•
160	65	Start/Pick-up L2			•	•	•	•	•	•	•	•	•	•	•
160	66	Start/Pick-up L3			•	•	•	•	•	•	•	•	•	•	•
160	67	Start/Pick-up N			•	•	•	•	•	•	•	•	•	•	•
160	68	General Trip	•	•	•	•	•	•	•	•	•	•	•	•	•
160	69	Trip L1			•	•	•	•	•	•	•	•	•	•	•
160	70	Trip L2			•	•	•	•	•	•	•	•	•	•	•
160	71	Trip L3			•	•	•	•	•	•	•	•	•	•	•
160	74	Fault Forward/Line			•	•	•	•	•	•	•	•	•	•	•
160	75	Fault Reverse/Busbar			•	•	•	•	•	•	•	•	•	•	•
160	84	General Start/Pick-up	•	•	•	•	•	•	•	•	•	•	•	•	•
160	85	Circuit Breaker Failure			•	•	•	•	•	•	•	•	•	•	•
160	90	Trip I>			•	•	•	•	•	•	•	•	•	•	•
160	91	Trip I>>			•	•	•	•	•	•	•	•	•	•	•
160	92	Trip In>	•		•	•	•	•	•	•	•	•	•	•	•
160	93	Trip In>>	•		•	•	•	•	•	•	•	•	•	•	•
160	128	CB on by auto reclose				•		•		•		•		•	

FUN	INF	Event																			
			7SR1204-2xA12-xCA0	7SR1204-4xA12-xCA0	7SR1205-2xA12-xCA0	7SR1205-2xA12-xDA0	7SR1205-4xA12-xCA0	7SR1205-4xA12-xDA0	7SR1206-2xA12-xCA0	7SR1206-2xA12-xDA0	7SR1206-4xA12-xCA0	7SR1206-4xA12-xDA0									
160	130	Reclose blocked																			
183	0	Data Lost	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	10	51-1			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	11	50-1			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	12	51N-1			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	13	50N-1			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	14	51G-1	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	15	50G-1	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	16	51-2			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	17	50-2			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	18	51N-2			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	19	50N-2			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	20	51G-2	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	21	50G-2	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	22	51-3			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	23	50-3			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	24	51N-3			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	25	50N-3			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	26	51G-3	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	27	50G-3	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	28	51-4			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	29	50-4			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	30	51N-4			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	31	50N-4			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	32	51G-4	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	33	50G-4	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	34	50BF Stage 2			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	35	49-Alarm			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	36	49-Trip			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	40	60 CTS			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	41	51SEF-1		•				•	•					•	•			•	•		
183	42	50SEF-1		•				•	•					•	•			•	•		
183	43	51SEF-2		•				•	•					•	•			•	•		
183	44	50SEF-2		•				•	•					•	•			•	•		
183	45	51SEF-3		•				•	•					•	•			•	•		
183	46	50SEF-3		•				•	•					•	•			•	•		
183	47	51SEF-4		•				•	•					•	•			•	•		
183	48	50SEF-4		•				•	•					•	•			•	•		
183	49	SEF Out/In		•				•	•					•	•			•	•		
183	50	46IT			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	51	46DT			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	52	64H	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	53	E/F Out/In	•		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	54	SEF Forward/Line		•				•	•					•	•			•	•		
183	55	SEF Reverse/Busbar		•				•	•					•	•			•	•		
183	60	47-1			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	61	47-2			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	62	37-1	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	63	37-2	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	70	46BC			•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
183	81	27/59-1	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•

FUN	INF	Event													
			7SR1204-2xA12-xCA0	7SR1204-4xA12-xCA0	7SR1205-2xA12-xCA0	7SR1205-2xA12-xDA0	7SR1205-4xA12-xCA0	7SR1205-4xA12-xDA0	7SR1206-2xA12-xCA0	7SR1206-2xA12-xDA0	7SR1206-4xA12-xCA0	7SR1206-4xA12-xDA0			
183	82	27/59-2	•	•	•	•	•	•	•	•	•	•	•	•	•
183	83	27/59-3	•	•	•	•	•	•	•	•	•	•	•	•	•
183	84	27/59-4	•	•	•	•	•	•	•	•	•	•	•	•	•
183	85	59NIT	•	•	•	•	•	•	•	•	•	•	•	•	•
183	86	59NDT	•	•	•	•	•	•	•	•	•	•	•	•	•
183	90	81-1	•	•	•	•	•	•	•	•	•	•	•	•	•
183	91	81-2	•	•	•	•	•	•	•	•	•	•	•	•	•
183	92	81-3	•	•	•	•	•	•	•	•	•	•	•	•	•
183	93	81-4	•	•	•	•	•	•	•	•	•	•	•	•	•
183	96	81HBL2	•	•	•	•	•	•	•	•	•	•	•	•	•
183	101	Trip Circuit Fail 1	•	•	•	•	•	•	•	•	•	•	•	•	•
183	102	Trip Circuit Fail 2	•	•	•	•	•	•	•	•	•	•	•	•	•
183	103	Trip Circuit Fail 3	•	•	•	•	•	•	•	•	•	•	•	•	•
183	114	Close CB Failed	•	•	•	•	•	•	•	•	•	•	•	•	•
183	115	Open CB Failed	•	•	•	•	•	•	•	•	•	•	•	•	•
183	116	Reclaim	•	•	•	•	•	•	•	•	•	•	•	•	•
183	117	Lockout	•	•	•	•	•	•	•	•	•	•	•	•	•
183	119	Successful DAR Close				•		•		•		•		•	
183	120	Successful Man Close	•	•	•	•	•	•	•	•	•	•	•	•	•
183	121	Hotline Working				•		•		•		•		•	
183	122	Inst Protection Out				•		•		•		•		•	
183	123	CB Total Trip Count	•	•	•	•	•	•	•	•	•	•	•	•	•
183	124	CB Delta Trip Count	•	•	•	•	•	•	•	•	•	•	•	•	•
183	125	CB Count To AR Block				•		•		•		•		•	
183	126	Reset CB Total Trip Count	•	•	•	•	•	•	•	•	•	•	•	•	•
183	127	Reset CB Delta Trip Count	•	•	•	•	•	•	•	•	•	•	•	•	•
183	128	Reset CB Count To AR Block				•		•		•		•		•	
183	129	I^2t CB Wear				•		•		•		•		•	
183	130	Reset I^2t CB Wear				•		•		•		•		•	
183	131	79 AR In progress				•		•		•		•		•	
183	132	CB Frequent Ops Count				•		•		•		•		•	
183	133	Reset CB Frequent Ops Count				•		•		•		•		•	
183	140	Cold Load Active				•		•		•		•		•	
183	141	P/F Inst Protection Inhibited				•		•		•		•		•	
183	142	E/F Inst Protection Inhibited				•		•		•		•		•	
183	143	SEF Inst Protection Inhibited				•		•		•		•		•	
183	144	Ext Inst Protection Inhibited				•		•		•		•		•	
183	163	Trip Time Alarm	•	•	•	•	•	•	•	•	•	•	•	•	•
183	164	Close Circuit Fail 1	•	•	•	•	•	•	•	•	•	•	•	•	•
183	165	Close Circuit Fail 2	•	•	•	•	•	•	•	•	•	•	•	•	•
183	166	Close Circuit Fail 3	•	•	•	•	•	•	•	•	•	•	•	•	•
183	167	Close Circuit Fail	•	•	•	•	•	•	•	•	•	•	•	•	•
183	171	60 CTS-I				•		•		•		•		•	
183	172	Act Energy Exp	•	•	•	•	•	•	•	•	•	•	•	•	•
183	173	Act Energy Imp	•	•	•	•	•	•	•	•	•	•	•	•	•
183	174	React Energy Exp	•	•	•	•	•	•	•	•	•	•	•	•	•
183	175	React Energy Imp	•	•	•	•	•	•	•	•	•	•	•	•	•
183	176	Reset Energy Meters	•	•	•	•	•	•	•	•	•	•	•	•	•
183	177	Active Exp Meter Reset	•	•	•	•	•	•	•	•	•	•	•	•	•
183	178	Active Imp Meter Reset	•	•	•	•	•	•	•	•	•	•	•	•	•

FUN	INF	Event												
			7SR1204-2xA12-xCA0	7SR1204-4xA12-xCA0	7SR1205-2xA12-xCA0	7SR1205-2xA12-xDA0	7SR1205-4xA12-xCA0	7SR1205-4xA12-xDA0	7SR1206-2xA12-xCA0	7SR1206-2xA12-xDA0	7SR1206-4xA12-xCA0	7SR1206-4xA12-xDA0		
183	179	Reactive Exp Meter Reset	•	•	•	•	•	•	•	•	•	•	•	•
183	180	Reactive Imp Meter Reset	•	•	•	•	•	•	•	•	•	•	•	•
183	181	CB Total Trip Count	•	•	•	•	•	•	•	•	•	•	•	•
183	182	CB Delta Trip Count	•	•	•	•	•	•	•	•	•	•	•	•
183	183	CB Count To AR Block	•	•	•	•	•	•	•	•	•	•	•	•
183	184	CB Freq Ops Count	•	•	•	•	•	•	•	•	•	•	•	•
183	221	Wattmetric Po>		•			•	•				•	•	•
183	222	37-PhA			•		•	•			•	•	•	•
183	223	37-PhB			•		•	•			•	•	•	•
183	224	37-PhC			•		•	•			•	•	•	•
183	225	50 LC-1	•	•	•	•	•	•	•	•	•	•	•	•
183	226	50 LC-2	•	•	•	•	•	•	•	•	•	•	•	•
183	227	50G LC-1	•	•	•	•	•	•	•	•	•	•	•	•
183	228	50G LC-2	•	•	•	•	•	•	•	•	•	•	•	•
183	229	50SEF LC-1		•			•	•				•	•	•
183	230	50SEF LC-2		•			•	•				•	•	•
183	231	50BF-PhA			•	•	•	•	•	•	•	•	•	•
183	232	50BF-PhB			•	•	•	•	•	•	•	•	•	•
183	233	50BF-PhC			•	•	•	•	•	•	•	•	•	•
183	234	50BF-EF			•	•	•	•	•	•	•	•	•	•
183	235	79 Last Trip Lockout					•		•		•		•	•
183	239	In Fault Current			•	•	•	•	•	•	•	•	•	•
183	240	Ia Fault Current			•	•	•	•	•	•	•	•	•	•
183	241	Ib Fault Current			•	•	•	•	•	•	•	•	•	•
183	242	Ic Fault Current			•	•	•	•	•	•	•	•	•	•
183	243	Ig Fault Current	•		•	•			•	•				
183	244	Isef Fault Current		•			•	•				•	•	•
183	245	Va Fault Voltage	•	•	•	•	•	•	•	•	•	•	•	•
183	246	Vb Fault Voltage	•	•	•	•	•	•	•	•	•	•	•	•
183	247	Vc Fault Voltage	•	•	•	•	•	•	•	•	•	•	•	•
183	249	60 CTS-I-PhA			•	•	•	•	•	•	•	•	•	•
183	250	60 CTS-I-PhB			•	•	•	•	•	•	•	•	•	•
183	251	60 CTS-I-PhC			•	•	•	•	•	•	•	•	•	•
200	1	CB 1	•	•	•	•	•	•	•	•	•	•	•	•
200	200	CB 1 Trip & Reclose					•		•		•		•	•
200	201	CB 1 Trip & Lockout					•		•		•		•	•
200	255	Blocked By Interlocking	•	•	•	•	•	•	•	•	•	•	•	•
255	0	Time Synchronisation	•	•	•	•	•	•	•	•	•	•	•	•
255	0	GI Initiation	•	•	•	•	•	•	•	•	•	•	•	•
255	0	End of GI	•	•	•	•	•	•	•	•	•	•	•	•

## Section 4: Modbus Definitions

### 4.1 INTRODUCTION

This section describes the MODBUS-RTU protocol implementation in the relays. This protocol is used for communication with a suitable control system.

This protocol can be set to use the RS485 port. The relay can communicate simultaneously on all ports regardless of protocol used.


Each relay must be given an address to enable communication and can be set by the *Communication Interface:Relay Address*.

Note that not all definitions are available on all relay models.

### 4.2 MODBUS REGISTER DATA TYPES

#### 4.2.1 FLOAT\_IEEE\_754

The float data type conforms to the IEEE 754 floating point definition. This specifies that 32 bits of data will be formatted as a sign bit in the most significant bit (MSB) followed by an 8 bit exponent then a 23 bit mantissa, down to the least significant bit (LSB).



#### FLOAT\_IEEE\_754 IN DETAIL


The exponent is an 8 bit unsigned integer. To allow for negative exponents, it is offset by 127. Therefore the actual exponent is e - 127. The following table shows a detailed layout of the exponent.

$2^7$	$2^6$	$2^5$	$2^4$	$2^3$	$2^2$	$2^1$	$2^0$
128	64	32	16	8	4	2	1

The mantissa contains the fractional part of a number normalized to the form 1.xyz i.e. in this instance xyz. The mantissa represents the binary fraction of a number; therefore the MSB represents  $2^{-1}$  (or  $1/2^1$ ) and its LSB  $2^{-23}$  (or  $1/2^{23}$ ). The following table shows a detailed layout of the mantissa.

$\frac{1}{2^1}$	$\frac{1}{2^2}$	$\frac{1}{2^3}$	$\frac{1}{2^4}$																						$\frac{1}{2^{21}}$	$\frac{1}{2^{22}}$	$\frac{1}{2^{23}}$			
0.5	0.25	0.125	0.0625																									4.768e-7	2.384e-7	1.192e-7

As an example 1,000,000 would be represented as follows (hex 49742400).



This calculates out as:

Sign = +1

Exponent =  $10010010_2 = 128 + 16 + 2 = 146$ , subtract 127 = 19.

$$\begin{aligned} \text{Mantissa} &= 1 + \frac{1}{2^1} + \frac{1}{2^2} + \frac{1}{2^3} + \frac{1}{2^5} + \frac{1}{2^{10}} + \frac{1}{2^{13}} \\ &= 1 + \frac{4096 + 2048 + 1024 + 256 + 8 + 1}{2^{13}} = 1 + \frac{7433}{2^{13}} = 1.907348632 \end{aligned}$$

Therefore  $\text{Sign} * 2^{\text{Exponent}} * \text{Mantissa} = 1 * 2^{19} * 1.907348632 = 1000000$

## FLOAT\_IEEE\_754 & MODBUS

In this MODBUS implementation the 32 bit float is stored in 2 16 registers in Big-Endian format. As an example, if we take the hex representation of 1,000,000 as a float (from above) we have 49742400h. Assume this is stored in the registers 30001 and 30002, it would look as follows.

Address	Value
30001	4974
30002	2400

On reception these two registers should be interpreted in the correct order as IEEE754 floating point representation.

### 4.2.2 FP\_32BITS\_3DP

The FP\_32BITS\_3DP is a 32 bit integer fixed point value, containing 3 decimal places of information. It is used to send a real value to 3 decimal places as an integer. For example, if the value in a device is 123.456 it will be sent as 123456. As it is an integer, negative numbers are sent as 2's complement.

#### FP\_32BITS\_3DP & MODBUS

In this MODBUS implementation the 32 bit value is stored in 2 16 registers in Big-Endian format. As an example, if we take the hex representation of 123456, we have 1E240h. Assume this is stored in the registers 30001 and 30002, it would look as follows:

Address	Value
30001	1
30002	E240

On reception these two registers should be interpreted in the correct order as a 32 bit integer.

### 4.2.3 UINT32

The UINT32 is a signed 32 bit integer. As it is an integer, negative numbers are sent as 2's complement.

#### UINT32 & MODBUS

In this MODBUS implementation the 32 bit value is stored in 2 16 bit registers in Big-Endian format. As an example, if we take the hex representation of -123456, in 2's complement, we have FFFE1DC0h. Assume this is stored in the registers 30001 and 30002, it would look as follows:

Address	Value
30001	FFFE
30002	1DC0

On reception these two registers should be interpreted in the correct order as a 32 bit integer.

### 4.2.4 UINT16

The UINT16 is a signed 16 bit integer. As it is an integer, negative numbers are sent as 2's complement.

#### UINT16 & MODBUS

In this MODBUS implementation the 16 bit value is stored in a 16 bit register in Big-Endian format. As an example, if we take the hex representation of 5678 we have 162Eh. Assume this is stored in the register 30001, it would look as follows:

Address	Value
30001	162E

On reception this register should be interpreted as a 16 bit integer.

## Truncation

Calculations are performed as 32 bit. The 16 bit value is the lowest 16 bits of the 32 bit value. Therefore, when values overflow the returned value is the lowest 16 bits of the calculated value. For Example, if the value is 85400 = 14D98h, the value returned would be the lowest 16 bits = 4D98h which equals 19864.

### 4.2.5 EVENT

MODBUS does not define a method for extracting events; therefore a private method has been defined based on that defined by IEC60870-5-103.

The EVENT register contains the earliest event record available. The event record is 8 registers (16 bytes) of information, whose format is described below. When this record has been read it will be replaced by the next available record. Event records must be read completely; therefore the quantity value must be set to 8 before reading. Failing to do this will result in an exception code 2. If no event record is present the exception code 2 will be returned. The EVENT register should be polled regularly by the master for events.

The EVENTCOUNT register can be checked periodically to determine how many events are stored.

The format of the event record is defined by the zero byte. It signifies the type of record which is used to decode the event information. The zero byte can be one of the following.

#### Format

The format of the event record is defined by the zero byte. It signifies the type of record which is used to decode the event information. The zero byte can be one of the following.

Type	Description
1	Event
2	Event with Relative Time
4	Measurand Event with Relative Time

The following table describes the fields in the event record.

Key	Description
FUN	Function Type, as defined for IEC870-5-103.
INF	Information Number, as defined for IEC870-5-103.
DPI	Measurand Event with Relative Time, values 1 = OFF, 2 = ON.
ms L	Time Stamp Milliseconds low byte.
ms H	Time Stamp Milliseconds high byte.
Mi	Time Stamp Minutes (MSB = invalid, time not set > 23 hours).
Ho	Time Stamp Hours (MSB = Summer time flag).
RT L	Relative Time low byte.
RT H	Relative Time high byte.
F# L	Fault Number low byte.
F# H	Fault Number high byte.
Meas	Measurand format R32.23, sent least significant byte first.

The following tables show the fields in the different event records as they are returned.

Byte	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Content	1	0	FUN	INF	DPI	0	0	0	0	0	0	0	ms L	ms H	Mi	Ho

*Event Type 1 Format.*



Byte	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Content	2	0	FUN	INF	DPI	RT L	RT H	F# L	F# H	0	0	0	ms L	ms H	Mi	Ho

*Event Type 2 Format.*

Byte	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Content	4	0	FUN	INF	Meas				0	0	0	0	ms L	ms H	Mi	Ho

*Event Type 4 Format.*

#### 4.2.6 EVENTCOUNT

The EVENTCOUNT register contains the current number of events in the relay's event buffer.

On reception this register should be interpreted as a 16 bit integer.

#### 4.2.7 TIME\_METER

The TIME\_METER register contains the device's time. The time must be read or written in one step; therefore the quantity should be 4 registers. Failing to do this will result in an exception code 2. The time format is 8 bytes as follows.

The following table describes the fields in the time.

Key	Description
ms L	Time Stamp Milliseconds low byte.
ms H	Time Stamp Milliseconds high byte.
Mi	Time Stamp Minutes (MSB = invalid, time not set > 23 hours).
Ho	Time Stamp Hours (MSB = Summer time flag).
Da	Time Stamp Days.
Mo	Time Stamp Months.
Ye L	Time Stamp Years low byte.
Ye H	Time Stamp Years high byte (Not Used).

The following table shows the fields in the time as they are returned.

Byte	0	1	2	3	4	5	6	7
Content	ms L	ms H	Mi	Ho	Da	Mo	Ye L	Ye H

*Time Format.*

#### 4.2.8 STR32 & STR64

#### 4.2.9 BITSTRING

A Bit-String (or Bit-Array) is a method of compactly storing a number of bits of data. In this instance we store up to 16 bit values, for example the states of binary inputs, in a single 16 bit register. The first bit value is stored in the Least Significant Bit (LSB) of the register. The 16<sup>th</sup> value would be in the Most Significant Bit (MSB). Bit values can only be zero or one. Any unused bits will be set to zero.

#### BITSTRING & MODBUS

In this MODBUS implementation the 16 bit value is stored in a 16 bit register in Big-Endian format. As an example, assume bits 1, 3, 9 and 12 are set. The binary representation of this would be 00001001000001012 giving a hex representation of 0905h. Assume this is stored in the register 30001, it would look as follows:

Address	Value
30001	0905

On reception this register should be interpreted as a 16 bit integer.

## 4.3 POINTS LIST

### 4.3.1 Coils (Read Write Binary values)

Address	Description
00001	Binary Output 1
00002	Binary Output 2
00003	Binary Output 3
00004	Binary Output 4
00005	Binary Output 5
00006	Binary Output 6
00007	Binary Output 7
00008	Binary Output 8
00100	LED Reset (Write only location)
00101	Settings Group 1
00102	Settings Group 2
00103	Settings Group 3
00104	Settings Group 4
00109	CB 1
00110	CB 1 Trip & Reclose
00111	CB 1 Trip & Lockout
00112	Auto-reclose on/off
00113	Hot Line Working on/off
00114	E/F off/on
00115	SEF off/on
00116	Inst Protection off/on
00118	Reset CB Total Trip Count
00119	Reset CB Delta Trip Count
00120	Reset CB Count To AR Block
00121	Reset CB Frequent Ops Count
00123	Reset I <sup>2</sup> t CB Wear
00126	Demand metering reset
00154	Reset Energy Meters
00155	Remote mode
00156	Service mode
00157	Local mode
00158	Local & Remote
00165	Reset Start Count
00200	User SP Command 1
00201	User SP Command 2
00202	User SP Command 3
00203	User SP Command 4
00204	User SP Command 5
00205	User SP Command 6
00206	User SP Command 7
00207	User SP Command 8
00208	User DP Command 1
00209	User DP Command 2
00210	User DP Command 3
00211	User DP Command 4
00212	User DP Command 5
00213	User DP Command 6
00214	User DP Command 7
00215	User DP Command 8

### 4.3.2 Inputs (Read Only Binary values)

10001	Binary Input 1
10002	Binary Input 2
10003	Binary Input 3
10004	Binary Input 4
10005	Binary Input 5
10006	Binary Input 6
10102	Remote mode
10103	Service mode
10104	Local mode
10105	Local & Remote mode
10111	Trip Circuit Fail
10112	A-Starter
10113	B-Starter
10114	C-Starter
10115	General Starter
10116	VTS Alarm
10117	Earth Fault Forward/Line
10118	Earth Fault Reverse/Busbar
10119	Start/Pick Up N
10120	Fault Forward/Line
10121	Fault Reverse/Busbar
10122	51-1
10123	50-1
10124	51N-1
10125	50N-1
10126	51G-1
10127	50G-1
10128	51-2
10129	50-2
10130	51N-2
10131	50N-2
10132	51G-2
10133	50G-2
10134	51-3
10135	50-3
10136	51N-3
10137	50N-3
10138	51G-3
10139	50G-3
10140	51-4
10141	50-4
10142	51N-4
10143	50N-4
10144	51G-4
10145	50G-4
10146	50BF Stage 2
10147	49 Alarm
10148	49 Trip
10149	60 CTS
10150	46IT
10151	46DT
10152	47-1
10153	47-2
10154	46BC
10155	27/59-1
10156	27/59-2
10157	27/59-3
10158	27/59-4
10159	59NIT
10160	59NDT
10161	81-1
10162	81-2

10163	81-3
10164	81-4
10167	64H
10168	37-1
10169	37-2
10171	AR Active
10172	CB on by AR
10173	Reclaim
10174	Lockout
10175	Hot Line Working
10176	Inst Protection Out
10177	CB Trip Count Maint
10178	CB Trip Count Delta
10179	CB Trip Count Lockout
10180	I <sup>2</sup> t CB Wear
10181	79 AR In Progress
10182	Cold Load Active
10183	E/F Protection Out
10184	P/F Inst Protection Inhibited
10185	E/F Inst Protection Inhibited
10186	SEF Inst Protection Inhibited
10187	Ext Inst Protection Inhibited
10202	51SEF-1
10203	50SEF-1
10204	51SEF-2
10205	50SEF-2
10206	51SEF-3
10207	50SEF-3
10208	51SEF-4
10209	50SEF-4
10210	SEF Out
10211	Trip Circuit Fail 1
10212	Trip Circuit Fail 2
10213	Trip Circuit Fail 3
10214	CB Total Trip Count
10215	CB Delta Trip Count
10216	CB Count to AR Block
10217	CB Frequent Ops Count
10218	I <sup>2</sup> t CB Wear
10219	CB Open
10220	CB Closed
10283	Close Circuit Fail 1
10284	Close Circuit Fail 2
10285	Close Circuit Fail 3
10286	Close Circuit Fail
10288	SEF Forward/Line
10289	SEF Reverse/Busbar
10290	General Alarm 1
10291	General Alarm 2
10292	General Alarm 3
10293	General Alarm 4
10294	General Alarm 5
10295	General Alarm 6
10302	Quick Logic E1
10303	Quick Logic E2
10304	Quick Logic E3
10305	Quick Logic E4
10334	60 CTS-I
10335	81HBL2
10336	37G-1
10337	37G-2
10338	37SEF-1

10339	37SEF-2
10367	50BF-1
10368	Wattmetric Po>
10369	37-PhA
10370	37-PhB
10371	37-PhC
10372	50 LC-1
10373	50 LC-2
10374	50G LC-1
10375	50G LC-2
10376	50SEF LC-1
10377	50SEF LC-2
10378	50BF-PhA
10379	50BF-PhB
10380	50BF-PhC
10381	50BF-EF
10382	79 Last Trip Lockout
10383	60 CTS-I-PhA
10384	60 CTS-I-PhB
10385	60 CTS-I-PhC
10501	Virtual Input 1
10502	Virtual Input 2
10503	Virtual Input 3
10504	Virtual Input 4
10505	Virtual Input 5
10506	Virtual Input 6
10507	Virtual Input 7
10508	Virtual Input 8
10601	LED 1
10602	LED 2
10603	LED 3
10604	LED 4
10605	LED 5
10606	LED 6
10607	LED 7
10608	LED 8
10609	LED 9
10701	LED PU 1
10702	LED PU 2
10703	LED PU 3
10704	LED PU 4
10705	LED PU 5
10706	LED PU 6
10707	LED PU 7
10708	LED PU 8
10709	LED PU 9
10800	Cold Start
10801	Warm Start
10802	Re-Start
10803	Power On
10804	Expected Restart
10805	Unexpected Restart
10806	Reset Start Count
10900	User SP Event 1
10901	User SP Event 2
10902	User SP Event 3
10903	User SP Event 4
10904	User SP Event 5
10905	User SP Event 6
10906	User SP Event 7
10907	User SP Event 8
10908	User DP Event 1
10909	User DP Event 2
10910	User DP Event 3

10911	User DP Event 4
10912	User DP Event 5
10913	User DP Event 6
10914	User DP Event 7
10915	User DP Event 8
11117	81THD

### 4.3.3 Registers

Address	Name	Format	Multiplier	Description
30001	No.of Events In Store	1 Register	0	Events Counter
30002	Event Record	8 Registers <sup>2</sup>	0	8 Registers
30010	Vab Primary	FP_32BITS_3DP <sup>1</sup>	1	Vab V
30012	Vbc Primary	FP_32BITS_3DP <sup>1</sup>	1	Vbc V
30014	Vca Primary	FP_32BITS_3DP <sup>1</sup>	1	Vca V
30016	Phase A Primary Volt	FP_32BITS_3DP <sup>1</sup>	1	Va V
30018	Phase B Primary Volt	FP_32BITS_3DP <sup>1</sup>	1	Vb V
30020	Phase C Primary Volt	FP_32BITS_3DP <sup>1</sup>	1	Vc V
30022	Phase a Secondary Volt	FP_32BITS_3DP <sup>1</sup>	1	Va V
30024	Phase b Secondary Volt	FP_32BITS_3DP <sup>1</sup>	1	Vb V
30026	Phase c Secondary Volt	FP_32BITS_3DP <sup>1</sup>	1	Vc V
30034	Phase ab Nominal Volt	FP_32BITS_3DP <sup>1</sup>	1	Vab Degrees
30036	Phase bc Nominal Volt	FP_32BITS_3DP <sup>1</sup>	1	Vbc Degrees
30038	Phase ca Nominal Volt	FP_32BITS_3DP <sup>1</sup>	1	Vca Degrees
30040	Phase a Nominal Volt	FP_32BITS_3DP <sup>1</sup>	1	Va Degrees
30042	Phase b Nominal Volt	FP_32BITS_3DP <sup>1</sup>	1	Vb Degrees
30044	Phase c Nominal Volt	FP_32BITS_3DP <sup>1</sup>	1	Vc Degrees
30048	Vzps	FP_32BITS_3DP <sup>1</sup>	1	Vzps xVn
30050	Vpps	FP_32BITS_3DP <sup>1</sup>	1	Vpps xVn
30052	Vnps	FP_32BITS_3DP <sup>1</sup>	1	Vnps xVn
30054	Vzps	FP_32BITS_3DP <sup>1</sup>	1	Vzps Degrees
30056	Vpps	FP_32BITS_3DP <sup>1</sup>	1	Vpps Degrees
30058	Vnps	FP_32BITS_3DP <sup>1</sup>	1	Vnps Degrees
30060	Frequency	FP_32BITS_3DP <sup>1</sup>	1	Frequency Hz
30064	Phase A Primary Curr	FP_32BITS_3DP <sup>1</sup>	1	Ia A
30066	Phase B Primary Curr	FP_32BITS_3DP <sup>1</sup>	1	Ib A
30068	Phase C Primary Curr	FP_32BITS_3DP <sup>1</sup>	1	Ic A
30070	Phase a Secondary Curr	FP_32BITS_3DP <sup>1</sup>	1	Ia A
30072	Phase b Secondary Curr	FP_32BITS_3DP <sup>1</sup>	1	Ib A
30074	Phase c Secondary Curr	FP_32BITS_3DP <sup>1</sup>	1	Ic A
30076	Phase A Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ia xIn
30078	Phase B Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ib xIn
30080	Phase C Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ic xIn
30082	Phase A Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ia Degrees
30084	Phase B Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ib Degrees
30086	Phase C Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ic Degrees
30088	Earth Primary Curr	FP_32BITS_3DP <sup>1</sup>	1	In A
30090	In Secondary	FP_32BITS_3DP <sup>1</sup>	1	In A
30092	In Nominal	FP_32BITS_3DP <sup>1</sup>	1	In xIn
30094	Ig Primary	FP_32BITS_3DP <sup>1</sup>	1	Ig A
30096	Ig Secondary	FP_32BITS_3DP <sup>1</sup>	1	Ig A
30098	Ig Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ig xIn
30100	Izps Nominal	FP_32BITS_3DP <sup>1</sup>	1	Izps xIn
30102	Ipps Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ipps xIn
30104	Inps Nominal	FP_32BITS_3DP <sup>1</sup>	1	Inps xIn
30106	Izps Nominal	FP_32BITS_3DP <sup>1</sup>	1	Izps Degrees
30108	Ipps Nominal	FP_32BITS_3DP <sup>1</sup>	1	Ipps Degrees
30110	Inps Nominal	FP_32BITS_3DP <sup>1</sup>	1	Inps Degrees
30112	Active Power A	FP_32BITS_3DP <sup>1</sup>	0.000001	A Phase W
30114	Active Power B	FP_32BITS_3DP <sup>1</sup>	0.000001	B Phase W
30116	Active Power C	FP_32BITS_3DP <sup>1</sup>	0.000001	C Phase W
30118	3P Power	FP_32BITS_3DP <sup>1</sup>	0.000001	3 Phase W
30120	Reactive Power A	FP_32BITS_3DP <sup>1</sup>	0.000001	A Phase VAR

Address	Name	Format	Multiplier	Description
30122	Reactive Power B	FP_32BITS_3DP <sup>1</sup>	0.000001	B Phase VAR
30124	Reactive Power C	FP_32BITS_3DP <sup>1</sup>	0.000001	C Phase VAR
30126	3P Reactive Power Q	FP_32BITS_3DP <sup>1</sup>	0.000001	3 Phase VAR
30128	Apparent Power A	FP_32BITS_3DP <sup>1</sup>	0.000001	A Phase VA
30130	Apparent Power B	FP_32BITS_3DP <sup>1</sup>	0.000001	B Phase VA
30132	Apparent Power C	FP_32BITS_3DP <sup>1</sup>	0.000001	C Phase VA
30134	3P Apparent Power	FP_32BITS_3DP <sup>1</sup>	0.000001	3 Phase VA
30136	Power Factor A	FP_32BITS_3DP <sup>1</sup>	1	Phase A
30138	Power Factor B	FP_32BITS_3DP <sup>1</sup>	1	Phase B
30140	Power Factor C	FP_32BITS_3DP <sup>1</sup>	1	Phase C
30142	3P Power Factor	FP_32BITS_3DP <sup>1</sup>	1	3 Phase
30152	Thermal Status Ph A	UINT16 <sup>3</sup>	1	%
30153	Thermal Status Ph B	UINT16 <sup>3</sup>	1	%
30154	Thermal Status Ph C	UINT16 <sup>3</sup>	1	%
30167	Fault Records	UINT16 <sup>3</sup>	1	Fault Records
30168	Event Records	UINT16 <sup>3</sup>	1	Event Records
30169	Waveform Records	UINT16 <sup>3</sup>	1	Waveform Records
30170	Vab Secondary Volt	FP_32BITS_3DP <sup>1</sup>	1	Vab V
30172	Vbc Secondary Volt	FP_32BITS_3DP <sup>1</sup>	1	Vbc V
30174	Vca Secondary Volt	FP_32BITS_3DP <sup>1</sup>	1	Vca V
30176	Vn Primary	FP_32BITS_3DP <sup>1</sup>	1	Vn V
30178	Vn Secondary	FP_32BITS_3DP <sup>1</sup>	1	Vn V
30180	Vn Secondary	FP_32BITS_3DP <sup>1</sup>	1	Vn Degrees
30193	I Phase A Max	FP_32BITS_3DP <sup>1</sup>	1	Ia Max Demand
30194	I Phase B Max	FP_32BITS_3DP <sup>1</sup>	1	Ib Max Demand
30195	I Phase C Max	FP_32BITS_3DP <sup>1</sup>	1	Ic Max Demand
30196	P 3P Max	FP_32BITS_3DP <sup>1</sup>	0.000001	Power Max Demand
30197	Q 3P Max	FP_32BITS_3DP <sup>1</sup>	0.000001	VARs Max Demand
30207	Isef Primary	FP_32BITS_3DP <sup>1</sup>	1	Isef A
30209	Isef Secondary	FP_32BITS_3DP <sup>1</sup>	1	Isef A
30211	Isef Nominal	FP_32BITS_3DP <sup>1</sup>	1	Isef xIn
30241	CB Total Trip Count	UINT32 <sup>4</sup>	1	CB Total Trip Count
30243	CB Delta Trip Count	UINT32 <sup>4</sup>	1	CB Delta Trip Count
30245	CB Count to AR Block	UINT32 <sup>4</sup>	1	CB Count to AR Block
30247	CB Frequent Ops Count	UINT32 <sup>4</sup>	1	CB Frequent Ops Count
30301	Ia Last Trip	FP_32BITS_3DP <sup>1</sup>	1	Ia Fault
30303	Ib Last Trip	FP_32BITS_3DP <sup>1</sup>	1	Ib Fault
30305	Ic Last Trip	FP_32BITS_3DP <sup>1</sup>	1	Ic Fault
30307	Va Last Trip	FP_32BITS_3DP <sup>1</sup>	1	Va Fault
30309	Vb Last Trip	FP_32BITS_3DP <sup>1</sup>	1	Vb Fault
30311	Vc Last Trip	FP_32BITS_3DP <sup>1</sup>	1	Vc Fault
30313	In Last Trip	FP_32BITS_3DP <sup>1</sup>	1	In Fault
30317	Isef Last Trip	FP_32BITS_3DP <sup>1</sup>	1	Isef Fault
30319	V Phase A Max	FP_32BITS_3DP <sup>1</sup>	1	Va Max Demand
30321	V Phase B Max	FP_32BITS_3DP <sup>1</sup>	1	Vb Max Demand
30323	V Phase C Max	FP_32BITS_3DP <sup>1</sup>	1	Vc Max Demand
30341	LED1-n	BITSTRING <sup>5</sup>	0	Led 1-16 status
30342	LED1-n	BITSTRING <sup>5</sup>	0	Led 17-32 status
30343	INP1-n	BITSTRING <sup>5</sup>	0	Input 1-16 status
30344	INP1-n	BITSTRING <sup>5</sup>	0	Input 17-32 status
30345	OUT1-n	BITSTRING <sup>5</sup>	0	Output 1-16 status
30346	OUT1-n	BITSTRING <sup>5</sup>	0	Output 17-32 status
30347	VRT1-n	BITSTRING <sup>5</sup>	0	Virtual 1-16 status
30348	VRT1-n	BITSTRING <sup>5</sup>	0	Virtual 17-32 status
30349	EQN1-n	BITSTRING <sup>5</sup>	0	Equation 1-16 status
30350	EQN1-n	BITSTRING <sup>5</sup>	0	Equation 17-32 status
30354	CB Wear A	FP_32BITS_3DP <sup>1</sup>	0.000001	CB Wear A
30356	CB Wear B	FP_32BITS_3DP <sup>1</sup>	0.000001	CB Wear B
30358	CB Wear C	FP_32BITS_3DP <sup>1</sup>	0.000001	CB Wear C
30380	StartCount	FP_32BITS_3DP <sup>1</sup>	1	Start Count
30382	Start Count Target	FP_32BITS_3DP <sup>1</sup>	1	Start Count Target
30390	Freq Last Trip	FP_32BITS_3DP <sup>1</sup>	1	Freq Last Trip
30578	Ia THD	FP_32BITS_3DP <sup>1</sup>	1	Phase A THD %

Address	Name	Format	Multiplier	Description
30580	Ib THD	FP_32BITS_3DP'	1	Phase B THD %
30582	Ic THD	FP_32BITS_3DP'	1	Phase C THD %

1) FP\_32BITS\_3DP: 2 registers - 32 bit fixed point, a 32 bit integer containing a value to 3 decimal places e.g. 50000 sent = 50.000

2) Sequence of 8 registers containing an event record. Read address 30002 for 8 registers (16 bytes), each read returns the earliest event record and removes it from the internal store. Repeat this process for the number of events in the register 30001, or until no more events are returned. (the error condition exception code 2)

3) UINT16: 1 register - standard 16 bit unsigned integer

4) UINT32: 2 registers - 32bit unsigned integer

5) BITSTRING: Sequence of bits showing the status of 1-16 items. For example, if 9 inputs are used, bits 1-9 show the status of inputs 1-9 respectively. Unused bits are set to zero.

#### 4.3.4 Holding Registers (Read Write values)

Address	Description
40001	Time Meter

#### 4.3.5 Event Record

MODBUS does not define a method for extracting events; therefore a private method has been defined based on that defined by [4] IEC60870-5-103.

Register 30001 contains the current number of events in the relays event buffer. Register 30002 contains the earliest event record available. The event record is 8 registers (16 bytes) of information, whose format is described below. When this record has been read it will be replaced by the next available record. Event records must be read completely; therefore the quantity value must be set to 8 before reading. Failing to do this will result in an exception code 2. If no event record is present the exception code 2 will be returned. The event address should be polled regularly by the master for events.

##### 4.3.5.1 Event Format

The format of the event record is defined by the zero byte. It signifies the type of record which is used to decode the event information. The zero byte can be one of the following.

Type	Description
1	Event
2	Event with Relative Time
4	Measurand Event with Relative Time



## Section 5: DNP3.0 Definitions

### 5.1 DEVICE PROFILE

The following table provides a "Device Profile Document" in the standard format defined in the DNP 3.0 Subset Definitions Document. While it is referred to in the DNP 3.0 Subset Definitions as a "Document," it is in fact a table, and only a component of a total interoperability guide. The table, in combination with the Implementation Table in Section 5.2 and the Point List Tables provided in Section 5.3 should provide a complete configuration/interoperability guide for communicating with a device implementing the Triangle MicroWorks, Inc. DNP 3.0 Slave Source Code Library.

<b>DNP V3.0</b> DEVICE PROFILE DOCUMENT (Also see the DNP 3.0 Implementation Table Section 5.2.)	
Vendor Name: <b>Siemens Protection Devices Ltd.</b>	
Device Name: <b>7SR1 , using the Triangle MicroWorks, Inc. DNP3 Slave Source Code Library, Version 3.</b>	
Highest DNP Level Supported:	Device Function:
For Requests: <b>Level 3</b> For Responses: <b>Level 3</b>	£ Master T <b>Slave</b>
<p>Notable objects, functions, and/or qualifiers supported in addition to the Highest DNP Levels Supported (the complete list is described in the attached table):</p> <p>For static (non-change-event) object requests, request qualifier codes 07 and 08 (limited quantity), and 17 and 28 (index) are supported. Static object requests sent with qualifiers 07, or 08, will be responded with qualifiers 00 or 01.</p> <p><b>16-bit, 32-bit and Floating Point Analog Change Events with Time may be requested.</b>  <b>Analog Input Deadbands, Object 34, variations 1 through 3, are supported.</b>  <b>Output Event Objects 11, 13, are supported.</b></p>	
Maximum Data Link Frame Size (octets):	Maximum Application Fragment Size (octets):
Transmitted: <b>256</b> Received <b>256</b>	Transmitted: <b>2048</b> Received <b>2048</b>
Maximum Data Link Re-tries:	Maximum Application Layer Re-tries:
£ None T <b>Fixed (3)</b> £ Configurable from 0 to 65535	T <b>None</b> £ Configurable
Requires Data Link Layer Confirmation:	
T <b>Never</b> £ Always £ Sometimes £ Configurable as: Never, Only for multi-frame messages, or Always	
Requires Application Layer Confirmation:	
£ Never £ Always T <b>When reporting Event Data (Slave devices only)</b> T <b>When sending multi-fragment responses (Slave devices only)</b> £ Sometimes £ Configurable as: "Only when reporting event data", or "When reporting event data or multi-fragment messages."	

<p><b>DNP V3.0</b>                  DEVICE PROFILE DOCUMENT                  (Also see the DNP 3.0 Implementation Table Section 5.2.)</p>																																																																																																				
<p>Timeouts while waiting for:</p> <table border="0"> <tr> <td>Data Link Confirm:</td> <td>£</td> <td>None</td> <td>T</td> <td>Fixed at 2sec</td> <td>£</td> <td>Variable</td> <td>£</td> <td>Configurable.</td> </tr> <tr> <td>Complete Appl. Fragment:</td> <td>T</td> <td><b>None</b></td> <td>£</td> <td>Fixed at _____</td> <td>£</td> <td>Variable</td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>Application Confirm:</td> <td>£</td> <td>None</td> <td>T</td> <td>Fixed at 10sec</td> <td>£</td> <td>Variable</td> <td>£</td> <td>Configurable.</td> </tr> <tr> <td>Complete Appl. Response:</td> <td>T</td> <td><b>None</b></td> <td>£</td> <td>Fixed at _____</td> <td>£</td> <td>Variable</td> <td>£</td> <td>Configurable</td> </tr> </table> <p>Others: <b>Transmission Delay, (0 sec)</b>  <b>Select/Operate Arm Timeout, (5 sec)</b>  <b>Need Time Interval, (30 minutes)</b>  <b>Application File Timeout, (60 sec)</b>  <b>Unsolicited Notification Delay, (5 seconds)</b>  <b>Unsolicited Response Retry Delay, (between 3 – 9 seconds)</b>  <b>Unsolicited Offline Interval, (30 seconds)</b>  <b>Binary Change Event Scan Period, (Polled, Not Applicable)</b>  <b>Double Bit Change Event Scan Period, (Unsupported - Not Applicable)</b>  <b>Analog Change Event Scan Period, (Unsupported - Not Applicable)</b>  <b>Counter Change Event Scan Period, (Unsupported - Not Applicable)</b>  <b>Frozen Counter Change Event Scan Period, (Unsupported - Not Applicable)</b>  <b>String Change Event Scan Period, (Unsupported - Not Applicable)</b>  <b>Virtual Terminal Event Scan Period, (Unsupported - Not Applicable)</b></p>		Data Link Confirm:	£	None	T	Fixed at 2sec	£	Variable	£	Configurable.	Complete Appl. Fragment:	T	<b>None</b>	£	Fixed at _____	£	Variable	£	Configurable	Application Confirm:	£	None	T	Fixed at 10sec	£	Variable	£	Configurable.	Complete Appl. Response:	T	<b>None</b>	£	Fixed at _____	£	Variable	£	Configurable																																																															
Data Link Confirm:	£	None	T	Fixed at 2sec	£	Variable	£	Configurable.																																																																																												
Complete Appl. Fragment:	T	<b>None</b>	£	Fixed at _____	£	Variable	£	Configurable																																																																																												
Application Confirm:	£	None	T	Fixed at 10sec	£	Variable	£	Configurable.																																																																																												
Complete Appl. Response:	T	<b>None</b>	£	Fixed at _____	£	Variable	£	Configurable																																																																																												
<p>Sends/Executes Control Operations:</p> <table border="0"> <tr> <td>WRITE Binary Outputs</td> <td>T</td> <td><b>Never</b></td> <td>£</td> <td>Always</td> <td>£</td> <td>Sometimes</td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>SELECT/OPERATE</td> <td>£</td> <td>Never</td> <td>T</td> <td><b>Always</b></td> <td>£</td> <td>Sometimes</td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>DIRECT OPERATE</td> <td>£</td> <td>Never</td> <td>T</td> <td><b>Always</b></td> <td>£</td> <td>Sometimes</td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>DIRECT OPERATE – NO ACK</td> <td>£</td> <td>Never</td> <td>T</td> <td><b>Always</b></td> <td>£</td> <td>Sometimes</td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>Count &gt; 1</td> <td>T</td> <td><b>Never</b></td> <td>£</td> <td>Always</td> <td>£</td> <td>Sometimes</td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>Pulse On</td> <td>£</td> <td>Never</td> <td>£</td> <td>Always</td> <td>T</td> <td><b>Sometimes</b></td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>Pulse Off</td> <td>£</td> <td>Never</td> <td>£</td> <td>Always</td> <td>T</td> <td><b>Sometimes</b></td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>Latch On</td> <td>£</td> <td>Never</td> <td>£</td> <td>Always</td> <td>T</td> <td><b>Sometimes</b></td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>Latch Off</td> <td>£</td> <td>Never</td> <td>£</td> <td>Always</td> <td>T</td> <td><b>Sometimes</b></td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>Queue</td> <td>T</td> <td><b>Never</b></td> <td>£</td> <td>Always</td> <td>£</td> <td>Sometimes</td> <td>£</td> <td>Configurable</td> </tr> <tr> <td>Clear Queue</td> <td>T</td> <td><b>Never</b></td> <td>£</td> <td>Always</td> <td>£</td> <td>Sometimes</td> <td>£</td> <td>Configurable</td> </tr> </table> <p>Attach explanation if 'Sometimes' or 'Configurable' was checked for any operation.</p>		WRITE Binary Outputs	T	<b>Never</b>	£	Always	£	Sometimes	£	Configurable	SELECT/OPERATE	£	Never	T	<b>Always</b>	£	Sometimes	£	Configurable	DIRECT OPERATE	£	Never	T	<b>Always</b>	£	Sometimes	£	Configurable	DIRECT OPERATE – NO ACK	£	Never	T	<b>Always</b>	£	Sometimes	£	Configurable	Count > 1	T	<b>Never</b>	£	Always	£	Sometimes	£	Configurable	Pulse On	£	Never	£	Always	T	<b>Sometimes</b>	£	Configurable	Pulse Off	£	Never	£	Always	T	<b>Sometimes</b>	£	Configurable	Latch On	£	Never	£	Always	T	<b>Sometimes</b>	£	Configurable	Latch Off	£	Never	£	Always	T	<b>Sometimes</b>	£	Configurable	Queue	T	<b>Never</b>	£	Always	£	Sometimes	£	Configurable	Clear Queue	T	<b>Never</b>	£	Always	£	Sometimes	£	Configurable
WRITE Binary Outputs	T	<b>Never</b>	£	Always	£	Sometimes	£	Configurable																																																																																												
SELECT/OPERATE	£	Never	T	<b>Always</b>	£	Sometimes	£	Configurable																																																																																												
DIRECT OPERATE	£	Never	T	<b>Always</b>	£	Sometimes	£	Configurable																																																																																												
DIRECT OPERATE – NO ACK	£	Never	T	<b>Always</b>	£	Sometimes	£	Configurable																																																																																												
Count > 1	T	<b>Never</b>	£	Always	£	Sometimes	£	Configurable																																																																																												
Pulse On	£	Never	£	Always	T	<b>Sometimes</b>	£	Configurable																																																																																												
Pulse Off	£	Never	£	Always	T	<b>Sometimes</b>	£	Configurable																																																																																												
Latch On	£	Never	£	Always	T	<b>Sometimes</b>	£	Configurable																																																																																												
Latch Off	£	Never	£	Always	T	<b>Sometimes</b>	£	Configurable																																																																																												
Queue	T	<b>Never</b>	£	Always	£	Sometimes	£	Configurable																																																																																												
Clear Queue	T	<b>Never</b>	£	Always	£	Sometimes	£	Configurable																																																																																												
<p>Reports Binary Input Change Events when no specific variation requested:</p> <p>£ Never                  £ Only time-tagged                  £ Only non-time-tagged                  T <b>Configurable to send one or the other</b></p>	<p>Reports time-tagged Binary Input Change Events when no specific variation requested:</p> <p>£ Never                  £ Binary Input Change With Time                  £ Binary Input Change With Relative Time                  T <b>Configurable</b></p>																																																																																																			
<p>Sends Unsolicited Responses:</p> <p>£ Never                  T <b>Configurable</b>                  £ Only certain objects                  £ Sometimes (attach explanation)                  T <b>ENABLE/DISABLE UNSOLICITED Function codes supported</b></p>	<p>Sends Static Data in Unsolicited Responses:</p> <p>T <b>Never</b>                  £ When Device Restarts                  £ When Status Flags Change</p> <p>No other options are permitted.</p>																																																																																																			
<p>Default Counter Object/Variation:</p> <p>£ <b>No Counters Reported</b>                  T Configurable                  £ Default Object                  £ Default Variation:                  £ Point-by-point list attached</p>	<p>Counters Roll Over at:</p> <p>£ <b>No Counters Reported</b>                  £ Configurable (attach explanation)                  £ 16 Bits                  T 32 Bits                  £ Other Value: _____                  £ Point-by-point list attached</p>																																																																																																			

<b>DNP V3.0</b>		
DEVICE PROFILE DOCUMENT (Also see the DNP 3.0 Implementation Table Section 5.2.)		
Sends Multi-Fragment Responses:		
T	Yes	
£	No	
£	Configurable	
Sequential File Transfer Support:		
File Transfer Support	£ Yes	T <b>No</b>
Append File Mode	£ Yes	T <b>No</b>
Custom Status Code Strings	£ Yes	T <b>No</b>
Permissions Field	£ Yes	T <b>No</b>
File Events Assigned to Class	£ Yes	T <b>No</b>
File Events Send Immediately	£ Yes	T <b>No</b>
Multiple Blocks in a Fragment	£ Yes	T <b>No</b>
Max Number of Files Open	<b>0</b>	

## 5.2 IMPLEMENTATION TABLE

The following table identifies which object variations, function codes, and qualifiers the Triangle MicroWorks, Inc. DNP 3.0 Slave Source Code Library supports in both request messages and in response messages. For static (non-change-event) objects, requests sent with qualifiers 00, 01, 06, 07, or 08, will be responded with qualifiers 00 or 01. Requests sent with qualifiers 17 or 28 will be responded with qualifiers 17 or 28. For change-event objects, qualifiers 17 or 28 are always responded.

In the table below, text shaded as **00, 01 (start stop)** indicates Subset Level 3 functionality (beyond Subset Level 2).

In the table below, text shaded as **07, 08 (limited qty)** indicates functionality beyond Subset Level 3.

OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
1	0	Binary Input – Any Variation	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)		
1	1 (default – see note 1)	Binary Input	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
1	2	Binary Input with Status	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
2	0	Binary Input Change – Any Variation	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
2	1	Binary Input Change without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
2	2	Binary Input Change with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
2	3 (default – see note 1)	Binary Input Change with Relative Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
3	0	Double Bit Input – Any Variation	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)		
3	1 (default – see note 1)	Double Bit Input	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 1)

OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
3	2	Double Bit Input with Status	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 1)
4	0	Double Bit Input Change – Any Variation	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
4	1	Double Bit Input Change without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
4	2	Double Bit Input Change with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
4	3 (default – see note 1)	Double Bit Input Change with Relative Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
10	0	Binary Output – Any Variation	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)		
10	1	Binary Output	1 (read)  1 (write)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index) 00, 01 (start-stop)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 1)
10	2 (default – see note 1)	Binary Output Status	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
11	0	Binary Output Change – Any Variation	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
11	1 (default – see note 1)	Binary Output Change without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
11	2	Binary Output Change with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
12	0	Control Relay Output Block	22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)		

OBJECT			REQUEST (Library will parse)	RESPONSE (Library will respond with)		
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
12	1	Control Relay Output Block	3 (select) 4 (operate) 5 (direct op) 6 (dir. op, noack)	17, 28 (index)	129 (response)	echo of request
12	2	Pattern Control Block	3 (select) 4 (operate) 5 (direct op) 6 (dir. op, noack)	7 (limited quantity)	129 (response)	echo of request
12	3	Pattern Mask	3 (select) 4 (operate) 5 (direct op) 6 (dir. op, noack)	00, 01 (start-stop)	129 (response)	echo of request
13	0	Binary Output Command Event – Any Variation	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
13	1	Binary Output Command Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
13	2	Binary Output Command Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
20	0	Binary Input – Any Variation	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)		
			7 (freeze) 8 (freeze noack) 9 (freeze clear) 10 (frz. cl. noack)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty)		
20	1	32-Bit Binary Counter (with Flag)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
20	2	16-Bit Binary Counter (with Flag)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
20	3	32-Bit Delta Counter (with Flag)				

OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
20	4	16-Bit Delta Counter (with Flag)				
20	5 (default – see note 1)	32-Bit Binary Counter without Flag	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
20	6	16-Bit Binary Counter without Flag	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
20	7	32-Bit Delta Counter without Flag				
20	8	16-Bit Delta Counter without Flag				
21	0	Frozen Counter – Any Variation	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)		
21	1	32-Bit Frozen Counter (with Flag)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
21	2	16-Bit Frozen Counter (with Flag)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
21	3	32-Bit Frozen Delta Counter (with Flag)				
21	4	16-Bit Frozen Delta Counter (with Flag)				
21	5	32-Bit Frozen Counter with Time Of Freeze	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 1)
21	6	16-Bit Frozen Counter with Time Of Freeze	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 1)
21	7	32-Bit Frozen Delta Counter with Time Of Freeze				
21	8	16-Bit Frozen Delta Counter with Time Of Freeze				

OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
21	9 (default – see note 1)	32-Bit Frozen Counter without Flag	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
21	10	16-Bit Frozen Counter without Flag	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
21	11	32-Bit Frozen Delta Counter without Flag				
21	12	16-Bit Frozen Delta Counter without Flag				
22	0	Counter Change Event – Any Variation	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
22	1 (default – see note 1)	32-Bit Counter Change Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
22	2	16-Bit Counter Change Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
22	3	32-Bit Delta Counter Change Event without Time				
22	4	16-Bit Delta Counter Change Event without Time				
22	5	32-Bit Counter Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
22	6	16-Bit Counter Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
22	7	32-Bit Delta Counter Change Event with Time				
22	8	16-Bit Delta Counter Change Event with Time				
23	0	Frozen Counter Event (Variation 0 is used to request default variation)	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
23	1 (default – see note 1)	32-Bit Frozen Counter Event	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
23	2	16-Bit Frozen Counter Event	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
23	3	32-Bit Frozen Delta Counter Event				
23	4	16-Bit Frozen Delta Counter Event				
23	5	32-Bit Frozen Counter Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)



OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
23	6	16-Bit Frozen Counter Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
23	7	32-Bit Frozen Delta Counter Event with Time				
23	8	16-Bit Frozen Delta Counter Event with Time				
30	0	Analog Input - Any Variation	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)		
30	1	32-Bit Analog Input	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
30	2	16-Bit Analog Input	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
30	3 (default – see note 1)	32-Bit Analog Input without Flag	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
30	4	16-Bit Analog Input without Flag	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
30	5	short floating point	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
30	6	long floating point	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 1)
31	0	Frozen Analog Input – Any Variation				
31	1	32-Bit Frozen Analog input				
31	2	16-Bit Frozen Analog input				
31	3	32-Bit Frozen Analog input with Time of freeze				
31	4	16-Bit Frozen Analog input with Time of freeze				

OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
31	5	32-Bit Frozen Analog input without Flag				
31	6	16-Bit Frozen Analog input without Flag				
32	0	Analog Change Event – Any Variation	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
32	1 (default – see note 1)	32-Bit Analog Change Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
32	2	16-Bit Analog Change Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
32	3	32-Bit Analog Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
32	4	16-Bit Analog Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
32	5	short floating point Analog Change Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
32	6	long floating point Analog Change Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
32	7	short floating point Analog Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
32	8	long floating point Analog Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp)	17, 28 (index)
33	0	Frozen Analog Event – Any Variation				
33	1	32-Bit Frozen Analog Event without Time				
33	2	16-Bit Frozen Analog Event without Time				
33	3	32-Bit Frozen Analog Event with Time				
33	4	16-Bit Frozen Analog Event with Time				
33	5	Short Floating Point Frozen Analog Event				
33	6	Long Floating Point Frozen Analog Event				

OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
33	7	Extended Floating Point Frozen Analog Event				
34	0	Analog Input Deadband (Variation 0 is used to request default variation)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)		
34	1	16 bit Analog Input Deadband	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
			2 (write)	00, 01 (start-stop) 07, 08 (limited qty) 17, 27, 28 (index)		
34	2 (default – see note 1)	32 bit Analog Input Deadband	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
			2 (write)	00, 01 (start-stop) 07, 08 (limited qty) 17, 27, 28 (index)		
34	3	Short Floating Point Analog Input Deadband	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 27, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index – see note 2)
			2 (write)	00, 01 (start-stop) 07, 08 (limited qty) 17, 27, 28 (index)		
50	0	Time and Date				
50	1 (default – see note 1)	Time and Date	1 (read)	07 (limited qty = 1)	129 (response)	07 (limited qty = 1)
			2 (write)	07 (limited qty = 1)		
50	3	Time and Date Last Recorded Time	2 (write)	07 (limited qty)		
51	1	Time and Date CTO			129 (response) 130 (unsol. Resp)	07 (limited qty = 1)
51	2	Unsynchronised Time and Date CTO			129 (response) 130 (unsol. Resp)	07 (limited qty = 1)

OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
52	1	Time Delay Coarse			129 (response)	07 (limited qty = 1)
52	2	Time Delay Fine			129 (response)	07 (limited qty = 1)
60	0	Not Defined				
60	1	Class 0 Data	1 (read)	06 (no range, or all)		
60	2	Class 1 Data	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
			20 (enbl. unsol.)	06 (no range, or all)		
			21 (dab. unsol.)			
			22 (assign class)			
60	3	Class 2 Data	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
			20 (enbl. unsol.)	06 (no range, or all)		
			21 (dab. unsol.)			
			22 (assign class)			
60	4	Class 3 Data	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
			20 (enbl. unsol.)	06 (no range, or all)		
			21 (dab. unsol.)			
			22 (assign class)			
70	1	File Transfer				
80	1	Internal Indications	1 (read)	00, 01 (start-stop)	129 (response)	00, 01 (start-stop)
			2 (write) (see note 3)	00 (start-stop) index = 7		
81	1	Storage Object				
82	1	Device Profile				
83	1	Private Registration Object				
83	2	Private Registration Object Descriptor				
90	1	Application Identifier				
100	1	Short Floating Point				
100	2	Long Floating Point				
100	3	Extended Floating Point				

OBJECT			REQUEST (Library will parse)		RESPONSE (Library will respond with)	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
101	1	Small Packed Binary-Coded Decimal				
101	2	Medium Packed Binary-Coded Decimal				
101	3	Large Packed Binary-Coded Decimal				
		No Object (function code only)	13 (cold restart)			
		No Object (function code only)	14 (warm restart)			
		No Object (function code only)	23 (delay meas.)			
		No Object (function code only)	24 (record current)			

Note 1: A Default variation refers to the variation responded when variation 0 is requested and/or in class 0, 1, 2, or 3 scans. Default variations are configurable; however, default settings for the configuration parameters are indicated in the table above.

Note 2: For static (non-change-event) objects, qualifiers 17 or 28 are only responded when a request is sent with qualifiers 17 or 28, respectively. Otherwise, static object requests sent with qualifiers 00, 01, 06, 07, or 08, will be responded with qualifiers 00 or 01. (For change-event objects, qualifiers 17 or 28 are always responded.)

Note 3: Writes of Internal Indications are only supported for index 7 (Restart IIN1-7)

### 5.3 POINT LIST

The tables below identify all the default data points provided by the implementation of the Triangle MicroWorks, Inc. DNP 3.0 Slave Source Code Library.

The default binary input event buffer size is set to allow 100 events.

Note, not all points listed here apply to all builds of devices.

#### 5.3.1 Binary Input Points

Binary Inputs are by default returned in a class zero interrogation.

Binary Input Points		
Static (Steady-State) Object Number: 1		
Change Event Object Number: 2		
Default Static Variation reported when variation 0 requested: 2 (Binary Input with flags)		
Default Change Event Variation reported when variation 0 requested: 2 (Binary Input with absolute time)		
Point Index	Name/Description	Default Change Event Assigned Class (1, 2, 3 or none)
1	Binary Input 1	2
2	Binary Input 2	2
3	Binary Input 3	2
4	Binary Input 4	2
5	Binary Input 5	2
6	Binary Input 6	2
35	Remote mode	2
36	Service mode	2
37	Local mode	2
38	Local & Remote	2

<b>Binary Input Points</b>		
Static (Steady-State) Object Number: <b>1</b>		
Change Event Object Number: <b>2</b>		
Default Static Variation reported when variation 0 requested: <b>2 (Binary Input with flags)</b>		
Default Change Event Variation reported when variation 0 requested: <b>2 (Binary Input with absolute time)</b>		
<b>Point Index</b>	<b>Name/Description</b>	<b>Default Change Event Assigned Class (1, 2, 3 or none)</b>
41	Trip Circuit Fail	2
42	A-Starter	2
43	B-Starter	2
44	C-Starter	2
45	General Starter	2
46	VTS Alarm	2
47	Earth Fault Forward/Line	2
48	Earth Fault Reverse/Busbar	2
49	Start/Pick-up N	2
50	Fault Forward/Line	2
51	Fault Reverse/Busbar	2
52	51-1	2
53	50-1	2
54	51N-1	2
55	50N-1	2
56	51G-1	2
57	50G-1	2
58	51-2	2
59	50-2	2
60	51N-2	2
61	50N-2	2
62	51G-2	2
63	50G-2	2
64	CTS Alarm	2
65	46IT	2
66	46DT	2
67	47-1	2
68	47-2	2
69	46BC	2
70	27/59-1	2
71	27/59-2	2
72	27/59-3	2
73	27/59-4	2
74	59NIT	2
75	59NDT	2
76	81-1	2
77	81-2	2
78	81-3	2
79	81-4	2
80	Auto-reclose active	2
81	CB on by auto reclose	2
82	Reclaim	2
83	Lockout	2
86	51-3	2
87	50-3	2
88	51N-3	2
89	50N-3	2
90	51G-3	2

<b>Binary Input Points</b>		
Static (Steady-State) Object Number: <b>1</b>		
Change Event Object Number: <b>2</b>		
Default Static Variation reported when variation 0 requested: <b>2 (Binary Input with flags)</b>		
Default Change Event Variation reported when variation 0 requested: <b>2 (Binary Input with absolute time)</b>		
<b>Point Index</b>	<b>Name/Description</b>	<b>Default Change Event Assigned Class (1, 2, 3 or none)</b>
91	50G-3	2
92	51-4	2
93	50-4	2
94	51N-4	2
95	50N-4	2
96	51G-4	2
97	50G-4	2
98	Cold Load Active	2
99	E/F Protection Out	2
100	P/F Inst Protection Inhibited	2
101	E/F Inst Protection Inhibited	2
102	SEF Inst Protection Inhibited	2
103	Ext Inst Protection Inhibited	2
117	51SEF-1	2
118	50SEF-1	2
119	51SEF-2	2
120	50SEF-2	2
121	51SEF-3	2
122	50SEF-3	2
123	51SEF-4	2
124	51SEF-4	2
125	SEF Out	2
126	Trip Circuit Fail 1	2
127	Trip Circuit Fail 2	2
128	Trip Circuit Fail 3	2
129	CB Total Trip Count	2
130	CB Delta Trip Count	2
131	CB Count to AR Block	2
132	CB Frequent Ops Count	2
133	1/2t CB Wear	2
207	Close Circuit Fail 1	2
208	Close Circuit Fail 2	2
209	Close Circuit Fail 3	2
210	Close Circuit Fail	2
211	50BF-1	2
212	50BF-2	2
213	49 Alarm	2
214	49 Trip	2
215	64H	2
217	37-1	2
218	37-2	2
222	Trip Time Alarm	2
223	SEF Forward / Line	2
224	SEF Reverse / Busbar	2
225	General Alarm 1	2
226	General Alarm 2	2
227	General Alarm 3	2
228	General Alarm 4	2

<b>Binary Input Points</b>		
Static (Steady-State) Object Number: <b>1</b>		
Change Event Object Number: <b>2</b>		
Default Static Variation reported when variation 0 requested: <b>2 (Binary Input with flags)</b>		
Default Change Event Variation reported when variation 0 requested: <b>2 (Binary Input with absolute time)</b>		
<b>Point Index</b>	<b>Name/Description</b>	<b>Default Change Event Assigned Class (1, 2, 3 or none)</b>
229	General Alarm 5	2
230	General Alarm 6	2
237	Quick Logic E1	2
238	Quick Logic E2	2
239	Quick Logic E3	2
240	Quick Logic E4	2
269	60 CTS-I	2
270	81HBL2	2
271	37G-1	2
272	37G-2	2
273	Wattmetric Po>	2
274	37-PhA	2
275	37-PhB	2
276	37-PhC	2
277	50 LC-1	2
278	50 LC-2	2
279	50G LC-1	2
280	50G LC-2	2
281	50SEF LC-1	2
282	50SEF LC-2	2
283	50BF-PhA	2
284	50BF-PhB	2
285	50BF-PhC	2
286	50BF-EF	2
287	79 Last Trip Lockout	2
288	60 CTS-I-PhA	2
289	60 CTS-I-PhB	2
290	60 CTS-I-PhC	2
373	37SEF-1	2
374	37SEF-2	2
411	Settings Group 1	2
412	Settings Group 2	2
413	Settings Group 3	2
414	Settings Group 4	2
422	Hot Line Working On/Off	2
425	Inst Protection Off/On	2
427	CB 1	2
501	Virtual Input 1	2
502	Virtual Input 2	2
503	Virtual Input 3	2
504	Virtual Input 4	2
505	Virtual Input 5	2
506	Virtual Input 6	2
507	Virtual Input 7	2
508	Virtual Input 8	2
601	LED 1	2
602	LED 2	2
603	LED 3	2



<b>Binary Input Points</b>		
Static (Steady-State) Object Number: <b>1</b>		
Change Event Object Number: <b>2</b>		
Default Static Variation reported when variation 0 requested: <b>2 (Binary Input with flags)</b>		
Default Change Event Variation reported when variation 0 requested: <b>2 (Binary Input with absolute time)</b>		
<b>Point Index</b>	<b>Name/Description</b>	<b>Default Change Event Assigned Class (1, 2, 3 or none)</b>
604	LED 4	2
605	LED 5	2
606	LED 6	2
607	LED 7	2
608	LED 8	2
609	LED 9	2
701	LED PU 1	2
702	LED PU 2	2
703	LED PU 3	2
704	LED PU 4	2
705	LED PU 5	2
706	LED PU 6	2
707	LED PU 7	2
708	LED PU 8	2
709	LED PU 9	2
801	RL 1	2
802	RL 2	2
803	RL 3	2
804	RL 4	2
805	RL 5	2
806	RL 6	2
807	RL 7	2
808	RL 8	2
871	Cold start	2
872	Warm Start	2
873	Re-Start	2
874	Power On	2
875	Expected Restart	2
876	Unexpected Restart	2
877	Reset Start Count	2
900	User SP Event 1	2
901	User SP Event 2	2
902	User SP Event 3	2
903	User SP Event 4	2
904	User SP Event 5	2
905	User SP Event 6	2
906	User SP Event 7	2
907	User SP Event 8	2
1107	81THD	2

### 5.3.2 Double Bit Binary Input Points

Double Bit Binary Inputs are by default returned in a class zero interrogation.

<b>Double Bit Input Points</b>		
Static (Steady-State) Object Number: <b>3</b>		
Change Event Object Number: <b>4</b>		
Default Static Variation reported when variation 0 requested: <b>1 (Double Bit Binary Input packed format)</b>		
Default Change Event Variation reported when variation 0 requested: <b>3 (Double Bit Binary Input Event with relative time)</b>		
<b>Point Index</b>	<b>Name/Description</b>	<b>Default Change Event Assigned Class (1, 2, 3 or none)</b>
0	CB 1	2
10	User DP Event 1	2
11	User DP Event 2	2
12	User DP Event 3	2
13	User DP Event 4	2
14	User DP Event 5	2
15	User DP Event 6	2
16	User DP Event 7	2
17	User DP Event 8	2

### 5.3.3 Binary Output Status Points and Control Relay Output Blocks

The following table lists both the Binary Output Status Points (Object 10) and the Control Relay Output Blocks (Object 12).

While Binary Output Status Points are included here for completeness, they are not often polled by DNP 3.0 Masters. It is recommended that Binary Output Status points represent the most recent DNP "commanded" value for the corresponding Control Relay Output Block point. Because many, if not most, Control Relay Output Block points are controlled through pulse mechanisms, the value of the output status may in fact be meaningless. Binary Output Status points are not recommended to be included in class 0 polls.

As an alternative, it is recommended that "actual" status values of Control Relay Output Block points be looped around and mapped as Binary Inputs. (The "actual" status value, as opposed to the "commanded" status value, is the value of the actuated control. For example, a DNP control command may be blocked through hardware or software mechanisms; in this case, the actual status value would indicate the control failed because of the blocking). Looping Control Relay Output Block actual status values as Binary Inputs has several advantages:

- it allows actual statuses to be included in class 0 polls,
- it allows change event reporting of the actual statuses, which is a more efficient and time-accurate method of communicating control values,
- and it allows reporting of time-based information associated with controls, including any delays before controls are actuated, and any durations if the controls are pulsed.

The default select/control buffer size is large enough to hold 10 of the largest select requests possible.

Binary Outputs are by default returned in a class zero interrogation.

<b>Point Index</b>	<b>Name/Description</b>	<b>Supported Control Relay Output Block Fields</b>
1	Binary Output 1	Pulse On/Latch On/Close
2	Binary Output 2	Pulse On/Latch On/Close
3	Binary Output 3	Pulse On/Latch On/Close
4	Binary Output 4	Pulse On/Latch On/Close
5	Binary Output 5	Pulse On/Latch On/Close
6	Binary Output 6	Pulse On/Latch On/Close
7	Binary Output 7	Pulse On/Latch On/Close
8	Binary Output 8	Pulse On/Latch On/Close

<b>Point Index</b>	<b>Name/Description</b>	<b>Supported Control Relay Output Block Fields</b>
33	LED Reset	Pulse On/Latch On/Close
34	Settings Group 1	Pulse On/Latch On/Close
35	Settings Group 2	Pulse On/Latch On/Close
36	Settings Group 3	Pulse On/Latch On/Close
37	Settings Group 4	Pulse On/Latch On/Close
42	Auto-reclose on/off	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
43	Hot line working on/off	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
44	E/F off/on	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
45	SEF off/on	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
46	Inst Protection off/on	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
48	Reset CB Total Trip Count	Pulse On/Latch On/Close
49	Reset CB Delta Trip Count	Pulse On/Latch On/Close
50	Reset CB Count to AR Block	Pulse On/Latch On/Close
51	Reset Frequent Ops Count	Pulse On/Latch On/Close
53	Reset I <sup>2</sup> t CB Wear	Pulse On/Latch On/Close
54	CB 1	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
55	CB 1 Trip & Reclose	Pulse On/Latch On/Close
56	CB 1 Trip & Lockout	Pulse On/Latch On/Close
59	Demand metering reset	Pulse On/Latch On/Close
87	Reset Energy Meters	Pulse On/Latch On/Close
88	Remote mode	Pulse On/Latch On/Close
89	Service mode	Pulse On/Latch On/Close
90	Local mode	Pulse On/Latch On/Close
91	Local & Remote	Pulse On/Latch On/Close
98	Reset Start Count	Pulse On/Latch On/Close
99	User SP Command 1.	Pulse On/Latch On/Close
100	User SP Command 2.	Pulse On/Latch On/Close
101	User SP Command 3.	Pulse On/Latch On/Close
102	User SP Command 4.	Pulse On/Latch On/Close
103	User SP Command 5.	Pulse On/Latch On/Close
104	User SP Command 6.	Pulse On/Latch On/Close
105	User SP Command 7.	Pulse On/Latch On/Close
106	User SP Command 8.	Pulse On/Latch On/Close
107	User DP Command 1.	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
108	User DP Command 2.	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
109	User DP Command 3.	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
110	User DP Command 4.	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
111	User DP Command 5.	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
112	User DP Command 6.	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
113	User DP Command 7.	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip
114	User DP Command 8.	Pulse On/Pulse Off/Latch On/Latch Off/Close/Trip

### 5.3.4 Analogue Inputs

The following table lists Analog Inputs (Object 30). It is important to note that 16-bit and 32-bit variations of Analog Inputs, Analog Output Control Blocks, and Analog Output Statuses are transmitted through DNP as signed numbers.

The “Default Deadband,” and the “Default Change Event Assigned Class” columns are used to represent the absolute amount by which the point must change before an analog change event will be generated, and once generated in which class poll (1, 2, 3, or none) will the change event be reported.

The default analog input event buffer size is set 30.

Analog Inputs are by default returned in a class zero interrogation.

<b>Analog Inputs</b>						
Static (Steady-State) Object Number: <b>30</b>						
Change Event Object Number: <b>32</b>						
Default Static Variation reported when variation 0 requested: <b>2 (16-Bit Analog Input with Flag)</b>						
Default Change Event Variation reported when variation 0 requested: <b>4 (16-Bit Analog Change Event with Time)</b>						
Point #	Default Class	Default Static Variant	Default Event Variant	Name	Scaling Factor	Deadband
0	3	2	4	Frequency	100.0	1
1	3	2	4	Vab Primary	0.001	1000
2	3	2	4	Vbc Primary	0.001	1000
3	3	2	4	Vca Primary	0.001	1000
4	3	2	4	Va Primary	0.001	1000
5	3	2	4	Vb Primary	0.001	1000
6	3	2	4	Vc Primary	0.001	1000
7	3	2	4	Va Secondary	100.0	1
8	3	2	4	Vb Secondary	100.0	1
9	3	2	4	Vc Secondary	100.0	1
21	3	2	4	Vzps	10.0	1
22	3	2	4	Vpps	10.0	1
23	3	2	4	Vnps	10.0	1
31	3	2	4	Ia Primary	1	100
32	3	2	4	Ib Primary	1	100
33	3	2	4	Ic Primary	1	100
34	3	2	4	Ia Secondary	100.0	0.1
35	3	2	4	Ib Secondary	100.0	0.1
36	3	2	4	Ic Secondary	100.0	0.1
37	3	2	4	Ia Nominal	100.0	0.1
38	3	2	4	Ib Nominal	100.0	0.1
39	3	2	4	Ic Nominal	100.0	0.1
43	3	2	4	In Primary	1	100
44	3	2	4	In Secondary	100.0	0.1
45	3	2	4	In Nominal	100.0	0.1
46	3	2	4	Ig Primary	1	100
47	3	2	4	Ig Secondary	1000.0	0.1
48	3	2	4	Ig Nominal	1000.0	0.1
51	3	2	4	Izps Nominal	100.0	0.1
52	3	2	4	Ipps Nominal	100.0	0.1
53	3	2	4	Inps Nominal	100.0	0.1
57	3	2	4	Active Power A	0.00001	1000000
58	3	2	4	Active Power B	0.00001	1000000
59	3	2	4	Active Power C	0.00001	1000000
60	3	2	4	P (3P)	0.00001	1000000
61	3	2	4	Reactive Power A	0.00001	1000000
62	3	2	4	Reactive Power B	0.00001	1000000
63	3	2	4	Reactive Power C	0.00001	1000000
64	3	2	4	Q (3P)	0.00001	1000000
65	3	2	4	Apparent Power A	0.00001	1000000
66	3	2	4	Apparent Power B	0.00001	1000000
67	3	2	4	Apparent Power C	0.00001	1000000

**Analog Inputs**Static (Steady-State) Object Number: **30**Change Event Object Number: **32**Default Static Variation reported when variation 0 requested: **2 (16-Bit Analog Input with Flag)**Default Change Event Variation reported when variation 0 requested: **4 (16-Bit Analog Change Event with Time)**

Point #	Default Class	Default Static Variant	Default Event Variant	Name	Scaling Factor	Deadband
68	3	2	4	S (3P)	0.00001	1000000
71	3	2	4	Power Factor A	1000	0.1
72	3	2	4	Power Factor B	1000	0.1
73	3	2	4	Power Factor C	1000	0.1
74	3	2	4	Power Factor(3P)	1000	0.1
81	3	2	4	Thermal Status Ph A	100.0	1
82	3	2	4	Thermal Status Ph B	100.0	1
83	3	2	4	Thermal Status Ph C	100.0	1
99	3	2	4	Vab Secondary	10.0	1
100	3	2	4	Vbc Secondary	10.0	1
101	3	2	4	Vca Secondary	10.0	1
102	3	2	4	Vn Primary	0.01	100
103	3	2	4	Vn Secondary	10.0	1
108	3	2	4	Ia Max Demand	1	100
109	3	2	4	Ib Max Demand	1	100
110	3	2	4	Ic Max Demand	1	100
111	3	2	4	P 3P Max Demand	0.00001	1000000
112	3	2	4	Q 3P Max Demand	0.00001	1000000
113	3	2	4	Ig Max	1	100
114	3	2	4	Isef Max	1	10
115	3	2	4	Isef Primary	1	10
116	3	2	4	Isef Secondary	1000.0	0.05
117	3	2	4	Isef Nominal	1000.0	0.05
135	3	2	4	CB Total Trip Count	1	1
136	3	2	4	CB Delta Trip Count	1	1
137	3	2	4	CB Count to AR Block	1	1
138	3	2	4	CB Frequent Ops Count	1	1
165	3	1	3	Ia Last Trip	1	0
166	3	1	3	Ib Last Trip	1	0
167	3	1	3	Ic Last Trip	1	0
168	3	1	3	Va Last Trip	1	0
169	3	1	3	Vb Last Trip	1	0
170	3	1	3	Vc Last Trip	1	0
171	3	1	3	In Last Trip	1	0
172	3	1	3	Ig Last Trip	1	0
173	3	1	3	Isef Last Trip	1	0
174	3	2	4	Va Max	0.01	100
175	3	2	4	Vb Max	0.01	100
176	3	2	4	Vc Max	0.01	100
177	3	2	4	Vab Max	0.01	100
178	3	2	4	Vbc Max	0.01	100
179	3	2	4	Vca Max	0.01	100
184	3	1	3	CB Wear A	0.0001	1000000
185	3	1	3	CB Wear B	0.0001	1000000
186	3	1	3	CB Wear C	0.0001	1000000
192	3	5	7	Freq Last Trip	1	1
294	3	2	4	Ia 81THD	100	1
295	3	2	4	Ib 81THD	100	1
296	3	2	4	Ic 81THD	100	1

### 5.3.5 Binary Counters

The following table lists the Counters (Object 20).

The “Default Deadband,” and the “Default Change Event Assigned Class” columns are used to represent the absolute amount by which the point must change before a Counter change event will be generated, and once generated in which class poll (1, 2, 3, or none) will the change event be reported.

Counters are by default not returned in a class zero interrogation.

<b>Counters</b>					
Static (Steady-State) Object Number: <b>20</b>					
Change Event Object Number: <b>22</b>					
Default Static Variation reported when variation 0 requested: <b>5 (32-Bit Counter without Flag)</b>					
Default Change Event Variation reported when variation 0 requested: <b>1 (32-Bit Change Event with Flag)</b>					
Point #	Default Class	Default Static Variant	Default Event Variant	Name	Deadband
0	3	5	1	Waveform Records	1
1	3	5	1	Fault Records	1
2	3	5	1	Event Records	1
3	3	5	1	Data Log Records	1
4	3	5	1	Number User Files	1
5	3	5	1	Start Count	1
6	3	5	1	Start Count Target	1
7	3	5	1	Active Setting Group	1
11	3	5	1	CB Total Trip Count	1
16	3	5	1	CB Delta Trip Count	1
17	3	5	1	CB Count To AR Block	1
18	3	5	1	CB Frequent Ops Count	1
21	3	5	1	E1 Counter	1
22	3	5	1	E2 Counter	1
23	3	5	1	E3 Counter	1
24	3	5	1	E4 Counter	1

### 5.3.6 Frozen Counters

The following table lists the Frozen Counters (Object 21).

The “Default Change Event Assigned Class” column is used to define which class poll (1, 2, 3, or none) the change event will be reported.

Note the point number of the Frozen Counter must match that of the corresponding Counter.

Frozen Counters are by default not returned in a class zero interrogation.

<b>Frozen Counters</b>					
Static (Steady-State) Object Number: <b>21</b>					
Change Event Object Number: <b>23</b>					
Default Static Variation reported when variation 0 requested: <b>9 (32-Bit Counter without Flag)</b>					
Default Change Event Variation reported when variation 0 requested: <b>1 (32-Bit Change Event with Flag)</b>					
Point #	Default Class	Default Static Variant	Default Event Variant	Name	Resettable
0	2	9	1	Waveform Records	ý
1	2	9	1	Fault Records	ý
2	2	9	1	Event Records	ý
3	2	9	1	Data Log Records	ý
4	2	9	1	Number User Files	ý
5	2	9	1	Start Count	þ
6	2	9	1	Start Count Target	ý
7	2	9	1	Active Setting Group	ý
11	2	9	1	CB Total Trip Count	þ
16	2	9	1	CB Delta Trip Count	þ
17	2	9	1	CB Count To AR Block	þ
18	2	9	1	CB Frequent Ops Count	þ

**Frozen Counters**Static (Steady-State) Object Number: **21**Change Event Object Number: **23**Default Static Variation reported when variation 0 requested: **9 (32-Bit Counter without Flag)**Default Change Event Variation reported when variation 0 requested: **1 (32-Bit Change Event with Flag)**

Point #	Default Class	Default Static Variant	Default Event Variant	Name	Resettable
21	2	9	1	E1 Counter	ý
22	2	9	1	E2 Counter	ý
23	2	9	1	E3 Counter	ý
24	2	9	1	E4 Counter	ý

## **Section 6: IEC61850 Protocol Support**

The relay can optionally be provided with IEC61850 communication capabilities.

For further details on IEC61850 refer to the following publications:

- 1) Model Implementation Conformance Statement (MICS)
- 2) Protocol Implementation Conformance Statement (PICS)
- 3) Protocol Implementation Extra Information for Testing (PIXIT)



## Section 7: Modems

### 7.1 INTRODUCTION

The communications interface has been designed to allow data transfer via modems. However, IEC 60870-5-103 defines the data transfer protocol as an 11 bit format of 1 start, 1 stop, 8 data and even parity, which is a mode most commercial modems do not support. High performance modems will support this mode, but are expensive. For this reason, a parity setting is provided to allow use of easily available and relatively inexpensive commercial modems. This will result in a small reduction in data security and the system will not be compatible with true IEC 60870-5-103 control systems.

### 7.2 CONNECTING A MODEM TO THE RELAY(S)

RS232C defines devices as being either Data Terminal Equipment (DTE) e.g. computers, or data Communications Equipment (DCE), e.g. modems, where one is designed to be connected to the other. In this case, two DCE devices (the modem and the fibre-optic converter) are being connected together, so a null terminal connector is required, which switches various control lines. The fibre-optic converter is then connected to the relay Network Tx to Relay Rx and Network Rx to Relay Tx.

### 7.3 SETTING THE REMOTE MODEM

The exact settings of the modem are dependent on the type of modem. Although most modems support the basic Hayes 'AT' command format, different manufacturers use different commands for the same functions. In addition, some modems use DIP switches to set parameters, others are entirely software configured.

Before applying settings, the modem's factory default settings should be applied, to ensure it is in a known state.

Several factors must be considered to allow remote dialling to the relays. The first is that the modem at the remote end must be configured as auto answer. This will allow it to initiate communications with the relays. Next, the user should set the data configuration at the local port, i.e. baud rate and parity, so that communication will be at the same rate and format as that set on the relay and the error correction is disabled.

Auto-answer usually requires two parameters to be set. The auto-answer setting should be switched on and the number of rings after which it will answer. The Data Terminal Ready (DTR) settings should be forced on. This tells the modem that the device connected to it is ready to receive data.

The parameters of the modem's RS232C port are set to match those set on the relay, set baud rate and parity to be the same as the settings on the relay and number of data bits to be 8 and stop bits 1. Note, although the device may be able to communicate with the modem at say 19200 bps, the modem may only be able to transmit over the telephone lines at 14400 bps. Therefore, a baud rate setting on which the modem can transmit should be chosen. In this example, a baud rate of 9600 should be chosen.

As the modems are required to be transparent, simply passing on the data sent from the controller to the device and vice versa, error correction and buffering is turned off.

If possible, Data Carrier Detect (DCD) should be forced on, as this control line will be used by the Fibre-optic converter.

Finally, these settings should be stored in the modem's memory for power on defaults.

### 7.4 CONNECTING TO THE REMOTE MODEM

Once the remote modem has been configured correctly, it should be possible to dial up the modem and make connection to the relay. As the settings on the remote modem are fixed the local modem should negotiate with it on connection, choosing suitable matching settings. If it cannot do this, the local modem should be set with settings equivalent to those of the remote modem as described above.

## Section 8: Configuration

The data points and control features which are possible within the relay is fixed and can be transmitted over the communication channel(s) protocols in the default format described earlier in this section. The default data transmitted is not always directly compatible with the needs of the substation control system and will require some tailoring, this can be done by the user with the Reydisp software comms editor tool.

The Comms Editor is provided to allow its users to configure the Communications Files Protocols in Reyrolle brand Relays manufactured by Siemens Protection Devices Limited (SPDL).

The editor supports configuring DNP3, IEC60870-5-103 and MODBUS protocols.

The editor allows configuration files to be retrieved from the relay, edited, then uploaded back to the relay. Files may also be saved/loaded from disc to work offline. The protocols will be stored in a Reyrolle Protection Device Comms file (RPDC), which will be stored locally, so that the editor can be used when the relay is not connected.

### 8.1 DNP3

The tool will allow:

- Data Points to be enabled or disabled.
- Changing the point numbers for the Binary Inputs, Binary Outputs and Analogue Inputs.
- Changing their assigned class and object variants.
- Setting Binary points to be inverted before transmission.
- Setting the Control Relay Output Block (CROB) commands that can be used with a Binary Output.
- Specifying a dead-band outside which Analogue Events will be generated.
- Specifying a multiplier that will be applied to an analogue value before transmission.

### 8.2 IEC60870-5-103

The tool will allow:

- Data Points to be enabled or disabled.
- Changing the point numbers Function Type (FUN) and Information (INF), returned by each point.
- Changing the text returned to Reydisp for display in its event viewer.

### 8.3 MODBUS-RTU

The tool will allow:

- Changing the Addresses for the Coils, Inputs and Registers.
- Changing the format of the instrument returned in a register, e.g. 16 or 32 bit.
- Specifying a multiplier that will be applied to an analogue value before transmission.

Note, as MODBUS points are polled they do not need to be enabled or disabled

The user can check if the relay contains user configured communication files via a meter in the relay menus. Pressing the Enter and down arrow buttons on the fascia, then scrolling down, the number of files stored in the relay is displayed. The file name can also be viewed by pressing the Cancel and Test/Reset buttons together when in the relay Instruments menu. The user must ensure when naming the file, they use a unique file name including the version number.

Please refer to the Comms Editor Technical Manual for further guidance.

## Section 9: Glossary

**ASDU**

Application Service Data Unit.

**Baud Rate**

Data transmission speed.

**Bit**

The smallest measure of computer data.

**Bits Per Second (bps)**

Measurement of data transmission speed.

**Data Bits**

A number of bits containing the data. Sent after the start bit.

**Data Echo**

When connecting relays in an optical ring architecture, the data must be passed from one relay to the next, therefore when connecting in this method all relays must have the Data Echo ON.

**Half-Duplex Asynchronous Communications**

Communications in two directions, but only one at a time.

**Hayes 'AT'**

Modem command set developed by Hayes Microcomputer products, Inc.

**Line Idle**

Determines when the device is not communicating if the idle state transmits light.

**Parity**

Method of error checking by counting the value of the bits in a sequence, and adding a parity bit to make the outcome, for example, even.

**Parity Bit**

Bit used for implementing parity checking. Sent after the data bits.

**RS232C**

Serial Communications Standard. Electronic Industries Association Recommended Standard Number 232, Revision C.

**RS485**

Serial Communications Standard. Electronic Industries Association Recommended Standard Number 485.

**Start Bit**

Bit (logical 0) sent to signify the start of a byte during data transmission.

**Stop Bit**

Bit (logical 1) sent to signify the end

**USB**

**Universal Serial Bus standard for the transfer of data.**

# 7SR10

Installation Guide

## Document Release History

This document is issue 2017/07. The list of revisions up to and including this issue is:

2013/11	First Issue
2015/02	Second Issue
2015/03	Third Issue
2015/06	Fourth Issue
2015/09	Fifth Issue
2016/11	Sixth Issue
2017/03	Seventh Issue
2017/04	Eighth Issue
2017/07	Nineth Issue

## Software Revision History

2013/11	2436H80015 R2d-1a	First Release
2015/02	2437H80001 R4b-1d	Second Release
2015/03	2437H80001 R4b-1e	Third Release
2015/06	2437H80001 R4b-1f	Fourth Release
2015/09	2437H80001 R4b-2a	Fifth Release
2016/11	2437H80001 R4b-2b	Sixth Release
2017/04	2437H80001 R4c-2b	Seventh Release

---

## Contents

Section 1: Installation Guide.....	3
1.1 Installation.....	3
1.2 Fascia Cover Mounting Instructions.....	5

## List of Figures

Figure 1-1	Clearance for Terminal Wiring.....	3
Figure 1-2	Panel cut-out.....	4
Figure 1-3	7SR10 Relay with Mounting Brackets.....	5
Figure 1-4	7SR10 Relay with Fascia Cover.....	6
Figure 1-5	7SR10 Relay with Sealing Knob.....	6

## List of Tables

Table 1-1	Recommended Terminal Lugs Specifications with Control Push Buttons.....	4
-----------	---	---

## Section 1: Installation Guide

### 1.1 Installation

Execute the following procedure to install the 7SR10 Overcurrent and Earth Fault relay:

1. Create a slot of dimensions as shown in Figure 1-2 to house the relay in the protection panel.
2. Flush the rear-side of relay into the protection panel cut-out.
3. Fasten the relay using the four M4x20 Pan Phillips SS screws with nut provided in the 7SR10 packing box to the protection panel/cubicle.
4. Carry-out all other installation steps/wiring internally from the protection panel.
5. In the rear terminal of the relay, execute the wiring process as mentioned in scheme requirements. Refer the diagram for more details about terminal connector diagram. Refer the table for the recommended terminal lugs to be used.
6. The earthing cable should be wired using a cable of 2.5 mm<sup>2</sup> (min) and this should be terminated in the shortest possible path to the earth terminal/bus bar in panel or cubicle.
7. Maintain a minimum clearance from the relay as given in Figure 1-1 to ensure safety and accidental touch of terminals. In case of work area is restricted in a cubicle, then suitable protective terminals to be provided in the cubicle.

#### NOTE:

The earthing point (E) of auxiliary supply is connected to the ground (GND) point of the relay. The earth connection of relay casing should be solidly connected to the panel earth.

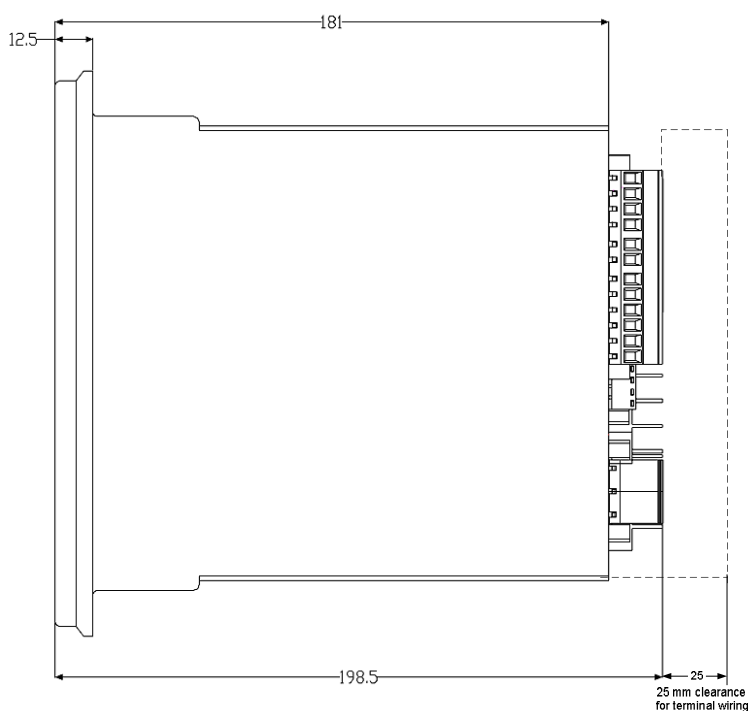


Figure 1-1 Clearance for Terminal Wiring

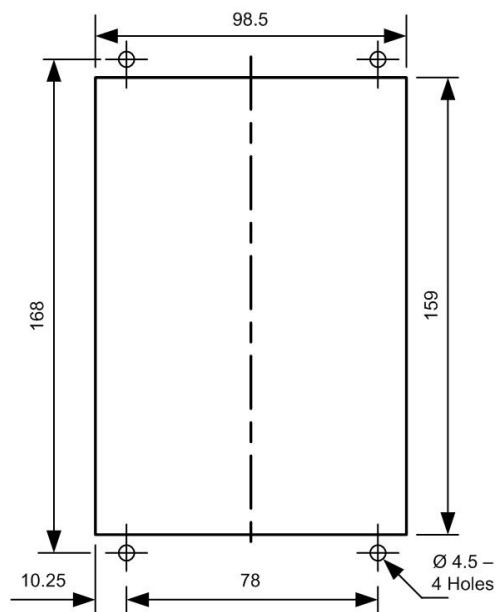


Figure 1-2 Panel cut-out

Table 1-1 Recommended Terminal Lugs Specifications with Control Push Buttons

Terminal Blocks	Type/Cable Specifications	Manufacturer/Part number
<b>Current Inputs</b> (Terminal X5)	Ring type lug/2.5 mm <sup>2</sup> or 4 mm <sup>2</sup> control cable	Dowell's/RS007 or equivalent
<b>Auxiliary Supply</b> (Terminal X3)	Pin type lug/1.5 mm <sup>2</sup> /2.5 mm <sup>2</sup> control cable	Dowell's/CP9/CP1 or equivalent
<b>Rear Communication Port</b> (Terminal X2)	Pin type lug/1.5 mm <sup>2</sup> control cable	Dowell's/CP9 or equivalent
<b>Front Communication Port</b>	USB, Type B	Tyco/974329-1 or equivalent
<b>Binary Input</b> (Terminal X1)	Pin type lug/1.5 mm <sup>2</sup> /2.5 mm <sup>2</sup> control cable	Dowell's/CP9/CP1 or equivalent
<b>Binary Output</b> (Terminal X4)	Pin type lug/1.5 mm <sup>2</sup> /2.5 mm <sup>2</sup> control cable	Dowell's/CP9/CP1 or equivalent
<b>Earth Connections</b>	Ring type lug/2.5 mm <sup>2</sup> or 4 mm <sup>2</sup> control cable	Dowell's/RS007 or equivalent

## 1.2 Fascia Cover Mounting Instructions

Follow the procedure to fit the 7SR10 overcurrent and protection relay with removable fascia cover:

1. Fix the 7SR10 overcurrent and protection relay on the panel along with mounting brackets.


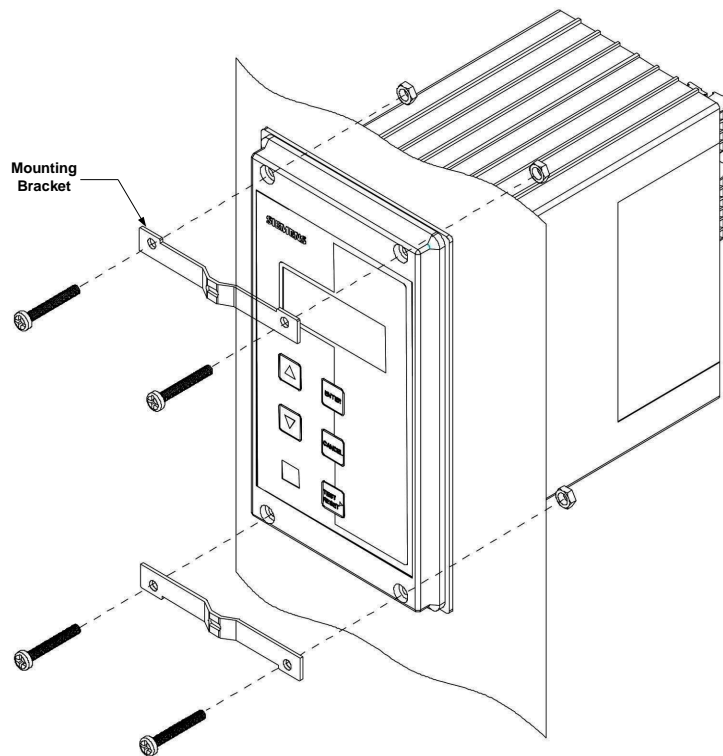


Figure 1-3 7SR10 Relay with Mounting Brackets




2. Assemble the removable fascia cover on the relay by using the sealing knob.

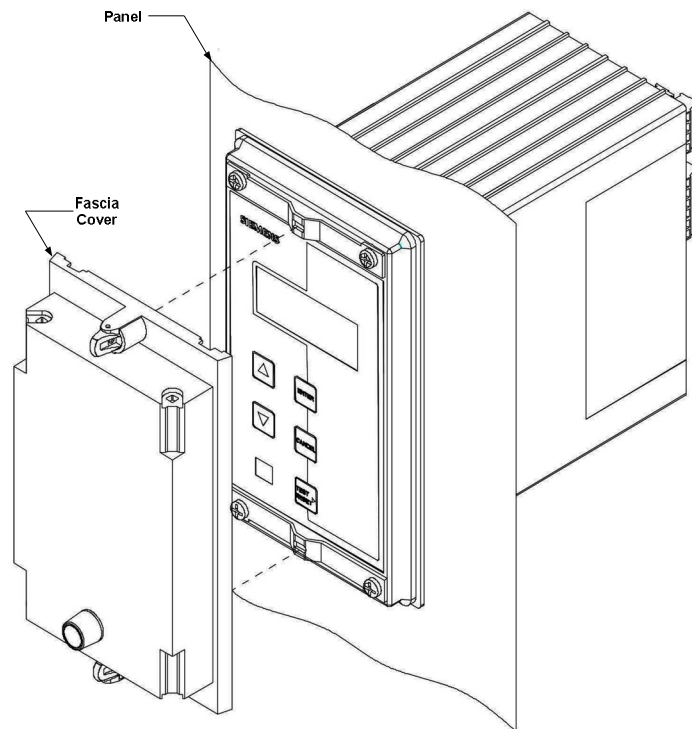

**Figure 1-4 7SR10 Relay with Fascia Cover**

3. Lock the sealing knob by rotating clockwise direction to lock.

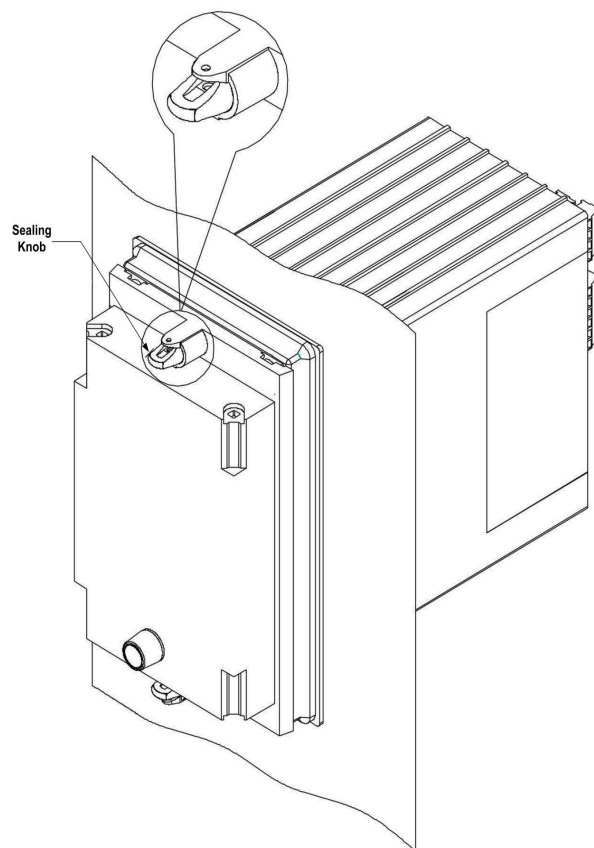

**Figure 1-5 7SR10 Relay with Sealing Knob**

# 7SR10

Commissioning and Maintenance Guide

## Document Release History

This document is issue 2017/07. The list of revisions up to and including this issue is:

2013/11	First Issue
2015/02	Second Issue
2015/03	Third Issue
2015/06	Fourth Issue
2015/09	Fifth Issue
2016/11	Sixth Issue
2017/03	Seventh Issue
2017/04	Eighth Issue
2017/07	Nineth Issue

## Software Revision History

2013/11	2436H80015 R2d-1a	First Release
2015/02	2437H80001 R4b-1d	Second Release
2015/03	2437H80001 R4b-1e	Third Release
2015/06	2437H80001 R4b-1f	Fourth Release
2015/09	2437H80001 R4b-2a	Fifth Release
2016/11	2437H80001 R4b-2b	Sixth Release
2017/04	2437H80001 R4c-2b	Seventh Release

## Contents

Section 1: Commissioning and Maintenance Guide.....	2
1.1 Troubleshooting.....	2

## Section 1: Commissioning and Maintenance Guide

### 1.1 Troubleshooting

This section provides the common problems and the recommended solution to resolve the problem.

Observation	Action
<b>Relay does not power up</b>	Check the correct auxiliary AC or DC voltage is applied and the polarity is correct.
<b>Relay won't accept the password</b>	The password entered is wrong. Enter the correct password. If correct password has been forgotten, note down the numeric code displayed at the Change Password screen e.g. Change password = 1234567 To retrieve the password, communicate this numeric code to a Siemens Limited representative.
<b>Protection Healthy LED flashes</b>	General failure. Contact a Siemens Limited representative.
<b>LCD screen flashes continuously</b>	The LCD displays multiple error messages by flashing continuously. These indicate the various processor card faults. General failure. Contact a Siemens Limited representative.
<b>Relay displays one instrument after another with no user intervention</b>	This is normal operation, the default instruments are enabled. Remove all instruments from the default list and add only the instruments that are required.
<b>Cannot communicate with the relay</b>	<ul style="list-style-type: none"> <li>• Check that all the communications settings matches with the settings used by Reydisp Evolution.</li> <li>• Check that all cables, modems, and fibre-optic cables work correctly.</li> <li>• Ensure that IEC 60870-5-103 is specified for the connected port (COM1 or COM2).</li> </ul>
<b>Relays will not communicate in a ring network</b>	<ul style="list-style-type: none"> <li>• Check that all relays are powered up.</li> <li>• Check that all relays have unique addresses.</li> </ul>
<b>Status inputs do not work</b>	<ul style="list-style-type: none"> <li>• Check that the correct DC voltage is applied and that the polarity is correct.</li> <li>• Check that the status input settings such as the pick-up and drop-off timers and the status inversion function are correctly set.</li> </ul>
<b>Relay instrument displays show small currents or voltages even though the system is dead</b>	This is normal. The relay is displaying calculation noise. This will not affect any accuracy claims for the relay.

If the above troubleshooting checklist does not help in correcting the problem please contact our Customer Support Center:

Phone: +49 180/524 8437 (24hrs)

Fax: +49 180/524 2471

E-mail: [support.energy@siemens.com](mailto:support.energy@siemens.com)

# 7SR10, 7SR11, and 7SR12

Applications Guide

## Document Release History

This document is issue 2017/07. The list of revisions up to and including this issue is:

2013/11	First Issue
2015/02	Second Issue
2015/03	Third Issue
2015/06	Fourth Issue
2015/09	Fifth Issue
2016/11	Sixth Issue
2017/03	Seventh Issue
2017/04	Eighth Issue
2017/07	Nineth Issue

## Software Revision History

2013/11	2436H80015 R2d-1a	First Release
2015/02	2437H80001 R4b-1d	Second Release
2015/03	2437H80001 R4b-1e	Third Release
2015/06	2437H80001 R4b-1f	Fourth Release
2015/09	2437H80001 R4b-2a	Fifth Release
2016/11	2437H80001 R4b-2b	Sixth Release
2017/04	2437H80001 R4c-2b	Seventh Release

## Contents

Section 1: Common Functions.....	4
1.1 Multiple Settings Groups.....	4
1.2 Binary Inputs.....	5
1.2.1 Alarm and Tripping Inputs.....	5
1.2.2 The Effects of Capacitance Current.....	6
1.3 Binary Outputs.....	7
1.4 LEDs.....	7
Section 2: Protection Functions.....	8
2.1 Time delayed overcurrent (51/51G/51N).....	8
2.1.1 Selection of Overcurrent Characteristics.....	9
2.1.2 Reset Delay.....	10
2.2 Voltage dependent overcurrent (51V).....	11
2.3 Cold Load Settings (51c).....	11
2.4 Instantaneous Overcurrent (50/50G/50N).....	12
2.4.1 Blocked Overcurrent Protection Schemes.....	12
2.5 Sensitive Earth-fault Protection (50SEF).....	14
2.6 Directional Protection (67).....	15
2.6.1 2 Out of 3 Logic.....	17
2.7 Directional Earth-Fault (50/51G, 50/51N, 50/51SEF).....	18
2.7.1 Compensated Coil Earthing Networks.....	18
2.7.2 Isolated Networks.....	20
2.7.3 Minimum Polarising Voltage.....	20
2.8 High Impedance Restricted Earth Fault Protection (64H).....	21
2.9 Negative Phase Sequence Overcurrent (46NPS).....	22
2.10 Undercurrent (37).....	23
2.11 Thermal Overload (49).....	23
2.12 Under/Over Voltage Protection (27/59).....	24
2.13 Neutral Overvoltage (59N).....	25
2.13.1 Application with Capacitor Cone Units.....	26
2.13.2 Derived NVD Voltage.....	26
2.14 Negative Phase Sequence Overvoltage (47).....	26
2.15 Under/Over Frequency (81).....	26
Section 3: CT Requirements.....	28
3.1 CT Requirements for Overcurrent and Earth Fault Protection.....	28
3.1.1 Overcurrent Protection CTs.....	28
3.1.2 Earth Fault Protection CTs.....	28
3.2 CT Requirements for High Impedance Restricted Earth Fault Protection.....	28
Section 4: Control Functions.....	29
4.1 Auto-reclose Applications.....	29
4.1.1 Auto-Reclose Example 1.....	30
4.1.2 Auto-Reclose Example 2 (Use of Quicklogic with AR).....	31
4.2 Quick Logic Applications.....	32
4.2.1 Auto-Changeover Scheme Example.....	32
Section 5: Supervision Functions.....	33
5.1 Circuit-Breaker Fail (50BF).....	33
5.1.1 Settings Guidelines.....	33
5.2 Current Transformer Supervision.....	35
5.3 Voltage Transformer Supervision (60VTS).....	36
5.4 Trip/Close Circuit Supervision (74T/CCS).....	37
5.4.1 Trip Circuit Supervision Connections.....	37
5.4.2 Close Circuit Supervision Connections.....	39
5.5 Inrush Detector (81HBL2).....	40
5.6 Broken Conductor / Load Imbalance (46BC).....	40
5.6.1 Broken Conductor example.....	40
5.7 Circuit-Breaker Maintenance.....	41

## List of Figures

Figure 1.5-1 Example Use of Alternative Settings Groups .....	4
Figure 1.4-1 LED configuration via the LED Matrix tab .....	7
Figure 1.4-2 LED configuration via the Settings \ OUTPUT CONFIG \ LED CONFIG menu .....	7
Figure 2.1-1 IEC NI Curve with Time Multiplier and Follower DTL Applied.....	8
Figure 2.1-2 IEC NI Curve with Minimum Operate Time Setting Applied .....	9
Figure 2.1-3 Reset Delay .....	10
Figure 2.4-4 General Form of DTL Operate Characteristic.....	12
Figure 2.4-5 Blocking Scheme Using Instantaneous Overcurrent Elements .....	13
Figure 2.5-6 Sensitive Earth Fault Protection Application.....	14
Figure 2.6-7 Directional Characteristics .....	15
Figure 2.6-8 Phase Fault Angles .....	16
Figure 2.6-9 Application of Directional Overcurrent Protection .....	16
Figure 2.7-1 Earth fault current distribution in Compensated network.....	18
Figure 2.7-2 Earth fault current direction in compensated network .....	19
Figure 2.7-3 Adjustment of Characteristic Angle.....	19
Figure 2.7-4 Cosine component of current.....	19
Figure 2.7-5 Earth fault current in isolated network.....	20
Figure 2.8-1 Balanced and Restricted Earth-fault protection of Transformers .....	21
Figure 2.8-2 Composite Overcurrent and Restricted Earth-fault Protection.....	22
Figure 2.11-3 Thermal Overload Heating and Cooling Characteristic .....	23
Figure 2.13-4 NVD Application .....	25
Figure 2.13-5 NVD Protection Connections.....	25
Figure 2.15-1 Load Shedding Scheme Using Under-Frequency Elements .....	27
Figure 4.1-1 Sequence Co-ordination .....	29
Figure 4.1-2 Example of Logic Application .....	31
Figure 4.2-3 Example Use of Quick Logic.....	32
Figure 5.1-1 Circuit Breaker Fail .....	33
Figure 5.1-2 Single Stage Circuit Breaker Fail Timing.....	34
Figure 5.1-3 Two Stage Circuit Breaker Fail Timing.....	34
Figure 5-4 Logic Diagram: Trip Circuit Supervision Feature (74TCS).....	37
Figure 5-5 Logic Diagram: Close Circuit Supervision Feature (74CCS).....	37
Figure 5-6 Trip Circuit Supervision Scheme 1 (H5).....	38
Figure 5-7 Trip Circuit Supervision Scheme 2 (H6).....	38
Figure 5-8 Trip Circuit Supervision Scheme 3 (H7).....	39
Figure 5-9 Close Circuit Supervision Scheme .....	39

## List of Tables

Table 2-1 Application of IDMTL Characteristics.....	10
Table 5-1 Determination of VT Failure (1 or 2 Phases).....	35
Table 5-2 Determination of VT Failure (1 or 2 Phases).....	36
Table 5-3 Determination of VT Failure (3 Phases).....	36
Table 5-4 Magnetic Inrush Bias.....	40

## Section 1: Common Functions

### 1.1 Multiple Settings Groups

Alternate settings groups can be used to reconfigure the relay during significant changes to system conditions e.g.

- Primary plant switching in/out.
- Summer/winter or day/night settings.
- Switchable earthing connections.
- Loss of Grid connection (see below)

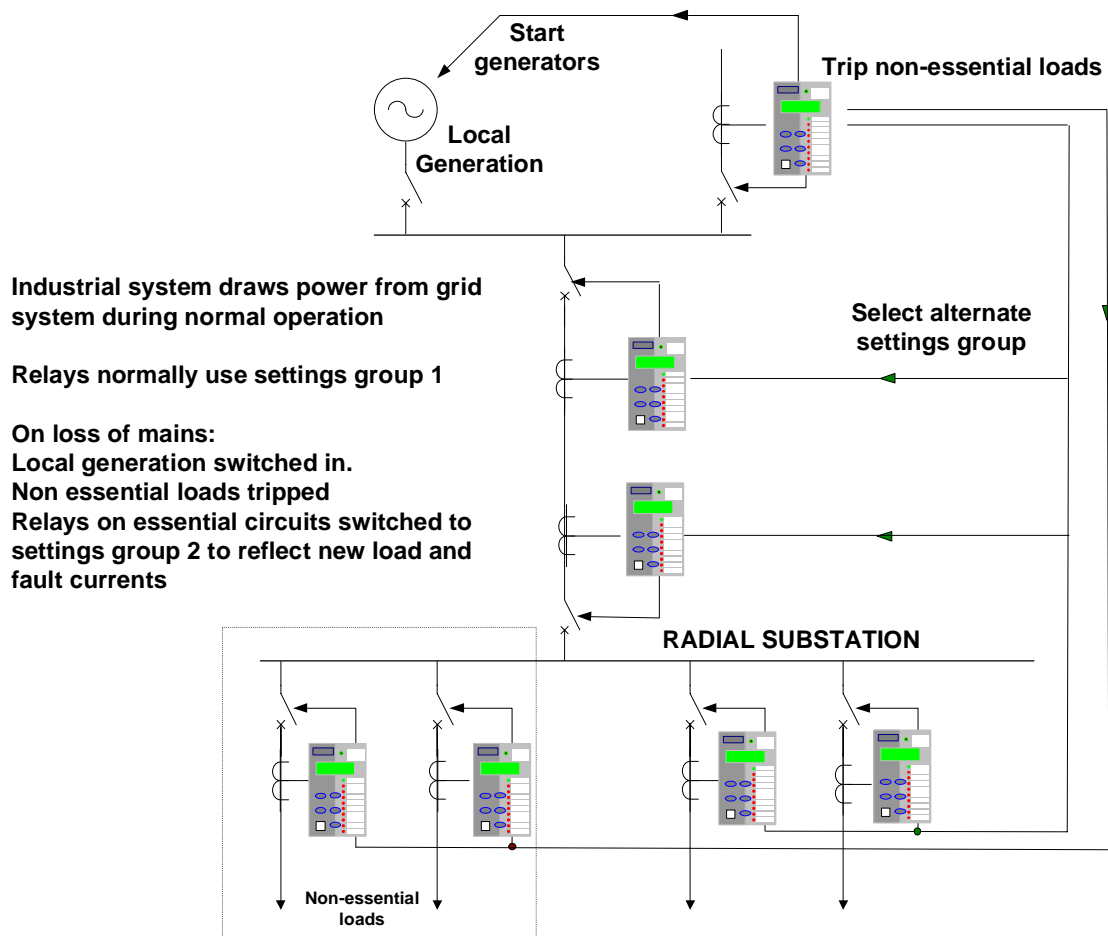


Figure 1.5-1 Example Use of Alternative Settings Groups

## 1.2 Binary Inputs

Each Binary Input (BI) can be programmed to operate one or more of the relay functions, LEDs or output relays. These could be used to bring such digital signals as Inhibits for protection elements, the trip circuit supervision status, autoreclose control signals etc. into the Relay.

### 1.2.1 Alarm and Tripping Inputs

A common use of binary inputs is to provide indication of alarm or fault conditions e.g. transformer Buchholz Gas or Buchholz Surge conditions. The Binary Inputs are mapped to LED(s), waveform storage trigger and binary outputs. Note that transformer outputs which require high speed tripping, such as a Buchholz Surge, should be wired to a binary input to provide LED indication and also have a parallel connection wired to directly trip the circuit via a blocking diode, see figure. 1.2-1:

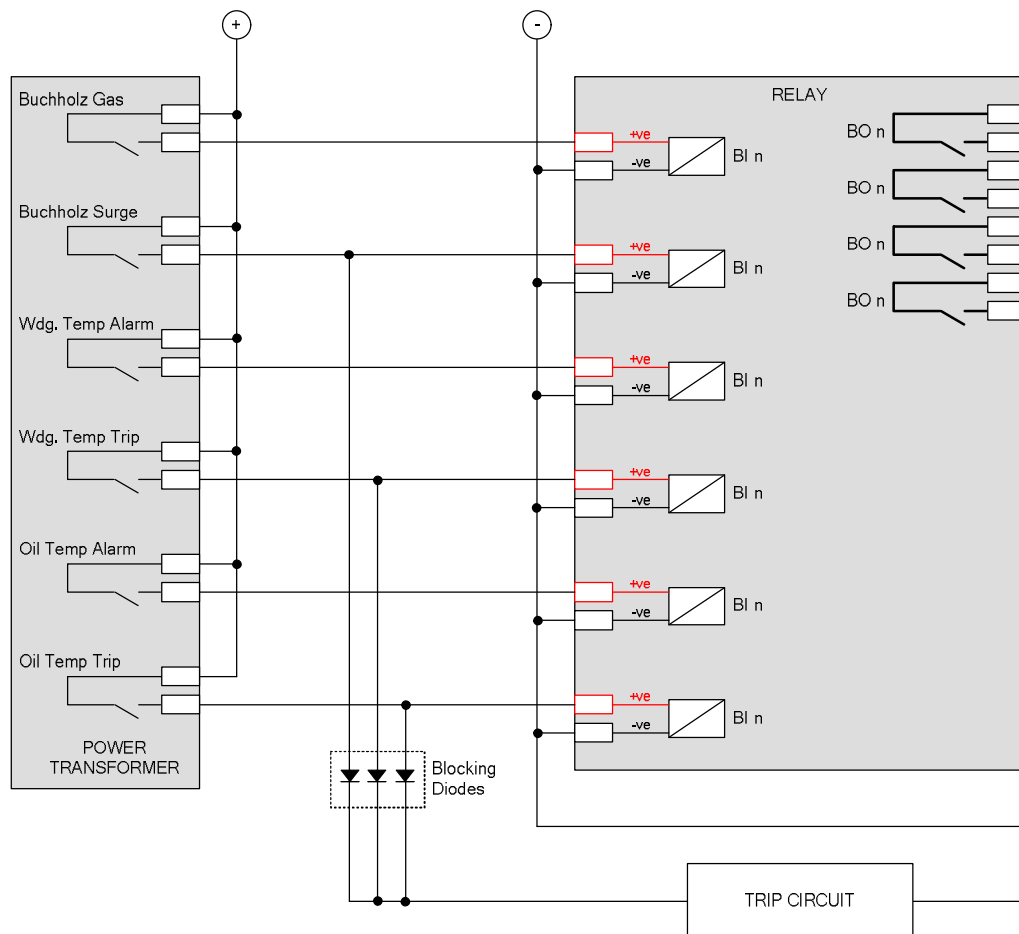


Figure 1.2-1 Example of Transformer Alarm and Trip Wiring



### 1.2.2 The Effects of Capacitance Current

The binary inputs have a low minimum operate current and may be set for instantaneous operation. Consideration should be given to the likelihood of mal-operation due to capacitance current. Capacitance current can flow through the BI for example if an earth fault occurs on the dc circuits associated with the relay. The binary inputs will be less likely to mal-operate if they:

- 1 Have both the positive and negative switched (double-pole switched).
- 2 Do not have extensive external wiring associated with them e.g. if the wiring is confined to the relay room.

Where a binary input is both used to influence a control function (e.g. provide a tripping function) and it is considered to be susceptible to mal-operation the external circuitry can be modified to provide immunity to such disturbances, see figure 1.2-2.

## 1.3 Binary Outputs

Binary Outputs are mapped to output functions by means of settings. These could be used to bring out such digital signals as trips, a general pick-up, plant control signals etc.

All Binary Outputs are Trip rated

Each can be defined as Self or Hand Reset. Self-reset contacts are applicable to most protection applications. Hand-reset contacts are used where the output must remain active until the user expressly clears it e.g. in a control scheme where the output must remain active until some external feature has correctly processed it.

Notes on Self Reset Outputs

With a failed breaker condition the relay may remain operated until current flow in the primary system is interrupted by an upstream device. The relay will then reset and attempt to interrupt trip coil current flowing through an output contact. Where this level is above the break rating of the output contact an auxiliary relay with heavy-duty contacts should be utilised.

## 1.4 LEDs

In the Output Configuration menu LEDs can be mapped to output functions by means of settings. These could be used to display such digital signals as trips, a general pick-up, plant control signals etc.

Each LED can be defined as Self or Hand Reset. Hand reset LEDs are used where the user is required to expressly acknowledge the change in status e.g. critical operations such as trips or system failures. Self-reset LEDs are used to display features which routinely change state, such as Circuit-Breaker open or close.

The status of hand reset LEDs is retained in capacitor-backed memory in the event of supply loss.

Each LED can be assigned as red, yellow or green in colour. There are two methods for doing this: -

- 1) In the LED Matrix tab, to assign the LED as a red colour select a box on the red row. To assign the LED as a green colour select a box on the green row. To assign the LED as a yellow colour, select boxes on both the red and green rows.

NB: If there are no boxes selected the LED will not illuminate.

Setting \ LED	1	2	3	4	5	6	7	8	9	10	11	12	13	14
Self Reset LEDs	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
PU Self Reset LEDs	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Green LEDs	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Red LEDs	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
PU Green LEDs	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
PU Red LEDs	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Figure 1.4-1 LED configuration via the LED Matrix tab

- 2) In the OUTPUT CONFIG\LED CONFIG menu in the Settings tab, to assign the required LED as a particular colour, either red or green, type the LED number in the appropriate row. To assign the required LED as a yellow colour, type the LED number in both red and green rows.

NB: If a LED number is not assigned that particular LED will not illuminate.

Parameter	Value
<input checked="" type="checkbox"/> Self Reset LEDs	9, 10, 11, 12, 13, 14
<input checked="" type="checkbox"/> PU Self Reset LEDs	1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14
<input checked="" type="checkbox"/> Green LEDs	5, 6, 7, 8, 9, 10, 11, 12
<input checked="" type="checkbox"/> Red LEDs	1, 2, 3, 4, 9, 10, 11, 12
<input checked="" type="checkbox"/> PU Green LEDs	5, 6, 7, 8, 9, 10, 11, 12
<input checked="" type="checkbox"/> PU Red LEDs	1, 2, 3, 4, 9, 10, 11, 12

Figure 1.4-2 LED configuration via the Settings \ OUTPUT CONFIG \ LED CONFIG menu

## Section 2: Protection Functions

### 2.1 Time delayed overcurrent (51/51G/51N)

The 51-n characteristic element provides a number of time/current operate characteristics. The element can be defined as either an Inverse Definite Minimum Time Lag (IDMTL) or Definite Time Lag (DTL) characteristic. If an IDMTL characteristic is required, then IEC, ANSI/IEEE and a number of manufacturer specific curves are supported.

IDMTL characteristics are defined as “Inverse” because their tripping times are inversely proportional to the Fault Current being measured. This makes them particularly suitable to grading studies where it is important that only the Relay(s) closest to the fault operate. Discrimination can be achieved with minimised operating times.

To optimise the grading capability of the relay additional time multiplier, ‘Follower DTL’ (Fig. 2.1-1) or ‘Minimum Operate Time’ (Fig. 2.1-2) settings can be applied.


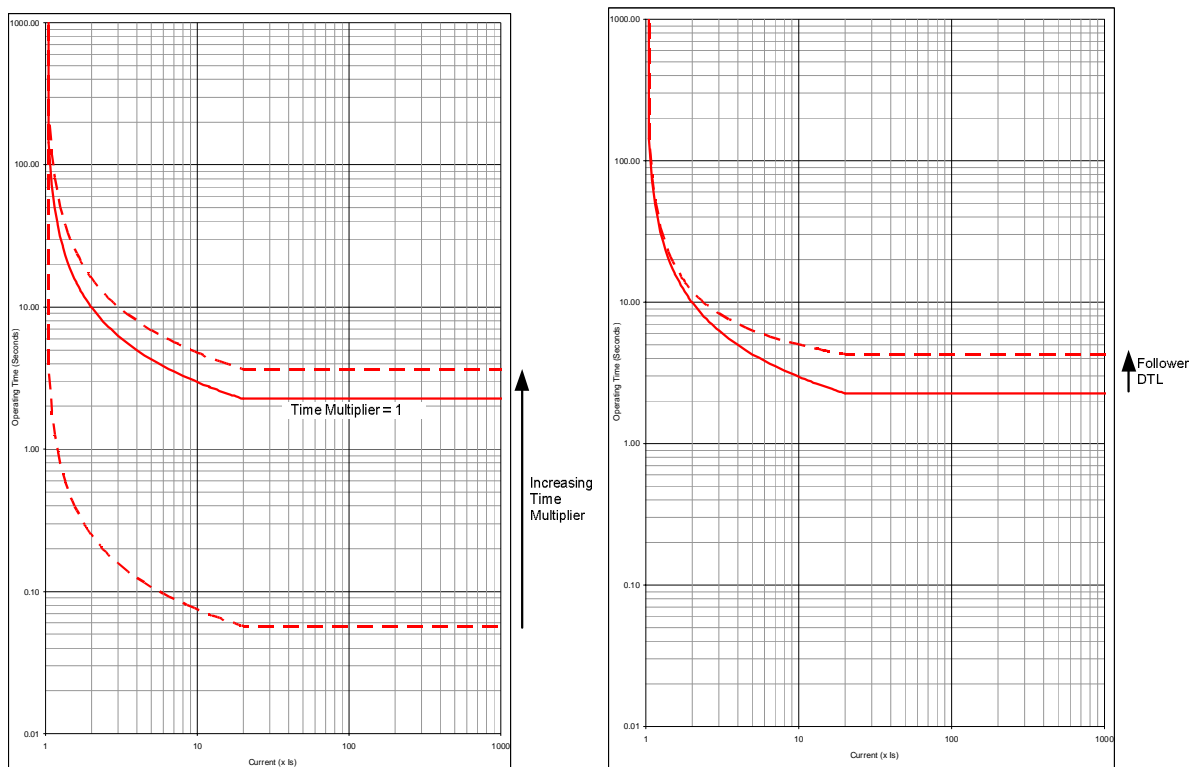


Figure 2.1-1 IEC NI Curve with Time Multiplier and Follower DTL Applied

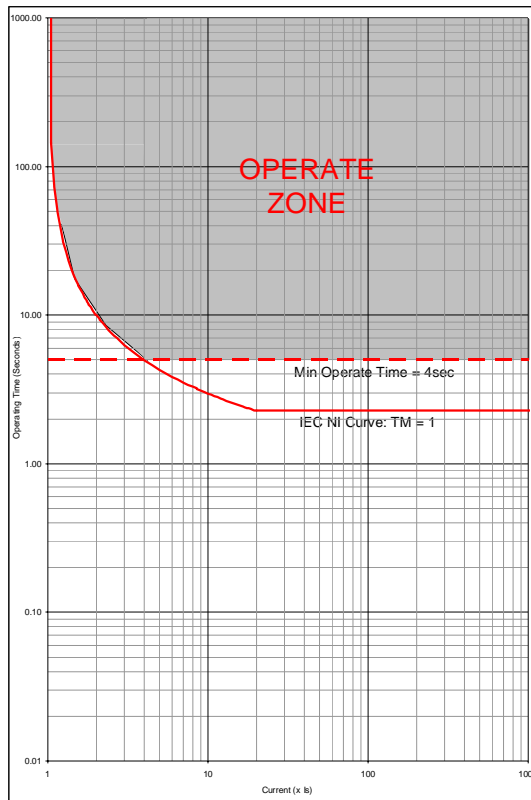

**Figure 2.1-2 IEC NI Curve with Minimum Operate Time Setting Applied**

To increase sensitivity, dedicated Earth fault elements are used. There should be little or no current flowing to earth in a healthy system so such relays can be given far lower pick-up levels than relays which detect excess current ( $>$  load current) in each phase conductor. Such dedicated earth fault relays are important where the fault path to earth is a high-resistance one (such as in highly arid areas) or where the system uses high values of earthing resistor / reactance and the fault current detected in the phase conductors will be limited.

### 2.1.1 Selection of Overcurrent Characteristics

Each pole has two independent over-current characteristics. Where required the two curves can be used:

- To produce a composite curve

- To provide a two stage tripping scheme

Where one curve is to be directionalised in the forward direction the other in the reverse direction.

The characteristic curve shape is selected to be the same type as the other relays on the same circuit or to grade with items of plant e.g. fuses or earthing resistors.

The application of IDMTL characteristic is summarised in the following table:

OC/EF Curve Characteristic	Application
IEC Normal Inverse (NI) ANSI Moderately Inverse (MI)	Generally applied
IEC Very Inverse (VI) ANSI Very Inverse (VI)	Used with high impedance paths where there is a significant difference between fault levels at protection points
IEC Extreme Inversely (EI) ANSI Extremely Inverse (EI)	Grading with Fuses
IEC Long Time Inverse (LTI)	Used to protect transformer earthing resistors having long withstand times

Table 2-1 Application of IDMTL Characteristics

### 2.1.2 Reset Delay

The increasing use of plastic insulated cables, both conventionally buried and aerial bundled conductors, have given rise to the number of flashing intermittent faults on distribution systems. At the fault position, the plastic melts and temporarily reseals the faulty cable for a short time after which the insulation fails again. The same phenomenon has occurred in compound-filled joint boxes or on 'clashing' overhead line conductors. The repeating occurrence of the fault can cause electromechanical disc relays to "ratchet" up and eventually trip the faulty circuit if the reset time of the relay is longer than the time between successive faults.

To mimic an electromechanical relay the relay can be user programmed for an IEC/ANSI DECAYING characteristic when an ANSI operate characteristic is applied. Alternatively a DTL reset (0 to 60 seconds) can be used with other operate characteristics.

For protection of cable feeders, it is recommended that a 60 second DTL reset be used.

On overhead line networks, particularly where reclosers are incorporated in the protected system, instantaneous resetting is desirable to ensure that, on multiple shot reclosing schemes, correct grading between the source relays and the relays associated with the reclosers is maintained.

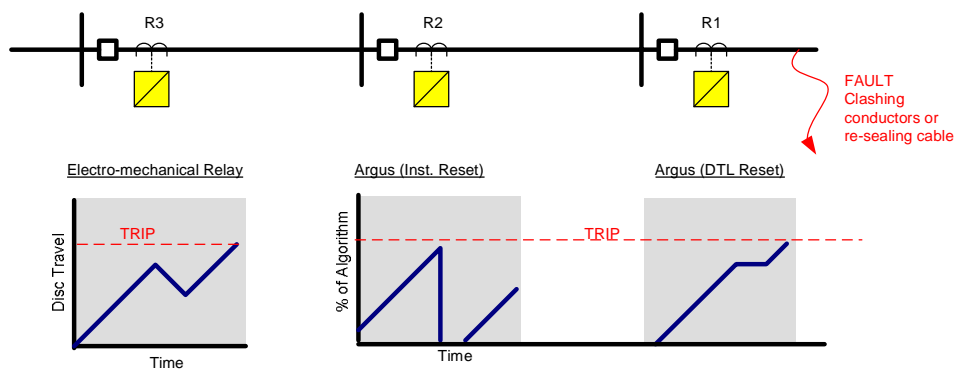


Figure 2.1-3 Reset Delay

## 2.2 Voltage dependent overcurrent (51V)

Reduced voltage can indicate a fault on the system, it can be used to make the 51 elements more sensitive.

Typically Voltage Dependent Over-current (VDO) is applied to:

**Transformer Incomers:** Where the impedance of the transformer limits fault current the measured voltage level can be used to discriminate between load and fault current.

**Long lines:** Where the impedance of the line limits fault current the measured voltage level can be used to discriminate between load and fault current.

**Generator circuits:** When a Generator is subjected to a short circuit close to its terminals the short-circuit current follows a complex profile. After the initial "sub-transient" value, generally in the order of 7 to 10 times full load current, it falls rapidly (around 10 to 20ms) to the "transient" value. This is still about 5 to 7 times full load and would be sufficient to operate the protection's over-current elements. However the effect on armature reactance of the highly inductive short-circuit current is to increase significantly the internal impedance to the synchronous reactance value. If the Automatic Voltage Regulation (AVR) system does not respond to increase the excitation, the fault current will decay over the next few seconds to a value below the full load current. This is termed the steady state fault current, determined by the Generator's synchronous reactance (and pre-fault excitation). It will be insufficient to operate the protection's over-current elements and the fault will not be detected. Even if AVR is active, problems may still be encountered. The AVR will have a declared minimum sustained fault current and this must be above the protection over-current settings. Close-in short circuit faults may also cause the AVR to reach its safety limits for supplying maximum excitation boost, in the order of several seconds, and this will result in AVR internal protection devices such as diode fuses to start operating. The generator excitation will then collapse, and the situation will be the same as when no AVR was present. The fault may again not be detected.

Current grading remains important since a significant voltage reduction may be seen for faults on other parts of the system. An inverse time operating characteristic must therefore be used.

The VDO Level - the voltage setting below which the more sensitive operating curve applies - must be set low enough to discriminate between short-circuits and temporary voltage dips due to overloads. However, it must also be high enough to cover a range of voltage drops for different circuit configurations, from around  $0.6V_n$  to almost zero. Typically it will be set in the range 0.6 to  $0.8V_n$ .

## 2.3 Cold Load Settings (51c)

Once a Circuit-Breaker has been open for a period of time, higher than normal levels of load current may flow following CB re-closure e.g. heating or refrigeration plant. The size and duration of this current is dependent upon the type of load and the time that the CB is open.

The feature allows the relay to use alternative Shaped Overcurrent (51c) settings when a Cold Load condition is identified. The cold load current and time multiplier settings will normally be set higher than those of the normal overcurrent settings.

The relay will revert to its usual settings (51-n) after elapse of the cold load period. This is determined either by a user set delay, or by the current in all 3-phases falling below a set level (usually related to normal load levels) for a user set period.

## 2.4 Instantaneous Overcurrent (50/50G/50N)

Each instantaneous element has an independent setting for pick-up current and a follower definite time lag (DTL) which can be used to provide time grading margins, sequence co-ordination grading or scheme logic. The “instantaneous” description relates to the pick-up of the element rather than its operation.

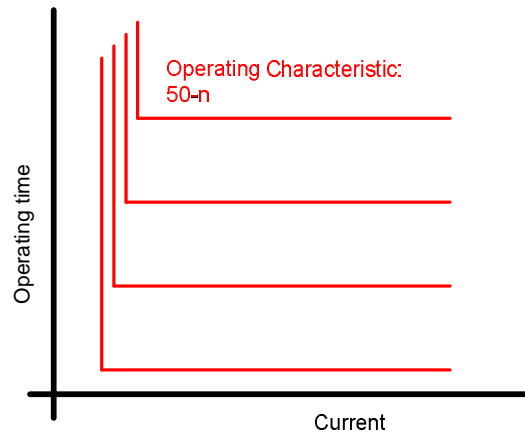


Figure 2.4-4 General Form of DTL Operate Characteristic

Instantaneous elements can be used in current graded schemes where there is a significant difference between the fault current levels at different relay point. The Instantaneous element is set to pick up at a current level above the maximum Fault Current level at the next downstream relay location, and below its own minimum fault current level. The protection is set to operate instantaneously and is often termed ‘Highset Overcurrent’. A typical application is the protection of transformer HV connections – the impedance of the transformer ensuring that the LV side has a much lower level of fault current.

The 50-n elements have a very low transient overreach i.e. their accuracy is not appreciably affected by the initial dc offset transient associated with fault inception.

### 2.4.1 Blocked Overcurrent Protection Schemes


A combination of instantaneous and DTL elements can be used in blocked overcurrent protection schemes. These protection schemes are applied to protect substation busbars or interconnectors etc. Blocked overcurrent protection provides improved fault clearance times when compared against normally graded overcurrent relays.

The blocked overcurrent scheme of busbar protection shown in Figure 2.4-2 illustrates that circuit overcurrent and earth fault protection relays can additionally be configured with busbar protection logic.

The diagram shows a substation. The relay on the incomer is to trip for busbar faults (F1) but remain inoperative for circuit faults (F2).

In this example the overcurrent and earth fault settings for the incomer 50-1 element are set to below the relevant busbar fault levels. 50-1 time delay is set longer than it would take to acknowledge receipt of a blocking signal from an outgoing circuit.

Close up faults on the outgoing circuits will have a similar fault level to busbar faults. As the incomer 50-1 elements would operate for these faults it is necessary to provide a blocking output from the circuit protections. The 50-1 elements of the output relays are given lower current settings than the incomer 50-1 settings, the time delay is set to 0ms. The output is mapped to a contact. The outgoing relay blocking contacts of all circuits are wired in parallel and this wiring is also connected to a BI on the incomer relay. The BI on the incomer relay is mapped to block its 50-1 element.

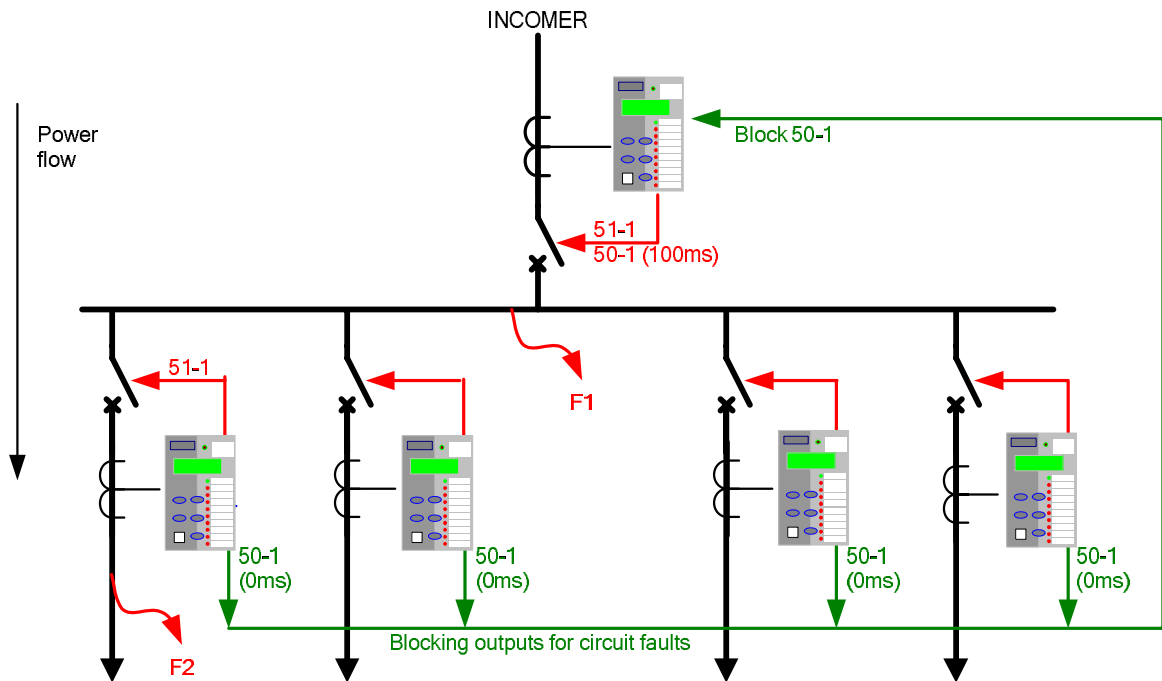

**Figure 2.4-5 Blocking Scheme Using Instantaneous Overcurrent Elements**

Typically a time delay as low as 50ms on the incomer 50-1 element will ensure that the incomer is not tripped for outgoing circuit faults. However, to include for both equipment tolerances and a safety margin a minimum time delay of 100ms is recommended.

This type of scheme is very cost effective and provides a compromise between back-up overcurrent busbar protection and dedicated schemes of busbar protection.

Instantaneous elements are also commonly applied to autoreclose schemes to grade with downstream circuit reclosers and maximise the probability of a successful auto-reclose sequence – see section 4.




## 2.5 Sensitive Earth-fault Protection (50SEF)

Earth fault protection is based on the assumption that fault current levels will be limited only by the earth fault impedance of the line and associated plant. However, it may be difficult to make an effective short circuit to earth due to the nature of the terrain e.g. dry earth, desert or mountains. The resulting earth fault current may therefore be limited to very low levels.

Sensitive earth fault (SEF) protection is used to detect such faults. The relays have a low burden, so avoiding unacceptable loading of the CTs at low current settings. Only the fundamental component is used to avoid pick up from harmonics.

SEF provides a backup to the main protection. A DTL characteristic with a time delay of several seconds is typically applied ensuring no interference with other discriminative protections. A relatively long time delay can be tolerated since fault current is low and it is impractical to grade SEF protection with other earth fault protections. Although not suitable for grading with other forms of protection SEF relays may be graded with each other.

Where very sensitive current settings are required then it is preferable to use a core balance CT rather than wire into the residual connection of the line CTs. The turns ratio of a core balance CT can be much smaller than that of phase conductors as they are not related to the rated current of the protected circuit. Since only one core is used, the CT magnetising current losses are also reduced by a factor of 3.

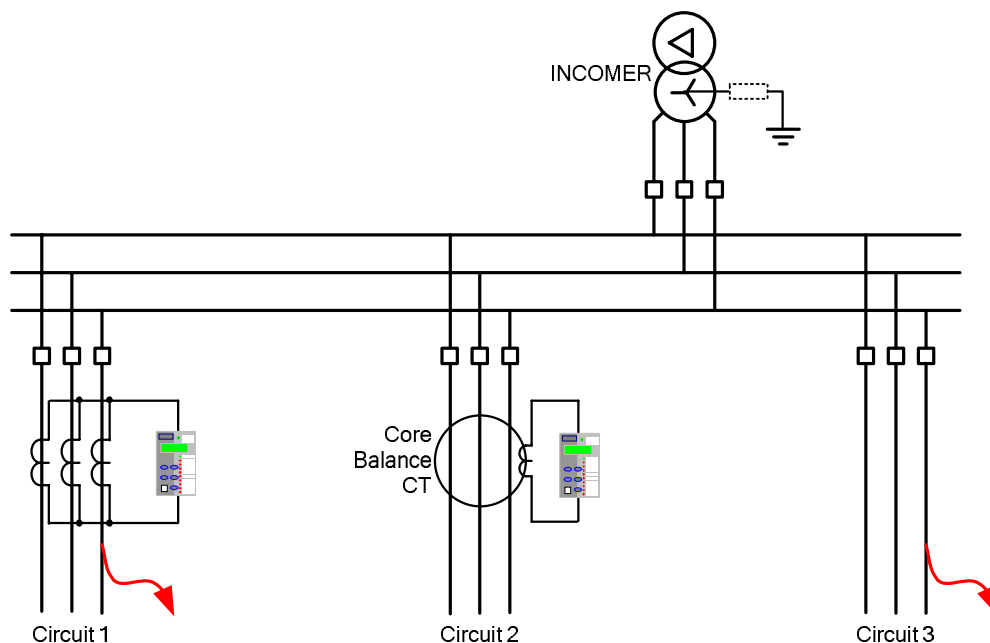

**Figure 2.5-6 Sensitive Earth Fault Protection Application**

There are limits to how sensitive an SEF relay may be set since the setting must be above any line charging current levels that can be detected by the relay. On occurrence of an out of zone earth fault e.g. on circuit 3 the elevation of sound phase voltage to earth in a non-effectively earthed system can result in a zero sequence current of up to 3 times phase charging current flowing through the relay location.

The step change from balanced 3-phase charging currents to this level of zero sequence current includes transients. It is recommended to allow for a transient factor of 2 to 3 when determining the limit of charging current. Based on the above considerations the minimum setting of a relay in a resistance earthed power system is 6 to 9 times the charging current per phase.

## 2.6 Directional Protection (67)

Each overcurrent stage can operate for faults in either forward or reverse direction. Convention dictates that forward direction refers to power flow away from the busbar, while reverse direction refers to power flowing towards the busbar.

The directional phase fault elements, 67/50 and 67/51, work with a Quadrature Connection to prevent loss of polarising quantity for close-in phase faults. That is, each of the current elements is directionalised by a voltage derived from the other two phases.

This connection introduces a 90° Phase Shift (Current leading Voltage) between reference and operate quantities which must be allowed for in the Characteristic Angle setting. This is the expected fault angle, sometimes termed the Maximum Torque Angle (MTA) as an analogy to older Electro-mechanical type relays

Example: Expected fault angle is -30° (Current lagging Voltage) so set Directional Angle to:  $+90^\circ - 30^\circ = +60^\circ$ .

A fault is determined to be in the selected direction if its phase relationship lies within a quadrant  $\pm 85^\circ$  either side of the Characteristic Angle setting.

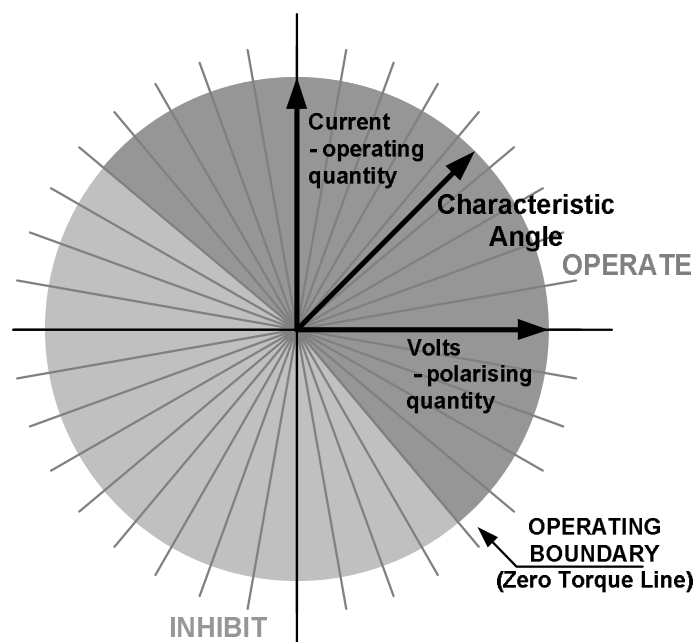


Figure 2.6-7 Directional Characteristics

A number of studies have been made to determine the optimum MTA settings e.g. W.K Sonnemann's paper "A Study of Directional Element Connections for Phase Relays". Figure 2.6-1 shows the most likely fault angle for phase faults on Overhead Line and Cable circuits.

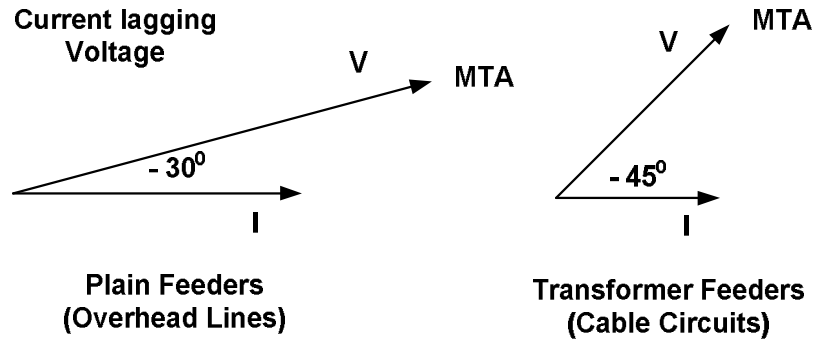


Figure 2.6-8 Phase Fault Angles

Directional overcurrent elements allow greater fault selectivity than non-directional elements for interconnected systems where fault current can flow in both directions through the relaying point. Consider the network shown in fig. 2.6-3.

The Circuit breakers at A, B, E and G have directional overcurrent relays fitted since fault current can flow in both directions at these points. The forward direction is defined as being away from the busbar and against the direction of normal load current flow. These forward looking IDMTL elements can have sensitive settings applied i.e. low current and time multiplier settings. Note that 7SR12 relays may be programmed with forward, reverse and non-directional elements simultaneously when required by the protection scheme.


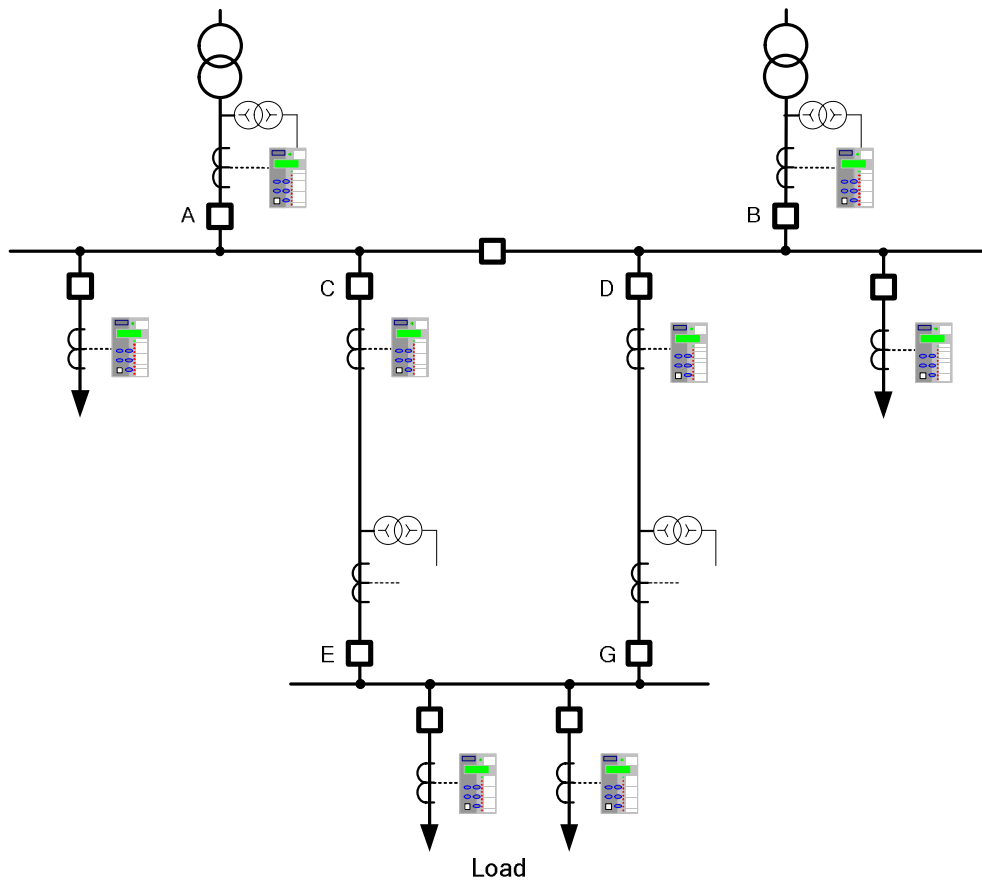


Figure 2.6-9 Application of Directional Overcurrent Protection

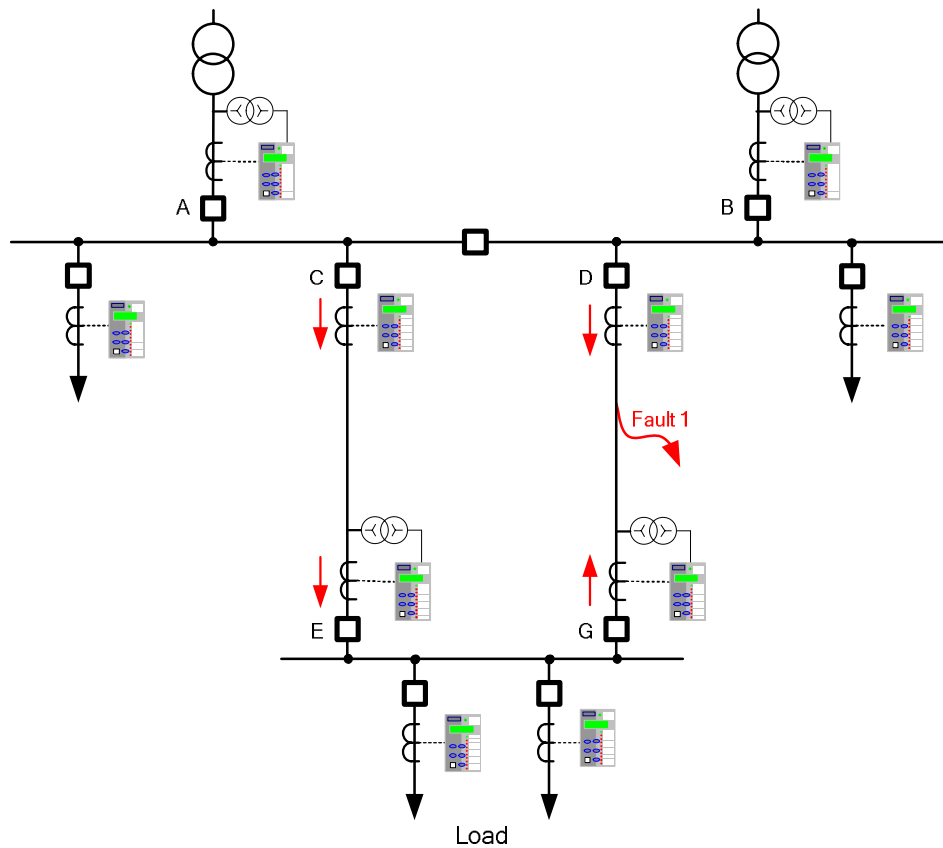

**Figure 2.6-4 Feeder Fault on Interconnected Network**

Considering the D-G feeder fault shown in fig. 2.6-4: the current magnitude through breakers C and D will be similar and their associated relays will have similar prospective operate times. To ensure that only the faulted feeder is isolated G FWD must be set to be faster than C. Relay G will thus Trip first on FWD settings, leaving D to operate to clear the fault. The un-faulted Feeder C-E maintains power to the load.

Relays on circuits C and D at the main substation need not be directional to provide the above protection scheme. However additional directional elements could be mapped to facilitate a blocked overcurrent scheme of busbar protection.

At A and B, forward looking directional elements enable sensitive settings to be applied to detect transformer faults whilst reverse elements can be used to provide back-up protection for the relays at C and D.

By using different settings for forward and reverse directions, closed ring circuits can be set to grade correctly whether fault current flows in a clockwise or counter clockwise direction i.e. it may be practical to use only one relay to provide dual directional protection.

### 2.6.1 2 Out of 3 Logic

Sensitive settings can be used with directional overcurrent relays since they are directionalised in a way which opposes the flow of normal load current i.e. on the substation incomers as shown on fig. 2.6-4. However on occurrence of transformer HV or feeder incomer phase-phase faults an unbalanced load current may still flow as an unbalanced driving voltage is present. This unbalanced load current during a fault may be significant where sensitive overcurrent settings are applied - the load current in one phase may be in the operate direction and above the relay setting.

Where this current distribution may occur then the relay is set to CURRENT PROTECTION>PHASE OVERCURRENT> **67 2-out-of-3 Logic = ENABLED**

Enabling 2-out-of-3 logic will prevent operation of the directional phase fault protection for a single phase to earth fault. Dedicated earth-fault protection should therefore be used if required.

## 2.7 Directional Earth-Fault (50/51G, 50/51N, 50/51SEF)

The directional earth-fault elements, either measured directly or derived from the three line currents the zero sequence current (operate quantity) and compare this against the derived zero phase sequence voltage (polarising quantity). Chapter 1 of the Technical Manual 'Description of Operation' details the method of measurement. The required setting is entered directly as dictated by the system impedances.

Example: Expected fault angle is  $-45^\circ$  (i.e. residual current lagging residual voltage) therefore **67G Char Angle =  $-45^\circ$**

However directional earth elements can be selectable to use either ZPS or NPS Polarising. This is to allow for the situation where ZPS voltage is not available; perhaps because a 3-limb VT is being used. Care must be taken as the Characteristic Angle will change if NPS Polarising is used.

Once again the fault angle is completely predictable, though this is a little more complicated as the method of earthing must be considered.

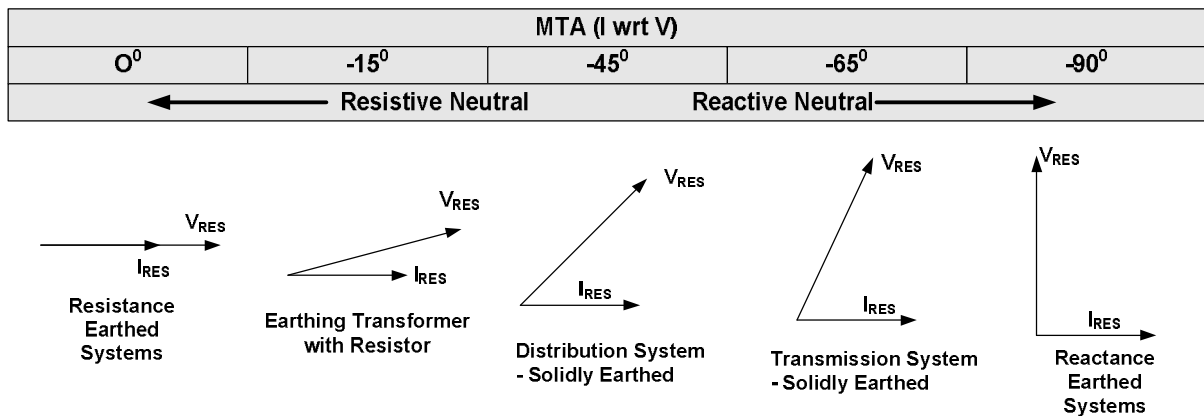


Figure 2.7-1 Earth Fault Angles

### 2.7.1 Compensated Coil Earthing Networks

In compensated networks the Resonant Coil (Petersen coil) is tuned to match the capacitive charging currents such that when an earth fault occurs, negligible fault current will flow. However, resistive losses in the primary conductors and also in the earthing coil will lead to resistive (wattmetric) components which can be measured by the 50/51SEF elements and used to indicate fault position. Core balance CTs are recommended for this application to achieve the necessary accuracy of residual current measurement.


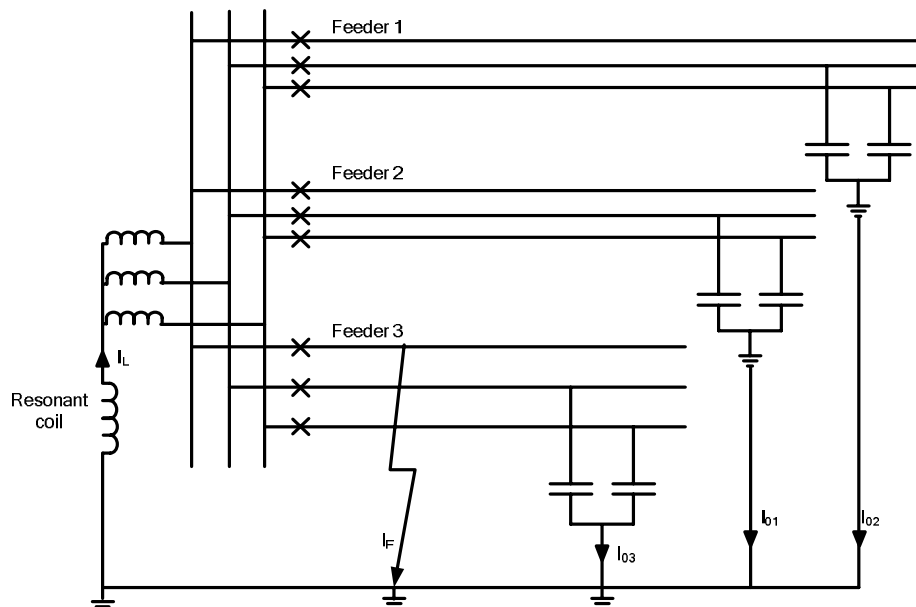



Figure 2.7-1 Earth fault current distribution in Compensated network

Three methods are commonly employed to detect the wattmetric current. The 7SR12 relay has customer settings that can be configured to provide each of these methods.

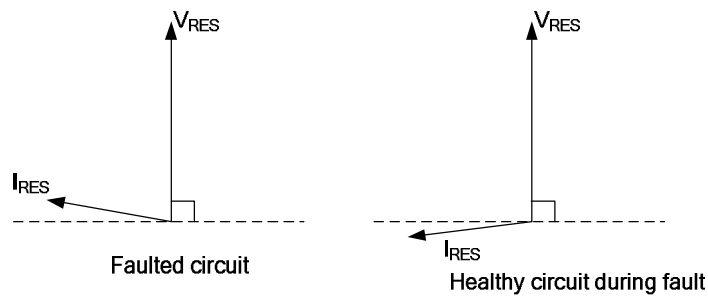


**Figure 2.7-2 Earth fault current direction in compensated network**

(i) The directional boundary can be used to discriminate between healthy and faulted feeders. The characteristic angle is set to approximately  $0^\circ$  and the boundary at  $+90^\circ$  used to detect the direction of the resistive component within the residual current. Setting of the boundary is critical to discriminate between faulted and unfaulted circuits. Setting '67SEF Compensated Network' to 'Enabled' will set the directional boundaries to  $\pm 87^\circ$  around the characteristic angle, fine adjustment of the boundary may be necessary using the characteristic angle setting.

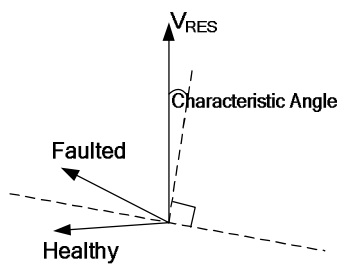

**Figure 2.7-3 Adjustment of Characteristic Angle**

(ii) The element measuring circuit can be subjected to only the cosine component of residual current i.e. to directly measure the real (wattmetric) current due to losses. The current  $I_{RES}\cos(\theta-\emptyset)$  is calculated where  $\theta$  is the measured phase angle between residual current and voltage and  $\emptyset$  is the characteristic angle. This option is selected by setting 'Ires Select' to 'Ires Real'. The characteristic angle should be set to  $0^\circ$ .

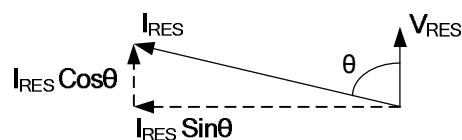

**Figure 2.7-4 Cosine component of current**

(iii) Application of a Wattmetric power characteristic. The directional 50/51 SEF element operation is subject to an additional sensitive residual power element which operates only on the real (wattmetric) component of residual power.

## 2.7.2 Isolated Networks

During earth faults on isolated distribution networks there is no fault current path to the source and subsequently no fault current will flow. However, the phase-neutral capacitive charging currents on the three phases will become unbalanced and the healthy phase currents will create an unbalance current which flows to earth. Unbalanced charging current for the whole connected network will return to the source through the fault path. This will produce a current at the relay which can be used to detect the presence of the fault. On each healthy circuit the unbalanced capacitive currents appear as a residual current which LAGS the residual voltage by  $90^\circ$ . On the faulted circuit the charging current creates no residual but the return of the charging current on the other circuits appears as a residual current which LEADS the residual voltage by  $90^\circ$ . The characteristic angle should be set to  $+90^\circ$ .

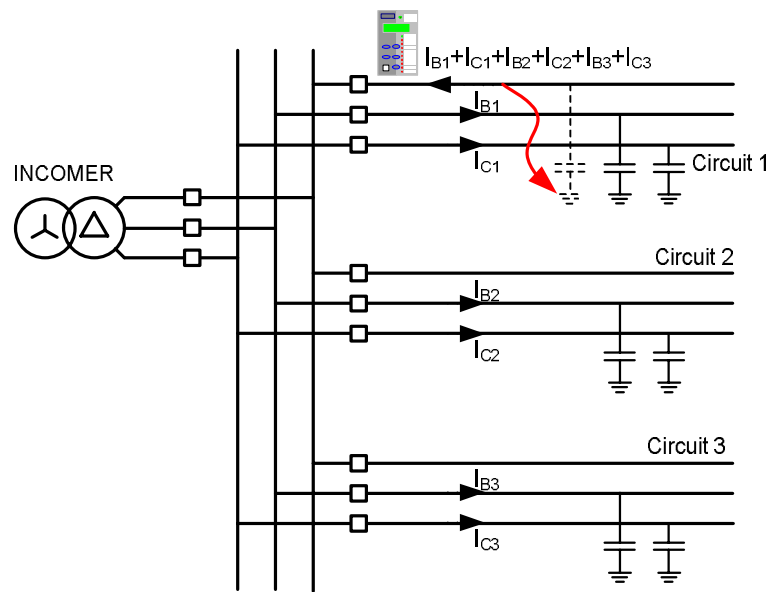


Figure 2.7-5 Earth fault current in isolated network

Some customers prefer to use only the sine (reactive) component of the residual current which can be easily achieved by setting 'Ires Select' to 'Ires Real' to select the operating current to  $I_{RES}\cos(\theta-\varnothing)$  and setting the characteristic angle  $\varnothing$  to  $+90^\circ$ .

## 2.7.3 Minimum Polarising Voltage

The correct residual voltage direction must be measured to allow a forward/reverse decision to be made. Minimum polarising voltage setting can be used to prevent tripping when fault conditions are such that significant residual voltage is not generated and the directional decision would be unreliable. The setting must allow for error in voltage measurement due to VT inaccuracy and connection. It can be used to improve stability under non-fault conditions during unbalanced load, when earth fault elements with very sensitive current settings are applied. This is ensured by selecting a setting which is near to the minimum expected residual voltage during fault conditions.

High impedance earthing methods, including compensated and isolated systems, will result in high levels of residual voltage, up to 3 times normal phase to neutral voltage, during earth faults. The minimum polarising voltage can therefore be increased to allow very low residual current settings to be applied without risk of operation during unbalanced load conditions.

## 2.8 High Impedance Restricted Earth Fault Protection (64H)

Restricted Earth Fault (REF) protection is applied to Transformers to detect low level earth faults in the transformer windings. Current transformers are located on all connections to the transformer. During normal operation or external fault conditions no current will flow in the relay element. When an internal earth fault occurs, the currents in the CTs will not balance and the resulting unbalance flows through the relay.

The current transformers may saturate when carrying high levels of fault current. The high impedance name is derived from the fact that a resistor is added to the relay leg to prevent relay operation due to CT saturation under through fault conditions.

The REF Trip output is configured to provide an instantaneous trip output from the relay to minimise damage from developing winding faults.

The application of the element to a delta-star transformer is shown in Figure 2.8-1. Although the connection on the relay winding is more correctly termed a Balanced Earth-Fault element, it is still usually referred to as Restricted Earth Fault because of the presence of the transformer.

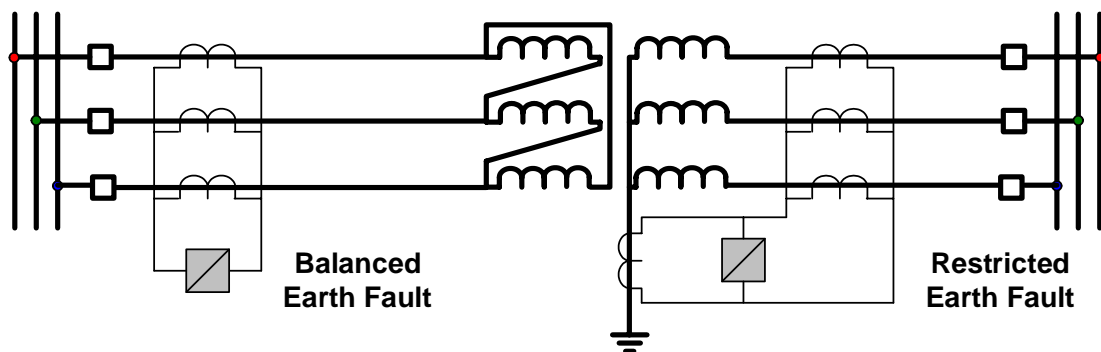


Figure 2.8-1 Balanced and Restricted Earth-fault protection of Transformers

The calculation of the value of the Stability Resistor is based on the worst case where one CT fully saturates and the other balancing CT does not saturate at all. A separate Siemens Protection Devices Limited Publication is available covering the calculation procedure for REF protection. To summarise this:

The relay Stability (operating)  $V_s$  voltage is calculated using worst case lead burden to avoid relay operation for through-fault conditions where one of the CTs may be fully saturated. The required fault setting (primary operate current) of the protection is chosen; typically, this is between 10 % and 25 % of the protected winding rated current. The relay setting current is calculated based on the secondary value of the operate current, note, however, that the summated CT magnetising current @  $V_s$  must be subtracted to obtain the required relay operate current setting.


Since the relay operate current setting and stability/operating voltage are now known, a value for the series resistance can now be calculated.

A check is made as to whether a Non-Linear Resistor is required to limit scheme voltage during internal fault conditions – typically where the calculated voltage is in excess of 2kV.

The required thermal ratings for external circuit components are calculated.



Composite overcurrent and REF protection can be provided using a multi-element relay as shown below.

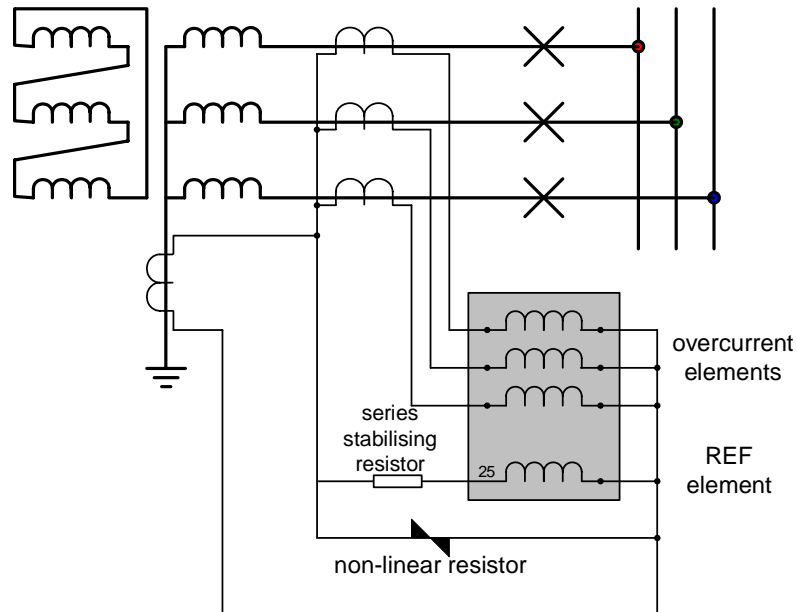

**Figure 2.8-2 Composite Overcurrent and Restricted Earth-fault Protection**

Although core-balance CTs are traditionally used with elements requiring sensitive pickup settings, cost and size usually precludes this on REF schemes. Instead single-Phase CTs are used and their secondary's connected in parallel.

Where sensitive settings are required, the setting must be above any line charging current levels that can be detected by the relay.

On occurrence of an out of zone earth fault the elevation of sound phase voltage to earth in a non-effectively earthed system can result in a zero sequence current of up to 3 times phase charging current flowing through the relay location.

The step change from balanced 3-phase charging currents to this level of zero sequence current includes transients. It is recommended to allow for a transient factor of 2 to 3 when determining the limit of charging current. Based on the above considerations the minimum setting of a relay in a resistance earthed power system is 6 to 9 times the charging current per phase.

High impedance differential protection is suitable for application to auto transformers as line currents are in phase and the secondary current through the relay is balanced to zero by the use of CTs ratios at all three terminals. High impedance protection of this type is very sensitive and fast operating for internal faults.

## 2.9 Negative Phase Sequence Overcurrent (46NPS)

The presence of Negative Phase Sequence (NPS) current indicates an unbalance in the phase currents, either due to a fault or unbalanced load.

NPS current presents a major problem for 3-phase rotating plant. It produces a reaction magnetic field which rotates in the opposite direction, and at twice the frequency, to the main field created by the DC excitation system. This induces double-frequency currents into the rotor which cause very large eddy currents in the rotor body. The resulting heating of the rotor can be severe and is proportional to  $(I_2)^2 t$ .

Generators and Motors are designed, manufactured and tested to be capable of withstanding unbalanced current for specified limits. Their withstand is specified in two parts; continuous capability based on a figure of  $I_2$ , and short time capability based on a constant, K, where  $K = (I_2)^2 t$ . NPS overcurrent protection is therefore configured to match these two plant characteristics.

## 2.10 Undercurrent (37)

Undercurrent elements are used in control logic schemes such as Auto-Changeover Schemes, Auto-Switching Interlock and Loss of Load. They are used to indicate that current has ceased to flow or that a low load situation exists. For this reason simple Definite Time Lag (DTL) elements may be used.

For example, once it has been determined that fault current has been broken – the CB is open and no current flows – an auto-isolation sequence may safely be initiated.

## 2.11 Thermal Overload (49)

The element uses measured 3-phase current to estimate the real-time Thermal State,  $\theta$ , of cables or transformers. The Thermal State is based on both past and present current levels.

$\theta = 0\%$  for unheated equipment, and  $\theta = 100\%$  for maximum thermal withstand of equipment or the Trip threshold.

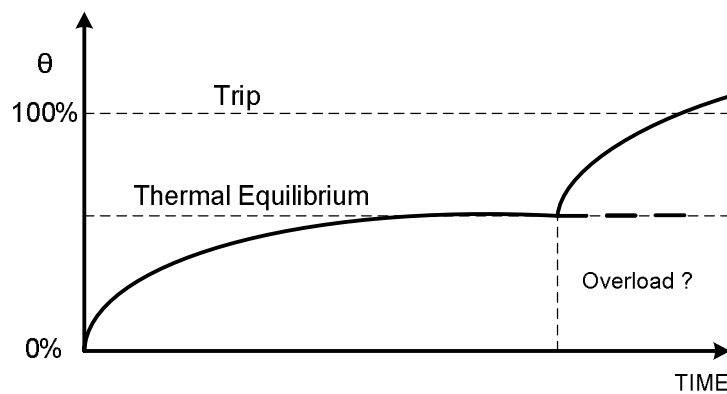


Figure 2.11-3 Thermal Overload Heating and Cooling Characteristic

For given current level, the Thermal State will ramp up over time until Thermal Equilibrium is reached when Heating Effects of Current = Thermal Losses.

The heating / cooling curve is primarily dependant upon the Thermal Time Constant. This must be matched against that quoted for the item of plant being protected. Similarly the current tripping threshold,  $I_q$ , is related to the thermal withstand of the plant.

Thermal Overload is a slow acting protection, detecting faults or system conditions too small to pick-up fast acting protections such as Phase Overcurrent. An Alarm is provided for  $\theta$  at or above a set % of capacity to indicate that a potential trip condition exists and that the system should be scrutinised for abnormalities.

## 2.12 Under/Over Voltage Protection (27/59)

Power system under-voltages on may occur due to:

- System faults.
- An increase in system loading,
- Non-energized power system e.g. loss of an incoming transformer

During normal system operating conditions regulating equipment such as transformer On Load Tap Changers (OLTC) and generator Automatic Voltage Regulators (AVR) ensure that the system runs within acceptable voltage limits.

Undervoltage/DTL elements can be used to detect abnormal undervoltage conditions due to system overloads. Binary outputs can be used to trip non-essential loads - returning the system back to its normal operating levels. This 'load shedding' should be initiated via time delay elements so avoiding operation during transient disturbances. An undervoltage scheme (or a combined under frequency/under voltage scheme) can provide faster tripping of non-essential loads than under-frequency load shedding so minimising the possibility of system instability.

Where a transformer is supplying 3-phase motors a significant voltage drop e.g. to below 80% may cause the motors to stall. An undervoltage element can be set to trip motor circuits when the voltage falls below a preset value so that on restoration of supply an overload is not caused by the simultaneous starting of all the motors. A time delay is required to ensure voltage dips due to remote system faults do not result in an unnecessary disconnection of motors.

To confirm presence/loss of supply, the voltage elements should be set to values safely above/below that where a normal system voltage excursion can be expected. The switchgear/plant design should be considered. The 'Dead' level may be very near to the 'live' level or may be significantly below it. The variable hysteresis setting allows the relay to be used with all types of switchgear.

System over-voltages can damage component insulation. Excessive voltage may occur for:

- Sudden loss of load
- A tap changer run-away condition occurs in the high voltage direction,
- Generator AVR equipment malfunctions or
- Reactive compensation control malfunctions.

System regulating equipment such as transformer tap changers and generator AVRs may correct the overvoltage – unless this equipment mal-functions. The overvoltage/DTL elements can be used to protect against damage caused by system overvoltages.

If the overvoltage condition is small a relatively long DTL time delay can be used. If the overvoltage is more severe then another element, set at a higher pickup level and with a shorter DTL can be used to isolate the circuit more quickly. Alternatively, elements can be set to provide alarm and tripping stages, with the alarm levels set lower than the tripping stages.

The use of DTL settings allows a grading system to be applied to co-ordinate the network design, the regulating plant design, system plant insulation withstand and with other overvoltage relays elsewhere on the system. The DTL also prevents operation during transient disturbances.

The use of IDMTL protection is not recommended because of the difficulty of choosing settings to ensure correct co-ordination and security of supply.

## 2.13 Neutral Overvoltage (59N)

Neutral Voltage Displacement (NVD) protection is used to detect an earth fault where little or no earth current flows.

This can occur where a feeder has been tripped at its HV side for an earth fault, but the circuit is still energised from the LV side via an unearthed transformer winding. Insufficient earth current would be present to cause a trip, but residual voltage would increase significantly; reaching up to 3-times the normal phase-earth voltage level.

If Neutral Overvoltage protection is used, it must be suitably time graded with other protections in order to prevent unwanted tripping for external system earth faults.

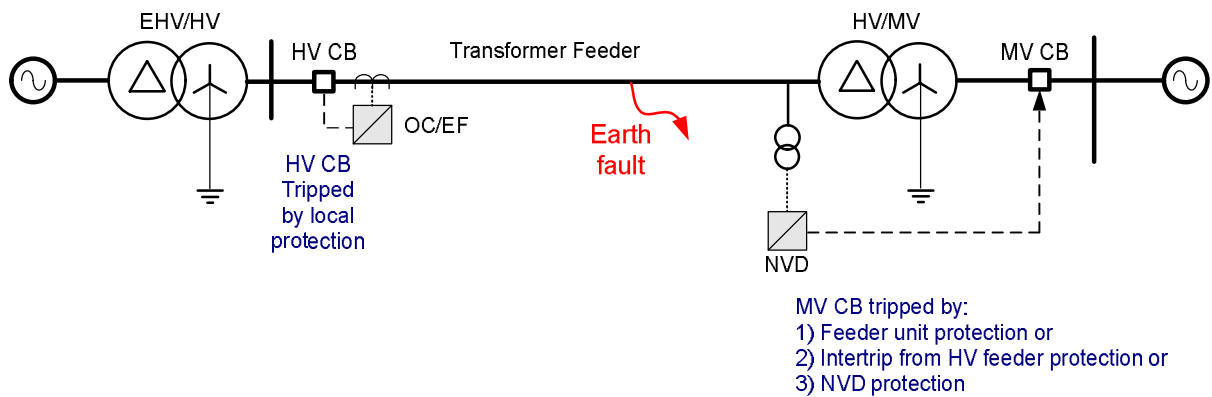


Figure 2.13-4 NVD Application

Typically NVD protection measures the residual voltage ( $3V_0$ ) directly from an open delta VT or from capacitor cones – see fig. 2.13-2 below.

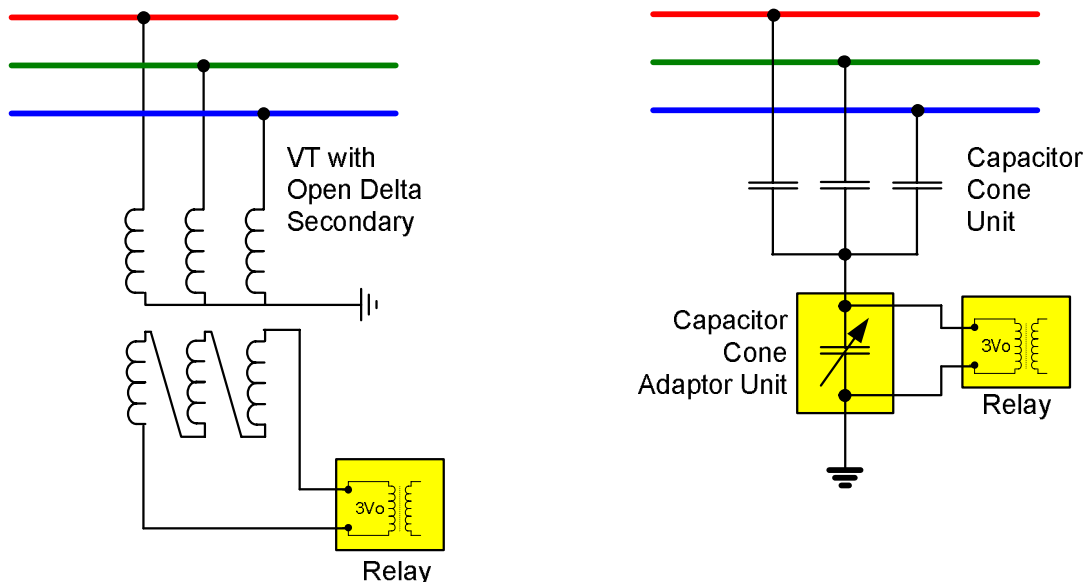


Figure 2.13-5 NVD Protection Connections

### 2.13.1 Application with Capacitor Cone Units

Capacitor cones provide a cost effective method of deriving residual voltage. The wide range of capacitor cone component values used by different manufacturers means that the relay cannot be connected directly to the cones.

The external adaptor unit contains parallel switched capacitors that enable a wide range of values to be selected using a DIL switch and hence the Capacitor Cone output can be scaled to the standard relay input range.

### 2.13.2 Derived NVD Voltage

Alternatively NVD voltage can be derived from the three phase to neutral voltages, this setting is available within the relay. Note with this method the NVD protection may mal-operate during a VT Fail condition.

## 2.14 Negative Phase Sequence Overvoltage (47)

Negative Phase Sequence (NPS) protection detects phase unbalances and is widely used in protecting rotating plant such as motors and generators. However such protection is almost universally based on detecting NPS Current rather than Voltage. This is because the NPS impedance of motors etc. is much less than the Positive Phase Sequence (PPS) impedance and therefore the ratio of NPS to PPS Current is much higher than the equivalent ratio of NPS to PPS Voltage.

NPS Voltage is instead used for monitoring busbar supply quality rather than detecting system faults. The presence of NPS Voltage is due to unbalanced load on a system. Any system voltage abnormality is important since it will affect every motor connected to the source of supply and can result in mass failures in an industrial plant.

The two NPS Voltage DTL elements should therefore be used as Alarms to indicate that the level of NPS has reached abnormal levels. Remedial action can then be taken, such as introducing a Balancer network of capacitors and inductors. Very high levels of NPS Voltage indicate incorrect phase sequence due to an incorrect connection.

## 2.15 Under/Over Frequency (81)

During normal system operation the frequency will continuously vary over a relatively small range due to the changing generation/load balance. Excessive frequency variation may occur for:

Loss of generating capacity, or loss of mains supply (underfrequency): If the governors and other regulating equipment cannot respond to correct the balance, a sustained underfrequency condition may lead to a system collapse.


Loss of load – excess generation (overfrequency): The generator speeds will increase causing a proportional frequency rise. This may be unacceptable to industrial loads, for example, where the running speeds of synchronous motors will be affected.

In the situation where the system frequency is falling rapidly it is common practise to disconnect non-essential loads until the generation-load balance can be restored. Usually, automatic load shedding, based on underfrequency is implemented. Underfrequency relays are usually installed on the transformer incomers of distribution or industrial substations as this provides a convenient position from which to monitor the busbar frequency. Loads are disconnected from the busbar (shed) in stages until the frequency stabilises and returns to an acceptable level.

The relay has four under/over frequency elements.

An example scheme may have the first load shedding stage set just below the nominal frequency, e.g. between 49.0 - 49.5Hz. A time delay element would be associated with this to allow for transient dips in frequency and to provide a time for the system regulating equipment to respond. If the first load shedding stage disconnects sufficient plant the frequency will stabilise and perhaps return to nominal. If, however, this is not sufficient then a second load shedding stage, set at a lower frequency, will shed further loads until the overload is relieved. This process will continue until all stages have operated. In the event of the load shedding being unsuccessful, a final stage of underfrequency protection should be provided to totally isolate all loads before plant is damaged, e.g. due to overfluxing.

An alternative type of load shedding scheme would be to set all underfrequency stages to about the same frequency setting but to have different length time delays set on each stage. If after the first stage is shed the frequency doesn't recover then subsequent stages will shed after longer time delays have elapsed.

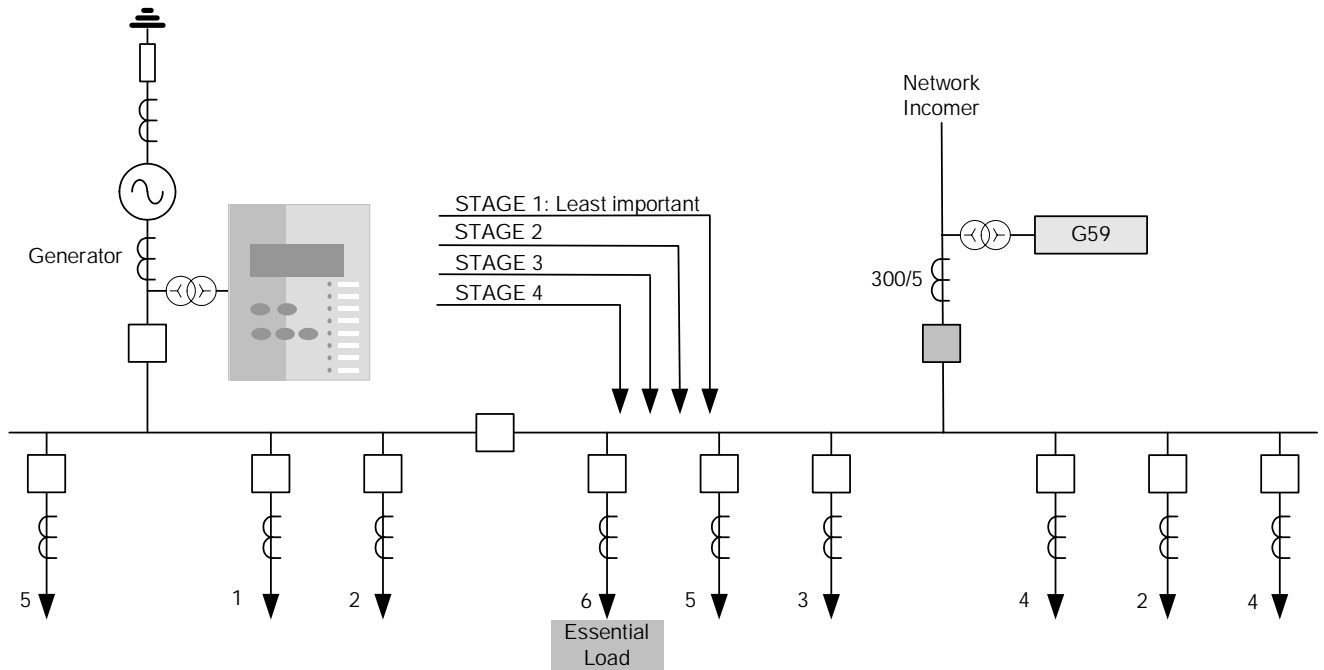

**Figure 2.15-1 Load Shedding Scheme Using Under-Frequency Elements**

## Section 3: CT Requirements

### 3.1 CT Requirements for Overcurrent and Earth Fault Protection

#### 3.1.1 Overcurrent Protection CTs

- a) For industrial systems with relatively low fault current and no onerous grading requirements - a class 10P10 with VA rating to match the load.
- b) For utility distribution networks with relatively high fault current and several grading stages - a class 5P20, with VA rating to match the load.

Note: if an accuracy limit factor is chosen which is much lower than the maximum fault current it will be necessary to consider any effect on the protection system performance and accuracy e.g. grading margins.

For idmtl applications, because the operating time at high fault current is a definite minimum value, partial saturation of the CT at values beyond the overcurrent factor has only a minimal effect. However, this must be taken into account in establishing the appropriate setting to ensure proper grading.

- c) For dtl applications utilities as for (b) above - a class 5P10 (or 20), with rated burden to suit the load.

Note: Overcurrent factors do not need to be high for definite time protection because once the setting is exceeded magnitude accuracy is not important. Often, however, there is also the need to consider instantaneous HighSet overcurrent protection as part of the same protection system and the settings would normally be of the order of 10x the CT rating or higher. Where higher settings are to be used then the overcurrent factor must be raised accordingly, e.g. to P20.

#### 3.1.2 Earth Fault Protection CTs

Considerations and requirements for earth fault protection are the same as for Phase fault. Usually the relay employs the same CT's e.g. three phase CTs star connected to derive the residual earth fault current.

The accuracy class and overcurrent accuracy limit factors are therefore already determined and for both these factors the earth fault protection requirements are normally less onerous than for overcurrent.

### 3.2 CT Requirements for High Impedance Restricted Earth Fault Protection

For high impedance REF it is recommended that:

Low reactance CTs to IEC Class PX are used, this allows a sensitive current setting to be applied.

All CT's should, if possible have identical turns ratios.

The knee point voltage of the CTs must be greater than  $2 \times 64H$  setting voltage  $V_s$ .

Where the REF function is used then this dictates that the other protection functions are also used with class PX CTs.

A full explanation of how to specify CTs for use with REF protection, and set REF relays is available on our website: [www.siemens.com/energy](http://www.siemens.com/energy).

## Section 4: Control Functions

### 4.1 Auto-reclose Applications

- Automatic circuit reclosing is extensively applied to overhead line circuits where a high percentage of faults that occur are of a transient nature. By automatically reclosing the circuit-breaker the feature attempts to minimise the loss of supply to the customer and reduce the need for manual intervention.

The function supports up to 4 ARC sequences. That is, 4 x Trip / Recloses followed by a Trip & Lockout. A lockout condition prevents any further automatic attempts to close the circuit-breaker. The number of sequences selected depends upon the type of faults expected. If there are a sufficient percentage of semi-permanent faults which could be burnt away, e.g. fallen branches, a multi shot scheme would be appropriate. Alternatively, if there is a high likelihood of permanent faults, a single shot scheme would minimise the chances of causing damage by reclosing onto a fault. In general, 80% of faults will be cleared by a single Trip and Reclose sequence. A further 10% will be cleared by a second Trip and Reclose. Different sequences can be selected for different fault types (Phase/Earth/Sensitive Earth faults).

The Deadtime is the interval between the trip and the CB close pulse being issued. This is to allow for the line to go 'dead' after the fault is cleared. The delay chosen is a compromise between the need to return the line to service as soon as possible and prevented unnecessary trips through re-closing too soon. The Reclaim Time is the delay following a re-closure before the line can be considered back in service. This should be set long enough to allow for protection operation for the same fault, but not so long that two separate faults could occur in the same Autoreclose (ARC) sequence and cause unnecessary lockouts.

The Sequence Fail Timer provides an overall maximum time limit on the ARC operation. It should therefore be longer than all the set delays in a complete cycle of ARC sequences; trip delays, Deadtimes, Reclaim Time etc. Generally this will only be exceeded if the circuit-breaker has either failed to open or close.

Since large fault currents could potentially damage the system during a prolonged ARC sequence, there are also settings to identify which protection elements are High-sets and these can cause an early termination of the sequence.

Where a relay is to operate as part of an ARC scheme involving a number of other relays, the feature attempts to clear any faults quickly without regard to normal fault current grading. It does this by setting each Trip element to be either Delayed or Instantaneous. Instantaneous Trips are set to operate at just above maximum load current with small delays while Delayed Trips are set to suit actual fault levels and with delays suitable for current grading.

A typical sequence would be 2 Instantaneous Trips followed by a Delayed Trip & Lockout:

- When any fault occurs, the relay will trip instantaneously and then reclose.
- If this does not clear the fault, the relay will do the same again.
- If this still does not clear the fault, the fault is presumed to be permanent and the next Trip will be Delayed and so suitable for grading with the rest of the network. Thus allowing downstream protection time to operate.
- The next trip will Lockout the ARC sequence and prevent further recloses.

It is important that all the relays in an ARC scheme shadow this process – advancing through their own ARC sequences when a fault is detected by an element pickup even though they are not actually causing a trip or reclose. This is termed Sequence Co-ordination and prevents an excessive number of recloses as each successive relay attempts to clear the fault in isolation. For this reason each relay in an ARC scheme must be set with identical Instantaneous and Delayed sequence of trips.

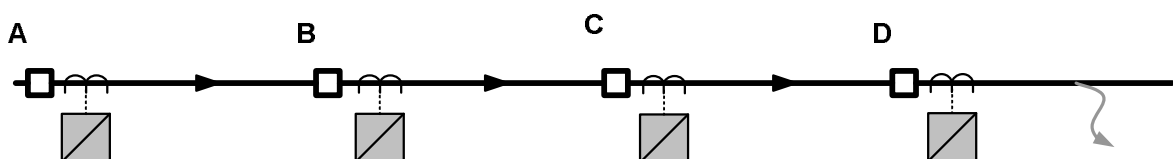


Figure 4.1-1 Sequence Co-ordination



The relay closest to the fault (D) would step through its Instantaneous Trips in an attempt to clear the fault. If unsuccessful, the relay would move to a Delayed Trip sequence.

The other relays in the network (A, B and C) would recognise the sequence of Pick-up followed by current switch-off as ARC sequences. They would therefore also step to their Delayed Trip to retain co-ordination with the respective downstream devices.

The next Trip would be subject to current grading and Lockout the ARC sequence such that the fault is cleared by the correct CB.

#### 4.1.1 Auto-Reclose Example 1

Requirement: Settings shall provide four phase fault recloses – two instantaneous and two delayed - and only two delayed recloses for faults detected by the SEF protection.

Proposed settings include:

CONTROL & LOGIC > AUTORECLOSE PROT'N:

**79 P/F Inst Trips: 50-1**

**79 P/F Delayed Trips: 51-1**

**79 SEF Delayed Trips: 51SEF-1**

CONTROL & LOGIC > AUTORECLOSE CONFIG

**79 Num Shots: 4**

CONTROL & LOGIC > AUTORECLOSE CONFIG > P/F SHOTS

**79 P/F Prot'n Trip 1 : Inst**

**79 P/F Prot'n Trip 2 : Inst**

**79 P/F Prot'n Trip 3 : Delayed**

**79 P/F Prot'n Trip 4 : Delayed**

**79 P/F Delayed Trips to Lockout : 3**

CONTROL & LOGIC > AUTORECLOSE CONFIG > SEF SHOTS

**79 SEF Prot'n Trip 1 : Delayed**

**79 SEF Prot'n Trip 2 : Delayed**

**79 SEF Delayed Trips to Lockout : 3**

*Note that Instantaneous' trips are inhibited if the shot is defined as 'Delayed'*

## 4.1.2 Auto-Reclose Example 2 (Use of Quicklogic with AR)

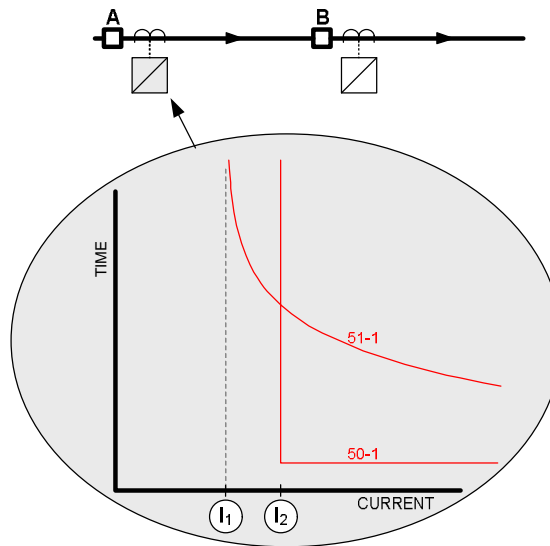


Figure 4.1-2 Example of Logic Application

Requirement: The relay at location 'A' is required to provide a reclose sequence of 2 Instantaneous followed by 2 delayed recloses. Where the fault current level is between the values 'I1' and 'I2' and the first trip is initiated from the 51-1 (IDMT) element, the IDMT characteristic should trip the CB and lockout the auto-reclose.

Typical settings are:

CONTROL & LOGIC > AUTORECLOSE PROT'N:

**79 P/F Inst Trips: 50-1**

**79 P/F Delayed Trips: 51-1**

CONTROL & LOGIC > AUTORECLOSE CONFIG > P/F SHOTS

**79 P/F Prot'n Trip 1 : Inst**

**79 P/F Prot'n Trip 2 : Inst**

**79 P/F Prot'n Trip 3 : Delayed**

**79 P/F Prot'n Trip 4 : Delayed**

The above settings are suitable at values of fault current above 'I2' however were a fault to occur with a current value between 'I1' and 'I2' this would be detected by the 51-1 element only. As **Prot'n Trip 1 = Inst** then the relay would trip and reclose whereas it is required to lockout for this occurrence.

To provide a lockout for the above faults an additional element 50-2 with identical settings to 50-1 is assigned as a Delayed Trip and is used in conjunction with the Quick Logic feature i.e.

OUTPUT CONFIG>OUTPUT MATRIX: **51-1 = V1**

OUTPUT CONFIG>OUTPUT MATRIX: **50-2 = V2**


OUTPUT CONFIG>OUTPUT MATRIX: **E1 = V3**

CONTROL & LOGIC>QUICK LOGIC: **E1 = V1.IV2**

INPUT CONFIG>INPUT MATRIX: **79 Lockout = V3**

## 4.2 Quick Logic Applications

### 4.2.1 Auto-Changeover Scheme Example

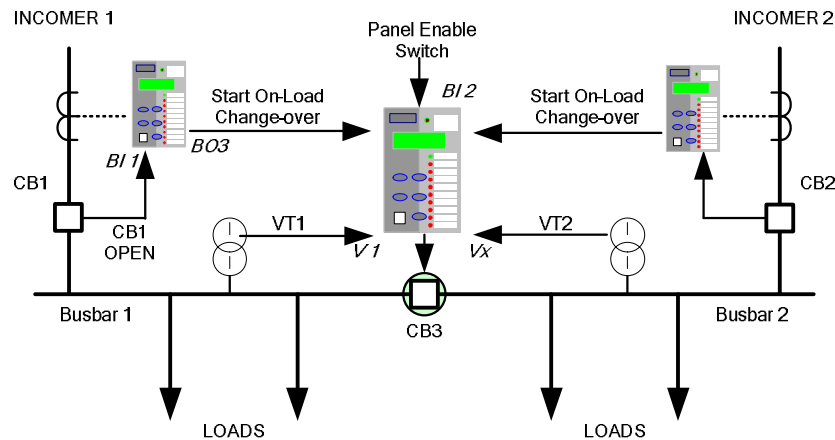

**Figure 4.2-3 Example Use of Quick Logic**

The MV installation illustrated above is fed from two incomers. To limit the substation fault level the busbar is run with CB3 open. When a fault occurs on one of the incomers it is isolated by the circuit protection. To re-supply the disconnected loads from the remaining incomer CB3 is closed.

If the line fault occurs on incomer 1 it must be confirmed that CB 1 has opened before CB3 can be closed. The relay on incomer 1 confirms that a trip has been issued to CB1 (e.g. Binary Output 2), that CB 1 has opened (e.g. Binary Input 1) and that no current flows in the circuit (e.g. 37-1 = Virtual 1):

Incomer 1 Relay is Configured:

CB1 Open auxiliary switch wired to BI 1

Trip output to CB1 = BO 2

OUTPUT CONFIG>OUTPUT MATRIX: **37-1 = V1**

OUTPUT CONFIG>OUTPUT MATRIX: **E1 = BO3**

CONTROL & LOGIC>QUICK LOGIC: **E1 = O2.I1.V1**

The output from Incomer 1 (Binary Output 3) relay is input to the relay on CB 3 (Binary Input 1). A panel switch may be used to enable the On-Load Change-over scheme (Binary Input 2). Before Closing CB3 a check may be made that there is no voltage on busbar 1 (27/59-1 = Virtual 1). CB 3 is closed from Binary Output 3.

CB3 Relay is Configured:

Panel switch (ON-Load Change-over Enabled) wired to BI2

OUTPUT CONFIG>OUTPUT MATRIX: **27/59-1 = V1**

OUTPUT CONFIG>OUTPUT MATRIX: **E1 = BO3**

CONTROL & LOGIC>QUICK LOGIC: **E1 = I1.I2.V1**

If required a time delay can be added to the output using the CONTROL & LOGIC > QUICK LOGIC: **E1 Pickup Delay** setting.

## Section 5: Supervision Functions

### 5.1 Circuit-Breaker Fail (50BF)

Where a circuit breaker fails to operate to clear fault current the power system will remain in a hazardous state until the fault is cleared by remote or back-up protections. To minimise any delay, CB Failure protection provides a signal to either re-trip the local CB or back-trip 'adjacent' CBs.

The function is initiated by the operation of user selectable protection functions or from a binary input. Current flow is monitored after a tripping signal has been issued if any of the 50BF current check elements have not reset before the timers have expired an output is given. For CB trips where the fault is not current related an additional input is provided (50BF Mech Trip) which monitors the CB closed input and provides an output if the circuit breaker has not opened before the timers expire.

The relay incorporates a two-stage circuit breaker fail feature. For some systems, only the first will be used and the CB Failure output will be used to back-trip the adjacent CB(s). On other systems, however, this output will be used to re-trip the local CB to minimise potential disruption to the system; if possible via a secondary trip coil and wiring. The second CB Failure stage will then be used to back-trip the adjacent CB(s).

If the CB is faulty and unable to open, a faulty contact can be wired to the CB faulty input of the relay and if a trip occurs while this input is raised the CB fail delay timers may be by-passed to allow back tripping to occur without delay.

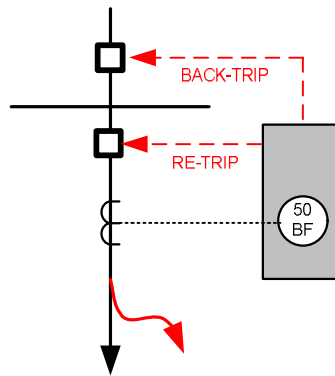


Figure 5.1-1 Circuit Breaker Fail

#### 5.1.1 Settings Guidelines

##### 50BF Setting

The phase current setting must be set below the minimum protection setting current.

##### 50BF Setting-I4

The EF or SEF current setting must be set below the minimum protection setting current.

##### 50BF Ext Trig

Any binary input can be mapped to this input to trigger the circuit breaker fail function. Note current must be above setting for the function to operate.

##### 50BF Mech Trip

Any binary input can be mapped to this input to trigger the circuit breaker fail function. Note for the function to operate the circuit breaker closed input is used to detect a failure, not the current.

##### 50BF CB Faulty

Any binary input can be mapped to this input, if it is energised when a trip initiation is received an output will be given immediately (the timers are by-passed).

**50BF DTL1/50BF DTL2**

The time delays run concurrently within the relay. The time delay applied to the CB Fail protection must be in excess of the longest CB operate time + relay reset time + a safety margin.

**First Stage (Retrip)**


Trip Relay operate time	10ms
Reset Time	20ms
CB Tripping time	50ms
Safety Margin	40ms
<b>Overall First Stage CBF Time Delay</b>	<b>120ms</b>

**Second Stage (Back Trip)**


First CBF Time Delay	120ms
Trip Relay operate time	10ms
CB Tripping time	50ms
Reset Time of measuring element	20ms
Margin	60ms
<b>Overall Second Stage CBF Time Delay</b>	<b>260ms</b>

The safety margin is extended by 1 cycle for the second CBF stage as this will usually involve a back-trip of a Busbar tripping scheme.

The timing sequence for each stage of the circuit breaker fail function is as below.

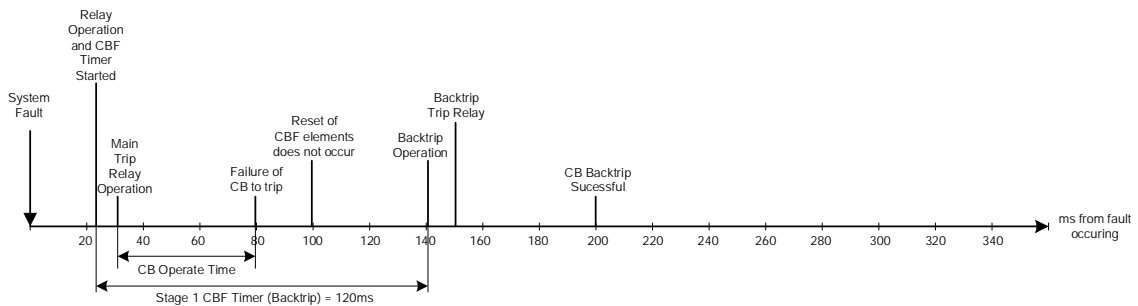

**Figure 5.1-2 Single Stage Circuit Breaker Fail Timing**

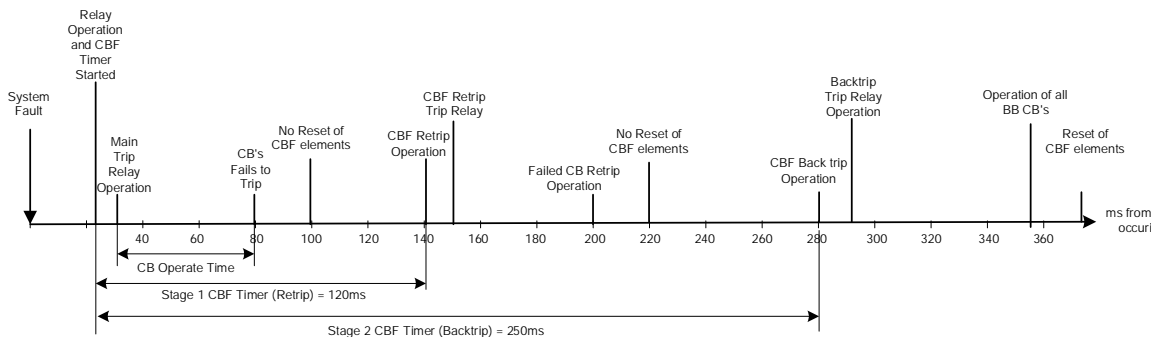

**Figure 5.1-3 Two Stage Circuit Breaker Fail Timing**

## 5.2 Current Transformer Supervision

When a CT fails, the current levels seen by the protection become unbalanced, however this condition would also occur during a system fault. Depending upon the relay model different methods are used to determine the condition, depending upon the measured quantities available.

### Current Transformer Supervision (60CTS – 7SR11)

Following a CT Failure, if one or two of the three phases falls below the CT supervision setting the element will operate

Operation is subject to a time delay to prevent operation for transitory effects.

A 3-phase CT failure is considered so unlikely (these being independent units) that this condition is not tested for.

### Current Transformer Supervision (60CTS – 7SR12)

When a CT fails, the current levels seen by the protection become unbalanced. A large level of NPS current is therefore detected - around  $0.3 \times I_n$  for one or two CT failures. However this condition would also occur for a system fault. To differentiate between the two conditions, the element uses NPS voltage to restrain the CTS algorithm as shown in the accompanying table.

NPS Current	NPS Voltage	Decision
> Setting	> Setting	System Fault
> Setting	< Setting	CT Failure

Table 5-1 Determination of VT Failure (1 or 2 Phases)

Following a CT Failure, there should be little or no NPS voltage. Perhaps  $0.1 \times V_n$  as a maximum.

Operation is subject to a time delay to prevent operation for transitory effects.

A 3-phase CT failure is considered so unlikely (these being independent units) that this condition is not tested for.

### 5.3 Voltage Transformer Supervision (60VTS)

Although VTs rarely fail themselves, VT Supervision presents a common application because of the failure of protective Fuses connected in series with the VTs.

When a VT failure occurs on one or two phases, the voltage levels seen by the protection become unbalanced. A large level of NPS voltage is therefore detected - around  $0.3 \times V_n$  for one or two VT failures. However this condition would also occur for a system fault. To differentiate between the two conditions, the element uses NPS current to restrain the VTS algorithm as show in the accompanying table.

NPS Voltage	NPS Current	Decision
> Setting	> Setting	System Fault
> Setting	< Setting	VT Failure

Table 5-2 Determination of VT Failure (1 or 2 Phases)

Following a VT Failure, the level of NPS current would be dependent solely upon load imbalance - perhaps  $0.1 \times I_n$  as a maximum.

Operation is subject to a time delay to prevent operation for transitory effects.

NPS voltage and current quantities are used rather than ZPS since the latter makes it difficult to differentiate between a VT failure and a Phase-Phase fault. Both conditions would generate little or no ZPS current. However the element provides an option to use ZPS quantities to meet some older specifications.

There are possible problems with using NPS quantities due to load imbalances. These would also generate significant levels of NPS current and so possibly cause a VT failure to be missed. This problem can be overcome by careful selection of settings, however, setting the NPS current threshold above the level expected for imbalance conditions.

If a failure occurs in all 3 Phases of a Voltage Transformer, then there will be no NPS or ZPS voltage to work with. However the PPS Voltage will fall below expected minimum measurement levels.

This could also be due to a 'close in' fault and so PPS Current must remain above minimum load level BUT below minimum fault level.

PPS Voltage	PPS Current	Decision
< Setting	> Minimum Fault Level	System Fault
< Setting	Minimum Load Level < AND < Minimum Fault Level	VT Failure

Table 5-3 Determination of VT Failure (3 Phases)

Operation is again subject to a time delay to prevent operation for transitory effects.

Alternatively a 3 Phase VT failure can be signalled to the relay via a Binary Input taken from the Trip output of an external MCB. This can also be reset by a Binary Input signal.

VTS would not normally be used for tripping - it is an alarm rather than fault condition. However the loss of a VT would cause problems for protection elements that have voltage dependant functionality. For this reason, the relay allows these protection elements - under-voltage, directional over-current, etc. - to be inhibited if a VT failure occurs.

## 5.4 Trip/Close Circuit Supervision (74T/CCS)

The relay provides three trips and three close circuit supervision elements, all elements are identical in operation and independent from each other allowing 3 trip and 3 close circuits to be monitored.

One or more binary inputs can be mapped to **74TCS-n**. The inputs are connected into the trip circuit such that at least one input is energised when the trip circuit wiring is intact. If all the mapped inputs become de-energised, due to a break in the trip circuit wiring or loss of supply an output is given.

The **74TCS-n Delay** setting prevents the failure being incorrectly indicated during circuit breaker operation. This delay should be greater than the operating time of the circuit breaker.

The use of one or two binary inputs mapped to the same Trip Circuit Supervision element (e.g. 74TCS-n) allows the user to realise several alternative monitoring schemes.

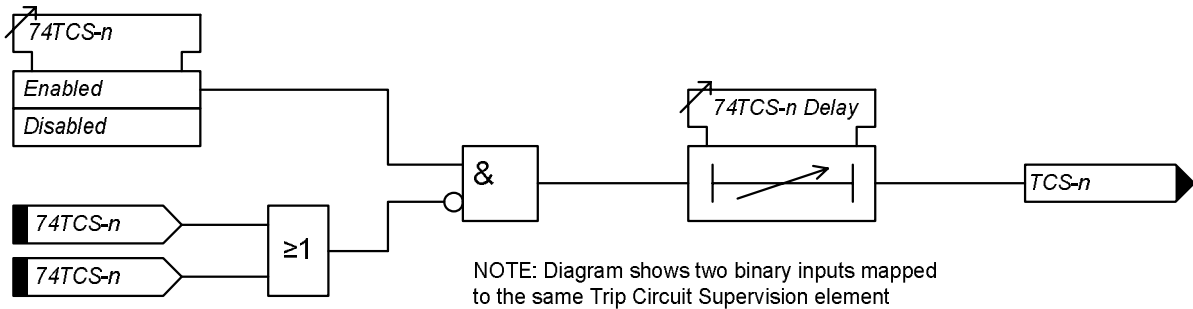


Figure 5-4 Logic Diagram: Trip Circuit Supervision Feature (74TCS)

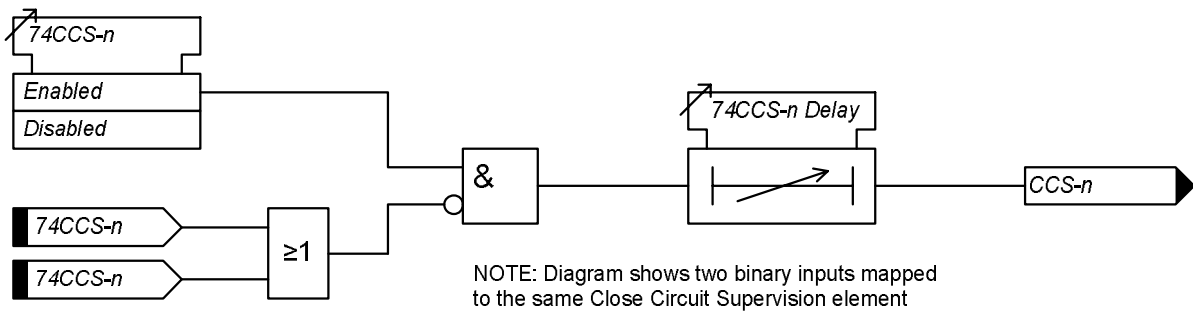


Figure 5-5 Logic Diagram: Close Circuit Supervision Feature (74CCS)

### 5.4.1 Trip Circuit Supervision Connections

The following circuits are derived from UK ENA S15 standard schemes H5, H6 and H7.


For compliance with this standard:

Where more than one device is used to trip the CB then connections should be looped between the tripping contacts. To ensure that all wiring is monitored the binary input must be at the end of the looped wiring.

Resistors must be continuously rated and where possible should be of wire-wound construction.



Scheme 1 (Basic)

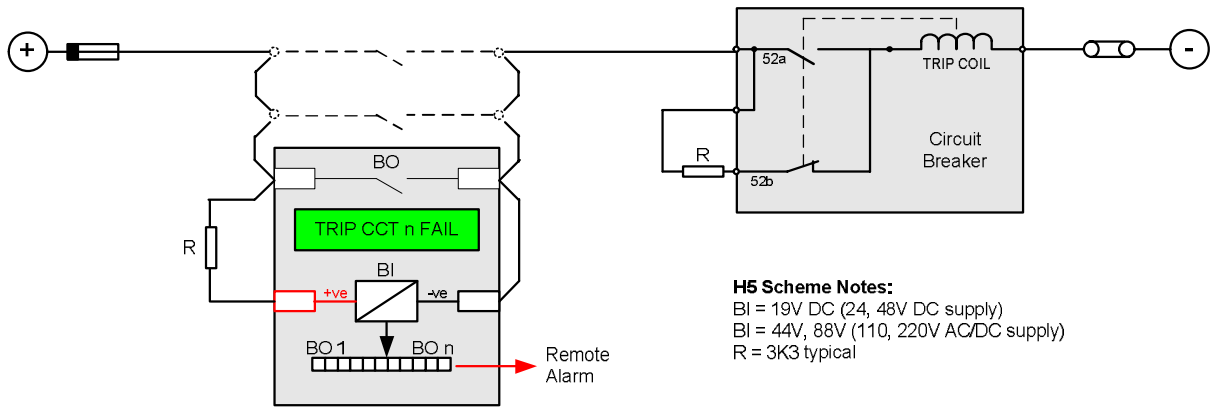


**Figure 5-6 Trip Circuit Supervision Scheme 1 (H5)**

Scheme 1 provides full Trip supervision with the circuit breaker Open or Closed.

Where a 'Hand Reset' Trip contact is used measures must be taken to inhibit alarm indications after a CB trip.


Scheme 2 (Intermediate)

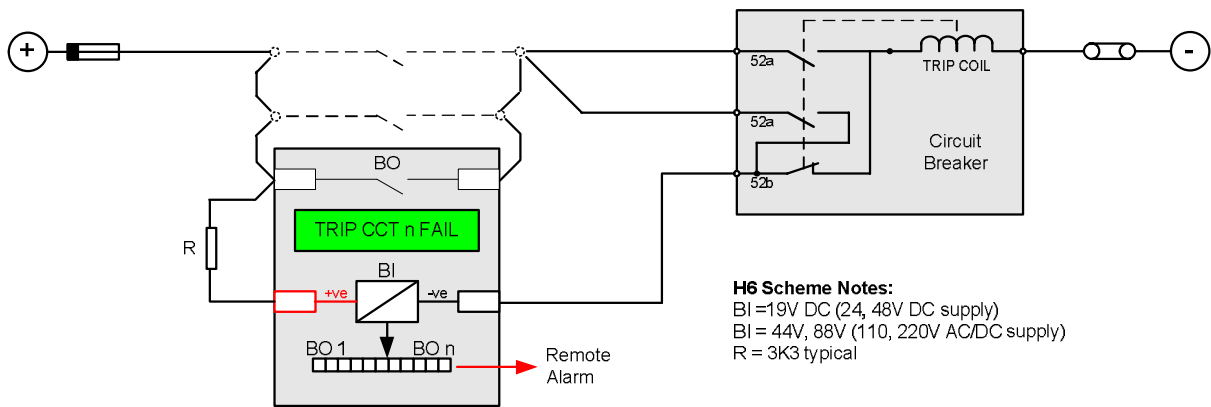

**Figure 5-7 Trip Circuit Supervision Scheme 2 (H6)**

Scheme 2 provides continuous Trip Circuit Supervision of trip coil with the circuit breaker Open or Closed. It does not provide pre-closing supervision of the connections and links between the tripping contacts and the circuit breaker and may not therefore be suitable for some circuits which include an isolating link.


**Scheme 3 (Comprehensive)**

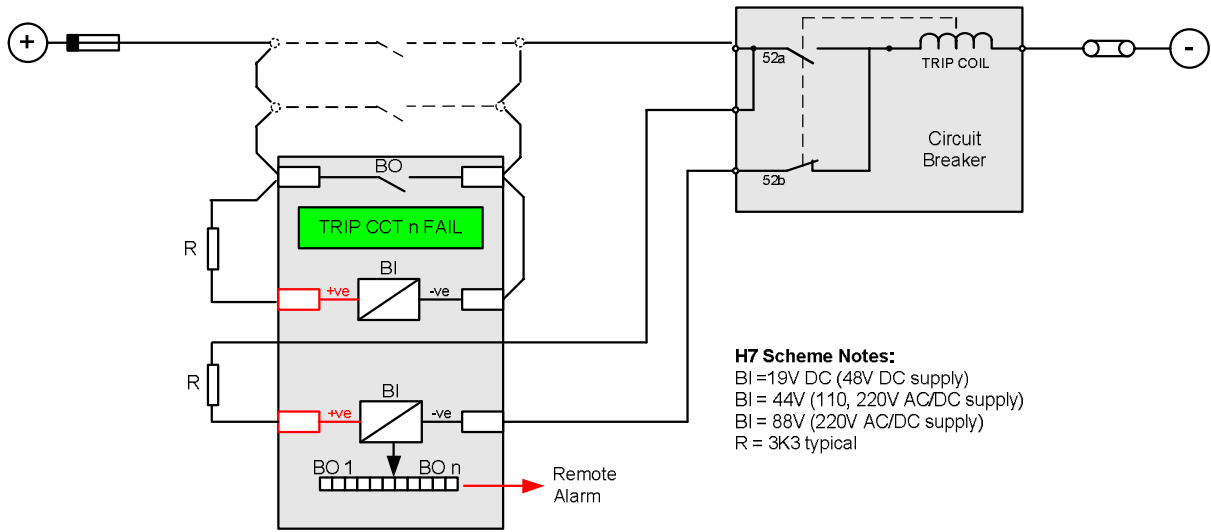

**Figure 5-8 Trip Circuit Supervision Scheme 3 (H7)**

Scheme 3 provides full Trip supervision with the circuit breaker Open or Closed.

**5.4.2 Close Circuit Supervision Connections**

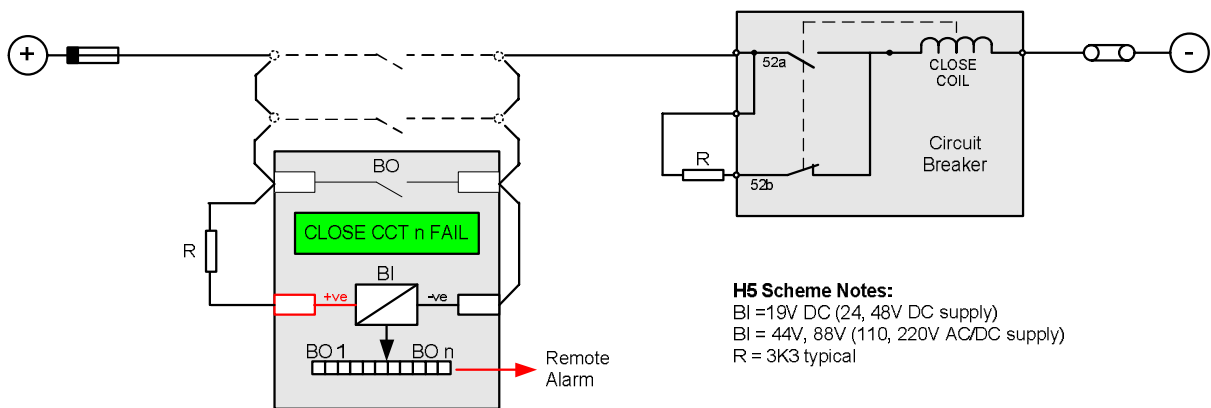

**Figure 5-9 Close Circuit Supervision Scheme**

Close circuit supervision with the circuit breaker Open or Closed.

**NOTE:**

To achieve higher isolation, in the dual TCS application, it is recommended to maintain one Binary Input channel should not be connected between 110 V DC and 230 V AC control supply.

**NOTE:**

Use the correct threshold voltages for BI when using TCS with 2 BI.

**NOTE:**

It is recommended to use Resistor (R), when the low voltage BI is used in the high voltage application. For e.g: BI44 is used 220 V DC application.

With use of Resistor(R) mentioned above, BI threshold will increase due to voltage drop across external resistor.

## 5.5 Inrush Detector (81HBL2)

This element detects the presence of high levels of 2<sup>nd</sup> Harmonic current which is indicative of transformer Inrush current at switch-on. These currents may be above the operate level of the overcurrent elements for a short duration and it is important that the relay does not issue an incorrect trip command for this transient network condition.

If a magnetic inrush condition is detected operation of the overcurrent elements can be blocked.

Calculation of the magnetising inrush current level is complex. However a ratio of 20% 2<sup>nd</sup> Harmonic to Fundamental current will meet most applications without compromising the integrity of the Overcurrent protection.

There are 3 methods of detection and blocking during the passage of magnetising inrush current.

<b>Phase</b>	Blocking only occurs in those phases where Inrush is detected.  Large, Single Phase Transformers – Auto-transformers.
<b>Cross</b>	All 3-phases are blocked if Inrush is detected in any phase.  Traditional application for most Transformers but can give delayed operation for Switch-on to Earth Fault conditions.
<b>Sum</b>	Composite 2nd Harmonic content derived for all 3-phases and then compared to Fundamental current for each individual phase.  Provides good compromise between Inrush stability and fast fault detection.

Table 5-4 Magnetic Inrush Bias

## 5.6 Broken Conductor / Load Imbalance (46BC)

Used to detect an open circuit condition when a conductor breaks or a mal-operation occurs in phase segregated switchgear.

There will be little or no fault current and so overcurrent elements will not detect the condition. However the condition can be detected because there will be a high content of NPS (unbalance) current present.

However if the line is on light load, the negative phase sequence current may be very close to, to less than the full load steady state unbalance arising from CT errors, load unbalance etc. This means a simple negative phase sequence element would not operate.

With such faults a measurable amount of zero sequence current will be produced, but even this will not be sensitive enough.

To detect such a fault it is necessary to evaluate the ratio of negative phase current (NPS) to positive phase current (PPS), since the ratio is approximately constant with variations in load current and allows a more sensitive setting to be achieved.

In the case of a single point earthed system, there will be little ZPS current and the ratio of NPS/PPS in the protected circuit will approach 100%

In the case of a multiple earthed system (assuming equal impedances in each sequence network) an NPS / PPS ratio of 50% will result from a Broken Conductor condition. This ratio may vary depending upon the location of the fault and it is therefore recommended to apply a setting as sensitive as possible.

In practice, this minimum setting is governed by the levels of standing NPS current present on the system. This can be determined from a system study or measured during commissioning making sure it is measured during maximum system load conditions to ensure all single phase loads are included.

Operation is subject to a time delay to prevent operation for transitory effects, a minimum delay of 50sec may be recommended.

### 5.6.1 Broken Conductor example

Information recorded during commissioning:

I full load = 500A

$I_{NPS} = 50A$

Therefore the ratio is given by  $50/500 = 0.1$

To allow for tolerances and load variation a setting of 200% of this value is recommended and therefore the ratio for **46BC setting** should be set at 20%.

To allow for adequate time for short circuit fault clearance by time delayed protection the **46BC delay** should be set to 50seconds.

To ensure the broken conductor protection does not operate incorrectly during low load conditions, where the three phases are less than 10% of normal load, the element should be inhibited by setting the **46BC U/C Guarded** to Yes and selecting a **46BC U/C Guard Setting** to  $0.1 \times I_n$

## 5.7 Circuit-Breaker Maintenance

The Relay provides Total, Delta and Frequent CB Operation Counters along with an  $I^2t$  Counter to estimate the amount of wear and tear experienced by a Circuit-Breaker. Alarm can be provided once set levels have been exceeded.

Typically estimates obtained from previous circuit-breaker maintenance schedules or manufacturers data sheets are used for setting these alarm levels. The relay instrumentation provides the current values of these counters.

Siemens Protection Devices Limited

P.O. Box 8, North Farm Road

Hebburn, Tyne & Wear

NE31 1TZ

United Kingdom

Phone: +44 (0)191 401 7901

Fax: +44 (0)191 401 5575

E-mail: [marketing.spdl.gb@siemens.com](mailto:marketing.spdl.gb@siemens.com)

For enquires please contact our Customer Support Center

Phone: +49 180/524 8437 (24hrs)

Fax: +49 180/524 2471

E-mail: [support.energy@siemens.com](mailto:support.energy@siemens.com)

[www.siemens.com/protection](http://www.siemens.com/protection)

C53000-G7076-C002-GB

July 17