

SIEMENS

Ingenuity for life



SIMATIC PCS 7 Minimal Configurations

SIMATIC PCS 7 V9.1

<https://support.industry.siemens.com/cs/ww/de/view/24023824>

Siemens
Industry
Online
Support



Legal information

Use of application examples

Application examples illustrate the solution of automation tasks through an interaction of several components in the form of text, graphics and/or software modules. The application examples are a free service by Siemens AG and/or a subsidiary of Siemens AG ("Siemens"). They are non-binding and make no claim to completeness or functionality regarding configuration and equipment. The application examples merely offer help with typical tasks; they do not constitute customer-specific solutions. You yourself are responsible for the proper and safe operation of the products in accordance with applicable regulations and must also check the function of the respective application example and customize it for your system.

Siemens grants you the non-exclusive, non-sublicensable and non-transferable right to have the application examples used by technically trained personnel. Any change to the application examples is your responsibility. Sharing the application examples with third parties or copying the application examples or excerpts thereof is permitted only in combination with your own products. The application examples are not required to undergo the customary tests and quality inspections of a chargeable product; they may have functional and performance defects as well as errors. It is your responsibility to use them in such a manner that any malfunctions that may occur do not result in property damage or injury to persons.

Disclaimer of liability

Siemens shall not assume any liability, for any legal reason whatsoever, including, without limitation, liability for the usability, availability, completeness and freedom from defects of the application examples as well as for related information, configuration and performance data and any damage caused thereby. This shall not apply in cases of mandatory liability, for example under the German Product Liability Act, or in cases of intent, gross negligence, or culpable loss of life, bodily injury or damage to health, non-compliance with a guarantee, fraudulent non-disclosure of a defect, or culpable breach of material contractual obligations. Claims for damages arising from a breach of material contractual obligations shall however be limited to the foreseeable damage typical of the type of agreement, unless liability arises from intent or gross negligence or is based on loss of life, bodily injury or damage to health. The foregoing provisions do not imply any change in the burden of proof to your detriment. You shall indemnify Siemens against existing or future claims of third parties in this connection except where Siemens is mandatorily liable.

By using the application examples you acknowledge that Siemens cannot be held liable for any damage beyond the liability provisions described.

Other information

Siemens reserves the right to make changes to the application examples at any time without notice. In case of discrepancies between the suggestions in the application examples and other Siemens publications such as catalogs, the content of the other documentation shall have precedence.

The Siemens terms of use (<https://support.industry.siemens.com>) shall also apply.

Security information

Siemens provides products and solutions with Industrial Security functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial security concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the Internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place. For additional information on industrial security measures that may be implemented, please visit <https://www.siemens.com/industrialsecurity>.

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customer's exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Security RSS Feed at: <https://www.siemens.com/industrialsecurity>.

Foreword

Aim of this document

Typical PCS 7 systems have at least one ES (Engineering Station) on the PC side, one or more possibly redundant servers and several OS clients (Operator Stations). In addition to the maximum availability of process control and data acquisition, there is also the possibility of integrating program adjustments or expansions in the foreground, quickly and without affecting the current process.

In contrast, small systems or stand-alone units often require very little maintenance after commissioning. To achieve high efficiency, there exists the requirement to get along with as few PC stations as possible. It therefore makes sense to utilize the rarely used ES as an OS in process mode.

This document is intended to help you in choosing a suitable PC set-up for small systems. It compares various minimal configurations (up to a maximum of three PCs) in terms of their functionality. Since the corresponding PCS 7 configuration is not the main focus of the system documentation, here you can also find the necessary activities for installation in the form of detailed step instructions.

Core contents

The main focus is on the following:

- Configuration comparison regarding functionality
- Activities for configuration, activation, and maintenance of different configurations

Validity

SIMATIC PCS 7:

- V9.1
- V9.0
- V8.2

Table of contents

Legal information	2
Foreword	3
1 Overview of Minimal Configurations	6
1.1 ES/OS Single Station	6
1.2 ES/OS Client and OS Server	7
1.3 ES, OS Master and OS Standby	8
1.4 ES/OS Master and OS Standby	9
2 General/optional system settings	11
2.1 Bus connection of the PC stations	11
2.2 Autostarting WinCC	11
3 ES/OS Single Station	12
3.1 Configuration description	12
3.2 Required hardware and software licensing	13
3.3 Step-by-step configuration	14
3.3.1 ES configuration	14
3.3.2 OS configuration	24
3.3.3 Activating runtime	27
3.3.4 Particularities when loading OS project changes	27
4 ES/OS Client and OS Server	28
4.1 Configuration description	28
4.2 Required hardware and software licensing	29
4.3 Step-by-step configuration	30
4.3.1 Preparatory activities	30
4.3.2 ES configuration	30
4.3.3 OS configuration	47
4.3.4 Activating runtime	52
4.3.5 Particularities when loading OS project changes	52
5 ES, OS Master and OS Standby	53
5.1 Configuration description	53
5.2 Required hardware and software licensing	55
5.3 Step-by-step configuration	56
5.3.1 Preparatory activities	56
5.3.2 ES configuration	56
5.3.3 OS configuration	75
5.3.4 Activating runtime	82
6 ES/OS Master and OS Standby	83
6.1 Configuration description	83
6.2 Required hardware and software licensing	86
6.3 Step-by-step configuration	87
6.3.1 Preparatory activities	87
6.3.2 ES configuration	87
6.3.3 OS configuration	101
6.3.4 Activating runtime	108
6.3.5 Particularities when loading OS project changes	108
7 Expansion with the PCS 7 OS Web Option	110
7.1 Web configurations	111
7.2 Web-specific hardware and software requirements	113
7.3 Maximum number of Web client connections	115

Table of contents

7.4	Configuring the OS Web Server.....	115
7.4.1	Publishing project data	116
7.4.2	Setting up user rights, website start screen, and the language	119
7.4.3	Configuring using the Web Configurator	120
7.4.4	Downloading and compiling the Web Server	123
7.5	Settings on the Web client.....	124
7.6	Installing the Web client plug-ins.....	128
8	Appendix	130
8.1	Service and support	130
8.2	Industry Mall	131
8.3	Links and literature	131
8.4	Change documentation	131

1 Overview of Minimal Configurations


There are various possible options when utilizing the engineering station in process mode as an operator station or multiple operator stations with as few PCs as possible. The following versions were selected according to their feasibility and usefulness in the context of PCS 7.

The configurations shown here also include descriptions of solutions with configurations that do not differ significantly from each other.

In general, particular functionality criteria must be considered when using the engineering PC as an OS, because the OS project must be closed when performing certain activities. This will also be discussed in more detail below.

1.1 ES/OS Single Station

The smallest of all configurations only needs one PC station.



Process mode/functionality

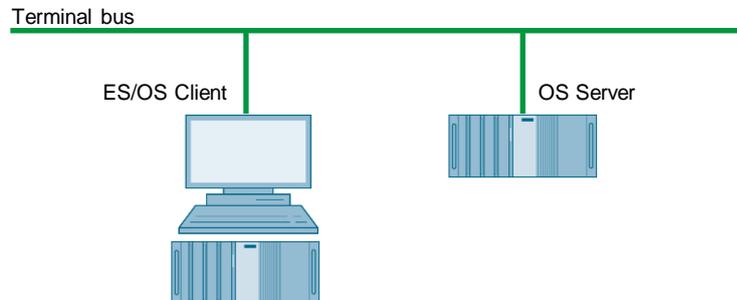
Since version 6.1 of PCS 7, it has also been possible to compile the OS project when runtime is activated (change compilation). This means that the operator and archiving functions are present permanently.

Note You can find a description of this configuration and a how-to guide in chapter 3 "ES/OS Single Station".

Note The ES/OS Single Station can also be extended with the functionality of the PCS 7 OS Web Server. You can find a guide to doing this in chapter 7 "Expansion with the PCS 7 OS Web Option".

1.2 ES/OS Client and OS Server

With an additional PC station as an OS server, the ES can be used as an OS client. This accesses the data of the OS server in process mode and visualizes it.



Process mode/functionality

In PCS 7, the OS server can be used for operator functions when no more than four OS clients are connected. In this example, if the server malfunctions, the complete OS functionality fails. Besides this, the OS client must be terminated to make OS project changes at a later stage. However, the OS server keeps on working permanently at compiling/loading of changes.

Note

You can find a description of this configuration and a how-to guide in chapter 4 "ES/OS Client and OS Server".

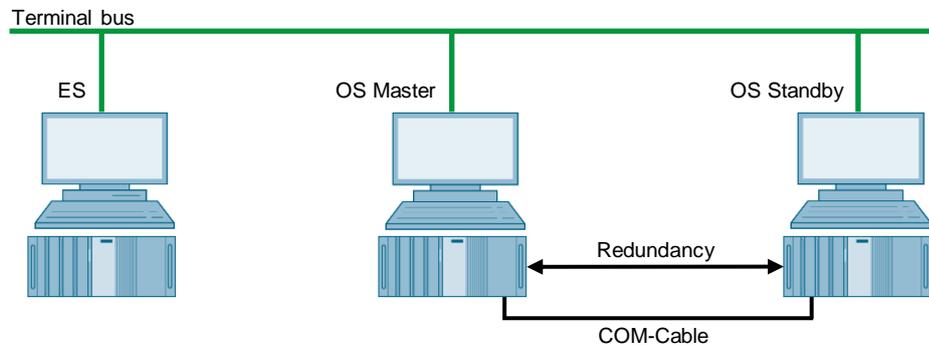
Alternatives/variations

One of the advantages of this configuration is the option of connecting additional clients to the OS server on a relatively simple and inexpensive basis.

1.3 ES, OS Master and OS Standby

You need three PC stations for PCS 7-compliant implementation of OS redundancy.

In this case, the ES only carries out engineering tasks and, while doing this, is only used for testing OS functions.



Process mode/functionality

Since the ES is not involved in process mode, the operator functions of the two OS Single Stations are permanently available. The OS remains active even during complete loading of project changes. Redundancy ensures mutual synchronization both when online and after the failure of one of the two partners.

The COM connection (RS 232 connecting cable) is for optimization of internal server-to-server communication.

Since PCS 7 V7.0, it has been possible, as an alternative to the COM connection, to use a separate Ethernet connection (a free on-board or additional network adapter) for the redundancy connection.

Note

You can find a description of this configuration and a how-to guide 5 "ES, OS Master and OS Standby".

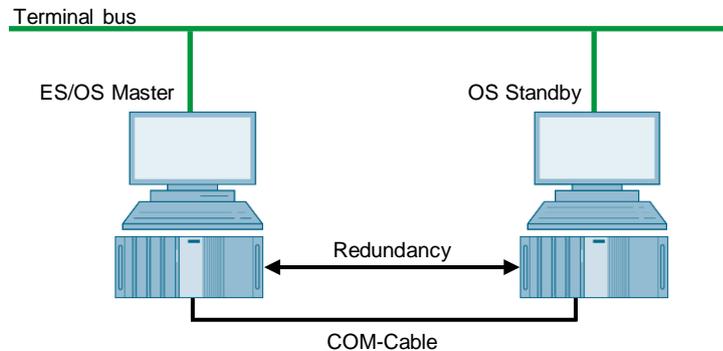
Alternatives/variants

In the case of the low-maintenance systems that this document focuses on, you can often do without a permanently available if it is possible to rent a temporary ES for configuration, commissioning, and project changes.

In this example, it is only conceivable to extend the system using additional OS clients if a server operating system is installed on the OSes.

1.4 ES/OS Master and OS Standby

In this configuration with two redundant OS Single Stations, one of the stations is also used as a simultaneous ES, which obviates the need for a separate third station.



Process mode/functionality

In this example, both PC stations work in process mode as redundant OS single stations that balance each other both in operation and after the failure of one of the two partners. This is also relevant for later OS project changes, which require the Master OS to be exited. In this case, the Standby OS takes over the master role. It keeps on working permanently while compiling/loading changes and updates the redundancy partner after it returns.

The COM connection (RS 232 connecting cable) is used to optimize internal communication between the two OS Single Stations.

Since PCS 7 V7.0, it has been possible, as an alternative to the COM connection, to use a separate Ethernet connection (a free on-board or additional network adapter) for the redundancy connection. For complete loading, you must deactivate OS Runtime and the OS projects on both stations and close them. For this period, no OS functionality is available.

Note

This configuration does not offer all of the PCS 7 functionality, since redundancy is set up using WinCC resources.

In chapter 6 "ES/OS Master and OS Standby", you can find corresponding limitations in process operation and differences in system behavior together with a description of configuration and a how-to guide.

Alternatives/variations

For PCS 7-compliant implementation of OS redundancy, we recommend using three PC stations. With the changes to the license concept from PCS 7 V8.0 onward, you will need the same number of license packages. The implementation of redundancy with two PC stations is associated with some limitations (see chapter 6.1 "Configuration description") and, compared to PCS 7-compliant implementation with a separate ES and two redundant OS Single Stations (see chapter 1.3 "ES, OS Master and OS Standby"), only saves you one computer (hardware and Windows license).

Note

The ES/OS Single Station can also be extended with the functionality of the PCS 7 OS Web Server. You can find a guide to doing this in chapter 7 "Expansion with the PCS 7 OS Web Option".

2 General/optional system settings

The system settings that are relevant to configuration are presented below.

2.1 Bus connection of the PC stations

Plant bus

In the ES and in each server, a network card is used in "Configured mode" for the plant bus. On this network card, only the ISO protocol is enabled for Windows. If a CP1623 is present, it is used for accessing the plant bus. Parameterization is carried out in SIMATIC NetPro and in the HW Config.

Terminal bus

Except for configuration with only one ES/OS Single Station, all of the other PC stations are additionally linked to the terminal bus. When doing this, the necessary second network card of the ES and the server is set here to "PG mode". This card is not configured in SIMATIC NetPro and in the HW Config. PCS7 finds this network access via the computer name or the specified path for the target machine that must be entered in the object properties of the PC station. For this network card, only the TCP/IP protocol (not ISO) is activated in Windows.

Client PC stations are generally fitted with only one network card that is used to connect to the terminal bus. For this network card, only the TCP/IP protocol (not ISO) is activated in Windows.

2.2 Autostarting WinCC

This document contains the step-by-step instructions for opening the OS project on the OS servers and clients for runtime activation in the WinCC Explorer.

This should be usually avoided in the system, since there are generally no configuration licenses (RC licenses) on the OSES. If WinCC Explorer is open for longer than two hours while doing this, WinCC switches to Demo mode and you must close it completely (including runtime) and reopen it for further configuration steps.

To activate runtime automatically when the computer starts without having to open WinCC Explorer, you can configure an automatic start for the project.

In conjunction with SIMATIC NET 2005 Edition (WinCC V6.0 SP3 and above), you should configure the "AutoStartRT" WinCC tool on the "Set configuration console PC station" to configure the WinCC automatic start. You can find more information in the following FAQs:

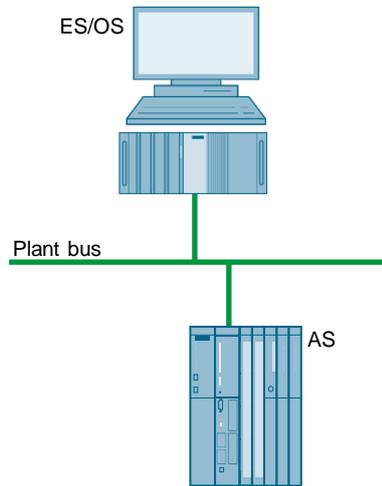
<https://support.industry.siemens.com/cs/ww/en/view/23061262>

3 ES/OS Single Station

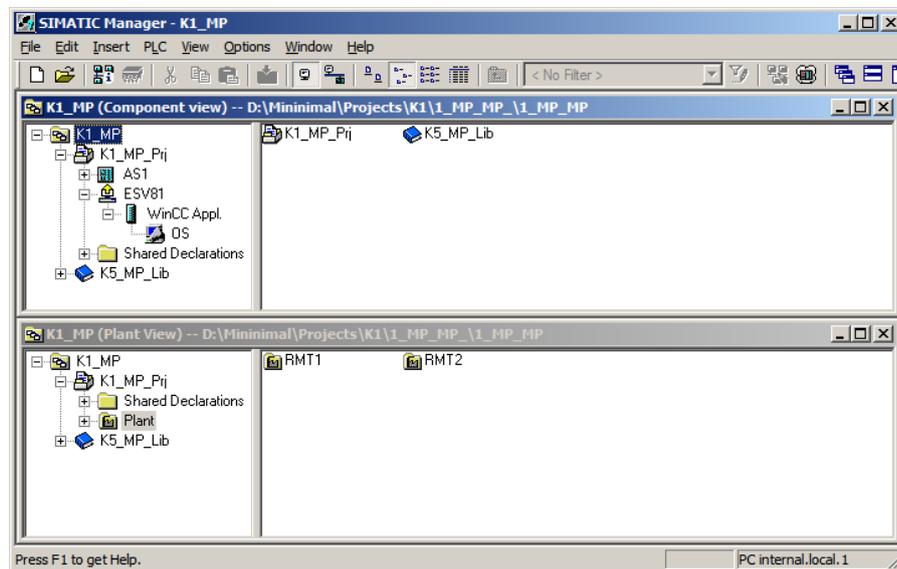
3.1 Configuration description

The Single Station is the smallest possible configuration. The same PC is used for both ES and OS functionality.

Hardware configuration



PCS 7 configuration



3.2 Required hardware and software licensing

Hardware

The following hardware is recommended for this configuration and can be ordered via the Siemens mall. Your selected operating system and the appropriate scope of the SIMATIC PCS 7 system software are preinstalled on the PC station.

Station	Product designation	Operating system	Plant bus transition
1 x ES/OS	SIMATIC PCS 7 ES/OS IPC847E BCE	Windows 10	RJ45 network card
	SIMATIC PCS 7 ES/OS IPC847E IE	Windows 10	CP1623

Software licensing

The following section lists the software/license package that are necessary for this configuration selection.

In the selected configuration as a Single Station, the number of POs is limited to a maximum of 2000.

Component	Software/licence packages
ES/OS	<ul style="list-style-type: none"> • SIMATIC PCS 7 ES Single Station (incl. 250 AS/OS Runtime POs) • SIMATIC PCS 7 AS runtime license • SIMATIC PCS 7 OS runtime license

3.3 Step-by-step configuration

Note The following instructions have been drawn up based on Windows 7 and PCS 7 V9.0. A CP1623 is used as an example of the plant bus transition. Time synchronization is activated.

3.3.1 ES configuration

Creating the multiproject

As the basis for the instructions below, the station must be physically networked as shown in the illustration in chapter 3.1. Apart from this, you must create a multiproject on the ES in which the hardware and software of the AS are already configured.

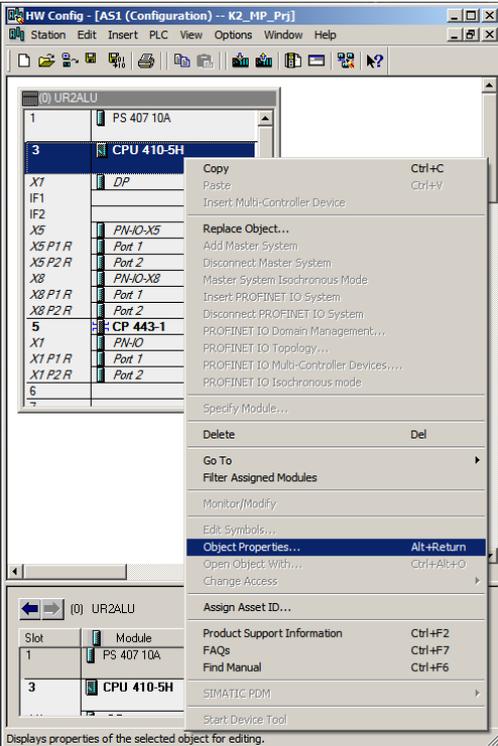
AS settings

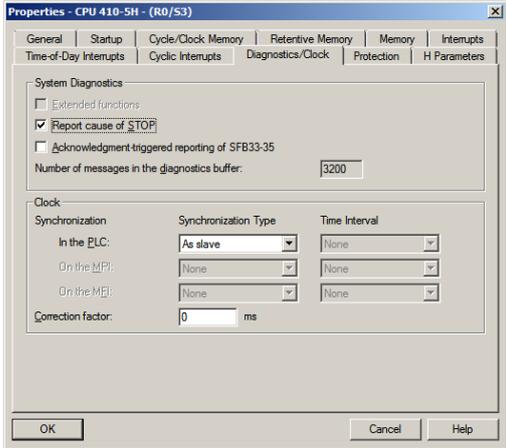
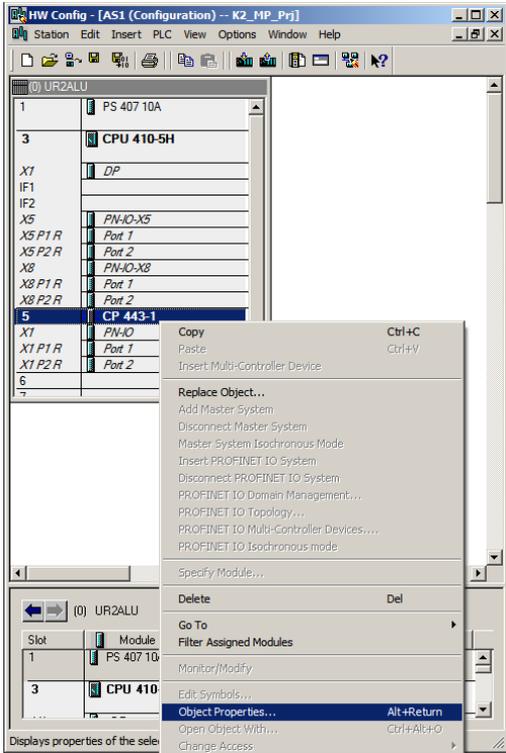
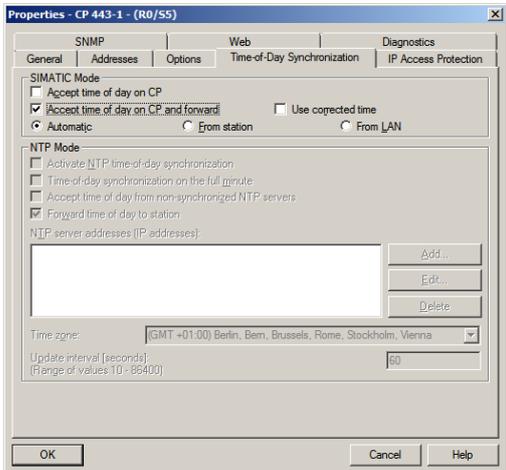
This example describes a way in which the OS server specifies the master time.

Note More time synchronization options are described in detail in the following manuals:

- "SIMATIC PCS 7 Operator Station"
<https://support.industry.siemens.com/cs/ww/en/view/109805404>
- "SIMATIC Process Control System PCS 7 Time Synchronization"
<https://support.industry.siemens.com/cs/ww/en/view/109805436>

© Siemens AG 2022. All rights reserved.

Step	Activity	Screenshot
1.	Open the HW Config for the AS. Highlight the CPU and choose "Object properties..." in the shortcut menu.	 <p>The screenshot shows the 'HW Config' window for a rack (UR2ALU). The rack contains a power supply (PS 407 10A) in slot 1 and a CPU (CPU 410-5H) in slot 3. The CPU is selected, and a context menu is displayed over it. The menu options include 'Copy', 'Paste', 'Insert Multi-Controller Device', 'Replace Object...', 'Delete', 'Go To', 'Filter Assigned Modules', 'Monitor/Modify', 'Edit Symbols...', 'Object Properties...' (highlighted), 'Open Object With...', 'Change Access', 'Assign Asset ID...', 'Product Support Information', 'FAQs', 'Find Manual', 'SIMATIC PDM', and 'Start Device Tool'. The 'Object Properties...' option is associated with the keyboard shortcut 'Alt+Return'.</p>

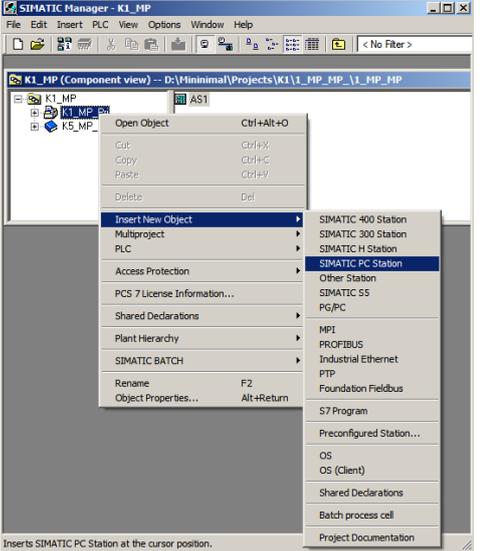
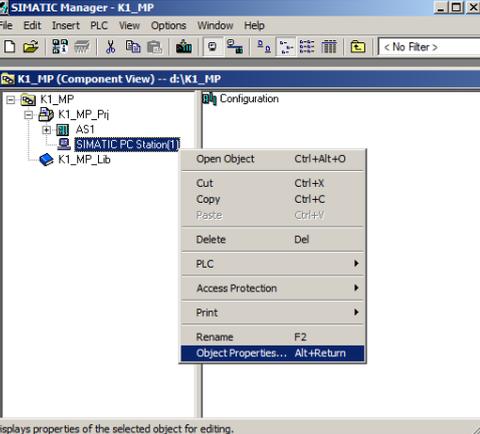
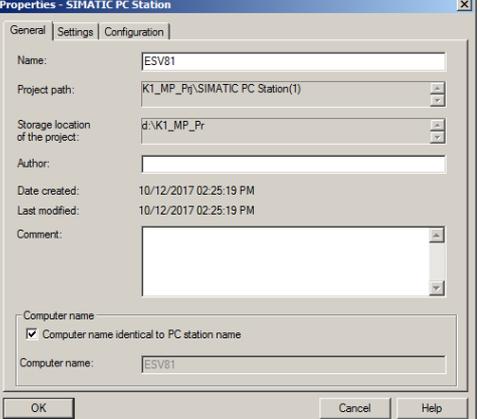
Step	Activity	Screenshot
2.	<p>Switch to the "Diagnostics/Clock" tab. In the "Clock" section, set "As slave" for the AS under "Synchronization Type". Click on the "OK" button to confirm your selection.</p>	
3.	<p>Open the shortcut menu of the CP and select "Object properties...".</p>	
4.	<p>Switch to the "Time synchronization" tab. Select the "Accept time of day on CP and forward" check box. Click on the "OK" button to confirm the setting.</p>	

3 ES/OS Single Station

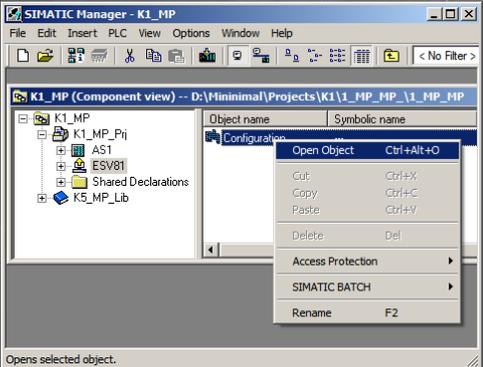
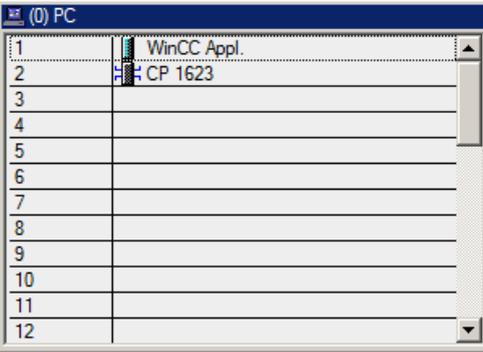
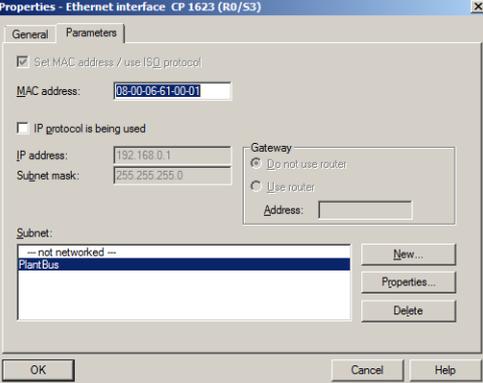
Step	Activity	Screenshot
5.	Save the configuration and compile it using: "Station > Save and Compile...". Close the HW Config.	

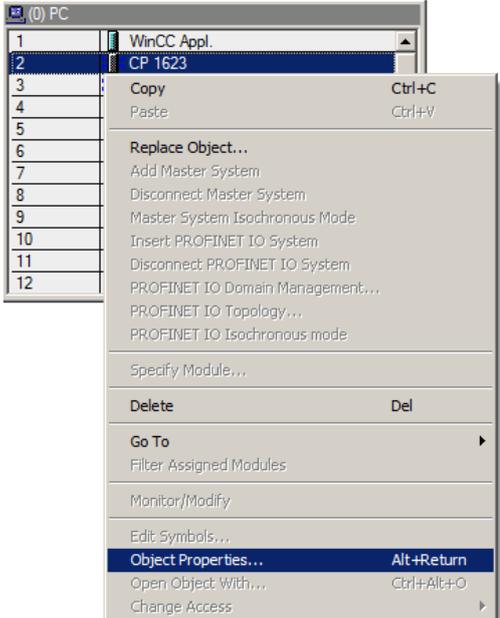
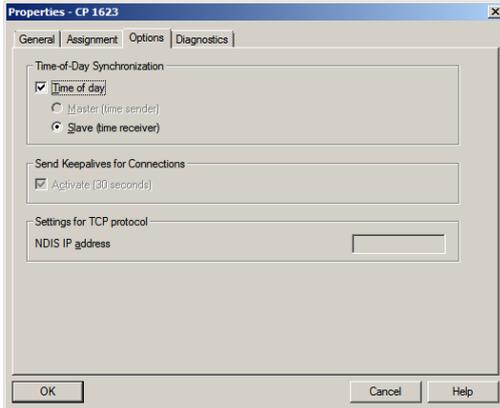
Creating a PC station

The PC station is created in the PCS 7 project that represents both the ES and the OS.

Step	Activity	Screenshot
1.	In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.	 <p>The screenshot shows the SIMATIC Manager interface with the Component View open. A context menu is displayed over the project tree, with 'Insert New Object' selected. A sub-menu is open, showing 'SIMATIC PC Station' as the selected option. Other options include SIMATIC 400 Station, SIMATIC 300 Station, SIMATIC H Station, Other Station, SIMATIC S5, PG/PC, MPI, PROFIBUS, Industrial Ethernet, PTP, Foundation Fieldbus, S7 Program, Preconfigured Station..., OS, OS (Client), Shared Declarations, Batch process cell, and Project Documentation.</p>
2.	Use the shortcut menu to open the object properties of the PC station.	 <p>The screenshot shows the SIMATIC Manager interface with the Component View open. The 'SIMATIC PC Station(1)' object is selected in the project tree. A context menu is displayed, and 'Object Properties...' is highlighted. The status bar at the bottom indicates 'Displays properties of the selected object for editing.'</p>
3.	Change the name of the ES PC station to match the name of the local computer on the network. Select the "Computer name identical to PC station name" checkbox.	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box. The 'General' tab is active. The 'Name' field contains 'ESV81'. The 'Project path' is 'K1_MP_Prj\SIMATIC PC Station(1)'. The 'Storage location of the project' is 'd:\K1_MP_Pr'. The 'Author' field is empty. The 'Date created' and 'Last modified' fields both show '10/12/2017 02:25:19 PM'. The 'Comment' field is empty. At the bottom, the 'Computer name' section has the checkbox 'Computer name identical to PC station name' checked, and the 'Computer name' field contains 'ESV81'. The 'OK', 'Cancel', and 'Help' buttons are visible at the bottom.</p>

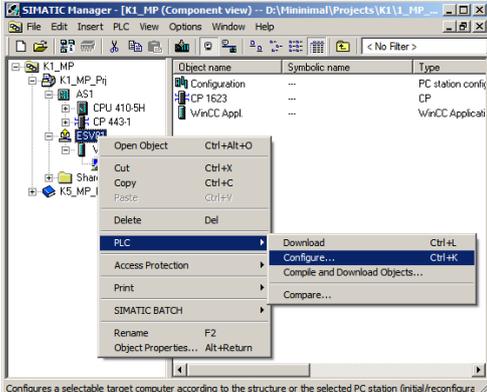
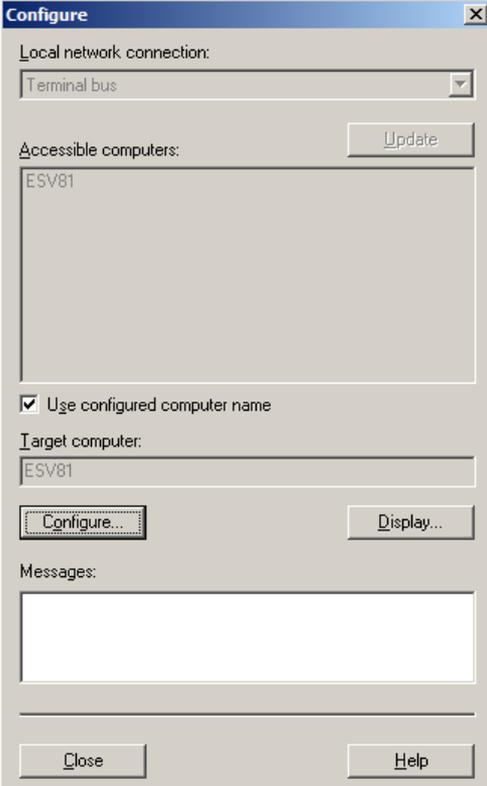
3 ES/OS Single Station

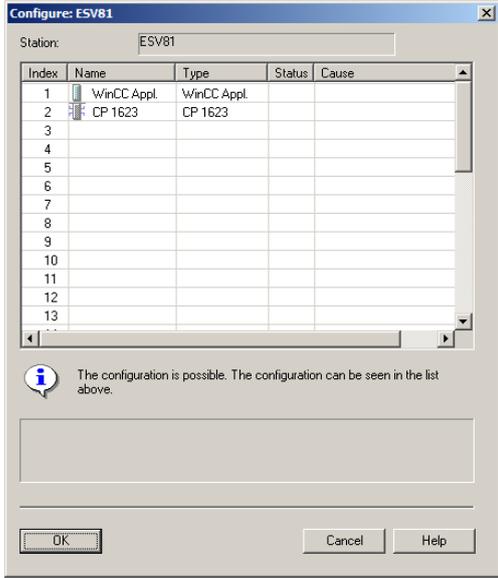
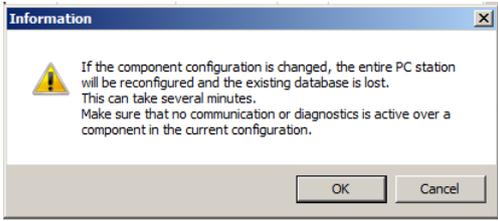
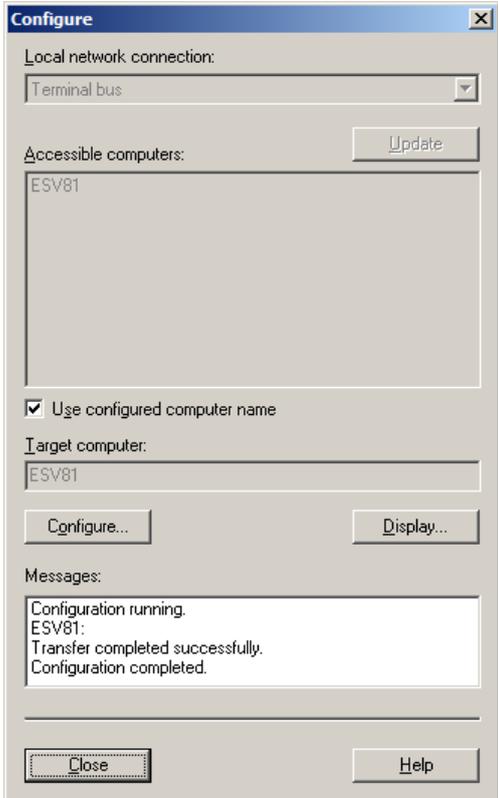
Step	Activity	Screenshot
4.	Open the HW Config of the PC station via the shortcut menu.	
5.	Insert a "WinCC application" and a network card of type "CP1623" from the object catalog (View > Catalog).	
6.	<p>Under "Subnet", choose the plant bus or create it by clicking on the "New..." button.</p> <p>Assign the corresponding MAC address to the CP1623.</p> <p>Deselect the "IP protocol is being used" checkbox.</p> <p>Click on the "OK" button to confirm your settings.</p>	

Step	Activity	Screenshot
7.	Open the shortcut menu of the CP1623 and select "Object properties...".	
8.	Switch to the "Options" tab and select the "Time of day" checkbox. Click on the "OK" button to confirm your selection.	
9.	Use the "Station > Save and compile..." menu item to save the configuration and compile it. Close the HW Config.	

Configuring the PC station

The "Configure PC station" function transfers project configurations to one or more target stations.

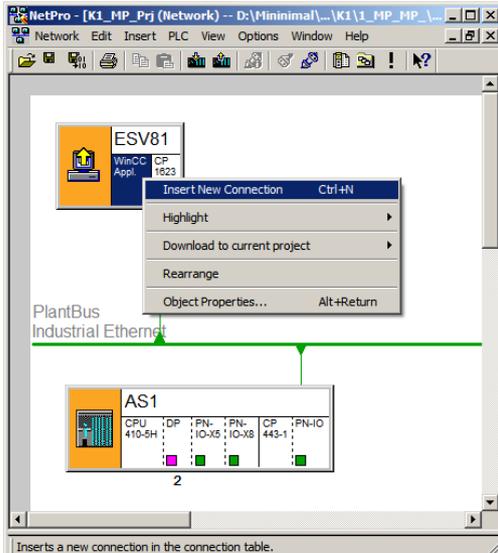
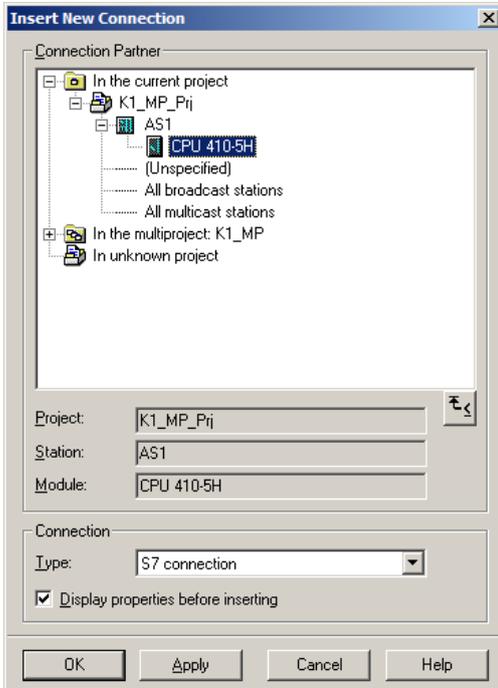
Step	Activity	Screenshot
1.	<p>Configure the Station Configuration Editor of the ES. To do this, highlight the PC station of the ES and then choose "PLC > Configure..." in the shortcut menu.</p>	 <p>The screenshot shows the SIMATIC Manager interface with a context menu open over a selected PC station. The menu path 'PLC > Configure...' is highlighted. The background shows a project tree with components like CPU 410-5H and CP 443-1.</p>
2.	<p>Under "Accessible computers:" choose the PC that you want to configure.</p> <p>NOTE If you chose the option "PC name identical to PC station name" for the PC station in the "Object properties", the system displays directly in the component configurator the target PC to be configured.</p> <p>Using the "Display..." button, you can display the current configuration of the PC station. Click on the "Configure..." button.</p>	 <p>The screenshot shows the 'Configure' dialog box. The 'Local network connection' is set to 'Terminal bus'. Under 'Accessible computers:', 'ESV81' is listed. The 'Use configured computer name' checkbox is checked. The 'Target computer:' field also contains 'ESV81'. The 'Configure...' button is highlighted.</p>

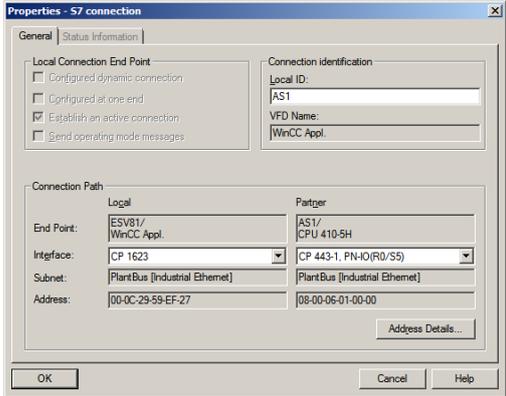
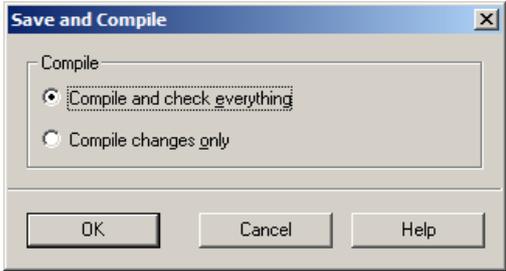
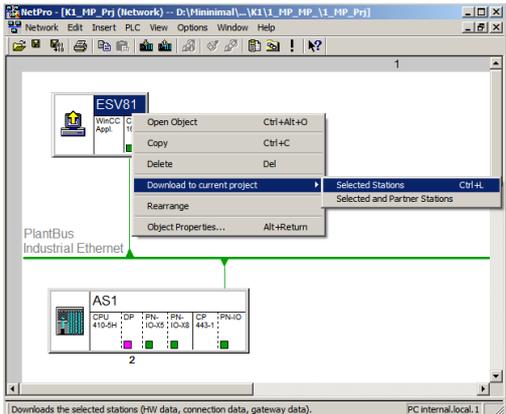
Step	Activity	Screenshot
3.	<p>In the window that appears, you can see how the PC station is configured. Click on the "OK" button to confirm this.</p>	
4.	<p>Click on the "OK" button to confirm the information dialog.</p>	
5.	<p>In the bottom window, you then see the message: "Transfer completed successfully." Close the configuration dialog.</p>	

Configuring and loading AS-OS communication

In the following section, the connection is configured using NetPro and loaded in the stations.

Note In the case of a granular station configuration, you must merge the subnets of the individual sub-projects first.

Step	Activity	Screenshot
1.	<p>Open NetPro.</p> <p>Highlight the WinCC application of the ES and open the shortcut menu. Choose "Insert New Connection".</p>	 <p>Inserts a new connection in the connection table.</p>
2.	<p>In the "Connection Partner" window, select the CPU of AS.</p> <p>Make sure that an "S7 connection" is selected under "Connection".</p> <p>Click on the "OK" button to confirm your selection.</p>	

Step	Activity	Screenshot
3.	<p>On the "General" tab under "Connection identification", change the "Local ID:" to a descriptive name like AS1, for example. Click on the "OK" button to confirm your entry.</p>	
4.	<p>Save and compile by means of: "Network > Save and Compile...". Select "Compile and check everything". Click on the "OK" button to confirm your selection.</p>	
5.	<p>Highlight the ES and download the connection via the shortcut menu: "Download to current project > Selected Stations". Download the AS in the same way. Then, close NetPro.</p>	

© Siemens AG 2022 All rights reserved

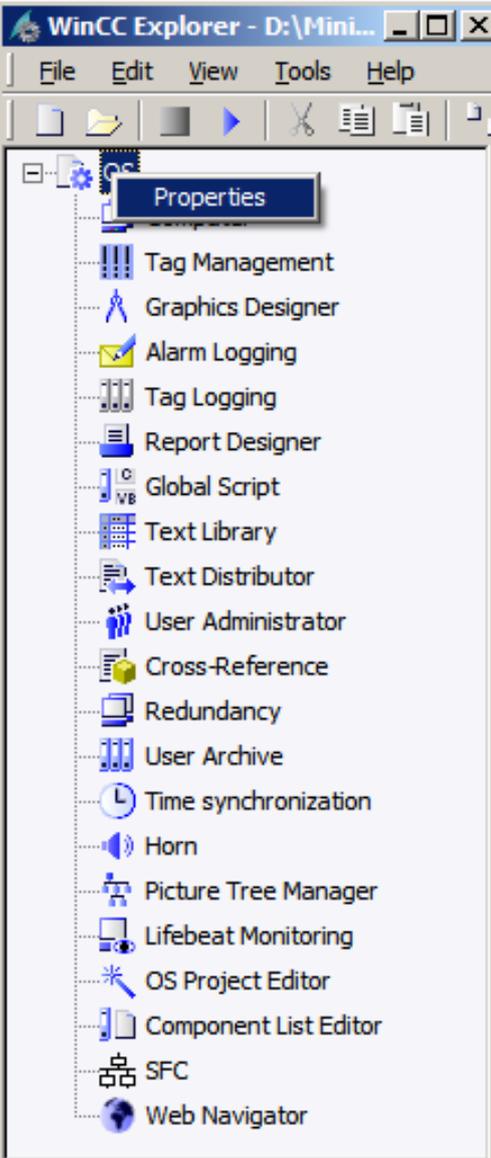
Compiling and loading the user program

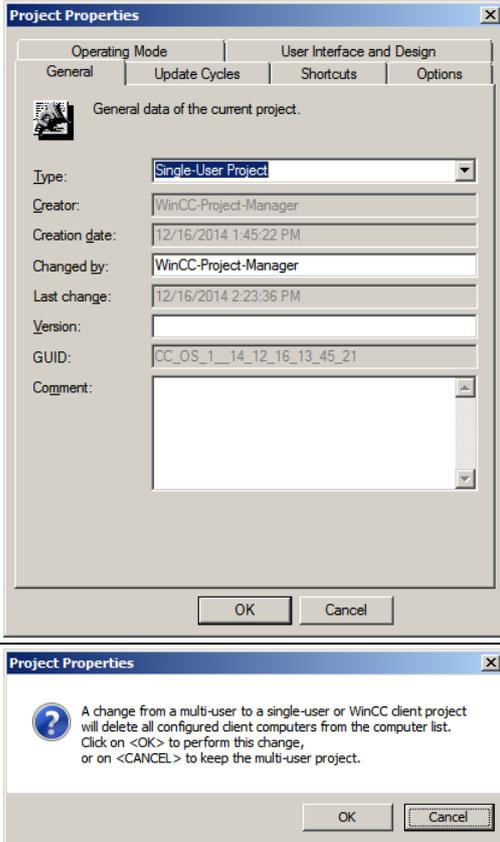
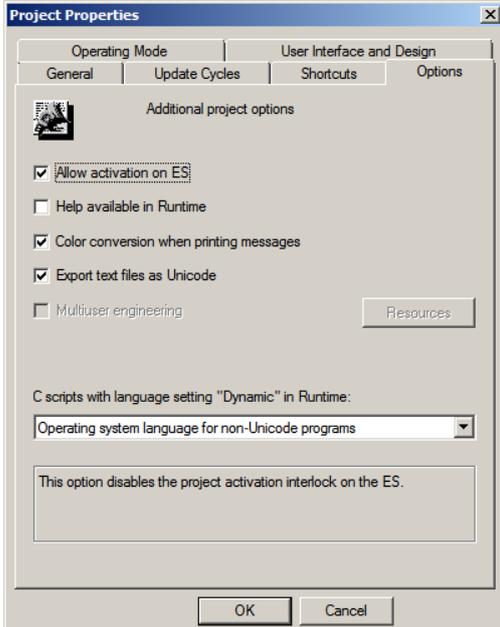
Compile the S7 program and download it to the AS.

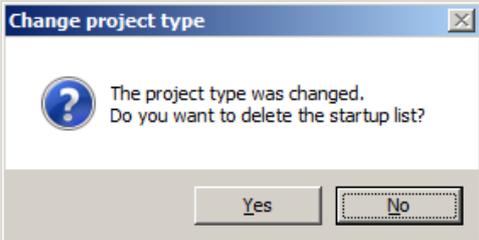
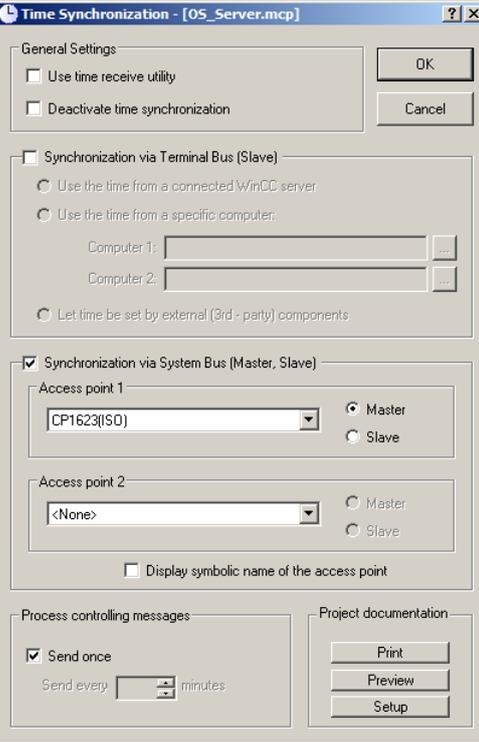
Compiling the OS project

Compile the OS project in SIMATIC Manager.

3.3.2 OS configuration

Step	Activity	Screenshot
1.	<p>Open the OS project.</p> <p>In the open WinCC Explorer, highlight the OS project and choose "Properties" in the shortcut menu.</p>	 <p>The screenshot shows the WinCC Explorer application window with the 'Properties' context menu open over the OS project. The menu items listed are: Properties, Tag Management, Graphics Designer, Alarm Logging, Tag Logging, Report Designer, Global Script, Text Library, Text Distributor, User Administrator, Cross-Reference, Redundancy, User Archive, Time synchronization, Horn, Picture Tree Manager, Lifebeat Monitoring, OS Project Editor, Component List Editor, SFC, and Web Navigator. The 'Properties' option is highlighted in blue.</p>

Step	Activity	Screenshot
2.	<p>On the "General" tab under "Type:", choose "Single-user project".</p> <p>Click on the "OK" button to confirm your selection and the message that the system then displays.</p>	
3.	<p>On the "Options" tab, select the "Allow activation on the ES" option.</p> <p>NOTE When using PCS 7 V9.0 and above, the "Allow activation on the ES" option is automatically selected and grayed out if you have not configured a "Path to the target OS computer".</p>	

Step	Activity	Screenshot
4.	Click on the "No" button to prevent the startup list being deleted.	 <p>The screenshot shows a dialog box titled "Change project type" with a question mark icon. The text inside reads: "The project type was changed. Do you want to delete the startup list?". At the bottom, there are two buttons: "Yes" and "No". The "No" button is highlighted with a dashed border.</p>
5.	<p>Open the "Time Synchronization" editor.</p> <p>Select the "Synchronization via System Bus (Master, Slave)" checkbox.</p> <p>Under "Access point 1", choose "CP1623(ISO)" and select the "Master" radio button.</p> <p>Click on the "OK" button to confirm your selection.</p>	 <p>The screenshot shows the "Time Synchronization" dialog box for project [05_Server.mcp]. It has several sections: <ul style="list-style-type: none"> General Settings: Includes checkboxes for "Use time receive utility" and "Deactivate time synchronization". Synchronization via Terminal Bus (Slave): Includes radio buttons for "Use the time from a connected WinCC server", "Use the time from a specific computer" (with fields for Computer 1 and Computer 2), and "Let time be set by external (3rd - party) components". Synchronization via System Bus (Master, Slave): This section is checked. It contains two "Access point" sections. "Access point 1" has a dropdown menu set to "CP1623(ISO)" and the "Master" radio button selected. "Access point 2" has a dropdown menu set to "<None>" and the "Slave" radio button selected. There is also a checkbox for "Display symbolic name of the access point". Process controlling messages: Includes a checked "Send once" checkbox and a "Send every" field set to 5 minutes. Project documentation: Includes "Print", "Preview", and "Setup" buttons. </p>
6.	<p>Close WinCC Explorer.</p> <p>NOTE The changes do not take effect until you have closed and reopened WinCC Explorer.</p>	

3.3.3 **Activating runtime**

After the OS project has been closed, open it again and activate runtime.

3.3.4 **Particularities when loading OS project changes**

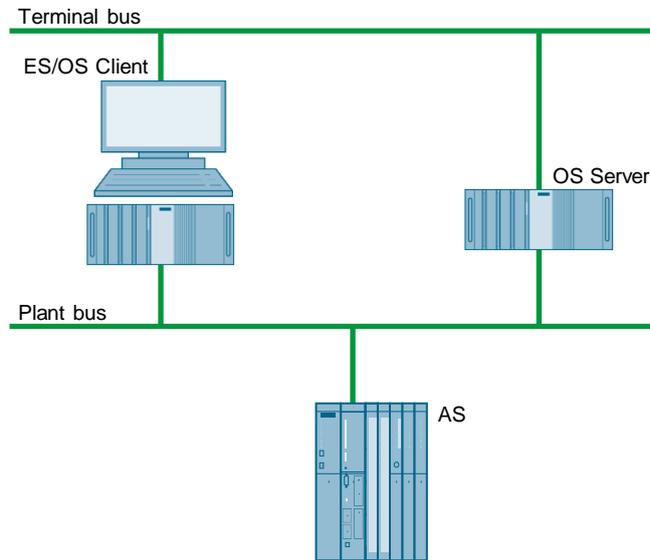
If the OS and ES are operated on a single PC, you do not need to carry out a loading operation because all the required data is already available. In this case, you only need to run the "Compile OS" function.

In a similar way to the "Download changes" function, you can run the "Compile changes" function in the Single Station without exiting process mode in the OS.

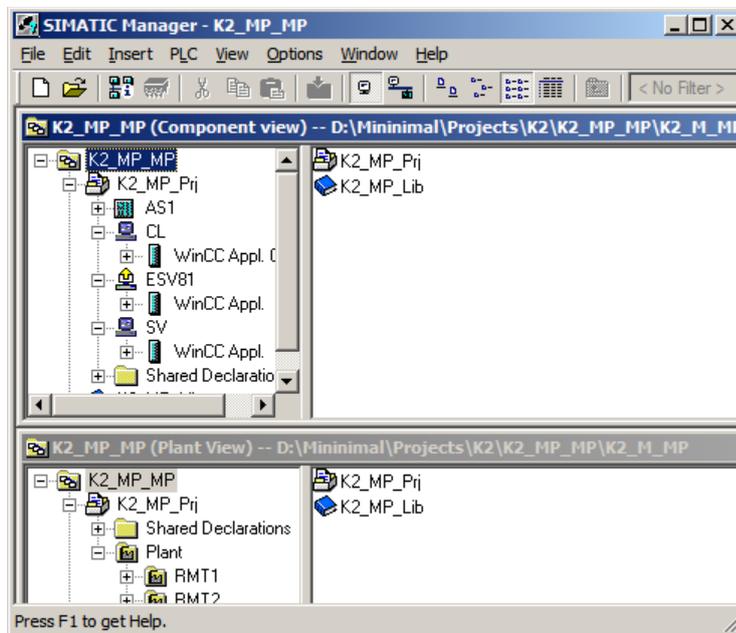
4 ES/OS Client and OS Server

4.1 Configuration description

In a server-client structure with only two computers, the ES is used as an OS client at the same time. Three PCs should be provided in this configuration.



PCS 7 configuration



4.2 Required hardware and software licensing

Hardware

For this configuration, we recommend using the hardware below which you can order via the Siemens mall. This ensures that the appropriate number of selected operating systems and SIMATIC PCS 7 system software packages are pre-installed on the PC stations.

Station	Product designation	Operating system	Plant bus transition
1 x ES/OS Client	SIMATIC PCS 7 ES/OS IPC847E BCE	Windows 10	RJ45 Network card
	SIMATIC PCS 7 ES/OS IPC847E IE	Windows 10	CP 1623
1 x OS Server	SIMATIC PCS 7 ES/OS IPC847E BCE	Windows Server 2019	RJ45 Network card
	SIMATIC PCS 7 ES/OS IPC847E IE	Windows Server 2019	CP 1623

Software licensing

The following section lists the software/license packages that you need for the selected configuration.

Depending on the project size, an OS server can provide up to 12,000 POs with the corresponding software package. In addition to engineering software, OS client software must also be installed on the ES.

Component	Software/licence packages
ES/OS client	<ul style="list-style-type: none"> • SIMATIC PCS 7 AS/OS Engineering Software (PO unlimited) • SIMATIC PCS 7 AS Runtime License • SIMATIC PCS 7 OS Software Client
OS Server	<ul style="list-style-type: none"> • SIMATIC PCS 7 OS Software Server • SIMATIC PCS 7 OS Runtime License

4.3 Step-by-step configuration

Note

The following instructions have been drawn up based on Windows 7 and PCS 7 V9.0.

CP1623 are used as an example of the plant bus transition. Time synchronization is activated.

The PC stations used in the test setup are called:

- ES/OS client: ESV81
- OS server: SV

4.3.1 Preparatory activities

Create a project folder on the OS server and share it. This allows the OS data configured on the engineering station to be transferred to the OS server.

4.3.2 ES configuration

Creating the multiproject

As the basis for the following instructions, all of the PC stations must be physically networked as shown in the illustration on page 28. Apart from this, you must create a multiproject on the ES in which the hardware and software of the AS are already configured.

Then, you start with the following CPU and CP settings.

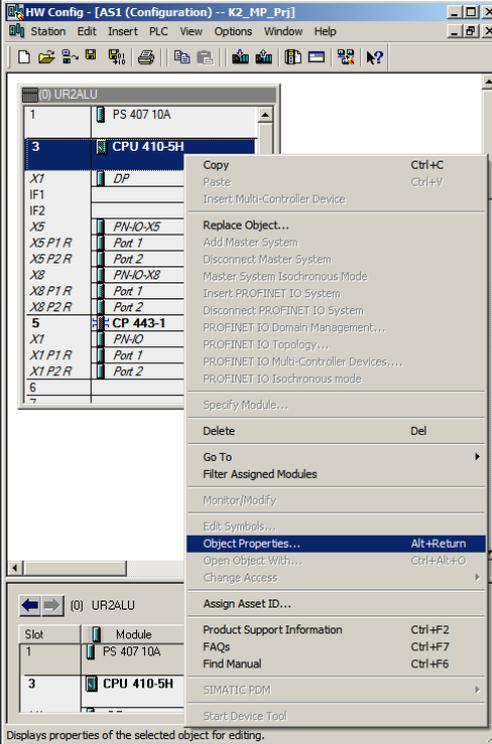
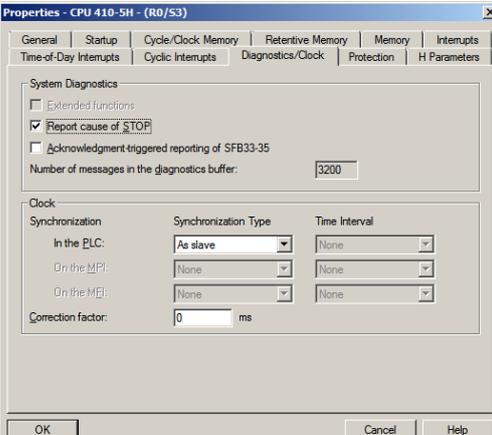
AS settings

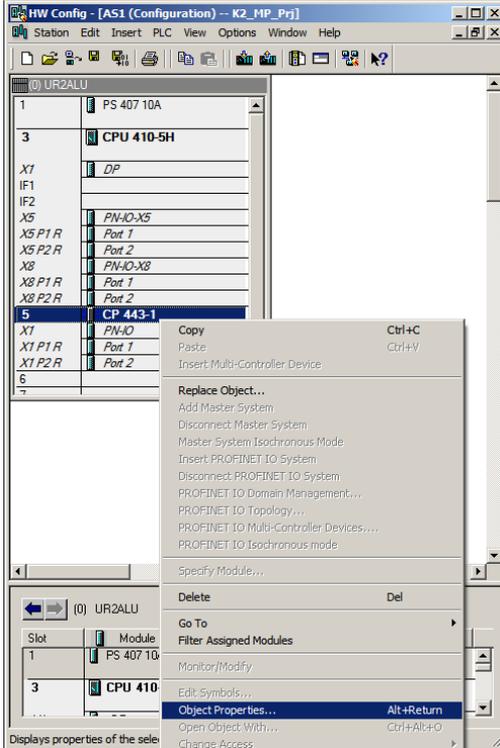
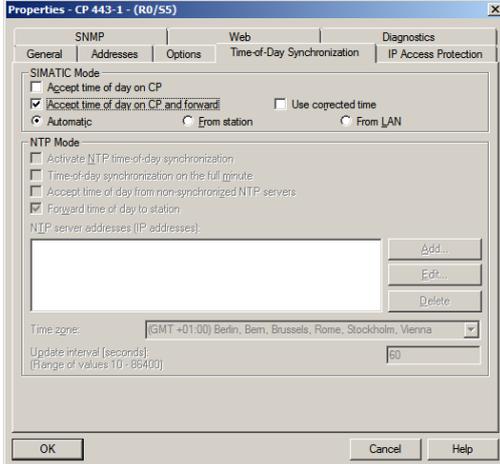
This example describes a way in which the OS server specifies the master time.

Note

More time synchronization options are described in detail in the following manuals:

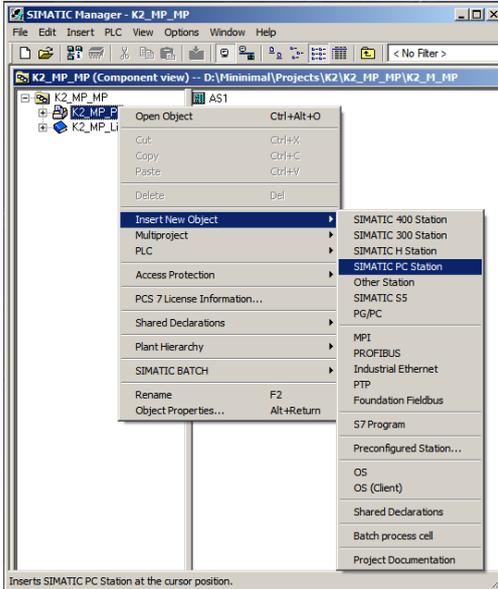
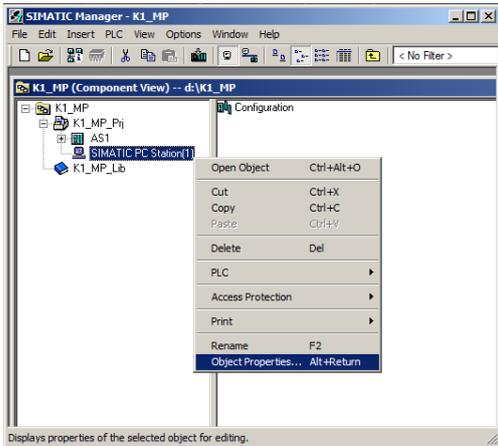
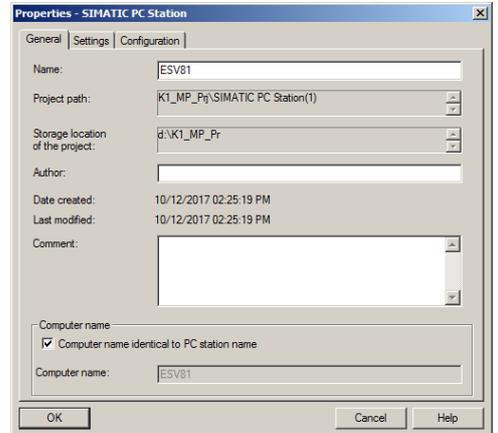
- "SIMATIC PCS 7 Operator Station"
<https://support.industry.siemens.com/cs/ww/en/view/109805404>
- "SIMATIC Process Control System PCS 7 Time Synchronization"
<https://support.industry.siemens.com/cs/ww/en/view/109805436>

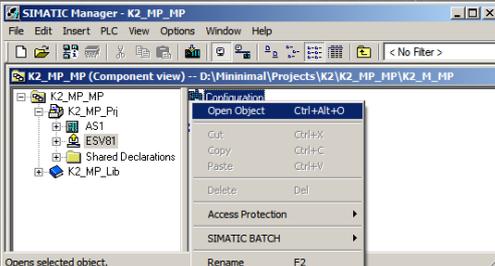
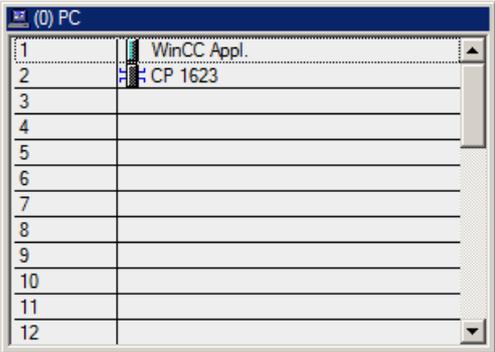
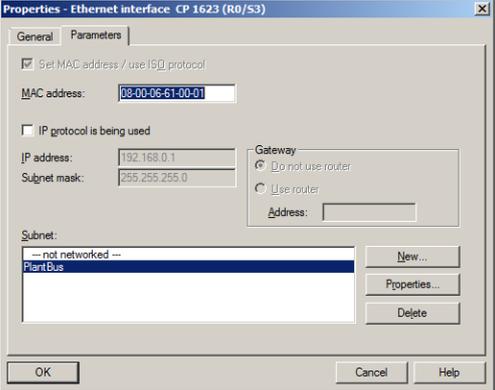
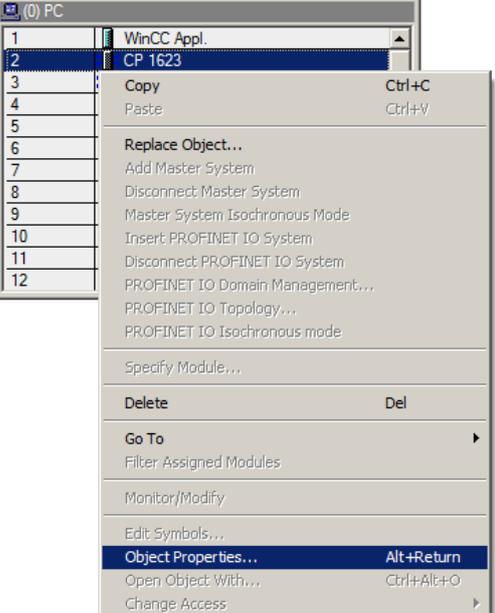
Step	Activity	Screenshot
1.	Open the HW Config for the AS. Highlight the CPU and choose "Object properties..." in the shortcut menu.	
2.	Switch to the "Diagnostics/Clock" tab. In the "Clock" section, set "As slave" for the AS under "Synchronization Type". Click on the "OK" button to confirm your selection.	

Step	Activity	Screenshot
3.	Open the shortcut menu of the CP and select "Object properties...".	 <p>The screenshot shows the HW Config interface for a CP 443-1 module. A context menu is open over the module, with 'Object Properties...' selected. The menu includes options like Copy, Paste, Replace Object..., Delete, and Go To. The background shows a rack configuration with slots 1, 3, and 5 containing modules like PS 407 10A and CPU 410-5H.</p>
4.	Switch to the "Time synchronization" tab. Select the "Accept time of day on CP and forward" check box. Click on the "OK" button to confirm the setting.	 <p>The screenshot shows the 'Properties - CP 443-1 - (R0/S5)' dialog box, specifically the 'Time-of-Day Synchronization' tab. Under the 'SIMATIC Mode' section, the 'Accept time of day on CP and forward' checkbox is checked. Other options include 'Automatic', 'From station', and 'From LAN'. The 'NTP Mode' section has several unchecked options. The 'Time zone' is set to '(GMT +01:00) Berlin, Bern, Brussels, Rome, Stockholm, Vienna'. The 'Update interval' is set to 60 seconds.</p>
5.	Save the configuration and compile it using: "Station > Save and Compile...". Close the HW Config.	

Setting up the ES PC station

To be able to test the OS project on the ES, create a PC station for the ES using the WinCC application.

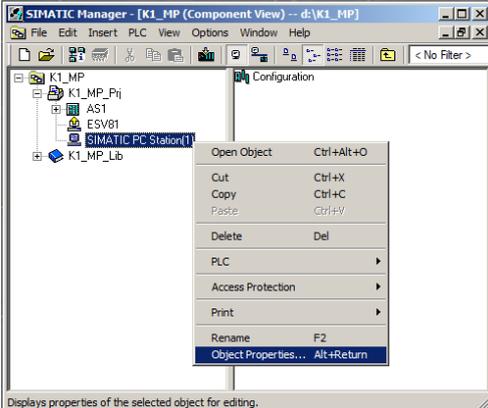
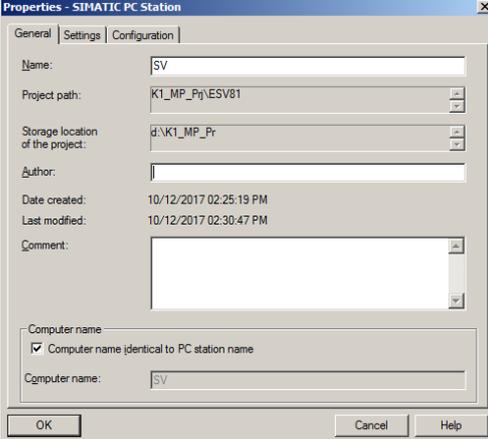
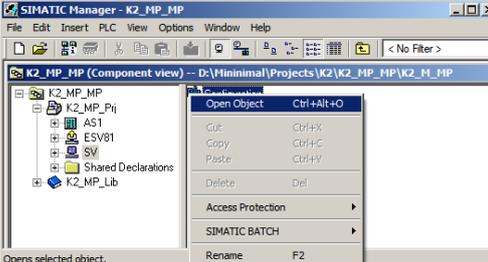
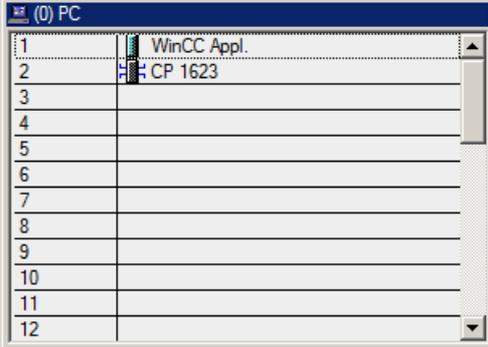
Step	Activity	Screenshot
1.	In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.	 <p>The screenshot shows the SIMATIC Manager interface with a context menu open over a project object. The menu path 'Insert New Object > SIMATIC PC Station' is highlighted. Other options include SIMATIC 400 Station, SIMATIC 300 Station, SIMATIC H Station, SIMATIC S5, PG/PC, MPI, PROFIBUS, Industrial Ethernet, PTP, Foundation Fieldbus, S7 Program, Preconfigured Station..., OS (Client), Shared Declarations, Batch process cell, and Project Documentation.</p>
2.	Use the shortcut menu to open the object properties of the PC station.	 <p>The screenshot shows the SIMATIC Manager interface with the context menu open over the 'SIMATIC PC Station(1)' object. The 'Object Properties...' option is highlighted, indicating that the properties dialog is about to be opened.</p>
3.	Change the name of the ES PC station to match the name of the local computer on the network. Select the "Computer name identical to PC station name" checkbox.	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box. The 'Name' field contains 'ESV81'. The 'Project path' is 'K1_MP_Prj\SIMATIC PC Station(1)'. The 'Storage location of the project' is 'd:\K1_MP_Pr'. The 'Computer name' section has the checkbox 'Computer name identical to PC station name' checked, and the 'Computer name' field also contains 'ESV81'.</p>

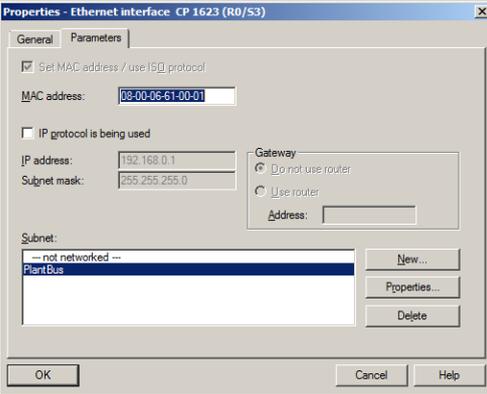
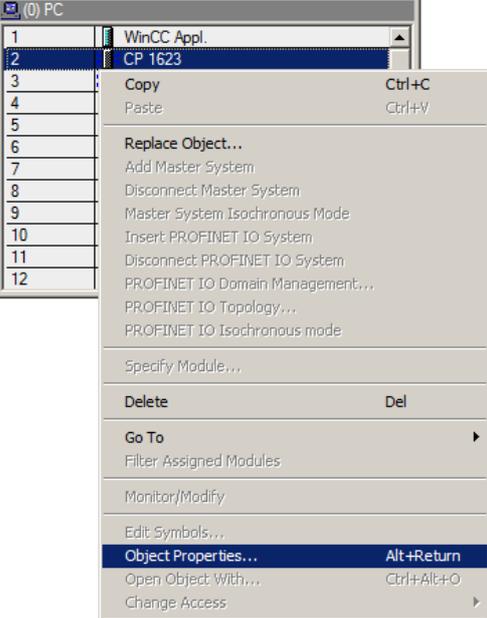
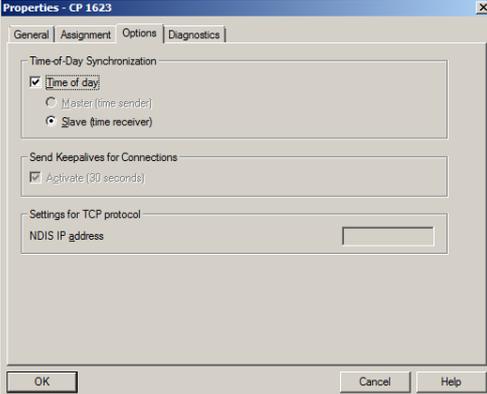
Step	Activity	Screenshot
4.	Open the HW Config of the PC station via the shortcut menu.	 <p>The screenshot shows the SIMATIC Manager interface with the 'Component view' of a project. A context menu is open over the 'K2_MP_MP' component, with the 'Open Object' option selected. The menu includes options like Cut, Copy, Paste, Delete, and Rename.</p>
5.	Insert a "WinCC application" (and a network card) of type "CP1623" from the object catalog (View > Catalog).	 <p>The screenshot shows the HW Config PC rack. The first slot contains a 'WinCC Appl.' module, and the second slot contains a 'CP 1623' module. Slots 3 through 12 are empty.</p>
6.	<p>Under "Subnet", choose the plant bus or create it by clicking on the "New..." button. Assign the corresponding MAC address to the CP1623.</p> <p>Deselect the "IP protocol is being used" checkbox.</p> <p>Click on the "OK" button to confirm your settings.</p>	 <p>The screenshot shows the 'Properties - Ethernet interface CP 1623 (R0/S3)' dialog box. The 'Parameters' tab is active. The 'MAC address' is set to '08-00-06-51-00-01'. The 'IP protocol is being used' checkbox is unchecked. The 'Subnet' dropdown is set to 'Plant Bus'. The 'OK' button is highlighted.</p>
7.	Open the shortcut menu of the CP1623 and select "Object properties...".	 <p>The screenshot shows the HW Config PC rack with the context menu open over the 'CP 1623' module. The 'Object Properties...' option is highlighted in blue. Other options include Copy, Paste, Replace Object..., Delete, and Go To.</p>

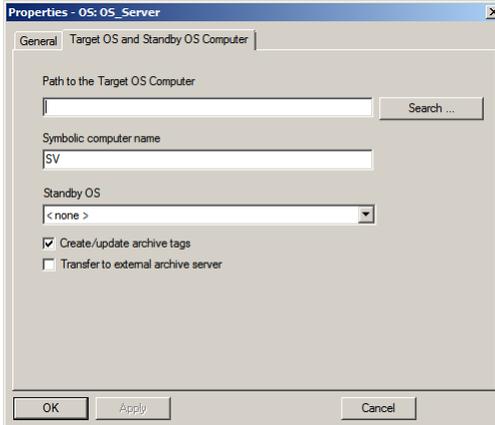
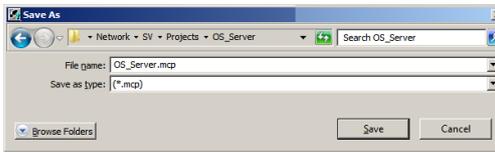
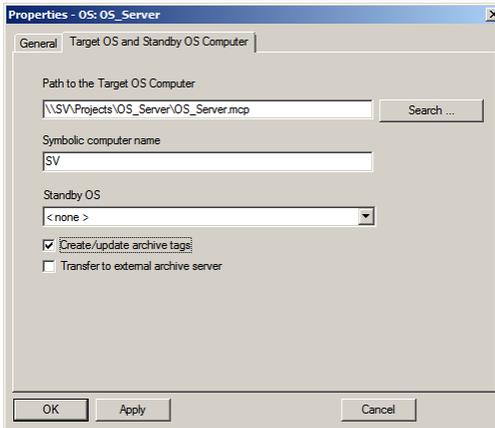
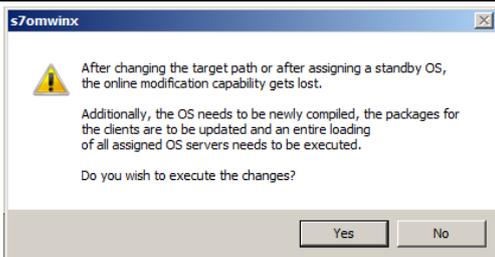
Step	Activity	Screenshot
8. Optionally	<p>Switch to the "Options" tab and select the "Time of day" checkbox.</p> <p>Click on the "OK" button to confirm your selection</p> <p>NOTE</p> <p>You do not need to activate Time of day of the CP 1623 for an ES/OS client combination, since time synchronization of the OS client is configured via the terminal bus.</p>	
9.	<p>Save and compile using the "Station > Save and compile..." menu item.</p> <p>Close the HW Config.</p>	
10. Optionally	<p>In SIMATIC Manager, delete the OS application of the ES PC station, since it is not needed in our example.</p>	

Setting up the OS server PC station

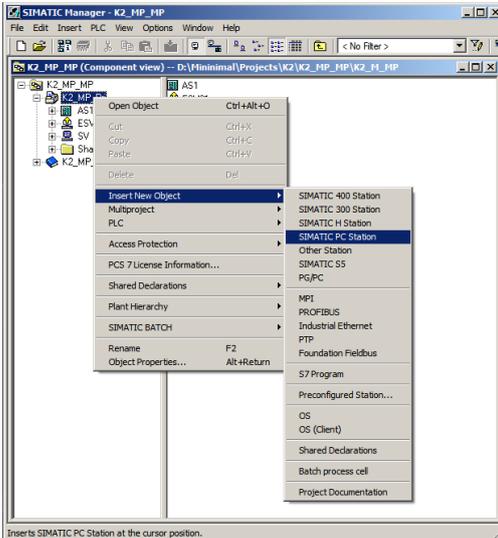
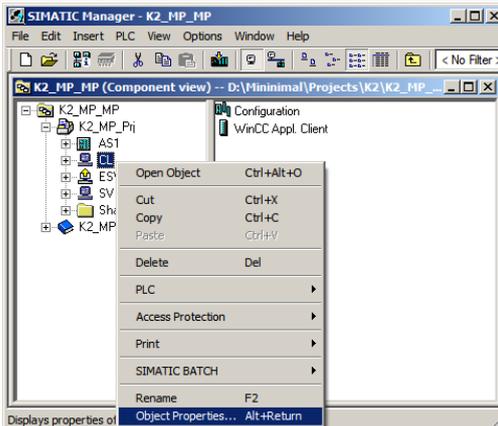
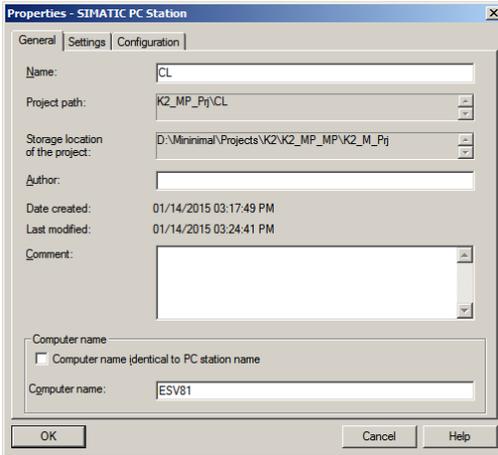
Step	Activity	Screenshot
1.	<p>In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.</p>	

Step	Activity	Screenshot
2.	Use the shortcut menu to open the object properties of the PC station.	 <p>The screenshot shows the SIMATIC Manager interface with a project tree on the left. The 'SIMATIC PC Station(1)' object is selected, and a context menu is open over it. The 'Object Properties...' option is highlighted in blue. The status bar at the bottom indicates 'Displays properties of the selected object for editing.'</p>
3.	<p>Change the name of the OS server PC station to match the name of the computer on the network.</p> <p>Select the "Computer name identical to PC station name" checkbox.</p>	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box. The 'General' tab is active. The 'Name' field contains 'SV'. The 'Computer name' section at the bottom has the checkbox 'Computer name identical to PC station name' checked. The 'Computer name' field also contains 'SV'. Buttons for 'OK', 'Cancel', and 'Help' are visible at the bottom.</p>
4.	Open the HW Config of the PC station via the shortcut menu.	 <p>The screenshot shows the SIMATIC Manager interface with a project tree. The 'SIMATIC PC Station' object is selected, and a context menu is open. The 'SIMATIC BATCH' and 'Rename' options are visible in the menu. The status bar at the bottom indicates 'Opens selected object.'</p>
5.	From the object catalog ("View > Catalog"), insert a "WinCC application" and a network card of type "CP1623".	 <p>The screenshot shows the 'WinCC Appl.' object catalog. The 'CP 1623' object is selected and highlighted in blue. The catalog lists 12 slots, with 'WinCC Appl.' in slot 1 and 'CP 1623' in slot 2.</p>

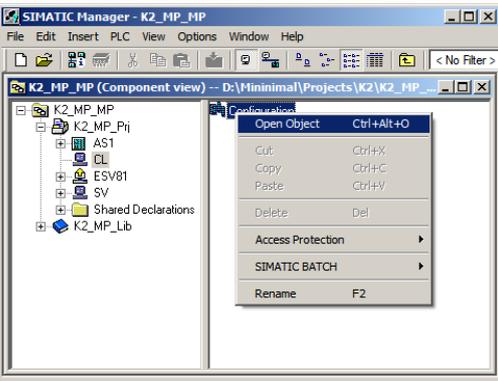
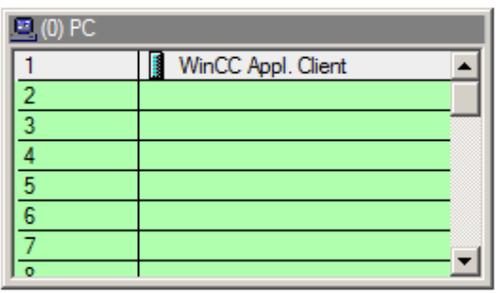
Step	Activity	Screenshot
6.	<p>Under "Subnet", choose the plant bus or create it by clicking on the "New..." button. Assign the corresponding MAC address to the CP1623.</p> <p>Deselect the "IP protocol is being used" checkbox.</p> <p>Click on the "OK" button to confirm your settings.</p>	
7.	<p>Open the shortcut menu of the CP1623 and select "Object properties..."</p>	
8.	<p>Switch to the "Options" tab and select the "Time of day" checkbox.</p> <p>Click on the "OK" button to confirm the setting.</p>	
9.	<p>Save and compile using the "Station > Save and compile..." menu item.</p> <p>Close the HW Config.</p>	

Step	Activity	Screenshot
10.	<p>In SIMATIC Manager, open the properties dialog of the OS server's OS project. Switch to the "Target OS and Standby OS Computer" tab. Under "Standby OS", choose <none>. Then, click on the "Search..." button.</p>	
11.	<p>Use the drop-down list to navigate to the shared project folder of the OS server (see 4.3.1 Preparatory activities). Click on the "Save" button.</p>	
12.	<p>In the input field, check the "Path to the Target OS Computer". Clear the "Transfer to external archive server" checkbox if you are not using a Process Historian. Click on the "OK" button to confirm this.</p>	
13.	<p>Click on the "Yes" button to confirm the information dialog.</p>	

Setting up the Client PC station

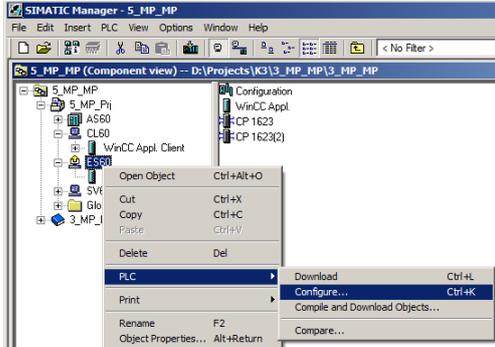
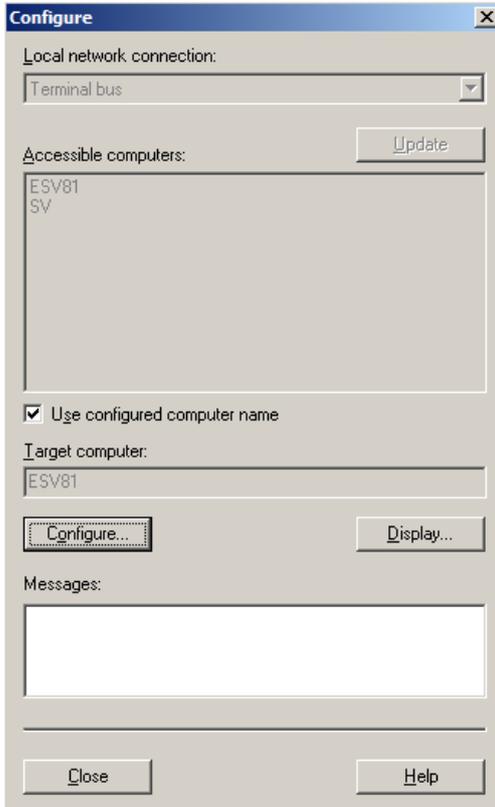
Step	Activity	Screenshot
1.	In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.	 <p>The screenshot shows the SIMATIC Manager interface with a context menu open over a project object. The menu path is: Insert New Object > SIMATIC PC Station. Other options in the submenu include SIMATIC 400 Station, SIMATIC 300 Station, SIMATIC H Station, Other Station, SIMATIC S5, PG/PC, MPI, PROFIBUS, Industrial Ethernet, PTP, Foundation Fieldbus, S7 Program, Preconfigured Station..., OS, OS (Client), Shared Declarations, Batch process cell, and Project Documentation.</p>
2.	Use the shortcut menu to open the object properties of the PC station.	 <p>The screenshot shows the SIMATIC Manager interface with the context menu open over the newly added PC station object. The 'Object Properties...' option is highlighted at the bottom of the menu.</p>
3.	Enter a freely selectable name under "Name". Under "PC name:" enter the name of the PC on which you intend to operate the client. In the present configuration, this is the ES PC. Click on the "OK" button to confirm your entry.	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box with the following fields filled: Name: CL, Project path: K2_MP_Prt\CL, Storage location of the project: D:\Minimal\Projects\K2\K2_MP_MP\K2_M_Prt, Date created: 01/14/2015 03:17:49 PM, Last modified: 01/14/2015 03:24:41 PM, and Computer name: ESV81. The 'Computer name identical to PC station name' checkbox is unchecked.</p>

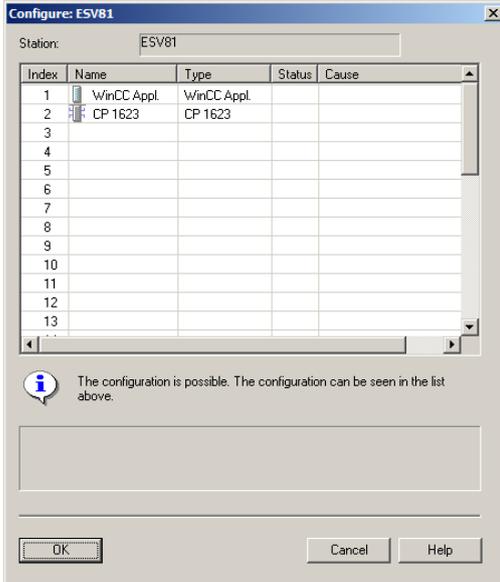
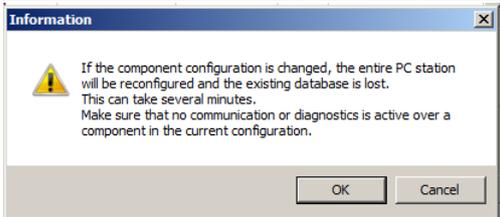
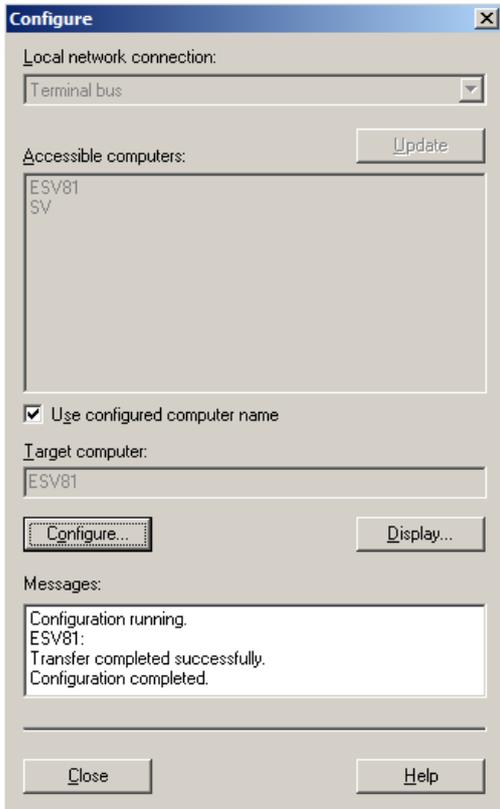
4 ES/OS Client and OS Server

Step	Activity	Screenshot
4.	Open the HW Config of the OS client's PC station.	
5.	From the object catalog (View > Catalog) insert a WinCC application client.	
6.	Save and compile using menu command: "Station > Save and Compile...". Close the HW Config.	

Configuring all of the relevant PC stations

The "Configure PC station" transfers project configurations to one or more target stations. First of all, configure the local Station Configuration Editor of the ES and then the OS connected to the plant bus.

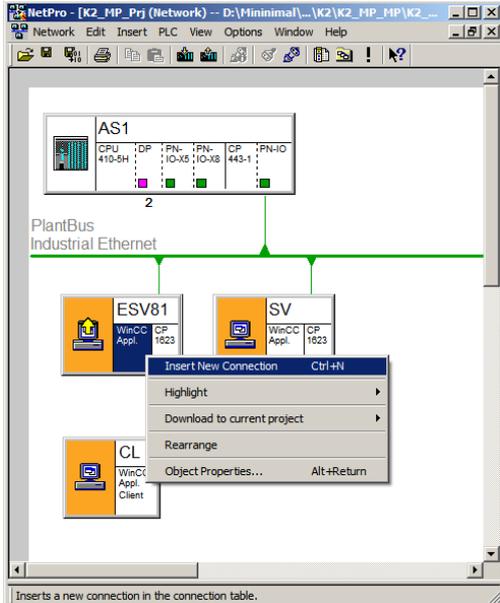
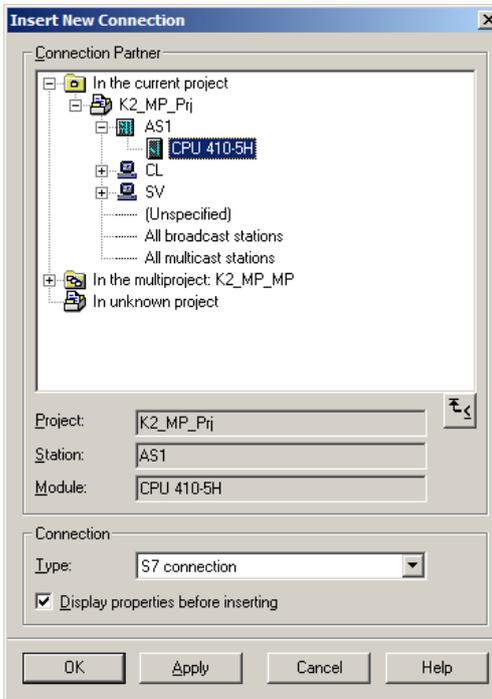
Step	Activity	Screenshot
1.	<p>Configure the Station Configuration Editor of the ES. To do this, open the shortcut menu of the ES and choose "PLC > Configure...".</p>	 <p>The screenshot shows the SIMATIC Manager interface with a context menu open over the 'ES' object in the component view. The 'PLC' menu item is expanded, and 'Configure...' is highlighted. Other options include 'Download', 'Print', 'Rename', and 'Object Properties...'. The background shows a project tree with various components like WinCC Appl, CP 1623, and CP 1623(2).</p>
2.	<p>Under "Accessible computers:" choose the PC that you want to configure.</p> <p>NOTE If you chose the option "PC name identical to PC station name" for the PC station in the "Object properties", the system displays directly in the component configurator the target PC to be configured.</p> <p>Using the "Display..." button, you can show the current configuration of the PC station. Click on the "Configure..." button.</p>	 <p>The screenshot shows the 'Configure' dialog box. The 'Local network connection' is set to 'Terminal bus'. Under 'Accessible computers', a list contains 'ESV81' and 'SV'. The 'Use configured computer name' checkbox is checked. The 'Target computer' field is filled with 'ESV81'. Buttons for 'Configure...', 'Display...', 'Close', and 'Help' are visible.</p>

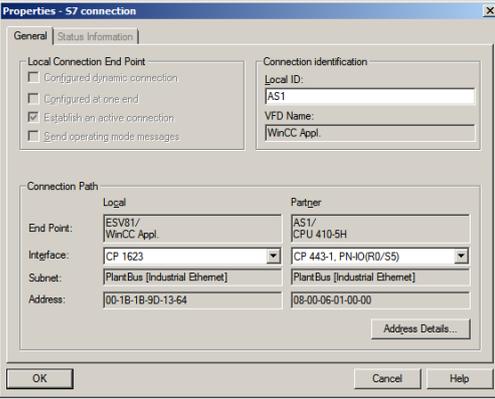
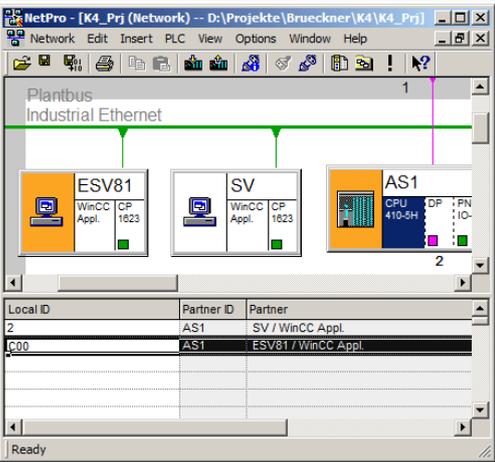
Step	Activity	Screenshot
3.	<p>In the window that appears, you can see how the PC station is configured. Click on the "OK" button to confirm this setting.</p>	
4.	<p>Click on the "OK" button to confirm the information dialog.</p>	
5.	<p>In the bottom window, you then see the message: "Transfer completed successfully." Close the configuration dialog.</p>	
6.	<p>Configure the Station Configuration Editor of the OS server as shown in steps 1 to 5.</p>	

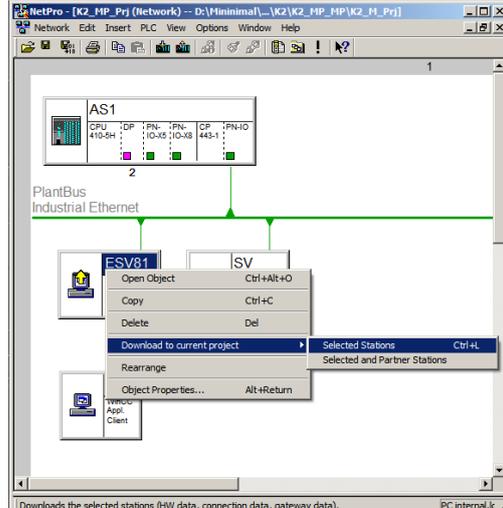
Configuring and loading AS-OS communication

In the following section, the connections between the PC stations and the AS are configured in NetPro and loaded in the individual stations.

Note In the case of a granular station configuration, you must merge the subnets of the individual sub-projects first.

Step	Activity	Screenshot
1.	<p>Open NetPro. Highlight the WinCC application of the ES and open the shortcut menu. Choose "Insert New Connection".</p>	 <p>The screenshot shows the NetPro interface with a network diagram. At the top, AS1 is connected to a PlantBus Industrial Ethernet. Below it, ESV81, SV, and CL are connected. A context menu is open over the ESV81 station, showing options like 'Insert New Connection', 'Highlight', 'Download to current project', 'Rearrange', and 'Object Properties...'. The 'Insert New Connection' option is highlighted.</p>
2.	<p>In the "Connection Partner" window, select the CPU of the AS. Make sure that an "S7 connection" is selected under "Connection". Click on the "OK" button to confirm your selection.</p>	 <p>The screenshot shows the 'Insert New Connection' dialog box. The 'Connection Partner' tree is expanded to show 'CPU 410-5H' selected. Below the tree, the 'Project' is 'K2_MP_Pri', 'Station' is 'AS1', and 'Module' is 'CPU 410-5H'. The 'Connection' section shows 'Type' set to 'S7 connection' and a checked box for 'Display properties before inserting'. Buttons for 'OK', 'Apply', 'Cancel', and 'Help' are at the bottom.</p>

Step	Activity	Screenshot
3.	<p>On the "General" tab under "Connection identification", change the "Local ID:" to a descriptive name like AS1, for example. Click on the "OK" button to confirm your entries.</p>	
4.	<p>Repeat steps 1 to 3 to connect the OS server to the AS. When doing this, it is important that the connections of the ES and the OS server to the AS have the same name.</p>	
5. Optionally	<p>In the connection table of the AS, change the local ID for the connection to the ES to a value of greater than 0xc00.</p> <p>Note A connection ID of greater than 0xc00 prevents the AS from generating messages in later operation due to starting or stopping of OS simulation on the ES.</p>	
6.	<p>Use the ""Network > Save and Compile..." menu item to save the configuration and compile it. Select the "Compile and check everything" option button and click on the "OK" button to confirm your selection.</p>	

Step	Activity	Screenshot
7.	<p>Select the ES and download the connections via the shortcut menu: "Download to current project > Selected Stations".</p> <p>Download the OS server and the AS in the same way.</p> <p>Then, close NetPro.</p>	 <p>The screenshot shows the SIMATIC NetPro interface. At the top, there's a title bar and menu bar. The main area displays a network diagram with a 'PlantBus Industrial Ethernet' backbone. A station 'AS1' is connected to the bus. Below the bus, there are two stations: 'ESV81' and 'SV'. A context menu is open over the 'ESV81' station. The menu items are: 'Open Object' (Ctrl+Alt+O), 'Copy' (Ctrl+C), 'Delete' (Del), 'Download to current project' (which is expanded to show 'Selected Stations' (Ctrl+L) and 'Selected and Partner Stations'), 'Rearrange', and 'Object Properties...' (Alt+Return). At the bottom of the window, a status bar indicates 'Downloads the selected stations (HW data, connection data, gateway data)' and 'PC Internal.k'.</p>

Compiling and loading the user program

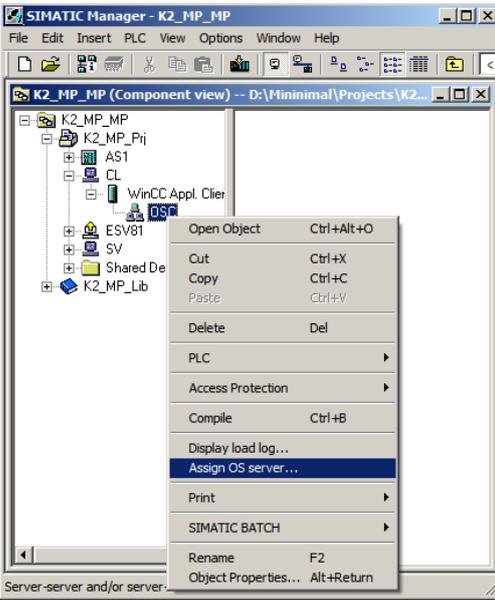
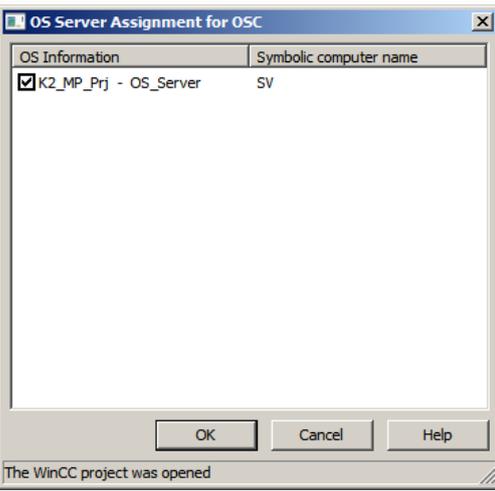
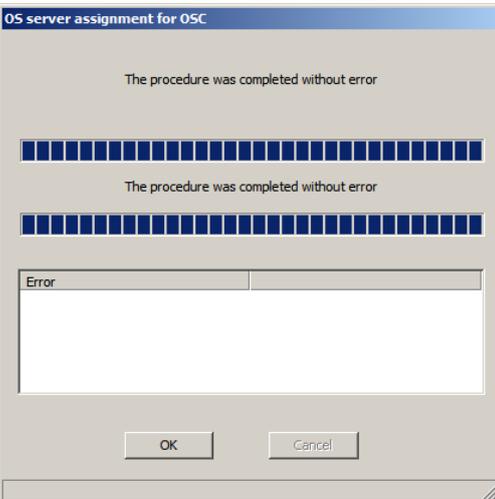
Compile the S7 program and download it to the AS.

Compiling the OS server project

Compile the OS server project in SIMATIC Manager with selected "Generate server data" checkbox.

Make sure that you make the correct OS assignment to the server in plant view.

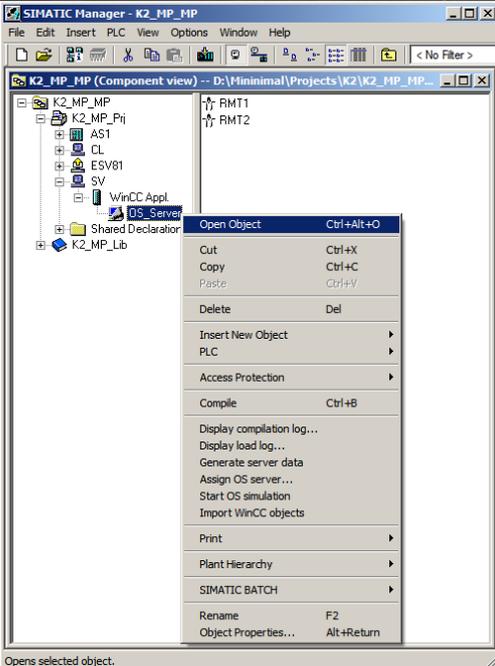
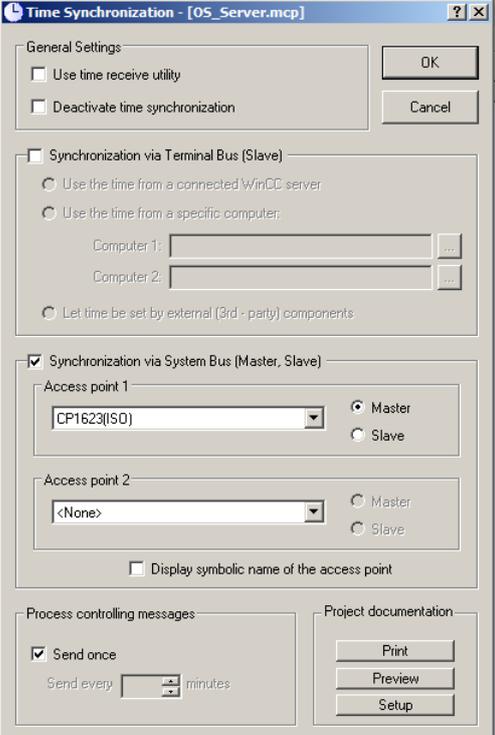
Assigning the server package

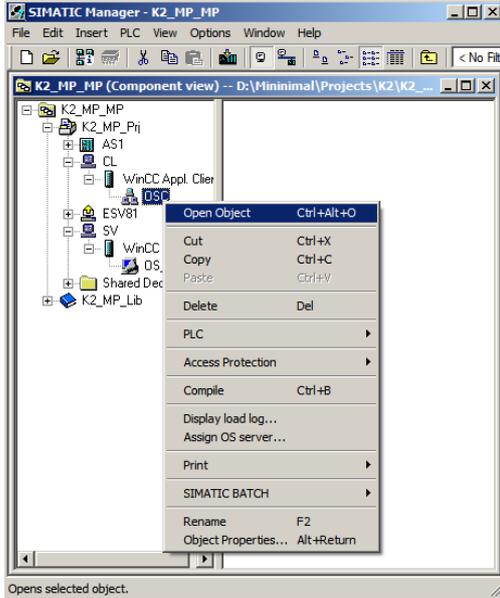
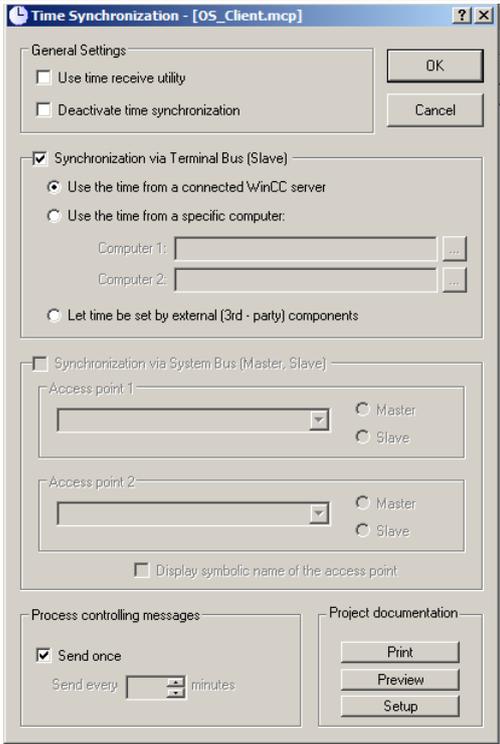
Step	Activity	Screenshot
1.	Highlight the OS application of the OS client and choose "Assign OS server..." in the shortcut menu.	 <p>The screenshot shows the SIMATIC Manager interface with the project tree on the left. The 'OS' application under 'WinCC Appl. Clien' is selected. A context menu is open, and the 'Assign OS server...' option is highlighted. Other menu items include 'Open Object', 'Cut', 'Copy', 'Paste', 'Delete', 'PLC', 'Access Protection', 'Compile', 'Display load log...', 'Print', 'SIMATIC BATCH', 'Rename', and 'Object Properties...'.</p>
2.	Select the corresponding OS project and click on the "OK" button to confirm your selection.	 <p>The screenshot shows the 'OS Server Assignment for OSC' dialog box. It has a table with two columns: 'OS Information' and 'Symbolic computer name'. The entry 'K2_MP_Prj - OS_Server' is selected with a checkmark, and 'SV' is listed in the 'Symbolic computer name' column. There are 'OK', 'Cancel', and 'Help' buttons at the bottom. A status bar at the bottom indicates 'The WinCC project was opened'.</p>
3.	Click on the "OK" button to confirm that the package was loaded successfully.	 <p>The screenshot shows a dialog box titled 'OS server assignment for OSC'. It contains two lines of text, each followed by a progress bar: 'The procedure was completed without error'. There is an 'Error' field at the bottom, which is currently empty. 'OK' and 'Cancel' buttons are at the bottom.</p>

4.3.3 OS configuration

Activating time synchronization

On the ES, the necessary settings are activated in the OS projects of the OS server and the OS client.

Step	Activity	Screenshot
1.	Open the OS server project.	 <p>The screenshot shows the SIMATIC Manager interface. The project tree on the left includes 'K2_MP_MP', 'K2_MP_Prt', 'AS1', 'CL', 'ESV81', 'SV', 'WinCC Appl.', 'OS_Server', 'Shared Declaration', and 'K2_MP_Lib'. The 'OS_Server' object is selected, and a context menu is displayed with options like 'Open Object', 'Cut', 'Copy', 'Paste', 'Delete', 'Insert New Object', 'PLC', 'Access Protection', 'Compile', 'Display compilation log...', 'Display load log...', 'Generate server data', 'Assign OS server...', 'Start OS simulation', 'Import WinCC objects', 'Print', 'Plant Hierarchy', 'SIMATIC BATCH', 'Rename', and 'Object Properties...'. The status bar at the bottom indicates 'Opens selected object.'</p>
2.	<p>Open the "Time Synchronization" editor from the shortcut menu.</p> <p>Select the "Synchronization via System Bus (Master, Slave)" checkbox.</p> <p>Under "Access point 1", choose "CP1623(ISO)" and select the "Master" radio button.</p> <p>Click on the "OK" button to confirm your selection.</p> <p>NOTE If you configure station time synchronization on a different computer, the access points are not known, which means that they are not available in the drop-down list. To choose the access point regardless, select the "Display symbolic name of the access point" checkbox and then choose the appropriate access point.</p>	 <p>The screenshot shows the 'Time Synchronization - [OS_Server.mcp]' dialog box. It has several sections: <ul style="list-style-type: none"> General Settings: 'Use time receive utility' and 'Deactivate time synchronization' are unchecked. 'OK' and 'Cancel' buttons are present. Synchronization via Terminal Bus (Slave): This section is unchecked. It includes options for 'Use the time from a connected WinCC server' and 'Use the time from a specific computer' (with fields for 'Computer 1' and 'Computer 2'). Synchronization via System Bus (Master, Slave): This section is checked. Under 'Access point 1', 'CP1623(ISO)' is selected in the dropdown, and the 'Master' radio button is selected. Under 'Access point 2', '<None>' is selected. The 'Display symbolic name of the access point' checkbox is unchecked. Process controlling messages: 'Send once' is checked, and 'Send every' is set to a few minutes. Project documentation: 'Print', 'Preview', and 'Setup' buttons are available. </p>
3.	Close the OS server project.	

Step	Activity	Screenshot
4.	Open the OS client project.	 <p>The screenshot shows the SIMATIC Manager interface with the project tree on the left. A context menu is open over the 'OS' folder, listing options such as 'Open Object', 'Cut', 'Copy', 'Paste', 'Delete', 'PLC', 'Access Protection', 'Compile', 'Display load log...', 'Assign OS server...', 'Print', 'SIMATIC BATCH', 'Rename', and 'Object Properties...'. The 'Open Object' option is highlighted.</p>
5.	<p>Open the "Time Synchronization" editor from the shortcut menu.</p> <p>Select the "Synchronization via Terminal Bus (Slave)" checkbox and choose "Use the time from a connected WinCC server".</p> <p>Click on the "OK" button to confirm your selection.</p>	 <p>The screenshot shows the 'Time Synchronization - [OS_Client.mcp]' dialog box. The 'Synchronization via Terminal Bus (Slave)' section is selected and checked. Under this section, the radio button 'Use the time from a connected WinCC server' is selected. The 'General Settings' section has 'Use time receive utility' and 'Deactivate time synchronization' unchecked. The 'Process controlling messages' section has 'Send once' checked. The 'Project documentation' section has 'Print', 'Preview', and 'Setup' buttons visible.</p>

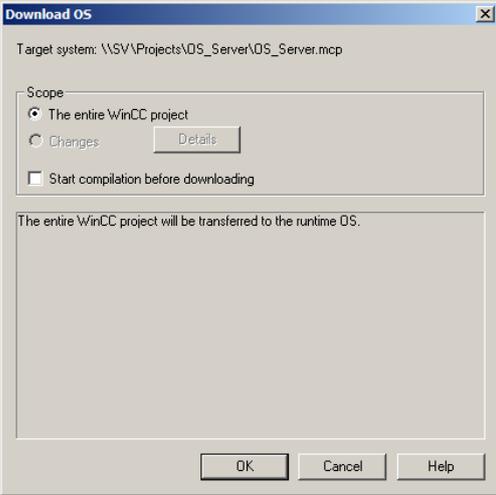
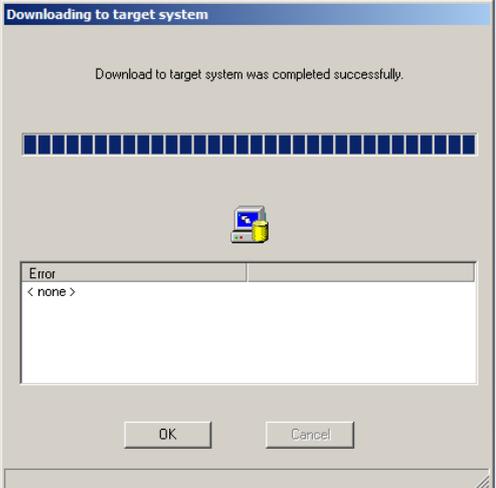
4 ES/OS Client and OS Server

Step	Activity	Screenshot
6.	<p>Select the "Server Data" editor in the WinCC Explorer, and then select the "Standard Server..." command from the shortcut menu.</p> <p>Select the standard server for the components "Alarms" and "SSM" (Split Screen Manager)</p> <p>Click on the "OK" button to confirm your selection.</p>	
7.	Close the OS client project.	

Downloading the OS project to the OS server

After time synchronization is configured on the ES side, download the OS project to the OS server.

Step	Activity	Screenshot
1.	In SIMATIC Manager, highlight the OS project of the OS server and select the "PLC > Download" context menu.	

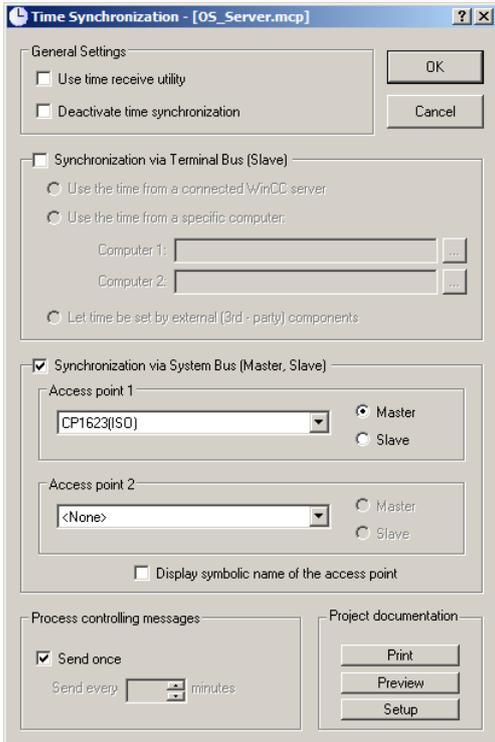
Step	Activity	Screenshot
2.	<p>For the first OS project download, an entire download is required. Click on the "OK" button to start downloading.</p>	
3.	<p>After successful downloading, the OS project is located in the specified folder on the OS server. Click on the "OK" button to confirm the message that is issued.</p>	

OS configuration on the OS server

After the first download, check the step instructions below for time synchronization and correct them if necessary.

Note

Normally, all configuration work is carried out on the ES to ensure consistent data management. This means that no WinCC engineering licenses are needed on the OSes. However, each time WinCC Explorer is opened, a license-free time window of two hours is available for WinCC configuration work.

Step	Activity	Screenshot
1.	Open the OS project on the OS server.	
2.	<p>Open the "Time Synchronization" editor from the shortcut menu.</p> <p>Check or select the "Synchronization via System Bus (Master, Slave)" checkbox.</p> <p>Check or select "CP1623(ISO)" and the "Master" option button under "Access point 1".</p> <p>Click on the "OK" button to confirm your settings.</p>	

4.3.4 Activating runtime

Open the OS project on the OS server and activate runtime.

Then, switch to the ES computer and open the OS client project. Activate runtime there too.

4.3.5 Particularities when loading OS project changes

Loading changes

Before you can carry out OS compiling and downloading to the ES, OS client runtime must be deactivated and the OS project closed.

Complete download

Before you can carry out OS compiling and downloading from the ES, OS client runtime and the OS server must be deactivated and the respective OS projects must be closed.

5 ES, OS Master and OS Standby

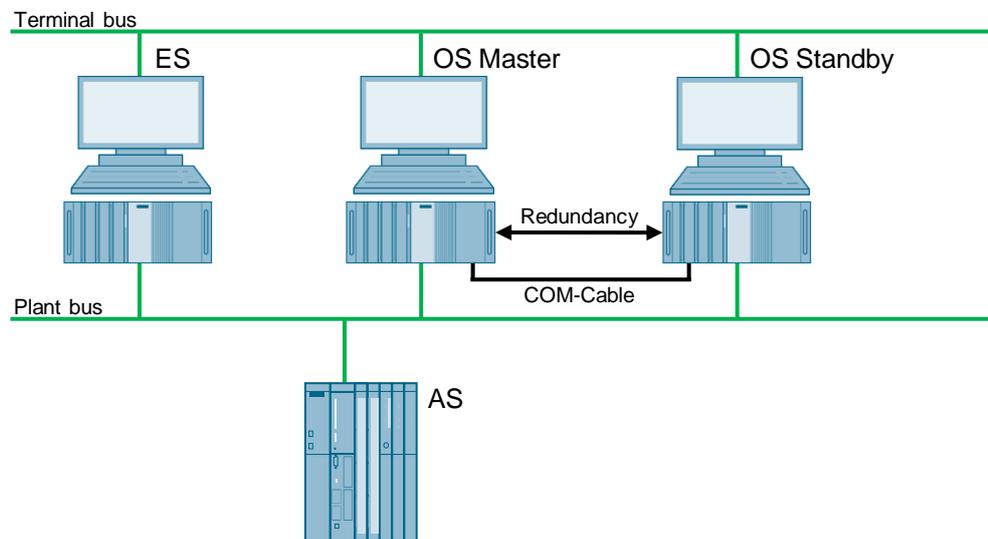
5.1 Configuration description

During process mode, the pair of Single Stations runs completely in-parallel and independently from each other. If one of the Single Stations fails, an equivalent, redundant OS Single Station is always available. The Single Stations monitor each other during runtime and synchronize the project archives as needed.

For synchronization, the OS Single Stations are connected via a redundant cable. You can use a network cable on an additional network adapter or a null modem cable on the COM port as the redundant cable. In the configuration below, a COM cable is used.

Configuration is carried out via the ES.

Hardware configuration

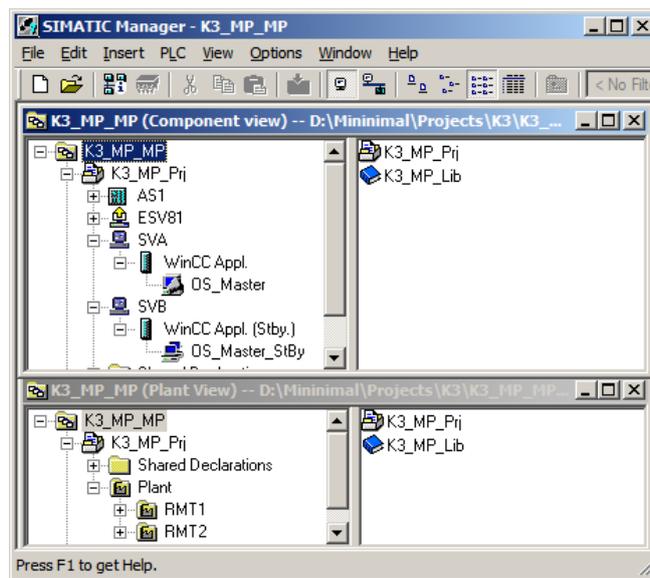


Note

You need server packages for the function of the MS clients. If the OS/MS server is set up as a Single Station, the MS client cannot be used on the ES. The jump keys in the asset faceplate for hardware configuration and for PDM function as follows:

- Up to PDM V8.1: On ES only
- PDM V8.2 and higher: On ES and OS clients
- PDM V9.0 and higher: On ES and OS clients, and web clients

PCS 7 configuration



5.2 Required hardware and software licensing

Hardware

For this configuration, we recommend using the hardware below which you can order via the Siemens mall. This means that the appropriate number of selected operating systems and SIMATIC PCS 7 system software packages are pre-installed on the PC stations.

Station	Product designation	Operating system	Plant bus transition
1 x ES	SIMATIC PCS 7 ES/OS IPC847E BCE	Windows 10	RJ45 Network card
	SIMATIC PCS 7 ES/OS IPC847E IE	Windows 10	CP 1623
2 x OS Single Station	SIMATIC PCS 7 ES/OS IPC847E BCE	Windows 10	RJ45 Network card
	SIMATIC PCS 7 ES/OS IPC847E IE	Windows 10	CP 1623

Software licensing

The following section lists the software/license packages that you need for the selected configuration.

Component	Software/license packages
ES	<ul style="list-style-type: none"> SIMATIC PCS 7 AS/OS Engineering Software (PO unlimited) SIMATIC PCS 7 AS Runtime License
OS Single Station Redundant	<ul style="list-style-type: none"> SIMATIC PCS 7 OS Software Single Station Redundancy (Single License for 2 installations) 2 x SIMATIC PCS 7 OS Runtime License (max. of 8,500 POs)

5.3 Step-by-step configuration

Note

The following instructions have been drawn up based on Windows 7 and PCS 7 V9.0.

CP1623 are used as an example of the plant bus transition. Time synchronization is activated.

The PC stations used in the test setup are called:

- ES: ESV81
- OS server: SVA
- OS server standby: SVB

5.3.1 Preparatory activities

Create a project folder on the OS master and the OS standby and share it. This makes it possible to transfer the OS data that is configured on the engineering station to the OS master and the OS standby.

5.3.2 ES configuration

Creating the multiproject

As the basis for the instructions below, all of the PC stations must be physically networked as shown in the illustration in chapter 5.1. Apart from this, you must create a multiproject on the ES in which the hardware and software of the AS are already configured.

Then, you start with the following CPU and CP settings.

AS settings

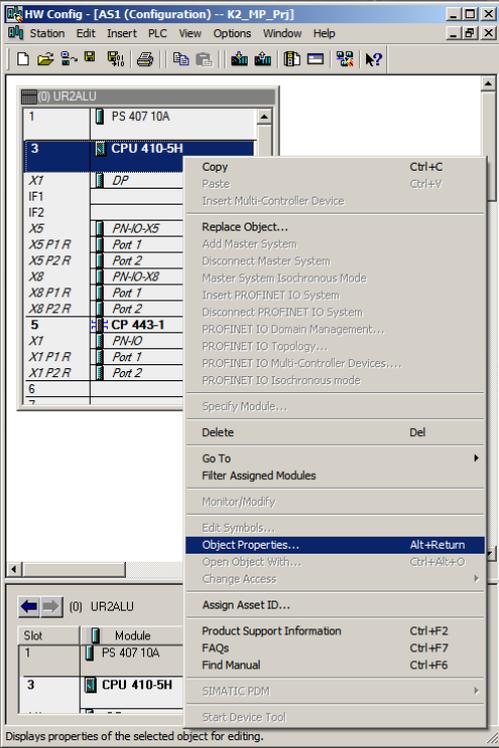
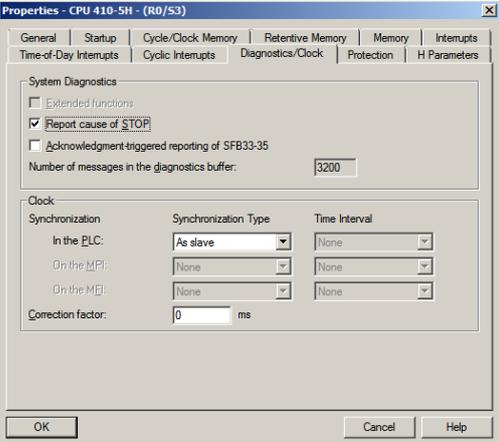
The analyzability of the process data requires that all of the components of the process control system work with an identical clock time to be able to assign messages in the correct time sequence.

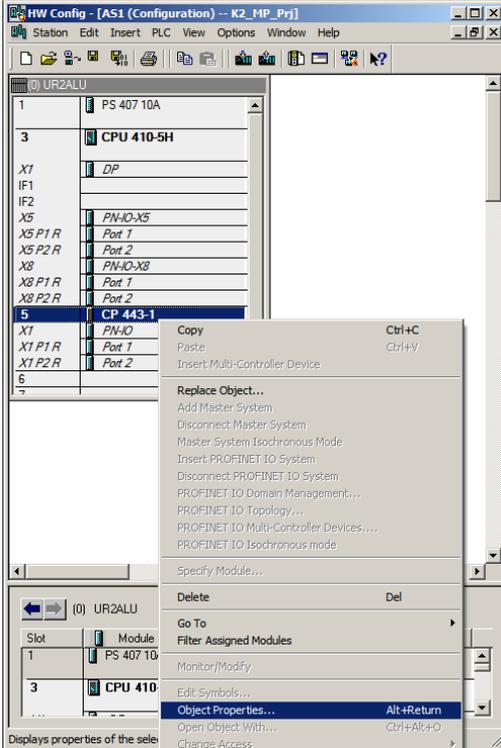
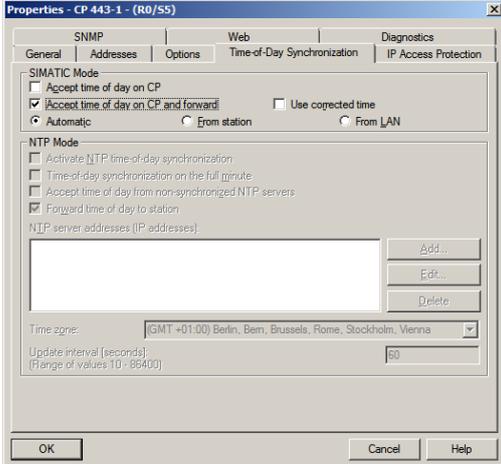
The following section describes a way in which the redundant OS Single Stations specify the master time.

Note

More time synchronization options are described in detail in the following manuals:

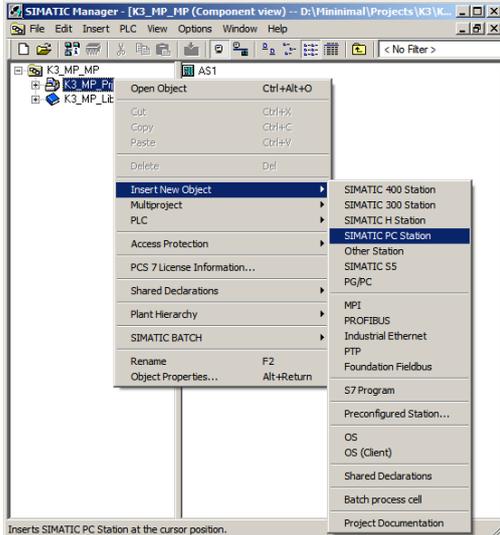
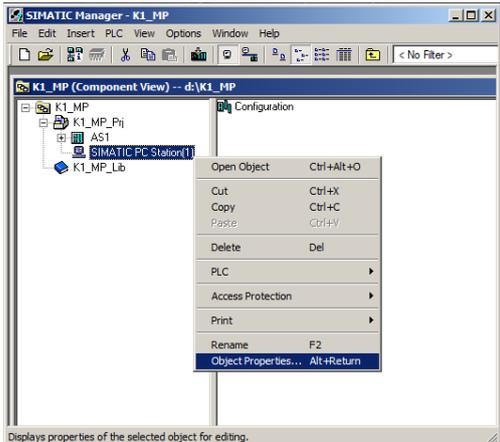
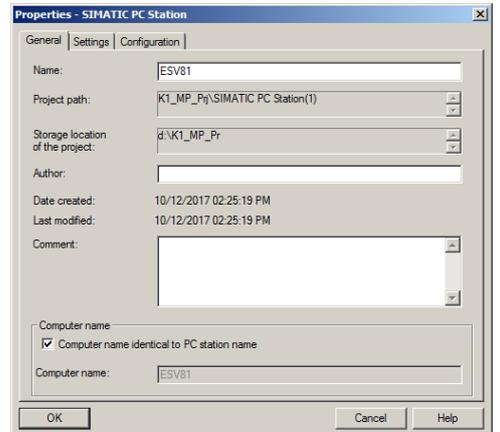
- "SIMATIC PCS 7 Operator Station"
<https://support.industry.siemens.com/cs/ww/en/view/109805404>
- "SIMATIC Process Control System PCS 7 Time Synchronization"
<https://support.industry.siemens.com/cs/ww/en/view/109805436>

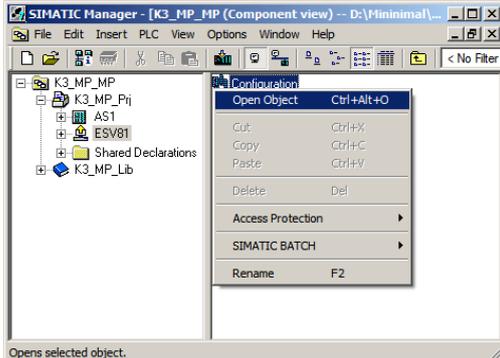
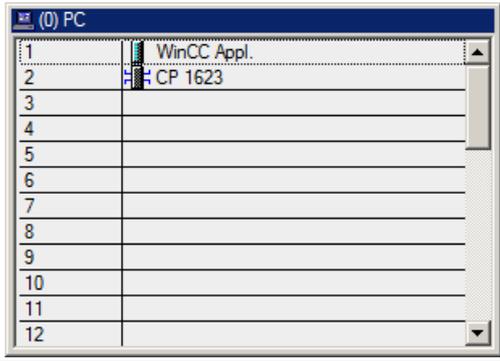
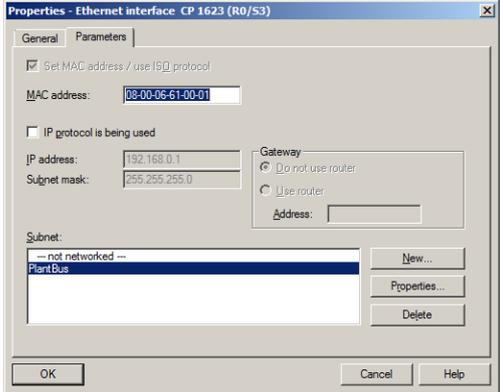
Step	Activity	Screenshot
<p>1.</p>	<p>Open the HW Config for the AS. Highlight the CPU and choose "Object properties..." in the shortcut menu.</p>	 <p>The screenshot shows the HW Config interface for a rack (UR2ALU). The CPU 410-5H is selected in slot 3. A context menu is open over the CPU, with 'Object Properties...' highlighted. The menu includes options like Copy, Paste, Replace Object..., and Delete. The status bar at the bottom of the screenshot reads 'Displays properties of the selected object for editing.'</p>
<p>2.</p>	<p>Switch to the "Diagnostics/Clock" tab. In the "Clock" section, set "Synchronization Type - As slave" for the AS. Click on the "OK" button to confirm your selection.</p>	 <p>The screenshot shows the 'Properties - CPU 410-5H - (R0/S3)' dialog box. The 'Diagnostics/Clock' tab is active. Under the 'Clock' section, the 'Synchronization Type' is set to 'As slave'. Other settings include 'Report cause of STOP' checked and 'Number of messages in the diagnostics buffer' set to 3200. The 'OK' button is visible at the bottom left.</p>

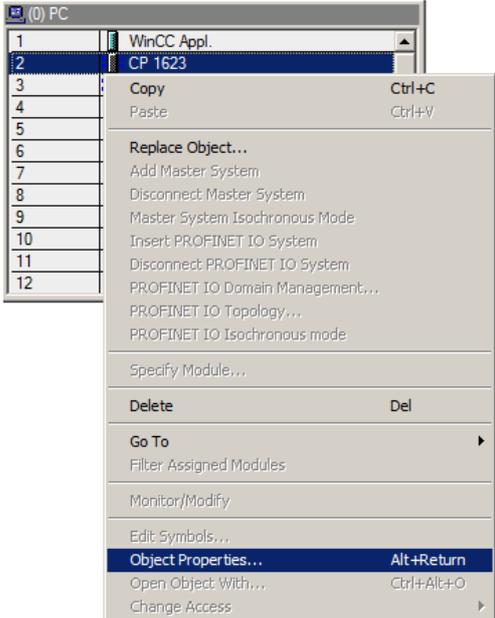
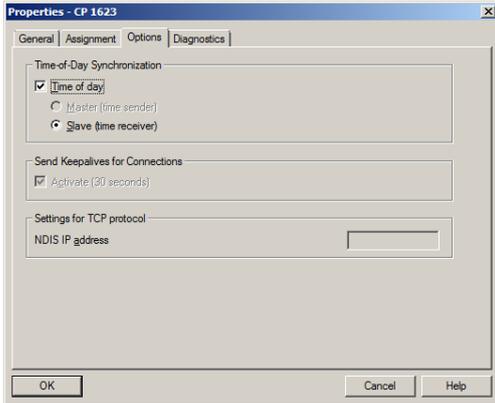
Step	Activity	Screenshot
3.	Open the shortcut menu of the CP and select "Object properties...".	 <p>The screenshot shows the HW Config interface for a CP 443-1 module. A context menu is open over the module, with 'Object Properties...' selected. The menu includes options like Copy, Paste, Replace Object..., Delete, and Go To. The background shows a rack configuration with slots 1 (PS 407 10A) and 3 (CPU 410-5H).</p>
4.	Switch to the "Time synchronization" tab. Select the "Accept time of day on CP and forward" check box. Click on the "OK" button to confirm the setting.	 <p>The screenshot shows the 'Properties - CP 443-1 - (R0/S5)' dialog box, specifically the 'Time-of-Day Synchronization' tab. Under 'SIMATIC Mode', the 'Accept time of day on CP and forward' checkbox is checked. Other options include 'Automatic', 'From station', and 'From LAN'. There are also sections for 'NTP Mode' and 'NTP server addresses'.</p>
5.	Save the configuration and compile it using: "Station > Save and Compile...". Close the HW Config.	

Setting up the ES PC station

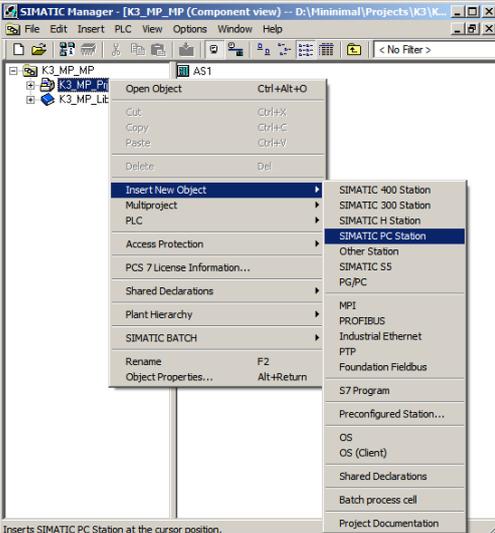
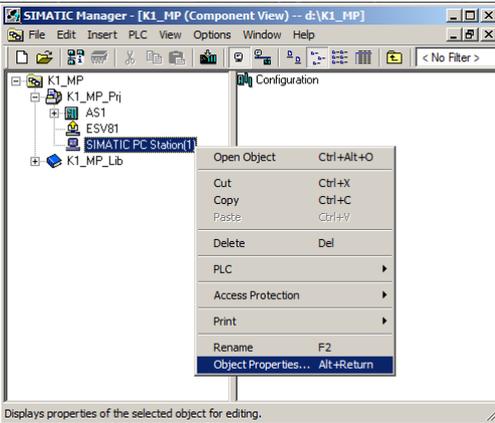
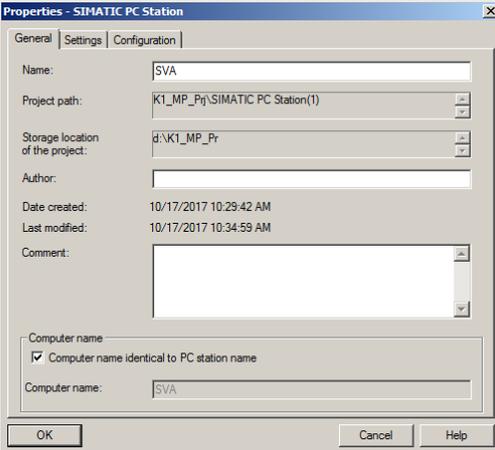
A PC station is created for the ES using the WinCC application to allow testing of the OS project on the ES.

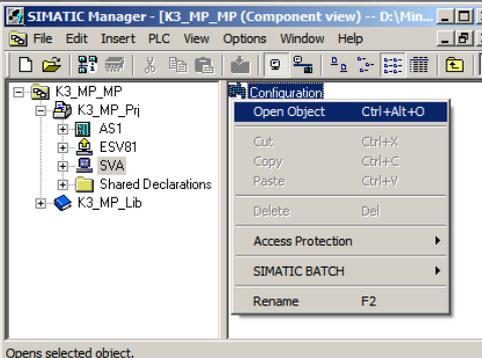
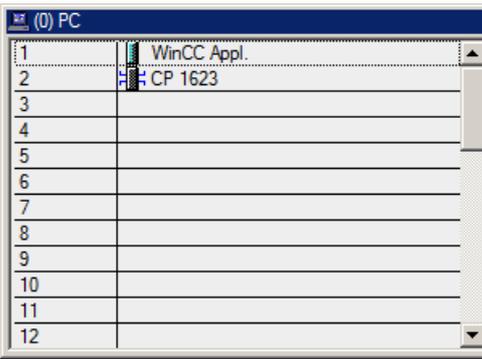
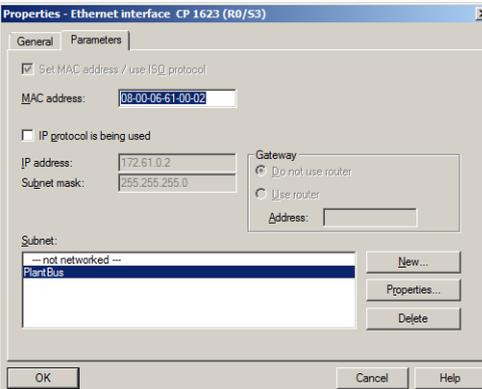
Step	Activity	Screenshot
1.	In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.	 <p>The screenshot shows the SIMATIC Manager interface in component view. A context menu is open over the project tree, with 'Insert New Object' selected. A submenu is displayed, showing 'SIMATIC PC Station' as the selected option. Other options in the submenu include SIMATIC 400 Station, SIMATIC 300 Station, SIMATIC H Station, Other Station, SIMATIC S5, PG/PC, MPI, PROFIBUS, Industrial Ethernet, PTP, Foundation Fieldbus, S7 Program, Preconfigured Station..., OS, OS (Client), Shared Declarations, Batch process cell, and Project Documentation.</p>
2.	Use the shortcut menu to open the object properties of the PC station.	 <p>The screenshot shows the SIMATIC Manager interface with the 'SIMATIC PC Station' object selected in the project tree. A context menu is open, and 'Object Properties...' is highlighted. The status bar at the bottom indicates 'Displays properties of the selected object for editing.'</p>
3.	Change the name of the ES PC station to match the name of the local computer on the network. Select the "Computer name identical to PC station name" checkbox.	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box. The 'General' tab is active. The 'Name' field contains 'ESV81'. The 'Project path' is 'K1_MP_Pj\SIMATIC PC Station(1)'. The 'Storage location of the project' is 'd:\K1_MP_Pr'. The 'Date created' and 'Last modified' are both '10/12/2017 02:25:19 PM'. In the 'Computer name' section, the checkbox 'Computer name identical to PC station name' is checked, and the 'Computer name' field contains 'ESV81'.</p>

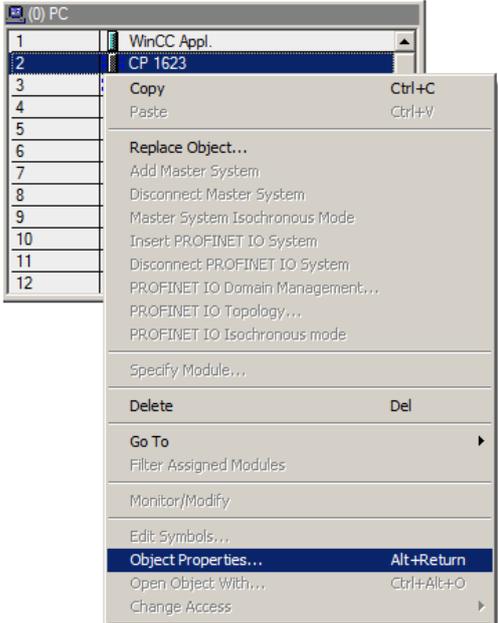
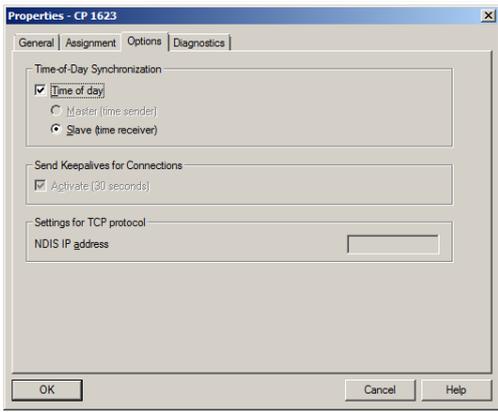
Step	Activity	Screenshot
4.	Open the HW Config of the ES PC station via the shortcut menu.	 <p>The screenshot shows the SIMATIC Manager interface. A tree view on the left displays the project structure: K3_MP_MP, K3_MP_Pri, AS1, ESW81, Shared Declarations, and K3_MP_Lib. A context menu is open over the 'K3_MP_MP' node, listing options: Open Object (Ctrl+Alt+O), Cut (Ctrl+X), Copy (Ctrl+C), Paste (Ctrl+V), Delete (Del), Access Protection, SIMATIC BATCH, and Rename (F2). The 'Open Object' option is highlighted.</p>
5.	Insert a "WinCC application" and a network card of type "CP1623" from the object catalog (View > Catalog).	 <p>The screenshot shows the HW Config window for a PC. A rack configuration table is visible with 12 slots. Slot 1 contains 'WinCC Appl.' and slot 2 contains 'CP 1623'. The rest of the slots are empty.</p>
6.	<p>Under "Subnet", choose the plant bus or create it by clicking on the "New..." button. Assign the corresponding MAC address to the CP1623.</p> <p>Deselect the "IP protocol is being used" checkbox.</p> <p>Click on the "OK" button to confirm your settings.</p>	 <p>The screenshot shows the 'Properties - Ethernet interface CP 1623 (R0/53)' dialog box. The 'Parameters' tab is active. The 'Get MAC address / use ISO protocol' checkbox is checked, and the MAC address is set to '08-00-06-61-00-01'. The 'IP protocol is being used' checkbox is unchecked. The IP address is '192.168.0.1' and the subnet mask is '255.255.255.0'. The 'Gateway' section has 'Do not use router' selected. The 'Subnet' dropdown menu is open, showing 'Plant Bus' selected. The 'New...' button is visible next to the dropdown.</p>

Step	Activity	Screenshot
7.	Open the shortcut menu of the CP1623 and select "Object properties...".	 <p>The screenshot shows a SIMATIC Manager window with a tree view on the left containing a CP 1623 object. A right-click context menu is open over the CP 1623 object. The menu items include 'Copy', 'Paste', 'Replace Object...', 'Delete', 'Go To', 'Monitor/Modify', 'Edit Symbols...', 'Object Properties...' (highlighted), 'Open Object With...', and 'Change Access'. The 'Object Properties...' option has the keyboard shortcut 'Alt+Return'.</p>
8.	Switch to the "Options" tab and select the "Time of day" checkbox. Click on the "OK" button to confirm your selection.	 <p>The screenshot shows the 'Properties - CP 1623' dialog box with the 'Options' tab selected. Under the 'Time-of-Day Synchronization' section, the 'Time of day' checkbox is checked. Below it, there are radio buttons for 'Master (time sender)' and 'Slave (time receiver)'. There is also a 'Send Keepalives for Connections' section with a checked 'Activate (30 seconds)' checkbox. At the bottom, there is a 'Settings for TCP protocol' section with an 'NDIS IP address' field. 'OK', 'Cancel', and 'Help' buttons are at the bottom.</p>
9.	Save and compile using menu command: "Station > Save and Compile...". Close the HW Config.	
10. Optionally	Delete the OS of the Engineering Station in SIMATIC Manager as it is not needed in our example.	

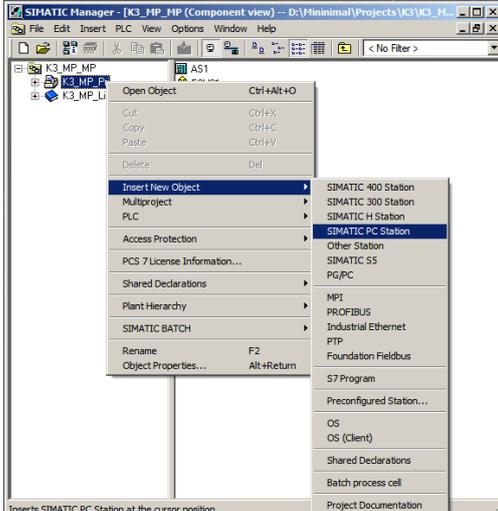
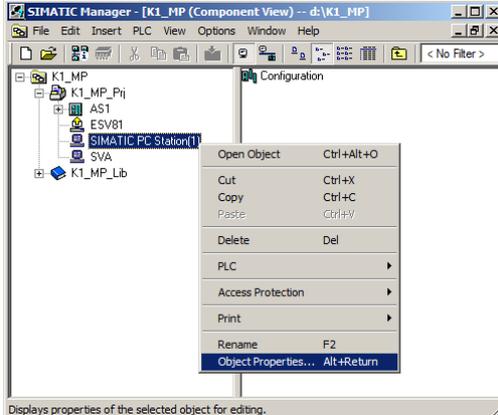
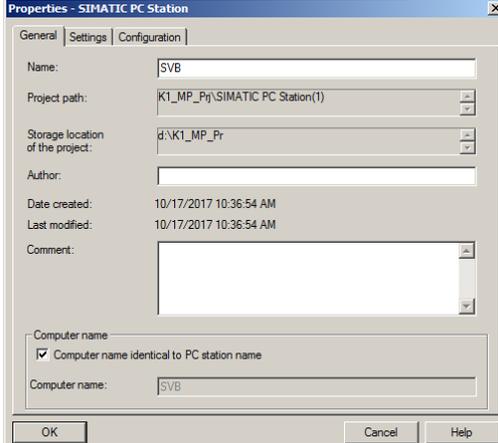
Setting up the Master OS PC station

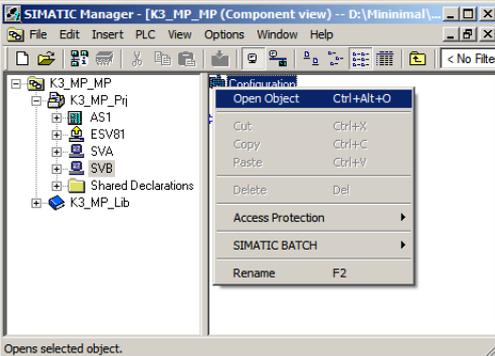
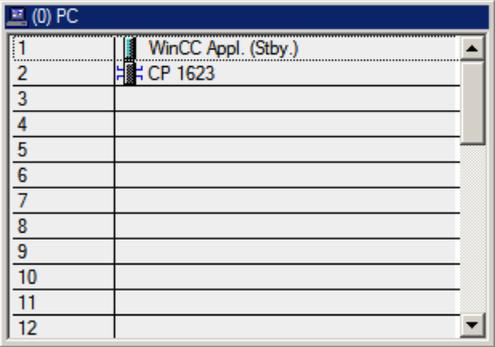
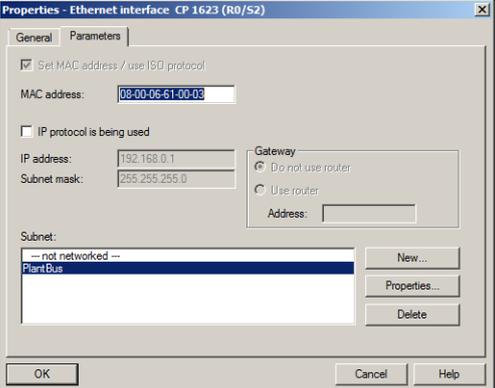
Step	Activity	Screenshot
1.	In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.	 <p>The screenshot shows the SIMATIC Manager interface with a context menu open over the project tree. The menu path is: Insert New Object > SIMATIC PC Station. The 'SIMATIC PC Station' option is highlighted in blue in the submenu.</p>
2.	Use the shortcut menu to open the object properties of the PC station.	 <p>The screenshot shows the SIMATIC Manager interface with a context menu open over the 'SIMATIC PC Station(1)' object in the project tree. The 'Object Properties...' option is highlighted in blue.</p>
3.	Change the name of the OS master PC station to match the name of the computer on the network. Select the "Computer name identical to PC station name" checkbox.	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box. The 'General' tab is active. The 'Name' field contains 'SVA'. The 'Project path' is 'K1_MP_Ph\SIMATIC PC Station(1)'. The 'Storage location of the project' is 'd:\K1_MP_Pr'. The 'Computer name' section has the checkbox 'Computer name identical to PC station name' checked. The 'Computer name' field also contains 'SVA'.</p>

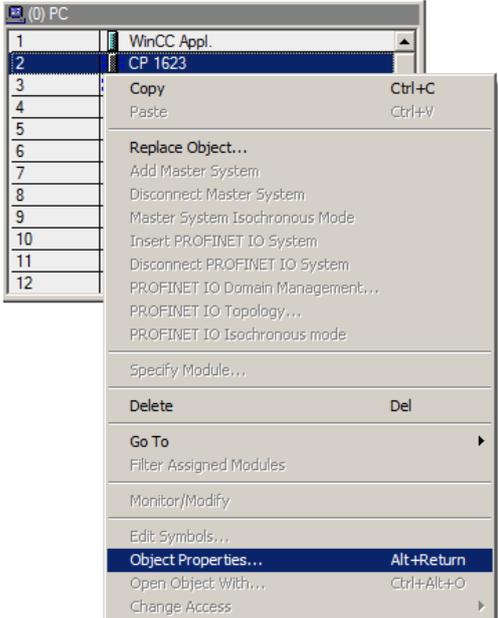
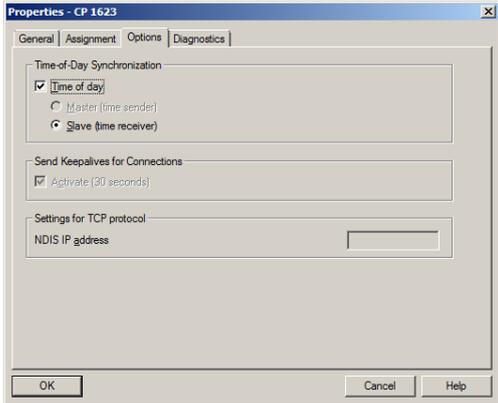
Step	Activity	Screenshot
4.	Open the HW Config of the OS master PC station via the shortcut menu.	
5.	Insert a "WinCC application" and a network card of type "CP1623" from the object catalog (View > Catalog).	
6.	<p>Under "Subnet", choose the plant bus or create it by clicking on the "New..." button. Assign the corresponding MAC address to the CP1623.</p> <p>Deselect the "IP protocol is being used" checkbox.</p> <p>Click on the "OK" button to confirm your settings.</p>	

Step	Activity	Screenshot
7.	Open the shortcut menu of the CP1623 and select "Object properties...".	
8.	Switch to the "Options" tab and select the "Time of day" checkbox. Click on the "OK" button to confirm your selection.	
9.	Save and compile using menu command: "Station > Save and Compile...". Close the HW Config.	

Setting up the OS standby PC station

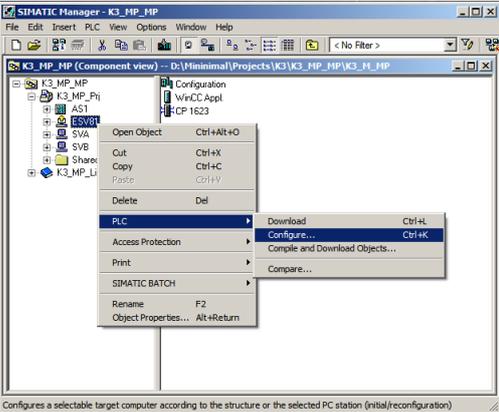
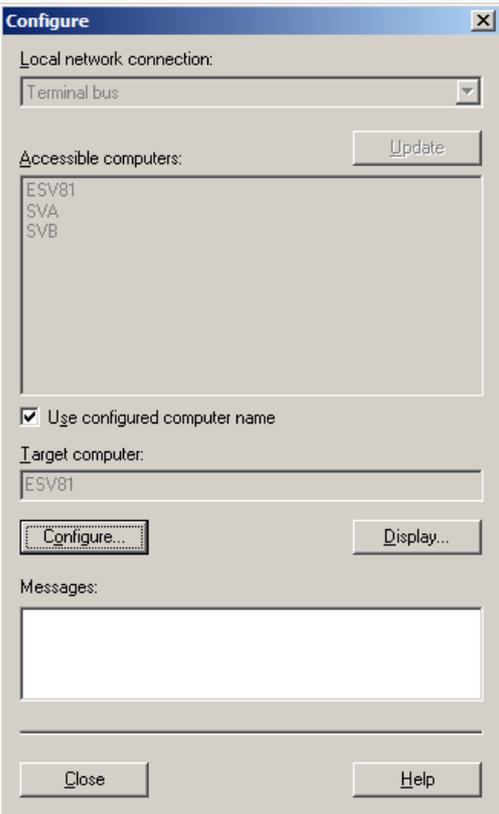
Step	Activity	Screenshot
1.	<p>In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.</p>	 <p>The screenshot shows the SIMATIC Manager interface in component view. A context menu is open over the project tree, with 'Insert New Object' selected. A submenu is displayed, showing various object types, with 'SIMATIC PC Station' highlighted.</p>
2.	<p>Use the shortcut menu to open the object properties of the PC station.</p>	 <p>The screenshot shows the SIMATIC Manager interface with the 'SIMATIC PC Station(1)' object selected in the project tree. A context menu is open, and 'Object Properties...' is highlighted.</p>
3.	<p>Change the name of the OS standby PC station to match the name of the computer on the network. Select the "Computer name identical to PC station name" checkbox.</p>	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box. The 'Configuration' tab is active. The 'Name' field contains 'SVB'. The 'Computer name' section has the checkbox 'Computer name identical to PC station name' checked. The 'Computer name' field also contains 'SVB'.</p>

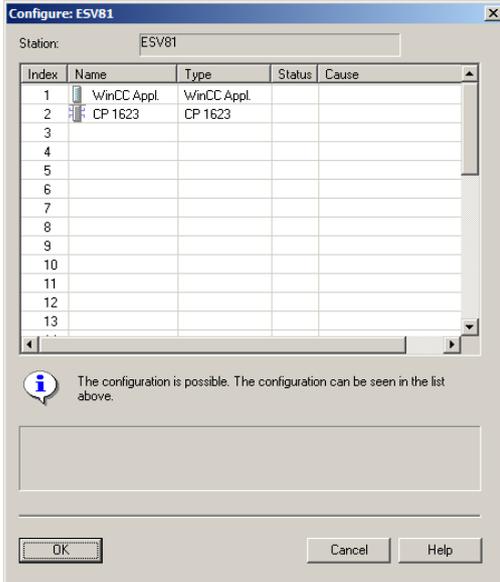
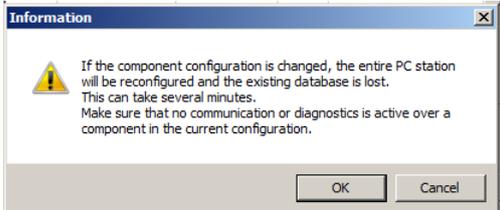
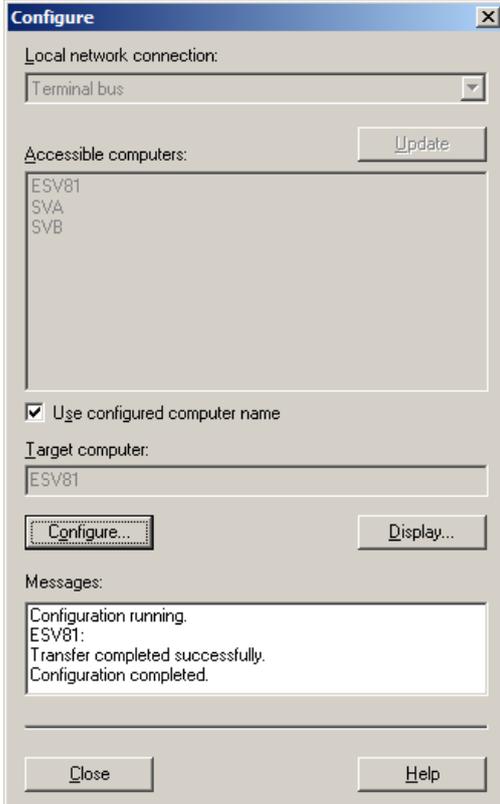
Step	Activity	Screenshot																								
4.	Open the HW Config of the OS standby PC station via the shortcut menu.	 <p>The screenshot shows the SIMATIC Manager interface with the project tree on the left. A context menu is open over the 'K3_MP_MP' project, listing options like 'Open Object', 'Cut', 'Copy', 'Paste', 'Delete', 'Access Protection', 'SIMATIC BATCH', and 'Rename'.</p>																								
5.	From the object catalog (View > Catalog), insert a "WinCC application (Stby)" and a network card of type "CP1623".	 <p>The screenshot shows the HW Config window with a table of objects. The first row is 'WinCC Appl. (Stby)' and the second row is 'CP 1623'.</p> <table border="1" data-bbox="863 638 1358 985"> <tr><td>1</td><td>WinCC Appl. (Stby.)</td></tr> <tr><td>2</td><td>CP 1623</td></tr> <tr><td>3</td><td></td></tr> <tr><td>4</td><td></td></tr> <tr><td>5</td><td></td></tr> <tr><td>6</td><td></td></tr> <tr><td>7</td><td></td></tr> <tr><td>8</td><td></td></tr> <tr><td>9</td><td></td></tr> <tr><td>10</td><td></td></tr> <tr><td>11</td><td></td></tr> <tr><td>12</td><td></td></tr> </table>	1	WinCC Appl. (Stby.)	2	CP 1623	3		4		5		6		7		8		9		10		11		12	
1	WinCC Appl. (Stby.)																									
2	CP 1623																									
3																										
4																										
5																										
6																										
7																										
8																										
9																										
10																										
11																										
12																										
6.	<p>Under "Subnet", choose the plant bus or create it by clicking on the "New..." button.</p> <p>Assign the corresponding MAC address to the CP1623.</p> <p>Deselect the "IP protocol is being used" checkbox.</p> <p>Click on the "OK" button to confirm your settings.</p>	 <p>The screenshot shows the 'Properties - Ethernet interface CP 1623 (R0/S2)' dialog box. The 'Parameters' tab is active. The 'MAC address' is set to '08-00-06-61-00-03'. The 'IP protocol is being used' checkbox is unchecked. The 'Gateway' section has 'Do not use router' selected. The 'Subnet' dropdown is set to 'Plant Bus'.</p>																								

Step	Activity	Screenshot
7.	Open the shortcut menu of the CP1623 and select "Object properties...".	 <p>The screenshot shows a 'WinCC Appl.' window with a tree view containing 'CP 1623'. A right-click context menu is open over 'CP 1623'. The menu items include 'Copy', 'Paste', 'Replace Object...', 'Delete', 'Go To', 'Monitor/Modify', 'Edit Symbols...', 'Object Properties...' (highlighted), 'Open Object With...', and 'Change Access'. Keyboard shortcuts like 'Ctrl+C', 'Ctrl+V', 'Del', 'Alt+Return', and 'Ctrl+Alt+O' are also visible.</p>
8.	Switch to the "Options" tab and select the "Time of day" checkbox. Click on the "OK" button to confirm the setting.	 <p>The screenshot shows the 'Properties - CP 1623' dialog box with the 'Options' tab selected. Under 'Time-of-Day Synchronization', the 'Time of day' checkbox is checked. Below it, there are radio buttons for 'Master (time sender)' and 'Slave (time receiver)'. There is also a section for 'Send Keepalives for Connections' with a checked 'Activate (30 seconds)' checkbox. At the bottom, there is a 'Settings for TCP protocol' section with an 'NDIS IP address' field. 'OK', 'Cancel', and 'Help' buttons are at the bottom.</p>
9.	Save and compile using menu command: "Station > Save and Compile...". Close the HW Config.	

Configuring all of the PC stations

The "Configure PC station" function transfers project configurations to one or more target stations. First, configure the local ES and then all of the operator stations that are connected to the plant bus.

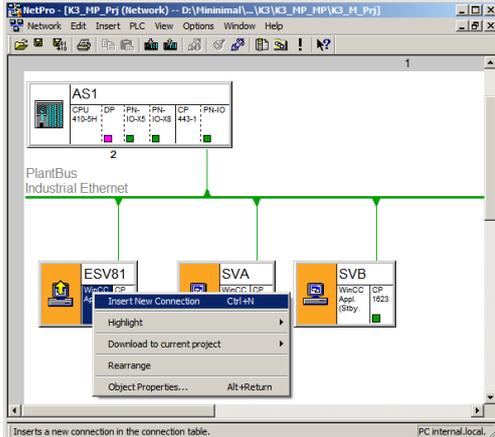
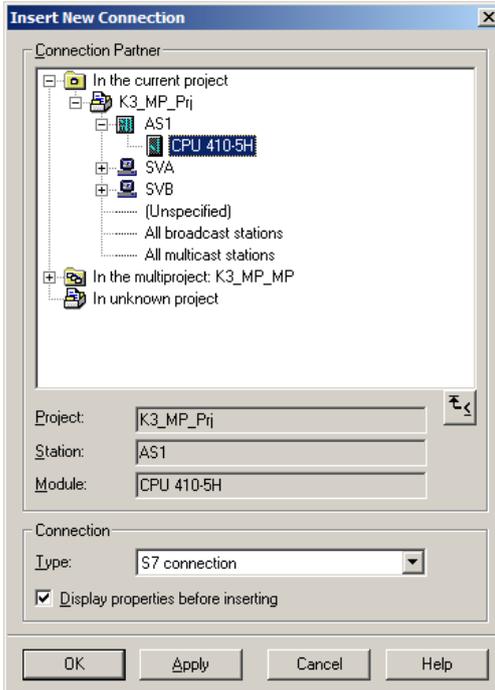
Step	Activity	Screenshot
1.	<p>Configure the Station Configuration Editor of the ES. To do this, select the PC station of the ES and in the shortcut menu choose: "PLC > Configure...".</p>	 <p>The screenshot shows the SIMATIC Manager interface. A context menu is open over a PLC object in the project tree. The menu items include 'Open Object', 'Cut', 'Copy', 'Delete', 'PLC', 'Access Protection', 'Print', 'SIMATIC BATCH', 'Rename', and 'Object Properties...'. The 'PLC' menu item is expanded, showing sub-options: 'Download', 'Configure...', 'Compile and Download Objects...', and 'Compare...'. The 'Configure...' option is highlighted.</p>
2.	<p>Under "Accessible computers:" choose the PC that you want to configure.</p> <p>NOTE If you chose the option "PC name identical to PC station name" for the PC station in the "Object properties", the system displays directly in the component configurator the target PC to be configured.</p> <p>Using the "Display..." button, you can show the current configuration of the PC station. Click on the "Configure..." button.</p>	 <p>The screenshot shows the 'Configure' dialog box. It has a 'Local network connection:' dropdown menu set to 'Terminal bus'. Below it is an 'Update' button. The 'Accessible computers:' section contains a list with 'ESV81', 'SVA', and 'SVB'. A checkbox labeled 'Use configured computer name' is checked. The 'Target computer:' field contains 'ESV81'. At the bottom, there are 'Configure...' and 'Display...' buttons. A 'Messages:' text area is empty. 'Close' and 'Help' buttons are at the very bottom.</p>

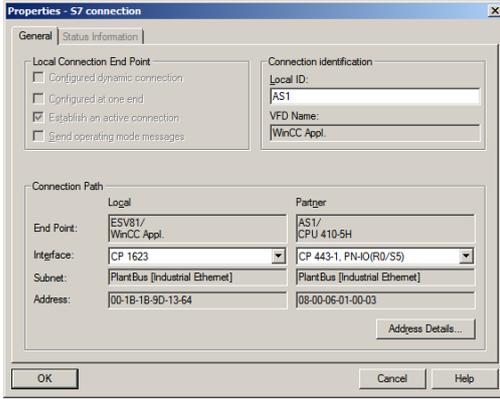
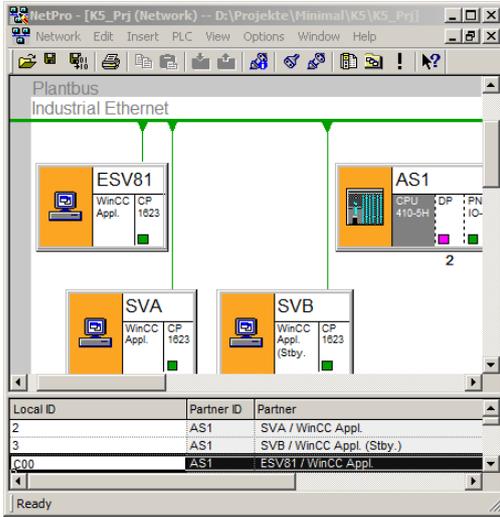
Step	Activity	Screenshot
3.	<p>In the window that appears, you can see how the PC station is configured. Click on the "OK" button to confirm this setting.</p>	
4.	<p>Click on the "OK" button to confirm the information dialog.</p>	
5.	<p>In the bottom window, you then see the message: "Transfer completed successfully." Close the configuration dialog.</p>	
6.	<p>Configure the Station Configuration Editors of the OS master/standby as shown in steps 1 to 5.</p>	

Configuring and loading AS-OS communication

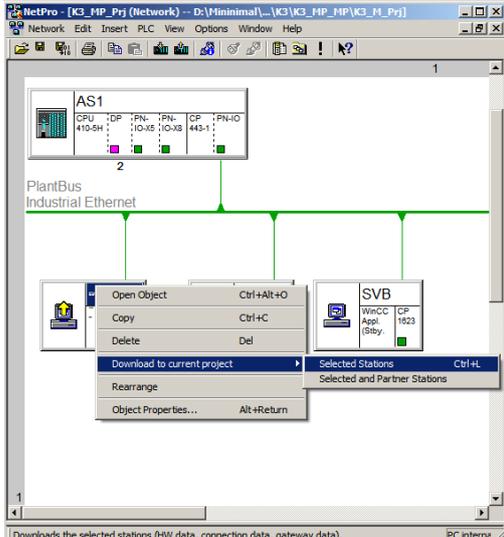
In the following section, the connections between the PC stations and the AS are configured in NetPro and loaded in the individual stations.

Note In the case of a granular station configuration, you must merge the subnets of the individual sub-projects first.

Step	Activity	Screenshot
1.	<p>Open NetPro. Highlight the WinCC application of the ES and open the shortcut menu. Choose "Insert New Connection".</p>	
2.	<p>In the "Connection Partner" window, select the CPU of the AS. Make sure that an "S7 connection" is selected under "Connection". In this example, a high-availability S7 connection is configured due to the AS configuration. Click on the "OK" button to confirm your selection.</p>	

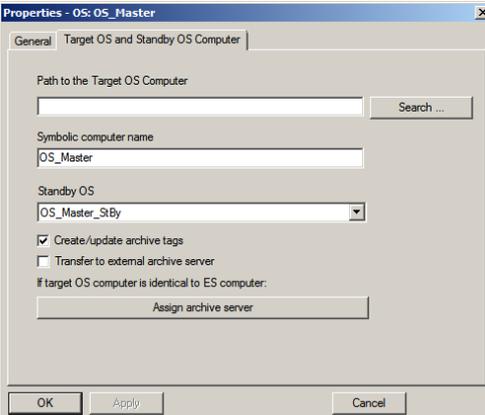
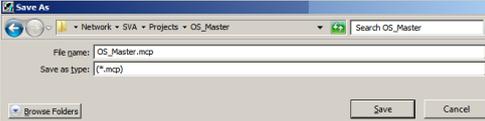
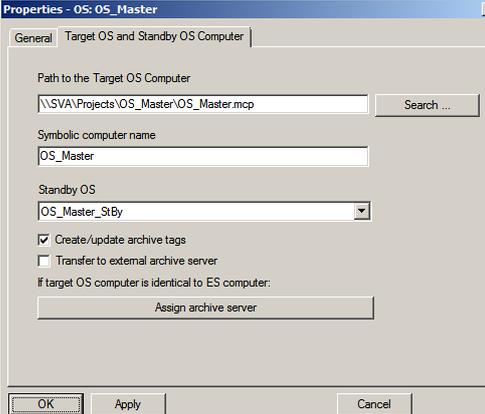
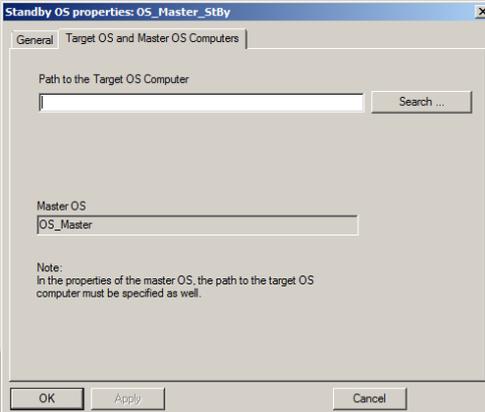
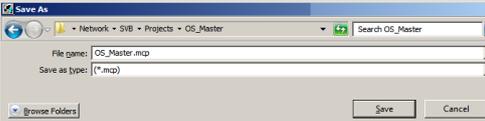
Step	Activity	Screenshot												
3.	<p>On the "General" tab under "Connection identification", change the "Local ID:" to a descriptive name like AS1, for example.</p> <p>Click on the "OK" button to confirm your settings.</p>													
4. Optionally	<p>In the connection table of the AS, change the local ID for the connection to the ES to a value of greater than 0xc00.</p> <p>Note A connection ID of greater than 0xc00 prevents the AS from generating messages in later operation due to starting or stopping of OS simulation on the ES.</p>	 <table border="1" data-bbox="863 1070 1353 1182"> <thead> <tr> <th>Local ID</th> <th>Partner ID</th> <th>Partner</th> </tr> </thead> <tbody> <tr> <td>2</td> <td>AS1</td> <td>SVA / WinCC Appl.</td> </tr> <tr> <td>3</td> <td>AS1</td> <td>SVB / WinCC Appl. (Stby.)</td> </tr> <tr> <td>0xc00</td> <td>AS1</td> <td>ESV81 / WinCC Appl.</td> </tr> </tbody> </table>	Local ID	Partner ID	Partner	2	AS1	SVA / WinCC Appl.	3	AS1	SVB / WinCC Appl. (Stby.)	0xc00	AS1	ESV81 / WinCC Appl.
Local ID	Partner ID	Partner												
2	AS1	SVA / WinCC Appl.												
3	AS1	SVB / WinCC Appl. (Stby.)												
0xc00	AS1	ESV81 / WinCC Appl.												
5.	<p>Also set the connections of the OS master and OS standby to the AS by repeating steps 1 to 3.</p> <p>When doing this, it is important that the connections of the OS master, OS standby and of the ES to the AS have the same name.</p> <p>After this, use the "Network > Save and Compile..." menu item to save the configurations and compile them.</p> <p>Select the "Compile and check everything" option and click on the "OK" button to confirm your selection.</p>													

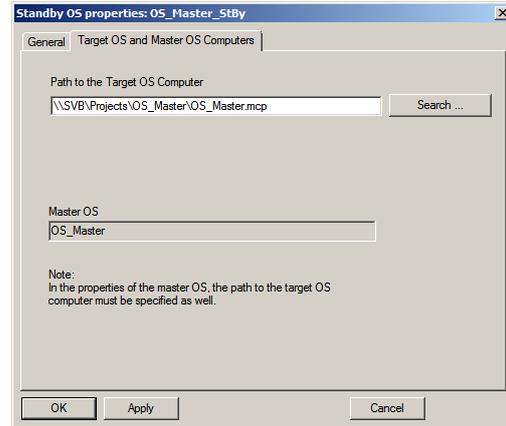
5 ES, OS Master and OS Standby

Step	Activity	Screenshot
6.	<p>Highlight the ES and download the connection use the "PLC > Download to Current Project > Selected Stations" menu item to download the connection.</p> <p>Download the AS, the OS master, and OS standby in the same way.</p> <p>Then, close NetPro.</p>	 <p>The screenshot shows the NetPro interface with a network diagram. A context menu is open over a station, with the 'Download to current project' option selected. The menu options are: Open Object (Ctrl+Alt+O), Copy (Ctrl+C), Delete (Del), Download to current project (Selected Stations Ctrl+S, Selected and Partner Stations), Rearrange, and Object Properties... (Alt+Return). The diagram shows a PlantBus Industrial Ethernet network with stations AS1 and SVB connected to a central bus.</p>

Master/Standby settings on the ES

Here, you define the master/standby assignment and set the loading paths.

Step	Activity	Screenshot
1.	<p>In SIMATIC Manager, open the properties dialog of the OS master PC station.</p> <p>Switch to the "Target OS and Standby OS Computer" tab.</p> <p>Select the Standby OS from the drop-down list.</p> <p>Select the "Create/update archive tags" checkbox.</p> <p>Clear the "Transfer to external archive server" checkbox if you are not using a Process Historian.</p> <p>Click on the "Browse" button.</p>	
2.	<p>Use the drop-down list to navigate to the shared project folder of the Master OS (see 5.3.1 Preparatory activities).</p> <p>Click on the "Save" button.</p>	
3.	<p>In the "Path to Target OS Computer" input field, check again the whole project path.</p> <p>Click on the "OK" button to confirm your entry.</p>	
4.	<p>Open the properties dialog of the Standby OS PC station.</p> <p>Switch to the "Target OS and Mater OS Computers" tab.</p> <p>Check whether OS_Master is entered in the "Master OS" field too.</p> <p>Click on the "Search..." button to select the storage path of the OS data.</p>	
5.	<p>Use the drop-down list to navigate to the shared project folder of the Standby OS (see 5.3.1 Preparatory activities).</p> <p>Click on the "Save" button.</p>	

Step	Activity	Screenshot
6.	<p>In the input field, check the "Path to the Target OS Computer".</p> <p>Click on the "OK" button to confirm this.</p> <p>Click on "Yes" to confirm the dialog that is displayed next.</p>	

Compiling and loading the user program

Compile the S7 program and download it to the AS.

Compiling the OS project

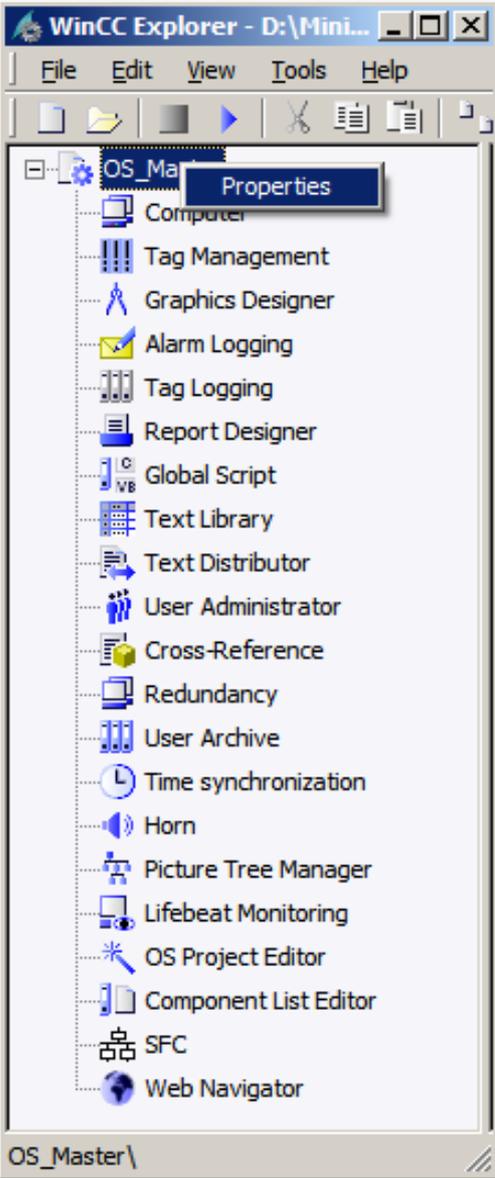
Compile the OS project of the Master OS in SIMATIC Manager.

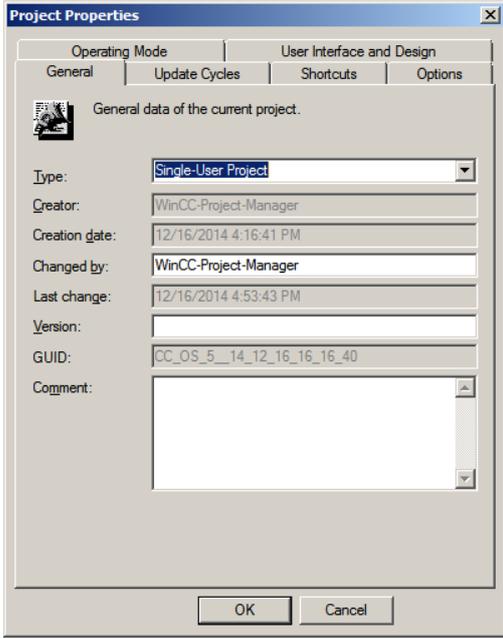
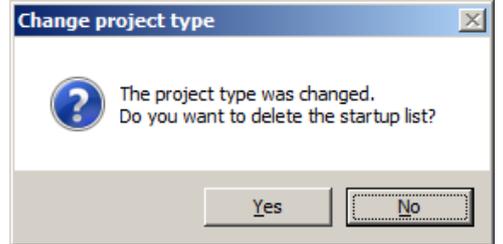
Make sure that you make the correct OS assignment to the server in plant view.

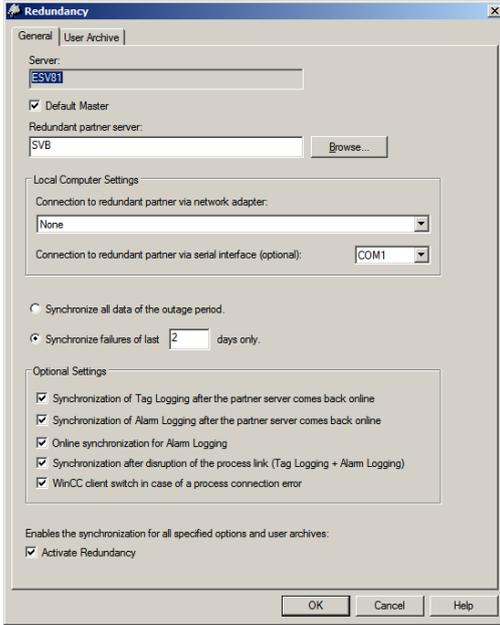
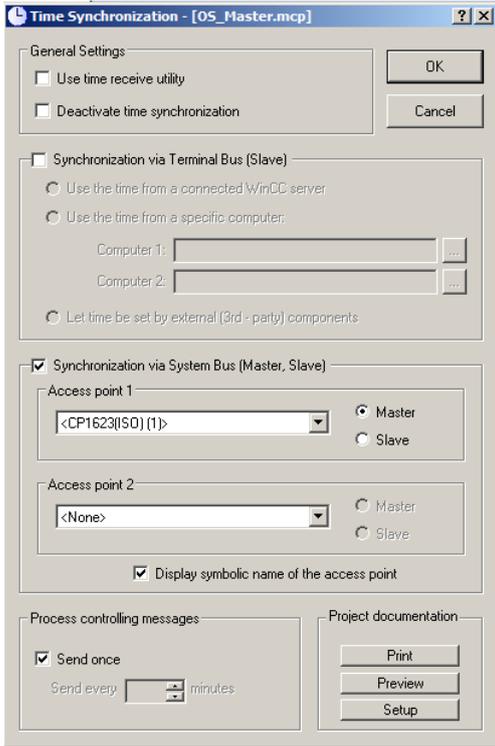
5.3.3 OS configuration

Configuring the OS on the engineering station

On the ES, you switch from a multi-user system to a single-user one and make the settings for redundancy and time synchronization.

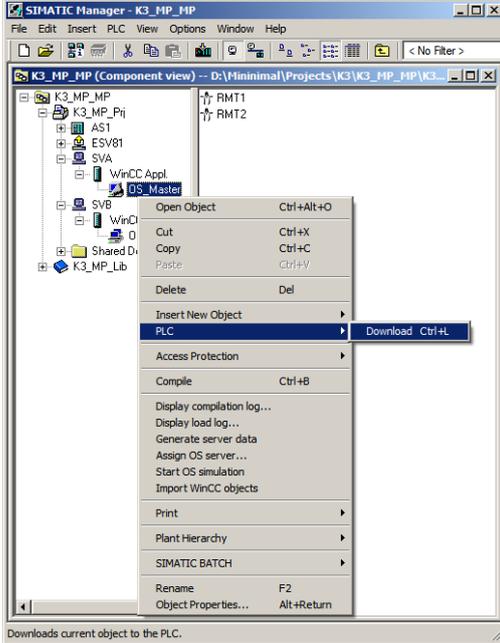
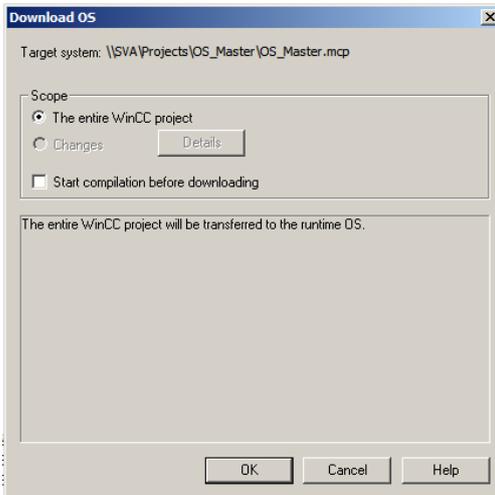
Step	Activity	Screenshot
1.	<p>On the ES, open the OS project of the Master OS.</p> <p>In the open WinCC Explorer, highlight the OS project and choose "Properties" in the shortcut menu.</p>	 <p>The screenshot shows the WinCC Explorer interface. The title bar reads 'WinCC Explorer - D:\Mini...'. The menu bar includes 'File', 'Edit', 'View', 'Tools', and 'Help'. The main workspace displays a tree view of the project structure. The 'OS_Ma' folder is selected, and its context menu is open, showing options such as 'Computer', 'Tag Management', 'Graphics Designer', 'Alarm Logging', 'Tag Logging', 'Report Designer', 'Global Script', 'Text Library', 'Text Distributor', 'User Administrator', 'Cross-Reference', 'Redundancy', 'User Archive', 'Time synchronization', 'Horn', 'Picture Tree Manager', 'Lifebeat Monitoring', 'OS Project Editor', 'Component List Editor', 'SFC', and 'Web Navigator'. The 'Properties' option is highlighted. The status bar at the bottom shows 'OS_Master\'.</p>

Step	Activity	Screenshot
<p>2.</p> <p>On the "General" tab under "Type:", choose "Single-user project". Confirm your input and the displayed message by clicking on the "OK" button.</p> <p>Note: You need server packages for the function of the MS clients, i.e. the OS/MS server must not be a single-user project. If the OS/MS server is set up as a single-user project, the MS client cannot be used on the ES.</p>		 <p>The screenshot shows the 'Project Properties' dialog box with the 'General' tab selected. The 'Type' dropdown menu is set to 'Single-User Project'. Other fields include 'Creator: WinCC-Project-Manager', 'Creation date: 12/16/2014 4:16:41 PM', 'Changed by: WinCC-Project-Manager', 'Last change: 12/16/2014 4:53:43 PM', 'Version:', 'GUID: CC_OS_5_14_12_16_16_40', and 'Comment:'. There are 'OK' and 'Cancel' buttons at the bottom.</p>
<p>3.</p> <p>Click on the "No" button to prevent the startup list from being deleted.</p>		 <p>The screenshot shows a 'Change project type' dialog box with a question mark icon. The text reads: 'The project type was changed. Do you want to delete the startup list?'. There are 'Yes' and 'No' buttons at the bottom.</p>

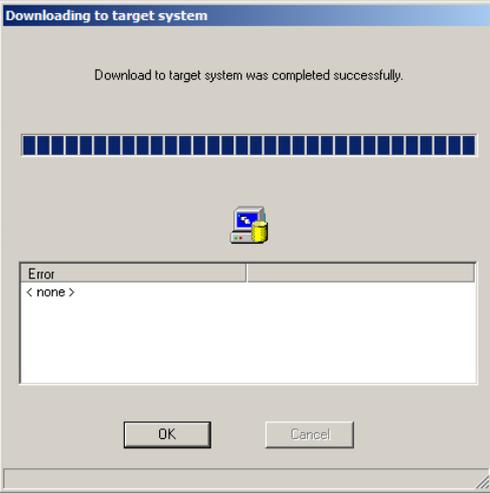
Step	Activity	Screenshot
4.	<p>Open the "Redundancy" editor.</p> <p>Select the "Default Master" checkbox.</p> <p>Enter the Standby OS in the "Redundant partner server" field.</p> <p>Check whether you have selected the desired checkboxes under "Optional Settings".</p> <p>In the drop-down list, select the connection path that is used to connect the Master OS and the Standby OS.</p> <p>Click on the "OK" button to confirm your settings.</p>	
5.	<p>Open the "Time Synchronization" editor.</p> <p>Select the "Synchronization via System Bus (Master, Slave)" checkbox.</p> <p>Under "Access point 1", choose "CP1623(ISO)" and select the "Master" radio button.</p> <p>Click on the "OK" button to confirm your settings.</p> <p>NOTE If you configure station time synchronization on a different computer, the access points are not known, which means that they are not available in the drop-down list. To choose the access point regardless, select the "Display symbolic name of the access point" checkbox and then choose the appropriate access point.</p>	
6.	Close the OS project.	

Downloading the OS project to the OS computer

Once redundancy and time synchronization have been configured on the ES, download the OS project to the Master OS and the Standby OS.

Step	Activity	Screenshot
1.	In SIMATIC Manager, highlight the Master OS and choose "PLC -> Download" in the shortcut menu.	 <p>The screenshot shows the SIMATIC Manager interface with the 'OS Master' object selected in the project tree. A context menu is open, and the 'Download' option under the 'PLC' menu is highlighted. The status bar at the bottom indicates 'Downloads current object to the PLC.'</p>
2.	For the first OS project download, an entire download is required. Click on the "OK" button to start downloading.	 <p>The screenshot shows the 'Download OS' dialog box. The 'Target system' is set to '\\SVA\Projects\OS_Master\OS_Master.mcp'. Under the 'Scope' section, 'The entire WinCC project' is selected. There is a checkbox for 'Start compilation before downloading' which is currently unchecked. The dialog box includes 'OK', 'Cancel', and 'Help' buttons at the bottom.</p>

5 ES, OS Master and OS Standby

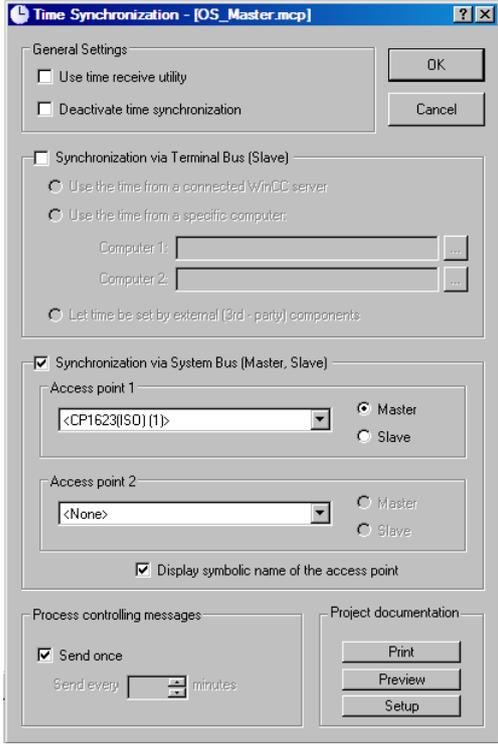
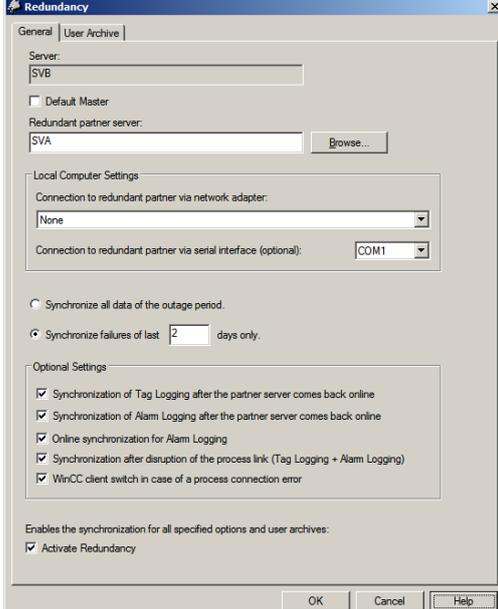
Step	Activity	Screenshot
3.	<p>After successful downloading, the OS project is located in the specified folder on the Master OS.</p> <p>Click on the "OK" button to confirm the message that is issued.</p>	
4.	<p>Repeat steps 1 to 3 to download the OS project to the Standby OS.</p>	

Configuring on the operator station

Generally, we would advise you to check the project settings after the project has been downloaded to the target systems.

Note Normally, all configuration work is carried out on the ES to ensure consistent data management. This means that no WinCC engineering licenses are needed on the OSes. However, each time WinCC Explorer is opened, a license-free time window of two hours is available for WinCC configuration work.

Step	Activity	Screenshot
1.	Open the OS project on the OS project.	
2.	<p>Open the "Redundancy" editor. Check the name of the Master OS in the "Server" field. Select the "Default Master" checkbox. Also, check whether the name of the Standby OS is entered correctly under "Redundant partner server:". Check whether you have selected the desired checkboxes under "Optional Settings". Check whether the connection path that is used to connect the Master OS and the Standby OS is set.</p> <p>Click on the "OK" button to confirm your settings.</p>	

Step	Activity	Screenshot
3.	<p>Open the "Time Synchronization" editor.</p> <p>Check or select the "Synchronization via System Bus (Master, Slave)" checkbox.</p> <p>Under "Access point 1", check or select "CP1623(ISO)" and the "Master" radio button.</p> <p>Click on the "OK" button to confirm your settings.</p>	
4.	<p>If you have made project changes in WinCC Explorer, close the OS project and open it again for the settings to take effect.</p>	
5.	<p>Repeat steps 1 to 4 on the Standby OS with the following modifications for step 2 (redundancy):</p> <ul style="list-style-type: none"> • The "Default Master" checkbox must be cleared. • Check whether the name of the Master OS is entered correctly under "Redundant partner server:" and change it if necessary. 	

5.3.4 Activating runtime

First activate the OS project on the Master OS and then on the Standby OS. Before activating the second runtime, it is advisable to wait until the boot process of the first one has completed.

Online synchronization is active immediately.

By contrast, mutual synchronization of archives starts 10 minutes later.

6 ES/OS Master and OS Standby

6.1 Configuration description

In this configuration with two redundant OS Single Stations, one of the stations is used at the same time as an ES, which obviates the need for a separate third station.

In this connection, you must pay attention to the following two criteria. This is why we generally recommend creating a configuration with a separate ES (see chapter 5 "ES, OS Master and OS Standby"):

Comparatively low savings potential

The savings potential has been reduced since PCS 7 V8.0 because the OS runtime license is no longer included with the ES license. This means that, savings are limited to one computer (hardware and Windows license).

Special considerations when configuring

The configuration differs from that of the PCS 7 Engineering Standard and represents a kind of workaround.

You cannot use the "WinCC Application" and "WinCC Standby Application" PCS 7 standard tools, since it is not possible to download changes during operation. The mechanisms controlling the fact that both systems must be in runtime and that runtime on the ES must be stopped for the download to proceed block one another.

For this reason, we configure only one OS application, open it on both stations, and configure mutual redundancy locally in WinCC in each case. To be able to download to the OS Single Station, runtime on the ES and the OS must be closed first.

CAUTION

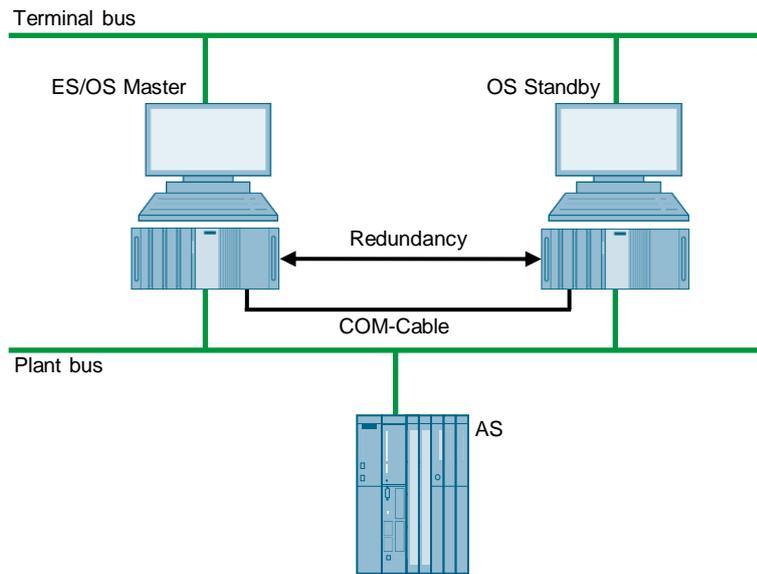
This configuration has been tested with a PCS 7 basic installation including the Web Option. No statement can be made regarding the functionality with additional optional packages.

Note

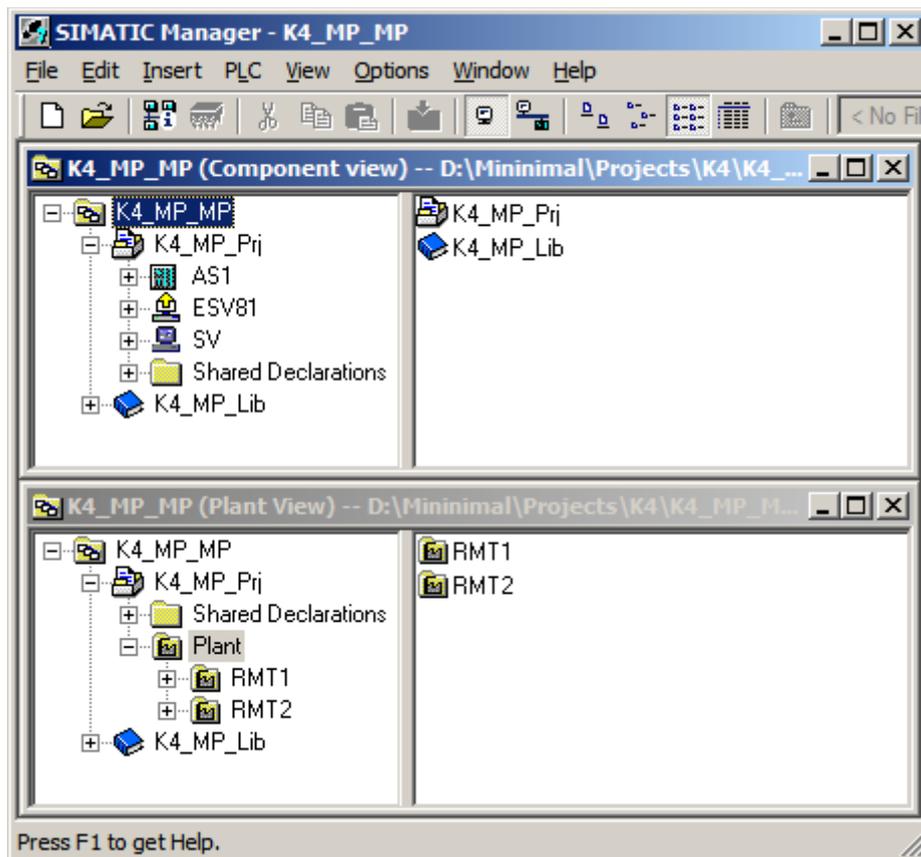
The jump keys in the asset faceplates for hardware configuration and for PDM function as follows:

- Up to PDM V8.1: On ES only
- PDM V8.2 and higher: On ES and Standby OS
- PDM V9.0 and higher: On ES and OS clients, and web clients

Hardware configuration



PCS 7 configuration



Limitations/Particularities

Due to the untypical configuration of PCS 7 with only one OS, there are differences in system behavior that must be observed:

- The first activated OS takes on the master role.
- For an entire download to be performed, runtime must be deactivated and the OS project closed on both computers. During this time, operator actions and archiving are not possible.
- To download changes, runtime must be stopped on the ES when compiling the OS. These can then be re-activated to test the modified OS functions. For the downloading process, runtime must be terminated and the OS Project must be closed. As a result, it is not possible to take operator actions on the ES computer during this time.

CAUTION

Depending on the changes that are carried out, if runtime remains active during OS compilation, subsequent downloading of changes may not be performed completely and will cause errors. If this happens, only an entire download is possible.

- When runtime is active on the ES computer, the runtime archives are stored in the multiproject path. At archiving, they are included in the ZIP file, which causes an increased demand on memory resources as well as longer archiving times
Workaround:
 - Deactivate runtime on the ES computer
 - Reset the archives in the OS project on the ES computer and close the entire PCS 7 project

After archiving and re-activating runtime, the archives are synchronized again. However, it must be noted that more time is needed for synchronization.

6.2 Required hardware and software licensing

Hardware

For this configuration, we recommend using the hardware below which you can order via the Siemens mall. This ensures that the appropriate number of selected operating systems and SIMATIC PCS 7 system software packages are pre-installed on the PC stations.

Station	Product designation	Operating system	Plant bus transition
1 x ES/OS	SIMATIC PCS 7 ES/OS IPC847E BCE	Windows 10	RJ45 Network card
	SIMATIC PCS 7 ES/OS IPC847E IE	Windows 10	CP 1623
1 x OS Single Station	SIMATIC PCS 7 ES/OS IPC847E BCE	Windows 10	RJ45 Network card
	SIMATIC PCS 7 ES/OS IPC847E IE	Windows 10	CP 1623

Software licensing

The following section lists the software/license packages that you need for the selected configuration.

Component	Software/license packages
ES	<ul style="list-style-type: none"> SIMATIC PCS 7 AS/OS Engineering Software (Unlimited POs) SIMATIC PCS 7 AS Runtime License
OS Single Station Redundant	<ul style="list-style-type: none"> SIMATIC PCS 7 OS Software Single Station Redundancy (Single License for 2 installations) 2 x SIMATIC PCS 7 OS Runtime License (max. of 2,000 POs)

6.3 Step-by-step configuration

Note The following instructions have been drawn up based on Windows 7 and PCS 7 V9.0.

CP1623 are used as an example of the plant bus transition. Time synchronization is activated additionally.

The PC stations used in the test setup are called:

- ES/OS Master:ESV81
- OS Standby: SV

6.3.1 Preparatory activities

Create a project folder on the Standby OS PC station and share it. This makes it possible to transfer the OS data that is configured on the engineering station to the OS master and the OS standby.

6.3.2 ES configuration

Creating the multiproject

As the basis for the instructions below, all of the PC stations must be physically networked as shown in the illustration in chapter 6.1. Apart from this, you must create a multiproject on the ES in which the hardware and software of the AS are already configured.

Start with the following CPU and CP settings.

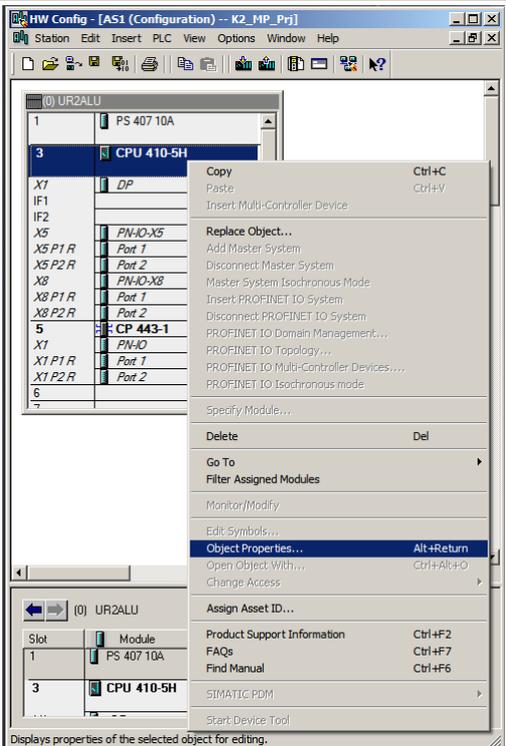
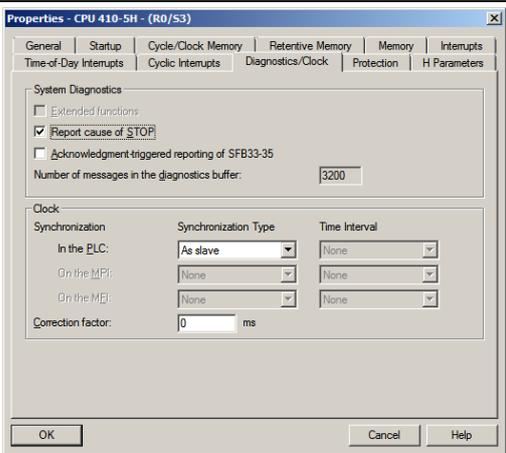
AS settings for time synchronization

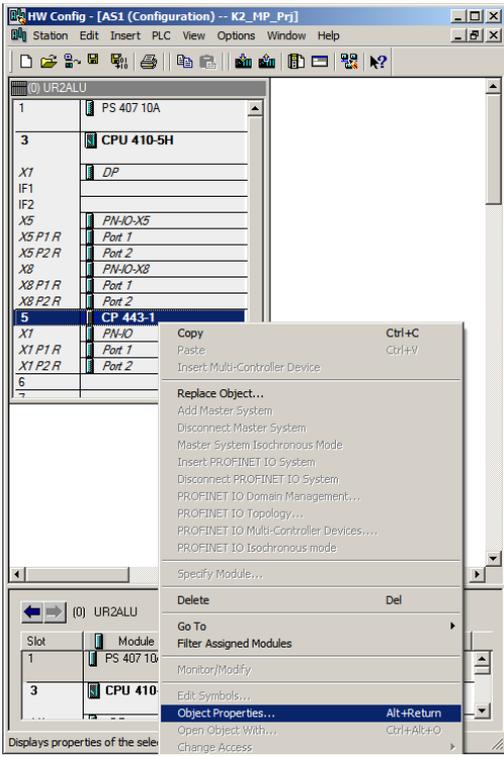
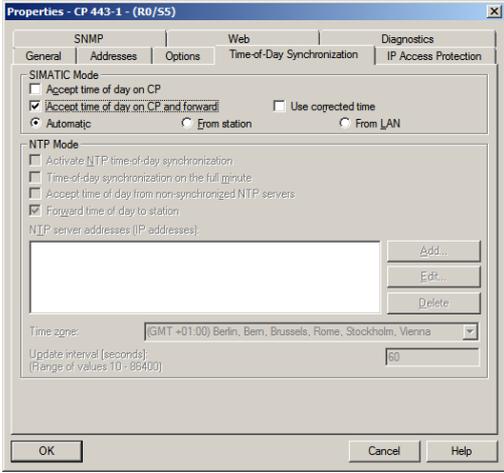
The analyzability of the process data requires that all of the components of the process control system work with an identical clock time to be able to assign messages in the correct time sequence

The following section describes a way in which the OS Single Station that is activated first specifies the master time.

Note More time synchronization options are described in detail in the following manuals:

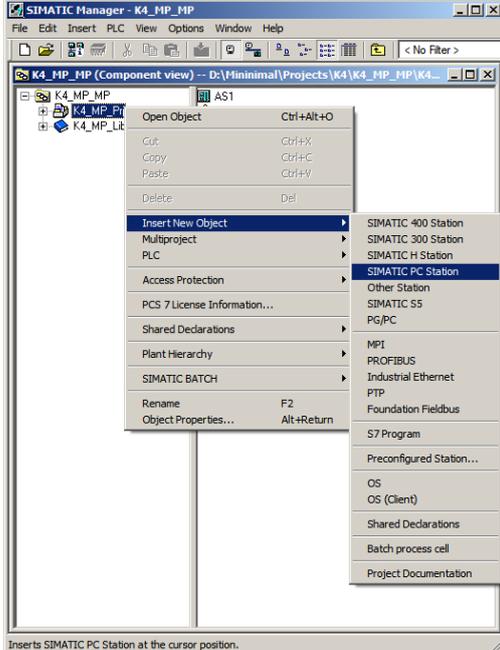
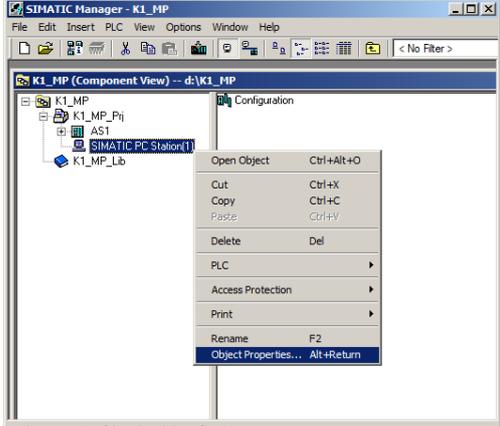
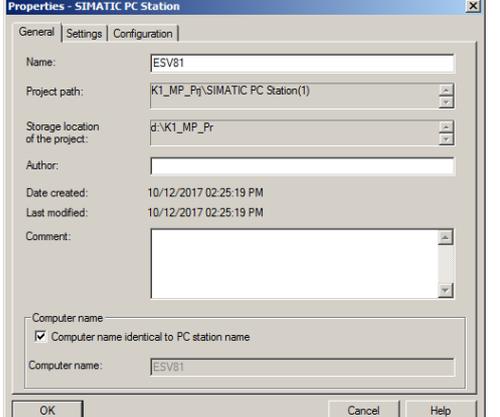
- "SIMATIC PCS 7 Operator Station"
<https://support.industry.siemens.com/cs/ww/en/view/109805404>
- "SIMATIC Process Control System PCS 7 Time Synchronization"
<https://support.industry.siemens.com/cs/ww/en/view/109805436>

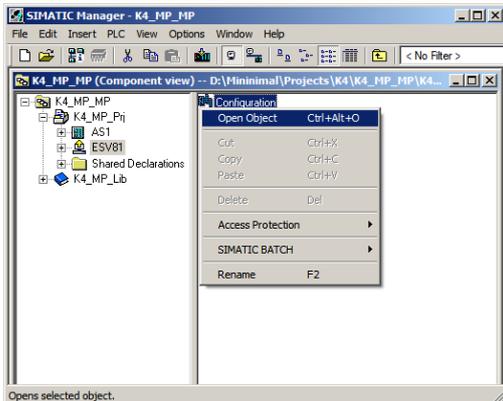
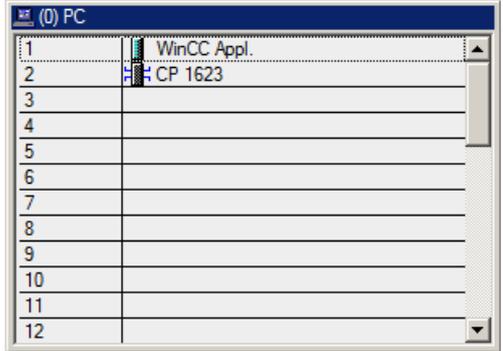
Step	Activity	Screenshot
<p>1.</p>	<p>Open the HW Config for the AS. Highlight the CPU and choose "Object properties..." in the shortcut menu.</p>	 <p>The screenshot shows the HW Config interface for a rack (UR2ALU). The CPU 410-5H is selected, and a context menu is open. The 'Object Properties...' option is highlighted, which is used to access the properties dialog for the selected object.</p>
<p>2.</p>	<p>Switch to the "Diagnostics/Clock" tab. In the "Clock" section, set "Synchronization Type - As slave" for the AS. Click on the "OK" button to confirm this setting.</p>	 <p>The screenshot shows the 'Properties - CPU 410-5H - (R0/S3)' dialog box. The 'Diagnostics/Clock' tab is active. Under the 'Clock' section, the 'Synchronization Type' is set to 'As slave'. The 'Time Interval' is set to 'None'. The 'Correction factor' is set to '0 ms'. The 'OK' button is highlighted.</p>

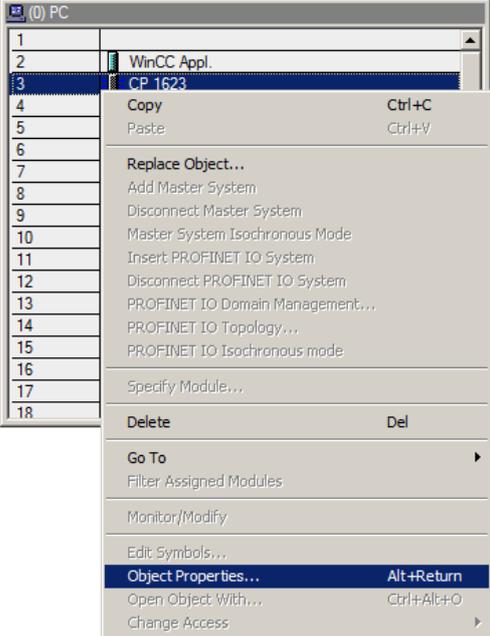
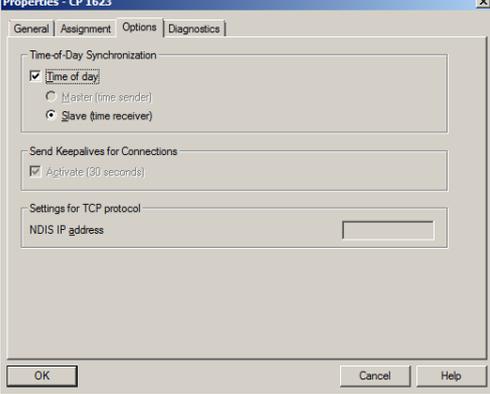
Step	Activity	Screenshot
3.	Open the shortcut menu of the CP and select "Object properties...".	 <p>The screenshot shows the HW Config interface with a context menu open over the CP 443-1 module. The menu items include Copy, Paste, Replace Object..., Delete, Go To, Filter Assigned Modules, Monitor/Modify, Edit Symbols..., Object Properties... (highlighted), Open Object With..., and Change Access.</p>
4.	Switch to the "Time synchronization" tab. Select the "Accept time of day on CP and forward" check box. Click on the "OK" button to confirm your selection.	 <p>The screenshot shows the 'Properties - CP 443-1 - (R0/SS)' dialog box, specifically the 'Time-of-Day Synchronization' tab. Under 'SIMATIC Mode', the 'Accept time of day on CP and forward' checkbox is checked. Other options include 'Automatic', 'From station', and 'From LAN'. There are also sections for 'NTP Mode' and 'NTP server addresses'.</p>
5.	Use the "Station > Save and compile..." command to save the configuration. Close the HW Config.	

Setting up the ES PC station

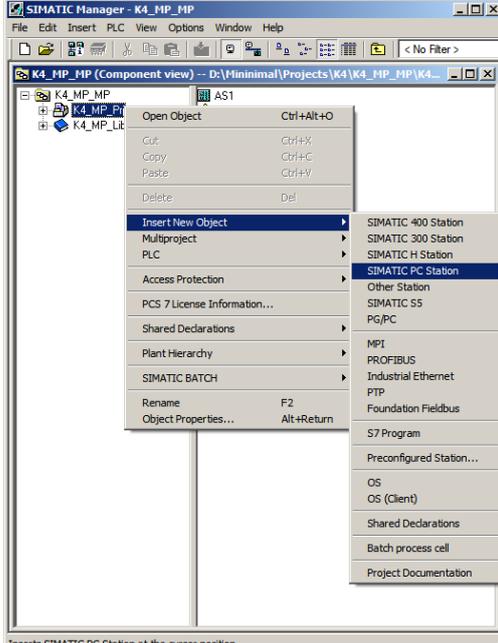
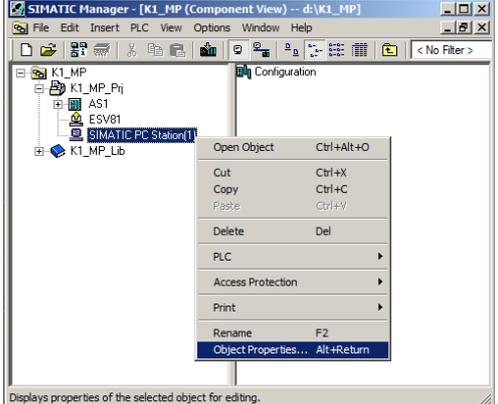
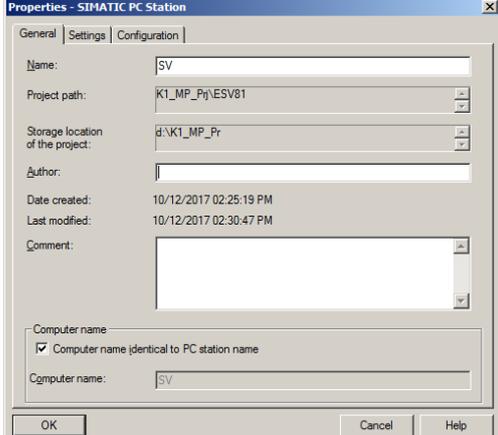
To run the OS project on the ES, a PC station is created for the ES using the WinCC application.

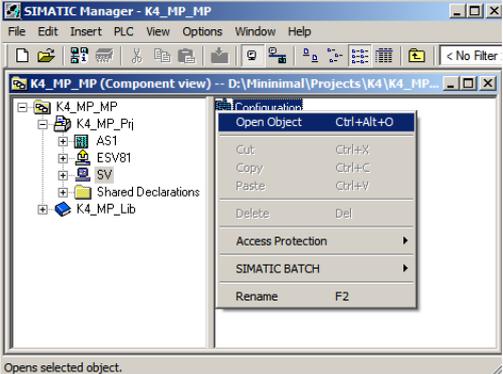
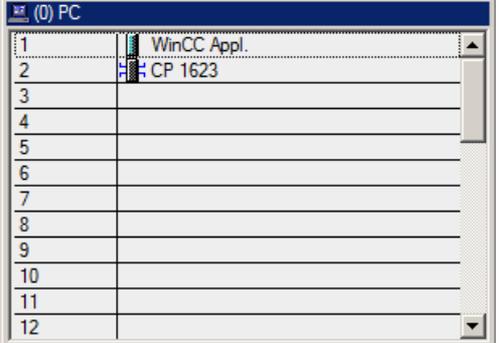
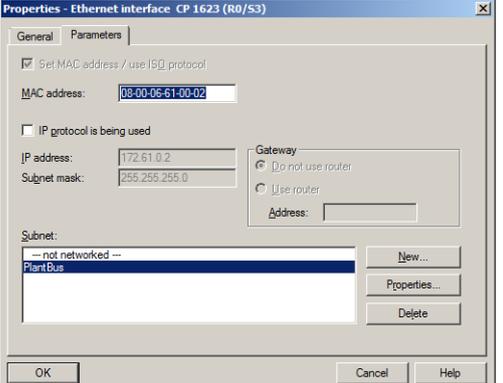
Step	Activity	Screenshot
1.	In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.	 <p>The screenshot shows the SIMATIC Manager interface with the 'Component view' of a project. A context menu is open over the project tree, and the 'Insert New Object' option is selected. A sub-menu is displayed, listing various station types, with 'SIMATIC PC Station' highlighted. The status bar at the bottom indicates 'Inserts SIMATIC PC Station at the cursor position.'</p>
2.	Use the shortcut menu to open the object properties of the PC station.	 <p>The screenshot shows the SIMATIC Manager interface with the 'Component view' of a project. A context menu is open over the 'SIMATIC PC Station(1)' object in the project tree. The 'Object Properties...' option is selected. The status bar at the bottom indicates 'Displays properties of the selected object for editing.'</p>
3.	Change the name of the ES PC station to match the name of the local computer on the network. Select the "Computer name identical to PC station name" checkbox.	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box with the 'Configuration' tab selected. The 'Name' field contains 'ESV81'. The 'Project path' is 'K1_MP_Pj\SIMATIC PC Station(1)'. The 'Storage location of the project' is 'd:\K1_MP_Pr'. The 'Computer name' section has the checkbox 'Computer name identical to PC station name' checked, and the 'Computer name' field also contains 'ESV81'. The dialog has 'OK', 'Cancel', and 'Help' buttons.</p>

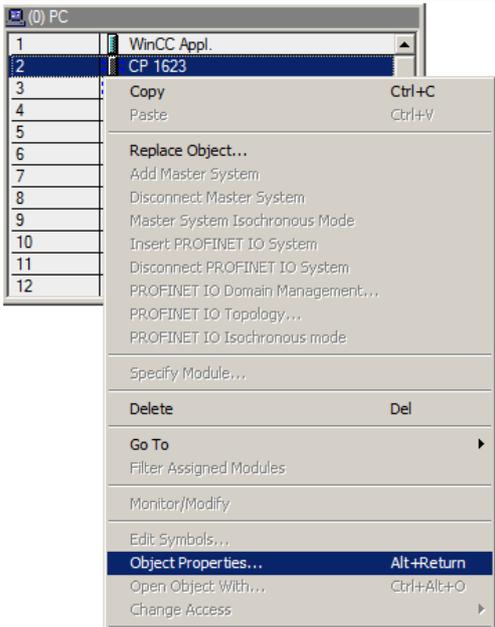
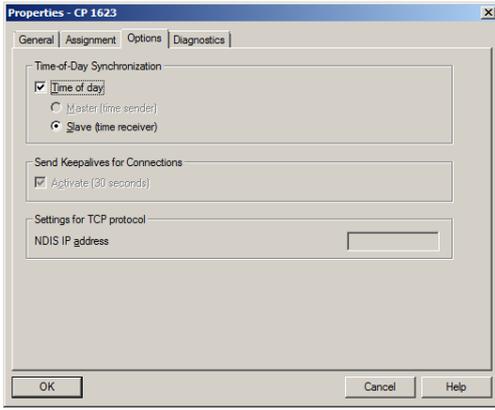
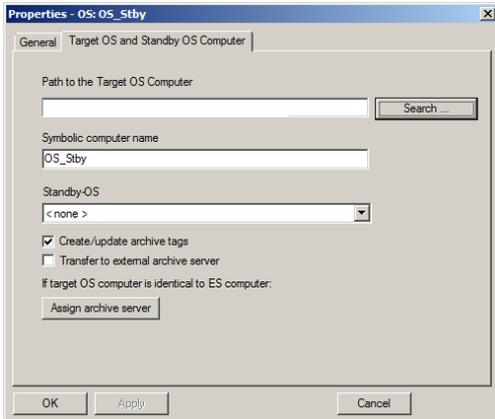
Step	Activity	Screenshot
4.	Open the HW Config of the ES PC station via the shortcut menu.	 <p>The screenshot shows the SIMATIC Manager interface with the 'Configuration' context menu open over a selected object in the HW Config view. The menu options include: Open Object (Ctrl+Alt+O), Cut (Ctrl+X), Copy (Ctrl+C), Paste (Ctrl+V), Delete (Del), Access Protection, SIMATIC BATCH, and Rename (F2).</p>
5.	Insert a "WinCC application" (and a network card) of type "CP1623" from the object catalog (View > Catalog).	 <p>The screenshot shows the 'Object Catalog' window in SIMATIC Manager. It displays a list of objects for a PC station. Two objects are highlighted: 'WinCC Appl.' and 'CP 1623'.</p>
6.	<p>Under "Subnet", choose the plant bus or create it by clicking on the "New..." button. Assign the corresponding MAC address to the CP1623.</p> <p>Deselect the "IP protocol is being used" checkbox.</p> <p>Click on the "OK" button to confirm your settings.</p>	 <p>The screenshot shows the 'Properties - Ethernet interface CP 1623 (R0/S3)' dialog box. The 'General' tab is active. The 'Get MAC address / use ISO protocol' checkbox is checked. The MAC address is set to 08-00-06-61-00-01. The 'IP protocol is being used' checkbox is unchecked. The IP address is 192.168.0.1 and the subnet mask is 255.255.255.0. The 'Gateway' section has 'Do not use router' selected. The 'Subnet' dropdown menu is open, showing 'Plant Bus' selected. The 'New...' button is visible next to the dropdown.</p>

Step	Activity	Screenshot
7.	Open the shortcut menu of the CP1623 and select "Object properties...".	 <p>The screenshot shows a tree view with 'CP 1623' selected. A context menu is open, listing various actions. The 'Object Properties...' option is highlighted in blue, with the keyboard shortcut 'Alt+Return' shown next to it.</p>
8.	Switch to the "Options" tab and select the "Time of day" checkbox. Click on the "OK" button to confirm your selection.	 <p>The screenshot shows the 'Properties - CP 1623' dialog box with the 'Options' tab selected. Under 'Time-Day Synchronization', the 'Time of day' checkbox is checked. Below it, there are radio buttons for 'Master (time sender)' and 'Slave (time receiver)'. There is also a 'Send Keepalives for Connections' section with a checked 'Activate (30 seconds)' checkbox. At the bottom, there is an 'NDIS IP address' field and 'OK', 'Cancel', and 'Help' buttons.</p>
9.	Use the "Station > Save and compile..." menu item to save the configuration and compile it. Close the HW Config.	
10. Optionally	Delete the OS of the PC station of the ES in SIMATIC Manager as it is not needed in our example.	

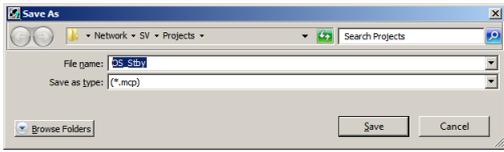
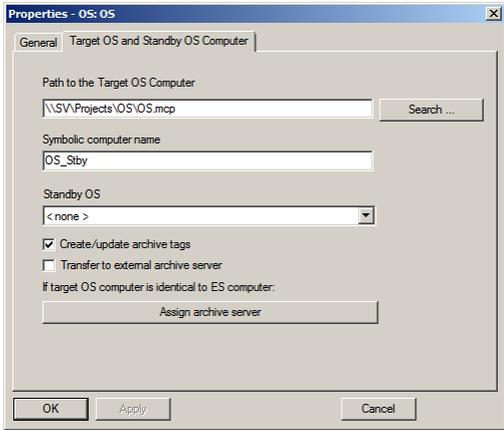
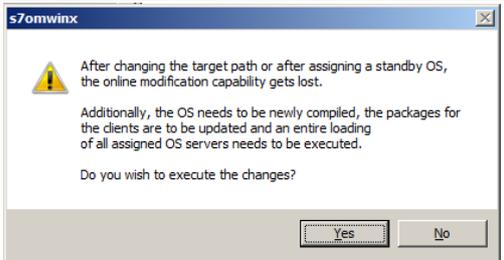
Setting up the OS standby PC station

Step	Activity	Screenshot
1.	In component view, open the shortcut menu of the project and use "Insert New Object > SIMATIC PC station" to add a new PC station.	 <p>The screenshot shows the SIMATIC Manager interface with a context menu open over a project. The menu path is: Insert New Object > SIMATIC PC Station. The 'SIMATIC PC Station' option is highlighted in blue. Other options in the menu include SIMATIC 400 Station, SIMATIC 300 Station, SIMATIC H Station, Other Station, SIMATIC S5, PG/PC, MP1, PROFIBUS, Industrial Ethernet, PTP, Foundation Fieldbus, S7 Program, Preconfigured Station..., OS, OS (Client), Shared Declarations, Batch process cell, and Project Documentation.</p>
2.	Use the shortcut menu to open the object properties of the PC station.	 <p>The screenshot shows the SIMATIC Manager interface with a context menu open over a 'SIMATIC PC Station(1)' object. The 'Object Properties...' option is highlighted in blue. Other options in the menu include Open Object, Cut, Copy, Paste, Delete, PLC, Access Protection, Print, Rename, and Object Properties... (F2).</p>
3.	Change the name of the OS server PC station to match the name of the computer on the network. Select the "Computer name identical to PC station name" checkbox.	 <p>The screenshot shows the 'Properties - SIMATIC PC Station' dialog box with the 'Configuration' tab selected. The 'Name' field contains 'SV'. The 'Project path' is 'K1_MP_Pj\ESV81'. The 'Storage location of the project' is 'd:\K1_MP_Pr'. The 'Computer name' section has the checkbox 'Computer name identical to PC station name' checked. The 'Computer name' field also contains 'SV'. Other fields include Author, Date created, Last modified, and Comment.</p>

Step	Activity	Screenshot
4.	Open the HW Config of the OS standby PC station via the shortcut menu.	 <p>The screenshot shows the SIMATIC Manager interface. The main window displays the component view of the project 'K4_MP_MP'. A context menu is open over the 'K4_MP_Ptj' object, showing options like 'Open Object', 'Cut', 'Copy', 'Paste', 'Delete', 'Access Protection', 'SIMATIC BATCH', and 'Rename'. The 'Open Object' option is highlighted.</p>
5.	From the object catalog (View > Catalog) insert a "WinCC application (not a WinCC Application Stby!)" and a network card of type "CP1623".	 <p>The screenshot shows the HW Config window. The object catalog is open, and two objects are selected: 'WinCC Appl.' and 'CP 1623'. The catalog lists 12 slots, with the selected objects occupying slots 1 and 2.</p>
6.	Under "Subnet", choose the plant bus or create it by clicking on the "New..." button. Assign the corresponding MAC address to the CP1623. Deselect the "IP protocol is being used" checkbox. Click on the "OK" button to confirm your settings.	 <p>The screenshot shows the 'Properties - Ethernet interface CP 1623 (R0/S3)' dialog box. The 'General' tab is active. The 'MAC address' is set to '08-00-06-61-00-02'. The 'IP protocol is being used' checkbox is unchecked. The 'Subnet' dropdown is set to 'Plant Bus'. The 'OK' button is highlighted.</p>

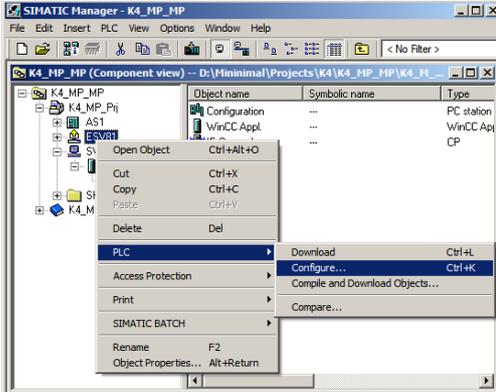
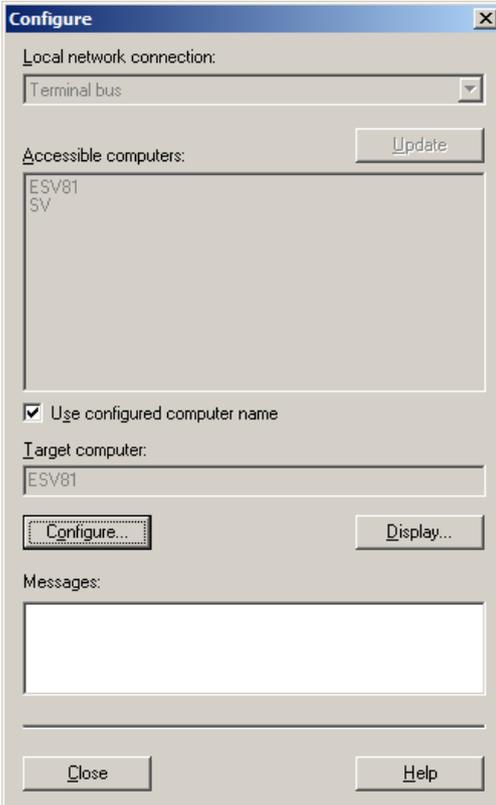
Step	Activity	Screenshot
7.	Open the shortcut menu of the CP1623 and select "Object properties...".	
8.	Switch to the "Options" tab and select the "Time of day" checkbox. Click on the "OK" button to confirm the setting.	
9.	Save and compile using the "Station > Save and compile..." command. Close the HW Config.	
10.	In SIMATIC Manager, open the properties dialog of the Standby OS. Switch to the "Target OS and Standby OS Computer" tab. Select the "Create/update archive tags" checkbox and clear the "Transfer to external archive server" checkbox. Click on the "Search..." button.	

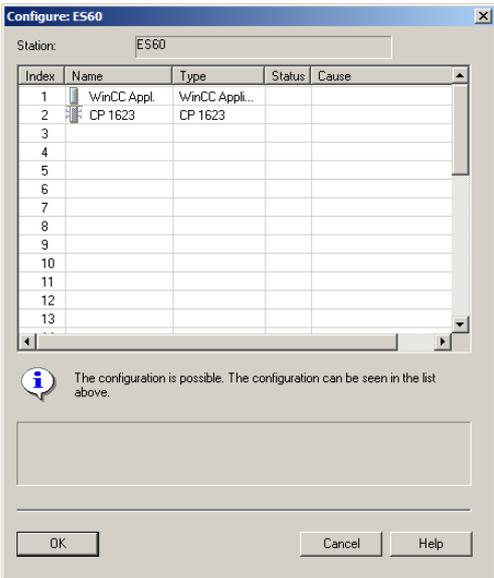
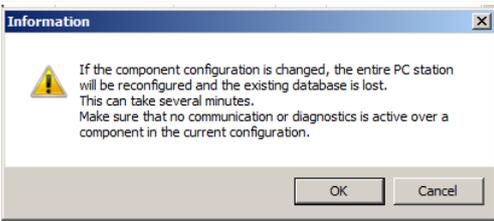
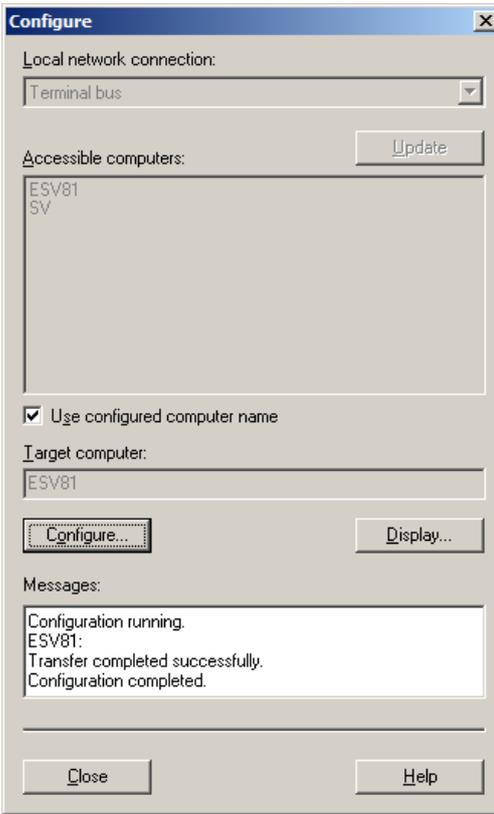
6 ES/OS Master and OS Standby

Step	Activity	Screenshot
11.	Use the drop-down list to navigate to the shared project folder of the Standby OS (see 6.3.1 Preparatory activities). Click on the "Save" button.	
12.	In the "Path to Target OS Computer" input field, check again the whole project path. Click on the "OK" button to confirm this.	
13.	Click on the "Yes" button to confirm the information dialog.	

Configuring the PC stations

The "Configure PC station" transfers project configurations to one or more target stations. First configure the local Station Configuration Editor of the ES and then all the other PC stations connected to the plant bus.

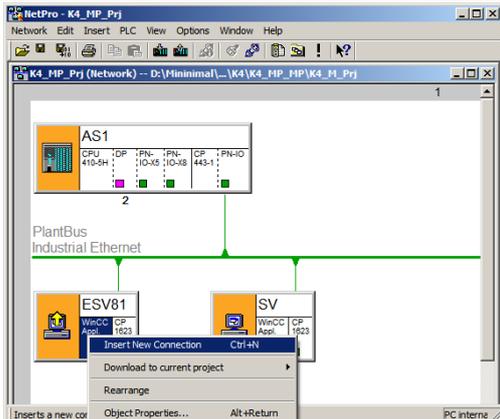
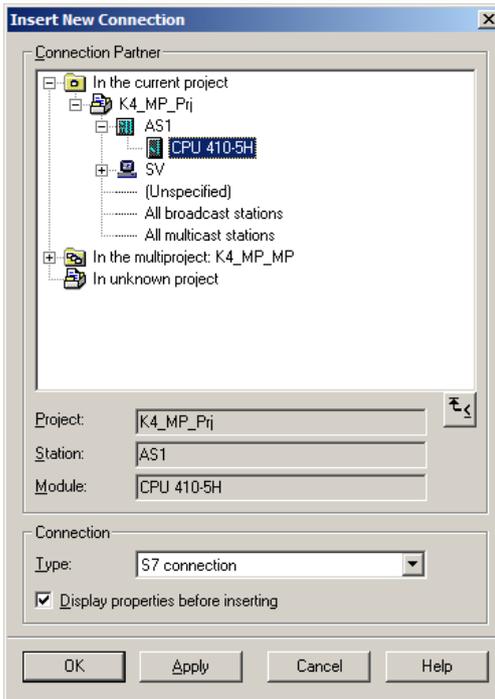
Step	Activity	Screenshot
1.	<p>Execute the Station Configuration Editor of the ES. To do this, select the PC station of the ES and in the shortcut menu choose: "PLC > Configure...".</p>	 <p>The screenshot shows the SIMATIC Manager interface. A context menu is open over a selected PC station in the project tree. The menu items include 'Open Object', 'Cut', 'Copy', 'Paste', 'Delete', 'PLC', 'Access Protection', 'Print', 'SIMATIC BATCH', 'Rename', and 'Object Properties...'. The 'PLC' menu is expanded, showing sub-options: 'Download', 'Configure...', 'Compile and Download Objects...', and 'Compare...'. The 'Configure...' option is highlighted.</p>
2.	<p>Under "Accessible computers:" choose the PC that you want to configure.</p> <p>Note If you chose the "PC name identical to PC station name" option for the PC station in the "Object properties", the system displays directly in the component configurator the target PC to be configured.</p> <p>Using the "Display..." button, you can display the current configuration of the PC station.</p> <p>Click on the "Configure..." button.</p>	 <p>The screenshot shows the 'Configure' dialog box. It has a 'Local network connection:' dropdown set to 'Terminal bus'. Below it is an 'Accessible computers:' list containing 'ESV81' and 'SV'. There is an 'Update' button next to the list. A checked checkbox 'Use configured computer name' is present. The 'Target computer:' field contains 'ESV81'. At the bottom, there are 'Configure...' and 'Display...' buttons. A 'Messages:' text area is at the very bottom, and 'Close' and 'Help' buttons are at the bottom right.</p>

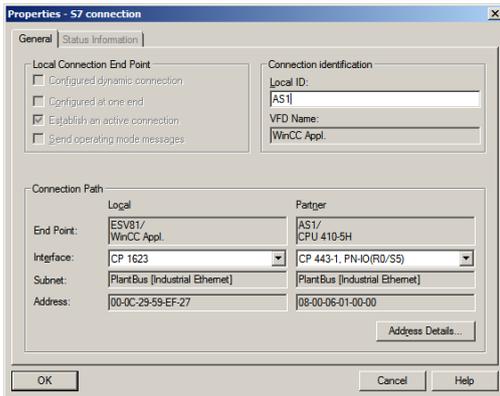
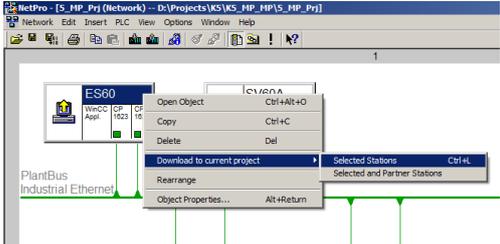
Step	Activity	Screenshot
3.	<p>In the window that appears, you can see how the PC station is configured.</p> <p>Click on the "OK" button to confirm this setting.</p>	
4.	<p>Click on "OK" to confirm the information dialog.</p>	
5.	<p>In the bottom window, you then see the message: "Transfer completed successfully".</p> <p>Close the configuration dialog.</p>	
6.	<p>Configure the Station Configuration Editor of the Standby OS as shown in steps 1 to 5.</p>	

Configuring and loading AS-OS communication

In the following section, the connections between the PC stations and the AS are configured in NetPro and loaded in the individual stations.

Note In the case of a granular station configuration, you must merge the subnets of the individual sub-projects first.

Step	Activity	Screenshot
1.	Open NetPro. Highlight the WinCC application of the ES and open the shortcut menu. Select "Insert New Connection".	
2.	In the "Connection Partner" window, select the CPU of the AS. Make sure that an "S7 connection" is selected under "Connection".	

Step	Activity	Screenshot
3.	<p>On the "General" tab under "Connection identification", change the "Local ID:" to a descriptive name like AS1, for example.</p> <p>Click on the "OK" button to confirm your settings.</p>	
4.	<p>Also create a connection between the Standby OS and the AS by repeating steps 1 to 3.</p> <p>When doing this, it is important that the connection has the same name as the connection of the ES to the AS.</p> <p>After this, use the "Network > Save and Compile..." menu item to save the configuration and compile it.</p> <p>Select the "Compile and check everything" option button and click on the "OK" button to confirm your selection.</p>	
5.	<p>Select the ES and download the connections via the shortcut menu: "Download to current project > Selected Stations".</p> <p>Download the Standby OS and the AS in the same way.</p> <p>Then, close NetPro.</p>	

© Siemens AG 2022 All rights reserved

Compiling and loading the user program

Compile the S7 program and download it to the AS.

Compiling the OS project

Compile the OS project of the Standby OS in SIMATIC Manager.

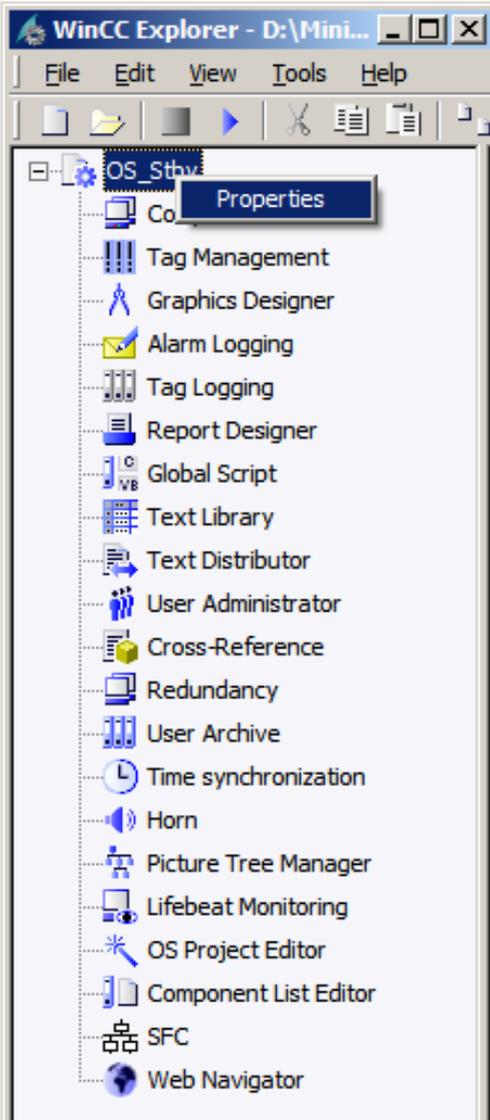
Make sure that you make the correct OS assignment to the server in plant view.

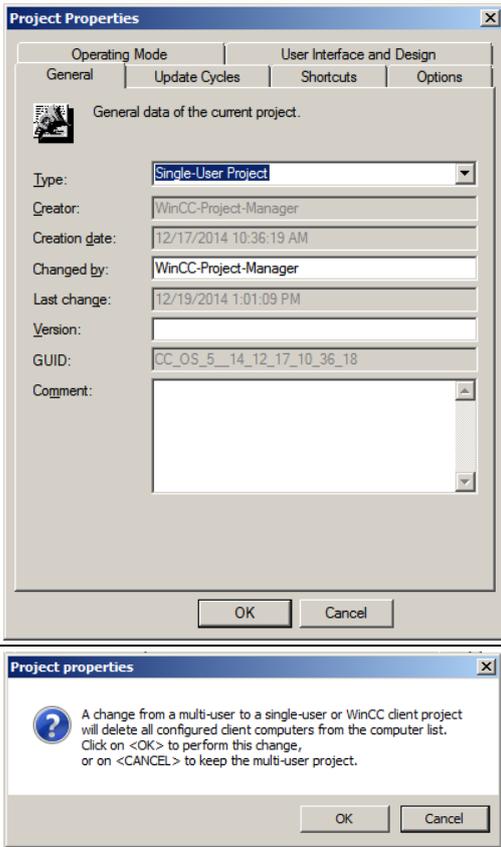
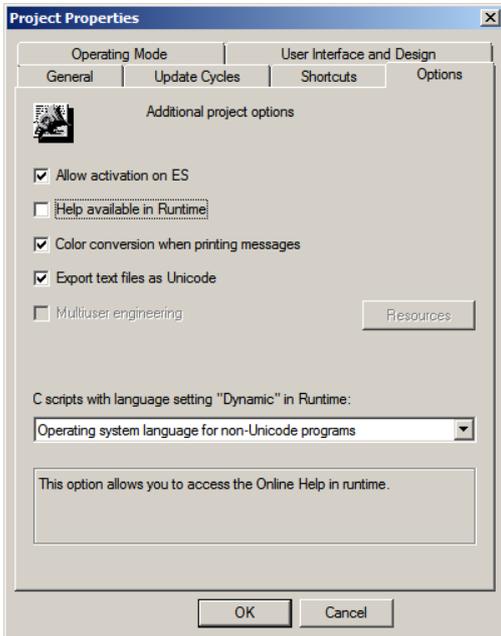
6.3.3 OS configuration

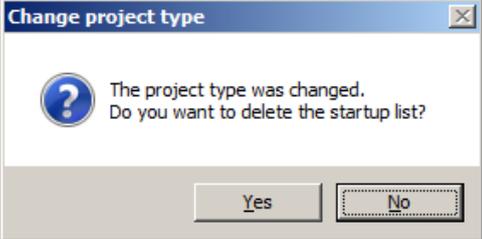
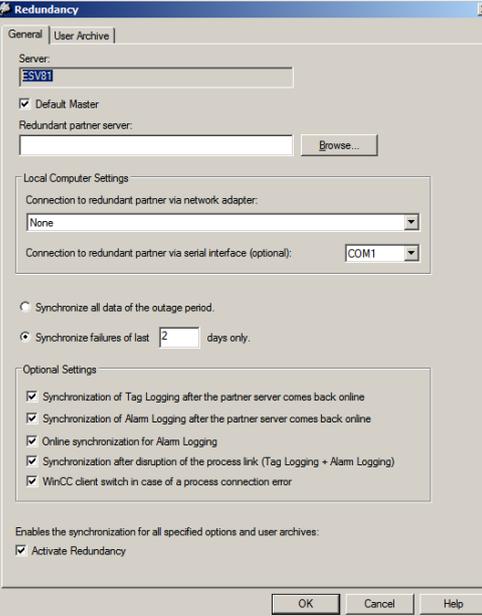
Configuring the OS on the engineering station

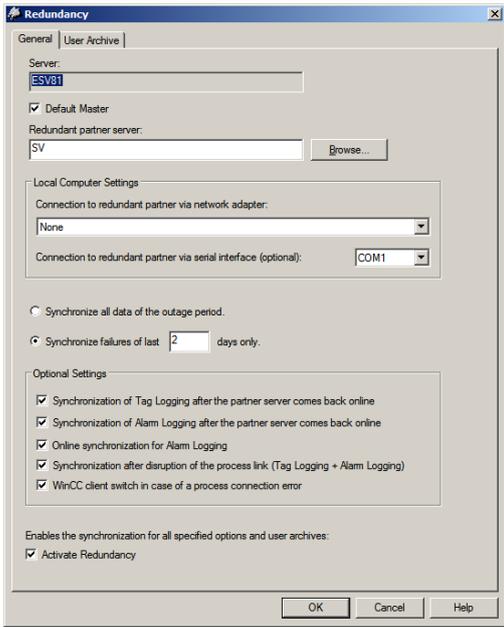
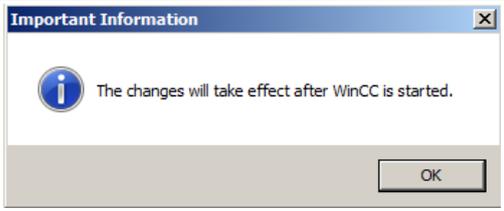
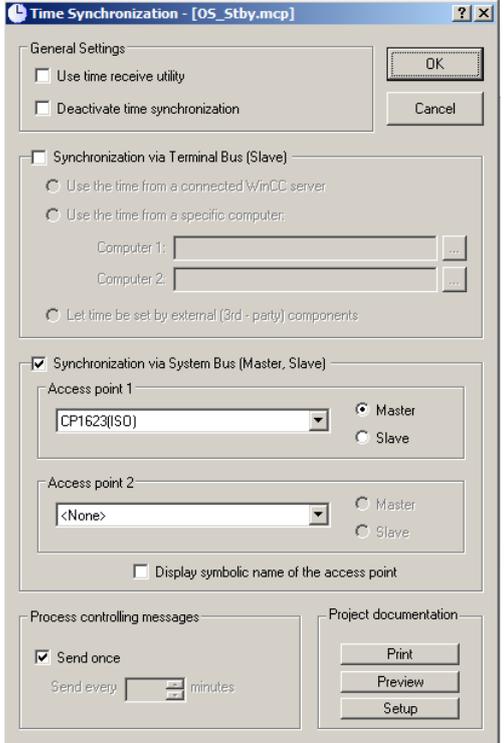
On the ES, you must still switch from a multi-user system to a single-user one and make the settings for redundancy and time synchronization.

Note In this particular configuration, it is necessary to complete the redundancy settings in WinCC Explorer of the Standby OS after the entire download completes.

Step	Activity	Screenshot
1.	<p>Open the OS project of the Standby OS in the ES.</p> <p>In the open WinCC Explorer, highlight the OS project and choose "Properties" in the shortcut menu.</p>	 <p>The screenshot shows the WinCC Explorer interface. The title bar reads 'WinCC Explorer - D:\Mini...'. The menu bar includes 'File', 'Edit', 'View', 'Tools', and 'Help'. The toolbar contains icons for file operations. The main pane shows a tree view with 'OS_Standby' selected. A context menu is open over 'OS_Standby', with 'Properties' highlighted. Other items in the menu include 'Co...', 'Tag Management', 'Graphics Designer', 'Alarm Logging', 'Tag Logging', 'Report Designer', 'Global Script', 'Text Library', 'Text Distributor', 'User Administrator', 'Cross-Reference', 'Redundancy', 'User Archive', 'Time synchronization', 'Horn', 'Picture Tree Manager', 'Lifebeat Monitoring', 'OS Project Editor', 'Component List Editor', 'SFC', and 'Web Navigator'. A status bar at the bottom says 'Press F1 for Help.'</p>

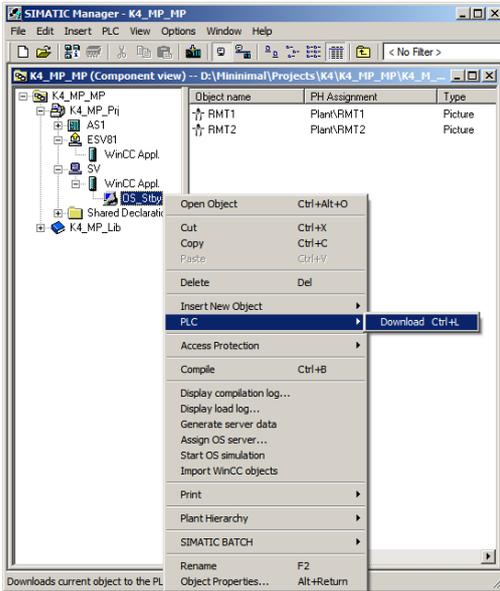
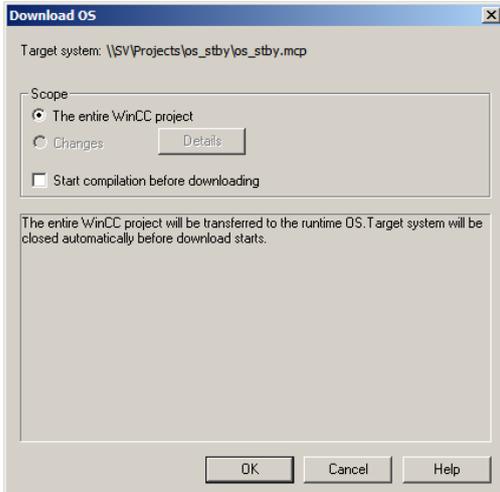
Step	Activity	Screenshot
2.	<p>On the "General" tab under "Type:", choose "Single-User Project" from the drop-down list.</p> <p>Confirm your settings and the displayed message by clicking on the "OK" button.</p>	
3.	<p>Activate OS project option "Allow activation on ES" from the "Options" tab. This setting allows runtime to be activated in the ES.</p> <p>Then click on the "OK" button.</p>	

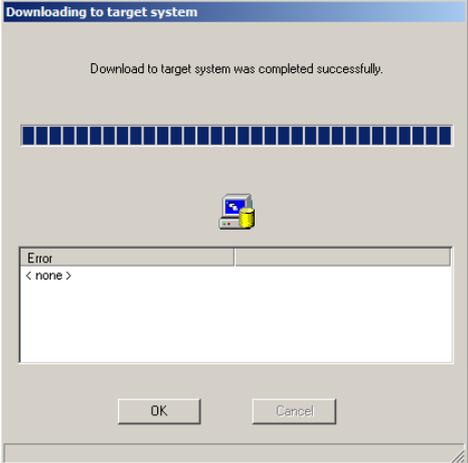
Step	Activity	Screenshot
4.	<p>Click on the "No" button to prevent the startup list from being deleted. Confirm the displayed message by clicking on "OK".</p>	
5.	<p>Open the "Redundancy" editor. Select the "Activate Redundancy" checkbox. Select the "Default Master" checkbox. If necessary, adapt the redundancy properties in "Optional Settings" to meet your requirements. In the drop-down list, select the connection path that is used to connect the Master OS and the Standby OS.</p>	
6.	<p>To complete the redundancy settings for the ES, the partner server must be still selected. To do this, click on the "Search ..." button and select the Standby OS as a redundant partner from the network. Click on the "OK" button to confirm your settings.</p>	

Step	Activity	Screenshot
7.	Double check all of the options before clicking on the "OK" button to confirm the redundancy settings.	
8.	Click on the "OK" button to acknowledge the message.	
9.	Open the "Time Synchronization" editor. Here, select the "Synchronization via System Bus (Master, Slave)" checkbox. Under "Access point 1", choose "CP1623(ISO)" and select the "Master" radio button. Click on the "OK" button to confirm your settings. NOTE If you configure station time synchronization on a different computer, the access points are not known, which means that they are not available in the drop-down list. To choose the access point regardless, select the "Display symbolic name of the access point" checkbox and then choose the appropriate access point.	
10.	Close the OS project.	

Downloading the OS project to the Standby OS

Once redundancy and time synchronization have been configured on the ES and you have closed the OS project again, download the OS project to the Standby OS.

Step	Activity	Screenshot
1.	<p>In SIMATIC Manager, highlight the Standby OS and choose "PLC -> Download" in the shortcut menu.</p>	
2.	<p>For the first OS project download, an entire download is required. Click on the "OK" button to start downloading.</p>	

Step	Activity	Screenshot
3.	<p>After successful downloading, the OS project is located in the specified folder on the Standby OS.</p> <p>Click on the "OK" button to confirm the message that is issued.</p>	

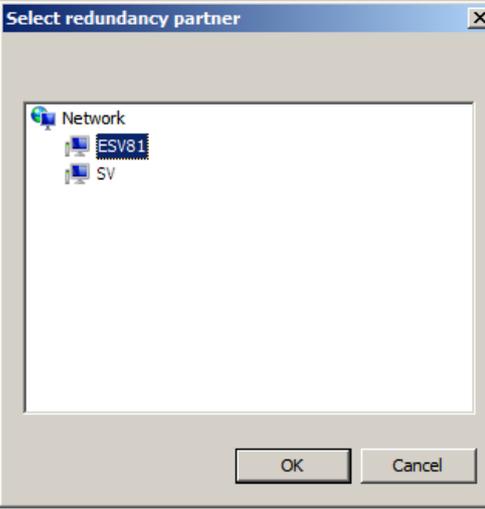
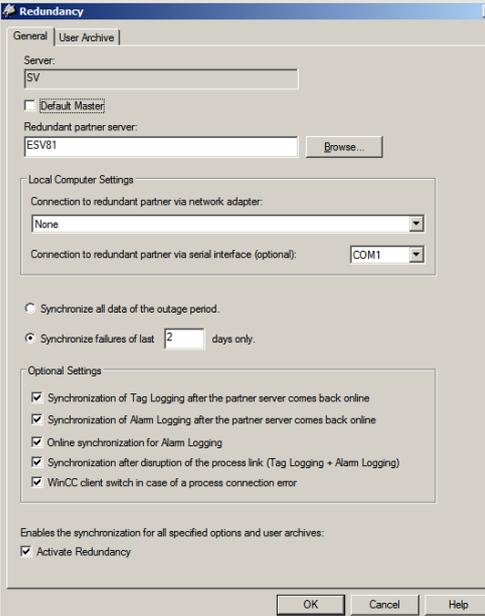
OS configuration on the Standby OS

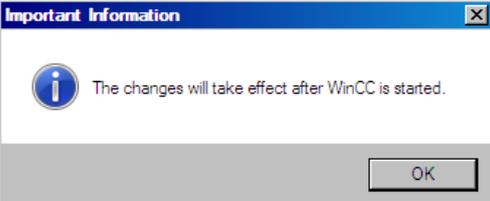
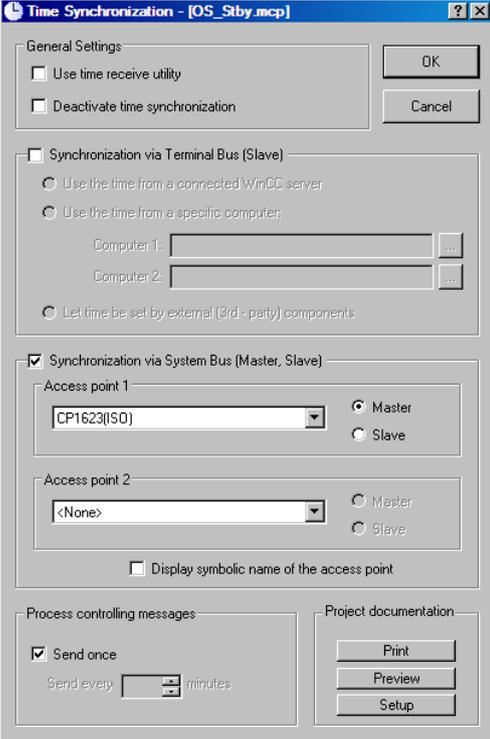
In this particular configuration, it is necessary to make the redundancy settings after the download completes.

Generally, we would advise you to check the project settings after the project has been downloaded to the target systems.

Note

Normally, all configuration work is carried out on the ES to ensure consistent data management. This means that no WinCC engineering licenses are needed on the OSes. However, each time WinCC Explorer is opened, a license-free time window of two hours is available for WinCC configuration work.

Step	Activity	Screenshot
1.	Open the OS project on the Standby OS under the shared project folder.	
2.	<p>Open the "Redundancy" editor from the shortcut menu.</p> <p>Click on the "Search..." button to select the ES computer as the redundant partner.</p>	
3.	<p>Clear the "Default Master" checkbox here. Check whether you have selected the desired checkboxes under "Optional Settings".</p> <p>In the drop-down list, select the connection path that is used to connect the Master OS and the Standby OS.</p> <p>Click on the "OK" button to confirm your settings.</p>	

Step	Activity	Screenshot
4.	Click on the "OK" button to acknowledge the message.	
5.	<p>Open the "Time Synchronization" editor from the shortcut menu.</p> <p>Check or select the "Synchronization via System Bus (Master, Slave)" checkbox. Under "Access point 1", check or select "CP1623(ISO)" and the "Master" radio button.</p> <p>Always click on the "OK" button to confirm your settings.</p>	
6.	If you have made project changes in WinCC Explorer, close the OS project and open it again for the settings to take effect.	

© Siemens AG 2022. All rights reserved.

6.3.4 Activating runtime

First activate the OS project on the ES and then on the Standby OS. Before activating the second runtime, it is advisable to wait until the boot process of the first one has completed.

Online synchronization is active immediately.
Mutual synchronization of archives starts after ten minutes.

6.3.5 Particularities when loading OS project changes

Loading changes

To download changes, runtime must be stopped on the ES when compiling the OS. These can then be re-activated to test the modified OS functions.

CAUTION Depending on the changes that are made, if runtime remains active during OS compilation, the system may not download changes completely, which will cause errors. If this happens, only an entire download is possible.

For the downloading process, runtime must be terminated and the OS Project must be closed. As a result, it is not possible to take operator actions on the ES computer during this time.

Complete download

For a complete download, the following must be always observed:

1. Runtime must be deactivated on both PC stations and the OS project must be closed.
2. Before re-enabling runtime on the Standby OS, you must make the redundancy settings again.
To do this, repeat the steps in the table on page 107.

7 Expansion with the PCS 7 OS Web Option

Positioning

To control automated processes via the Internet/Intranet, SIMATIC PCS 7 provides operating and monitoring options: what are known as the "Web Options".

This chapter describes configuration of the Web Option on an ES/OS Single Station. The instructions can also be used to expand the following minimal configurations:

- ES/OS Single Station (Chapter 3)
- ES/OS Master and OS Standby (Chapter 6)

Note

To expand the redundant Single Station configuration with the Web Option, the ES/OS station in the following example has been configured as a Web Server. The partner OS could also be used in the same way as a Web Server. The functionality for the Web clients is unchanged.

Redundancy of the operator stations is not available for Web clients. If the OS with the Web Server option is in the STOP status, the Web clients do not have a connection to the process either.

Function

All of the relevant pictures and scripts are stored on the Web Server to make it possible to display or run them via a Web client.

The Web client accesses the system data provided by the Web Server via a TCP/IP connection. The user interface matches the appearance of a standard OS client with an overview, work, and key areas.

Amongst others, the functions below are available via Web:

- Operator control and monitoring functions, which are also used on an OS client
- Message lists that are called on a user-dependent basis, just like on an OS client. Messages can be acknowledged on a user-dependent basis.
- Displaying the picture hierarchy according to the plant hierarchy
- Group display function including the "loop-in-alarm" function
- Enhanced status display

Note

For further information about the PCS 7 Web Options, see the following manual: "SIMATIC PCS 7 Web Option for OS "

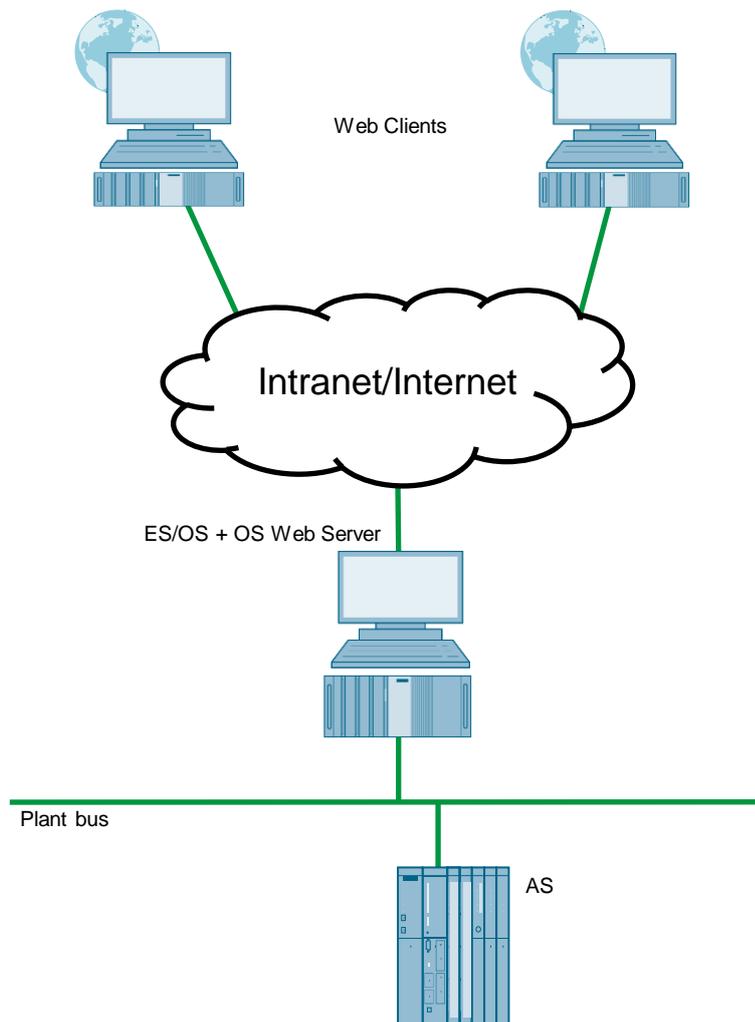
<https://support.industry.siemens.com/cs/ww/en/view/109805408>

7.1 Web configurations

In our example, configuration of the Web Option is an extension to the hardware and software configurations in chapter 3, "ES/OS Single Station" and chapter 6 "Master ES/OS and Standby OS".

ES/OS Single Station with OS Web Server option

To operate and monitor the system process, the OS Web clients use Internet Explorer to get their project data from the Single Station with the OS Web Server option via the Internet/Intranet.

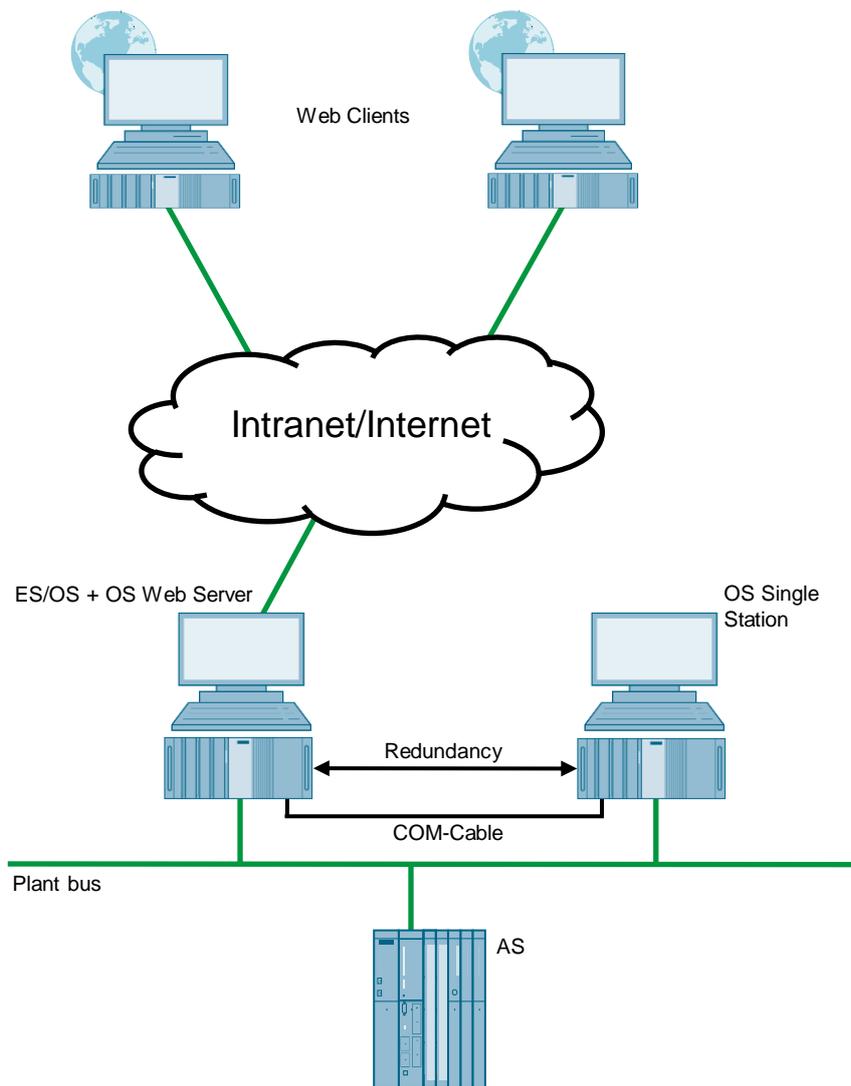


Master ES/OS with OS Web Server option

To operate and monitor the system process, the OS Web clients use Internet Explorer to get their project data from the Single Station with the OS Web Server option via the Intranet/Intranet.

In addition, the system process is set up on a redundant basis to offer the greatest possible protection from failure of system operation.

CAUTION Redundancy of the operator stations is not available for Web clients. If the OS with the Web Server option is in the STOP status, the Web clients do not have a connection to the process.



7.2 Web-specific hardware and software requirements

Single Station with Web Server option

Property	Requirement
Operating system	<ul style="list-style-type: none"> Windows 10 Enterprise 2019 LTSC Windows Server 2019 <p>You can find further information in the document entitled "SIMATIC PCS 7 process control system PCS 7 Readme" https://support.industry.siemens.com/cs/ww/en/view/109801032</p>
Hardware	<ul style="list-style-type: none"> SIMATIC PCS 7 ES/OS IPC847E BCE SIMATIC PCS 7 ES/OS IPC847E IE <p>You can find information on this topic in the document entitled "SIMATIC PCS 7 process control system PCS 7 Readme" https://support.industry.siemens.com/cs/ww/en/view/109801032</p>
Software	<ul style="list-style-type: none"> Internet Explorer Internet Information Services (IIS)
Miscellaneous	Fast access (\geq 64 kbps) to the Web Client via Internet/Intranet or a TCP/IP connection

Web Client

Property	Requirement
Operating systems	<ul style="list-style-type: none"> Windows 10 Enterprise 2019 LTSC Windows Server 2019 <p>You can find further information in the document entitled "SIMATIC PCS 7 process control system PCS 7 Readme" https://support.industry.siemens.com/cs/ww/en/view/109801032</p>
Minimum hardware requirements	No PDAs, tablet PCs etc.
Software	Internet Explorer
Miscellaneous	Fast access (\geq 64 kbit/s) to the Web client via Internet/Intranet or a TCP/IP connection

Note

Choose the version of Internet Explorer to match the PCS 7 version. You can find more information by visiting the "Compatibility Tool for Automation and Drive Technology" at: <http://www.siemens.de/kompatool>

Software licensing

The following section lists the various additional software/license packages that you need for the selected configuration.

Component	Software/license packages
Single Station with Web Server option	<ul style="list-style-type: none"><li data-bbox="740 432 1166 456">• SIMATIC PCS 7 Web Server Basic<li data-bbox="740 461 1318 486">• SIMATIC PCS 7 Web Server license (cumulative)

7.3 Maximum number of Web client connections

In one OS Single Station, it is possible to operate a maximum of three Web clients per Web server at the same time.

7.4 Configuring the OS Web Server

Configuration steps on the ES

- Publish pictures using Web View Publisher
- Configure user rights, start screen, and the language of the website in the User Administrator
- Download and compile the Web server

Publishing OS data

The Web Publisher makes it possible to publish pictures and scripts on the OS Web Server, which are intended to run later on the Web clients. In this connection, the following actions are carried out:

- Project data is compressed and saved
- Picture windows are converted to Internet-enabled ActiveX components
- Scripts are converted so that they run on the Web

Requirements

To publish the Web Server data, the following requirements must be met:

- The hardware and software requirements mentioned in chapter 7.2 have been met.
- The "PCS 7 Web Server" software package have been installed on the ES/OS Single Station.
- The PCS 7 Project is available and fully configured.
- "OS compiling" has been carried out.
- The scripts that are accessed by the Web clients are present.
- Process pictures do not contain double underscores (e.g. yy__xx.pdl).
- Tag names in plain text (quotation marks) within C scripts do not contain any spaces.

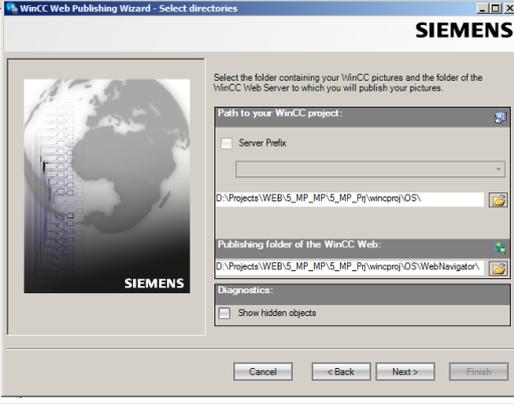
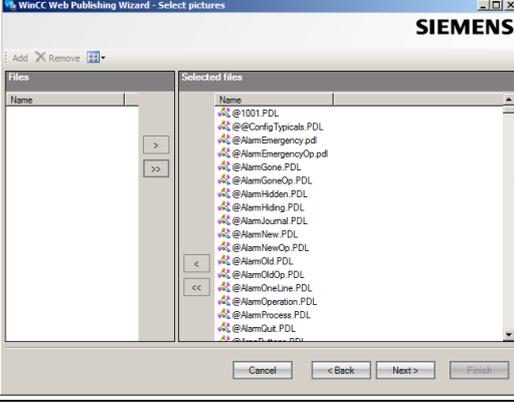
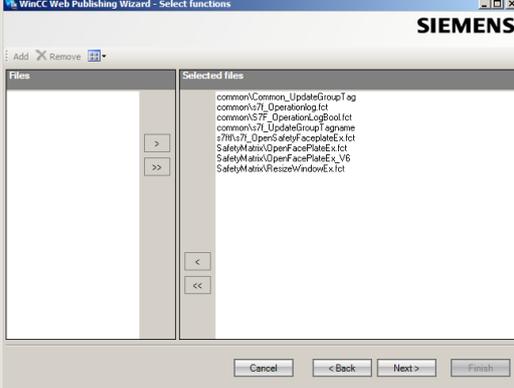
Note

In a Single Station, only one publishing process is needed to publish local data on the Web Server.

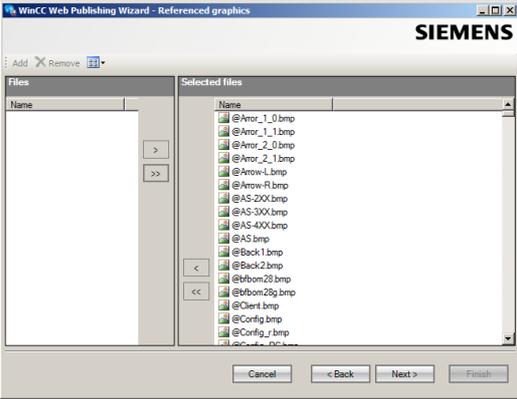
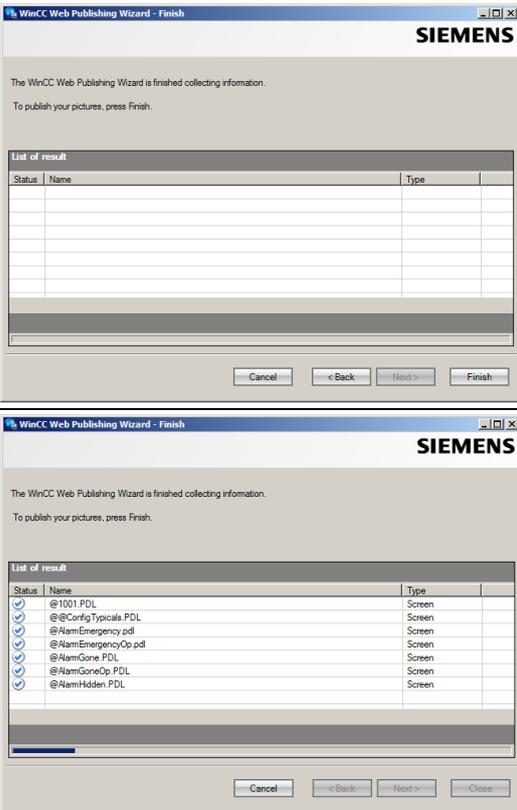
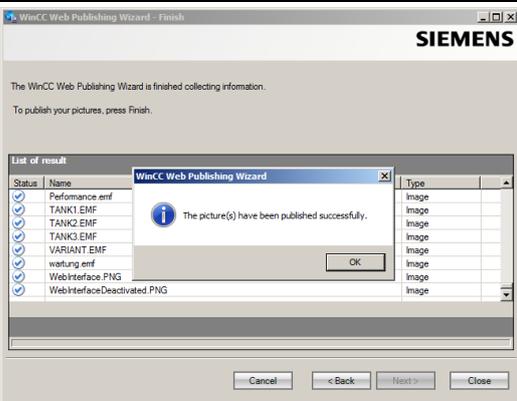
For information on the topic of "supported script standard functions", refer to the "SIMATIC PCS 7 Web Option for OS" manual.

<https://support.industry.siemens.com/cs/ww/en/view/109805408>
("Web-enabled functions for the Web Option for OS")

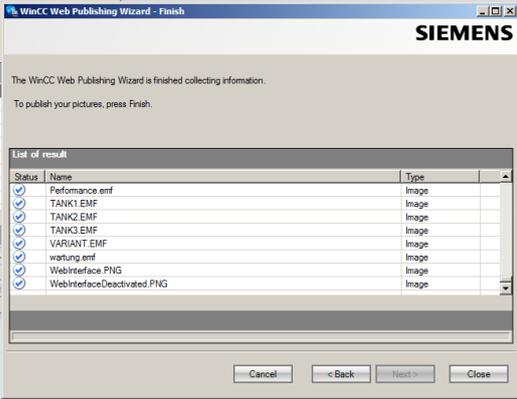
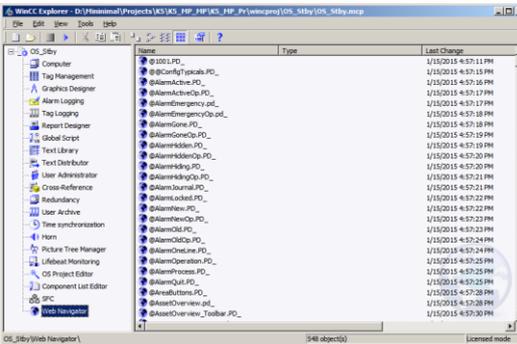
7.4.1 Publishing project data

Step	Action	Note
1.	<p>Open the OS project of the OS Web Server in WinCC Explorer.</p> <p>Using the shortcut menu of the "Web Navigator" editor, select the "Web View Publisher" command.</p> <p>The system opens the "WinCC Web Publishing Wizard - Introduction" dialog box.</p> <p>Click on "Continue".</p>	
2.	<p>This opens the "WinCC Web Publishing Wizard – Select files and folders" dialog box.</p> <p>Clear the "Server Prefix" checkbox, since you want to publish local data.</p> <p>Accept the default destination and source paths. If you really want to change the respective path, click on the button behind the grayed entry fields. Navigate to the desired target or source folder.</p> <p>Click on "Continue".</p>	
3.	<p>The system opens the "WinCC Web Publishing Wizard - Select pictures" dialog box.</p> <p>Select all of the pictures that you want to publish. We recommend publishing all of the standard pictures.</p> <p>Use the ">>", "<<", ">", and "<" buttons to select the pictures.</p> <p>Click on "Continue".</p>	
4.	<p>The system opens the "WinCC Web Publishing Wizard - Select functions" dialog box.</p> <p>Select all of the functions that you want to publish. In the pictures, only the scripts are available that you selected during the last publication process. This means that you must select all the necessary functions at every publication process.</p> <p>Use the ">>", "<<", ">", and "<" buttons to select the functions.</p> <p>Click on "Continue".</p>	

7 Expansion with the PCS 7 OS Web Option

Step	Action	Note
5.	<p>The system opens the "WinCC Web Publishing Wizard - Referenced graphics" dialog box.</p> <p>Select all of the graphics that you want to publish. We recommend publishing all of the graphics.</p> <p>Use the ">>", "<<", ">", and "<" buttons to select the graphics.</p> <p>Click on "Continue".</p>	
6.	<p>The system opens the "WinCC Web Publishing Wizard - Finish" dialog box.</p> <p>Click on the "Finish" button.</p>	
7.	<p>Pictures and functions that contain faulty scripts are identified by a red cross.</p> <p>Double-click on each faulty picture to open the picture in the "PdIPad" editor and to correct it.</p> <p>Once the publishing process is complete, click on the "OK" button to confirm the message.</p>	

7 Expansion with the PCS 7 OS Web Option

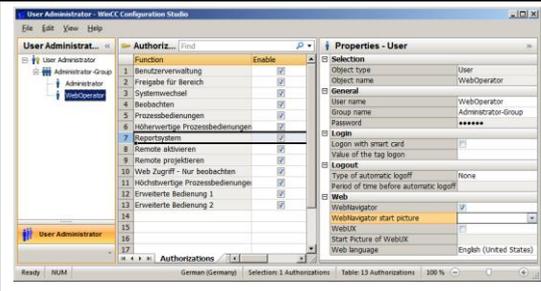
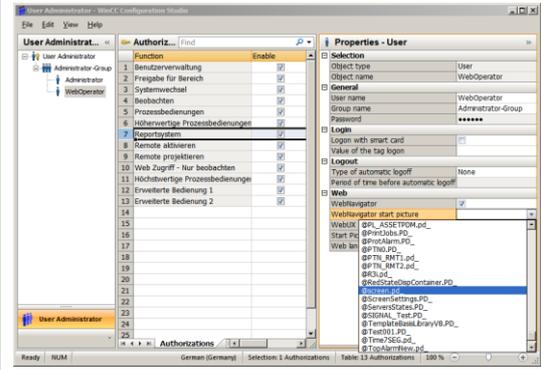
Step	Action	Note
8.	<p>The system lists the transferred pictures in the "WinCC Web Publishing Wizard – Finish" dialog box.</p> <p>Click on the "Finish" button.</p>	
9.	<p>The published pictures are displayed in the data window of the Web Navigator.</p>	

7.4.2 Setting up user rights, website start screen, and the language

Restriction of access

You can control the access of the Web client to the OS Web Server by defining user rights. You assign user rights in the "User Administrator" editor. User rights are the same as those of the standard clients.

Settings in the "User Administrator" editor

Step	Action	Note
1.	<p>In the WinCC Explorer of the currently open OS project, open the "User Administrator" editor.</p> <p>Create new users and/or new user groups that you want to assign appropriate permissions to.</p> <p>Also select the "Web Navigator" checkbox for the user(s) or user group(s) and enter the "Start picture" and "Language" of the website in the corresponding input fields.</p>	
2.	<p>Use the "..." button to select the start picture from the published graphics.</p> <p>"...\OS Web Server\<wincc-projectshare-name>\Web Navigator\pictures"</p> <p>Choose the "@screen.pd_" graphic as the start picture.</p> <p>Click on the "Open" button to confirm your selection</p> <p>You can also specify a language for the control and monitoring interface of the Web clients. To do this, you must also click on the corresponding "..." button.</p> <p>Click on the "OK" button to confirm your selection.</p>	
3.	Close the User Administrator Editor.	

7.4.3 Configuring using the Web Configurator

Web Configurator tasks

The Web Configurator enables you to configure and manage the Internet Information Service (IIS) and therefore the website of the OS Web Server. You make the setting on the Web Server after you have downloaded the project to the Web Server. Setup and configuration are necessary to set up an operating station (OS) as an OS Web Server and to make it accessible for the Web clients via the Intranet/Internet.

The Web Configurator allows you to make the necessary firewall settings, if a firewall is activated.

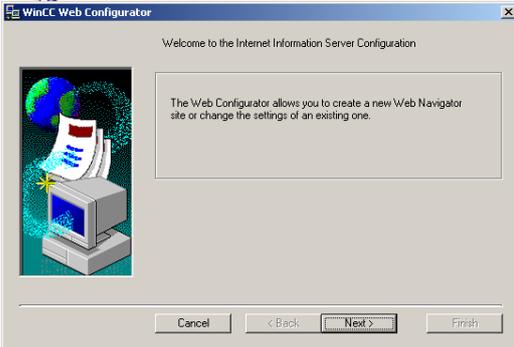
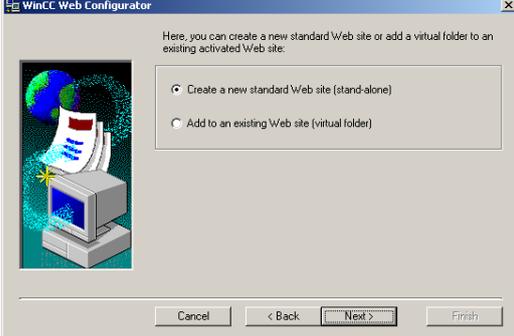
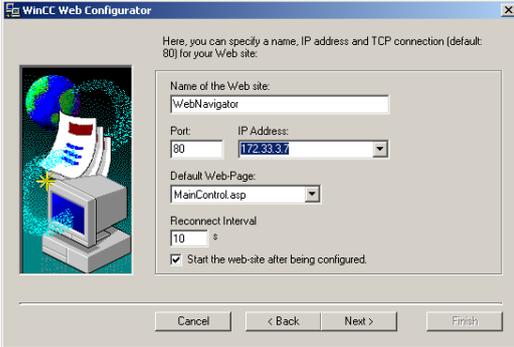
Requirements of the Single Station

- The PCS 7 Web Server software has been installed on the Single Station
- The OS project has been downloaded to the Single Station
- All settings have been made in the OS
- Pictures, functions, and graphics have been published
- User rights have been assigned

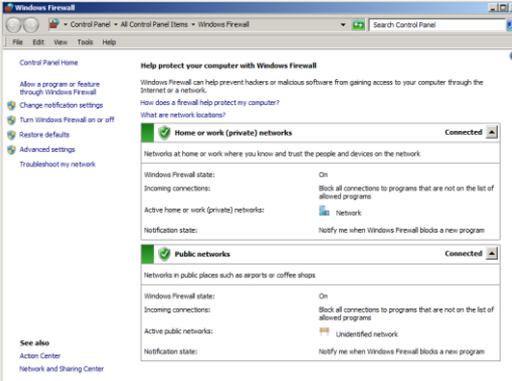
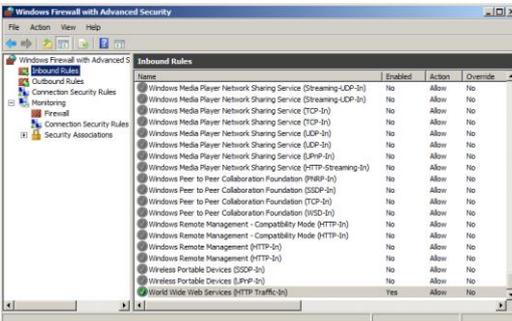
Note

For more information about setting up the standard Web site, refer to the manual entitled "SIMATIC PCS 7 Web Option for OS"
<https://support.industry.siemens.com/cs/ww/en/view/109805408>
Chapter: "Completing the configuration on the Web server"

Settings in the "Web Navigator" editor

Step	Action	Note
1.	<p>Open the OS project in WinCC Explorer on the OS Web Server.</p> <p>Use the shortcut menu of the "Web Navigator" editor to select the "Web Configurator" command.</p> <p>The system opens the "WinCC Web Configurator" dialog box.</p> <p>Click on "Continue".</p>	
2.	<p>In the next window, select "Create a new standard Web site (stand-alone)".</p> <p>Click on "Continue".</p>	
3.	<p>Enter a name for your web site in the "Name of the Web site" text box.</p> <p>Also assign the IP address and connection port of the computer in the "Port" and "IP address" text boxes.</p> <p>Under "Default Web-Page", select "MainControl" from the drop-down list.</p> <p>Enter a time interval in the "Reconnect Interval" text box.</p> <p>Select the "Start the web-site after being configured" checkbox.</p> <p>Click on "Continue".</p> <p>If you have not activated the Windows firewall, continue with step "7".</p>	
4.	<p>Click on the "Windows Firewall" button (the button is only visible if the firewall is activated).</p>	

7 Expansion with the PCS 7 OS Web Option

Step	Action	Note
5.	Click the "Advanced Settings" button in the "Windows Firewall" dialog box.	
6.	Check whether the "World Wide Web Services (HTTP Traffic-In) inbound rule is activated. If this function is deactivated, highlight it and choose the "Enable" command in the shortcut menu.	
7.	Click on the "Finish" button.	
8.	Click on the "OK" button. Then, close WinCC Explorer and restart your computer to apply the settings.	

7.4.4 Downloading and compiling the Web Server

Downloading the Web Server

Since the OS Web Server function is on a Single Station (ES/OS/Web Server), it is not necessary to carry out downloading or change downloading of project data. Due to the "Compile OS", the necessary data is already present locally.

Compile

The "Compile Changes" function can be executed in Single Station without having to interrupt the process mode of the Web Server.

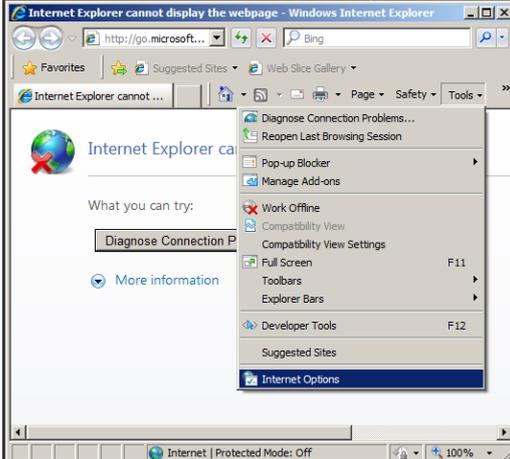
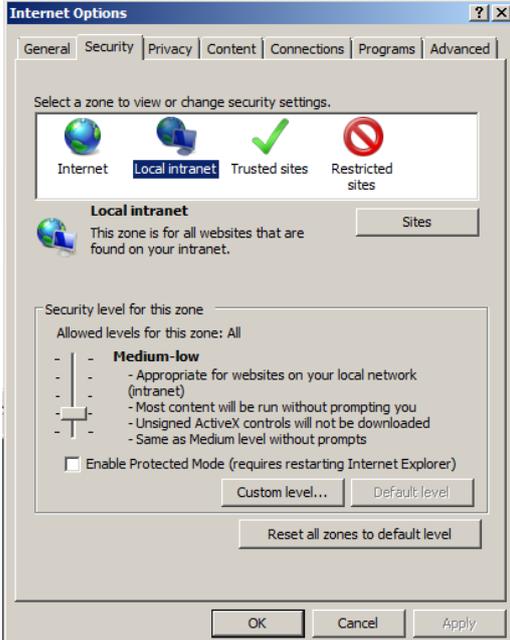
Note

For more information about "Configuring the OS Web Server", refer to the manual entitled "SIMATIC PCS 7 Web Option for OS"
<https://support.industry.siemens.com/cs/ww/en/view/109805408>
(Chapter: "Configuring the Web server on an ES")

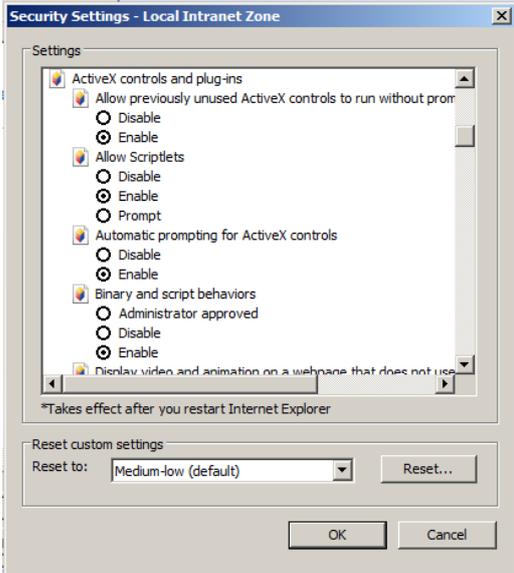
7.5 Settings on the Web client

Settings for the "Internet" or "Local Intranet" Web content zone

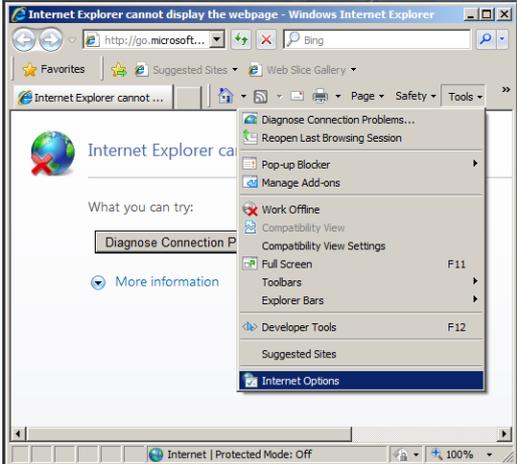
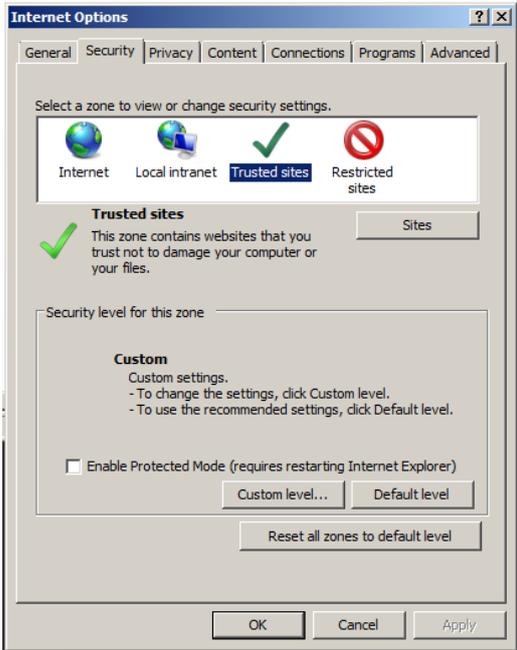
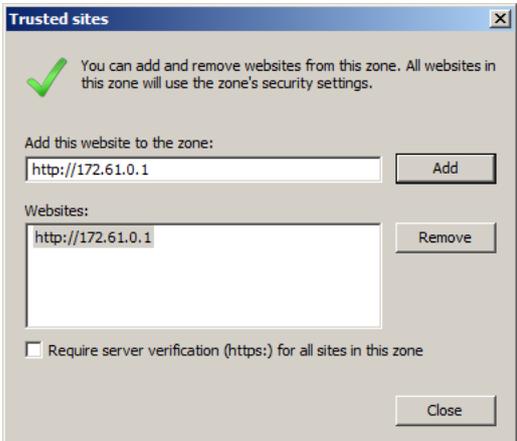
In Internet Explorer, you must make/check the settings for the Web content zone such that you will be able to install the plug-ins for the Web client from the OS Web server later.

Step	Action	Note
1.	<p>Open Internet Explorer. Select the "Tools > Internet Options" menu command.</p>	 <p>The screenshot shows the Internet Explorer browser window with the title bar 'Internet Explorer cannot display the webpage - Windows Internet Explorer'. The address bar contains 'http://go.microsoft...'. The Tools menu is open, showing options like 'Diagnose Connection Problems...', 'Work Offline', 'Compatibility View', and 'Internet Options' at the bottom.</p>
2.	<p>Click on the "Security" tab. Highlight the Web content zone in which the Web server is located ("Internet" or "Local intranet"). Click on the "Custom Level" button.</p>	 <p>The screenshot shows the 'Internet Options' dialog box with the 'Security' tab selected. Under 'Select a zone to view or change security settings', the 'Local intranet' zone is highlighted with a blue border and a green checkmark. Below, the 'Security level for this zone' is set to 'Medium-low'. The 'Custom level...' button is visible at the bottom.</p>

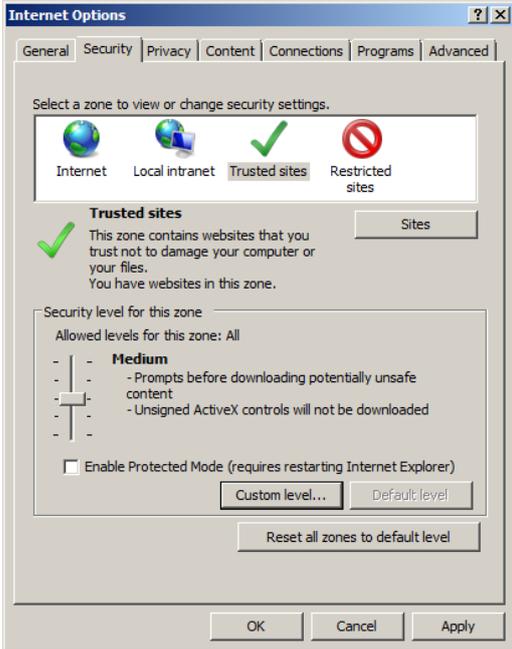
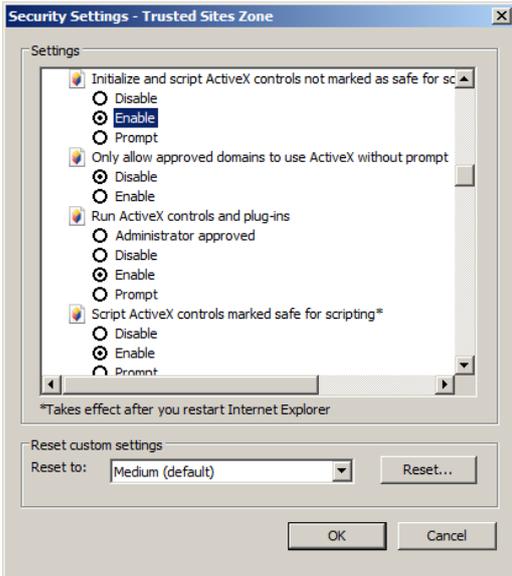
7 Expansion with the PCS 7 OS Web Option

Step	Action	Note
3.	Select the radio buttons under "Run ActiveX controls that are safe for scripting" and "Download signed ActiveX controls".	
4.	Click on each of the "OK" buttons for the "Security Settings" and "Internet Options" dialog boxes to close them.	

Settings for the "Trusted sites" Web content zone

Step	Action	Note
1.	<p>Open Internet Explorer. Select the "Tools > Internet Options" menu command.</p>	
2.	<p>Click on the "Security" tab. Highlight the "Trusted sites" Web content zone. Click on the "Sites" button to open the dialog box.</p>	
3.	<p>In the text box "Add this website to the zone", enter the address of the OS Web server (7.4.3 Configuring with the Web Configurator > Settings in the "Web Navigator" editor), e.g. <code>*://172.61.0.1</code> or http://*.microsoft.com Also, clear the "Require server verification (https:)" for all sites in this zone" checkbox. Click on the "Add" and "Close" buttons.</p>	

7 Expansion with the PCS 7 OS Web Option

Step	Action	Note
4.	<p>Highlight the "Trusted sites" Web content zone.</p> <p>Click on the "Default level" button and then on the "Custom level" button.</p>	
5.	<p>In the "Security Settings" dialog box, select the radio button under "Initialize and script ActiveX controls not marked as safe for scripting".</p>	
6.	<p>Click on each of the "OK" buttons for the "Security Settings" and "Internet Options" dialog boxes to close them.</p>	

You have now created the conditions that are needed to connect from a Web client to a Web server.

7.6 Installing the Web client plug-ins

Installation methods

During installation of plug-ins for Internet Explorer, you can choose between two installation methods:

- Remote Installation - Installation via the Intranet/Internet from the Web server
- Local Installation - Installation via the Windows installer package of the Web client

In this application example, we will consider "remote installation".

Requirements

- The OS Web server is in runtime.
- The "PCS 7 Web Client" software package has been installed on the PC.
- The Web client has access to the Web server.
- You know the Web server's address.
- You know the domain name, user name, and password.
- The user permissions apply to the PCS 7 Web Options.
- The logon on the PC has the rights of a primary user.

Installation

Step	Action	Note
1.	Open Internet Explorer. Enter the web server address (http://<server name or IP>) in the "Address" text box.	
2.	In the "Enter Network Password" dialog box, enter the credentials that were set in the "User Administrator" editor on the Web server.	

7 Expansion with the PCS 7 OS Web Option

Step	Action	Note
3.	When you first connect, the "Security Warning" dialog box opens. Proceed by clicking on the "Install" button.	
4.	The system now displays all of the available plug-ins for the Web client in the Internet Explorer window. To install the plug-in, click on the arrow in front of the version number in the "Install" column. The following plug-ins are installed to ensure a minimum of process control: <ul style="list-style-type: none"> • WinCC Basic Process Control • WinCC Advanced Process Control • PCS 7 Basic Faceplates • PCS 7 Advanced Faceplates During installation, always proceed in the order that is shown.	
5.	Installation of the Web client is complete. Close Internet Explorer and reopen it to register for process control. The process pictures can be called once the Web client has established a connection to the Web server.	

Note

For more information about "Installing a Web client", "Process control on the Web client" and "Settings", refer to the manual entitled "SIMATIC PCS 7 Web Option for OS"

<https://support.industry.siemens.com/cs/ww/en/view/109805408>

(Chapter: "Installation and settings for the Web client")

8 Appendix

8.1 Service and support

Industry Online Support

Do you have any questions or need assistance?

Siemens Industry Online Support offers round the clock access to our entire service and support know-how and portfolio.

The Industry Online Support is the central address for information about our products, solutions and services.

Product information, manuals, downloads, FAQs, application examples and videos – all information is accessible with just a few mouse clicks:

support.industry.siemens.com

Technical Support

The Technical Support of Siemens Industry provides you fast and competent support regarding all technical queries with numerous tailor-made offers – ranging from basic support to individual support contracts.

Please send queries to Technical Support via Web form:

support.industry.siemens.com/cs/my/src

SITRAIN – Digital Industry Academy

We support you with our globally available training courses for industry with practical experience, innovative learning methods and a concept that's tailored to the customer's specific needs.

For more information on our offered trainings and courses, as well as their locations and dates, refer to our web page:

siemens.com/sitrain

Service offer

Our range of services includes the following:

- Plant data services
- Spare parts services
- Repair services
- On-site and maintenance services
- Retrofitting and modernization services
- Service programs and contracts

You can find detailed information on our range of services in the service catalog web page:

support.industry.siemens.com/cs/sc

Industry Online Support app

You will receive optimum support wherever you are with the "Siemens Industry Online Support" app. The app is available for iOS and Android:

support.industry.siemens.com/cs/ww/en/sc/2067

8.2 Industry Mall



The Siemens Industry Mall is the platform on which the entire Siemens Industry product portfolio is accessible. From the selection of products to the order and the delivery tracking, the Industry Mall enables the complete purchasing processing – directly and independently of time and location:

mall.industry.siemens.com

8.3 Links and literature

Table 8-1

No.	Topic
\1\	Siemens Industry Online Support https://support.industry.siemens.com
\2\	Link to this entry page of this application example https://support.industry.siemens.com/cs/ww/de/view/24023824
\3\	

8.4 Change documentation

Table 8-2

Version	Date	Change
V1.0	10/2006	First edition V6.1 SP1
V1.1	11/2006	Revised V6.1 SP1
V1.2	05/2009	Revised V6.1 SP1
V2.1	09/2008	First edition V7.0 SP1
V2.2	12/2008	Correction of table 6-2
V2.3	05/2009	Revision V7.0 SP1
V3.0	05/2009	First edition V7.1
V3.1	05/2009	Revision V7.1
V3.2	11/2009	Extension of the document for V7.1 to include the PCS 7 Web Option (tested for PCS 7 V7.1 and V7.0 SP2)
V2.4	12/2010	Note added: The configuration described in chapter 6, "Master ES/OS and Standby OS" only works in PCS 7 V7.0 SP3 if it has WinCC V6.2 SP3 HF8 or higher.
V3.3	09/2011	Note added: The configuration described in chapter 6, "Master ES/OS and Standby OS" only works in PCS 7 V7.1 SP2 and SP3 if

Version	Date	Change
		it has WinCC V7.0 SP2 HF5 or higher.
V4.0	10/2012	First edition PCS 7 V8.0 Upd1
V4.1	11/2012	Adaptations in the following chapters: <ul style="list-style-type: none"> Chapter 7 "Expansion with the PCS 7 OS Web Option" Chapter 7.1 "Web configurations" Chapter 7.2 "Web-specific hardware and software requirements" New chapter: <ul style="list-style-type: none"> Chapter 7.3 "Maximum number of Web client connections"
V4.2	01/2013	Introduction in chapter 6 "Master ES/OS and Standby OS" has been editorially revised.
V4.3	05/2013	Test and declaration for PCS 7 V8.0 SP1
V4.4	09/2013	License adjustments in chapter 7.1. "Web configurations" in Fig. 7-1 "Web Option in Single Station"
V5.0	02/2015	Test and declaration for PCS 7 V8.1
V6.0	06/2016	Test and declaration for PCS 7 V8.2
V7.0	11/2017	Expansion of time synchronization in chapter 3 "ES/OS Single Station" Test and declaration for PCS 7 V9.0
V7.1	02/2018	Step added (Configuring the standard server) in chapter 5.3.3 "OS configuration" OS Client
V8.0	02/2022	Test and declaration for PCS 7 V9.1